
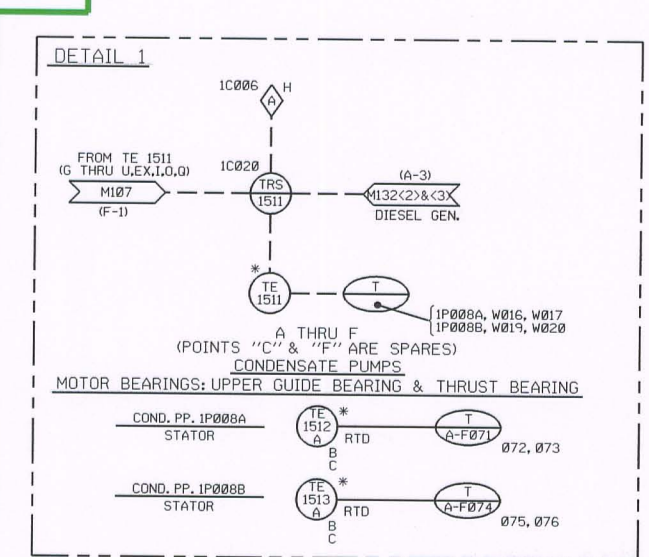


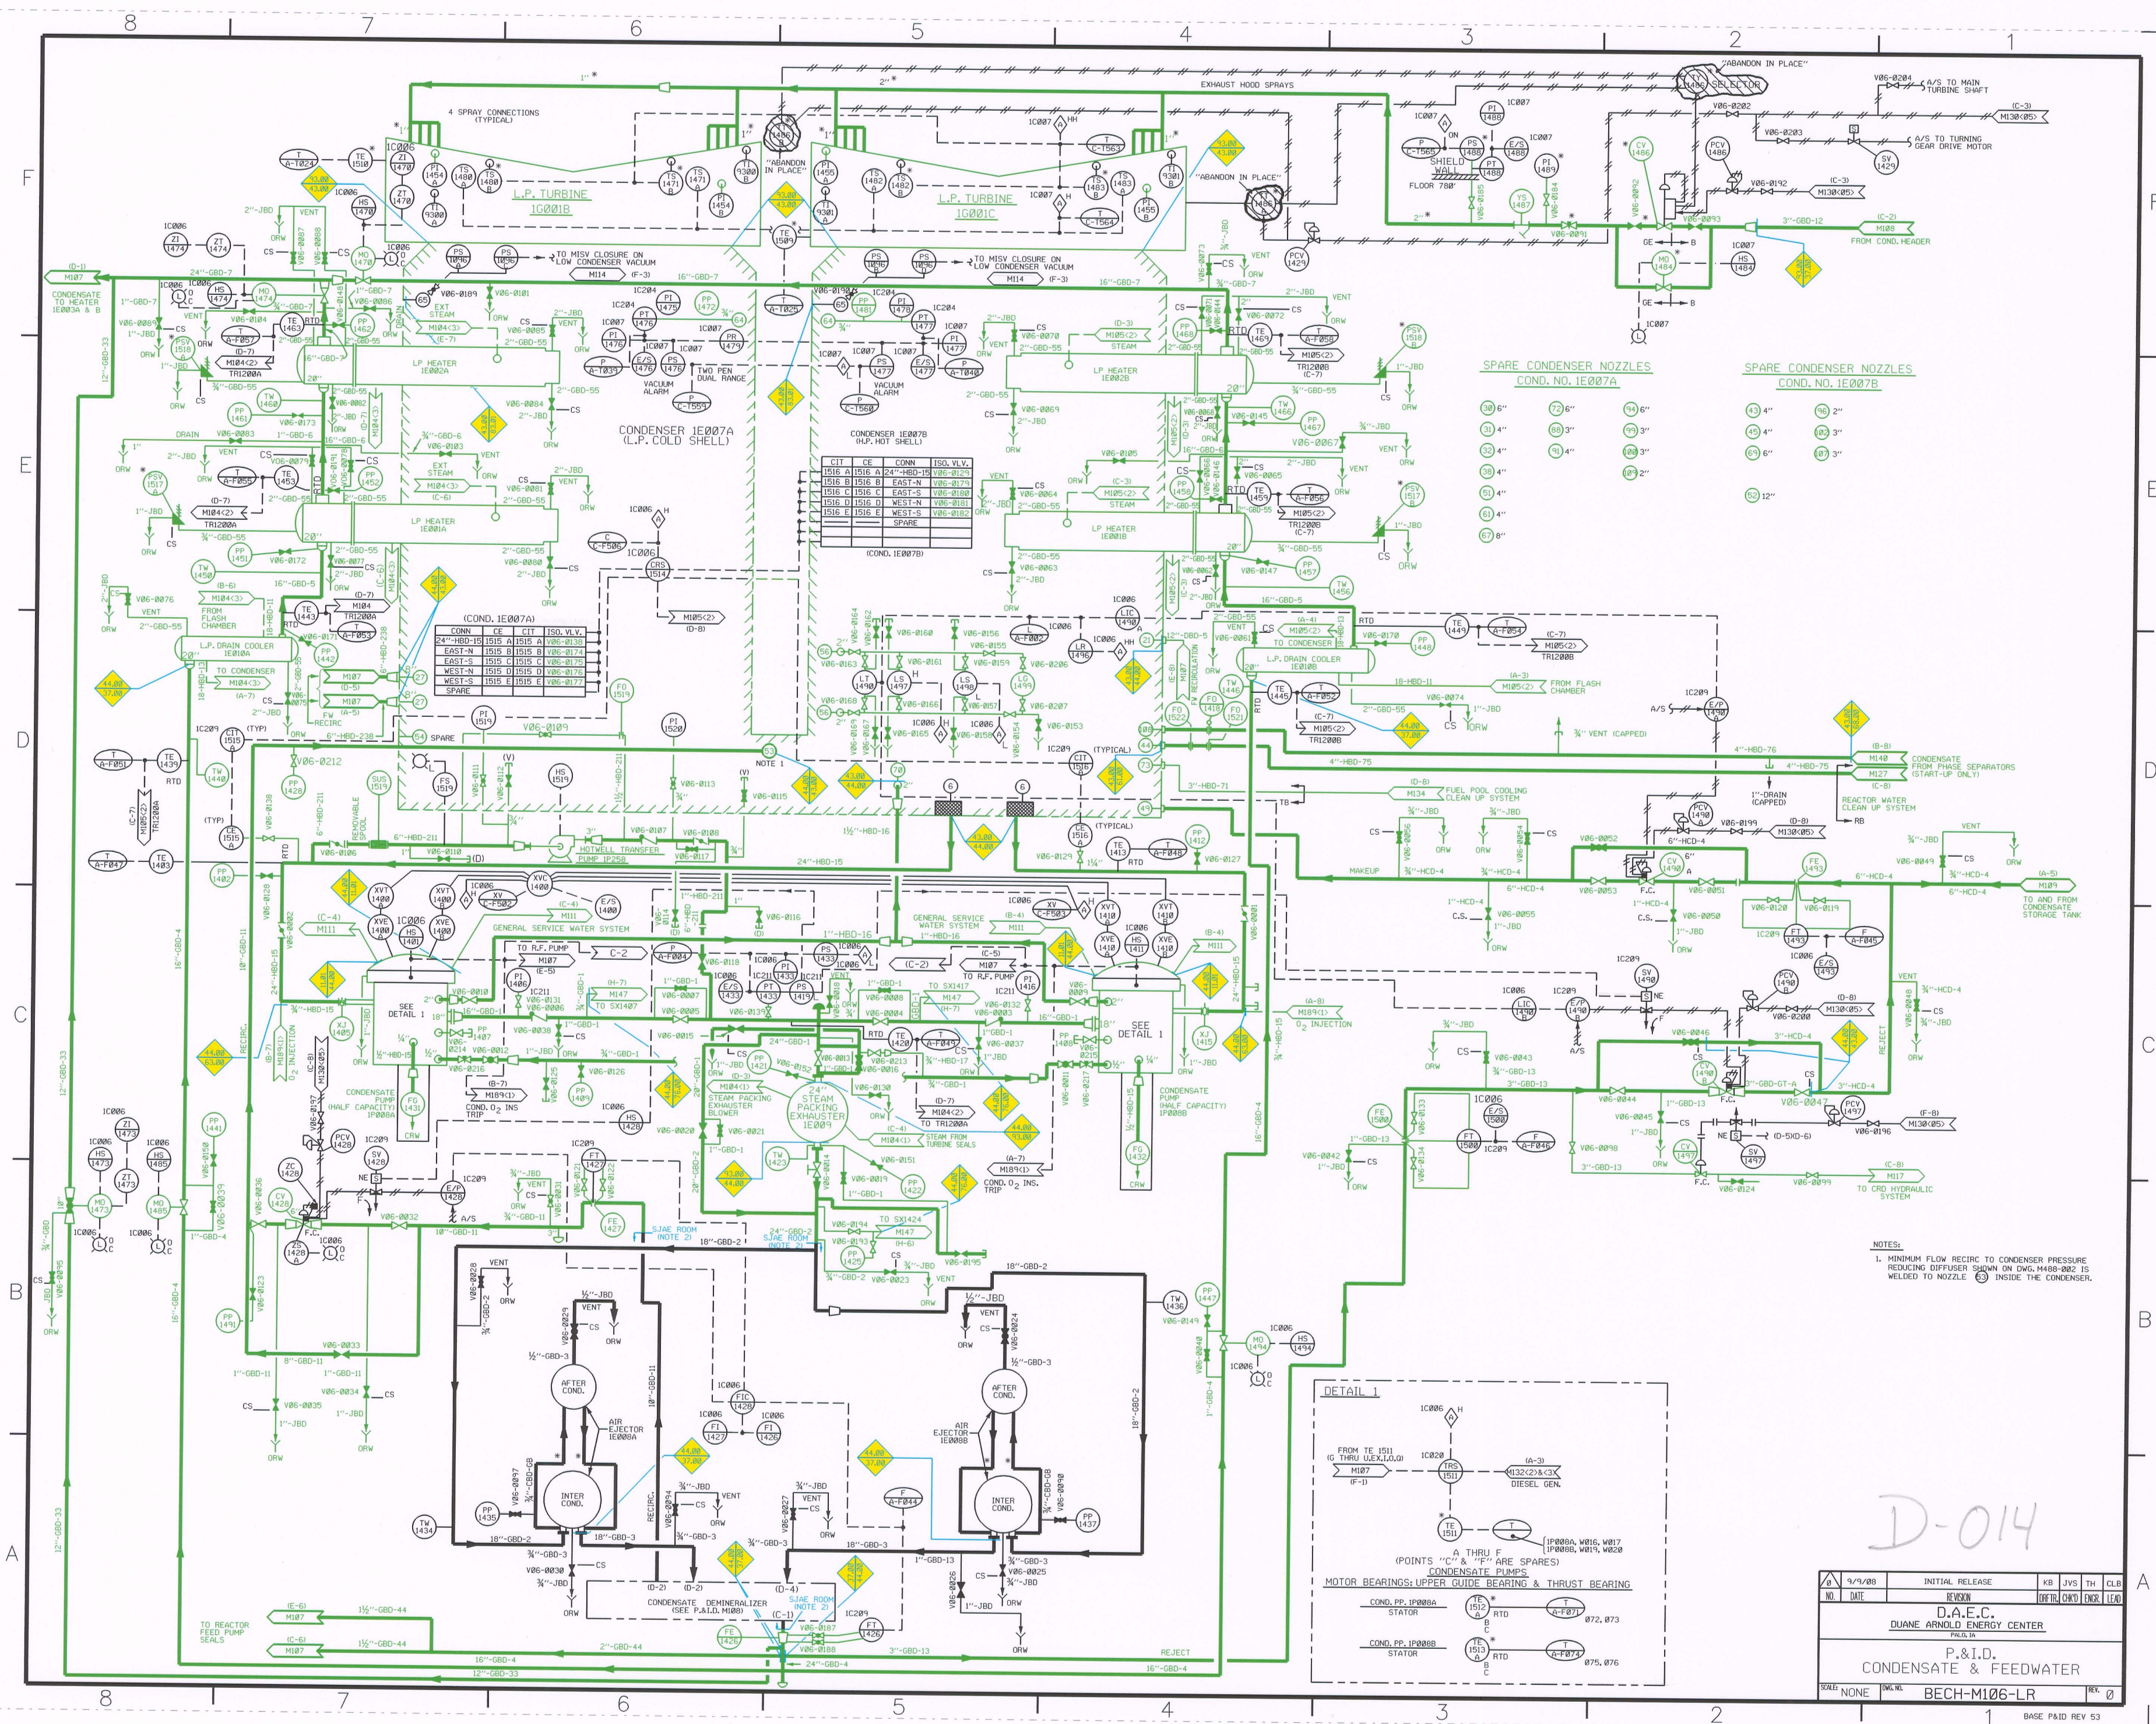

LR NOTES:

- ALL EXPOSED DRAIN PIPING AND FLEXIBLES ARE IN SCOPE FOR LICENSE RENEWAL.
- CONDENSATE SYSTEM COMPONENTS INSIDE THE SJAE ROOM ARE NOT SUBJECT TO 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21.

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND/OR 54.3 AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21

SYSTEM BOUNDARY INTERFACE

NO.	DATE	INITIAL RELEASE	BY	JVS	TH	CLB
1	3/9/98	INITIAL RELEASE	BY	JVS	TH	CLB

D.A.E.C.
DUANE ARNOLD ENERGY CENTER
P.I.D.
CONDENSATE & FEEDWATER
BECH-M106-LR