


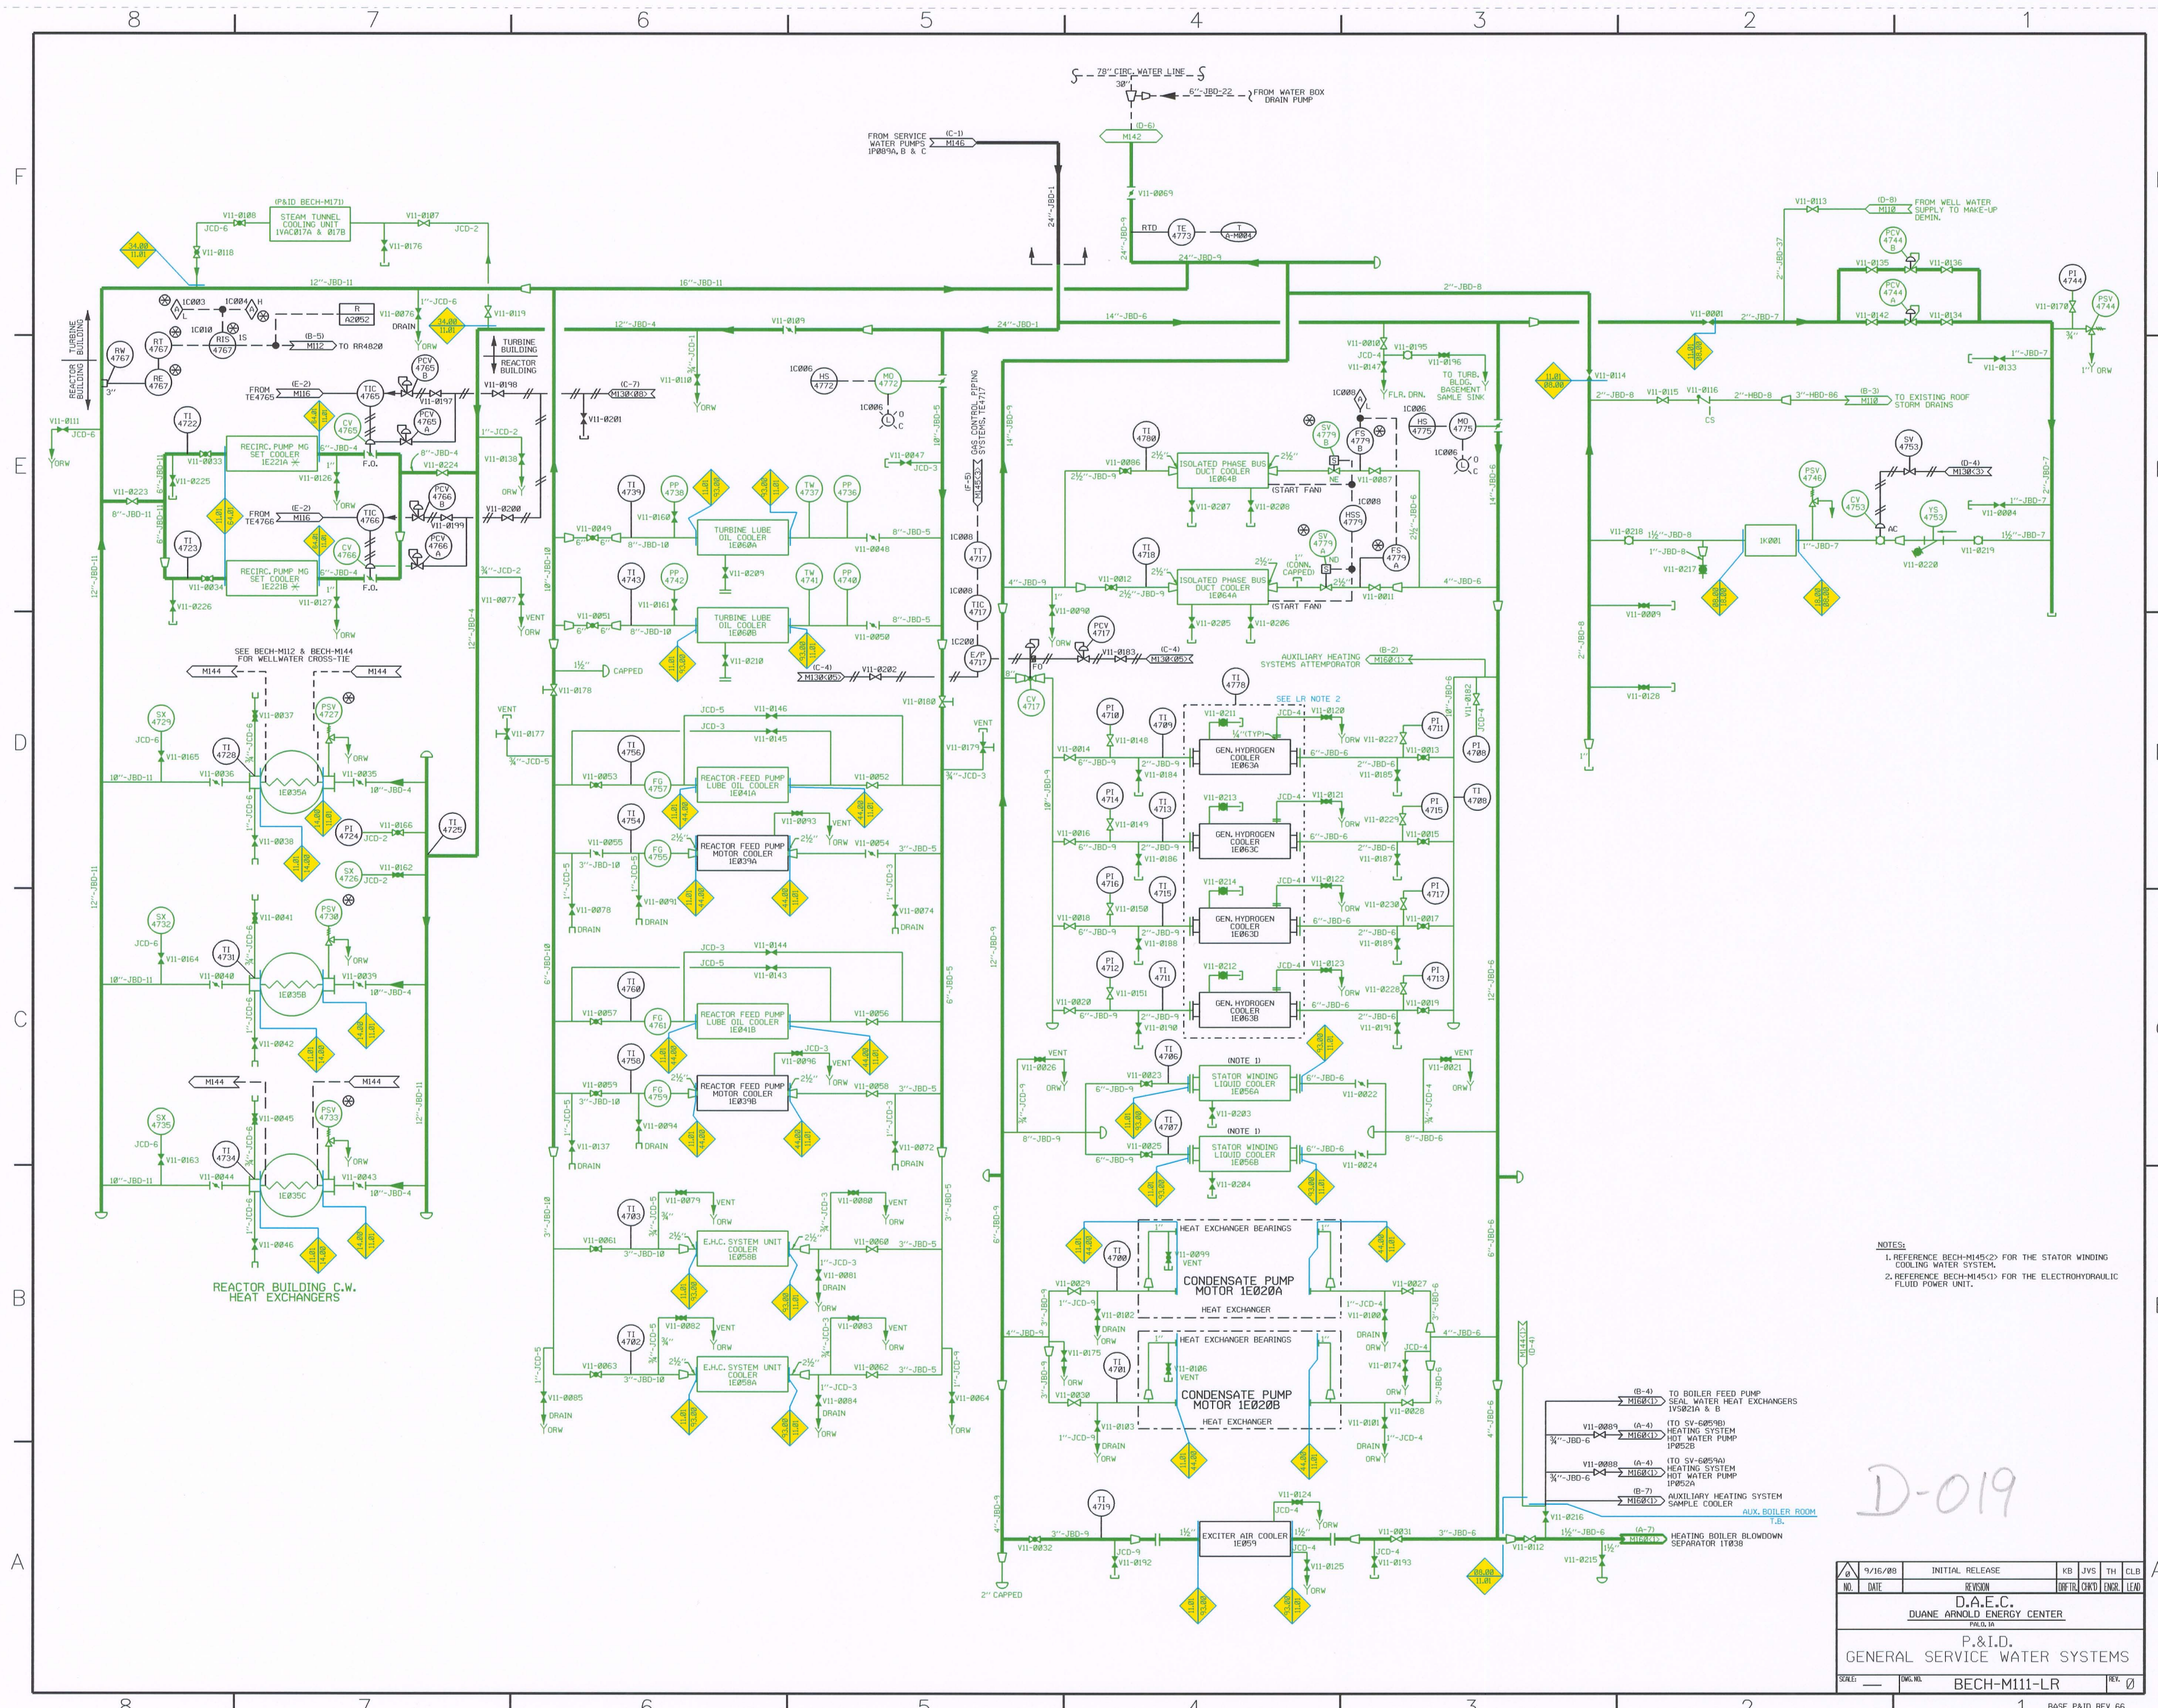

NOTES:
1. REFERENCE BECH-M112-2 FOR THE STATOR WINDING COOLING WATER SYSTEM.
2. REFERENCE BECH-M145(1) FOR THE ELECTROHYDRAULIC FLUID POWER UNIT.

LR NOTES:

- ALL EXPOSED DRAIN PIPING AND FURNELLS ARE IN SCOPE FOR LICENSE RENEWAL.
- GENERATOR HYDROGEN COOLERS IE863A, B, C, AND D ARE EVALUATED IN SYSTEM "88.00" MAIN GENERATOR.

LR LEGEND:

- COMPONENTS IN SCOPE PER 18CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR

SYSTEM BOUNDARY INTERFACE

- 88.00 WELL WATER
- 11.00 GSW
- 14.00 RBCCW
- 15.00 INSTRUMENT AIR
- 34.00 REACTOR BUILDING HVAC
- 44.00 CONDENSATE AND FEED
- 64.01 REACTOR RECIRC
- 93.00 MAIN TURBINE

REVISIONS

NO.	DATE	REVISION	BY	CHKD	TH	CLB
1	9/16/98	INITIAL RELEASE	KB	JYS	TH	CLB
2		REVISION	DP	TR	GRD	ENR

DUANE ARNOLD ENERGY CENTER
P&ID
GENERAL SERVICE WATER SYSTEMS
BECH-M111-LR
SCALE: 1"=6'-0" BASE P&ID REV 66