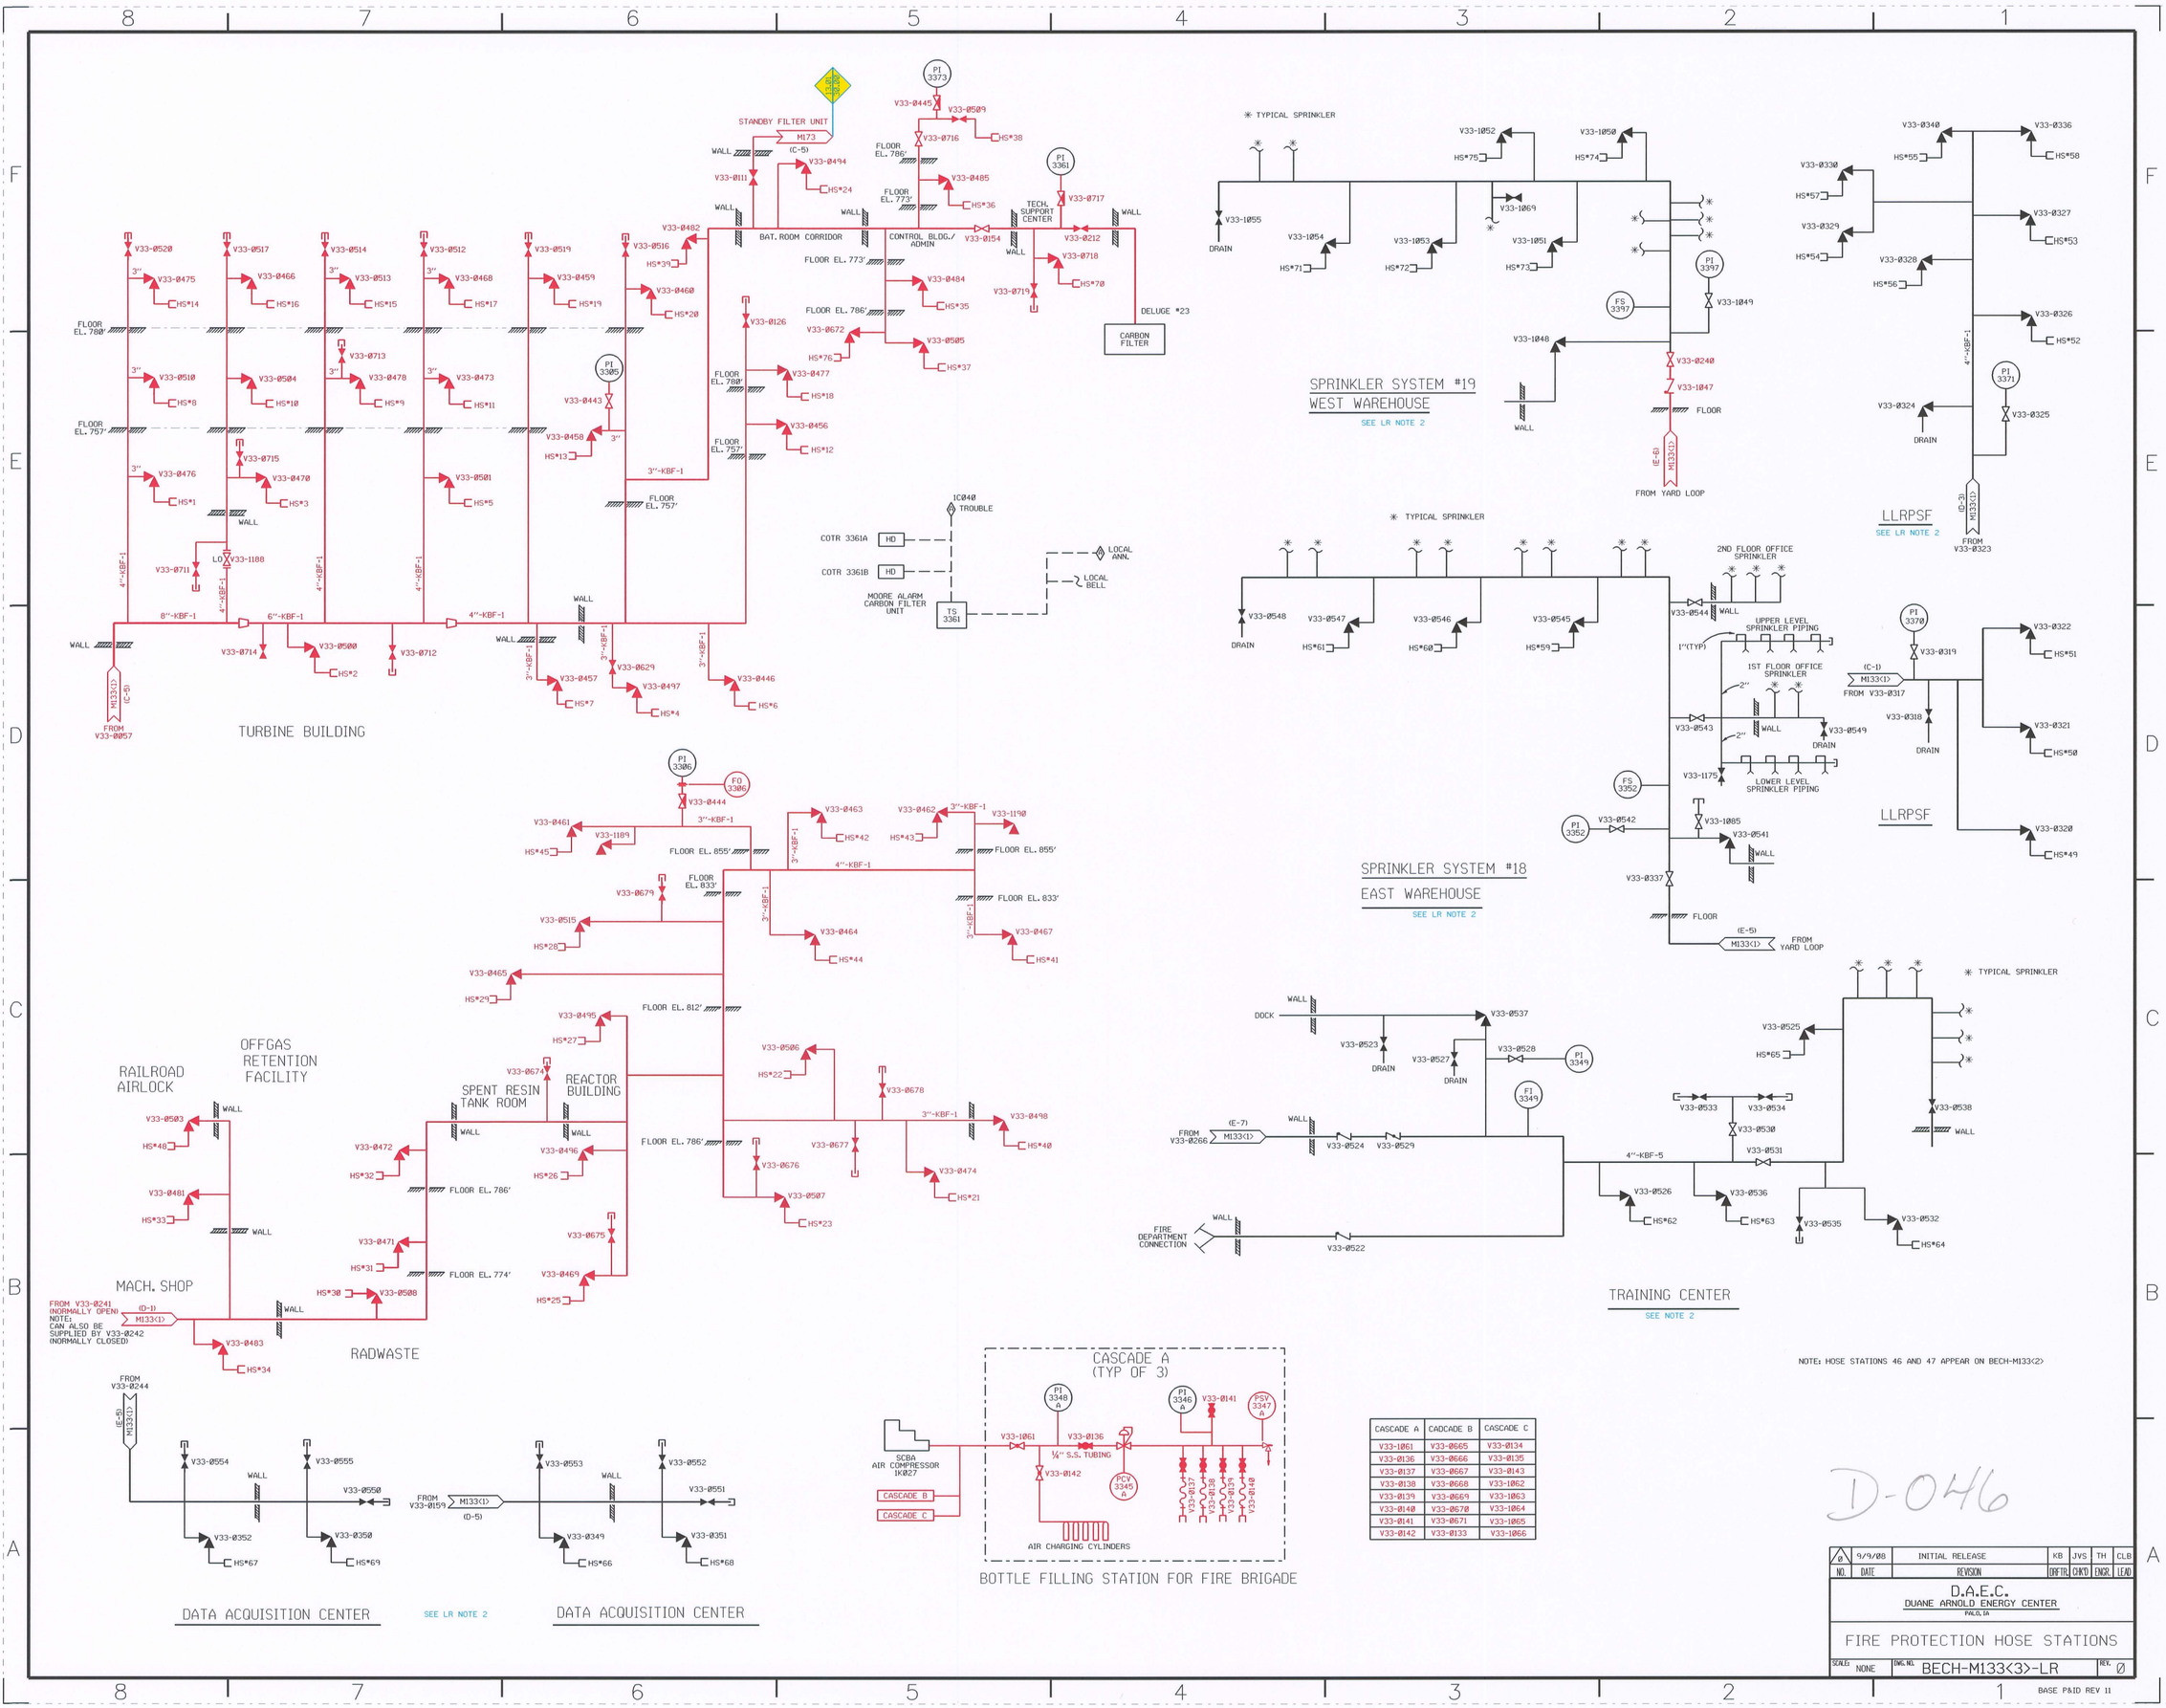

CASCADE A	CADCADE B	CASCADE C
V33-1061	V33-0665	V33-0134
V33-0136	V33-0666	V33-0135
V33-0137	V33-0667	V33-0143
V33-0138	V33-0668	V33-1062
V33-0139	V33-0669	V33-1063
V33-0140	V33-0670	V33-1064
V33-0141	V33-0671	V33-1065
V33-0142	V33-0133	V33-1066

D-046

NO.	DATE	REVISION	DRFTR.	CHKD	ENGR.	LEAD
Ø	9/9/08	INITIAL RELEASE	KB	JVS	TH	CLB

D.A.E.C.
DUANE ARNOLD ENERGY CENTER
PALO, IA

FIRE PROTECTION HOSE STATIONS

SCALE: NONE | DWG. NO. BECH-M133<3>-LR | REV. Ø

BASE P&ID REV 11

LR NOTES:

1. ALL EXPOSED DRAIN PIPING AND FUNNELS ARE IN SCOPE FOR LICENSE RENEWAL.
2. DAC HOSE STATIONS 66-69, LLRPSF HOSE STATIONS 49-51, EAST WAREHOUSE SPRINKLER 18, WEST WAREHOUSE SPRINKLER 19, AND THE TRAINING CENTER SPRINKLER INCLUDING THEIR ASSOCIATED PIPING AND COMPONENTS ARE IN BUILDINGS THAT DO NOT CONTAIN AND/OR ARE REMOTELY LOCATED FROM SAFETY RELATED EQUIPMENT.

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
- SYSTEM BOUNDARY INTERFACE
  - 13.01 FIRE PROTECTION
  - 30.00 CONTROL BUILDING HVAC