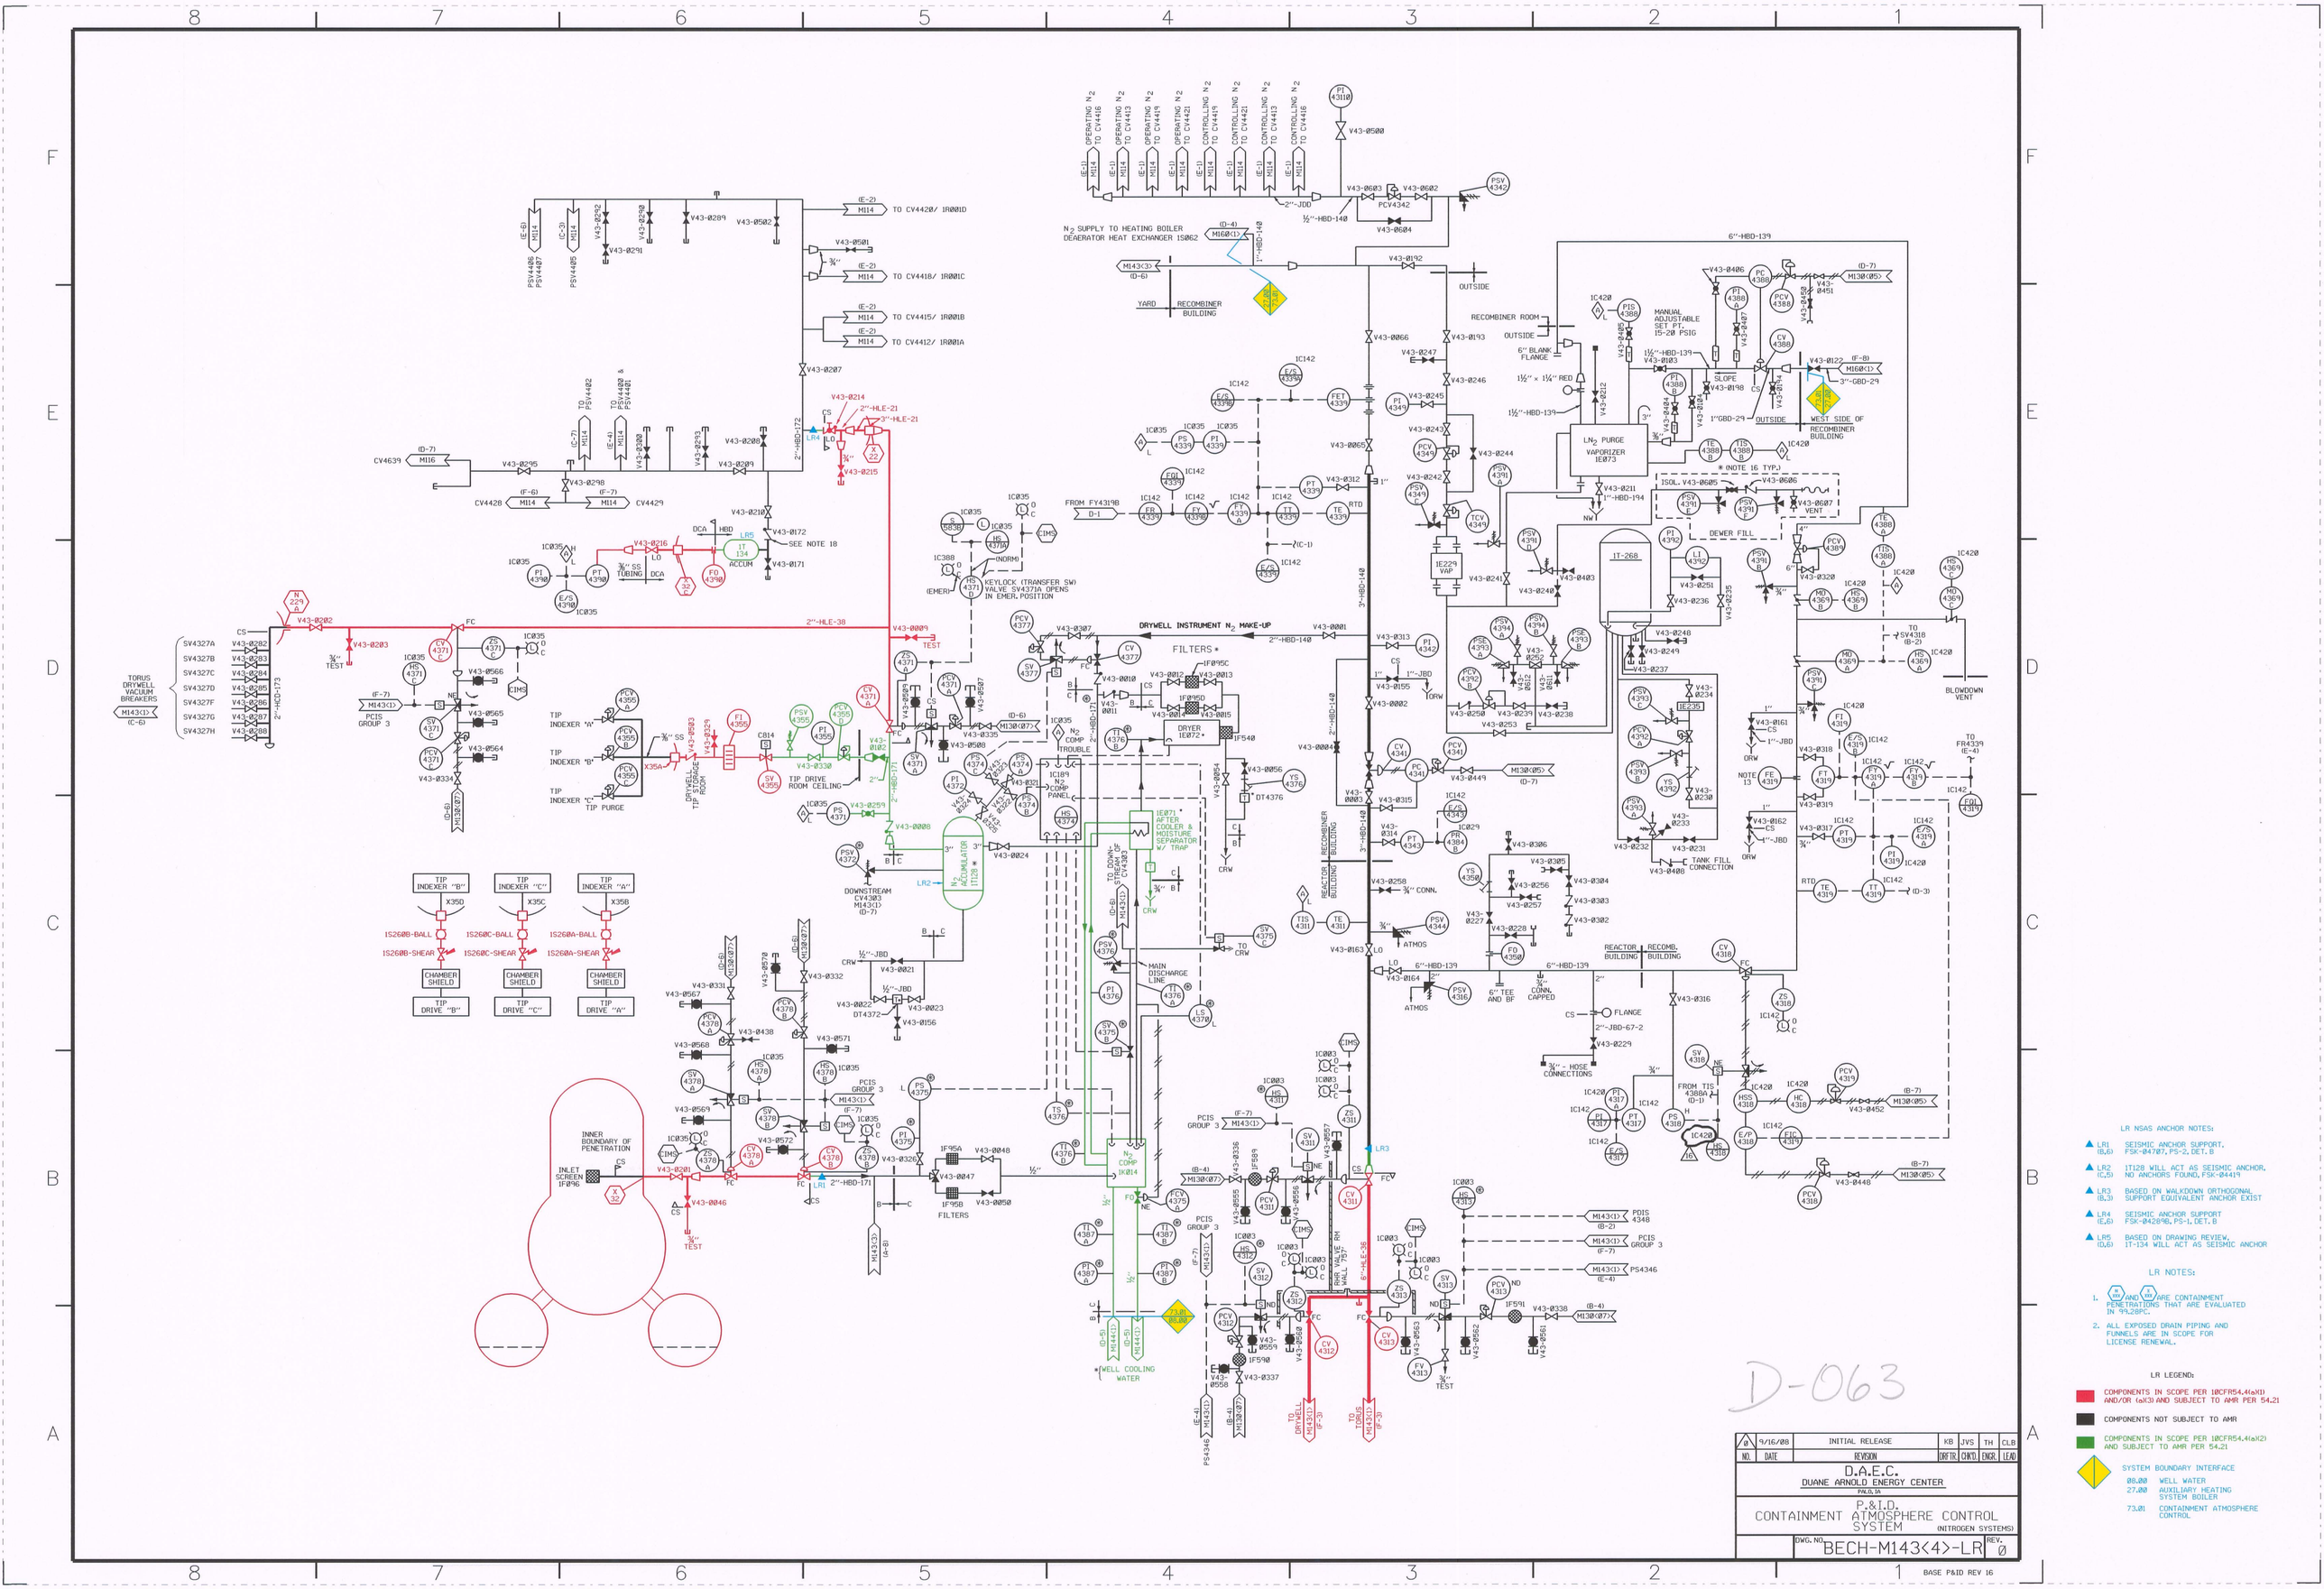

NO.	DATE	REVISION	DRFTR.	CHK'D.	ENGR.	LEAD
0	9/16/08	INITIAL RELEASE	KB	JVS	TH	CLB

D.A.E.C.
DUANE ARNOLD ENERGY CENTER
PALO, IA

P.&I.D.
CONTAINMENT ATMOSPHERE CONTROL SYSTEM (NITROGEN SYSTEMS)

DWG. NO. BECH-M143<4>-LR REV. 0

LR NSAS ANCHOR NOTES:

- LR1 (B,6) SEISMIC ANCHOR SUPPORT, FSK-04707, PS-2, DET. B
- LR2 (C,5) IT128 WILL ACT AS SEISMIC ANCHOR, NO ANCHORS FOUND, FSK-04419
- LR3 (B,3) BASED ON WALKDOWN ORTHOGONAL SUPPORT EQUIVALENT ANCHOR EXIST
- LR4 (E,6) SEISMIC ANCHOR SUPPORT FSK-04289B, PS-1, DET. B
- LR5 (D,6) BASED ON DRAWING REVIEW, IT-134 WILL ACT AS SEISMIC ANCHOR

LR NOTES:

1. NX/XXX AND XX/XXX ARE CONTAINMENT PENETRATIONS THAT ARE EVALUATED IN 99.28PC.
2. ALL EXPOSED DRAIN PIPING AND FUNNELS ARE IN SCOPE FOR LICENSE RENEWAL.

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
- SYSTEM BOUNDARY INTERFACE
  - 08.00 WELL WATER
  - 27.00 AUXILIARY HEATING SYSTEM BOILER
  - 73.01 CONTAINMENT ATMOSPHERE CONTROL

BASE P&ID REV 16