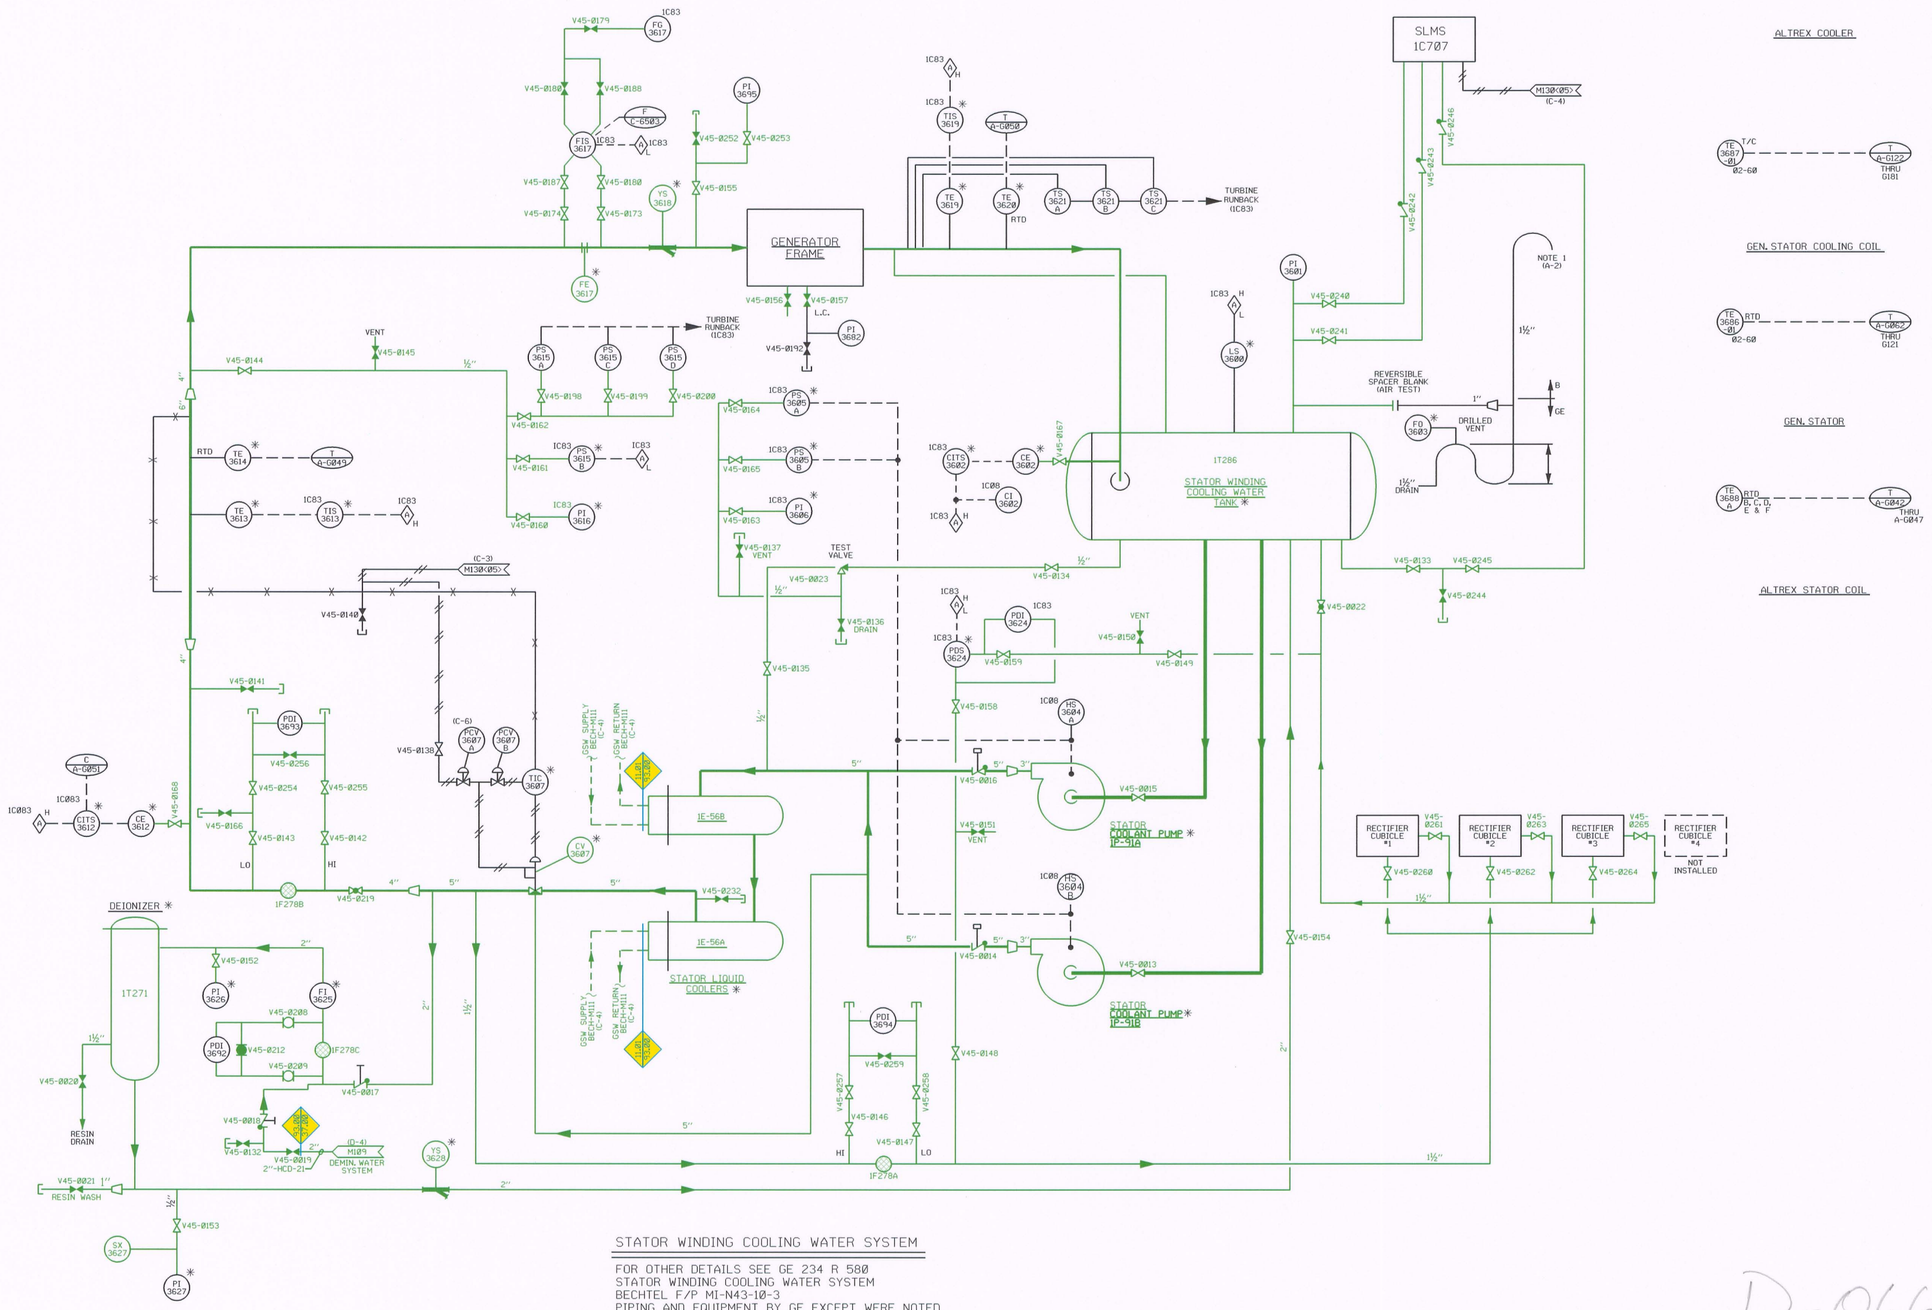

STATOR WINDING COOLING WATER SYSTEM

FOR OTHER DETAILS SEE GE 234 R 580
STATOR WINDING COOLING WATER SYSTEM
BECHTEL F/P MI-N43-10-3
PIPING AND EQUIPMENT BY GE EXCEPT WERE NOTED
(1S009-STATOR WINDING COOLING PUMPING UNIT)

NOTES:

1. VENT TO BE SHIELDED OUTSIDE BUILDING. USE LONG RADIUS ELBOWS. DO NO TIE IN WITH ANY OTHER VENT PIPING. VENT FOR HYDROGEN PURGING AND VENTING ONLY.

D-066

NO.	DATE	REVISION	DRFTR.	CHKD	ENGR.	LEAD
0	9/19/08	INITIAL RELEASE	KB	MF	TH	CLB

BECHTEL
SAN FRANCISCO

DUANE ARNOLD ENERGY CENTER-UNIT NO 1
IOWA ELECTRIC LIGHT AND POWER COMPANY
CEDAR RAPIDS, IOWA

P & I.D.
MISC. TURBINE GENERATOR SYSTEM

DRAWING NO. BECH-M145<2>-LR REV. 0

LR NOTES:

1. ALL EXPOSED DRAIN PIPING AND FUNNELS ARE IN SCOPE FOR LR

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
- SYSTEM BOUNDARY INTERFACE
  - 37.00 CONDENSATE AND DEMIN WATER
  - 93.00 MAIN TURBINE
  - 11.01 GENERAL SERVICE WATER

BASE P&ID REV 7