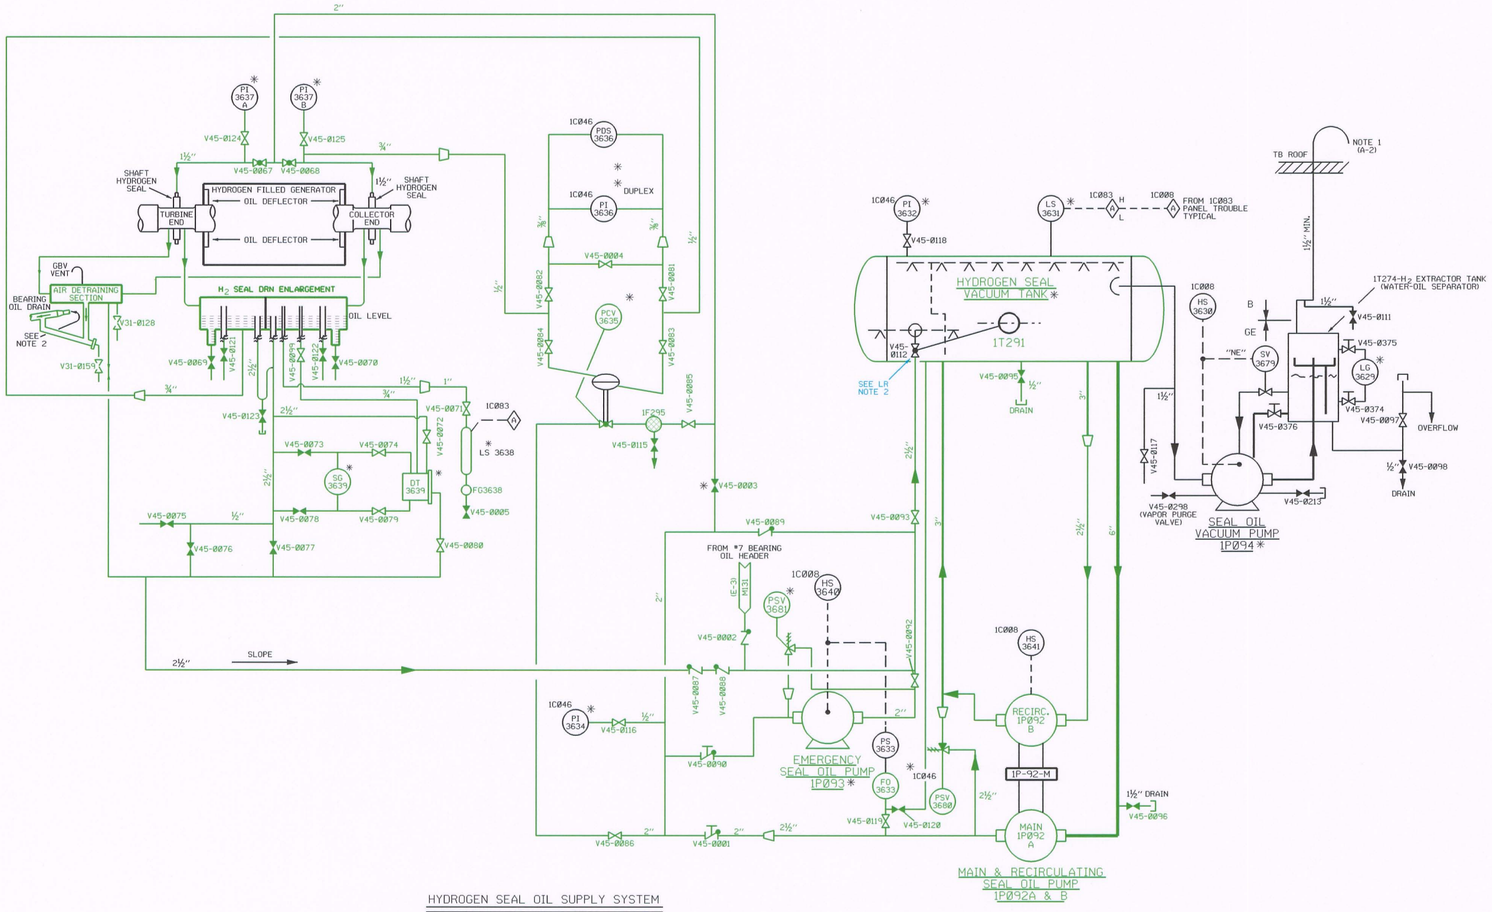

FOR OTHER DETAILS SEE GE 114D 8034
ARRANGEMENT OF SHAFT SEALING SYSTEM
(BECHTEL F/P M001-N42-007
LINES AND EQUIPMENT BY GE EXCEPT WHERE NOTED
(ISO42-GENERATOR HYDROGEN SEAL OIL UNIT)

NOTES:

1. VENT TO BE SHIELDED OUTSIDE BUILDING. USE LONG RADIUS ELBOWS. DO NOT TIE IN WITH ANY OTHER VENT PIPING. VENT FOR HYDROGEN PURGING AND VENTING ONLY.
2. SEE BECH-M131 FOR BEARING OIL DRAIN PIPING DETAILS.

D-067

NO.	DATE	REVISION	DRFTR.	CHK'D	ENGR.	VER.
0	9/16/08	INITIAL RELEASE	KB	JVS	TH	CLB

BECHTEL
SAN FRANCISCO

D.A.E.C.
DUANE ARNOLD ENERGY CENTER
PALO, IA

P & I.D.
MISC. TURBINE GENERATOR SYSTEM

DRAWING NO. BECH-M145<4>-LR REV. 0

BASE P&ID REV 10

LR NOTES:

1. ALL EXPOSED DRAIN PIPING AND FUNNELS ARE IN SCOPE FOR LICENSE RENEWAL
2. V45-0112 IS LOCATED INSIDE 1T291

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
- SYSTEM BOUNDARY INTERFACE