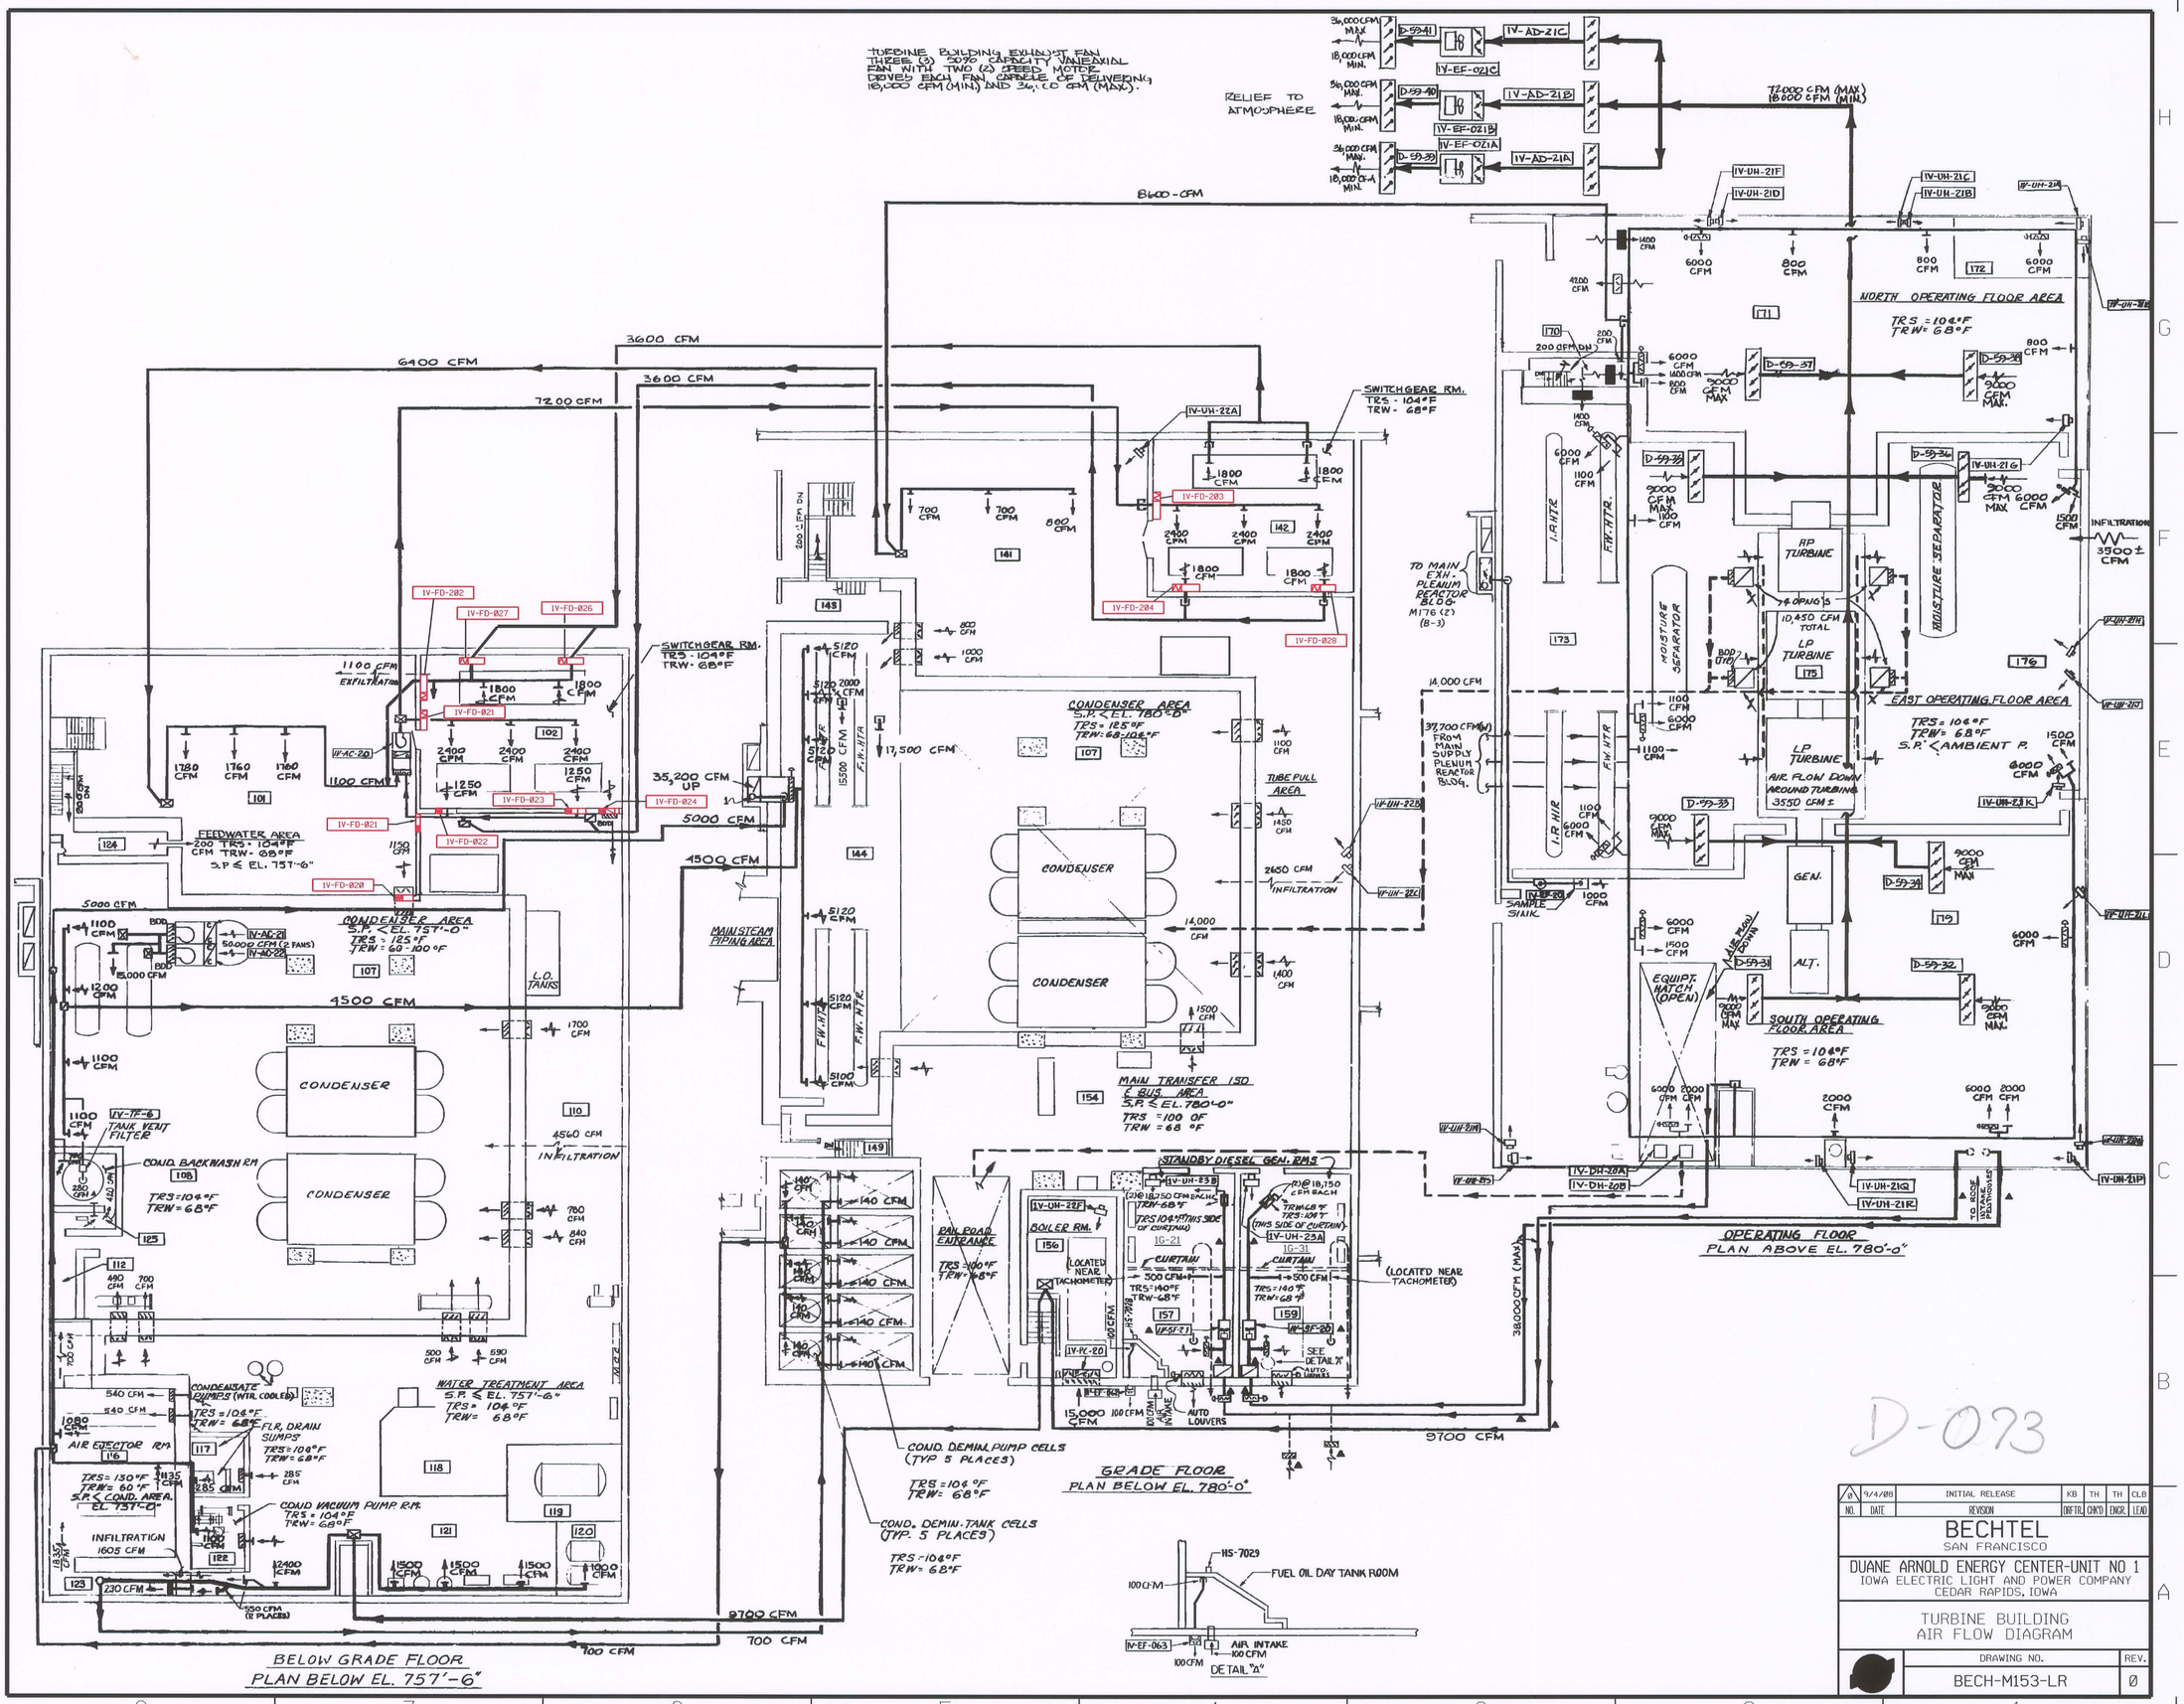

NO.	DATE	REVISION	DR'TR.	CK'D	ENGR.	LEAD
0	9/4/08	INITIAL RELEASE	KB	TH	TH	CLB

BECHTEL
SAN FRANCISCO

DUANE ARNOLD ENERGY CENTER-UNIT NO 1
IOWA ELECTRIC LIGHT AND POWER COMPANY
CEDAR RAPIDS, IOWA

TURBINE BUILDING
AIR FLOW DIAGRAM

DRAWING NO. BECH-M153-LR REV. 0

BASE P&ID REV 21

LR NOTES

1. THIS AIR FLOW DIAGRAM IS ONLY USED TO DEPICT FIRE DAMPERS SUBJECT TO AMR. OTHER TURBINE BUILDING VENTILATION SYSTEMS SUBJECT TO AMR ARE SHOWN ON THEIR RESPECTIVE HVAC P&ID, REFERENCED IN SUS 10.03 PLANT VENTILATION.

LR LEGEND:

- COMPONENTS IN SCOPE PER 10CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
- COMPONENTS NOT SUBJECT TO AMR
- COMPONENTS IN SCOPE PER 10CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
- SYSTEM BOUNDARY INTERFACE 13.01 FIRE PROTECTION