


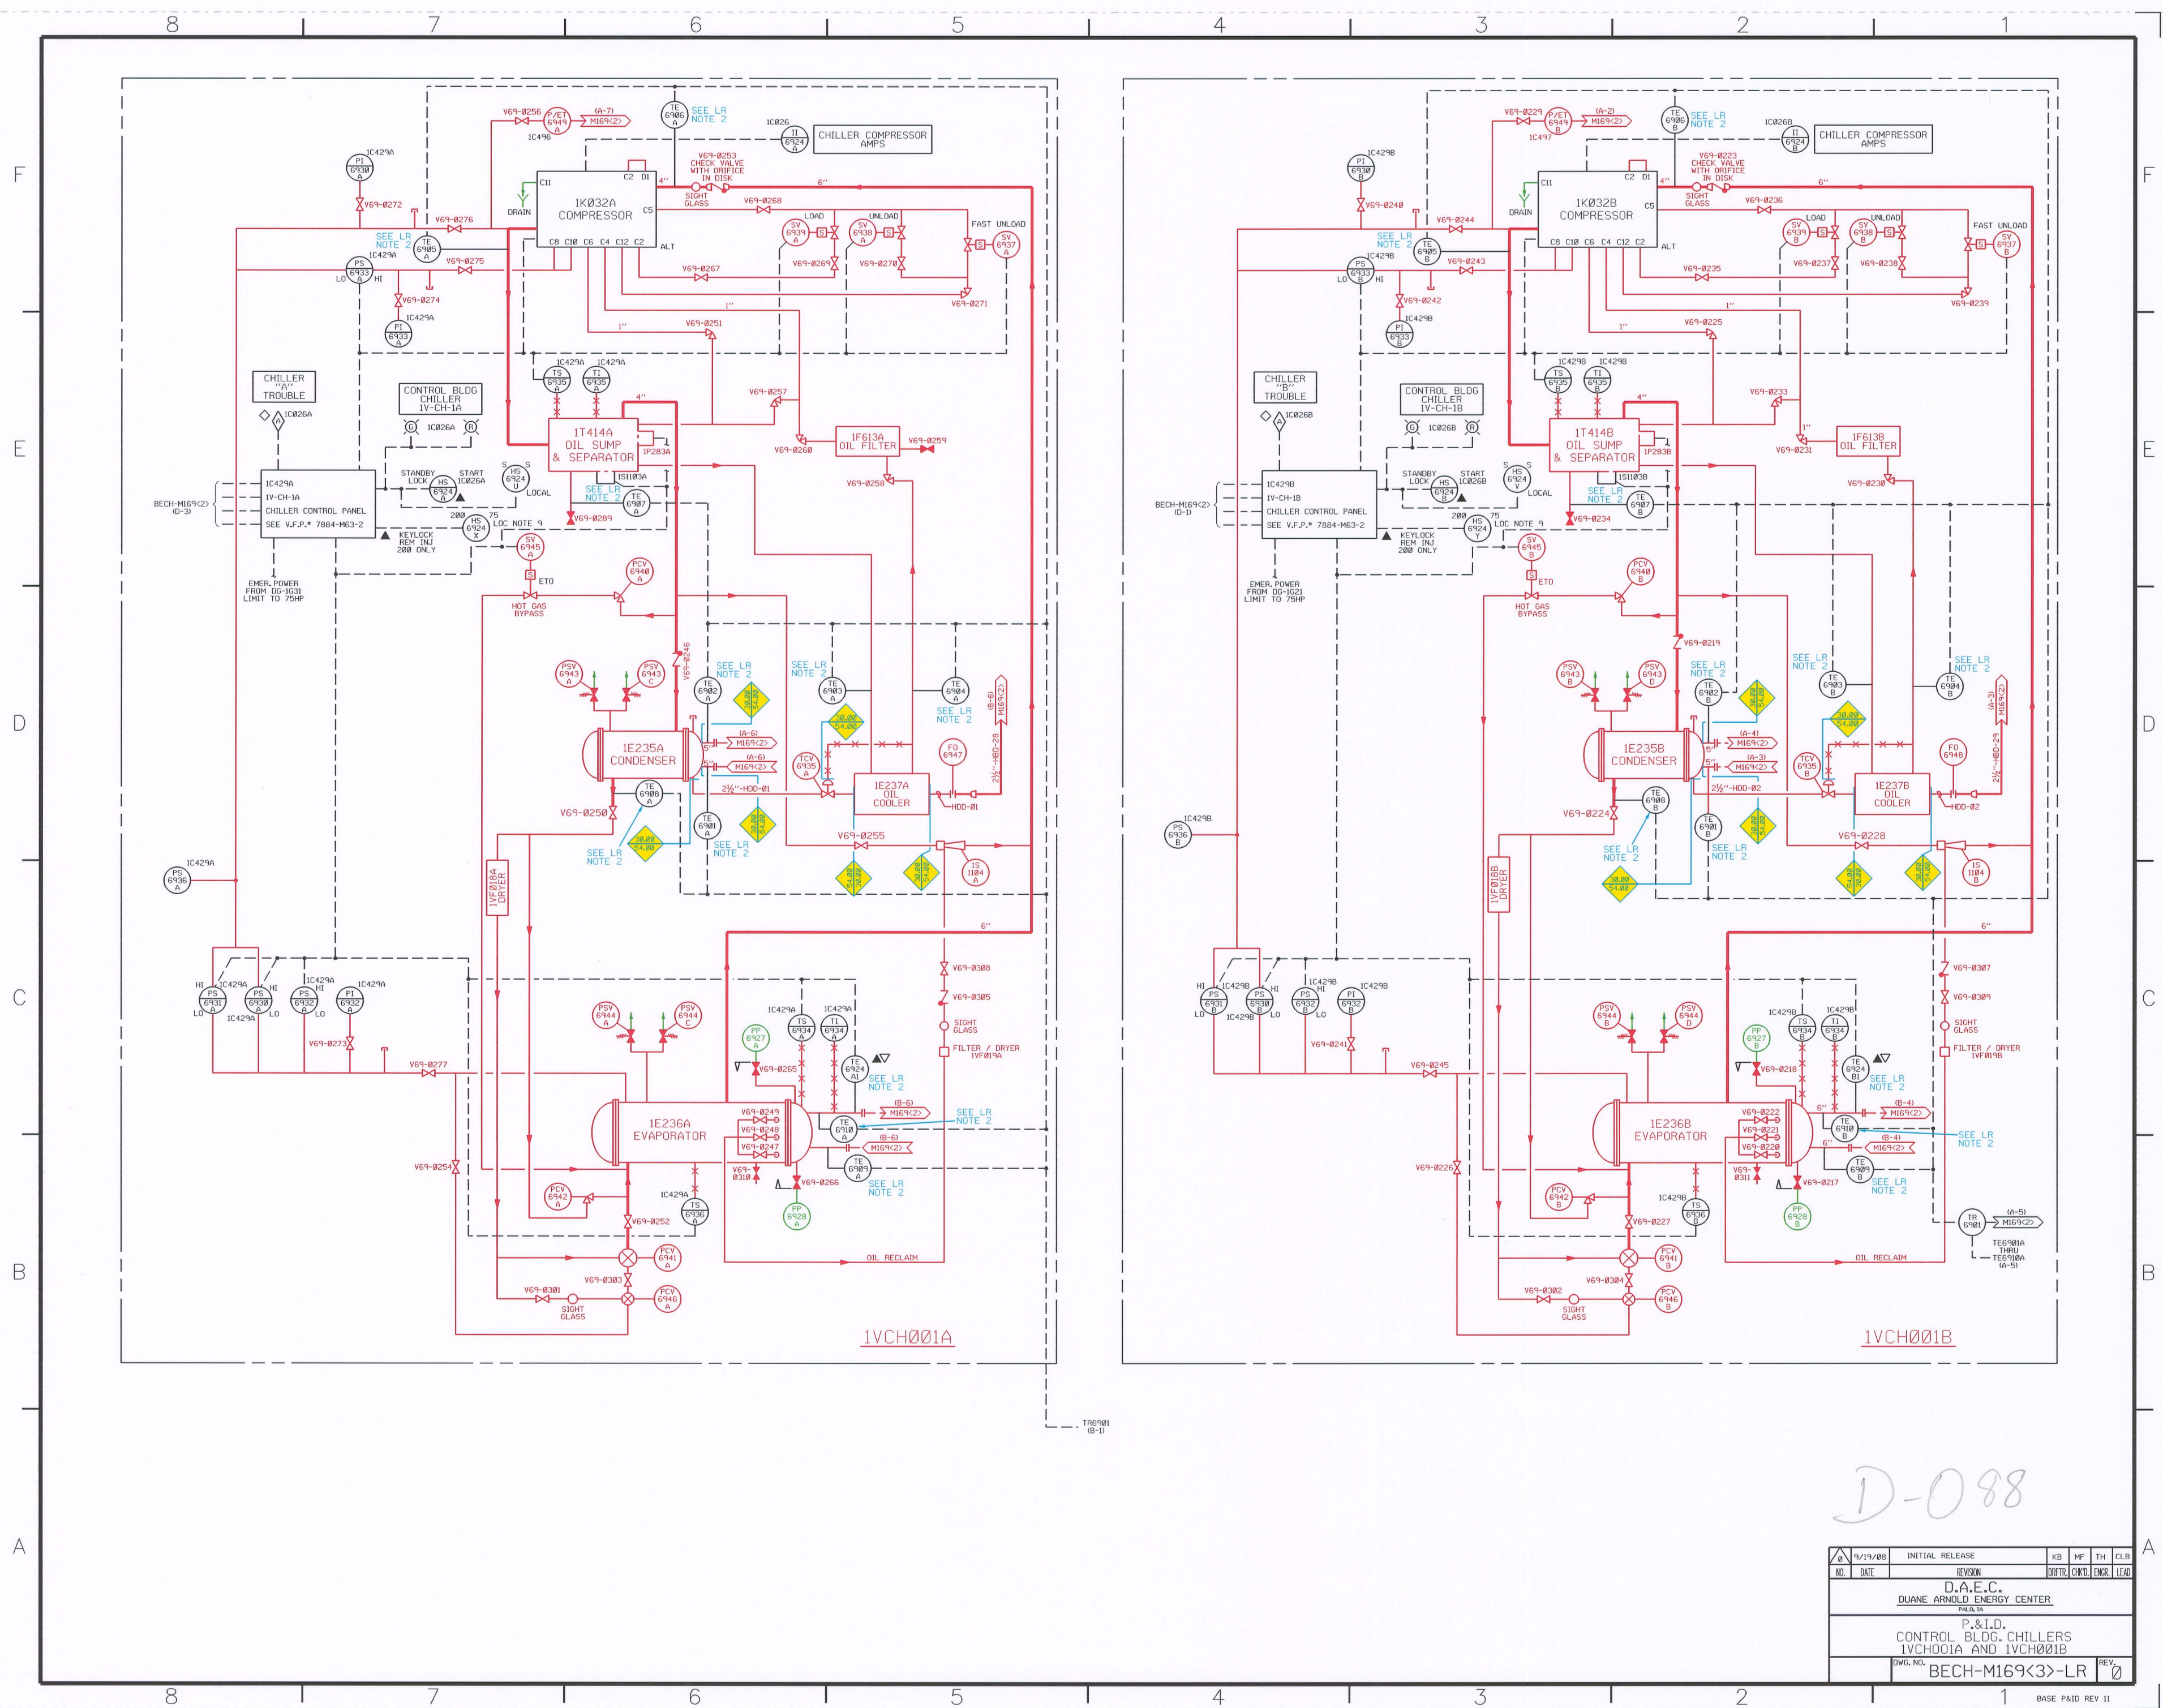

- LR NOTES:
- ALL EXPOSED DRAIN PIPING IS IN SCOPE FOR LICENSE RENEWAL BECAUSE IT AFFECTS SAFETY RELATED EQUIPMENT.
 - THESE TE's ARE AFFIXED TO THE OUTSIDE OF THE PIPE
- LR LEGEND:
- COMPONENTS IN SCOPE PER 18CFR54.4(a)(1) AND/OR (a)(3) AND SUBJECT TO AMR PER 54.21
 - COMPONENTS NOT SUBJECT TO AMR
 - COMPONENTS IN SCOPE PER 18CFR54.4(a)(2) AND SUBJECT TO AMR PER 54.21
 - SYSTEM BOUNDARY INTERFACE
 - 30.00 CONTROL BUILDING HVAC
 - 54.00 EMERGENCY SERVICE WATER

D-088

9/19/88	INITIAL RELEASE	KB	MF	TH	CLB
NO.	DATE	REVISION	DATE	CHKD	ENGR
D.A.E.C.					
DUANE ARNOLD ENERGY CENTER					
P.I.D.					
CONTROL BLDG. CHILLERS					
1VCH001A AND 1VCH001B					
DWG. NO. BECH-M169<3>-LR					
REV. 0					