

Bellefonte Nuclear Plant, Units 3 & 4
COL Application
Part 3, Environmental Report

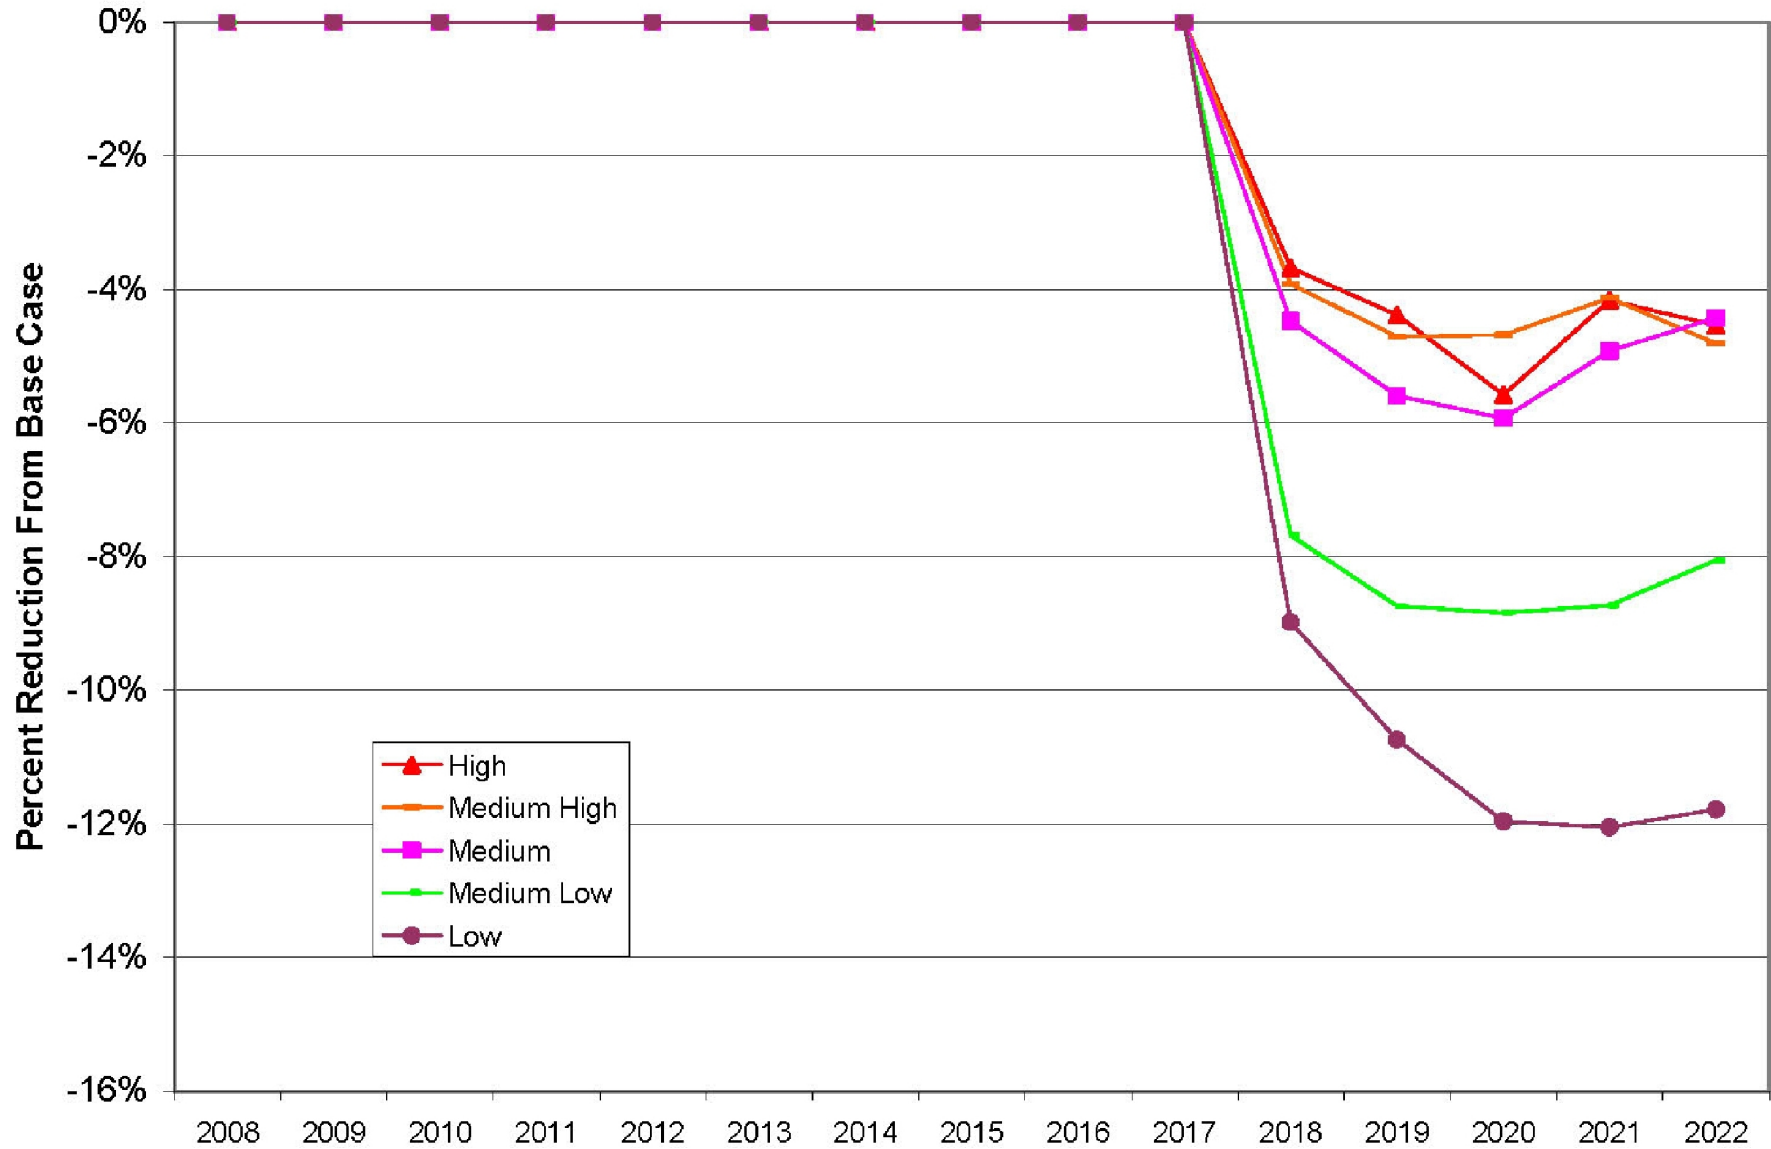


FIGURE 8.4-10
Percent Reduction in TVA SO₂ Emissions due to BLN Unit 3 (2018) and BLN Unit 4 (2019)