

Client: <u>Duke Power Carolinas, LLC</u>		Calculation No. <u>07Q3691-CAL-010</u>		
Title: <u>Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator "2B" Unit 2</u>				
Project: <u>Catawba Unit #1 and Unit #2 – Buried HDPE Pipe Design and Analysis</u>				
Method: <u>Computer and Manual Calculations</u>				
Acceptance Criteria: <u>N/A</u>				
Remarks: _____				
Verification Method		<input checked="" type="checkbox"/> Design Review Method	<input type="checkbox"/> Alternate Calculation	
		<input type="checkbox"/> Other	<input type="checkbox"/> No Verification Necessary	
		<input type="checkbox"/> Qualification Test		
<b>Results:</b>				
Computer Programs Used	Program Name	Version/Revision	Computer Type	QA Verified
	ADLPIPE	4F10.1	PC	YES
	Microsoft Word	2003	PC	N/A
	Mathcad	2000	PC	N/A
<b>REVISIONS</b>				
Revision No.	0			
Description	Original Issue			
Total Pages (Cumulative)	93			
By/Date	<i>S. Hails</i> 11-10-08			
Checked/Date	<i>Bruce P. Dubonchey</i> 11-11-08			
Approved/Date	<i>[Signature]</i> 11-11-08			
		<b>CALCULATION COVER SHEET</b>	<b>CONTRACT NO.  07Q3691</b>	

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouchef</i>	Date	11/11/08

### TABLE OF CONTENTS

TABLE OF CONTENTS .....	2
DOCUMENT INDEX .....	4
1.0 PURPOSE OR OBJECTIVE .....	6
2.0 SCOPE AND LIMITATIONS.....	6
3.0 DEFINITIONS.....	6
4.0 ASSUMPTIONS.....	8
<b>4.1 Assumptions Not Requiring Verification</b> .....	8
<b>4.2 Assumptions To Be Verified</b> .....	8
5.0 ANALYSIS METHODOLOGY AND APPROACH.....	8
<b>5.1 Background</b> .....	8
<b>5.2 Methodology and Approach</b> .....	9
<b>5.2.1 HDPE Calculations Dependent Only on Design Conditions and Pipe Size</b> .....	9
<b>5.2.2 HDPE Calculations Requiring the Input of Geometry Specific Loads</b> .....	12
<b>5.2.3 Steel Pipe Criteria</b> .....	15
6.0 ANALYSIS INPUTS.....	15
<b>6.1 Design Loads</b> .....	15
<b>6.2 Pipe Properties</b> .....	15
<b>6.3 Material Properties</b> .....	16
<b>6.4 HDPE to Steel Boundary</b> .....	19
<b>6.5 HDPE Elbows</b> .....	19
<b>6.6 Stress Indices and SIFs</b> .....	20
<b>6.7 Soil Springs</b> .....	22
<b>6.8 Seismic Analysis Input</b> .....	22
<b>6.8.1 Seismic Anchor Motion</b> .....	22
<b>6.8.2 Seismic Wave Passage</b> .....	23
<b>6.8.3 Decoupling of 12” Steel Pipe</b> .....	23
<b>6.9 Piping Layout</b> .....	23
<b>6.10 Pipe Criteria – Steel and HDPE</b> .....	25
<b>6.11 Acceptance Criteria – Steel and HDPE</b> .....	27
7.0 ANALYSIS.....	29
<b>7.1 Computer Model</b> .....	29
<b>7.2 Results of ADLPIPE Analysis</b> .....	30
<b>7.2.1 Load Cases Analyzed</b> .....	30
<b>7.2.2 Summary of HDPE Loads at Critical Locations</b> .....	31
<b>7.3 Calculations per ASME BPVC Code Case N-755</b> .....	33
<b>7.5 Flange Summary for Unit 2 HDPE Pipe</b> .....	44
<b>7.6 Evaluation of Buoyancy over Condenser Cooling Water Lines</b> .....	44
<b>7.7 Evaluation of Steel Bridge Pipe over Condenser Cooling Water Lines</b> .....	46
<b>7.8 Evaluation of 12” <math>\phi</math> HDPE Pipe over Condenser Cooling Water Lines</b> .....	49
8.0 RESULTS .....	51
<b>8.1 Functionality Capability and Break Postulation</b> .....	52

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

<b>8.2</b>	<b>Final Loads at the Anchor at the Diesel Generator Building due to Soil Effects</b> .....	54
<b>8.3</b>	<b>Final Loads at the Centerline of the 42” <math>\phi</math> Supply Line due to Soil Effects</b> .....	54
<b>8.4</b>	<b>Branch Line Qualification</b> .....	55
9.0	CONCLUSIONS .....	55
Appendix A	.....	56
Appendix B	.....	62

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

### DOCUMENT INDEX

DIN No.	Document Number/Title	Revision, Edition, Date	Reference	Input	Output
1	“Nondestructive Evaluation: Seismic Design Criteria for Polyethylene Pipe Replacement Code Case,” EPRI, Palo Alto, CA, 2006, Report Number 1013549	September 2006	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
2	“Guidelines for the Seismic Design of Oil and Gas Pipeline Systems,” ASCE	1984	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
3	“Catawba Updated Final Safety Analysis Report”	Rev. 12, April 2006	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
4	“Polyethylene (PE) Pressure Pipe and Fittings, 4in. (100 mm) through 63 in. (1,575 mm) for Water Distribution and Transmission,” ANSI/AWWA C906-99, American Water Works Association, 6666 West Quincy Ave., Denver, CO 80235	March 1, 2000	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
5	Catawba Nuclear Station Units 1&2, Yard Layout, Buried Systems, Drawing No. CN-1038-06.		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
6	Catawba Nuclear Station Units 1&2, Yard Layout, Buried Systems, Drawing No. CN-1038-11.		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
7	Catawba Nuclear Station Units 1&2, Yard Layout, Buried Systems, Drawing No. CN-1038-12.		<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
8	HDPE Product Catalog, ISCO Industries	Version 2.1, 2005	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
9	Ladish General Catalog No. 55	1971	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
10	Navco Piping Catalog	Edition No. 10, June 1, 1974	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
11	ASME Boiler and Pressure Vessel Code, Section III, Division I, Subsection ND-3600	1998 Edition with 2000 Addenda	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
12	ASME BPVC Code Case N-755, High Density Polyethylene (HPDE) Buried Pipe, Section III, Division I, Class 3	March 22, 2007	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
13	CNS ISFSI Haul Path Evaluation Calculation, CNM 1140.04-0005 001	Rev. 0, December 21, 2006	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
14	Request for relief Number 06-CN-003 “Use of Polyethylene Material in Nuclear Safety-Related Piping Applications” (TAC Numbers MD 3729 and MD 3730)	March 13, 2008	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
15	S&A Calculation 07Q3691-CAL-001 “Calculation of Soil Spring Stiffness for Buried HDPE Pipe”	Rev. 0, 2008	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
16	Catawba Nuclear Station Units 1 and 2 Calculation CNC-1206.02-84-001, “Nuclear Service Water Pipe Seismic Analysis (Buried Portion)”	Rev. 16, September 7, 2006	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

DIN No.	Document Number/Title	Revision, Edition, Date	Reference	Input	Output
17	Bonney Forge Stress Intensification Factors: Weldolet, Sockolet, Thredolet, Sweepolet, Latrolet, Insert Weldolet, Bulletin SI-1	1988	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
18	S&A Calculation 07Q3691-CAL-002 “Calculation of Equivalent Thermal Strain for Seismic Analysis of Buried HDPE Pipe”	Rev. 0, 2008	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
19	Catawba Nuclear Station Specification CNS-1206.02-01-008	Rev. 1, January 3, 1998	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
20	018B00Y020G PLOT_Digitized Spectra (4-14)	-	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
21	Young, W. C., “Roark’s Formulas for Stress and Strain”.	McGraw-Hill, Sixth Edition, 1989	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
22	Fatigue and Capacity Testing of High-Density Polyethylene Pipe and Pipe Components Fabricated from PE4710 (1015062)	Final Report, December 2007	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
23	3691-LSC-002, “HDPE Pipe Interface Loads Applied to Steel Pipe”	March 17, 2008	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
24	S&A Calculation 07Q3691-CAL-011, “Definition of Break Selection Criteria and Functional Capability Criteria for the Piping Design Specification”	August 30, 2008	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
25	S&A Calculation 07Q3691-CAL-013, “Technical Basis for Design Acceptance Criteria”	September, 30, 2008	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
26	CNS-1574-00_RN-00-0002, “ ASME Design Specification for the Nuclear Service Water System (RN) Diesel Generator Cooling Supply and Return Piping; Modification, Repair, and Replacement”	Preliminary Draft	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>
27	S&A Document 3691-DI-001, “ Design Instructions for Analysis of Polyethylene Pipe”	Rev. 0, July 2008	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
28	Welding Research Council Bulletin 300, “Technical Position on Industry Practice”	December, 1984	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
29	ASME Boiler and Pressure Vessel Code, Section III, Division I, Subsection ND-3600	1989 Edition	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis		
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2		
By:	<i>L. Hails</i>	Date	11/10/08
		Chk'd by	<i>Bruce P. Dubouchef</i>
		Date	11/11/08

### 1.0 PURPOSE OR OBJECTIVE

Catawba Nuclear Station has decided to replace the buried nuclear service water piping lines connecting the 42-in Nuclear Service Water System (NSWS) supply and return headers to Unit 1 and Unit 2 Diesel Generator (DG) buildings. The existing 10-in carbon steel piping will be replaced by 12-in High-Density Polyethylene (HDPE) piping. The purpose of this calculation is to demonstrate the Design Basis ASME BPVC Code and Regulatory compliance for the buried HDPE piping system connecting the 42-in Return Header 'B' to the DG Building of Unit 2.

### 2.0 SCOPE AND LIMITATIONS

Results of this calculation are limited to the 12-in buried HDPE piping system returning cooling water from the Diesel Generator Building of Unit 2 to the 42-in NSWS Return Header 'B'. The piping model goes from the anchor at the wall (column lines 76 & AA) to the 42"Ø Return Header 'B' pipe of the NSWS. There is a manhole (MH-3) at Diesel Generator Building of Unit 2, and there is also a manhole (MH-8) at the connection to the 42" Ø Return Header 'B' pipe of the NSWS. The manholes provide access to the steel-to-HDPE flanged connections for the purpose of inspection and maintenance of the steel to HDPE connections. The HDPE pipe passes through the wall penetration of the manhole, but it is not attached to the structure. The manhole does not transfer any load to the HDPE pipe. The gap between the manhole penetration and the HDPE pipe is sealed to prevent water from entering the manhole through this penetration. The piping qualification includes the following:

- (a) The Steel Pipe from the Unit 2 Diesel Generator Building anchor steel to the High Density Polyethylene (HDPE) pipe Flange.
- (b) HDPE Piping from Steel – HDPE Flange near the Unit 2 Diesel Generator Building Anchor to the Steel – HDPE Flange near the 42" NSWS Return Header 'B'
- (c) The Steel Pipe from the Steel – HDPE Flange anchor to the 42" NSWS Return Header 'B', including qualification of the 12" NSWS Return Header 'B' branch connection to the NSWS Return Header pipe

### 3.0 DEFINITIONS

Nomenclature per Ref. [14], "Request for Relief Number 06-CN-003 "Use of Polyethylene Material in Nuclear Safety-Related Piping Applications" (TAC Numbers MD 3729 and MD 3730)." This nomenclature may differ somewhat from the nomenclature used in ASME BPVC Code Case N-755 Ref. [12]. Nomenclature is provided at point of use.

$A$  = Cross sectional area of pipe [in<sup>2</sup>]

$\alpha$  = Coefficient of thermal expansion [in/in/°F]

$B_1$  and  $B_2$  = Primary stress indices

$B'$  = Burial factor

$BS$  = Building settlement loads

$c$  = Allowance for erosion or mechanical damage, [in]

$D$  = Outside diameter of pipe [in]

$DR$  = Dimensional ratio of pipe; for OD-controlled pipe,  $DR = D/t$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date			11/11/08

$DW$  = Deadweight of pipe and contents [lb]  
 $E'$  = Modulus of soil reaction [psi]  
 $E_{pipe}$  = Elastic modulus of pipe [psi]  
 $f_0$  = Ovality correction factor  
 $F$  = Impact factor for surface loads.  
 $FS$  = Factor of safety (FS = 2.0 Level A, 1.8 for Level B, and 1.5 for Levels C and D)  
 $\gamma_{soil}$  = Specific weight of the soil [lb/ft<sup>3</sup>]  
 $\gamma_{water}$  = Specific weight of the water [lb/ft<sup>3</sup>]  
 $H$  = Height of fill (or cover) above top of pipe [ft]  
 $H_{gw}$  = height of groundwater above pipe [ft]  
 $k$  = Longitudinal stress factor  
 $K_b$  = Bedding factor, usually 0.1.  
 $K_0$  = Coefficient of soil pressure at rest, 0.5 to 1.0, may conservatively be taken as 1.0  
 $K_{po}$  = Spring due to pipe ovaling [lb/in]  
 $L$  = Deflection lag factor (recommended values: 1.0 for short term and 1.5 for long term loads)

$OBE_w$  = Operating Basis Earthquake due to effects of seismic wave passage  
 $OBE_S$  = Operating Basis Earthquake due to effects of soil movement  
 $OBE_D$  = Operating Basis Earthquake due to effects of anchor movements  
 $P$  = Long-term design gage pressure for the pipe at the specified design temperature [psi]  
 $P_A, P_B, P_C$  and  $P_D$  = Maximum Pressures for Service Levels A through D [psi]  
 $P_{bs}, P_{cs}$ , and  $P_{ds}$  = Surge Pressures for Service Levels B through D [psi]  
 $P_E$  = Vertical soil pressure loads due to weight of soil cover [psi]  
 $P_{gw}$  = Groundwater pressure loads [psi]  
 $P_L$  = Vertical surcharge (transportation) loads [psi]  
 $PS$  = Loads due to pump startup and shutdown  
 $R_b$  = Buoyancy reduction factor  
 $S_h$  = Design allowable stress for HDPE piping at temperature [psi]  
 $S_y$  = Yield stress [psi]  
 $SSE_w$  = Safe Shutdown Earthquake due to effects of seismic wave passage  
 $SSE_S$  = Safe Shutdown Earthquake due to effects of soil movement  
 $SSE_D$  = Safe Shutdown Earthquake due to effects of anchor movements  
 $T_{A,max}, T_{B,max}, T_{C,max}$  and  $T_{D,max}$  = Maximum temperature for Service Levels A through D [°F]  
 $T_{A,min}, T_{B,min}, T_{C,min}$  and  $T_{D,min}$  = Minimum temperature for Service Levels A through D [°F]  
 $t$  = Actual (not nominal) pipe wall thickness [in]  
 $t_{min}$  = Minimum allowable pipe wall thickness [in]  
 $VOT$  = Valve Operating Transients  
 $\nu$  = Poisson's ratio for piping  
 $\nu_r$  = Poisson ratio for the bedrock  
 $W_p$  = Weight of empty pipe [lb/ft]  
 $W_w$  = Groundwater floatation loads (usually equal to weight of water displaced by pipe) [lb]  
 $Z$  = Section modulus of pipe cross section [in<sup>3</sup>]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce S. Dubouché</i>	Date	11/11/08

### 4.0 ASSUMPTIONS

#### 4.1 Assumptions Not Requiring Verification

- [1] Due to the small Seismic Building Displacement of the Unit 2 DG Building (0.003”), the seismic response of the buried steel pipe from the DG building anchor to the HDPE piping is predominantly due the effect of seismic wave passage. The effect of the DG Building Amplified Floor Response does not need to be considered in the analysis of the buried pipe, Ref. [25].
- [2] Per discussion with Catawba Systems Engineering, it is concluded that the buried HDPE piping at Catawba is not subjected to any pressure surge loads, Ref. [25].
- [3] Seismic anchor motions of 0.003” are much less than 1/16” and therefore will have negligible effect on the piping and are not considered in the analysis.

#### 4.2 Assumptions To Be Verified

- [1] Stress Intensification Factors (SIF's) for mitered elbows less than 90° are enveloped by SIF's of 90° elbows

### 5.0 ANALYSIS METHODOLOGY AND APPROACH

#### 5.1 Background

The buried water supply system to and from the Diesel Generator (DG) buildings to the 42-in Nuclear Service Water System (NSWS) currently uses 10-in carbon steel pipes. Catawba Nuclear Station (CNS) has decided to replace the 10-in steel pipes with 12-in High-Density Polyethylene (HDPE) pipes. There are a total of eight cooling water piping lines—four supply lines and four return lines.

- Two cooling water supply lines to the DG building of Unit 1. One line originates from the 42-in Supply Header ‘A’ and the other originates from the 42-in Supply Header ‘B’.
- Two cooling water supply lines to the DG building of Unit 2. One line originates from the 42-in Supply Header ‘A’ and the other originates from the 42-in Supply Header ‘B’.
- Two cooling water return lines originating from the DG building of Unit 1. One line returns water to the 42-in Return Header ‘A’ and the other returns water to the 42-in Return Header ‘B’.
- Two cooling water return lines originating from the DG building of Unit 2. One line returns water to the 42-in Return Header ‘A’ and the other returns water to the 42-in Return Header ‘B’.

The HDPE pipes are connected to the steel pipes by means of a flanged joint. At the DG building wall entrance, a transition is made from 10-in to 12-in using a 10x12 steel reducer with flanges to provide the necessary flanged connection to the HDPE pipe and a means of providing future access for examination of all joints from the inside surface per Ref. [14]. At the 42-in header side, a short 12-in flanged steel

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

pipe is welded to the header. An additional steel flanged joint attached to the 12-in pipe provides the necessary connection to the HDPE pipe and serves as future access. The HDPE piping system is considered anchored at both ends.

The buried HDPE piping system considered in this calculation is the cooling water return line from the DG Building of Unit 2 to the 42-in Return Header 'B'. The effects of pressure, deadweight, seismic and temperature loads on the buried HDPE piping are analyzed.

### 5.2 Methodology and Approach

The piping is qualified to the requirements of the Piping Design Specification Ref. [26]. The Design Specification is based on ASME BPVC Code Case N-755 Ref. [12] and the commitments in Relief Request Number 06-CN-003 Ref. [14]. In addition, further guidance on design and analysis methods is provided in EPRI Report 1013549 Ref. [1] and S & A Design Instruction 3691-DI-001 Ref. [27]. However, the controlling design document is the Piping Design Specification Ref. [26].

The Code of Record for the Design and Analysis of the HDPE Pipe is the 1998 Edition of the ASME Boiler and Pressure Vessel Code, Section III, Division 1, Subsection ND up to and including the 2000 Addenda. However, ND-3600 of the ASME Boiler and Pressure Vessel Code 1989 Edition shall be used to comply with the limitations imposed by 10 CFR 50.55 a (b) (1) (iii) except as amended by the governing document Relief Request Number 06-CN-003, Ref. [14]. The piping is classified as ASME Class 3 Duke Class C.

The piping system is analyzed using a combination of hand calculations and the ADLPIPE computer program. ADLPIPE analyzes complex piping systems subjected to static and dynamic loads. The basic load cases (deadweight, thermal, seismic OBE, seismic SSE, etc.) and their combinations (such as thermal plus seismic) are included in the ADLPIPE analysis.

Stresses in steel pipes are automatically computed by ADLPIPE according to an ASME Code year of interest. However, ADLPIPE does not calculate the stresses for all piping load cases and combinations in the HDPE pipe because HDPE material, properties and qualification criteria are not yet included in the ADLPIPE computer code. Therefore, manual calculations are performed for the HDPE piping according to the relief request Ref. [14] which is consistent with the ASME BPVC Code Case N-755 [Ref. 12]. The required manual calculations are presented in sections 5.2.1 and 5.2.2.

#### 5.2.1 HDPE Calculations Dependent Only on Design Conditions and Pipe Size

These calculations do not require ADLPIPE analysis results as input. The HDPE pipe size and the design conditions are the only inputs needed to perform the manual calculations in this section.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

### Minimum Required Wall Thickness

Per Section 3131.1 of Ref. [12], the minimum required wall thickness ( $t_{min}$ ) of straight pipe sections is determined from:

$$t_{min} = \frac{P \cdot D}{2S + P} + c \quad (5.1)$$

where:

- $P$  = internal design gage pressure at the specified design temperature [psi]
- $D$  = outside diameter of pipe [in]
- $S$  = allowable stress [psi] from Table 3021-1 Ref. [14]
- $c$  = allowance for mechanical and erosion damage [in]

The actual wall thickness of the HDPE pipe shall not be less than  $t_{min}$ .

### Ring Deflection

Per Section 3210 of Ref. [12], the deflection of the pipe diameter ( $\Omega$ ) due to soil and surcharge loads should be less than the maximum allowable value ( $\Omega_{max}$ ):

$$\Omega = \frac{1}{144} \cdot \frac{K_b \cdot L \cdot P_E + K_b \cdot P_L}{\frac{2E_{pipe}}{3} \left( \frac{1}{DR - 1} \right)^3 + 0.061F_s \cdot E'} \leq \Omega_{max} \quad (5.2)$$

where:

- $P_E = \rho_{saturated} H_{gw} + \rho_{dry} (H - H_{gw})$
- $K_b$  = bedding factor
- $L$  = deflection lag factor
- $P_E$  = vertical soil pressure due to earth loads [lb/ft<sup>2</sup>]
- $P_L$  = vertical soil pressure due to surcharge loads [lb/ft<sup>2</sup>]
- $E_{pipe}$  = modulus of elasticity of pipe at 50 years [psi]
- $DR$  = dimensional ratio of pipe (D/t)
- $D$  = outside pipe diameter [in]
- $F_s$  = soil support factor
- $E'$  = modulus of soil reaction [psi]
- $\rho_{saturated}$  = density of saturated soil [lb/ft<sup>3</sup>]
- $\rho_{dry}$  = density of dry soil [lb/ft<sup>3</sup>]
- $H$  = height of ground cover [ft]
- $H_{gw}$  = height of groundwater above pipe [ft]
- $D$  = outside diameter of pipe [in]
- $t$  = minimum pipe wall thickness [in]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce S. Dubouché</i>
		Date		Date	11/11/08

### Compression of Sidewalls

The circumferential compressive stress ( $\sigma_{SW}$ ) in the sidewalls of pipe and miters due to soil and surcharge loads per Section 3220 of Ref. [12] should be less than 1000 psi. This 1000 psi is based on PE-3408 material and assumes a temperature of 70° F. Per Ref. [25] the allowable value at a temperature of 140° F for PE-4710 material is 530 psi. The value used in this analysis is 500 psi which is conservative. This 140° F temperature was selected because it is the maximum discharge line temperature. This lower bound value is conservatively applied to this piping analysis.

$$\sigma_{SW} = \frac{(P_E + P_L) \cdot DR}{2 \times 144} \leq 500 \text{ psi} \quad (5.3)$$

where:

- $P_E$  = vertical soil pressure due to earth loads [lb/ft<sup>2</sup>]
- $P_L$  = vertical soil pressure due to surcharge loads [lb/ft<sup>2</sup>]
- $DR$  = dimensional ratio of pipe (D/t)
- D = outside diameter of pipe [in]
- t = minimum pipe wall thickness [in]

### Buckling Due to External Pressure

External pressure from groundwater, earth loads, and surcharge loads on the buried HDPE pipe shall not cause the pipe to buckle per Section 3221.1 of Ref. [12]; that is,

$$\frac{P_E + P_L + P_{gw}}{144} \leq 2.8 \cdot \left[ R_b \cdot B' \cdot E' \cdot \frac{E_{pipe}}{12 \cdot (DR - 1)^3} \right]^{1/2} \quad (5.4)$$

where:

$$R_b = 1 - 0.33 \frac{H_{gw}}{H}$$

$$B' = \frac{1}{1 + 4e^{-0.065H}}$$

- $P_E$  = vertical soil pressure due to earth loads [lb/ft<sup>2</sup>]
- $P_L$  = vertical soil pressure due to surcharge loads [lb/ft<sup>2</sup>]
- $P_{gw}$  = pressure due to groundwater [lb/ft<sup>2</sup>]
- $R_b$  = buoyancy reduction factor
- $B'$  = burial factor
- $E_{pipe}$  = modulus of elasticity of pipe [psi]
- $E'$  = modulus of soil reaction [psi]
- $DR$  = dimensional ratio of pipe (D/t)
- H = depth of cover [ft]
- $H_{gw}$  = height of groundwater above pipe [ft]
- D = outside diameter of pipe [in]
- t = minimum pipe wall thickness [in]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce S. Dubouchef</i>
		Date	11/11/08		

### Effects of Negative Internal Pressure

Per Section 3221.2 of Ref. [12], when the pipe is subjected to a negative internal pressure, it should withstand the differential pressure ( $\Delta P$ ) without credit for the surrounding soil, that is:

$$\Delta P \leq \frac{f_o}{2} \frac{2E_{pipe}}{(1-\nu^2)} \left( \frac{1}{DR-1} \right)^3 \quad (5.5)$$

where:

$f_o$  = ovality correction factor

$E_{pipe}$  = modulus of elasticity of pipe [psi]

$\nu$  = Poisson's ratio (0.35 for short duration loads to 0.45 for long duration loads)

$DR$  = dimensional ratio of pipe (D/t)

D = outside diameter of pipe [in]

t = minimum pipe wall thickness [in]

### Floatation

To prevent floatation by groundwater, the buried pipe must have sufficient cover or be anchored to the ground. Per Section 3222 of Ref. [12], the following criterion must be satisfied:

$$W_w < W_p + \frac{P_E \cdot D}{12} \quad (5.6)$$

where:

$W_w$  = weight of water displaced by pipe [lb/ft]

$W_p$  = weight of empty pipe [lb/ft]

$P_E$  = vertical soil pressure due to earth loads [lb/ft<sup>2</sup>]

D = outside pipe diameter [in]

## 5.2.2 HDPE Calculations Requiring the Input of Geometry Specific Loads

The manual calculations in this section require the ADLPIPE analysis results as input. HDPE pipe stresses are computed using the forces and moments obtained from ADLPIPE analysis. The stress calculations are performed both for straight pipes and mitered elbows.

### Longitudinal Stress

Per Section 3223.1 of Ref. [12], the longitudinal stresses due to axial forces and bending moments resulting from applied mechanical loads shall not exceed  $k \cdot S$ :

$$B_1 \frac{P_a \cdot D}{2t} + 2B_1 \frac{F_a}{A} + B_2 \frac{M}{Z} \leq k \cdot S \quad (5.7)$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

where:

- $B_1$  and  $B_2$  = primary stress indices defined in Table 3223-1 of Ref. [12]
- $P_a$  = design or service level A, B, C or D pressure [psi]
- $D$  = outside diameter of pipe at the section where the evaluation is conducted [in]
- $t$  = nominal pipe wall thickness at the section where the evaluation is conducted [in]
- $F_a$  = axial force due to the specified design, level A, B, C or D applied mechanical loads [lb]
- $M$  = resultant bending moment due to the specified design, level A, B, C or D applied mechanical loads [in.-lb]
- $A$  = cross sectional area of pipe at the section where the force is calculated [in<sup>2</sup>]
- $Z$  = section modulus of pipe cross section at the section where the moment is calculated [in<sup>3</sup>]
- $k$  = longitudinal stress factor per Table 3223-2 of Ref. [12]
- $S$  = allowable stress [psi] from Table 3021-1 Ref. [14]

### Thermal Expansion and Contraction

#### (a) Fully Constrained Thermal Contraction

The tensile stress, per Section 3311.1 of Ref. [12], resulting from the assumption of fully constrained thermal contraction of the buried pipe when  $T_{\text{water}} < T_{\text{ground}}$ , increased by the tensile stress due to axial contraction from Poisson effect, shall not exceed the allowable stress (S):

$$\sigma_{\tau} = \left| E_{\text{pipe}} \cdot \alpha \cdot \Delta T - \nu \frac{P \cdot D}{2t} \right| \leq S \quad (5.8)$$

- where:
- $E_{\text{pipe}}$  = modulus of elasticity of pipe [psi]
  - $\alpha$  = coefficient of thermal expansion [in/in/°F]
  - $\Delta T = T_{\text{water}} - T_{\text{ground}} < 0$ , [°F]
  - $\nu$  = Poisson's ratio (0.35 for short duration loads to 0.45 for long duration loads)
  - $P$  = internal design gage pressure including pressure spikes due to transients from anticipated water hammer events [psi]
  - $D$  = outside pipe diameter [in]
  - $t$  = pipe wall thickness [in]
  - $S$  = allowable stress [psi] from Table 3021-1 Ref. [14]

#### (b) Fully Constrained Thermal Expansion

The tensile stress resulting from the assumption of fully constrained thermal expansion of the buried pipe when  $T_{\text{water}} > T_{\text{ground}}$ , per Section 3311.2 of Ref. [12], shall not exceed the allowable stress (S):

$$E_{\text{pipe}} \cdot \alpha \cdot \Delta T \leq S \quad (5.9)$$

- where:
- $E_{\text{pipe}}$  = modulus of elasticity of pipe [psi]
  - $\alpha$  = coefficient of thermal expansion [in/in/°F]
  - $\Delta T = T_{\text{water}} - T_{\text{ground}} > 0$ , [°F]
  - $S$  = allowable stress [psi] from Table 3021-1 Ref. [14]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

### (c) Alternative Evaluation for Thermal Expansion or Contraction

When the soil stiffness is accounted for to calculate the pipe expansion and contraction stresses, per Section 3311.3 of Ref. [12], the stresses must satisfy the following condition:

$$\frac{i \cdot M_C}{Z} + \frac{F_{aC}}{A} \leq 1100 \text{ psi} \quad (5.10)$$

where:

$i$  = stress intensification factor

$F_{aC}$  = axial force range due to thermal expansion or contraction and/or the restraint of free end displacement [lb]

$M_C$  = resultant moment range due to thermal expansion or contraction and/or the restraint of free end displacement [in.-lb]

$A$  = cross sectional area of pipe at the section where the force is calculated [in<sup>2</sup>]

$Z$  = section modulus of pipe cross section at the section where the moment is calculated [in<sup>3</sup>]

### Non-repeated Anchor Movements

Per Section 3312 of Ref. [12], the effects of any single non-repeated anchor movement shall meet the requirements of the following equation:

$$\frac{i \cdot M_D}{Z} + \frac{F_{aD}}{A} \leq 2 \cdot S \quad (5.11)$$

where:

$i$  = stress intensification factor

$F_{aD}$  = axial force due to the non-repeated anchor motion [lb]

$M_D$  = resultant moment due to the non-repeated anchor motion [in.-lb]

$A$  = cross sectional area of pipe at the section where the force is calculated [in<sup>2</sup>]

$Z$  = section modulus of pipe cross section at the section where the moment is calculated [in<sup>3</sup>]

$S$  = allowable stress [psi] from Table 3021-1 Ref. [14]

### Seismic Induced Stresses

Per Section 3410 of Ref. [12], the stresses in the buried pipe due to soil strains caused by seismic wave passage, seismic soil movement, and building seismic anchor motion effects, where applicable, must satisfy the following equation:

$$\frac{i \cdot M_E}{Z} + \frac{F_{aE}}{A} \leq 1100 \text{ psi} \quad (5.12)$$

where:

$i$  = stress intensification factor

$F_{aE}$  = axial force range due to the combined effects of seismic wave passage, seismic soil movement, and building seismic anchor motion effects [lb]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

$M_E$  = resultant moment range due to the combined effects of seismic wave passage, seismic soil movement, and building seismic anchor motion effects [in.-lb]

A = cross section area of pipe at the section where the force is calculated [in<sup>2</sup>]

Z = section modulus of pipe cross section at the section where the moment is calculated [in<sup>3</sup>]

Seismic wave passage, seismic soil movement, and building seismic anchor motions are combined by square root sum of the squares. This equation is applicable to both OBE and SSE. Ref. [25] Section 7.0 provides the basis of this applicability.

### 5.2.3 Steel Pipe Criteria

The steel pipe from the Diesel Generator building anchor to the HDPE pipe flange connection and from the HDPE pipe flange connection to the 42"Ø return header are qualified in the ADLPIPE analysis in accordance with Ref. [29]. The stresses for the steel pipe are shown in Section 7.4.

## 6.0 ANALYSIS INPUTS

### 6.1 Design Loads

Design temperature and pressure values supplied by Duke Power Carolinas and used as input in this calculation are listed in Table 6.1.

Design Temperature	140 °F
Ambient Temperature	55 °F
Minimum Temperature	32 °F
Maximum Temperature	140 °F
Design Pressure	60 psig
Operating Pressure	25 psig

### 6.2 Pipe Properties

Geometric and other relevant properties for the pipes used in this calculation are shown in Table 6.2. Outside diameter (OD), thickness and weight values for steel pipes were taken from standard piping catalogs, Ref. [10]. For IPS HDPE pipe, OD values were taken from ANSI/AWWA C906-99, Ref. [4], thickness values were obtained from Ref. [12,] and weight values were taken from manufacturers' literature [Ref. 8]. For the same nominal pipe size, the ODs of the HDPE pipes and the steel pipes are equal; therefore, the IPS sizing system is used.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010	
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date			11/11/08

	Cr-Mo Steel Pipe		Carbon Steel Pipe	HDPE Pipe/Elbow
Nominal size	10-in	12-in	12-in	12-in
Material	A6XLN <sup>(1)</sup>	A6XLN <sup>(1)</sup>	A-106, Gr. B	PE 4710 <sup>(2)</sup>
Schedule	Standard	Standard	Standard	DR 11/DR 9
Outside Diameter [in]	10.75	12.75	12.75	12.75
Wall Thickness [in]	0.365	0.375	0.375	1.159/1.417
Contents	Water	Water	Water	Water
Wt. of Contents [lb/ft]	34.1	49.0	49.0	37.0/33.5
Wt. of Pipe [lbs/ft]	40.5	49.6	49.6	18.4/22

<sup>(1)</sup> This is a manufacturer's designation for a Cr-Mo alloy used for piping as SB-675 and SB-690, for forgings as SB-462, and for castings as SB-366.

<sup>(2)</sup> The cell classification of PE 4710 material is 445574C

### 6.3 Material Properties

Properties of A-106 carbon steel and A6XLN (Cr-Mo) are given in Tables 6.3a and 6.3b. The values in Table 6.3a were obtained from the 1989 edition of the ASME B&PVC, Section III [Ref. 29]. The values in Table 6.3b were obtained from the 1998 edition of the ASME B&PVC, Section III, Part D [Ref. 11].

Temperature, T [°F]	32	55	65	100	140
Coeff. of Thermal Exp., $\alpha$ [in/in/°F]	$6.5 \times 10^{-6}$				
Modulus of Elasticity, E [ksi]	27,900	27,900	27,900	27,900	27,900
Allowable Stress, $S_c$ [psi]	15,000	15,000	15,000	15,000	15,000
$S_h$ [psi]	15,000	15,000	15,000	15,000	15,000
Yield Stress, $S_y$ [psi]	35,000	35,000	35,000	35,000	35,000

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date			11/11/08

Temperature, T [°F]	32	55	65	100	140
Coeff. of Thermal Expansion, $\alpha$ [in/in/°F]	$8.2 \times 10^{-6}$	$8.2 \times 10^{-6}$	$8.2 \times 10^{-6}$	$8.2 \times 10^{-6}$	$8.4 \times 10^{-6}$
Modulus of Elasticity, E [ksi]	28,000	28,000	28,000	28,000	28,000
Allowable Stress <sup>(1)</sup> , $S_c$ [psi]	24,300	24,300	24,300	24,300	24,300
$S_h$ [psi]	24,300	24,300	24,300	24,300	24,300
Yield Stress <sup>(2)</sup> , $S_y$ [psi]	45,000	45,000	45,000	45,000	45,000

**Notes:**

<sup>(1)</sup> A6XLN is a manufacturer's designation for the following Cr-Mo alloys: SB-675, SB-690, and SB-462. The values shown here correspond to the minimum values listed in the 1998 ASME Code.

<sup>(2)</sup> The yield strength shown here corresponds to that of SB-675, SB-690, and SB-462.

The mechanical properties of HDPE vary significantly with load duration. Therefore, different values must be used for different load cases. Tables 6.3c thru 6.3f provide the mechanical properties of HDPE for various load durations.

Mechanical properties obtained for 50-year load duration are given in Table 6.3c. These properties are used for deadweight and thermal analysis.

Temperature, T [°F]	32	55	65	100	140
Coeff. Of Thermal Exp., $\alpha$ [in/in/°F]	$90 \times 10^{-6}$				
Modulus of Elasticity <sup>(1)</sup> , E [ksi]	28	28	28	23	12
Allowable Stress <sup>(2)</sup> , S [psi]	800	800	800	620	430
Poisson's Ratio, $\nu$ [ - ]	0.45	0.45	0.45	0.45	0.45

(1) Per Table 3210-3 of Ref. [12]

(2) Per Table 3131-1 of Ref. [12]. The allowable stress at 140° F is in development. The value shown here at 140° F is the S&A best estimate based on values provided in Table 3131-1 of Ref. [12].

Mechanical properties obtained for short-term load duration are shown in Table 6.3d. These are used for OBE, SSE, and equivalent thermal strain analysis.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date			11/11/08

Property	32	55	65	100	140
Temperature, T [°F]	32	55	65	100	140
Coeff. Of Thermal Exp., $\alpha$ [in/in/°F]	$90 \times 10^{-6}$				
Modulus of Elasticity <sup>(1)</sup> , E [ksi]	110	110	110	100	50
Allowable Stress <sup>(2)</sup> , S [psi]	1200	1200	1200	940	630
Poisson's Ratio, $\nu$ [ - ]	0.35	0.35	0.35	0.35	0.35

(1) Per Table 3210-3 of Ref. [12]  
(2) Per Table 3223-3 of Ref. [12]

Property	32	55	65	100	140
Temperature, T [°F]	32	55	65	100	140
Coeff. Of Thermal Exp., $\alpha$ [in/in/°F]	$90 \times 10^{-6}$				
Modulus of Elasticity <sup>(1)</sup> , E [ksi]	44	44	44	36	18
Allowable Stress <sup>(2)</sup> , S [psi]	840	840	840	620	430
Poisson's Ratio, $\nu$ [ - ]	0.45	0.45	0.45	0.45	0.45

(1) Per Table 3210-3 of Ref. [12]  
(2) The allowables for 10-year duration listed in Table 3131-1 of Ref. [12] are used. This is conservative.

Property	32	55	65	100	140
Temperature, T [°F]	32	55	65	100	140
Coeff. Of Thermal Exp., $\alpha$ [in/in/°F]	$90 \times 10^{-6}$				
Modulus of Elasticity <sup>(1)</sup> , E [ksi]	32	32	32	26	13
Allowable Stress <sup>(2)</sup> , S [psi]	840	840	840	620	430
Poisson's Ratio, $\nu$ [ - ]	0.45	0.45	0.45	0.45	0.45

(1) Per Table 3210-3 of Ref. [12]  
(2) Per Table 3131-1 of Ref. [12]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

### 6.4 HDPE to Steel Boundary

The HDPE pipe is connected to the steel pipe by means of a flanged connection. The following piping components are used for the joints at the entrance to the DG building wall and at the 42-in header:

- A 10-in by 12-in steel reducer
- 10-in, 150-lb ANSI B16.5 raised face welding neck steel flanges
- 12-in, 150-lb ANSI B16.5 raised face welding neck steel flanges
- A 12-in, short-radius, 90° steel elbow
- Two HDPE flange adapters
- Two special steel backup rings that possess the same bolt pattern as 12-in, 150-lb steel flanges and are used in conjunction with the HDPE adapters

Relevant properties for the above piping components were obtained from manufacturers' catalogs – Ref. [9] for the steel components and Ref. [8] for the HDPE components and steel backup rings. The properties are listed in Table 6.6.

Piping Component	Nominal Size [in]	Thickness [in]	Length [in]	O. D. [in]	Weight [lb]
150-lb, Welding Neck Steel Flange	10	0.365	4	12 <sup>(1)</sup>	54
	12	0.375	4.5	14.375 <sup>(1)</sup>	88
Steel Reducer	10x12	NA <sup>(2)</sup>	8	NA <sup>(2)</sup>	34
90° Steel Elbow	12	0.375	12 <sup>(3)</sup>	12.75	80
HDPE Flange Adapter	12	1.55	12	12.75	24
Steel Backup Ring	12	1.25	1.25	19	24

<sup>(1)</sup> These values represent the diameter of the flange hub at base.  
<sup>(2)</sup> OD and thickness for a reducer are variable and are not required as input.  
<sup>(3)</sup> This is the center to face length; it is also equal to the radius of the elbow.

### 6.5 HDPE Elbows

The piping system includes 90° and 45° HDPE mitered elbows. The mitered elbows are size DR 9 (one DR ratio lower than the HDPE pipe that is DR-11) to comply with the requirements of ASME BPVC Code Case N-755 Paragraph -3132(d) Ref. [12]. These elbows are modeled according to the manufacturer's catalog specifications [Ref. 8]. The 90° mitered elbow has 5 segments as shown in Fig. 6.5a and the 45° mitered elbow has 3 segments as shown in Fig. 6.5b. This piping analysis has 90° and 45° mitered elbows in the model.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator "2B" Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouchef</i>
		Date	11/11/08		

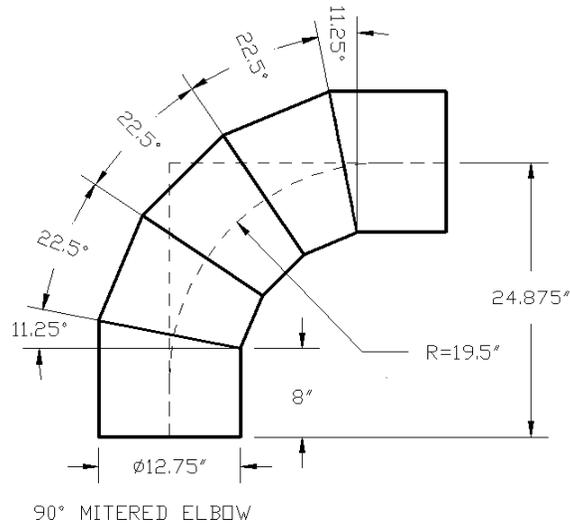


Fig. 6.5a: Geometry of 90° HDPE mitered elbow

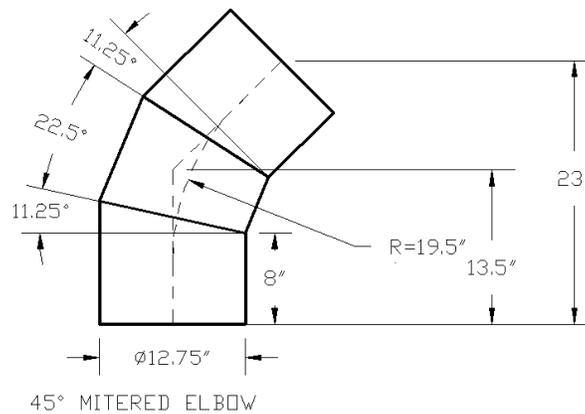


Fig. 6.5b: Geometry of 45° HDPE mitered elbow

### 6.6 Stress Indices and SIFs

ADLPIPE automatically calculates stress indices and stress intensification factors (SIF) for the steel piping components based on the 1989 Code [Ref. 29]. The 10-in and 12-in steel piping has butt welded fittings. The analysis is based on the 1989 Class 3 ASME Code.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis		
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2		
By:	<i>L. Hails</i>	Date	11/10/08
		Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08

### 6.6.1 HPDE Pipe

The buried HDPE piping is DR-11 butt welded, straight pipe. The following stress index and SIF values as listed in Tables 3223-1 and 3311.2-1 of Ref. [12], are used:

Stress Indices:  $B_1 = 0.5$   
 $B_2 = 1.0$   
 Stress Intensification Factor:  $i = 1.0$

### 6.6.2 HPDE Mitered Elbows

The 90° mitered elbows are DR-9. SIF and stress index values for these components, as obtained from Tables 3223-1 and 3311.2-1 of Ref. [12], are as follows:

Stress Indices:  $B_1 = 0.69$   
 $B_2 = 1.64$   
 Stress Intensification Factor:  $i = 2.0$

These values are for 5 segment 90° mitered elbows. Per Ref. [25] Section 6.1, it is assumed these values envelope the 3 segment 45° mitered elbows.

### 6.6.3 Flexibility Factors for Mitered Elbows

The flexibility factor calculated by ADLPIPE for the 12"Ø mitered elbows is  $1.79 \approx 1.82$  which is the calculated flexibility factor per Table NB-3673.2 (b)(1), Section 5.6.2.3 of Ref. [22]. The preliminary mean flexibility factor from testing Ref. [22] of the 12"Ø elbows is 2.15 for in-plane and 2.44 for out-of-plane Ref. [22]. The lower flexibility factor calculated by ADLPIPE will result in higher moments on the piping system due to less flexibility. The calculated Stress Intensification Factor (SIF) calculated from Table NB-3673.2(b)(1) for 12" Ø elbows is 1.04 in-plane and 0.87 out-of-plane. This piping analysis uses a 2.0 SIF for in-plane and out-of-plane for the mitered elbows which is from Code Case N-755 Ref. [12].

### 6.6.4 Weldolet

A Weldolet is used for attaching the 12-in pipe to the 42-in header. The stress intensification factor for the Weldolet is determined from the following equation given in Ref. [17]:

$$i = \frac{0.9}{(3.3t/r)^{2/3}}$$

where:  $i$  = stress intensification factor  
 $t$  = nominal wall thickness of run pipe [in]  
 $r$  = mean radius of run pipe [in]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

For the 42-in diameter pipe,  $t = 0.500$  in. [Ref. 10], and the mean radius,  $r = (42 - 0.500)/2 = 20.75$  in. The stress intensification factor is therefore:

$$i = \frac{0.9}{(3.3 * 0.5 / 20.75)^{2/3}} = 4.87$$

### 6.7 Soil Springs

The buried piping is subject to loads from earthquake, temperature and surrounding soil. To determine the pipe stresses resulting from these loads, the soil spring stiffness is required as input. For this piping system, the height of soil from top of the pipe is 5 ft. Therefore, soil spring stiffness values obtained in Ref. [15] for  $H = 5$  ft and shown here in Table 6.7 will be used as input in the ADLPIPE analysis of this piping. Soil springs are generally applied at 2 ft intervals around elbows (over 6ft sections on each side of elbows) and at 10 ft intervals elsewhere.

H = 5 ft	Lateral	130	3120	15600
	Vertical	540	12960	64800
	Axial	425	10200	51000

Note that soil spring stiffness values for pipe sections of length other than shown in Table 6.7 can be determined by proportion.

### 6.8 Seismic Analysis Input

#### 6.8.1 Seismic Anchor Motion

Per Calculation CNC-1206.02-84-0001 [Ref. 16] provided by CNS, the seismic displacement of the DG building is less than 0.003 inches for OBE or SSE analysis. The 42"  $\emptyset$  Return Line is attached at the Auxiliary Building and has the following seismic displacements: lateral = 0.014328" < 1/16 in, axial = 0.01374" < 1/16 in, and vertical = 0.0" for OBE or SSE analysis. These displacements are considered insignificant for this analysis and a seismic anchor motion analysis is therefore not conducted.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce S. Dubouché</i>	Date	11/11/08

### 6.8.2 Seismic Wave Passage

Since the piping system is completely buried and isolated from aboveground piping, the methodology of Non-Mandatory Appendix D of ASME BPVC Code Case N-755 will be used to qualify the piping for seismic wave passage. In Ref. [18], the strains due to seismic wave passage were computed and then converted to an equivalent thermal strain resulting in a temperature change ( $\Delta T$ ) of 10 °F. This change in temperature will be used as input in the ADLPIPE computer model as a thermal analysis of the piping system to determine the seismic loads.

### 6.8.3 Decoupling of 12” Steel Pipe

If the ratio of the moment of inertia of the run pipe to branch pipe (decoupled pipe) is equal to or greater than 25, the branch piping may be considered to have no significant effect on the response of the run pipe, Ref. [28].  $I_{12'' \text{ branch pipe}} = 300 \text{ in}^4$ ;  $I_{42'' \text{ run pipe}} = 14037 \text{ in}^4$ ; ratio of run to branch is 46. The analysis of the decoupled piping shall consider the thermal, seismic, and other movements of the run pipe at the intersection point. There are no thermal or seismic anchor movements (See section 6.8.1) on the run pipe. The steel buried pipe will not have seismic response from the seismic wave passage. Therefore, there are no anchor movements at the 12” pipe (branch) to the 42” pipe (run) connection.

### 6.9 Piping Layout

The layout of the piping system is shown in the following drawings provided by Duke Power Carolinas: CN-1038-06 [Ref. 5], CN-1038-11 [Ref. 6] and CN-1038-12 [Ref. 7]. Dimensions and orientations of piping shown on these drawings were used in generating the ADLPIPE computer model for the piping system. A sketch of the piping layout is shown in Fig. 6.9

# CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouchef</i>	Date	11/11/08

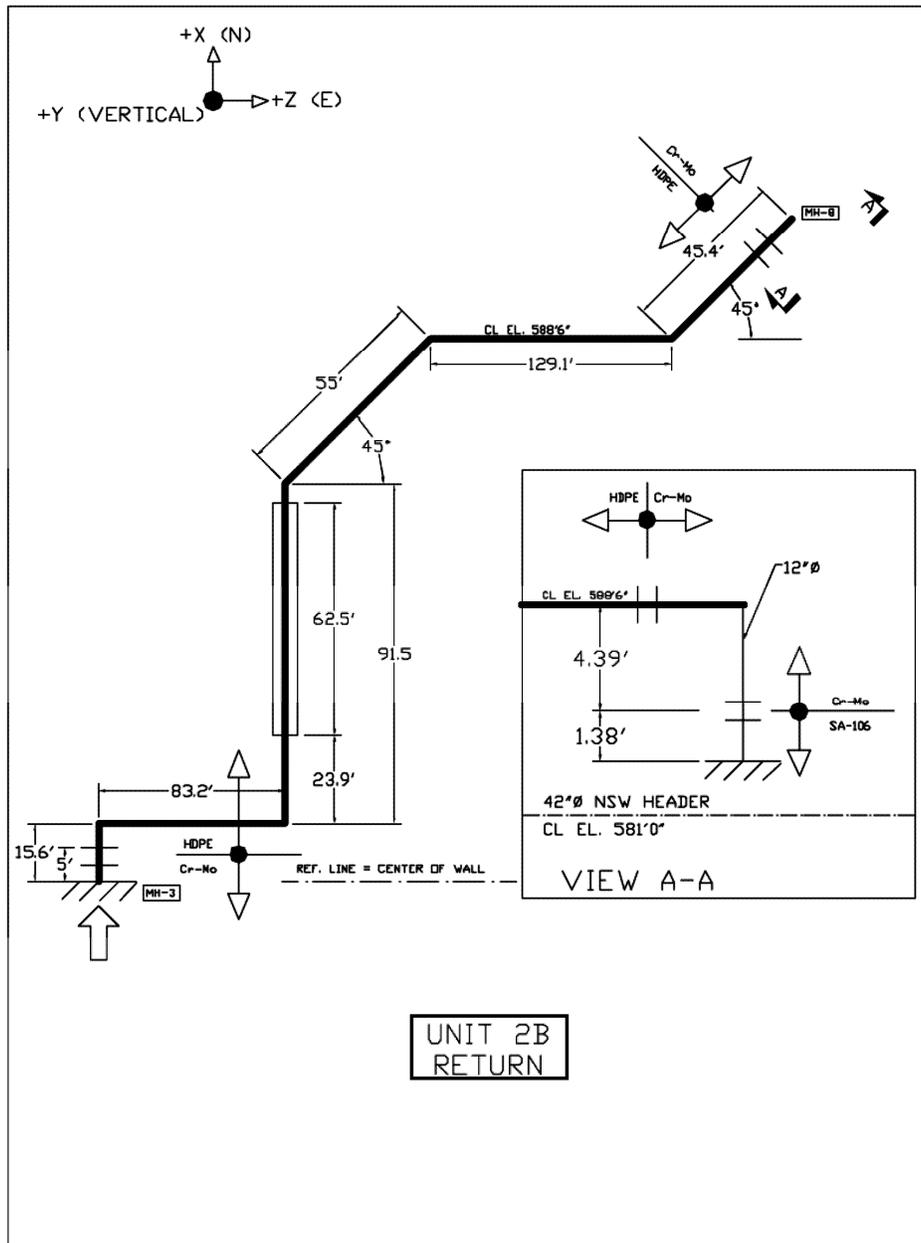


Fig. 6.9

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

### 6.10 Pipe Criteria – Steel and HDPE

The pipe load combinations considered and shown in Table 6.10(a) – Steel

Table 6.10(a) Buried Steel Piping Load Combinations		
Service Level	Stress Condition	Load Combination
Design	Primary	P
	Primary	P + DW
A	Primary	$P_a$
	Primary - - Longitudinal Stress	$P_a + DW$
	Secondary	Range of ( $T_{a \min}$ , $T_{a \max}$ )
	Non Repeated Anchor Motion	BS
B	Primary	$P_b$
	Primary	$P_{bs}$
	Primary - - Longitudinal Stress	$P_b + DW + VOT$ $P_b + DW + PS$
	Secondary – Thermal and Seismic	(a) Range of ( $T_{b \min}$ , $T_{b \max}$ ) (b) $ T_{b \max}  + \left[ \text{OBE}_W^2 + (  \text{OBE}_S   +   \text{OBE}_D  )^2 \right]^{1/2}$ (c) $ T_{b \min}  + \left[ \text{OBE}_W^2 + (  \text{OBE}_S   +   \text{OBE}_D  )^2 \right]^{1/2}$
C	Primary	$P_c$
D	Primary	$P_d$
	Secondary - Seismic	$[\text{SSE}_W^2 + (  \text{SSE}_S   +   \text{SSE}_D  )^2]^{1/2}$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

The pipe load combinations considered and shown in Table 6.10(b) – HDPE

Table 6.10(b)- Buried HDPE Piping Load Combinations		
Service Level	Stress Condition	Load Combination
Design		P
		P + DW
A	Primary - Side Wall Compression	$P_E + P_L$
	Primary - Buckling due to External Pressure	$P_E + P_L + P_{gw}$
	Primary -- Flotation	$W_W$
	Primary -- Pressure	$P_a$
	Primary - - Longitudinal Stress	$P_a + DW$
	Secondary	Range of ( $T_{a \min}$ , $T_{a \max}$ )
	Non Repeated Anchor Motion	BS
B	Primary - Side Wall Compression	$P_E + P_L$
	Primary - Buckling due to External Pressure	$P_E + P_L + P_{gw}$
	Primary -- Flotation	$W_W$
	Primary -- Pressure	$P_b$
	Primary -- Pressure + Surge Pressure	$P_b + P_{bs}$
	Primary - - Longitudinal Stress	$P_b + DW$
	Primary -- Pressure + Longitudinal Stress + Short Term	$P_b + DW + VOT$ $P_b + DW + PS$
	Secondary -- Thermal	Range of ( $T_{b \min}$ , $T_{b \max}$ )
	Secondary -- Seismic	$[OBE_W^2 + ( OBE_S  +  OBE_D )^2]^{1/2}$
C	Primary -- Side Wall Compression	$P_E + P_L$
	Primary -- Buckling due to External Pressure	$P_E + P_L + P_{gw}$
	Primary -- Flotation	$W_W$
	Primary -- Pressure	$P_c$
	Primary -- Pressure + Surge Pressure	$P_c + P_{cs}$
	Secondary -- Thermal	Range of ( $T_{c \min}$ , $T_{c \max}$ )
D	Primary -- Side Wall Compression	$P_E + P_L$
	Primary -- Buckling due to External Pressure	$P_E + P_L + P_{gw}$
	Primary -- Flotation	$W_W$
	Primary -- Pressure	$P_d$
	Primary -- Pressure + Surge Pressure	$P_d + P_{ds}$
	Secondary -- Thermal	Range of ( $T_{d \min}$ , $T_{d \max}$ )
	Secondary -- Seismic	$[SSE_W^2 + ( SSE_S  +  SSE_D )^2]^{1/2}$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

### 6.11 Acceptance Criteria – Steel and HDPE

The criteria used to evaluate the adequacy of the buried steel piping system are summarized in Table 6.11(a).

Table 6.11(a) - Buried Steel Piping Capacity Criteria		
Service Level	Stress Condition	Capacity Criteria
Design	Primary	Requirements of ND-3640
	Primary	ND-3652, Equation (8) with a Stress Limit of $1.5 S_h$
A	Primary	Less than 1.0 P
	Primary - - Longitudinal Stress	ND-3653.1, Equation (9) with a stress limit of Lesser of $1.8 S_h$ or $1.5 S_y$
	Secondary	ND-3653.2(a), Equation (10) with a stress limit of $S_A$
	Non Repeated Anchor Motion	ND-3653.2(b), Equation (10a) with a stress limit of $3.0 S_c$
B	Primary	Less than 1.1 P
	Primary - - Longitudinal Stress	ND-3653.1, Equation (9) with a stress limit of Lesser of $1.8 S_h$ or $1.5 S_y$
	Secondary – Thermal and Seismic	ND-3653.2(a), Equation (10) with a stress limit of $S_A$
C	Primary	Less than 1.8 P
D	Primary	Less than 2.0 P
	Secondary - Seismic	ND-3653.2(a), Equation (10) with a stress limit of $S_A$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis		
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2		
By:	<i>L. Hails</i>	Date	11/10/08
		Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08

The criteria used to evaluate the adequacy of the buried HDPE piping system are summarized in Table 6.11(b).

Table 6-11(b) - Buried HDPE Capacity Criteria		
Service Level	Stress Condition	Capacity Criteria
Design		Requirements of N755-3131.1
		Requirements of N755-3223.1 with k=1.0
A	Primary – Side Wall Compression	500 psi (N755-3220)
	Primary – Buckling due to External Pressure	Requirements of N755-3221.1
	Primary – Flotation	$W_P + [P_E * (DW/12)]$
	Primary	Less than $1.0 * P$
	Primary – Longitudinal Stress	Requirements of N755-3223.1 with k=1.0
	Secondary – Thermal	1100 psi (N755-3311.3)
	Non Repeated Anchor Motion	$2 * S$ (N755-3312)
B	Primary – Side Wall Compression	500 psi (N755-3220)
	Primary – Buckling due to External Pressure	Requirements of N755-3221.1
	Primary – Flotation	$W_P + [P_E * (DW/12)]$
	Primary – Pressure	Less than $1.1 * P$
	Primary – Pressure + Surge Pressure	$1.5 * P$
	Primary – Longitudinal Stress	Requirements of N755-3223.1 with k=1.1
	Primary – Pressure + Longitudinal Stress + Short Duration	Requirements of N755-3223.2 or $0.4 * \text{Material tensile strength at yield}$
	Secondary – Thermal	1100 psi (N755-3311.3)
Secondary – Seismic	1100 psi (N755-3410)	
C	Primary – Side Wall Compression	500 psi (N755-3220)
	Primary – Buckling due to External Pressure	Requirements of N755-3221.1
	Primary – Flotation	$W_P + [P_E * (DW/12)]$
	Primary – Pressure	Less than $1.33 * P$
	Primary – Pressure + Surge Pressure	$2.0 * P$
	Secondary – Thermal	1100 psi (N755-3311.3)
D	Primary – Side Wall Compression	500 psi (N755-3220)
	Primary – Buckling due to External Pressure	Requirements of N755-3221.1
	Primary – Flotation	$W_P + [P_E * (DW/12)]$
	Primary – Pressure	Less than $1.33 * P$
	Primary – Pressure + Surge Pressure	$2.0 * P$
	Secondary – Thermal	1100 psi (N755-3311.3)
	Secondary – Seismic	1100 psi (N755-3410)

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>	Date	11/11/08

### 7.0 ANALYSIS

The analysis of the piping system is done per the Piping Design Specification Ref. [26] using analysis methods consistent with the Relief Request, Ref. [14], and the ASME BPVC Code Case N-755 Ref. [12] as outlined in Section 5.2 of this calculation. The calculations presented in Section 5.2.1 are dependent only on design conditions and pipe size. For the calculations described in Section 5.2.2, the loads acting on the piping system (due to pressure, deadweight, thermal, seismic, etc.) for the various service levels are required. These loads are determined using the ADLPIPE computer program.

#### 7.1 Computer Model

The run starts at the DG building wall of Unit 2 (Node Pt. = 100) and ends at the centerline of the 42-in Return Header 'B' (Node Pt. = 990). The piping system is considered anchored at each end.

A steel flange is welded to the 10-in pipe coming out of the DG building wall. A 10x12 steel reducer, with flanges on both ends, is attached to the 10-in pipe coming out of the DG building wall. A flanged joint is created (Node Pt. 130) between the steel reducer and the HDPE pipe by fusing an HDPE flange adapter, with a steel backup ring mounted on it, to the end of the HDPE pipe. The steel backup ring and the flange on the reducer have the same bolt pattern.

A 12-in pipe with a flange on one end is welded to the 42-in header. An additional 12-in steel pipe with flanges welded to its ends extends to Node Pt. 880. A flanged joint between the steel pipe and the HDPE pipe is created (Node Pt. 880) by fusing an HDPE flange adapter, with a steel backup ring mounted on it, to the end of the HDPE pipe. The steel backup ring and the flange on the 12-in pipe piece have the same bolt pattern.

Various mitered elbows are used as the HDPE pipe is routed from Node Pt. 130 at EL. 588'-6" to Node Pt. 880 at EL. 588'-6".

Details of the piping dimensions and routing are found in Refs. [5], [6], and [7]. The isometric sketch of the piping system is attached in Appendix A. The ADLPIPE computer model was created for this piping system using the inputs listed in Section 6 of this calculation. Soil springs were generally applied at 2 ft intervals around elbows and at 10 ft intervals in the remaining section of the piping. A complete listing of the ADLPIPE model (input file) and analysis results (output file) are attached in Appendix B.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

### 7.2 Results of ADLPIPE Analysis

#### 7.2.1 Load Cases Analyzed

Steel and HDPE pipe load cases as well as load combinations analyzed using the ADLPIPE piping analysis program are shown in Tables 7.2.1a and 7.2.1b. Thermal cases are required for Level A, B, C, and D because of the time dependence of the elastic modulus for HDPE pipe. The following durations were used for each service level:

Service Level A: 50 Years Ref. [14]  $E_c = 28,000$  psi  $E_h = 12,000$  psi  
 Service Level B: 10 Years Ref. [14]  $E_c = 32,000$  psi  $E_h = 13,000$  psi  
 Service Level C: 1000 Hrs Ref. [14]  $E_c = 44,000$  psi  $E_h = 18,000$  psi  
 Service Level D: 1000 Hrs Ref. [14]  $E_c = 44,000$  psi  $E_h = 18,000$  psi

Load Type	Load Case
Deadweight + Pressure	10
Level A Thermal at Minimum Temperature, $T_{min} = 32^\circ$ F ( $\Delta T = -23^\circ$ F)	21
Level A Thermal at Maximum Temperature, $T_{max} = 140^\circ$ F ( $\Delta T = 85^\circ$ F)	22
Level B Thermal at Minimum Temperature, $T_{min} = 32^\circ$ F ( $\Delta T = -23^\circ$ F)	23
Level B Thermal at Maximum Temperature, $T_{max} = 140^\circ$ F ( $\Delta T = 85^\circ$ F)	24
Level C/D Thermal at Minimum Temperature, $T_{min} = 32^\circ$ F ( $\Delta T = -23^\circ$ F)	25
Level C/D Thermal at Maximum Temperature, $T_{max} = 140^\circ$ F ( $\Delta T = 85^\circ$ F)	26
Thermal at $T = 65^\circ$ F ( $\Delta T = 10^\circ$ F) <sup>(1)</sup>	30

<sup>(1)</sup> This is a pseudo-seismic case.  $\Delta T$  is the equivalent temperature rise for computing the seismic loads on the piping system.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis		
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2		
By:	<i>L. Hails</i>	Date	11/10/08
		Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08

Load Type	Load Case
Level A : Absolute Range of Load Cases 21 and 22	27
Level B : Absolute Range of Load Cases 23 and 24	28
Level C/D : Absolute Range of Load Cases 25 and 26	29
Level D : Absolute Range of Load Case 30 (SSE)	31
Level B : Load Case 31 / 1.875 (OBE) <sup>(1)</sup>	32
Level B: Absolute Thermal Max (L.C. 24) + OBE Seismic (L.C. 32)	40
Level B: Absolute Thermal Min (L.C. 23) + OBE Seismic (L.C. 32)	41
Level B: Max of Load Case 28, 40 and 41	45

<sup>(1)</sup> Per page 94 of Ref. [16], OBE = SSE/1.875.

### 7.2.2 Summary of HDPE Loads at Critical Locations

The loads acting at the critical locations on the HDPE pipe (i.e., where the maximum stresses occur) for Service Levels A, B, C and D are extracted from the results of the ADLPIPE analysis. These loads are summarized in Tables 7.2.2a to 7.2.2d and will be used for computing pipe stresses as described in Section 5 of this calculation.

#### Service Level A

Load Case	Straight Pipe				Mitered Elbow			
	F [lb]	Node No.	M [ft-lb]	Node No.	F [lb]	Node No.	M [ft-lb]	Node No.
10	0	820	515	820	0	320	70	320

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

Service Level B								
Load Case	Straight Pipe				Mitered Elbow			
	Force [lb]	Node No.	Moment [ft-lb]	Node No.	Force [lb] <sup>(1)</sup>	Node No.	Moment [ft-lb]	Node No.
27 (Level A)	5474	880	470	880	2500	650	1100	650
28 (Level B)	5972	880	540	880	2749	650	1234	650
29 (Level C/D)	7904	880	808	880	3720	650	1771	650
<sup>(1)</sup> Values shown here were obtained from the SRSS of forces acting on the mitered elbow. Using these values for axial force is therefore conservative.								

### Service Level B

Service Level D								
Load Case	Straight Pipe				Mitered Elbow			
	F [lb]	Node No.	M [ft-lb]	Node No.	F [lb] <sup>(1)</sup>	Node No.	M [ft-lb]	Node No.
32 (OBE)	2813	880	600	880	1532	650	997	650
<sup>(1)</sup> Values shown here were obtained from the SRSS of forces acting on the mitered elbow. Using these values for axial force is therefore conservative.								

### Service Level D

Service Level D								
Load Case	Straight Pipe				Mitered Elbow			
	F [lb]	Node No.	M [ft-lb]	Node No.	F [lb] <sup>(1)</sup>	Node No.	M [ft-lb]	Node No.
31 (SSE)	5275	880	1124	880	2873	650	1869	650
<sup>(1)</sup> Values shown here were obtained from the SRSS of forces acting on the mitered elbow. Using these values for axial force is therefore conservative.								

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>	Date	11/11/08

### 7.3 Calculations per ASME BPVC Code Case N-755

The HDPE piping system was analyzed per the Design Specification Ref. [26] which is consistent with Relief Request 06-CN-003 Ref. [14], and the ASME BPVC Code Case N-755 Ref. [12], as described in Sections 5.2.1 and 5.2.2, of this calculation. The manual calculations were performed using MathCad. The design conditions and the maximum loads obtained from ADLPIPE analysis (as listed in Tables 7.2.2a to 7.2.2d) were used to qualify the HDPE piping based on the applicable criteria for the design load cases. The manual calculations are provided below.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

**Manual Calculations Per ASME BPVC Code Case N-755:**

***Define Variables:***

$S := 430 \cdot \frac{\text{lb}}{\text{in}^2}$	Allowable stress at 140° F
$E_{\text{pipe50y}} := 12000 \cdot \frac{\text{lb}}{\text{in}^2}$	Elastic modulus at 140° F for 50 yr load duration
$E_{\text{pipe10h}} := 50000 \cdot \frac{\text{lb}}{\text{in}^2}$	Elastic modulus at 140° F for short term load duration
$E' := 2000 \cdot \frac{\text{lb}}{\text{in}^2}$	Modulus for fine grain sand compacted to > 95%
$W_p := 18.4 \frac{\text{lb}}{\text{ft}}$	Weight of empty pipe per foot
$\gamma_w := 62.4 \frac{\text{lb}}{\text{ft}^3}$	Specific weight of water
$P := 60 \frac{\text{lb}}{\text{in}^2}$	Design pressure, psig
$\gamma_{\text{soil}} := 105 \cdot \frac{\text{lb}}{\text{ft}^3}$	Specific weight of dry soil
$L := 1.5$	Deflection lag factor
$K_{\text{bed}} := 0.1$	Bedding factor
$D := 12.75 \cdot \text{in}$	Outside diameter of pipe
$t = 1.159 \cdot \text{in}$	Minimum wall thickness for DR-11 pipe, Ref. [12]
$t = 1.417 \cdot \text{in}$	Minimum wall thickness for DR-9 pipe, Ref. [12]
$DR = \frac{D}{t}$	Dimensional ratio (DR = 11 for straight pipe and DR = 9 for mitered elbows)
$c := 0.0\text{in}$	Allowance for mechanical and erosion damage

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date	11/11/08		

### Section 3131.1 - Minimum Required Wall Thickness

Calculate the pressure design thickness,  $t_{min}$ :

$$t_{min} := \frac{P \cdot D}{(2 \cdot S + P)} \qquad t_{min} = 0.83 \text{ in}$$

Determine the minimum required wall thickness,  $t_{design}$ :

$$t_{design} := t_{min} + c \qquad t_{design} = 0.83 \text{ in}$$

Pipe wall thickness (DR 11),  $t = 1.159 \text{ in} > 0.83 \text{ in}$ .....**O.K.**

Pipe wall thickness (DR 9),  $t = 1.417 \text{ in} > 0.83 \text{ in}$ .....**O.K.**

Note that DR-11 governs. Therefore, for subsequent calculations, only DR-11 needs to be considered; that is::

$$DR := 11$$

### Section 3210 - Ring Deflection

Determine the vertical soil pressure ( $P_L$ ) due to surcharge loads.

Per Drawing No. CN-1038-06 [Ref. 5], the Transporter Haul Path crosses over the HDPE pipe lines of Unit 2. The Haul Path is at EL. 594'-0" and the pipe centerline is at EL. 588'-6". Hence, the soil depth from surface to top of pipe = 5 ft.

$$H := 5 \text{ ft}$$

As shown on page 21 of 79 of Ref. [13], the maximum vertical soil pressure ( $P_V$ ) due to the combined weight of the transporter and cask at 5 feet below surface, not including impact, is:

$$P_V := 15.58 \frac{\text{lb}}{\text{in}^2}$$

This soil pressure value was obtained based on a cask weight of 310 kip and transporter weight of 170 kip. Per Sheet 25 of EC./VN No. CD500920D (DOC. ID. 32-5053646-01 Rev. 1) dated 2-20-07, the cask weight is 314.6 kip, which is 1.5% greater than the original value used in computing soil pressure. Therefore, in this calculation, the vertical soil pressure value will be increased by 1.5%; that is:

$$P_V := 1.015 \cdot P_V \qquad P_V = 15.814 \frac{\text{lb}}{\text{in}^2}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

Per Ref. [13], the impact load factor (F) due to the cask dropping from a maximum height of 8.0 inches is:

$$F := 3.033$$

The maximum vertical soil pressure due to surcharge loads, including impact, is computed by applying the impact load factor to the combined weight of the transporter and cask. This is conservative since the impact load factor actually applies to the cask weight only. Therefore:

$$P_L := F \cdot P_v \qquad P_L = 47.96 \frac{\text{lb}}{\text{in}^2}$$

Calculate the vertical soil pressure due to earth loads. Note that there is no water above pipe; hence, dry soil is the only source of pressure.

$$P_E := \gamma_{\text{soil}} \cdot H \qquad P_E = 3.65 \frac{\text{lb}}{\text{in}^2}$$

Compute the ring deflection  $\Omega$  by letting Soil Support Factor,  $F_s = 0$ . Note that as shown in Table 3210-2 of Ref. [12], the value of  $F_s$  depends on properties of the trench and native soil, and on pipe diameter and trench width. Using zero for  $F_s$  (see equation below) will yield a conservative value for  $\Omega$ .

$$F_s := 0$$

Compute the ring deflection  $\Omega$ .

$$\Omega_1 := \frac{K_{\text{bed}} \cdot L \cdot P_E}{\frac{2 \cdot E_{\text{pipe50y}}}{3} \cdot \left( \frac{1}{\text{DR} - 1} \right) + 0.061 \cdot F_s \cdot E'} \qquad \Omega_1 = 6.84 \times 10^{-4}$$

$$\Omega_2 := \frac{K_{\text{bed}} \cdot P_L}{\frac{2 \cdot E_{\text{pipe10h}}}{3} \cdot \left( \frac{1}{\text{DR} - 1} \right) + 0.061 \cdot F_s \cdot E'} \qquad \Omega_2 = 1.44 \times 10^{-3}$$

Note that the equation given in Ref. [12] for computing  $\Omega$  includes a conversion factor of 144. Since MathCad automatically converts units, this conversion factor is not included in the above equation.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

$$\Omega := \Omega_1 + \Omega_2 \qquad \Omega = 2.12 \times 10^{-3}$$

The maximum allowable ring deflection ( $\Omega_{max}$ ) is given in Ref. [12] as percent of the original diameter. Per Table 3210-1 of Ref. [12], for DR = 11:

$$\Omega_{max} = 5\% = 0.05 > \Omega = 2.12 \times 10^{-3} \dots\dots\dots \mathbf{O.K.}$$

### Section 3220 - Compression of Sidewalls

Calculate the circumferential compressive stress ( $\sigma_{sw}$ ) in the sidewalls of pipe and miters.

$$\sigma_{sw} := \frac{(P_E + P_L) \cdot DR}{2} \qquad \sigma_{sw} = 283.8 \frac{\text{lb}}{\text{in}^2}$$

Note that the equation given in Ref. [12] for computing  $\sigma_{sw}$  includes a conversion factor of 144. Since MathCad automatically converts units, the conversion factor is omitted here.

Compare  $\sigma_{sw}$  to the allowable stress value of 500 psi:

$$\sigma_{sw} = 283.8 \frac{\text{lb}}{\text{in}^2} < 500 \text{ psi} \dots\dots\dots \mathbf{O.K.}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

### Section 3221.1 - Buckling Due to External Pressure

Check that external pressure from ground water (  $P_{gw}$  ), earth loads (  $P_E$  ) and surcharge loads (  $P_L$  ) does not cause the pipe to buckle.

$$P_{hydro} = (P_{gw} + P_E + P_L) \leq 2.8 \cdot \left[ R_b \cdot B \cdot E' \cdot \frac{E_{pipe50y}}{12 \cdot (DR - 1)^3} \right]^{0.5}$$

Note that the equation provided in Ref. [12] for computing the external buckling pressure includes a conversion factor of 144. The conversion factor is not needed here since MathCad automatically converts units.

There is no water above the pipe. Hence:

$$H_{gw} := 0 \text{ft} \qquad P_{gw} := 0 \frac{\text{lb}}{\text{in}^2}$$

$$R_b := 1 - 0.33 \frac{H_{gw}}{H} \qquad R_b = 1$$

Compute the burial factor, B. Note that for computing burial factor, height of soil above pipe (H) needs to be redefined as a quantity  $H_B$  with no units.

$$H_B := 5$$

$$B := \frac{1}{1 + 4 \cdot \exp(-0.065 \cdot H_B)} \qquad B = 0.257$$

$$P_{gw} + P_E + P_L = 51.6 \frac{\text{lb}}{\text{in}^2}$$

$$2.8 \cdot \left[ R_b \cdot B \cdot E' \cdot \frac{E_{pipe50y}}{12 \cdot (DR - 1)^3} \right]^{0.5} = 63.5 \frac{\text{lb}}{\text{in}^2}$$

( $P_{gw} + P_E + P_L$ ) is less than 63.5 lb/in<sup>2</sup>.....**O.K.**



## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date		Date	11/11/08

### Calculation of Stresses Per ASME BPVC Code Case N-755 [Ref. 12]

*Define Variables:*

$$P_a := 60 \cdot \frac{\text{lb}}{\text{in}^2} \quad \text{Design or Service Level A, B, C, or D pressure}$$

$$D := 12.75 \cdot \text{in} \quad \text{Outside diameter of pipe and mitered elbow}$$

#### Properties of Straight Pipe

Straight pipe is DR-11

$$D_i := 10.432 \cdot \text{in} \quad \text{Inside Diameter of straight pipe, per Ref. [12]}$$

$$t := 1.159 \cdot \text{in} \quad \text{Wall thickness of straight pipe, per Ref. [12]}$$

$$A := \frac{\pi}{4} \cdot (D^2 - D_i^2) \quad A = 42.2 \text{in}^2 \quad \text{Cross sectional area of straight pipe}$$

$$Z := \left( \frac{\pi}{32} \right) \cdot \frac{D^4 - D_i^4}{D} \quad Z = 112.3 \text{in}^3 \quad \text{Section modulus of straight pipe}$$

$$i := 1.0 \quad \text{Stress Intensification Factor of straight pipe (per Table 3311.2-1)}$$

$$B_1 := 0.5 \quad B_2 := 1.0 \quad \text{Stress Indices of straight pipe (per Table 3223-1)}$$

#### Properties of Mitered Elbow

Elbow is DR-9

$$D_{ie} := 9.916 \cdot \text{in} \quad \text{Inside Diameter of elbow, per Ref. [12]}$$

$$t_e := 1.417 \cdot \text{in} \quad \text{Wall thickness of elbow, per Ref. [12]}$$

$$A_e := \frac{\pi}{4} \cdot (D^2 - D_{ie}^2) \quad A_e = 50.5 \text{in}^2 \quad \text{Cross sectional area of elbow}$$

$$Z_e := \left( \frac{\pi}{32} \right) \cdot \frac{D^4 - D_{ie}^4}{D} \quad Z_e = 129.0 \text{in}^3 \quad \text{Section modulus of elbow}$$

$$i_e := 2.0 \quad \text{Stress Intensification Factor of elbow (per Table 3311.2-1)}$$

$$B_{1e} := 0.69 \quad B_{2e} := 1.64 \quad \text{Stress Indices of elbow (per Table 3223-1)}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date		Date	11/11/08

The design/operating temperature is 140 degrees F. The design pressure for the outlet line is 60 psig. The Level A, B, C, and D operating pressure for the outlet line is 25 psig. The maximum deadweight and pressure loads (Load Case 10) are obtained from the ADLPIPE analysis and listed in Section 7.3 of this calculation. Qualification of the HDPE pipe is based on design level factors and allowable stress using the design temperature and pressure. Design pressure envelopes Service Levels A, B, C, and D pressures.

### 3223.1 - Longitudinal Stress Design

$$S := 430 \cdot \frac{\text{lb}}{\text{in}^2}$$

Allowable stress at 140 degrees F  
(per Table 3131-1)

$$k := 1.0$$

Longitudinal Stress Factor for Design  
(per Table 3223-2)

$$k \cdot S = 430 \cdot \frac{\text{lb}}{\text{in}^2}$$

Straight Piping Section:

Straight pipe is DR-11

$$B_1 \cdot \frac{P_a \cdot D}{2 \cdot t} + 2 \cdot B_1 \cdot \frac{F_a}{A} + B_2 \cdot \frac{M}{Z} \leq k \cdot S$$

$$F_a := 0 \cdot \text{lb}$$

Axial force due to deadweight on the straight pipe

$$M := 515 \cdot \text{lb} \cdot \text{ft}$$

Resultant bending moment due to deadweight on the straight pipe

$$B_1 \cdot \frac{P_a \cdot D}{2 \cdot t} + 2 \cdot B_1 \cdot \frac{F_a}{A} + B_2 \cdot \frac{M}{Z} = 220.0 \cdot \frac{\text{lb}}{\text{in}^2} < k \cdot S = 430 \cdot \frac{\text{lb}}{\text{in}^2} \dots\dots\dots\text{OK}$$

Mitered Elbow:

Elbow is DR-9

$$B_{1e} \cdot \frac{P_a \cdot D}{2 \cdot t_e} + 2 \cdot B_{1e} \cdot \frac{F_{ae}}{A_e} + B_{2e} \cdot \frac{M_e}{Z_e} \leq k \cdot S$$

$$F_{ae} := 0 \cdot \text{lb}$$

Axial force due to deadweight on the mitered elbow

$$M_e := 70 \cdot \text{lb} \cdot \text{ft}$$

Resultant bending moment due to deadweight on the mitered elbow

$$B_{1e} \cdot \frac{P_a \cdot D}{2 \cdot t_e} + 2 \cdot B_{1e} \cdot \frac{F_{ae}}{A_e} + B_{2e} \cdot \frac{M_e}{Z_e} = 196.9 \cdot \frac{\text{lb}}{\text{in}^2} < k \cdot S = 430 \cdot \frac{\text{lb}}{\text{in}^2} \dots\dots\dots\text{OK}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

### 3311 - Design for Thermal Expansion and Contraction

Soil springs were applied to account for the soil stiffness. Therefore, the alternative method of 3311.3 is used: The maximum thermal range force and moment were used to check the stresses in the HDPE pipe. The thermal range of Service Level C/D envelopes Service Level A and B.

#### Straight Piping Section:

Straight pipe is DR-11

$$i \cdot \frac{M_c}{Z} + \frac{F_{ac}}{A} \leq 1100 \cdot \frac{\text{lb}}{\text{in}^2}$$

$$F_{ac} := 7904 \cdot \text{lb}$$

Axial force range due to thermal expansion and/or contraction on the straight pipe (Level C/D)

$$M_c := 808 \cdot \text{ft} \cdot \text{lb}$$

Resultant moment range due to thermal expansion and/or contraction on the straight pipe (Level C/D)

$$i \cdot \frac{M_c}{Z} + \frac{F_{ac}}{A} = 273.6 \frac{\text{lb}}{\text{in}^2} < 1100 \frac{\text{lb}}{\text{in}^2} \dots\dots\dots \mathbf{OK}$$

#### Mitered Elbow:

Elbow is DR-9

$$i_e \cdot \frac{M_{ce}}{Z_e} + \frac{F_{ace}}{A_e} \leq 1100 \cdot \frac{\text{lb}}{\text{in}^2}$$

$$F_{ace} := 3720 \cdot \text{lb}$$

Axial force range due to thermal expansion and/or contraction on the mitered elbow (Level C/D)

$$M_{ce} := 1771 \cdot \text{ft} \cdot \text{lb}$$

Resultant moment range due to thermal expansion and/or contraction on the mitered elbow (Level C/D)

$$i_e \cdot \frac{M_{ce}}{Z_e} + \frac{F_{ace}}{A_e} = 403.1 \frac{\text{lb}}{\text{in}^2} < 1100 \frac{\text{lb}}{\text{in}^2} \dots\dots\dots \mathbf{OK}$$

### 3312 - Nonrepeated Anchor Movements

There are no nonrepeated (thermal) anchor movements .

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

### 3410 - Seismic Induced Stresses

This is applicable for both SSE and OBE loads. These stresses are based on evaluation of the SSE (Level D) conditions which also qualifies the piping for OBE (Level B) conditions as OBE loads are lower and OBE and SSE limits are the same

Straight Piping Section:

Straight pipe is DR-11

$$i \cdot \frac{M_E}{Z} + \frac{F_{aE}}{A} \leq 1100 \cdot \frac{\text{lb}}{\text{in}^2}$$

$$F_{aE} := 5275 \cdot \text{lb}$$

Axial force range due to seismic loads on the straight pipe

$$M_E := 1124 \cdot \text{ft} \cdot \text{lb}$$

Resultant moment range due to seismic loads on the straight pipe

$$i \cdot \frac{M_E}{Z} + \frac{F_{aE}}{A} = 245.1 \frac{\text{lb}}{\text{in}^2} < 1100 \frac{\text{lb}}{\text{in}^2} \dots\dots\dots \mathbf{OK}$$

Mitered Elbow:

Mitered elbow is DR-9

$$i_e \cdot \frac{M_{Ee}}{Z_e} + \frac{F_{aEe}}{A_e} \leq 1100 \cdot \frac{\text{lb}}{\text{in}^2}$$

$$F_{aEe} := 2873 \cdot \text{lb}$$

Axial force range due to seismic loads on the mitered elbow

$$M_{Ee} := 1869 \cdot \text{ft} \cdot \text{lb}$$

Resultant moment range due to seismic loads on the mitered elbow

$$i_e \cdot \frac{M_{Ee}}{Z_e} + \frac{F_{aEe}}{A_e} = 404.6 \frac{\text{lb}}{\text{in}^2} < 1100 \frac{\text{lb}}{\text{in}^2} \dots\dots\dots \mathbf{OK}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

### 7.4 Stress Summary for Unit 2 Steel Pipe

Acceptance Criteria	Calculated Stress [psi]	Allowable Stress [psi]	Calculated Allowable	Node Point
Equation 8 (Design)	1264	22500	0.06	985
Equation 9 (Level A)	529	27000	0.03	985
Equation 9 (Level B)	529	27000	0.03	985
Equation 10 (Level A)	8418	22500	0.37	985
Equation 10 (Level B)	9566	22500	0.43	985
Equation 10 (Level C/D)	7838	22500	0.35	985

### 7.5 Flange Summary for Unit 2 HDPE Pipe

The EPRI flange capacity tests, Ref. [22], demonstrated that if the pipe stresses at the fusion joint joining the HDPE flange adapter to the piping were less than the maximum code capacities, the flanges were adequate. For this system, all pipe stresses at the fusion joint, joining the HDPE flange adapter to the piping are less than the maximum permitted code capacities.


### 7.6 Evaluation of Buoyancy over Condenser Cooling Water Lines

This piping system goes over the 10-ft diameter Condenser Cooling Water (CCW) lines in the region with plant coordinates 49+50X to 50+00X and 54+00Y to 55+00Y. The HDPE cooling water pipe line is at EL. 588'-6" and the CCW lines are at EL. 579'-2". In the event a CCW line breaks and completely floods the region, the buoyancy force acting on the HDPE cooling water line needs to be checked if it would result in pipe floatation.

The HDPE pipe in this location rests on a composite bed made up of a 16-in HDPE pipe and an 18-in steel pipe as shown in Fig. 7.6 below. The 18-in pipe is attached to concrete piers at its ends.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouchef</i>	Date	11/11/08

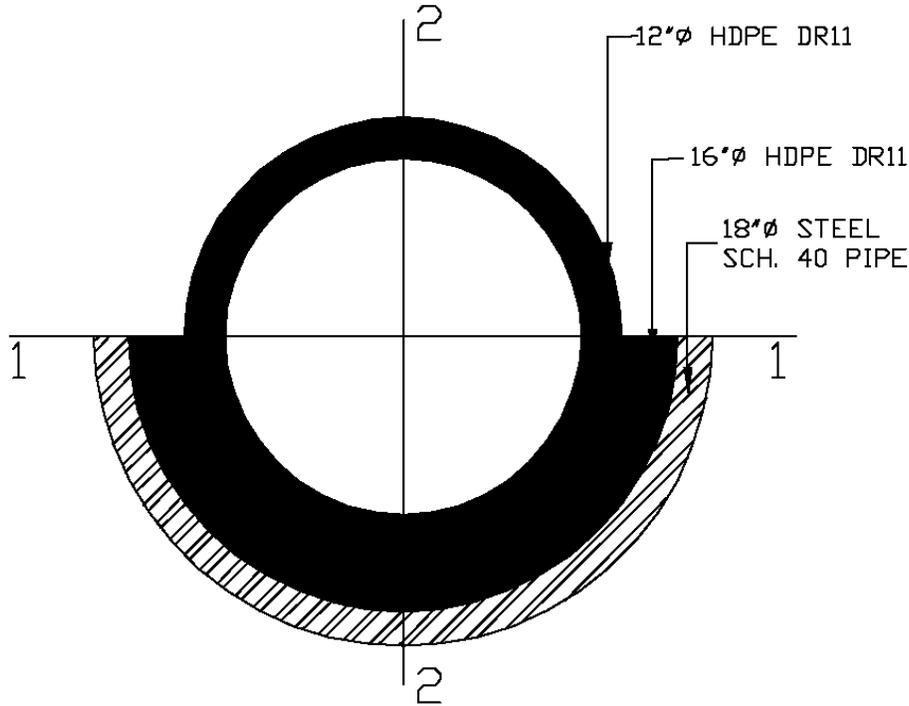

**Fig. 7.6: Support provided for HDPE pipe system in the region where it lies over the CCW lines**

The buoyancy force ( $F_b$ ) per unit length acting on the pipe is:

$$F_b = \gamma_{water} A_b$$

where:

$$\gamma_{water} = \text{specific weight of water [lb/ft}^3\text{]}; \gamma_{water} = 62.4 \text{ lb/ft}^3$$

$$A_b = \text{cross-sectional area of related to the displaced volume [ft}^2\text{]}$$

The area  $A_b$  can be conservatively estimated from:

$$A_b = \frac{\pi}{4} \left( \frac{D_{18}^2 + D_{12}^2}{2} \right)$$

where  $D_{18}$  and  $D_{12}$  are the ODs for 18-in steel pipe and 12-in HDPE pipe, respectively.

Noting that  $D_{18} = 18/12 = 1.5$  ft and  $D_{12} = 12.75/12 = 1.0625$  ft, and substituting yields:

$$F_b = 62.4 * \frac{\pi}{4} \left( \frac{1.5^2 + 1.0625^2}{2} \right) = 82.8 \text{ lb/ft}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

The forces resisting buoyancy force are:

- weight of 18-in steel pipe = 104.7 lb/ft; use only ½ of this weight → 52.3 lb/ft
- weight of 16-in HDPE pipe = 29.0 lb/ft; use only ½ of this weight → 14.5 lb/ft
- weight of 12-in HDPE pipe = 18.4 lb/ft
- weight of soil above pipe =  $\gamma_{\text{soil}} * H * D_{12} = 105 \text{ lb/ft}^3 * 5 \text{ ft} * 1.0625 \text{ ft} = 557.8 \text{ lb/ft}$

Note that in computing the soil weight above pipe, for conservatism,  $D_{12}$  was used instead of  $D_{18}$  and the height of soil above pipe (H) was taken as 5 ft.

Force resisting buoyancy = 52.3 + 14.5 + 18.4 + 557.8 = 643.0 lb/ft >  $F_b = 82.8 \text{ lb/ft}$

The 18-in pipe is attached to concrete piers on both ends. The concrete piers are  $3' \times 2' \times 14' - 10'' = 89 \text{ ft}^3$ . Concrete weighs about  $144 \text{ lb/ft}^3$ . Hence, the weight of the concrete piers is  $89 \text{ ft}^3 \times 144 \text{ lb/ft}^3 = 12.8 \text{ kips}$ . This is an additional force that is resisting the buoyancy force.

It is concluded that in the event the CCW lines break and flood the region, the HDPE piping will be OK against floatation.

### 7.7 Evaluation of Steel Bridge Pipe over Condenser Cooling Water Lines

This evaluation is for the steel pipe bridge over the 10'-0"  $\varnothing$  Condenser Cooling Water lines should they rupture and erode the soil supporting the 12"  $\varnothing$  Nuclear Service Water (NSW) lines to the Diesel Generator Building. This is a faulted condition on the piping system.

Three concrete piers split the 58 foot span into two 29 foot spans simply supported. The bridge is composed of half of a 18"  $\varnothing$  sch. 40 carbon steel pipe ( $104.7 \text{ lb/ft} / 2 = 52.4 \text{ lb/ft}$ ) as shown in Figure 7.6. The bridge is essentially a steel structure that supports the half section of a 16"  $\varnothing$  DR11 HDPE pipe ( $29 \text{ lb/ft} / 2 = 14.5 \text{ lb/ft}$ ) that acts as protection for the pressure retaining 12"  $\varnothing$  DR 11 HDPE pipe with water (54.4 lb/ft)

The weight per foot supported by the bridge is:

Half of a 18" $\varnothing$ Sch. 40 steel pipe = $0.5 * (104.7 \text{ lb/ft})$	= 52.35 lb/ft
Half of a 16" $\varnothing$ DR 11 HDPE pipe = $0.5 * (29 \text{ lb/ft})$	= 14.5 lb/ft
12" $\varnothing$ DR 11 HDPE pipe with water = 54.4 lb/ft	= 54.4 lb/ft
Total wt.	= 121.25 lb/ft

Check the half section of 18" steel pipe acting as a bridge for deadweight bending stress over a 29 foot span. Conservatively assume simply supported connections for the bridge.

$$M_{\text{bending}} = \frac{w \cdot l^2}{8}$$

$$w = 121.25 \text{ lb/ft} / 12 = 10.104 \text{ lb/in}$$

$$l = 29 \text{ ft} \times 12 \text{ in/ft} = 348 \text{ in}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

$$M_{bending} = \frac{10.104 * 348^2}{8}$$

$$M_{bending} = 152,954 \text{ lb} / \text{in}$$

$$\sigma_{bending} = \frac{M}{Z}$$

### Calculate the Section Properties of the Half 18” Section:

18 in. Sch. 40 pipe       $t_m = 0.562$  in

From, [Ref. 21], “Roark’s Formulas for Stress and Strain”, 6<sup>th</sup> Edition Page 69, Section 22

Dia. = 18 inches  
 $t_m = 0.562$  inches

R = 9 inches  
 $R_i = 8.438$  inches

See Section in Figure 7.6

$$A = \frac{\pi}{2} * (R^2 - R_i^2)$$

$$A = \frac{\pi}{2} * (9^2 - 8.438^2)$$

$$A = 15.394 \text{ in}^2$$

$$I_{2-2} = \frac{\pi}{8} (R^4 - R_i^4)$$

$$I_{2-2} = \frac{\pi}{8} (6561 - 5069.418) \quad \text{where the 2-2 axis is the vertical axis about the centroid of the section.}$$

$$I_{2-2} = \frac{\pi}{8} (1491.582)$$

$$I_{2-2} = 585.743 \text{ in}^4$$

$$Z_{2-2} = 585.743 \text{ in}^4 / 9 \text{ in} = 65.08 \text{ in}^3$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

Calculate the centroid for calculating the section modulus in the 1-1 direction

$$y_{1b} = \frac{4}{3\pi} \left[ \frac{R^3 - Ri^3}{R^2 - Ri^2} \right]$$

$$y_{1b} = \frac{4}{3\pi} * \left[ \frac{9^3 - 8.438^3}{9^2 - 8.438^2} \right]$$

$$y_{1b} = \frac{4}{3\pi} * \left[ \frac{128.216}{9.80} \right]$$

$$y_{1b} = 5.553 \text{ in}$$

Calculate  $I_{1-1}$  about the centroid about the horizontal axis:

$$I_{1-1} = \frac{\pi}{8} (R^4 - Ri^4) - \frac{8}{9\pi} \left[ \frac{(R^3 - Ri^3)^2}{R^2 - Ri^2} \right]$$

$$I_{1-1} = \frac{\pi}{8} (9^4 - 8.438^4) - \frac{8}{9\pi} \left[ \frac{(9^3 - 8.438^3)^2}{9^2 - 8.438^2} \right]$$

$$I_{1-1} = \frac{\pi}{8} (1,491.582) - \frac{8}{9\pi} \left[ \frac{16,439.270}{9.80} \right]$$

$$I_{1-1} = \frac{\pi}{8} (1,491.582) - \frac{8}{9\pi} [1,677.450]$$

$$I_{1-1} = 585.743 - 474.621$$

$$I_{1-1} = 111.122 \text{ in}^4$$

$$z_{1-1} = \frac{I_{x1-x1}}{y_{16}} = \frac{111.122}{5.553} = 20.01 \text{ in}^3$$

### Deadweight Stress in the Pipe Bridge:

$$\sigma_{bending} = \frac{152,954}{20.01}$$

$$\sigma_{bending} = 7,644 \text{ psi} < 0.60 * F_y = 0.60 * 36 \text{ ksi} = 21.6 \text{ ksi OK}$$

0.60 \*  $F_y$  is the normal AISC Allowable Stress for a Steel Pipe Support

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis		
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2		
By:	<i>L. Hails</i>	Date	11/10/08
		Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08

### Earthquake Stress in the Pipe Bridge

The peak seismic acceleration near the DG building is 0.324g vertical and 0.486g horizontal Ref. [19] & Ref. [20].

$$\delta_{\text{seis-horizontal}} = 0.486g * 152,954 \text{ lb-in} / 65.083 \text{ in}^3 = 1,142 \text{ psi}$$

$$\delta_{\text{seis-vertical}} = 0.324g * 152,954 \text{ lb-in} / 20.01 \text{ in}^3 = 2,477 \text{ psi}$$

$$\delta_{\text{seis-total}} = [(1,142)^2 + (2,477)^2]^{0.5} = 2,728 \text{ psi}$$

$$\sigma_{\text{faulted}} = \text{Deadweight} + \text{Seismic}_{\text{faulted}} < 0.90 * F_y$$

$$\sigma_{\text{faulted}} = 7,644 + 2,728 = 10,372 \text{ psi} < 0.90 * 36 \text{ ksi} = 32.4 \text{ ksi OK}$$

0.90 \* F<sub>y</sub> is an appropriate Faulted Allowable Stress for a Steel Structure

Therefore the 18" ø steel pipe will support the 12" ø HDPE pipe in the event of a rupture of the CCW pipe and a subsequent SSE event.

### 7.8 Evaluation of 12" ø HDPE Pipe over Condenser Cooling Water Lines

As discussed in Section 7.7, the 12" ø HDPE piping is supported by the steel pipe bridge in the unlikely event that the Condenser Cooling Water lines wash out the soil surrounding the HDPE piping crossing this piping. Section 7.7 resulted in the conclusion that the bridge analyzed as a steel structure is acceptable. This portion of the calculation analyzes the pressure retaining 12" ø HDPE for this faulted event. The 12" ø HDPE will deflect with the pipe bridge. Therefore, the deflection of the bridge will be calculated. Using this displacement, an equivalent load will be calculated for the 12" ø HDPE. This load will be combined appropriately with other loads (pressure) and the resulting stresses will be compared to the allowable stress.

#### Deflection of Pipe Bridge for Dead Weight

For a simply supported beam deflection is as follows:

$$\Delta_{\text{max}} = 5 \omega l^4 / 384 EI = 5 * 10.104 \text{ lb/in} * 348^4 \text{ in}^2 / (384 * 29 * 10^6 \text{ lb/in}^2 * 111.112 \text{ in}^4) = 0.888 \text{ in.}$$

#### Deflection of Pipe Bridge for Earthquake Load

For a simply supported beam deflection is as follows:

$$\Delta_{\text{max-vertical-earthquake}} = 0.324g * 0.888 \text{ in.} = 0.288 \text{ in.}$$

$$\Delta_{\text{max-horizontal-earthquake}} = 0.486g * 5 * 10.104 \text{ lb/in} * 348^4 \text{ in}^2 / (384 * 29 * 10^6 \text{ lb/in}^2 * 585.743 \text{ in}^4) = 0.0552 \text{ in.}$$

$$\Delta_{\text{max-total-earthquake}} = (0.288^2 \text{ in}^2 + 0.0552^2 \text{ in}^2)^{0.50} = 0.293 \text{ in}$$

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce S. Dubouché</i>
		Date	11/11/08		

### Calculation of Bending Stress in the HDPE Piping Due to Deflection

In the case of the 12” HDPE pressure retaining piping, the stress is at its highest when the system is stiffest since the stress in this case is displacement dependent. Therefore, the piping will be conservatively assumed to have a fixed connection on either side of the span.

HDPE Properties:

$$I = 1/64 \pi (D^4 - D_i^4) = 1/64 \pi (12.75^{in^4} - 10.45^{in^4}) = 711.8 \text{ in}^4$$

$$Z = I * 2 / D = 711.8 \text{ in}^4 * 2 / 12.75 \text{ in.} = 111.7 \text{ in}^3$$

For a Fixed – Fixed Beam Dead Weight @ Ambient Temperature:

$$\Delta = \omega l^4 / 384 E I \rightarrow \omega = 384 E I \Delta / l^4 = 384 * 110,000 \text{ lb/in}^2 * 711.8 \text{ in}^4 * 0.888" / 348^4 \text{ in}^4 = 1.82045 \text{ lb/in}$$

(Equivalent Load on Pipe)

E = 110,000 psi for the HDPE Pipe @ Ambient Temperature (conservative for calculating stress,  
 $\Delta = 0.888"$  is the deflection at the center of the bridge due to Dead Weight  
 l = 348 in (29 foot span of the bridge)

$$M_{Max} = \omega l^2 / 24 = 1.82045 \text{ lb/in} * (348^{in^2}) / 24 = 9,186 \text{ in-lb}$$

$$\delta_{bending-Deadweight} = 9,186 \text{ in-lb} / 111.7 \text{ in}^3 = 82.24 \text{ psi}$$

$$\delta_{bending-Earthquake} = 82.24 \text{ psi} * 0.293" / 0.888" = 27.13 \text{ psi}$$

The earthquake does not act concurrently with the washout from the CCW pipes. These stresses are small enough that they do not control design when combined appropriately with pressure stress. They are acceptable by inspection.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

### 8.0 RESULTS

The HDPE piping system was found to be adequate. Table 8.a summarizes these results.

<b>Table 8.a</b>				
<b>Result Summary for 12” HDPE Pipe</b>				
<b>Acceptance Criteria</b>	<b>Calculated Value</b>	<b>Allowable Value</b>	<b><u>Calculated</u> <u>Allowable</u></b>	<b>Node Pt.</b>
Minimum Required Wall Thickness	0.83”	1.159”	0.72	N/A
Ring Deflection	0.00212”	0.05”	0.04	N/A
Compression of Side Walls	284 psi	500 psi	0.57	N/A
Buckling Due to External Pressure	51.6 lb/in <sup>2</sup>	63.5 lb/in <sup>2</sup>	0.81	N/A
Effects of Negative Internal Pressure	> - 36.5 psi	0 psi	***0.0	N/A
Flotation	55.3 lb/ft	576 lb/ft	0.10	N/A
Deadweight + Pressure Stress – Straight Pipe	220.0 psi	430 psi	0.51	820
Deadweight + Pressure Stress – Mitered Elbow	196.9 psi	430 psi	0.46	320
Thermal Stress – Straight Pipe	273.6 psi	1100 psi	0.25	880
Thermal Stress – Mitered Elbow	403.1 psi	1100 psi	0.37	650
Seismic SSE Stress – Straight Pipe	245.1 psi	1100 psi	0.22	880
Seismic SSE Stress – Mitered Elbow	404.6 psi	1100 psi	0.37	650

\*\*\* The HDPE pipe is not under a vacuum per the Design Specification Ref. [26]

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

The steel piping system was found to be adequate. Table 8.b summarizes these results

<b>Table 8.b</b>				
<b>Result Summary for 10” and 12” Steel Pipe</b>				
Acceptance Criteria	Calculated Stress [psi]	Allowable Stress [psi]	Calculated Allowable	Node Point
Deadweight and Pressure (Design)	1264	22500	0.06	985
Deadweight and Pressure (Level A)	529	27000	0.03	985
Thermal (Level A)	8418	22500	0.37	985
Deadweight and Pressure (Level B)	529	27000	0.03	985
Thermal and Seismic (Level B)	9566	22500	0.43	985
Seismic (Level C/D)	7838	22500	0.35	985

### 8.1 Functionality Capability and Break Postulation

This piping analysis meets functional capability as defined in Ref. [24]. The maximum Level D Pressure and Temperature do not exceed design Pressure and Temperature. All piping stress limits given in ASME BPVC Code Case N-755 are met for all applied Level D loads and the capacities used in this review are based on the Design Temperature.

This piping is classified as moderate energy as defined in Ref. [24]. Moderate energy piping is piping that has a temperature of less than 200 ° F and a pressure of 275 psig or less. Per Ref [26], for this piping, the maximum temperature is 140° F and the operating pressure is 25 psig. Leak cracks are to be postulated at points based on the following equation:

$$\frac{PD}{4t} + 0.75i \left[ \frac{M_A}{Z} + \frac{F_{aA}}{A} \right] + i \left[ \frac{M_C}{Z} + \frac{F_{aC}}{A} \right] + i \left[ \frac{M_E}{Z} + \frac{F_{aE}}{A} \right] \leq 0.4(1.1S + 1100 + 1100)psi = 0.4(1.1S + 2200)psi$$

where:

- P = Operating pressure
- D = Outside pipe diameter
- t = Nominal pipe wall thickness

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date	11/11/08		

*i* = Stress intensification factor  
*A* = Cross sectional area of pipe  
*Z* = Section modulus of pipe  
*F<sub>aA</sub>* = Axial force due to deadweight loads  
*F<sub>aC</sub>* = Axial force range due to thermal loads  
*F<sub>aE</sub>* = Axial force range due to seismic loads  
*M<sub>A</sub>* = Moment due to deadweight loads  
*M<sub>C</sub>* = Moment range due to thermal loads  
*M<sub>E</sub>* = Moment range due to seismic loads

The deadweight, thermal, and seismic loads at the critical locations will be taken from Tables 7.2.2a to 7.2.2d for straight pipe and mitered elbows and checked to the postulated break equation. The maximum stresses for deadweight, seismic and thermal cases may occur at different locations. The equation uses the maximum stresses even when they are found in separate locations. This is conservative.

$$S = 430 \text{ psi} \rightarrow 0.4(1.1S + 2200) = 0.4 (1.1 \cdot 430 + 2200) = 1069 \text{ psi}$$

For straight pipe:

$$\begin{array}{llll}
 D = 12.75 \text{ in} & t = 1.159 \text{ in} & A = 42.2 \text{ in}^2 & Z = 112.3 \text{ in}^3 \\
 P = 25 \text{ psi} & i = 1.0 & 0.75i = 1.0 & \text{(Note: } 0.75i \text{ cannot be less than } 1.0\text{)} \\
 M_A = 515 \text{ ft-lb} = 6180 \text{ in-lb} & M_C = 808 \text{ ft-lb} = 9696 \text{ in-lb} & M_E = 1124 \text{ ft-lb} = 13488 \text{ in-lb} \\
 F_{aA} = 0 & F_{aC} = 7904 \text{ lb} & F_{aE} = 5275 \text{ lb}
 \end{array}$$

Substituting these values into the equation yields:

$$\frac{25 \cdot 12.75}{4 \cdot 1.159} + 1.0 \left[ \frac{6180}{112.3} + \frac{0}{42.2} \right] + 1.0 \left[ \frac{9696}{112.3} + \frac{7904}{42.2} \right] + 1.0 \left[ \frac{13488}{112.3} + \frac{5275}{42.2} \right] = 643 \text{ psi} < 1069 \text{ psi}$$

Therefore, there are no postulated moderate energy leak cracks on the straight HDPE piping.

For mitered elbows:

$$\begin{array}{llll}
 D = 12.75 \text{ in} & t = 1.417 \text{ in} & A = 50.5 \text{ in}^2 & Z = 129.0 \text{ in}^3 \\
 P = 25 \text{ psi} & i = 2.0 & 0.75i = 1.5 \\
 M_A = 70 \text{ ft-lb} = 840 \text{ in-lb} & M_C = 1771 \text{ ft-lb} = 21252 \text{ in-lb} & M_E = 1869 \text{ ft-lb} = 22428 \text{ in-lb} \\
 F_{aA} = 0 & F_{aC} = 3720 \text{ lb} & F_{aE} = 2873 \text{ lb}
 \end{array}$$

Substituting these values into the equation yields:

$$\frac{25 \cdot 12.75}{4 \cdot 1.417} + 1.5 \left[ \frac{840}{129} + \frac{0}{50.5} \right] + 2.0 \left[ \frac{21252}{129} + \frac{3720}{50.5} \right] + 2.0 \left[ \frac{22428}{129} + \frac{2873}{50.5} \right] = 1004 \text{ psi} < 1069 \text{ psi}$$

Therefore, there are no postulated moderate energy leak cracks on the mitered HDPE piping.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

### 8.2 Final Loads at the Anchor at the Diesel Generator Building due to Soil Effects

The maximum loads acting from the HDPE pipe for Service Levels A, B, C and D acting on the anchor at the face of the Diesel Generator Building are extracted from the results of the ADLPIPE analysis. These loads are summarized in Tables 8.2a and 8.2b and compared to the maximum loads that the HDPE pipe can contribute to anchor load at the face of the Diesel Generator Building.

**Table 8.2a: HDPE Loads from ADLPIPE for Anchor at Diesel Generator Building**

Load Case	Node Point	Fx (lbs)	Fy (lbs)	Fz (lbs)	Mx (ft-lb)	My (ft-lb)	Mz (ft-lb)
10 (DW)	100	0	520	0	6	0	1250
27 (Th)	100	5952	0	12	0	61	0
28 (Th)	100	6432	0	16	0	81	0
29 (Th)	100	8243	0	35	0	165	0
31 (SSE)	100	3878	0	77	0	251	0
32(OBE)	100	2068	0	41	0	134	0

**Table 8.2b: HDPE Loads combined for maximum forces and moments to be compared to allowable interface loads applied to the steel pipe per Ref. [23]**

Load Case	Node Point	Axial Force (lbs)		Shear Force (lbs)		Resultant Moment (in-lbs)	
		Combined from ADLPIPE	Maximum	Combined from ADLPIPE	Maximum	Combined from ADLPIPE	Maximum
10 (DW)	130	0	4200	103	4200	564	100000
27 (Th)	130	5952 (1)	4200	12	4200	264	100000
28 (Th)	130	6432 (1)	4600	16	4600	324	100000
29 (Th)	130	8243 (1)	5500	35	5500	564	100000
31 (SSE)	130	3878	4600	77	4600	108	100000
32 (OBE)	130	2068	4600	41	4600	60	100000

(1) The thermal axial forces exceed the maximum for the HDPE pipe. These forces are acceptable due to the very small shear force and moment at the same node point. Therefore, the loads shown above will be used as input for the anchor design at the Diesel Generator Building.

### 8.3 Final Loads at the Centerline of the 42” ø Return Line due to Soil Effects

**Table 8.3a: HDPE Loads from ADLPIPE at the Centerline of the 42” ø Supply Line**

Load Case	Node Point	Fx (lbs)	Fy (lbs)	Fz (lbs)	Mx (ft-lb)	My (ft-lb)	Mz (ft-lb)
10 (DW)	990	19	2409	20	116	0	124
27 (Th)	990	3871	275	3871	28509	0	28509
28 (Th)	990	4223	312	4223	31072	0	31073
29 (Th)	990	5589	444	5589	41023	0	41024
31 (SSE)	990	3730	502	3730	26765	0	26765
32 (OBE)	990	1989	268	1989	14274	0	14274

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC		Calculation No.	07Q3691-CAL-010			
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

### 8.4 Branch Line Qualification

The branch line meets the 1989 ASME BPVC Code allowable stresses. Table 8.4a below shows the results of the ADLPIPE analysis for the branch line (Nodes 880 to 985).

<b>Table 8.b Result Summary for 12” Steel Branch Line</b>				
Acceptance Criteria	Calculated Stress [psi]	Allowable Stress [psi]	Calculated Allowable	Node Point
Deadweight and Pressure (Design)	1264	22500	0.06	985
Deadweight and Pressure (Level A)	529	27000	0.02	985
Thermal (Level A)	8418	22500	0.37	985
Deadweight and Pressure (Level B)	529	27000	0.02	985
Thermal and Seismic (Level B)	9566	22500	0.43	985
Seismic (Level C/D)	7838	22500	0.35	985

### 9.0 CONCLUSIONS

The existing 10-in carbon steel buried nuclear service water piping lines connecting the 42-in Nuclear Service Water System (NSWS) Return Header ‘B’ to Unit 2 Diesel Generator (DG) building piping at the Catawba Nuclear Station will be replaced by 12-in high-density polyethylene (HDPE) piping system. This calculation determined that the buried HDPE piping system connecting the 42-in Return Header ‘B’ to the DG building of Unit 2 meets all applicable acceptance criteria as defined in the piping design specification Ref. [26] which is consistent with the Relief Request, Ref. [14], and the ASME BPVC Code Case N-755 [Ref. 12] as summarized in Table 8-1.

## CALCULATION CONTINUATION SHEET




Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>	Date	11/11/08

### Appendix A

#### ADLPIPE Model Isometrics

# CALCULATION CONTINUATION SHEET



Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
				Date	11/11/08

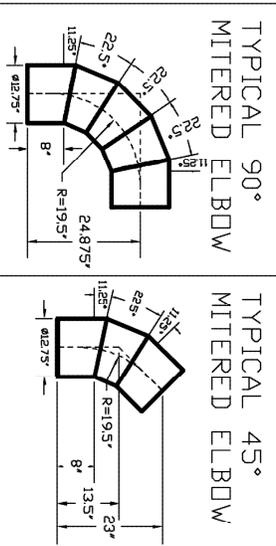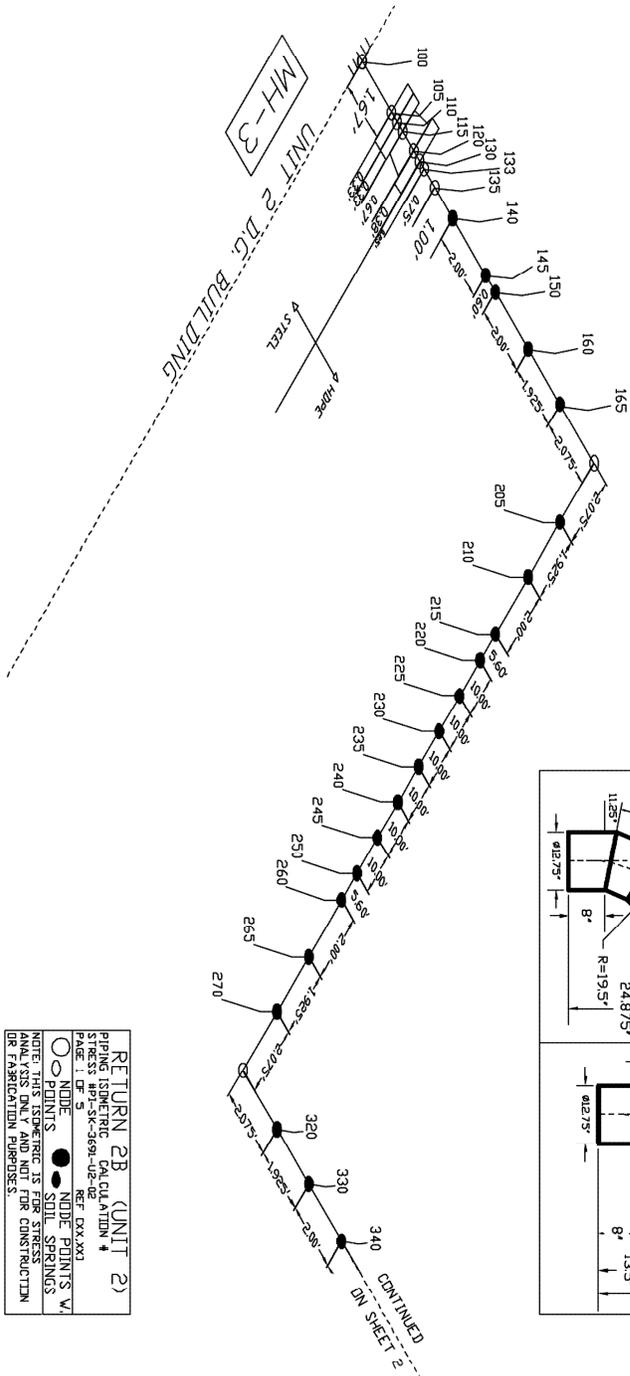

RETURN 2B (UNIT 2)  
 PIPELINE ANALYSIS  
 STRESS ANALYSIS  
 PAGE 1 OF 5  
 REF: DXX.XXX  
 NOTE: THIS ISOMETRIC IS FOR STRESS ANALYSIS ONLY AND IS NOT TO BE USED FOR FABRICATION PURPOSES.

# CALCULATION CONTINUATION SHEET


Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

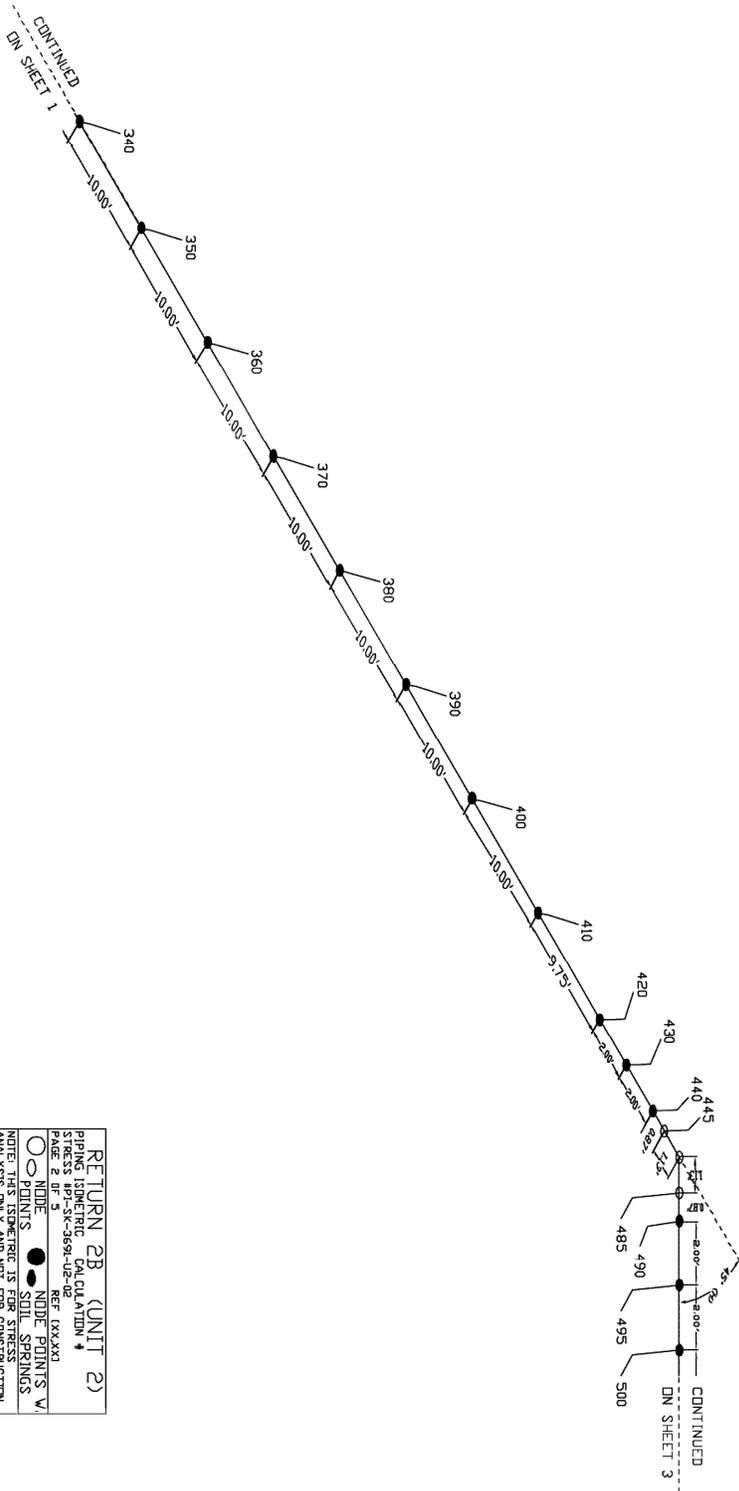

RETURN 2B (UNIT 2)  
 PIPING ISOMETRIC CALCULATION  
 PROJECT NO. 07Q3691-CAL-010  
 PAGE 2 OF 5  
 REF. LXXXXX  
 REVISIONS:  
 ○ NODE  
 ● NODE POINTS W/ SOIL SPRINGS  
 NOTE: THIS ISOMETRIC IS FOR STRESS ANALYSIS ONLY AND NOT FOR CONSTRUCTION OR FABRICATION PURPOSES.

# CALCULATION CONTINUATION SHEET


Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

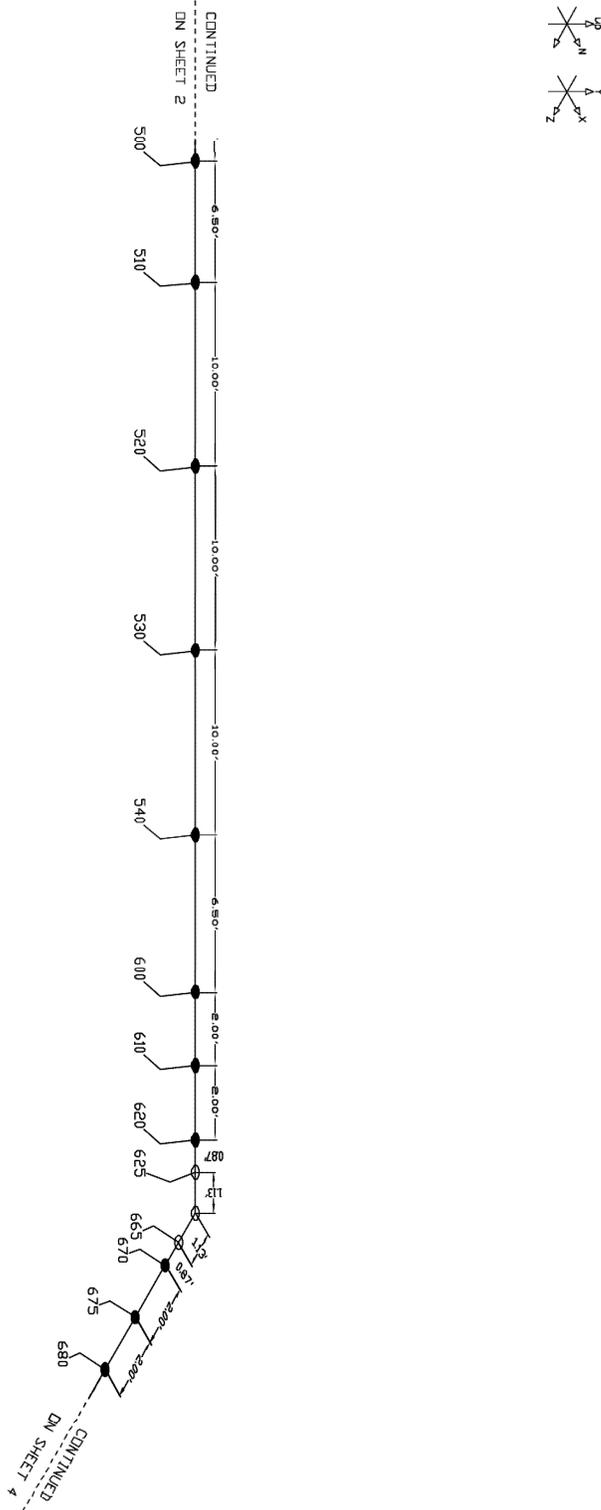

**RETURN 2B (UNIT 2)**  
 PIPE ISOMETRIC CALCULATION #  
 STRONG ISOMETRIC-059L-06-03 REF: CXXXX  
 PAGE 3 OF 5  
 ○ NODE  
 ● NODE POINTS W/ SOIL SPRINGS  
 NOTE: THIS ISOMETRIC IS FOR STRESS ANALYSIS ONLY AND NOT FOR CONSTRUCTION OR FABRICATION PURPOSES.

# CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>	Date	11/11/08

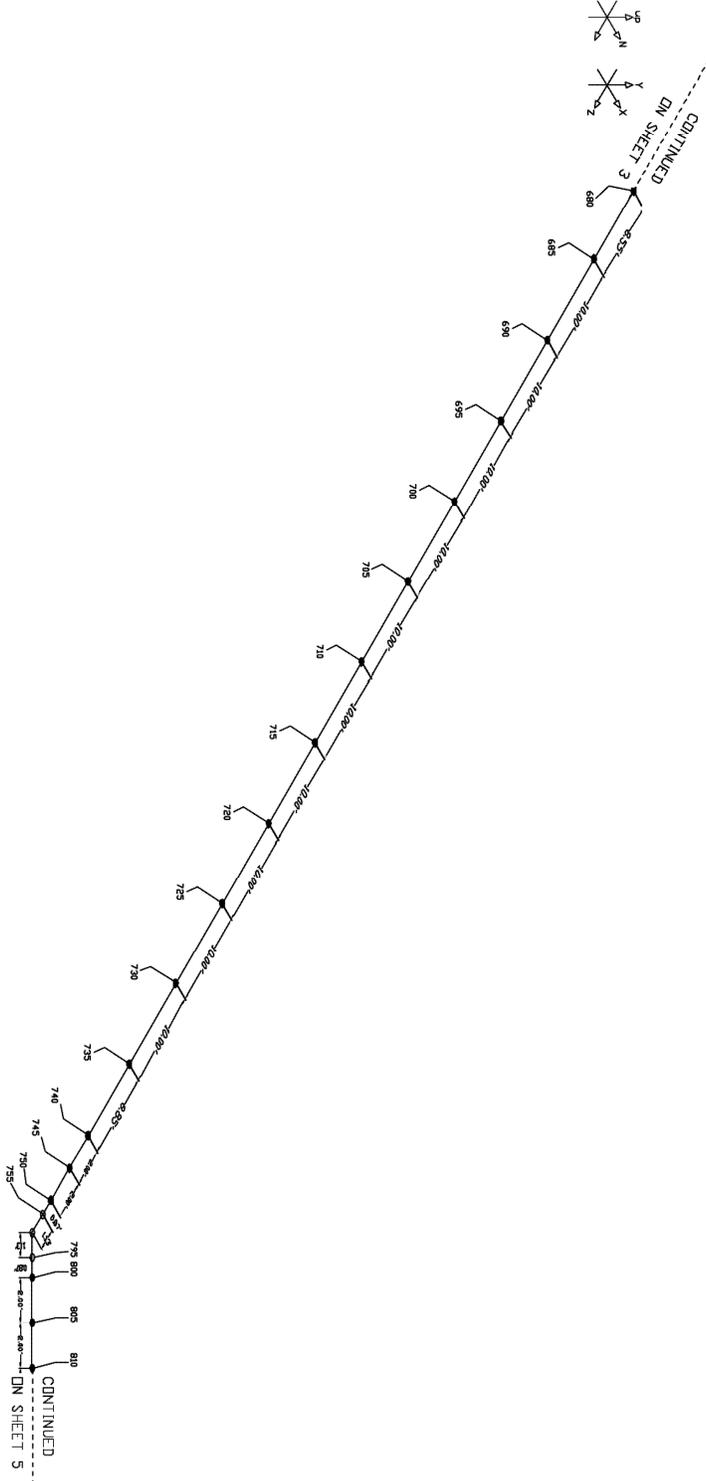

RETURN 2B (UNIT 2)


POINTS  
 NODES  
 POINTS W/ SOIL SPRINGS  
 NODE POINTS W/ SOIL SPRINGS

NOTE: THIS ISOMETRIC IS FOR CONSTRUCTION AND NOT FOR FABRICATION PURPOSES.  
 REF: XXXXX

PRINTS: ISOMETRIC CALCULATION #  
 STRESS: MP/5-0560-02-02  
 PAGE 4 OF 5

# CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce P. Dubouché</i>
		Date			11/11/08

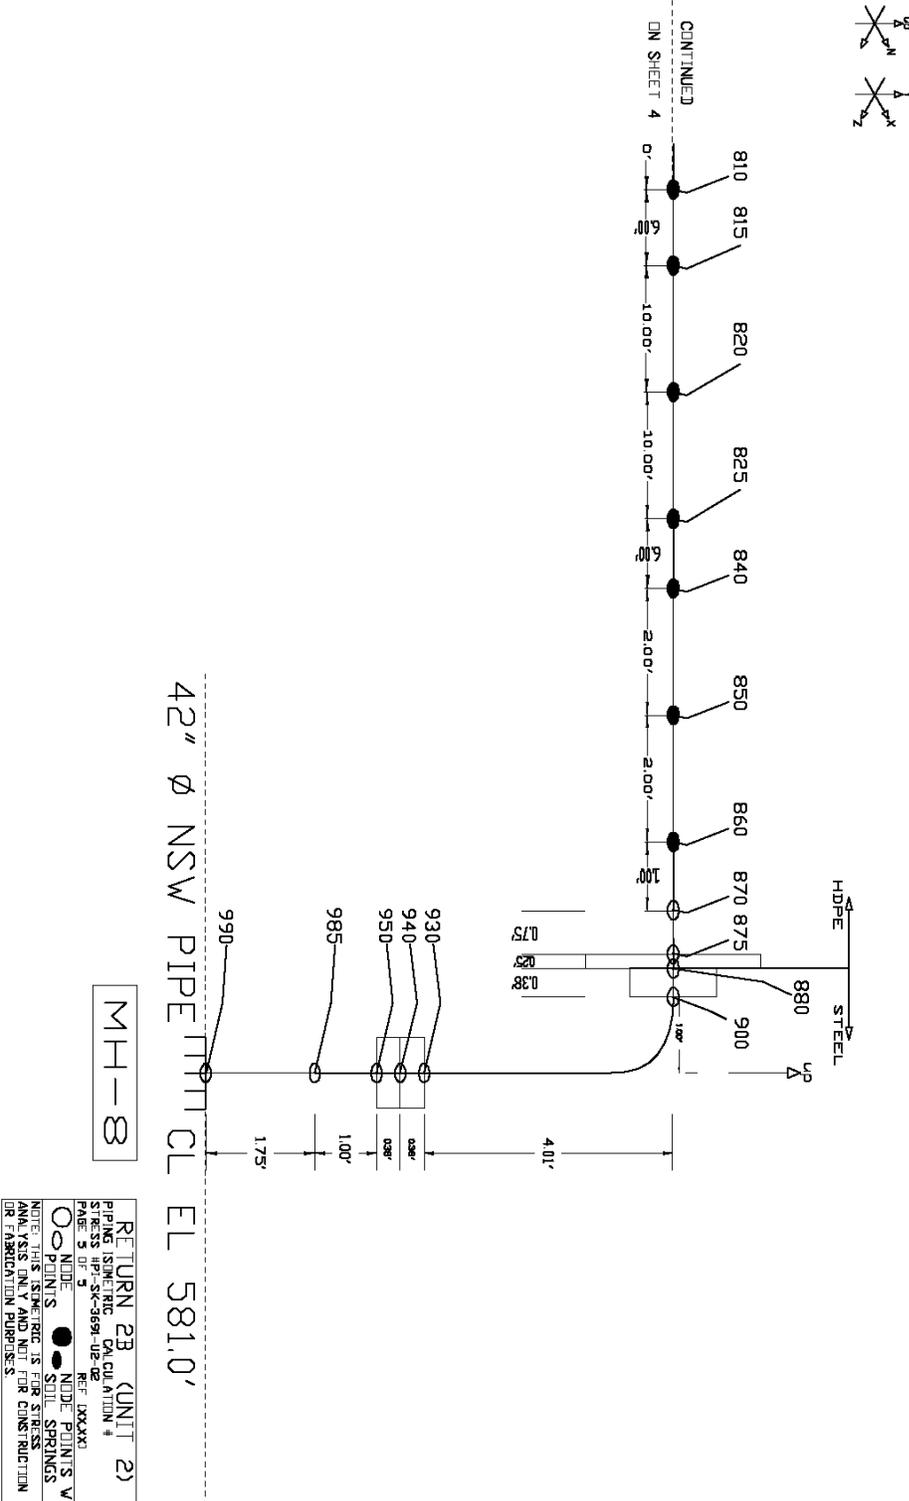

RETURN 2B (UNIT 2)  
 PIPING ISOMETRIC CALCULATION #  
 STRESS HP-5K-3691-UB-02 REF: EX-XX-XX  
 PAGE 3 OF 5  
 ○ NODE ● NODE POINTS W/ SOLE SPRINGS  
 NOTES: REFER TO SHEETS 15 FOR CONSTRUCTION AND MATERIAL SPECIFICATIONS FOR FABRICATION PURPOSES.

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>	Date	11/11/08

### Appendix B

#### ADLPIPE Input and Output files

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

### INPUT FILE

```

GE ***** CATAWBA NUCLEAR STATION *****
GE,COOLING WATER RETURN LINE FROM D/G BLDG OF UNIT 2 TO 42-IN HEADER 'B'
UN,0,0,0,
NOTE,MODEL=return2b.adi
NO,*****
NO,THERE ARE TWO RETURN LINES RUNNING FROM THE D/G BUILDING OF UNIT 2
NO,THIS IS THE LINE THAT GOES TO THE 42-IN RETURN HEADER 'B'
NO,*****
NO,GLOBAL COORDINATE SYSTEM: +X = NORTH, +Z = EAST, Y = VERTICAL
NO,*****
NO,PIPING: 10" AND 12", SCH. 40, Cr-Mo AND CARBON STEEL PIPES
NO, 12", DR 11, IPS HDPE PIPE,
NO,CONTENTS:
NO, WATER FILLED, NO INSULATION,
NO,DESIGN CONDITIONS:
NO, T(AMBIENT) = 55 F, T(DESIGN) = 140 F, P(DESIGN) = 60 PSI
NO,CODE: ASME, YEAR 1989,
NO,*****
NO,PIPING SYSTEM IS CONSIDERED ANCHORED AT BOTH ENDS
AN,,100,
RE,,100,1,1,1,1,1,1,
AN,,990,
RE,,990,1,1,1,1,1,1,
NO,*****
NO,THE FOLLOWING SOIL SPRING STIFFNESS VALUES IN [LB/IN] ARE USED.
NO
NO, LENGTH OF PIPE BETWEEN SPRINGS
NO, SOIL HEIGHT DIRECTION -----
NO, ABOVE PIPE OF SPRING 2FT SECTION 10FT SECTION
NO, -----
NO, H = 5 FT LATERAL 3120 15600
NO, VERTICAL 12960 64800
NO, AXIAL 10200 51000
NO,
NO,STIFFNESS VALUES FOR OTHER LENGTHS ARE OBTAINED BY PROPORTION
NO,*****
NO
RE,,1140,1,1,1,1,1,1,
RE,,2140,1,1,1,1,1,1,
RE,,3140,1,1,1,1,1,1,
RE,,1145,1,1,1,1,1,1,
RE,,2145,1,1,1,1,1,1,
RE,,3145,1,1,1,1,1,1,
RE,,1150,1,1,1,1,1,1,
RE,,2150,1,1,1,1,1,1,
RE,,3150,1,1,1,1,1,1,
RE,,1160,1,1,1,1,1,1,
RE,,2160,1,1,1,1,1,1,
RE,,3160,1,1,1,1,1,1,
RE,,1165,1,1,1,1,1,1,
RE,,2165,1,1,1,1,1,1,
RE,,3165,1,1,1,1,1,1,
RE,,1205,1,1,1,1,1,1,
RE,,2205,1,1,1,1,1,1,
RE,,3205,1,1,1,1,1,1,
RE,,1210,1,1,1,1,1,1,
RE,,2210,1,1,1,1,1,1,
RE,,3210,1,1,1,1,1,1,
RE,,1215,1,1,1,1,1,1,
RE,,2215,1,1,1,1,1,1,

```

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date			11/11/08

RE,,3215,1,1,1,1,1,1,  
 RE,,1220,1,1,1,1,1,1,  
 RE,,2220,1,1,1,1,1,1,  
 RE,,3220,1,1,1,1,1,1,  
 RE,,1225,1,1,1,1,1,1,  
 RE,,2225,1,1,1,1,1,1,  
 RE,,3225,1,1,1,1,1,1,  
 RE,,1230,1,1,1,1,1,1,  
 RE,,2230,1,1,1,1,1,1,  
 RE,,3230,1,1,1,1,1,1,  
 RE,,1235,1,1,1,1,1,1,  
 RE,,2235,1,1,1,1,1,1,  
 RE,,3235,1,1,1,1,1,1,  
 RE,,1240,1,1,1,1,1,1,  
 RE,,2240,1,1,1,1,1,1,  
 RE,,3240,1,1,1,1,1,1,  
 RE,,1245,1,1,1,1,1,1,  
 RE,,2245,1,1,1,1,1,1,  
 RE,,3245,1,1,1,1,1,1,  
 RE,,1250,1,1,1,1,1,1,  
 RE,,2250,1,1,1,1,1,1,  
 RE,,3250,1,1,1,1,1,1,  
 RE,,1260,1,1,1,1,1,1,  
 RE,,2260,1,1,1,1,1,1,  
 RE,,3260,1,1,1,1,1,1,  
 RE,,1265,1,1,1,1,1,1,  
 RE,,2265,1,1,1,1,1,1,  
 RE,,3265,1,1,1,1,1,1,  
 RE,,1270,1,1,1,1,1,1,  
 RE,,2270,1,1,1,1,1,1,  
 RE,,3270,1,1,1,1,1,1,  
 RE,,1320,1,1,1,1,1,1,  
 RE,,2320,1,1,1,1,1,1,  
 RE,,3320,1,1,1,1,1,1,  
 RE,,1330,1,1,1,1,1,1,  
 RE,,2330,1,1,1,1,1,1,  
 RE,,3330,1,1,1,1,1,1,  
 RE,,1340,1,1,1,1,1,1,  
 RE,,2340,1,1,1,1,1,1,  
 RE,,3340,1,1,1,1,1,1,  
 RE,,1350,1,1,1,1,1,1,  
 RE,,2350,1,1,1,1,1,1,  
 RE,,3350,1,1,1,1,1,1,  
 RE,,1360,1,1,1,1,1,1,  
 RE,,2360,1,1,1,1,1,1,  
 RE,,3360,1,1,1,1,1,1,  
 RE,,1370,1,1,1,1,1,1,  
 RE,,2370,1,1,1,1,1,1,  
 RE,,3370,1,1,1,1,1,1,  
 RE,,1380,1,1,1,1,1,1,  
 RE,,2380,1,1,1,1,1,1,  
 RE,,3380,1,1,1,1,1,1,  
 RE,,1390,1,1,1,1,1,1,  
 RE,,2390,1,1,1,1,1,1,  
 RE,,3390,1,1,1,1,1,1,  
 RE,,1400,1,1,1,1,1,1,  
 RE,,2400,1,1,1,1,1,1,  
 RE,,3400,1,1,1,1,1,1,  
 RE,,1410,1,1,1,1,1,1,  
 RE,,2410,1,1,1,1,1,1,  
 RE,,3410,1,1,1,1,1,1,  
 RE,,1420,1,1,1,1,1,1,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date			11/11/08

RE,,2420,1,1,1,1,1,1,  
 RE,,3420,1,1,1,1,1,1,  
 RE,,1430,1,1,1,1,1,1,  
 RE,,2430,1,1,1,1,1,1,  
 RE,,3430,1,1,1,1,1,1,  
 RE,,1440,1,1,1,1,1,1,  
 RE,,2440,1,1,1,1,1,1,  
 RE,,3440,1,1,1,1,1,1,  
 RE,,1490,1,1,1,1,1,1,  
 RE,,2490,1,1,1,1,1,1,  
 RE,,3490,1,1,1,1,1,1,  
 RE,,1495,1,1,1,1,1,1,  
 RE,,2495,1,1,1,1,1,1,  
 RE,,3495,1,1,1,1,1,1,  
 RE,,1500,1,1,1,1,1,1,  
 RE,,2500,1,1,1,1,1,1,  
 RE,,3500,1,1,1,1,1,1,  
 RE,,1510,1,1,1,1,1,1,  
 RE,,2510,1,1,1,1,1,1,  
 RE,,3510,1,1,1,1,1,1,  
 RE,,1520,1,1,1,1,1,1,  
 RE,,2520,1,1,1,1,1,1,  
 RE,,3520,1,1,1,1,1,1,  
 RE,,1530,1,1,1,1,1,1,  
 RE,,2530,1,1,1,1,1,1,  
 RE,,3530,1,1,1,1,1,1,  
 RE,,1540,1,1,1,1,1,1,  
 RE,,2540,1,1,1,1,1,1,  
 RE,,3540,1,1,1,1,1,1,  
 RE,,1600,1,1,1,1,1,1,  
 RE,,2600,1,1,1,1,1,1,  
 RE,,3600,1,1,1,1,1,1,  
 RE,,1610,1,1,1,1,1,1,  
 RE,,2610,1,1,1,1,1,1,  
 RE,,3610,1,1,1,1,1,1,  
 RE,,1620,1,1,1,1,1,1,  
 RE,,2620,1,1,1,1,1,1,  
 RE,,3620,1,1,1,1,1,1,  
 RE,,1670,1,1,1,1,1,1,  
 RE,,2670,1,1,1,1,1,1,  
 RE,,3670,1,1,1,1,1,1,  
 RE,,1675,1,1,1,1,1,1,  
 RE,,2675,1,1,1,1,1,1,  
 RE,,3675,1,1,1,1,1,1,  
 RE,,1680,1,1,1,1,1,1,  
 RE,,2680,1,1,1,1,1,1,  
 RE,,3680,1,1,1,1,1,1,  
 RE,,1685,1,1,1,1,1,1,  
 RE,,2685,1,1,1,1,1,1,  
 RE,,3685,1,1,1,1,1,1,  
 RE,,1690,1,1,1,1,1,1,  
 RE,,2690,1,1,1,1,1,1,  
 RE,,3690,1,1,1,1,1,1,  
 RE,,1695,1,1,1,1,1,1,  
 RE,,2695,1,1,1,1,1,1,  
 RE,,3695,1,1,1,1,1,1,  
 RE,,1700,1,1,1,1,1,1,  
 RE,,2700,1,1,1,1,1,1,  
 RE,,3700,1,1,1,1,1,1,  
 RE,,1705,1,1,1,1,1,1,  
 RE,,2705,1,1,1,1,1,1,  
 RE,,3705,1,1,1,1,1,1,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

RE,,1710,1,1,1,1,1,1,  
 RE,,2710,1,1,1,1,1,1,  
 RE,,3710,1,1,1,1,1,1,  
 RE,,1715,1,1,1,1,1,1,  
 RE,,2715,1,1,1,1,1,1,  
 RE,,3715,1,1,1,1,1,1,  
 RE,,1720,1,1,1,1,1,1,  
 RE,,2720,1,1,1,1,1,1,  
 RE,,3720,1,1,1,1,1,1,  
 RE,,1725,1,1,1,1,1,1,  
 RE,,2725,1,1,1,1,1,1,  
 RE,,3725,1,1,1,1,1,1,  
 RE,,1730,1,1,1,1,1,1,  
 RE,,2730,1,1,1,1,1,1,  
 RE,,3730,1,1,1,1,1,1,  
 RE,,1735,1,1,1,1,1,1,  
 RE,,2735,1,1,1,1,1,1,  
 RE,,3735,1,1,1,1,1,1,  
 RE,,1740,1,1,1,1,1,1,  
 RE,,2740,1,1,1,1,1,1,  
 RE,,3740,1,1,1,1,1,1,  
 RE,,1745,1,1,1,1,1,1,  
 RE,,2745,1,1,1,1,1,1,  
 RE,,3745,1,1,1,1,1,1,  
 RE,,1750,1,1,1,1,1,1,  
 RE,,2750,1,1,1,1,1,1,  
 RE,,3750,1,1,1,1,1,1,  
 RE,,1800,1,1,1,1,1,1,  
 RE,,2800,1,1,1,1,1,1,  
 RE,,3800,1,1,1,1,1,1,  
 RE,,1805,1,1,1,1,1,1,  
 RE,,2805,1,1,1,1,1,1,  
 RE,,3805,1,1,1,1,1,1,  
 RE,,1810,1,1,1,1,1,1,  
 RE,,2810,1,1,1,1,1,1,  
 RE,,3810,1,1,1,1,1,1,  
 RE,,1815,1,1,1,1,1,1,  
 RE,,2815,1,1,1,1,1,1,  
 RE,,3815,1,1,1,1,1,1,  
 RE,,1820,1,1,1,1,1,1,  
 RE,,2820,1,1,1,1,1,1,  
 RE,,3820,1,1,1,1,1,1,  
 RE,,1825,1,1,1,1,1,1,  
 RE,,2825,1,1,1,1,1,1,  
 RE,,3825,1,1,1,1,1,1,  
 RE,,1840,1,1,1,1,1,1,  
 RE,,2840,1,1,1,1,1,1,  
 RE,,3840,1,1,1,1,1,1,  
 RE,,1850,1,1,1,1,1,1,  
 RE,,2850,1,1,1,1,1,1,  
 RE,,3850,1,1,1,1,1,1,  
 RE,,1860,1,1,1,1,1,1,  
 RE,,2860,1,1,1,1,1,1,  
 RE,,3860,1,1,1,1,1,1,  
 SE,,0,

NO \*\*\*\*\*

NO,THE PIPING SYSTEM STARTS AT THE SURFACE OF THE D/G BUILDING WALL  
 NO,WITH A 10-IN Cr-Mo STEEL PIPE THAT IS CONSIDERED ANCHORED AT THE  
 NO,SURFACE OF THE WALL (NODE PT. 100).  
 NO,  
 NO,PIPE CENTERLINE IS AT ELEVATION 588'-6"  
 NO

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

NO,A 10X12 STEEL REDUCER, WITH FLANGES WELDED ON ITS ENDS, CONNECTS,  
NO,THE 10-IN PIPE TO A 12-IN HDPE PIPE

NO,\*\*\*\*\*

NO,10-IN, SCH. 40 CHROM-MOLY STEEL PIPE PROPERTIES,;

NO, OUTSIDE DIAMETER = 10.75 IN

NO, WALL THICKNESS = 0.365 IN

NO, WT(PIPE)= 40.5LB/FT = 3.38 LB/IN

NO, WT(WATER) = 34.1 LB/FT= 2.84 LB/IN

NO, WT(PIPE+WATER) = 3.38 + 2.84 = 6.22 LB/IN

NO

NO,PROPERTIES OF PIPE MATERIAL (SB-690/SB-675) AT 70 F:

NO, E = 28E+06 PSI

NO, ALPHA = 8.1E-06 IN/IN/F

NO,\*\*\*\*\*

NO

PI,100,105,10.75,0.365,28.0,8.1,.01,6.22,

NO

NO,\*\*\*\*\*

NO,LENGTH OF 10-IN DIAMETER PIPE COMING OUT OF WALL = 20IN = 1.67FT

NO,\*\*\*\*\*

NO

RU,100,105,1.67,,,

NO

NO,\*\*\*\*\*

NO,ATTACH A 150-LB WELDING NECK (WN) FLANGE TO END OF 10-IN PIPE

NO,AND TO THE 10" SIDE OF REDUCER

NO,FOR 10-IN WN FLANGE (PER LADISH CATALOG):

NO, TOTAL LENGTH = 4.0 IN = 0.33 FT

NO, FLANGE THICKNESS = 1.188 IN

NO, O. D. OF FLANGE = 16 IN

NO, DIAMETER AT HUB BASE= 12.0 IN

NO, WALL THICKNESS (MIN) = 0.365 IN

NO, WEIGHT OF FLANGE= 54 LB --> UNIT WT = 13.50 LB/IN

NO, WT(FLANGE+WATER)= 13.50 + 2.84 = 16.3 LB/IN

NO,USE DIAMETER AT HUB BASE AS O.D. FOR MODELING

NO,\*\*\*\*\*

NO

NOTE,IV=WNFL,END=FLG

1V,105,110,0.33,,12.0,0.365,16.3,

NOTE,IV=WNFL,BEG=FLG

1V,110,115,0.33,,12.0,0.365,16.3,

NO

NO,\*\*\*\*\*

NO,INSTALL A 10X12 STEEL REDUCER.

NO,PER LADISH CATALOG:

NO, REDUCER LENGTH = 8 IN = 0.67 FT

NO, REDUCER WEIGHT = 34 LB --> UNIT WT = 4.25 LB/IN

NO,WEIGHT OF WATER:

NO, FOR 10" PIPE = 34.1 LB/FT = 2.84 LB/IN

NO, FOR 12" PIPE = 49.0 LB/FT = 4.08 LB/IN

NO, FOR 10X12 REDUCER = (2.84+4.08)/2 = 3.46 LB/IN

NO,WT (REDUCER+WATER) = 4.25 + 3.46 = 7.7 LB/IN

NO,FOR 12" PIPE: OD = 12.75 IN AND WALL THICKNESS = 0.375 IN

NO,\*\*\*\*\*

NO

RD,115,120,0.67,,12.75,0.375,7.7,

NO

NO,\*\*\*\*\*

NO,ATTACH A WELDING NECK (WN) FLANGE TO THE 12-IN SIDE OF REDUCER

NO,FOR 12-IN,150-LB WN FLANGE (PER LADISH CATALOG):,

NO, TOTAL LENGTH = 4.5 IN = 0.38 FT

NO, FLANGE THICKNESS = 1.25 IN

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

NO, O. D. OF FLANGE = 19 IN  
 NO, DIAMETER AT HUB BASE= 14.375 IN  
 NO, WALL THICKNESS (MIN) = 0.375 IN  
 NO, WEIGHT OF FLANGE= 88 LB --> UNIT WT = 19.56 LB/IN  
 NO, WT(FLANGE+WATER)= 19.56 + 4.08 = 23.6 LB/IN  
 NO,USE DIAMETER AT HUB BASE AS O.D. FOR MODELING  
 NO,\*\*\*\*\*  
 NO,  
 NOTE,IV=WNFL,END=FLG  
 1V,120,130,0.38,,,14.375,0.375,23.6,  
 SE,,0,  
 NO,  
 NO,\*\*\*\*\*  
 NO, CHANGE TO 12" HDPE PIPE  
 NO,\*\*\*\*\*  
 NO,12-IN, DR 11 HDPE PIPE PROPERTIES:,  
 NO, OUTSIDE DIAMETER, OD = 12.75 IN  
 NO, MIN.WALL THICKNESS, t = 1.159 IN  
 NO, INSIDE DIAMETER, ID = OD - 2t = 10.432 IN  
 NO, WT(PIPE) = 18.41 LB/FT = 1.53 LB/IN  
 NO, WT(WATER) = 37.04 LB/FT = 3.09 LB/IN  
 NO, WT(WATER+PIPE) = 1.53 + 3.09 = 4.62 LB/IN  
 NO,  
 NO,HDPE PROEPRITIES AT 70F AND 50-YEAR DURATION:  
 NO, E = 28 KSI  
 NO, ALPHA = 90.0E-6 IN/IN/F  
 NO,\*\*\*\*\*  
 NO,  
 PI,130,133,12.75,1.159,28.0E-3,90.0,0.01,4.62,  
 NO,  
 NO,\*\*\*\*\*  
 NO,INSTALL A FLANGE ADAPTER WITH A STEEL BACKUP RING MOUNTED ON IT  
 NO,  
 NO,FOR 12-IN, DR 11, IPS HDPE FLANGE ADAPTER (PER ISCO CATALOG):,  
 NO, TOTAL LENGTH = 12.0 IN = 1.0 FT  
 NO, FLANGE THICKNESS = 1.55 IN  
 NO, WEIGHT OF ADAPTER = 24 LB  
 NO,FOR 12-IN STEEL BACKUP RING (PER ISCO CATALOG):  
 NO, THICKNESS = 1.25 IN, WEIGHT = 24 LB  
 NO,  
 NO,MODEL ADAPTER AND RING ASSEMBLY AS A PIPE AND FLANGE COMBINATION  
 NO,FOR FLANGE, USE:,  
 NO, LENGTH = 1.55+1.25 = 2.8" --> LENGTH = 3 IN  
 NO, WALL THICKNESS = 1.15 IN  
 NO, O.D. OF FLANGE = 15.5 IN  
 NO, WEIGHT = WT(RING+ADAPTER) - WT(9" LONG PIPE)  
 NO, = 24.0 + 24.0 - 18.4\*(9/12) = 34.2 LB  
 NO, WT(FLANGE+WATER)=( 34.2/3)+3.09 = 14.5 LB/IN  
 NO,  
 NO,FOR PIPE, USE:,  
 NO, LENGTH = 12.0 - 3.0 = 9 IN  
 NO, WT(PIPE+WATER) = 4.62LB/IN  
 NO,\*\*\*\*\*  
 NO,  
 NOTE,IV=WNFL,BEG=FLG  
 1V,130,133,0.25,,,15.5,1.159,14.5,  
 RU,133,135,0.75,,,  
 NO,  
 NO,\*\*\*\*\*  
 NO,PIPE ORIENTATION: PARALLEL TO X-AXIS  
 NO,  
 NO,SINCE PIPE AXIS IS AT ELEVATION 588'-6", HEIGHT OF SOIL (H) FROM,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date	11/11/08		

NO, TOP OF PIPE = 5 FT. THEREFORE, USE THE FOLLOWING SOIL SPRING  
 NO, STIFFNESS VALUES OBTAINED FOR H = 5 FT.

NO,	SPRING STIFFNESS [LB/IN]		
NO,	DIRECTION	-----	
NO,	OF SPRING	2FT SECTION	10FT SECTION
NO,	-----	-----	-----
NO,	LATERAL	3120	15600
NO,	VERTICAL	12960	64800
NO,	AXIAL	10200	51000

NO, LENGTH OF HDPE PIPE PARALLEL TO X-AXIS = 15.6-5.0 = 10.6FT < 12FT  
 NO, THEREFORE, APPLY SOIL SPRINGS AT 2FT (OR LESS) INTERVALS  
 NO, DIVIDE PIPE LENGTH AS FOLLOWS: 10.6'=2.0'+2.0'+0.6'+2.0'+2.0'+2.0'

NO, LOCATION OF 1ST SPRING SET FROM END OF FLANGE ADAPTER= 1.0 FT

NO, \*\*\*\*\*

NO  
 RU,135,140,1.0,  
 SE,,0,  
 RU,140,1140,1.0,,  
 2SP,140,1140,10200,,  
 SE,,0,  
 RU,140,2140,,1.0,,  
 2SP,140,2140,12960,,  
 SE,,0,  
 RU,140,3140,,1.0,  
 2SP,140,3140,3120,,  
 SE,,0,  
 RU,140,145,2.0,  
 SE,,0,  
 RU,145,1145,1.0,,  
 2SP,145,1145,10200,,  
 SE,,0,  
 RU,145,2145,,1.0,,  
 2SP,145,2145,12960,,  
 SE,,0,  
 RU,145,3145,,1.0,  
 2SP,145,3145,3120,,  
 SE,,0,

NO, \*\*\*\*\*

NO, LENGTH OF NEXT SECTION = 0.6FT. SOIL SPRING STIFFNESS VALUES  
 NO, ARE ADJUSTED (PROPORTIONAL TO LENGTH)

NO, \*\*\*\*\*

RU,145,150,0.6,,  
 SE,,0,  
 RU,150,1150,1.0,,  
 2SP,150,1150,3060,,  
 SE,,0,  
 RU,150,2150,,1.0,,  
 2SP,150,2150,3888,,  
 SE,,0,  
 RU,150,3150,,1.0,  
 2SP,150,3150,936,,  
 SE,,0,

NO, \*\*\*\*\*

NO, APPLY SOIL SPRINGS AROUND 90-DEG. ELBOW AT 2 FT INTERVALS

NO, \*\*\*\*\*

RU,150,160,2.0,  
 SE,,0,  
 RU,160,1160,1.0,,  
 2SP,160,1160,10200,,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

SE,,0,  
 RU,160,2160,,1.0,,  
 2SP,160,2160,12960,,,  
 SE,,0,  
 RU,160,3160,,1.0,  
 2SP,160,3160,3120,,,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,LENGTH OF 90-DEGREE ELBOW 24.9 IN > 2FT. HENCE, ELBOW STARTS IN  
 NO,NEXT 2FT SECTION (23.1 IN = 1.925FT FROM CURRENT NODE POINT)  
 NO,  
 NO,NEXT RUN GOES UP TO BEGINNING OF ELBOW. SINCE RUN LENGTH IS  
 NO,APPROX. = 2FT, FOR SIMPLICITY, APPLY SOIL SPRINGS AT END OF THIS  
 NO,RUN AND USE STIFFNESS VALUES OBTAINED FOR A 2FT SECTION.  
 NO,\*\*\*\*\*  
 RU,160,165,1.925,  
 SE,,0,  
 RU,165,1165,1.0,,  
 2SP,165,1165,10200,,  
 SE,,0,  
 RU,165,2165,,1.0,,  
 2SP,165,2165,12960,,  
 SE,,0,  
 RU,165,3165,,1.0,  
 2SP,165,3165,3120,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,\*\*\*\*\* 90 DEGREE IPS HDPE ELBOW \*\*\*\*\*  
 NO,\*\*\*\*\*  
 NO,THIS IS A 5-SEGMENT MITERED ELBOW.  
 NO,FOR 12-IN, DR-9, MITERED ELBOW (PER ISCO CATALOG);  
 NO, OUTSIDE DIAMETER, OD = 12.75 IN  
 NO, MIN. WALL THICKNESS, t = 1.417 IN  
 NO, INSIDE DIAMETER, ID = OD - 2t = 9.916 IN  
 NO, RADIUS, R = 19.5 IN  
 NO, LENGTH, FC = 24.9 IN = 2.075 FT  
 NO, WT(PIPE) = 21.97 LB/FT = 1.83 LB/IN  
 NO,WEIGHT OF WATER FOR ID = 9.916 IN:  
 NO, WT(WATER)= 33.46 LB/FT = 2.79 LB/IN  
 NO,WT(PIPE+WATER) = 1.83 + 2.79 = 4.62 LB/IN  
 NO  
 NO,SIF AND STRESS INDICES FOR MITERED ELBOW:  
 NO, SIF = 2.0 B1 = 0.69 B2 = 1.64  
 NO  
 NO,ELBOW STARTS AT NODE PT. 165 AND ENDS AT NODE PT. 205  
 NO,\*\*\*\*\*  
 NO,  
 RU,165,170,2.075,,  
 CM,170,180,12.75,1.417,,19.5,11.25,4.62,  
 IB,170,180,2.0,.69,1.64,  
 CM,180,185,12.75,1.417,,19.5,22.5,4.62,  
 IB,180,185,2.0,.69,1.64,  
 CM,185,190,12.75,1.417,,19.5,22.5,4.62,  
 IB,185,190,2.0,.69,1.64,  
 CM,190,195,12.75,1.417,,19.5,22.5,4.62,  
 IB,190,195,2.0,.69,1.64,  
 CM,195,200,12.75,1.417,,19.5,,4.62,  
 IB,195,200,2.0,.69,1.64,  
 RU,200,205,,2.075,  
 NO  
 NO,\*\*\*\*\*  
 NO,PIPE AXIS IS NOW PARALLEL TO Z-AXIS, X IS LATERAL DIRECTION,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date			11/11/08

NO  
 NO,TOTAL LENGTH OF PIPING UP TO THE NEXT (90-DEG.) ELBOW = 83.2 FT  
 NO  
 NO,LENGTH FOR APPLICATION OF SOIL SPRINGS AT 2FT INTERVALS (AROUND  
 NO,ELBOWS, ON EACH END OF PIPING) = 12 FT  
 NO  
 NO,LENGTH AVAILABLE TO APPLY SPRINGS AT 10 FT INTERVALS = 71.2 FT  
 NO,\*\*\*\*\*  
 NO,SINCE 90-DEG ELBOW LENGTH = 24.9" = 2.075 FT (APPROX.= 2FT),  
 NO,FOR SIMPLICITY, APPLY FISRT SET OF SOIL SPRINGS AT END OF ELBOW  
 NO,AND USE STIFFNESS VALUES OBTAINED FOR A 2FT SECTION.  
 NO,\*\*\*\*\*  
 SE,,0,  
 RU,205,1205,1.0,,,  
 2SP,205,1205,3120,  
 SE,,0,  
 RU,205,2205,1.0,,  
 2SP,205,2205,12960,  
 SE,,0,  
 RU,205,3205,,,1.0,  
 2SP,205,3205,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT SECTION IS 1.925FT LONG (=APPROX. 2 FT). USE SOIL SPRING  
 NO,STIFFNESS VALUE OF A 2FT SECTION  
 NO,\*\*\*\*\*  
 RU,205,210,,,1.925,  
 SE,,0,  
 RU,210,1210,1.0,,,  
 2SP,210,1210,3120,  
 SE,,0,  
 RU,210,2210,1.0,,  
 2SP,210,2210,12960,  
 SE,,0,  
 RU,210,3210,,,1.0,  
 2SP,210,3210,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT SECTION IS 2 FT LONG  
 NO,\*\*\*\*\*  
 RU,210,215,,,2.0,  
 SE,,0,  
 RU,215,1215,1.0,,,  
 2SP,215,1215,3120,  
 SE,,0,  
 RU,215,2215,1.0,,  
 2SP,215,2215,12960,  
 SE,,0,  
 RU,215,3215,,,1.0,  
 2SP,215,3215,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,CHANGE SPACING OF SOIL SPRINGS FROM 2 FT TO 10 FT  
 NO,AVAILABLE LENGTH TO APPLY SPRINGS EVERY 10 FT = 71.2 FT  
 NO,DIVIDE THIS LENGTH AS FOLLOWS: 71.2FT = 6\*10FT + 2\*5.6FT  
 NO,\*\*\*\*\*  
 NO,  
 NO,\*\*\*\*\*  
 NO,NEXT PIPNG SECTION IS 5.6 FT LONG. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO,\*\*\*\*\*  
 RU,215,220,,,5.6,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

SE,,0,  
 RU,220,1220,1.0,,,  
 2SP,220,1220,8736,  
 SE,,0,  
 RU,220,2220,,1.0.,  
 2SP,220,2220,36288,  
 SE,,0,  
 RU,220,3220,,,1.0,  
 2SP,220,3220,28560,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,SOIL SPRING SPACING = 10 FT (OVER THE NEXT 60 FT LENGTH)  
 NO \*\*\*\*\*  
 RU,220,225,,,10.0,  
 SE,,0,  
 RU,225,1225,1.0,,,  
 2SP,225,1225,15600,  
 SE,,0,  
 RU,225,2225,,1.0.,  
 2SP,225,2225,64800,  
 SE,,0,  
 RU,225,3225,,,1.0,  
 2SP,225,3225,51000,  
 SE,,0,  
 RU,225,230,,,10.0,  
 SE,,0,  
 RU,230,1230,1.0,,,  
 2SP,230,1230,15600,  
 SE,,0,  
 RU,230,2230,,1.0.,  
 2SP,230,2230,64800,  
 SE,,0,  
 RU,230,3230,,,1.0,  
 2SP,230,3230,51000,  
 SE,,0,  
 RU,230,235,,,10.0,  
 SE,,0,  
 RU,235,1235,1.0,,,  
 2SP,235,1235,15600,  
 SE,,0,  
 RU,235,2235,,1.0.,  
 2SP,235,2235,64800,  
 SE,,0,  
 RU,235,3235,,,1.0,  
 2SP,235,3235,51000,  
 SE,,0,  
 RU,235,240,,,10.0,  
 SE,,0,  
 RU,240,1240,1.0,,,  
 2SP,240,1240,15600,  
 SE,,0,  
 RU,240,2240,,1.0.,  
 2SP,240,2240,64800,  
 SE,,0,  
 RU,240,3240,,,1.0,  
 2SP,240,3240,51000,  
 SE,,0,  
 RU,240,245,,,10.0,  
 SE,,0,  
 RU,245,1245,1.0,,,  
 2SP,245,1245,15600,  
 SE,,0,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

RU,245,2245,,1.0,,  
 2SP,245,2245,64800,  
 SE,,0,  
 RU,245,3245,,,1.0,  
 2SP,245,3245,51000,  
 SE,,0,  
 RU,245,250,,,10.0,  
 SE,,0,  
 RU,250,1250,1.0,,,  
 2SP,250,1250,15600,  
 SE,,0,  
 RU,250,2250,,1.0,,  
 2SP,250,2250,64800,  
 SE,,0,  
 RU,250,3250,,,1.0,  
 2SP,250,3250,51000,  
 SE,,0,

NO,\*\*\*\*\*  
 NO,NEXT PIPNG SECTION IS 5.6 FT LONG. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO,\*\*\*\*\*

RU,250,260,,,5.6,  
 SE,,0,  
 RU,260,1260,1.0,,,  
 2SP,260,1260,8736,  
 SE,,0,  
 RU,260,2260,,1.0,,  
 2SP,260,2260,36288,  
 SE,,0,  
 RU,260,3260,,,1.0,  
 2SP,260,3260,28560,  
 SE,,0,

NO,\*\*\*\*\*  
 NO,CHANGE SPACING OF SOIL SPRINGS TO 2 FT (AROUND 90-DEGREE ELBOW)  
 NO,\*\*\*\*\*

RU,260,265,,,2.0,  
 SE,,0,  
 RU,265,1265,1.0,,,  
 2SP,265,1265,3120,  
 SE,,0,  
 RU,265,2265,,1.0,,  
 2SP,265,2265,12960,  
 SE,,0,  
 RU,265,3265,,,1.0,  
 2SP,265,3265,10200,  
 SE,,0,

NO,\*\*\*\*\*  
 NO,LENGTH OF 90-DEGREE ELBOW 24.9 IN > 2FT. HENCE, ELBOW STARTS IN  
 NO,NEXT 2FT SECTION (23.1 IN = 1.925FT FROM CURRENT NODE POINT)  
 NO,

NO,NEXT RUN GOES UP TO BEGINNING OF ELBOW. SINCE RUN LENGTH IS  
 NO,APPROX. = 2FT, FOR SIMPLICITY, APPLY SOIL SPRINGS AT END OF THIS  
 NO,RUN AND USE STIFFNESS VALUES OBTAINED FOR A 2FT SECTION.  
 NO,\*\*\*\*\*

NO  
 RU,265,270,,,1.925,  
 SE,,0,  
 RU,270,1270,1.0,,,  
 2SP,270,1270,3120,  
 SE,,0,  
 RU,270,2270,,1.0,,  
 2SP,270,2270,12960,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

SE,,0,  
 RU,270,3270,,1.0,  
 2SP,270,3270,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO, 90 DEGREE IPS HDPE ELBOW  
 NO,\*\*\*\*\*  
 NO,THIS IS A 12", DR-9, 5-SEGMENT MITER ELBOW. PROPERTIES OF ELBOW  
 NO,ARE AS LISTED EARLIER.  
 NO,  
 NO,ELBOW STARTS AT NODE PT. 270 AND ENDS AT NODE PT. 320  
 NO,\*\*\*\*\*  
 NO  
 RU,270,280,,2.075,  
 CM,280,285,12.75,1.417,,19.5,11.25,4.62,  
 IB,280,285,2.0,.69,1.64,  
 CM,285,290,12.75,1.417,,19.5,22.5,4.62,  
 IB,285,290,2.0,.69,1.64,  
 CM,290,295,12.75,1.417,,19.5,22.5,4.62,  
 IB,290,295,2.0,.69,1.64,  
 CM,295,300,12.75,1.417,,19.5,22.5,4.62,  
 IB,295,300,2.0,.69,1.64,  
 CM,300,310,12.75,1.417,,19.5,,4.62,  
 IB,300,310,2.0,.69,1.64,  
 RU,310,320,2.075,,  
 NO  
 NO,\*\*\*\*\*  
 NO,PIPE IS PARALLEL TO X-AXIS; Z IS LATERAL DIRECTION  
 NO,  
 NO,LENGTH OF NEXT SECTION = 91.5 FT  
 NO,  
 NO,APPLY SPRINGS AT 2FT INTERVALS AROUND ELBOWS (6FT ON EACH END)  
 NO,AND EVERY 10FT IN REMAINING SECTION (LENGTH= 91.5'-12'= 79.5FT)  
 NO,\*\*\*\*\*  
 NO,SINCE 90-DEG ELBOW LENGTH = 24.9" = 2.075 FT (APPROX.= 2FT),  
 NO,FOR SIMPLICITY, APPLY FIRST SET OF SOIL SPRINGS AT END OF ELBOW  
 NO,AND USE STIFFNESS VALUES OBTAINED FOR A 2FT SECTION.  
 NO,\*\*\*\*\*  
 SE,,0,  
 RU,320,1320,1.0,,  
 2SP,320,1320,10200,,  
 SE,,0,  
 RU,320,2320,,1.0,,  
 2SP,320,2320,12960,,  
 SE,,0,  
 RU,320,3320,,1.0,  
 2SP,320,3320,3120,,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT SECTION IS 1.925FT LONG (=APPROX. 2 FT). USE SOIL SPRING  
 NO,STIFFNESS VALUE OF A 2FT SECTION  
 NO,\*\*\*\*\*  
 RU,320,330,1.925,,  
 SE,,0,  
 RU,330,1330,1.0,,  
 2SP,330,1330,10200,,  
 SE,,0,  
 RU,330,2330,,1.0,,  
 2SP,330,2330,12960,,  
 SE,,0,  
 RU,330,3330,,1.0,  
 2SP,330,3330,3120,,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

SE,,0,  
NO, \*\*\*\*\*  
NO,NEXT SECTION IS 2FT LONG  
NO, \*\*\*\*\*  
RU,330,340,2,,,  
SE,,0,  
RU,340,1340,1.0,,,  
2SP,340,1340,10200,,,  
SE,,0,  
RU,340,2340,,1.0,,  
2SP,340,2340,12960,,,  
SE,,0,  
RU,340,3340,,1.0,  
2SP,340,3340,3120,,,  
SE,,0,  
NO, \*\*\*\*\*  
NO,CHANGE SPACING OF SOIL SPRINGS FROM 2 FT TO 10 FT  
NO,AVAILABLE LENGTH TO APPLY SPRINGS EVERY 10 FT = 79.5 FT  
NO,DIVIDE THIS LENGTH AS FOLLOWS: 79.5FT = 6\*10FT + 2\*9.75FT  
NO, \*\*\*\*\*  
NO, \*\*\*\*\*  
NO,NEXT PIPNG SECTION IS 9.75 FT LONG. SOIL SPRING STIFFNESS VALUES  
NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
NO, \*\*\*\*\*  
RU,340,350,9.75,,,  
SE,,0,  
RU,350,1350,1.0,,,  
2SP,350,1350,49725,,,  
SE,,0,  
RU,350,2350,,1.0,,  
2SP,350,2350,63180,,,  
SE,,0,  
RU,350,3350,,1.0,  
2SP,350,3350,15210,,,  
SE,,0,  
NO, \*\*\*\*\*  
NO,SOIL SPRING SPACING IS 10 FT FOR THE NEXT 60 FT SECTION  
NO, \*\*\*\*\*  
RU,350,360,10,,,  
SE,,0,  
RU,360,1360,1.0,,,  
2SP,360,1360,51000,,,  
SE,,0,  
RU,360,2360,,1.0,,  
2SP,360,2360,64800,,,  
SE,,0,  
RU,360,3360,,1.0,  
2SP,360,3360,15600,,,  
SE,,0,  
RU,360,370,10,,,  
SE,,0,  
RU,370,1370,1.0,,,  
2SP,370,1370,51000,,,  
SE,,0,  
RU,370,2370,,1.0,,  
2SP,370,2370,64800,,,  
SE,,0,  
RU,370,3370,,1.0,  
2SP,370,3370,15600,,,  
SE,,0,  
RU,370,380,10,,,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

SE,,0,  
 RU,380,1380,1.0,,,  
 2SP,380,1380,51000,,,  
 SE,,0,  
 RU,380,2380,,1.0,,  
 2SP,380,2380,64800,,,  
 SE,,0,  
 RU,380,3380,,,1.0,  
 2SP,380,3380,15600,,,  
 SE,,0,  
 RU,380,390,10.,,,  
 SE,,0,  
 RU,390,1390,1.0,,,  
 2SP,390,1390,51000,,,  
 SE,,0,  
 RU,390,2390,,1.0,,  
 2SP,390,2390,64800,,,  
 SE,,0,  
 RU,390,3390,,,1.0,  
 2SP,390,3390,15600,,,  
 SE,,0,  
 RU,390,400,10.,,,  
 SE,,0,  
 RU,400,1400,1.0,,,  
 2SP,400,1400,51000,,,  
 SE,,0,  
 RU,400,2400,,1.0,,  
 2SP,400,2400,64800,,,  
 SE,,0,  
 RU,400,3400,,,1.0,  
 2SP,400,3400,15600,,,  
 SE,,0,  
 RU,400,410,10.,,,  
 SE,,0,  
 RU,410,1410,1.0,,,  
 2SP,410,1410,51000,,,  
 SE,,0,  
 RU,410,2410,,1.0,,  
 2SP,410,2410,64800,,,  
 SE,,0,  
 RU,410,3410,,,1.0,  
 2SP,410,3410,15600,,,  
 SE,,0,  
 NO,\*\*\*\*\*

NO,NEXT PIPNG SECTION IS 9.75FT LONG. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)

NO,\*\*\*\*\*  
 RU,410,420,9.75,,,  
 SE,,0,  
 RU,420,1420,1.0,,,  
 2SP,420,1420,49725,,,  
 SE,,0,  
 RU,420,2420,,1.0,,  
 2SP,420,2420,63180,,,  
 SE,,0,  
 RU,420,3420,,,1.0,  
 2SP,420,3420,15210,,,  
 SE,,0,  
 NO,\*\*\*\*\*

NO,CHANGE SPACING OF SOIL SPRINGS TO 2 FT (AROUND 45-DEGREE ELBOW)

NO,  
 NO

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

RU,420,430,2,,,  
 SE,,0,  
 RU,430,1430,1.0,,,  
 2SP,430,1430,10200,,,  
 SE,,0,  
 RU,430,2430,,1.0,,  
 2SP,430,2430,12960,,,  
 SE,,0,  
 RU,430,3430,,,1.0,  
 2SP,430,3430,3120,,,  
 SE,,0,  
 RU,430,440,2,,,  
 SE,,0,  
 RU,440,1440,1.0,,,  
 2SP,440,1440,10200,,,  
 SE,,0,  
 RU,440,2440,,1.0,,  
 2SP,440,2440,12960,,,  
 SE,,0,  
 RU,440,3440,,,1.0,  
 2SP,440,3440,3120,,,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT RUN GOES UP TO BEGINNING OF 45-DEGREE MITERED ELBOW  
 NO,LENGTH OF 45-DEG. MITERED ELBOW (SEE BELOW): FC = 1.13 FT  
 NO,THEREFORE, LENGTH OF RUN = 2.0'-1.13' = 0.87 FT  
 NO,\*\*\*\*\*  
 NO  
 RU,440,445,0.87,  
 NO  
 NO,\*\*\*\*\*  
 NO \*\*\*\*\* 45 DEGREE IPS HDPE ELBOW \*\*\*\*\*  
 NO,\*\*\*\*\*  
 NO,THIS IS A 3-SEGMENT MITERED ELBOW.  
 NO,FOR 12-IN, DR-9, MITERED ELBOW (PER ISCO CATALOG):  
 NO, OUTSIDE DIAMETER, OD = 12.75 IN  
 NO, MIN. WALL THICKNESS, t = 1.417 IN  
 NO, INSIDE DIAMETER, ID = OD - 2t = 9.916 IN  
 NO, RADIUS, R = 19.5 IN  
 NO, LENGTH, FC = 13.5 IN = 1.13 FT  
 NO, WT(PIPE) = 21.97 LB/FT = 1.83 LB/IN  
 NO,WEIGHT OF WATER FOR ID = 9.916 IN:  
 NO, WT(WATER)= 33.46 LB/FT = 2.79 LB/IN  
 NO,WT(PIPE+WATER) = 1.83 + 2.79 = 4.62 LB/IN  
 NO  
 NO,SIF AND STRESS INDICES FOR MITERED ELBOW:  
 NO, SIF = 2.0 B1 = 0.69 B2 = 1.64  
 NO  
 NO,ELBOW STARTS AT NODE PT. 445 AND ENDS AT NODE PT. 485  
 NO,\*\*\*\*\*  
 NO  
 RU,445,450,1.13,,,  
 CM,450,460,12.75,1.417,,19.5,11.25,4.62,  
 IB,450,460,2.0,,.69,1.64,  
 CM,460,470,12.75,1.417,,19.5,22.5,4.62,  
 IB,460,470,2.0,,.69,1.64,  
 CM,470,480,12.75,1.417,,19.5,,4.62,  
 IB,470,480,2.0,,.69,1.64,  
 RU,480,485,0.8,,0.8,  
 NO  
 NO,\*\*\*\*\*  
 NO,PIPE AXIS OF NEXT SECTION MAKES 45 DEGREES (CCW) WITH Z-AXIS

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

NO,LENGTH OF PIPE = 55 FT  
 NO,\*\*\*\*\*  
 NO,APPLY SOIL SPRINGS EVERY 2FT AROUND ELBOWS (6FT ON EACH END)  
 NO,AND EVERY 10FT IN THE REMAINING SECTION (LENGTH= 55'-12')= 43 FT  
 NO  
 NO,LOCATION OF 1ST SPRING SET FROM END OF ELBOW= 2.0-1.13= 0.87FT  
 NO,\*\*\*\*\*  
 NO  
 RU,485,490,0.615,,0.615,  
 SE,,0,  
 RU,490,1490,0.707,,0.707,,1,,  
 2SP,490,1490,10200,  
 SE,,0,  
 RU,490,2490,,1,,  
 2SP,490,2490,12960,  
 SE,,0,  
 RU,490,3490,0.707,,0.707,,1,,  
 2SP,490,3490,3120,  
 SE,,0,  
 RU,490,495,1.414,,1.414,  
 SE,,0,  
 RU,495,1495,0.707,,0.707,,1,,  
 2SP,495,1495,10200,,  
 SE,,0,  
 RU,495,2495,,1.0,,  
 2SP,495,2495,12960,,  
 SE,,0,  
 RU,495,3495,0.707,,0.707,,1,,  
 2SP,495,3495,3120,,  
 SE,,0,  
 RU,495,500,1.414,,1.414,  
 SE,,0,  
 RU,500,1500,0.707,,0.707,,1,,  
 2SP,500,1500,10200,,  
 SE,,0,  
 RU,500,2500,,1.0,,  
 2SP,500,2500,12960,,  
 SE,,0,  
 RU,500,3500,0.707,,0.707,,1,,  
 2SP,500,3500,3120,,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,CHANGE SPACING OF SOIL SPRINGS FROM 2 FT TO 10 FT  
 NO,AVAILABLE LENGTH TO APPLY SPRINGS EVERY 10FT = 43 FT  
 NO,DIVIDE THIS LENGTH AS: 43FT = 6.5FT + 3\*10FT + 6.5FT  
 NO,\*\*\*\*\*  
 NO,NEXT PIPING SECTION IS 6.5 FT LONG. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO,\*\*\*\*\*  
 NO  
 RU,500,510,4.60,,4.60,  
 SE,,0,  
 RU,510,1510,0.707,,0.707,,1,,  
 2SP,510,1510,33150,,  
 SE,,0,  
 RU,510,2510,,1.0,,  
 2SP,510,2510,42120,,  
 SE,,0,  
 RU,510,3510,0.707,,0.707,,1,,  
 2SP,510,3510,10140,,  
 SE,,0,  
 NO,\*\*\*\*\*

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date	11/11/08		

NO,SOIL SPRING SPACING = 10FT FOR NEXT 30 FT LENGTH

NO \*\*\*\*\*

RU,510,520,7.07,,7.07,  
 SE,,0,  
 RU,520,1520,0.707,,0.707,,1,,  
 2SP,520,1520,51000,,  
 SE,,0,  
 RU,520,2520,,1.0,,  
 2SP,520,2520,64800,,  
 SE,,0,  
 RU,520,3520,0.707,,-0.707,,1,,  
 2SP,520,3520,15600,,  
 SE,,0,  
 RU,520,530,7.07,,7.07,  
 SE,,0,  
 RU,530,1530,0.707,,0.707,,1,,  
 2SP,530,1530,51000,,  
 SE,,0,  
 RU,530,2530,,1.0,,  
 2SP,530,2530,64800,,  
 SE,,0,  
 RU,530,3530,0.707,,-0.707,,1,,  
 2SP,530,3530,15600,,  
 SE,,0,  
 RU,530,540,7.07,,7.07,  
 SE,,0,  
 RU,540,1540,0.707,,0.707,,1,,  
 2SP,540,1540,51000,,  
 SE,,0,  
 RU,540,2540,,1.0,,  
 2SP,540,2540,64800,,  
 SE,,0,  
 RU,540,3540,0.707,,-0.707,,1,,  
 2SP,540,3540,15600,,  
 SE,,0,

NO \*\*\*\*\*

NO,NEXT PIPING SECTION IS 6.5 FT LONG. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)

NO \*\*\*\*\*

NO  
 RU,540,600,4.60,,4.60,  
 SE,,0,  
 RU,600,1600,0.707,,0.707,,1,,  
 2SP,600,1600,33150,,  
 SE,,0,  
 RU,600,2600,,1.0,,  
 2SP,600,2600,42120,,  
 SE,,0,  
 RU,600,3600,0.707,,-0.707,,1,,  
 2SP,600,3600,10140,,  
 SE,,0,

NO \*\*\*\*\*

NO,CHANGE SPACING OF SOIL SPRINGS TO 2 FT (AROUND 45-DEGREE ELBOW)

NO \*\*\*\*\*

NO  
 RU,600,610,1.414,,1.414,  
 SE,,0,  
 RU,610,1610,0.707,,0.707,,1,,  
 2SP,610,1610,10200,,  
 SE,,0,  
 RU,610,2610,,1.0,,  
 2SP,610,2610,12960,,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

SE,,0,  
 RU,610,3610,0.707,,-0.707,,1,,  
 2SP,610,3610,3120,,,  
 SE,,0,  
 RU,610,620,1.414,,1.414,  
 SE,,0,  
 RU,620,1620,0.707,,0.707,,1,,  
 2SP,620,1620,10200,,,  
 SE,,0,  
 RU,620,2620,,1.0,,  
 2SP,620,2620,12960,,,  
 SE,,0,  
 RU,620,3620,0.707,,-0.707,,1,,  
 2SP,620,3620,3120,,,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT RUN GOES UP TO BEGINNING OF 45-DEGREE MITERED ELBOW  
 NO,LENGTH OF 45-DEG. MITERED ELBOW (SEE ELBOW DIMENSIONS):FC= 1.13FT  
 NO,THEREFORE, LENGTH OF NEXT RUN = 2.0'-1.13' = 0.87 FT  
 NO,\*\*\*\*\*  
 NO  
 RU,620,625,0.615,,0.615,  
 NO  
 NO,\*\*\*\*\*  
 NO,\*\*\*\*\* 45 DEGREE IPS HDPE ELBOW \*\*\*\*\*  
 NO,\*\*\*\*\*  
 NO,THIS IS A 3-SEGMENT MITERED ELBOW. THE PROPERTIES ARE AS LISTED  
 NO,EARLIER.  
 NO  
 NO,ELBOW STARTS AT NODE PT. 625 AND ENDS AT NODE PT. 665  
 NO,\*\*\*\*\*  
 NO  
 RU,625,630,0.8,,0.8,  
 CM,630,640,12.75,1.417,,19.5,11.25,4.62,  
 IB,630,640,2.0,.69,1.64,  
 CM,640,650,12.75,1.417,,19.5,22.5,4.62,  
 IB,640,650,2.0,.69,1.64,  
 CM,650,660,12.75,1.417,,19.5,,4.62,  
 IB,650,660,2.0,0.69,1.64,  
 RU,660,665,,1.13,  
 NO  
 NO,\*\*\*\*\*  
 NO,PIPING IS NOW PARALLEL TO Z-AXIS. X IS LATERAL DIRECTION  
 NO  
 NO,LENGTH OF PIPING SECTION PARALLEL TO Z-AXIS = 129.1 FT  
 NO,  
 NO,APPLY SOIL SPRINGS EVERY 2FT AROUND ELBOWS (6FT AT EACH END) AND  
 NO,EVERY 10 FT IN THE REMAINING SECTION (LENGTH= 129.1-12=117.1 FT)  
 NO  
 NO,LOCATION OF 1ST SPRING SET FROM END OF ELBOW= 2.0-1.13= 0.87FT  
 NO,\*\*\*\*\*  
 NO  
 RU,665,670,,0.87,  
 NO  
 SE,,0,  
 RU,670,1670,1.0,,  
 2SP,670,1670,3120,  
 SE,,0,  
 RU,670,2670,,1.0,,  
 2SP,670,2670,12960,  
 SE,,0,  
 RU,670,3670,,1.0,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

2SP,670,3670,10200,  
 SE,,0,  
 RU,670,675,,,2.0,  
 SE,,0,  
 RU,675,1675,1.0,,,  
 2SP,675,1675,3120,  
 SE,,0,  
 RU,675,2675,,1.0,,  
 2SP,675,2675,12960,  
 SE,,0,  
 RU,675,3675,,,1.0,  
 2SP,675,3675,10200,  
 SE,,0,  
 RU,675,680,,,2.0,  
 SE,,0,  
 RU,680,1680,1.0,,,  
 2SP,680,1680,3120,  
 SE,,0,  
 RU,680,2680,,1.0,,  
 2SP,680,2680,12960,  
 SE,,0,  
 RU,680,3680,,,1.0,  
 2SP,680,3680,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,CHANGE SPACING OF SOIL SPRINGS TO 10 FT  
 NO,AVAILABLE LENGTH = 117.1 FT  
 NO,DIVIDE THIS LENGTH AS FOLLOWS: 117.1 FT = 10\*10FT + 2\*8.55FT  
 NO,\*\*\*\*\*  
 NO  
 NO,\*\*\*\*\*  
 NO,LENGTH OF NEXT PIPING SECTION = 8.55 FT. SOIL SPRING STIFFNESS  
 NO,VALUES ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO,\*\*\*\*\*  
 NO  
 RU,680,685,,,8.55,  
 SE,,0,  
 RU,685,1685,1.0,,,  
 2SP,685,1685,13338,  
 SE,,0,  
 RU,685,2685,,1.0,,  
 2SP,685,2685,55404,  
 SE,,0,  
 RU,685,3685,,,1.0,  
 2SP,685,3685,43605,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,SOIL SPRING SPACING IS 10 FT FOR THE NEXT 100 FT SECTION  
 NO,\*\*\*\*\*  
 RU,685,690,,,10.0,  
 SE,,0,  
 RU,690,1690,1.0,,,  
 2SP,690,1690,15600,  
 SE,,0,  
 RU,690,2690,,1.0,,  
 2SP,690,2690,64800,  
 SE,,0,  
 RU,690,3690,,,1.0,  
 2SP,690,3690,51000,  
 SE,,0,  
 RU,690,695,,,10.0,  
 SE,,0,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

RU,695,1695,1.0,,,  
 2SP,695,1695,15600,  
 SE,,0,  
 RU,695,2695,,1.0,,  
 2SP,695,2695,64800,  
 SE,,0,  
 RU,695,3695,,,1.0,  
 2SP,695,3695,51000,  
 SE,,0,  
 RU,695,700,,,10.0,  
 SE,,0,  
 RU,700,1700,1.0,,,  
 2SP,700,1700,15600,  
 SE,,0,  
 RU,700,2700,,1.0,,  
 2SP,700,2700,64800,  
 SE,,0,  
 RU,700,3700,,,1.0,  
 2SP,700,3700,51000,  
 SE,,0,  
 RU,700,705,,,10.0,  
 SE,,0,  
 RU,705,1705,1.0,,,  
 2SP,705,1705,15600,  
 SE,,0,  
 RU,705,2705,,1.0,,  
 2SP,705,2705,64800,  
 SE,,0,  
 RU,705,3705,,,1.0,  
 2SP,705,3705,51000,  
 SE,,0,  
 RU,705,710,,,10.0,  
 SE,,0,  
 RU,710,1710,1.0,,,  
 2SP,710,1710,15600,  
 SE,,0,  
 RU,710,2710,,1.0,,  
 2SP,710,2710,64800,  
 SE,,0,  
 RU,710,3710,,,1.0,  
 2SP,710,3710,51000,  
 SE,,0,  
 RU,710,715,,,10.0,  
 SE,,0,  
 RU,715,1715,1.0,,,  
 2SP,715,1715,15600,  
 SE,,0,  
 RU,715,2715,,1.0,,  
 2SP,715,2715,64800,  
 SE,,0,  
 RU,715,3715,,,1.0,  
 2SP,715,3715,51000,  
 SE,,0,  
 RU,715,720,,,10.0,  
 SE,,0,  
 RU,720,1720,1.0,,,  
 2SP,720,1720,15600,  
 SE,,0,  
 RU,720,2720,,1.0,,  
 2SP,720,2720,64800,  
 SE,,0,  
 RU,720,3720,,,1.0,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date		Date	11/11/08

2SP,720,3720,51000,  
 SE,,0,  
 RU,720,725,,,10.0,  
 SE,,0,  
 RU,725,1725,1.0,,,  
 2SP,725,1725,15600,  
 SE,,0,  
 RU,725,2725,,1.0,,  
 2SP,725,2725,64800,  
 SE,,0,  
 RU,725,3725,,,1.0,  
 2SP,725,3725,51000,  
 SE,,0,  
 RU,725,730,,,10.0,  
 SE,,0,  
 RU,730,1730,1.0,,,  
 2SP,730,1730,15600,  
 SE,,0,  
 RU,730,2730,,1.0,,  
 2SP,730,2730,64800,  
 SE,,0,  
 RU,730,3730,,,1.0,  
 2SP,730,3730,51000,  
 SE,,0,  
 RU,730,735,,,10.0,  
 SE,,0,  
 RU,735,1735,1.0,,,  
 2SP,735,1735,15600,  
 SE,,0,  
 RU,735,2735,,1.0,,  
 2SP,735,2735,64800,  
 SE,,0,  
 RU,735,3735,,,1.0,  
 2SP,735,3735,51000,  
 SE,,0,

NO \*\*\*\*\*  
 NO,NEXT SECTION IS 8.55 FT LONG. SOIL SPRING STIFFNESS VALUES ARE  
 NO,ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO \*\*\*\*\*

NO  
 RU,735,740,,,8.55,  
 SE,,0,  
 RU,740,1740,1.0,,,  
 2SP,740,1740,13338,  
 SE,,0,  
 RU,740,2740,,1.0,,  
 2SP,740,2740,55404,  
 SE,,0,  
 RU,740,3740,,,1.0,  
 2SP,740,3740,43605,  
 SE,,0,

NO \*\*\*\*\*  
 NO,APPLY SOIL SPRINGS AT 2 FT INTERVALS  
 NO \*\*\*\*\*

NO  
 RU,740,745,,,2.0,  
 SE,,0,  
 RU,745,1745,1.0,,,  
 2SP,745,1745,3120,  
 SE,,0,  
 RU,745,2745,,1.0,,  
 2SP,745,2745,12960,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

SE,,0,  
 RU,745,3745,,,1.0,  
 2SP,745,3745,10200,  
 SE,,0,  
 RU,745,750,,,2.0,  
 SE,,0,  
 RU,750,1750,1.0,,,  
 2SP,750,1750,3120,  
 SE,,0,  
 RU,750,2750,,,1.0,,  
 2SP,750,2750,12960,  
 SE,,0,  
 RU,750,3750,,,1.0,  
 2SP,750,3750,10200,  
 SE,,0,  
 NO,\*\*\*\*\*  
 NO,NEXT RUN GOES UP TO BEGINNING OF 45-DEGREE MITERED ELBOW  
 NO,LENGTH OF 45-DEG. MITERED ELBOW (SEE ELBOW DIMENSIONS):FC= 1.13FT  
 NO,THEREFORE, LENGTH OF NEXT RUN = 2.0'-1.13' = 0.87 FT  
 NO,\*\*\*\*\*  
 NO  
 RU,750,755,,,0.87,  
 NO  
 NO,\*\*\*\*\*  
 NO,\*\*\*\*\* 45 DEGREE IPS HDPE ELBOW \*\*\*\*\*  
 NO,\*\*\*\*\*  
 NO,THIS IS A 3-SEGMENT MITERED ELBOW. THE PROPERTIES ARE AS LISTED  
 NO,EARLIER.  
 NO  
 NO,ELBOW STARTS AT NODE PT. 755 AND ENDS AT NODE PT. 795  
 NO,\*\*\*\*\*  
 NO  
 RU,755,760,,,1.13,  
 CM,760,770,12.75,1.417,,19.5,11.25,4.62,  
 IB,760,770,2.0,.69,1.64,  
 CM,770,780,12.75,1.417,,19.5,22.5,4.62,  
 IB,770,780,2.0,.69,1.64,  
 CM,780,790,12.75,1.417,,19.5,,4.62,  
 IB,780,790,2.0,.69,1.64,  
 RU,790,795,0.8,,0.8,  
 NO  
 NO,\*\*\*\*\*  
 NO,PIPE AXIS NOW MAKES 45 DEGREES (CCW) WITH Z-AXIS  
 NO  
 NO,TOTAL LENGTH OF NEXT PIPING SECTION= 45.4 FT  
 NO,LENGTH OF STEEL COMPONENTS= ELBOW(12")+FLANGE(4.5")=16.5"= 1.4'  
 NO,LENGTH OF HDPE PIPING = 45.4' - 1.4' = 44.0 FT  
 NO  
 NO,\*\*\*\*\*  
 NO,APPLY SOIL SPRINGS EVERY 2FT AROUND HDPE ELBOW AND WITHIN THE  
 NO,'INFLUENCE LENGTH' (OVER A TOTAL OF 12 FT) AND EVERY 10FT IN  
 NO,THE REMAINING SECTION (LENGTH = 44 - 12 = 32 FT)  
 NO  
 NO,LOCATION OF 1ST SPRING SET FROM END OF ELBOW= 2.0-1.13= 0.87FT  
 NO,\*\*\*\*\*  
 NO  
 RU,795,800,0.615,,0.615,  
 SE,,0,  
 RU,800,1800,0.707,,0.707,,1,,  
 2SP,800,1800,10200,  
 SE,,0,  
 RU,800,2800,,1,,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date			11/11/08

2SP,800,2800,12960,  
 SE,,0,  
 RU,800,3800,0.707,-0.707,,1,,  
 2SP,800,3800,3120,  
 SE,,0,  
 RU,800,805,1.414,,1.414,  
 SE,,0,  
 RU,805,1805,0.707,,0.707,,1,,  
 2SP,805,1805,10200,  
 SE,,0,  
 RU,805,2805,,1,,  
 2SP,805,2805,12960,  
 SE,,0,  
 RU,805,3805,0.707,-0.707,,1,,  
 2SP,805,3805,3120,  
 SE,,0,  
 RU,805,810,1.414,,1.414,  
 SE,,0,  
 RU,810,1810,0.707,,0.707,,1,,  
 2SP,810,1810,10200,  
 SE,,0,  
 RU,810,2810,,1,,  
 2SP,810,2810,12960,  
 SE,,0,  
 RU,810,3810,0.707,-0.707,,1,,  
 2SP,810,3810,3120,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,CHANGE SOIL SPRING SPACING TO 10FT  
 NO,DIVIDE AVAILABLE LENGTH AS FOLLOWS: 32FT = 2\*10FT + 2\*6FT  
 NO \*\*\*\*\*  
 NO  
 NO,\*\*\*\*\*  
 NO,LENGTH OF NEXT PIPING SECTION = 6 FT. SOIL SPRING STIFFNESS  
 NO,VALUES ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO \*\*\*\*\*  
 RU,810,815,4.24,,4.24,  
 SE,,0,  
 RU,815,1815,0.707,,0.707,,1,,  
 2SP,815,1815,30600,,  
 SE,,0,  
 RU,815,2815,,1.0,,  
 2SP,815,2815,38880,,  
 SE,,0,  
 RU,815,3815,0.707,-0.707,,1,,  
 2SP,815,3815,9360,,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,SOIL SPRING SPACING = 10 FT OVER THE NEXT 20 FT SECTION  
 NO,\*\*\*\*\*  
 RU,815,820,7.07,,7.07,  
 SE,,0,  
 RU,820,1820,0.707,,0.707,,1,,  
 2SP,820,1820,51000,,  
 SE,,0,  
 RU,820,2820,,1.0,,  
 2SP,820,2820,64800,,  
 SE,,0,  
 RU,820,3820,0.707,-0.707,,1,,  
 2SP,820,3820,15600,,  
 SE,,0,  
 RU,820,825,7.07,,7.07,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

SE,,0,  
 RU,825,1825,0.707,,0.707,,1,,  
 2SP,825,1825,51000,,,  
 SE,,0,  
 RU,825,2825,,1.0,,  
 2SP,825,2825,64800,,,  
 SE,,0,  
 RU,825,3825,0.707,,-0.707,,1,,  
 2SP,825,3825,15600,,,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,LENGTH OF NEXT SECTION = 6 FT. SOIL SPRING STIFFNESS VALUES  
 NO,ARE ADJUSTED (PROPORTIONAL TO SECTION LENGTH)  
 NO \*\*\*\*\*  
 RU,825,840,4.24,,4.24,  
 SE,,0,  
 RU,840,1840,0.707,,0.707,,1,,  
 2SP,840,1840,30600,,,  
 SE,,0,  
 RU,840,2840,,1.0,,  
 2SP,840,2840,38880,,,  
 SE,,0,  
 RU,840,3840,0.707,,-0.707,,1,,  
 2SP,840,3840,9360,,,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,CHANGE SOIL SPRING SPACING TO 2 FT  
 NO \*\*\*\*\*  
 NO  
 RU,840,850,1.414,,1.414,  
 SE,,0,  
 RU,850,1850,0.707,,0.707,,1,,  
 2SP,850,1850,10200,,,  
 SE,,0,  
 RU,850,2850,,1.0,,  
 2SP,850,2850,12960,,,  
 SE,,0,  
 RU,850,3850,0.707,,-0.707,,1,,  
 2SP,850,3850,3120,,,  
 SE,,0,  
 RU,850,860,1.414,,1.414,  
 SE,,0,  
 RU,860,1860,0.707,,0.707,,1,,  
 2SP,860,1860,10200,,,  
 SE,,0,  
 RU,860,2860,,1.0,,  
 2SP,860,2860,12960,,,  
 SE,,0,  
 RU,860,3860,0.707,,-0.707,,1,,  
 2SP,860,3860,3120,,,  
 SE,,0,  
 NO \*\*\*\*\*  
 NO,NEXT 2FT SECTION CONTAINS THE FLANGED END OF HDPE PIPE  
 NO  
 NO,LENGTH OF PIPE UP TO THE BEGINNING OF FLANGE ADAPTER:  
 NO, 2.0FT - 1.0 FT = 1.0 FT  
 NO \*\*\*\*\*  
 NO  
 RU,860,870,0.707,,0.707,  
 NO  
 NO \*\*\*\*\*  
 NO,INSTALL A FLANGE ADAPTER WITH A STEEL BACKUP RING MOUNTED ON IT

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

NO  
 NO, PROPERTIES OF ADAPTER AND RING ARE AS LISTED EARLIER (NEAR THE  
 NO, BEGINNING OF THIS MODEL)  
 NO, \*\*\*\*\*  
 NO  
 RU, 870,875,0.530,,0.530,  
 NOTE, IV=WNFL, END=FLG  
 1V, 875,880,0.177,,0.177,15.5,1.159,14.5,  
 SE,,0,  
 NO, \*\*\*\*\*  
 NO, CHANGE TO STEEL PIPE  
 NO, \*\*\*\*\*  
 NO, 12-IN, SCH. 40 Cr-Mo STEEL PIPE PROPERTIES:,  
 NO, OUTSIDE DIAMETER = 12.75 IN  
 NO, WALL THICKNESS = 0.375 IN  
 NO, WT(PIPE)= 49.6 LB/FT = 4.13 LB/IN  
 NO, WT(WATER) = 49.0 LB/FT = 4.08 LB/IN  
 NO, WT(PIPE+WATER) = (49.6+49.0)/12 = 8.22 LB/IN  
 NO, \*\*\*\*\*  
 NO,  
 PI, 880,900,12.75,0.375,28.0,8.1,0.01,8.22,  
 NO,  
 NO, \*\*\*\*\*  
 NO, INSTALL A 90-DEGREE ELBOW WITH A FLANGE WELDED TO ONE END  
 NO, \*\*\*\*\*  
 NO, FOR 12-IN SHORT RADIUS 90-DEG. ELBOW (BASED ON LADISH CATALOG):  
 NO, LENGTH = 12 IN T = 0.375 IN  
 NO, RADIUS = 12 IN WT(ELBOW)= 80 LB  
 NO, WT(ELBOW+WATER)= 129.0 LB/FT = 10.75 LB/IN  
 NO, \*\*\*\*\*  
 NO, PROPERTIES OF 12-IN, 150-LB WELDING NECK FLANGE ARE AS LISTED,  
 NO, EARLIER  
 NO, \*\*\*\*\*  
 NO, 90-DEG. ELBOW WILL BE CONNECTED TO A VERTICAL 12-IN PIPE  
 NO, \*\*\*\*\*  
 NO,  
 NOTE, IV=WNFL, BEG=FLG  
 1V, 880,900,0.269,,0.269,14.375,0.375,23.6,  
 RU, 900,910,0.71,,0.71,  
 EL, 910,920,,12.0,,10.75,  
 RU, 920,925,,-1.01,,  
 NO,  
 NO, \*\*\*\*\*  
 NO, PIPE IS ORIENTED PARALLEL TO THE Y-AXIS  
 NO,  
 NO, WELD ONE END OF A 3 FT LONG, 12-IN PIPE TO END OF 90-DEG. ELBOW.  
 NO, A FLANGE IS WELDED TO OTHER END OF THE PIPE.  
 NO, \*\*\*\*\*  
 NO,  
 RU, 925,930,,-3.0,,  
 NOTE, IV=WNFL, END=FLG  
 1V, 930,940,,-0.38,,14.375,0.375,23.6,  
 SE,,0,  
 NO,  
 NO, \*\*\*\*\*  
 NO, CHANGE MATERIAL TO CARBON STEEL (SA-106)  
 NO, \*\*\*\*\*  
 NO,  
 PI, 940,950,12.75,0.375,27.9,6.01,0.01,8.22,  
 NO,  
 NO, \*\*\*\*\*  
 NO, WELD A FLANGE TO A 12-IN CARBON STEEL PIPE AND ATTACH THE PIPE TO

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

```

NO,42-IN HEADER   LENGTH OF PIPE = 12 IN = 1.0 FT
NO,*****
NO,
NO,
NOTE,IV=WNFL,BEG=FLG
1V,940,950,,-0.38,,14.375,0.375,23.6,
RU,950,985,,-1.0,,
NO,
NO,*****
NO,A WELDOLET IS USED BETWEEN THE 12-IN PIPE AND 42-IN HEADER
NO,APPLY SIF=4.87 FOR WELDOLET AT JUNCTION POINT (CENTER OF 42" PIPE)
NO,*****
NO,42-IN DIAMETER PIPE PROPERTIES:
NO,  OD = 42 IN           WALL THICKNESS = 0.500 IN
NO,  WT(PIPE) = 221.6LB/FT   WT(WATER) = 571.7LB/FT
NO,  WT(PIPE+WATER)= 66.1LB/IN
NO,*****
NO,
SE,,0,
RU,985,990,,-1.75,
CH,985,990,42,0.500,,,66.1,
JB,985,990,4.87,
NO,
EN,,0
NO,***** END OF RUN *****
NO,
EXECUTE
NO,***** DEADWEIGHT ANALYSIS *****
NO,LOADING CASE NO. 10
NO,CODE= ASME, YEAR = 1989, CLASS = 3
NO,FOR 1989 ASME CODE, CLASS 3 ANALYSIS = CLASS 2 ANALYSIS
NO,DESIGN PRESSURE = 60 PSI, PEAK PRESSURE = 25 PSI
NO,SA-106 GRADE B CARBON STEEL PROPERTIES:
NO,  Sc = 15000 PSI       Sh = 15000 PSI
NO,  Sy = 35000 PSI       POISSON RATIO = 0.3
NO,  Ec = 27.9E+06 PSI
NO,HDPE 50-YEAR DURATION PROPERTIES:
NO,  Sc = 800 PSI         Sh = 800 PSI
NO,  Sy = 2500 PSI        POISSON RATIO = 0.45
NO,  Ec = 0.028E+06 PSI
NO,SB-690/SB-675 Cr-Mo STEEL PROPERTIES:
NO,  Sc = 23100 PSI       Sh = 22200 PSI
NO,  Sy = 45000 PSI       POISSON RATIO = 0.3
NO,  Ec = 28E+06 PSI
NO,
CL,,,3.0,1989,1,
CO,3,1,10,60,25,23100,22200,
MA,,,45000,,0.3,,,28.0,
CL,130,133,3.0,60,25,800,800,
MA,130,133,2500,,0.45,,,0.028,
CL,880,900,3.0,60,25,23100,22200,
MA,880,900,45000,,0.3,,,28.0,
CL,940,950,3.0,60,25,15000,15000,
MA,940,950,35000,,0.3,,,27.9,
DEADWEIGHT,,,,-1,,
XP,-27,20,
EN,,,
NO,
EXECUTE
NO,***** THERMAL ANALYSIS AT MIN TEMP = 32 F, LEVEL A *****
NO,LOADING CASE NO. 21
NO,Delta T = 32 F - 55 F = -23 F
NO,PROPERTIES OF HDPE, Cr-Mo AND CARBON STEEL ARE SAME AS DW CASE,

```

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>
		Date			11/11/08

NO

CL,,,3.0,1989,1,  
 CO,3,0,21,60,25,23100,22200,  
 MA,,,45000,,0.3,,,28.0,  
 CL,130,133,3.0,60,25,800,800,  
 MA,130,133,2500,,0.45,,,0.028,  
 CL,880,900,3.0,60,25,23100,22200,  
 MA,880,900,45000,,0.3,,,28.0,  
 CL,940,950,3.0,60,25,15000,15000,  
 MA,940,950,35000,,0.3,,,27.9,  
 CH,100,105,10.75,0.365,28.0,8.1,-23.,6.22,  
 CH,130,133,12.75,1.159,0.028,90.,-23.,4.62,  
 CH,880,900,12.75,0.375,28.0,8.1,-23.,8.22,  
 CH,950,985,12.75,0.375,27.9,6.07,-23,8.22,  
 TH,,0,  
 EN,,,  
 EXECUTE

NO,\*\*\*\*\* THERMAL ANALYSIS AT MAX TEMP = 140 F, LEVEL A \*\*\*\*\*

NO,LOADING CASE NO. 22

NO,Delta T = 140 F - 55 F = 85 F

NO,CARBON STEEL AND Cr-Mo STEEL PROPERTIES ARE SAME AS FOR DW CASE

NO

NO,HDPE 50-YEAR DURATION PROPERTIES:

NO, Sc = 800 PSI Sh = 430 PSI  
 NO, Sy = 2500 PSI POISSON RATIO = 0.45  
 NO, Ec = 0.012E+06 PSI

CL,,,3.0,1989,1,  
 CO,3,0,22,60,25,23100,22200,  
 MA,,,45000,,0.3,,,28.0,  
 CL,130,133,3.0,60,25,800,430,  
 MA,130,133,2500,,0.45,,,0.012,  
 CL,880,900,3.0,60,25,23100,22200,  
 MA,880,900,45000,,0.3,,,28.0,  
 CL,940,950,3.0,60,25,15000,15000,  
 MA,940,950,35000,,0.3,,,27.9,  
 CH,100,105,10.75,0.365,28.0,8.1,85.,6.22,  
 CH,130,133,12.75,1.159,0.012,90.,85.,4.62,  
 CH,880,900,12.75,0.375,28.0,8.1,85.,8.22,  
 CH,950,985,12.75,0.375,27.9,6.07,85,8.22,  
 TH,,0,  
 EN,,,  
 EXECUTE

NO,\*\*\*\*\* THERMAL ANALYSIS AT MIN TEMP = 32 F, LEVEL B \*\*\*\*\*

NO,LOADING CASE NO. 23

NO,DELTA T=32 F - 55 F = -23F

NO,CARBON STEEL AND Cr-Mo STEEL PROPERTIES ARE SAME AS DW CASE

NO,HDPE 10 YEAR DURATION PROPERTIES

NO, Sc=840 PSI Sh=840 PSI  
 NO, Sy=2500 PSI POISSON RATIO=0.45  
 NO, Ec=0.032E+6 PSI

CL,,,3.0,1989,1,  
 CO,3,0,23,60,25,23100,22200,  
 MA,,,45000,,0.3,,,28.0,  
 CL,130,133,3.0,60,25,840,840,  
 MA,130,133,2500,,0.45,,,0.032,  
 CL,880,900,3.0,60,25,23100,22200,  
 MA,880,900,45000,,0.3,,,28.0,  
 CL,940,950,3.0,60,25,15000,15000,  
 MA,940,950,35000,,0.3,,,27.9,  
 CH,100,105,10.75,0.365,28.0,8.1,-23,6.22,  
 CH,130,133,12.75,1.159,0.032,90,-23,4.62,  
 CH,880,900,12.75,0.375,28.0,8.1,-23,8.22,

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

CH,950,985,12.75,0.375,27.9,6.07,-23,8.22,  
 TH,,0,  
 EN,,,  
 NO  
 EXECUTE

NO,\*\*\*\*\* THERMAL ANALYSIS AT MAX TEMP = 140 F, LEVEL B \*\*\*\*\*

NO,LOADING CASE NO. 24  
 NO,DELTA T = 140 F - 85 F = 45 F  
 NO,CARBON STEEL AND Cr.-Mo STEEL PROPERTIES ARE SAME FOR DW CASE  
 NO,HDPE 10 YEAR DURATION PROPERTIES  
 NO, Sc=840 PSI Sh=430 PSI  
 NO, Sy=2500 PSI POISSON=0.45  
 NO, Ec=0.013E+6 PSI

CL,,,3.0,1989,1,  
 CO,3,0,24,60,25,23100,22000,  
 MA,,,45000,,0.3,,,28.0,  
 CL,130,133,3.0,60,25,840,430,  
 MA,130,133,2500,,0.45,,,0.013,  
 CL,880,900,3.0,60,25,23100,22200,  
 MA,880,900,45000,,0.3,,,28.0,  
 CL,940,950,3.0,60,25,15000,15000,  
 MA,940,950,35000,,0.3,,,27.9,  
 CH,100,105,10.75,0.365,28.0,8.1,85,6.22,  
 CH,130,133,12.75,1.159,0.013,90,85,4.62,  
 CH,880,900,12.75,0.375,28.0,8.1,85,8.22,  
 CH,950,985,12.75,0.375,27.9,6.07,85,8.22,

TH,,0,  
 EN,,,  
 NO  
 EXECUTE

NO,\*\*\*\*\* THERMAL ANALYSIS AT MIN TEMP = 32 F, LEVEL C/D \*\*\*\*\*

NO,LOADING CASE 25  
 NO,DELTA T = 32 F - 55 F = -23 F  
 NO  
 NO,CARBON STEEL AND Cr.-Mo. STEEL PROPERTIES ARE SAME AS DW CASE  
 NO,HDPE 1000 HOUR DURATION PROPERTIES  
 NO, Sc=840 PSI Sh=840 PSI  
 NO, Sy=2500 PSI POISSON=0.45  
 NO, Ec=0.044E+6 PSI

CL,,,3.0,1989,1,  
 CO,3,0,25,60,25,23100,22200,  
 MA,,,45000,,0.3,,,28.0,  
 CL,130,133,3.0,60,25,840,840,  
 MA,130,133,2500,,0.45,,,0.044,  
 CL,880,900,3.0,60,25,23100,22200,  
 MA,880,900,45000,,0.3,,,28.0,  
 CL,940,950,3.0,60,25,15000,15000,  
 MA,940,950,35000,,0.3,,,27.9,  
 CH,100,105,10.75,0.365,28.0,8.1,-23,6.22,  
 CH,130,133,12.75,1.159,0.044,90,-23,4.62,  
 CH,880,900,12.75,0.375,28.0,8.1,-23,8.22,  
 CH,950,985,12.75,0.375,27.9,6.07,-23,8.22,

TH,,0,  
 EN,,,  
 NO  
 EXECUTE

NO,\*\*\*\*\* THERMAL ANALYSIS AT MAX TEMP = 140 F, LEVEL C/D \*\*\*\*\*

NO,LOADING CASE 26  
 NO,DELTA T = 140 F - 55 F = 85 F  
 NO,CARBON STEEL AND Cr.-Mo. STEEL PROPERTIES ARE SAME DW CASE  
 NO,HDPE 1000 YEAR DURATION PROPERTIES  
 NO, Sc=840 PSI Sh=430 PSI

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>L. Hails</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date			11/11/08

```

NO, Sy=2500 PSI          POISSON=0.45
NO, Ec=0.018E+6 PSI
CL,,,3.0,1989,1,
CO,3,0,26,60,25,23100,22000,
MA,,,45000,,0.3,,,28.0,
CL,130,133,3.0,60,25,840,430,
MA,130,133,2500,,0.45,,,0.018,
CL,880,900,3.0,60,25,23100,22200,
MA,880,900,45000,,0.3,,,28.0,
CL,940,950,3.0,60,25,15000,15000,
MA,940,950,35000,,0.3,,,27.9,
CH,100,105,10.75,0.365,28.0,8.1,85,6.22,
CH,130,133,12.75,1.159,0.018,90,85,4.62,
CH,880,900,12.75,0.375,28.0,8.1,85,8.22,
CH,950,985,12.75,0.375,27.9,6.07,45,8.22,
TH,,0,
EN,,,
EXECUTE
NO,***** THERMAL ANALYSIS AT 65 F, PSEUDO-SEISMIC *****
NO,LOADING CASE NO. 30
NO
NO,Delta T = 10 F
NO,CARBON STEEL AND Cr.-Mo. STEEL PROPERTIES ARE SAME AS DW CASE
NO
NO,*** FOR HDPE, USE SHORT-TERM (< 10 HRS) PROPERTIES:,
NO, Sc = 1200 PSI          Sh = 1200 PSI
NO, Sy = 2500 PSI          POISSON RATIO = 0.35
NO, Ec = 0.110E+06 PSI
CL,,,3.0,1989,1,
CO,3,0,30,60,25,23100,22000,
MA,,,45000,,0.3,,,28.0,
CL,130,133,3.0,60,25,1200,1200,
MA,130,133,2500,,0.35,,,0.110,
CL,880,900,3.0,60,25,23100,22200,
MA,880,900,45000,,0.3,,,28.0,
CL,940,950,3.0,60,25,15000,15000,
MA,940,950,35000,,0.3,,,27.9,
CH,100,105,10.75,0.365,28.0,8.1,10.,6.22,
CH,130,133,12.75,1.159,0.110,90.,10.,4.62,
CH,880,900,12.75,0.375,28.0,8.1,10.,8.22,
CH,950,985,12.75,0.375,27.9,6.07,10,8.22,
TH,,0,
EN,,0,
NO
EXECUTE
NO,***** COMBINE LOAD CASES 21 AND 22, LEVEL A *****
NO,METHOD OF LOAD COMBINATION = ABSOLUTE VALUE OF RANGE
NO,LOADING CASE NO. 27
CL,,,3.0,1989,3,
NE,7,,21,22,,,,27,
OU,4,,27,
EN,,,
EXECUTE
NO,***** COMBINE LOAD CASES 23 AND 24, LEVEL B *****
NO,METHOD OF LOAD COMBINATION = ABSOLUTE VALUE OF RANGE
NO,LOADING CASE NO. 28
CL,,,3.0,1989,3,
NE,7,,23,24,,,,28,
OU,4,,28,
EN,,0,
EXECUTE
NO,***** COMBINE LOAD CASES 25 AND 26, LEVEL C/D *****

```

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010		
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis				
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2				
By:	<i>S. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouchef</i>
		Date		Date	11/11/08

```

NO,METHOD OF LOAD COMBINATION = ABSOLUTE VALUE OF RANGE
NO,LOADING CASE NO. 29
CL,,3.0,1989,3,
NE,7,,25,26,,,,29,
OU,4,,29,
EN,,0,
EXECUTE
NO,***** COMPUTE ABSOLUTE RANGE FOR LOAD CASE 30 (SEISMIC) *****
NO,THESE LOADS REPRESENT SSE SEISMIC LOAD RANGES
NO,METHOD OF COMPUTING = ABSOLUTE LOAD CASE 30 + ABSOLUTE LOAD CASE 30
NO,LOADING CASE NO. 31
CL,,3.0,1989,3,
NE,3,,30,30,,,,31,
OU,4,,31,
EN,,0,
EXECUTE
NO,***** DIVIDE ABSOLUTE RANGE OF LOAD CASE 30 BY 1.875 *****
NO,THESE LOADS REPRESENT OBE SEISMIC LOAD RANGES
NO,METHOD OF COMPUTING = FACTORING -> 0.5333*LOAD CASE 31
NO,LOADING CASE NO. 32
CL,,3.0,1989,3,
NE,8,,31,0.5333,,,,32,
OU,4,,32,
EN,,0,
EXECUTE
NO,***** COMBINE THERMAL AND OBE LOADS: LEVEL B *****
NO,METHOD OF COMBINATION = ADD ABSOLUTE VALUES OF EACH LOAD
NO,LOAD CASE NO. 40 -- USE THERMAL LOADS OBTAINED AT MINIMUM TEMP. (LOAD CASE 21)
NO,LOAD CASE NO. 41 -- USE THERMAL LOADS OBTAINED AT MAXIMUM TEMP. (LOAD CASE 22)
CL,,3.0,1989,3,
NE,3,,21,32,,,,40
NE,3,,22,32,,,,41
OU,1,,40,
OU,1,,41,
EN,,0,
EXECUTE
NO,***** SEARCH FOR HIGHEST LOADS FROM LOAD CASES 27, 40, AND 41: LEVEL B *****
NO,LOAD CASE NO. 45
CL,,3.0,1989,3,
NE,9,,27,40,41,,45
OU,1,,45,
EN,,0,
EXECUTE
NO,***** GENERATE STRESS REPORT: LEVEL A *****
CL,,3.0,1989,1,
EQUATION,8,,10
EQUATION,9,,10
EQUATION,10,,27
EN,,0,
EXECUTE
NO,***** GENERATE STRESS REPORT: LEVEL B *****
CL,,3.0,1989,2,
EQUATION,8,,10
EQUATION,9,,10
EQUATION,10,,45
EN,,0,
EXECUTE
NO,***** GENERATE STRESS REPORT: LEVEL C/D *****
CL,,3.0,1989,4,
EQUATION,10,,31
EN,,0,

```

## CALCULATION CONTINUATION SHEET

Client	Duke Power Carolinas, LLC	Calculation No.	07Q3691-CAL-010				
Project	Catawba Unit # 1 and #2 – Buried HDPE Piping Design and Analysis						
Title	Analysis of Buried HDPE Piping System— Nuclear Service Water (NSW) Return Line Diesel Generator “2B” Unit 2						
By:	<i>L. Hailer</i>	Date	11/10/08	Chk'd by	<i>Bruce J. Dubouché</i>	Date	11/11/08

### **OUTPUT FILE**

**Output file on CD-Rom**