



EXISTING TRANSMISSION SYSTEM

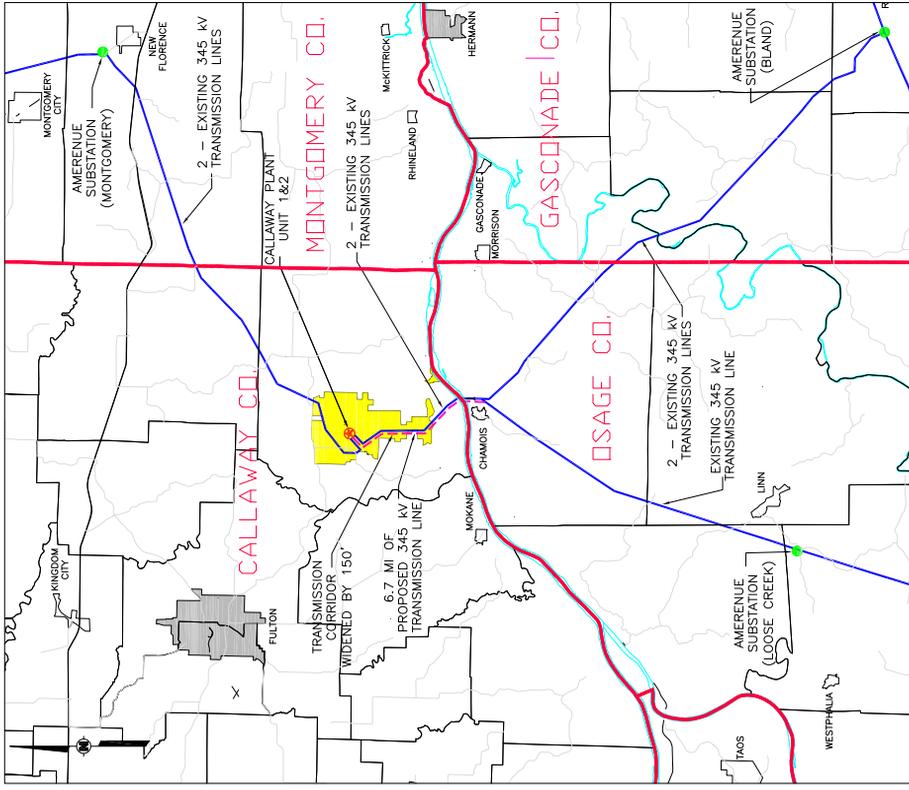

PLANNED TRANSMISSION SYSTEM



Callaway Plant Unit 2: 345 kV Transmission Line Corridors

Source: AmerenUE, Callaway Plant Unit 2 Combined License Application, Part 3: Environmental Report, Revision 0, July 2008, Fig. 3.7-1