Entergy
Nuclear Northeast

One Site, One Team, One Fleet
Indian Point Energy Center

Procedure Use Is:

☑ Continuous

☐ Reference

☐ Information

Control Copy:_____

Effective Date: 11/13/2006

2-GRAPH-TC-29, Revision 2
CITY WATER STORAGE TANK LEVEL

2

Indian Point Operations

Approved By:

Mark J. Mell 11/6/06

Procedure Sponsor, RPO/ Designee — Date

Team S

Procedure Owner

PARTIAL REVISION

CITY WATER STORAGE TANK LEVEL	No: 2-GRAPH-TC-29 Rev: 2
	Page 2 of 3

CWST Capacity vs. Indicated Level

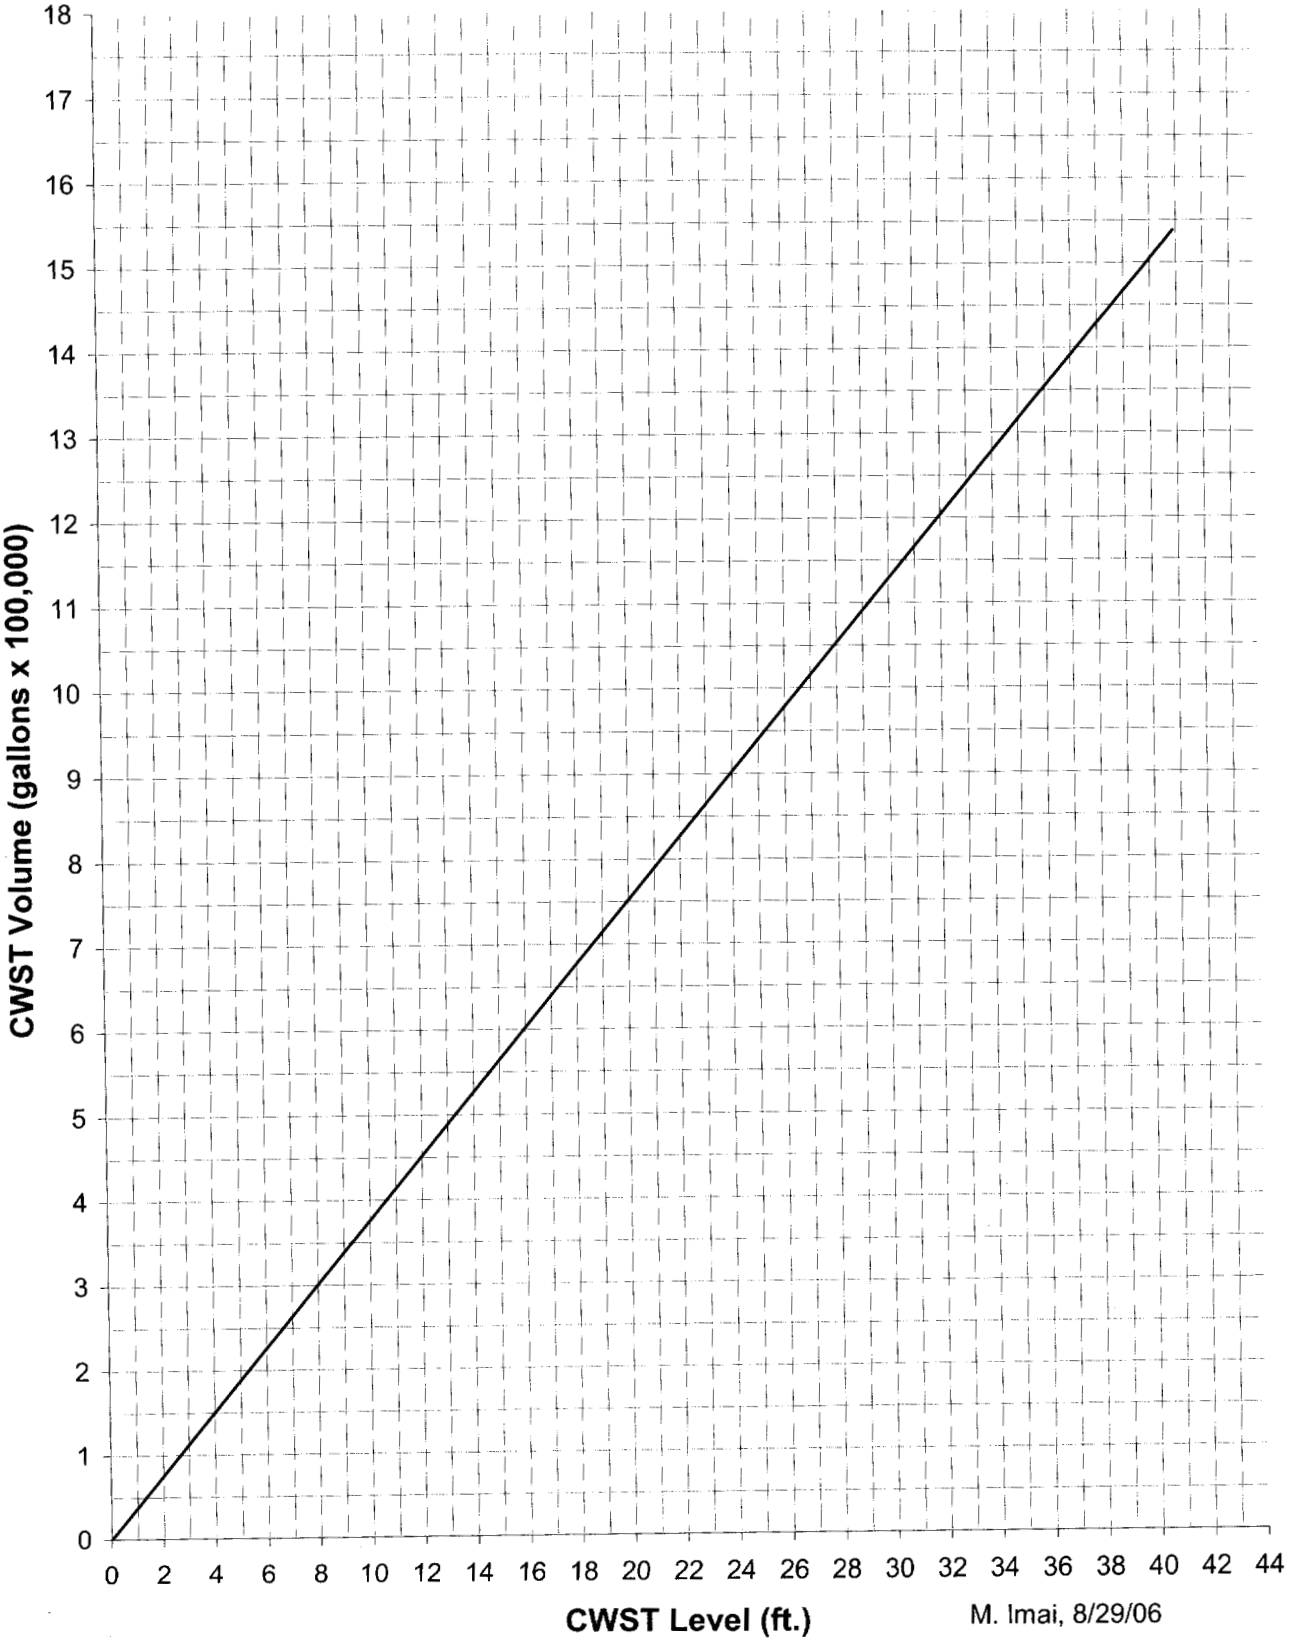
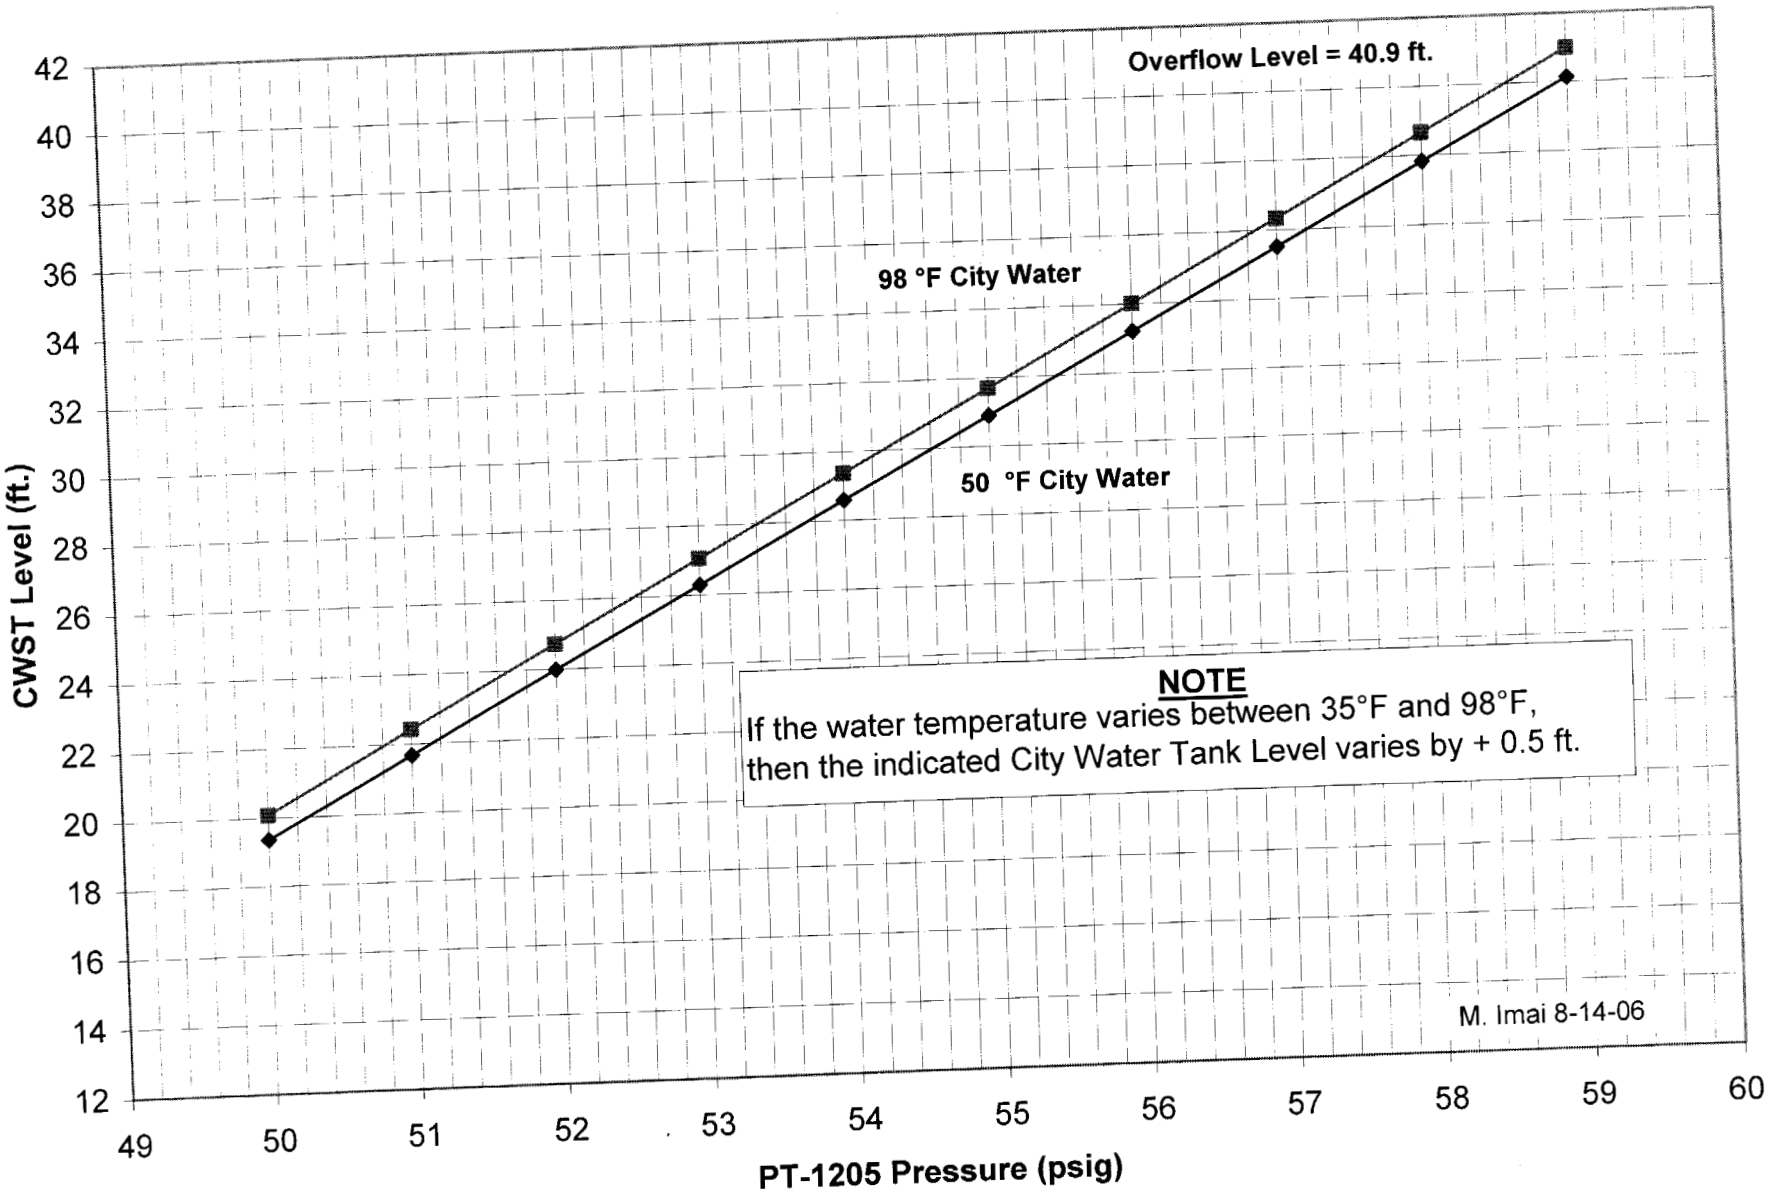
CWST Level vs. PT-1205 Pressure