

**Duke Energy Carolinas**

**Quality Assurance Program Description**

Title: Nuclear Plant Development Quality Assurance Program Description

Process/Program Owner: **Manager, Nuclear Quality Assurance and Oversight**

|                                  |                                     |                |
|----------------------------------|-------------------------------------|----------------|
| <b>Duke-2<br/>Topical Report</b> | Version Number<br><b>Revision 1</b> | Effective Date |
|----------------------------------|-------------------------------------|----------------|

Revision Summary

This revision incorporates changes identified in response to Nuclear Regulatory Commission Requests for Additional Information. Specifically addressed are RAI 17.05-001, 17.05-004, and 17.05-007 for the William States Lee Nuclear Station. The revision also incorporates STANDARD responses to RAI 17.05-05 and 17.05-15 for Bellefonte Units 3 and 4.

The Table of Changes on the following page provides detailed identification of the revised material.

Prepared By/Date:

\_\_\_\_\_/\_\_\_\_\_  
Nuclear Plant Development QA

Reviewed By/Date:

\_\_\_\_\_/\_\_\_\_\_  
Manager, Nuclear QA & Oversight

Approved By/Date:

\_\_\_\_\_/\_\_\_\_\_  
Chief Nuclear Officer, Nuclear Generation

**Nuclear Plant Development  
Quality Assurance Program Description**

**Table of Changes in Revision 0 of QAPD Duke-2**

The following table summarizes changes from Duke-2 Revision 0.

| <b>QAPD Section</b>              | <b>Detail Change Description</b>  |
|----------------------------------|---|
| Part I Section 1.1               | Revised to replace “and/or” with “and”.   |
| Part I Section 1.1               | Removed “Licensing” and changed “Constructing” to “Construction” in the list of activities.   |
| Part II Sections 1.1 through 1.7 | Replaced Sections 1.1 through 1.7 with the updated organization description and added “Organization Charts” as Figures 1, 2, and 3 consistent with the detail in the current Duke Energy Carolinas Topical Report Quality Assurance Program (DUKE-1) and with the content shown in the NEI 06-14A example “Organization Chart” including a figure typical of the construction/preoperational phase.   |
| Part II Section 2.3              | Title change to Site Specific Safety-Related Design Basis Activities and paragraph revised.<br><br>For Nuclear Plant Development, site safety-related design basis activities are defined as those activities, including sampling, testing, data collection and supporting engineering calculations and reports that are used to determine the bounding physical parameters of the site. Appropriate quality assurance measures are applied.<br><br>Information not related to safety-related design basis activities has been deleted from this section. |
| Part II Section 2.5              | Deleted 10 CFR 50.34 (b) (6) (ii) and 10 CFR part 52.79 (a) (25) from the second paragraph.   |
| Part II Section 2.7              | Paragraph d was changed to remove the limitation of reviewing only items required to be reported in writing within 24 hours.  |
| Part II Section 7.2              | Sections 7.2 item (3) was changed to reflect additional acceptability approved by the NRC (reference ADAMS Accession Numbers ML073440472, ML081140564, and ML081330265).  |
| Part II Section 13.2             | Added reference to NQA-1-1994 Subpart 3.2 to this section.  |
| Part III Section 2               | Applicability of Regulatory Guide 1.155 is addressed in the FSAR.   |
| Part IV Regulatory Commitments   | Update reference to Regulatory Guide 1.26 to Revision 4 March 2007.   |
| Part IV Regulatory Commitments   | Update reference to Regulatory Guide 1.29 to Revision 4 March 2007.   |
| Part IV Regulatory Commitments   | Added Regulatory Guide 1.37, Revision 1, March 2007 – Requirements for Cleaning of Fluid Systems and Associated Components of Water-Cooled Nuclear Power Plants to the referenced commitments.  |

# Nuclear Plant Development Quality Assurance Program Description

---

## Duke Energy Carolinas

### Nuclear Plant Development

#### POLICY STATEMENT

Duke Energy Carolinas (Duke) shall design, procure, construct and operate nuclear plants in a manner that will ensure the health and safety of the public and workers. These activities shall be performed in compliance with the requirements of the Code of Federal Regulations (CFR), the applicable Nuclear Regulatory Commission (NRC) Facility Operating Licenses, and applicable laws and regulations of the state and local governments.

The Duke Nuclear Plant Development Quality Assurance Program (QAP) is the Quality Assurance Program Description (QAPD) provided in this document and the associated implementing documents. Together they provide for control of Duke activities that affect the quality of safety-related nuclear plant structures, systems, and components and include all planned and systematic activities necessary to provide adequate confidence that such structures, systems, and components will perform satisfactorily in service. The QAPD may also be applied to certain equipment and activities that are not safety-related, but support safe plant operations, or where other NRC guidance establishes program requirements.

The QAPD is the top-level policy document that establishes the manner in which quality is to be achieved and presents Duke's overall philosophy regarding achievement and assurance of quality. Implementing documents assign more detailed responsibilities and requirements and define the organizational interfaces involved in conducting activities within the scope of the QAP. Compliance with the QAPD and implementing documents is mandatory for personnel directly or indirectly associated with implementation of the Duke QAP.

Signed \_\_\_\_\_

Jim Rogers  
Chairman, President and Chief Executive Officer  
Duke Energy  
Date \_\_\_\_\_

**Nuclear Plant Development  
Quality Assurance Program Description**

---

**TABLE OF CONTENTS**

|  |          |
|--|----------|
| <b>POLICY STATEMENT .....</b>  | <b>2</b> |
| <b>PART I INTRODUCTION.....</b>                                      | <b>6</b> |
| SECTION 1 GENERAL .....  | 6        |
| 1.1 Scope / Applicability .....                                      | 6        |
| <b>PART II QAPD DETAILS .....</b>                                    | <b>8</b> |
| SECTION 1 ORGANIZATION .....   | 8        |
| 1.1 Duke Corporate Organization.....                                 | 8        |
| 1.2 Nuclear Generation .....   | 9        |
| 1.3 U. S. Franchised Electric and Gas .....                          | 12       |
| 1.4 Corporate Administration .....                                   | 12       |
| 1.5 Strategy, Policy, and Regulatory Activities.....                 | 12       |
| 1.6 Department Interfaces.....                                       | 12       |
| 1.7 Agents and Contractors .....                                     | 12       |
| 1.8 Authority to Stop Work .....                                     | 12       |
| 1.9 Quality Assurance Organizational Independence .....              | 13       |
| 1.10 NQA-1-1994 Commitment.....                                      | 13       |
| SECTION 2 QUALITY ASSURANCE PROGRAM .....                            | 17       |
| 2.1 Responsibilities .....   | 18       |
| 2.2 Delegation of Work.....  | 18       |
| 2.3 Site Specific Safety-Related Design Basis Activities.....        | 18       |
| 2.4 Periodic Review of the Quality Assurance Program.....            | 19       |
| 2.5 Issuance and Revision to Quality Assurance Program .....         | 19       |
| 2.6 Personnel Qualifications.....                                    | 19       |
| 2.7 Independent Review.....  | 20       |
| 2.8 NQA-1-1994 Commitment / Exceptions .....                         | 21       |
| SECTION 3 DESIGN CONTROL .....                                       | 23       |
| 3.1 Design Verification .....  | 23       |
| 3.2 Design Records.....  | 24       |
| 3.3 Computer Application and Digital Equipment Software.....         | 24       |
| 3.4 Setpoint Control.....  | 24       |
| 3.5 NQA-1-1994 Commitment.....                                       | 24       |
| SECTION 4 PROCUREMENT DOCUMENT CONTROL .....                         | 25       |
| 4.1 NQA-1-1994 Commitment / Exceptions .....                         | 25       |
| SECTION 5 INSTRUCTIONS, PROCEDURES, AND DRAWINGS .....               | 27       |
| 5.1 Procedure Adherence .....  | 27       |
| 5.2 Procedure Content .....  | 27       |
| 5.3 NQA-1-1994 Commitment.....                                       | 27       |
| SECTION 6 DOCUMENT CONTROL .....                                     | 28       |
| 6.1 Review and Approval of Documents .....                           | 28       |
| 6.2 Changes to Documents.....  | 29       |
| 6.3 NQA-1-1994 Commitment.....                                       | 29       |
| SECTION 7 CONTROL OF PURCHASED MATERIAL, EQUIPMENT, AND SERVICES ... | 30       |
| 7.1 Acceptance of Item or Service .....                              | 30       |
| 7.2 NQA-1-1994 Commitment / Exceptions .....                         | 31       |

**Nuclear Plant Development  
Quality Assurance Program Description**

---

|   |           |
|---|-----------|
| SECTION 8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS, AND COMPONENTS .....    | 33        |
| 8.1 NQA-1-1994 Commitment.....  | 33        |
| SECTION 9 CONTROL OF SPECIAL PROCESSES .....                                      | 34        |
| 9.1 NQA-1-1994 Commitment.....  | 34        |
| SECTION 10 INSPECTION.....  | 35        |
| 10.1 Inspection Program .....   | 35        |
| 10.2 Inspector Qualification.....   | 35        |
| 10.3 NQA-1-1994 Commitment / Exceptions .....                                     | 36        |
| SECTION 11 TEST CONTROL.....  | 37        |
| 11.1 NQA-1-1994 Commitment.....   | 37        |
| 11.2 NQA-1-1994 Commitment for Computer Program Testing .....                     | 37        |
| SECTION 12 CONTROL OF MEASURING AND TEST EQUIPMENT .....                          | 38        |
| 12.1 Installed Instrument and Control Devices.....                                | 38        |
| 12.2 NQA-1-1994 Commitment / Exceptions .....                                     | 38        |
| SECTION 13 HANDLING, STORAGE, AND SHIPPING.....                                   | 39        |
| 13.1 Housekeeping .....   | 39        |
| 13.2 NQA-1-1994 Commitment / Exceptions .....                                     | 39        |
| SECTION 14 INSPECTION, TEST, AND OPERATING STATUS .....                           | 41        |
| 14.1 NQA-1-1994 Commitment.....   | 41        |
| SECTION 15 NONCONFORMING MATERIALS, PARTS, OR COMPONENTS .....                    | 42        |
| 15.1 Reporting Program .....  | 42        |
| 15.2 NQA-1-1994 Commitment.....   | 42        |
| SECTION 16 CORRECTIVE ACTION .....  | 43        |
| 16.1 Reporting Program .....  | 43        |
| 16.2 NQA-1-1994 Commitment.....   | 43        |
| SECTION 17 QUALITY ASSURANCE RECORDS.....   | 44        |
| 17.1 Record Retention .....   | 44        |
| 17.2 Electronic Records .....   | 44        |
| 17.3 NQA-1-1994 Commitment / Exceptions .....                                     | 44        |
| SECTION 18 AUDITS .....   | 45        |
| 18.1 Performance of Audits.....   | 45        |
| 18.2 NQA-1-1994 Commitment.....   | 46        |
| <b>PART III NON-SAFETY-RELATED SSC QUALITY CONTROL .....</b>                      | <b>47</b> |
| SECTION 1 Non-Safety Related SSCs - Significant Contributors to Plant Safety..... | 47        |
| 1.1 Organization .....  | 47        |
| 1.2 QA Program .....  | 47        |
| 1.3 Design Control.....   | 47        |
| 1.4 Procurement Document Control.....   | 47        |
| 1.5 Instructions, Procedures, and Drawings.....                                   | 47        |
| 1.6 Document Control .....  | 48        |
| 1.7 Control of Purchased Items and Services .....                                 | 48        |
| 1.8 Identification and Control of Purchased Items.....                            | 48        |
| 1.9 Control of Special Processes .....  | 48        |
| 1.10 Inspection.....  | 48        |
| 1.11 Test Control.....  | 48        |
| 1.12 Control of Measuring and Test Equipment (M&TE) .....                         | 48        |
| 1.13 Handling, Storage, and Shipping.....   | 49        |
| 1.14 Inspection, Test, and Operating Status .....                                 | 49        |
| 1.15 Control of Nonconforming Items.....  | 49        |

**Nuclear Plant Development  
Quality Assurance Program Description**

---

|  |           |
|--|-----------|
| 1.16 Corrective Action .....   | 49        |
| 1.17 Records .....   | 49        |
| 1.18 Audits .....  | 49        |
| SECTION 2 Non-Safety-Related SSCs Credited for Regulatory Events ..... | 49        |
| <b>PART IV REGULATORY COMMITMENTS .....</b>                            | <b>51</b> |
| NRC Regulatory Guides and Quality Assurance Standards .....            | 51        |
| Regulatory Guides: .....   | 51        |
| Standards: .....   | 51        |

## **PART I INTRODUCTION**

### **SECTION 1 GENERAL**

Duke Energy Carolinas (Duke) Nuclear Plant Development Quality Assurance Program Description (QAPD) is the top-level policy document that establishes the quality assurance policy and assigns major functional responsibilities for Nuclear Plant Development including combined license (COL), construction, pre-operation, and operations activities conducted by or for Duke. The QAPD describes the methods and establishes QAPD and administrative control requirements that meet 10 CFR 50, Appendix B and 10 CFR 52. The QAPD is based on the requirements of ASME NQA-1-1994, "Quality Assurance Requirements for Nuclear Facility Applications," Parts I and II, as specified in this document.

The QAPD is defined by the NRC approved regulatory document that describes the Quality Assurance Program (QAP) elements, along with the associated implementing documents. Procedures and instructions that control Nuclear Plant Development activities will be developed prior to commencement of those activities. As the overall controlling QAPD for design, construction, and operations, this document invokes QA requirements for controlling Duke performed quality-affecting activities as well as providing controls for subcontractors, addressed by Part II Sections 4 and 7, to perform their assigned quality-affecting activities to their own QA Programs. Policies establish high level responsibilities and authority for carrying out important administrative functions which are outside the scope of the QAPD. Procedures establish practices for certain activities which are common to all Duke organizations performing those activities such that the activity is controlled and carried out in a manner that meets QAPD requirements. Site or organization specific procedures establish detailed implementation requirements and methods, and may be used to implement policies or be unique to particular functions or work activities.

#### **1.1 Scope / Applicability**

This QAPD applies to COL/construction/pre-operation and operations activities affecting the quality and performance of safety-related structures, systems, and components, including, but not limited to:

|              |                            |             |            |                 |
|--------------|----------------------------|-------------|------------|-----------------|
| Designing    | Handling                   | Siting      | Erecting   | Decommissioning |
| Construction | Testing                    | Operating   | Installing | Modifying       |
| Procuring    | Pre-operational activities | Maintaining | Repairing  | Inspecting      |
| Fabricating  | (including ITAAC)          | Receiving   | Training   | Refueling       |
| Cleaning     | Startup                    | Storing     |            | Shipping        |

Safety-related systems, structures, and components, under the control of the QAPD, are identified by design documents. The technical aspects of these items are considered when determining program applicability, including, as appropriate, the item's design safety function. The QAPD may be applied to certain activities where regulations other than 10 CFR 50 and 10 CFR 52 establish QAPD requirements for activities within their scope.

The policy of Duke is to assure a high degree of availability and reliability of its nuclear plants while ensuring the health and safety of its workers and the public. To this end, selected elements

## **Nuclear Plant Development Quality Assurance Program Description**

---

of the QAPD are also applied to certain equipment and activities that are not safety-related, but support safe, economic, and reliable plant operations, or where other NRC guidance establishes quality assurance requirements. Implementing documents establish program element applicability.

## **PART II QAPD DETAILS**

### **SECTION 1 ORGANIZATION**

This Section describes the Duke organizational structure, functional responsibilities, levels of authority and interfaces for establishing, executing, and verifying QAPD implementation. The organizational structure includes corporate support, offsite and onsite functions for Nuclear Plant Development including interface responsibilities for multiple organizations performing quality-related functions. Implementing documents assign more specific responsibilities and duties, and define the organizational interfaces involved in conducting activities and duties within the scope of this QAPD. Management gives careful consideration to the timing, extent and effects of organizational structure changes.

Duke management is responsible to size the Quality Assurance organization commensurate with the duties and responsibilities assigned.

The Duke Nuclear Plant Development organization is responsible for new nuclear plant licensing, engineering, procurement, construction, startup and operations development activities. There are several organizations within Duke that implement and support the QAPD. These organizations include, but are not limited to Nuclear Plant Development, Corporate Services and Quality Assurance.

Organization charts for various departments/locations are contained in Chapter 13 of the respective Station FSAR and describe organizational positions of the nuclear station and associated functions and responsibilities.

Design, engineering and environmental services are provided to the Duke Nuclear Plant Development organization by a contract that identifies the Engineer and Constructor and invokes the applicable quality program requirements described in this document to applicable contractors and subcontractors.

The following sections describe the reporting relationships, functional responsibilities and authorities for organizations implementing and supporting the Nuclear Plant Development QA Program.

#### **1.1 Duke Corporate Organization**

The Chairman, President, and Chief Executive Officer (CEO) has overall responsibility for design, construction, and operation of generation and transmission facilities. The CEO reports to the Duke Board of Directors with respect to all matters. The QAP Policy Statement issued by the CEO establishes mandatory expectations for all organizations and personnel to comply with the QAPD and its implementing documents while performing quality affecting activities covered by the QAP. Thus, the attainment of quality rests with those assigned responsibility for performing an activity.

Reporting to the CEO is the President and Chief Operating Officer (COO) of US Franchised Electric and Gas who is responsible for electrical transmission, distribution, laboratory services, and switchyard maintenance and technical support; the Chief Strategy and Policy Officer who supports emergency response communications; and the Chief Administrative Officer who is responsible for Information Technology Services, purchasing activities, and corporate document

## **Nuclear Plant Development Quality Assurance Program Description**

---

control and record management activities. Various services that support nuclear generation are provided by these mentioned branches of the corporate organization.

Also reporting to the CEO is the Chief Nuclear Officer (CNO) who is the corporate executive delegated overall authority and responsibility for directing the establishment and implementation of the nuclear policies, goals, and objectives of the QAP to attain safe, reliable, and efficient operation of nuclear plants.

Figure 1 shows the overall Corporate Organization.

### **1.2 Nuclear Generation**

As directed by the CNO, the Nuclear Generation Department has direct line responsibility for all nuclear plant operations. Nuclear Generation is responsible for achieving quality results during design, construction, preoperational testing, operation, testing, maintenance, and modification of the plants and for complying with applicable codes, standards and NRC regulations. The CNO is also responsible for establishing and managing new nuclear plant development.

The CNO is informed of significant problems or occurrences relating to safety and QA through established administrative procedures, and participates directly in their resolution, as necessary.

#### **1.2.1 Operating Plant Site Organization**

As shown in Figure 2, each plant has a Site Vice President who reports to the Senior Vice President of Nuclear Operations, who in turn reports to the CNO. The Site Vice President has the responsibility for overall plant nuclear safety as established by Technical Specifications. The Site VP is also responsible for the administration, implementation, and assessment of the QAP as it applies to plant operation. The Site Vice President directs the activities of the plant through five major suborganizations: 1) Station Management, 2) Safety Assurance, 3) Engineering, 4) Site Services, and 5) Training.

1. **Station Management** consists of five primary groups: a) Operations, b) Maintenance, c) Work Control, d) Radiation Protection, and e) Chemistry. Each group's activities are directed by a superintendent or senior manager who reports to the Station Manager. Reporting to the Site Vice President is a Station Manager who is assigned the direct responsibility for operating the station in a safe, reliable, and efficient manner; and is responsible for protection of the station staff and the general public from radiation exposure and any other consequences of an accident at the station and bears the responsibility for compliance with the facility operating license. In addition, the Station Manager or his designee shall approve, prior to implementation, each proposed test, experiment, or modification to SSCs that affect nuclear safety.
  - a. **Operations** directs the actual day-to-day operation of the station.
  - b. **Maintenance** directs the maintenance of mechanical equipment, electrical equipment, instrumentation, controls, and computers.
  - c. **Work Control** facilitates operational and outage activities through coordination, development, and shift and outage management of a timely and effective integrated station schedule.
  - d. **Radiation Protection** directs the radiation protection program. The duties include the training of personnel in equipment use, control of personnel radiation exposure, continuous determination of plant radiological status, surveillance of radioactive

## Nuclear Plant Development Quality Assurance Program Description

---

waste disposal operations, conduct of radiological environmental monitoring, and records maintenance.

- e. **Chemistry** directs activities to meet overall chemistry and radiochemistry requirements, with special emphasis on primary and secondary system water chemistry.
2. **Safety Assurance** directs activities in environmental health and safety, regulatory compliance, emergency planning, and security.
3. **Engineering** directs activities in the following engineering areas: reactor, component, systems, mechanical, electrical, civil, computer, and modifications. Functions include design and coordination of plant modifications, design basis documentation and design reviews, plant process information systems, and support of maintenance, operating, and surveillance activities.
4. **Site Services** directs activities associated with tools management, facilities management, and equipment and distribution.
5. **Training** directs implementation and oversight of the training programs for site personnel. Functions include analysis, design, development, implementation, and evaluation of training and qualifications programs that support personnel performing plant work.

### 1.2.2 General Office Organization

The General Office is organized into four divisions. The activities of each division are directed by a vice president who reports to the CNO. The four divisions are: 1) Nuclear Operations, 2) Nuclear Plant Development, 3) Nuclear Engineering, and 4) Nuclear Fleet Performance, Oversight and Strategy.

1. **Nuclear Operations** consists of two primary groups: a) Plant Support and b) Major Projects. Each group's activities are directed by a vice president reporting to the Senior Vice President, Nuclear Operations who also provides management oversight to the nuclear stations.
  - a. **Plant Support** is divided into five subgroups: 1) Nuclear Technical Services, 2) Nuclear Supply Chain, 3) Licensing and Regulatory Compliance, 4) Fleet Outage Support, and 5) Plant Services that support the nuclear sites. Each subgroup's activities are directed by a senior manager who reports to the group vice president.
    - 1) **Nuclear Technical Services** provides chemistry, radiation protection, metallurgy, laboratory services, materials, aging management, specialized plant engineering support, calibration services, steam generator maintenance, QC and NDE inspector training and certification, inspection procedure management, and special projects support.
    - 2) **Nuclear Supply Chain** provides procurement engineering, procurement, storage, inventory control, and receipt inspection/testing support.
    - 3) **Licensing and Regulatory Compliance** provides regulatory issues and industry affairs support.
    - 4) **Fleet Outage Management** provides refueling outage planning coordination support.
    - 5) **Plant Services** provides Fitness for Duty and Nuclear Access Program implementation support.

## Nuclear Plant Development Quality Assurance Program Description

---

- b. **Major Projects** manages contracts, engineering, and overall management for major projects.
2. **Nuclear Plant Development** is responsible for development of the licensing actions needed in support of new nuclear site development. Responsibilities also include engineering oversight of contractors, site layout, staffing and program development. The executive in charge of nuclear plant development is assisted by a support staff and reports directly to the CNO. Nuclear Plant Development responsibilities include the establishment and execution of a contract or contracts for the engineering, procurement, construction, and startup activities of new nuclear plants up to the transition point when a Site Executive is named to assume those responsibilities. Figure 3 shows the Nuclear Plant Development/Construction Organization. As a new nuclear plant development approaches startup, the site organization transitions from the development focused organization in Figure 3 to the Operating Plant Site Organization shown in Figure 2.
3. **Nuclear Engineering** provides station support for probabilistic risk analysis, safety analysis, nuclear design, core mechanical and thermal hydraulic analysis, fuel management, and radiological engineering.
4. **Nuclear Fleet Performance, Oversight, and Strategy** consists of two primary groups: a) Independent Nuclear Oversight (INOS) and b) Nuclear Performance and Strategy. Each group's activities are directed by a senior manager who reports to the division vice president.
  - a. **INOS** provides QA oversight of corporate and supplier organizations that are involved in nuclear safety-related activities. Oversight is provided by four functional groups: Audit, Inspection, Procurement Quality, and Performance. Audits are conducted to verify effective implementation and compliance with QAPD criteria and NRC regulations. Inspections (both QC and NDE) are conducted to ensure compliance with applicable codes and standards. Procurement Quality performs audits and surveillances of supplier products and services to ensure compliance with the supplier's quality program and Duke's procurement requirements. Performance conducts assessments of plant operation and support activities based on their nuclear safety risk-significance with a focus on performance improvement. All four groups identify and communicate adverse quality conditions for timely resolution and advise line and corporate management on the overall quality and safety of plant operations.

The INOS manager is delegated primary ownership of the department QAP and is responsible for day-to-day administration of the program and resolution of QA issues. The INOS manager has immediate access to the CNO to communicate significant QAP concerns and issues. Within the INOS group, a QA single point of contact (QA SPOC) provides the first point of reference for QAP issues, clarifications, and interpretations. Duties also include ownership of the QAPD, interpretation of QAP details and commitments, review and acceptance of proposed QAPD changes, response to management, regulator, and industry inquiries with regard to QAP implementation, and review of department policy documents to maintain their alignment with the QAP.
  - b. **Nuclear Performance and Strategy** provides performance improvement program oversight that identifies gaps to excellence, conducts operating experience assessments, administers the corrective action program, monitors other lower level performance trends and issues, and provides oversight for document control and record management activities.

### **1.3 U. S. Franchised Electric and Gas**

#### **1.3.1 Power Delivery**

Power Delivery provides electrical transmission, distribution and switchyard engineering, maintenance, and testing support.

#### **1.3.2 Engineering and Technical Services**

Engineering and Technical Services provides environmental and laboratory support services and relay engineering and switchyard maintenance support.

### **1.4 Corporate Administration**

#### **1.4.1 Enterprise Business Services**

Enterprise Business Services provides a variety of services and technical support for critical information technology applications and systems such as equipment databases, applications, and infrastructure. This organization is also responsible for the development and maintenance of selected information technology services and support, including electronic document management, some of which support QA Condition activities.

#### **1.4.2 Enterprise Operations Services**

Enterprise Operations Services provides record storage and document management services.

#### **1.4.3 Supply Chain**

Supply Chain provides overall corporate procurement services.

### **1.5 Strategy, Policy, and Regulatory Activities**

#### **1.5.1 Corporate Communications**

Corporate Communications provides support for the nuclear site's emergency response organization.

### **1.6 Department Interfaces**

Departmental interfaces are identified in QAP manuals. Quality related activities performed by departments other than Nuclear Generation are identified by and conducted in accordance with approved departmental interface agreements.

### **1.7 Agents and Contractors**

Duke may contract various activities such as engineering, procurement, and construction. These contracts will identify QAP requirements that are applicable to the contractors and their subcontractors, consistent with the requirements of Part II, Sections 4 and 7.

### **1.8 Authority to Stop Work**

Quality assurance and inspection personnel have the authority, and the responsibility, to stop work in progress which is not being done in accordance with approved procedures or where

## **Nuclear Plant Development Quality Assurance Program Description**

---

safety or SSC integrity may be jeopardized. This extends to off-site work performed by suppliers furnishing safety-related materials and services to Duke.


### **1.9 Quality Assurance Organizational Independence**

Independence shall be maintained between the organization or organizations performing the checking (quality assurance and control) functions and the organizations performing the functions. This provision is not applicable to design review/verification.


### **1.10 NQA-1-1994 Commitment**

In establishing its organizational structure, Duke commits to compliance with NQA-1-1994, Basic Requirement 1 and Supplement 1S-1.

FIGURE 1 -- Duke Corporate Organization

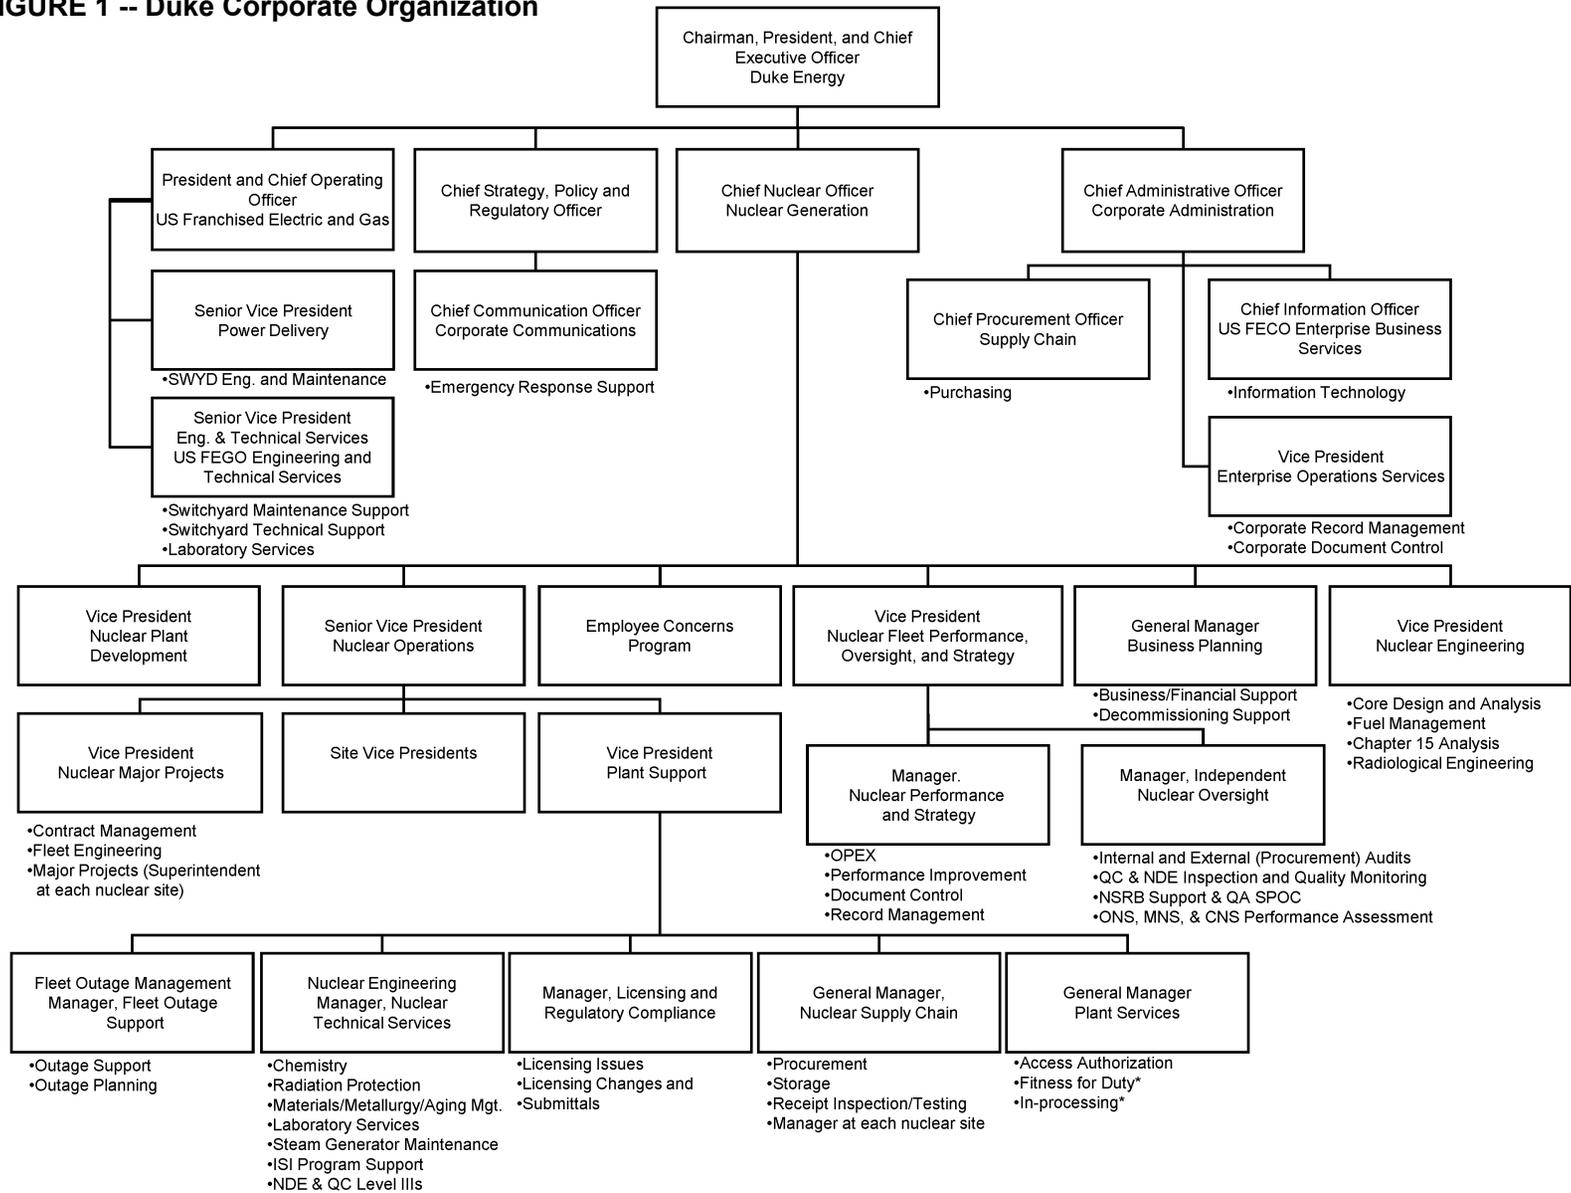


**Figure 2 -- Operating Plant Site Organization**

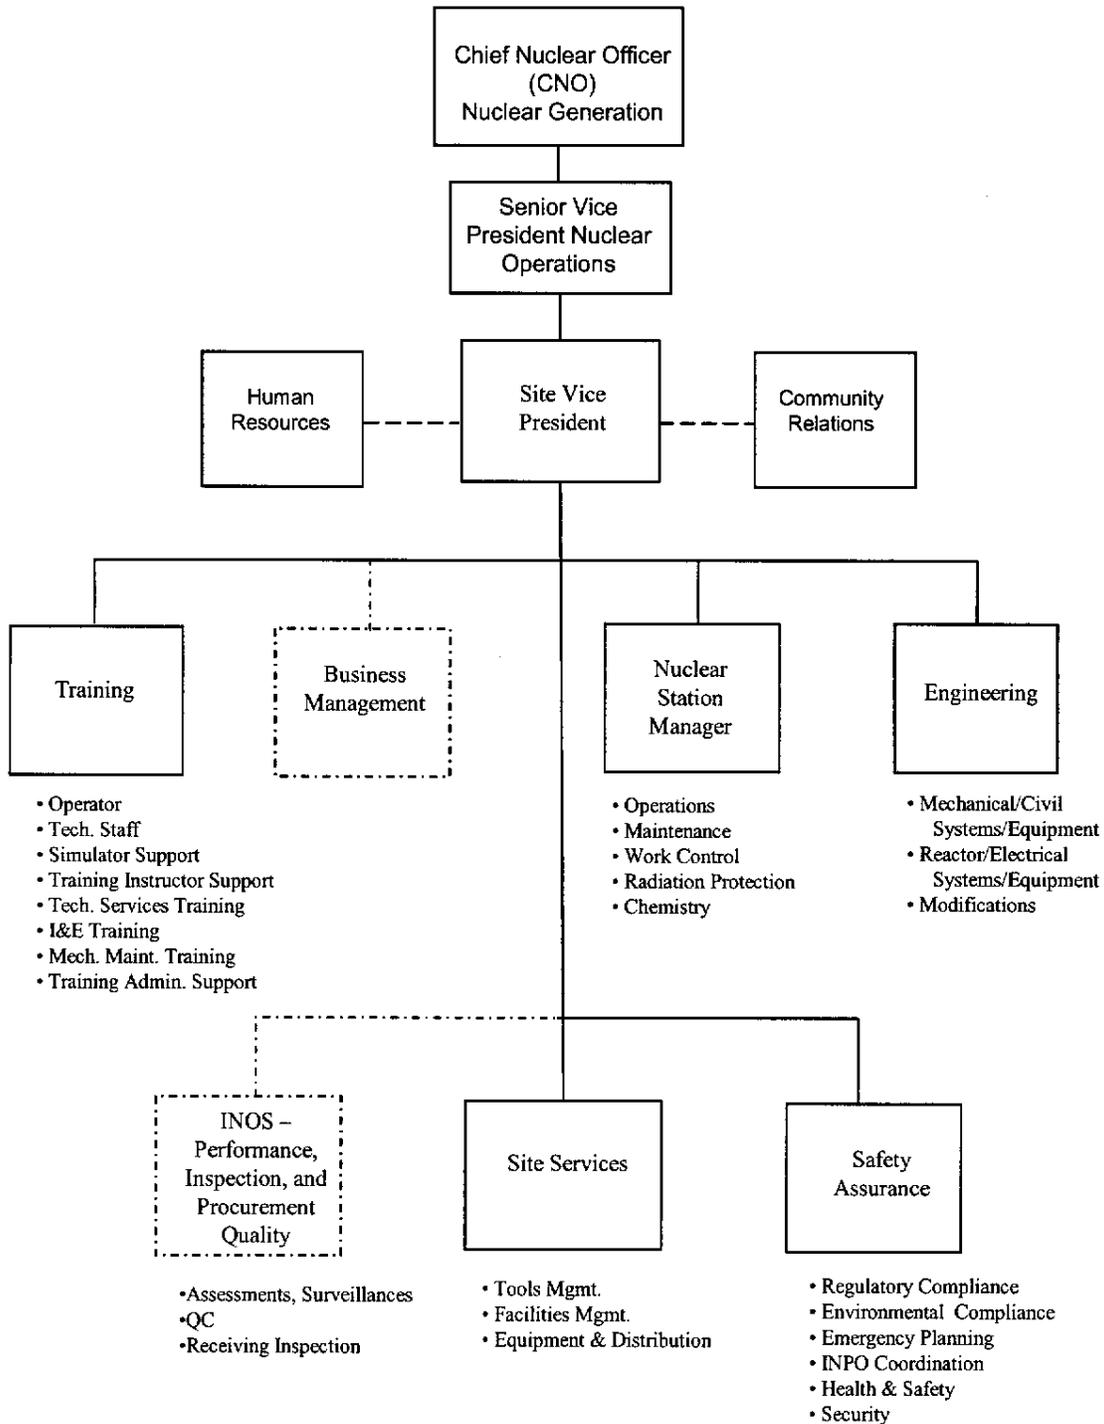

# Nuclear Plant Development Quality Assurance Program Description

**Figure 3 -- Nuclear Plant Development/Construction Organization**

Note 1: Initially, Nuclear Plant Development described in QAPD Part II, Section 1.2.2, enumerated paragraph 2, is responsible for construction planning and preparation. The responsibility for construction oversight transitions to the Site Executive when that position is filled.

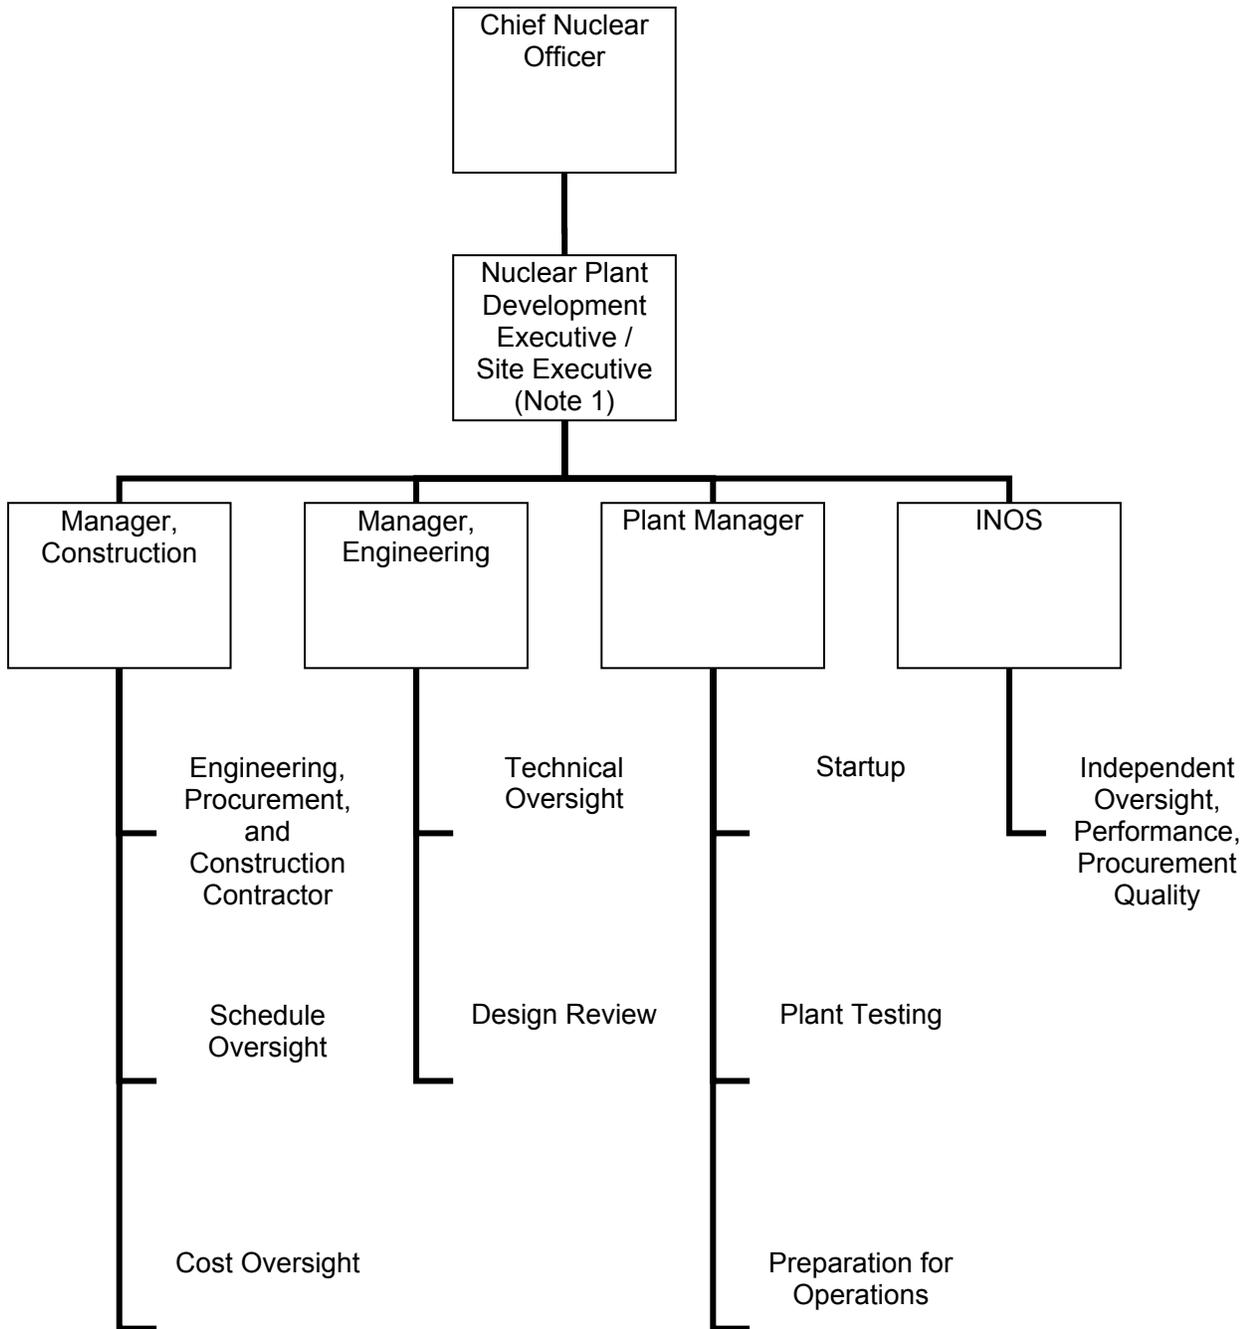

# Nuclear Plant Development Quality Assurance Program Description

---

## SECTION 2 QUALITY ASSURANCE PROGRAM

Duke has established the necessary measures and governing procedures to implement the QAPD as described in the QAPD. Duke is committed to implementing the Quality Assurance Program in all aspects of work that are important to the safety of the nuclear plants as described and to the extent delineated in this QAPD. Further, Duke ensures through the systematic process described herein that its suppliers of safety-related equipment or services meet the applicable requirements of 10 CFR 50, Appendix B. This QAPD also applies to certain non-safety-related structures, systems, components and activities to a degree consistent with their importance to safety. Senior management is regularly apprised of audit results evaluating the adequacy of implementation of the QAPD through the audit functions described in the Audit Section of this QAPD.

The objective of the QAPD is to assure that Duke nuclear generating plants are designed, constructed and operated in accordance with governing regulations and license requirements. The program is based on the requirements of ASME NQA-1-1994, "Quality Assurance Requirements for Nuclear Facility Applications," as further described in this document. The QAPD applies to those quality-related activities that involve the functions of safety-related structures, systems, and components (SSCs) associated with the design, licensing, construction and operation of new nuclear power plants as described in the ESP Site Safety Analysis Report and COL Final Safety Analysis Report. Examples of ESP/COL program safety-related activities include, but are not limited to, site specific engineering related to safety-related SSCs, site geotechnical investigations, site engineering analysis, seismic analysis, and meteorological analysis. A list or system for identifying SSCs and activities to which this program applies is maintained at the appropriate facility. The Design Certification Document is used as the basis for this identification. Cost and scheduling functions do not prevent proper implementation of the QAPD.

Specific program controls are applied to non-safety related SSCs, for which 10CFR50, Appendix B is not applicable, that are significant contributors to plant safety. The specific program controls consistent with applicable sections of the QAPD are applied to those items in a selected manner, targeted at those characteristics or critical attributes that render the SSC a significant contributor to plant safety. These controls are identified in Part III.

Delegated responsibilities may be performed under a supplier's or principal contractor's QAPD, provided that the supplier or principle contractor has been approved as a supplier in accordance with the QAPD. Periodic audits and assessments of supplier QA programs are performed to assure compliance with the supplier's or principle contractor's QAPD and implementing procedures. In addition, routine interfaces with project personnel assure that quality expectations are met.

For the ESP and/or COL applications, this QAPD applies to those Nuclear Plant Development and Duke activities that can affect either directly or indirectly the safety-related site characteristics or analysis of those characteristics. In addition, this QAPD applies to engineering activities that are used to characterize the site or analyze that characterization.

New nuclear plant construction will be the responsibility of the Nuclear Plant Development organization. Detailed engineering specifications and construction procedures will be developed to implement the QAPD and Contractor QA programs prior to commencement of construction activities. Examples of Limited Work Authorization (LWA) activities that could impact safety-

## **Nuclear Plant Development Quality Assurance Program Description**

---

related SSCs would include impacts of construction to existing facilities and for construction of new plants, the design interface between non-safety-related and safety-related SSCs and the placement of seismically designed backfill.

In general, the program requirements specified herein are detailed in implementing procedures that are either Duke implementing procedures, or supplier implementing procedures governed by a supplier quality program.

A grace period of 90 days may be applied to provisions that are required to be performed on a periodic basis unless otherwise noted. Annual evaluations and audits that must be performed on a triennial basis are examples where the 90 day general period could be applied. The grace period does not allow the “clock” for a particular activity to be reset forward. The “clock” for an activity is reset backwards by performing the activity early. Audits schedules are based on the month in which the audit starts.

### **2.1 Responsibilities**

Personnel who work directly or indirectly for Duke are responsible for the achievement of acceptable quality in the work covered by this QAPD. This includes those activities delineated in Part I, Section 1.1 of this QAPD. Duke personnel performing verification activities are responsible for verifying the achievement of acceptable quality. Activities governed by the QAPD are performed as directed by documented instructions, procedures and drawings that are of a detail appropriate for the activity’s complexity and effect on safety. Instructions, procedures and drawings specify quantitative or qualitative acceptance criteria as applicable or appropriate for the activity, and verification is against these criteria. Provisions are established to designate or identify the proper documents to be used in an activity, and to ascertain that such documents are being used. The manager of quality assurance and oversight is responsible to verify that processes and procedures comply with QAPD and other applicable requirements, that such processes or procedures are implemented, and that management appropriately ensures compliance.

### **2.2 Delegation of Work**

Duke retains and exercises the responsibility for the scope and implementation of an effective QAPD. Positions identified in the Organization Section of this QAPD may delegate all or part of the activities of planning, establishing, and implementing the program for which they are responsible to others, but retain the responsibility for the program's effectiveness. Decisions affecting safety are made at the level appropriate for its nature and effect, and with any necessary technical advice or review.

### **2.3 Site Specific Safety-Related Design Basis Activities**

For Nuclear Plant Development, site safety-related design basis activities are defined as those activities, including sampling, testing, data collection and supporting engineering calculations and reports that are used to determine the bounding physical parameters of the site. Appropriate quality assurance measures are applied. The development of the Duke ESP or COL applications involve site testing, data collection and calculations that may create or bound safety-related design basis data. Site testing and data collection of information pertaining to the physical characteristics of the site that have the potential to affect safety-related design are considered

## **Nuclear Plant Development Quality Assurance Program Description**

---

safety-related. In addition, calculations and other engineering data that bounds or characterizes the site are classified as safety-related.

### **2.4 Periodic Review of the Quality Assurance Program**

Management of those organizations implementing the QA program or portions thereof, assess the adequacy of that part of the program for which they are responsible and assure its effective implementation at least once each year or at least once during the life of the activity, which ever is shorter. However, the period for assessing QA programs during the operations phase may be extended to once every two years.

### **2.5 Issuance and Revision to Quality Assurance Program**

Administrative control of the QAPD will be in accordance with 10 CFR 50.55(f) and 10 CFR 50.54(a), as appropriate. Changes to the QAPD are evaluated by the manager responsible for quality assurance and oversight to ensure that such changes do not degrade previously approved quality assurance controls specified in the QAPD. This document shall be revised as appropriate to incorporate additional QA commitments that may be established during the COL application development process. New revisions to the document will be reviewed, at a minimum, by the manager responsible for quality assurance and oversight and approved by the CNO.

Regulations require that the Final Safety Analysis Report (FSAR) include, among other things, the managerial and administrative controls to be used to assure safe operation, including a discussion of how the applicable requirements of Appendix B will be satisfied. In order to comply with this requirement, the FSAR references this QAPD and, as a result, the requirements of 10 CFR 50.54(a), are satisfied by and apply to the QAPD.

### **2.6 Personnel Qualifications**

Personnel assigned to implement elements of the QAPD shall be capable of performing their assigned tasks. To this end Duke establishes and maintains formal indoctrination and training programs for personnel performing, verifying, or managing activities within the scope of the QAPD to assure that suitable proficiency is achieved and maintained. Plant and support staff minimum qualification requirements are as delineated in each site's Technical Specifications. Other qualification requirements may be established but will not reduce those required by Technical Specifications. Sufficient managerial depth is provided to cover absences of incumbents. When required by code, regulation, or standard, specific qualification and selection of personnel is conducted in accordance with those requirements as established in the applicable Duke procedures. Indoctrination includes the administrative and technical objectives, requirements of the applicable codes and standards, and the QAPD elements to be employed. Training for positions identified in 10 CFR 50.120 and 10 CFR 52.79(a)(33) is accomplished according to programs accredited by the National Nuclear Accrediting Board of the National Academy of Nuclear Training that implement a systematic approach to training. Records of personnel training and qualification are maintained.

The minimum qualifications of the manager responsible for quality assurance and oversight are an engineering or related science degree and a minimum of four year of related experience, including two years of nuclear power plant experience, one year of supervisory or management experience, and one year of experience performing quality verification activities. Special requirements shall include management and supervisory skills and experience or training in

## **Nuclear Plant Development Quality Assurance Program Description**

---

leadership, interpersonal communication, management responsibilities, motivation of personnel, problem analysis and decision making, and administrative policies and procedures. Individuals who do not possess these formal education and minimum experience requirements should not be eliminated automatically when other factors provide sufficient demonstration of their abilities. These other factors are evaluated on a case-by-case basis and approved and documented by senior management.

The minimum qualifications of the individuals responsible for planning, implementing and maintaining the programs for the QAPD are that each has a high school diploma or equivalent and has a minimum of one year of related experience. Individuals who do not possess these formal education and minimum experience requirements should not be eliminated automatically when other factors provide sufficient demonstration of their abilities. These other factors are evaluated on a case-by-case basis and approved and documented by senior management.

### **2.7 Independent Review**

Activities occurring during the operational phase shall be independently reviewed on a periodic basis. The independent review program shall be functional prior to initial core loading. The independent review function performs the following:

- a. Reviews proposed changes to the facility as described in the safety analysis report (SAR). The independent review function also verifies that changes do not adversely affect safety and if a technical specification change or NRC review is required.
- b. Reviews proposed tests and experiments not described in the SAR. Changes to proposed tests and experiments not described in the SAR that **do** require a technical specification change must be reviewed prior to NRC submittal and implementation.
- c. Reviews proposed technical specification changes and license amendments relating to nuclear safety prior to NRC submittal and implementation, except in those cases where the change is identical to a previously approved change.
- d. Reviews violations, deviations, and events that are required to be reported to the NRC. This review includes the results of investigations and recommendations resulting from such investigations to prevent or reduce the probability of recurrence of the event.
- e. Reviews any matter related to nuclear safety that is requested by the Site Vice President, Site Director, Plant Manager, or any independent review program member,
- f. Reviews corrective actions for significant conditions adverse to quality.
- g. Reviews the adequacy of the audit program every 24 months.

#### **Independent Review Body**

A group may function as an independent review body (IRB). In discharging its review responsibilities, the IRB keeps safety considerations paramount when opposed to cost or schedule considerations. One or more organizational units may collectively perform this function.

1. IRB reviews are supplemented as follows:

## **Nuclear Plant Development Quality Assurance Program Description**

---

- a. A qualified person, independent of the preparer, reviews proposed changes in the procedures as described in the SAR prior to implementation of the change to determine if a technical specification change or NRC approval is required.
  - b. Audits of selected changes in the procedures described in the SAR are performed to verify that procedure reviews and revision controls are effectively implemented.
  - c. Competent individual(s) or group(s) other than those who performed the original design but who may be from the same organization verify that changes to the facility do not result in a loss of adequate design or safety margins.
2. The results of IRB reviews of matters involving the safe operation of the facility are periodically independently reviewed. This review is intended to support management in identifying and resolving issues potentially affecting safe plant operation. This review supplements the existing corrective action programs and audits.
- a. The review is performed by a team consisting of personnel with experience and competence in the activities being reviewed, but independent from cost and schedule considerations and from the organizations responsible for those activities.
  - b. The review is supplemented by outside consultants or organizations as necessary to ensure the team has the requisite expertise and competence.
  - c. Results of the review are documented and reported to responsible management.
  - d. Management periodically considers issues that they determine warrant special attention, such as deficient plant programs, declining performance trends, employee concerns, or other issues related to safe plant operations and determine what issues warrant the review.
  - e. Management determines the scheduling and scope of review and the composition of the team performing the review.

### **2.8 NQA-1-1994 Commitment / Exceptions**

- In establishing qualification and training programs, Duke commits to compliance with NQA-1-1994, Basic Requirement 2 and Supplements 2S-1, 2S-2, 2S-3 and 2S-4, with the following clarifications and exceptions:
  - NQA-1-1994, Supplement 2S-1
    - Supplement 2S-1 will include use of the guidance provided in Appendix 2A-1 the same as if it were part of the Supplement. The following two alternatives may be applied to the implementation of this Supplement and Appendix:
      - (1) In lieu of being certified as Level I, II, or III in accordance with NQA-1-1994, personnel performing independent quality verification inspections, examinations, measurements, or tests of material, products, or activities will be required to possess qualifications equal

## **Nuclear Plant Development Quality Assurance Program Description**

---

to or better than those required for performing the task being verified; and the verification is within the skills of these personnel and/or is addressed by procedures. These individuals will not be responsible for the planning of quality verification inspections and tests (i.e., establishing hold points and acceptance criteria in procedures, and determining who will be responsible for performing the inspections), evaluating inspection training programs, nor certifying inspection personnel.

- (2) A qualified engineer may be used to plan inspections, evaluate the capabilities of an inspector, or evaluate the training program for inspectors. For the purpose of these functions, a qualified engineer is one who has a baccalaureate in engineering in a discipline related to the inspection activity (such as electrical, mechanical, civil) and has a minimum of five years engineering work experience with at least two years of this experience related to nuclear facilities.
- NQA-1-1994, Supplement 2S-2
  - In lieu of Supplement 2S-2, for qualification of nondestructive examination personnel, Duke will follow the applicable standard cited in the version(s) of Section III and Section XI of the ASME Boiler and Pressure Vessel Code approved by the NRC for use at Duke sites.
- NQA-1-1994, Supplement 2S-3
  - The requirement that prospective Lead Auditors have participated in a minimum of five (5) audits in the previous three (3) years is replaced by the following, “The prospective lead auditor shall demonstrate his/her ability to properly implement the audit process, as implemented by Duke, to effectively lead an audit team, and to effectively organize and report results, including participation in at least one nuclear audit within the year preceding the date of qualification.”

## **SECTION 3 DESIGN CONTROL**

Duke has established and implements a process to control the design, design changes and temporary modifications (e.g., temporary bypass lines, electrical jumpers and lifted wires, and temporary setpoints) of items that are subject to the provisions of this QAPD. The design process includes provisions to control design inputs, outputs, changes, interfaces, records and organizational interfaces within Duke and with suppliers. These provisions assure that design inputs (such as design bases and the performance, regulatory, quality, and quality verification requirements) are correctly translated into design outputs (such as analyses, specifications, drawings, procedures, and instructions) so that the final design output can be related to the design input in sufficient detail to permit verification. Design change processes and the division of responsibilities for design-related activities are detailed in Duke and supplier procedures. The design control program includes interface controls necessary to control the development, verification, approval, release, status, distribution and revision of design inputs and outputs. Design changes and disposition of nonconforming items as “use as is” or “repair” are reviewed and approved by the Duke design organization or by other organizations so authorized by Duke.

Design documents are reviewed by individuals knowledgeable in QA to ensure the documents contain the necessary QA requirements.

### **3.1 Design Verification**

Duke design processes provide for design verification to ensure that items and activities subject to the provisions of this QAPD are suitable for their intended application, consistent with their effect on safety. Design changes are subjected to these controls, which include verification measures commensurate with those applied to original plant design.

Design verifications are performed by competent individuals or groups other than those who performed the original design but who may be from the same organization. The verifier shall not have taken part in the selection of design inputs, the selection of design considerations, or the selection of a singular design approach, as applicable. This verification may be performed by the originator's supervisor provided the supervisor did not specify a singular design approach, rule out certain design considerations, and did not establish the design inputs used in the design, or if the supervisor is the only individual in the organization competent to perform the verification. If the verification is performed by the originator's supervisor, the justification of the need is documented and approved in advance by management.

The extent of the design verification required is a function of the importance to safety of the item under consideration, the complexity of the design, the degree of standardization, the state-of-the-art, and the similarity with previously proven designs. This includes design inputs, design outputs and design changes. Design verification procedures are established and implemented to assure that an appropriate verification method is used, the appropriate design parameters to be verified are chosen, the acceptance criteria are identified, and the verification is satisfactorily accomplished and documented. Verification methods may include, but are not limited to, design reviews, alternative calculations and qualification testing. Testing used to verify the acceptability of a specific design feature demonstrates acceptable performance under conditions that simulate the most adverse design conditions expected for item's intended use.

Duke normally completes design verification activities before the design outputs are used by other organizations for design work, and before they are used to support other activities such as

## **Nuclear Plant Development Quality Assurance Program Description**

---

procurement, manufacture or construction. When such timing cannot be achieved, the design verification is completed before relying on the item to perform its intended design or safety function.

### **3.2 Design Records**

Duke maintains records sufficient to provide evidence that the design was properly accomplished. These records include the final design output and any revisions thereto, as well as record of the important design steps (e.g., calculations, analyses and computer programs) and the sources of input that support the final output.

Plant design drawings reflect the properly reviewed and approved configuration of the plant.

### **3.3 Computer Application and Digital Equipment Software**

The QAPD shall govern the development, procurement, testing, maintenance, and use of computer application and digital equipment software when used in safety-related applications and designated non-safety-related applications. Duke and suppliers shall be responsible for developing, approving, and issuing procedures, as necessary, to control the use of such computer application and digital equipment software. The procedures shall require that the application software be assigned a proper quality classification and that the associated quality requirements be consistent with this classification. Each application software and revision thereto shall be documented and approved by authorized personnel. This QAPD shall also be applicable to the administrative functions associated with the maintenance and security of computer hardware where such functions are considered essential in order to comply with other QAPD requirements such as QA records.

### **3.4 Setpoint Control**

Instrument and equipment setpoints that could affect nuclear safety shall be controlled in accordance with written instructions. As a minimum, these written instructions shall:

- (1) Identify responsibilities and processes for reviewing, approving, and revising setpoints and setpoint changes originally supplied by the Design Certification holder, the A/E, and the plant's technical staff.
- (2) Ensure that setpoints and setpoint changes are consistent with design and accident analysis requirements and assumptions.
- (3) Provide for documentation of setpoints, including those determined by operating experience.
- (4) Provide for access to necessary setpoint information for personnel who write or revise plant procedures, operate or maintain plant equipment, develop or revise design documents, or develop or revise accident analyses.

### **3.5 NQA-1-1994 Commitment**

In establishing its program for design control and verification, Duke commits to compliance with NQA-1-1994, Basic Requirement 3, and Supplement 3S-1, the subsurface investigations requirements contained in Subpart 2.20 and the standards for computer software contained in Subpart 2.7.

## **SECTION 4 PROCUREMENT DOCUMENT CONTROL**

Duke has established the necessary measures and governing procedures to assure that purchased items and services are subject to appropriate quality and technical requirements. Procurement document changes shall be subject to the same degree of control as utilized in the preparation of the original documents. These controls include provisions such that:

- Where original technical or quality assurance requirements cannot be determined, an engineering evaluation is conducted and documented by qualified staff to establish appropriate requirements and controls to assure that interfaces, interchangeability, safety, fit and function, as applicable, are not adversely affected or contrary to applicable regulatory requirements.
- Applicable technical, regulatory, administrative, quality and reporting requirements (such as specifications, codes, standards, tests, inspections, special processes, and 10 CFR 21) are invoked for procurement of items and services. 10 CFR 21 requirements for posting, evaluating and reporting will be followed and imposed on suppliers when applicable. Applicable design bases and other requirements necessary to assure adequate quality shall be included or referenced in documents for procurement of items and services. To the extent necessary, procurement documents shall require suppliers to have a documented QA program that is determined to meet the applicable requirements of 10 CFR 50, Appendix B, as appropriate to the circumstances of procurements (or the supplier may work under the licensee's approved QA program).

Reviews of procurement documents shall be performed by personnel who have access to pertinent information and who have an adequate understanding of the requirements and intent of the procurement documents.

### **4.1 NQA-1-1994 Commitment / Exceptions**

In establishing controls for procurement, Duke commits to compliance with NQA-1-1994, Basic Requirement 4 and Supplement 4S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 4S-1
  - Section 2.3 of this Supplement 4S-1 includes a requirement that procurement documents require suppliers to have a documented QAP that implements NQA-1-1994, Part 1. In lieu of this requirement, Duke may require suppliers to have a documented supplier QAP that is determined to meet the applicable requirements of 10 CFR 50, Appendix B, as appropriate to the circumstances of the procurement.
  - With regard to service performed by a supplier, Duke procurement documents may allow the supplier to work under the Duke QAP, including implementing procedures, in lieu of the supplier having its own QAP.
  - Section 3 of this supplement 4S-1 requires procurement documents to be reviewed prior to bid or award of contract. The quality assurance review of procurement documents is satisfied through review of the applicable procurement specification, including the technical and quality procurement

## **Nuclear Plant Development Quality Assurance Program Description**

---

requirements, prior to bid or award of contract. Procurement document changes (e.g., scope, technical or quality requirements) will also receive the quality assurance review.

- Procurement documents for Commercial Grade Items that will be procured by Duke for use as safety-related items shall contain technical and quality requirements such that the procured item can be appropriately dedicated.

## **SECTION 5 INSTRUCTIONS, PROCEDURES, AND DRAWINGS**

Duke has established the necessary measures and governing procedures to ensure that activities affecting quality are prescribed by and performed in accordance with instructions, procedures or drawings of a type appropriate to the circumstances and which, where applicable, include quantitative or qualitative acceptance criteria to implement the QAPD as described in the QAPD. Such documents are prepared and controlled according to Part II, Section 6 of this QAPD. In addition, means are provided for dissemination to the staff of instructions of both general and continuing applicability, as well as those of short-term applicability. Provisions are included for reviewing, updating, and canceling such procedures.

### **5.1 Procedure Adherence**

The Duke policy is that procedures are followed, and the requirements for use of procedures have been established in administrative procedures. Where procedures cannot be followed as written, provisions are established for making changes in accordance with Part II, Section 6 of this QAPD. Requirements are established to identify the manner in which procedures are to be implemented, including identification of those tasks that require (1) the written procedure to be present and followed step-by-step while the task is being performed, (2) the user to have committed the procedure steps to memory, (3) verification of completion of significant steps, by initials or signatures or use of check-off lists. Procedures that are required to be present and referred to directly are those developed for extensive or complex jobs where reliance on memory cannot be trusted, tasks that are infrequently performed, and tasks where steps must be performed in a specified sequence.

In cases of emergency, personnel are authorized to depart from approved procedures when necessary to prevent injury to personnel or damage to the plant. Such departures are recorded describing the prevailing conditions and reasons for the action taken.

### **5.2 Procedure Content**

The established measures address the applicable content of procedures as described in the introduction to Part II of NQA-1-1994. In addition, procedures governing tests, inspections, operational activities and maintenance will include as applicable, initial conditions and prerequisites for the performance of the activity.

### **5.3 NQA-1-1994 Commitment**

In establishing procedural controls, Duke commits to compliance with NQA-1-1994, Basic Requirement 5.

## **SECTION 6 DOCUMENT CONTROL**

Duke has established the necessary measures and governing procedures to control the preparation of, issuance of, and changes to documents that specify quality requirements or prescribe how activities affecting quality, including organizational interfaces, are controlled to assure that correct documents are being employed. The control system (including electronic systems used to make documents available) shall be documented and shall provide for (a) through (f) below:

- (a) identification of documents to be controlled and their specified distribution;
- (b) a method to identify the correct document (including revision) to be used and control of superseded documents;
- (c) identification of assignment of responsibility for preparing, reviewing, approving, and issuing documents;
- (d) review of documents for adequacy, completeness, and correctness prior to approval and issuance;
- (e) a method for providing feedback from users to continually improve procedures and work instructions; and
- (f) coordinating and controlling interface documents and procedures.

The types of documents to be controlled include:

- (a) drawings such as design, construction, installation, and as-built drawings;
- (b) engineering calculations;
- (c) design specifications;
- (d) purchase orders and related documents;
- (e) vendor supplied documents (e.g., manuals, drawings, schematics);
- (f) audit, surveillance, and quality verification/inspection procedures;
- (g) inspection and test reports;
- (h) instructions and procedures for activities covered by this QAPD including design, construction, installation, operating (including normal and emergency operations), maintenance, calibration, and routine testing;
- (i) technical specifications; and
- (j) nonconformance reports and corrective action reports.

During the operational phase, where temporary procedures are used, they shall include a designation of the period of time during which it is acceptable to use them.

### **6.1 Review and Approval of Documents**

Documents shall be reviewed for adequacy by qualified persons other than the preparer. During the construction phase, procedures for design, construction, and installation shall also be reviewed by the organization responsible for quality verification to ensure quality assurance measures have been appropriately applied. The documented review signifies concurrence.

## **Nuclear Plant Development Quality Assurance Program Description**

---

During the operations phase, documents affecting the configuration or operation of the station as described in the SAR shall be screened to identify those that require review by the IRB prior to implementation as described in Section 2 of this QAPD.

To ensure effective and accurate procedures during the operational phase, applicable procedures shall be reviewed, and updated as necessary, based on the following conditions:

- (a) any modification to a system;
- (b) an unusual incident, such as an accident, significant operator error, or equipment malfunction;
- (c) procedure discrepancies;
- (d) prior to use if not used in the previous two years; and
- (e) results of QA audits conducted in accordance with Section 18.1 of this QAPD.

Prior to issuance or use, documents including revisions thereto, shall be approved by the designated authority. A listing of all controlled documents identifying the current approved revision, or date, is maintained so personnel can readily determine the appropriate document for use.

### **6.2 Changes to Documents**

Changes to documents, other than those defined in implementing procedures as minor changes, shall be reviewed and approved by the same organizations that performed the original review and approval unless other organizations are specifically designated. The reviewing organization shall have access to pertinent background data or information upon which to base their approval. Where temporary procedure changes are necessary during the operations phase, changes that clearly do not change the intent of the approved procedure may be implemented provided they are approved by two members of the staff knowledgeable in the areas affected by the procedures. Minor changes to documents, such as inconsequential editorial corrections, do not require that the revised documents receive the same review and approval as the original documents. To avoid a possible omission of a required review, the type of minor changes that do not require such a review and approval and the persons who can authorize such a classification shall be clearly delineated in implementing procedures.

### **6.3 NQA-1-1994 Commitment**

In establishing provisions for document control, Duke commits to compliance with NQA-1-1994, Basic Requirement 6 and Supplement 6S-1.

## **Nuclear Plant Development Quality Assurance Program Description**

---

### **SECTION 7 CONTROL OF PURCHASED MATERIAL, EQUIPMENT, AND SERVICES**

Duke has established the necessary measures and governing procedures to control the procurement of items and services to assure conformance with specified requirements. Such control shall provide for the following as appropriate: source evaluation and selection, evaluation of objective evidence of quality furnished by the supplier, source inspection, audit, and examination of items or services.

#### **7.1 Acceptance of Item or Service**

Duke establishes and implements measures to assess the quality of purchased items and services, whether purchased directly or through contractors, at intervals and to a depth consistent with the item's or service's importance to safety, complexity, quantity and the frequency of procurement. Verification actions include testing, as appropriate, during design, fabrication and construction activities. Verifications occur at the appropriate phases of the procurement process, including, as necessary, verification of activities of suppliers below the first tier.

Measures to assure the quality of purchased items and services include the following, as applicable:

- Items are inspected, identified, and stored to protect against damage, deterioration, or misuse.
- Prospective suppliers of safety-related items and services are evaluated to assure that only qualified suppliers are used. Qualified suppliers are audited on a triennial basis. In addition, if a subsequent contract or a contract modification significantly enlarges the scope of or changes the methods or controls for activities performed by the same supplier, an audit of the modified requirements is conducted, thus starting a new triennial period. Duke may utilize audits conducted by outside organizations for supplier qualification provided that the scope and adequacy of the audits meet Duke requirements. Documented annual evaluations are performed for qualified suppliers to assure they continue to provide acceptable products and services. Industry programs, such as those applied by ASME, Nuclear Procurement Issues Committee (NUPIC), or other established utility groups, are used as input or the basis for supplier qualification whenever appropriate. The results of the reviews are promptly considered for effect on a supplier's continued qualification and adjustments made as necessary (including corrective actions, adjustments of supplier audit plans, and input to third party auditing entities, as warranted). In addition, results are reviewed periodically to determine if, as a whole, they constitute a significant condition adverse to quality requiring additional action.
- Provisions are made for accepting purchased items and services, such as source verification, receipt inspection, pre- and post-installation tests, certificates of conformance, and document reviews (including Certified Material Test Report/Certificate). Acceptance actions/documents should be established by the Purchaser with appropriate input from the Supplier and be completed to ensure that procurement, inspection, and test requirements, as applicable, have been satisfied before relying on the item to perform its intended safety function.

## **Nuclear Plant Development Quality Assurance Program Description**

---

- Controls are imposed for the selection, determination of suitability for intended use (critical characteristics), evaluation, receipt and acceptance of commercial-grade services or items to assure they will perform satisfactorily in service in safety-related applications.
- If there is insufficient evidence of implementation of a QA program, the initial evaluation is of the existence of a QA program addressing the scope of services to be provided. The initial audit is performed after the supplier has completed sufficient work to demonstrate that its organization is implementing a QA program.

### **7.2 NQA-1-1994 Commitment / Exceptions**

In establishing procurement verification controls, Duke commits to compliance with NQA-1-1994, Basic Requirement 7 and Supplement 7S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 7S-1
  - Duke considers that other 10 CFR 50 licensees, Authorized Nuclear Inspection Agencies, National Institute of Standards and Technology, or other State and Federal agencies which may provide items or services to Duke plants are not required to be evaluated or audited.
  - When purchasing commercial grade calibration services from a calibration laboratory, procurement source evaluation and selection measures need not be performed provided each of the following conditions are met:
    - (1) The purchase documents impose any additional technical and administrative requirements, as necessary, to comply with the Duke QA program and technical provisions. At a minimum, the purchase document shall require that the calibration certificate/report include identification of the laboratory equipment/standard used.
    - (2) The purchase documents require reporting as-found calibration data when calibrated items are found to be out-of-tolerance.
    - (3) A documented review of the supplier's accreditation will be performed and will include a verification of the following:
      - The calibration laboratory holds a domestic (United States) accreditation by any one of the following accrediting bodies, which are recognized by the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Arrangement (MRA):
        - National Voluntary Laboratory Accreditation Program (NVLAP), administered by the National Institute of Standards & Technology;
        - American Association for Laboratory Accreditation (A2LA);
        - ACLASS Accreditation Services (ACLASS);

## **Nuclear Plant Development Quality Assurance Program Description**

---

- International Accreditation Service (IAS);
    - Laboratory Accreditation Bureau (L-A-B);
    - Other NRC-approved laboratory accrediting body.
  - The accreditation encompasses ANS/ISO/IEC 17025, “General Requirements for the Competence of Testing and Calibration Laboratories.”
  - The published scope of accreditation for the calibration laboratory covers the necessary measurement parameters, ranges, and uncertainties.
- 
- For Section 8.1, Duke considers documents that may be stored in approved electronic media under Duke or vendor control and not physically located on the plant site but which are accessible from the respective nuclear facility site as meeting the NQA-1 requirement for documents to be available at the site. Following completion of the construction period, sufficient as-built documentation will be turned over to Duke to support operations. The Duke records management system will provide for timely retrieval of necessary records.
  - In lieu of the requirements of Section 10, Commercial Grade Items, controls for commercial grade items and services are established in Duke documents using 10 CFR 21 and the guidance of EPRI NP-5652 as discussed in Generic Letter 89-02 and Generic Letter 91-05.
  - For commercial grade items, special quality verification requirements are established and described in Duke documents to provide the necessary assurance an item will perform satisfactorily in service. The Duke documents address determining the critical characteristics that ensure an item is suitable for its intended use, technical evaluation of the item, receipt requirements, and quality evaluation of the item.
  - Duke will also use other appropriate approved regulatory means and controls to support Duke commercial grade dedication activities. One example of this is NRC Regulatory Issue Summary 2002-22. Duke will assume 10 CFR 21 reporting responsibility for all items that Duke dedicates as safety-related.

## **SECTION 8 IDENTIFICATION AND CONTROL OF MATERIALS, PARTS, AND COMPONENTS**

Duke has established the necessary measures and governing procedures to identify and control items to prevent the use of incorrect or defective items. This includes controls for consumable materials and items with limited shelf life. The identification of items is maintained throughout fabrication, erection, installation and use so that the item can be traced to its documentation, consistent with the item's effect on safety. Identification locations and methods are selected so as not to affect the function or quality of the item.

### **8.1 NQA-1-1994 Commitment**

In establishing provisions for identification and control of items, Duke commits to compliance with NQA-1-1994, Basic Requirement 8 and Supplement 8S-1.

## **SECTION 9 CONTROL OF SPECIAL PROCESSES**

Duke has established the necessary measures and governing procedures to assure that special processes that require interim process controls to assure quality, such as welding, heat treating, and nondestructive examination, are controlled. These provisions include assuring that special processes are accomplished by qualified personnel using qualified procedures and equipment. Personnel are qualified and special processes are performed in accordance with applicable codes, standards, specifications, criteria or other specially established requirements. Special processes are those where the results are highly dependent on the control of the process or the skill of the operator, or both, and for which the specified quality cannot be fully and readily determined by inspection or test of the final product.

### **9.1 NQA-1-1994 Commitment**

In establishing measures for the control of special processes, Duke commits to compliance with NQA-1-1994, Basic Requirement 9 and Supplement 9S-1.

## **SECTION 10           INSPECTION**

Duke has established the necessary measures and governing procedures to implement inspections that assure items, services and activities affecting safety meet established requirements and conform to applicable documented specifications, instructions, procedures, and design documents. Inspection may also be applied to items, services and activities affecting plant reliability and integrity. Types of inspections may include those verifications related to procurement, such as source, in-process, final, and receipt inspection, as well as construction, installation, and operations activities. Inspections are carried out by properly qualified persons independent of those who performed or directly supervised the work. Inspection results shall be documented.

### **10.1   Inspection Program**

The inspection program establishes inspections (including surveillance of processes), as necessary to verify quality: (1) at the source of supplied items or services, (2) in-process during fabrication at a Supplier's facility or at a Company facility, (3) for final acceptance of fabricated and/or installed items during construction, (4) upon receipt of items for a facility, as well as (5) during maintenance, modification, inservice, and operating activities.

The inspection program establishes requirements for planning inspections, such as the group or discipline responsible for performing the inspection, where inspection hold points are to be applied, determining applicable acceptance criteria, the frequency of inspection to be applied, and identification of special tools needed to perform the inspection. Inspection planning is performed by personnel qualified in the discipline related to the inspection and includes qualified inspectors or engineers. Inspection plans are based on, as a minimum, the importance of the item to the safety of the facility, the complexity of the item, technical requirements to be met, and design specifications. Where significant changes in inspection activities for the facilities are to occur, management responsible for the inspection programs evaluate the resource and planning requirements to ensure effective implementation of the inspection program.

Inspection program documents establish requirements for performing the planned inspections, and documenting required inspection information such as: rejection, acceptance, and reinspection results; and the person(s) performing the inspection.

Inspection results are documented by the inspector, reviewed by authorized personnel qualified to evaluate the technical adequacy of the inspection results, and controlled by instructions, procedures, and drawings.

### **10.2   Inspector Qualification**

Duke has established qualification programs for personnel performing quality inspections. The qualification program requirements are described in Section 2 of this QAPD. These qualification programs are applied to individuals performing quality inspections regardless of the functional group where they are assigned.

### **10.3 NQA-1-1994 Commitment / Exceptions**

- In establishing inspection requirements, Duke commits to compliance with NQA-1-1994, Basic Requirement 10, Supplement 10S-1 and Subpart 2.4, with the clarification that follows below. In addition, Duke commits to compliance with the requirements of Subparts 2.5 and 2.8 for establishing appropriate inspection requirements.
  - Subpart 2.4 commits Duke to IEEE 336-1985. IEEE 336-1985 refers to IEEE 498-1985. Both IEEE 336 -1985 and IEEE 498-1985 use the definition of “Safety Systems Equipment” from IEEE 603-1980. Duke commits to the definition of Safety Systems Equipment in IEEE 603-1980, but does not commit to the balance of that standard. This definition is only applicable to equipment in the context of Subpart 2.4.
  - An additional exception to Subpart 2.4 is contained in Section 12 of this QAPD.

## **SECTION 11            TEST CONTROL**

Duke has established the necessary measures and governing procedures to demonstrate that items subject to the provisions of this QAPD will perform satisfactorily in service, that the plant can be operated safely and as designed, and that the coordinated operation of the plant as a whole is satisfactory. These programs include criteria for determining when testing is required, such as proof tests before installation, pre-operational tests, post-maintenance tests, post-modification tests, in-service tests, and operational tests (such as surveillance tests required by Plant Technical Specifications), to demonstrate that performance of plant systems is in accordance with design. Programs also include provisions for establishing and adjusting test schedules and maintaining status for periodic or recurring tests. Tests are performed according to applicable procedures that include, consistent with the effect on safety, (1) instructions and prerequisites to perform the test, (2) use of proper test equipment, (3) acceptance criteria, and (4) mandatory verification points as necessary to confirm satisfactory test completion. Test results are documented and evaluated by the organization performing the test and reviewed by a responsible authority to assure that the test requirements have been satisfied. If acceptance criteria are not met, retesting is performed as needed to confirm acceptability following correction of the system or equipment deficiencies that caused the failure.

The initial start-up test program is planned and scheduled to permit safe fuel loading and start-up; to increase power in safe increments; and to perform major testing at specified power levels. If tests require the variation of operating parameters outside of their normal range, the limits within which such variation is permitted will be prescribed. The scope of the testing demonstrates, insofar as practicable, that the plant is capable of withstanding the design transients and accidents. For new facility construction, the suitability of facility operating procedures is checked to the maximum extent possible during the preoperational and initial start-up test programs.

The tests are performed and results documented in accordance with applicable technical and regulatory requirements including those described in the Technical Specifications and SAR. The test programs ensure appropriate retention of test data in accordance with the records requirements of this QAPD. The personnel performing or evaluating tests are qualified in accordance with the requirements established in Section 2 of this QAPD.

### **11.1 NQA-1-1994 Commitment**

In establishing provisions for testing, Duke commits to compliance with NQA-1-1994, Basic Requirement 11 and Supplement 11S-1.

### **11.2 NQA-1-1994 Commitment for Computer Program Testing**

Duke establishes and implements provisions to assure that computer software used in applications affecting safety is prepared, documented, verified and tested, and used such that the expected output is obtained and configuration control maintained. To this end Duke commits to compliance with the requirements of NQA-1-1994, Supplement 11S-2 and Subpart 2.7 to establish the appropriate provisions.

## **SECTION 12           CONTROL OF MEASURING AND TEST EQUIPMENT**

Duke has established the necessary measures and governing procedures to control the calibration, maintenance, and use of measuring and test equipment (M&TE) that provides information important to safe plant operation. The provisions of such procedures cover equipment such as indicating and actuating instruments and gages, tools, reference and transfer standards, and nondestructive examination equipment. The suppliers of commercial-grade calibration services shall be controlled as described in Section 7 of this QAPD.

### **12.1   Installed Instrument and Control Devices**

For the operations phase of the facilities, Duke has established and implements procedures for the calibration and adjustment of instrument and control devices installed in the facility. The calibration and adjustment of these devices is accomplished through the facility maintenance programs to ensure the facility is operated within design and technical requirements. Appropriate documentation will be maintained for these devices to indicate the control status, when the next calibration is due, and identify any limitations on use of the device.

### **12.2   NQA-1-1994 Commitment / Exceptions**

In establishing provisions for control of measuring and test equipment, Duke commits to compliance with NQA-1-1994, Basic Requirement 12 and Supplement 12S-1 with the following clarification and exception:

- The out of calibration conditions described in paragraph 3.2 of Supplement 12S-1 refers to when the M&TE is found out of the required accuracy limits (i.e., out of tolerance) during calibration.
- Measuring and test equipment are not required to be marked with the calibration status where it is impossible or impractical due to equipment size or configuration (such as the label will interfere with operation of the device) provided the required information is maintained in suitable documentation traceable to the device. This exception also applies to the calibration labeling requirement stated in NQA-1-1994, Subpart 2.4, Section 7.2.1 (ANSI/IEEE Std. 336-1985).

## **SECTION 13            HANDLING, STORAGE, AND SHIPPING**

Duke has established the necessary measures and governing procedures to control the handling, storage, packaging, shipping, cleaning, and preservation of items to prevent inadvertent damage or loss, and to minimize deterioration. These provisions include specific procedures, when required to maintain acceptable quality of the items important to the safe operations of the plant. Items are appropriately marked and labeled during packaging, shipping, handling and storage to identify, maintain, and preserve the item's integrity and indicate the need for special controls. Special controls (such as containers, shock absorbers, accelerometers, inert gas atmospheres, specific moisture content levels and temperature levels) are provided when required to maintain acceptable quality.

Special or additional handling, storage, shipping, cleaning and preservation requirements are identified and implemented as specified in procurement documents and applicable procedures. Where special requirements are specified, the items and containers (where used) are suitably marked.

Special handling tools and equipment shall be used and controlled as necessary to ensure safe and adequate handling. Special handling tools and equipment shall be inspected and tested at specified time intervals and in accordance with procedures to verify that the tools and equipment are adequately maintained.

Operators of special handling and lifting equipment shall be experienced or trained in the use the equipment. During the operational phase, Duke establishes and implements controls over hoisting, rigging and transport activities to the extent necessary to protect the integrity of the items involved, as well as potentially affected nearby structures and components. Where required, Duke complies with applicable hoisting, rigging and transportation regulations and codes.

### **13.1 Housekeeping**

Housekeeping practices are established to account for conditions or environments that could affect the quality of structures, systems and components within the plant. This includes control of cleanliness of facilities and materials, fire prevention and protection, disposal of combustible material and debris, control of access to work areas, protection of equipment, radioactive contamination control and storage of solid radioactive waste. Housekeeping practices help assure that only proper materials, equipment, processes and procedures are used and that the quality of items is not degraded. Necessary procedures or work instructions, such as for electrical bus and control center cleaning, cleaning of control consoles, and radioactive decontamination are developed and used.

### **13.2 NQA-1-1994 Commitment / Exceptions**

In establishing provisions for handling, storage and shipping, Duke commits to compliance with NQA-1-1994, Basic Requirement 13 and Supplement 13S-1. Duke also commits, during the construction and pre-operational phase of the plant, to compliance with the requirements of NQA-1-1994, Subpart 2.1, Subpart 2.2, and Subpart 3.2, Appendix 2.1, with the clarifications and exceptions shown below:

## Nuclear Plant Development Quality Assurance Program Description

---

- NQA-1-1994, Subpart 2.2
  - Subpart 2.2, section 6.6, “Storage Records:” This section requires written records be prepared containing information on personnel access. As an alternative to this requirement, Duke documents establish controls for storage areas that describe those authorized to access areas and the requirements for recording access of personnel. However, these records of access are not considered quality records and will be retained in accordance with the administrative controls of the applicable plant.
  - Subpart 2.2, section 7.1 refers to Subpart 2.15 for requirements related to handling of items. The scope of Subpart 2.15 includes hoisting, rigging and transporting of items for nuclear power plants during construction.
  
- NQA-1-1994, Subpart 3.2
  - Subpart 3.2, Appendix 2.1: Only section 3 precautions, which address the use of alkaline cleaning compounds and chelating agents that will be used in conjunction with the cleaning activities under Subpart 2.1, sections 8.2.2 and 8.2.3, are committed to in accordance with Regulatory Guide 1.37.

## **SECTION 14           INSPECTION, TEST, AND OPERATING STATUS**

Duke has established the necessary measures and governing procedures to identify the inspection, test, and operating status of items and components subject to the provisions of this QAPD in order to maintain personnel and reactor safety and avoid inadvertent operation of equipment. Where necessary to preclude inadvertent bypassing of inspections or tests, or to preclude inadvertent operation, these measures require the inspection, test or operating status be verified before release, fabrication, receipt, installation, test or use. These measures also establish the necessary authorities and controls for the application and removal of status indicators or labels.

In addition, temporary design changes (temporary modifications), such as temporary bypass lines, electrical jumpers and lifted wires, and temporary trip-point settings, are controlled by procedures that include requirements for appropriate installation and removal, independent/concurrent verifications and status tracking.

The administrative procedures also describe the measures taken to control altering the sequence of required tests, inspections, and other operations. The review and approval for these actions is subject to the same control as taken during the original review and approval of tests, inspections, and other operations.

### **14.1 NQA-1-1994 Commitment**

In establishing measures for control of inspection, test and operating status, Duke commits to compliance with NQA-1-1994, Basic Requirement 14.

## **SECTION 15           NONCONFORMING MATERIALS, PARTS, OR COMPONENTS**

Duke has established the necessary measures and governing procedures to control items, including services, which do not conform to specified requirements to prevent inadvertent installation or use. Controls provide for identification, documentation, evaluation, segregation when practical, and disposition of nonconforming items, and for notification to affected organizations. Controls are provided to address conditional release of nonconforming items for use on an at risk basis prior to resolution and disposition of the nonconformance, including maintaining identification of the item and documenting the basis for such release. Conditional release of nonconforming items for installation requires the approval of the designated management. Nonconformances are corrected or resolved prior to depending on the item to perform its intended safety function. Nonconformances are evaluated for impact on operability of quality structures, systems, and components to assure that the final condition does not adversely affect safety, operation, or maintenance of the item or service. Nonconformances to design requirements dispositioned repair or use-as-is, shall be subject to design control measures commensurate with those applied to the original design. Nonconformance dispositions are reviewed for adequacy, analysis of quality trends, and reports provided to the designated management. Significant trends are reported to management in accordance with Duke procedures, regulatory requirements, and industry standards.

### **15.1 Reporting Program**

Duke will establish the necessary measures and governing procedures that implement a reporting program which conforms to the requirements of 10 CFR 52, 10 CFR 50.55(e) and/or 10 CFR 21 during ESP/COL and construction and 10 CFR 21 during operations.

### **15.2 NQA-1-1994 Commitment**

In establishing measures for nonconforming materials, parts, or components, Duke commits to compliance with NQA-1-1994, Basic Requirement 15, and Supplement 15S-1.

## **SECTION 16            CORRECTIVE ACTION**

Duke has established the necessary measures and governing procedures to promptly identify, control, document, classify and correct conditions adverse to quality. Duke procedures assure that corrective actions are documented and initiated following the determination of conditions adverse to quality in accordance with regulatory requirements and applicable quality standards. Duke procedures require personnel to identify known conditions adverse to quality. When complex issues arise where it cannot be readily determined if a condition adverse to quality exists, Duke documents establish the requirements for documentation and timely evaluation of the issue. Reports of conditions adverse to quality are analyzed to identify trends. Significant conditions adverse to quality and significant adverse trends are documented and reported to responsible management. In the case of a significant condition adverse to quality, the cause is determined and actions to preclude recurrence are taken.

In the case of suppliers working on safety-related activities, or other similar situations, the licensee may delegate specific responsibilities of the Corrective Action program but the licensee maintains responsibility for the program's effectiveness.

### **16.1 Reporting Program**

Duke has in-place the necessary measures and governing procedures that implement a program to identify, evaluate and report defects and non-compliances in accordance with 10 CFR 50.55(e) and/or 10 CFR Part 21, as applicable. Such a reporting program applies to safety-related activities and services performed by Duke and/or Duke suppliers / sub-suppliers providing input to the ESP and COL application development.

### **16.2 NQA-1-1994 Commitment**

In establishing provisions for corrective action, Duke commits to compliance with NQA-1-1994, Basic Requirement 16.

## **SECTION 17           QUALITY ASSURANCE RECORDS**

Duke shall establish the necessary measures and governing procedures to ensure that sufficient records of items and activities affecting quality are developed, reviewed, approved, issued, used, and revised to reflect completed work. The provisions of such procedures establish the scope of the records retention program for Duke and include requirements for records administration, including receipt, preservation, retention, storage, safekeeping, retrieval, access controls, user privileges, and final disposition.

### **17.1 Record Retention**

Measures are required to be established that ensure that sufficient records of completed items and activities affecting quality are appropriately stored. Such records and their retention times are defined in appropriate procedures. In all cases where state, local, or other agencies have more restrictive requirements for record retention, those requirements will be met.

### **17.2 Electronic Records**

When using electronic records storage and retrieval systems, Duke complies with NRC guidance Generic Letter 88-18, "Plant Record Storage on Optical Disks." Duke will manage the storage of QA Records in electronic media consistent with the intent of RIS 2000-18 and associated NIRMA Guidelines TG 11-1998, TG15-1998, TG16-1998, and TG21-1998.

### **17.3 NQA-1-1994 Commitment / Exceptions**

In establishing provisions for records, Duke commits to compliance with NQA-1-1994, Basic Requirement 17 and Supplement 17S-1, with the following clarifications and exceptions:

- NQA-1-1994, Supplement 17S-1
  - Supplement 17S-1, section 4.2(b) requires records to be firmly attached in binders or placed in folders or envelopes for storage in steel file cabinets or on shelving in containers. For hard-copy records maintained by Duke, the records are suitably stored in steel file cabinets or on shelving in containers, except that methods other than binders, folders or envelopes may be used to organize the records for storage.

## **SECTION 18        AUDITS**

Duke has established the necessary measures and governing procedures to implement audits to verify that activities covered by this QAPD are performed in conformance with the requirements established. The audit programs are themselves reviewed for effectiveness as a part of the overall audit process.

### **18.1 Performance of Audits**

Internal audits of selected aspects of licensing, design, construction phase and operating activities are performed with a frequency commensurate with safety significance and in a manner which assures that audits of safety-related activities are completed. During the early portions of new Nuclear Plant Development activities, audits will focus on areas including, but not limited to, site investigation, procurement, and corrective action. Functional areas of an organization's QA program for auditing include at a minimum verification of compliance and effectiveness of implementation of internal rules, procedures (e.g., operating, design, procurement, maintenance, modification, refueling, surveillance, test, security, radiation control procedures, and the emergency plan), Technical Specifications, regulations and license conditions, programs for training, retraining, qualification and performance of operating staff, corrective actions, and observation of performance of operating, refueling, maintenance and modification activities, including associated record keeping.

The audits are scheduled on a formal preplanned audit schedule. The audit system is reviewed periodically and revised as necessary to assure coverage commensurate with current and planned activities. Additional audits may be performed as deemed necessary by management. The scope of the audit is determined by the quality status and safety importance of the activities being performed. These audits are conducted by trained personnel not having direct responsibilities in the area being audited and in accordance with preplanned and approved audit plans or checklists, under the direction of a qualified lead auditor and the cognizance of the manager responsible for quality assurance and oversight.

Duke is responsible for conducting periodic internal and external audits. Internal audits are conducted to determine the adequacy of programs and procedures (by representative sampling), and to determine if they are meaningful and comply with the overall QAPD. External audits determine the adequacy of supplier and contractor quality assurance program.

The results of each audit are reported in writing to the responsible Senior Nuclear Generation Officer, or designee, as appropriate. Additional internal distribution is made to other concerned management levels in accordance with approved procedures.

Management responds to all audit findings and initiates corrective action where indicated. Where corrective action measures are indicated, documented follow-up of applicable areas through inspections, review, re-audits, or other appropriate means is conducted to verify implementation of assigned corrective action.

#### **Internal Audits**

- a. Internal audits of organization and facility activities, conducted prior to placing the facility in operation, should be performed in such a manner as to assure that an audit of all applicable QA program elements is completed for each functional area at least once each year or at least

## **Nuclear Plant Development Quality Assurance Program Description**

---

once during the life of the activity, whichever is shorter. Internal audits of activities, conducted after placing the facility in operation, should be performed in such a manner as to assure that an audit of all applicable QA program elements is completed for each functional area within a period of two years.

- b. Internal audit frequencies of well established activities, conducted after placing the facility in operation, may be extended one year at a time beyond the above two-year interval based on the results of an annual evaluation of the applicable functional area and objective evidence that the functional area activities are being satisfactorily accomplished. The evaluation should include a detailed performance analysis of the functional area based upon applicable internal and external source data and due consideration of the impact of any function area changes in responsibility, resources or management. However, the internal audit frequency interval should not exceed a maximum of four years. If an adverse trend is identified in the applicable functional area, the extension of the internal audit frequency interval should be rescinded and an audit scheduled as soon as practicable.

During the operations phase audits are performed at a frequency commensurate with the safety significance of the activities and in such a manner to assure audits of all applicable QA program elements are completed within a period of two years. These audits will include, as a minimum, activities in the following areas:

- (1) The conformance of facility operation to provisions contained within the Technical Specifications and applicable license conditions including administrative controls.
- (2) The performance, training, and qualifications of the facility staff.
- (3) The performance of activities required by the QAPD to meet the criteria of 10 CFR 50, Appendix B.
- (4) The Fire Protection Program and implementing procedures. A fire protection equipment and program implementation inspection and audit is conducted utilizing either a qualified offsite licensed fire protection engineer or an outside qualified fire protection consultant.
- (5) Other activities and documents considered appropriate by Nuclear Plant Development, Nuclear Operations, or the CNO.

Audits may also be used to meet the periodic review requirements of the code for the Security, Emergency Preparedness, and Radiological Protection programs within the provisions of the applicable code.

Internal audits include verification of compliance and effectiveness of the administrative controls established for implementing the requirements of this QAPD; regulations and license provisions; provisions for training, retraining, qualification, and performance of personnel performing activities covered by this QAPD; corrective actions taken following abnormal occurrences; and, observation of the performance of construction, fabrication, operating, refueling, maintenance and modification activities including associated record keeping.

- c. Audits of suppliers of safety-related components and/or services are conducted as described in Section 7.1.

### **18.2 NQA-1-1994 Commitment**

In establishing the independent audit program, Duke commits to compliance with NQA-1-1994, Basic Requirement 18 and Supplement 18S-1.

## **PART III NON-SAFETY-RELATED SSC QUALITY CONTROL**

(NOTE: Part III does not apply to ESP activities.)

### **SECTION 1 Non-Safety Related SSCs - Significant Contributors to Plant Safety**

Specific program controls are applied to non-safety related SSCs, for which 10 CFR 50, Appendix B is not applicable, that are significant contributors to plant safety. The specific program controls consistent with applicable sections of the QAPD are applied to those items in a selected manner, targeted at those characteristics or critical attributes that render the SSC a significant contributor to plant safety.

The following clarify the applicability of the QA Program to the non-safety-related SSCs and related activities, including the identification of exceptions to the QA Program described in Part II, Sections 1 through 18 taken for non-safety-related SSCs.

#### **1.1 Organization**

The verification activities described in this part may be performed by the Duke line organization; the QA organization described in Part II is not required to perform these functions.

#### **1.2 QA Program**

Duke QA requirements for non-safety-related SSCs are contained in this QAPD and appropriate procedures. Suppliers of these SSCs or related services describe the quality controls applied in appropriate procedures; a new or separate QA program is not required.

#### **1.3 Design Control**

Duke shall establish design control measures to ensure that the contractually established design requirements are included in the design. These measures ensure that applicable design inputs are included or correctly translated into the design documents, and deviations from those requirements are controlled. Design verification is provided through the normal supervisory review of the designer's work.

#### **1.4 Procurement Document Control**

Procurement documents for items and services obtained by or for Duke shall include or reference documents describing applicable design bases, design requirements, and other requirements necessary to ensure component performance. The procurement documents are controlled to address deviations from the specified requirements.

#### **1.5 Instructions, Procedures, and Drawings**

Duke shall provide documents such as, but not limited to, written instructions, plant procedures, drawings, vendor technical manuals, and special instructions in work orders, to direct the performance of activities affecting quality. The method of

## **Nuclear Plant Development Quality Assurance Program Description**

---

instruction employed shall provide an appropriate degree of guidance to the personnel performing the activity to achieve acceptable functional performance of the SSC.

### **1.6 Document Control**

Duke shall establish controls for the issuance and change of documents that specify quality requirements or prescribe activities affecting quality to ensure that correct documents are used. These controls include review and approval of documents, identification of the appropriate revision for use, and measures to preclude the use of superseded or obsolete documents.

### **1.7 Control of Purchased Items and Services**

Duke shall establish measures, such as inspection of items or documents upon receipt or acceptance testing, to ensure that all purchased items and services conform to appropriate procurement documents.

### **1.8 Identification and Control of Purchased Items**

Duke shall establish measures where necessary, to identify purchased items and preserve their functional performance capability. Storage controls take into account appropriate environmental, maintenance, or shelf life restrictions for the items.

### **1.9 Control of Special Processes**

Duke shall establish process and procedure controls for special processes, including welding, heat treating, and nondestructive testing. These controls are based on applicable codes, standards, specifications, criteria, or other special requirements for the special process.

### **1.10 Inspection**

Duke shall establish documented instructions to ensure necessary inspections are performed to verify conformance of an item or activity to specified requirements or to verify that activities are satisfactorily accomplished. These inspections may be performed by personnel in the line organization through the Duke's independent verification (IV)/ simultaneous verification (SV), or similar process that utilizes knowledgeable personnel to perform the verification function.

### **1.11 Test Control**

Duke shall establish measures to identify required testing that demonstrates that equipment conforms to design requirements. These tests are performed in accordance with test instructions or procedures. The test results are recorded, and authorized individuals evaluate the results to ensure that test requirements are met.

### **1.12 Control of Measuring and Test Equipment (M&TE)**

Duke shall establish measures to control M&TE use, and calibration and adjustment at specific intervals or prior to use.

**1.13 Handling, Storage, and Shipping**

Duke shall establish measures to control the handling, storage, cleaning, packaging, shipping, and preservation of items to prevent damage or loss and to minimize deterioration. These measures include appropriate marking or labels, and identification of any special storage or handling requirements.

**1.14 Inspection, Test, and Operating Status**

Duke shall establish measures to identify items that have satisfactorily passed required tests and inspections and to indicate the status of inspection, test, and operability as appropriate.

**1.15 Control of Nonconforming Items**

Duke shall establish measures to identify and control items that do not conform to specified requirements to prevent their inadvertent installation or use.

**1.16 Corrective Action**

Duke shall establish measures to ensure that failures, malfunctions, deficiencies, deviations, defective components, and nonconformances are properly identified, reported, and corrected.

**1.17 Records**

Duke shall establish measures to ensure records are prepared and maintained to furnish evidence that the above requirements for design, procurement, document control, inspection, and test activities have been met.

**1.18 Audits**

Duke shall establish measures for line management to periodically review and document the adequacy of the process and take any necessary corrective action. Audits independent of line management are not required. Line management is responsible for determining whether reviews conducted by line management or audits conducted by any organization independent of line management are appropriate. If performed, audits are conducted and documented to verify compliance with design and procurement documents, instructions, procedures, drawings, and inspection and test activities. Where the measures of this part (Part III) are implemented by the same programs, processes, or procedures as the comparable activities of Part II, the audits performed under the provisions of Part II may be used to satisfy the review requirements of this Section (Part III, Section 1.18).

**SECTION 2 Non-Safety-Related SSCs Credited for Regulatory Events**

The following criteria apply to fire protection (10 CFR 50.48), anticipated transients without scram (ATWS) (10 CFR 50.62), the station blackout (SBO) (10 CFR 50.63) SSCs that are not safety related.

## **Nuclear Plant Development Quality Assurance Program Description**

---

Duke shall implement quality requirements to the fire protection system in accordance with Regulatory Position 1.7, "Quality Assurance," in Regulatory Guide 1.189, "Fire Protection for Operating Nuclear Power Plants."

Duke shall implement the quality requirements to ATWS equipment in accordance with Generic Letter 85-06, "Quality Assurance Guidance for ATWS Equipment That Is Not Safety Related."

Duke implements quality requirements for Station Blackout (SBO) equipment as described in the individual plant FSAR. Applicability of Regulatory Guide 1.155, "Station Blackout" is addressed in Chapter 1 of the FSAR.

## **PART IV REGULATORY COMMITMENTS**

### **NRC Regulatory Guides and Quality Assurance Standards**

This section identifies the NRC Regulatory Guides and the other quality assurance standards which have been selected to supplement and support the Duke QAPD. Duke commits to compliance with these standards to the extent described herein. Commitment to a particular Regulatory Guide or other QA standard does not constitute a commitment to the Regulatory Guides or QA standards that may be referenced therein.

#### **Regulatory Guides:**

**Regulatory Guide 1.26**, Revision 4, March 2007 – Quality Group Classifications and Standards for Water-, Steam-, and Radioactive-Waste-Containing Components of Nuclear Power Plants

Regulatory Guide 1.26 defines classification of systems and components.

Duke commits to the applicable regulatory position guidance provided in this regulatory guide for Nuclear Plant Development with the exception of Criteria C.1, C.1.a, C.1.b, and C.3. Refer to the Westinghouse AP1000 Design Control Document, Appendix 1A, for a detailed discussion of these exceptions.

**Regulatory Guide 1.29**, Revision 4, March 2007 – Seismic Design Classification

Regulatory Guide 1.29 defines systems required to withstand a safe shutdown earthquake (SSE).

Duke commits to the applicable regulatory position guidance provided in this regulatory guide for Nuclear Plant Development with the exception of Criteria C.1.d, C.1.g, and C.1.n. Refer to the Westinghouse AP1000 Design Control Document, Appendix 1A, for a detailed discussion of these exceptions.

**Regulatory Guide 1.37**, Revision 1, March 2007 – Requirements for Cleaning of Fluid Systems and Associated Components of Water-Cooled Nuclear Power Plants

Regulatory Guide 1.37 provides guidance on specifying water quality and precautions related to the use of alkaline cleaning solutions and chelating agents.

Duke commits to the applicable regulatory position guidance provided in this regulatory guide for Nuclear Plant Development.

#### **Standards:**

**ASME NQA-1-1994 Edition** – Quality Assurance Requirements for Nuclear Facility Applications

Duke commits to NQA-1-1994, Parts I and II, as described in the foregoing sections of this document.

## **Nuclear Plant Development Quality Assurance Program Description**

---

### **Nuclear Information and Records Management Association, Inc. (NIRMA) Technical Guides (TGs)**

Duke commits to NIRMA TGs as described in Part II, Section 17 of this document.