



LA CROSSE BOILING WATER REACTOR  
(LACBWR)


OFFSITE DOSE CALCULATION MANUAL

Prepared by:  12/3/08  
Date

Health Physics Review:  12-10-8  
Date

Radiation Protection Engineer Review:  12-17-08  
Date

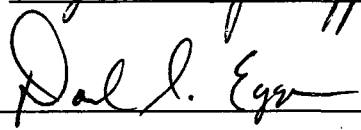Quality Assurance Review:  12/29/08  
Date

ORC Approved:  12/30/08  
Date

December 2008

Revision 11

Dairyland Power Cooperative  
3200 East Avenue South  
La Crosse, WI 54602-0817

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

## TABLE OF CONTENTS

1. INTRODUCTION.....	1
1.1 Purpose.....	1
1.2 Definitions.....	1
2. OFFSITE DOSE CALCULATIONS.....	5
2.1 Compliance with the Limitations for Liquid Effluent Releases.....	5
2.2 Compliance with the Limitations for Gaseous Effluent Releases.....	12
3. RADIOACTIVE EFFLUENT CONTROL PROGRAM.....	35
3.1 Program Requirements.....	35
3.2 Liquid Effluents.....	36
3.2.1 Sampling and Analysis.....	36
3.2.2 Liquid Effluent Release Limitation.....	38
3.2.3 Liquid Effluent Instrumentation.....	39
3.3 Gaseous Effluents.....	43
3.3.1 Reactor Building Ventilation.....	43
3.3.2 Stack Effluent Sampling and Analyses.....	43
3.3.3 Stack Effluent Release Limitation.....	45
3.3.4 Instrumentation.....	49
3.4 Total Dose to a Member of the Public.....	53
4. RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM.....	55
4.1 Program Requirements.....	55
4.2 REMP Description.....	56
4.3 REMP Lower Limits of Detection.....	59
4.3.1 Calculation of Lower Limits of Detection.....	60
4.4 Interlaboratory Comparison Program.....	62
4.5 Reporting Requirements.....	62

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

## LIST OF TABLES

2.1	Infant Dose Factors $P_{it}$ (Inhalation) for H-3 and Particulate Gaseous Release Monitor Alarm Setpoint Determinations.....	24
3.1	Radioactive Liquid Waste Sampling and Analysis Requirements for Batch Releases.....	37
3.2	Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements.....	41
3.3	Radioactive Gaseous Waste Sampling and Analysis.....	44
3.4	Radioactive Gaseous Effluent Monitoring Instrumentation.....	51
3.5	Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements.....	52
4.1	Radiological Environmental Monitoring Program.....	57
4.2	Environmental Sample Analyses Lower Limits Values (LLD).....	61
4.3	Reporting Levels for Radioactivity Concentrations in Environmental Samples.....	64

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re Seymour J. Raffety	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	--	------------------

## LIST OF FIGURES

2.1	Liquid Release Monitor Alarm Setpoint Determination.....	8
2.2	Noble Gas (Kr-85) Release Monitor Alarm Setpoint Calculations.....	16
2.3	Noble Gas (Kr-85) Release Monitor Alarm Setpoint Summary.....	17
2.4	H-3 and Particulate Gaseous Release Monitor Alarm Setpoint Determination.....	22
2.5	H-3 and Particulate Gaseous Release Monitor Alarm Setpoint Summary.....	23
2.6	Air Dose Commitment to a Member of the Public from Noble Gas (Kr-85) Release.....	27

## LIST OF DIAGRAMS

1.1	Site Map, Including Effluent Release Boundary.....	4
-----	--	---

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

## 1.0 INTRODUCTION

### 1.1 Purpose

The OFFSITE DOSE CALCULATION MANUAL (ODCM) contains the methodology and parameters used in (1) the calculation of offsite doses resulting from radioactive gaseous and liquid effluents from LACBWR, and (2) the calculation of gaseous and liquid effluent monitoring Alarm/Trip Setpoints. The ODCM also contains the Radioactive Effluent Controls and Radiological Environmental Monitoring Programs.

### 1.2 Definitions

#### CHANNEL CALIBRATION

A CHANNEL CALIBRATION shall be the adjustment, as necessary, of the channel output such that it responds with the necessary range and accuracy to known values of the parameter which the channel monitors. The CHANNEL CALIBRATION shall encompass the entire channel including the sensor and alarm and/or trip functions, and shall include the CHANNEL FUNCTIONAL TEST. The CHANNEL CALIBRATION may be performed by any series of sequential, overlapping or total channel steps such that the entire channel is calibrated.

#### CHANNEL CHECK

A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other

Prepared or Revised By	Date	Rad. Prot. Engineer Re.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/20/08

indications and/or status derived from independent instrument channels measuring the same parameter.

### CHANNEL FUNCTIONAL TEST

A CHANNEL FUNCTIONAL TEST shall be:

- a. Analog channels - the injection of a simulated signal into the channel as close to the sensor as practicable to verify OPERABILITY including alarm and/or trip functions and channel failure trips.
- b. Bistable channels - the injection of a real or simulated signal into the sensor to verify OPERABILITY including alarm and/or trip functions.

### EFFLUENT RELEASE BOUNDARY

The Dairyland Power Cooperative property line within the 1109 ft. (338m) radius EXCLUSION AREA is the EFFLUENT RELEASE BOUNDARY.

(See Diagram 1.1.)

### EXCLUSION AREA

The EXCLUSION AREA is defined as the area within an 1109 ft. (338m) radius from the centerline of the Reactor Building. This was the area established per 10 CFR 100 as the EXCLUSION AREA for plant siting and operation.

### MAXIMUM PERMITTED CONCENTRATION (MPC)

The limiting liquid effluent concentration value 10 CFR 20, Appendix B, Table 2, Column 2.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/12/08
---	------------------	--	------------------	--	------------------

## MEMBER OF THE PUBLIC

MEMBER OF THE PUBLIC shall mean an individual in a CONTROLLED or UNRESTRICTED AREA. However, an individual is not a MEMBER OF THE PUBLIC during any period in which the individual receives an occupational dose.

## OPERABLE-OPERABILITY


A system, subsystem, train, component or device shall be OPERABLE or have OPERABILITY when it is capable of performing its specified function(s) and when all necessary attendant instrumentation, controls, a normal or an emergency electrical power source, cooling or seal water, lubrication or other auxiliary equipment that are required for the system, subsystem, train, component or device to perform its function(s) are also capable of performing their related support function(s).

## SOURCE CHECK

A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to a radioactive source.

Diagram 1.1

# SITE MAP INCLUDING EFFLUENT RELEASE BOUNDARY

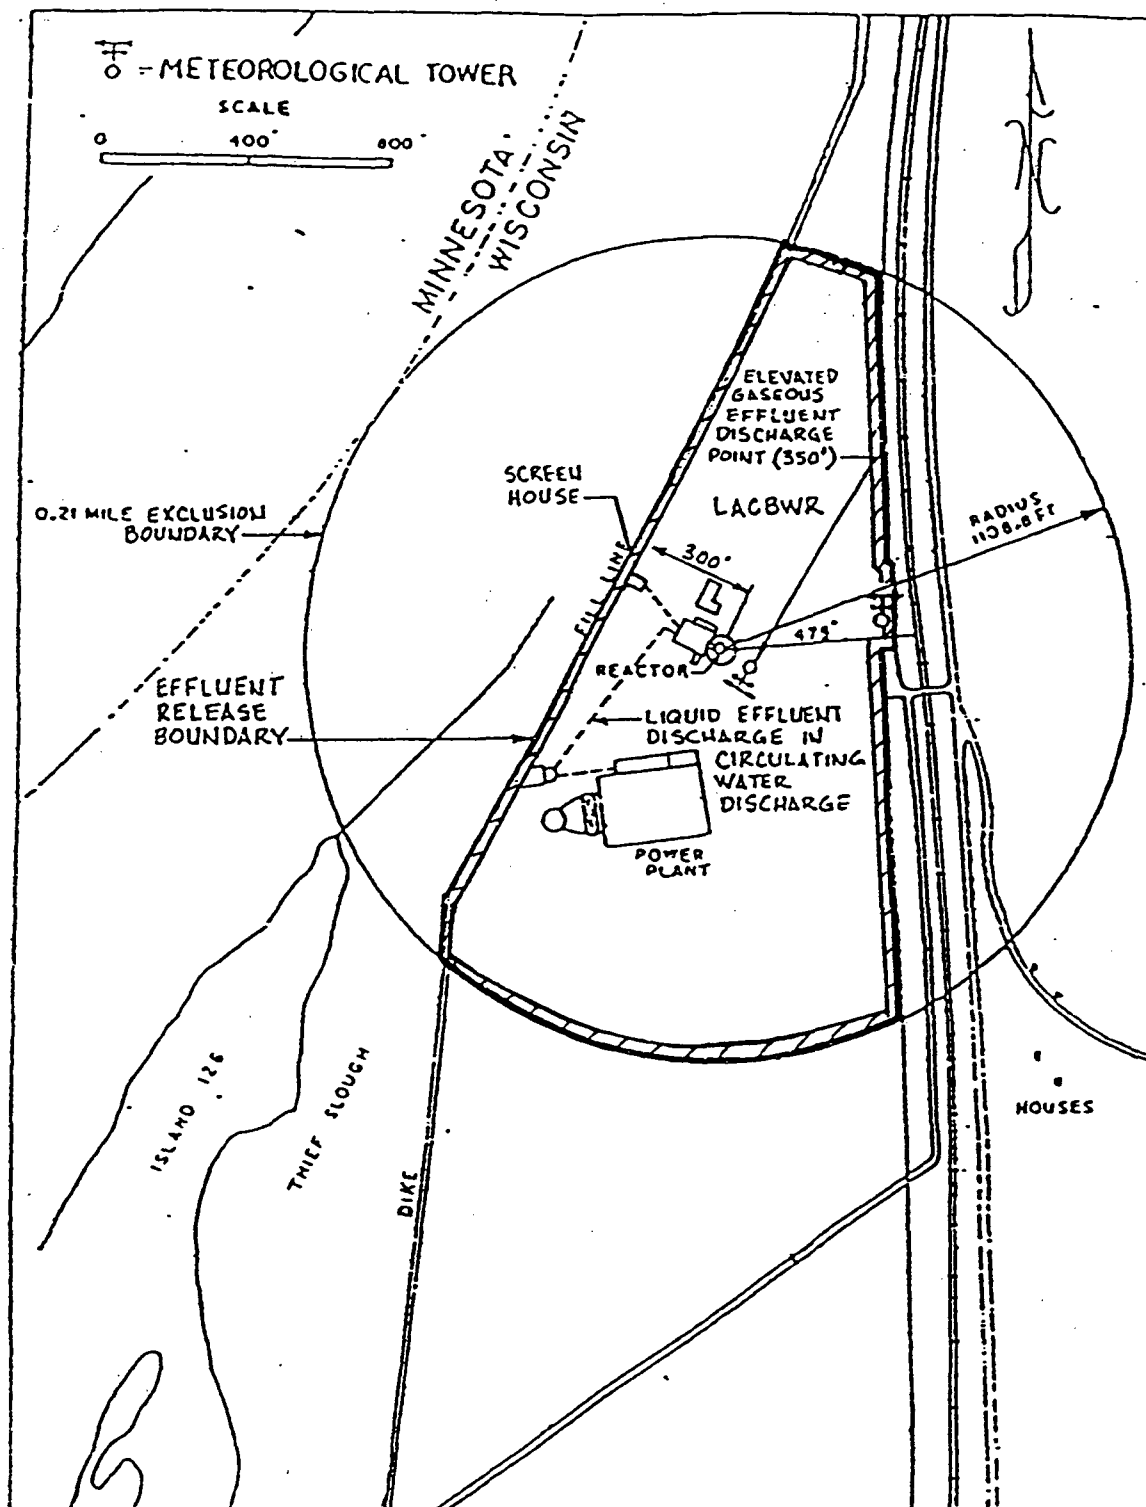

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm.	Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	<i>[Signature]</i>	12/17/08



## 2.0 OFFSITE DOSE CALCULATIONS

### 2.1 Compliance with the Limitations for Liquid Effluent Releases

- a) To assure compliance with the limitations of Section 3.2.2.a, Radioactive Effluent Control Program (RECP), the radioactivity monitor alarm setpoint is calculated for the monitor as a function of the maximum effluent flow rate and the minimum dilution flow rate. The following equation is used to calculate setpoints:

$$\frac{af}{k(F + f)} \leq C \quad (2.1)$$

where:

C = the effluent concentration limit implementing 10 CFR 20 for LACBWR, in  $\mu\text{Ci/ml}$ .

a = the setpoint (in CPS above background) of the radioactivity monitor measuring the radioactivity concentration in the effluent line prior to dilution and subsequent release; the setpoint, which is inversely proportional to the volumetric flow of the effluent line (f) and proportional to the volumetric flow of the dilution stream plus the effluent stream (F + f), represents a value which, if exceeded, could result in concentrations exceeding the limits of 10 CFR 20.

k = the conversion factor, cps per  $\mu\text{Ci/ml}$ , for the liquid waste effluent monitor based upon most recent calibration of the monitor.

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty		12/20/08

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	[Signature]	12/29/08

$f$  = the effluent line volumetric flow setpoint as measured at the radiation monitor location, in gallons per minute.

$F$  = the dilution stream (LACBWR & Genoa Station No. 3 [G-3] Condenser Cooling Water) volumetric flow, in gallons per minute.

Since  $f \ll F$ , Equation 2.1 is satisfied when the following discharge line radioactivity monitor setpoint is met:

$$a \leq \frac{kCF}{f} \quad (2.2)$$

#### Calculation of Instantaneous Allowable Release Rates

LACBWR's liquid radwaste is released in batches. In order to assess the required radioactive liquid effluent line monitor setpoint,  $a$ , the following step-by-step method for obtaining data will be performed. The form presented in Figure 2.1 may be used as a worksheet for these calculations. The alarm setpoint calculation may be performed on an annual basis if the setpoint is determined to be sufficiently conservative so as to prevent exceeding 0.5 MPC at the discharge point where MPC is the isotope weighted effluent concentration release limit for a typical LACBWR waste batch based on 10CFR20, appendix B, Table 2, Col. 2 values.

1. Go to Figure 2.1 Enter the date on the form.
2. Enter the concentration  $C_i$  ( $\mu\text{Ci/ml}$ ) for each isotope  $i$ , in a typical LACBWR waste batch.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

3. The values of  $f$  and  $F$  are determined and recorded at the top of Figure 2.1.  $F$  is the minimum volumetric dilution flow rate during releases at the LACBWR - G-3 outfall which is equal to the LACBWR condenser cooling water flow rate plus the G-3 condenser cooling water volumetric flow, in gallons per minute. The value  $f$  is the maximum radioactive liquid release flow rate (GPM) for the batches discharged during the period. A value of 17 GPM is normally specified for  $f$ .
4. The quantities  $\sum C_i$ , and  $\sum C_i/MPC_i$  are determined and recorded.
5. The monitor conversion factor,  $k$ , determined at last primary calibration is recorded on Figure 2.1, in cps (net) per  $\mu\text{Ci/ml}$ .
6. The alarm setpoint,  $a$  (cps), with a 0.5 factor for conservatism, for the monitor measuring radioactivity in the liquid effluent line is then determined by:

$$a = \frac{0.5 k F \sum C_i}{f \sum C_i/MPC_i} \quad (2.3)$$

Figure 2.1

LIQUID RELEASE MONITOR  
ALARM SETPOINT DETERMINATION

Date \_\_\_\_\_

Maximum Liquid Release Rate for Period,  $f$  = \_\_\_\_\_ GPM

Minimum Dilution Flow Rate for Period,  $F$  = \_\_\_\_\_ GPM

Nuclide $i$	Average Concentration (in Tanks), $C_i$ ( $\mu\text{Ci/ml}$ )	$\text{MPC}_i$ (10 CFR Part 20, Appendix B Table 2, Col. 2)	$C_i/\text{MPC}_i$
Co-60		3 E-06	
Cs-137		1 E-06	
Cs-134		9 E-07	
Sr-90		5 E-07	
Fe-55		1 E-04	
$\sum C_i$ =		$\sum C_i/\text{MPC}_i$ =	

Monitor Conversion Factor,  $k$  = \_\_\_\_\_  $\frac{\text{cps}(\text{net})}{\mu\text{Ci/ml}}$

$$a_{(\text{alarm setpoint})} \leq \frac{0.5 k F \sum C_i}{f \sum C_i/\text{MPC}_i} = \text{_____ cps above background}$$

Prepared or Revised By: LARRY L. NELSON  
Date: 12/02/08  
Rad. Prot. Engineer Re. w. Seymour J. Rafferty  
Date: 12/02/08  
Operations Review Comm. Approval: [Signature]  
Date: 12/30/08

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

- b) To demonstrate compliance with the limitations of Section 3.2.2.b, dose contributions are calculated at a maximum interval of once every calendar quarter for all radionuclides identified in liquid effluents released to unrestricted areas using the methodology presented in NRC Regulatory Guide 1.109, Rev. 1, October 1977. This methodology takes the form of the following general equation:

$$D_{a\tau} = \sum_i (A_{ait} \sum_{j=1}^m C_{ij}/F_j) \quad (2.4)$$

where:

$D_{a\tau}$  = the cumulative dose commitment to the total body or any organ  $\tau$  of an individual in age group  $a$  from the liquid effluents released in  $m$  batches, in mRem.

$C_{ij}$  = the total quantity of radionuclide  $i$ , released by batch  $j$ , in Ci.

$A_{ait}$  = the site-related ingestion dose commitment factor to the total body or any organ  $\tau$  of an individual in age group  $a$  for each identified principal gamma and/or beta emitter, in mRem-gal-min<sup>-1</sup>-Ci<sup>-1</sup>.

$F_j$  = the average dilution water flow rate during batch release  $j$  in gallons/minute.

Equation 2.4 requires the use of a dose factor  $A_{ait}$  for each nuclide, organ and individual in age group  $a$  which includes the factors which determine the ultimate dose received such as pathway transfer factors (e.g., bioaccumulation factors), pathway usage factors, ingestion dose factors and dilution factors. The following philosophy and site-specific conditions determine the site-specific factors

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/20/08

incorporated into the liquid effluent dose calculation model:

1. Liquid Dose Pathways

Due to LACBWR's status as a fresh water site, there is no invertebrate pathway. The drinking water pathway is not included, since the nearest community which obtains its drinking water supply from the Mississippi River is located at Davenport, Iowa, which is 195 miles downstream. The drinking water pathway represents < 0.01% of the dose to any organ. The irrigated foods pathway is not included since the river water is not used for irrigation in this area and the shoreline deposits pathway is insignificant for the Mississippi River. The only significant dose pathway is the dose commitment due to ingestion of fish from the Mississippi River waters.

2. Dilution

The liquid effluent flow from the waste tanks is diluted by the combined total circulating water flow for condenser cooling at both LACBWR and G-3. For offsite dose calculations, no dilution by the Mississippi River flow is considered. Also, under SAFSTOR conditions batch discharges of liquid effluent normally take place during less than 35 hours per month (< 5% of the time). Therefore, no fish in the river are continuously exposed to a radioactive environment produced by LACBWR liquid effluent as assumed in the calculation of the published bioaccumulation factors for fish.

Based on the above site-specific criteria, the dose factor  $A_{ait}$  is defined as follows:

$$A_{ait} = K_o (UF_a)(BF_i)(DF_{ait}) \quad (2.5)$$

where:

$$K_o = \text{a units conversion constant, } 5.03 \text{ E5} =$$

$$(1 \text{ E12 pCi/Ci} \times .2642 \text{ gal/} \ell) / (8760 \text{ hrs/yr} \times 60 \text{ min/hr}).$$

$UF_a$  = fish consumption usage factor for an individual in age group  $a$ , in kg/yr.

$BF_i$  = the bioaccumulation factor in fish for nuclide  $i$ , in pCi/kg per pCi/  $\ell$ .

$DF_{ait}$  = the ingestion dose factor for age group  $a$  for nuclide  $i$ , in organ  $\tau$  in mRem/pCi.

### Calculation of Dose Commitments from Liquid Effluents

The equations for this calculation have been formatted on a computer-based spreadsheet. The values of  $UF_a$ ,  $BF_i$ , and  $DF_{ait}$  specified in NRC Regulatory Guide 1.109 Rev. 1, October 1977, and the constant  $K_o$  have been entered on the spreadsheet.

To perform the calculation the following information is entered in the appropriate cells of the spreadsheet for each liquid batch released during the period of interest:

1. Date
2. Release interval, hrs
3. Waste volume, gal
4. Condenser cooling water flow rate, GPM
5. Activity concentration of each isotope,  $i$ , in waste,  $\mu\text{Ci/ml}$ .

The spreadsheet program will then calculate and display the total quarterly dose in mRem to the total body and each organ of an individual in each age group. The cumulative calendar year doses and the percentage of the limits set forth in Section 3.2.2.b are also calculated. This spreadsheet will also print the data tables for the liquid effluent section of the annual report.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Reviewed Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

## 2.2 Compliance with the Limitations for Gaseous Effluent Releases

- a) To assure compliance with the limitations of Section 3.3.3.a, alarm setpoints are established for the gaseous effluent monitor. These setpoints are calculated or checked annually, or as required by procedure, to confirm that the current setpoints are set correctly for one- or two-stack blower operation.

During SAFSTOR, the offgas treatment system from the condenser to the stack is no longer in operation since the plant is shut down. The principal potential gaseous release pathway is from the Reactor Building ventilation exhaust system. The only noble gas potentially available for release from the facility is Kr-85. The irradiated fuel assemblies stored in the Fuel Element Storage Well (FESW) contain essentially all the Kr-85 inventory. There is a very small potential for a Kr-85 release from the Waste Treatment and Turbine Building ventilation exhaust systems. This would be possible only if FESW water containing Kr-85 were transferred to the Spent Resin Receiving Tank (SRRT) or the Waste Water Tanks (WWT). Activity in particulate form and H-3 can theoretically be released via any of these release pathways. There will be no radioiodine (I-131, I-133) releases since they are no longer being produced and, since shutdown, any residual activity has decayed to insignificant levels.

### Noble gases

The following mathematical relationships shall be used to implement the above requirements for noble gas (Kr-85) release alarm setpoints:

$$D = \frac{T}{K' Q (x/Q)} \text{ (DFB)}$$



Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

$$= K' Q_v F_s (x/Q) (DFB) \quad (2.6)$$

$$\begin{aligned} D &= K' [1.11 Q(x/Q) DF^Y + Q(x/Q) (DFS)] \\ &= K' Q_v F_s (x/Q) (1.11 DF^Y + DFS) \end{aligned} \quad (2.7)$$

where:

- T  
D = the dose rate in mRem/yr to the total body of an individual beyond the EFFLUENT RELEASE BOUNDARY due to Kr-85. This value is to be less than 500 mRem/yr.
- K' = unit conversion constant, 1E6 pCi/μCi.
- F<sub>s</sub> = volume flow rate in stack, cc/sec.
- Q = average Kr-85 release rate, μCi/sec.
- Q<sub>v</sub> = average Kr-85 release concentration, μCi/cc.
- (x/Q) = atmospheric dispersion coefficient for instantaneous releases. (For the FAST alarm setpoint, 6.05 E-5 sec/m<sup>3</sup> is used, based upon Regulatory Guide 1.3 criteria. For the SLOW alarm setpoint, 3.90 E-6 sec/m<sup>3</sup> is used, based upon actual historical monthly average x/Q values at the worst case receptor location.)
- DFB = the total body gamma dose factor for exposure to a semi-infinite cloud of Kr-85 = 1.61 E-5 mRem-m<sup>3</sup> per pCi-yr.
- S  
D = the dose rate to the skin of an individual at or beyond the EFFLUENT RELEASE BOUNDARY due to Kr-85. This value is to be less than 3000 mRem/yr.
- 1.11 = the ratio of the tissue to air energy absorption coefficients over the energy range of photons of interest. This converts dose (mRad) to dose equivalent (mRem).
- DF<sup>Y</sup> = the gamma air dose factor for exposure to semi-infinite cloud of Kr-85 = 1.72 E-5 mRad-m<sup>3</sup> per pCi-yr.
- DFS = the skin beta dose factor for exposure to a semi-infinite cloud of Kr-85 = 1.34 E-3 mRem-m<sup>3</sup> per pCi-yr.

Prepared or Revised By	Date	Rad. Prot. Engineer Re.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	[Signature]	12/30/08

**NOTE:** Equations 2.6 and 2.7 incorporate the use of the semi-infinite plume model. The model assumes receptor submersion in a plume of uniform concentration, which is semi-infinite in geometry, having as its only boundary the ground plane. Due to the meteorology and topography at the La Crosse Site, the worst receptor locations are a bluff 1300 m SSE and a bluff 600 m ENE of the facility. At these locations the receptor is submerged in the plume.

#### Calculation of Instantaneous Release Rate Monitor Setpoints for Noble Gases (Kr-85)

Equations 2.6 and 2.7 are used to calculate the controlling instantaneous release rate setpoints for dose rates to the total body and skin of an individual due to Kr-85 for one- and two-blower operation.

The DFB, DF<sup>Y</sup> and DFS values for Kr-85 are multiplied by the appropriate  $x/Q$  value, the conversion constants and the stack flow rate for one- or two-stack blower operation to obtain the values for TBF, SFG and SFB which are then inserted into the following equations to determine gaseous release monitor alarm setpoints,  $Q_{vs}$ :

$$Q_{vs} \text{ (Whole Body)} = \frac{(500 \text{ mRem/yr})}{(\text{TBF})} \quad (2.8)$$

$$Q_{vs} \text{ (Skin)} = \frac{(3000 \text{ mRem/yr})}{(\text{SFG} + \text{SFB})} \quad (2.9)$$

where:

$$\text{TBF} = (1\text{E}6) (x/Q) (\text{DFB}) (F_s)$$

$$\text{SFG} = (1.11\text{E}6) (x/Q) (\text{DF}^Y) (F_s)$$

$$\text{SFB} = (1\text{E}6) (x/Q) (\text{DFS}) (F_s)$$

The smaller of the two values calculated is used for the setpoint. This instantaneous release rate setpoint is very conservative since it is the average release rate allowed for a whole year.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Review Seymour J. Raffety	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

The following step-by-step procedure may be used in conjunction with the equations found on Figure 2.2 to calculate the instantaneous release rate limits for Kr-85 for one- or two-stack blower operation:

1. On Figure 2.2, enter the date that the alarm setpoint calculation is performed.
2. Note the appropriate value for  $x/Q$ .
3. Note the appropriate value of  $F_s$  and the number of stack blowers operating for the condition being calculated.
4. Using the equations at the top of Figure 2.2, calculate the values of TBF, SFG and SFB for one- and two-blower operation and for all appropriate  $x/Q$ 's, using the DFB,  $DF^Y$  and DFS values for Kr-85 listed on Figure 2.2.
5. Calculate the values of  $Q_{vs}$  for each case. Select the smallest  $Q_{vs}$  value for each  $x/Q$  which will become the FAST and SLOW alarm setpoints for the noble gas monitor.
6. The  $Q_{vs}$  values (alarm setpoints) are tabulated on Figure 2.3.

**NOTE:** These alarm setpoints ( $Q_{vs}$ ) will not need to be recalculated during SAFSTOR unless: (1) limits are changed, (2)  $x/Q$  values are changed, (3) dose factors are changed, or (4) volume flow rate in the stack changes.

Figure 2.2

# NOBLE GAS (KR-85) RELEASE MONITOR ALARM SETPOINT CALCULATIONS

Calculation for Alarm Condition (FAST or SLOW) \_\_\_\_\_

$x/Q$  = \_\_\_\_\_ No. of Stack Blowers = \_\_\_\_\_  $F_s$  = \_\_\_\_\_

## Equations:

$$TBF = (1E6) (x/Q) (DFB) (F_s)$$

$$SFG = (1.11 E6) (x/Q) (DF^y) (F_s)$$

$$SFB = (1E6) (x/Q) (DFS) (F_s)$$

where:

$$(x/Q) = \begin{matrix} 6.05 E-5 \text{ sec/m}^3 & \text{or} & 3.90 E-6 \text{ sec/m}^3 \\ \text{(FAST)} & & \text{(SLOW)} \end{matrix}$$

$$DFB = 1.61 E-5 \frac{\text{mRem-m}^3}{\text{pCi-yr}}$$

$$DF^y = 1.72 E-5 \frac{\text{mRad-m}^3}{\text{pCi-yr}}$$

$$DFS = 1.34 E-3 \frac{\text{mRem-m}^3}{\text{pCi-yr}}$$

$$F_s = \begin{matrix} 1.65 E7 \text{ cc/sec} & \text{or} & 3.304 E7 \text{ cc/sec} \\ \text{(1 blower)} & & \text{(2 blowers)} \end{matrix}$$

---


$$TBF = \frac{\text{mRem-cc}}{\mu\text{Ci-yr}}$$

$$SFG+SFB = \text{_____} + \text{_____} = \frac{\text{mRem-cc}}{\mu\text{Ci-yr}}$$


---

$$Q_{vs} \text{ (whole body)} = \frac{500 \text{ mRem/yr}}{TBF} = \text{_____} \mu\text{Ci/cc}$$

$$Q_{vs} \text{ (skin)} = \frac{3000 \text{ mRem/yr}}{(SFG + SFB)} = \text{_____} \mu\text{Ci/cc}$$

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	[Signature]	12/30/08

**Figure 2.3**

**NOBLE GAS (Kr-85) RELEASE MONITOR**  
**ALARM SETPOINT SUMMARY**  
 (μCi/cc in stack effluent)

$Q_{vs}$	<u>FAST ALARM SETPOINT</u>		<u>SLOW ALARM SETPOINT</u>	
	1 BLOWER	2 BLOWERS	1 BLOWER	2 BLOWERS
WHOLE BODY	3.11 E-2	1.55 E-2	4.82 E-1	2.40 E-1
SKIN	2.21 E-3	1.10 E-3*	3.43 E-2	1.71 E-2*

- \* Since Kr-85's beta dose equivalent component is significantly higher than its gamma dose component, the noble gas monitor alarm setpoints will always be based upon the  $Q_{vs}$  for skin dose. Since the alarm setpoints for 2 blowers are the most restrictive, they may be used for all operating conditions without exceeding the limits for instantaneous release.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

### H-3 and Particulates

The following mathematical relationship shall be used to implement the limitation for H-3 and Particulates with  $T_{1/2} > 8$  days alarm setpoints:

$$D_{P\tau} = \sum_i P_{i\tau} Q_{Pi} (x/Q) \quad (2.10)$$

where:

$D_{P\tau}$  = the dose rate to organ  $\tau$  of an individual at or beyond the EFFLUENT RELEASE BOUNDARY, due to H-3 and particulates with half-lives greater than 8 days. This value is to be less than 1500 mRem/yr.

$P_{i\tau}$  = the dose parameter for organ  $\tau$ , for radionuclide  $i$ , for the inhalation pathway, in mRem-m<sup>3</sup> per  $\mu$ Ci-yr.

$x/Q$  = the atmosphere dispersion coefficient in sec/m<sup>3</sup>

$Q_{Pi}$  = release rate of nuclide  $i$ , in  $\mu$ Ci/sec.

### Calculation of Release Limits for H-3 and Particulates with Half-Lives Greater than 8 days

Since it is impractical to measure instantaneous release rates for radionuclides other than noble gases, the alarm setpoints for radionuclides other than noble gases are expressed in terms of total accumulated activity on sample media for a specified sampling time,  $\Delta T$ , which is monitored as  $\mu$ Ci by the stack effluent monitor.

Equation 2.11 is used to calculate the release rate limit for all H-3 and particulates with half-lives greater than 8 days. This equation is based on the dose rate to an infant due to inhalation of these radionuclides. In accordance with NUREG-0133, the infant will always receive the maximum dose rate. The atmospheric dispersion coefficients ( $x/Q$ )

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

used are 6.05 E-5 sec/m<sup>3</sup> for the calculation of the FAST alarm setpoint and 3.9 E-6 sec/m<sup>3</sup> for the SLOW alarm setpoint.

Alarm Setpoint Calculations for H-3 and Particulates with Half-Lives Greater than 8 days

$$Q_{P_{\tau}} = \frac{1500 \text{ mRem/yr}}{\sum_i [P_{i\tau} (\text{inhalation}) \times R_{pi}] (x/Q)} \quad (2.11)$$

where:

$Q_{P_{\tau}}$  = the maximum allowed total release rate of a typical mixture of radionuclides in  $\mu\text{Ci/sec}$  conservatively derived from the allowed annual average dose rate to organ  $\tau$  and very conservative  $x/Q$ .

$R_{pi}$  = the ratio of the activity of nuclide  $i$ , to the total activity of all nuclides other than noble gases in a typical mixture being released.

$x/Q$  = the atmospheric dispersion coefficient as given above for FAST or SLOW alarm respectively, in sec/m<sup>3</sup>.

Resolution of the  $P_{i\tau}$  term in Equation 2.11 yields:

$$P_{i\tau} (\text{inhalation}) = (10^6 \text{ pCi}/\mu\text{Ci}) (\text{BR}) (\text{DFA}_{i\tau}) \quad (2.12)$$

where:

$\text{DFA}_{i\tau}$  = the inhalation dose factor for an infant, for the  $i^{\text{th}}$  radionuclide, for organ  $\tau$ , in mRem/pCi.

BR = infant breathing rate, in m<sup>3</sup>/yr.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

To calculate the alarm setpoint in terms of total  $\mu\text{Ci}$  deposited on filter or cartridge sample media, the following equation is used:

$$Q_{sa} = \frac{\text{Lowest } Q_{Pr} \times \Delta F}{F_s} \quad (2.13)$$

where:

$Q_{sa}$  = the activity in  $\mu\text{Ci}$  (deposited on sample media in sample time  $\Delta T$ ) which initiates an appropriate alarm in the stack effluent monitor.

$Q_{Pr}$  =  $\mu\text{Ci/sec}$

$F_s$  = stack flow rate,  $\text{cc/sec}$

$\Delta F$  = total flow through sample media ( $\text{cc}$ ), in sample time  $\Delta T$ , corrected to stack gas conditions.  $\Delta T$  is normally 7 days.

The procedure outlined below is used to calculate the release limits for radionuclides other than noble gases. This will be done at least annually.

**NOTE:** This procedure is applicable for the determination of either FAST or SLOW alarms by utilizing the appropriate value for  $x/Q$  in the equation.

1. Start on Figure 2.4. Enter the date, the alarm setpoint being calculated, (FAST or SLOW) and the appropriate  $x/Q$  value to be used.
2. Enter the average release rate for the period,  $Q_{Pi}$ , in  $\mu\text{Ci/sec}$ , of each identified radionuclide. At the bottom of the form, compute and enter the sum  $\sum_i Q_{Pi}$ .



Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

3. In the column labeled  $R_{Pi}$ , enter the ratio of the average period release rate of nuclide  $i$  to the average total period release rate,  $\sum_i Q_{Pi}$ , for the period.
4. For each organ  $\tau$ , as noted at the top of the form, calculate and enter the value of  $(x/Q) (R_{Pi}) P_{i\tau}$  (inhalation) for each nuclide.  $P_{i\tau}$  (inhalation) values are found on Table 2.1. At the bottom of the column, for each organ, enter the value of  $\sum_i R_{Pi} P_{i\tau} (x/Q)$  for that organ.
5. Go to Figure 2.5. Enter the date and the alarm setpoint being determined.
6. Using the equation at the top of Figure 2.5, calculate the release rate limits,  $Q_{p\tau}$ , for each organ  $\tau$ .
7. Select the lowest value of  $Q_{p\tau}$ , enter at the bottom of Figure 2.5 under appropriate blower operation. Multiply the  $Q_{p\tau}$  number times the total sample flow through the sample media, cc, and divide this by the appropriate blower flow rate, cc/sec, to determine the  $Q_{sa}$  in  $\mu\text{Ci}$  and use these as alarm setpoints.

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

Figure 2.4

Date \_\_\_\_\_

### H-3 AND PARTICULATE GASEOUS RELEASE MONITOR ALARM SETPOINT DETERMINATION

Alarm being calculated (FAST or SLOW) \_\_\_\_\_

$x/Q$  \_\_\_\_\_ sec/m<sup>3</sup> \*

Nuclide i	$Q_{pi}$	$R_{pi}$	$(x/Q) R_{pi} P_{it}$ (inhalation) **						
			W Body	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI
H-3									
Co-60									
Sr-90									
Cs-134									
Cs-137									
Ce-144									
$\sum_i Q_{pi} =$		$\sum_i =$							

\* For FAST alarm use 6.05 E-5 sec/m<sup>3</sup> for  $x/Q$  and for SLOW Alarm use 3.90 E-6 sec/m<sup>3</sup>

\*\*  $P_{it}$  (inhalation) values found in Table 2.1.

Figure 2.5

### H-3 AND PARTICULATE GASEOUS RELEASE MONITOR ALARM SETPOINT SUMMARY

Calculation for (FAST or SLOW) \_\_\_\_\_ alarm.

$$Q_{P\tau} = \frac{1500 \text{ mRem/yr}}{\sum_i [P_{it} (\text{inhalation}) \times R_{Pi} \times x/Q]}$$

$Q_{P\tau}$  = maximum allowed total release rate,  $\mu\text{Ci/sec}$  to meet dose rate limit to organ  $\tau$ .

$\tau$	$\sum (x/Q) R_{Pi} P_{it} (\text{inhalation}) *$	$Q_{P\tau} (\mu\text{Ci/sec})$
Whole Body		
Bone		
Liver		
Thyroid		
Kidney		
Lung		
GI-LLI		

\* From Figure 2.4

#### One-Blower Operation

$$Q_{sa} = \frac{\text{Lowest } Q_{P\tau} \times \Delta F}{1.650E7}$$

where:

$\Delta F$  = corrected total flow through sample media, cc

$$Q_{sa} = \frac{\mu\text{Ci/sec} \times \text{cc}}{1.650 \text{ E7 cc/sec}}$$

$$= \text{_____} \mu\text{Ci}$$

#### Two-Blower Operation

$$Q_{sa} = \frac{\text{Lowest } Q_{P\tau} \times \Delta F}{3.304E7}$$

$$Q_{sa} = \frac{\mu\text{Ci/sec} \times \text{cc}}{3.304 \text{ E7 cc/sec}}$$

$$= \text{_____} \mu\text{Ci}$$

Prepared or Revised By	Date	Rad. Prot. Engineer R.	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	[Signature]	12/30/08

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

**Table 2.1**

**INFANT DOSE FACTORS  $P_{ir}$  (INHALATION) FOR H-3 AND PARTICULATE  
GASEOUS RELEASE MONITOR ALARM SETPOINT DETERMINATIONS**

In Units of mRem-m<sup>3</sup>/μCi-yr

Nuclide	Whole Body	Bone	Liver	Thyroid	Kidney	Lung	GI-LLI
H-3	6.47 E2	*	6.47 E2	6.47 E2	6.47 E2	6.47 E2	6.47 E2
CO-60	1.18 E4	*	8.02 E3	*	*	4.51 E6	3.19 E4
SR-90	2.59 E6	4.09 E7	*	*	*	1.12 E7	1.31 E5
CS-134	7.45 E4	3.96 E5	7.03 E5	*	1.90 E5	7.97E 4	1.33 E3
CS-137	4.55 E4	5.49 E5	6.12 E5	*	1.72 E5	7.13 E4	1.33 E3
CE-144	1.76 E5	3.19 E6	1.21 E6	*	5.38 E5	9.84 E6	1.48 E5

Values in this table are derived from Tables E-5 and E-10 in App. E of NRC Regulatory Guide 1.109 Rev. 1, October 1977.

\* No data available.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

- b) To demonstrate compliance with the limitations of Section 3.3.3.b, dose contributions are calculated for any Kr-85 released to unrestricted areas using the following expressions:

$$D^{\gamma}(r, \Theta) = 3.17 \text{ E-2 } DF^{\gamma} Q [x/Q] (r, \Theta) \quad (2.14)$$

$$D^{\beta}(r, \Theta) = 3.17 \text{ E-2 } DF^{\beta} Q [x/Q] (r, \Theta) \quad (2.15)$$

where:

$D^{\gamma}(r, \Theta)$  = the dose commitment to the maximum individual due to the gamma radiation from Kr-85 at location  $(r, \Theta)$ , in mRad.

$D^{\beta}(r, \Theta)$  = the dose commitment to the maximum individual due to the beta radiation from Kr-85 at location  $(r, \Theta)$ , in mRad.

$Q$  = the total release of Kr-85 in gaseous effluents for the release period, in  $\mu\text{Ci}$ .

$3.17 \text{ E-2}$  =  $\text{pCi}/\mu\text{Ci}$  divided by  $\text{sec/yr}$

$[x/Q] (r, \Theta)$  = the annual average atmospheric dispersion constant for long- term releases at location  $(r, \Theta)$ , in  $\text{sec}/\text{m}^3$ . Since the collection of hourly meteorological data is no longer required or performed at the LACBWR site, a conservative value based on historical site specific annual average  $x/Q$  values will be used. This value is  $1.82\text{E-6 sec}/\text{m}^3$ .

$DF^{\gamma}$  and  $DF^{\beta}$  = the gamma and beta air dose factors for exposure to a uniform semi-infinite cloud of Kr-85 in  $(\text{mRad}\cdot\text{m}^3/\text{pCi}\cdot\text{yr})$ . Numerical values are  $1.72\text{E-5}$  and  $1.95\text{E-3}$  respectively. (Ref. NRC Regulatory Guide 1.109 Rev. 1, October 1977.)

### Calculation of Gamma and Beta Air Dose Commitments

In accordance with the RECP, the gamma and beta air dose commitments are to be calculated once per calendar quarter and yearly. Equations 2.14 and 2.15 are used to perform these calculations. Since the only noble gas that needs to be considered at

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R <sub>e</sub> Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/20/08
---	------------------	---	------------------	--	------------------

LACBWR is Kr-85, and since a conservative constant value is used for  $x/Q$ , these equations reduce to:

$$D^Y = 9.923E-13Q$$

$$D^B = 1.125E-10Q$$

The following step-by-step procedure is used in conjunction with Figure 2.6 to calculate the quarterly cumulative dose commitments due to Kr-85.

1. Go to Figure 2.6. Enter the Date. Enter the period covered by the calculations.
2. Enter the total Kr-85 activity released in the gaseous effluent during the period being considered, in  $\mu\text{Ci}$ .
3. Calculate the dose commitments  $D^Y(r, \Theta)$  and  $D^B(r, \Theta)$  due to Kr-85 using the equations on Figure 2.6.
4. Calculate the percent of the current quarterly and annual release limits and enter on Figure 2.6.

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

**Figure 2.6**

Date \_\_\_\_\_

# **AIR DOSE COMMITMENT TO A MEMBER OF THE PUBLIC FROM NOBLE GAS (Kr-85) RELEASE**

Release Period \_\_\_\_\_

Total Kr-85 Act. Released, Q = \_\_\_\_\_  $\mu$ Ci

## Dose Calculation for Release Period

$$D^{\gamma} = 9.923 \text{ E-13 } Q = \text{_____ mRad}$$

$$D^{\beta} = 1.125 \text{ E-10 } Q = \text{_____ mRad}$$

## Limits

	<u>Gamma</u>	<u>Beta Particle</u>
Calendar Quarter	$\leq 5 \text{ mRad}$	$\leq 10 \text{ mRad}$
Calendar Year	$\leq 10 \text{ mRad}$	$\leq 20 \text{ mRad}$

## Current Air Dose Commitment Record for Calendar Year

	1st Quarter		2nd Quarter		3rd Quarter		4th Quarter		Calendar Year	
	Gamma	Beta	Gamma	Beta	Gamma	Beta	Gamma	Beta	Gamma	Beta
Dose, mRad										
% of Limit										

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R.C. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

- c) To demonstrate compliance with the limitations of Section 3.3.3.c, dose contributions are calculated for H-3, and particulates with half-lives greater than 8 days, identified in gaseous effluents released to unrestricted areas using the methodology presented in NRC Regulatory Guide 1.109, Rev 1, October 1977. This methodology takes the form of the following general equation:

$$D_{\tau a}(r, \Theta) = \sum_P \sum_i \mathbf{M}_{ita}^P W(r, \Theta) Q_i \quad (2.16)$$

where:

$D_{\tau a}(r, \Theta)$  = the dose commitment to organ  $\tau$  of an individual in age group  $a$ , at a distance  $r$  in sector  $\Theta$  from the release point, due to the release to the atmosphere of radionuclides other than noble gases, in mRem.

$W(r, \Theta)$  = the average dispersion parameter for estimating the dose to an individual at the receptor location  $(r, \Theta)$ , for the period of release, in  $\text{sec}/\text{m}^3$  or  $\text{m}^{-2}$  as required by the characteristics of the exposure pathway.

$Q_i$  = the total activity of each radionuclide  $i$ , other than noble gases, in gaseous effluents for the release period of interest, in  $\mu\text{Ci}$ .

$\mathbf{M}_{ita}^P$  = the dose conversion factor for exposure pathway  $P$  to organ  $\tau$  of an individual in age group  $a$ , for each identified radionuclide  $i$ . The units of  $\mathbf{M}_{ita}^P$  are  $(\text{mRem}\cdot\text{m}^2)/\mu\text{Ci}$  or  $(\text{mRem}\cdot\text{m}^3)/\mu\text{Ci}\cdot\text{sec}$  as required so that the product  $\mathbf{M}_{ita}^P W(r, \Theta)$  is  $\text{mRem}/\mu\text{Ci}$ .

Equation 2.16 may be expanded to the following form where each term is the incremental dose received via one of the three major dose pathways.

$$D_{\tau a}(r, \Theta) = \sum_i D_{ita}^G(r, \Theta) + D_{ita}^A(r, \Theta) + D_{ita}^D(r, \Theta) \quad (2.17)$$



Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Review Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

where the first term on the right is the external dose from direct exposure to activity deposited on the ground plane, the second term is the dose from inhalation of radionuclides in air, and the third term is the dose from ingestion of foods contaminated by atmospheric releases of radionuclides.

Applying the methodology of NRC Regulatory Guide 1.109 Rev. 1, equation 2.17 is expanded as follows:

$$\begin{aligned}
 D_{\text{Ta}}(r, \theta) = & \sum_i M_{\text{ita}}^G Q_i (D/Q)(r, \theta) \\
 & + \sum_i M_{\text{ita}}^A Q_i (x/Q)(r, \theta) \\
 & + \sum_i M_{\text{ita}}^{\text{DV}} Q_i (D/Q)(r, \theta) + (M_{14\text{Ta}}^{\text{DV}} Q_{14} + M_{\text{Tta}}^{\text{DV}} Q_{\text{T}}) (x/Q)(r, \theta) \\
 & + \sum_i M_{\text{ita}}^{\text{DM}} Q_i (D/Q)(r, \theta) + (M_{14\text{Ta}}^{\text{DM}} Q_{14} + M_{\text{Tta}}^{\text{DM}} Q_{\text{T}}) (x/Q)(r, \theta) \\
 & + \sum_i M_{\text{ita}}^{\text{DM}} Q_i (D/Q)(r, \theta) + (M_{14\text{Ta}}^{\text{DM}} Q_{14} + M_{\text{Tta}}^{\text{DM}} Q_{\text{T}}) (x/Q)(r, \theta) \\
 & + \sum_i M_{\text{ita}}^{\text{DL}} Q_i (D/Q)(r, \theta) + (M_{14\text{Ta}}^{\text{DL}} Q_{14} + M_{\text{Tta}}^{\text{DL}} Q_{\text{T}}) (x/Q)(r, \theta)
 \end{aligned} \tag{2.18}$$

where:

$(x/Q)(r, \theta) =$  the annual average atmospheric dispersion factor for a receptor at the distance  $r$  in sector  $\theta$  from the release point, in  $\text{sec}/\text{m}^3$ . For the LACBWR in the SAFSTOR mode, the value for this term is conservatively taken to be the largest historical (1983-1987) undecayed/undepleted  $x/Q$  for a real receptor and is  $1.82\text{E}-6 \text{ sec}/\text{m}^3$ .

$(D/Q)(r, \theta) = 1.82\text{E}-9\text{m}^{-2}$ . This is based on the relationship  $D/Q = V_d x/Q$  where  $V_d$  = the deposition velocity in  $\text{m}/\text{sec}$ .  $V_d$  is generally  $\leq 1\text{E}-3\text{m}/\text{sec}$  for dry deposition of submicron aerosols which may be released from the LACBWR facility during SAFSTOR (Ref Whicker, F. W. and Schultz, V., Radioecology: Nuclear Energy and the Environment, Vol. II, CRC Press, Inc., Boca Raton, Florida, 1982).

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/20/08
---	------------------	---	------------------	--	------------------

$M_{ita}^G = 1.06 S_F DFG_{it} (1 - \exp(-\lambda_i t_b)) / \lambda_i$  and according to R.G. 1.109 the dose to all internal organs ( $\tau$ ) for all age groups ( $a$ ) is taken to be the same as the total body dose.

$$M_{ita}^A = 3.17E-2 BR_a DFA_{ita}$$

and for the ingestion pathway (DV) for produce (non-leafy-vegetables, fruits, and grains)

$$M_{ita}^{DV} = 1.1E2 DFI_{ita} U_a^V f_g \exp(-\lambda_i t_h) (r(1 - \exp(-\lambda_{Ei} t_e)) / Y_v \lambda_{Ei} + B_{iv} (1 - \exp(-\lambda_{ii} t_b)) / P \lambda_i)$$

for all radionuclides except C-14 and H-3

$$M_{14ta}^{DV} = 22 DFI_{14ta} U_a^V f_g p \quad \text{for C-14}$$

$$M_{Tta}^{DV} = 12 DFI_{Tta} U_a^V f_g / H \quad \text{for tritium}$$

for the ingestion pathway (Dm) for milk

$$M_{ita}^{DM} = 1.1E2 DFI_{ita} U_a^m F_{mi} Q_F \exp(-\lambda_i t_f) (f_p f_s (1 - \exp(-\lambda_i t_h)) + \exp(-\lambda_i t_h)) \times (r(1 - \exp(-\lambda_{Ei} t_e)) / Y_v \lambda_{Ei} + B_{iv} (1 - \exp(-\lambda_{ii} t_b)) / P \lambda_i)$$

for all radionuclide except C-14 and H-3

$$M_{14ta}^{DM} = 22 DFI_{14ta} U_a^m F_{mi} Q_F p(\exp(-\lambda_{14} t_f)) \quad \text{for C-14}$$

$$M_{Tta}^{DM} = 12 DFI_{Tta} U_a^m F_{mi} Q_F \exp(-\lambda_T t_f) / H \quad \text{for tritium}$$

for the ingestion pathway (DM) for meat

$$M_{ita}^{DM} = 1.1E2 DFI_{ita} U_a^M F_{fi} Q_F \exp(-\lambda_i t_s) (f_p f_s (1 - \exp(-\lambda_i t_h)) + \exp(-\lambda_i t_h)) \times (r(1 - \exp(-\lambda_{Ei} t_e)) / Y_v \lambda_{Ei} + B_{iv} (1 - \exp(-\lambda_{ii} t_b)) / P \lambda_i)$$

for all radionuclides except C-14 and H-3

$$M_{14ta}^{DM} = 22 DFI_{14ta} U_a^M F_{f14} Q_F p(\exp(-\lambda_{14} t_s)) \quad \text{for C-14}$$

$$M_{Tta}^{DM} = 12 DFI_{Tta} U_a^M F_{fT} Q_F \exp(-\lambda_T t_s) / H \quad \text{for tritium}$$

Prepared or Revised By	Date	Rad. Prot. Engineer Re.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

for the ingestion pathway (DL) for leafy vegetables:

$$M_{ita}^{DL} = 1.1E2 DFI_{ita} U_a^L f_e \exp(-\lambda_i t_h) (r(1 - \exp(-\lambda_{ei} t_e)) / Y_v \lambda_{ei} + B_{iv}(1 - \exp(-\lambda_i t_b)) / P \lambda_i)$$

for all radionuclides except C-14 and H-3.

$$M_{14ta}^{DL} = 22 DFI_{14ta} U_a^L f_{ep} \quad \text{for C-14}$$

$$M_{Tta}^{DL} = 12 DFI_{Tta} U_a^L f_e / H \quad \text{for tritium}$$

The values used for the various parameters in the above equations are those recommended in NRC Regulatory Guide 1.109, Rev. 1, for the maximum exposed individual.

Parameter		Dimensions	Description/Source
1.0E6		pCi/μCi	
DFG <sub>it</sub>		mRem-m <sup>2</sup> /pCi-hr	from table E-6 in R.G.
DFA <sub>ita</sub>		mRem/pCi inhaled	from table E-7 thru E-10 in R.G.
DFA <sub>14ta</sub>		mRem/pCi inhaled	from table E-7 thru E-10 in R.G.
DFA <sub>Tta</sub>		mRem/pCi inhaled	from table E-7 thru E-10 in R.G.
DFI <sub>ita+</sub>		mRem/pCi ingested	from tables E-11 thru E-14 in R.G.
DFI <sub>14ta</sub>		mRem/pCi ingested	from tables E-11 thru E-14 in R.G.
DFI <sub>Tta</sub>		mRem/pCi ingested	from tables E-11 thru E-14 in R.G.
S <sub>F</sub>	= 0.7	dimensionless	attenuation factor accounting for shielding by residential structures
λ <sub>i</sub>		hr <sup>-1</sup>	radiological decay constant for nuclide i.
t <sub>b</sub>	= 1.31x10 <sup>5</sup>	Hr	period of long-term buildup for activity in soil (nominally 15 yrs)
3.17x10 <sup>-2</sup>		pCi – yr/μCi – sec	
BR <sub>a</sub>		m <sup>3</sup> /yr	inhalation rate for age group a. Table E-5 in R.G.
1.1x10 <sup>2</sup>		pCi – yr/μCi – hr	

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

Parameter		Dimensions	Description/Source
$U_a^v$		kg/yr	consumption rate of produce for individual in age group a. Table E-5 of R.G.
$f_g$	= 0.76	Dimensionless	fraction of produce ingested that is grown in garden of interest.
$t_h$		hr	time delay between harvest of vegetation or crops and ingestion.
	= 0		for pasture grass by animals
	= 2160		for stored feed by animals
	= 24		for leafy vegetables by man
	= 1440		for produce by man
$r$	= 0.2	dimensionless	fraction of deposited activity retained on crops, leafy vegetables, or pasture grass.
$\lambda_{Ei}$	= $\lambda_i + \lambda_W$	hr <sup>-1</sup>	the effective removal rate constant for radionuclide i from crops.
$\lambda_W$	= .0021	hr <sup>-1</sup>	removal rate constant for activity on plant or leaf surfaces by weathering (~ to 14 day half-life)
$t_e$		hr	period of crop, leafy vegetable, or pasture grass exposure during growing season.
	= 720		for grass-cow-milk-man pathway
	= 1440		for crop/vegetation-man pathway
$Y_v$		kg/m <sup>2</sup>	agricultural productivity (measured in wet weight)
	= 0.7		for grass-cow-milk-man pathway
	= 2.0		for produce or leafy vegetables ingested by man
$B_{iv}$		dimensionless	pCi/kg in vegetation per pCi/kg in soil for nuclide i. Table E-1 in R.G.
$P$	= 240	kg/m <sup>2</sup>	effective surface density of soil (dry weight)
22		pCi - yr - m <sup>3</sup> /μCi - kg - sec	
$p$		dimensionless	the ratio of the total annual release time for C-14 to the total annual time during which photosynthesis occurs with the condition that $p \leq 1.0$

Prepared or Revised By	Date	Rad. Prot. Engineer Ref.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

Parameter		Dimensions	Description/Source
	= 1.0		for continuous C-14 releases.
12		$pCi - g - yr / \mu Ci - kg - sec$	
H	= 8.0	$g/m^3$	average absolute humidity of the atmosphere at location (r,0)
$U_a^m$		liters/yr	consumption rate of milk for individual in age group a. Table E-5 of R.G.
$F_{mi}$		day/l	factor for estimation of activity of nuclide i in milk from that in animal feed (pCi/l in milk per pCi/d ingested by the animal) Table E-1 in R.G.
$Q_F$	= 50	kg/day	feed or forage consumption rate (wet weight) by milk cow or beef cattle
$t_f$	= 48	hr	transport time from animal feed-milk-man.
$f_p$	= 0.5	dimensionless	fraction of the year that animals graze on pasture.
$f_s$	= 1.0	dimensionless	fraction of daily feed that is pasture when the animal is on pasture
$U_a^M$		kg/yr	consumption rate of meat & poultry for individual in age group a. Table E-5 of R.G.
$F_{fi}$		day/kg	factor for estimation of activity of nuclide i in meat from that in animal feed (pCi/kg in meat per pCi/day ingested by the animal) Table E-1 in R.G.
$t_s$	= 480	hr	average time from slaughter of meat animal to consumption of meat
$U_a^L$		kg/yr	consumption rate of leafy vegetables for individual in age group a. Table E-5 in R.G.
$f_e$	= 1.0	dimensionless	fraction of leafy vegetables grown in garden of interest.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/02/08
---	------------------	--	------------------	--	------------------

### Calculations of Dose Commitments due to Gaseous Release other than Noble Gases

In accordance with the RECP, the maximum commitment to a MEMBER OF THE PUBLIC from H-3 and all radionuclides in particulate form with half-lives greater than 8 days shall be determined at least quarterly.

To perform this calculation Eq 2.18 has been formatted on a computer-based spreadsheet. The quantity in curies of each nuclide (i) released to the atmosphere from the LACBWR facility during the calendar quarter is entered in the appropriate cell of the spreadsheet. The spreadsheet program calculates and displays the total quarterly dose in mRem to the total body and each organ of an individual in each of four age groups and the cumulative calendar year dose to the total body and each organ. It also determines the maximum exposed organ (and its dose) for each age group each quarter and the dose to the maximum exposed organ in all age groups. The quarterly and cumulative calendar year doses to the maximum exposed organ are compared to the limits and the relation in terms of percent of the limit is displayed. The maximum incremental organ dose received through each of the three major pathways is also determined for each age group each quarter.

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty		12/30/08

### 3.0 RADIOACTIVE EFFLUENT CONTROL PROGRAM

#### 3.1 Program Requirements

The Radioactive Effluent Control Program (RECP) shall conform to the guidance of 10 CFR 50.36a for the control of radioactive effluents and for maintaining the doses to MEMBERS OF THE PUBLIC from radioactive effluents as low as reasonably achievable. This program shall establish the requirements for monitoring, sampling and analysis of radioactive gaseous and liquid effluents released from LACBWR to ensure the concentrations in effluents released to areas beyond the EFFLUENT RELEASE BOUNDARY conform to 10 CFR Part 20, Appendix B, Table 2, Columns 1 and 2. It shall provide limitations on the annual and quarterly dose commitment to a MEMBER OF THE PUBLIC from radioactive effluents in conformance with Appendix I of 10 CFR Part 50.

The limitations of operability of gaseous and liquid monitoring instrumentation, including surveillance test and setpoint determination in accordance with Section 2.0, Offsite Dose Calculations, will be included in this program.

Requirements for the Reactor Building Ventilation System, including filtration and elevated stack release of exhausted air is included in Section 3.3.1.

In accordance with provisions of 40 CFR 190, the restrictions and surveillance requirements for total dose to any MEMBER OF THE PUBLIC from all LACBWR related sources and dose pathways are presented in Section 3.4.

### 3.2 Liquid Effluents

#### 3.2.1 Sampling and Analysis

All liquid effluent releases at LACBWR will be in batch form. A batch release is the discharge of liquid wastes of a discrete volume. Prior to sampling for analysis, each batch shall be isolated and then thoroughly mixed, to assure representative sampling. The radioactive content of each batch of radioactive liquid waste to be discharged shall be determined, as per the following table:

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08



**Table 3.1**

**RADIOACTIVE LIQUID WASTE SAMPLING AND ANALYSIS REQUIREMENTS**  
**FOR BATCH RELEASES**

	TYPE OF ACTIVITY ANALYSIS <sup>(c)</sup>	SAMPLING FREQUENCY	MINIMUM ANALYSIS FREQUENCY
1.	Principal Gamma emitters <sup>(b)</sup> Includes KR-85	Prior to discharge	Each discharge - prior to discharge
2.	Gross Alpha	Prior to discharge	Each discharge - prior to discharge
3.	Tritium	Prior to discharge	Each discharge
4.	Sr-90 and Fe-55 Beta emitters	Prior to discharge	Quarterly Composite <sup>(a)</sup>

(a) A composite sample is one made up of individual samples which are proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquid release.

(b) The principal gamma emitters for which the LLD specification will apply are exclusively the following radionuclides: Co-60, Cs-134, and Cs-137. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported.

(c) Methods of calculating the Lower Limits of Detection (LLD) shall be contained in plant procedures and are calculated in accordance with criteria of NUREG-0473, Rev. 2.

The results of pre-release analyses shall be used in accordance with the Offsite Dose Calculations methodology to assure that the concentration at the point of release is maintained within the limits specified in this RECP.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Raffety	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/2/08
---	------------------	---	------------------	--	-----------------

### 3.2.2 Liquid Effluent Release Limitation

- a) Concentration - the concentration of radioactive material released in liquid effluents at any time to areas beyond the EFFLUENT RELEASE BOUNDARY shall be limited to concentrations specified in 10 CFR Part 20, Appendix B, Table 2, Column 2.

If the concentration of radioactive material released beyond the EFFLUENT RELEASE BOUNDARY exceeds the above limits, restore the concentration to within the above limits without delay.

This limit is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than the concentration levels specified in 10 CFR Part 20, Appendix B, Table 2, Column 2.

- b) Dose - the dose or dose commitment to a MEMBER OF THE PUBLIC from radioactive materials in liquid effluents released to areas beyond the Effluent Release Boundary shall be limited to:

#### Calendar Quarter

$\leq 1.5$  mRem total body

$\leq 5$  mRem to any organ

#### Calendar Year

$\leq 3$  mRem total body

$\leq 10$  mRem to any organ

The cumulative dose contribution from liquid effluent shall be determined at least once per calendar quarter in accordance with Section 2.0, Offsite Dose Calculations. If this calculated dose exceeds the above limits, prepare and submit to the Commission, within 30 days, a Special Report which identifies the cause(s) for

repaired or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Raffety	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	--	------------------	--	------------------

exceeding the limit(s) and defines the corrective actions which have been or will be taken to assure that subsequent releases shall be in compliance with the above limits.

This limit is provided to implement the requirements of Sections II.A, III.A, IV.A and Annex of Appendix I, 10 CFR Part 50. The dose calculations in Section 2.0 implement the requirement in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated.

### 3.2.3 Liquid Effluent Instrumentation

The following radioactive liquid effluent monitoring instrumentation channels shall be OPERABLE, with their alarm setpoints set to ensure that the limits of Section 3.2.2.a are not exceeded, at all times when releasing liquid radioactive effluents.

- Liquid Radwaste Effluent Line Monitor
- and
- Liquid Radwaste Effluent Line Flow Meter

The alarm setpoints for this monitor will be determined and adjusted using methodology in Section 2.0, Offsite Dose Calculations.

The radioactive liquid effluent instrumentation is provided to monitor the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents with the alarm setpoints set to ensure that the alarm will occur prior to exceeding the limits of 10 CFR Part 20.

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	12/02/08	<i>[Signature]</i>	12/30/08

- a) Surveillance Requirements - each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL FUNCTIONAL TEST, and CHANNEL CALIBRATION operations at the frequencies shown in the following table.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Re. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/02/08
---	------------------	--	------------------	--	------------------

**Table 3.2**

**RADIOACTIVE LIQUID EFFLUENT MONITORING INSTRUMENTATION**  
**SURVEILLANCE REQUIREMENTS**

Instrument	Channel Check	Source Checks	Channel Functional Test	Channel Calibration
Liquid Radwaste Effluent Line Monitor	Prior to discharge	Prior to discharge (See Note 4)	Quarterly (See Note 1)	At least once per 18 months (See Note 3)
Liquid Radwaste Effluent Line Flow Meter	(See Note 2)	N/A	N/A	At least once per 18 months (See Note 5)

**NOTES:**

- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:  
Instrument indicates measured levels at the alarm setpoint.  
Instrument indicates a downscale (circuit failure) failure.
- (2) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days in which continuous, periodic, or batch releases are made.
- (3) The CHANNEL CALIBRATION shall include the use of a known liquid radioactive source positioned in a reproducible geometry with respect to the sensor. The source will have the gamma emitting radionuclide mixture and activity concentration which would normally be measured by the channel during batch discharges.
- (4) Background radiation may be used for the source check.
- (5) The CHANNEL CALIBRATION will be in accordance with plant procedures.

repaired or Revised By	Date	Rad. Prot. Engineer Review	Operations Review	Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	<i>[Signature]</i>	<i>[Signature]</i>	12/30/08

b) Corrective Action

- (1) With the Liquid Radwaste Effluent Line Monitor channel alarm/trip-point setpoint less conservative than that required by Section 3.2.2(a), immediately suspend the release or change the setpoint so that it is acceptably conservative.
- (2) With the Liquid Radwaste Effluent Line Monitor NOT OPERABLE, or if its alarm setpoint is found to be less conservative than required, suspend release of liquid radioactive effluent without delay. Effluent releases may be resumed without the Liquid Radwaste Effluent Line Monitor OPERABLE, provided that at least two independent samples are analyzed and that at least two technically qualified members of the staff independently verify the release rate calculations. If the monitor is not operable for more than 30 continuous days, explain in the next Annual Effluent Report.
- (3) With the flow meter not OPERABLE, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 4 hours during actual releases.

### 3.3 Gaseous Effluents

#### 3.3.1 Reactor Building Ventilation

Normal air discharge from LACBWR is made as an elevated stack release. Air is swept through the Turbine and Reactor Building and then discharged out the stack. Whenever the Reactor Ventilation dampers are open, the air from the Reactor Building shall be discharged through a set of HEPA particulate filters to reduce the amount of radioactive particulates being released to the environment. This filtration of the Reactor Building Ventilation System exhaust implements the requirements of 10 CFR Part 50.36a, General Design Criterion 60 of Appendix A to 10 CFR Part 50, and the design objectives given in Section II.D of Appendix I to 10 CFR Part 50.

With Reactor Building Ventilation System exhaust being discharged without filtration, prepare and submit to the Commission within 30 days a Special Report which discusses the circumstances and what action will be taken to prevent a recurrence.

#### 3.3.2 Stack Effluent Sampling and Analyses

The radioactive gaseous discharge from LACBWR will be sampled and analyzed as per the following table.

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	<i>[Signature]</i>	12/30/08

Table 3.3

RADIOACTIVE GASEOUS WASTE SAMPLING AND ANALYSIS

Release Type	Sampling Frequency	Minimum Analysis Frequency	Type of Activity Analysis <sup>(d)</sup>
Stack Effluent	Continuous <sup>(b)</sup>	Weekly <sup>(a)</sup> Particulate Sample	Principal Gamma Emitters <sup>(c)</sup>
	Continuous <sup>(b)</sup>	Quarterly Particulate Sample Composite	Sr-90
	Continuous <sup>(b)</sup>	Weekly <sup>(a)</sup> Particulate Sample	Gross Alpha
	Continuous <sup>(b)</sup>	Noble Gas Monitor	Noble Gases Gross Beta and Gamma
	Monthly	Monthly	H-3

NOTES:

- (a) The filter sample shall be changed at least weekly, and filter analyses shall be completed within seven (7) days.
- (b) The ratio of the sample flow rate to the sampled stream flow rate shall be known for the time period covered by each dose or dose rate calculation.
- (c) The principal gamma emitters for which the LLD specification applies exclusively are the following radionuclides: Mn-54, Co-60, Zn-65, Cs-134, Cs-137, and Ce-144 for particulate emissions. This list does not mean that only these nuclides are to be considered. Other gamma peaks that are identifiable and measurable, together with those of the above nuclides, shall also be analyzed and reported in the annual Radioactive Effluent Release Report.
- (d) Lower Limits of Detection (LLD) are determined in accordance with plant procedures and are calculated in accordance with criteria of NUREG-0473, Revision 2.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------



### 3.3.3 Stack Effluent Release Limitation

a) Instantaneous Dose Rate - the dose rate due to radioactive materials released in gaseous stack effluents to areas beyond the EFFLUENT RELEASE BOUNDARY shall be limited to:

- The dose rate limit for noble gases shall be  $\leq 500$  mRem/year to the total body and  $\leq 3000$  mRem/year to the skin.
- The dose rate limit for H-3 and for all radionuclides in particulate form with half-lives greater than 8 days shall be  $\leq 1500$  mRem/year to any organ.

The dose rate due to noble gases in gaseous stack effluents shall be determined to be within the above limits in accordance with Section 2.0, Offsite Dose Calculations.

The dose rate due to H-3 and for all radioactive materials in particulate form with half-lives  $> 8$  days in gaseous stack effluents shall be determined to be within the above limits in accordance with Section 2.0, Offsite Dose Calculations, by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Table 3.3.

If the dose rate(s) exceeds the above limits, without delay decrease the release rate to within the above limit(s).

Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08		12/30/08

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Review Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/29/08
---	------------------	---	------------------	--	------------------

This instantaneous dose rate limit is provided to ensure that the dose rate at any time at the EFFLUENT RELEASE BOUNDARY from gaseous effluents from LACBWR will be within the annual dose limits of 10 CFR Part 20 for unrestricted areas. The annual dose limits are the doses associated with the concentrations of 10 CFR Part 20, Appendix B, Table 2, Column 1. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual in an unrestricted area, outside the EFFLUENT RELEASE BOUNDARY to annual average concentrations exceeding the limits specified in Appendix B, Table 2 of 10 CFR Part 20. For individuals who may at times be within the EFFLUENT RELEASE BOUNDARY, the occupancy of the individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the EFFLUENT RELEASE BOUNDARY. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the EFFLUENT RELEASE BOUNDARY to  $\leq 500$  mRem/year to the total body or to  $\leq 3000$  mRem/year to the skin. These release rate limits also restrict, at all times, the corresponding organ dose rate above background to an individual via the inhalation pathway to  $\leq 1500$  mRem/year.

- b) Dose from Noble Gas - the air dose to a MEMBER OF THE PUBLIC due to noble gases released in gaseous effluents to areas beyond the EFFLUENT RELEASE BOUNDARY shall be limited to:

Calendar Quarter

$\leq 5$  mRad from gamma radiation

$\leq 10$  mRad from beta particulate radiation

Calendar Year

$\leq 10$  mRad from gamma radiation

$\leq 20$  mRad from beta particulate radiation

The cumulative dose contributions shall be determined at least once per calendar quarter in accordance with Section 2.0, Offsite Dose Calculations.

With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days, a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions which have been taken or will be taken to reduce the releases of radioactive noble gases in gaseous effluents so that the cumulative dose during each subsequent quarter and the dose for the calendar year will be within the above limits.

This limit is provided to implement the requirements of Sections II.B, III.A, and IV.A of Appendix I, 10 CFR Part 50. The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I is to be shown by calculational procedures based on models and data such that the actual exposure of an individual through the appropriate pathways is unlikely to be substantially underestimated.

- c) Dose from Radionuclides other than Noble Gases - the dose to a MEMBER OF THE PUBLIC from H-3, and all radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents released to areas beyond the EFFLUENT RELEASE BOUNDARY shall be limited to:

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/29/08
---	------------------	---	------------------	--	------------------

Calendar Quarter

$\leq 7.5$  mRem to any organ

Calendar Year

$\leq 15$  mRem to any organ

The cumulative dose contributions shall be determined at least once per calendar quarter in accordance with Section 2.0, Offsite Dose Calculations.

With the calculated dose from the release of H-3 and all radionuclides in particulate form with half-lives greater than 8 days, in gaseous effluents exceeding any of the above limits, prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions which have been taken or will be taken to reduce these releases in gaseous effluents during remaining quarters so that the cumulative dose during each subsequent quarter and during the calendar year will be within the above limits.

This limit is provided to implement the requirements of Sections II.C, III.A, IV.A and Annex of Appendix I, 10 CFR Part 50. The ODCM calculational methods specified in the surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated.

Prepared or Revised By	Date	Rad. Prot. Engineer R. w	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/02/08

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	---	------------------	--	------------------

### 3.3.4 Instrumentation

The radioactive gaseous effluent monitoring instrumentation channels shown in Table 3.4 shall be OPERABLE with their alarm setpoints set to ensure that the limits of Section 3.3.3a are not exceeded. The stack noble gas instrumentation alarm setpoint will be determined and adjusted in accordance with the methodology and parameters in Section 2.0, Offsite Dose Calculations.

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The only significant noble gas remaining is Kr-85. The alarm setpoints for these instruments shall be set to ensure that the alarm will occur prior to exceeding the limits of 10 CFR Part 20.

a) Gaseous Effluent Instrumentation Surveillance Requirements -

Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL FUNCTIONAL TEST, and CHANNEL CALIBRATION operations at the frequencies shown in Table 3.5.

b) Corrective Action

- (1) With a radioactive gaseous effluent monitoring instrumentation channel alarm setpoint less conservative than that required, declare the channel inoperable or change the setpoint so that it is acceptably conservative.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Review Seymour J. Raffety	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/24/08
---	------------------	--	------------------	--	------------------

- (2) With less than the minimum number of radioactive gaseous effluent monitoring instrumentation channels OPERABLE, take the ACTION required by Table 3.4. Exert best efforts to return the instruments to OPERABLE status within 30 days and, if unsuccessful, explain in the next Annual Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner.

Table 3.4

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION

<u>INSTRUMENT</u>	<u>MINIMUM CHANNELS OPERABLE</u>	<u>APPLICABLE CONDITIONS</u>	<u>ACTION</u>
1. Reactor Building Ventilation Monitor System			
a. Particulate Activity Monitor	1	*	A
b. Gaseous Activity Monitor	1	*	A
c. Sampler Flow Rate Measuring Device	1	*	B
2. Stack Monitor System			
a. Gaseous Activity Monitor	1	**	C
b. Particulate Activity Monitor	1	**	D
c. Sampler Flow Rate Measuring Device	1	**	B

\* When Reactor Building Ventilation System is in operation.

\*\* At all times, unless alternate monitoring is available

ACTIONS:

- A. With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases through this pathway may continue as long as a stack monitor is OPERABLE; otherwise, secure the Reactor Building Ventilation.
- B. With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the flow rate is estimated at least once per 24 hours.
- C. With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided the Reactor Building Gaseous Activity Monitor is OPERABLE; otherwise, secure the Reactor Building Ventilation.
- D. With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided continuous collection of samples with auxiliary sampling equipment is initiated within 12 hours.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/30/08
---	------------------	------------------------------------	------------------	--	------------------

Table 3.5

RADIOACTIVE GASEOUS EFFLUENT MONITORING INSTRUMENTATION  
SURVEILLANCE REQUIREMENTS

<u>INSTRUMENT</u>		<u>CHANNEL CHECK</u>	<u>SOURCE CHECK</u>	<u>CHANNEL FUNCTIONAL TEST</u>	<u>CHANNEL <sup>(4)</sup> CALIBRATION</u>
1.	Reactor Building Ventilation Monitor System				
a.	Particulate Activity Monitor	DAILY	MONTHLY	QUARTERLY <sup>(1)</sup>	At LEAST ONCE PER 18 MONTHS
b.	Gaseous Activity Monitor	DAILY	MONTHLY	QUARTERLY <sup>(1)</sup>	At LEAST ONCE PER 18 MONTHS
c.	Sampler Flow Rate Measuring Device	DAILY	MONTHLY	QUARTERLY <sup>(3)</sup>	At LEAST ONCE PER 18 MONTHS
2.	Stack Monitor System				
a.	Noble Gas Activity Monitor	DAILY	MONTHLY	QUARTERLY <sup>(2)</sup>	At LEAST ONCE PER 18 MONTHS
b.	Particulate Activity Monitor	DAILY	N/A	QUARTERLY <sup>(2)</sup>	At LEAST ONCE PER 18 MONTHS
c.	Sampler Flow Rate Measuring Device	DAILY	N/A	QUARTERLY <sup>(3)</sup>	At LEAST ONCE PER 18 MONTHS

NOTES:

- (1) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
- Instrument indicates measured levels at or above the alarm setpoint.
  - Instrument indicates a downscale failure.
  - Instrument indicates a circuit failure.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
- Instrument indicates measured level above the alarm setpoint on one channel.
  - Instrument indicates a failure by a Low Flow and Low Count Rate signal.
- (3) The CHANNEL FUNCTIONAL TEST shall also demonstrate that the control room local alarm occurs if the flow instrument indicates measured levels below the minimum and/or above the maximum alarm setpoint.
- (4) The CHANNEL CALIBRATION shall be conducted in accordance with plant procedures.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/13/08
---	------------------	---	------------------	--	------------------



Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/02/08
---	------------------	---	------------------	--	------------------

### 3.4 Total Dose to a Member of the Public

The dose equivalent to any MEMBER OF THE PUBLIC due to release of radioactivity and radiation, shall be limited to  $\leq 25$  mRem to the total body or any organ (except the thyroid, which is limited to  $\leq 75$  mRem) over a period of one calendar year.

With the calculated doses from the release of radioactive materials in liquid or gaseous effluents exceeding twice the calendar year dose limits specified in Sections 3.2.2b, 3.3.3b, or 3.3.3c, a determination should be made, including direct radiation from Reactor Building and radioactive waste storage tanks to determine if the above limits have been exceeded. If these limits have been exceeded, prepare and submit a Special Report (including an analysis which estimates the radiation exposure to a MEMBER OF THE PUBLIC for the calendar year) to the Director, Nuclear Reactor Regulation, U.S. Nuclear Regulatory Commission, Washington, DC 20555, within 30 days, which defines the corrective action to be taken to reduce subsequent releases to prevent recurrence of exceeding these limits. If the release condition resulting in the excess has not already been corrected, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190. Submittal of the Special Report is considered a timely request, and a variance is granted until staff action on the request is complete.

Cumulative dose contributions from liquid and gaseous effluents shall be determined quarterly and annually in accordance with Section 2.0, Offsite Dose Calculations.

Cumulative dose contributions from direct radiation from the reactor containment or radioactive waste storage tanks shall be determined once per year in

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/02/08

accordance with Section 4.0, Radiological Environmental Monitoring Program.

This requirement is provided to meet the dose limitations of 40 CFR 190.

Whenever the calculated doses from plant radioactive effluents exceed twice the design objective doses of Appendix I, a Special Report will be submitted which describes a course of action which should result in the limitation of dose to a real individual for 12 consecutive months to within the 40 CFR 190 limits.

For conservatism, for compliance with this limit, the maximum total dose to any MEMBER OF THE PUBLIC will be assumed to be the sum of the maximums from each dose pathway even though the actual maximally exposed individual for each of the pathways could not be the same person.

The maximum potential dose to a MEMBER OF THE PUBLIC from direct radiation from the Reactor Building and radioactive waste storage tanks is determined by TLD dosimeters located at various locations around the perimeter of the LACBWR access controlled area and the EFFLUENT RELEASE BOUNDARY for the environmental monitoring program. For compliance with this limit, the actual maximum possible exposure to an actual MEMBER OF THE PUBLIC from direct radiation may be determined from maximum possible exposure times relative to the continuous exposure dose measured by the TLD's. Conservative maximum possible exposure times will be determined by actual observation of the areas of interest by LACBWR management and/or security personnel.

## 4.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM

### 4.1 Program Requirements

The Radiological Environmental Monitoring Program (REMP) shall conform to the guidance of Appendix I to 10 CFR Part 50. The REMP shall provide the requirements for monitoring, sampling, analyzing, and reporting radiation and radionuclides in the environment resulting from the LACBWR facility and/or its effluents. These requirements have been established to ensure the measurements of radiation and of radioactive material in potential exposure pathways to MEMBERS OF THE PUBLIC are performed. Various environmental samples will be taken within the area surrounding LACBWR and in selected controlled or background locations. An Interlaboratory Comparison Program shall be established to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in the environmental sample matrices are performed, as part of quality control for environmental monitoring.

The radiological monitoring program required by this specification provides measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides, which lead to the highest potential radiation exposures of individuals resulting from plant effluents. This monitoring program theory supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways.

The requirement for participation in an Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental samples are performed to demonstrate that the results are reasonably valid.

Prepared or Revised By	Date	Rad. Prot. Engineer Re.	Date	Operations Review Comm.	Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	12/02/08			12/31/08

## 4.2 REMP Description

Radiological environmental monitoring samples will be collected and analyzed in accordance with Table 4.1. The specific sample locations are listed in HSP-03.1. Section 3 of the Health and Safety Procedures (HSP's) shall contain procedures to provide specific guidance to the HP technicians in the collection and analysis of each environmental sample.

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	12/02/08	<i>[Signature]</i>	12/30/08

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Raffety	12/02/08	<i>RSC</i>	12/30/08

**Table 4.1**

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples (A)</u>	<u>Sampling and Collection Frequency</u>	<u>Type and Frequency of Analysis</u>
1. AIRBORNE PARTICULATES	Three (3)	Continuous operation of sampler with sample collection as required by dust loading, but at least weekly.	<p>(1) Analyze each filter for gross beta radioactivity <math>\geq 24</math> hours following filter change. Perform gamma isotopic analysis on each sample when gross beta activity is <math>&gt; 10</math> times the control sample (La Crosse).</p> <p>(2) A composite of particulate filters from each location will be gamma analyzed at least once per quarter.</p>
2. DIRECT RADIATION	Eight (8)	At least semiannually.	1) Gamma dose - at least semi-annually.
3. WATERBORNE (River Water)	Two (2)	Monthly.	<p>1) Gamma isotopic analysis monthly on each sample.</p> <p>2) Tritium analysis on composite sample from each location quarterly.</p>

(A) Exact sample locations are listed in HSP-03.1.

Prepared or Revised By	Date	Rad. Prot. Engineer Re.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

Table 4.1 - (cont'd)

**RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM**

<u>Exposure Pathway and/or Sample</u>	<u>Number of Samples <sup>(A)</sup></u>	<u>Sampling and Collection Frequency</u>	<u>Type and Frequency of Analysis</u>
4. RIVER SEDIMENT	Two (2)	Semi-annually	(1) Gamma isotopic analysis on each sample.
5. INGESTION			
a. Fish	One (1) sample of two (2) different species in area important as a recreational or commercial species.	At least semi-annually	(1) Gamma isotopic analysis of the edible portions of each sample.
b. Milk	As Determined	Obtain sample if abnormal stack particulate release occurs	(1) Gamma isotopic analysis on each sample.
c. Vegetation	As Determined	Obtain sample if abnormal stack particulate release occurs	(1) Gamma isotopic analysis of the edible portion of each composite sample.

(A) Exact sample locations are listed in HSP-03.1.

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer Ref. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/20/08
---	------------------	---	------------------	--	------------------

### 4.3 REMP Lower Limits of Detection (LLD)

The sampling techniques and counting equipment used for the analysis of samples collected as requirements of the REMP will meet LLD's calculated in accordance with criteria of NUREG-0473, Rev. 2. LACBWR's LLD's are calculated as follows and are essentially the same as those found in NUREG-0473, Rev. 2. Table 4.2 lists these values.

#### 4.3.1 Calculation of Lower Limits of Detection:

The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability, with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{E \times V \times 2.22 \times Y \times \text{Exp}(-\lambda \Delta t)}$$

WHERE:

LLD is the priori lower limit of detection as defined above (as picocurie per unit mass or volume).

$S_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute).

$E$  is the counting efficiency (as counts per gamma).

$V$  is the sample size (in units of mass or volume).

2.22 is the number of transformations per minute per picocurie.

$Y$  is gamma abundance for isotope of interest.

$\lambda$  is the radioactive decay constant for the particular radionuclide.

$\Delta t$  is the elapsed time between sample collection (or end of the sample collection period) and time of counting.

Prepared or Revised By	Date	Rad. Prot. Engineer R. N.	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08		12/30/08



Prepared or Revised By	Date	Rad. Prot. Engineer Review	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	<i>[Signature]</i>	12/30/08

**Table 4.2**

**ENVIRONMENTAL SAMPLE ANALYSES LOWER LIMITS OF DETECTION VALUES (LLD)**

Analysis	Sample Type				
	Water pCi/l	Airborne Particulate or Radioiodine (pCi/m <sup>3</sup> )	Fish (pCi/Kg, Wet)	Milk (pCi/l)	Sediment (pCi/Kg Dry)
Gross Beta	6	1 E-2			
H-3	3500(2000) <sup>a</sup>				
Mn-54	15		130		
Co-60	15		130		
Zn-65	30		260		
Cs-134	15	5 E-2	130	15	150
Cs-137	18	6 E-2	150	18	180

<sup>a</sup> For drinking water.

#### 4.4 Interlaboratory Comparison Program

An Interlaboratory Comparison Program will be established to ensure that the analyses being performed to comply with the REMP is accurate. A suitable offsite laboratory will be used to supply NIST traceable or equivalent standard spiked sample media for analysis. The offsite laboratory will supply a report to DPC of the comparison results. The Interlaboratory Comparison Program will be conducted annually. The results of this comparison will be included in the Annual Radiological Environmental Monitoring Report.

#### 4.5 Reporting Requirements

- a) An Annual Radiological Environmental Monitoring Report shall be submitted to the Administrator of the Regional Office of the NRC. This report shall include summarized and tabulated results, including interpretations and analysis of data trends, of environmental samples taken during the previous calendar year. In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted as soon as possible in a supplementary report.

The report shall also include the following: a summary description of the Radiological Environmental Monitoring Program, a map of all sampling locations keyed to a table giving distances and directions from the plant, the results of the Interlaboratory Comparison Program, and a discussion of all analyses in which the LLD was not achievable.

Prepared or Revised By	Date	Rad. Prot. Engineer Re	Date	Operations Review Comm. Approval	Date
LARRY L. NELSON	12/02/08	Seymour J. Rafferty	12/02/08	[Signature]	12/02/08

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. E. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/02/08
---	------------------	--	------------------	--	------------------

- b) With the REMP program not being conducted as specified in Table 4.1, prepare and submit to the Commission, in the Annual Radiological Environmental Monitoring Report, a description of the reasons for not conducting the program as required, analysis of the cause of unexpected results, and the plans for preventing a recurrence.
- c) With the Interlaboratory Comparisons not being performed, report the corrective actions taken to prevent a recurrence to the Commission in the Radiological Environmental Monitoring Report.
- d) With radiological environmental sample analysis in excess of the reporting levels listed in Table 4.3, when averaged over any calendar quarter, prepare and submit to the Commission a Special Report within 30 days, with a description of the reasons for exceeding these reporting levels.

Table 4.3

### Reporting Levels for Radioactivity Concentrations in Environmental Samples

Analysis	Water pCi/l	Airborne Particulate pCi/m <sup>3</sup>	Fish pCi/kg (wet)	Milk pCi/l
H-3	20,000	--	--	--
Mn-54	1,000	--	30,000	--
Co-60	300	--	10,000	--
Zn-65	300	--	20,000	--
Cs-134	30	10	1,000	60
Cs-137	50	20	2,000	70

Prepared or Revised By LARRY L. NELSON	Date 12/02/08	Rad. Prot. Engineer R. Seymour J. Rafferty	Date 12/02/08	Operations Review Comm. Approval <i>[Signature]</i>	Date 12/13/08
---	------------------	---	------------------	--	------------------

**SECTION B**

**ANNUAL  
RADIOLOGICAL  
ENVIRONMENTAL MONITORING  
REPORT**

## INTRODUCTION:

*The Radiological Environmental Monitoring (REM) Program is conducted to comply with the requirements of the ODCM and in accordance with 10 CFR 50 Appendix I. The REM Program provides measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides which could potentially lead to radiation doses to Members of the Public resulting from plant effluents. Environmental samples are taken within the surrounding areas of the plant and in selected control or background locations.*

*The monitoring program at the LACBWR facility includes monitoring of liquid and gaseous releases from the plant, as well as environmental samples of surface air, river water, river sediment, milk, fish, and penetrating radiation.*

*The REM program theory supplements the Radioactive Effluent analyses by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways using the methodology of the Offsite Dose Calculation Manual (ODCM).*

*An Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental samples are performed.*

# **RADIOLOGICAL ENVIRONMENTAL MONITORING REPORT**

## **1.0 SAMPLE COLLECTION**

Environmental samples are collected from the area surrounding LACBWR at the frequencies outlined in the ODCM. A series of figures and tables are included in this report to better show LACBWR's environmental program.

- FIGURE 1      This map includes the plant boundary, roads, other generation plants, and the relationship of the plant to the nearest local community.
- FIGURE 2      This map shows the location of LACBWR's permanent environmental monitoring stations.
- FIGURES 3&4    These maps show the location of LACBWR's TLDs.
- TABLE 5        This table shows the sampling frequency of the various environmental samples and the analyses performed on these samples.
- TABLE 6        This table shows the permanent monitoring stations used in LACBWR's environmental program.
- TABLE 7        This table shows the TLD locations.
- TABLE 8        This table shows the number of various samples collected and analyzed during 2008.

## **2.0 RESULTS OF THE 2008 RADIO-ENVIRONMENTAL MONITORING SURVEYS**

During 2008, activity levels in the local environment were normal, indicating no significant plant attributed radioactivity.

### **2.1 PENETRATING RADIATION**

The environmental penetrating radiation dose is measured by thermo luminescent dosimeters consisting of four lithium fluoride (LiF) chips. These TLD's are changed on a quarterly basis and are sent to an outside contractor for reading. The TLD results for 2008 are shown on Table 9.

## 2.2 AIR PARTICULATE

Air samples are collected continuously from various sites (see Table 6) around LACBWR. An air sampler is also located 18 miles north of the plant in La Crosse, Wisconsin, to act as a control station.

Particulate air samples are collected at the rate of approximately 30-60 lpm with a Gelman Air Sampler. The air filter consists of a glass fiber filter with an associated pore size of approximately 0.45  $\mu\text{m}$ . The particulate filters are analyzed weekly for gross beta activity with an internal proportional counter, and the monthly particulate composites are gamma analyzed for individual isotopic concentration.

TABLE 10 This table shows the weekly gross beta gamma activity concentration from the air particulate filters.

TABLE 11 This table shows the composite air particulate isotopic analysis.

Comparison between the control station at La Crosse and the other stations near LACBWR indicate that there was no significant plant attributable airborne particulate activity.

## 2.3 RIVER WATER

River water is collected monthly. River water samples above at, and below the plant site are collected and are gamma analyzed for isotopic concentration. The river water gamma isotopic analysis results are shown in Table 12. The results indicate that there was no significant plant attributable radionuclides in the river water.



## 2.4 SEDIMENT SAMPLES

Sediment samples were collected twice per year above, at, and below the plant outfall. These samples were gamma analyzed and these results appear on Table 13. They indicated that small amounts of plant-attributed radionuclides have accumulated in river sediments near the outfall. The amount of radionuclide in this sediment declined significantly after plant shutdown. These amounts have remain relatively constant the last few years.

## 2.5 FISH

Fish samples were collected quarterly above and below the plant discharge. The results of gamma spectral analysis of edible portions of fish samples appear in Table 14. There has been no significant accumulation of plant-attributed radionuclides in fish in the vicinity of LACBWR.

## 3.0 CONCLUSIONS

All environmental samples collected and analyzed during 2007 exhibited no significant contribution from LACBWR.

**4.0 INTERLABORATORY COMPARISON PROGRAM RESULTS**

During 2008, interlaboratory comparison samples were obtained from an outside contractor. The equipment used to analyze the environmental samples was tested against the contractors' results. The following is the result of this comparison.

ANALYSIS	LACBWR RESULTS	CONTRACTOR RESULTS	RATIO
GROSS BETA	183 pCi	173 pCi	1.06
GROSS ALPHA	81.2 pCi	96.9 pCi	0.84
Ce-141	164 pCi	162 pCi	1.02
Cr-51	217 pCi	208 pCi	1.05
Cs-134	95 pCi	113 pCi	0.84
Cs-137	102 pCi	101 pCi	1.01
Co-58	86 pCi	87.8 pCi	0.98
Mn-54	133 pCi	128 pCi	1.04
Fe-59	94 pCi	84.6 pCi	1.11
Zn-65	163 pCi	154 pCi	1.06
Co-60	117 pCi	112 pCi	1.04
H-3	8.30E3 pCi/ℓ	1.02E4 pCi/ℓ	0.81

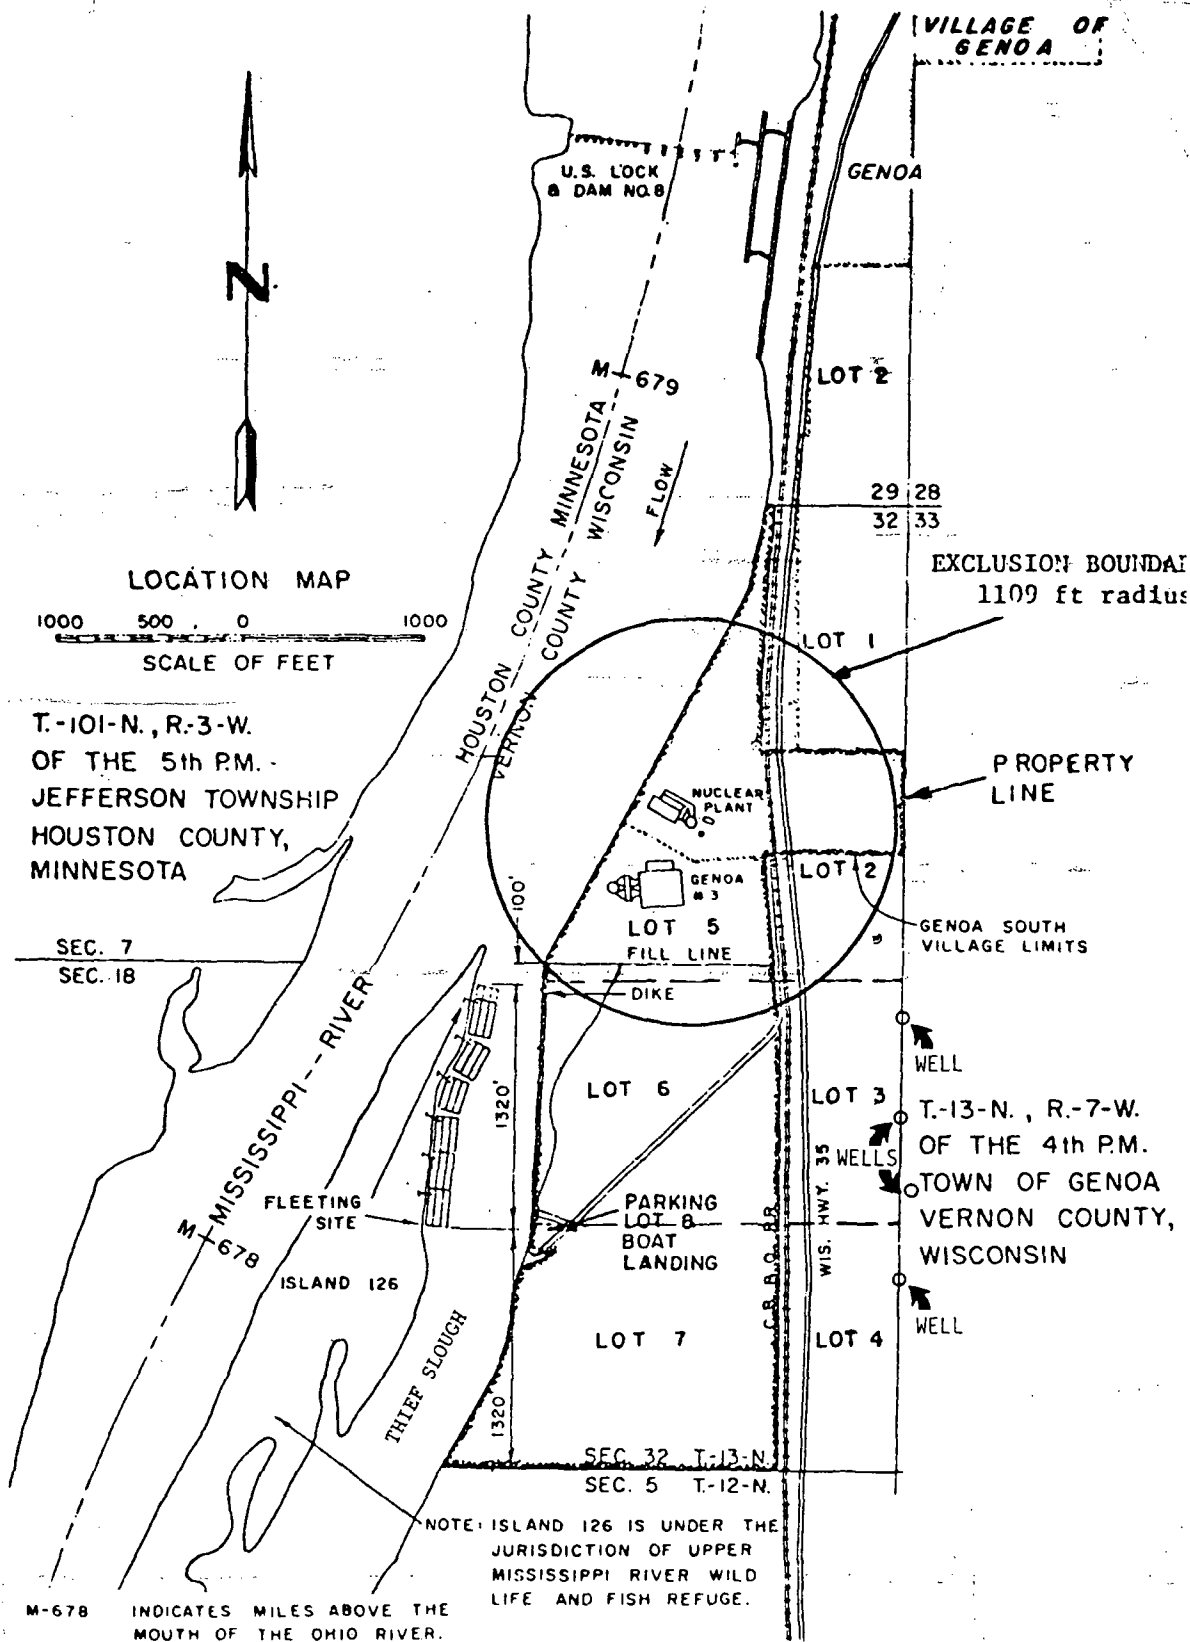


FIGURE 1 - LACBWR PROPERTY MAP

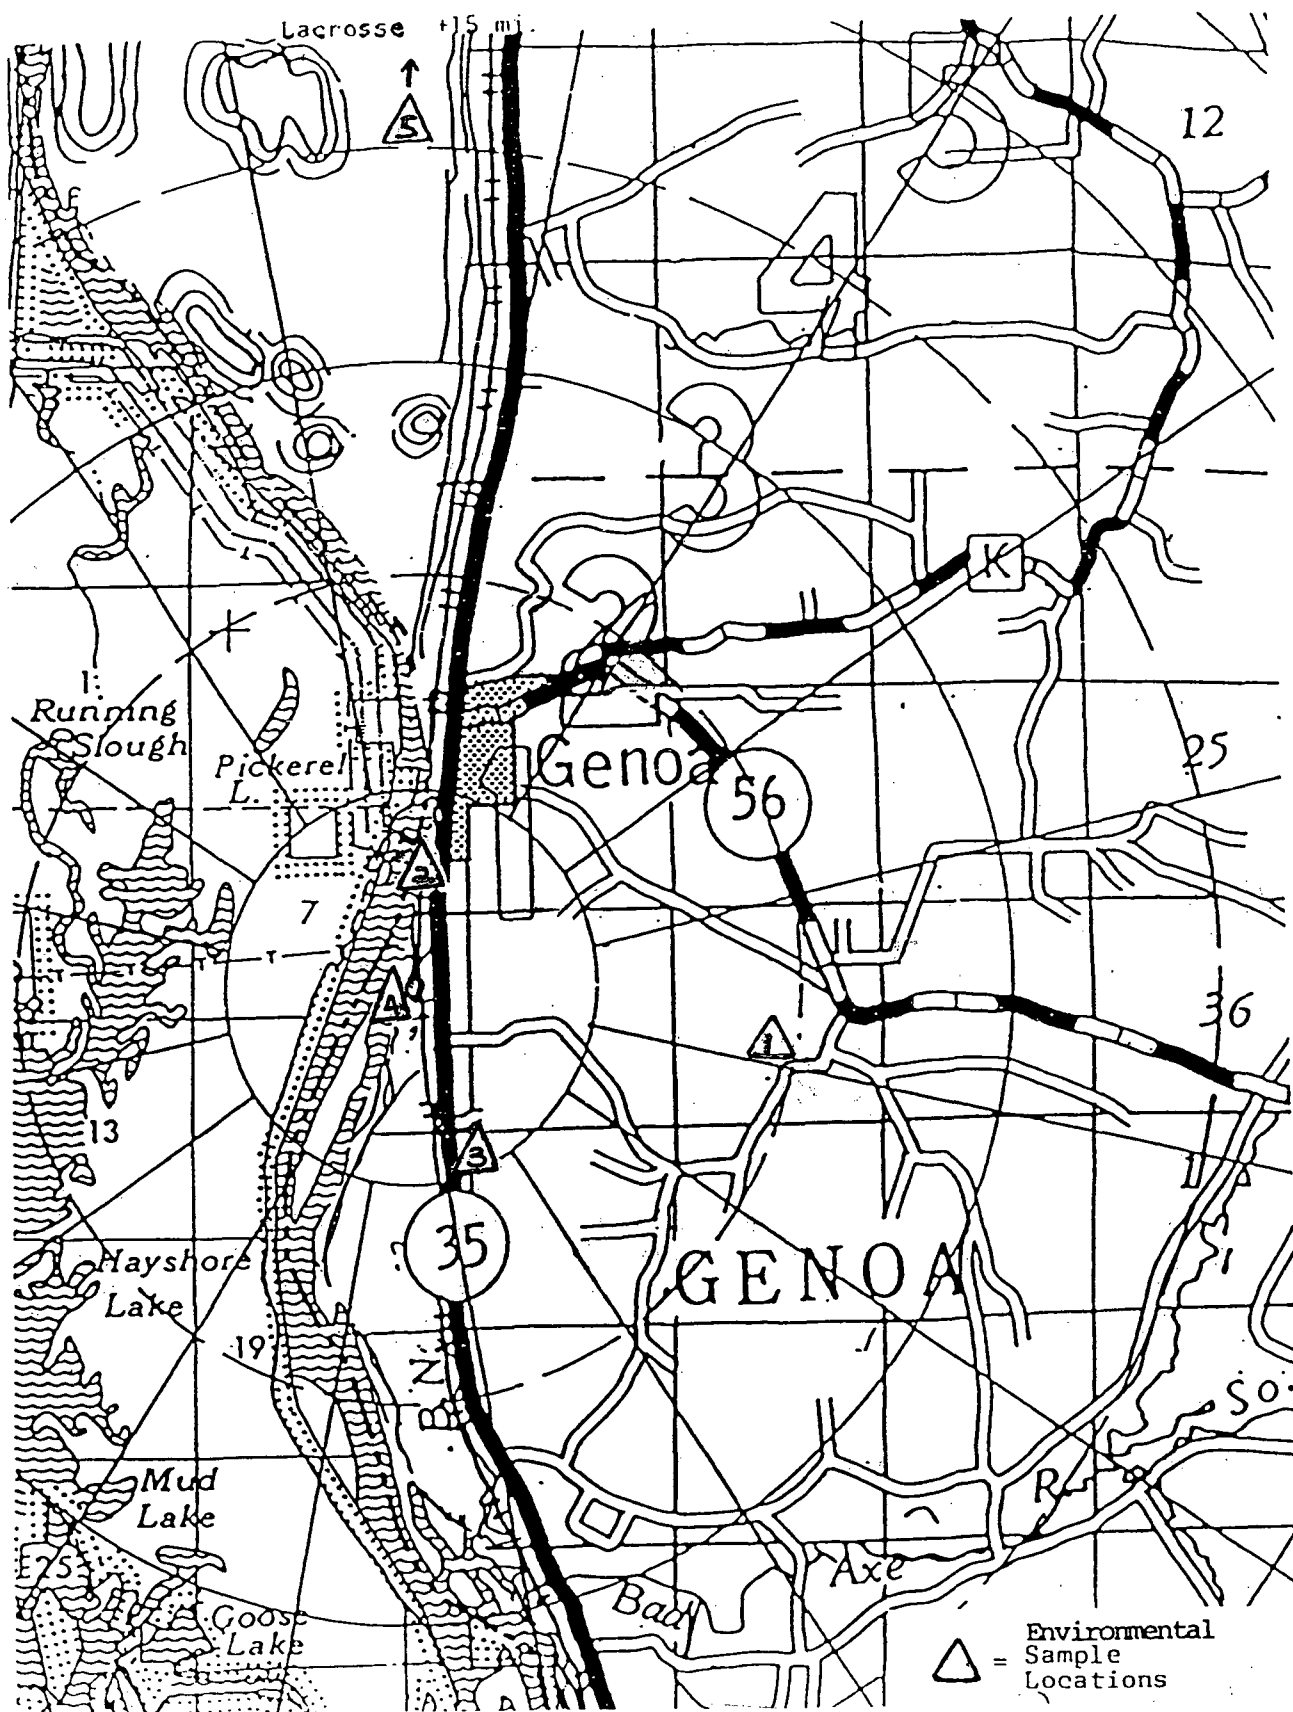


FIGURE 2 - PERMANENT ENVIRONMENTAL MONITORING STATION LOCATIONS  
(Refer to Table 6)

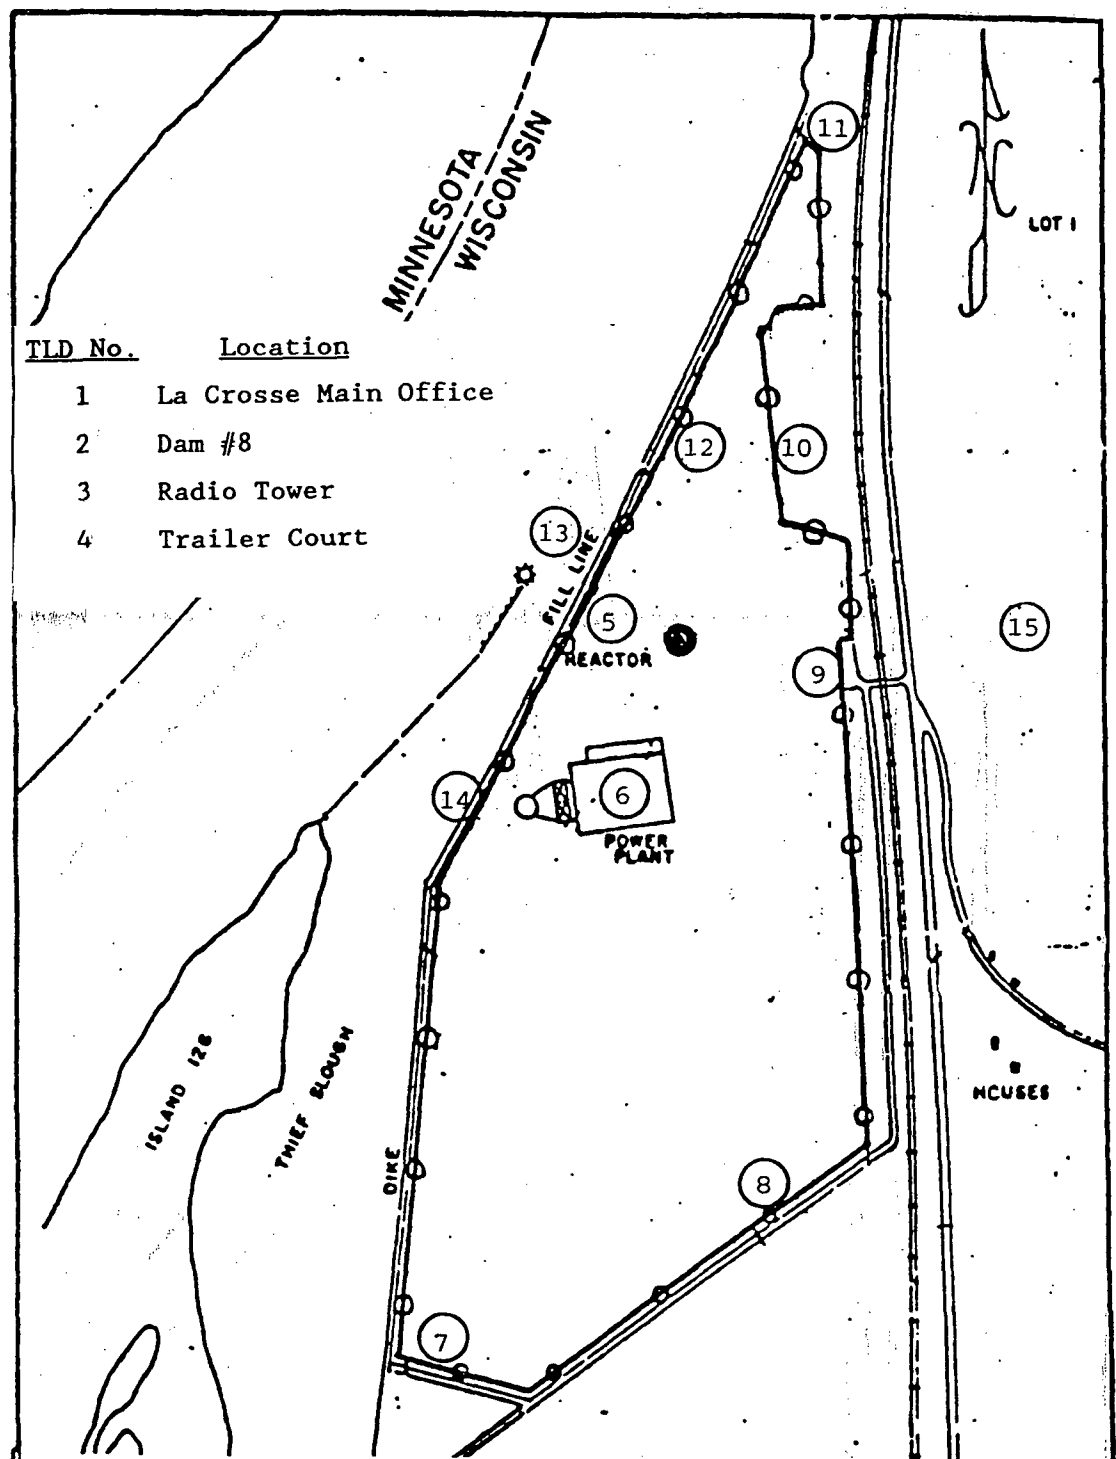


FIGURE 3 - LACBWR ENVIRONMENTAL DOSE ASSESSMENT LOCATIONS

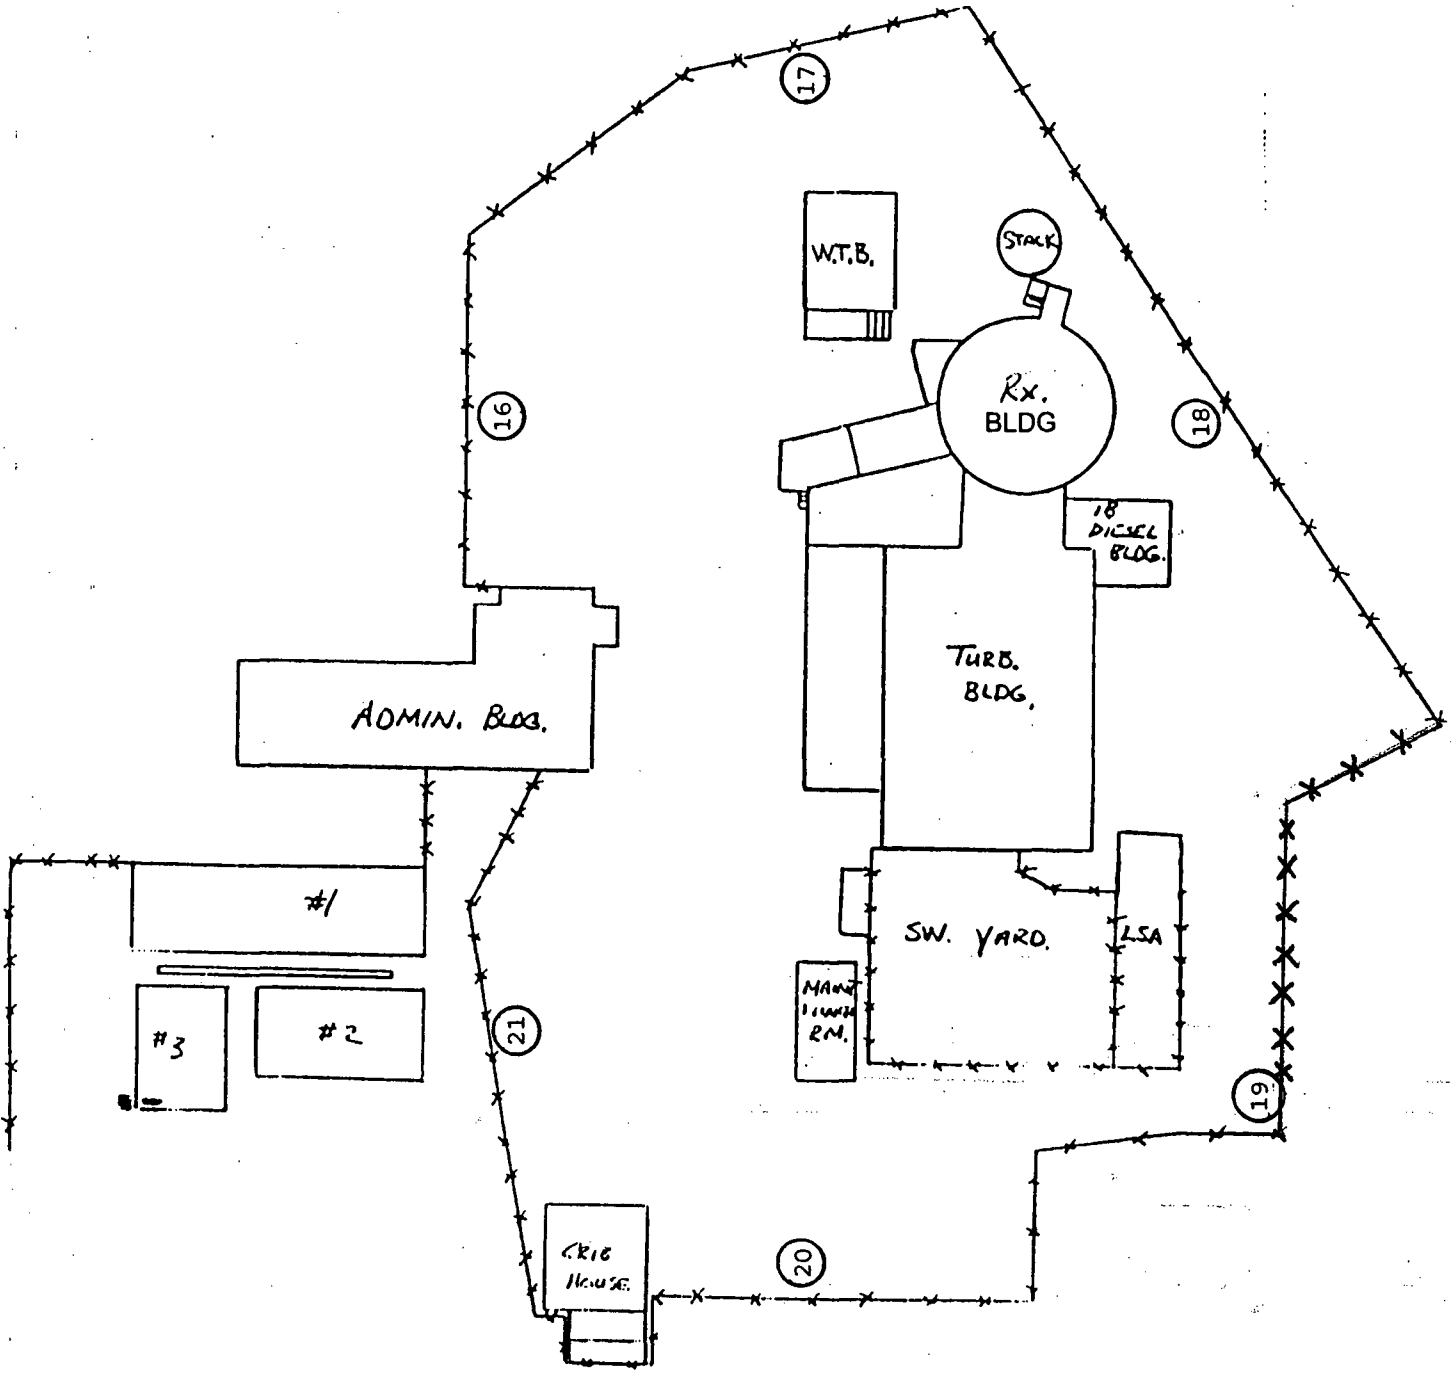


FIGURE 4 - LACBWR ENVIRONMENTAL DOSE ASSESSMENT LOCATIONS

TABLE 5

**SAMPLE FREQUENCY AND ANALYSIS OF RADIO-ENVIRONMENTAL SAMPLES**

<b><u>SAMPLE</u></b>	<b><u>FREQUENCY</u></b>	<b><u>ANALYSIS PERFORMED</u></b>
TLD (LiF) Dosimeters	Quarterly	Dose in mRem
Particulate Air Glass Fiber Filters	Weekly	Gross Beta and Gamma Spectroscopy of Composites Monthly (HPGe-MCA)
Milk	Obtain sample as directed if abnormal stack particulate release occurs.	Gamma Spectroscopy
Sediment	Twice per year	Gamma Spectroscopy
Fish	Quarterly	Gamma Spectroscopy
River	Monthly	Gamma isotopic analysis and tritium (Liquid Scintillation Analyzer)
Vegetation	Obtain sample as directed if abnormal stack particulate release occurs.	Gamma Spectroscopy

**TABLE 6**

**PERMANENT ENVIRONMENTAL MONITORING STATION LOCATIONS**

(Refer to Figure 2)

LOCATION NO.	LOCATION	AIR SAMPLE
1	Radio Tower	x
2	Dam No. 8	x
3	Trailer Court	x
4	Crib House	x
5	Main Office	x



**TABLE 7**  
**ENVIRONMENTAL TLD LOCATIONS**

LOCATION NO.	LOCATION
1	LA CROSSE MAIN OFFICE AIR SAMPLER BOX
2	DAM #8 AIR SAMPLER BOX
3	RADIO TOWER BUILDING AT AIR SAMPLER
4	TRAILER COURT AIR SAMPLER BOX
5	CRIBHOUSE AIR SAMPLER BOX
6	G-3 CONTROL ROOM
7	SW GATEPOST AT END OF G-3 DIKE
8	ON FENCE N. SIDE OF FISHERMAN'S ROAD
9	SITE ENTRANCE GUARD AREA
10	ON FENCE AT NE CORNER OF THE SWITCHYARD
11	ON N. SITE AREA FENCE GATE
12	G-1 CRIBHOUSE
13	ON MOORING WALKWAY WEST OF LACBWR #2 WAREHOUSE
14	G-3 COAL UNLOADING CRANE
15	POWER POLE ON BLUFF SIDE EAST OF PLANT
16	RESTRICTED AREA FENCE N. SIDE
17	RESTRICTED AREA FENCE E. SIDE
18	RESTRICTED AREA FENCE S. SIDE
19	RESTRICTED AREA FENCE SW CORNER
20	RESTRICTED AREA FENCE W. SIDE
21	RESTRICTED AREA FENCE NW CORNER

**TABLE 8**  
**RADIO-ENVIRONMENTAL SAMPLES COLLECTED**  
**JANUARY-DECEMBER 2008**

TYPE OF SAMPLE	NUMBER OF SAMPLES
Penetrating Radiation (TLD's)	78
Air Particulate	244
River Water	36
Sediment	6
Fish	8

**TABLE 9**  
**QUARTERLY THERMOLUMINESCENT DOSIMETER DOSE MEASUREMENTS**  
**IN THE LACBWR VICINITY**

**JANUARY – DECEMBER 2008**

**BACKGROUND CORRECTED**

STATION NO.	1st QUARTER mRem	2nd QUARTER mRem	3rd QUARTER mRem	4th QUARTER mRem
1	0	0	0	0
2	Missing	0.9	0	0
3	Missing	0	0	0
4	0	0	2.3	2.7
5	3.7	2.4	1.9	1.9
6	0	0	0	0
7	0	0	Missing	0
8	0	0	0.1	0
9	0	0	1.0	0
10	0	0	0	0
11	0	0	0.2	0
12	0	2.5	2.8	2.7
13	0	0	0	0
14	Missing	0	0	0
15	Missing	5.4	5.0	6.7
16	9.9	7.9	11.9	8.4
17	Missing	9.0	11.0	9.7
18	20	23.4	25.8	24.7
19	5.3	11.5	13.7	11.6
20	1.9	3.0	0.8	4.1
21	22.3	11.2	5.9	6.9

*Station #1 (La Crosse Main Office) located approximately 16 miles north of LACBWR is considered the Control TLD.*

**TABLE 10**  
**WEEKLY GROSS BETA AIR PARTICULATES IN THE LACBWR VICINITY**  
(Reporting Level = 10 times Control Value)

COLLECTION DATE	LACBWR PLANT pCi/m <sup>3</sup>	TRAILER COURT pCi/m <sup>3</sup>	DAM #8 pCi/m <sup>3</sup>	RADIO TOWER pCi/m <sup>3</sup>	LA CROSSE CONTROL
01-02-08	.031 ± .003	.024 ± .002	.024 ± .004	00S	.029 ± .003
01-09-08	.024 ± .003	.023 ± .003	.012 ± .004	00S	.027 ± .003
01-16-08	.033 ± .003	.029 ± .003	.029 ± .004	00S	.032 ± .003
01-23-08	.026 ± .003	.022 ± .002	.025 ± .004	00S	.033 ± .003
01-29-08	.038 ± .004	.022 ± .003	.025 ± .004	00S	.035 ± .003
02-06-08	.026 ± .002	.020 ± .002	.016 ± .003	00S	.022 ± .002
02-13-08	.030 ± .003	.021 ± .002	.029 ± .004	00S	.027 ± .003
02-20-08	.031 ± .003	.017 ± .002	.021 ± .003	00S	.029 ± .003
02-27-08	.027 ± .003	.019 ± .002	.022 ± .004	00S	.027 ± .002
03-05-08	.024 ± .003	.018 ± .002	.017 ± .003	00S	.023 ± .002
03-12-08	.026 ± .003	.020 ± .002	.022 ± .004	.050 ± .003	.024 ± .002
03-19-08	.015 ± .002	.013 ± .002	.013 ± .003	.013 ± .002	.016 ± .002
03-26-08	.014 ± .002	.015 ± .002	.012 ± .003	.015 ± .002	.016 ± .002
04-02-08	.016 ± .002	.012 ± .002	.009 ± .003	.013 ± .002	.014 ± .002

**TABLE 10**  
**WEEKLY GROSS BETA AIR PARTICULATES IN THE LACBWR VICINITY**  
(Reporting Level = 10 times Control Value)

COLLECTION DATE 2009	LACBWR PLANT pCi/m <sup>3</sup>	TRAILER COURT pCi/m <sup>3</sup>	DAM #8 pCi/m <sup>3</sup>	RADIO TOWER pCi/m <sup>3</sup>	LA CROSSE CONTROL
04-09-08	.020 ± .002	.015 ± .002	.015 ± .003	.016 ± .002	.018 ± .002
04-16-08	.012 ± .002	.008 ± .002	.011 ± .003	.010 ± .002	.010 ± .002
04-23-08	.020 ± .002	.016 ± .002	.008 ± .002	.019 ± .004	.016 ± .002
05-07-08	.022 ± .002	.017 ± .002	.015 ± .003	.020 ± .002	.022 ± .002
05-14-08	.017 ± .002	.012 ± .002	.009 ± .003	.014 ± .002	.012 ± .002
05-21-08	.012 ± .002	.011 ± .002	.007 ± .002	.013 ± .002	.011 ± .002
05-28-08	.009 ± .002	.007 ± .002	.007 ± .003	.008 ± .002	.010 ± .002
06-04-08	.016 ± .002	.016 ± .002	.010 ± .002	.013 ± .001	.015 ± .002
06-11-08	.010 ± .001	.010 ± .001	.009 ± .002	.024 ± .005	.013 ± .002
06-18-08	.014 ± .002	.010 ± .001	.009 ± .002	.010 ± .001	.013 ± .001
06-24-08	.015 ± .002	.015 ± .002	.008 ± .001	.011 ± .002	.011 ± .002
07-02-08	.016 ± .002	.020 ± .002	.010 ± .002	.016 ± .002	.018 ± .002
07-09-08	.013 ± .002	.009 ± .001	.007 ± .002	.012 ± .002	.008 ± .001
07-16-08	.014 ± .002	.013 ± .002	.009 ± .002	.013 ± .002	.014 ± .002

**TABLE 10**  
**WEEKLY GROSS BETA AIR PARTICULATES IN THE LACBWR VICINITY**  
(Reporting Level = 10 times Control Value)

COLLECTION DATE	LACBWR PLANT pCi/m <sup>3</sup>	TRAILER COURT pCi/m <sup>3</sup>	DAM #8 pCi/m <sup>3</sup>	RADIO TOWER pCi/m <sup>3</sup>	LA CROSSE CONTROL
07-23-08	.019 ± .002	.016 ± .002	.007 ± .003	.015 ± .002	.020 ± .002
07-30-08	.019 ± .002	.020 ± .002	.018 ± .003	.017 ± .002	.019 ± .002
08-06-08	.018 ± .002	.018 ± .002	.016 ± .003	.020 ± .002	.016 ± .002
08-13-08	.013 ± .002	.012 ± .002	.005 ± .002	NO SAMPLE	.013 ± .002
08-20-08	.020 ± .002	.022 ± .002	.009 ± .002	.021 ± .002	.019 ± .002
08-27-08	.013 ± .002	.014 ± .002	.008 ± .002	.017 ± .002	.015 ± .002
09-09-08	.014 ± .002	.012 ± .002	.008 ± .002	.014 ± .002	.011 ± .002
09-17-08	.012 ± .002	.012 ± .002	.007 ± .001	.014 ± .002	.011 ± .001
09-24-08	.032 ± .003	.033 ± .002	.027 ± .003	.030 ± .002	.029 ± .002
10-01-08	.026 ± .002	.026 ± .002	.017 ± .003	.026 ± .002	.026 ± .002
10-08-08	.022 ± .002	.015 ± .001	.011 ± .002	.017 ± .002	.018 ± .002
10-15-08	.017 ± .002	.019 ± .002	.016 ± .003	.017 ± .002	.018 ± .002
10-22-08	.011 ± .002	.016 ± .002	.014 ± .003	.017 ± .002	.018 ± .002
10-28-08	.015 ± .002	.016 ± .002	.004 ± .002	.015 ± .002	.014 ± .002

**TABLE 10**  
**WEEKLY GROSS BETA AIR PARTICULATES IN THE LACBWR VICINITY**  
(Reporting Level = 10 times Control Value)

COLLECTION DATE 2009	LACBWR PLANT pCi/m <sup>3</sup>	TRAILER COURT pCi/m <sup>3</sup>	DAM #8 pCi/m <sup>3</sup>	RADIO TOWER pCi/m <sup>3</sup>	LA CROSSE CONTROL
11-05-08	.035 ± .003	.038± .003	.046 ± .006	.038 ± .002	.037 ± .003
11-12-08	.006 ± .001	.010 ± .002	.006 ± .002	.009 ± .001	.017 ± .002
11-18-08	.005 ± .001	.015 ± .002	.009 ± .001	.016 ± .002	.013 ± .002
11-26-08	.009 ± .002	.019 ± .002	.014 ± .003	.021 ± .002	.021 ± .003
12-03-08	.009 ± .002	.018 ± .002	.014 ± .003	.017 ± .002	.019 ± .002
12-10-08	.009 ± .002	.013 ± .002	.013 ± .003	.019 ± .002	.016 ± .002
12-17-08	.014 ± .002	.017 ± .002	.019 ± .003	.020 ± .002	.023± .002
12-23-08	.016± .002	.017 ± .002	.018 ± .003	.022 ± .002	.026 ± .003
12-31-08	.021± .002	.028 ± .003	.020 ± .002	.036 ± .002	.041 ± .003

**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>1-02-08</u>	<u>1-02-08</u>	<u>1-02-08</u>	<u>1-02-08</u>	<u>1-02-08</u>
END DATE	<u>1-29-08</u>	<u>1-29-08</u>	<u>1-29-08</u>	<u>1-29-08</u>	<u>1-29-08</u>
ISOTOPES/RL *	OOS				
Cs-134/10		<3.60E-3	<3.21E-3	<3.24E-3	<6.09E-3
Cs-137/20		<3.86E-3	<3.44E-3	<3.18E-3	<6.75E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE		<u>1-29-08</u>	<u>1-29-08</u>	<u>1-29-08</u>	<u>1-29-08</u>
END DATE		<u>2-27-08</u>	<u>2-27-08</u>	<u>2-27-08</u>	<u>2-27-08</u>
ISOTOPES/RL *	OOS				
Cs-134/10		<3.02E-3	<3.03E-3	<5.56E-3	<2.81E-3
Cs-137/20		<3.08E-3	<3.14E-3	<5.63E-3	<2.98E-3

\*RL = REPORTING LEVEL



**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>2-27-08</u>	<u>2-27-08</u>	<u>2-27-08</u>	<u>2-27-08</u>	<u>2-27-08</u>
END DATE	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>
ISOTOPES/RL*					
Cs-134/10	<1.43E-3	<1.82E-3	<1.71E-3	<3.45E-3	<1.80E-3
Cs-137/20	<1.45E-3	<1.89E-3	<1.77E-3	<3.52E-3	<1.84E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>	<u>4-02-08</u>
END DATE	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.09E-3	<2.36E-3	<2.12E-3	<3.87E-3	<2.25E-3
Cs-137/20	<2.20E-3	<2.33E-3	<2.21E-3	<3.99E-3	<2.32E-3

\*RL = REPORTING LEVEL

**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>	<u>4-30-08</u>
END DATE	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.07E-3	<2.32E-3	<2.11E-3	<4.50E-3	<2.19E-3
Cs-137/20	<2.11E-3	<2.13E-3	<2.184E-3	<4.57E-3	<2.25E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>	<u>5-28-08</u>
END DATE	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.50E-3	<2.42E-3	<2.13E-3	<3.73E-3	<2.21E-3
Cs-137/20	<2.54E-3	<2.40E-3	<2.15E-3	<3.78E-3	<2.23E-3

\*RL = REPORTING LEVEL

**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>	<u>6-24-08</u>
END DATE	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.26E-3	<2.27E-3	<1.95E-3	<3.17E-3	<1.73E-3
Cs-137/20	<2.26E-3	<2.24E-3	<2.10E-3	<3.24E-3	<1.78E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>	<u>7-30-08</u>
END DATE	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.20E-3	<1.72E-3	<1.15E-3	<3.42E-3	<1.69E-3
Cs-137/20	<2.28E-3	<1.75E-3	<1.13E-3	<3.38E-3	<1.80E-3

\*RL = REPORTING LEVEL

**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>	<u>9-03-08</u>
END DATE	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.27E-3	<2.78E-3	<2.05E-3	<4.17E-3	<1.91E-3
Cs-137/20	<2.31E-3	<2.84E-3	<2.27E-3	<4.40E-3	<2.02E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>	<u>10-01-08</u>
END DATE	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.68E-3	<2.69E-3	<2.62E-3	<5.30E-3	<2.43E-3
Cs-137/20	<2.74E-3	<2.86E-3	<2.55E-3	<5.40E-3	<2.42E-3

\*RL = REPORTING LEVEL

**TABLE 11**  
**AIR PARTICULATE COMPOSITE RESULTS**  
(Concentrations in pCi/m<sup>3</sup>)

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>	<u>10-28-08</u>
END DATE	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>
ISOTOPES/RL*					
Cs-134/10	<2.29E-3	<2.78E-3	<2.72E-3	<5.36E-3	<2.69E-3
Cs-137/20	<2.31E-3	<2.84E-3	<2.81E-3	<5.78E-3	<2.80E-3

\*RL = REPORTING LEVEL

LOCATION	RADIO TOWER	LACBWR	TRAILER COURT	DAM NO. 8	LA CROSSE
START DATE	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>	<u>11-26-08</u>
END DATE	<u>12-31-08</u>	<u>12-31-08</u>	<u>12-31-08</u>	<u>12-31-08</u>	<u>12-31-08</u>
ISOTOPES/RL*					
Cs-134/10	<1.82E-3	<2.65E-3	<2.43E-3	<4.00E-3	<2.13E-3
Cs-137/20	<2.05E-3	<2.71E-3	<2.45E-3	<3.98E-3	<2.26E-3

\*RL = REPORTING LEVEL

TABLE 12

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>1-08-08</u> DAM 8	SAMPLE #2 <u>1-08-08</u> OUTFALL	SAMPLE #3 <u>1-08-08</u> VICTORY	SAMPLE #1 <u>2-12-08</u> DAM 8	SAMPLE #2 <u>2-12-08</u> OUTFALL	SAMPLE #3 <u>2-12-08</u> VICTORY
ISOTOPES/RL *						
H-3	<182	<182	<182	195 ± 138	210 ± 139	<147
Mn-54/1000	<5.61	<5.45	<5.37	<5.37	<5.58	<5.53
Co-60/300	<5.96	<5.89	<5.86	<5.82	<5.73	<5.68
Zn-65/300	<12.1	<12.4	<12.2	<12.3	<12.6	<12.1
Cs-134/30	<5.99	<6.03	<5.78	<6.06	<6.12	<6.07
Cs-137/50	3.80 ± 1.2	<3.21	<3.62	<6.10	<6.28	<6.20

\* RL = REPORTING LEVEL

TABLE 12

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>3-11-08</u> DAM 8	SAMPLE #2 <u>3-11-08</u> OUTFALL	SAMPLE #3 <u>3-12-08</u> VICTORY	SAMPLE #1 <u>4-08-08</u> DAM 8	SAMPLE #2 <u>4-08-08</u> OUTFALL	SAMPLE #3 <u>4-08-08</u> VICTORY
ISOTOPES/RL *						
H-3	227 ± 1.48	326 ± 150	311 ± 141	<159	<159	<159
Mn-54/1000	<5.49	<5.43	<5.45	<4.28	<4.22	<4.13
Co-60/300	<5.82	<5.84	<5.82	<4.15	<4.34	<4.31
Zn-65/300	<12.2	<12.1	<12.3	<9.70	<9.31	<9.74
Cs-134/30	<6.03	<6.14	<6.07	<4.74	<4.63	<4.70
Cs-137/50	<6.24	<5.95	<6.03	<4.67	<3.14	<3.00

\* RL = REPORTING LEVEL

**TABLE 12**

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>5-12-08</u> DAM 8	SAMPLE #2 <u>5-12-08</u> OUTFALL	SAMPLE #3 <u>5-12-08</u> VICTORY	SAMPLE #1 <u>6-09-08</u> DAM 8	SAMPLE #2 <u>6-09-08</u> OUTFALL	SAMPLE #3 <u>6-09-08</u> VICTORY
ISOTOPES/RL *						
H-3	<159	<159	<159	<163	<163	<163
Mn-54/1000	<3.96	<4.06	<4.01	<4.02	<4.22	<4.02
Co-60/300	<4.32	<4.15	<4.46	<4.22	<4.33	<4.47
Zn-65/300	<9.29	<9.71	<8.86	<9.38	<9.69	<9.72
Cs-134/30	<4.34	<4.56	<4.63	<4.56	<4.61	<4.54
Cs-137/50	<4.87	<4.85	<4.61	<4.94	<4.90	<4.68

\* RL = REPORTING LEVEL



TABLE 12

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>7-08-08</u> DAM 8	SAMPLE #2 <u>7-08-08</u> OUTFALL	SAMPLE #3 <u>7-08-08</u> VICTORY	SAMPLE #1 <u>8-12-08</u> DAM 8	SAMPLE #2 <u>8-12-08</u> OUTFALL	SAMPLE #3 <u>8-12-08</u> VICTORY
ISOTOPES/RL *						
H-3	<152	278 ± 145	<152	<154	<154	<154
Mn-54/1000	<4.04	<4.07	<3.99	<4.16	<4.14	<4.14
Co-60/300	<4.32	<4.34	<4.23	<4.30	<4.49	<4.41
Zn-65/300	<9.60	<9.26	<9.31	<9.85	<9.40	<9.96
Cs-134/30	<4.54	<4.63	<4.55	<4.70	<4.56	<4.70
Cs-137/50	<4.63	<2.76	<4.76	<4.77	<4.68	<4.78

\* RL = REPORTING LEVEL

**TABLE 12**

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>9-09-08</u> <u>DAM 8</u>	SAMPLE #2 <u>9-09-08</u> <u>OUTFALL</u>	SAMPLE #3 <u>9-09-08</u> <u>VICTORY</u>	SAMPLE #1 <u>10-07-08</u> <u>DAM 8</u>	SAMPLE #2 <u>10-07-08</u> <u>OUTFALL</u>	SAMPLE #3 <u>10-07-08</u> <u>VICTORY</u>
ISOTOPES/RL *						
H-3	<162	<162	<162	<164	<164	<164
Mn-54/1000	<4.04	<4.08	<4.15	<3.99	<4.05	<4.02
Co-60/300	<4.45	<4.41	<4.46	<4.32	<4.41	<4.50
Zn-65/300	<9.22	<9.19	<9.54	<9.76	<9.63	<9.28
Cs-134/30	<4.69	<4.57	<4.52	<4.65	<4.57	<4.44
Cs-137/50	<4.69	<4.69	<4.89	<4.67	<4.66	<4.68

\* RL = REPORTING LEVEL

TABLE 12

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER WATER IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Liter)

COLLECTION DATE: SAMPLE LOCATION:	SAMPLE #1 <u>11-12-08</u> <u>DAM 8</u>	SAMPLE #2 <u>11-12-08</u> <u>OUTFALL</u>	SAMPLE #3 <u>11-12-08</u> <u>VICTORY</u>	SAMPLE #1 <u>12-08-08</u> <u>DAM 8</u>	SAMPLE #2 <u>12-08-08</u> <u>OUTFALL</u>	SAMPLE #3 <u>12-08-08</u> <u>VICTORY</u>
ISOTOPES/RL *						
H-3	<168	<168	<168	<149	<149	<149
Mn-54/1000	<4.02	<4.14	<4.19	<4.04	<4.12	<3.95
Co-60/300	<4.22	<4.32	<4.16	<4.38	<4.28	<4.22
Zn-65/300	<9.52	<9.32	<9.54	<9.69	<9.30	<9.19
Cs-134/30	<4.80	<4.79	<4.71	<4.56	<4.81	<4.38
Cs-137/50	<4.83	<4.86	<4.95	<4.58	<4.76	<4.85

\* RL = REPORTING LEVEL

**TABLE 13**

**RESULTS OF ANALYSIS OF MISSISSIPPI RIVER SEDIMENT IN THE VICINITY OF LACBWR**

(Concentration in pCi/Kg)  
(Reporting Level = 10 times Control Value)

SAMPLE LOCATION	UPSTREAM	OUTFALL	DOWNSTREAM	UPSTREAM	OUTFALL	DOWNSTREAM
COLLECTION DATE	<u>5-22-08</u>	<u>5-22-08</u>	<u>5-22-08</u>	<u>8-20-08</u>	<u>8-20-08</u>	<u>8-20-08</u>
<u>ISOTOPES</u>						
Cs-134	<4.96	<5.03	<10.1	<4.87	<4.22	<8.96
Cs-137	<3.33	209 ± 8.62	62.8 ± 4.18	<3.33	37.0 ± 2.29	72.2 ± 4.33
Co-60		11.6 ± 1.30			3.76 ± .80	

TABLE 14

**FISH SAMPLE ACTIVITY IN THE VICINITY OF LACBWR**

(Report Concentrations in pCi/Kg)

SAMPLE TYPE:	CARP	WALLEYE	WALLEYE	CARP	CARP	BASS
COLLECTION DATE:	<u>3-31-08</u>	<u>3-31-08</u>	<u>5-22-08</u>	<u>5-22-08</u>	<u>8-20-08</u>	<u>8-20-08</u>
ISOTOPES/RL*						
Mn-54 / 3E4	<6.21	<8.86	<6.39	<6.23	<6.04	<6.79
Co-60/ 1E4	<6.90	<10.4	<7.31	<7.52	<7.40	<7.61
Zn-65/ 2E4	<16.0	<23.3	<16.8	<16.9	<16.4	<17.8
Cs-134/ 1E3	<6.37	<9.13	<7.14	<6.93	<6.92	<7.08
Cs-137/ 2E3	31.2 $\pm$ 3.23	11.9 $\pm$ 2.79	6.88 $\pm$ 2.00	<4.98	<7.26	7.87 $\pm$ 2.78

\*RL =REPORTING LEVEL

TABLE 14

**FISH SAMPLE ACTIVITY IN THE VICINITY OF LACBWR**  
 (Report Concentrations in pCi/Kg)

SAMPLE TYPE:	<u>WALLEYE</u>	<u>CARP</u>				
COLLECTION DATE:	<u>10-23-08</u>	<u>10-23-08</u>				
ISOTOPES/RL*						
Mn-54/ 3E4	<7.35	<6.21				
Co-60/ 1E4	<8.34	<6.21				
Zn-65/ 2E4	<19.4	<16.1				
Cs-134/ 1E3	<7.88	<7.02				
Cs-137/ 2E3	<7.20	40.0 ± 3.83				
Cd-109	123 ± 61.6					

\*RL =REPORTING LEVEL