



NUCLEAR ENERGY INSTITUTE

Leslie C. Kass
SENIOR PROJECT MANAGER
ADVANCED REACTOR LICENSING
NUCLEAR GENERATION DIVISION

March 10, 2008

Mr. Ramachandran Subbaratnam
U.S. Nuclear Regulatory Commission
11555 Rockville Pike
Rockville, MD 20852

Subject: Summary of NEI/NRC Telecon on March 4, 2008

Project Number: 689

Dear Mr. Subbaratnam:

We are providing this letter to summarize the discussions and conclusions of an NEI/NRC telecon held on March 4th from 1:00pm-1:30pm EST. The telecon was conducted to finalize the proposal for a sensitivity study being conducted by the industry to address NRC questions regarding the East Tennessee Seismic Zone (ETSZ). Please find a summary of the call below:

NRC Attendees: Rebecca Karas, Cliff Munson, Sarah Gonzales, Jon Ake, Yong Li.

Industry Attendees: Leslie Kass, Adrian Heymer, Robin McGuire, John Richards, Don Moore, Bob Whorton, Jim Chardos, Jeff Munsey, Eddie Grant, Ross Hartleb, Bill Godwin.

Purpose: This telecon was a follow-up discussion with NRC based on their request for additional information during the February 29 telecon, to discuss details of a plot showing the EPRI Earth Science Team (EST) source zones and Mmax distribution planned for use in the more detailed sensitivity study for the East Tennessee Seismic Zone (ETSZ). A technical summary of these inputs was provided to NRC on March 3rd (Enclosure 1) in preparation for these discussions. A list of proposed tasks for the ETSZ study was provided to the NRC on February 28th (Enclosure 2).

Cliff Munson/Rebecca Karas – NRC staff has reviewed the additional information provided on March 3 and agree with the sensitivity study approach which appears reasonable, but have a few questions:

1. Question that the Woodward-Clyde background source zone seems high
2. Would like to see the effects of individual sources, broken-out by each EST
3. Need coordinates (latitude/longitude) for each of the EPRI seismic sources used

Handwritten initials, possibly 'LCK', in the bottom right corner of the page.

Mr. Ramachandran Subbaratnam

March 10, 2008

Page 2

4. Question the minimum magnitude evaluated and magnitude scale

Robin McGuire responded to these questions as follows:

1. The Woodward-Clyde background source zone is high, but this is their representation.
2. Individual sources can be broken-out by EST, and will be evaluated at 1Hz and 10 Hz.
3. Seismic source coordinates can be provided, but will need to be released by EPRI.
4. MB 3.3 was used as minimum magnitude (with EPRI screen at magnitude 3.0).

Becky Karas concluded that the sensitivity study is reasonable as proposed.

Robin McGuire also provided an overview of the Dames & Moore (D&M) Sensitivity Study:

- For the Vogtle site, re-look at uniform hazard versus changes in activity, with and without D&M. This evaluation will look at the changes in effects of UHS at 1Hz and 10Hz (at 10⁻⁴ and 10⁻⁵).
- For the Harris site, provide a summary of the sensitivity results from Bob Young's evaluation.

Cliff Munson commented that the Dames & Moore sensitivity review appears to be reasonable.

The proposed schedule for the work has the report being provided to the NRC for review on May 14, 2008. The final report will include the ETSZ sensitivity study, Dames and Moore sensitivity study and a topical report on the process to update the PSHA.

We appreciate your prompt availability for the conference call and look forward to working toward resolution of these issues. If you have any questions, please contact me.

Sincerely,



Leslie C. Kass

Enclosures

- c: Dr. Rebecca Karas, U.S. Nuclear Regulatory Commission
Dr. Clifford Munson, U.S. Nuclear Regulatory Commission
Dr. Yong Li, U.S. Nuclear Regulatory Commission
Dr. John Ake, U.S. Nuclear Regulatory Commission

Notes on seismic hazard sensitivity studies for Eastern Tennessee Seismic Zone

3 March 2008—R. McGuire

Maximum magnitude values

The TIP study (Ref. 1) and TVA Dam Safety study (Ref. 2) used distributions of maximum magnitude M_{max} that are somewhat higher than values used in the EPRI-SOG study. Figure 1 shows distributions of values used in the TIP and TVA studies, on the moment magnitude (M) scale.

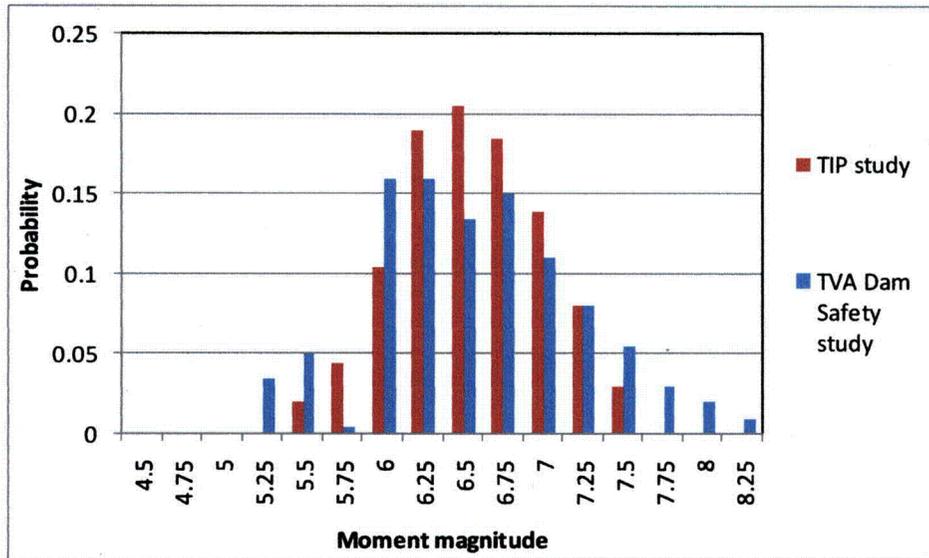


Figure 1: Distributions of M_{max} (on the moment magnitude scale) for the TIP and TVA studies.

These distributions have the following means and standard deviations (σ):

	<u>mean M</u>	<u>σ</u>
TIP study:	6.55	0.202
TVA Dam Safety study:	6.58	0.411
Composite:	6.56	0.307

Values for the composite distribution were determined by equally weighting the TIP and TVA distributions in Figure 1 and calculating the mean and σ .

For sensitivity studies on seismic hazard, the composite distribution can be represented with three magnitude values with weights, as follows:

<u>M value</u>	<u>equivalent m_b value</u>	<u>weight</u>
6.2	6.4	0.28
6.6	6.7	0.44

	7.0	6.9	0.28
Mean	6.60	6.67	
σ	0.299	0.190	

where the equivalent body-wave magnitude (m_b) values are computed by equally weighting the conversion equations from Atkinson and Boore (1995), Frankel et al. (1996), and EPRI (1993). The 3-point M distribution is one of many that could be chosen to represent the mean and σ of the composite distribution; the chosen values of M and m_b are on even tenths of a magnitude unit and will be consistent with the numerical integrations used for seismic hazard calculations. The distribution of M above (and the equivalent values of m_b) are referred to as the “composite distribution” in the next section.

EPRI-SOG source representations

The six EPRI-SOG teams represented seismicity in the region of eastern Tennessee with a range of seismic sources. These sources are summarized in Figure 2. They range from very localized sources capturing the seismicity in the eastern Tennessee region, to broad tectonic sources reflecting the geologic and tectonic structure, to large background sources that represent non-tectonic, “none-of-the-above” sources.

The specific EPRI-SOG interpretations, and the manner which they can be modified to determine the sensitivity to changes in m_{max} and seismicity for the eastern Tennessee region, are as follows. For sources that represent a tectonic explanation for the eastern Tennessee region, the m_{max} distribution will be modified to reflect the composite distribution described above. For sources that represent a background interpretation that is applicable when the tectonic sources are not active, the team’s original m_{max} distribution will not be modified to reflect the composite distribution. As summarized below, this occurs with a combined probability of about 0.21.

For these sensitivity studies, seismicity parameters will be updated using an extension of the EPRI-SOG catalog through 2007.

Bechtel team. Bechtel used 3 sources with mutually exclusive activity to represent seismicity in eastern Tennessee, as follows. (The original m_{max} values listed below are for the m_b magnitude scale, as published in the EPRI-SOG documents).

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
BEC-24	Bristol Trends	0.25	Updated (2007)	5.7-6.6	Composite
BEC-25	NY-AL lineament	0.30	Updated (2007)	5.4-6.6	Composite
BEC-25A	Altern. geom. for 25	<u>0.45</u>	Updated (2007)	5.4-6.6	Composite
	Total:	1.00			

The Bechtel team’s sources will be represented as 3 mutually exclusive sources with updated seismicity parameters (using the catalog extended through 2007) and the composite m_{max} distribution.

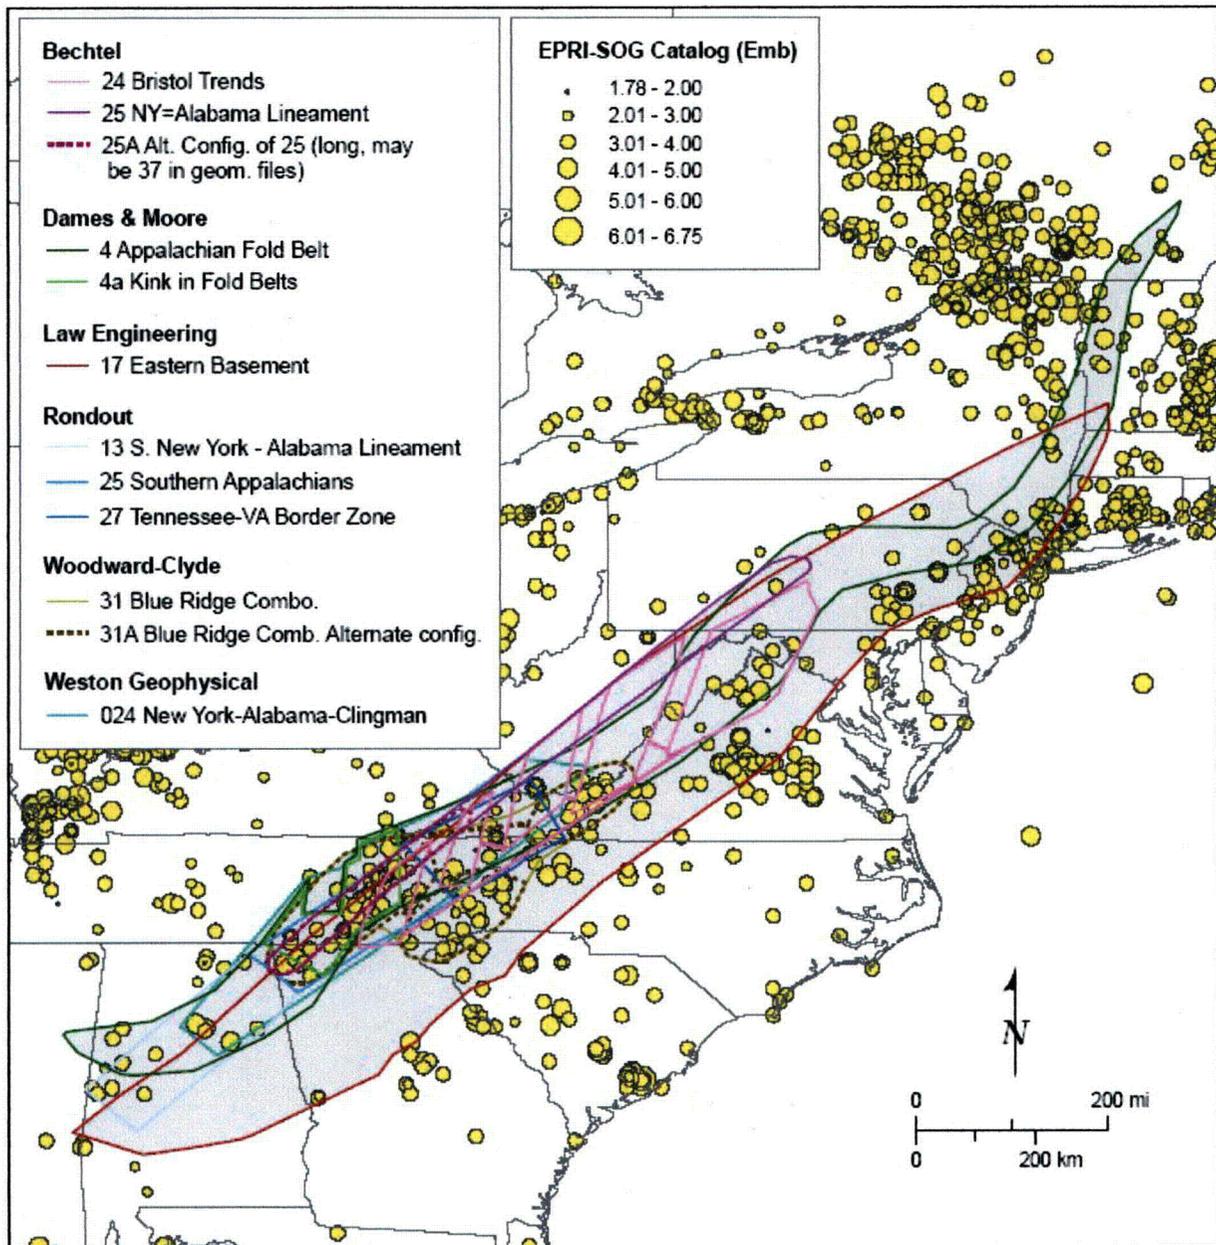


Figure 2: EPRISOG sources used to represent ETSZ, plotted with historical earthquakes from the EPRISOG catalog (figure courtesy of WLA).

Dames & Moore team. Dames & Moore used 2 sources with mutually exclusive activity to represent seismicity in eastern Tennessee, as follows.

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
DAM-04	Appal. fold belts	0.35	Updated (2007)	6.0-7.2	Composite
DAM-4A	Kink in fold belts	0.65	Updated (2007)	6.8-7.2	Composite
	Total:	1.00			

The Dames & Moore team's sources will be represented as 2 mutually exclusive sources with updated seismicity parameters (using the catalog extended through 2007) and the composite m_{max} distribution. Note that for the area covered by source DAM-4A, the combined probability of activity is 1.0, so that for a site in the center of the ETSZ there is not an issue of missing seismicity.

Law Engineering team. The Law team used one source plus a background source to represent seismicity in eastern Tennessee, as follows.

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
LAW-17	Eastern basement	0.62	Updated (2007)	5.7-6.8	Composite
LAW-217	Eastern base. BG	1.0 ($P_b=0.29$)*	Updated (2007)	4.9-5.7**	(not modified)

*--modified to $P_a=0.38$ and $P_b=1.0$ per nearby hazard studies
 **--modified to 5.2-5.7 per nearby hazard studies

The LAW-217 source has the same geometry as the LAW-17 source and is identified as a background source with probability of background $P_b=0.29$. Both the LAW-17 and LAW-217 sources use spatial smoothing of seismicity. The difference between the two sources is in the m_{max} values. As done in hazard studies at a site in the vicinity of the ETSZ, the P_a of LAW-217 will be changed to 0.38 (with $P_b=1.0$), and the original m_{max} distribution will be modeled as 5.2-5.7. Thus there will be a total $P_a=1.0$ for the LAW sources.

Rondout team. Rondout used 3 separate sources with non-overlapping geometries to represent seismicity in eastern Tennessee, as follows.

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
RND-25	So. Appalachians	0.99*	Updated (2007)	6.6-7.0	Composite
RND-13	So. NY-AL lineament	1.00	Updated (2007)	5.2-6.5	Composite
RND-27	TN-VA border zone	0.99*	Updated (2007)	5.2-6.5	Composite

*--will be changed to 1.00

The RND-25 source is centered on the ETSZ, and the RND-13 and RND-27 sources represent seismicity to the southwest and northeast, respectively. All 3 sources will be used to compute hazard sensitivity with updated seismicity parameters (using the catalog extended through 2007) and the composite m_{max} distribution.

Weston Geophysical team. Weston used one source plus a background source to represent seismicity in eastern Tennessee, as follows.

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
WGC-24	NY-AL Clingman	0.90	Updated (2007)	5.4-6.6	Composite
WGC-C17	So. Appalachians BG	0.10	Updated (2007)	5.4-6.6	(not modified)
	Total:	1.00			

Source WGC-24 is the Weston tectonic interpretation that incorporates the ETSZ. Background source C17 represents the remaining probability of 0.1 that earthquakes occur with some other explanation.

Woodward-Clyde team. Woodward-Clyde used 2 sources with mutually exclusive activity to represent seismicity in eastern Tennessee. The total probability of activity of these sources is 0.235. The remaining activity is represented by a Woodward-Clyde background source.

<u>Source</u>	<u>Name</u>	<u>P[activity]</u>	<u>Seismicity</u>	<u>Orig. m_{max}</u>	<u>Modified m_{max}</u>
WCC-31	Blue Ridge Comb.	0.024	Updated (2007)	5.9-7.0	Composite
WCC-31A	Blue Ridge Comb. Alt.	0.211	Updated (2007)	5.9-7.0	Composite
WCC-BG	Local background	<u>0.765</u>	Updated (2007)	5.8-6.6	(not modified)
	Total:	1.00			

The Woodward-Clyde team sources will be represented as 3 mutually exclusive sources with updated seismicity parameters (using the catalog extended through 2007). Two of these are tectonic sources and will be modified with the composite m_{max} distribution. The last source is a background source that will maintain the original m_{max} distribution. The total P[activity] for these sources is 1.0.

Summary. All of the six EPRI-SOG teams have interpretations of seismicity in the ETSZ with a total P[activity] of 1.0. Three of the six teams have alternative tectonic sources representing seismicity, and all of those sources will have m_{max} distributions modified to reflect the composite distribution. The remaining three teams have some sources representing tectonic interpretations, and alternative background sources representing the possibility that there is no specific tectonic basis in eastern Tennessee to explain historical seismicity there or to localize it there. These alternative background sources will not have their m_{max} distributions modified. These background sources have P[activity] of 0.38 (Law), 0.1 (Weston), and 0.765 (Woodward-Clyde), or a total probability (weighted by all team interpretations) of 0.2075.

The proposed seismic hazard sensitivity study using revised seismicity parameters and m_{max} value reflects the combined probability over all EPRI-SOG teams that seismicity in eastern Tennessee can be explained tectonically with about 79% confidence. For these interpretations, the m_{max} distribution will be modified to reflect the composite distribution. When tectonic interpretations do not apply (with about 21% confidence), the original EPRI-SOG m_{max} distributions will be used to represent the distributions of earthquake magnitudes in the eastern Tennessee region.

References

1. LLNL (2002). *Guidance for Performing Probabilistic Seismic Hazard Analysis for a Nuclear Plant Site: Example Application to the Southeastern United States*, USNRC Rept. NUREG/CR-6607, Oct.
2. Geomatrix Consultants (2004). *Dam Safety Seismic Hazard Assessment*, report prepared for Tennessee Valley Authority, 2 vol, September.

Proposed tasks to address ETSZ issues

TASK A: Develop updated earthquake catalog

Using publicly available sources, extend the EPRI-SOG catalog (which goes through 1984) to 2007. Delete duplicate events and aftershocks, and determine estimates of EMB, SMB, and RMB for each earthquake in the catalog (to be consistent with the EPRI-SOG study). The study region will encompass the Eastern Tennessee Seismic Zone (ETSZ), roughly bounded by longitudes 82°-- 82°W and longitudes 34°-- 37°N, but will also extend significantly to the northeast to cover seismic sources representing the ETSZ from the EPRI-SOG teams.

TASK B: Calculate updated parameters for EPRI-SOG teams

Using both the EPRI-SOG catalog and the updated catalog from Task A, calculate seismicity parameters for each of the six EPRI-SOG representations of the ETSZ. This will involve multiple sources for some teams.

Task C: Calculate seismic hazard for EPRI-SOG teams with TIP and TVA M_{max} values

For a site located within the ETSZ, calculate seismic hazard using each EPRI-SOG team's representation of the ETSZ, with parameters from both the original earthquake catalog and the updated earthquake catalog. Modify the maximum magnitude (M_{max}) distributions for the ETSZ zones to reflect the distributions published in the TIP study (Ref. 1) and TVA Dam Safety study (Ref. 2). Also include seismic hazard from the Charleston seismic zone (using recent representations from that zone, e.g. from the Vogtle ESP application) and from the New Madrid seismic zone (using recent representations from that zone, e.g. from the Clinton ESP application). Calculate hazard with EPRI (2004) ground motion equations with updated sigmas, both with and without the CAV filter (EPRI, 2006).

Task D: Document hazard sensitivity for EPRI-SOG teams

Write a description of the results from Task C in terms of the effect on GMRS ground motion at PGA, 25 Hz, 10 Hz, 5 Hz, 2.5 Hz, 1 Hz, and 0.5 Hz, of the updated seismicity parameters and of the updated (TIP and TVA) M_{max} values. Review the geologic and tectonic basis for the updated M_{max} values from the TIP and TVA Dam Safety studies. Develop recommendations on whether updates to the original EPRI-SOG parameters would increase or decrease GMRS ground motion, and whether such updates should be included in site hazard studies. If they should be included, recommend how that inclusion should take place.

Schedule: Preliminary results will be scheduled for 45 days following project start. A draft report will be scheduled for 60 days following project start.

References

1. LLNL (2002). *Guidance for Performing Probabilistic Seismic Hazard Analysis for a Nuclear Plant Site: Example Application to the Southeastern United States*, USNRC Rept. NUREG/CR-6607, Oct.
2. Geomatrix Consultants (2004). *Dam Safety Seismic Hazard Assessment*, report prepared for Tennessee Valley Authority, 2 vol, September.