

**Rancho Seco**

**Final Status Survey Summary Report**


**June 24, 2008**

**0' Auxiliary Steam Support, Class 1 Area**

**Survey Unit F8132133**

Prepared By:  Date: 6-24-2008  
FSS Engineer

Reviewed By:  Date: 11/24/08  
Lead FSS Engineer

Approved By:  Date: 2-27-09  
Dismantlement Superintendent, Radiological

## FINAL STATUS SURVEY SUMMARY REPORT

### Survey Unit:

F8132133, 0' Auxiliary Steam Support, Class 1 Area

### Survey Unit Description:

Operating History: The reinforced concrete structure contained the RadWaste processing and supporting systems. The building contained six main elevations. Residual radioactive material was known to be present on all levels of the interior of the building. Operating records and the HSA document several events with the potential for a release of radioactivity inside this structure. One report documented contamination of the auxiliary building roof. The roof was later replaced.

Site Characterization: Direct measurements were made of each of the interior elevation surfaces as well as the exterior surfaces of the structure. These measurements confirmed the presence of plant-derived radionuclides. Direct measurements on the -47' elevation showed a mean gross activity level of 320,071 dpm/100 cm<sup>2</sup> and a maximum value of 5,720,000 dpm/100 cm<sup>2</sup>. Direct measurements on the -29' elevation showed a mean gross activity level of 544,756 dpm/100 cm<sup>2</sup> and a maximum value of 11,370,000 dpm/100 cm<sup>2</sup>. Direct measurements on the -20' elevation showed a mean gross activity level of 247,831 dpm/100 cm<sup>2</sup> and a maximum value of 10,080,000 dpm/100 cm<sup>2</sup>. Direct measurements on the grade elevation showed a mean gross activity level of 373,758 dpm/100 cm<sup>2</sup> and a maximum value of 5,800,000 dpm/100 cm<sup>2</sup>. Direct measurements on the +20' elevation showed a mean gross activity level of 85,408 dpm/100 cm<sup>2</sup> and a maximum value of 1,900,000 dpm/100 cm<sup>2</sup>. Direct measurements on the +40' elevation showed a mean gross activity level of 3,288 dpm/100 cm<sup>2</sup> and a maximum value of 24,781 dpm/100 cm<sup>2</sup>. Direct measurements on the building exterior, including the mezzanine roof, showed a mean gross activity level of 1,897 dpm/100 cm<sup>2</sup> and a maximum value of 2,990 dpm/100 cm<sup>2</sup>. (The roof had been replaced prior to the classification survey.) Based on the classification procedure (DSIP-0020) and levels of gross activity reported, the interior of the auxiliary building was determined to be a Class 1, 2 area and the exterior was a Class 2,3.

HSA Events: HSA Report pg. 63.

### Survey Unit Design Information:

The Survey Unit Design Parameters are presented in Table 1 below. The survey unit and measurement locations are depicted on the maps in Attachment 1. Direct measurement locations were determined using a random-start, fixed grid pattern and 4 m<sup>2</sup> were scanned for 100% coverage. Samples of removable contamination were collected at each direct measurement location. The instrumentation used for the survey along with the MDC values are listed in Tables 2-1 and 2-2 in Attachment 2.

**Table 1. Survey Unit Design Parameters**

<b>Survey Design Parameter</b>	<b>Value</b>	<b>Comment</b>
<b>Survey Area:</b>	F813	0' Auxiliary Steam Support
<b>Survey Unit:</b>	2133	Structure Surface
<b>Class:</b>	1	LTP Table 5-4
<b>SU Area (m<sup>2</sup>):</b>	4	
<b>Evaluator:</b>	Gary Frank	
<b>DCGL (dpm/100 cm<sup>2</sup>):</b>	43000	Gross Activity DCGL
<b>Area Factor:</b>	48.3	Class 1
<b>Design DCGL<sub>me</sub> (dpm/100 cm<sup>2</sup>):</b>	2080217	Class 1
<b>LBGR (dpm/100 cm<sup>2</sup>):</b>	21500	Default = 50% DCGL
<b>Design Sigma (dpm/100 cm<sup>2</sup>):</b>	342	
<b>Type I Error:</b>	0.05	
<b>Type II Error:</b>	0.05	
<b>Predominant Nuclide:</b>	Cs-137	
<b>Sample Area (m<sup>2</sup>):</b>	0.28	Class 1
<b>Scan Area (m<sup>2</sup>):</b>	4	
<b>Scan Coverage (%):</b>	100%	Class 1
<b>Z<sub>1-α</sub>:</b>	1.645	
<b>Z<sub>1-β</sub>:</b>	1.645	
<b>Sign P:</b>	0.99865	
<b>Calculated Relative Shift:</b>	62.9	
<b>Relative Shift Used:</b>	3	Uses 3.0 if Relative Shift is >3
<b>N-Value:</b>	11	
<b>Design N-Value + 20%:</b>	14	NUREG-1575 Table 5-5
<b>Design Min Samples N:</b>	14	Class 1
<b>Grid Spacing L:</b>	0.5	Class 1

### Survey Results:

A total of 14 direct measurements were made in F8132133. The results including mean, median, standard deviation and range are shown in Table 2. All direct measurements were less than the DCGL. None of the scan measurements indicated areas of elevated activity. Scan activity ranged from 6756 to 13197 dpm/100 cm<sup>2</sup>, based on a surveyor efficiency of 0.5 and no background subtracted. Gamma particle scan measurements ranged from 4383 to 7006 cpm. Samples for removable surface activity were all less than 10% of the DCGL as shown in Table 3. Removable surface activity samples were counted for alpha activity and none was detected at the MDC shown in Table 2-1 of Attachment 2.

**Table 2. Direct Measurement Results**

Measurement ID	Gross Activity (dpm/100 cm <sup>2</sup> )
F8132133-C0001BD	1707
F8132133-C0002BD	2148
F8132133-C0003BD	2199
F8132133-C0004BD	2184
F8132133-C0005BD	1997
F8132133-C0006BD	1987
F8132133-C0007BD	1873
F8132133-C0008BD	2853
F8132133-C0009BD	3932
F8132133-C0010BD	2018
F8132133-C0011BD	1878
F8132133-C0012BD	1997
F8132133-C0013BD	1976
F8132133-C0014BD	1821
Mean:	2183
Median:	1997
Standard Deviation:	571
Range:	1707 - 3932

**Table 3. Removable Surface Activity Results**

<b>Measurement ID</b>	<b>Surface Beta Activity (dpm/100 cm<sup>2</sup>)</b>
F8132133C0001SM	-0.95
F8132133C0002SM	-0.95
F8132133C0003SM	1.64
F8132133C0004SM	1.64
F8132133C0005SM	2.93
F8132133C0006SM	-2.24
F8132133C0007SM	-2.24
F8132133C0008SM	-4.82
F8132133C0009SM	-2.24
F8132133C0010SM	1.64
F8132133C0011SM	-0.95
F8132133C0012SM	-0.95
F8132133C0013SM	-3.53
F8132133C0014SM	-3.53
<b>Mean:</b>	-1.04
<b>Median:</b>	-0.95
<b>Standard Deviation:</b>	2.29
<b>Range:</b>	-4.82 to 2.93

**Survey Unit Data Assessment:**

The survey design required 14 direct measurements for the Sign Test. The critical value and the results of the Sign Test are presented in Table 4. The sample mean and median values were less than the DCGL. The sample standard deviation was greater than the design standard deviation but no additional samples were required, since both values of sigma resulted in a relative shift greater than three (3), no additional samples were required.

**Table 4. Data Assessment Results**

<b>Survey Results Parameter</b>	<b>Value</b>	<b>Comment</b>
<b>Material Background Used</b> (dpm/100 cm <sup>2</sup> ):	N/A	
<b>Ambient Background Used</b> (dpm/100 cm <sup>2</sup> ):	N/A	Average Ambient BKG = 0
<b>Actual Direct Measurements (N):</b>	14	
<b>Median</b> (dpm/100 cm <sup>2</sup> ):	1997	
<b>Mean</b> (dpm/100 cm <sup>2</sup> ):	2183	
<b>Direct Measurement Standard Deviation</b> (dpm/100 cm <sup>2</sup> ):	571	
<b>Total Standard Deviation</b> (dpm/100 cm <sup>2</sup> ):	571	Based on samples and backgrounds.
<b>Maximum</b> (dpm/100 cm <sup>2</sup> ):	3932	
<b>Material Type:</b>	N/A	Background Subtract Not Applied
<b>Sign Test Final N Value:</b>	14	
<b>S+ Value:</b>	14	
<b>Critical Value:</b>	10	
<b>Sufficient Samples Collected:</b>	Yes	
<b>Maximum Value &lt; DCGL:</b>	Yes	
<b>Median Value &lt; DCGL:</b>	Yes	
<b>Mean Value &lt; DCGL:</b>	Yes	
<b>Maximum Value &lt; DCGL<sub>emc</sub>:</b>	Yes	Class 1
<b>Total Standard Deviation &lt;= Sigma:</b>	Investigate	All values <DCGL <sub>w</sub>
<b>Pass the Sign Test?</b>	Yes	
<b>Reject the Null Hypothesis?</b>	Yes	
<b>Does the Survey Unit Pass All Criteria?</b>	Investigate	Survey Unit Passes

**Survey Unit Investigations and Results:**

No investigations were required for either direct or scan measurements and no investigation results are reported.

**ALARA Statement:**

As stated in Chapter 4 of the LTP, as long as the residual activity within the survey unit is less than the DCGL, the ALARA criterion has been met.

**Changes in Initial Survey Unit Assumptions:**

The survey unit was designed as a Class 1 structure survey and the sample results are consistent with that classification. The variability of the survey results was greater than the characterization data used for survey design. However, no additional samples were required. No potential areas of elevated activity were detected. Therefore the EMC criterion was met.

**Conclusion:**

The FSS of this survey unit was properly designed as a Class 1 survey based on Table 5-4 of the LTP. The required number of direct measurements was made and the scan coverage met the requirement of Table 5-6 of the LTP. No direct measurements exceeded the DCGL of 43000 dpm/100 cm<sup>2</sup> and none of the removable surface activity measurements exceeded 10% of the DCGL. No investigations were required.

The direct measurement data support rejection of the null hypothesis, providing high confidence that the survey unit satisfied the release criteria and that the data quality objectives were met.

It is concluded that survey unit F8132133 meets the release criteria of 10CFR20.1402.


**Attachment 1**

**Maps**

**June 24, 2008**

**Survey Unit F8132133**


F8132133 - Beta Scans

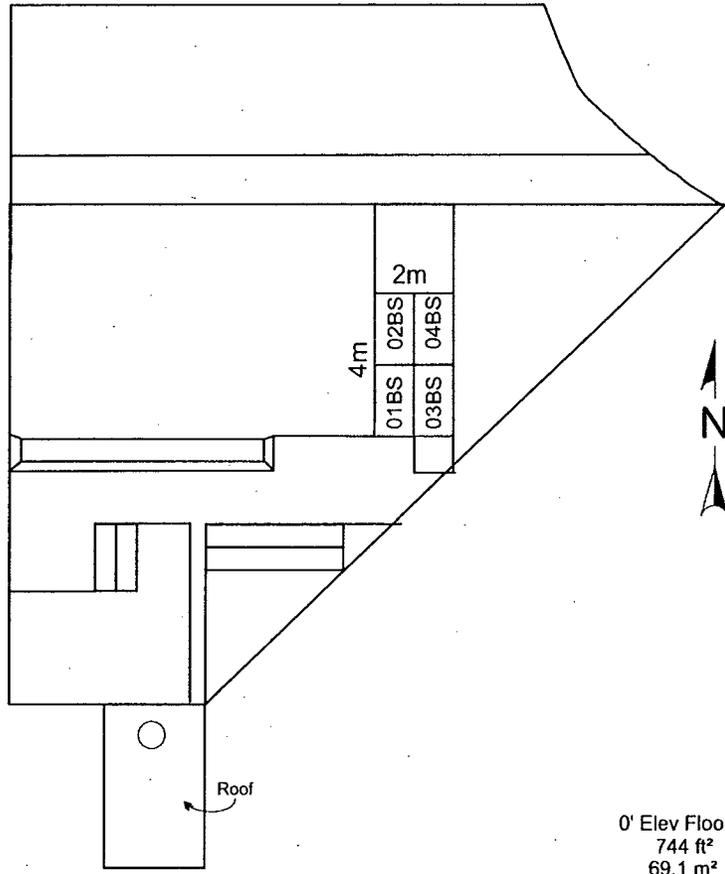

0'-0" ELEV. Auxiliary Steam Supports

F8132133 - M1

F8132133 - Beta Direct

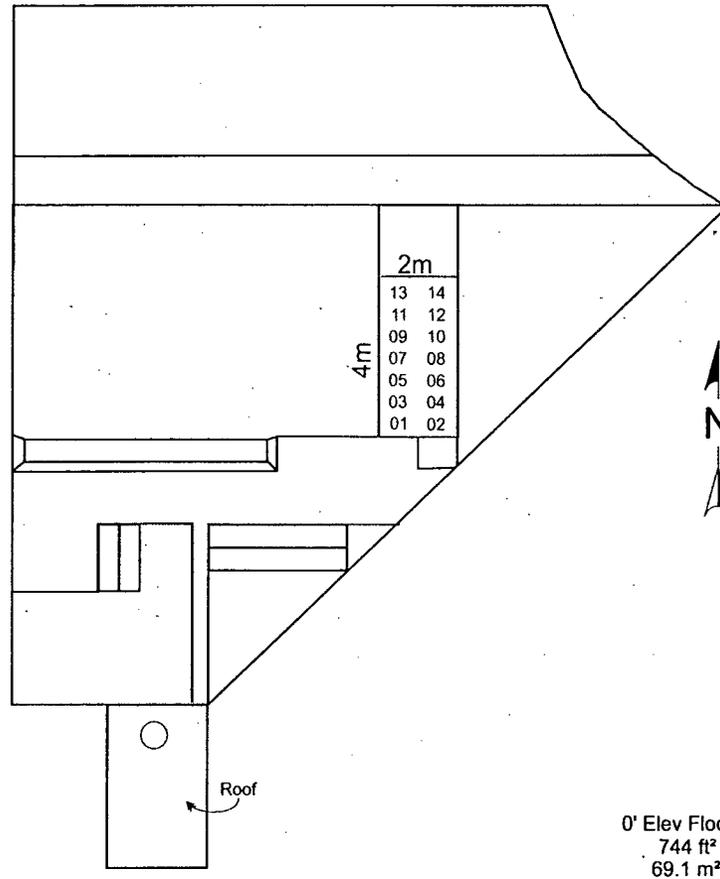


Gamma Backgrounds are obtained from the beta direct points 1 through 10 in order.

0'-0" ELEV. Auxiliary Steam Supports

F8132133 - M2

F8132133 - Gamma Particle Scans

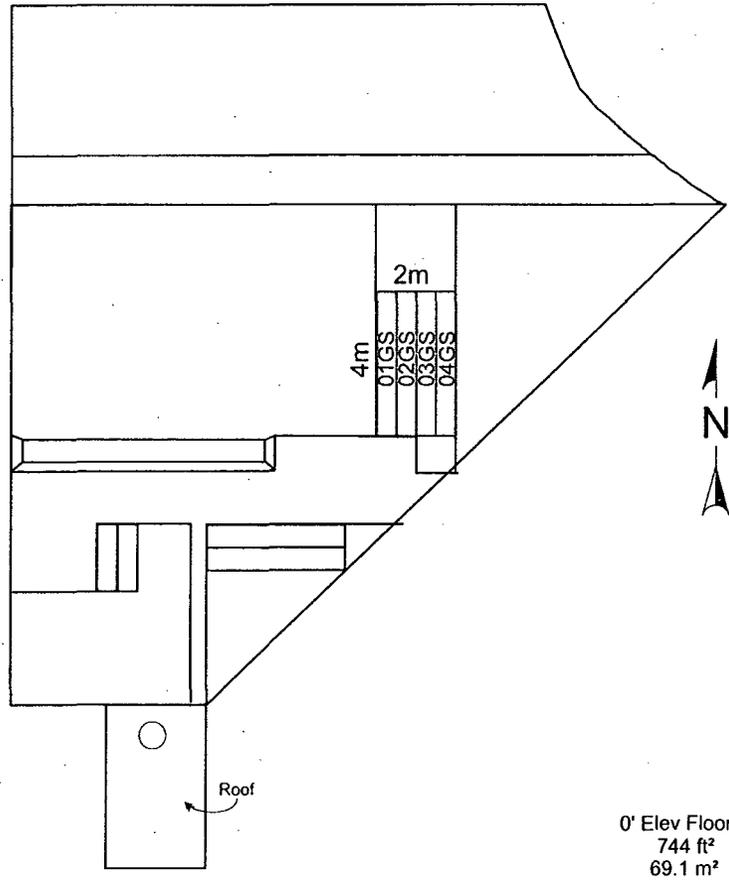

0' Elev Floor  
744 ft<sup>2</sup>  
69.1 m<sup>2</sup>

0'-0" ELEV. Auxiliary Steam Supports

F8132133 - M3

**Attachment 2**

**Instrumentation**

**June 24, 2008**

**Survey Unit F8132133**

**Table 2-1. Survey Unit Instrumentation**

<b>Instrument Model; Serial No.</b>	<b>Detector Model; Serial No.</b>	<b>MDC Static (dpm/100 cm<sup>2</sup>)</b>	<b>MDC Scan (dpm/100 cm<sup>2</sup>)</b>
M2350; 193715	44-10; 171374	N/A	5.2 pCi/g
M2350; 193715	43-68B; 160703	433	1033
Tennelec; 0401171	N/A	6 dpm $\alpha$ , 12 dpm $\beta$	N/A

**Table 2-2. Investigation Criteria and DCGL**

<b>Parameter</b>	<b>Value (dpm/100 cm<sup>2</sup>)</b>
Investigation Criteria - Direct	2080217
Investigation Criteria – Scan	2080217
DCGL <sub>w</sub>	43000
DCGL <sub>EMC</sub>	2080217

**Attachment 3**

**Investigation**

**June 24, 2008**

**Survey Unit F8132133**

**(none required)**

**Attachment 4**

**Data Assessment**

**June 24, 2008**

**Survey Unit F8132133**

