

Dominion Nuclear Connecticut, Inc.  
Millstone Power Station  
Rope Ferry Road  
Waterford, CT 06385



**Dominion**<sup>SM</sup>

APR 30 2009

U.S. Nuclear Regulatory Commission  
Attention: Document Control Desk  
Washington, DC 20555-0001

Serial No. 09-200  
MPS Lic/GJC R0  
Docket Nos. 50-245  
50-336  
50-423  
License Nos. DPR-21  
DPR-65  
NPF-49

**DOMINION NUCLEAR CONNECTICUT, INC.**  
**MILLSTONE POWER STATION UNITS 1, 2, AND 3**  
**2008 RADIOACTIVE EFFLUENT RELEASE REPORT**

In accordance with 10 CFR 50.36a, this letter transmits the annual Radioactive Effluent Release Report for the period January 2008 through December 2008. This report meets the provisions of Section 5.7.3 of the Millstone Power Station Unit 1 Permanently Defueled Technical Specifications (PDTs), and Sections 6.9.1.6b and 6.9.1.4 of the Millstone Power Station Units 2 and 3 Technical Specifications, respectively.

Attachment 1 transmits Volume 1 of the 2008 Radioactive Effluent Release Report, in accordance with Regulatory Guide 1.21. Volume 1 contains information regarding airborne, liquid, and solid radioactivity released from Millstone Power Station, off-site dose from airborne and liquid effluents, and a description of changes made to the Radioactive Effluent Monitoring and Off-Site Dose Calculation Manual (REMDCM) during the year 2008.

Attachment 2 transmits Volume 2 of the report, which contains changes made to the REMDCM through 2008. Volume 2 consists of a complete copy of the REMDCM as of December 31, 2008, which satisfies the requirements of Sections 5.6.1c of the Millstone Power Station Unit 1 PDTs, and Sections 6.15c and 6.9.13c of the Millstone Power Station Units 2 and 3 Technical Specifications, respectively.

If you have any questions or require additional information, please contact Mr. William D. Bartron at (860) 444 4301.

Sincerely,

 4/30/09  
R. T. Griffin  
Director, Nuclear Station Safety and Licensing

JE48

NRR

Attachments: 2

Commitments made in this letter: None.

cc: U.S. Nuclear Regulatory Commission  
Region I  
475 Allendale Road  
King of Prussia, PA 19406-1415

Mr. J. B. Hickman  
NRC Project Manager Millstone Unit 1  
U.S. Nuclear Regulatory Commission  
Mail Stop T-7E18  
Washington, DC 20555

Ms. L. A. Kauffman  
NRC Inspector  
U.S. Nuclear Regulatory Commission  
Region I  
475 Allendale Road  
King of Prussia, PA 19406-1415

Ms. C. J. Sanders  
NRC Project Manager  
U.S. Nuclear Regulatory Commission  
One White Flint North, Mail Stop 8B3  
11555 Rockville Pike  
Rockville, MD 20852-2738

NRC Senior Resident Inspector  
Millstone Power Station

Director  
Bureau of Air Management  
Monitoring & Radiation Division  
Department of Environmental Protection  
79 Elm Street  
Hartford, CT 06106-5127

Mr. Robert Oliveria  
American Nuclear Insurers  
95 Glastonbury Blvd.  
Glastonbury, CT 06033


Serial No. 09-200  
Docket Nos. 50-245  
50-336  
50-423  
License Nos. DPR-21  
DPR-65  
NPF-49

**ATTACHMENT 1**

**2008 RADIOACTIVE EFFLUENT RELEASE REPORT**  
**VOLUME 1**

**MILLSTONE POWER STATION UNITS 1, 2, AND 3**  
**DOMINION NUCLEAR CONNECTICUT, INC. (DNC)**

# Millstone Power Station 2008 Radioactive Effluents Release Report Volume 1

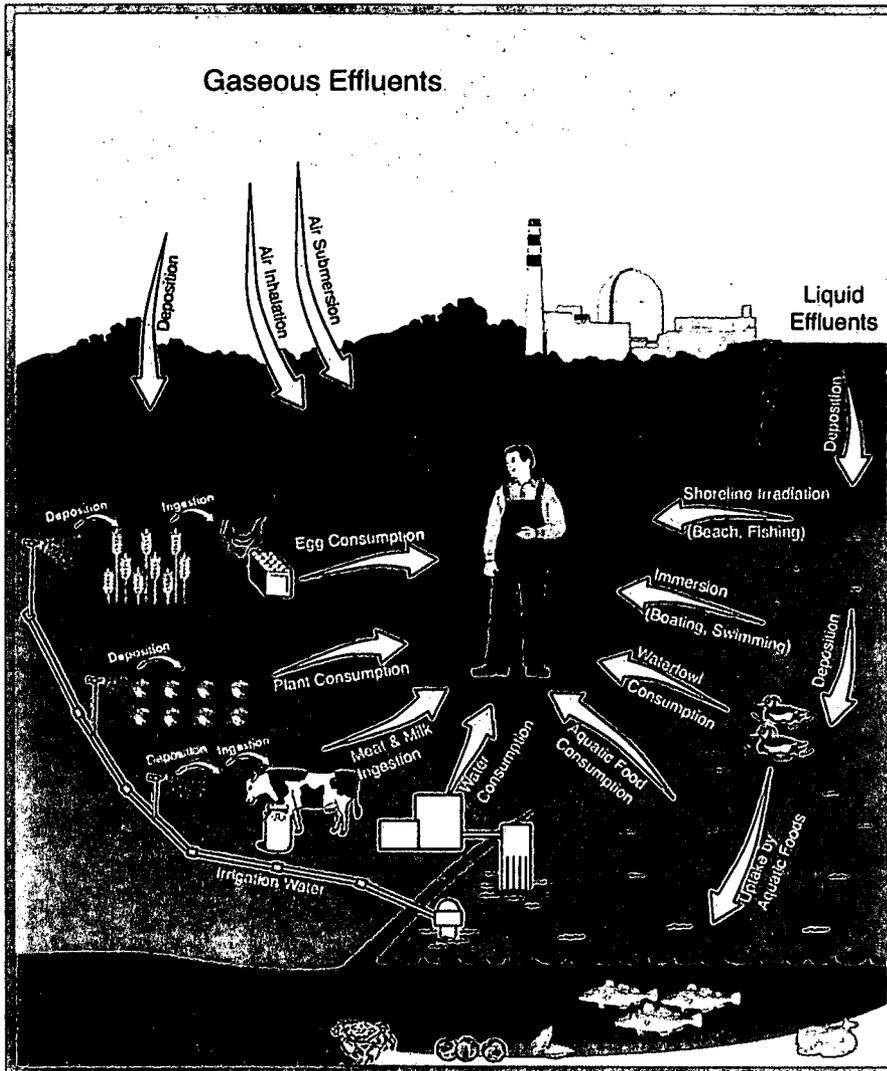

Dominion Nuclear Connecticut, Inc.

MILLSTONE UNIT	LICENSE	DOCKET
1	DPR-21	50-245
2	DPR-65	50-336
3	NPF-49	50-423



# Table of Contents

## Volume 1

Table of Contents.....	1
List of Tables.....	2
References.....	3
Introduction .....	4
1.0 Off-Site Doses.....	5
1.1 Dose Calculations.....	5
1.1.1 Airborne Effluents.....	5
1.1.2 Liquid Effluents.....	6
1.2 Dose Results.....	7
1.2.1 Airborne Effluents.....	7
1.2.2 Liquid Effluents.....	7
1.2.3 Analysis of Results.....	7
2.0 Effluent Radioactivity .....	12
2.1 Airborne Effluents .....	12
2.1.1 Measurement of Airborne Radioactivity.....	12
2.1.2 Estimate of Errors.....	14
2.1.3 Airborne Batch Release Statistics .....	14
2.1.4 Abnormal Airborne Releases.....	14
2.2 Liquid Effluents.....	34
2.2.1 Measurement of Liquid Radioactivity.....	34
2.2.1.1 Continuous Liquid Releases.....	34
2.2.1.2 Liquid Tanks/Sumps.....	34
2.2.2 Estimate of Errors.....	35
2.2.3 Liquid Batch Release Statistics .....	35
2.2.4 Abnormal Liquid Releases.....	35
2.2.5 Liquid Release Tables.....	35
2.3 Solid Waste .....	49
2.4 Groundwater Monitoring .....	74
3.0 Inoperable Effluent Monitors .....	86
4.0 Operating History.....	87
5.0 Errata .....	90
6.0 REMODCM Changes.....	92
6.1 REMODCM Description of Changes.....	93

## Volume 2

2008 REMODCM Revision 26-00

## List of Tables

Table 1-1	Off-Site Dose Summary from Airborne Effluents - Units 1, 2, 3
Table 1-2	Off-Site Dose Summary from Liquid Effluents - Units 1, 2, 3
Table 1-3	Off-Site Dose Comparison to Limits - Units 1, 2, 3
Table 1-4	Off-Site Dose Comparison - Units 1, 2, 3
Table 2.1-A1	Unit 1 Airborne Effluents - Release Summary
Table 2.1-A2	Unit 1 Airborne Effluents - Ground Continuous – B O P Vent & SFPJ Vent
Table 2.1-L1	Unit 1 Liquid Effluents - Release Summary (Release Point - Quarry)
Table 2.1-L2	Unit 1 Liquid Effluents - Batch - (Release Point - Quarry)
Table 2.2-A1	Unit 2 Airborne Effluents - Release Summary
Table 2.2-A2	Unit 2 Airborne Effluents - Mixed Continuous - Aux Bldg Vent, SGBD Tank Vent & Spent Fuel Pool Evaporation
Table 2.2-A3	Unit 2 Airborne Effluents - Mixed / Elevated Batch - Containment Purges
Table 2.2-A4	Unit 2 Airborne Effluents - Elevated Batch - WGDT
Table 2.2-A5	Unit 2 Airborne Effluents - Elevated Continuous - Containment Vents/Site stack
Table 2.2-A6	Unit 2 Airborne Effluents – Ground Batch - Containment Equipment Hatch
Table 2.2-A7	Unit 2 Airborne Effluents – Ground Batch - RWST Vent
Table 2.2-L1	Unit 2 Liquid Effluents - Release Summary - (Release Point - Quarry)
Table 2.2-L2	Unit 2 Liquid Effluents - Continuous – SGBD, SW, RBCCW - (Release Point - Quarry)
Table 2.2-L3	Unit 2 Liquid Effluents - Batch – LWS - (Release Point - Quarry)
Table 2.2-L4	Unit 2 Liquid Effluents - Release Summary - (Release Point - Yard Drain DSN 006)
Table 2.2-L5	Unit 2 Liquid Effluents - Continuous - Turbine Building Sump - (Release Point - Yard Drain DSN 006)
Table 2.3-A1	Unit 3 Airborne Effluents - Release Summary
Table 2.3-A2	Unit 3 Airborne Effluents - Mixed Continuous – Normal Ventilation & Spent Fuel Pool Evaporation
Table 2.3-A3	Unit 3 Airborne Effluents - Ground Continuous - ESF Building Ventilation
Table 2.3-A4	Unit 3 Airborne Effluents - Mixed Batch - Containment Drawdowns
Table 2.3-A5	Unit 3 Airborne Effluents - Mixed Batch - Containment Purges
Table 2.3-A6	Unit 3 Airborne Effluents - Elevated Continuous – Gaseous Waste System
Table 2.3-A7	Unit 3 Airborne Effluents - Elevated Batch – Containment Vents
Table 2.3-A8	Unit 3 Airborne Effluents - Ground Batch - Containment Equipment Hatch
Table 2.3-A9	Unit 3 Airborne Effluents - Ground Batch– RWST Vent
Table 2.3-L1	Unit 3 Liquid Effluents - Release Summary - (Release Point - Quarry)
Table 2.3-L2	Unit 3 Liquid Effluents - Continuous - SGBD, SW - (Release Point - Quarry)
Table 2.3-L3	Unit 3 Liquid Effluents - Batch – LWS - (Release Point - Quarry)
Table 2.3-L4	Unit 3 Liquid Effluents - Batch - CPF Waste Neut Sumps, Hotwell, S/G Bulk - (Release Point - Quarry)
Table 2.3-L5	Unit 3 Liquid Effluents - Release Summary - (Release Point - Yard Drain DSN 006)
Table 2.3-L6	Unit 3 Liquid Effluents - Continuous – T B Sump, WTT Berm - (Release Point - Yard Drain DSN 006)
Table 2.3-L7	Unit 3 Liquid Effluents - Continuous - Foundation Drain Sumps - (Release Point - Yard Drain DSN 006)
Table 2.1-S	Unit 1 Solid Waste & Irradiated Component Shipments
Table 2.2-S	Unit 2 Solid Waste & Irradiated Component Shipments
Table 2.3-S	Unit 3 Solid Waste & Irradiated Component Shipments
Table 2.4-GW1	Environmental Well Monitoring Results
Table 2.4-GW2	Catch Basin/Underdrain Monitoring Results
Table 2.4-GW3	Underdrain Monitoring Results
Table 2.4-GW4	RWST Yard Sample Results

## References

1. NUREG-0597 User Guide to GASPAR Code, KF Eckerman, FJ Congel, AK Roecklien, WJ Pasciak, Division of Site Safety and Environmental Analysis, Office of Nuclear Reactor Regulation, US Nuclear Regulatory Commission, Washington, DC 20555, manuscript completed January 1980, published June 1980.
2. Intentionally left blank
3. NRC Regulatory Guide 1.109 Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, Revision 1, October 1977.
4. Intentionally left blank
5. NRC Regulatory Guide 1.111 Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors, Revision 1, July 1977.
6. NUREG/CR-1276, ORNL/NUREG/TDMC-1 User's Manual for LADTAP II - A Computer Program for Calculating Radiation Exposure to Man from Routine Release of Nuclear Reactor Liquid Effluents, DB Simpson, BL McGill, prepared by Oak Ridge National Laboratory, Oak Ridge, TN 37830, for Office of Administration, US Nuclear Regulatory Commission, manuscript completed 17 March 1980.
7. 10 CFR Energy, Part 50 Domestic Licensing of Production and Utilization Facilities, Appendix I Numerical Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion "As Low As Reasonably Achievable" for Radioactive Material in Light-Water-Cooled Nuclear Power Reactor Effluents.
8. 40 CFR Environmental Protection Agency, Part 190 Environmental Radiation Protection Standard for Nuclear Power Operation.
9. DOSLIQ-Dose Excel Code for Liquid Effluents, Software Document File, Rev 1, February 2002.
10. DOSAIR-Dose Excel Code for Airborne Effluents, Software Document File, Rev 0, February 2002.
11. GASPAR II - Technical Reference and User Guide (NUREG/CR-4653), March 1987.
12. NEI 07-07 Industry Ground Water Protection Initiative – Final Guidance Document, August 2007.
13. Memo - MP-CHEM-09011, 2008 Radioactive Effluent Data, April 7, 2009.
14. Memo - MP-CHEM-09012, 2008 Radioactive Effluent Miscellaneous Data, April 8, 2009.
15. Memo - MP-CHEM-09013, 2008 Unplanned Radioactive Releases, April 8, 2009.
16. Memo - MP-CHEM-09015, GPI Tables for 2008 RERR, April 9, 2009.
17. Memo - NSE-09-007, 2008 Effluent Monitor Performance, April 8, 2009.

18. Memo - MP-HPO-09025, 2008 Report on Solid Waste and Irradiated Component Shipments, April 9, 2009.

## Introduction

This report, for the period of January through December of 2008, is being submitted by Dominion Nuclear Connecticut, Inc. for Millstone Power Station's Units 1, 2, and 3, in accordance with 10CFR50.36a, the REMODCM, and the Station's Technical Specifications. A combined report, written in the US NRC Regulatory Guide 1.21 format, is submitted for all three units.

Volume 1 contains radiological and volumetric information on airborne and liquid effluents, shipments of solid waste & irradiated components, calculated offsite radiological doses, all changes to the REMODCM, information on effluent monitors inoperable for more than 30 consecutive days, and corrections to previous reports. Volume 2 contains a full copy of each of the complete revisions to the REMODCM effective during the calendar year.



## 1.0 Off-Site Doses

This report provides a summary of the 2008 off-site radiation doses from releases of radioactive materials in airborne and liquid effluents from Millstone Units 1, 2, and 3. This includes the annual maximum dose (mrem) to any real member of the public as well the maximum gamma and beta air doses.

To provide perspective, these doses are compared to the regulatory limits and to the annual average dose that a member of the public could receive from natural background and other sources.

### 1.1 Dose Calculations

The off-site dose to humans from radioactive airborne and liquid effluents have been calculated using measured radioactive effluent data, measured meteorological data, and the dose computer models DOSAIR and DOSLIQ, which were developed by Millstone. The methodology and input parameters for DOSAIR are those used in GASPAR II (Reference 12) and NRC Regulatory Guide 1.109 (Reference 3). The methodology and input parameters for DOSLIQ are those used in LADTAP II (Reference 6) and NRC Regulatory Guide 1.109 (Reference 3). The calculated doses generally tend to be conservative due to the conservative model assumptions. More realistic estimates of the off-site dose can be obtained by analysis of environmental monitoring data. A comparison of doses estimated by each of the above methods is presented in the Annual Radiological Environmental Operating Report.

Doses are based upon exposure to the airborne and liquid effluents over a one-year period and an associated dose commitment over a 50-year period from initial exposure. The portion of the doses due to inhalation and ingestion take into account radioactive decay and biological elimination of the radioactive materials.

Maximum individual dose is defined as the dose to the individual who would receive the maximum dose from releases of airborne and liquid effluents. Although the location of the maximum individual may vary each quarterly period, the annual dose is the sum of these quarterly doses. This conservatively assumes that the individual is at the location of maximum dose each quarter.

The dose calculations are based upon three types of input: radioactive source term, site-specific data, and generic factors. The radioactive source terms (Curies) are characterized in Section 2, Effluent Radioactivity, of this report. The site-specific data includes: meteorological data (e.g. wind speed, wind direction, atmospheric stability, etc.) to calculate the transport and dispersion of airborne effluents, and dilution factors for liquid effluents. The generic factors include the average annual consumption rates (for inhalation of air and ingestion of fruits, vegetables, leafy vegetables, grains, milk, poultry, meat, fish, and shellfish) and occupancy factors (for air submersion and ground irradiation, shoreline activity, swimming, boating, etc.). All these inputs are used in the appropriate dose models to calculate the maximum individual dose from radioactive airborne and liquid effluents.

#### 1.1.1 Airborne Effluents

Maximum individual doses due to the release of noble gases, radiiodines, and particulates were calculated using the computer code DOSAIR (Reference 11). This is equivalent to the NRC code, GASPAR II, which uses a semi-infinite cloud model to implement the NRC Regulatory Guide 1.109 (Reference 3) dose models.

The values of average relative effluent concentration ( $\chi/Q$ ) and average relative deposition ( $D/Q$ ) used in the DOSAIR code were generated using EDAN4, a meteorological computer code which implements the assumptions cited in NRC Regulatory Guide 1.111 (Reference 5), Section C. The

annual summary of hourly meteorological data (in 15-minute increments), which includes wind speed, direction, atmospheric stability, and joint frequency distribution, is not provided in the report but can be retrieved from computer storage.

Millstone Stack (375 ft) releases are normally considered elevated with Pasquill stability classes determined based upon the temperature gradient between the 33 ft and 374 ft meteorological tower levels. The doses were conservatively calculated using mixed mode 142 ft meteorology since DOSAIR may underestimate the plume exposure (prior to plume touchdown) for elevated releases from the Millstone Stack. All three units previously had the ability to discharge effluents to the Millstone Stack. However, in March 2001, Unit 1 was separated from releasing to the stack and modifications were made to add two new release points, the Spent Fuel Pool Island (SFPI) Vent and the Balance of Plant (BOP) Vent.

Unit 1 Spent Fuel Pool Island Vent (73 ft) and the Balance of Plant Vent (80 ft) releases are considered ground level; therefore these doses were calculated using the 33 ft meteorology. Continuous ventilation of the Spent Fuel Pool Island and the evaporation from the spent fuel pool water (H-3) release through the Spent Fuel Pool Island Vent. Continuous ventilation from other Unit 1 buildings and airborne releases from the reactor building evaporator are discharged to the BOP Vent. Doses from these release points were summed to determine the total Unit 1 airborne effluent dose.

Unit 2 Auxiliary Building Ventilation, Steam Generator Blowdown Tank Vent, and Containment Purge, (through the Unit 2 Vent, ~159 ft) releases are considered mixed mode (partially elevated and partially ground) releases. The first two of these are continuous releases while the Containment Purge is typically a batch release. Containment Purges can also be released via the Millstone Stack. Because doses for releases from the Unit 2 Vent and from the Millstone Stack are calculated using the same meteorology, the Containment Purge releases are not divided between Unit 2 Vent and Millstone Stack. Batch releases from the Waste Gas Decay Tanks and Containment Vents are typically discharged via the Millstone Stack. The doses for these elevated releases were conservatively calculated using mixed mode 142 ft meteorology for which the Pasquill stability classes are determined based upon the temperature gradient between the 33 ft and 142 ft meteorological tower levels. The Containment Equipment Hatch and the RWST Tank Vent releases are considered ground level where the 33 ft meteorology was used for the dose calculations. Each of the doses for the various release points were summed to determine the total Unit 2 airborne effluent dose.

The Unit 3 Vent (142.5 ft) is considered a mixed mode (partially elevated and partially ground) release point. The Pasquill stability classes are determined based upon the temperature gradient between the 33 ft and 142 ft meteorological tower levels. Auxiliary Building Ventilation is a mixed mode continuous release while Containment Purge and the "initial" Containment Drawdown (released at the roof of the Auxiliary Building) are considered mixed mode batch releases. Gaseous waste and operational containment drawdowns (also called containment vents) are released through the Unit 3 Supplementary Leak Collection and Recovery System (SLCRS) system to the Millstone Stack (375 ft). The doses for these elevated releases were conservatively calculated using mixed mode 142 ft meteorology. The Engineered Safety Features Building (ESF) Ventilation, the Containment Equipment Hatch, and Refueling Water Storage Tank (RWST) Vent releases are considered ground level where the doses were calculated using 33 ft meteorology. Similar to Unit 2, each of the doses for the various release points were summed to determine the total Unit 3 airborne effluent dose.

### **1.1.2 Liquid Effluents**

Maximum individual doses from the release of radioactive liquid effluents were calculated using the DOSLIQ program (Reference 10). This program uses the dose models and parameters cited in NRC Regulatory Guide 1.109 with site-specific inputs to produce results similar to the LADTAP II code, (Reference 6).

## 1.2 Dose Results

The calculated maximum off-site doses are presented in Table 1-1 for airborne effluents and Table 1-2 for liquid effluents.

### 1.2.1 Airborne Effluents

For the dose to the maximum individual, DOSAIR calculates the dose to the whole body, GI-tract, bone, liver, kidney, thyroid, lung, and skin from each of the following pathways: direct exposure from noble gases in the plume and from ground deposition, inhalation, and ingestion of vegetation, cow or goat milk, and meat. The values presented are a total from all pathways. However, only the whole body, skin, thyroid and maximum organ (other than thyroid) doses are presented.

For the plume and inhalation pathways, the maximum individual dose is calculated at the off-site location of the highest decayed  $\chi/Q$  where a potential for dose exists.

For ground deposition, the maximum individual dose is calculated at both the off-site maximum land location of the highest  $\chi/Q$  and highest D/Q where a potential for dose exists.

For the vegetation pathway, the maximum individual dose is calculated at the vegetable garden of the highest D/Q (or highest  $\chi/Q$  when only tritium is released). For the vegetation pathway, the calculated dose is included in the maximum individual's dose only at locations and times where these pathways actually exist. Similarly, for meat, cow's milk, and goat's milk pathways, the calculated dose is included in the maximum individual's dose only at locations and times where these pathways actually exist.

To determine compliance with 10CFR50, Appendix I (Reference 7), the maximum individual whole body and organ doses include all applicable external pathways (i.e. plume and ground exposure) as well as the internal pathways (inhalation and ingestion).

### 1.2.2 Liquid Effluents

The DOSLIQ code performs calculations for the following pathways: fish, shellfish, shoreline activity, swimming, and boating. Doses are calculated for the whole body, skin, thyroid, and maximum organ (GI-LLI, bone, liver, kidney, and lung).

### 1.2.3 Analysis of Results

Table 1-3 provides a quantitative dose comparison with the limits specified in the REMODCM. The data indicates that the total whole body and organ doses to the maximum offsite individual from Millstone Station including all sources of the fuel cycle are well within the limits of 40CFR190 (Reference 8). On-site radioactive waste storage during this year was within storage criteria and the maximum dose to a member of the public was approximately 0.18 mrem/yr. The doses from airborne and liquid effluents were added to the estimated dose from on-site radioactive waste storage to show compliance compared to 40CFR190.

The Offsite Dose Comparison, Table 1-4, provides a perspective on the maximum offsite individual dose received from Millstone Station with the natural background radiation dose received by the average Connecticut resident. The total dose to the maximum individual received from Millstone Station is small (< 0.1%) in comparison to the dose received from natural background radiation.

**Table 1-1**  
**2008 Off-Site Dose Commitments from Airborne Effluents**  
**Millstone Units 1, 2, 3**

<b>Unit 1</b>	<b>1st Quarter</b>	<b>2nd Quarter</b>	<b>3rd Quarter</b>	<b>4th Quarter</b>	<b>Annual Total</b>
<b>Max Air</b>	(mrad)	(mrad)	(mrad)	(mrad)	(mrad)
<i>Beta</i>	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<i>Gamma</i>	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	8.11E-05	1.76E-04	1.42E-04	5.45E-05	4.53E-04
<i>Skin</i>	8.89E-05	1.76E-04	1.42E-04	5.45E-05	4.61E-04
<i>Thyroid</i>	8.10E-05	1.76E-04	1.42E-04	5.45E-05	4.53E-04
<i>Max organ+</i>	8.13E-05	1.76E-04	1.42E-04	5.45E-05	4.53E-04

<b>Unit 2</b>	<b>1st Quarter</b>	<b>2nd Quarter</b>	<b>3rd Quarter</b>	<b>4th Quarter</b>	<b>Annual Total</b>
<b>Max Air</b>	(mrad)	(mrad)	(mrad)	(mrad)	(mrad)
<i>Beta</i>	4.93E-04	5.33E-03	8.60E-04	2.79E-04	6.96E-03
<i>Gamma</i>	3.75E-05	1.33E-03	1.34E-04	6.89E-05	1.57E-03
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	1.54E-04	2.40E-03	6.10E-04	4.46E-04	3.61E-03
<i>Skin</i>	4.99E-04	4.95E-03	9.82E-04	6.12E-04	7.04E-03
<i>Thyroid</i>	4.53E-04	6.41E-02	9.38E-04	4.95E-04	6.60E-02
<i>Max organ+</i>	1.60E-04	2.58E-03	6.17E-04	4.48E-04	3.81E-03

<b>Unit 3</b>	<b>1st Quarter</b>	<b>2nd Quarter</b>	<b>3rd Quarter</b>	<b>4th Quarter</b>	<b>Annual Total</b>
<b>Max Air</b>	(mrad)	(mrad)	(mrad)	(mrad)	(mrad)
<i>Beta</i>	4.29E-04	1.62E-03	6.48E-04	7.60E-03	1.03E-02
<i>Gamma</i>	2.53E-05	4.53E-04	1.53E-04	2.56E-03	3.19E-03
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	1.70E-03	2.56E-03	2.67E-03	1.11E-02	1.80E-02
<i>Skin</i>	1.99E-03	2.80E-03	2.81E-03	1.55E-02	2.31E-02
<i>Thyroid</i>	1.70E-03	2.56E-03	2.67E-03	8.64E-02	9.34E-02
<i>Max organ+</i>	1.71E-03	2.56E-03	2.67E-03	1.14E-02	1.83E-02

\* Maximum of the following organs (not including thyroid): Bone, GI-LLI, Kidney, Liver, Lung

**Table 1-2**  
**2008 Off-Site Dose Commitments from Liquid Effluents**  
**Millstone Units 1, 2, 3**

<b>Unit 1</b>	<i>1st Quarter</i>	<i>2nd Quarter</i>	<i>3rd Quarter</i>	<i>4th Quarter</i>	<i>Annual Total</i>
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	2.41E-07	0.00E+00	0.00E+00	0.00E+00	2.41E-07
<i>Thyroid</i>	6.91E-08	0.00E+00	0.00E+00	0.00E+00	6.91E-08
<i>Max Organ</i>	3.42E-07	0.00E+00	0.00E+00	0.00E+00	3.42E-07

<b>Unit 2</b>	<i>1st Quarter</i>	<i>2nd Quarter</i>	<i>3rd Quarter</i>	<i>4th Quarter</i>	<i>Annual Total</i>
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	2.69E-04	7.06E-04	2.27E-05	3.28E-05	1.03E-03
<i>Thyroid</i>	1.74E-04	1.74E-04	6.04E-06	1.45E-05	3.69E-04
<i>Max Organ</i>	5.72E-03	1.14E-02	1.02E-03	1.36E-04	1.82E-02

<b>Unit 3</b>	<i>1st Quarter</i>	<i>2nd Quarter</i>	<i>3rd Quarter</i>	<i>4th Quarter</i>	<i>Annual Total</i>
<b>Max Individual</b>	(mrem)	(mrem)	(mrem)	(mrem)	(mrem)
<i>Whole Body</i>	3.37E-05	7.39E-05	1.25E-04	4.32E-04	6.65E-04
<i>Thyroid</i>	2.29E-05	5.48E-05	1.03E-04	3.52E-04	5.33E-04
<i>Max Organ</i>	2.42E-04	1.92E-04	2.41E-04	4.85E-03	5.52E-03

**Table 1-3  
2008 Off-Site Dose Comparison to Limits  
Millstone Units 1, 2, 3**

**Airborne Effluents Dose**

**Max Individual Dose vs REMODCM & 10CFR50 Appendix I Limits**

	<b>Whole Body (mrem)</b>	<b>Thyroid (mrem)</b>	<b>Max Organ* (mrem)</b>	<b>Skin (mrem)</b>	<b>Beta Air (mrad)</b>	<b>Gamma Air (mrad)</b>
<b>Unit 1</b>	4.53E-04	4.53E-04	4.53E-04	4.61E-04	0.00E+00	0.00E+00
<b>Unit 2</b>	3.61E-03	6.60E-02	3.81E-03	7.04E-03	6.96E-03	1.57E-03
<b>Unit 3</b>	1.80E-02	9.34E-02	1.83E-02	2.31E-02	1.03E-02	3.19E-03
<b>Millstone Station</b>	<b>2.21E-02</b>	<b>1.60E-01</b>	<b>2.26E-02</b>	<b>3.06E-02</b>	<b>1.73E-02</b>	<b>4.76E-03</b>
<b><u>Limits</u></b>	<b>5</b>	<b>15</b>	<b>15</b>	<b>15</b>	<b>20</b>	<b>10</b>

**Liquid Effluents Dose**

**Max Individual Dose vs REMODCM & 10CFR50 Appendix I Limits**

	<b>Whole Body (mrem)</b>	<b>Thyroid (mrem)</b>	<b>Max Organ** (mrem)</b>
<b>Unit 1</b>	2.41E-07	6.91E-08	3.42E-07
<b>Unit 2</b>	1.03E-03	3.69E-04	1.82E-02
<b>Unit 3</b>	6.65E-04	5.33E-04	5.52E-03
<b>Millstone Station</b>	<b>1.70E-03</b>	<b>9.02E-04</b>	<b>2.37E-02</b>
<b><u>Limits</u></b>	<b>5</b>	<b>10</b>	<b>10</b>

**Total Off-Site Dose from Millstone Station**

**Max Individual Dose vs REMODCM & 40CFR190 Limits**

	<b>Whole Body (mrem)</b>	<b>Thyroid (mrem)</b>	<b>Max Organ * (mrem)</b>
<b>Airborne Effluents</b>	2.21E-02	1.60E-01	2.26E-02
<b>Liquid Effluents</b>	1.70E-03	9.02E-04	2.37E-02
<b>Radwaste Storage</b>	1.80E-01	1.80E-01	1.80E-01
<b>Millstone Station</b>	<b>2.04E-01</b>	<b>3.41E-01</b>	<b>2.26E-01</b>
<b><u>Limits</u></b>	<b>25</b>	<b>75</b>	<b>25</b>

Note: REMODCM limits are listed in 10CFR50, Appendix I which contains additional limits not listed in the REMODCM

\* Maximum of the following organs (not including Thyroid): Bone, GI-LLI, Kidney, Liver, Lung

**Table 1-4**  
**2008 Offsite Dose Comparison**  
**Natural Background vs. Millstone Station**

<b>Average Resident</b>	<b>Natural Background Radiation Dose</b>
Cosmic	27 mrem
Cosmogenic	1 mrem
Terrestrial (Atlantic and Gulf Coastal Plain)	16 mrem
Inhaled	200 mrem
In the Body	40 mrem
<b>~ 284 mrem</b>	

Courtesy NCRP Report 94 (1987)

<b>Maximum Off-Site Individual</b>	<b>Millstone Station Whole Body Dose</b>
Airborne Effluents	0.0221 mrem
Liquid Effluents	0.0017 mrem
On-site RadWaste Storage	0.1800 mrem
<b>0.2038 mrem</b>	

## 2.0 Effluent Radioactivity

### 2.1 Airborne Effluents

#### 2.1.1 Measurement of Airborne Radioactivity

##### 2.1.1.1 Continuous Releases

The following pathways have continuous radiation monitors that include particulate filters and, except for Unit 1, charcoal cartridges for monitoring the activity being released:

- Unit 1 Spent Fuel Pool (SFPI) Island (no charcoal cartridge)
- Unit 1 Balance of Plant (BOP) Vent (no charcoal cartridge)
- Unit 2 Ventilation Vent
- Unit 2 Wide Range Gas Monitor (WRGM) to Site Stack
- Unit 3 Ventilation Vent
- Unit 3 Supplementary Leak Collection and Recovery System (SLCRS) to Site Stack
- Unit 3 Emergency Safeguards Facility (ESF) Building Vent

Charcoal cartridges and particulate filters are used to collect iodines and particulates, respectively. These filters are periodically replaced (typically weekly, except every two weeks for Unit 1) and then analyzed for isotopic content using a gamma spectrometer. Particulate filters are also analyzed for Sr-89 (for all but Unit 1), Sr-90 and gross alpha. At least monthly, gaseous grab samples are taken and analyzed for noble gasses and tritium. The gas washing bottle (bubbler) method is utilized for tritium collection. This sample is counted on a liquid scintillation detector. Isotopic concentrations at the release point are multiplied by the total flow to obtain the total activity released for each isotope.

Since a major source of tritium is evaporation of water from the spent fuel pools, tritium releases were also estimated based upon amount of water lost and measured concentrations of the pool water. Grab samples from the Unit 1 SFPI Vent and the Unit 2 and 3 Vents are compared to the measured evaporation technique and the higher amount from either the vent or the measured evaporation technique is used to determine the amount of tritium released.

Another continuous airborne pathway is the Unit 2 Steam Generator Blowdown Tank Vent. A decontamination factor (DF) across the SGBD Tank vent was determined for iodines by comparing the results of gamma spectrometry, HPGe, analysis of the Steam Generator Blowdown water and grab samples of the condensed steam exiting the vent. This DF was applied to the total iodine releases via the Steam Generator Blowdown water to calculate the iodine release out the vent. An additional factor of 0.33 was utilized to account for the fraction of blowdown water actually flashing to steam in the Steam Generator Blowdown Tank.

### 2.1.1.2 Batch Releases

The following pathways periodically have releases that are considered batches:

- Unit 1 Reactor Building Evaporator (via BOP Vent)
- Unit 2 Waste Gas Decay Tanks (via Unit 2 WRGM to Millstone Stack)
- Unit 2 and 3 Containment Purges (via Unit Ventilation Vents, except for Unit 2 if using Enclosure Building Filtration System (EBFS) via WRGM to Millstone Stack)
- Unit 2 and 3 Containment Vents (via EBFS to Millstone Stack for Unit 2 and via SLCRS to Millstone Stack for Unit 3)
- Unit 2 and 3 Containment Equipment Hatch Openings
- Unit 2 and 3 Refueling Water Storage Tank (RWST) Vents
- Unit 3 Containment Drawdown

Prior to processing each batch from the Reactor Building Evaporator a sample is collected and counted on a liquid scintillation detector. Concentration is multiplied by volume to determine the total activity released.

Waste Gases from the Unit 2 Gaseous Waste Processing System are held for decay in waste gas decay tanks (6) prior to discharge through the Millstone Site Stack. Each gas decay tank is analyzed prior to discharge for noble gas and tritium. Calculated volume discharged is multiplied by the isotopic concentrations (noble gas and tritium) from the analysis of grab samples to determine the total activity released.

Containment air is sampled periodically for gamma and tritium to determine the activity released from containment venting. The measured concentrations are multiplied by the containment vent volume to obtain the total activity released. Unit 2 typically performs this process of discharging air from containment to maintain pressure approximately once per week while at Unit 3 it is more often (typically at least daily). Any iodines and particulates discharged would be detected by the continuous monitoring discussed in section 2.1.1.1.

Containment air is sampled prior to each purge for gamma and tritium to determine the activity released from containment purging. Similar to containment venting, the measured concentrations are multiplied by the containment vent volume to obtain the total activity released. Any iodines and particulates discharged would be detected by the continuous monitoring discussed in section 2.1.1.1.

Samples of air near the Containment Equipment Hatch openings are analyzed for particulates and iodines, during refueling outages for the period that the equipment hatch is open. An estimated flow out of the hatch and sample results are used to determine the radioactivity released.

When water is transferred to Refueling Water Storage Tank (RWST) there is a potential for a release of radioactivity through the tank vent. A decontamination factor (DF) was applied to the total iodine contained in the water transferred to the RWST to estimate the iodine released. All noble gases are assumed to be released through the tank vent.

Unit 3 containment is initially drawn down prior to startup. This is accomplished by using the containment vacuum steam jet ejector which releases through an unmonitored vent on the roof of the Auxiliary Building. Grab samples are performed prior to drawdown to document the amount of radioactivity released during these evolutions.

## 2.1.2 Estimate of Errors

Estimates of errors associated with radioactivity measurements were made using the following guidelines:

Radioactivity Measurement Calibration	10%	Calibration to NBS standards
Sampling/Data Collection	10% - 20%	Variation in sample collection
Sample Line Loss	20% - 40%	Deposition of some nuclides
Sample Counting	10% - 30%	Error for counting statistics
Flow & Level Measurements	10% - 20%	Error for release volumes

## 2.1.3 Airborne Batch Release Statistics

### Unit 1 – None

Unit 2	Ctmt Purges	Ctmt Vents	WGDT
Number of Batches	1	37	5
Total Time (min)	841	5518	1929
Maximum Time (min)	841	230	612
Average Time (min)	841	149	386
Minimum Time (min)	841	48	145

Unit 3	Ctmt Purges	Ctmt Vents*	Ctmt Drawdowns
Number of Batches	1	230	1
Total Time (min)	301	*	427
Maximum Time (min)	301	*	427
Average Time (min)	301	*	427
Minimum Time (min)	301	*	427

\* ~ 2-3 hrs per Vent

## 2.1.4 Abnormal Airborne Releases

An abnormal airborne release of radioactivity is defined as an increase in airborne radioactive material released to the environment that was unplanned or uncontrolled due to an unanticipated event. These do not include normal routine effluent releases from anticipated operational and maintenance occurrences such as power level changes, reactor trip, opening primary system loops, degassing, letdown of reactor coolant or transferring spent resin and do not include non-routine events such as minor leakages from piping, valves, pump seals, tank vents, etc.

### 2.1.4.1 Unit 1 - None

### 2.1.4.2 Unit 2 – None

### 2.1.4.3 Unit 3 –

Description: The 'B' RHR (Residual Heat Removal) suction valve, 3RHS\*MV8702A, was identified (CR-07-12301) to have a known active pressure seal leak. Operability Determination OD MP3-020-07 evaluated the leak and determined that the leakage outside containment, including the assumed 3RHS\*MV8702A pressure seal leakage, is below the allowable limit of 5000 cc/hr. The valve was operable but not fully qualified with the valve to be overhauled during 3R12. During the shutdown and once RHR cool down was initiated on the RCS (approximately 10/12/08 12:30), the 'B' RHR suction valve began leaking (CR113568) at a rate of 1-2 gpm resulting in elevated noble gas and iodine airborne activity in the ESF building RHR cubicles (CR113701). Normal ESF building ventilation is unfiltered and was in-service during this time. Although attempts were made to filter the RHR cubicle areas, elevated levels existed for several days. These elevated levels resulted in additional releases to the environment as shown below. These levels were well within regulatory limits. Table 2.3-A3 includes these values.

Cause: Leaking suction valve as described above.

Resolution: Valve isolated and repaired.

Radioactive Source: RHR System (Reactor coolant)

Pathway to the Environment/Release Point: ESF (Emergency Safeguards Facility) Ventilation, ground level release

Release Start/Stop Dates/Times: Start: 10/12/08 12:30 Stop: 11/24/08 6:53  
Most of the releases of noble gases, iodines and particulates occurred in the first few days of the event, however significant releases occurred several days later during repair activities. Releases continued for much of 3R12. Therefore, the total time of the event encompasses all the releases from this pathway.

<u>Total Curies:</u>	<u>Isotope</u>	<u>Curies</u>	<u>Calculated Doses:</u>		
	Xe-133	7.09e-1	<u>Maximum Air (mrad)</u>	<b>Beta:</b>	<b>1.87E-04</b>
	H-3	1.00e-2		<b>Gamma:</b>	<b>6.29E-05</b>
	I-131	1.88e-3	<u>Maximum Individual (mrem)</u>	<b>Whole Body:</b>	<b>1.20E-04</b>
	I-132	2.67e-4		<b>Skin:</b>	<b>1.99E-04</b>
	I-133	2.00e-3		<b>Thyroid:</b>	<b>2.07E-02</b>
	I-135	2.11e-4		<b>Maximum</b>	<b>1.61E-04</b>
	Br-82	1.22e-6		<b>Organ:</b>	
	Co-58	2.59e-6			
	Co-60	7.76e-8			
	Ce-141	7.79e-8			
	Eu-152	9.66e-7			

These curies are also included in the 4<sup>th</sup> quarter of Table 2.3-A3 ESF Building Ventilation.

### 2.1.5 Airborne Release Tables

The following tables provide the details of the airborne radioactivity released from each of the Millstone units. They are categorized by type of release, source(s), and by release point of discharge to the environment.

**Table 2.1-A1**  
 Millstone Unit 1  
 Airborne Effluents - Release Summary

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

1. Total Activity Released	Ci					
2. Average Period Release Rate *	uCi/sec					

**B. Iodines / Halogens**

1. Total Activity Released	Ci					
2. Average Period Release Rate *	uCi/sec					

**C. Particulates**

1. Total Activity Released	Ci	1.19E-06				1.19E-06
2. Average Period Release Rate *	uCi/sec	1.51E-07				3.76E-08

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Tritium**

1. Total Activity Released	Ci	1.40E-01	1.32E-01	1.13E-01	2.35E-01	6.20E-01
2. Average Period Release Rate *	uCi/sec	1.78E-02	1.68E-02	1.42E-02	2.96E-02	1.96E-02

\* "Total Activity Released" ÷ Seconds in Quarter

"." denotes less than Minimum Detectable Activity (MDA)

**Table 2.1-A2**  
 Millstone Unit 1  
 Airborne Effluents - Ground Continuous - BOP Vent & SFPI Vent

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci					

**B. Iodines / Halogens**

	Ci	na	na	na	na	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci					

**C. Particulates**

Cs-137	Ci	1.19E-06	-	-	-	1.19E-06
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci	1.19E-06				1.19E-06

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	1.40E-01	1.32E-01	1.13E-01	2.35E-01	6.20E-01
-----	----	----------	----------	----------	----------	----------

"-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-A1**  
**Millstone Unit 2**  
**Airborne Effluents - Release Summary**

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

1. Total Activity Released	Ci	8.12E-01	1.45E+01	2.35E+00	1.03E+00	1.87E+01
2. Average Period Release Rate *	uCi/sec	1.03E-01	1.84E+00	2.95E-01	1.30E-01	5.90E-01

**B. Iodines / Halogens**

1. Total Activity Released	Ci	5.88E-04	1.42E-03	3.38E-05	5.19E-05	2.10E-03
2. Average Period Release Rate *	uCi/sec	7.48E-05	1.81E-04	4.26E-06	6.53E-06	6.63E-05

**C. Particulates**

1. Total Activity Released	Ci	2.16E-07	1.96E-05	1.12E-07		2.00E-05
2. Average Period Release Rate *	uCi/sec	2.75E-08	2.50E-06	1.41E-08		6.31E-07

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Tritium**

1. Total Activity Released	Ci	1.28E+00	5.32E+00	1.73E+00	3.16E+00	1.15E+01
2. Average Period Release Rate *	uCi/sec	1.63E-01	6.76E-01	2.17E-01	3.97E-01	3.63E-01

\* "Total Activity Released" ÷ Seconds in Quarter  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-A2**  
 Millstone Unit 2  
**Airborne Effluents - Mixed Continuous - Aux Bldg Vent & SGBD Tank Vent  
 & Spent Fuel Pool Evaporation \***

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Ar-41	Ci	-	-	-	-	
Kr-85	Ci	-	-	5.00E-01	5.00E-01	1.00E+00
Kr-85m	Ci	-	-	-	-	
Xe-133	Ci	-	1.02E+01	1.00E+00	5.00E-01	1.17E+01
Xe-133m	Ci	-	9.99E-02	-	-	9.99E-02
Xe-135	Ci	-	6.06E-02	-	-	6.06E-02
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci		1.04E+01	1.50E+00	1.00E+00	1.29E+01

**B. Iodines / Halogens**

I-131	Ci	7.49E-05	1.17E-03	6.74E-06	1.06E-05	1.26E-03
I-132	Ci	3.78E-05	7.70E-05	-	-	1.15E-04
I-133	Ci	2.72E-04	8.07E-05	2.71E-05	4.06E-05	4.20E-04
I-134	Ci	-	-	-	-	
I-135	Ci	2.03E-04	-	-	-	2.03E-04
Br-82	Ci	-	4.82E-06	-	-	4.82E-06
Total Activity	Ci	5.88E-04	1.33E-03	3.38E-05	5.12E-05	2.01E-03

**C. Particulates**

Co-58	Ci	-	2.24E-06	-	-	2.24E-06
Co-60	Ci	-	1.44E-06	-	-	1.44E-06
Nb-95	Ci	-	3.27E-07	-	-	3.27E-07
Zr-95	Ci	-	5.18E-07	-	-	5.18E-07
Cs-137	Ci	2.16E-07	7.26E-07	-	-	9.42E-07
	Ci					
Sr-89	Ci	-	-	-	-	
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci	2.16E-07	5.25E-06			5.47E-06

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium \***

H-3	Ci	1.14E+00	5.02E+00	1.59E+00	2.32E+00	1.01E+01
-----	----	----------	----------	----------	----------	----------

\* Includes estimated Spent Fuel Pool evaporation  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-A3**  
 Millstone Unit 2  
**Airborne Effluents - Mixed Batch - Containment Purges**

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Kr-85	Ci	na	1.82E+00	na	na	1.82E+00
Xe-133	Ci	na	2.00E-01	na	na	2.00E-01
Xe-135	Ci	na	4.00E-03	na	na	4.00E-03
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci		2.02E+00			2.02E+00

**B. Iodines / Halogens \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**C. Particulates \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**D. Gross Alpha \***

Gross Alpha	Ci	*	*	*	*	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	na	9.40E-02	na	na	9.40E-02
-----	----	----	----------	----	----	----------

\* Iodines, Particulates and Gross Alpha appear in Tables 2.2-A2 or 2.2-A5

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.2-A4**  
 Millstone Unit 2  
 Airborne Effluents - Elevated Batch - WGDT

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Kr-85	Ci	5.16E-01	1.81E+00	8.02E-01	na	3.13E+00
Xe-133	Ci	4.27E-05	-	-	na	4.27E-05
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci	5.16E-01	1.81E+00	8.02E-01		3.13E+00

**B. Iodines / Halogens \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**C. Particulates \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**D. Gross Alpha \***

Gross Alpha	Ci	*	*	*	*	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	3.42E-04	3.37E-04	4.44E-04	-	1.12E-03
-----	----	----------	----------	----------	---	----------

\* Iodines, Particulates and Gross Alpha appear in Tables 2.2-A2 or 2.2-A5  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-A5**  
 Millstone Unit 2  
 Airborne Effluents - Elevated Continuous - Containment Vents/Site Stack

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Ar-41	Ci	2.66E-02	1.52E-02	2.11E-02	2.15E-02	8.44E-02
Kr-85	Ci	2.39E-01	3.85E-02	1.49E-02	-	2.92E-01
Xe-131m	Ci	-	-	-	-	
Xe-133	Ci	3.04E-02	1.94E-01	7.10E-03	1.06E-02	2.42E-01
Xe-133m	Ci	-	-	-	-	
Xe-135	Ci	2.65E-04	2.63E-04	6.84E-04	1.02E-03	2.23E-03
Xe-138	Ci	-	-	3.13E-04	-	3.13E-04
	Ci					
<b>Total Activity</b>	<b>Ci</b>	<b>2.96E-01</b>	<b>2.48E-01</b>	<b>4.41E-02</b>	<b>3.31E-02</b>	<b>6.21E-01</b>

**B. Iodines / Halogens**

I-131	Ci	1.01E-07	7.08E-05	-	6.68E-07	7.16E-05
I-132	Ci	-	-	-	-	
I-133	Ci	3.82E-07	1.05E-05	-	-	1.09E-05
Br-82	Ci	-	1.35E-06	-	-	1.35E-06
	Ci	-	-	-	-	
	Ci	-	-	-	-	
<b>Total Activity</b>	<b>Ci</b>	<b>4.83E-07</b>	<b>8.27E-05</b>		<b>6.68E-07</b>	<b>8.38E-05</b>

**C. Particulates**

Co-58	Ci	-	1.21E-07	-	-	1.21E-07
Cs-137	Ci	-	2.64E-08	1.12E-07	-	1.38E-07
	Ci					
Sr-89	Ci	-	-	-	-	
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>		<b>1.47E-07</b>	<b>1.12E-07</b>		<b>2.59E-07</b>

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	1.41E-01	2.03E-01	1.35E-01	8.35E-01	1.31E+00
-----	----	----------	----------	----------	----------	----------

"-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-A6**  
 Millstone Unit 2  
 Airborne Effluents - Ground Batch - Containment Equipment Hatch

Nuclides Released	Units	2008				Total
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	

**A. Fission & Activation Gases**

γ Emitters	Ci	na	na	na	na	
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci					

**B. Iodines / Halogens**

I-131	Ci	na	2.40E-06	na	na	2.40E-06
I-132	Ci	na	5.80E-06	na	na	5.80E-06
I-133	Ci	na	1.80E-07	na	na	1.80E-07
	Ci					
	Ci					
Total Activity	Ci		8.38E-06			8.38E-06

**C. Particulates**

Cr-51	Ci	na	5.60E-06	na	na	5.60E-06
Mn-54	Ci	na	1.80E-07	na	na	1.80E-07
Co-58	Ci	na	3.70E-06	na	na	3.70E-06
Co-60	Ci	na	6.20E-07	na	na	6.20E-07
Zr-95	Ci	na	1.70E-06	na	na	1.70E-06
Nb-95	Ci	na	2.10E-06	na	na	2.10E-06
Cs-137	Ci	na	3.30E-07	na	na	3.30E-07
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci		1.42E-05			1.42E-05

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

**E. Tritium**

H-3	Ci	na	na	na	na	
-----	----	----	----	----	----	--

"." denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.2-A7**  
 Millstone Unit 2  
 Airborne Effluents - Ground Batch - RWST Vent

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Xe-133	Ci	na	2.60E-02	na	na	2.60E-02
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci		2.60E-02			2.60E-02

**B. Iodines / Halogens**

I-131	Ci	na	-	na	na	
I-132	Ci	na	-	na	na	
I-133	Ci	na	-	na	na	
Total Activity	Ci					

**C. Particulates**

γ Emitters	Ci	na	-	na	na	
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

**E. Tritium**

H-3	Ci	na	na	na	na	
-----	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-A1**  
**Millstone Unit 3**  
**Airborne Effluents - Release Summary**

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

1. Total Activity Released	Ci	2.28E+00	6.41E+00	3.37E+00	4.97E+01	6.18E+01
2. Average Period Release Rate *	uCi/sec	2.90E-01	8.15E-01	4.24E-01	6.26E+00	1.95E+00

**B. Iodines / Halogens**

1. Total Activity Released	Ci	6.50E-06	4.99E-06	6.29E-06	7.43E-03	7.45E-03
2. Average Period Release Rate *	uCi/sec	8.27E-07	6.35E-07	7.91E-07	9.35E-04	2.35E-04

**C. Particulates**

1. Total Activity Released	Ci	8.88E-07	3.85E-07	1.34E-05	6.64E-04	6.79E-04
2. Average Period Release Rate *	uCi/sec	1.13E-07	4.90E-08	1.68E-06	8.36E-05	2.15E-05

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Tritium**

1. Total Activity Released	Ci	2.15E+01	1.09E+01	1.14E+01	3.10E+01	7.48E+01
2. Average Period Release Rate *	uCi/sec	2.74E+00	1.38E+00	1.43E+00	3.90E+00	2.36E+00

\* "Total Activity Released" ÷ Seconds in Quarter  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.3-A2**  
 Millstone Unit 3  
**Airborne Effluents - Mixed Continuous - Normal Ventilation &  
 Spent Fuel Pool Evaporation \***

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Xe-133	Ci	-	2.92E+00	-	2.63E+01	2.92E+01
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci		2.92E+00		2.63E+01	2.92E+01

**B. Iodines / Halogens**

I-131	Ci	-	-	-	1.31E-03	1.31E-03
I-133	Ci	-	-	-	2.49E-04	2.49E-04
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci				1.56E-03	1.56E-03

**C. Particulates**

Be-7	Ci	-	-	1.30E-05	-	1.30E-05
Cr-51	Ci	-	-	-	1.26E-04	1.26E-04
Mn-54	Ci	-	-	-	1.53E-05	1.53E-05
Co-58	Ci	-	-	-	1.10E-04	1.10E-04
Co-60	Ci	-	-	-	6.81E-05	6.81E-05
Nb-95	Ci	-	-	-	1.18E-05	1.18E-05
Zr-95	Ci	-	-	-	6.15E-06	6.15E-06
Ba-140	Ci	-	-	-	2.25E-05	2.25E-05
	Ci				-	
Sr-89	Ci	-	-	-	-	
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
	Ci					
Total Activity	Ci			1.30E-05	3.60E-04	3.73E-04

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium \***

H-3	Ci	2.09E+01	9.94E+00	1.05E+01	2.97E+01	7.10E+01
-----	----	----------	----------	----------	----------	----------

\* Includes estimated Spent Fuel Pool evaporation  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.3-A3**  
 Millstone Unit 3  
 Airborne Effluents - Ground Continuous - ESF Building Ventilation

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Xe-133	Ci	-	-	-	7.09E-01	7.09E-01
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci				7.09E-01	7.09E-01

**B. Iodines / Halogens**

I-131	Ci	-	-	-	1.88E-03	1.88E-03
I-132	Ci	-	-	-	2.67E-04	2.67E-04
I-133	Ci	-	-	-	2.00E-03	2.00E-03
I-135	Ci	-	-	-	2.11E-04	2.11E-04
Br-82	Ci	-	-	-	1.22E-06	1.22E-06
	Ci					
Total Activity	Ci				4.36E-03	4.36E-03

**C. Particulates**

Be-7	Ci	3.69E-07	3.85E-07	3.89E-07	-	1.14E-06
Co-58	Ci	-	-	-	2.59E-06	2.59E-06
Co-60	Ci	-	-	-	7.76E-08	7.76E-08
Ce-141	Ci	7.79E-08	-	-	-	7.79E-08
Eu-152	Ci	-	-	-	9.66E-07	9.66E-07
	Ci					
Sr-89	Ci	-	-	-	-	
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci	4.47E-07	3.85E-07	3.89E-07	3.63E-06	4.85E-06

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	2.57E-01	1.09E-01	1.88E-01	1.03E-01	6.57E-01
-----	----	----------	----------	----------	----------	----------

"-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.3-A4**  
 Millstone Unit 3  
 Airborne Effluents - Mixed Batch - Containment Drawdowns

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Xe-133	Ci	na	na	na	-	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>					

**B. Iodines / Halogens**

I-131	Ci	na	na	na	1.42E-07	1.42E-07
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>				<b>1.42E-07</b>	<b>1.42E-07</b>

**C. Particulates**

γ Emitters	Ci	na	na	na	-	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

**E. Tritium**

H-3	Ci	na	na	na	1.76E-03	1.76E-03
-----	----	----	----	----	----------	----------

"-" denotes less than Minimum Detectable Activity (MDA)  
 "na" denotes Not Analyzed

**Table 2.3-A5**  
 Millstone Unit 3  
 Airborne Effluents - Mixed Batch - Containment Purges

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Ar-41	Ci	na	na	na	-	
Kr-85m	Ci	na	na	na	8.90E-04	8.90E-04
Xe-133	Ci	na	na	na	5.27E-01	5.27E-01
Xe-133m	Ci	na	na	na	8.90E-03	8.90E-03
Xe-135	Ci	na	na	na	2.35E-02	2.35E-02
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci				5.60E-01	5.60E-01

**B. Iodines / Halogens \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**C. Particulates \***

*	Ci	*	*	*	*	
Total Activity	Ci					

**D. Gross Alpha \***

Gross Alpha	Ci	*	*	*	*	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	na	na	na	1.39E-02	1.39E-02
-----	----	----	----	----	----------	----------

\* Iodines, Particulates and Gross Alpha included in Table 2.3-A2

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-A6**  
 Millstone Unit 3  
 Airborne Effluents - Elevated Continuous - Gaseous Waste System

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Kr-85	Ci	1.88E+00	7.45E-01	7.72E-01	2.54E+00	5.94E+00
Kr-85m	Ci	-	-	-	1.88E-02	1.88E-02
Xe-131m	Ci	-	-	-	2.45E-01	2.45E-01
Xe-133	Ci	-	2.07E+00	1.88E+00	1.69E+01	2.09E+01
Xe-133m	Ci	-	1.94E-03	-	4.01E-01	4.03E-01
Xe-135	Ci	-	-	-	1.60E+00	1.60E+00
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
<b>Total Activity</b>	<b>Ci</b>	<b>1.88E+00</b>	<b>2.82E+00</b>	<b>2.65E+00</b>	<b>2.17E+01</b>	<b>2.91E+01</b>

**B. Iodines / Halogens**

I-131	Ci	1.01E-07	-	1.01E-07	1.03E-03	1.03E-03
I-133	Ci	-	-	-	8.90E-05	8.90E-05
Br-82	Ci	6.40E-06	4.99E-06	6.19E-06	2.12E-06	1.97E-05
	Ci					
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>	<b>6.50E-06</b>	<b>4.99E-06</b>	<b>6.29E-06</b>	<b>1.12E-03</b>	<b>1.14E-03</b>

**C. Particulates**

Cr-51	Ci	-	-	-	5.50E-07	5.50E-07
Mn-54	Ci	7.47E-08	-	-	-	7.47E-08
Co-58	Ci	-	-	-	9.48E-06	9.48E-06
Co-60	Ci	3.66E-07	-	-	9.99E-08	4.66E-07
Cs-134	Ci	-	-	-	5.89E-07	5.89E-07
Cs-137	Ci	-	-	-	5.31E-07	5.31E-07
Ba-140	Ci	-	-	-	1.94E-06	1.94E-06
	Ci					
Sr-89	Ci	-	-	-	-	
Sr-90	Ci	-	-	-	-	
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>	<b>4.41E-07</b>			<b>1.32E-05</b>	<b>1.36E-05</b>

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

**E. Tritium**

H-3	Ci	3.36E-01	8.06E-01	6.67E-01	1.17E+00	2.98E+00
-----	----	----------	----------	----------	----------	----------

"-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.3-A7**  
 Millstone Unit 3  
 Airborne Effluents - Elevated Batch - Containment Vents

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Ar-41	Ci	7.57E-03	7.44E-03	8.57E-03	3.77E-03	2.74E-02
Kr-85	Ci	1.44E-02	1.40E-02	9.24E-03	5.60E-02	9.36E-02
Kr-85m	Ci	3.51E-05	2.02E-04	1.24E-04	-	3.61E-04
Xe-131m	Ci	1.91E-03	2.50E-03	5.11E-03	2.59E-03	1.21E-02
Xe-133	Ci	3.69E-01	6.31E-01	6.82E-01	5.40E-02	1.74E+00
Xe-133m	Ci	4.27E-03	8.92E-03	6.98E-03	6.18E-04	2.08E-02
Xe-135	Ci	4.46E-03	7.08E-03	4.83E-03	7.25E-04	1.71E-02
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
	Ci	-	-	-	-	
<b>Total Activity</b>	<b>Ci</b>	<b>4.02E-01</b>	<b>6.71E-01</b>	<b>7.17E-01</b>	<b>1.18E-01</b>	<b>1.91E+00</b>

**B. Iodines / Halogens \***

*	Ci	*	*	*	*	
<b>Total Activity</b>	<b>Ci</b>					

**C. Particulates \***

*	Ci	*	*	*	*	
<b>Total Activity</b>	<b>Ci</b>					

**D. Gross Alpha \***

<b>Gross Alpha</b>	<b>Ci</b>	*	*	*	*	
--------------------	-----------	---	---	---	---	--

**E. Tritium**

H-3	Ci	3.24E-02	2.17E-02	1.83E-02	4.13E-03	7.65E-02
-----	----	----------	----------	----------	----------	----------

\* Iodines, Particulates and Gross Alpha included in Table 2.3-A6  
 "-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.3-A8**  
 Millstone Unit 3  
 Airborne Effluents - Ground Batch - Containment Equipment Hatch

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

γ Emitters	Ci	na	na	na	-	
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci					

**B. Iodines / Halogens**

I-131	Ci	na	na	na	1.42E-04	1.42E-04
	Ci					
	Ci					
	Ci					
Total Activity	Ci				1.42E-04	1.42E-04

**C. Particulates**

Cr-51	Ci	na	na	na	1.58E-05	1.58E-05
Mn-54	Ci	na	na	na	1.86E-06	1.86E-06
Co-58	Ci	na	na	na	2.15E-05	2.15E-05
Fe-59	Ci	na	na	na	5.14E-07	5.14E-07
Co-60	Ci	na	na	na	4.03E-06	4.03E-06
Nb-95	Ci	na	na	na	9.84E-07	9.84E-07
Zr-95	Ci	na	na	na	1.01E-06	1.01E-06
Cs-137	Ci	na	na	na	1.12E-06	1.12E-06
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
	Ci					
Total Activity	Ci				4.68E-05	4.68E-05

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

**E. Tritium**

H-3	Ci	na	na	na	na	
-----	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-A9**  
 Millstone Unit 3  
 Airborne Effluents - Ground Batch - RWST Vent

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

Kr-85	Ci	na	na	na	-	
Xe-133	Ci	na	na	na	3.32E-01	3.32E-01
	Ci	-	-	-	-	
	Ci	-	-	-	-	
Total Activity	Ci				3.32E-01	3.32E-01

**B. Iodines / Halogens**

I-131	Ci	na	na	na	2.33E-04	2.33E-04
I-132	Ci	na	na	na	9.73E-06	9.73E-06
I-133	Ci	na	na	na	-	
	Ci				-	
Total Activity	Ci				2.43E-04	2.43E-04

**C. Particulates**

Cr-51	Ci	na	na	na	5.79E-05	5.79E-05
Mn-54	Ci	na	na	na	5.79E-06	5.79E-06
Co-57	Ci	na	na	na	3.13E-07	3.13E-07
Co-58	Ci	na	na	na	1.37E-04	1.37E-04
Fe-59	Ci	na	na	na	1.55E-06	1.55E-06
Co-60	Ci	na	na	na	5.47E-06	5.47E-06
Zr-95	Ci	na	na	na	2.96E-06	2.96E-06
Nb-95	Ci	na	na	na	4.64E-06	4.64E-06
Mo-99	Ci	na	na	na	2.67E-08	2.67E-08
Tc-99m	Ci	na	na	na	1.32E-08	1.32E-08
Ag-110m	Ci	na	na	na	1.37E-07	1.37E-07
Sn-113	Ci	na	na	na	1.32E-08	1.32E-08
Sn-117m	Ci	na	na	na	8.86E-09	8.86E-09
Sb-124	Ci	na	na	na	1.60E-07	1.60E-07
Sb-125	Ci	na	na	na	2.03E-06	2.03E-06
Cs-134	Ci	na	na	na	1.46E-05	1.46E-05
Cs-136	Ci	na	na	na	5.18E-07	5.18E-07
Cs-137	Ci	na	na	na	7.89E-06	7.89E-06
Ba-140	Ci	na	na	na	4.85E-08	4.85E-08
	Ci				-	
Total Activity	Ci				2.41E-04	2.41E-04

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

**E. Tritium**

H-3	Ci	na	na	na	na	
-----	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

## 2.2 Liquid Effluents

### 2.2.1 Measurement of Liquid Radioactivity

#### 2.2.1.1 Continuous Liquid Releases

Grab samples are taken for continuous liquid release pathways and analyzed on the HPGe gamma spectrometer and liquid scintillation detector (for tritium) if required by the conditional action requirements of the REMODCM. Total estimated volume is multiplied by the isotopic concentrations (if any) to determine the total activity released. A proportional aliquot of each discharge is retained for composite analysis for Sr-89, Sr-90, Fe-55 and gross alpha if required by the conditional action requirements of the REMODCM. Pathways for continuous liquid effluent releases include, Steam Generator Blowdown, Service Water Effluent, and Turbine Building Sump discharge from Units 2 & 3.

#### 2.2.1.2 Liquid Tanks/Sumps

There are numerous tanks & sumps that are used to discharge liquids containing radioactivity to the environs; they are:

- Unit 1**    Reactor Cavity Water
  
- Unit 2**    Clean Waste Monitor Tanks (2)  
            Aerated Waste Monitor Tanks (2)  
            CPF Waste Neutralization Sump & Turbine Building Sump  
            Steam Generator Bulk
  
- Unit 3**    High Level Waste Test Tanks (2)  
            Low Level Waste Drain Tanks (2)  
            Boron Test Tanks  
            CPF Waste Neutralization Sump & Turbine Building Sump  
            Steam Generator Bulk

Prior to release, a tank is re-circulated for two equivalent tank volumes, a sample is drawn and then analyzed on the HPGe gamma spectrometer and liquid scintillation detector (H-3) for individual radionuclide composition. Isotopic concentrations are multiplied by the volume released to obtain the total activity released. For bulk releases, several samples are taken during the discharge to verify the amount of radioactivity released. A proportional aliquot of each discharge is retained for composite analysis for Sr-89, Sr-90, Fe-55, Ni-63, and gross alpha.

## 2.2.2 Estimate of Errors

Estimates of errors associated with radioactivity measurements were made using the following guidelines:

Radioactivity Measurement Calibration	10%	Calibration to NBS standards
Sampling/Data Collection	10% - 20%	Variation in sample collection
Sample Line Loss	20% - 40%	Deposition of some nuclides
Sample Counting	10% - 30%	Error for counting statistics
Flow & Level Measurements	10% - 20%	Error for release volumes

## 2.2.3 Liquid Batch Release Statistics

	Unit 1	Unit 2	Unit 3
Number of Batches	1	64	56
Total Time (min)	373	6558	7340
Maximum Time (min)	373	258	1412
Average Time (min)	373	103	131
Minimum Time (min)	373	1	13
Average Stream Flow	Not Applicable - Ocean Site		

## 2.2.4 Abnormal Liquid Releases

An abnormal release of radioactivity is the discharge of a volume of liquid radioactive material to the environment that was unplanned or uncontrolled.

In 2008, the following abnormal liquid releases occurred:

**2.2.4.1 Unit 1 - None**

**2.2.4.2 Unit 2 - None**

**2.2.4.3 Unit 3 - None**

## 2.2.5 Liquid Release Tables

The following tables provide the details of the liquid radioactivity released from each of the Millstone units. They are categorized by type of release, source(s), and by release point of discharge to the environment.

**Table 2.1-L1**  
**Millstone Unit 1**  
**Liquid Effluents - Release Summary**  
 (Release Point - Quarry)

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission and Activation Products**

1. Total Activity Released	Ci	2.00E-05				2.00E-05
2. Average Period Diluted Activity *	uCi/ml	7.87E-14				7.87E-14

**B. Tritium**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**C. Dissolved and Entrained Gases**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Volume**

1. Released Waste Volume	Liters	1.06E+05				1.06E+05
2. Dilution Volume During Releases**	Liters	7.24E+08				7.24E+08
3. Dilution Volume During Period'	Liters	2.54E+11				2.54E+11

\* "Total Activity Released" ÷ ("Released Waste Volume" + "Dilution Volume During Period")

+ Unit 2 E.3 quarterly dilution used because there is no more Unit 1 dilution

++ E.3 quarterly dilution x (Total release time ÷ Total quarter time)

**Table 2.1-L2**  
 Millstone Unit 1  
**Liquid Effluents - Batch**  
 (Release Point - Quarry)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

Cs-137	Ci	2.00E-05	na	na	na	2.00E-05
	Ci					
	Ci					
Total Activity	Ci	2.00E-05				2.00E-05

**B. Tritium**

H-3	Ci	-	na	na	na	
-----	----	---	----	----	----	--

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	na	na	na	
	Ci					
	Ci					
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	-	na	na	na	
-------------	----	---	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.2-L1**  
 Millstone Unit No. 2  
**Liquid Effluents - Release Summary**  
 (Release Point - Quarry)

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission and Activation Products**

1. Total Activity Released	Ci	2.14E-02	8.31E-02	4.49E-03	3.85E-03	1.13E-01
2. Average Period Diluted Activity *	uCi/ml	8.44E-11	4.44E-10	1.57E-11	1.40E-11	1.12E-10

**B. Tritium**

1. Total Activity Released	Ci	3.12E+02	1.28E+02	7.11E+00	2.94E+01	4.77E+02
2. Average Period Diluted Activity *	uCi/ml	1.23E-06	6.84E-07	2.48E-08	1.07E-07	4.75E-07

**C. Dissolved and Entrained Gases**

1. Total Activity Released	Ci	1.01E-01	8.09E-01	2.17E-02		9.31E-01
2. Average Period Diluted Activity *	uCi/ml	3.96E-10	4.32E-09	7.55E-11		9.27E-10

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Volume**

1. Released Waste Volume	Primary	Liters	6.21E+05	1.25E+06	1.69E+05	1.11E+05	2.15E+06
	Secondary	Liters	4.08E+04	1.40E+05		7.35E+06	7.53E+06
2. Dilution Volume During Releases	Primary	Liters	2.99E+09	3.18E+09	1.68E+09	1.08E+09	8.93E+09
	Secondary	Liters					
3. Dilution Volume During Period		Liters	2.54E+11	1.87E+11	2.87E+11	2.76E+11	1.00E+12

\* "Total Activity Released" ÷ (Primary "Released Waste Volume" + "Dilution Volume During Period")

**Table 2.2-L2**  
 Millstone Unit 2  
**Liquid Effluents - Continuous - SGBD, SW, RBCCW**  
 (Release Point - Quarry)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

Cs-137	Ci	-	1.59E-07	-	-	1.59E-07
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>		1.59E-07			1.59E-07

**B. Tritium**

H-3	Ci	3.26E-04	1.09E-03	-	1.21E-02	1.35E-02
-----	----	----------	----------	---	----------	----------

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
<b>Total Activity</b>	<b>Ci</b>					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.2-L3**  
 Millstone Unit 2  
**Liquid Effluents - Batch - LWS**  
 (Release Point - Quarry)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

Be-7	Ci	-	-	-	1.76E-05	1.76E-05
Cr-51	Ci	-	1.23E-02	2.30E-04	-	1.25E-02
Mn-54	Ci	5.56E-04	9.31E-04	3.83E-05	-	1.53E-03
Co-57	Ci	3.12E-05	2.10E-06	-	-	3.33E-05
Co-58	Ci	2.57E-04	9.34E-03	2.84E-04	2.65E-05	9.91E-03
Fe-59	Ci	-	1.56E-03	9.62E-06	-	1.57E-03
Co-60	Ci	9.78E-03	1.27E-02	3.51E-04	1.47E-05	2.28E-02
Nb-95	Ci	5.59E-05	2.37E-03	1.89E-04	-	2.61E-03
Zr-95	Ci	-	1.47E-03	8.35E-05	-	1.55E-03
Ru-103	Ci	-	1.34E-04	-	-	1.34E-04
Ru-105	Ci	5.80E-05	-	1.27E-05	-	7.07E-05
Ag-110m	Ci	1.66E-03	1.15E-03	2.38E-04	8.11E-06	3.06E-03
Sn-113	Ci	2.45E-05	1.02E-03	1.29E-04	2.23E-05	1.20E-03
Sn-117m	Ci	-	6.51E-04	8.52E-06	-	6.60E-04
Sb-124	Ci	-	2.41E-04	3.47E-05	1.68E-05	2.93E-04
Sb-125	Ci	2.82E-03	7.33E-03	1.55E-03	1.93E-03	1.36E-02
I-132	Ci	-	2.08E-04	-	-	2.08E-04
Te-132	Ci	-	1.82E-04	-	-	1.82E-04
Cs-134	Ci	-	-	-	8.87E-05	8.87E-05
Cs-137	Ci	9.52E-05	2.31E-04	1.71E-06	3.54E-04	6.82E-04
La-140	Ci	-	3.34E-06	-	-	3.34E-06
Fe-55	Ci	4.65E-03	2.36E-02	1.22E-03	1.17E-03	3.06E-02
Ni-63	Ci	1.45E-03	7.66E-03	1.14E-04	2.06E-04	9.43E-03
Sr-89	Ci	-	-	-	-	-
Sr-90	Ci	-	-	-	-	-
Total Activity	Ci	2.14E-02	8.31E-02	4.49E-03	3.85E-03	1.13E-01

**B. Tritium**

H-3	Ci	3.12E+02	1.28E+02	7.11E+00	2.94E+01	4.77E+02
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

Kr-85	Ci	9.06E-02	4.48E-01	2.16E-02	-	5.60E-01
Xe-131m	Ci	-	5.95E-03	-	-	5.95E-03
Xe-133	Ci	1.01E-02	3.50E-01	7.73E-05	-	3.60E-01
Xe-133m	Ci	-	3.93E-03	-	-	3.93E-03
Xe-135	Ci	-	7.09E-04	-	-	7.09E-04
	Ci					
Total Activity	Ci	1.01E-01	8.09E-01	2.17E-02		9.31E-01

**D. Gross Alpha**

Gross Alpha	Ci	-	-	-	-	
-------------	----	---	---	---	---	--

"-" denotes less than Minimum Detectable Activity (MDA)

**Table 2.2-L4**  
 Millstone Unit 2  
**Liquid Effluents - Release Summary**  
 (Release Point - Yard Drain - DSN 006)

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission and Activation Products**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**B. Tritium**

1. Total Activity Released	Ci	1.39E-02	6.91E-03	4.46E-04	1.08E-03	2.23E-02
2. Average Period Diluted Activity *	uCi/ml	3.83E-07	2.31E-07	1.44E-08	3.04E-08	1.68E-07

**C. Dissolved and Entrained Gases**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Volume**

1. Released Waste Volume	Liters	2.40E+06	9.76E+05	1.95E+05	5.00E+05	4.07E+06
2. Dilution Volume During Releases	Liters	***	***	***	***	***
3. Dilution Volume During Period **	Liters	3.39E+07	2.89E+07	3.08E+07	3.50E+07	1.29E+08

\* "Total Activity Released" ÷ ("Released Waste Volume" + "Dilution Volume During Period")

\*\* Includes all station dilution sources via Yard Drain - DSN 006

\*\*\* Continuous "Dilution Volume During Releases" is not quantified

**Table 2.2-L5**  
 Millstone Unit 2  
**Liquid Effluents -Continuous-Turbine Building Sump**  
 (Release Point - Yard Drain - DSN 006)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**B. Tritium**

H-3	Ci	1.39E-02	6.91E-03	4.46E-04	1.08E-03	2.23E-02
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-L1**  
 Millstone Unit 3  
**Liquid Effluents - Release Summary**  
 (Release Point - Quarry)

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission and Activation Products**

1. Total Activity Released	Ci	1.56E-03	5.62E-03	1.91E-02	5.41E-02	8.04E-02
2. Average Period Diluted Activity *	uCi/ml	3.45E-12	1.22E-11	4.05E-11	1.66E-10	4.71E-11

**B. Tritium**

1. Total Activity Released	Ci	8.81E+00	8.14E+01	2.34E+02	3.71E+02	6.95E+02
2. Average Period Diluted Activity *	uCi/ml	1.95E-08	1.77E-07	4.97E-07	1.14E-06	4.07E-07

**C. Dissolved and Entrained Gases**

1. Total Activity Released	Ci				2.78E-05	2.78E-05
2. Average Period Diluted Activity *	uCi/ml				8.53E-14	1.63E-14

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Volume**

1. Released Waste Volume						
Primary	Liters	1.30E+05	4.39E+05	8.27E+05	6.82E+06	8.22E+06
Secondary	Liters	1.92E+07	8.90E+06	8.82E+06	3.72E+06	4.07E+07
2. Dilution Volume During Releases						
Primary	Liters	5.37E+08	2.42E+09	3.97E+09	7.88E+09	1.48E+10
Secondary	Liters	1.26E+10	1.16E+10	1.12E+10	3.13E+09	3.85E+10
3. Dilution Volume During Period						
	Liters	4.52E+11	4.59E+11	4.71E+11	3.26E+11	1.71E+12

\* "Total Activity Released" ÷ (Primary "Released Waste Volume" + "Dilution Volume During Period")

**Table 2.3-L2**  
 Millstone Unit 3  
**Liquid Effluents - Continuous - SGBD & SW**  
 (Release Point - Quarry)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**B. Tritium**

H-3	Ci	3.27E-01	1.75E-01	9.03E-02	1.85E-02	6.11E-01
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed



**Table 2.3-L4**  
**Millstone Unit 3**  
**Liquid Effluents - Batch - CPF Waste Neutralization Sumps, Hotwell, S/G Bulk**  
 (Release Point - Quarry)

Nuclides Released	Units	2008:				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

Cr-51	Ci	-	-	-	1.55E-05	1.55E-05
Mn-54	Ci	-	-	-	6.22E-06	6.22E-06
Co-58	Ci	-	-	-	5.49E-05	5.49E-05
Co-60	Ci	-	-	-	2.37E-06	2.37E-06
Sb-122	Ci	-	-	-	2.47E-06	2.47E-06
I-131	Ci	-	-	-	3.92E-05	3.92E-05
I-133	Ci	-	-	-	2.45E-06	2.45E-06
Cs-134	Ci	-	-	-	5.38E-05	5.38E-05
Cs-136	Ci	-	-	-	6.02E-06	6.02E-06
Cs-137	Ci	-	-	-	2.41E-05	2.41E-05
Ce-144	Ci	-	-	-	4.27E-06	4.27E-06
	Ci					
Fe-55	Ci	na	na	na	*	
Ni-63	Ci	na	na	na	*	
Sr-89	Ci	na	na	na	*	
Sr-90	Ci	na	na	na	*	
Total Activity	Ci				2.11E-04	2.11E-04

**B. Tritium**

H-3	Ci	1.64E-02	2.12E-02	1.04E-02	1.24E-03	4.92E-02
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

Xe-133	Ci	-	-	-	2.78E-05	2.78E-05
	Ci					
	Ci					
	Ci					
Total Activity	Ci				2.78E-05	2.78E-05

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

\* Nuclide results included in Table 2.3-L3

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-L5**  
**Millstone Unit 3**  
**Liquid Effluents - Release Summary**  
 (Release Point - Yard Drain - DSN 006)

Units	2008				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission and Activation Products**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**B. Tritium**

1. Total Activity Released	Ci	1.02E-01	9.07E-02	5.15E-02	8.27E-03	2.53E-01
2. Average Period Diluted Activity *	uCi/ml	2.82E-06	3.03E-06	1.66E-06	2.33E-07	1.91E-06

**C. Dissolved and Entrained Gases**

1. Total Activity Released	Ci					
2. Average Period Diluted Activity *	uCi/ml					

**D. Gross Alpha**

1. Total Activity Released	Ci					
----------------------------	----	--	--	--	--	--

**E. Volume**

1. Released Waste Volume	Liters	1.12E+07	5.32E+06	5.18E+06	3.12E+06	2.48E+07
2. Dilution Volume During Releases	Liters	***	***	***	***	***
3. Dilution Volume During Period **	Liters	2.51E+07	2.46E+07	2.58E+07	3.24E+07	1.08E+08

\* "Total Activity Released" ÷ ("Released Waste Volume" + "Dilution Volume During Period")

\*\* Includes all station dilution sources via Yard Drain - DSN 006

\*\*\* Continuous "Dilution Volume During Releases" is not quantified

**Table 2.3-L6**  
 Millstone Unit 3  
**Liquid Effluents - Continuous - TB Sump, WTT Berm**  
 (Release Point - Yard Drain - DSN 006)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**B. Tritium**

H-3	Ci	5.24E-02	8.88E-02	5.00E-02	5.07E-03	1.96E-01
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

**Table 2.3-L7**  
 Millstone Unit 3  
**Liquid Effluents - Continuous - Foundation Drain Sumps**  
 (Release Point - Yard Drain - DSN 006)

Nuclides Released	Units	2008				
		1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Products**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**B. Tritium**

H-3	Ci	5.00E-02	1.90E-03	1.50E-03	3.20E-03	5.66E-02
-----	----	----------	----------	----------	----------	----------

**C. Dissolved & Entrained Gases**

γ Emitters	Ci	-	-	-	-	
	Ci					
	Ci					
Total Activity	Ci					

**D. Gross Alpha**

Gross Alpha	Ci	na	na	na	na	
-------------	----	----	----	----	----	--

"-" denotes less than Minimum Detectable Activity (MDA)

"na" denotes Not Analyzed

## 2.3 Solid Waste

Solid waste shipment summaries for each unit are given in the following tables:

Table 2.1-S Unit 1 Solid Waste and Irradiated Component Shipments

Table 2.2-S Unit 2 Solid Waste and Irradiated Component Shipments

Table 2.3-S Unit 3 Solid Waste and Irradiated Component Shipments

The principal radionuclides in these tables were from shipping manifests.

Solidification Agent(s): No solidification on site

Containers routinely used for radioactive waste shipment include:

55-gal Steel Drum DOT 17-H container	7.5 ft <sup>3</sup>
Steel Boxes	45 ft <sup>3</sup> 87 ft <sup>3</sup> 95 ft <sup>3</sup> 122 ft <sup>3</sup>
Steel Container	202.1 ft <sup>3</sup>
Steel "Sea Van"	1280 ft <sup>3</sup>
Polyethylene High Integrity Containers	120.3 ft <sup>3</sup> 132.4 ft <sup>3</sup> 173.4 ft <sup>3</sup> 202.1 ft <sup>3</sup>

**Table 2.1-S**  
**Solid Waste and Irradiated Component Shipments**  
**Millstone Unit 1**

January 1, 2008 through December 31, 2008

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)

**1. Type of Waste**

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

Disposition	Units	Annual Totals	Est. Total Error

b. Dry compressible waste, Contaminated equipment, etc.

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	2.7180E+00	25%
	Ci	1.1677E-03	

c. Irradiated components, Control rods, etc.

Disposition	Units	Annual Totals	Est. Total Error

d. Other - (Grease, Oil, Oily waste)

Disposition	Units	Annual Totals	Est. Total Error

d. Other - (Mixed Waste)

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..	m <sup>3</sup>	1.1438E-01	25%
	Ci	6.8631E-04	

d. Other - (Water)

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.	m <sup>3</sup>	3.0700E+00	25%
	Ci	9.2077E-03	

## 2. Estimate of major nuclide composition (by type of waste)

b. Dry compressible waste, Contaminated equipment, etc.

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.29	3.3445E-06
C-14		
Cr-51		
Mn-54	0.29	3.4290E-06
Fe-55	47.89	5.5919E-04
Fe-59		
Co-57		
Co-58	0.14	1.6801E-06
Co-60	18.60	2.1717E-04
Ni-59		
Ni-63	10.52	1.2280E-04
Zn-65		
Sr-89		
Sr-90	0.04	4.4916E-07
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134	0.22	2.5564E-06
Cs-137	21.99	2.5673E-04
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.0257E-07
Pu-239	<0.01	7.0774E-09
Pu-241		
Am-241	0.01	1.4872E-07
Cm-242		
Cm-243		
Cm-244	<0.01	5.8252E-08
<b>CURIES (TOTAL)</b>		<b>1.1677E-03</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Mixed Waste)

From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..

Radionuclide	% of Total	Curies
H-3	0.04	2.6735E-07
C-14		
Cr-51		
Mn-54	0.89	6.1168E-06
Fe-55	51.43	3.5295E-04
Fe-59		
Co-57		
Co-58	1.04	7.1186E-06
Co-60	14.42	9.8935E-05
Ni-59		
Ni-63	27.00	1.8531E-04
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134	1.36	9.3462E-06
Cs-137	3.71	2.5436E-05
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.2499E-08
Pu-239	<0.01	3.4687E-09
Pu-241	0.12	7.9208E-07
Am-241	<0.01	1.6906E-08
Cm-242		
Cm-243		
Cm-244	<0.01	8.2257E-09
<b>CURIES (TOTAL)</b>		<b>6.8631E-04</b>

## 2. Estimate of major nuclide composition (by type of waste)

### d. Other - (Water)

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.

Radionuclide	% of Total	Curies
H-3	96.11	8.8497E-03
C-14		
Cr-51	0.01	9.7651E-07
Mn-54	0.02	1.3815E-06
Fe-55	1.80	1.6535E-04
Fe-59	<0.01	7.4708E-08
Co-57	<0.01	7.8209E-09
Co-58	0.04	3.5466E-06
Co-60	0.43	3.9810E-05
Ni-59		
Ni-63	0.54	5.0061E-05
Zn-65	<0.01	1.2132E-08
Sr-89	<0.01	1.7507E-11
Sr-90	<0.01	2.9054E-10
Zr-95	<0.01	9.4060E-08
Nb-95	<0.01	1.5516E-07
Tc-99	<0.01	1.4402E-07
Ru-103	<0.01	2.8587E-08
Ru-106	<0.01	5.0277E-08
Ag-110m	<0.01	5.7820E-09
Sn-113		
Sb-122	<0.01	6.6087E-09
Sb-124		
Sb-125	0.14	1.3172E-05
I-129	<0.01	1.7003E-11
Cs-134	0.17	1.5201E-05
Cs-137	0.73	6.7656E-05
La-140	<0.01	2.4823E-10
Ce-141	<0.01	6.3800E-09
Ce-144	<0.01	3.1195E-08
Hf-181		
Ta-182		
Th-230	<0.01	1.2001E-10
Np-237	<0.01	4.5002E-11
Pu-238	<0.01	1.5382E-08
Pu-239	<0.01	1.5258E-07
Pu-241	<0.01	1.0031E-09
Am-241	<0.01	4.6916E-08
Cm-242		
Cm-243		
Cm-244	<0.01	2.4547E-08
<b>CURIES (TOTAL)</b>		<b>9.2077E-03</b>

**3. Solid Waste Disposition (Shipments from Millstone)**

Number of Shipments*	Mode of Transportation	Destination
	Truck (Sole Use Vehicle)	Chem-Nuclear Systems, LLC, Barnwell, SC
	Truck (Sole Use Vehicle)	Diversified Scientific Services, Inc., Kingston, TN
	Truck (Sole Use Vehicle)	Duratek, Inc., Kingston, TN
4	Truck (Sole Use Vehicle)	Duratek, Inc., Oak Ridge, TN
1	Truck (Sole Use Vehicle)	Perma-Fix of Florida, Inc., Gainesville, FL
	Truck (Sole Use Vehicle)	Studsvik Processing Facility, Erwin, TN

\* Indicates the number of shipments in this category which contained *any* unit-1 waste. (Example: A shipment containing wastes from units 1, 2 *and* 3 will be counted once on *each* of the three unit-specific sections of this report.) 5 physical shipments were made from this station in 2008.

**B. IRRADIATED FUEL SHIPMENTS (Disposition)**

Number of Shipments	Mode of Transportation	Destination
No Shipments in 2008	N/A	N/A

**Table 2.2-S**  
**Solid Waste and Irradiated Component Shipments**  
**Millstone Unit 2**

January 1, 2008 through December 31, 2008

**A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)**

**1. Type of Waste**

**a. Spent resins, Filter sludges, Evaporator bottoms, etc.**

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	9.3726E+00	25%
	Ci	7.5323E-01	
From Millstone Nuclear Power Station to Studsvik Processing Facility, Erwin, TN for Thermal Destruction, Incineration, etc..	m <sup>3</sup>	8.4960E+00	25%
	Ci	2.0175E+02	

**b. Dry compressible waste, Contaminated equipment, etc.**

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	4.7277E+02	25%
	Ci	1.7278E+00	

**c. Irradiated components, Control rods, etc.**

Disposition	Units	Annual Totals	Est. Total Error

**d. Other - (Grease, Oil, Oily waste)**

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	1.8888E-01	25%
	Ci	1.8797E-06	

**d. Other - (Mixed Waste)**

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Diversified Scientific Services, Inc., Kingston, TN for Fuel Blending, Incineration.	m <sup>3</sup>	7.5048E-04	25%
	Ci	7.1515E-06	
From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..	m <sup>3</sup>	1.1438E-01	25%
	Ci	6.8631E-04	

**d. Other - (Water)**

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.	m <sup>3</sup>	1.2469E+02	25%
	Ci	9.0493E-02	

## 2. Estimate of major nuclide composition (by type of waste)

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.25	1.8799E-03
C-14		
Cr-51	0.93	7.0385E-03
Mn-54	0.79	5.9319E-03
Fe-55	44.16	3.3262E-01
Fe-59	0.04	2.9486E-04
Co-57	0.09	6.8341E-04
Co-58	6.60	4.9689E-02
Co-60	12.04	9.0703E-02
Ni-59		
Ni-63	26.59	2.0026E-01
Zn-65	0.03	1.9440E-04
Sr-89	<0.01	6.6614E-05
Sr-90	0.04	3.2504E-04
Zr-95	2.65	1.9931E-02
Nb-95	2.79	2.1030E-02
Tc-99		
Ru-103	<0.01	3.4917E-05
Ru-106	0.28	2.0938E-03
Ag-110m	0.17	1.2626E-03
Sn-113	0.14	1.0851E-03
Sb-122		
Sb-124	<0.01	3.8299E-05
Sb-125	1.35	1.0141E-02
I-129		
Cs-134	0.13	9.5072E-04
Cs-137	0.37	2.7878E-03
La-140		
Ce-141		
Ce-144	0.09	6.6398E-04
Hf-181	<0.01	5.7224E-05
Ta-182		
Th-230		
Np-237		
Pu-238	0.01	9.3122E-05
Pu-239	<0.01	3.4627E-05
Pu-241	0.42	3.1500E-03
Am-241	<0.01	3.9476E-05
Cm-242	<0.01	3.4766E-05
Cm-243		
Cm-244	0.02	1.1813E-04
<b>CURIES (TOTAL)</b>		<b>7.5323E-01</b>

## 2. Estimate of major nuclide composition (by type of waste)

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

From Millstone Nuclear Power Station to Studsvik Processing Facility, Erwin, TN for Thermal Destruction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.01	2.4052E-02
C-14		
Cr-51		
Mn-54	0.17	3.4695E-01
Fe-55	4.65	9.3888E+00
Fe-59		
Co-57	0.13	2.5667E-01
Co-58	0.56	1.1311E+00
Co-60	5.15	1.0387E+01
Ni-59		
Ni-63	53.41	1.0776E+02
Zn-65		
Sr-89	<0.01	2.1254E-03
Sr-90	0.10	2.0054E-01
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	0.72	1.4455E+00
I-129		
Cs-134	9.91	1.9997E+01
Cs-137	25.16	5.0762E+01
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.4408E-03
Pu-239	<0.01	4.7578E-04
Pu-241	0.02	4.2023E-02
Am-241	<0.01	5.5789E-04
Cm-242	<0.01	9.0127E-05
Cm-243		
Cm-244	<0.01	9.3022E-04
<b>CURIES (TOTAL)</b>		<b>2.0175E+02</b>

**2. Estimate of major nuclide composition (by type of waste)**

b. Dry compressible waste, Contaminated equipment, etc.

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.40	6.9081E-03
C-14		
Cr-51		
Mn-54	0.74	1.2767E-02
Fe-55	44.68	7.7205E-01
Fe-59		
Co-57	<0.01	6.9900E-05
Co-58	0.29	5.0369E-03
Co-60	13.93	2.4074E-01
Ni-59		
Ni-63	33.44	5.7784E-01
Zn-65		
Sr-89		
Sr-90		
Zr-95	<0.01	1.8500E-05
Nb-95	<0.01	8.7500E-07
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	0.56	9.7167E-03
I-129		
Cs-134	1.40	2.4164E-02
Cs-137	4.46	7.7140E-02
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.9710E-05
Pu-239	<0.01	9.9624E-06
Pu-241	0.07	1.2523E-03
Am-241	<0.01	2.5607E-05
Cm-242	<0.01	1.2500E-07
Cm-243		
Cm-244	<0.01	2.3471E-05
<b>CURIES (TOTAL)</b>		<b>1.7278E+00</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Grease, Oil, Oily waste)

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.03	5.9878E-10
C-14		
Cr-51		
Mn-54	2.18	4.0923E-08
Fe-55	56.33	1.0588E-06
Fe-59		
Co-57		
Co-58		
Co-60	13.79	2.5921E-07
Ni-59		
Ni-63	24.37	4.5813E-07
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	1.60	3.0001E-08
I-129		
Cs-134		
Cs-137	1.63	3.0548E-08
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	2.3510E-11
Pu-239		
Pu-241	0.08	1.4959E-09
Am-241	<0.01	3.1784E-11
Cm-242		
Cm-243		
Cm-244		
<b>CURIES (TOTAL)</b>		<b>1.8797E-06</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Mixed Waste)

From Millstone Nuclear Power Station to Diversified Scientific Services, Inc., Kingston, TN for Fuel Blending, Incineration.

Radionuclide	% of Total	Curies
H-3	99.28	7.1000E-06
C-14	0.72	5.1500E-08
Cr-51		
Mn-54		
Fe-55		
Fe-59		
Co-57		
Co-58		
Co-60		
Ni-59		
Ni-63		
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134		
Cs-137		
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238		
Pu-239		
Pu-241		
Am-241		
Cm-242		
Cm-243		
Cm-244		
<b>CURIES (TOTAL)</b>		7.1515E-06

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Mixed Waste)

From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..

Radionuclide	% of Total	Curies
H-3	0.04	2.6735E-07
C-14		
Cr-51		
Mn-54	0.89	6.1168E-06
Fe-55	51.43	3.5295E-04
Fe-59		
Co-57		
Co-58	1.04	7.1186E-06
Co-60	14.42	9.8935E-05
Ni-59		
Ni-63	27.00	1.8531E-04
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134	1.36	9.3462E-06
Cs-137	3.71	2.5436E-05
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.2499E-08
Pu-239	<0.01	3.4687E-09
Pu-241	0.12	7.9208E-07
Am-241	<0.01	1.6906E-08
Cm-242		
Cm-243		
Cm-244	<0.01	8.2257E-09
<b>CURIES (TOTAL)</b>		<b>6.8631E-04</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Water)

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.

Radionuclide	% of Total	Curies
H-3	96.06	8.6927E-02
C-14	<0.01	1.7236E-08
Cr-51	<0.01	8.2212E-06
Mn-54	0.02	2.0244E-05
Fe-55	1.62	1.4685E-03
Fe-59	<0.01	8.3029E-07
Co-57	<0.01	6.7008E-08
Co-58	0.21	1.9238E-04
Co-60	0.39	3.4878E-04
Ni-59	<0.01	3.2933E-10
Ni-63	0.49	4.4465E-04
Zn-65	<0.01	3.2415E-07
Sr-89	<0.01	1.3464E-07
Sr-90	<0.01	1.8881E-06
Zr-95	<0.01	8.0057E-07
Nb-95	<0.01	1.3876E-06
Tc-99	<0.01	7.2029E-07
Ru-103	<0.01	2.4004E-07
Ru-106	<0.01	4.1981E-07
Ag-110m	<0.01	4.8301E-08
Sn-113		
Sb-122	<0.01	2.1672E-07
Sb-124		
Sb-125	0.12	1.0897E-04
I-129	<0.01	1.4224E-10
Cs-134	0.15	1.3569E-04
Cs-137	0.92	8.2828E-04
La-140	<0.01	3.3106E-09
Ce-141	<0.01	5.3648E-08
Ce-144	<0.01	5.1123E-07
Hf-181		
Ta-182	<0.01	1.9684E-07
Th-230	<0.01	6.0015E-10
Np-237	<0.01	2.2505E-10
Pu-238	<0.01	1.2266E-07
Pu-239	<0.01	7.8786E-07
Pu-241	<0.01	9.1520E-08
Am-241	<0.01	3.7128E-07
Cm-242	<0.01	6.5423E-10
Cm-243	<0.01	3.3973E-10
Cm-244	<0.01	1.9381E-07
<b>CURIES (TOTAL)</b>		<b>9.0493E-02</b>

### 3. Solid Waste Disposition (Shipments from Millstone)

Number of Shipments*	Mode of Transportation	Destination
	Truck (Sole Use Vehicle)	Chem-Nuclear Systems, LLC, Barnwell, SC
1	Truck (Sole Use Vehicle)	Diversified Scientific Services, Inc., Kingston, TN
	Truck (Sole Use Vehicle)	Duratek, Inc., Kingston, TN
23	Truck (Sole Use Vehicle)	Duratek, Inc., Oak Ridge, TN
1	Truck (Sole Use Vehicle)	Perma-Fix of Florida, Inc., Gainesville, FL
3	Truck (Sole Use Vehicle)	Studsvik Processing Facility, Erwin, TN

\* Indicates the number of shipments in this category which contained *any* unit-2 waste.  
 (Example: A shipment containing wastes from units 1, 2 and 3 will be counted once on *each* of the three unit-specific sections of this report.) 28 physical shipments were made from this station in 2008.

### B. IRRADIATED FUEL SHIPMENTS (Disposition)

Number of Shipments	Mode of Transportation	Destination
No Shipments in 2008	N/A	N/A

**Table 2.3-S**  
**Solid Waste and Irradiated Component Shipments**  
**Millstone Unit 3**

January 1, 2008 through December 31, 2008

A. SOLID WASTE SHIPPED OFFSITE FOR BURIAL OR DISPOSAL (Not irradiated fuel)

**1. Type of Waste**

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	8.4442E+00	25%
	Ci	3.4609E+00	
From Millstone Nuclear Power Station to Studsvik Processing Facility, Erwin, TN for Thermal Destruction, Incineration, etc..	m <sup>3</sup>	3.6759E+00	25%
	Ci	4.7317E+01	

b. Dry compressible waste, Contaminated equipment, etc.

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	4.1479E+02	25%
	Ci	2.7558E+00	

c. Irradiated components, Control rods, etc.

Disposition	Units	Annual Totals	Est. Total Error

d. Other - (Grease, Oil, Oily waste)

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..	m <sup>3</sup>	2.1958E+00	25%
	Ci	9.8402E-06	

d. Other - (Mixed Waste)

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Diversified Scientific Services, Inc., Kingston, TN for Fuel Blending, Incineration.	m <sup>3</sup>	7.6478E-02	25%
	Ci	7.1634E-06	
From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..	m <sup>3</sup>	1.1438E-01	25%
	Ci	6.8631E-04	

d. Other - (Water)

Disposition	Units	Annual Totals	Est. Total Error
From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.	m <sup>3</sup>	3.6341E+01	25%
	Ci	3.3113E-02	

**2. Estimate of major nuclide composition (by type of waste)**

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	2.54	8.8080E-02
C-14		
Cr-51		
Mn-54	1.74	6.0161E-02
Fe-55	65.49	2.2664E+00
Fe-59	<0.01	1.2799E-07
Co-57	0.04	1.4449E-03
Co-58	0.72	2.4856E-02
Co-60	14.59	5.0502E-01
Ni-59		
Ni-63	14.00	4.8451E-01
Zn-65	<0.01	2.0609E-05
Sr-89		
Sr-90	<0.01	8.8358E-05
Zr-95	0.08	2.8887E-03
Nb-95	0.07	2.4148E-03
Tc-99		
Ru-103		
Ru-106	<0.01	3.3093E-04
Ag-110m	<0.01	1.5803E-04
Sn-113	<0.01	1.0017E-05
Sb-122		
Sb-124		
Sb-125	0.51	1.7674E-02
I-129		
Cs-134	<0.01	1.8880E-04
Cs-137	0.12	4.2305E-03
La-140		
Ce-141		
Ce-144	<0.01	9.0335E-05
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	4.2003E-05
Pu-239	<0.01	1.6217E-05
Pu-241	0.06	2.2071E-03
Am-241	<0.01	1.6735E-05
Cm-242	<0.01	5.1168E-06
Cm-243		
Cm-244	<0.01	5.0303E-05
<b>CURIES (TOTAL)</b>		<b>3.4609E+00</b>

## 2. Estimate of major nuclide composition (by type of waste)

a. Spent resins, Filter sludges, Evaporator bottoms, etc.

From Millstone Nuclear Power Station to Studsvik Processing Facility, Erwin, TN for Thermal Destruction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	0.03	1.3311E-02
C-14	<0.01	1.7173E-03
Cr-51		
Mn-54	4.35	2.0562E+00
Fe-55	22.76	1.0769E+01
Fe-59		
Co-57	0.09	4.4275E-02
Co-58	1.40	6.6292E-01
Co-60	7.11	3.3642E+00
Ni-59		
Ni-63	52.91	2.5038E+01
Zn-65		
Sr-89	<0.01	3.6940E-04
Sr-90	<0.01	3.1128E-03
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	0.74	3.4980E-01
I-129		
Cs-134	6.00	2.8367E+00
Cs-137	4.60	2.1772E+00
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	2.9135E-05
Pu-239	<0.01	7.1375E-06
Pu-241	<0.01	5.9703E-04
Am-241	<0.01	1.1643E-05
Cm-242	<0.01	1.2187E-05
Cm-243		
Cm-244	<0.01	2.0071E-05
<b>CURIES (TOTAL)</b>		<b>4.7317E+01</b>

**2. Estimate of major nuclide composition (by type of waste)**

b. Dry compressible waste, Contaminated equipment, etc.

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	1.27	3.5073E-02
C-14		
Cr-51		
Mn-54	1.93	5.3115E-02
Fe-55	61.09	1.6834E+00
Fe-59		
Co-57		
Co-58	1.11	3.0667E-02
Co-60	12.95	3.5680E-01
Ni-59		
Ni-63	20.05	5.5266E-01
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95	0.06	1.7382E-03
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	0.54	1.4962E-02
I-129		
Cs-134	0.31	8.4478E-03
Cs-137	0.69	1.8877E-02
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.5030E-08
Pu-239		
Pu-241		
Am-241	<0.01	2.1804E-08
Cm-242		
Cm-243		
Cm-244		
<b>CURIES (TOTAL)</b>		<b>2.7558E+00</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Grease, Oil, Oily waste)

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Super-Compaction, Incineration, etc..

Radionuclide	% of Total	Curies
H-3	3.02	2.9759E-07
C-14		
Cr-51		
Mn-54	2.08	2.0515E-07
Fe-55	53.94	5.3078E-06
Fe-59		
Co-57		
Co-58		
Co-60	13.90	1.3681E-06
Ni-59		
Ni-63	23.34	2.2966E-06
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125	1.53	1.5040E-07
I-129		
Cs-134		
Cs-137	2.10	2.0679E-07
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.1786E-10
Pu-239		
Pu-241	0.08	7.4991E-09
Am-241	<0.01	1.5934E-10
Cm-242		
Cm-243		
Cm-244		
<b>CURIES (TOTAL)</b>		<b>9.8402E-06</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Mixed Waste)

From Millstone Nuclear Power Station to Diversified Scientific Services, Inc., Kingston, TN for Fuel Blending, Incineration.

Radionuclide	% of Total	Curies
H-3	99.19	7.1053E-06
C-14	0.72	5.1500E-08
Cr-51		
Mn-54		
Fe-55	0.05	3.7900E-09
Fe-59		
Co-57		
Co-58		
Co-60	0.01	8.1800E-10
Ni-59		
Ni-63	0.01	1.0200E-09
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134		
Cs-137	0.01	9.5800E-10
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238		
Pu-239		
Pu-241		
Am-241		
Cm-242		
Cm-243		
Cm-244		
<b>CURIES (TOTAL)</b>		<b>7.1634E-06</b>

**2. Estimate of major nuclide composition (by type of waste)**

d. Other - (Mixed Waste)

From Millstone Nuclear Power Station to Perma-Fix of Florida, Inc., Gainesville, FL for Stabilization, Fuel Blending, etc..

Radionuclide	% of Total	Curies
H-3	0.04	2.6735E-07
C-14		
Cr-51		
Mn-54	0.89	6.1168E-06
Fe-55	51.43	3.5295E-04
Fe-59		
Co-57		
Co-58	1.04	7.1186E-06
Co-60	14.42	9.8935E-05
Ni-59		
Ni-63	27.00	1.8531E-04
Zn-65		
Sr-89		
Sr-90		
Zr-95		
Nb-95		
Tc-99		
Ru-103		
Ru-106		
Ag-110m		
Sn-113		
Sb-122		
Sb-124		
Sb-125		
I-129		
Cs-134	1.36	9.3462E-06
Cs-137	3.71	2.5436E-05
La-140		
Ce-141		
Ce-144		
Hf-181		
Ta-182		
Th-230		
Np-237		
Pu-238	<0.01	1.2499E-08
Pu-239	<0.01	3.4687E-09
Pu-241	0.12	7.9208E-07
Am-241	<0.01	1.6906E-08
Cm-242		
Cm-243		
Cm-244	<0.01	8.2257E-09
<b>CURIES (TOTAL)</b>		<b>6.8631E-04</b>

## 2. Estimate of major nuclide composition (by type of waste)

### d. Other - (Water)

From Millstone Nuclear Power Station to Duratek, Inc., Oak Ridge, TN for Incineration.

Radionuclide	% of Total	Curies
H-3	96.12	3.1828E-02
C-14		
Cr-51	<0.01	2.1703E-06
Mn-54	0.03	8.6199E-06
Fe-55	1.50	4.9555E-04
Fe-59	<0.01	4.3978E-07
Co-57	<0.01	1.7382E-08
Co-58	0.08	2.7301E-05
Co-60	0.33	1.0926E-04
Ni-59		
Ni-63	0.37	1.2133E-04
Zn-65	<0.01	3.2094E-07
Sr-89	<0.01	3.8615E-08
Sr-90	<0.01	3.3498E-07
Zr-95	<0.01	2.0905E-07
Nb-95	<0.01	4.2946E-07
Tc-99	<0.01	1.5359E-06
Ru-103	<0.01	6.3536E-08
Ru-106	<0.01	1.1174E-07
Ag-110m	<0.01	1.2851E-08
Sn-113		
Sb-122	<0.01	7.9100E-08
Sb-124		
Sb-125	0.09	3.0697E-05
I-129	<0.01	3.7785E-11
Cs-134	0.12	3.9612E-05
Cs-137	1.34	4.4531E-04
La-140	<0.01	5.5199E-10
Ce-141	<0.01	1.4180E-08
Ce-144	<0.01	2.1106E-07
Hf-181		
Ta-182		
Th-230	<0.01	1.2800E-09
Np-237	<0.01	4.7998E-10
Pu-238	<0.01	3.4473E-08
Pu-239	<0.01	1.5550E-06
Pu-241	<0.01	2.0785E-08
Am-241	<0.01	1.0708E-07
Cm-242	<0.01	8.8649E-10
Cm-243	<0.01	4.6033E-10
Cm-244	<0.01	5.4548E-08
<b>CURIES (TOTAL)</b>		<b>3.3113E-02</b>

**3. Solid Waste Disposition (Shipments from Millstone)**

Number of Shipments*	Mode of Transportation	Destination
	Truck (Sole Use Vehicle)	Chem-Nuclear Systems, LLC, Barnwell, SC
1	Truck (Sole Use Vehicle)	Diversified Scientific Services, Inc., Kingston, TN
	Truck (Sole Use Vehicle)	Duratek, Inc., Kingston, TN
20	Truck (Sole Use Vehicle)	Duratek, Inc., Oak Ridge, TN
1	Truck (Sole Use Vehicle)	Perma-Fix of Florida, Inc., Gainesville, FL
1	Truck (Sole Use Vehicle)	Studsvik Processing Facility, Erwin, TN

\* Indicates the number of shipments in this category which contained *any* unit-3 waste.  
 (Example: A shipment containing wastes from units 1, 2 and 3 will be counted once on *each* of the three unit-specific sections of this report.) 23 physical shipments were made from this station in 2008.

**B. IRRADIATED FUEL SHIPMENTS (Disposition)**

Number of Shipments	Mode of Transportation	Destination
No Shipments in 2008	N/A	N/A

## 2.4 Groundwater Monitoring

The Groundwater Protection Program (GPP) describes the means by which Millstone Station implements the actions cited in the Nuclear Energy's Institute's (NEI) Groundwater Protection Initiative. The purpose of the GPP is to establish a program to assure timely and effective management of situations involving potential releases of radioactive material to groundwater. A key element in the GPP is on-site groundwater monitoring. The results of the onsite monitoring programs required by the Radiological Environmental Monitoring Program are documented in the Annual Radiological Environmental Monitoring Report; the remaining monitoring programs are documented on the following pages (Tables 2.4-GW1 – 2.4-GW4).

Another key element in the GPP is site hydrological characterization. The general trend of groundwater flow at the station is toward the Long Island Sound. Although positive measurements of plant related activity are noted in the Tables 2.4-GW-2 – 2.4-GW4, there are no pathways to any offsite drinking water supplies. The underdrain system effectively captures groundwater in the area around Unit 3 and channels this water via the storm drain system to the Long Island Sound. The consequences of these measurements have been used to determine releases listed in Section 2.2 and the dose calculations listed in Section 1.0.

**Table 2.4-GW1 Environmental Well Monitoring Results**

Location	Well ID	Laboratory Analysis			
		March-08	June-08	Sept.-08	Dec.-08
T1 - Unit 1 Tank Farm	MW-9B	*		*	
	MW-9D	*		*	
	T1-MW-1	*		*	
T3 - Former Waste Oil UST	T3-MW-1	*	*	*	*
T4 - Abandoned Heating Oil UST - Building 511	T4-MW-2	*	*	*	*
T5 - Abandoned Heating Oil UST - Building 512	T5-MW-1	*	*	*	*
	T5-MW-2	*	*	*	*
T6 - Former ROB Heating Oil UST	ME-5	*	*	*	*
T7 - Former Stone & Webster USTs	T7-MW-1	*		*	
	T7-MW-2	*		*	
	T7-MW-3	*		*	
S1 - Unit 1 Transformer Switchyard	S1-MW-1	*		*	
S2 - Unit 2 Transformer Switchyard	MW-7C	*		*	
	MW-7D	*		*	
	S2-MW-1	**		*	
S5 - Former Batch Plant	ME-9	*	*	*	*
	S5-MW-1	*		*	
	MW-1	**	*	*	*
S11 - Fueling Station	S11-MW-1	*		*	
	S11-MW-2	*		*	
S13 - Recycling Area Waste Oil AST	S13-MW-1	*		*	
	S13-MW-2	*		*	
	MW-6B	*		*	
M2 - Settling Pond	ME-2	*	*	*	*
M5 - Excavation Pile	M5-MW-7	*		*	
	M5-MW-8	*		*	
	M5-MW-9S	*		*	
	M5-MW-9D	*		*	
Environmental Compliance Sampling	S12-MW-1	*			
	S12-MW-2	*			
	S12-MW-3	*	*		
	MW-4A	*			

\* sampled, gamma and H-3 were LLD      \*\* not sampled – not located in the field

**Table 2.4-GW2 Catch Basin/Underdrain Monitoring Results**

Type	Location	Identification	Frequency	Results
Yard Drains	Catch Basin 1-3	CB 1-3	Monthly	Gamma and H-3 < LLD
	Catch Basin 1-5	CB 1-5	Monthly	Gamma and H-3 < LLD
	Catch Basin 1-7	CB 1-7	Monthly	Gamma and H-3 < LLD
	Catch Basin 1-13	CB 1-13	Monthly	Gamma and H-3 < LLD
	Catch Basin 1-14	CB 1-14	Monthly	Gamma and H-3 < LLD
	Catch Basin 1-22	CB 1-22	Monthly	Gamma and H-3 < LLD
	Catch Basin 2-9	CB 2-9	Monthly	Gamma and H-3 < LLD
	NPDES Discharge DSN 006		Monthly	Gamma < LLD and, occasionally H-3 at ~2000 pCi/liter *
	ROB Yard Drain		Monthly	Gamma and H-3 < LLD
	ISFSI Yard Drain	DMH#11	Monthly	Gamma and H-3 < LLD
Sumps	Unit 3 Containment Underdrains		Weekly	Gamma and H-3 < LLD
	Unit 3 Foundation Underdrains**	3 SRW Sump 2	Quarterly	See next page
		3 SRW Sump 3	Quarterly	See next page

\* Turbine building sumps are discharged via DSN-006. These sumps normally have detectable H-3, which is monitored and reported in the effluent section of this report. Unit 3 Foundation Underdrains (3SRW2 & 3) are also discharged via DSN-006

\*\* New locations added in 2007. See Table 2.3 – L7 for the effluent release results for these locations.

**Table 2.4-GW3 Underdrain Monitoring Results**

<b>Sample Date</b>	<b>Foundation Drain Sump 3 (pCi/liter)</b>	<b>Foundation Drain Sump 2 (pCi/liter)</b>	<b>Unit 3 RWST Pit (pCi/liter)</b>
01/01/08	12800		
01/02/08	12800		
01/03/08	13200		
01/04/08	12000		60000
01/05/08	9980		71400
01/06/08	10600		77400
01/07/08	8040		81900
01/08/07	7650		86700
01/09/08	9050		92500
01/10/08	8280		
01/11/08	8370		99000
01/12/08	7990		25000
01/13/08	7080		38200
01/14/08	7170		13300
01/15/08	7520		16800
01/16/08	7010		25700
01/17/08	6800		38400
01/18/08	8330		13200
01/19/08	6640		23200
01/20/08	7040		24700
01/21/08	6900		29000
01/22/08	8420		35000
01/23/08	5100		39200
01/24/08	4770		43000
01/25/08	4480		49200
01/26/08	4670		46200
01/27/08	4730		54900
01/28/08	5130		55500
01/29/08	3720		61700
01/30/08	4420		48800
01/31/08	4770		56200
02/01/08	4130		18400
02/02/08	4090		18900
02/03/08	3370		30200
02/04/08	3050		24200
02/05/08	4050		48100
02/06/08	3340		21100
02/07/08	2900		14400
02/08/08	2720		14500
02/09/08	3340		14400
02/10/08	3130		17000
02/11/08	2240		11600
02/12/08	2950		18200
02/13/08	2540		22600
02/14/08	3120		27200

**Table 2.4-GW3 Underdrain Monitoring Results (cont)**

<b>Sample Date</b>	<b>Foundation Drain Sump 3 (pCi/liter)</b>	<b>Foundation Drain Sump 2 (pCi/liter)</b>	<b>Unit 3 RWST Pit (pCi/liter)</b>
02/15/08	3350		27900
02/16/08	2110		27400
02/17/08	3050		28400
02/18/08	2190		25900
02/19/08	1970		27500
02/20/08	2460		27200
02/21/08	2920		28700
02/22/08	2180		27300
02/23/08	3210		23900
02/24/08	2590		24500
02/25/08	2210		24900
02/26/08	2270		25000
02/27/08	2740		36100
02/28/08	2350		
02/29/08	3490		
03/01/08	2240		
03/02/08	3140		
03/03/08	2360		
03/04/08	2310		
03/05/08	3000	8370, 8720, 7970	35900
03/06/08	2820	7450	
03/07/08	2850	7530	
03/08/08	<1750		
03/09/08	2160		
03/10/08	2400	7710	
03/11/08	2640	9160	
03/12/08	5960	10350	
03/13/08	7055	9940	13600
03/14/08	7120	8900	
03/15/08	5630	8860	
03/16/08	4850	7290	
03/17/08	5550	6590	
03/18/08	4360	6380	
03/19/08	4200	4570	
03/20/08	4610	4700	
03/21/08	5440	4320	
03/22/08	10600	4270	
03/23/08	5160	3740	
03/24/08	4270	3070	
03/25/08	4640	3090	
03/26/08	4330	2880	16400
03/27/08	3340	2950	
03/28/08	3700	2560	
03/29/08	3080	2610	
03/30/08	3230	2810	

**Table 2.4-GW3 Underdrain Monitoring Results (cont)**

<b>Sample Date</b>	<b>Foundation Drain Sump 3 (pCi/liter)</b>	<b>Foundation Drain Sump 2 (pCi/liter)</b>	<b>Unit 3 RWST Pit (pCi/liter)</b>
03/31/08	3100	2150	
04/01/08	2820	1770	
04/02/08	3310	<1750	
04/03/08	1930	2050	17400
04/04/08	3230	1900	
04/05/08	2970	1990	
04/06/08	2530	<1750	
04/07/08	3240	<1750	
04/08/08	2290	<1750	
04/09/08	3220	<1750	18600
04/10/08	<1750	<1750	
04/11/08	2920	<1750	
04/12/08	2840	1940	
04/13/08	3060	<1750	
04/14/08	1810	<1750	
04/15/08	2380	<1750	
04/16/08	2710	<1750	39800
04/17/08	<1750	<1750	
04/18/08	1900	<1750	
04/19/08	2150	<1750	
04/20/08	2650	<1750	
04/21/08	2400	<1750	
04/23/08	<1750	<1750	35600
04/25/08	2340	<1750	
04/28/08	<1750	<1750	
04/30/08	<1750	<1750	152000
05/02/08	2480	<1750	
05/05/08	2350	<1750	
05/07/08	2610	<1750	140000
05/09/08	2270	<1750	
05/12/08	2310	<1750	
05/14/08	1910	<1750	
05/16/08	1960	<1750	
05/19/08	2270	<1750	
05/21/08	2310	<1750	225000
05/27/08	1830	<1750	

**Table 2.4-GW3 Underdrain Monitoring Results (cont)**

Sample Date	Foundation Drain Sump 3 (pCi/liter)	Foundation Drain Sump 2 (pCi/liter)	Unit 3 RWST Pit (pCi/liter)
05/28/09		<1750	50000
05/30/08	1970	<1750	
06/03/08	<1750	<1750	
06/09/08	2150	<1750	
06/11/09		<1750	7510000
06/16/08	<1750	<1750	
06/19/09		<1750	4180000
06/23/08	<1750	<1750	
06/25/09		<1750	4760000
06/30/08	1790	<1750	17700000
07/03/08	1760	<1750	
07/07/08	1940	<1750	19400000
07/10/08	<1750	<1750	
07/14/08	2210	<1750	
07/16/09		<1750	27000000
07/17/09		<1800	
07/21/08	<1800	<1800	
07/23/09			9100000
07/28/08	<1750	<1750	3870000
07/31/08	<1750	<1750	
08/04/08	<1750	<1750	
08/05/09			18600000
08/08/08	<1750	<1750	
08/11/09		<1750	8570000
08/14/08	<1750		
08/18/08	<1750	<1750	11500000
08/22/08	<1750		
08/25/08	<1750	<1750	18500000
09/02/09		<1750	15000000
09/05/08	<1750		
09/08/08	<1750	<1750	
09/09/09			1680000
09/15/08	<1750	<1750	
09/18/09		<1750	2520000
09/24/09		<1750	7770000

**Table 2.4-GW3 Underdrain Monitoring Results (cont)**

<b>Sample Date</b>	<b>Foundation Drain Sump 3 (pCi/liter)</b>	<b>Foundation Drain Sump 2 (pCi/liter)</b>	<b>Unit 3 RWST Pit (pCi/liter)</b>
09/29/08	2120	<1750	878000
10/01/08	2580	<1750	
10/06/08	2280	<1750	
10/13/08	1940	<1750	
10/17/09		<1750	5390000
10/20/08	3740	<1800	5640000
10/21/08	3530		
10/22/08	3430		
10/23/08	4330		
10/24/08	3410		
10/27/08	2870	<1750	2070000
10/29/08	3120		
10/31/08	3530	<1750	
11/03/08	3640	<1750	
11/06/08	2930	<1750	
11/07/08			614000
11/18/08			436000
12/01/08	2450	<1750	
12/04/08	2250	<1750	
12/17/08	3200		

Table 2.4-GW4 RWST Yard Sample Results

Location	Sample Type	DBG * (ft)	Date Sampled	Onsite Results (pCi/L)		Vendor Results (pCi/L)	
				gamma	H-3	gamma	H-3
DP 001	soil	0	01/15/2008	<LLD			<LLD
DP 001a	soil	0	01/16/2008	<LLD			<LLD
DP 001b	soil	0	01/22/2008	<LLD			<LLD
	soil	5	01/22/2008	<LLD			<LLD
	soil	10	01/22/2008	<LLD			<LLD
	water	11	01/23/2008	<LLD	2800	<LLD	3150
	water		02/04/2008	<LLD	2930		
	water		02/14/2008	<LLD	3280	<LLD	3190
	water		02/21/2008		3240		
	water		03/03/2008	<LLD	5780		
	water		03/04/2008	<LLD	6040		6730
	water		03/05/2008	<LLD	5910		
	water		03/10/2008		8740		
	water		03/11/2008		7920		
	water		03/12/2008		7080		
	water		03/13/2008		6570		
	water		03/14/2008		6550		
	water		03/17/2008		6720		
	water		03/20/2008		8460		
	water		03/24/2008		10900		
	water		03/25/2008		9380		
	water		03/26/2008		9840		
	water		03/28/2008		7880		
	water		03/31/2008		7840		
	water		04/02/2008		6080		
	water		04/14/2008		10300		
	water		04/16/2008		8730		
	water		04/18/2008		8260		
	water		04/21/2008		7410		
	water		04/30/2008		14200		
	water		05/02/2008		NSA		
	water		05/07/2008		NSA		
	water		05/15/2008		NSA		
	water		05/30/2008		NSA		
	water		06/13/2008		NSA		
	water		07/01/2008		NSA		
	water		07/10/2008		14300		
	water		09/04/2008		6810		
	water		10/22/2008		5980		
DP 002	soil	0	01/14/2008	<LLD			<LLD
DP 002a	soil	0	01/18/2008	<LLD			<LLD
	soil	5	01/18/2008	<LLD			<LLD
	soil	10	01/18/2008	<LLD			<LLD
	water	14.5	01/24/2008	<LLD	2600	<LLD	2690
	water		02/04/2008	<LLD	3350		

Table 2.4-GW4 RWST Yard Sample Results (cont)

Location	Sample Type	DBG * (ft)	Date Sampled	Onsite Results (pCi/L)		Vendor Results (pCi/L)	
				gamma	H-3	gamma	H-3
	water		02/14/2008	< LLD	4310		3700
	water		02/21/2008		3380		
	water		03/03/2008	<LLD	2650		
	water		03/10/2008		2430		
	water		03/17/2008		2740		
	water		04/02/2008		4160		
	water		04/14/2008		5360		
	water		04/21/2008		5820		
	water		04/30/2008		5900		
	water		05/07/2008		5690		
	water		05/15/2008		NSA		
	water		05/30/2008		NSA		
	water		06/13/2008		5690		
	water		07/01/2008		6530		
	water		07/10/2008		5730		
	water		08/01/2008		8880		
	water		09/04/2008		7020		
	water		10/21/2008		6240		
DP 003	soil	0	01/14/2008	<LLD			<LLD
	soil	5	01/15/2008	<LLD			<LLD
DP 003a	soil	0	01/22/2008	<LLD			<LLD
	soil	5	01/22/2008	<LLD			<LLD
	soil	10	01/22/2008	<LLD			<LLD
	water	16.5	01/24/2008		<LLD	<LLD	1870
	water		02/04/2008		2100		
	water		02/14/2008		2350		
	water		02/21/2008		2480		
	water		03/03/2008	<LLD	2460		
	water		03/10/2008		<LLD		
	water		03/17/2008		<LLD		
	water		04/02/2008		<LLD		
	water		04/14/2008		1920		
	water		04/21/2008		2760		
	water		04/30/2008		3500		
	water		05/07/2008		3080		
	water		05/15/2008		3450		
	water		05/30/2008		3490		
	water		06/13/2008		3550		
	water		07/10/2008		1940		
	water		08/01/2008		<LLD		
	water		09/04/2008		2010		
	water		10/21/2008		3940		
DP 004	soil	0	01/15/2008	<LLD			<LLD
	soil	5	01/16/2008	<LLD			<LLD
DP 004a	soil	0	01/18/2008	<LLD			<LLD
	soil	5	01/18/2008	<LLD			<LLD
	soil	10	01/18/2008	<LLD			<LLD
DP 005	soil	0	01/15/2008	<LLD			<LLD

Table 2.4-GW4 RWST Yard Sample Results (cont)

Location	Sample Type	DBG * (ft)	Date Sampled	Onsite Results (pCi/L)		Vendor Results (pCi/L)	
				gamma	H-3	gamma	H-3
DP 006	soil	0	01/17/2008	<LLD			<LLD
DP 006a	soil	5	01/22/2008	<LLD			<LLD
	soil	10	01/22/2008	<LLD			<LLD
DP 007	soil	0	01/17/2008	<LLD			<LLD
	soil	5	01/17/2008	<LLD			<LLD
	water	9	01/18/2008	<LLD	1970	<LLD	1660
	water		02/14/2008	<LLD	2010	<LLD	3400
	water		02/21/2008	<LLD	2280		
	water		03/03/2008	<LLD	<LLD		
	water		03/10/2008		1910		
	water		03/17/2008		<LLD		
	water		04/02/2008		3320		
	water		04/14/2008		3450		
	water		04/21/2008		3190		
	water		04/30/2008		2470		
	water		05/07/2008		2960		
	water		05/15/2008		2300		
	water		05/30/2008		NSA		
water		06/13/2008		NSA			
water		06/13/2008		NSA			
water		08/01/2008		3210			
water		09/04/2008		NSA			
DP 008	soil	0	01/16/2008	<LLD			<LLD
DP 008a	soil	0	01/17/2008	<LLD			<LLD
	soil	5	01/17/2008	<LLD			<LLD
DP 009	soil	0	01/15/2008	<LLD			<LLD
	soil	5	01/16/2008	<LLD			<LLD
DP 010	soil	0	01/22/2008	<LLD			<LLD
	soil	5	01/22/2008	<LLD			<LLD
DP 011	soil	0	01/23/2008	<LLD			<LLD
	soil	5	01/23/2008	<LLD			<LLD
	soil	10	01/23/2008	<LLD			<LLD
	water	16	01/25/2008		<LLD	<LLD	1780
	water		02/06/2008		<LLD		
	water		02/14/2008		<LLD		
	water		02/21/2008		<LLD		
	water		03/03/2008		<LLD		
	water		03/10/2008	<LLD	8660	<LLD	10100
	water		03/11/2008	<LLD	10600		
	water		03/12/2008		7010		
	water		03/13/2008		7460		
	water		03/14/2008		9360		
	water		03/17/2008		4790		
	water		03/20/2008		13900		
water		03/24/2008		17900			

**Table 2.4-GW4 RWST Yard Sample Results (cont)**

Location	Sample Type	DBG* (ft)	Date Sampled	Onsite Results (pCi/L)		Vendor Results (pCi/L)	
				gamma	H-3	gamma	H-3
	water		03/25/2008		17700		
	water		03/26/2008		13800		
	water		03/28/2008		11100		
	water		03/31/2008		5900		
	water		04/02/2008		3340		
	water		04/14/2008		1840		
	water		04/21/2008		2240		
	water		04/30/2008		<LLD		
	water		05/07/2008		<LLD		
	water		05/15/2008		<LLD		
	water		05/30/2008		<LLD		
	water		06/13/2008		NSA		
	water		07/01/2008		NSA		
	water		08/01/2008		NSA		
	water		09/04/2008		<LLD		
	water		10/24/2008		<LLD		
MW-GPI-6	water		10/24/2008		<LLD		
	water		12/02/2008		<LLD		
	water		12/04/2008		<LLD		

\* DBG = depth below grade

\*\* NSA = no sample available

### **3.0 Inoperable Effluent Monitors**

During the period January 1 through December 31, 2008, the following effluent monitors were inoperable for more than 30 consecutive days:

**3.1 Unit 1 – None**

**3.2 Unit 2 – None**

**3.3 Unit 3 – None**

## 4.0 Operating History

The operating history of the Millstone Units during this reporting period was as follows:


Unit 1 was shut down November 11, 1995 with a cessation of operation declared in July 1998.

Unit 2 operated with a DER capacity factor of 85.6% and Unit 3 operated with a DER capacity factor of 87.6%

The power histograms for 2008 are on the following pages.


**MP2 - CYCLE 18 & 19 POWER HISTORY  
YEAR 2008**

**Note: Data at 3 hour intervals**

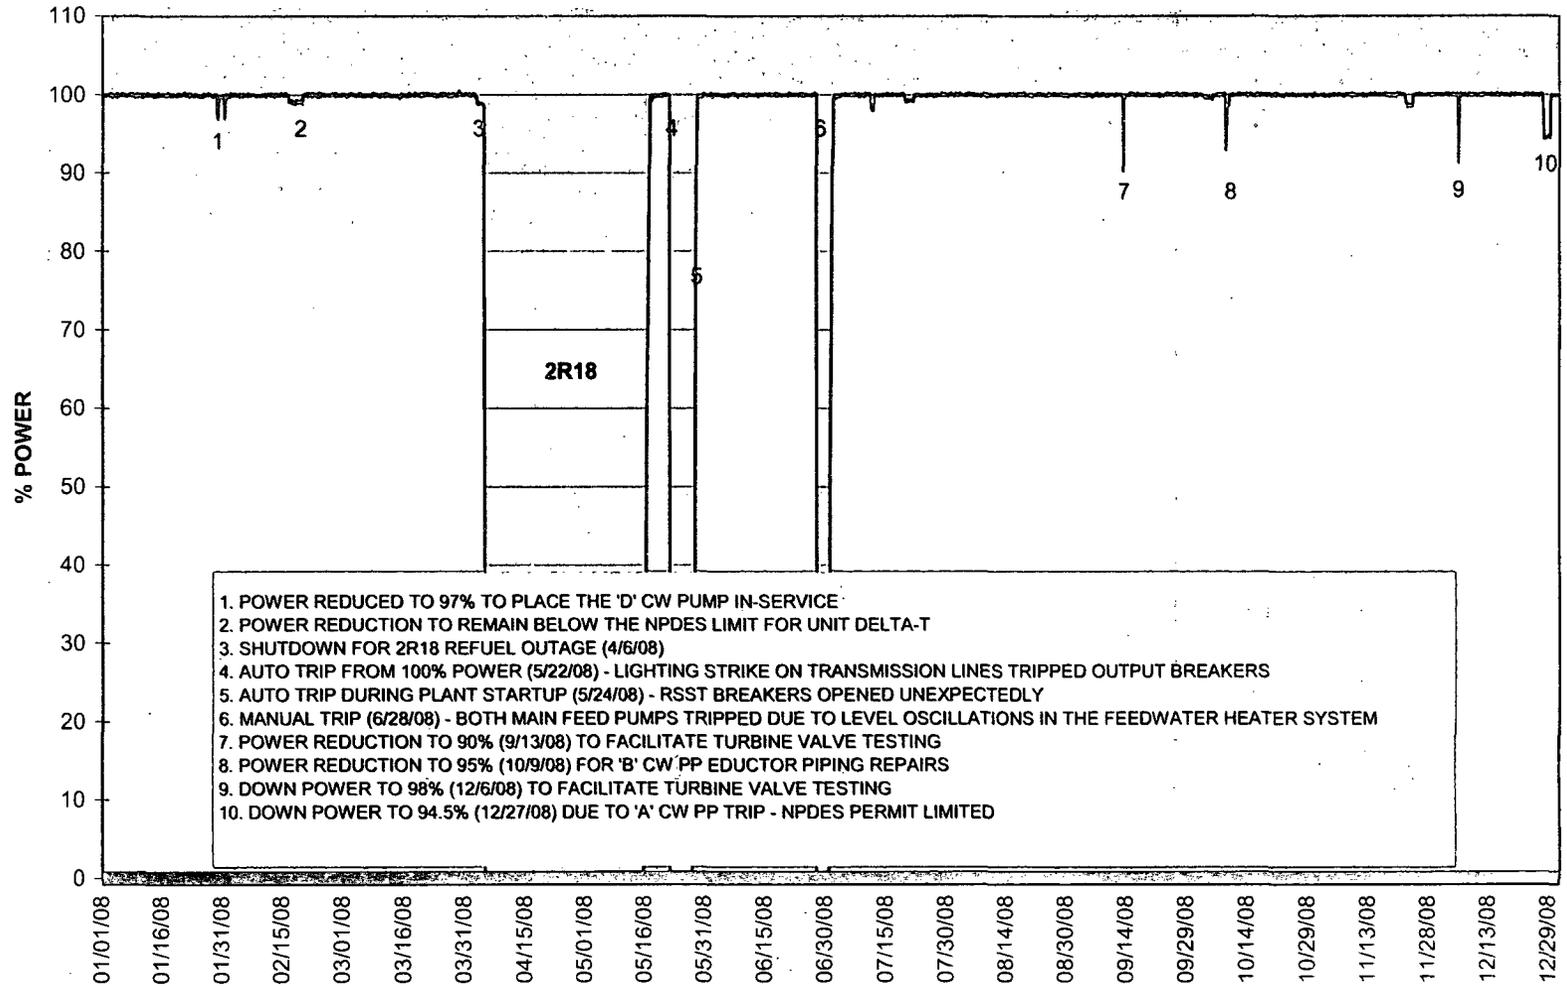

## MP3 - CYCLE 12 & 13 POWER HISTORY YEAR 2008

Note: Data at 3 hour intervals

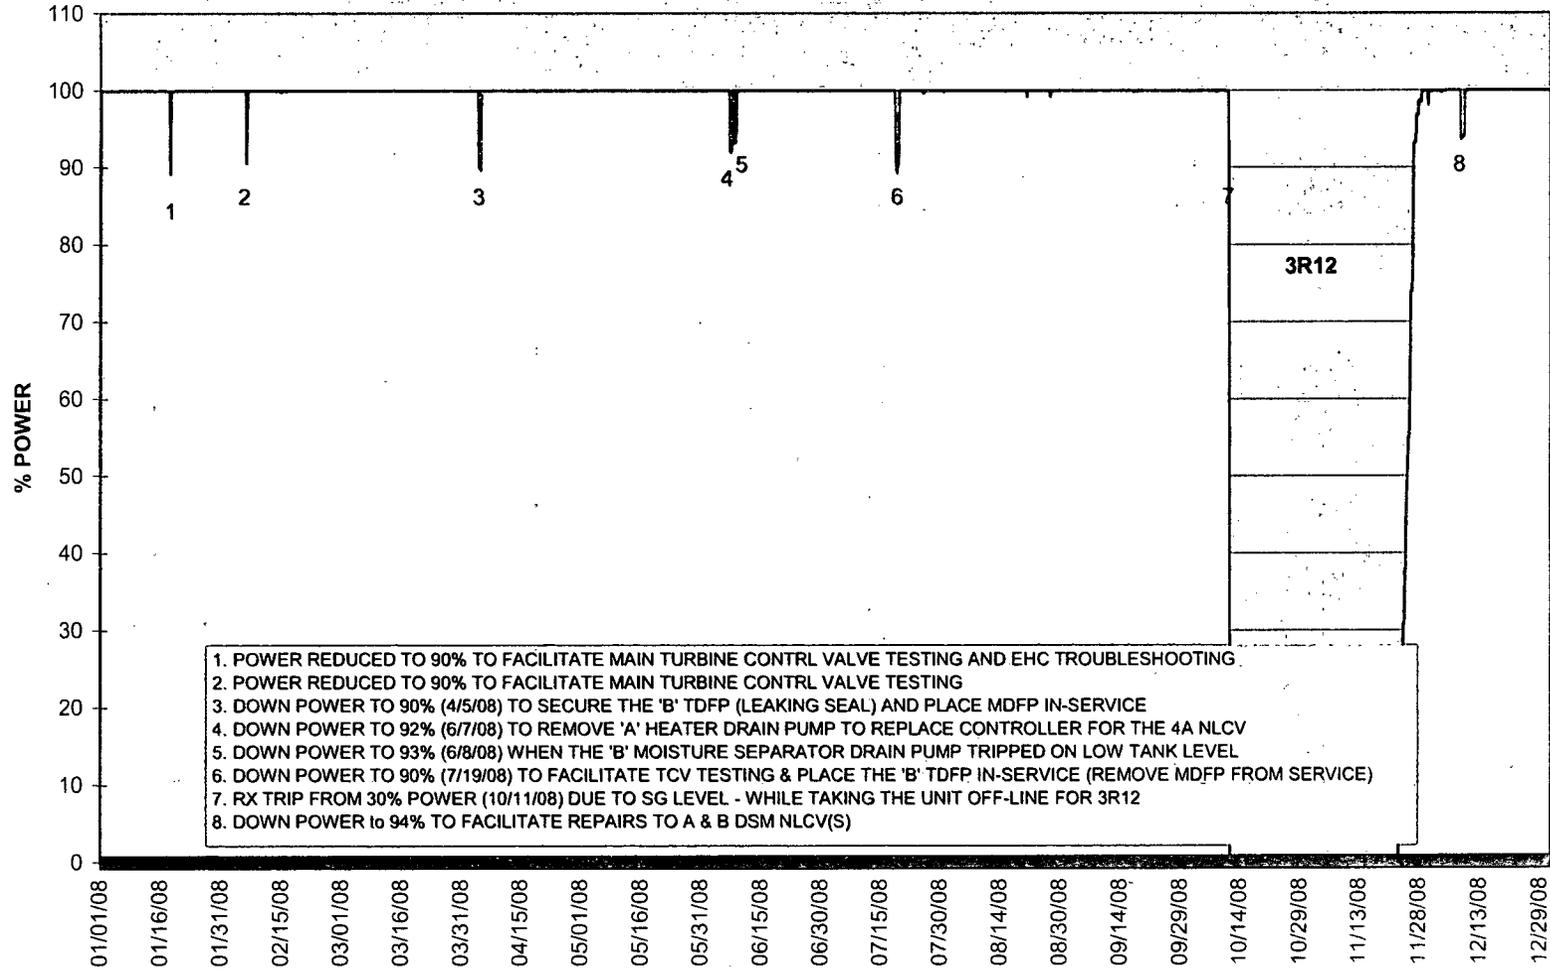

## 5.0 Errata

- 5.1 Table 2.3-A1 from the 2007 Radioactive Effluents Release Report had missing numbers for Particulates Total Activity Released and the Average Period Release Rate for the 1<sup>st</sup> quarter 2007. A revised table on the following page shows the correct numbers highlighted.

Table 2.3-A1 from the 2007 Radioactive Effluents Release Report had missing numbers for Particulates Total Activity Released and the Average Period Release Rate for the 1<sup>st</sup> quarter 2007. A revised table on the following page shows the correct numbers highlighted.

**Table 2.3-A1**  
 Millstone Unit No. 3  
 Airborne Effluents - Release Summary

Units	2007				
	1st Qtr	2nd Qtr	3rd Qtr	4th Qtr	Total

**A. Fission & Activation Gases**

1. Total Activity Released	Ci	6.68E-02	4.04E+01	3.26E+00	2.29E+00	4.60E+01
2. Average Period Release Rate	uCi/sec	8.59E-03	5.14E+00	4.10E-01	2.89E-01	1.46E+00

**B. Iodine-131**

1. Total Activity Released	Ci	3.93E-08	2.23E-03	2.27E-08	-	2.23E-03
2. Average Period Release Rate	uCi/sec	5.05E-09	2.84E-04	2.86E-09	-	7.08E-05

**C. Particulates**

1. Total Activity Released	Ci	4.30E-06	9.25E-04	1.97E-05	9.62E-06	9.59E-04
2. Average Period Release Rate	uCi/sec	5.53E-07	1.18E-04	2.47E-06	1.21E-06	3.04E-05

**D. Gross Alpha**

1. Total Activity Released	Ci	-	-	-	-	-
----------------------------	----	---	---	---	---	---

**E. Tritium**

1. Total Activity Released	Ci	7.31E+00	2.74E+01	8.69E+00	1.18E+01	5.52E+01
2. Average Period Release Rate	uCi/sec	9.40E-01	3.49E+00	1.09E+00	1.49E+00	1.75E+00

"-" denotes less than Minimum Detectable Activity (MDA)

## 6.0 REMODCM Changes

The description and the bases of the change(s) for each REMODCM revision are included here in Volume 1 of the Radioactive Effluent Release Report. In addition, a complete copy of the REMODCM revision(s) for the calendar year 2008 is provided to the Nuclear Regulatory Commission as Volume 2 of the Radioactive Effluent Release Report.

In 2008, there was 1 revision made to the Millstone REMODCM:

<u>Rev</u>	<u>Effective Date</u>
26-00	June 2008

## 6.1 REMODCM - Description of Change(s)

Change Request #: 08-01	
<b>I. Description of changes (include markup pages)</b>	
Originator name (Print):	
Section/Page	Section Title and Description of Change with Basis
Fig. I.C-2/21	<p>“Simplified Liquid Effluent Flow Diagram Millstone Unit 2” Revise figure as shown in markup.</p> <ol style="list-style-type: none"> <li>1) Deletes Degasifier which is no longer usable.</li> <li>2) Adds more detail to show: <ol style="list-style-type: none"> <li>a) cross connection between T21 and T14A/B,</li> <li>b) use of temporary filters between T14A/b and T23 and T15A/B,</li> <li>c) connection between T23 and T15A/B and between T14A/B and T15A/B,</li> <li>d) portable demin T141 A/B/C with option of bypassing ion exchanger T24, and</li> <li>e) cross connection between T21 and T24.</li> </ol> </li> <li>3) Adds footnote that HP decon facility sump is collected in totes and shipped offsite.</li> </ol>
Fig. I.C-3/22	<p>Revise figure as shown in markup.</p> <ol style="list-style-type: none"> <li>1) Adds more detail to show: <ol style="list-style-type: none"> <li>a) optional filter after LWS-TK1A/B,</li> <li>b) cross connections between Boron Recovery System and High Level Waste System, and</li> <li>c) Boron Recovery Tank.</li> </ol> </li> <li>2) Corrects ‘CVCS Ion Exchanger (CHS DEMN 1A/B)’ to ‘Cesium Ion Exchanger (BRS DEMN 1A/B).’</li> <li>3) Deletes LWS-FLT 2A/B.</li> <li>4) Deletes arrow showing direct discharge from Filter LWS-FLT1 to discharge tunnel.</li> <li>5) Replaces the “Chemical and Volume Control System” box with additional detail to show more components of letdown flow to the degasifier and volume control tank.</li> </ol>
Table I.D-1/23	<p>Change frequency of analyses for Balance of Plant Vent Sr-90, Gross alpha from ‘Twice per month’ to ‘Quarterly composite.’ This corrects a copy error from a previous REMODCM change. The frequency of analysis for the gamma emitters from the block above was inadvertently copied.</p>

**Change Request #: 08-01**

<b>Section/Page</b>	<b>Section Title and Description of Change with Basis</b>
Table I.D-2/25 Table I.D-3/28	Change frequency of analyses of gaseous grabs of containment vent to "Same as sample frequency for vent samples." In a prior revision of the REMODCM the frequency had been changed from weekly to every two weeks but the analysis frequency was not changed to correspond to sampling.
Table I.D-3/28 Fig. I.D-3/36	Delete the name "Hogger" because it is a slang term which is no longer used for the containment vacuum pump and it is not needed in this context.
Table I.D-3/28	Combine the four containment means of release in column one into one source release point as 'Containment.' Drawdown, purge, and vent modes of release are already listed in the 2 <sup>nd</sup> column, "Sample Type and Frequency." In the 2 <sup>nd</sup> column, the words 'via air ejector' are added in parentheses to clarify the drawdown mode of release and venting is redefined as "releases to maintain sub-atmospheric pressure (via containment vacuum pumps)." The redefinition of venting makes it technically more accurate as this mode of release is not a vent process.
I.D.2/31	In 2.a.1 after the words "not routinely operating" add the words "or being bypassed." This is needed because some of the processing equipment could be operational while still being bypassed.
I.D.2/32	From Unit 3 gaseous processing equipment delete the Fuel Building Ventilation Filter. This filter is not normally in service for the purpose of extending filter life in case of an accident or condition leading to a large release from the Fuel Building. Releases from the Fuel Building are normally below detectability. By removing the Fuel Building Ventilation Filter from list of processing equipment it would avoid an REMODCM requirement to use the filter in order to prevent a very small effluent dose.
Fig. I.D-2/35 Fig. I.D-3/36	Added a footnote to each diagram to indicate which flow paths are used during an accident. This is to distinguish use of these flow paths from normal effluent use.
I.E.1/38	Changing reporting requirement from "30 days from the end of the affected calendar quarter" to "30 days from receipt of sample results." Some samples are submitted to the contractor analysis lab at the end of the quarter and take 30 days for analyses.
Table I.E-1/39	Change No. of Locations of Well Water from 2 to 6. This change will support the Groundwater Protection Initiative Program as recommended by NEI.

Change Request #: 08-01	
Section/Page	Section Title and Description of Change with Basis
Table I.E-2/41	Add four onsite wells Nos. 79-I, 80-I, 81-I, and 82-I. This change will support the Groundwater Protection Initiative Program as recommended by NEI.
Table I.E-3/44	In Footnote A delete the words "(i.e., seawater)." This would allow the exception to use a value of 30,000 pCi/l for non-drinking water samples taken from on-site wells. This change will support the Groundwater Protection Initiative Program as recommended by NEI.
II.C.6/60	<ol style="list-style-type: none"> <li>1) Add the sentence "Use of a code using the methodology given in Regulatory Guide 1.109 is described in MP-22-REC-GDL03, 'Liquid Dose Calculations – DOSLIQ' " and</li> <li>2) In the last sentence of this section replace 'LADTAPII' with 'liquid dose calculations.'</li> </ol> <p>This change is needed to provide a complete description of the methodology presently being used to calculate dose from release of radioactivity in liquid effluents.</p>
II.D.4.c.1/75	In definition for $C_N^E$ add the words "to the Millstone Stack" after "from the reactor plant gaseous vents" to distinguish the pathway of the release from release to the Unit 3 vent.
II.D.4.c.2 & c.3 /75-76	Delete these two sections. Dose projections methodologies shown in these sections are for the purpose of implementing the requirements in Section I.D.2 when certain processing equipment is not operating. There is no processing for Steam Generator Blowdown Tank Vent; therefore, Section II.D.4.c.2 is not needed. With deletion of the Fuel Building ventilation filter (see change to Section I.D.2, p.32 above) there is no processing of ventilation releases; therefore, Section II.D.4.c.3 is not needed.
II.D.5/76	<p>At the end of Section II.D.5 (p. 76), add the sentences:</p> <ol style="list-style-type: none"> <li>1) "The use of this code and the input parameters are given in MP-22-REC-GDL04, 'Gaseous Dose Calculations – GASPARII' and</li> <li>2) "Use of a code using the methodology given in Regulatory Guide 1.109 is described in MP-22-REC-GDL05, 'Gaseous Dose Calculations – DOSAIR.' "</li> </ol> <p>This change is needed to provide a complete description of the methodology presently being used to calculate dose from release of radioactivity in gaseous effluents.</p>

**Change Request #: 08-01**

Section/Page	Section Title and Description of Change with Basis
II.F.5/92	Add the following sentence at end of 2nd paragraph: "In Calculation RERM-02906R2 a maximum allowable setpoint of 42,000 cpm is determined using vent flow of 100,000 ft <sup>3</sup> /min." This would identify the setpoint in the REMODCM without having to refer to a calculation.
Tables III.C-3, IV.C-3, V.C-3 /104, 127, 149	<ol style="list-style-type: none"> <li>1) In Action B add the sentence "Operation of the auxiliary sampling equipment shall be verified every twelve hours." This is needed to ensure that the sampling is maintained during the monitor inoperability.</li> <li>2) Add the following sentence at end of Action D: "Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use." This will relieve operators of having to estimate flow rate when not needed (see CR-07-10892).</li> </ol>
III.D.1.b/107	At the end of the first surveillance requirement add the words "once every 31 days." This would make the requirement consistent with the same requirement for Unit 2 (see page 130) and for Unit 3 (see page 153).
IV.B.2/119	Change definition of "Dose Equivalent I-131" to support AST licensing change. This definition would be worded the same as for Unit 3 (see page 140).
II/53 II.C.5/58 II.F.8/93	<p>Correct the following typographical errors:</p> <ol style="list-style-type: none"> <li>1) On top of page, change "CDCM" TO "ODCM" in title line.</li> <li>2) On bottom of page, delete asterices which appear in definitions for D'<sub>MW</sub> and D'<sub>MO</sub>.</li> <li>3) Change 'Rev. 0' to 'Rev. 1' in reference to Calculation RERM-01946-R3.</li> </ol>


Serial No. 09-200  
Docket Nos. 50-245  
50-336  
50-423  
License Nos. DPR-21  
DPR-65  
NPF-49

**ATTACHMENT 2**

**2008 RADIOACTIVE EFFLUENT RELEASE REPORT**  
**VOLUME 2**

**MILLSTONE POWER STATION UNITS 1, 2, AND 3**  
**DOMINION NUCLEAR CONNECTICUT, INC. (DNC)**

# Millstone Power Station 2008 Radioactive Effluents Release Report Volume 2

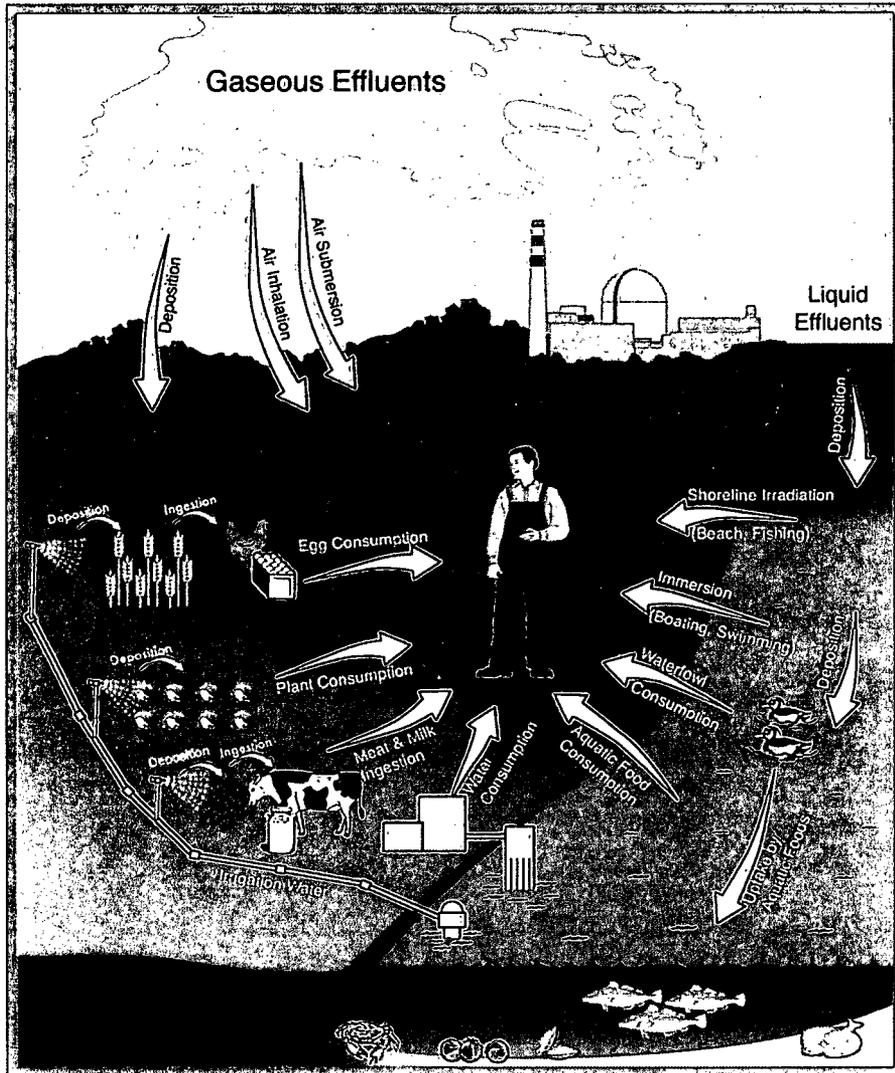

Dominion Nuclear Connecticut, Inc.

MILLSTONE UNIT	LICENSE	DOCKET
1	DPR-21	50-245
2	DPR-65	50-336
3	NPF-49	50-423



MILLSTONE POWER STATION  
STATION PROCEDURE



**Radiological Effluent Monitoring and Off-Site  
Dose Calculation Manual (REMDCM)**

MP-22-REC-BAP01

Rev. 026-00

Approval Date: 6/10/08

Effective Date: 6/19/08

Millstone All Units  
Station Procedure

**Radiological Effluent Monitoring and Off-Site Dose Calculation Manual  
(REMODCM)**

TABLE OF CONTENTS

I.	Radiological Effluent Monitoring Manual (REMM)	7
I.A.	Introduction	7
I.B.	Responsibilities	7
I.C.	Liquid Effluents	7
1.	Liquid Effluent Sampling and Analysis Program	7
2.	Liquid Radioactive Waste Treatment	17
3.	Basis for Liquid Sampling, Analysis and Radioactive Treatment System Use	19
I.D.	Gaseous Effluents	23
1.	Gaseous Effluent Sampling and Analysis Program	23
2.	Gaseous Radioactive Waste Treatment	31
3.	Basis for Gaseous Sampling, Analysis, and Radioactive Treatment System Use	33
I.E.	Radiological Environmental Monitoring	37
1.	Sampling and Analysis	37
2.	Land Use Census	47
3.	Interlaboratory Comparison Program	47
4.	Bases for the Radiological Environmental Monitoring Program	48
I.F.	Report Content	49
1.	Annual Radiological Environmental Operating Report	49
2.	Radioactive Effluent Release Report	50
II	Off-Site Dose Calculation Manual (CDCM)	53
II.A.	Introduction	53
II.B.	Responsibilities	53
II.C.	Liquid Dose Calculations	54
1.	Whole Body Dose from Liquid Effluents	54
2.	Maximum Organ Dose from Liquid Effluents	55
3.	Estimation of Annual Whole Body Dose (Applicable to All Units)	56
4.	Estimation of Annual Maximum Organ Dose (Applicable to All Units)	57
5.	Monthly Dose Projections	58
6.	Quarterly Dose Calculations for Radioactive Effluent Release Report	60
7.	Bases for Liquid Pathway Dose Calculations	61

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

1 of 165

II.D. Gaseous Dose Calculations .....	62
1. Site Release Rate Limits ("Instantaneous") .....	62
2. 10 CFR50 Appendix I – Noble Gas Limits .....	65
3. 10 CFR50 Appendix I – Iodine, Tritium and Particulate Doses .....	68
4. Gaseous Effluent Monthly Dose Projections .....	73
5. Quarterly Dose Calculations for Radioactive Effluent Release Report ..	75
6. Compliance with 40CFR190 .....	76
7. Bases for Gaseous Pathway Dose Calculations .....	76
II.E. Liquid Discharge Flow Rates And Monitor Setpoints .....	78
1. Unit 1 Reactor Cavity Water Discharge Line .....	78
2. Reserved .....	79
3. Unit 2 Clean Liquid Radwaste Effluent Line – RM9049 and Aerated Liquid Radwaste Effluent Line – RM9116 .....	79
4. Condensate Polishing Facility Waste Neutralization Sump Effluent Line – CND245 .....	81
5. Unit 2 Steam Generator Blowdown – RM4262 and Unit 2 Steam Generator Blowdown Effluent Concentration Limitation .....	82
6. Unit 2 Condenser Air Ejector – RM5099 .....	83
7. Unit 2 Reactor Building Closed Cooling Water RM6038 and Unit 2 Service Water, and RBCCW Sump and Turbine Building Sump Effluent Concentration Limitation .....	83
8. Unit 3 Liquid Waste Monitor – LWS–RE70 .....	85
9. Unit 3 Regenerant Evaporator Effluent Line – LWC–RE65 .....	87
10. Unit 3 Waste Neutralization Sump Effluent Line – CND–RE07 .....	87
11. Unit 3 Steam Generator Blowdown – SSR–RE08 and Unit 3 Steam Generator Blowdown Effluent Concentration Limitation .....	87
12. Unit 3 Turbine Building Floor Drains Effluent Line – DAS–RE50 and Unit 3 Service Water and Turbine Building Sump Effluent Concentration Limitation .....	89
13. Bases for Liquid Monitor Setpoints .....	89
II.F. Gaseous Monitor Setpoints .....	90
1. Unit 1 Spent Fuel Pool Island Monitor – RM–SFPI–02 .....	90
2. Unit 2 Wide Range Gas Monitor (WRGM) – RM8169 .....	90
3. Reserved .....	90
4. Unit 3 SLCRS – HVR–RE19B .....	91
5. Unit 2 Vent – Noble Gas Monitor – RM8132B .....	91
6. Unit 2 Waste Gas Decay Tank Monitor RM9095 .....	91
7. Unit 3 Vent Noble Gas Monitor – HVR–RE10B .....	92
8. Unit 3 Engineering Safeguards Building Monitor – HVQ–RE49 .....	92
9. Bases for Gaseous Monitor Setpoints .....	92

III	REMODCM Unit One Controls .....	98
III.A.	Introduction .....	96
III.B.	Definitions and Surveillance Requirement (SR) Applicability .....	96
III.C.	Radioactive Effluent Monitoring Instrumentation .....	99
1.	Radioactive Liquid Effluent Monitoring Instrumentation .....	99
2.	Radioactive Gaseous Effluent Monitoring Instrumentation .....	102
III.D.	Radioactive Effluents Concentrations And Dose Limitations .....	106
1.	Radioactive Liquid Effluents .....	106
2.	Radioactive Gaseous Effluents .....	108
III.E.	Total Radiological Dose From Station Operations Controls .....	112
III.F.	Bases .....	112
IV	REMODCM Unit Two Controls .....	117
IV.A.	Introduction .....	117
IV.B.	Definitions, Applicability and Surveillance Requirements .....	117
IV.C.	Radioactive Effluent Monitoring Instrumentation .....	121
1.	Radioactive Liquid Effluent Monitoring Instrumentation .....	121
2.	Radioactive Gaseous Effluent Monitoring Instrumentation .....	125
IV.D.	Radioactive Effluents Concentrations And Dose Limitations .....	129
1.	Radioactive Liquid Effluents .....	129
2.	Radioactive Gaseous Effluents .....	131
IV.E.	Total Radiological Dose From Station Operation .....	135
IV.F.	Bases .....	135
V	REMODCM Unit Three Controls .....	139
V.A.	Introduction .....	139
V.B.	Definitions and Applicability and Surveillance Requirements .....	139
V.C.	Radioactive Effluent Monitoring Instrumentation .....	142
1.	Radioactive Liquid Effluent Monitoring Instrumentation .....	142
2.	Radioactive Gaseous Effluent Monitoring Instrumentation .....	147
V.D.	Radioactive Effluents Concentrations And Dose Limitations .....	152
1.	Radioactive Liquid Effluents .....	152
2.	Radioactive Gaseous Effluents .....	154
V.E.	Total Radiological Dose From Station Operations .....	158
V.F.	Bases .....	158

TABLES AND FIGURES

TABLES

Table I.C.-1, "Millstone Unit 1 Radioactive Liquid Waste Sampling and Analysis Program" . . . . . 9

Table I.C.-2, "Millstone Unit 2 Radioactive Liquid Waste Sampling and Analysis Program" . . . . . 11

Table I.C.-3, "Millstone Unit 3 Radioactive Liquid Waste Sampling and Analysis Program" . . . . . 14

Table I.D.-1, "Millstone Unit 1 Radioactive Gaseous Waste Sampling and Analysis Program" . . . . . 23

Table I.D.-2, "Millstone Unit 2 Radioactive Gaseous Waste Sampling and Analysis Program" . . . . . 25

Table I.D.-3, "Millstone Unit 3 Radioactive Gaseous Waste Sampling and Analysis Program" . . . . . 28

Table I.E.-1, "Millstone Radiological Environmental Monitoring Program" . . . 39

Table I.E.-2, "Environmental Monitoring Program Sampling Locations" . . . . . 40

Table I.E.-3, Reporting Levels For Radioactivity Concentrations In Environmental Samples . . . . . 44

Table I.E.-4, Maximum Values For Lower Limits Of Detection (LLD) . . . . . 45

Table App. II.A.-1, "Millstone Effluent Requirements and Methodology Cross Reference" . . . . .

Table III.C.-1, "Radioactive Liquid Effluent Monitoring Instrumentation" . . . 100

Table III.C.-2, "Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 101

Table III.C.-3, "Radioactive Gaseous Effluent Monitoring Instrumentation" . 103

Table III.C.-4, "Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 105

Table IV.C.-1, "Radioactive Liquid Effluent Monitoring Instrumentation" . . . 122

Table IV.C.-2, "Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 124

Table IV.C.-3, "Radioactive Gaseous Effluent Instrumentation" . . . . . 126

Table IV.C.-4, "Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 128

Table V.C.-1, "Radioactive Liquid Effluent Monitoring Instrumentation" . . . . 143

Table V.C.-2, "Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 146

Table V.C.-3, "Radioactive Gaseous Effluent Monitoring Instrumentation" . . 148

Table V.C.-4, "Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements" . . . . . 150

FIGURES

Figure I.C.-1, "Reserved" ..... 20  
Figure I.C.-2, "Simplified Liquid Effluent Flow Diagram Millstone Unit 2 .... 21  
Figure I.C.-3, "Simplified Liquid Effluent Flow Diagram Millstone Unit 3 .... 22  
Figure I.D.-1, "Simplified Gaseous Effluent Flow Diagram Millstone Unit One" ..... 34  
Figure I.D.-2, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Two" ..... 35  
Figure I.D.-3, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Three" ..... 36  
Figure I.E.-1, "Inner Air Particulate And Vegetation Monitoring Stations" .... 42  
Figure I.E.-2, "Outer Terrestrial Monitoring Stations ..... 43  
Figure III.D.-1, "Site Boundary for Liquid and Gaseous Effluents" ..... 111  
Figure IV.D.-1, "Site Boundary for Liquid and Gaseous Effluents" ..... 134  
Figure V.D.-1, "Site Boundary for Liquid and Gaseous Effluents" ..... 157



# SECTION I.

## Radiological Effluent Monitoring Manual (REMM)

For the  
Millstone Nuclear Power Station  
Nos. 1, 2, & 3

Docket Nos. 50-245, 50-336, 50-423

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

6 of 165

## SECTION I. RADIOLOGICAL EFFLUENT MONITORING MANUAL (REMM)

### I.A. Introduction

The purpose of Section I of this manual is to provide the sampling and analysis programs which provide input to Section II for calculating liquid and gaseous effluent concentrations and offsite doses. Guidelines are provided for operating radioactive waste treatment systems in order that offsite doses are kept As-Low-As-Reasonably-Achievable (ALARA).

The Radiological Environmental Monitoring Program outlined within this manual provides confirmation that the measurable concentrations of radioactive material in the environment as a result of operations at the Millstone Site are not higher than expected.

In addition, this manual outlines the information required to be submitted to the NRC in both the Annual Radiological Environmental Operating Report and the Radioactive Effluent Release Report.

MP-22-REC-REF03, "REMODCM Technical Information Document (TID)," has additional bases and technical information. It also contains a list of exceptions to Regulatory Guide 1.21 (see Section 2 of the TID).

### I.B. Responsibilities

All changes to the Radiological Effluent Monitoring Manual (REMM) shall be reviewed and approved by the Site Operations Review Committee prior to implementation.

All changes and their rationale shall be documented in the Radioactive Effluent Release Report.

It shall be the responsibility of the Site Vice President Millstone to ensure that this manual is used as required by the administrative controls of the Technical Specifications. The delegation of implementation responsibilities is delineated in MP-22-REC-PRG, "Radiological Effluent Program."

### I.C. Liquid Effluents

#### 1. Liquid Effluent Sampling and Analysis Program

Radioactive liquid wastes shall be sampled and analyzed in accordance with the program specified in Table I.C.-1 for Millstone Unit No. 1, Table I.C.-2 for Millstone Unit No. 2, and Table I.C.-3 for Millstone Unit No. 3. The results of the radioactive analyses shall be input to the methodology of Section II to assure that the concentrations at the point of release are

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

7 of 165

maintained within the limits of Radiological Effluent Controls (Section III.D.1.a. for Millstone Unit No. 1, Section IV.D.1.a. for Millstone Unit No. 2, and Section V.D.1.a. for Millstone Unit No. 3).

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

8 of 165

**Table I.C. - 1**  
**Millstone Unit 1 Radioactive Liquid Waste Sampling and Analysis Program**

Liquid Release Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sub>A</sub> (μCi/ml)
Any Batch Release from any source	Grab sample prior to each batch release <sup>B</sup>	Prior to each batch release	Principal Gamma Emitters	5 x 10 <sup>-7</sup>
			Kr-85	1 x 10 <sup>-5</sup>
		Prior to initial batch release from any one source and monthly composite thereafter <sup>C</sup>	H-3	1 x 10 <sup>-5</sup>
	Grab sample prior to initial batch release from any one source and quarterly composite thereafter	Prior to initial batch release from any one source and quarterly thereafter	Gross alpha	1 x 10 <sup>-7</sup>
			Sr-90	5 x 10 <sup>-8</sup>
			Fe-55	1 x 10 <sup>-6</sup>

**Table I.C. - 1**  
**TABLE NOTATIONS**

A. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{(E)(V)(2.22 \times 10^6)(Ye^{-\lambda \Delta t})}$$

Where:

- LLD is the lower limit of detection as defined above (as μCi per unit mass or volume)
- S<sub>b</sub> is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
- E is the counting efficiency (as counts per transformation)
- V is the sample size (in units of mass or volume)
- 2.22 x 10<sup>6</sup> is the number of transformations per minute per μCi
- Y is the fractional radiochemical yield (when applicable)
- λ is the radioactive decay constant for the particular radionuclide
- Δt is the elapsed time between midpoint of sample collection and midpoint of counting time



It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and recorded on the analysis sheet for the particular sample.

- B. Prior to the sampling, each batch shall be isolated and at least two tank/sump volumes shall be recirculated or equivalent mixing provided.
- C. A composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluents released.



MP-22-REC-BAP01

Rev. 026-00

10 of 165

Table I.C. - 2 Millstone Unit 2 Radioactive Liquid Waste Sampling and Analysis Program					
Liquid Release Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sub>A</sub> (μCi/ml)	
<b>A. Batch Release<sup>B</sup></b>					
1. Clean Waste Monitor Tank, Aerated Waste Monitor Tank and Steam Generator Bulk <sup>D</sup> .	Grab sample prior to each batch release	Prior to each batch release	Principal Gamma Emitters <sup>C</sup>	$5 \times 10^{-7}$	
			I-131	$1 \times 10^{-6}$	
			Ce-144	$5 \times 10^{-6}$	
			Dissolved & Entrained Gases <sup>K</sup>	$1 \times 10^{-5}$	
2. Condensate Polishing Facility - Waste Neutralization Sump <sup>E</sup> .		Monthly Composite <sup>F,G</sup> .	H-3	$1 \times 10^{-5}$	
			Quarterly Composite <sup>F,G</sup> .	Gross alpha	$1 \times 10^{-7}$
				Sr-89, Sr-90	$5 \times 10^{-8}$
			Fe-55	$1 \times 10^{-6}$	
<b>B. Continuous Release</b>					
1. Steam Generator Blowdown <sup>H</sup> .	Daily Grab Sample <sup>I</sup> & prior to aligning to Long Island Sound for RBCCW sump	Weekly Composite <sup>F,G</sup> .	Principal Gamma Emitters <sup>C</sup>	$5 \times 10^{-7}$	
			I-131	$1 \times 10^{-6}$	
			Ce-144	$5 \times 10^{-6}$	
2. Service Water Effluent <sup>J</sup> .					
3. Turbine Sumps <sup>L</sup> .	Monthly Grab Sample	Monthly	Dissolved & Entrained Gases <sup>K</sup>	$1 \times 10^{-5}$	
4. RBCCW Sump <sup>M</sup> .	Weekly Grab or Composite	Monthly Composite <sup>F,G</sup> .	H-3 <sup>N</sup>	$1 \times 10^{-5}$	
			Weekly Composite	Quarterly Composite <sup>F,G</sup> .	Gross alpha
			Fe-55	$1 \times 10^{-6}$	

TABLE I.C. - 2  
TABLE NOTATIONS

A. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{(E)(V)(2.22 \times 10^6)(Ye^{-\lambda t})}$$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

11 of 165

Where:

- **LLD** is the lower limit of detection as defined above (as  $\mu\text{Ci}$  per unit mass or volume)
- **$S_b$**  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
- **E** is the counting efficiency (as counts per transformation)
- **V** is the sample size (in units of mass or volume)
- **$2.22 \times 10^6$**  is the number of transformations per minute per  $\mu\text{Ci}$
- **Y** is the fractional radiochemical yield (when applicable)
- **$\lambda$**  is the radioactive decay constant for the particular radionuclide
- **$\Delta t$**  is the elapsed time between midpoint of sample collection and midpoint of counting time

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and recorded on the analysis sheet for the particular sample.

- B. A batch release is the discharge of liquid wastes of a discrete volume from the tanks listed in this table. Prior to the sampling, each batch shall be isolated and at least two tank/sump volumes shall be recirculated or equivalent mixing provided. If the steam generator bulk can not be recirculated prior to batch discharge, samples will be obtained by representative compositing during discharge.
- C. The LLD will be  $5 \times 10^{-7} \mu\text{Ci/ml}$ . The principal gamma emitters for which this LLD applies are exclusively the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, and Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6} \mu\text{Ci/ml}$ . This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the Radioactive Effluent Release Report.
- D. For the Steam Generator Bulk:  
**IF** the applicable batch gamma activity is not greater than  $5 \times 10^{-7} \mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90, Fe-55 are not required.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

12 of 165

- E. For the Condensate Polishing Facility (CPF) waste neutralization sump:  
**IF** there is no detectable tritium in the steam generators, **THEN** tritium sampling and analyses is not required.  
**IF** the gross gamma activity in the grab sample taken prior to release does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90 and Fe-55 are not required.
- F. For Batch Releases and Steam Generator Blowdown only, a composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
- G. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluents released.
- H. For the Steam Generator Blowdown:  
**IF** the steam generator gross gamma activity does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for all principal gamma, I-131, Ce-144, noble gases, gross alpha, Sr-89, Sr-90 and Fe-55 are not required.
- I. Daily grab samples shall be taken at least five days per week. For service water, daily grabs shall include each train that is in-service.
- J. For the Service Water:  
**IF** a weekly gamma analysis does not indicate a gamma activity greater than  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90, Fe-55 are not required.
- K. LLD applies exclusively to the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the "Radioactive Effluent Release Report."
- L. For the Turbine Building Sump:  
**IF** there is no detectable tritium in the steam generators, **THEN** tritium sampling and analyses is not required.  
**IF** the steam generator gross gamma activity does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **OR** sump is directed to radwaste treatment, **THEN** the sampling and analysis schedule for all principal gamma, I-131, Ce-144, noble gases, gross alpha, Sr-89, Sr-90 and Fe-55 are not required.  
**IF** the release pathway is directed to yard drains, **THEN** the LLD for I-131 shall be  $1.5 \times 10^{-7}$   $\mu\text{Ci/ml}$  and for gross alpha  $1 \times 10^{-8}$   $\mu\text{Ci/ml}$ .
- M. For the RBCCW Sump:  
**IF** the RBCCW Sump is directed to radwaste treatment or is not aligned to Long Island Sound, **THEN** sampling is not required.  
**IF** the applicable batch gamma activity is not greater than  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** sampling and analysis schedule for gross alpha, Sr-89, Sr-90, Fe-55 are not required.
- N. Detectable tritium shall be used to estimate tritium releases to the atmosphere via the blowdown tank vent.



Table I.C.-3 Millstone Unit 3 Radioactive Liquid Waste Sampling and Analysis Program				
Liquid Release Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>A</sup> (μCi/ml)
<b>A. Batch Release<sup>B</sup></b>				
1. Condensate Polishing Facility Waste Neutralization Sump <sup>E</sup>  2. Waste Test Tanks, Low Level Waste Tank, Boron Test Tanks and Steam Generator Bulk <sup>D</sup>	Grab sample prior to each batch release	Prior to each batch release	Principal Gamma Emitters <sup>C</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
			Ce-144	$5 \times 10^{-6}$
			Dissolved & Entrained Gases <sup>K</sup>	$1 \times 10^{-5}$
		Monthly Composite <sup>F,G</sup>	H-3	$1 \times 10^{-5}$
		Quarterly Composite <sup>F,G</sup>	Gross alpha	$1 \times 10^{-7}$
			Sr-89, Sr-90	$5 \times 10^{-8}$
Fe-55	$1 \times 10^{-6}$			
<b>B. Continuous Release</b>				
1. Steam Generator Blowdown <sup>H</sup> 2. Service Water Effluent <sup>J</sup>	Daily Grab Sample <sup>L</sup>	Weekly Composite <sup>F,G</sup>	Principal Gamma Emitters <sup>C</sup>	$5 \times 10^{-7}$
			I-131	$1 \times 10^{-6}$
			Ce-144	$5 \times 10^{-6}$
3. Turbine Building Sumps <sup>L</sup>	Monthly Grab Sample	Monthly	Dissolved & Entrained Gases <sup>K</sup>	$1 \times 10^{-5}$
	Weekly Grab or Composite	Monthly Composite <sup>F,G</sup>	H-3 <sup>M</sup>	$1 \times 10^{-5}$
	Weekly Composite	Quarterly Composite <sup>F,G</sup>	Gross alpha	$1 \times 10^{-7}$
			Sr-89, Sr-90	$5 \times 10^{-8}$
Fe-55			$1 \times 10^{-6}$	

**TABLE I.C.-3  
TABLE NOTATIONS**

A. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{(E)(V)(2.22 \times 10^6)(Ye^{-\lambda t})}$$

Where:

- LLD is the lower limit of detection as defined above (as  $\mu\text{Ci}$  per unit mass or volume)
- $S_b$  is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
- E is the counting efficiency (as counts per transformation)
- V is the sample size (in units of mass or volume)
- $2.22 \times 10^6$  is the number of transformations per minute per  $\mu\text{Ci}$
- Y is the fractional radiochemical yield (when applicable)
- $\lambda$  is the radioactive decay constant for the particular radionuclide
- $\Delta t$  is the elapsed time between midpoint of sample collection and midpoint of counting time

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and recorded on the analysis sheet for the particular sample.

- B. A batch release is the discharge of liquid wastes of a discrete volume from the tanks listed in this table. Prior to the sampling, each batch shall be isolated and at least two tank/sump volumes shall be recirculated or equivalent mixing provided. If the steam generator bulk can not be recirculated prior to batch discharge, samples will be obtained by representative compositing during discharge.
- C. The LLD will be  $5 \times 10^{-7} \mu\text{Ci/ml}$ . The principal gamma emitters for which this LLD applies are exclusively the following radionuclides: Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, Cs-134, Cs-137, and Ce-141. Ce-144 shall also be measured, but with an LLD of  $5 \times 10^{-6} \mu\text{Ci/ml}$ . This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the Radioactive Effluent Release Report.
- D. For the Steam Generator Bulk:  
**IF** the applicable batch gamma activity is not greater than  $5 \times 10^{-7} \mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90, Fe-55 are not required.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

15 of 165

- E. For the Condensate Polishing Facility (CPF) waste neutralization sump:  
**IF** there is no detectable tritium in the steam generators, **THEN** tritium sampling and analyses is not required.  
**IF** the gross gamma activity in the grab sample taken prior to release does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90 and Fe-55 are not required.
- F. For Batch Releases and Steam Generator Blowdown only, a composite sample is one in which the quantity of liquid sampled is proportional to the quantity of liquid waste discharged and in which the method of sampling employed results in a specimen which is representative of the liquids released.
- G. Prior to analysis, all samples taken for the composite shall be thoroughly mixed in order for the composite sample to be representative of the effluents released.
- H. For the Steam Generator Blowdown:  
**IF** the steam generator gross gamma activity does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for all principal gamma, I-131, Ce-144, noble gases, gross alpha, Sr-89, Sr-90 and Fe-55 are not required.
- Steam Generator Blowdown samples are not required when blowdown is being recovered.
- I. Daily grab samples shall be taken at least five days per week. For service water, daily grabs shall include each train that is in-service.
- J. For the Service Water:  
**IF** a weekly gamma analysis does not indicate a gamma activity greater than  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **THEN** the sampling and analysis schedule for gross alpha, Sr-89, Sr-90, Fe-55 are not required.
- K. LLD applies exclusively to the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138. This list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the "Radioactive Effluent Release Report."
- L. For the Turbine Building Sump:  
**IF** there is no detectable tritium in the steam generators, **THEN** tritium sampling and analyses is not required.  
**IF** the steam generator gross gamma activity does not exceed  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , **OR** sump is directed to radwaste treatment, **THEN** the sampling and analysis schedule for all principal gamma, I-131, Ce-144, noble gases, gross alpha, Sr-89, Sr-90 and Fe-55 are not required.  
**IF** the release pathway is directed to yard drains, **THEN** the LLD for I-131 shall be  $1.5 \times 10^{-7}$   $\mu\text{Ci/ml}$  and for gross alpha  $1 \times 10^{-8}$   $\mu\text{Ci/ml}$ .
- M. Detectable tritium shall be used to estimate tritium releases to the atmosphere via the blowdown tank vent.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

16 of 165

## 2. Liquid Radioactive Waste Treatment

### a. Dose Criteria for Equipment Operability Applicable to All Millstone Units

The following dose criteria shall be applied separately to each Millstone unit.

- 1) **IF** the radioactivity concentration criteria for the Unit 3 steam generator blowdown is exceeded with blowdown recovery not available to maintain releases to as low as reasonably achievable; or, **IF** any of the other radioactive waste processing equipment listed in Section b. are not routinely operating, **THEN** doses due to liquid effluents from the applicable waste stream to unrestricted areas shall be projected at least once per 31 days in accordance with the methodology and parameters in Section II.C.5.
- 2) **IF** any of these dose projections exceeds 0.006 mrem to the total body or 0.02 mrem to any organ, **THEN** best efforts shall be made to return the processing equipment to service, or to limit discharges via the applicable waste stream.
- 3) **IF** an actual dose due to liquid effluents exceeds 0.06 mrem to the total body or 0.2 mrem to any organ **AND** the dose from the waste stream with processing equipment not operating exceeds 10% of one of these limits, **THEN** prepare and submit to the Commission a Special Report within 30 days as specified in Section 2.c.

### b. Required Equipment for Each Millstone Unit

Best efforts shall be made to return the applicable liquid radioactive waste treatment system equipment specified below for each unit to service or to limit discharge via the applicable waste stream if the projected doses exceed any of the doses specified above.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

17 of 165

1. Millstone Unit No. 1	
<b>Waste Stream</b>	<b>Processing Equipment</b>
Reactor cavity water	One filter and one demineralizer
2. Millstone Unit No. 2	
<b>Waste Stream</b>	<b>Processing Equipment</b>
Clean liquid	Deborating ion exchanger (T11) <b>OR</b> Purification ion exchanger (T10A or T10B) <b>OR</b> Equivalent ion exchanger
	Primary demineralizer (T22 A or B) <b>OR</b> Equivalent demineralizer
	Secondary demineralizer (T23 A or B) <b>OR</b> Equivalent demineralizer//Aerated liquid
Aerated liquid	Demineralizer (T24) <b>OR</b> Equivalent demineralizer
3. Millstone Unit No. 3	
<b>Waste Stream</b>	<b>Processing Equipment or Radioactivity Concentration</b>
High level	Demineralizer filter (LWS-FLT3) and Demineralizer (LWS-DEM2) <b>OR</b> Demineralizer (LWS-DEM1) and Demineralizer filter (LWS-FLT1)
Boron recovery	Cesium ion exchanger (DEMNA or B)
	Boron evaporator (EV-1)
Low level	High level processing equipment
Steam generator blowdown	Blowdown recovery when total gamma activity exceeds $5E-7$ $\mu$ Ci/ml or tritium activity exceeds 0.02 $\mu$ Ci/ml.

c. Report Requirement For All Three Millstone Units

If required by Section 2.a.3), prepare and submit to the Commission a Special Report within 30 days with the following content:

- Explanation of why liquid radwaste was being discharged without treatment, identification of any equipment not in service, and the reason for the equipment being out of service,
- Action(s) taken to restore the equipment to service, and
- Summary description of action(s) taken to prevent a recurrence.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

18 of 165

3. Basis for Liquid Sampling, Analysis and Radioactive Treatment System Use

Paragraph (a)(2) of Part 50.36a provides that licensee will submit an annual report to the Commission which specifies the quantity of each of the principal radionuclides released to unrestricted areas in liquid effluents during the past 12 months of plant operation. The indicated liquid surveillance programs (as directed by surveillance requirements for Radiological Effluent Controls in Sections III.D.1.a., IV.D.1.a., and V.D.1.a. provides the means to quantify and report on liquid discharges from release pathways. As specified in Regulatory Guide 1.21, this program monitors all major and potentially significant paths for release of radioactive material in liquid effluents during normal reactor operations, including anticipated operational occurrences. There are many minor release pathways which are not routinely monitored. The Millstone Effluent Control Program includes, as needed, evaluations to determine if any release point should be added to the REMODCM surveillance program. This information also provides for the assessment of effluent concentrations and environmental dose impacts for the purpose of demonstration compliance with the effluent limits of 10 CFR 20, and dose objectives of 10 CFR 50, Appendix I. The required detection capabilities for radioactive materials in liquid waste samples are tabulated in terms of Lower Limits of Detection (LLDs) and are selected such that the detection of radioactivity in effluent releases will occur at levels below which effluent concentration limits and off-site dose objectives would be exceeded. The LLDs are listed in Table 4.11-1 of NUREG-1301 except for the LLD for Ce-144 which is contained in Footnote (3) of Table 4.11-1 of NUREG-1301.

The indicated liquid radwaste treatment equipment for each Unit have been determined, using the GALE code, to be capable to minimize radioactive liquid effluents such that the dose objectives of Appendix I can be met for expected routine (and anticipated operational occurrence) effluent releases. This equipment is maintained and routinely operated to treat appropriate liquid waste streams without regards to projected environmental doses.

If not already in use, the requirement that the appropriate portions of the liquid radioactive waste treatment system for each Unit be returned to service when the specified effluent doses are exceeded provides assurance that the release of radioactive materials in liquid effluents will be kept "as low as is reasonably achievable." This condition of equipment usage implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR 50, and the design objective given in Section II.D. of Appendix I to 10 CFR 50. The specified dose limits governing the required use of appropriate portions of the liquid radwaste treatment system were selected as a suitable fraction of the dose design objectives set forth in Section II.A. of Appendix I, 10 CFR 50 for liquid effluents following the guidance given in NUREG-1301.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

19 of 165

Figure I.C.-1, "Reserved"

STOP

THINK

ACT


REVIEW

MP-22-REC-BAP01

Rev. 026-00

20 of 165

Figure I.C. -2, "Simplified Liquid Effluent Flow Diagram Millstone Unit 2"

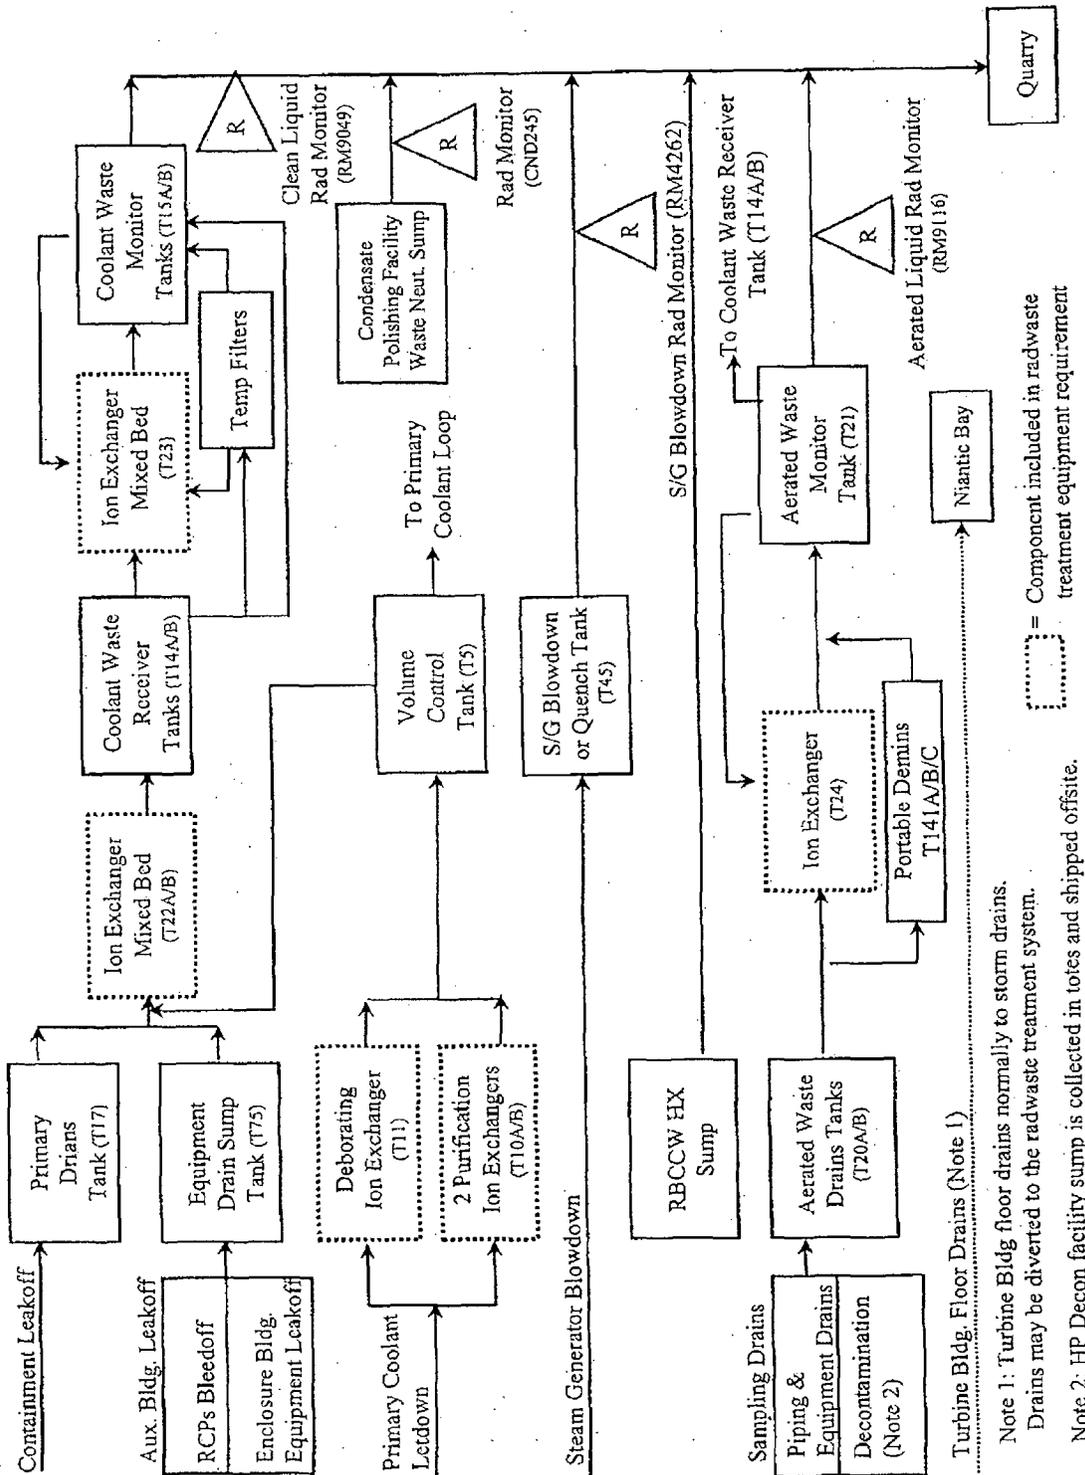

Turbine Bldg. Floor Drains (Note 1)

Note 1: Turbine Bldg floor drains normally to storm drains. Drains may be diverted to the radwaste treatment system.

Note 2: HP Decon facility sump is collected in totes and shipped offsite.

--- = Component included in radwaste treatment equipment requirement

STOP

THINK

ACT


REVIEW

MP-22-REC-BAP01

Rev. 026-00

21 of 165

Figure I.C.-3, "Simplified Liquid Effluent Flow Diagram Millstone Unit

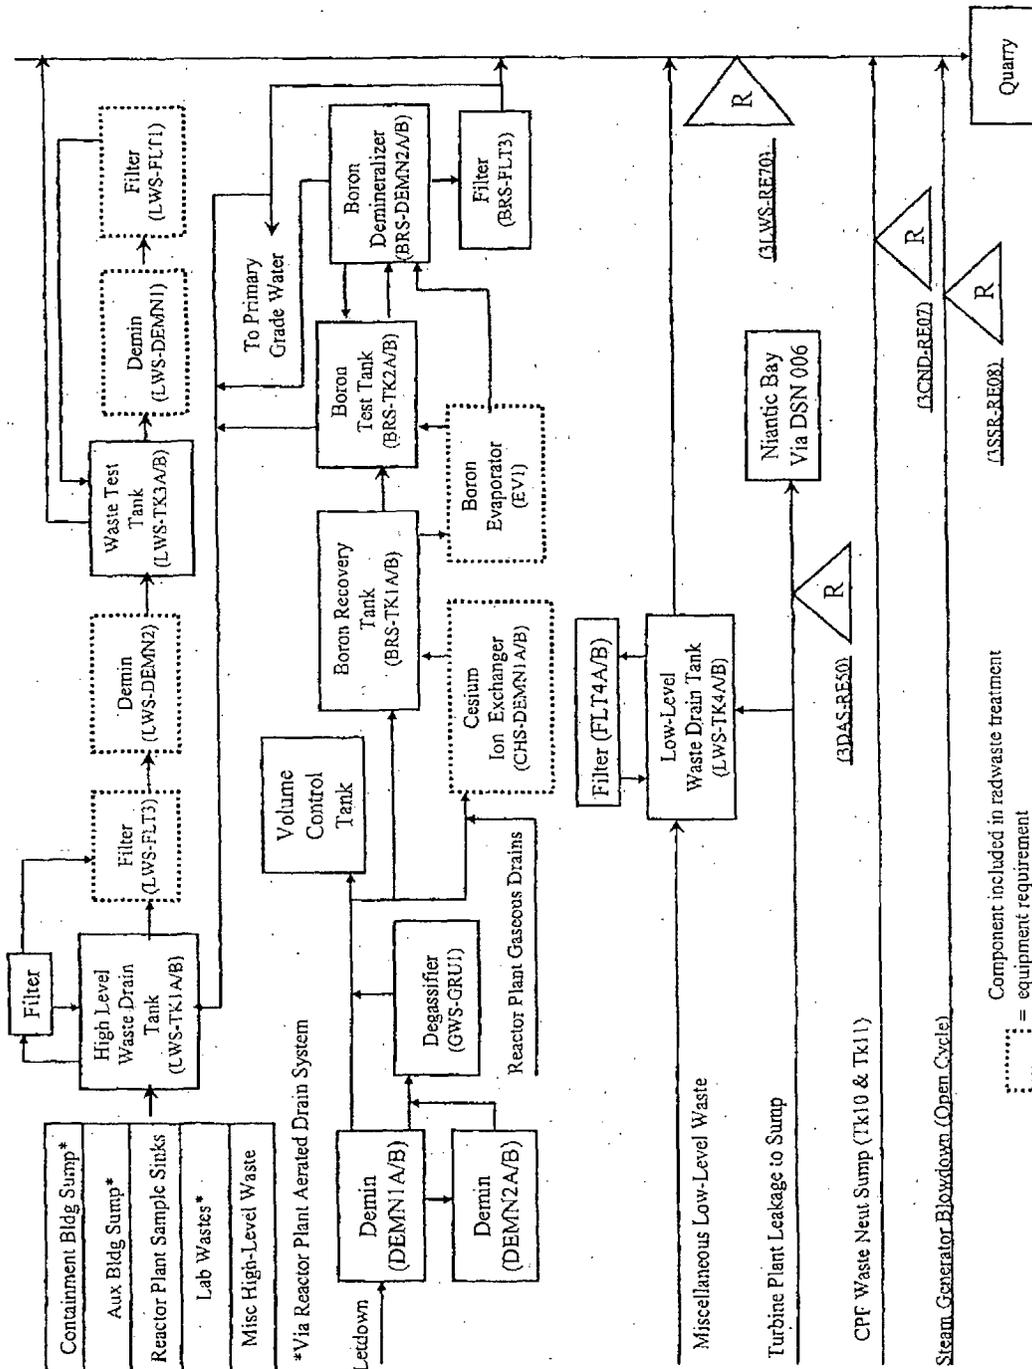

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

22 of 165

## I.D. Gaseous Effluents

### 1. Gaseous Effluent Sampling and Analysis Program

Radioactive gaseous wastes shall be sampled and analyzed in accordance with the program specified in Table I.D.-1 for Millstone Unit No. 1, Table I.D.-2 for Millstone Unit No. 2, and Table I.D.-3 for Millstone Unit No. 3. The results of the radioactive analyses shall be input to the methodology of Section II to assure that offsite dose rates are maintained within the limits of Radiological Effluent Controls (Section III.D.2.a. for Millstone Unit No. 1, Section IV.D.2.a. for Millstone Unit No. 2, and Section V.D.2.a. for Millstone Unit No. 3).

Table I.D.-1 Millstone Unit 1 Radioactive Gaseous Waste Sampling and Analysis Program					
Gaseous Release Point or Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>A</sup> (μCi/ml)	
A. Spent Fuel Pool Island Vent	Monthly <sup>D</sup> - Gaseous Grab Sample	Monthly	Kr-85	1 x 10 <sup>-4</sup>	
			H-3	1 x 10 <sup>-6</sup>	
	Continuous <sup>B,E</sup> Particulate Sample	Twice per month	Principal Particulate Gamma Emitters <sup>C</sup> - (with half lives greater than 8 days)		1 x 10 <sup>-11</sup>
			Sr-90, Gross alpha	1 x 10 <sup>-11</sup>	
Continuous <sup>B,E</sup> Noble Gas	Continuous Monitor	Kr-85	1 x 10 <sup>-6</sup>		
B. Balance of Plant Vent	Continuous <sup>B,E</sup> Particulate Sample	Twice per month	Principal Particulate Gamma Emitters <sup>C</sup> - (with half lives greater than 8 days)	1 x 10 <sup>-11</sup>	
		Quarterly Composite	Sr-90, Gross alpha	1 x 10 <sup>-11</sup>	
	Grab sample of Reactor Bldg evaporator staging tank prior to processing	Prior to processing of each batch	H-3	1 x 10 <sup>-5</sup>	

Table I.D.-1  
TABLE NOTATIONS

- A. The lower limit of detection (LLD) is defined in Table Notations, Item a, of Tables I.C.-1, I.C.-2, or I.C.-3.
- B. The ratio of the sample flow rate to the sampled stream flow rate shall be known.



- C. For particulate samples, the LLD will be  $1 \times 10^{-11}$   $\mu\text{Ci/cc}$ . The principal gamma emitters for which this LLD applies are exclusively the following radionuclides: Mn-54, Co-60, Zn-65, Cs-134, Cs-137, and Ce-144. The list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level for that nuclide. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the Radioactive Effluent Release Report.
- D. IF there is an unexplained increase of the SFPI Vent noble gas monitor of greater than a factor of ten, OR the monitor reads  $8.8\text{E}-5$   $\mu\text{Ci/cc}$  or greater, THEN sampling and analysis shall also be performed within 24 hours.
- E. Continuous when exhaust fans are in operation.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

24 of 165

Table I.D. - 2 Millstone Unit 2 Radioactive Gaseous Waste Sampling and Analysis Program				
Gaseous Release Point or Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sub>A</sub> (μCi/ml)
A. Batch Release 1. Waste Gas Storage Tank <sup>H</sup>	Gaseous Grab Prior to each Waste Gas Tank Discharge	Each Tank Discharge	Principal Particulate Gamma Emitters <sup>B</sup>	1 x 10 <sup>-4</sup>
			H-3	1 x 10 <sup>-6</sup>
<b>B. Containment &amp; Aux Building Releases</b>				
1. Containment Purge 2. Containment Venting 3. Open Equipment Hatch During Outages	Gaseous Grab of purges and vents 1. Prior to Each Purge <sup>I</sup> 2. Every two weeks for Venting <sup>I</sup>	1. Prior to purge 2. Same as sample frequency for vent samples.	Principal Gamma Emitters <sup>B</sup>	1 x 10 <sup>-4</sup>
		Monthly	H-3	1 x 10 <sup>-6</sup>
4. Spent Fuel Pool	Continuous Particulate for Open Equipment Hatch during Outage	Weekly	Particulate Gamma emitters for 1/2 hr count (I-131, others with half-life greater than 8 days)	NA
	Continuous Charcoal for Open Equipment Hatch during Outage & Aux Bldg Rollup Door <sup>L</sup>	Weekly	I-131 and I-133 for one hour count	NA
	Gaseous Grab at Equipment Hatch & Aux Bldg Rollup Door <sup>L</sup>	Daily	Noble Gases - Gross Activity	1 x 10 <sup>-4</sup>
<b>C. Continuous Release</b>				
1. Vent (RM8132B)	Monthly - Gaseous Grab Sample <sup>C,K</sup>	Monthly <sup>C,K</sup>	Principal Gamma Emitters <sup>B</sup>	1 x 10 <sup>-4</sup>
			H-3 <sup>G</sup>	1 x 10 <sup>-6</sup>
2. Millstone Stack (RM8169-1)	Continuous Charcoal Sample <sup>D,F</sup>	Weekly	I-131 I-133	1 x 10 <sup>-12</sup> 1 x 10 <sup>-10</sup>
	Continuous Particulate Sample <sup>D,F</sup>	Weekly	Principal Particulate Gamma Emitters <sup>B</sup> - (I-131, others with half lives greater than 8 days)	1 x 10 <sup>-11</sup>
	Continuous Particulate Sample <sup>D</sup>	Quarterly Composite	Sr-89, Sr-90 - Gross alpha	1 x 10 <sup>-11</sup> 1 x 10 <sup>-11</sup>
	Continuous Noble Gas <sup>D</sup>	Continuous Monitor	Noble Gases - Gross Activity	1 x 10 <sup>-6</sup>

TABLE I.D. - 2  
TABLE NOTATIONS

A. The lower limit of detection (LLD) is defined in Table Notations, Item a, of Tables I.C. - 1, I.C. - 2, or I.C. - 3.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

25 of 165

- B. For gaseous samples, the LLD will be  $1 \times 10^{-4}$   $\mu\text{Ci/cc}$  and for particulate samples, the LLD will be  $1 \times 10^{-11}$   $\mu\text{Ci/cc}$ . The principal gamma emitters for which these LLDs apply are exclusively the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emission and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 for particulate emissions. The list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level for that nuclide. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the "Radioactive Effluent Release Report."
- C. Sampling and analysis shall also be performed 24 to 72 hours after:
- (1) reactor shutdown or startup, or
  - (2) reactor power change greater than 15% of maximum power within a one hour period. If power change is part of a series of step changes, the sample may be collected 24 to 72 hours after last power change step.
- D. The ratio of the sample flow rate to the sampled stream flow rate shall be known.
- E. RESERVED
- F. Samples shall be changed at least once per seven days and analyses shall be completed within 48 hours after changing.

For Unit 2 vent only

Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup, or thermal power change exceeding 15% of rated thermal power within a 1-hour period and analyses shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This requirement does not apply if: (1) analysis shows that the Dose Equivalent I-131 concentration in the reactor coolant has not increased more than a factor of three; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of three.

- G. **IF** the refueling cavity is flooded and there is fuel in the cavity, **THEN** grab samples for tritium shall be taken weekly. The grab sample shall be taken from the Millstone Stack or vent where the containment ventilation is being discharged at the time of sampling.
- H. Waste Gas Storage Tanks are normally released on a batch basis via the Millstone Stack. However, for the purpose of tank maintenance, inspection, or reduction of oxygen concentration, a waste gas tank may be vented or purged with nitrogen and released to the environment via the normal or alternate pathway using one of the following methods:
- Method A: Without a permit provided the following conditions are met:
- (1) The previous batch of radioactive waste gas has been discharged to a final tank pressure of less than 5 PSIG.
  - (2) No radioactive gases have been added to the gaseous processing system since the previous discharge.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

26 of 165

- (3) Valve lineups are verified to ensure that no radioactive waste gases will be added to the tank.
- (4) Prior to initiation of the vent or purge, a sample of the gas in the tank will be taken and analyzed for any residual gamma emitters and tritium. The tank may be released if:
  - a) Tank activity is less than 1% of the activity released in the previous batch release from the tank, or less than 1% of the activity released to date for the calendar year, and
  - b) the activity of Kr-85 and Xe-133 is less than 0.01 Ci and the activity of all other gases is less than 0.001 Ci.

Method B: With a permit provided valve lineups are verified to ensure that no radioactive waste gases will be added to the tank.

- I. **IF** compared to the radioactivity at the time of the air sample, a Radiation Monitor RM8123 or RM8262 gas channel or a particulate channel increases by a factor of two, **THEN** a new containment air sample shall be taken.  
**IF** containment noble gas activity exceeds  $1E-6$   $\mu\text{Ci}/\text{cc}$  as indicated by the last grab sample, **THEN** sampling frequency shall be increased to weekly until such time that the activity is less than  $1E-6$   $\mu\text{Ci}/\text{cc}$ .
- J. During an outage a sample is only required prior to the initial purge.
- K. **IF** there is an increase of the Millstone Stack or Unit 2 Vent noble gas monitor of greater than 50%, **THEN** sampling and analysis shall also be performed within 24 hours, except for the following conditions:
  - (1) the increase is already accounted for, or
  - (2) the monitor has returned to within 20% of the average reading prior to the increase.**IF** the Millstone Stack or Unit 2 Vent noble gas monitor increased greater than 50% for more than one hour and has decreased prior to collecting a sample representative of the elevated reading, **THEN** an estimate of radioactivity released during the period of elevated reading shall be made.
- L. Continuous charcoal sample at Aux Bldg Rollup Door and daily gas sample at Equipment Hatch and Aux Bldg Rollup Door are only required when moving fuel. Sampling at the Equipment Hatch is not required if the Enclosure Building is intact. Sampling at the Aux Bldg Rollup Door is not required if the rollup door is closed.



**Table I.D.-3  
Millstone Unit 3 Radioactive Gaseous Waste Sampling and Analysis Program**

Gaseous Release Point or Source	Sample Type and Frequency	Minimum Analysis Frequency	Type of Activity Analysis	Lower Limit of Detection (LLD) <sup>A</sup> (µCi/ml)
<b>A. Containment and Fuel Building Release</b>				
1. Containment	Gaseous, particulate and charcoal grab prior to each drawdown (via air ejector)	Prior to each purge or drawdown. Same as sample frequency for releases to maintain sub-atmospheric.	Principal gamma emitters <sup>B</sup>	$1 \times 10^{-4}$
2. Fuel Building	Gaseous grab prior to each purge <sup>H</sup> . Gaseous Grab every two weeks for releases to maintain sub-atmospheric pressure (via containment vacuum purge) <sup>I</sup> .	Prior To Each Drawdown	I-131 I-133	$1 \times 10^{-12}$ $1 \times 10^{-10}$
			Principal particulate gamma emitters <sup>B</sup> - (I-131, others with half lives greater than 8 days)	$1 \times 10^{-11}$
		Monthly for all release sources except Equipment Hatch	H-3	$1 \times 10^{-6}$
	Continuous particulate at open containment equipment hatch	Weekly	Particulate gamma emitters for ½ hour count (I-131, others with half-life greater than 8 days)	NA
	Continuous charcoal at containment equipment hatch and fuel building rollup doors <sup>K</sup>	Weekly	I-131 and I-133 for one hour count	NA
	Gaseous grab at containment equipment hatch & fuel building rollup doors <sup>K</sup>	Daily	Noble Gases - Gross Activity	$1 \times 10^{-4}$
<b>B. Continuous Release</b>				
1. Unit 3 Ventilation Vent (HVR-RE10B)	Monthly - Gaseous Grab Sample <sup>C,J</sup>	Monthly <sup>C,J</sup>	Principal particulate gamma emitters <sup>B</sup>	$1 \times 10^{-4}$
			H-3 <sup>G</sup>	$1 \times 10^{-6}$
2. Engineered Safeguards Building (HVQ-RE49)	Continuous charcoal sample <sup>D,E</sup>	Weekly	I-131 I-133	$1 \times 10^{-12}$ $1 \times 10^{-10}$
	Continuous particulate sample <sup>D,E</sup>	Weekly	Principal particulate gamma emitters <sup>B</sup> - (I-131, others with half lives greater than 8 days)	$1 \times 10^{-11}$
3. Millstone Stack via SLCRS (HVR-RE19B)	Continuous particulate sample <sup>D</sup>	Quarterly composite	Sr-89, Sr-90 Gross alpha	$1 \times 10^{-11}$ $1 \times 10^{-11}$
	Continuous noble gas <sup>D</sup>	Continuous monitor	Noble gases - gross activity	$1 \times 10^{-6}$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

28 of 165

**TABLE I.D.-3  
TABLE NOTATIONS**

- A. The lower limit of detection (LLD) is defined in Table Notations, Item a, of Tables I.C.-1, I.C.-2, or I.C.-3.
- B. For gaseous samples, the LLD will be  $1 \times 10^{-4}$   $\mu\text{Ci/cc}$  and for particulate samples, the LLD will be  $1 \times 10^{-11}$   $\mu\text{Ci/cc}$ . The principal gamma emitters for which these LLDs apply are exclusively the following radionuclides: Kr-87, Kr-88, Xe-133, Xe-133m, Xe-135, and Xe-138 for gaseous emission and Mn-54, Fe-59, Co-58, Co-60, Zn-65, Mo-99, I-131, Cs-134, Cs-137, Ce-141, and Ce-144 for particulate emissions. The list does not mean that only these nuclides are to be detected and reported. Other peaks which are measurable and identifiable, together with the above nuclides, shall also be identified and reported. Nuclides which are below the LLD for the analyses should not be reported as being present at the LLD level for that nuclide. When unusual circumstances result in a priori LLDs higher than required, the reasons shall be documented in the Radioactive Effluent Release Report.
- C. For the ventilation vent and SLGRS, sampling and analysis shall also be performed 24 to 72 hours after:
- (1) reactor shutdown or startup, or
  - (2) reactor power change greater than 15% of maximum power within a one hour period. If power change is part of a series of step changes, the sample may be collected 24 to 72 hours after the last power change step.
- D. The ratio of the sample flow rate to the sampled stream flow rate shall be known.
- E. RESERVED
- F. Samples shall be changed at least once per seven days and analyses shall be completed within 48 hours after changing.

For Unit 3 Vent only:

Sampling shall also be performed at least once per 24 hours for at least 7 days following each shutdown, startup, or thermal power change exceeding 15% of rated thermal power within a 1-hour period and analyses shall be completed within 48 hours of changing. When samples collected for 24 hours are analyzed, the corresponding LLDs may be increased by a factor of 10. This requirement does not apply if: (1) analysis shows that the Dose Equivalent I-131 concentration in the reactor coolant has not increased more than a factor of three; and (2) the noble gas monitor shows that effluent activity has not increased more than a factor of three.

- G. **IF** the refueling cavity is flooded and there is fuel in the cavity, **THEN** grab samples for tritium shall be taken weekly from the ventilation vent.
- H. During an outage a sample is only required prior to the initial purge.
- I. **IF** compared to the radioactivity at the time of the air sample, Radiation Monitor CMS22 gas channel or particulate channel increases by a factor of two, **THEN** a new containment air sample shall be taken.



IF containment noble gas activity exceeds  $1E-6 \mu\text{Ci/cc}$  as indicated by the last grab sample, THEN sampling frequency shall be increased to weekly until such time that the activity is less than  $1E-6 \mu\text{Ci/cc}$ .

- J. IF there is an unexplained increase of the Unit 3 ventilation vent or SLCRS noble gas monitor of greater than 50%, THEN appropriate sampling and analysis shall also be performed within 24 hours, except for the following conditions:

- (1) the increase is already accounted for, or
- (2) the monitor has returned to within 20% of the reading prior to the increase.

IF the SLCRS or Unit 3 Vent noble gas monitor increased greater than 50% for more than one hour and has decreased prior to collecting a sample representative of the elevated reading, THEN an estimate of radioactivity released during the period of elevated reading shall be made.

- K. Continuous charcoal sample at any open Fuel Bldg Rollup Door and daily gas sample at Equipment Hatch and at any open Fuel Bldg Rollup Door are only required when moving fuel. Sampling at a Fuel Bldg Rollup Door is not required if the rollup door is closed.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

30 of 165

## 2. Gaseous Radioactive Waste Treatment

### a. Dose Criteria for Equipment Operability Applicable to All Millstone Units

The following dose criteria shall be applied separately to each Millstone unit.

- 1) **IF** any of the radioactive waste processing equipment listed in Section 2.b. are not routinely operating or are being bypassed, **THEN** doses due to gaseous effluents from the untreated waste stream to unrestricted areas shall be projected at least once per 31 days in accordance with the methodology and parameters in Section II.D.4. For each waste stream, only those doses specified in Section II.D.4. need to be determined for compliance with this section.
- 2) **IF** any of these dose projections exceed 0.02 mrad for gamma radiation, 0.04 mrad for beta radiation or 0.03 mrem to any organ due to gaseous effluents, **THEN** best efforts shall be made to return the processing equipment to service.
- 3) **IF** actual doses exceed 0.2 mrad for gamma radiation, 0.4 mrad for beta radiation or 0.3 mrem to any organ **AND** the dose from a waste stream with equipment not operating exceed 10% any of these limits, **THEN** prepare and submit to the Commission a report as specified in Section I.D.2.c.

### b. Required Equipment for Each Millstone Unit

Best efforts shall be made to return the gaseous radioactive waste treatment system equipment specified below for each unit to service if the projected doses exceed any of doses specified above. For the Unit 2 gas decay tanks, the tanks shall be operated to allow enough decay time of radioactive gases to ensure that the Radiological Effluent Control dose limits are not exceeded.



1. Millstone Unit No. 1	
<b>Waste Stream</b>	<b>Processing Equipment</b>
None Specified	None required
2. Millstone Unit No. 2	
<b>Waste Stream</b>	<b>Processing Equipment</b>
Gaseous Radwaste Treatment System	Five (5) gas decay tanks
	One waste gas compressor
Ventilation Exhaust Treatment System	Auxiliary building ventilation HEPA filter (L26 or L27)
	Containment purge HEPA filter (L25)
	Containment vent HEPA/charcoal filter (L29 A, or B)
3. Millstone Unit No. 3	
<b>Waste Stream</b>	<b>Processing Equipment or Radioactivity Concentration</b>
Gaseous Radwaste Treatment System	Charcoal bed adsorbers
	One HEPA filter

c. Report Requirement For All Three Millstone Units

If required by Section I.D.2.a.3), prepare and submit to the Commission a Special Report within 30 days with the following content:

- Explanation of why gaseous radwaste was being discharged without treatment, identification of any equipment out of service, and the reason for being out of service,
- Action(s) taken to restore the inoperable equipment to service, and
- Summary description of action(s) taken to prevent a recurrence.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

32 of 165


3. Basis for Gaseous Sampling, Analysis, and Radioactive Treatment System Use

Paragraph (a)(2) of Part 50.36a provides that licensee will submit an annual report to the Commission which specifies the quantity of each of the principal radionuclides released to unrestricted areas in gaseous effluents during the past 12 months of plant operation. The indicated gaseous surveillance programs (as directed by surveillance requirements for Radiological Effluent Controls in Sections III.D.2.a., IV.D.2.a. and V.D.2.a. provides the means to quantify and report on radioactive materials released to the atmosphere. As specified in Regulatory Guide 1.21, this program monitors all major and potentially significant paths for release of radioactive material in gaseous effluents during normal reactor operations, including anticipated operational occurrences. There are many minor release pathways which are not routinely monitored. The Millstone Effluent Control Program includes, as needed, evaluations to determine if any release point should be added to the REMODCM surveillance program. This information also provides for the assessment of effluent dose rates and environmental dose impacts for the purpose of demonstration compliance with the effluent limits of 10 CFR 20, and dose objectives of 10 CFR 50, Appendix I. The required detection capabilities for radioactive materials in gaseous waste samples are tabulated in terms of lower limits of detection (LLDs) and are selected, based on NUREG-1301, such that the detection of radioactivity in releases will occur at levels below which effluent offsite dose objectives would be exceeded. The indicated gaseous radwaste treatment equipment for each Unit have been determined, using the GALE code, to be capable to minimize radioactive gaseous effluents such that the dose objectives of Appendix I can be met for expected routine (and anticipated operational occurrence) effluent releases. This equipment is maintained and routinely operated to treat appropriate gaseous waste streams without regards to projected environmental doses.

If not already in use, the requirement that the appropriate portions of the gaseous radioactive waste treatment system for each Unit be returned to service when the specified effluent doses are exceeded provides assurance that the release of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." This condition of equipment usage implements the requirements of 10 CFR 50.36a, General Design Criterion 60 of Appendix A to 10 CFR 50, and the design objective given in Section II.D. of Appendix I to 10 CFR 50. The specified dose limits governing the required use of appropriate portions of the gaseous radwaste treatment system were selected as a suitable fraction of the dose design objectives set forth in Section II.A. of Appendix I, 10 CFR 50 for gaseous effluents following the guidance in NUREG-1301.



Figure I.D.-1, "Simplified Gaseous Effluent Flow Diagram Millstone Unit One"

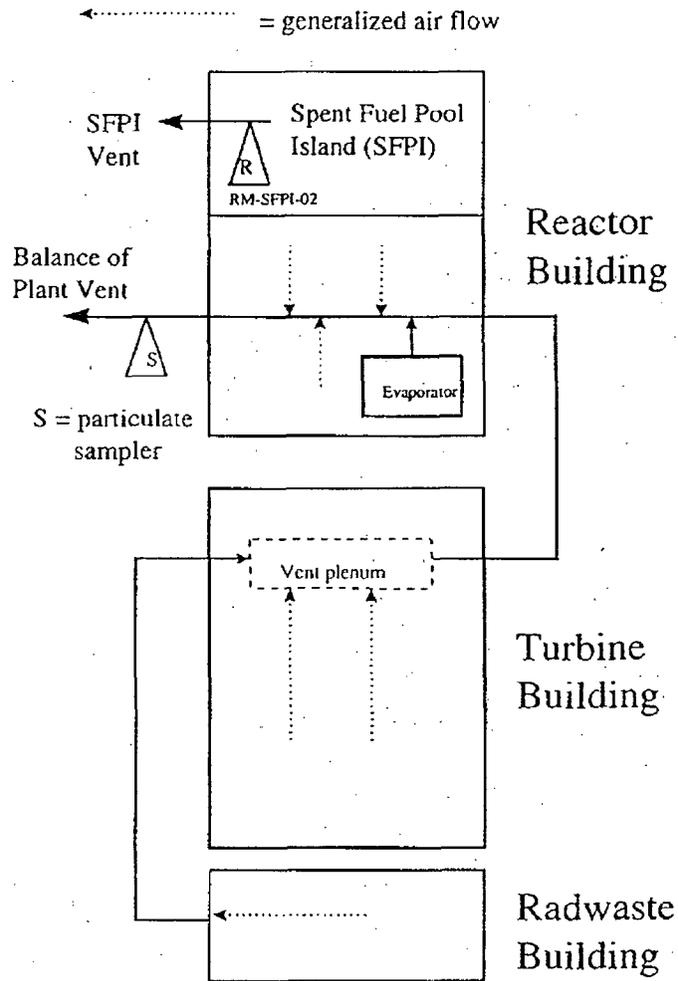

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

34 of 165

Figure I.D.-2, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Two"


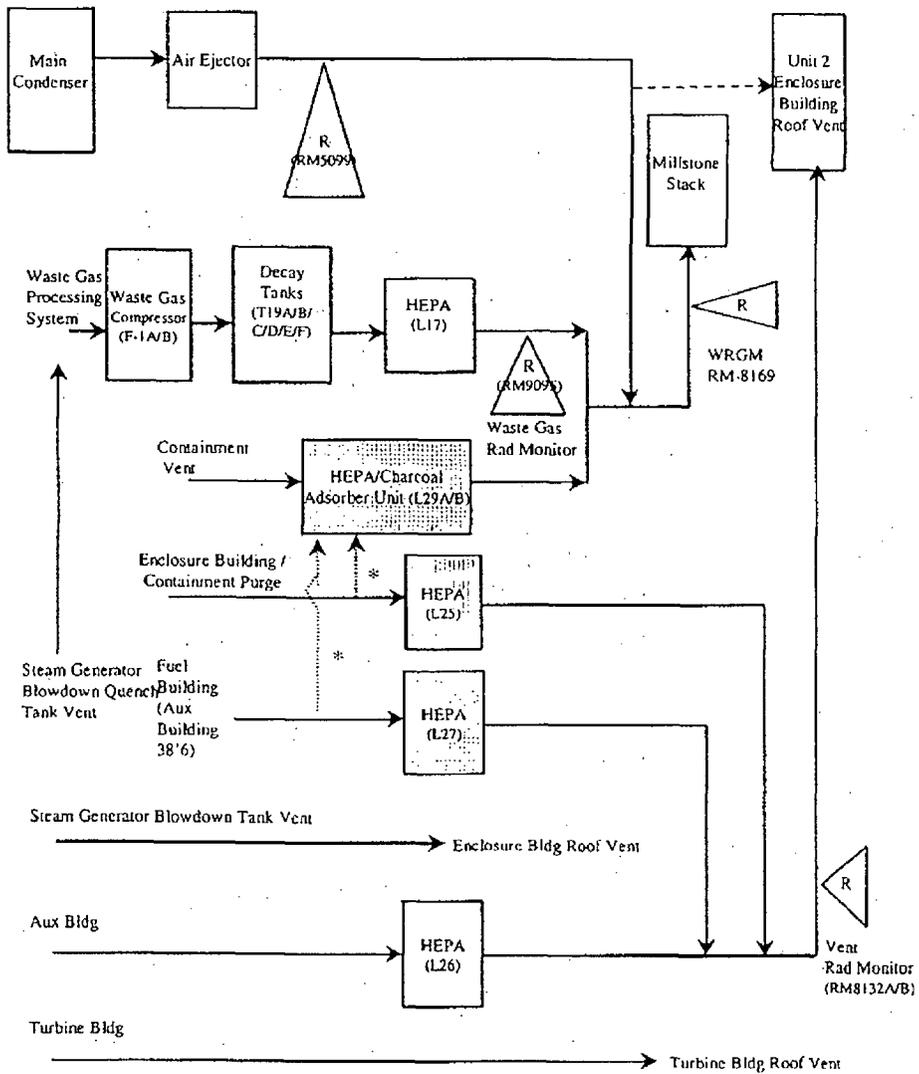


Figure I.D.-3, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Three"

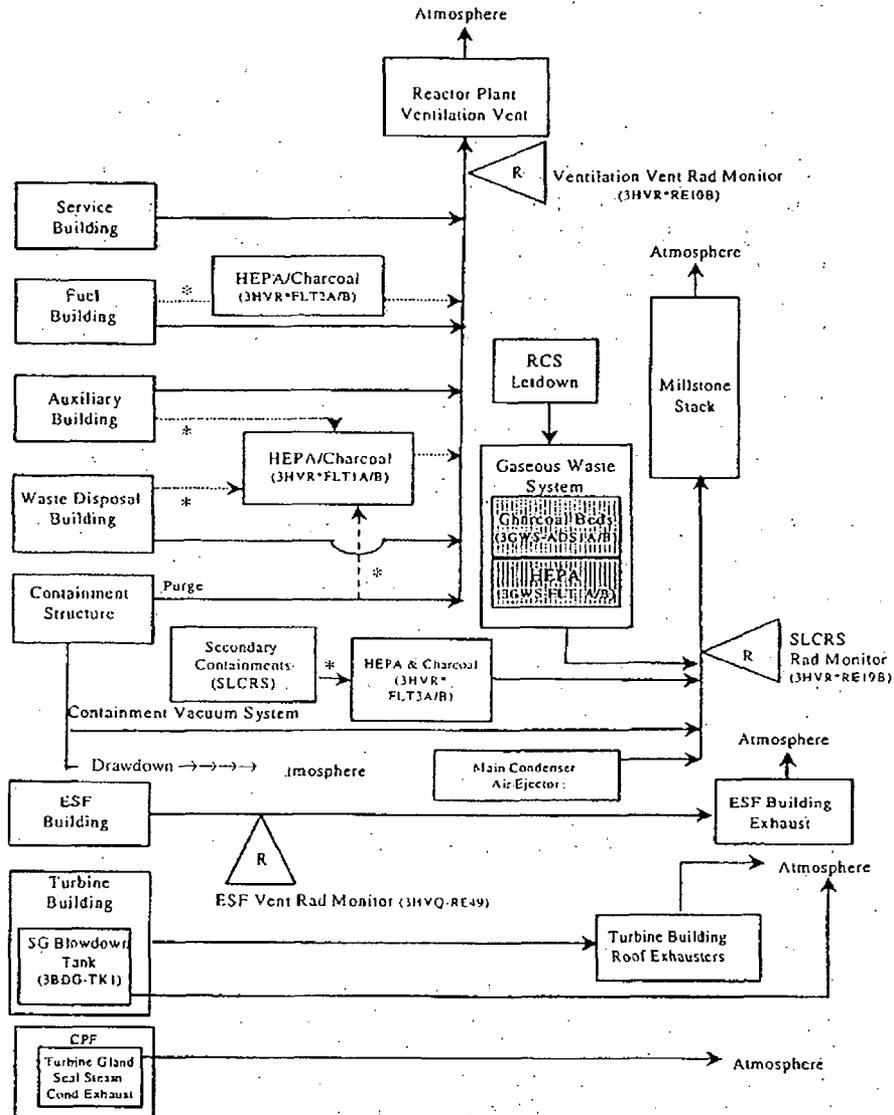

\* These flow paths used during an accident.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

36 of 165

## I.E. Radiological Environmental Monitoring

### 1. Sampling and Analysis

The radiological sampling and analyses provide measurements of radiation and of radioactive materials in those exposure pathways and for those radionuclides which lead to the highest potential radiation exposures of individuals resulting from plant operation. This monitoring program thereby supplements the radiological effluent monitoring program by verifying that the measurable concentrations of radioactive materials and levels of radiation are not higher than expected on the basis of the effluent measurements and modeling of the environmental exposure pathways. Program changes may be made based on operational experience.

The sampling and analyses shall be conducted as specified in Table I.E. -1 for the locations shown Table I.E. -2. Deviations are permitted from the required sampling schedule if specimens are unobtainable due to hazardous conditions, seasonal unavailability, malfunction of automatic sampling equipment or other legitimate reasons. If specimens are unobtainable due to sampling equipment malfunction, every effort shall be made to complete corrective action prior to the end of the next sampling period.

All deviations from the sampling schedule shall be documented in the Annual Radiological Environmental Operating Report pursuant to Section I.E.1. It is recognized that, at times, it may not be possible or practicable to continue to obtain samples of the media of choice (excluding milk) at the most desired location or time. In these instances suitable alternative media and locations may be chosen for the particular pathways in questions and appropriate substitutions made within 30 days in the radiological environmental monitoring program.

If milk samples are temporarily unavailable from any one or more of the milk sample locations required by Table I.E. -2, a grass sample shall be substituted during the growing season (Apr. - Dec.) and analyzed for gamma isotopes and I-131 until milk is again available. Upon notification that milk samples will be unavailable for a prolonged period (>9 months) from any one or more of the milk sample locations required by Table I.E. -2, a suitable replacement milk location shall be evaluated and appropriate changes made in the radiological environmental monitoring program. Reasonable attempts shall be made to sample the replacement milk location prior to the end of the next sampling period. Any of the above occurrences shall be documented in the Annual Radiological Environmental Operating Report, which is submitted to the U. S. Nuclear Regulatory Commission prior to May 1 of each year.

Changes to sampling locations shall be identified in a revised Table I.E. -2 and, as necessary, Figure(s) I.E. -1 through I.E. -3.



MP-22-REC-BAP01

Rev. 026-00

37 of 165

If the level of radioactivity in an environmental sampling medium at one or more of the locations specified in Table I.E. -2 exceeds the report levels of Table I.E. -3 when averaged over any calendar quarter, prepare and submit to the Commission within 30 days from receipt of sample results, a Special Report which includes an evaluation of any release conditions, environmental factors or other aspects which caused the limits of Table I.E. -3 to be exceeded. When more than one of the radionuclides in Table I.E. -3 are detected in the sampling medium, this report shall be submitted if:

$$\frac{\text{concentration (1)}}{\text{reporting level (1)}} + \frac{\text{concentration (2)}}{\text{reporting level (2)}} + \dots \geq 1.0$$

When radionuclides other than those in Table I.E. -3 are detected and are the result of plant effluents, this report shall be submitted if the potential annual dose to an individual is equal to or greater than the appropriate calendar year limit of the Radiological Effluent Controls (Sections III.D.1.b., III.D.2.b., or III.D.2.c. for Unit 1; Sections IVD.1.b., IVD.2.b., or IVD.2.c. for Unit 2; and Sections VD.1.b., VD.2.b., or VD.2.c. for Unit 3). This report is not required if the measured level of radioactivity was not the result of plant effluents, however, in such an event, the condition shall be reported and described in the Annual Radiological Environmental Operating Report.

The detection capabilities required by Table I.E. -4 are state-of-the-art for routine environmental measurements in industrial laboratories. It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement. All analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified and described in the Annual Radiological Environmental Operating Report.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

38 of 165

**Table I.E. - 1  
Millstone Radiological Environmental Monitoring Program**

Exposure Pathway and/or Sample	No. of Locations	Sampling and Collection Frequency	Type and Frequency of Analysis
1. Gamma Dose - Environmental TLD	40 <sup>(a)</sup>	Quarterly	Gamma Dose - Quarterly
2. Airborne Particulate	8	Continuous sampler - weekly filter change	Gross Beta - Weekly Gamma Spectrum - Quarterly on composite (by location), and on individual sample if gross beta is greater than 10x the mean of the weekly control station's gross beta results
3. Airborne Iodine	8	Continuous sampler - weekly canister change	I-131 - Weekly
4. Vegetation	5	One sample near middle and one near end of growing season	Gamma Isotopic on each sample
5. Milk	3	Semimonthly when animals are on pasture; monthly at other times	Gamma Isotopic and I-131 on each sample; Sr-89 and Sr-90 on Quarterly Composite
5.a. Pasture Grass	3	Sample as necessary to substitute for unavailable milk	Gamma Isotopic and I-131
6. Sea Water	2	Continuous sampler with a monthly collection at indicator location. Quarterly at control location - Composite of 6 weekly grab samples	Gamma Isotopic & Tritium on each sample
7. Well Water	6	Semiannual	Gamma Isotopic & Tritium on each sample
8. Bottom Sediment	5	Semiannual	Gamma Isotopic on each sample
9. Soil	3	Annually	Gamma Isotopic on each sample
10. Fin Fish-Flounder and one other type of edible fin fish (edible portion)	2	Quarterly	Gamma Isotopic on each sample
11. Mussels (edible portion)	2	Quarterly	Gamma Isotopic on each sample
12. Oysters (edible portion)	4	Quarterly	Gamma Isotopic on each sample
13. Clams (edible portion)	2	Quarterly	Gamma Isotopic on each sample
14. Lobsters (edible portion)	2	Quarterly	Gamma Isotopic on each sample

(a) Two or more TLDs or TLD with two or more elements per location.



MP-22-REC-BAP01

Rev. 026-00

39 of 165

**Table I.E. - 2**  
**Environmental Monitoring Program Sampling Locations**

The following lists the environmental sampling locations and the types of samples obtained at each location. Sampling locations are also shown on Figures I.E. - 1 and I.E. - 2:

Location		Direction & Distance from Release Point**	Sample Types
No*	Name		
1-I	Onsite - Old Millstone Road	0.6 Mi, NNW	TLD, Air Particulate, Iodine, Vegetation
2-I	Onsite - Weather Shack	0.3 Mi, S	TLD, Air Particulate, Iodine
3-I	Onsite - Bird Sanctuary	0.3 Mi, NE	TLD, Air Particulate, Iodine, Soil
4-I	Onsite - Albacore Drive	1.0 Mi, N	TLD, Air Particulate, Iodine, Soil
5-I	Onsite - MP3 Discharge	0.1 Mi, SSE	TLD
6-I	Onsite - Quarry Discharge	0.3 Mi, SSE	TLD
7-I	Onsite - Environmental Lab Dock	0.3 Mi, SE	TLD
8-I	Onsite - Environmental Lab	0.3 Mi, SE	TLD
9-I	Onsite - Bay Point Beach	0.4 Mi, W	TLD
10-I	Pleasure Beach	1.2 Mi, E	TLD, Air Particulate, Iodine, Vegetation
11-I	New London Country Club	1.6 Mi, ENE	TLD, Air Particulate, Iodine
12-C	Fisher's Island, NY	8.0 Mi, ESE	TLD
13-C	Mystic, CT	11.5 Mi, ENE	TLD
14-C	Ledyard, CT	12.0 Mi, NE	TLD, Soil
15-C	Norwich, CT	14.0 Mi, N	TLD, Air Particulate, Iodine
16-C	Old Lyme, CT	8.8 Mi, W	TLD
17-I	Site Boundary	0.5 Mi, NE	Vegetation
21-I	Goat Location No. 1	2.0 Mi., N	Milk
22-I	Goat Location No. 2	2.7 Mi, NE	Milk
24-C	Goat Location No. 3	29 Mi, NNW	Milk
25-I	Fruits & Vegetables	Within 10 Miles	Vegetation
26-C	Fruits & Vegetables	Beyond 10 Mi	Vegetation
27-I	Niantic	1.7 Mi, WNW	TLD, Air Particulate, Iodine
28-I	Two Tree Island	0.8 Mi, SSE	Mussels, Fish <sup>1</sup>
29-I	West Jordan Cove	0.4 Mi, NNE	Clams, Fish <sup>1</sup>
30-I	Niantic Shoals	1.5 Mi, NNW	Mussels
31-I	Niantic Shoals	1.8 Mi, NW	Bottom Sediment, Oysters
32-I	Vicinity of Discharge <sup>2</sup>		Bottom Sediment, Oysters, Lobster, Fish <sup>1</sup> , Seawater
33-I	Seaside Point	1.8 Mi, ESE	Bottom Sediment
34-I	Thames River Yacht Club	4.0 Mi, ENE	Bottom Sediment
35-I	Niantic Bay	0.3 Mi, WNW	Lobster, Fish
36-I	Black Point	3.0 Mi, WSW	Oysters
37-C	Giant's Neck	3.5 Mi, WSW	Bottom Sediment, Oysters, Seawater
38-I	Waterford Shellfish Bed No. 1	1.0 Mi, NW	Clams
41-I	Myrock Avenue	3.2 Mi, ENE	TLD
42-I	Billow Road	2.4 Mi, WSW	TLD

STOP

THINK

ACT

MP-22-REC-BAP01  
REVIEW Rev. 026-00

Table I.E.-2, Cont.

Location		Direction & Distance from Release Point**	Sample Types
No*	Name		
43-I	Black Point	2.6 Mi, SW	TLD
44-I	Onsite - Schoolhouse	0.1 Mi, NNE	TLD
45-I	Onsite Access Road	0.5 Mi, NNW	TLD
46-I	Old Lyme - Hillcrest Ave.	4.6 Mi, WSW	TLD
47-I	East Lyme - W. Main St.	4.5 Mi, W	TLD
48-I	East Lyme - Corey Rd.	3.4 Mi, WNW	TLD
49-I	East Lyme - Society Rd.	3.6 Mi, NW	TLD
50-I	East Lyme - Manwaring Rd.	2.1 Mi, W	TLD
51-I	East Lyme - Smith Ave.	1.5 Mi, NW	TLD
52-I	Waterford - River Rd.	1.1 Mi, NNW	TLD
53-I	Waterford - Gardiners Wood Rd.	1.4 Mi, NNE	TLD
55-I	Waterford - Magonk Point	1.8 Mi, ESE	TLD
56-I	New London - Mott Ave.	3.7 Mi, E	TLD
57-I	New London - Ocean Ave.	3.6 Mi, ENE	TLD
59-I	Waterford - Miner Ave.	3.4 Mi, NNE	TLD
60-I	Waterford - Parkway South	4.0 Mi, N	TLD
61-I	Waterford - Boston Post Rd.	4.3 Mi, NNW	TLD
62-I	East Lyme - Columbus Ave.	1.9 Mi, WNW	TLD
63-I	Waterford - Jordon Cove Rd.	0.8 Mi, NE	TLD
64-I	Waterford - Shore Rd.	1.1 Mi, ENE	TLD
65-I	Waterford - Bank St.	3.2 Mi, NE	TLD
71-I	Onsite well	Onsite	Well water
72-I	Onsite well	Onsite	Well water
79-I	Onsite well	Onsite	Well water
80-I	Onsite well	Onsite	Well water
81-I	Onsite well	Onsite	Well water
82-I	Onsite well	Onsite	Well water

<sup>1</sup>Fish to be sampled from one of three locations -28, 29, or 32.

<sup>2</sup>Vicinity of discharge includes the Quarry and shoreline area from Fox Island to western point of Red Barn Recreation Area and offshore out to 500 feet.

\* I = Indicator; C = Control.

\*\* = The release points are the Millstone Stack for terrestrial locations and the end of the quarry for aquatic location.

NOTE: Environmental TLDs also function as accident TLDs in support of the Millstone Emergency Plan.



Figure I.E.-1, "Inner Air Particulate And Vegetation Monitoring Stations"


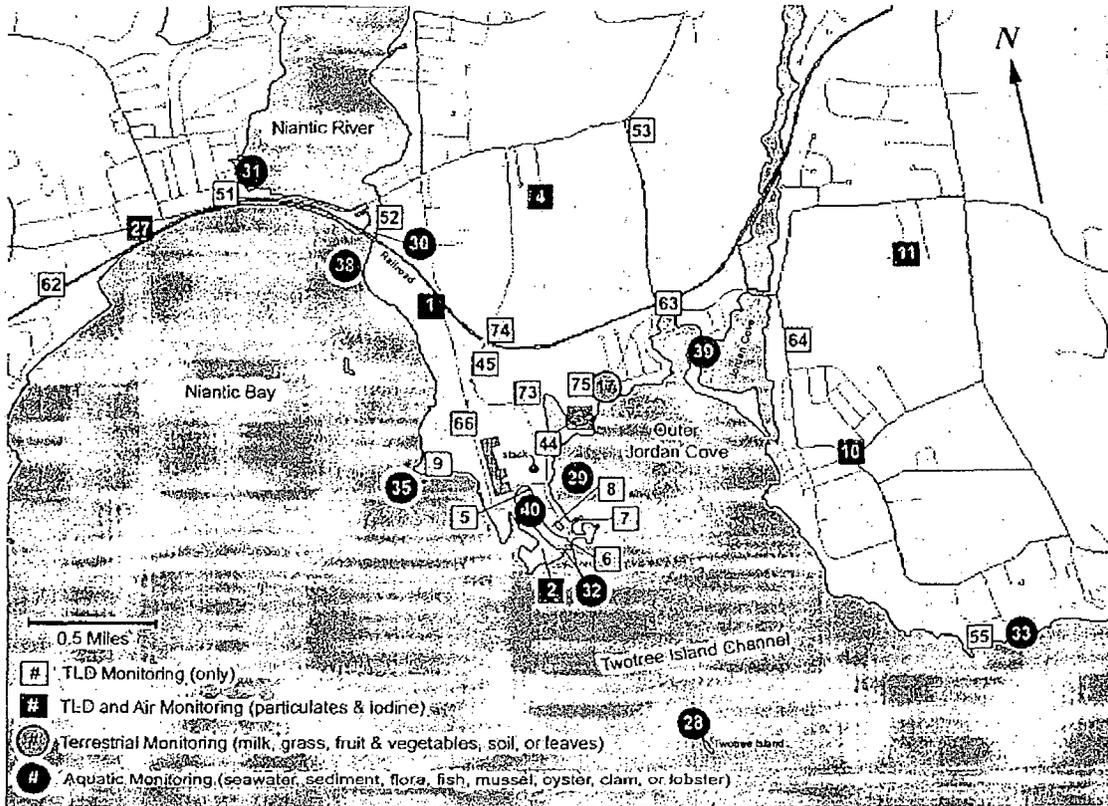


Figure I.E.-2, "Outer Terrestrial Monitoring Stations"

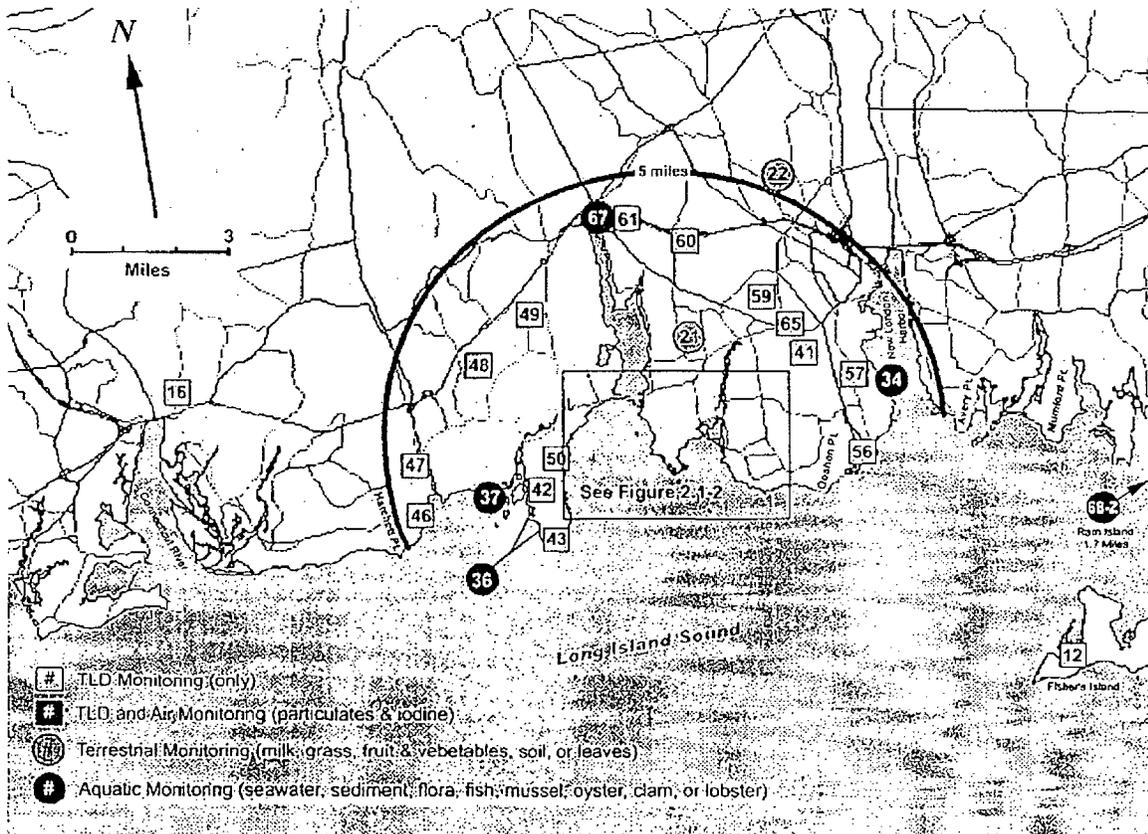

STOP THINK ACT REVIEW

**Table I.E. - 3**  
**Reporting Levels For Radioactivity Concentrations In Environmental Samples**

Analysis	Water (pCi/l)	Airborne- Particulate or Gases (pCi/m <sup>3</sup> )	Fish (pCi/g, wet)	Shellfish <sup>C</sup> (pCi/g, wet)	Milk (pCi/l)	Vegetables (pCi/g, wet)
H-3	20,000 <sup>A</sup>					
Mn-54	1,000		30	140		
Fe-59	400		10	60		
Co-58	1,000		30	130		
Co-60	300		10	50		
Zn-65	300		20	80		
Zr-95	400					
Nb-95	400					
Ag-110m			8	30		
I-131	20 <sup>B</sup>	0.9	0.2	1	3	0.1
Cs-134	30	10	1	5	60	1
Cs-137	50	20	2	8	70	2
Ba-140	200				300	
La-140	200				300	

- A. 20,000 pCi/l for drinking water samples. (This is 40 CFR Part 141 value.) For non-drinking water pathways, a value of 30,000 pCi/l may be used.
- B. Reporting level for I-131 applies to non-drinking water pathways (i.e., seawater). If drinking water pathways are sampled, a value of 2 pCi/l is used.
- C. For on-site samples, these values can be multiplied by 3 to account for the near field dilution factor

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

44 of 165

**Table I.E.-4  
Maximum Values For Lower Limits Of Detection (LLD)<sup>A</sup>.**

Analysis	Water (pCi/l)	Airborne- Particulate or Gases (pCi/m <sup>3</sup> )	Fish Shellfish (pCi/g, wet)	Milk (pCi/l)	Food Products (pCi/g, wet)	Sediment (pCi/g, dry)
gross beta		1 x 10 <sup>-2</sup>				
H-3	2000 <sup>D</sup>					
Mn-54	15		0.130			
Fe-59	30		0.260			
Co-58, 60	15		0.130			
Zn-65	30		0.260			
Zr-95	30					
Nb-95	15					
I-131	15 <sup>C</sup>	7 x 10 <sup>-2</sup>		1	0.06 <sup>B</sup>	
Cs-134	15	5 x 10 <sup>-2</sup>	0.130	15	0.060	0.150
Cs-137	18	6 x 10 <sup>-2</sup>	0.150	18	0.080	0.180
Ba-140	60 <sup>C</sup>			70		
La-140	15 <sup>C</sup>			25		

**TABLE NOTATIONS  
Table I.E.-4**

A. The LLD is the smallest concentration of radioactive material in a sample that will be detected with 95% probability with 5% probability of falsely concluding that a blank observation represents a "real" signal.

For a particular measurement system (which may include radiochemical separation):

$$LLD = \frac{4.66 S_b}{(E)(V)(2.22)(Ye^{-\lambda t})}$$

Where:

- **LLD** is the lower limit of detection as defined above (as  $\mu$ Ci per unit mass or volume)
- **S<sub>b</sub>** is the standard deviation of the background counting rate or of the counting rate of a blank sample as appropriate (as counts per minute)
- **E** is the counting efficiency (as counts per transformation)
- **V** is the sample size (in units of mass or volume)
- **2.22** is the number of transformations per minute per pCi
- **Y** is the fractional radiochemical yield (when applicable)



MP-22-REC-BAP01

Rev. 026-00

45 of 165

- $\lambda$  is the radioactive decay constant for the particular radionuclide
- $\Delta t$  is the elapsed time between midpoint of sample collection and midpoint of counting time (or end of the sample collection period) and time of counting.

It should be recognized that the LLD is defined as an a priori (before the fact) limit representing the capability of a measurement system and not as an a posteriori (after the fact) limit for a particular measurement.

Analyses shall be performed in such a manner that the stated LLDs will be achieved under routine conditions. Occasionally background fluctuations, unavoidably small sample sizes, the presence of interfering nuclides, or other uncontrollable circumstances may render these LLDs unachievable. In such cases, the contributing factors will be identified in the Annual Radiological Environmental Operating Report.

- B. LLD for leafy vegetables.
- C. From end of sample period.
- D. If no drinking water pathway exists (i.e., seawater), a value of 3,000 pCi/l may be used.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01  
Rev. 026-00

46 of 165

## 2. Land Use Census

The land use census ensures that changes in the use of unrestricted areas are identified and that modifications to the monitoring program are made if required by the results of this census. This census satisfies the requirements of Section IV.B.3 of Appendix I to 10 CFR 50. The land use census shall be maintained and shall identify the location of the nearest resident, nearest garden\*, and milk animals in each of the 16 meteorological sectors within a distance of five miles.

The validity of the land use census shall be verified within the last half of every year by either a door-to-door survey, aerial survey, consulting local agriculture authorities, or any combination of these methods.

With a land use census identifying a location(s) which yields a calculated dose or dose commitment greater than the doses currently being calculated in the off-site dose models, make the appropriate changes in the sample locations used.

With a land use census identifying a location(s) which has a higher D/Q than a current indicator location the following shall apply:

- 1) If the D/Q is at least 20% greater than the previously highest D/Q, replace one of the present sample locations with the new one within 30 days if milk is available.
- 2) If the D/Q is not 20% greater than the previously highest D/Q, consider direction, distance, availability of milk, and D/Q in deciding whether to replace one of the existing sample locations. If applicable, replacement shall be within 30 days. If no replacement is made, sufficient justification shall be given in the annual report.

Sample location changes shall be noted in the Annual Radiological Environmental Operating Report.

\*Broad leaf vegetation (a composite of at least 3 different kinds of vegetation) may be sampled at the site boundary in each of 2 different direction sectors with high D/Qs in lieu of a garden census.

## 3. Interlaboratory Comparison Program

The Interlaboratory Comparison Program is provided to ensure that independent checks on the precision and accuracy of the measurements of radioactive material in environmental sample matrices are performed as part of a quality assurance program for environmental monitoring in order to demonstrate that the results are reasonably valid.



MP-22-REC-BAP01

Rev. 026-00

47 of 165

Analyses shall be performed on radioactive materials supplied as part of an Interlaboratory Comparison Program. A summary of the results obtained as part of the above required Interlaboratory Comparison Program shall be included in the Annual Radiological Environmental Operating Report.

With analyses not being performed as required above, report the corrective actions taken to prevent a recurrence to the Commission in the Annual Radiological Environmental Operating Report.

#### 4. Bases for the Radiological Environmental Monitoring Program

Federal regulations (10 CFR Parts 20 and 50) require that radiological environmental monitoring programs be established to provide data on measurable levels of radiation and radioactive materials in the site environs. In addition, Appendix I to 10 CFR 50 requires that the relationship between quantities of radioactive material released in effluents during normal operation, including anticipated operational occurrences, and the resultant radiation doses to individuals from principal pathways of exposure be evaluated. The Millstone Environmental Radiological Monitoring Program (REMP) has been established to verify the effectiveness of in-plant measures used for controlling the release of radioactive materials from the plant, as well as provide for the comparison of measurable concentrations of radioactive materials found in the environment with expected levels based on effluent measurements and the modeling of the environmental exposure pathways.

The REMP detailed in Table I.E.-1 provides measurements of radioactive materials or exposures in the environment along all principal exposure pathways to man that could be impacted by plant effluents. These include direct radiation exposure, inhalation exposure, and ingestion of food products (both aquatic and land grown). In addition, intermediate media such as vegetation and bottom sediments are included as potential early indicators of radioactive material buildup. The selections of sample locations include areas subject to plant effluents that would be expected to exhibit early indication of any buildup of plant related radioactive materials.

The required detection capabilities for environmental sample analyses are tabulated in terms of lower limits of detection (LLDs). Except for Ba-140 and La-140 in milk, the required LLDs are from NUREGs-1301 and 1302. The NUREGs specify an LLD of 15 pCi/l for the parent-daughter combination of Ba-La-140. An LLD of 25 pCi/l is specified for the daughter La-140 and 70 pCi/l for the parent Ba-140.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

48 of 165

Annual reports of environmental radiation monitoring summaries are filed with the NRC in accordance with the requirements of 10 CFR 50.36b and the guidance contained in Regulatory Guide 4.8, Environmental Technical Specifications for Nuclear Power Plant," and NUREG-0472 (NUREG-0473) Revision 3, "Standard Radiological Effluent Technical Specifications for Pressurized Water Reactors (Boiling Water Reactors)."

## I.F. Report Content

### 1. Annual Radiological Environmental Operating Report

The Annual Radiological Environmental Operating Report shall include summaries, interpretations, and statistical evaluation of the results of the radiological environmental surveillance activities for the report period, including a comparison with previous environmental surveillance reports and an assessment of the observed impacts of the plant operation on the environment. The report shall also include the results of the land use census required by Section I.E.2. of this manual. If levels of radioactivity are detected that result in calculated doses greater than 10CFR50 Appendix I Guidelines, the report shall provide an analysis of the cause and a planned course of action to alleviate the cause.

The report shall include a summary table of all radiological environmental samples which shall include the following information for each pathway sampled and each type of analysis:

- 1) Total number of analyses performed at indicator locations.
- 2) Total number of analyses performed at control locations.
- 3) Lower limit of detection (LLD).
- 4) Mean and range of all indicator locations together.
- 5) Mean and range of all control locations together.
- 6) Name, distance and direction from discharge, mean and range for the location with the highest annual mean (indicator or control).
- 7) Number of non-routine reported measurements as defined in these specifications.

In the event that some results are not available for inclusion with the report, the report shall be submitted noting and explaining the reasons for the missing results. The missing data shall be submitted in the next annual report.



This report shall include a comparison of dose assessments of the measured environmental results of the calculated effluent results to confirm the relative accuracy or conservatism of effluent monitoring dose calculations.

The report shall also include a map of sampling locations keyed to a table giving distances and directions from the discharge; the report shall also include a summary of the Interlaboratory Comparison Data required by Section I.E.3. of this manual.

## 2. Radioactive Effluent Release Report

The Radioactive Effluent Release Report (RERR) shall include quarterly quantities of and an annual summary of radioactive liquid and gaseous effluents released from the unit in the Regulatory Guide 1.21 (Rev. 1, June 1974) format. Radiation dose assessments for these effluents shall be provided in accordance with 10 CFR 50.36a and the Radiological Effluent Controls. An annual assessment of the radiation doses from the site to the most likely exposed REAL MEMBER OF THE PUBLIC shall be included to demonstrate conformance with 40 CFR 190. Gaseous pathway doses shall use meteorological conditions concurrent with the quarter of radioactive gaseous effluent releases. Doses shall be calculated in accordance with the Offsite Dose Calculation Manual. The licensee shall maintain an annual summary of the hourly meteorological data (i.e., wind speed, wind direction and atmospheric stability) either in the form of an hour-by-hour listing on a magnetic medium or in the form of a joint frequency distribution. The licensee has the option of submitting this annual meteorological summary with the RERR or retaining it and providing it to the NRC upon request. The RERR shall be submitted prior to May 1 of each year for the period covering the previous calendar year.

The RERR shall include a summary of each type of solid radioactive waste shipped offsite for burial or final disposal during the report period and shall include the following information for each type:

- type of waste (e.g., spent resin, compacted dry waste, irradiated components, etc.)
- solidification agent (e.g., cement)
- total curies
- total volume and typical container volumes
- principal radionuclides (those greater than 10% of total activity)
- types of containers used (e.g., LSA, Type A, etc.)

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01  
Rev. 026-00

50 of 165

The RERR shall include a list of all abnormal releases of radioactive gaseous and liquid effluents (i.e., all unplanned or uncontrolled radioactivity releases, including reportable quantities) from the site to unrestricted areas. Refer To MP-22-REC-REF03, "REMODOCM Technical Information Document (TID)," for guidance on classifying releases as normal or abnormal. The following information shall be included for each abnormal release:

- total number of and curie content of releases (liquid and gas)
- a description of the event and equipment involved
- cause(s) for the abnormal release
- actions taken to prevent recurrence
- consequences of the abnormal release

Changes to the MP-22-REC-BAP01, "Radiological Effluent Monitoring And Offsite Dose Calculation Manual (REMODOCM)," shall be submitted to the NRC as appropriate, as a part of or concurrent with the RERR for the period in which the changes were made.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01  
Rev. 026-00

51 of 165

## SECTION II.

# Offsite Dose Calculation Manual (ODCM)

For the  
Millstone Nuclear Power Station  
Nos. 1, 2, & 3

Docket Nos. 50-245, 50-336, 50-423

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

52 of 165

## SECTION II. OFF-SITE DOSE CALCULATION MANUAL (ODCM)

### II.A. Introduction

The purpose of the Off-Site Dose Calculation Manual (Section II of the REMODCM) is to provide the parameters and methods to be used in calculating offsite doses and effluent monitor setpoints at the Millstone Nuclear Power Station. Included are methods for determining maximum individual whole body and organ doses due to liquid and gaseous effluents to assure compliance with the regulatory dose limitations in 10 CFR 50, Appendix I. Also included are methods for performing dose projections to assure compliance with the liquid and gaseous treatment system operability sections of the Radiological Effluent Monitoring Manual (REMM - Section I of the REMODCM). The manual also includes the methods used for determining quarterly and annual doses for inclusion in the Radioactive Effluent Release Report.

The bases for selected site-specific factors used in the dose calculation methodology are provided in MP-22-REC-REF03, "REMODCM Technical Information."

Another section of this manual discusses the methods to be used in determining effluent monitor alarm/trip setpoints to be used to ensure compliance with the instantaneous release rate limits in Sections III.D.2.a., IV.D.2.a., and V.D.2.a.

This manual includes the methods to be used in performance of the surveillance requirements in the Radiological Effluent Controls of Sections III, IV, and V. Appendix A, Tables App.A-1 provide a cross-reference of effluent requirements and applicable methodologies contained in the REMODCM.

Most of the calculations in this manual have several methods given for the calculation of the same parameter. These methods are arranged in order of simplicity and conservatism, Method 1 being the easiest and most conservative. As long as releases remain low, one should be able to use Method 1 as a simple estimate of the dose. If release calculations approach the limit, however, more detailed yet less conservative calculations may be used. At any time a more detailed calculation may be used in lieu of a simple calculation.

This manual is written common to all three units since some release pathways are shared and there are also site release limits involved. These facts make it impossible to completely separate the three units.

### II.B. Responsibilities

All changes to the Off-Site Dose Calculation Manual (ODCM) shall be reviewed and approved by the Site Operations Review Committee prior to implementation.



MP-22-REC-BAP01

Rev. 026-00

53 of 165

All changes and their rationale shall be documented in the Radioactive Effluent Release Report.

It shall be the responsibility of the Vice President and Senior Nuclear Executive – Millstone to ensure that this manual is used as required by the administrative controls of the Technical Specifications. The delegation of implementation responsibilities is delineated in the MP-22-REC-PRG, “Radiological Effluent Control.”

## II.C. Liquid Dose Calculations

The determination of potential doses from liquid effluents to the maximum exposed member of the public is divided into two methods. Method 1 is a simplified calculation approach that is used as an operational tool to ensure that effluent releases as they occur are not likely to cause quarterly and annual offsite dose limits to be exceeded. Effluent doses are calculated at least once every 31 days. Method 2 is a more detailed computational calculation using accepted computer models to demonstrate actual regulatory dose compliance. Method 2 is used whenever the Method 1 estimation begins to approach a regulatory limit, and for preparation of the Radioactive Effluent Release Report, which includes the quarterly and annual dose impacts for all effluents recorded discharged to the environment during the year of record.

### 1. Whole Body Dose from Liquid Effluents

Radiological Effluent Controls (Sections III, IV, and V) limit the whole body dose to an individual member of the public to 1.5 mrem per calendar quarter and 3 mrem per year from liquid effluents released from each unit. (See Appendix A, Table App.A-1 for cross-reference effluent control requirements and applicable sections in the REMODCM which are used to determine compliance). In addition, installed portions of liquid radwaste treatment system are required to be operated to reduce radioactive materials in liquid effluents when the projected whole body dose over 31 days from applicable waste streams exceeds 0.006 mrem. This part of the REMODCM provides the calculation methodology for determining the whole body dose from radioactive materials released into liquid pathways of exposure associated with routine discharges. This includes the liquid pathways which contribute to the 25 mrem annual total dose limit (40 CFR190) to any real individual member of the public from all effluent sources (liquids, gases, and direct).

#### a. Method 1 (Applicable to Units 1, 2, and 3)

For Unit 1: No Method 1, use Method 2 (Section II.C.1.b.)

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

54 of 165

For Units 2 and 3:

$$D_W = 0.2 C_F + 5.6 \times 10^{-7} C_H$$

Where:

$D_W$  = The estimated whole body dose to a potentially maximum exposed individual (in mrem) due to fission and activation products released in liquid effluents during a specified time period.

$C_F$  = total gross curies of fission and activation products, excluding tritium and dissolved noble gases, released during the period of interest.

$C_H$  = total curies of tritium released during the period of interest.

If  $D_W$ , within a calendar quarter is greater than 0.5 mrem, go to Method 2.

b. Method 2 (Applicable to Units 1, 2, and 3)

If the calculated dose using Method 1 is greater than 0.5 mrem within a calendar quarter, or if a more accurate determination is desired, use the NRC computer code LADTAP II, or a code which uses the methodology given in Regulatory Guide 1.109, to calculate the liquid whole body doses. Method 2 (LADTAP II) is also used in the performance of dose calculations for the Radioactive Effluent Release Report. The use of this code is given in MP-22-REC-GDL02, "Liquid Dose Calculations - LADTAP-II." Additional information on LADTAPII is contained in MP-22-REC-REF03, "REMODCM Technical Information Manual."

2. Maximum Organ Dose from Liquid Effluents

Radiological Effluent Controls (Sections III, IV, and V) limit the maximum organ dose to an individual member of the public to 5 mrem per calendar quarter and 10 mrem per year from liquid effluents released from each unit. (See Appendix A, Table App.A-1 for cross-reference effluent control requirements and applicable sections in the REMODCM which are used to determine compliance). In addition, installed portions of liquid radwaste treatment system are required to be operated to reduce radioactive materials in liquid effluents when the projected maximum organ dose over 31 days from applicable waste streams exceeds 0.02 mrem. This part of the REMODCM provides the calculation methodology for determining the maximum organ dose from radioactive materials released into liquid pathways of exposure associated with routine discharges. This includes the



liquid pathways which contribute to the 25 mrem annual organ (except 75 mrem thyroid) dose limit (40 CFR190) to any real individual member of the public from all effluent sources (liquids, gases, and direct).

- a. Method 1 (Applicable to Units 1, 2, and 3)

For Unit 1: No Method 1, use Method 2 (Section II.C.2.b.)

For Units 2 and 3:

$$D_O = 1.5 C_F$$

Where:  $D_O$  = The estimated maximum organ dose to the potentially maximum exposed individual (in mrem) due to fission and activation products released in liquid effluents during a specified time period.

$C_F$  = total gross curies of fission and activation products, excluding tritium and dissolved noble gases, released during the period of interest – same as Section II.C.1.a.

If  $D_O$ , within a calendar quarter is greater than 2 mrem, go to Method 2.

- b. Method 2 (Applicable to Units 1, 2, and 3)

If the calculated dose using Method 1 is greater than 2 mrem, or if a more accurate determination is desired, use the NRC computer code LADTAP II, or a code which uses the methodology given in Regulatory Guide 1.109, to calculate the liquid maximum organ doses. Method 2 (LADTAP II) is also used in the performance of dose calculations for the Radioactive Effluent Release Report. The use of this code and the input parameters are given in MP-22-REC-GDL02, "Liquid Dose Calculations - LADTAP-II." Additional information on LADTAPII is contained in MP-22-REC-REF03, "REMODOCM Technical Information Manual."

3. Estimation of Annual Whole Body Dose (Applicable to All Units)

An estimation of annual (year-to-date) whole body dose ( $D_{YW}$ ) from liquid effluents shall be made every month to determine compliance with the annual dose limits for each Unit which releases any radioactivity in liquid effluents. Annual doses will be determined as follows:

$$D_{YW} = \sum D_W$$

Where the sum of the doses include the whole body dose contribution from all effluent releases for each Unit recorded to-date. For estimation of the

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

56 of 165

Total Dose requirements of 40CFR190, the effluent releases from all three Units combined are used.

The following shall be used as  $D_w$ :

- 1) If the detailed quarterly dose calculations required per Section II.C.6. for the Radioactive Effluent Release Report are completed for any calendar quarter, use that result.
  - 2) If the detailed calculations are not complete for a particular quarter, use the results as determined in Section II.C.1.
  - 3) If the annual dose estimate,  $D_{Yw}$  is greater than 3 mrem and any  $D_w$  determined as in Section II.C.1. was not calculated using Method 2 (i.e., LADTAP II computer code or a Regulatory Guide 1.109 code), recalculate  $D_w$  using Method 2 if this could reduce  $D_{Yw}$  to less than 3 mrem.
4. Estimation of Annual Maximum Organ Dose (Applicable to All Units)

An estimation of annual (year-to-date) maximum organ dose ( $D_{YO}$ ) from liquid effluents shall be made every month to determine compliance with the annual dose limits for each Unit which releases any radioactivity in liquid effluents. Annual doses will be determined as follows:

$$D_{YO} = \sum D_O$$

Where the sum of the doses include the maximum organ dose contribution from all effluent releases for each Unit recorded to-date. For estimation of the Total Dose requirements of 40CFR190, the effluent releases from all three Units combined are used.

The following guidelines shall be used:

- 1) If the detailed quarterly dose calculations required per Section II.C.6. for the Radioactive Effluent Release Report are completed for any calendar quarter, use that result.
- 2) If the detailed calculations are not complete for a particular quarter, use the results as determined in Section II.C.2.
- 3) If different organs are the maximum for different quarters, they may be summed together and  $D_{YO}$  can be recorded as a less than value as long as the value is less than 10 mrem.



- 4) If  $D_{YO}$  is greater than 10 mrem and any value used in its determination was calculated as in Section II.C.2., but not with Method 2 (i.e., LADTAP II computer code or a Regulatory Guide 1.109 code), recalculate that value using Method 2 if this could reduce  $D_{YO}$  to less than 10 mrem.

5. Monthly Dose Projections

Section I.C.2.a. of the REMM requires that certain portions of the liquid radwaste treatment equipment be used to reduce radioactive liquid effluents when the projected doses for each Unit (made at least once per 31 days) exceeds 0.006 mrem whole body or 0.02 mrem to any organ. The following methods are applied in the estimation of monthly dose projections:

a. Whole Body and Maximum Organ (Applicable to Unit 1 Only)

In the dose code DOSLIQ use concentrations of radionuclides in reactor cavity water and estimates of projected volumes and discharge rates for the following 31 days to estimate dose from liquid discharge of reactor cavity water in the following 31 days.

b. Whole Body and Maximum Organ when Steam Generator Total Gamma Activity is less than  $5E-7$   $\mu$ Ci/ml and Steam Generator Tritium is less than 0.02  $\mu$ Ci/ml (Applicable to Units 2 and 3)

The projected monthly whole body dose (Units 2 or 3) is determined from:

$$D_{MW}^E = D'_{MW} [R_1 R_4 F_2]$$

The monthly projected maximum organ dose (Units 2 or 3) is determined from:

$$D_{MO}^E = D'_{MO} [R_1 R_4 F_2]$$

Where:

$D'_{MW}$  = the whole body dose from the last typical previously completed month as calculated per the methods in Section II.C.1.

$D'_{MO}$  = the maximum organ dose from the last typical previously completed month as calculated per the methods in Section II.C.2.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

58 of 165

$R_1$  = the ratio of the total estimated volume of liquid batches to be released in the present month to the volume released in the past month.

$R_4$  = the ratio of estimated primary coolant activity for the present month to that for the past month.

$F_2$  = the factor to be applied to the estimated ratio of final curies released if there are expected differences in treatment of liquid waste for the present month as opposed to the past month (e.g., bypass of filters or demineralizers). NUREG-0017 or past experience shall be used to determine the effect of each form of treatment which will vary.  $F_2 = 1$  if there are no expected differences.

Notes:

- 1) The last month should be typical without significant operational differences from the projected month. If there were no releases during last month, do not use that month as the base month if it is estimated that there will be releases for the coming month.
  - 2) If the last typical month's doses were calculated using LADTAP II (or similar methodology), also multiply the LADTAP (or similar methodology) doses by  $R_5$  where  $R_5$  = total dilution flow from LADTAP run divided by estimated total dilution flow.
- c. Whole Body and Maximum Organ when Steam Generator Total Gamma Activity Exceeds  $5E-7$   $\mu\text{Ci/ml}$  or Steam Generator Tritium Exceeds  $0.02$   $\mu\text{Ci/ml}$  (Applicable to Units 2 and 3)

The projected monthly whole body dose (Units 2 or 3) is determined from:

$$D_{MW}^E = D'_{MW} [(1 - F_1) R_1 R_4 F_2 + F_1 R_2 R_3]$$

The monthly projected maximum organ dose (Units 2 or 3) is determined from:

$$D_{MO}^E = D'_{MO} [(1 - F_1) R_1 R_4 F_2 + F_1 R_2 R_3]$$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

59 of 165

Where:

$D'_{MW}$  = the whole body dose from the last typical previously completed month as calculated per the methods in Section II.C.1.

$D'_{MO}$  = the maximum organ dose from the last typical previously completed month as calculated per the methods in Section II.C.2.

$R_1$  = the ratio of the total estimated volume of liquid batches to be released in the present month to the volume released in the past month.

$R_2$  = the ratio of estimated volume of steam generator blowdown to be released in present month to the volume released in the past month.

$F_1$  = the fraction of curies released last month coming from steam generator blowdown calculated as:

$$\frac{\text{curies from blowdown}}{\text{curies from blowdown} + \text{curies from batch tanks}}$$

$R_3$  = the ratio of estimated secondary coolant activity for the present month to that for the past month.

$R_4$  = the ratio of estimated primary coolant activity for the present month to that for the past month.

$F_2$  = the factor to be applied to the estimated ratio of final curies released if there are expected differences in treatment of liquid waste for the present month as opposed to the past month (e.g., bypass of filters or demineralizers). NUREG-0017 or past experience shall be used to determine the effect of each form of treatment which will vary.  $F_2 = 1$  if there are no expected differences.

#### 6. Quarterly Dose Calculations for Radioactive Effluent Release Report

Detailed quarterly dose calculations required for the Radioactive Effluent Release Report shall be done using the NRC computer code LADTAP II, or a code which uses the methodology given in Regulatory Guide 1.109. The use of LADTAP II code, and the input parameters are given in MP-22-REC-GDL02, "Liquid Dose Calculations - LADTAP II." Use of a code using the methodology given in Regulatory Guide 1.109 is described in MP-22-REC-GDL03, "Liquid Dose Calculations - DOSLIQ."

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

60 of 165

Additional information on liquid dose calculations is contained in MP-22-REC-REF03, "REMODCM Technical Information Manual."

#### 7. Bases for Liquid Pathway Dose Calculations

The dose calculation methodology and parameters used in Section II of the REMODCM implement the requirements in Section III.A of Appendix I (10CFR50) which states that conformance with the dose objectives of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a member of the public through appropriate pathways is unlikely to be substantially underestimated. The dose estimations calculated by both Method 1 and Method 2 are based on the liquid models presented in Regulatory Guide 1.109, Rev.1; "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR Part 50, Appendix I". These equations are implemented via the use of the NRC sponsored computer code LADTAP II. Input parameter values typically used in the dose models are listed in MP-22-REC-REF03, "REMODCM Technical Information Document." This same methodology is used in the determination of compliance with the 40CFR190 total dose standard for the liquid pathways.

The conversion constants in the Method 1 equations are based on the maximum observed comparison of historical effluent releases for each unit and corresponding whole body or critical organ doses to a maximum individual. The dose conversion factors are calculated based on the ratio of the observed highest dose (whole body and organ) and the curies of fission and activation products released during the period. This ratio results in the Method 1 equation conversion factor in mrem/Ci released. This same approach was repeated separately for tritium (as a different radionuclide class) discharged in liquids wastes. MP-22-REC-REF03 describes the derivation of the Method 1 constants and list the historical whole body and maximum organ doses calculated for each unit operation.



## II.D. Gaseous Dose Calculations

The determination of potential release rates and doses from radioactive gaseous effluents to the maximum off-site receptor are divided into two methods. Method 1 provides simplified operational tools to ensure that effluent releases are not likely to cause quarterly and annual off-site dose or dose rate limits to be exceeded. Effluent doses are calculated at least once every 31 days. Method 2 provides for a more detailed computational calculation using accepted computer models to demonstrate actual regulatory compliance. Method 2 is used whenever the Method 1 estimation approaches a regulatory limit, and for preparation of the Radioactive Effluent Release Report which includes the quarterly and annual dose impacts for all effluents recorded discharged to the atmosphere during the year of record.

### 1. Site Release Rate Limits ("Instantaneous")

Radiological Effluent Controls (Sections III, IV, and V) for each unit require that the instantaneous off-site dose rates from noble gases released to the atmosphere be limited such that they do not exceed 500 mrem/year at any time to the whole body or 3000 mrem/year to the skin at any time from the external cloud. For iodine-131, 133, tritium, and particulates (half-lives > 8 days), the inhalation pathway critical organ dose rate from all units shall not exceed 1500 mrem/year at any time. These limits apply to the combination of releases from all three Units on the site, and are directly related to the radioactivity release rates measured for each Unit. By limiting gaseous release rates for both classes of radionuclides (i.e., noble gases; and iodines, tritium, and particulates) to within values which correlate to the above dose rate limits, assurance is provided that the Radiological Effluent Controls dose rate limits are not exceeded.

#### a. Method 1 for Noble Gas Release Rate Limits

The instantaneous noble gas release rate limit from the site shall be:

$$Q_{1V}/90,000 + Q_{2S}/560,000 + Q_{2V}/290,000 + Q_{3S}/560,000 + Q_{3V}/290,000 \leq 1$$

Where:

$Q_{1V}$  = Noble gas release rate from Spent Fuel Pool Island Vent ( $\mu\text{Ci}/\text{sec}$ )

$Q_{2S}$  = Noble gas release rate from MP2 to Millstone Stack ( $\mu\text{Ci}/\text{sec}$ )

$Q_{2V}$  = Noble gas release rate from MP2 Vent ( $\mu\text{Ci}/\text{sec}$ )

$Q_{3V}$  = Noble gas release rate from MP3 Vent ( $\mu\text{Ci}/\text{sec}$ )

$Q_{3S}$  = Noble gas release rate from MP3 to Millstone Stack ( $\mu\text{Ci}/\text{sec}$ )

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

62 of 165

As long as the above is less than or equal to 1, the doses will be less than or equal to 500 mrem to the total body and less than 3000 mrem to the skin. The limiting factor for the Unit 1 SFPI vent of 90,000 is based on the skin dose limit of 3,000 mrem/year, while all the other factors are based on the whole body dose limit of 500 mrem/year.

b. Method 1 Release Rate Limit – I-131, I-133, H-3 and Particulates Half Lives Greater Than 8 Days

With releases satisfying the following limit conditions, the dose rate to the maximum organ will be less than 1500 mrem/year from the inhalation pathway:

- 1) The site release rate limit of I-131, I-133, and tritium (where the thyroid is the critical organ for these radionuclides) shall be:

$$DR_{thy1} + DR_{thy2} + DR_{thy3} \leq 1$$

Where the contribution from each Unit is calculated from:

$$\text{Unit 1: } DR_{thy1} = 9.36 \times 10^{-6} \cdot Q_{H1V}$$

$$\text{Unit 2: } DR_{thy2} = 5.1 \times 10^{-2} {}^{131}Q_{I2V} + 2.38 \times 10^{-3} {}^{131}Q_{I2S} + 1.25 \times 10^{-2} {}^{133}Q_{I2V} + 5.75 \times 10^{-4} {}^{133}Q_{I2S} + 4.2 \times 10^{-6} Q_{H2V} + 1.9 \times 10^{-7} Q_{H2S}$$

$$\text{Unit 3: } DR_{thy3} = 5.1 \times 10^{-2} {}^{131}Q_{I3V} + 2.38 \times 10^{-3} {}^{131}Q_{I3S} + 1.25 \times 10^{-2} {}^{133}Q_{I3V} + 5.75 \times 10^{-4} {}^{133}Q_{I3S} + 4.2 \times 10^{-6} Q_{H3V} + 1.9 \times 10^{-7} Q_{H3S}$$

- 2) The site release rate limit of particulates with half-lives greater than 8 days and tritium (where the critical organ is a composite of target organs for a mix of radionuclides) shall be:

$$DR_{org1} + DR_{org2} + DR_{org3} \leq 1$$

Where the contribution from each Unit is calculated from:

$$\text{Unit 1: } DR_{org1} = 1.05 \times 10^{-1} [Q_{P1V} + Q_{P1B}] + 9.36 \times 10^{-6} Q_{H1V}$$

$$\text{Unit 2: } DR_{org2} = 2.38 \times 10^{-3} Q_{P2S} + 5.1 \times 10^{-2} Q_{P2V} + 1.9 \times 10^{-7} Q_{H2S} + 4.2 \times 10^{-6} Q_{H2V}$$

$$\text{Unit 3: } DR_{org3} = 2.38 \times 10^{-3} Q_{P3S} + 5.1 \times 10^{-2} Q_{P3V} + 1.9 \times 10^{-7} Q_{H3S} + 4.2 \times 10^{-6} Q_{H3V}$$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

63 of 165

Each of the release rate quantities in the above equations are defined as:

${}_{131}Q_{I2V}$  = Release rate of I-131 from MP2 Vent ( $\mu\text{Ci/sec}$ )\*

${}_{131}Q_{I2S}$  = Release rate of I-131 from MP2 to Millstone Stack ( $\mu\text{Ci/sec}$ )

${}_{133}Q_{I2V}$  = Release rate of I-133 from MP2 Vent ( $\mu\text{Ci/sec}$ )\*

${}_{133}Q_{I2S}$  = Release rate of I-133 from MP2 to Millstone Stack ( $\mu\text{Ci/sec}$ )

${}_{131}Q_{I3V}$  = Release rate of I-131 from MP3 Vents (Normal and ESF) ( $\mu\text{Ci/sec}$ )\*

${}_{131}Q_{I3S}$  = Release rate of I-131 from MP3 to Millstone Stack ( $\mu\text{Ci/sec}$ )

${}_{133}Q_{I3V}$  = Release rate of I-133 from MP3 Vents (Normal and ESF) ( $\mu\text{Ci/sec}$ )\*

${}_{133}Q_{I3S}$  = Release rate of I-133 from MP3 to Millstone Stack ( $\mu\text{Ci/sec}$ )

$Q_{H1V}$  = Release rate of tritium from the Spent Fuel Pool Island and Balance of Plant Vents ( $\mu\text{Ci/sec}$ )

$Q_{H2V}$  = Release rate of tritium from MP2 Vent ( $\mu\text{Ci/sec}$ )\*

$Q_{H2S}$  = Release rate of tritium from MP2 to Millstone Stack ( $\mu\text{Ci/sec}$ )

$Q_{H3V}$  = Release rate of tritium from MP3 Vents (Normal and ESF) ( $\mu\text{Ci/sec}$ )\*

$Q_{H3S}$  = Release rate of tritium from MP3 to Millstone Stack ( $\mu\text{Ci/sec}$ )

$Q_{P1V}$  = Release rate of total particulates with half-lives greater than 8 days from the Spent Fuel Pool Island Vent ( $\mu\text{Ci/sec}$ )

$Q_{P1B}$  = Release rate of total particulates with half-lives greater than 8 days from the Balance of Plant Vent ( $\mu\text{Ci/sec}$ )

$Q_{P2V}$  = Release rate of total particulates with half-lives greater than 8 days from the MP2 Vent ( $\mu\text{Ci/sec}$ )

$Q_{P2S}$  = Release rate of total particulates with half-lives greater than 8 days from MP2 to Millstone Stack ( $\mu\text{Ci/sec}$ )

$Q_{P3V}$  = Release rate of total particulates with half-lives greater than 8 days from MP3 Vents (Normal and ESF) ( $\mu\text{Ci/sec}$ )

$Q_{P3S}$  = Release rate of total particulates with half-lives greater than 8 days from MP3 to Millstone Stack ( $\mu\text{Ci/sec}$ )

\* includes releases via the steam generator blowdown tank vent.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

64 of 165

c. Method 2

The above Method 1 equations assume a conservative nuclide mix. If necessary, utilize the GASPAR, or a code which uses the methodology given in Regulatory Guide 1.109, code to estimate the dose rate from either noble gases or iodines, tritium, and particulates with half-lives greater than 8 days. The use of the code is described in MP-22-REC-GDL04, "Gaseous Dose Calculations - GASPARII." Additional information on GASPAR is contained in the MP-22-REC-REF03, "REMODOCM Technical Information Manual."

2. 10 CFR50 Appendix I - Noble Gas Limits

Radiological Effluent Controls (Sections III, IV, and V) limit the off-site air dose from noble gases released in gaseous effluents to 5 mrad gamma and 10 mrad beta for a calendar quarter (10 and 20 mrad gamma and beta, respectively, per calendar year). Effluent dose calculations are calculated at least once every 31 days. In addition, installed portions of the gaseous radwaste treatment system are required to be operated to reduce radioactive materials in gaseous effluents when the projected doses over 31 days from the applicable waste stream exceed 0.02 mrad air gamma or 0.04 mrad air beta. (See Appendix A, Tables App.A-1 for a cross reference of effluent control requirements and applicable sections of the REMODOCM which are used to determine compliance.) This part of the REMODOCM provides the calculation methodology for determining air doses from noble gases.

a. Method 1 Air Dose\* (Applicable to Units 1, 2, and 3)

$$\text{For Unit 1: } D_{G1} = 3.3 \times 10^{-6} C_{N1V}^* \\ D_{B1} = 1.49 \times 10^{-3} C_{N1V}^*$$

$$\text{For Unit 2: } D_{G2} = 6.3 \times 10^{-4} C_{N2V} + 1.81 \times 10^{-4} C_{N2S}^* \\ D_{B2} = 1.7 \times 10^{-3} C_{N2V} + 1.81 \times 10^{-6} C_{N2S}^*$$

$$\text{For Unit 3: } D_{G3} = 6.3 \times 10^{-4} C_{N3V} + 1.81 \times 10^{-4} C_{N3S}^* \\ D_{B3} = 1.7 \times 10^{-3} C_{N3V} + 1.81 \times 10^{-6} C_{N3S}^*$$

If  $D_{G1}$ ,  $D_{G2}$ , or  $D_{G3}$  are greater than 1.6 mrad or  $D_{B1}$ ,  $D_{B2}$ , or  $D_{B3}$  are greater than 3.3 mrad within a calendar quarter, go to Method 2 below.

Where:

$D_{G1}$  = the gamma air dose from Unit 1 for the period of interest (mrad).

$D_{B1}$  = the beta air dose from Unit 1 for the period of interest (mrad).



$D_{G2}$  = the gamma air dose from Unit 2 for the period of interest (mrad).

$D_{B2}$  = the beta air dose from Unit 2 for the period of interest (mrad).

$D_{G3}$  = the gamma air dose from Unit 3 for the period of interest (mrad).

$D_{B3}$  = the beta air dose from Unit 3 for the period of interest (mrad).

$C_{N1V}$  = the total curies of noble gas released from Spent Fuel Pool Island Vent during the period of interest.

$C_{N2V}$  = the total curies of noble gas released from Unit 2 Vent during the period of interest. Include containment releases to Unit 2 Vent

$C_{N2S}$  = the total curies of noble gas released from Unit 2 to Millstone Stack during the period of interest.

$C_{N3V}$  = the total curies of noble gas released from Unit 3 vents during the period of interest. Include containment releases to Unit 3 Vent and ESF Building Vent.

$C_{N3S}$  = the total curies of noble gas released from Unit 3 to Millstone Stack during the period of interest.

\*See MP-22-REC-REF03, "REMODCM Technical Information Document," Section 4.2, for the derivation of air dose Method 1 factors.

b. Method 2 Air Dose (Applicable to Units 1, 2, and 3)

Use the GASPAR computer code, or a code which uses the methodology given in Regulatory Guide 1.109, to determine the critical site boundary air doses.

For the Special Location, enter the following worst case quarterly average meteorology based on the Unit 2 vent eight-year history for 1980 to 1987:

$$\chi/Q = 8.1 \times 10^{-6} \text{ sec/m}^3$$

$$D/Q = 1.5 \times 10^{-7} \text{ m}^{-2}$$

(See the MP-22-REC-REF03, (Att) "Determination of Maximum  $\chi/Q$  and  $D/Q$ .")

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

66 of 165

If the calculated air dose exceeds one half the quarterly Radiological Effluent Control limit, use meteorology concurrent with quarter of release.

c. Estimation of Annual Air Dose Limit Due to Noble Gases (Applicable to Units 1, 2, and 3)

An estimation of annual (year-to-date) beta and gamma air doses ( $D_{YB}$  and  $D_{YG}$ , respectively) from noble gases released from Units 1, 2 and 3 shall be made every month to determine compliance with the annual dose limits for each Unit. Annual air doses will be determined as follows:

<u>Unit 1</u>	<u>Unit 2</u>	<u>Unit 3</u>
$D_{YG1} = \sum D_{G1}$	$D_{YG2} = \sum D_{G2}$	$D_{YG3} = \sum D_{G3}$
$D_{YB1} = \sum D_{B1}$	$D_{YB2} = \sum D_{B2}$	$D_{YB3} = \sum D_{B3}$

Where the sums are over the first quarter (i.e., summation of the all release periods within the quarter) through the present calendar quarter doses.

Where:  $D_{YG1}$ ,  $D_{YG2}$ ,  $D_{YG3}$ ,  $D_{YB1}$ ,  $D_{YB2}$  and  $D_{YB3}$  = gamma air dose and beta air dose for the calendar year for Unit 1, 2, or 3.

The following shall be used as the quarterly doses:

- (1) If the detailed quarterly dose calculations required per Section II.D.5. for the Radioactive Effluent Release Report are complete for any calendar quarter, use those results.
- (2) If the detailed calculations are not complete for a particular quarter, use the results as determined above in Sections II.D.2.a. or II.D.2.b.

If  $D_{YG1}$ ,  $YG2$  or  $YG3$  are greater than 10 mrad or  $D_{YB1}$ ,  $YB2$  or  $YB3$  are greater than 20 mrad and any corresponding quarterly dose was not calculated using Method 2 (Section II.D.2.b.), recalculate the quarterly dose using meteorology concurrent with quarter of release.



3. 10 CFR50 Appendix I – Iodine, Tritium and Particulate Doses

Radiological Effluent Controls (Section III, IV, and V) limit the off-site dose to a critical organ from radioiodines, tritium, and particulates with half-lives greater than 8 days released in gaseous effluents to 7.5 mrem for a calendar quarter (15 mrem per calendar year). Effluent dose calculations are performed at least once every 31 days. In addition, installed portions of the gaseous radwaste treatment system are required to be operated to reduce radioactive materials in gaseous effluents when the projected doses over 31 days from the applicable waste stream exceed 0.03 mrem. (See Appendix A, Table App.A-1 for a cross reference of effluent control requirements and applicable sections of the REMODCM which are used to determine compliance.) This part of the REMODCM provides the calculation methodology for determining critical organ doses from atmospheric releases of iodines, tritium and particulates.

a. Critical Organ Doses (Applicable to Millstone Stack and Unit 1 releases)

1) Method 1 – Millstone Stack and Unit 1 Releases

Calculate organ doses for  $D_{TS}$  and  $D_{OS}$ :

$$\begin{aligned} \text{For Unit 2 or 3: } D_{TS} &= 30_{131}C_{IS} + 0.29_{133}C_{IS} + 4.66 \times 10^{-5} C_{HS} \\ D_{OS} &= 10.2C_{PS} + 4.66 \times 10^{-5} C_{HS} \end{aligned}$$

Sum critical organ doses from stack with critical organ doses from vent in Section II.D.3.b.1) below:

If either dose is greater than 2.5 mrem within a calendar quarter go to Method 2a below

$$\begin{aligned} \text{For Unit 1: } D_{TS} &= 1.97 \times 10^{-3} C_{HV} \\ D_{OS} &= 94.8[C_{PV} + C_{PB}] + 1.97 \times 10^{-3} C_{HV} \end{aligned}$$

If either dose is greater than 2.5 mrem within a calendar quarter go to Method 2a below

Where:

$D_{TS}$  = the thyroid dose for the period of release of gaseous effluents.

$D_{OS}$  = the dose to the maximum organ other than the thyroid for the period of gaseous effluent release.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

68 of 165

$^{131}C_{IS}$  = The total curies of I-131 released in gaseous effluents from Unit 2 or 3 to Millstone Stack during the period of interest.

$^{133}C_{IS}$  = The total curies of I-133 released in gaseous effluents from Unit 2 or 3 to Millstone Stack during the period of interest.

$C_{PS}$  = the total curies of particulates with half-lives greater than 8 days released in gaseous effluents from Millstone Stack during the period of interest.

$C_{PV}$  = the total curies of particulates with half-lives greater than 8 days released in gaseous effluents from the SFPI vent during the period of interest.

$C_{PB}$  = the total curies of particulates with half-lives greater than 8 days released in gaseous effluents from the BOP vent during the period of interest.

$C_{HS}$  = the total curies of tritium released in gaseous effluents from Millstone Stack during period of interest.

$C_{HV}$  = the total curies of tritium released in gaseous effluents from the SFPI and BOP vents during period of interest.

2) Method 2 – Millstone Stack and Unit 1 Releases

Use the GASPARE code, or a code which uses the methodology given in Regulatory Guide 1.109, with actual locations, real-time meteorology and the pathways which actually exist at the time at those locations:

Sum critical organ doses from stack with critical organ doses from vent in Section II.D.3.b. below.

b. Critical Organ Doses (Applicable to Units 2 and 3 vent releases)

1) Method 1 – Unit 2 and Unit 3 releases

For Unit 2 and Unit 3, separately, calculate organ doses  $D_T$  and  $D_O$ :

$$D_{TV} = 230 \ ^{131}C_{IV} + 4.0 \ ^{133}C_{IV} + 2.6 \times 10^{-3} \ C_{HV}$$

$$D_{OV} = 1.1 \times 10^3 \ C_{PV} + 2.6 \times 10^{-3} \ C_{HV}$$

Sum with organ doses for releases from the stack from Section II.D.3.a.1):

$$D_T = D_{TS} + D_{TV}$$

$$D_O = D_{OS} + D_{OV}$$



MP-22-REC-BAP01

Rev. 026-00

69 of 165

If either dose is greater than 2.5 mrem within a calendar quarter go to Section II.D.3.a. and recalculate any organ dose greater than 2.5 mrem for releases from the stack and go to Section II.D.3.b. below and recalculate any organ dose greater than 2.5 mrem for releases from the vent, where:

$D_T$  = the total thyroid dose for the period of gaseous effluents releases.

$D_O$  = the total dose to the maximum organ other than the thyroid for the period of gaseous effluent releases.

$D_{TV}$  = the thyroid dose for the period of gaseous effluents releases from the vent.

$D_{OV}$  = the dose to the maximum organ other than the thyroid for the period of gaseous effluent releases from the vent.

$^{131}C_{IV}$  = The total curies of I-131 in gaseous effluents from Unit 2 other than to the Millstone Stack (Unit 2 Vent, containment releases to vent, and Steam Generator Blowdown Tank Vent) or from Unit 3 other than to the Millstone Stack (Unit 3 Vent, ESF Building Vent, containment releases to vent, Steam Generator Blowdown Tank Vent, and Containment Drawdown using mechanical vacuum) during the period of interest.

$^{133}C_{IV}$  = The total curies of I-133 in gaseous effluents from Unit 2 other than to the Millstone Stack (Unit 2 Vent, containment releases to vent, and Steam Generator Blowdown Tank Vent) or from Unit 3 other than to the Millstone Stack (Unit 3 Vent, ESF Building Vent, containment releases to vent, Steam Generator Blowdown Tank Vent, and Containment Drawdown using mechanical vacuum) during the period of interest.

$C_{PS}$  = The total curies of particulates with half-lives greater than eight days released in gaseous effluents from Unit 2 other than to the Millstone Stack (Unit 2 Vent and containment releases to vent) or from Unit 3 other than to the Millstone Stack (Unit 3 Vent, ESF Building Vent, containment releases to vent, and Containment Drawdown using mechanical vacuum) during the period of interest.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

70 of 165

$C_{HV}$  = The total curies of tritium released in gaseous effluents from Unit 2 other than to the Millstone Stack (Unit 2 Vent, Steam Generator Blowdown Tank Vent and containment releases to vent) or from Unit 3 other than to the Millstone Stack (Unit 3 Vent, ESF Building Vent, Steam Generator Blowdown Tank Vent containment releases to vent, and Containment Drawdown using mechanical vacuum) during the period of interest.

2) Method 2 – Unit 2 and Unit 3 releases

Use the GASPAR code, or a code which uses the methodology given in Regulatory Guide 1.109, with the actual locations, real-time meteorology and the pathways which actually exist at the time at these locations. For Unit 2, the code shall be run separately for steam generator blowdown tank vents and ventilation releases, containment purges and waste gas tank releases. For Unit 3, the code shall be run separately for ventilation, process gas, containment vacuum system, ESF ventilation and containment purges.



MP-22-REC-BAP01

Rev. 026-00

71 of 165

c. Estimation of Annual Critical Organ Doses Due to Iodines, Tritium and Particulates (Applicable to Units 1, 2, and 3)

An estimation of annual (year-to-date) critical organ doses ( $D_{YT}$  and  $D_{YO}$  for thyroid and maximum organ other than thyroid, respectively) from radioiodine, tritium and particulates with half-lives greater than 8 days released from Units 1, 2 and 3 shall be made every month to determine compliance with the annual dose limits for each Unit. Annual critical organ doses will be determined as follows:

<u>Unit 1</u>	<u>Unit 2</u>	<u>Unit 3</u>
$D_{YT1} = \sum D_{T1}$	$D_{YT2} = \sum D_{T2}$	$D_{YT3} = \sum D_{T3}$
$D_{YO1} = \sum D_{O1}$	$D_{YO2} = \sum D_{O2}$	$D_{YO3} = \sum D_{O3}$

Where the sums are over the first quarter (i.e., summation of the all release periods within the quarter) through the present calendar quarter doses.

Where:

$D_{YT1}$ ,  $D_{YT2}$ ,  $D_{YT3}$ ,  $D_{YO1}$ ,  $D_{YO2}$  and  $D_{YO3}$  = thyroid (T) dose and maximum organ (O) dose (other than the thyroid) for the calendar year for Unit 1, 2, or 3.

The following guidelines shall be used for  $D_T$  and  $D_O$ :

- (1) If the detailed quarterly dose calculations required per Section II.D.5. for the Radioactive Effluent Release Report are complete for any calendar quarter, use those results.
- (2) If the detailed calculations are not complete for a particular quarter, use the results as determined above in Section II.D.3.a. or II.D.3.b.
- (3) If  $D_{YT}$  and/or  $D_{YO}$  are greater than 15 mrem and quarterly dose was not calculated using Method 2 of Section II.D.3.a. or II.D.3.b., recalculate the quarterly dose using Method 2.
- (4) If different organs are the maximum organ for different quarters, they can be summed together and  $D_{YO}$  recorded as a less-than value as long as the value is less than 15 mrem. If it is not, the sum for each organ involved shall be determined.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

72 of 165

#### 4. Gaseous Effluent Monthly Dose Projections

Section I.D.2.a. of the REMM requires that certain portions of the gaseous radwaste treatment equipment be returned to service to reduce radioactive gaseous effluents when the projected doses for each Unit (made at least once per 31 days) exceed 0.02 mrad gamma air, 0.04 mrad beta air, or 0.03 mrem to any organ from gaseous effluents. The following methods are applied in the estimation of monthly dose projections.

##### a. Unit 1 Projection Method

None required.

##### b. Unit 2 Projection Method

###### 1) Due to Gaseous Radwaste Treatment System (Unit 2)

Determine the beta and gamma monthly air dose projection from noble gases from the following:

$$D_{MG}^E \text{ (mrad)} = 1.81 \times 10^{-4} C_N^E$$

$$D_{MB}^E \text{ (mrad)} = 1.81 \times 10^{-6} C_N^E$$

Where:

$C_N^E$  = the number of curies of noble gas estimated to be released from the waste gas storage tanks during the next month.

$D_{MG}^E$  = the estimated monthly gamma air dose.

$D_{MB}^E$  = the estimated monthly beta air dose.

(The dose conversion factor is from MP-22-REC-REF03, "REMODOCM Technical Information Document," Section 4.2, for the Millstone Stack releases since the Unit 2 waste gas tanks are discharged via the Millstone Stack. This factor is conservative because the isotopic mix assumed for the dose conversion factor consists of shorter-lived noble gases which have higher dose conversion factors than the typical mix from Unit 2 waste gas tank discharges.)

###### 2) (Reserved)

###### 3) Due to Ventilation Releases (Unit 2)



If portions of the ventilation treatment system are expected to be out of service during the month, determine the monthly maximum organ dose projection ( $D_{MO}^E$ ) from the following:

i. Method 1

Determine  $D_{MO}^E$  which is the estimated monthly dose to the maximum organ from the following:

$$D_{MO}^E = 1/3 R_1 (1.01 - R_2) (R_3 + 0.01) D_O$$

For the last quarter of operation, determine  $D_O$  as determined per Section II.D.3.b.

$R_1$  = the expected reduction factor for the HEPA filter. Typically this should be 100 (see NUREG-0016 or 0017 for additional guidance).

$R_2$  = the fraction of the time which the equipment was inoperable during the last quarter.

$R_3$  = the fraction of the time which the equipment is expected to be inoperable during the next month.

ii. Method 2

If necessary, estimate the curies expected to be released for the next month and applicable method for dose calculation from Section II.D.3.b.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

74 of 165

c. Unit 3 Projection Method

1) Due to Radioactive Gaseous Waste System (Unit 3)

Determine the beta and gamma monthly air dose projection from noble gases from the following:

$$D_{MG}^E \text{ (mrad)} = 1.81 \times 10^{-4} C_N^E$$

$$D_{MB}^E \text{ (mrad)} = 1.81 \times 10^{-6} C_N^E$$

Where:

$C_N^E$  = the number of curies of noble gas estimated to be released from the reactor plant gaseous vents to the Millstone stack (the activity from this pathway increases when the process waste gas system is out of service.) during the next month.

$D_{MG}^E$  = the estimated monthly gamma air dose.

$D_{MB}^E$  = the estimated monthly beta air dose.

(The dose conversion factor is from the MP-22-REC-REF03, "REMODCM Technical Information Document," for the Millstone Stack releases since the Unit 3 reactor plant gaseous vents are discharged via the Millstone Stack.)

5. Quarterly Dose Calculations for Radioactive Effluent Release Report

Detailed quarterly gaseous dose calculations required for the Radioactive Effluent Release Report shall be done using the computer code GASPAR, or a code which use the methodology given in Regulatory Guide 1.109. The use of LADTAP II code and the input parameters are given in MP-22-REC-GDL04, "Gaseous Dose Calculations - GASPARII." Use of a code using the methodology given in Regulatory Guide 1.109 is described in MP-22-REC-GDL05, "Gaseous Dose Calculations - DOSAIR."



6. Compliance with 40CFR190

The following sources shall be considered in determining the total dose to a real individual from uranium fuel cycle sources:

- a. Gaseous Releases from Units 1, 2, and 3.
- b. Liquid Releases from Units 1, 2, and 3.
- c. Direct and Scattered Radiation from Radioactive Material on Site.
- d. Since all other uranium fuel cycle sources are greater than 5 miles away, they need not be considered.

The Radiological Effluent Controls in Sections III.E. (Unit 1), IV.E. (Unit 2), and V.E. (Unit 3) contain specific requirements for ensuring compliance with 40CFR190 based on gaseous and liquid doses (sources a and b).

Doses to source c are controlled by design and operations to ensure the off-site dose from each radwaste storage facility is less than one mrem per year. Potential doses from each facility are evaluated in Radiological Environmental Reviews (RERs) where total off-site doses from all sources are considered to ensure compliance with 40CFR190.

7. Bases for Gaseous Pathway Dose Calculations

The dose calculation methodology and parameters used in Section II of the REMODCM implement the requirements in Section III.A. of Appendix I (10CFR50) which states that conformance with the ALARA dose objectives of Appendix I be shown by calculational procedures based on models and data, such that the actual exposure of a member of the public through appropriate pathways is unlikely to be substantially underestimated. Operational flexibility is provided by controlling the instantaneous release rate of noble gas (as well as iodines and particulate activity) such the maximum off-site dose rates are less than the equivalent of 500 mrem/year to the whole body, 3000 mrem/year to the skin from noble gases, or 1500 mrem/year to a critical organ from the inhalation of iodines, tritium and particulates. The dose rate limits are based on the 10CFR20 annual dose limits, but applied as an instantaneous limit to assure that the actual dose over a year will be well below these numbers.

The equivalent instantaneous release rate limits for Millstone Stack were determined using the EPA AIREM code. For Units 2 & 3, these doses were calculated using the NRC GASPAR code. The AIREM code calculates cloud gamma doses using dose tables from a model that considers the finite extent of the cloud in the vertical direction. Beta doses are calculated assuming semi-infinite cloud concentrations, which are based upon a

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

76 of 165

standard sector averaged diffusion equation. The GASPAR code implements the models of NRC Regulatory Guide 1.109, Rev. 1, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10CFR Part 50, Appendix I." Input parameter values typically used in the dose models are listed in MP-22-REC-REF03, "REMOTCM Technical Information Document." This same methodology is used in the determination of compliance with the 40CFR190 total dose standard for the gaseous pathways.

In the determination of compliance with the dose and dose rate limits, maximum individual dose calculations are performed at the nearest land site boundary with maximum decayed X/Q, and at the nearest vegetable garden (assumed to be nearest residence) and cow and goat farms with maximum D/Qs. The conversion constants in the Method 1 equations for maximum air doses, organ and whole body doses, and dose rates are based on the maximum observed comparison of historical effluent releases and corresponding calculated maximum doses. The dose conversion factors are calculated based on the ratio of the observed highest dose and the curies of fission and activation products released during the period. This ratio results in the Method 1 equation conversion factor in mrem/Ci released.

MP-22-REC-REF02 describes the derivation of the Method 1 constants and list the historical maximum doses calculated for the maximum organ.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01  
Rev. 026-00

77 of 165

## **II.E. Liquid Discharge Flow Rates And Monitor Setpoints**

### **1. Unit 1 Reactor Cavity Water Discharge Line**

The limit on discharge flow rate and setpoint on the Unit 1 liquid waste monitor depend on dilution water flow, radwaste discharge flow, the isotopic composition of the liquid, the background count rate of the monitor and the efficiency of the monitor. Due to the variability of these parameters, the alert and alarm setpoints will be determined prior to the release of each batch. The following method will be used:

#### **STEP 1:**

From the isotopic analysis and the Effluent Concentration (EC) values for each identified nuclide determine the required reduction factor, i.e.:

$$R = \text{Required Reduction Factor} = \frac{1}{\sum \frac{\mu\text{Ci}}{\text{ml}} \text{ of nuclide } i}{10 \times \text{EC of nuclide } i}$$

#### **STEP 2:**

Determine the allowable discharge flow (F)

$$F = 0.1 \times R \times D$$

Where:

D = The existing dilution flow which is the any dilution flow from Millstone Unit 2 and/or Unit 3 not being credited for any other radioactivity discharge during discharge of Unit 1 water.

0.1 = safety factor to limit discharge concentration to 10% of the Radiological Effluent Control Limit.

#### **STEP 3:**

Calculate the monitor setpoint as follows:

$$R_{\text{set}} = 2 \times \text{AC} \times \text{RCF}$$

Where:

Rset = The setpoint of the monitor.

AC = The total radwaste effluent concentration ( $\mu\text{Ci/ml}$ ) in the tank.

STOP

THINK

ACT

REVIEW

MP--22--REC--BAP01

Rev. 026--00

78 of 165

RCF = The response correction factor for the effluent line monitor using the current calibration factor or isotopic-specific responses.

2 = Tolerance limit which brings the setpoint at twice the expected response of the monitor based on sample analysis. With the safety factor of 0.1 the setpoint would be at 20% of the Radiological Effluent Control Limit.

Option setpoint:

A setpoint based upon worst case conditions may be used. Assume the maximum possible discharge flow, a minimum dilution flow not to exceed 100,000 gpm, and a limit of  $1 \times 10^{-7}$   $\mu\text{Ci/ml}$  which is lower than any 10CFR20 EC limit except for transuranics. This will assure that low level releases are not terminated due to small fluctuations in activity. When using this option setpoint independent verification of discharge lineup shall be performed. The optional setpoint may be adjusted (increased or decreased) by factors to account for the actual discharge flow and actual dilution flow; however, controls shall be established to ensure that the allowable discharge flow is not exceeded and the dilution flow is maintained.

2. Reserved
3. Unit 2 Clean Liquid Radwaste Effluent Line – RM9049 and Aerated Liquid Radwaste Effluent Line – RM9116

The setpoint on the Unit 2 clean and aerated liquid waste effluent lines depend on dilution water flow, radwaste discharge flow, the isotopic composition of the liquid, the background count rate of the monitor and the efficiency of the monitor. Due to the variability of these parameters, an alarm/trip setpoint will be determined prior to the release of each batch. The following method will be used:

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

79 of 165

STEP 1:

From the tank isotopic analysis and the Effluent Concentrations (EC) in 10CFR20, App. B, Table 2, Col. 2 for each identified nuclide determine the required reduction factor, i.e.:

For Nuclides Other Than Noble Gases:

$$R_1 = \text{Required Reduction Factor} = \frac{1}{\sum \frac{\frac{\mu\text{Ci}}{\text{ml}} \text{ of nuclide } i}{10 \times \text{EC of nuclide } i}}$$

For Noble Gases: If the noble gas concentration is less than  $0.011 \mu\text{Ci/ml}$ , the reduction factor need not be determined

$$R_2 = \text{Required Reduction Factor} = \frac{1}{\sum \frac{\frac{\mu\text{Ci}}{\text{ml}} \text{ of noble gases}}{2 \times 10^{-4} \frac{\mu\text{Ci}}{\text{ml}}}} = \frac{2 \times 10^{-4} \frac{\mu\text{Ci}}{\text{ml}}}{\sum \frac{\mu\text{Ci}}{\text{ml}} \text{ noble gases}}$$

R = the smaller of  $R_1$  or  $R_2$

STEP 2:

Determine the allowable discharge flow (F) in gpm:

$$F = 0.1 \times R \times D$$

Where:

D = the existing dilution flow (D)

Note: D = # circulating water pumps x 100,000 gpm + # service water pumps x 4,000 gpm)

**NOTE**

Note that discharging at this flow rate would yield a discharge concentration corresponding to 10% of the Radiological Effluent Control Limit due to the safety factor of 0.1.

With this condition on discharge flow rate met, the monitor setpoint can be calculated:

$$R_{\text{set}} = 2 \times \text{AC} \times \text{RF} \text{ (See Note 1 below.)}$$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

80 of 165

Where:

$R_{set}$  = the setpoint of the monitor (cpm).

AC = the total radwaste effluent concentration ( $\mu\text{Ci/ml}$ ) in the tank.

RF = the response factor for the effluent line monitor using the current calibration factor or isotopic-specific responses.

2 = the multiple of expected count rate on the monitor based on the radioactivity concentration in the tank.

This value or that corresponding to  $2.8 \times 10^{-5} \mu\text{Ci/ml}$  (Note 2 below), whichever is greater, plus background is the trip setpoint. For the latter setpoint, independent valve verification shall be performed and minimum dilution flow in Note 2 shall be verified and if necessary, appropriately adjusted.

Note 1: If discharging at the allowable discharge rate (F) as determined in above, this setpoint would correspond to 20% of the Radiological Effluent Control limit.

Note 2: This value is based upon worst case conditions, assuming maximum discharge flow (350 gpm), dilution water flow of 100,000 gpm and a limit of  $1 \times 10^{-7}$  which is lower than any Technical Specification limit (ten times 10CFR20 EC values) except for transuranics. This will assure that low level releases are not terminated due to small fluctuations in activity. However, to verify that the correct tank is being discharged when using this value, independent valve verification shall be performed. This value may be adjusted (increased or decreased) by factors to account for the actual discharge flow and actual dilution flow; however, controls shall be established to ensure that the allowable discharge flow is not exceeded and the dilution flow is maintained.

4. Condensate Polishing Facility Waste Neutralization Sump Effluent Line - CND245

When the grab sample prior to release required by Table I.C.-2 is greater than  $5 \times 10^{-7} \mu\text{Ci/ml}$ , the setpoint shall be determined as for the Clean and Aerated Liquid Monitors in Section II.E.3. except the CPF monitor has the capability to readout in CPM or  $\mu\text{Ci/ml}$ . If the grab sample is less than  $5 \times 10^{-7} \mu\text{Ci/ml}$ , use a setpoint of the lower of ten times background or the value as specified in II.E.3. A setpoint based on ten times background shall not exceed a reading corresponding to  $1.7 \times 10^{-4} \mu\text{Ci/ml}$ , which is approximately 38,000 CPM based on recent calibration data.



5. Unit 2 Steam Generator Blowdown – RM4262 and Unit 2 Steam Generator Blowdown Effluent Concentration Limitation

5a. Unit 2 Steam Generator Blowdown – RM4262

Assumptions used in determining the Alarm setpoint for this monitor are:

- a. Total S.G. blowdown flow rate = 700 gpm.
- b. Normal minimum possible circulating water dilution flow during periods of blowdown = 200,000 gpm (2 circulating water pumps) = 200,000 gpm.
- c. The release rate limit is conservatively set at  $3 \times 10^{-8}$   $\mu\text{Ci/ml}$  which is lower than any 10CFR20 Effluent Concentration (EC) limit except for some transuranics \*
- d. Background can be added after above calculations are performed.

Therefore, the alarm setpoint corresponds to a concentration of:

$$\text{Alarm } (\mu\text{Ci/ml}) = \frac{200,000}{700} \times 3 \times 10^{-8} + \text{background}^{**} = 8.5 \times 10^{-6} \mu\text{Ci/ml} + \text{background}$$

The latest monitor calibration curve shall be used to determine the alarm setpoint in cpm corresponding to  $8.5 \times 10^{-6}$   $\mu\text{Ci/ml}$ .

This setpoint may be adjusted (increased or decreased) through proper administrative controls if the steam generator blowdown rate is maintained other than 700 gpm and/or other than 2 circulating water pumps are available. The adjustment would correspond to the ratio of flows to those assumed above or:

$$\text{Alarm } (\mu\text{Ci/ml}) = 8.5 \times 10^{-6} \mu\text{Ci/ml} \times \frac{\text{circulating \& service water flow (gpm)}}{200,000} \times \frac{700}{S/G_{\text{blowdown}} \text{ (gpm)}} +$$

$$\text{Background} = 3 \times 10^{-8} \mu\text{Ci/ml} \times \frac{\text{circulating \& service water flow (gpm)}}{\text{total S/G blowdown (gpm)}} + \text{Background}$$

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

82 of 165

### NOTE

The Steam Generator Blowdown alarm criteria is in practice based on setpoints required to detect allowable levels of primary to secondary leakage. This alarm criteria is typically more restrictive than that required to meet discharge limits. This fact shall be verified, however, whenever the alarm setpoint is recalculated.

\*In lieu of using  $3 \times 10^{-8} \mu\text{Ci/ml}$ , the identified EC limits from 10CFR20 may be used.

\*\*Background of monitor at monitor location (i.e., indication provided by system monitor with no activity present in the monitored system).

#### 5b. Unit 2 Steam Generator Blowdown Effluent Concentration Limitation

The results of analysis of blowdown samples required by Table I.C.-2 of Section I of the REMODCM shall be used to ensure that blowdown effluent releases do not exceed ten times the concentration limits in 10CFR20, Appendix B.

#### 6. Unit 2 Condenser Air Ejector – RM5099

N/A since this monitor is no longer a final liquid effluent monitor.

#### 7. Unit 2 Reactor Building Closed Cooling Water RM6038 and Unit 2 Service Water, and RBCCW Sump and Turbine Building Sump Effluent Concentration Limitation

##### 7a. Unit 2 Reactor Building Closed Cooling Water RM6038

The purpose of the Reactor Building Closed Cooling Water (RBCCW) radiation monitor is to give warning of abnormal radioactivity in the RBCCW system and to prevent releases to the Service Water system which, upon release to the environment, would exceed ten times the concentration values in 10CFR20. According to Calculation RERM-02665-R2, radioactivity in RBCCW water which causes a monitor response of greater than the setpoint prescribed below could exceed ten times the 10CFR20 concentrations upon release to the Service Water system.

#### SETPOINT DURING POWER OPERATIONS:

To give adequate warning of abnormal radioactivity, the setpoint shall be two times the radiation monitor background reading, provided that the



MP-22-REC-BAP01

Rev. 026-00

83 of 165

background reading does not exceed 2,000 cpm. The monitor background reading shall be the normal monitor reading. If the monitor background reading exceeds 2,000 cpm, the setpoint shall be set at the background reading plus 2,000 cpm and provisions shall be made to adjust the setpoint if the background decreases.

#### SETPOINT DURING SHUTDOWN:

- 1) During outages not exceeding three months the setpoint shall be two times the radiation monitor background reading, provided that the background reading does not exceed 415 cpm. If the monitor background reading exceeds 415 cpm, the setpoint shall be set at the background reading plus 415 cpm and provisions shall be made to adjust the setpoint if the background decreases.
- 2) During extended outages exceeding three months, but not exceeding three years, the setpoint shall be two times the radiation monitor background reading, provided that the background reading does not exceed 80 cpm. If the monitor background reading exceeds 80 cpm, the setpoint shall be set at the background reading plus 80 cpm and provisions shall be made to adjust the setpoint if the background decreases.

#### PROVISIONS FOR ALTERNATE DILUTION FLOWS:

These setpoints are based on a dilution flow of 4,000 gpm from one service water train. If additional dilution flow is credited, the setpoint may be adjusted proportionately. For example, the addition of a circulating water pump dilution flow of 100,000 gpm would allow the setpoint to be increased by a factor of 25.

#### 7b. Unit 2 Service Water, and RBCCW Sump and Turbine Building Sump Effluent Concentration Limitation

Results of analyses of service water, RBCCW sump and turbine building sump samples taken in accordance with Table I.C. - 2 of Section I of the REMODCM shall be used to limit radioactivity concentrations in the service water, RBCCW sump and turbine building sump effluents to less than ten times the limits in 10CFR20, Appendix B.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

84 of 165

8. Unit 3 Liquid Waste Monitor – LWS–RE70

The setpoints on the Unit 3 liquid waste monitor depend on dilution water flow, radwaste discharge flow, the isotopic composition of the liquid, the background count rate of the monitor and the efficiency of the monitor. Due to the variability of these parameters, the alert and alarm setpoints will be determined prior to the release of each batch. The following method will be used:

Step 1:

From the tank isotopic analysis and the Effluent Concentration (EC) values for each identified nuclide determine the required reduction factor, i.e.:

For Nuclides Other Than Noble Gases:

$$R_1 = \text{Required Reduction Factor} = \frac{1}{\sum \frac{\frac{\mu\text{Ci}}{\text{ml}} \text{ of nuclide } i}{10 \times \text{EC of nuclide } i}}$$

For Noble Gases: If the noble gas concentration is less than 0.026  $\mu\text{Ci}/\text{ml}$ , the reduction factor need not be determined

$$R_2 = \text{Required Reduction Factor} = \frac{1}{\sum \frac{\frac{\mu\text{Ci}}{\text{ml}} \text{ of noble gases}}{2 \times 10^{-4} \frac{\mu\text{Ci}}{\text{ml}}}} = \frac{2 \times 10^{-4} \frac{\mu\text{Ci}}{\text{ml}}}{\sum \frac{\mu\text{Ci}}{\text{ml}} \text{ noble gases}}$$

R = the smaller of R1 or R2

Step 2:

Determine the allowable discharge flow (F)

$$F = 0.1 \times R \times D$$

Where:

D = The existing dilution flow (D):

Note: D = # circulating water pumps x 100,000 gpm + # service water pumps x 15,000 gpm



### NOTE

Note that discharging at this flow rate would yield a discharge concentration corresponding to 10% of the Radiological Effluent Control Limit due to the safety factor of 0.1.

With this condition on discharge flow rate met, the monitor setpoint can be calculated:

$$R_{set} = 2 \times AC \times RCF \text{ (see Note 1)}$$

Where:

$R_{set}$  = The setpoint of the monitor.

$AC$  = The total radwaste effluent concentration ( $\mu\text{Ci/ml}$ ) in the tank.

$RCF$  = The response correction factor for the effluent line monitor using the current calibration factor or isotopic-specific responses.

2 = The multiple of expected count rate on the monitor based on the radioactivity concentration in the tank.

This value, or that corresponding to  $6.6 \times 10^{-5} \mu\text{Ci/ml}$  (Note 2 below), whichever is greater, plus background is the trip setpoint. For the latter setpoint, independent valve verification shall be performed and minimum dilution flow in Note 2 shall be verified and if necessary, appropriately adjusted.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

86 of 165

## NOTE

1. If discharging at the allowable discharge rate (F) as determined above, this Alarm setpoint would yield a discharge concentration corresponding to 20% of the Radiological Effluent Control limit.
2. This value is based upon worst case conditions, assuming maximum discharge flow (150 gpm), dilution water flow of 100,000 gpm, and a limit of  $1 \times 10^{-7}$   $\mu\text{Ci/ml}$  which is lower than any Technical Specification limit (ten times 10CFR20 EC values) except for transuranics. This will assure that low level releases are not terminated due to small fluctuations in activity. However, to verify that the correct tank is being discharged when using this value, independent valve verification shall be performed. This value may be adjusted (increased or decreased) by factors to account for the actual discharge flow and actual dilution flow; however, controls shall be established to ensure that the allowable discharge flow is not exceeded and the dilution flow is maintained

### 9. Unit 3 Regenerant Evaporator Effluent Line – LWC–RE65

The MP3 Regenerant Evaporator has been removed from service with DCR M3–97–041. Therefore a radiation monitor alarm is not needed.

### 10. Unit 3 Waste Neutralization Sump Effluent Line – CND–RE07

Same as Section II.E.8.

### 11. Unit 3 Steam Generator Blowdown – SSR–RE08 and Unit 3 Steam Generator Blowdown Effluent Concentration Limitation

#### 11a. Unit 3 Steam Generator Blowdown – SSR–RE08

The alarm setpoint for this monitor assumes:

- a. Steam generator blowdown rate of 400 gpm (maximum blowdown total including weekly cleaning of generators – per ERC 25212–ER–99–0133).
- b. The release rate limit is conservatively set at  $3 \times 10^{-8}$   $\mu\text{Ci/ml}$  which is well below any 10CFR20 Effluent Concentration except for transuranics\*.
- c. Minimum possible circulating and service water dilution flow during periods of blowdown = 200,000 gpm (2 circulating water pumps) + 30,000 gpm (2 service water pumps) = 230,000 gpm.



MP–22–REC–BAP01

Rev. 026–00

87 of 165

d. Background can be added after above calculations are performed.

Therefore, the alarm setpoint corresponds to a concentration of:

$$\text{Alarm } (\mu\text{Ci/ml}) = \frac{230,000}{400} \times 3 \times 10^{-8} + \text{background} = 1.7 \times 10^{-5} \mu\text{Ci/ml} + \text{background}$$

This setpoint may be increased through proper administrative controls if the steam generator blowdown rate is maintained less than 400 gpm and/or more than 2 circulating and 2 service water pumps are available. The amount of the increase would correspond to the ratio of flows to those assumed above or:

$$\text{Alarm } (\mu\text{Ci/ml}) = 1.7 \times 10^{-5} \mu\text{Ci/ml} \times \frac{\text{circulating \& service water flow (gpm)}}{230,000} \times \frac{400}{\text{S/G blowdown (gpm)}}$$

$$\text{Background} = 3 \times 10^{-8} \mu\text{Ci/ml} \times \frac{\text{circulating \& service water flow (gpm)}}{\text{total S/G blowdown (gpm)}} + \text{Background}$$

#### NOTE

The Steam Generator Blowdown alarm criteria is in practice based on setpoints required to detect allowable levels of primary to secondary leakage. This alarm criteria is typically more restrictive than that required to meet discharge limits. This fact shall be verified, however, whenever the alarm setpoint is recalculated.

\* In lieu of using  $3 \times 10^{-8} \mu\text{Ci/ml}$ , ten times the identified 10CFR20 EC values may be used.

#### 11b. Unit 3 Steam Generator Blowdown Effluent Concentration Limitation

The results of analysis of blowdown samples required by Table I.C.-3 of Section I of the REMODCM shall be used to ensure that blowdown effluent releases do not exceed ten times the concentration limits in 10CFR20, Appendix B.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

88 of 165

12. Unit 3 Turbine Building Floor Drains Effluent Line – DAS–RE50 and Unit 3 Service Water and Turbine Building Sump Effluent Concentration Limitation

12a. Unit 3 Turbine Building Floor Drains Effluent Line – DAS–RE50

The alarm setpoint for this monitor shall be set to four times (4X) the reading of the monitor when there is no gamma radioactivity present in the turbine building sumps. As determined in Calculation RERM–04101R3, the setpoint shall not exceed  $1.4 \times 10^{-5}$   $\mu\text{Ci/ml}$ .

12b. Unit 3 Service Water and Turbine Building Sump Effluent Concentration Limitation

Results of analyses of service water and turbine building sump samples taken in accordance with Table I.C.–3 of Section I of the REMODCM shall be used to limit radioactivity concentrations in the service water and turbine building sump effluents to less than ten times the limits in 10CFR20, Appendix B.

13. Bases for Liquid Monitor Setpoints

Liquid effluent monitors are provided on discharge pathways to control, as applicable, the release of radioactive materials in liquid effluents during actual or potential releases of liquid waste to the environment. The alarm / trip setpoints are calculated to ensure that the alarm / trip function of the monitor will occur prior to exceeding ten times the Effluent Concentration (EC) limits of 10 CFR 20 (Appendix B, Table 2, Column 2), which applies to the release of radioactive materials from all units on the site. This limitation also provides additional assurance that the levels of radioactive materials in bodies of water in Unrestricted Areas will result in exposures within the Section II.A. design objectives of Appendix I to 10CFR50 to a member of the public.

In application, the typical approach is to determine the expected concentration in a radioactive release path and set the allowable discharge rate past the monitor such the existing dilution flow will limit the effluent release concentration to 10% of the limit for the mix. The setpoint is then selected to be only 2 times the expected concentration, or 20% of the limit. As a result, considerable margin is included in the selection of the setpoint for the monitor to account for unexpected changes in the discharge concentration or the contribution from other potential release pathways occurring at the same time as the planned effluent release. For those monitors on systems that are not expected to be contaminated, the alarm point is usually selected to be two times the ambient background to give notice that normal conditions may have changed and should be evaluated.



## II.F. Gaseous Monitor Setpoints

### 1. Unit 1 Spent Fuel Pool Island Monitor – RM-SFPI-02

The instantaneous release rate limit from the site shall be set in accordance with the conditions given in Section II.D.1.a. in order to satisfy Radiological Effluent Controls III.C.2. and III.D.2.a.

The alarm setpoint shall be set at or below the monitor reading in  $\mu\text{Ci}/\text{cc}$  corresponding to 29,000  $\mu\text{Ci}/\text{sec}$  assuming a maximum ventilation flow of 36,000 cfm. The corresponding monitor reading is  $1.71\text{E}-3$   $\mu\text{Ci}/\text{cc}$ . NOTE: This setpoint is the basis for emergency classification in Unit 1 EAL Table (OA-1). A change to this setpoint would require a concurrent change to the EAL.

The release rate value of 29,000  $\mu\text{Ci}/\text{sec}$  assumes that 7% of the site limit for skin dose of 3000 mrem per year is assigned to the Unit 1 Spent Fuel Pool Island vent. If effluent conditions from the Unit 1 Spent Fuel Pool Island vent reach 29,000  $\mu\text{Ci}/\text{sec}$ , releases from Units 2 and 3 vents and from the Millstone Stack shall be determined to ensure that the sum of the individual noble gas release rates do not cause the site skin dose limit to be exceeded. Use Section II.D.1.a. and Section 4.2 of MP-22-REC-REF03, "REMODOCM Technical Information Document," in making this determination.

### 2. Unit 2 Wide Range Gas Monitor (WRGM) – RM8169

The instantaneous release rate limit from the site shall be set in accordance with the conditions given in Section II.D.1.a. in order to satisfy Units 2 Radiological Effluent Controls IV.C.2. and IV.D.2.a.

The alarm setpoint shall be set at or below the monitor reading in  $\mu\text{Ci}/\text{cc}$  corresponding to 74,000  $\mu\text{Ci}/\text{sec}$  assuming a maximum ventilation flow of 12,000 cfm. The corresponding monitor reading is  $1.31\text{E}-2$   $\mu\text{Ci}/\text{cc}$ .

The release rate value of 74,000  $\mu\text{Ci}/\text{sec}$  assumes that 13% of the site limit is assigned to Unit 2 releases to the Millstone Stack. If effluent conditions from Unit 2 to the Millstone Stack reach 74,000  $\mu\text{Ci}/\text{sec}$ , releases from Units 1, 2 and 3 vents and from Unit 3 to the Millstone Stack shall be determined to ensure that the sum of the individual noble gas release rates do not exceed the site limit as dictated in Section II.D.1.a., and described in MP-22-REC-REF03, "REMODOCM Technical Information Document," Section 4.2.

### 3. Reserved

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

90 of 165

4. Unit 3 SLCRS – HVR – RE19B

The instantaneous release rate limit from the site shall be set in accordance with the conditions given in Section II.D.1.a. in order to satisfy Unit 3 Radiological Effluent Controls V.C.2. and V.D.2.a.

The alarm setpoint shall be set at or below the monitor reading in  $\mu\text{Ci}/\text{cc}$  corresponding to 74,000  $\mu\text{Ci}/\text{sec}$  assuming a maximum ventilation flow of 12,000 cfm. The corresponding monitor reading is  $1.16 \text{ E} - 2 \mu\text{Ci}/\text{cc}$  in accordance with Calculation RERM-01946R3, Rev.1.

If effluent conditions from Unit 3 to the Millstone Stack reach 74,000  $\mu\text{Ci}/\text{sec}$ , measures shall be taken to ensure that the sum of the individual noble gas release rates do not exceed the site limit as dictated in Section II.D.1.a., and described in MP-22-REC-REF03, "REMODOCM Technical Information Document," Section 4.2.

5. Unit 2 Vent – Noble Gas Monitor – RM8132B

The instantaneous release rate limit from the site shall be set in accordance with the conditions given in Section II.D.1.a. in order to satisfy Radiological Effluent Controls in Sections IV.C.2. and IV.D.2.a.

The alarm setpoint shall be set at or below the "cpm" corresponding to 95,000  $\mu\text{Ci}/\text{sec}$  from the MP2 vent noble gas monitor calibration curve. The calibration curve (given as  $\mu\text{Ci}/\text{sec}$  per cpm) is determined by assuming the maximum possible ventilation flow for various fan combinations. Curves for three different fan combinations are normally given. In calculation RERM-02906R2 a maximum allowable setpoint of 42,000 CPM is determined using vent flow of 100,000  $\text{ft}^3/\text{min}$ .

The release rate value of 95,000  $\mu\text{Ci}/\text{sec}$  assumes that 33% of the site limit is assigned to the MP2 vent. If effluent conditions from the MP2 vent reach the alarm setpoint, releases from Units 1 and 3 vents and from the Millstone Stack shall be determined to ensure that the sum of the individual noble gas release rates do not exceed the site limit as dictated in Section II.D.1.a., and described in MP-22-REC-REF03, "REMODOCM Technical Information Document," Section 4.2.

6. Unit 2 Waste Gas Decay Tank Monitor RM9095

Administratively all waste gas decay tank releases are via the Millstone Stack. Unit 2 has a release rate limit to the Millstone Stack of 74,000  $\mu\text{Ci}/\text{sec}$  (see the MP-22-REC-REF03, "REMODOCM Technical Information Document," Section 4.2 for bases).

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

91 of 165

Batch releases of waste gas shall be limited to less than 10% of the Unit 2 releases to the Millstone Stack release rate limits. Therefore, the waste gas decay tank monitor setpoint should be set not to exceed 7,400  $\mu\text{Ci}/\text{sec}$ .

The MP2 waste gas decay tank monitor (given  $\mu\text{Ci}/\text{cc}$  per cpm) calibration curve and the tank discharge rate is used to assure that the concentration of gaseous activity being released from a waste gas decay tank does not cause the setpoint of 7,400  $\mu\text{Ci}/\text{sec}$  to be exceeded.

7. Unit 3 Vent Noble Gas Monitor – HVR–RE10B

The instantaneous release rate limit from the site shall be set in accordance with the conditions given in Section II.D.1.a. in order to satisfy Radiological Effluent Controls in Sections V.C.2. and V.D.2.a.

The alarm setpoint shall be set at or below a value of  $8.4 \times 10^{-4}$   $\mu\text{Ci}/\text{cc}$  for the MP3 vent in accordance with Calculation RERM–01946R3, Rev.1.

If effluent conditions from the MP3 vent reach the alarm setpoint, releases from Units 1 and 2 vents and from the Millstone Stack shall be determined to ensure that the sum of the individual noble gas release rates do not exceed the site limit as dictated in Section II.D.1.a., and described in MP–22–REC–REF03, "REMODOCM Technical Information Document," Section 4.2.

8. Unit 3 Engineering Safeguards Building Monitor – HVQ–RE49

The Alarm setpoint shall be set at or below the value of  $5.9\text{E}-4$   $\mu\text{Ci}/\text{cc}$  in accordance with Calculation RERM–01946–R3, Rev. 1.

9. Bases for Gaseous Monitor Setpoints

Gaseous effluent monitors are provided on atmospheric release pathways to control, as applicable, the release of radioactive materials in gaseous effluents to the environment. The alarm / trip setpoints are calculated to ensure that the alarm / trip function of the monitor will occur prior to exceeding the dose rate limits required by the Technical Specifications (Units 2 and 3) or Radiological Effluent Controls (Sections III, IV, and V) requirements for each unit. Monitor setpoint selection is based on a conservative set of conditions for each release pathway (as discussed above for each monitor pathway) such that the dose rate at any time at and beyond the site boundary from all gaseous effluents from all units on the site will be within the numerical values of the annual dose limits of 10 CFR 20 in Unrestricted Areas. Since the Radiological Effluent Controls are constructed such that the numerical values of the annual dose limits of 10 CFR 20 be applied on an instantaneous basis (i.e., no time averaging over the year), and the integrated dose objectives of 10 CFR 50, Appendix I

STOP

THINK

ACT

REVIEW

MP–22–REC–BAP01

Rev. 026–00

92 of 165

provide for corrective actions to reduce effluents if the ALARA dose values are exceeded, assurance is obtained that compliance with the revised annual dose limits of 10 CFR 20.1301 (100 mrem total effective dose equivalent to a member of the public) will also be met. The use of the stated instantaneous release rate values, which equate to the site dose rate limits, also provides operational flexibility to accommodate short periods of higher than normal effluent releases that may occur during plant operations.

#### APPENDIX II.A REMODOCM METHODOLOGY CROSS-REFERENCES

Radiological effluent controls (Sections III, IV, and V) identify the requirements for monitoring and limiting liquid and gaseous effluents releases from the site such the resulting dose impacts to members of the public are kept to "As Low As Reasonably Achievable" (ALARA). The demonstration of compliance with the dose limits is by calculational models that are implemented by Section II of the REMODOCM.

Table App. II.A-1 provides a cross-reference guide between liquid and gaseous effluent release limits and those sections of the REMODOCM, which are used to determine compliance. It also shows the administrative Technical Specifications which reference the REMODOCM for operation of radioactive waste processing equipment. This table also provides a quick outline of the applicable limits or dose objectives and the required actions if those limits are exceeded. Details of the effluent control requirements and the implementing sections of the REMODOCM should be reviewed directly for a full explanation of the requirements.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

93 of 165

**Table II.A. - 1  
Millstone Effluent Requirements and Methodology Cross Reference**

Radiological Effluent Controls & Technical Specifications	REMOCM Methodology Section	Applicable Limit or Objective	Exposure Period	Required Action
IV/VE.1.a Liquid Effluent Concentration	Tables I.C.-2 and I.C.-3	Ten times 10CFR20App.B, Table 2, Column 2, & $2 \times 10^{-4}$ $\mu\text{Ci/mL}$ for dissolved noble gases*	Instantaneous	Restore concentration to within limits within 15 mins.
IV/VE.1.b Dose - Liquids	II.C.1. II.C.2.	$\leq 1.5$ mrem T.B. $\leq 5$ mrem Organ	Calendar Quarter**	30-day report if exceeded. Relative accuracy or conservatism of the calculations shall be confirmed by performance of the REMP in Section I.
	II.C.3. II.C.4.	$\leq 3$ mrem T.B. $\leq 10$ mrem Organ	Calendar Year	
T.S. 6.16 (Unit 2) T.S. 6.14 (Unit 3) Liquid Radwaste Treatment	I.C.2. II.C.5.	$\leq 0.06$ mrem T.B. $\leq 0.2$ mrem Organ	Projected for 31 days (if system not in use)	Return to operation Liquid Waste Treatment System
III.D.2.a IV/V.D.2.a Gaseous Effluents Dose Rate	Tables I.D.-1, I.D.-2, & I.D.-3	$\leq 500$ mrem/yr T.B. from noble gases*	Instantaneous	Restore release rates to within specifications within 15 minutes
	II.D.1.a.	$\leq 3000$ mrem/yr skin from noble gases*		
	II.D.1.b.	$\leq 1500$ mrem/yr organ from particulates with $T_{1/2} > 8d.$ , I-131, I-133 & tritium*		
III.D.2.b IV/V.D.2.b Dose Noble Gases	II.D.2.	$\leq 5$ mrad gamma air $\leq 10$ mrad beta air	Calendar Quarter**	30-day report if exceeded
		$\leq 10$ mrad gamma air $\leq 20$ mrad beta air	Calendar Year	
III.D.2.c IV/V.D.2.c Dose I-131, I-133, Particulates, H-3	II.D.3.	$\leq 7.5$ mrem organ	Calendar Quarter**	30-day report if exceeded. Relative accuracy or conservatism of the calculations shall be confirmed by performance of the REMP in Section I.
		$\leq 15$ mrem organ	Calendar Year	
T.S. 5.6.4 (Unit 1) T.S. 6.14 (Unit 2) T.S. 6.16 (Unit 3) Gaseous Radwaste Treatment	II.D.2. II.D.4.	$> 0.02$ mrad gamma air $> 0.04$ mrad beta air $> 0.03$ mrem organ	Projected for 31 Days (if system not in use)	Return to operation Gaseous Radwaste Treatment System
II.E IVI/VF Total Dose	II.D.6.	$\leq 25$ mrem T.B.* $\leq 25$ mrem organ* $\leq 75$ mrem thyroid*	12 Consecutive Months**	30-day report if Unit 1 Effluent Control III.D.1.2, III.D.2.2, or III.D.2.3 or Units 2/3 Effluent Control IV/VE.1.2, IV/VE.2.2, or IV/VE.2.3 are exceeded by a factor of 2. Restore dose to public to within the applicable EPA limit(s) or obtain a variance

NOTE: T.B. means total or whole body.

\* Applies to the entire site (Units 1, 2, and 3) discharges combined.

\*\*Cumulative dose contributions calculated once per 31 days.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

94 of 165

# SECTION III.

## Millstone Unit 1

### Radiological Effluent Controls

Docket Nos. 50-245



MP-22-REC-BAP01

Rev. 026-00

95 of 165

## SECTION III. REMODCM UNIT ONE CONTROLS

### III.A. Introduction

The purpose of this section is to provide the following for Millstone Unit One:

- a. the effluent radiation monitor controls and surveillance requirements,
- b. the effluent radioactivity concentration and dose controls and surveillance requirements, and
- c. the bases for the controls and surveillance requirements.

Definitions of certain terms are provided as an aid for implementation of the controls and requirements.

Some surveillance requirements refer to specific sub-sections in Sections I and II as part of their required actions

### III.B. Definitions and Surveillance Requirement (SR) Applicability

#### III.B.1 - Definitions

The defined terms of this sub-section appear in capitalized type and are applicable throughout Section III.

1. **ACTION** - that part of a Control that prescribes remedial measures required under designated conditions.
2. **INSTRUMENT CALIBRATION** - the adjustment, as necessary, of the instrument output such that it responds within the necessary range and accuracy to known values of the parameter that the instrument monitors. The **INSTRUMENT CALIBRATION** shall encompass those components, such as sensors, displays, and trip functions, required to perform the specified safety function(s). The **INSTRUMENT CALIBRATION** shall include the **INSTRUMENT FUNCTIONAL TEST** and may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is calibrated.

3. **INSTRUMENT FUNCTIONAL TEST** – the injection of a simulated or actual signal into the channel as close to the sensor as practicable to verify that the instrument is **OPERABLE**, including all components in the channel, such as alarms, interlocks, displays, and trip functions, required to perform the specified safety function(s). For digital instruments, the computer database may be manipulated, in lieu of a signal injection, to verify operability of alarm and/or trip functions. The **INSTRUMENT FUNCTIONAL TEST** may be performed by means of any series of sequential, overlapping, or total channel steps so that the entire channel is tested.
4. **INSTRUMENT CHECK** – the qualitative determination of operability by observation of behavior during operation. This determination shall include, where possible, comparison of the instrument with other independent instruments measuring the same variable.
5. **OPERABLE** – An instrument shall be **OPERABLE** when it is capable of performing its specified functions(s). Implicit in this definition shall be the assumption that all necessary attendant instrumentation, controls, normal and emergency electrical power sources, cooling or seal water, lubrication or other auxiliary equipment that are required for the instrument to perform its functions(s) are also capable of performing their related support function(s).
6. **REAL MEMBER OF THE PUBLIC** – an individual, not occupationally associated with the Millstone site, who is exposed to existing dose pathways at one particular location. This does not include employees of the utility or utilities which own a Millstone plant and utility contractors and vendors. Also excluded are persons who enter the Millstone site to service equipment or to make deliveries. This does include persons who use portions of the Millstone site for recreational, occupational, or other purposes not associated with any of the Millstone plants.
7. **SITE BOUNDARY** – that line beyond which the land is not owned, leased, or otherwise controlled by the licensee.
8. **SOURCE CHECK** – the qualitative assessment of channel response when the channel is exposed to radiation.
9. **RADIOACTIVE WASTE TREATMENT SYSTEMS** – Radioactive Waste Treatment Systems are those liquid, gaseous, and solid waste systems which are required to maintain control over radioactive materials in order to meet the controls set forth in this section.



### III.B.2 – Surveillance Requirement (SR) Applicability

1. SRs shall be met during specific conditions in the Applicability for individual LCOs unless otherwise stated in the SR. Failure to meet a Surveillance, whether such failure is experienced during the performance of the Surveillance or between performances of the Surveillance, shall be failure to meet the LCO. Failure to perform a Surveillance within the specified Frequency shall be failure to meet the LCO except as provided in III.B.2 3. Surveillances do not have to be performed on inoperable equipment or variables outside specified limits.
2. The specified Frequency for each SR is met if the Surveillance is performed within 1.25 times the interval specified in the Frequency, as measured from the previous performance or as measured from the time a specified condition of the frequency is met.
3. If it is discovered that a Surveillance was not performed within its specified frequency, then compliance with the requirement to declare the LCO not met may be delayed from the time of discovery up to 24 hours or up to the limit of the specified frequency, whichever is less. This delay period is permitted to allow performance of the surveillance. If the Surveillance is not performed within the delay period, the LCO must immediately be declared not met and the applicable Condition(s) must be entered. The Completion Times of the Required Actions begin immediately upon expiration of the delay period. When the Surveillance is performed within the delay period and the Surveillance is not met, the LCO must immediately be declared not met and the applicable Condition(s) must be entered. The Completion Times of the Required Actions begin immediately upon failure to meet the Surveillance.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

98 of 165

### III.C. Radioactive Effluent Monitoring Instrumentation

#### 1. Radioactive Liquid Effluent Monitoring Instrumentation

##### CONTROLS

---

The radioactive liquid effluent monitoring instrumentation channels shown in Table III.C. - 1 shall be OPERABLE with applicable alarm/trip setpoints set to ensure that the limits of Specification III.D.1.a. are not exceeded. The setpoints shall be determined in accordance with methods and parameters described in Section II.

APPLICABILITY: As shown in Table III.C. - 1

##### ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Specification, without delay suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With the number of channels less than the minimum channels OPERABLE requirement, take the action shown in Table III.C. - 1. Exert best efforts to restore the inoperable monitor to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner. Releases need not be terminated after 30 days provided the specified actions are continued.

##### SURVEILLANCE REQUIREMENTS

---

Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table III.C. - 2.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

99 of 165

**TABLE III.C.-1  
Radioactive Liquid Effluent Monitoring Instrumentation**

Instrument	Minimum # Operable	Alarm Setpoints Required	Applicability	Action
1. Radioactivity Monitor Liquid Effluent Line	1	Yes	*	A

\* Whenever the pathway is being used except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling.

Action A

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that best efforts are made to repair the instrument and that prior to initiating a release:

- (1) At least two independent samples are analyzed in accordance with the first Surveillance Requirement of Specification III.D.1.a. and;
- (2) The original release rate calculations and discharge valving are independently verified by a second individual.

TABLE III.C.-2 Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements				
Instrument	Channel Check	Source Check	Channel Calibration	Channel Functional Test
1. Radioactivity Monitor Liquid Effluent Line	D*	P	T(1)	Q

- D = Daily
- P = Prior to each batch release
- T = Once every two years
- Q = Once every 3 months

\* During releases via this pathway and when the monitor is required OPERABLE per Table III.C.-1. The CHANNEL CHECK should be done when the discharge is in progress.

- (1) Calibration shall include the use of a radioactive liquid or solid source which is traceable to an NIST source.



## 2. Radioactive Gaseous Effluent Monitoring Instrumentation

### CONTROLS

The radioactive gaseous effluent monitoring instrumentation channels shown in Table III.C.-3 shall be OPERABLE with applicable alarm setpoints set to ensure that the limits of Control III.D.2.a. are not exceeded. The setpoints shall be determined in accordance with methods and parameters described in Section II.F.1.

APPLICABILITY: As shown in Table III.C.-3.

### ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm setpoint less conservative than required by the above Control, without delay suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With the number of channels less than the minimum channels operable requirements, take the action shown in Table III.C.-3. Exert best efforts to restore the inoperable monitor to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radiological Effluent Release Report why the inoperability was not corrected in a timely manner. Release need not be terminated after 30 days provided the specified actions are continued.

### SURVEILLANCE REQUIREMENT

Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the INSTRUMENT CHECK, INSTRUMENT CALIBRATION, INSTRUMENT FUNCTIONAL TEST, and SOURCE CHECK operations at the frequencies shown in Table III.C.-4.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

102 of 165

**TABLE III.C.-3  
Radioactive Gaseous Effluent Monitoring Instrumentation**

Instrument	Minimum # Operable	Alarm Setpoints Required	Applicability	Action
<b>1. Spent Fuel Pool Island Vent</b>				
(a) Noble Gas Activity Monitor	1	Yes	*	A
(b) Particulate Sampler	1	No	*	B
(c) Vent Flow Rate Monitor	1	No	*	C
(d) Sampler Flow Rate Monitor	1	Yes	*	D
<b>2. Balance of Plant Vent</b>				
(a) Particulate Sampler	1	No	*	B
(b) Sampler Flow Monitor	1	Yes	*	D

\* Channels are OPERABLE and in service on a continuous, uninterrupted basis when exhaust fans are operating, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required tests, checks, calibrations, and sampling associated with the instrument or any system or component which affects functioning of the instrument.

**ACTION STATEMENTS**

**Action A**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that grab samples are taken daily when fuel is being moved, or during any evolution or event which would threaten fuel integrity, and these samples are analyzed for gross activity within 24 hours.

**Action B**

With the number of samplers OPERABLE less than required by the Minimum number OPERABLE requirement, effluent releases via this pathway may continue provided that the best efforts are made to repair the instrument and that a 24 hour sample is collected with auxiliary sampling equipment once every seven (7) days, or anytime significant generation of airborne radioactivity is expected, and analyzed for principal gamma emitters with half lives greater than 8 days within 24 hours after the end of the sampling period. Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours.

**Action C**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument.

**Action D**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that the flow rate is estimated once during the

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

103 of 165

Chemistry compensatory sampling time period as specified in Action A or Action B. Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

104 of 165

TABLE III.C.-4 Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements				
Instrument	Instrument Check	Instrument Calibration	Functional Test	Source Check
1. Spent Fuel Pool Island Vent				
(a) Noble Gas Activity Monitor	D <sup>(3)</sup>	T <sup>(6)</sup>	Q <sup>(7)</sup>	M
(b) Particulate Sampler	TM	NA	NA	NA
(c) Vent Flow Rate Monitor	D	T	NA	NA
(d) Sampler Flow Rate Monitor	D	T	NA	NA
2. Balance of Plant Vent				
(a) Particulate Sampler	TM	NA	NA	NA
(b) Sampler Flow Monitor	D	T	NA	NA

D = Daily  
 W = Weekly  
 TM = Twice per month  
 M = Monthly  
 Q = Once every 3 months  
 T = Once every two years  
 NA = Not Applicable

Table III.C.-4  
TABLE NOTATION

- (1) RESERVED
- (2) RESERVED
- (3) Instrument check daily only when there exist releases via this pathway.
- (4) RESERVED
- (5) RESERVED
- (6) Calibration shall include the use of a known source whose strength is determined by a detector which has been calibrated to a source which is traceable to the NIST. These sources shall be in a known reproducible geometry.
- (7) The INSTRUMENT FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
  - 1. Instrument indicates measured levels above the alarm/trip setpoint.
  - 2. Instrument indicates a downscale failure.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

105 of 165

### III.D. Radioactive Effluents Concentrations And Dose Limitations

#### 1. Radioactive Liquid Effluents

##### a. Radioactive Liquid Effluents Concentrations

#### LIMITING CONDITIONS OF OPERATIONS

The concentration of radioactive material released from the site (see Figure III.D.-1) shall not exceed ten times the concentrations specified in 10 CFR Part 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall not exceed  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity.

APPLICABILITY: At all times.

#### ACTION:

With the concentration of radioactive material released from the site exceeding the above limits, restore the concentration to within the above limits within 15 minutes.

#### SURVEILLANCE REQUIREMENT

Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program specified in Section I. The results of the radioactive analysis shall be used in accordance with the methods of Section II to assure that the concentrations at the point of release are maintained within the limits of Specification III.D.1.a.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

106 of 165

b. Radioactive Liquid Effluents Doses

LIMITING CONDITIONS OF OPERATIONS

The dose or dose commitment to any REAL MEMBER OF THE PUBLIC from radioactive materials in liquid effluents from Unit 1 released from the site (see Figure III.D.-1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ; and,
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive materials in liquid effluents during the remainder of the current calendar quarter and the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 3 mrem to the total body and 10 mrem to any organ.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

107 of 165

## 2. Radioactive Gaseous Effluents

### a. Radioactive Gaseous Effluents Dose Rate

#### CONTROLS

---

The dose rate, at any time, offsite (See Figure III.D.-1) due to radioactive materials released in gaseous effluents from the site shall be limited to the following values:

- a. The dose rate limit for noble gases shall be less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin; and,
- b. The dose rate limit for Tritium and for all radioactive materials in particulate form with half lives greater than 8 days shall be less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

#### ACTION:

With the dose rate(s) exceeding the above limits, decrease the release rate to comply with the limit(s) given in Control III.D.2.a. within 15 minutes.

#### SURVEILLANCE REQUIREMENT

---

- 1) The instantaneous release rate corresponding to the above dose rate shall be determined in accordance with the methodology of Section II.
- 2) The instantaneous release rate shall be monitored in accordance with the requirements of Section III.C.2.
- 3) Sampling and analysis shall be performed in accordance with Section I to assure that the limits of Control III.D.2.a. are met.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

108 of 165

b. Radioactive Gaseous Effluents Noble Gas Dose

CONTROLS

The air dose offsite (see Figure III.D.-1) due to noble gases released in gaseous effluents from Unit 1 shall be limited to the following:

- a. During any calendar quarter, to less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation;
- b. During any calendar year to less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

ACTION:

With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive noble gases in gaseous effluents during the remainder of the current calendar quarter and the calendar year so that the cumulative dose during the calendar year is within 10 mrad for gamma radiation and 20 mrad for beta radiation.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.

★  
STOP

★  
THINK

★  
ACT

★  
REVIEW

MP-22-REC-BAP01  
Rev. 026-00  
109 of 165

c. Gaseous Effluents – Dose from Radionuclides Other than Noble Gas

CONTROLS

---

The dose to any REAL MEMBER OF THE PUBLIC from Tritium and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents released offsite from Unit 1 (see Figure III.D. – 1) shall be limited to the following:

- a. During any calendar quarter to less than or equal to 7.5 mrem [to any organ];
- b. During any calendar year to less than or equal to 15 mrem [to any organ].

APPLICABILITY: At all times.

ACTION:

With the calculated dose from the release of Tritium and radioactive materials in particulate form exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions to be taken to reduce the releases during the remainder of the current calendar quarter and during the remainder of the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 15 mrem to any organ.

SURVEILLANCE REQUIREMENTS

---

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.





### III.E. Total Radiological Dose From Station Operations Controls

#### CONTROLS

The annual dose or dose commitment to any REAL MEMBER OF THE PUBLIC, beyond the site boundary, from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which is limited to less than or equal to 75 mrem).

APPLICABILITY: At all times.

#### ACTION:

With the calculated dose from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Controls III.D.1.b., III.D.2.b. or III.D.2.c. prepare and submit a Special Report to the Commission within 30 days and limit the subsequent releases such that the dose commitment from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except thyroid, which is limited to less than or equal to 75 mrem) over 12 consecutive months. This Special Report shall include an analysis which demonstrates that radiation exposures from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site (including all effluent pathways and direct radiation) are less than the 40 CFR 190 Standard.

If the estimated doses exceed the above limits, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.

#### SURVEILLANCE REQUIREMENTS

Cumulative dose contributions from liquid and gaseous effluents and direct radiation from the Millstone Site shall be determined in accordance with Section II once per 31 days.

### III.F. Bases

#### Section III.C.1 – Radioactive Liquid Effluent Monitoring Instrumentation

No controls required; Unit 1 is not currently releasing radioactivity in liquid effluents

#### Section III.C.2 – Radioactive Gaseous Effluent Monitoring Instrumentation

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

112 of 165

The Spent Fuel Pool Island Vent is the only gaseous pathway currently requiring radiation monitoring for Unit 1.

Section III.D.1.a. – Radioactive Liquid Effluents Concentrations

This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than ten times the concentration levels specified in 10 CFR 20, Appendix B, Table 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within: (1) the Section II.A. design objectives of Appendix I, 10 CFR 50, to an individual and (2) the limits of 10 CFR 20 to the population. The concentration limit for noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its concentration in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

Section III.D.1.b. – Radioactive Liquid Effluents Doses

This specification is provided to implement the requirements of Sections II.A., III.A, and IV.A of Appendix I, 10 CFR 50. The specification implements the guides set forth in Section II.A of Appendix I. The Action statements provide the required operating flexibility and at the same time implement the guides set forth in Section III.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable". The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I is to be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR 50, Appendix I," Revision 1, October 1977, and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

Section III.D.2.a. – Radioactive Gaseous Effluents Dose Rate

This control is provided to ensure that the dose rate at anytime from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR 20 for all areas offsite. The annual dose limits are the doses associated with the concentrations of 10 CFR 20, Appendix B, Table 2. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual offsite to annual average concentrations exceeding the limits specified in Appendix B, Table 2 of 10 CFR



20. For individuals who may, at times, be within the site boundary, the occupancy of that individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid dose rate above background to an infant via the cow-milk-infant pathway to less than or equal to 1500 mrem/year for the nearest cow to the plant.

Section III.D.2.b. – Radioactive Gaseous Effluents Noble Gas Dose

This control is provided to implement the requirements of Sections II.B., III.A., and IV.A. of Appendix I, 10 CFR 50. The control implements the guides set forth in Section II.B of Appendix I. The action statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through the appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in the ODCM for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents will be consistent with the methodology provided in Regulatory Guide 1.109, "Calculational of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977.

The ODCM equations provided for determining the air doses at the site boundary were based upon utilizing successively more realistic dose calculational methodologies. More realistic dose calculational methods are used whenever simplified calculations indicate a dose approaching a substantial portion of the regulatory limits. The methods used are, in order, previously determined air dose per released activity ratio, historical meteorological data and actual radionuclide mix released, or real time meteorology and actual radionuclides released.

Section III.D.2.c. – Radioactive Gaseous Effluents, Particulates, and Gas Other Than Noble Gas Doses

These controls is provided to implement the requirements of Sections II.C, III.A and IV.A of Appendix I, 10 CFR 50. The controls are the guides set forth in Section II.C of Appendix I. The action statements provide the required

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

114 of 165

operating flexibility and at the same time implement the guides set forth in Section IV.A of Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The ODCM calculational methods specified in the surveillance requirements implement the requirements in Section III.A of Appendix I that conformance with the guides for Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The ODCM calculational methods for calculating the doses due to the actual release rates of the subject materials will to be consistent with the methodology provided in Regulatory Guide 1.109, "Calculating of Annual Dose to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR 50, Appendix I," Revision I, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision I, July 1977. These equations provide for determining the doses based upon either conservative atmospheric dispersion and an assumed critical nuclide mix or using real time meteorology and specific nuclides released. The release rate specifications for radioactive material in particulate form and radionuclides other than noble gases are dependent on the existing radionuclide pathways to man. The pathways which are examined in the development of these calculations are: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

#### Section III.E. - Total Radiological Dose from Station Operations

This control is provided to meet the reporting requirements of 40 CFR 190. For the purpose of the Special Report, it may be assumed that the dose commitment to any REAL MEMBER OF THE PUBLIC from other fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

115 of 165

SECTION IV.

Millstone Unit 2

Radiological Effluent Controls

Docket Nos. 50-336

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

116 of 165

## SECTION IV. REMODCM UNIT TWO CONTROLS

### IV.A. Introduction

The purpose of this section is to provide the following for Millstone Unit Two:

- a. the effluent radiation monitor controls and surveillance requirements,
- b. the effluent radioactivity concentration and dose controls and surveillance requirements, and
- c. the bases for the controls and surveillance requirements.

Definitions of certain terms are provided as an aid for implementation of the controls and requirements.

Some surveillance requirements refer to specific sub-sections in Sections I and II as part of their required actions.

### IV.B. Definitions, Applicability and Surveillance Requirements

#### IV.B.1 - Definitions

The defined terms of this sub-section appear in capitalized type and are applicable throughout Section IV.

1. **ACTION** – Those additional requirements specified as corollary statements to each principal control and shall be part of the control.
2. **OPERABLE / OPERABILITY** – An instrument shall be **OPERABLE** or have **OPERABILITY** when it is capable of performing its specified functions(s) and when all necessary attendant instrumentation, controls, normal and emergency electrical power sources, or other auxiliary equipment that are required for the instrument to perform its functions(s) are also capable of performing their related support function(s).
3. **CHANNEL CALIBRATION** – A **CHANNEL CALIBRATION** shall be the adjustment, as necessary, of the channel output such that it responds within the necessary range and accuracy to know values of the parameter which the channel monitors. The **CHANNEL CALIBRATION** shall encompass the entire channel including the sensors and alarm and/or trip functions, and shall include the **CHANNEL FUNCTIONAL TEST**. The **CHANNEL CALIBRATION** may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is calibrated.



MP-22-REC-BAP01

Rev. 026-00

117 of 165

4. CHANNEL CHECK – A CHANNEL CHECK shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.
5. CHANNEL FUNCTIONAL TEST – A CHANNEL FUNCTIONAL TEST shall be the injection of a simulated signal into the channel as close to the primary sensor as practicable to verify OPERABILITY including alarm and/or trip functions. For digital instruments, the computer database may be manipulated, in lieu of a signal injection, to verify operability of alarm and/or trip functions.
6. SOURCE CHECK – A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to radiation.
7. MEMBER(S) OF THE PUBLIC – MEMBER(S) OF THE PUBLIC shall include all persons who are not occupationally associated with the plant. This category does not include employees of the utility, its contractors or its vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with the plant.

The term “REAL MEMBER OF THE PUBLIC” means an individual who is exposed to existing dose pathways at one particular location.

8. MODE – Refers to Mode of Operation as defined in Safety Technical Specifications.
9. SITE BOUNDARY – The SITE BOUNDARY shall be that line beyond which the land is not owned, leased, or otherwise controlled by the licensee.
10. UNRESTRICTED AREA – Any area at or beyond the site boundary to which access is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials or any area within the site boundary used for residential quarters or industrial, commercial, institutional and/or recreational purposes.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

118 of 165

11. DOSE EQUIVALENT I-131 – DOSE EQUIVALENT I-131 shall be that concentration of I-131 ( $\mu\text{Ci}/\text{gram}$ ) which alone would produce the same CDE-thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed under Inhalation in Federal Guidance Report No. 11 (FGR 11), "Limiting Values of Radionuclide Intake and Air Concentration and Dose Conversion Factors for Inhalation, Submersion and Ingestion."

#### IV.B.2 – Applicability

##### IV.B.2a – LIMITING CONDITIONS FOR OPERATION

1. Compliance with the Limiting Conditions for Operation contained in the succeeding specifications is required during the OPERATIONAL MODES or other conditions specified therein; except that upon failure to meet the Limiting Conditions for Operation, the associated ACTION requirements shall be met.
2. Noncompliance with a specification shall exist when the requirements of the Limiting Condition for Operation and associated ACTION requirements are not met within the specified time intervals, except as provided in Condition IV.B.2.a(6). If the Limiting Condition for Operation is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.
3. NOT USED.
4. NOT USED.
5. When a system, subsystem, train, component or device is determined to be inoperable solely because its emergency power source is inoperable, or solely because its normal power source is inoperable, it may be considered OPERABLE for the purpose of satisfying the requirements of its applicable Limiting Condition for Operation, provided: (1) its corresponding normal or emergency power source is OPERABLE; and (2) all of its redundant system(s), subsystem(s), train(s), component(s) and device(s) are OPERABLE, or likewise satisfy the requirements of this specification.
6. Equipment removed from service or declared inoperable to comply with ACTIONS may be returned to service under administrative control solely to perform testing required to demonstrate its OPERABILITY or the OPERABILITY of other equipment. This is an exception to Condition IV.B.2.a(2) for the system returned to service under administrative control to perform the testing required to demonstrate OPERABILITY.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

119 of 165

## IV.B2.b – SURVEILLANCE REQUIREMENTS

1. Surveillance Requirements shall be applicable during any condition specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.
2. Each Surveillance Requirement shall be performed within the specified time interval with a maximum allowable extension not to exceed 25% of the surveillance time interval.
3. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Condition IV.B2.b(2), shall constitute a failure to meet the OPERABILITY requirements for a Limiting Condition for Operation. The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. Surveillance Requirements do not have to be performed on inoperable equipment.
4. Entry into any specified condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the stated surveillance interval or as otherwise specified.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

120 of 165

## IV.C. Radioactive Effluent Monitoring Instrumentation

### 1. Radioactive Liquid Effluent Monitoring Instrumentation

#### LIMITING CONDITIONS OF OPERATIONS

The radioactive liquid effluent monitoring instrumentation channels shown in Table IV.C.-1 shall be OPERABLE with applicable alarm/trip setpoints set to ensure that the limits of Specification IV.D.1.a. are not exceeded. The setpoints shall be determined in accordance with methods and parameters described in Section II.

APPLICABILITY: As shown in Table IV.C.-1

#### ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above Specification, without delay suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With the number of channels less than the minimum channels OPERABLE requirement, take the action shown in Table IV.C.-1. Exert best efforts to restore the inoperable monitor to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner. Releases need not be terminated after 30 days provided the specified actions are continued.

#### SURVEILLANCE REQUIREMENTS

Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table IV.C.-2.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

121 of 165

TABLE IV.C.-1 Radioactive Liquid Effluent Monitoring Instrumentation				
Instrument	Minimum # Operable	Alarm Setpoints Required	Applicability	Action
1. Gross Radioactivity Monitors Providing Automatic Termination Of Release				
(a) Clean Liquid Radwaste Effluent Line	1	Yes	*	A
(b) Aerated Liquid Radwaste Effluent Line	1	Yes	****	A
(c) Steam Generator Blowdown Monitor	1	Yes	*****	B
(d) Condensate Polishing Facility Waste Neut Sump	1	Yes	***	E
2. Gross Radioactivity Monitors Not Providing Automatic Termination Of Release				
(a) Reactor Building Closed Cooling Water Monitor#	1	Yes	*	C
3. Flow Rate Measurements				
(a) Clean Liquid Radwaste Effluent Line	1	No	*	D
(b) Aerated Liquid Radwaste Effluent Line	1	No	*	D
(c) Condensate Polishing Facility	1	No	*	D

TABLE IV.C.-1  
TABLE NOTES

- \* At all times – which means that channels shall be OPERABLE and in service on a continuous, uninterrupted basis, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.
- \*\* Deleted.
- \*\*\* Whenever the pathway is being used except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.
- \*\*\*\* MODEs 1-4, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.
- # Since the only source of service water contamination is the reactor building closed cooling water, monitoring of the closed cooling water and conservative leakage assumptions will provide adequate control of service water effluents.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

122 of 165

## ACTION STATEMENTS

### Action A

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that best efforts are made to repair the instrument and that prior to initiating a release:

- (1) At least two independent samples are analyzed in accordance with the first Surveillance Requirement of Specification IV.D.1.a. and;
- (2) The original release rate calculations and discharge valving are independently verified by a second individual.

### Action B

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, either:

- (1) Suspend all effluent releases via this pathway, or
- (2) Make best efforts to repair the instrument and obtain grab samples and analyze for gamma radioactivity at lower limits of detection as specified in Table I.C.-2;
  - a) Once per 12 hours when the specific activity of the secondary coolant is greater than 0.01  $\mu\text{Ci/gm}$  DOSE EQUIVALENT I-131.
  - b) Once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01  $\mu\text{Ci/gm}$  DOSE EQUIVALENT I-131.

### Action C

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that once per 12 hours grab samples of the service water effluent are collected and analyzed for gamma radioactivity at LLD as specified in Table I.C.-2;

### Action D

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that the flow rate is estimated once per 4 hours during actual releases. Pump performance curves may be used to estimate flow.

### Action E

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that best efforts are made to repair the instrument and that prior to initiating a release:

- (1) At least two independent samples are analyzed in accordance with the first Surveillance Requirement of Specification IV.D.1.a., and;
- (2) If one of the samples has gamma radioactivity greater than any of the LLDs in Table I.C.-2, the original release rate calculations and discharge valving are independently verified by a second individual.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

123 of 165

<b>TABLE IV.C.-2 Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements</b>				
<b>Instrument</b>	<b>Channel Check</b>	<b>Source Check</b>	<b>Channel Calibration</b>	<b>Channel Functional Test</b>
<b>1. Gross Radioactivity Monitors Providing Alarm and Automatic Termination Of Release</b>				
a. Clean Liquid Radwaste Effluent Line	D*	P	R(1)	Q(2)
b. Aerated Liquid Radwaste Effluent Line	D*	P	R(1)	Q(2)
c. Steam Generator Blowdown Monitor	D*	M	R(1)	Q(2)
d. Condensate Polishing Facility Waste Neut Sump	D*	P	R(1)	Q(2)
<b>2. Gross Radioactivity Monitors Providing Alarm But Not Providing Automatic Termination Of Release</b>				
a. Reactor Building Closed Cooling Water Monitor	D*	M	R(1)	Q(2)
<b>3. Flow Rate Measurements</b>				
a. Clean Liquid Radwaste Effluent Line	D*	N/A	R	Q
b. Aerated Liquid Radwaste Effluent Line	D*	N/A	R	Q
c. Condensate Polishing Facility Waste Neut Sump	D*	N/A	R	Q

D = Daily

M = Monthly

P = Prior to each batch release

R = Once every 18 months

Q = Once every 3 months

N/A = Not Applicable

**TABLE IV.C.-2  
TABLE NOTATION**

\* During releases via this pathway and when the monitor is required OPERABLE per Table IV.C.-1. The CHANNEL CHECK should be done when the discharge is in progress.

- (1) Calibration shall include the use of a radioactive liquid or solid source which is traceable to an NIST source.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
  - a) Instrument indicates measured levels above the alarm/trip setpoint.
  - b) Instrument indicates a downscale or circuit failure.
    - Automatic isolation of the discharge stream shall also be demonstrated for this case for each monitor except the reactor building closed cooling water monitor.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

124 of 165

## 2. Radioactive Gaseous Effluent Monitoring Instrumentation

### LIMITING CONDITIONS OF OPERATIONS

The radioactive gaseous effluent monitoring instrumentation channels shown in Table IV.C.-3 shall be OPERABLE with applicable alarm/trip setpoints set to ensure that the limits of Specifications IVD.2.a. are not exceeded. The setpoints shall be determined in accordance with methods and parameters described in Section II.

APPLICABILITY: As shown in Table IV.C.-3

### ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel alarm/trip setpoint less conservative than required by the above specification, without delay suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With the number of channels less than the minimum channels OPERABLE requirement, take the action shown in Table IV.C.-3. Exert best efforts to restore the inoperable monitor to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner. Release need not be terminated after 30 days provided the specified actions are continued.

### SURVEILLANCE REQUIREMENTS

Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST operations at the frequencies shown in Table IV.C.-4.



**TABLE IV.C.-3  
Radioactive Gaseous Effluent Instrumentation**

Instrument	Minimum Channels Operable	Alarm Setpoints Required	Applicability	Action
1. MP2 Vent (normal range, RM-8132 only; high range monitor, RM-8168, requirements are in the TS)				
a. Noble Gas Activity Monitor	1	Yes***	**	A
b. Iodine Sampler	1	No	**	B
c. Particulate Sampler	1	No	**	B
d. Vent Flow Rate Monitor	1	No	**	C
e. Sampler Flow Rate Monitor	1	No	**	C
2. Millstone Stack - applicable to the WRGM (RM-8169, normal range, channel 1, only; mid range channel 2 and high range channel 3 requirements are contained in TRM LCO 3.3.3.8)				
a. Noble Gas Activity Monitor	1	Yes***	**	E
b. Iodine Sampler	1	No	**	B
c. Particulate Sampler	1	No	**	B
d. Stack Flow Rate Monitor	1	No	**	C
e. Sampler Flow Rate Monitor	1	No	**	C
3. Waste Gas Holdup System				
a. Noble Gas Monitor Providing Automatic Termination of Release	1	Yes	*	D

\* During waste gas holdup system discharge.

\*\* At all times when air is being released to the environment by the pathway being monitored, which means that channels be OPERABLE and in service on a continuous, uninterrupted basis, except that outages are permitted for a maximum of 12 hours for the purpose of maintenance and performance of required tests, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.

\*\*\* No automatic isolation features.

**ACTION STATEMENTS**

**Action A**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that grab samples are taken once per 12 hours and these samples are analyzed for gross activity within 24 hours.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

126 of 165

#### Action B

With the number of samplers OPERABLE less than required by the Minimum number OPERABLE requirement, effluent releases via this pathway may continue provided that the best efforts are made to repair the instrument and that samples are continuously collected with auxiliary sampling equipment for periods of seven (7) days and analyzed for principal gamma emitters with half lives greater than 8 days within 48 hours after the end of the sampling period. Auxiliary sampling must be initiated within 12 hours of initiation of this action statement. Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours. Auxiliary sampling outages are permitted for a maximum of 12 hours for the purpose of maintenance and performance of required tests, checks, calibrations, or sampling.

#### Action C

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that the flow rate is estimated once per 5 hours. Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use.

#### Action D

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement:

Releases from the Millstone Unit 2 waste gas system may continue provided that best efforts are made to repair the instrument and that prior to initiating the release:

- a) At least two independent samples of the tank's contents are analyzed; and
- b) The original release rate calculations and discharge valve lineups are independently verified by a second individual. Otherwise, suspend releases from the waste gas holdup system.

#### Action E

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, Millstone Unit 2 releases via the Millstone Stack may continue provided that best efforts are made to repair the instrument and that grab samples are taken once per 12 hours and these samples are analyzed for gross activity within 24 hours

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

127 of 165

**TABLE IV.C.-4  
Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements**

Instrument	Channel Check	Source Check	Channel Calibration	Channel Functional Test
1.MP2 Vent (normal range, RM-8132 only; high range monitor, RM-8168, requirements are in the TS)				
a. Noble Gas Activity Monitor	D	M	R <sup>(1)</sup>	Q <sup>(2)</sup>
b. Iodine Sampler	W	NA	NA	NA
c. Particulate Sampler	W	NA	NA	NA
d. Vent Flow Rate Monitor	D	NA	R	Q
e. Sampler Flow Rate Monitor	D	NA	R	NA
2.Millstone Stack – applicable to the WRGM (RM-8169, normal range, channel 1, only; mid range channel 2 and high range channel 3 requirements are contained in TRM LCO 3.3.3.8)				
a. Noble Gas Activity Monitor	D	M	R <sup>(1)</sup>	Q <sup>(2)</sup>
b. Iodine Sampler	W	NA	NA	NA
c. Particulate Sampler	W	NA	NA	NA
d. Stack Flow Rate Monitor	D	NA	R	Q <sup>(2)</sup>
e. Sampler Flow Rate Monitor	D	NA	R	NA
3.Waste Gas Holdup System				
a. Noble Gas Monitor	D*	P	R <sup>(1)</sup>	Q <sup>(2)</sup>

\*During releases via this pathway and when the monitor is required OPERABLE per Table IV.C.-3. The CHANNEL CHECK should be performed when the discharge is in progress.

P = Prior to discharge  
D = Daily  
W = Weekly  
M = Monthly

R = Once every 18 months  
Q = Once every 3 months  
NA= Not Applicable

**TABLE IV.C.-4  
TABLE NOTATION**

- (1) Calibration shall include the use of a known source whose strength is determined by a detector which has been calibrated to a source which is traceable to the NIST. These sources shall be in a known, reproducible geometry.
- (2) The CHANNEL FUNCTIONAL TEST shall also demonstrate that control room alarm annunciation\* occurs if any of the following conditions exist:
- Instrument indicates measured levels above the alarm/trip setpoint.
  - Instrument indicates a downscale failure.

\* – Also demonstrate automatic isolation for the waste gas system noble gas monitor.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01  
Rev. 026-00  
128 of 165

## IV.D. Radioactive Effluents Concentrations And Dose Limitations

### 1. Radioactive Liquid Effluents

#### a. Radioactive Liquid Effluents Concentrations

##### LIMITING CONDITIONS OF OPERATIONS

The concentration of radioactive material released from the site (see Figure IV.D. - 1) shall not exceed ten times the concentrations specified in 10 CFR 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall not exceed  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity.

APPLICABILITY: At all times.

##### ACTION:

With the concentration of radioactive material released from the site exceeding the above limits, restore the concentration to within the above limits within 15 minutes.

##### SURVEILLANCE REQUIREMENTS

- 1) Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program specified in Section I.
- 2) The results of the radioactive analysis shall be used in accordance with the methods of Section II to assure that the concentrations at the point of release are maintained within the limits of Specification IV.D.1.a.



MP-22-REC-BAP01

Rev. 026-00

129 of 165

b. Radioactive Liquid Effluents Doses

LIMITING CONDITIONS OF OPERATIONS

The dose or dose commitment to any REAL MEMBER OF THE PUBLIC from radioactive materials in liquid effluents from Unit 2 released from the site (see Figure IV.D. -1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ; and,
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive materials in liquid effluents during the remainder of the current calendar quarter and the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 3 mrem to the total body and 10 mrem to any organ.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations. Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in Section II at least once per 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

130 of 165

2. Radioactive Gaseous Effluents

a. Radioactive Gaseous Effluents Dose Rate

LIMITING CONDITIONS OF OPERATIONS

The dose rate, at any time, offsite (see Figure IV.D.-1) due to radioactive materials released in gaseous effluents from the site shall be limited to the following values:

- a. The dose rate limit for noble gases shall be less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin; and,
- b. The dose rate limit for Iodine-131, Iodine-133, Tritium, and for all radioactive materials in particulate form with half lives greater than 8 days shall be less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

ACTION:

With the dose rate(s) exceeding the above limits, decrease the release rate to comply with the limit(s) given in Specification IV.D.2.a. within 15 minutes.

SURVEILLANCE REQUIREMENTS

- 1) The release rate, at any time, of noble gases in gaseous effluents shall be controlled by the offsite dose rate as established above in Specification IV.D.2.a. The corresponding release rate shall be determined in accordance with the methodology of Section II.
- 2) The noble gas effluent monitors of Table IV.C.-3 shall be used to control release rates to limit offsite doses within the values established in Specification IV.D.2.a.
- 3) The release rate of radioactive materials in gaseous effluents shall be determined by obtaining representative samples and performing analyses in accordance with the sampling and analysis program specified in Section I. The corresponding dose rate shall be determined using the methodology given in Section II.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

131 of 165

b. Radioactive Gaseous Effluents Noble Gas Dose

LIMITING CONDITIONS OF OPERATIONS

The air dose offsite (see Figure IV.D.-1) due to noble gases released in gaseous effluents from Unit 2 shall be limited to the following:

- a. During any calendar quarter, to less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation;
- b. During any calendar year to less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive noble gases in gaseous effluents during the remainder of the current calendar quarter and the calendar year so that the cumulative dose during the calendar year is within 10 mrad for gamma radiation and 20 mrad for beta radiation.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

132 of 165

- c. Gaseous Effluents – Doses from Radionuclides Other than Noble Gas

LIMITING CONDITIONS OF OPERATIONS

The dose to any REAL MEMBER OF THE PUBLIC from Iodine-131, Iodine-133, Tritium, and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents released offsite from Unit 2 (see Figure IV.D. - 1) shall be limited to the following:

- a. During any calendar quarter to less than or equal to 7.5 mrem to any organ;
- b. During any calendar year to less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of radioiodines, radioactive materials in particulate form, or radionuclides other than noble gases in gaseous effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions to be taken to reduce the releases during the remainder of the current calendar quarter and during the remainder of the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 15 mrem to any organ.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.



MP-22-REC-BAP01

Rev. 026-00

133 of 165



#### IV.E. Total Radiological Dose From Station Operation

##### CONTROLS

The annual dose or dose commitment to any REAL MEMBER OF THE PUBLIC, beyond the site boundary, from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which is limited to less than or equal to 75 mrem).

APPLICABILITY: At all times.

##### ACTION:

With the calculated dose from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Controls IV.D.2.a., IV.D.1.b., or IV.D.2.c. prepare and submit a Special Report to the Commission within 30 days and limit the subsequent releases such that the dose commitment from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except thyroid, which is limited to less than or equal to 75 mrem) over 12 consecutive months. This Special Report shall include an analysis which demonstrates that radiation exposures from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site (including all effluent pathways and direct radiation) are less than the 40 CFR 190.

If the estimated doses exceed the above limits, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.

##### SURVEILLANCE REQUIREMENTS

Cumulative dose contributions from liquid and gaseous effluents and direct radiation from the Millstone Site shall be determined in accordance with Section II once per 31 days.

#### IV.F. Bases

##### Section IV.C.1. – Radioactive Liquid Effluent Monitoring Instrumentation

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The alarm/trip setpoints for these instruments shall be calculated in accordance with the approved methods in the ODCM to ensure that the alarm/trip will occur prior to exceeding ten times the limits of 10 CFR 20. The OPERABILITY and use of this

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

135 of 165

instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 50. Monitoring of the turbine building sumps and condensate polishing facility floor drains is not required due to relatively low concentrations of radioactivity possible.

#### Section IV.C.2. – Radioactive Gaseous Effluent Monitoring Instrumentation

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases. The alarm/trip setpoints for these instruments shall be calculated in accordance with the approved methods in the REMODCM to ensure that the alarm/trip will occur prior to exceeding the dose rate limits, at any time, as specified in Section IV.D.2.a. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 50.

Two types of radioactive gaseous effluent monitoring instrumentation, monitors and samplers, are being used at MP2 vent and Millstone Stack. Monitors have alarm/trip setpoints and are demonstrated operable by performing one or more of the following operations: CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL FUNCTIONAL TEST. Samplers are strictly collection devices made of canisters and filters. The CHANNEL CHECK surveillance requirements are met through (1) documented observation of the in-service rad monitor sample flow prior to filter replacement; (2) documented replacement of in-line iodine and particulate filters; and (3) documented observation of sample flow following the sampler return to service. The flow indicator is the only indication available for comparison. These observations adequately provide assurance that the sampler is operating and is capable of performing its design function.

There are a number of gaseous release points which could exhibit very low concentrations of radioactivity. For all of these release paths, dose consequences would be insignificant due to the intermittent nature of the release and/or the extremely low concentrations of radioactivity. Since it is not cost-beneficial (nor in many cases practical due to the nature of the release (steam) or the impossibility of detecting such low levels), to monitor these pathways, it has been determined that these release paths require no monitoring or sampling.

#### Section IV.D.1.a. – Radioactive Liquid Effluents Concentrations

This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than ten times the concentration levels specified in 10 CFR 20, Appendix B, Table 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within: (1) the Section II.A design objectives of Appendix I, 10 CFR 50, to an individual and (2) the limits of 10 CFR 20 to the population. The concentration limit for noble gases is



MP-22-REC-BAP01

Rev. 026-00

136 of 165

based upon the assumption that Xe-135 is the controlling radioisotope and its concentration in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

Section IV.D.1.b. – Radioactive Liquid Effluents Doses

This specification is provided to implement the requirements of Sections II.A, III.A, and IV.A of Appendix I, 10 CFR 50. The specification implements the guides set forth in Section II.A of Appendix I. The Action statements provide the required operating flexibility and at the same time implement the guides set forth in Section III.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable". The dose calculations in the ODCM implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I is to be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in the ODCM for calculating the doses due to the actual release rates of radioactive materials in liquid effluents are consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR 50, Appendix I, Revision 1, October 1977, and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

Section IV.D.2.a. – Radioactive Gaseous Effluents Dose Rate

This specification is provided to ensure that the dose rate at anytime from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR 20 for all areas offsite. The annual dose limits are the doses associated with the concentrations of 10 CFR 20, Appendix B, Table 2. These limits provide reasonable assurance that radioactive material discharged in gaseous effluents will not result in the exposure of an individual offsite to annual average concentrations exceeding the limits specified in Appendix B, Table 2 of 10 CFR 20. For individuals who may, at times, be within the site boundary, the occupancy of that individual will be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the site boundary. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the site boundary to less than or equal to 500 mrem/year to the total body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid or any other organ dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.



MP-22-REC-BAP01

Rev. 026-00

137 of 165

SECTION V.

Millstone Unit 3

Radiological Effluent Controls

Docket Nos. 50-423

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

138 of 165

## SECTION V. REMODCM UNIT THREE CONTROLS

### V.A. Introduction

The purpose of this section is to provide the following for Millstone Unit Three:

- a. the effluent radiation monitor controls and surveillance requirements,
- b. the effluent radioactivity concentration and dose controls and surveillance requirements, and
- c. the bases for the controls and surveillance requirements.

Definitions of certain terms are provided as an aid for implementation of the controls and requirements.

Some surveillance requirements refer to specific sub-sections in Sections I and II as part of their required actions.

### V.B. Definitions and Applicability and Surveillance Requirements

#### V.B.1 – Definitions

The defined terms of this sub-section appear in capitalized type and are applicable throughout Section V.

1. **ACTION – ACTION** shall be that part of the control which prescribes remedial measures required under designated conditions.
2. **CHANNEL OPERATIONAL TEST – A CHANNEL OPERATIONAL TEST** shall be the injection of a simulated signal into the channel as close to the sensor as practicable to verify **OPERABILITY** of alarm, interlock and/or trip functions. For digital instruments, the computer database may be manipulated, in lieu of a signal injection, to verify operability of alarm and/or trip functions.

The **CHANNEL OPERATIONAL TEST** shall include adjustments, as necessary, of the alarm, interlock and/or trip setpoints such that the setpoints are within the required range and accuracy.

3. **CHANNEL CALIBRATION** – A **CHANNEL CALIBRATION** shall be the adjustment, as necessary, of the channel such that it responds within the required range and accuracy to known values of input. The **CHANNEL CALIBRATION** shall encompass the entire channel including the sensors and alarm, interlock and/or trip functions and may be performed by any series of sequential, overlapping, or total channel steps such that the entire channel is calibrated.
4. **CHANNEL CHECK** – A **CHANNEL CHECK** shall be the qualitative assessment of channel behavior during operation by observation. This determination shall include, where possible, comparison of the channel indication and/or status with other indications and/or status derived from independent instrument channels measuring the same parameter.
5. **DOSE EQUIVALENT I-131** – **DOSE EQUIVALENT I-131** shall be that concentration of I-131 ( $\mu\text{Ci}/\text{gram}$ ) which alone would produce the same CDE – thyroid dose as the quantity and isotopic mixture of I-131, I-132, I-133, I-134, and I-135 actually present. The thyroid dose conversion factors used for this calculation shall be those listed under Inhalation in Federal Guidance Report No. 11 (FGR 11), "Limiting Values of Radionuclide Intake and Air Concentration and Dose Conversion Factors for Inhalation, Submersion and Ingestion."
6. **MEMBER(S) OF THE PUBLIC** – **MEMBER(S) OF THE PUBLIC** shall include all persons who are not occupationally associated with the plant. This category does not include employees of the licensee, its contractors or its vendors. Also excluded from this category are persons who enter the site to service equipment or to make deliveries. This category does include persons who use portions of the site for recreational, occupational, or other purposes not associated with the plant.  
  
The term "REAL MEMBER OF THE PUBLIC" means an individual who is exposed to existing dose pathways at one particular location.
7. **MODE** – Refers to Mode of Operation as defined in Safety Technical Specifications.
8. **OPERABLE – OPERABILITY** – An instrument shall be **OPERABLE** or have **OPERABILITY** when it is capable of performing its specified functions(s) and when all necessary attendant instrumentation, controls, electrical power, or other auxiliary equipment that are required for the instrument to perform its functions(s) are also capable of performing their related support function(s).
9. **SITE BOUNDARY** – The **SITE BOUNDARY** shall be that line beyond which the land is not owned, leased, or otherwise controlled by the licensee.



10. SOURCE CHECK – A SOURCE CHECK shall be the qualitative assessment of channel response when the channel sensor is exposed to radiation.
11. UNRESTRICTED AREA – Any area at or beyond the SITE BOUNDARY to which access is not controlled by the licensee for purposes of protection of individuals from exposure to radiation and radioactive materials or any area within the SITE BOUNDARY used for residential quarters or industrial, commercial, institutional and/or recreational purposes.

VB.2 – Applicability

VB.2.a – LIMITING CONDITIONS FOR OPERATION

1. Compliance with the Limiting Conditions for Operation contained in the succeeding specifications is required during the OPERATIONAL MODES or other conditions specified therein; except that upon failure to meet the Limiting Conditions for Operation, the associated ACTION requirements shall be met.
2. Noncompliance with a specification shall exist when the requirements of the Limiting Condition for Operation and associated ACTION requirements are not met within the specified time intervals. If the Limiting Condition for Operation is restored prior to expiration of the specified time intervals, completion of the ACTION requirements is not required.

VB.2.b – SURVEILLANCE REQUIREMENTS

1. Surveillance Requirements shall be applicable during any condition specified for individual Limiting Conditions for Operation unless otherwise stated in an individual Surveillance Requirement.
2. Each Surveillance Requirement shall be performed within the specified time interval with a maximum allowable extension not to exceed 25% of the surveillance time interval.
3. Failure to perform a Surveillance Requirement within the allowed surveillance interval, defined by Condition VB.2.b(2), shall constitute a failure to meet the OPERABILITY requirements for a Limiting Condition for Operation. The time limits of the ACTION requirements are applicable at the time it is identified that a Surveillance Requirement has not been performed. The ACTION requirements may be delayed for up to 24 hours to permit the completion of the surveillance when the allowable outage time limits of the ACTION requirements are less than 24 hours. Surveillance Requirements do not have to be performed on inoperable equipment.



4. Entry into any specified condition shall not be made unless the Surveillance Requirement(s) associated with the Limiting Condition for Operation have been performed within the stated surveillance interval or as otherwise specified.

#### V.C. Radioactive Effluent Monitoring Instrumentation

1. Radioactive Liquid Effluent Monitoring Instrumentation

##### LIMITING CONDITIONS OF OPERATION

The radioactive liquid effluent monitoring instrumentation channels shown in Table V.C.-1 shall be OPERABLE with their Alarm/Trip setpoints set to ensure that the limits of Specification V.D.1.a are not exceeded. The alarm/trip setpoints shall be determined in accordance with methodology and parameters as described in Section II.

APPLICABILITY: As shown in Table V.C.-1

##### ACTION:

- a. With a radioactive liquid effluent monitoring instrumentation channel Alarm/Trip setpoint less conservative than required by the above specification, without delay suspend the release of radioactive liquid effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With less than the minimum number of radioactive liquid effluent monitoring instrumentation channels OPERABLE, take the action shown in Table V.C.-1. Exert best efforts to restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner. Releases need not be terminated after 30 days provided the specified actions are continued.

##### SURVEILLANCE REQUIREMENTS

Each radioactive liquid effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL OPERATIONAL TEST at the frequencies shown in Table V.C.-2.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

142 of 165

**TABLE VC.-1  
Radioactive Liquid Effluent Monitoring Instrumentation**

Instrument	Minimum # Operable	Applicability	Action
<b>1. Radioactivity Monitors Providing Alarm and Automatic Termination Of Release</b>			
a. Waste Neutralization Sump Monitor Condensate Polishing Facility	1*	##	D
b. Turbine Building Floor Drains	1	#	B
c. Liquid Waste Monitor	1	#	A
d. RESERVED			
e. Steam Generator Blowdown Monitor	1	###	B
<b>2. Flow Rate Measurement Devices – No Alarm Setpoint Requirements</b>			
a. Waste Neutralization Sump Effluents	1*	#	C
b. RESERVED			
c. Liquid Waste Effluent Line	1	#	C
d. RESERVED			
e. Steam Generator Blowdown Effluent Line	1	#	C

\* NA if tritium in the steam generators is less than detectable; or gamma radioactivity in the steam generators is less than  $5 \times 10^{-7}$   $\mu\text{Ci/ml}$ , or the sump is being directed to radwaste.

# At all times – which means that channels shall be OPERABLE and in service on a continuous, uninterrupted basis, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.

## MODEs 1–5, and MODE 6 when pathway is being used, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument. The monitor must be on-line with no unexpected alarms. When the affected discharge path is isolated in MODE 6, the applicable LCO and Surveillance Requirements are not applicable.

### MODEs 1–5, except that outages are permitted, for a maximum of 12 hours, for the purpose of maintenance and performance of required test, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument. The monitor must be on-line with no unexpected alarms.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

143 of 165

## SECTION VI. Summary of Changes

### 1.1 Revision 025-02

- 1.1.1 Created Summary of Changes Section.
- 1.1.2 Corrected Table I.D-3 Title to Unit 3 from Unit 2.
- 1.1.3 Re-numbered Table I.E-1 and changed number of locations from 3 to 2 under Well Water.
- 1.1.4 Changed referenced document V.B.1 definition 5. DOSE EQUIVALENT I-131 to Federal Guidance Report No. 11 (FGR 11), "Limiting Values of Radionuclide Intake and Air Concentration and Dose Conversion Factors for Inhalation, Submersion and Ingestion".

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

144 of 165

**TABLE V.C.-1**  
**ACTION STATEMENTS**

Action A

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that prior to initiating a release:

1. At least two independent samples are analyzed in accordance with the first Surveillance Requirement of Specification V.D.1.a. and;
2. The original release rate calculations and discharge line valving are independently verified by a second individual.

Action B

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided best efforts are made to repair the instrument and that grab samples are analyzed for gamma radioactivity at the lower limits of detection specified in Table I.C.-3:

1. At least once per 12 hours when the specific activity of the secondary coolant is greater than 0.01  $\mu\text{Ci}/\text{gram}$  DOSE EQUIVALENT I-131, or
2. At least once per 24 hours when the specific activity of the secondary coolant is less than or equal to 0.01  $\mu\text{Ci}/\text{gram}$  DOSE EQUIVALENT I-131.

Action C

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that the flow rate is estimated at least once per 4 hours during actual releases. Pump performance curves may be used to estimate flow.

Action D

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirements, effluent releases may continue provided that best efforts are made to repair the instrument and that prior to initiating a release:

1. At least two independent samples are analyzed in accordance with the first Surveillance Requirement of Specification V.D.1.a., and;
2. If one of the samples has gamma radioactivity greater than any of the lower limits of detection specified in Table I.C.-3, the original release rate calculations and discharge valving are independently verified by a second individual.



TABLE V.C.-2 Radioactive Liquid Effluent Monitoring Instrumentation Surveillance Requirements				
Instrument	Channel Check	Source Check	Channel Calibration	Channel Functional Test
1. Radioactivity Monitors Providing Alarm and Automatic Termination Of Release				
a. Waste Neutralization Sump Monitor Condensate Polishing Facility	D	P	R <sup>(2)</sup>	Q <sup>(1)</sup>
b. Turbine Building Floor Drains	D	M	R <sup>(2)</sup>	Q <sup>(1)</sup>
c. Liquid Waste Monitor	D	P	R <sup>(2)</sup>	Q <sup>(1)</sup>
d. Deleted				
e. Steam Generator Blowdown Monitor	D	M	R <sup>(2)</sup>	Q <sup>(1)</sup>
2. Flow Rate Measurements				
a. Waste Neutralization Sump Effluents	D <sup>(3)</sup>	NA	R	Q
b. RESERVED				
c. Liquid Waste Effluent Line	D <sup>(3)</sup>	N/A	R	Q
d. Deleted				
e. Steam Generator Blowdown Effluent Line	D <sup>(3)</sup>	N/A	R	Q

D = Daily  
 M = Monthly  
 P = Prior to each batch release  
 R = Once every 18 months  
 Q = Once every 3 months  
 N/A = Not Applicable

**TABLE V.C.-2**  
**TABLE NOTATION**

- (1) The CHANNEL OPERATIONAL TEST shall also demonstrate that automatic isolation of this pathway and control room alarm annunciation occur if any of the following conditions exists:
  - a) Instrument indicates measured levels above the alarm/trip setpoint, or
  - b) Circuit failure (Alarm only), or Instrument indicates a downscale failure (Alarm only).
- (2) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities of NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (3) CHANNEL CHECK shall consist of verifying indication of flow during periods of release. CHANNEL CHECK shall be made at least once per 24 hours on days on which continuous, periodic, or batch releases are made.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

146 of 165

## 2. Radioactive Gaseous Effluent Monitoring Instrumentation

### LIMITING CONDITIONS OF OPERATION

The radioactive gaseous effluent monitoring instrumentation channels shown in Table V.C.-3 shall be OPERABLE with their Alarm/Trip Setpoints set to ensure that the limits of Specification V.D.2.a. are not exceeded. The Alarm/Trip Setpoints of these channels shall be determined in accordance with the methodology and parameters in Section II.

APPLICABILITY: As shown in Table V.C.-3.

### ACTION:

- a. With a radioactive gaseous effluent monitoring instrumentation channel Alarm/Trip Setpoint less conservative than required by the above specification, without delay suspend the release of radioactive gaseous effluents monitored by the affected channel, or declare the channel inoperable, or change the setpoint so it is acceptably conservative.
- b. With the number of OPERABLE radioactive gaseous effluent monitoring instrumentation channels less than the Minimum Channels OPERABLE, take the ACTION shown in Table V.C.-3. Exert best efforts to restore the inoperable instrumentation to OPERABLE status within 30 days and, if unsuccessful, explain in the next Radioactive Effluent Release Report why the inoperability was not corrected in a timely manner. Release need not be terminated after 30 days provided the specified actions are continued.

### SURVEILLANCE REQUIREMENT

Each radioactive gaseous effluent monitoring instrumentation channel shall be demonstrated OPERABLE by performance of the CHANNEL CHECK, SOURCE CHECK, CHANNEL CALIBRATION, and CHANNEL OPERATIONAL TEST at the frequencies shown in Table V.C.-4:

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

147 of 165

TABLE V.C.-3 Radioactive Gaseous Effluent Monitoring Instrumentation			
Instrument	Minimum Channels Operable	Applicability	Action
1. Millstone Unit 3 Ventilation Vent (Turbine Building - HVR-RE10B, normal range only; high range monitor, HVR-RE10A, requirements are in the TRM)			
a. Noble Gas Activity Monitor Providing Alarm	1	*	A
b. Iodine Sampler	1	*	B
c. Particulate Sampler	1	*	B
d. Vent Flow Rate Monitor	1	*	C
e. Sampler Flow Rate Monitor	1	*	C
2. Millstone Stack -- applicable to SLCRS (HVR-RE19B, normal range only; high range monitor, HVR-RE19A, requirements are in the TRM)			
a. Noble Gas Activity Monitor Providing Alarm	1	*	A
b. Iodine Sampler	1	*	B
c. Particulate Sampler	1	*	B
d. Process Flow Rate Monitor	1	*	C
e. Sampler Flow Rate Monitor	1	*	C
3. Engineered Safeguards Building Monitor (HVQ-RE49)			
a. Noble Gas Activity Monitor	1	*	D
b. Iodine Sampler	1	*	B
c. Particulate Sampler	1	*	B
d. Discharge Flow Rate Monitor	1	*	E
e. Sampler Flow Rate Monitor	1	*	C

TABLE V.C.-3  
Table Notations

- \* Whenever the release path is in service. Outages are permitted for a maximum of 12 hours for the purpose of maintenance and performance of required tests, checks, calibrations, or sampling associated with the instrument or any system or component which affects functioning of the instrument.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

148 of 165

**TABLE V.C.-3**  
**ACTION STATEMENTS**

**Action A**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that

- a) best efforts are made to repair the instrument and that grab samples are taken at least once per 12 hours and these samples are analyzed for radioactivity within 24 hours, OR
- b) if the cause of the inoperability is solely due to a loss of annunciation in the control room and the Remote Indicating Controller (RIC) remains OPERABLE, perform a channel check at the RIC at least once per twelve hours and verify the indication has not alarmed.

**Action B**

With the number of samplers OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that the best efforts are made to repair the instrument and that samples are continuously collected with auxiliary sampling equipment for periods of seven (7) days and analyzed for principal gamma emitters with half lives greater than 8 days within 48 hours after the end of the sampling period. Auxiliary sampling must be initiated within 12 hours after initiation of this ACTION statement. Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours. Auxiliary sampling outages are permitted for a maximum of 12 hours for the purpose of maintenance and performance of required tests, checks, calibrations, or sampling.

**Action C**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that the flow rate is estimated at least once per 5 hours. Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use.

**Action D**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument and that grab samples are taken at least once per 12 hours and these samples are analyzed for radioactivity within 24 hours.

**Action E**

With the number of channels OPERABLE less than required by the Minimum Channels OPERABLE requirement, effluent releases via this pathway may continue provided that best efforts are made to repair the instrument.

**TABLE V.C.-4  
Radioactive Gaseous Effluent Monitoring Instrumentation Surveillance Requirements**

Instrument	Check	Source-Check	Channel Calibration	Channel Operational Check	When Surveillance is Required
<b>1. Millstone Unit 3 Ventilation Vent (Turbine Building - HVR-RE10B, normal range only; high range monitor, HVR-RE10A, requirements are in the TRM)</b>					
a. Noble Gas Activity Monitor Providing Alarm	D	M	R <sup>(1)</sup>	Q <sup>(2)</sup>	*
b. Iodine Sampler	W	NA	NA	NA	*
c. Particulate Sampler	W	NA	NA	NA	*
d. Vent Flow Rate Monitor	D	NA	R	Q	*
e. Sampler Flow Rate Monitor	D	NA	R	Q	*
<b>2. Millstone Stack - applicable to SLCRS (HVR-RE19B, normal range only; high range monitor, HVR-RE19A, requirements are in the TRM)</b>					
a. Noble Gas Activity Monitor Providing Alarm	D	M	R <sup>(3)</sup>	Q <sup>(2)</sup>	*
b. Iodine Sampler	W	NA	NA	NA	*
c. Particulate Sampler	W	NA	NA	NA	*
d. Process Flow Rate Monitor	D	NA	R	Q	*
e. Sampler Flow Rate Monitor	D	NA	R	Q	*
<b>3. Engineered Safeguards Building Monitor (HVQ-RE49)</b>					
a. Noble Gas Activity Monitor Providing Alarm	D	M	R <sup>(1)</sup>	Q <sup>(2)</sup>	*
b. Iodine Sampler	W	NA	NA	NA	*
c. Particulate Sampler	W	NA	NA	NA	*
d. Discharge Flow Rate Monitor	D	NA	R	Q	*
e. Sampler Flow Rate Monitor	D	NA	R	Q	*

\* At all times except when the vent path is isolated.

D = Daily  
W = Weekly  
M = Monthly

R = Once every 18 months  
Q = Once every 3 months  
N/A = Not Applicable

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

150 of 165

**TABLE V.C.-4**  
**Table Notations**

- (1) The initial CHANNEL CALIBRATION shall be performed using one or more of the reference standards certified by the National Institute of Standards and Technology (NIST) or using standards that have been obtained from suppliers that participate in measurement assurance activities of NIST. These standards shall permit calibrating the system over its intended range of energy and measurement range. For subsequent CHANNEL CALIBRATION, sources that have been related to the initial calibration shall be used.
- (2) The CHANNEL OPERATIONAL TEST shall also demonstrate that control room alarm annunciation occurs if any of the following conditions exist:
  - a) Instrument indicates measured levels above the Alarm Setpoint, or
  - b) Circuit failure, or
  - c) Instrument indicates a downscale failure.
- (3) The CHANNEL CALIBRATION shall include the use of a known source whose strength is determined by a detector which has been calibrated to an NIST source. These sources shall be in known, reproducible geometry.



## V.D. Radioactive Effluents Concentrations And Dose Limitations

### 1. Radioactive Liquid Effluents

#### a. Radioactive Liquid Effluents Concentrations

##### LIMITING CONDITIONS OF OPERATION

The concentration of radioactive material released from the site (see Figure V.D.-1) shall be limited to ten times the concentrations specified in 10 CFR 20, Appendix B, Table 2, Column 2 for radionuclides other than dissolved or entrained noble gases. For dissolved or entrained noble gases, the concentration shall not exceed  $2 \times 10^{-4}$   $\mu\text{Ci/ml}$  total activity.

APPLICABILITY: At all times.

##### ACTION:

With the concentration of radioactive material released from the site exceeding the above limits, restore the concentration to within the above limits within 15 minutes.

##### SURVEILLANCE REQUIREMENTS

- 1) Radioactive liquid wastes shall be sampled and analyzed according to the sampling and analysis program specified in Section I.
- 2) The results of the radioactive analysis shall be used in accordance with the methods of Section II to assure that the concentrations at the point of release are maintained within the limits of Specification V.D.1.a.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

152 of 165

b. Radioactive Liquid Effluents Doses

LIMITING CONDITIONS OF OPERATION

The dose or dose commitment to any REAL MEMBER OF THE PUBLIC from radioactive materials in liquid effluents from Unit 3 released from the site (see Figure V.D. - 1) shall be limited:

- a. During any calendar quarter to less than or equal to 1.5 mrem to the total body and to less than or equal to 5 mrem to any organ; and,
- b. During any calendar year to less than or equal to 3 mrem to the total body and to less than or equal to 10 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated dose from the release of radioactive materials in liquid effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive materials in liquid effluents during the remainder of the current calendar quarter and the remainder of the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 3 mrem to the whole body and 10 mrem to any organ.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations. Cumulative dose contributions from liquid effluents for the current calendar quarter and the current calendar year shall be determined in accordance with the methodology and parameters in Section II at least once per 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.



## 2. Radioactive Gaseous Effluents

### a. Radioactive Gaseous Effluents Dose Rate

#### LIMITING CONDITIONS OF OPERATION

The dose rate, at any time, offsite (see Figure V.D. - 1) due to radioactive materials released in gaseous effluents from the site shall be limited to the following values:

- a. The dose rate limit for noble gases shall be less than or equal to 500 mrem/yr to the total body and less than or equal to 3000 mrem/yr to the skin; and,
- b. The dose rate limit due to inhalation for Iodine-131, Iodine-133, Tritium, and for all radioactive materials in particulate form with half lives greater than 8 days shall be less than or equal to 1500 mrem/yr to any organ.

APPLICABILITY: At all times.

#### ACTION:

With the dose rate(s) exceeding the above limits, decrease the release rate to comply with the limit(s) given in Specification V.D.2.a. within 15 minutes.

#### SURVEILLANCE REQUIREMENTS

- 1) The release rate, at any time, of noble gases in gaseous effluents shall be controlled by the offsite dose rate as established in Specification V.D.2.a. The corresponding release rate shall be determined in accordance with the methodology of Section II.
- 2) The noble gas effluent monitors of Table V.C. - 3 shall be used to control release rates to limit offsite doses within the values established in Specification V.D.2.a.
- 3) The release rate of radioactive materials in gaseous effluents shall be determined by obtaining representative samples and performing analyses in accordance with the sampling and analysis program, specified in Section I. The corresponding dose rate shall be determined using the methodology given in Section II.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

154 of 165

b. Radioactive Gaseous Effluents Noble Gas Dose

LIMITING CONDITIONS OF OPERATION

The air dose offsite (see Figure V.D. -1) due to noble gases released from Unit 3 in gaseous effluents shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 5 mrad for gamma radiation and less than or equal to 10 mrad for beta radiation, and
- b. During any calendar year: Less than or equal to 10 mrad for gamma radiation and less than or equal to 20 mrad for beta radiation.

APPLICABILITY: At all times.

ACTION:

- a. With the calculated air dose from radioactive noble gases in gaseous effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit(s) and defines the corrective actions to be taken to reduce the releases of radioactive noble gases in gaseous effluents during the remainder of the current calendar quarter and during the remainder of the calendar year so that the cumulative dose during the calendar year is within 10 mrad for gamma radiation and 20 mrad for beta radiation.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.



- c. Gaseous Effluents – Doses from Radionuclides Other than Noble Gas

LIMITING CONDITIONS OF OPERATION

The dose to any REAL MEMBER OF THE PUBLIC from Iodine-131, Iodine-133, Tritium, and radioactive materials in particulate form with half lives greater than 8 days in gaseous effluents released offsite from Unit 3 released offsite (see Figure V.D.-1) shall be limited to the following:

- a. During any calendar quarter: Less than or equal to 7.5 mrem to any organ and,
- b. During any calendar year: Less than or equal to 15 mrem to any organ.

APPLICABILITY: At all times.

ACTION:

- c. With the calculated dose from the release of radioiodines, radioactive materials in particulate form, or radionuclides other than noble gases in gaseous effluents exceeding any of the above limits prepare and submit to the Commission within 30 days a Special Report which identifies the cause(s) for exceeding the limit and defines the corrective actions to be taken to reduce the releases during the remainder of the current calendar quarter and during the remainder of the calendar year so that the cumulative dose or dose commitment to any REAL MEMBER OF THE PUBLIC from such releases during the calendar year is within 15 mrem to any organ.

SURVEILLANCE REQUIREMENTS

- 1) Dose Calculations – Cumulative dose contributions for the current calendar quarter and current calendar year shall be determined in accordance with Section II once every 31 days.
- 2) Relative accuracy or conservatism of the calculations shall be confirmed by performance of the Radiological Environmental Monitoring Program as detailed in Section I.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

156 of 165



**V.E. Total Radiological Dose From Station Operations**

**CONTROLS**

---

The annual dose or dose commitment to any REAL MEMBER OF THE PUBLIC, beyond the site boundary, from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except the thyroid, which is limited to less than or equal to 75 mrem).

**APPLICABILITY:** At all times.

**ACTION:**

With the calculated dose from the release of radioactive materials in liquid or gaseous effluents exceeding twice the limits of Controls V.D.1.b., V.D.2.b., or V.D.2.c. prepare and submit a Special Report to the Commission within 30 days and limit the subsequent releases such that the dose commitment from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site is limited to less than or equal to 25 mrem to the total body or any organ (except thyroid, which is limited to less than or equal to 75 mrem) over consecutive months. This Special Report shall include an analysis which demonstrates that radiation exposures from the site to any REAL MEMBER OF THE PUBLIC from the Millstone Site (including all effluent pathways and direct radiation) are less than the 40 CFR 190 Standard.

If the estimated doses exceed the above limits, the Special Report shall include a request for a variance in accordance with the provisions of 40 CFR 190. Submittal of the report is considered a timely request, and a variance is granted until staff action on the request is complete.

**SURVEILLANCE REQUIREMENTS**

---

Cumulative dose contributions from liquid and gaseous effluents and direct radiation from the Millstone Site shall be determined in accordance with Section II once per 31 days.

**V.F. Bases**

**Section V.C.1. - Radioactive Liquid Effluent Monitoring Instrumentation**

The radioactive liquid effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in liquid effluents during actual or potential releases of liquid effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in Section II to ensure that the alarm/trip will occur prior to exceeding ten times the limits of 10 CFR 20. The OPERABILITY and

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

158 of 165

use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 20 Part 50.

OPERABILITY of a radiation monitor is determined by its ability to perform its specified function. The specified function of the radioactivity monitors listed in Table V.C.-1 is to provide Control Room alarm annunciation and automatic termination of release. The monitor must be on-line with no unexpected alarms in order to perform its specified function.

Definition B.7 states a component is OPERABLE when it is capable of performing its specified function. The monitors are described in Tables V.C.-1 and V.C.-2 as "Radioactivity Monitors Providing Alarm and Automatic Termination of Releases." Table V.C.-2 Note 1 requires that the Analog Channel Operational Test (ACOT) demonstrate that automatic isolation and "control room annunciation" occur. Control room annunciation cannot occur unless the monitor is on line (i.e. in communication with the RMS computer.). Section V.C.1. Surveillance Requirement requires that the ACOT be performed to demonstrate OPERABILITY. General Design Criteria 64 states in part: "Means shall be provided for monitoring effluent discharge paths for radioactivity." Regulatory Guide 1.21 Appendix A describes a monitor program that is acceptable to the Regulatory staff. Under Section B of Appendix A, "LIQUID EFFLUENTS," the first paragraph states in part: "During the release of radioactive wastes, the effluent control monitor should be set to alarm and to initiate automatic closure..."

Certain of the monitors listed in Table V.C.-1 are designed to operate without sample pumps. These monitors utilize pressure in the effluent line during discharge to provide sample flow and sample pressure. Low sample flow and/or low sample pressure alarms may be received when no discharge is in progress. These are expected alarms. Sample flow and/or sample pressure will return to normal when the discharge is initiated. These alarms will clear when discharge begins. The monitors are OPERABLE since they are able to perform their specified function with the expected alarms in.

Table V.C.-1 note ## requires entry into the radioactive liquid effluent monitoring action statements whenever the radiation monitors are not available in the required MODE. This note applies to items 1.a (3CND-RE07, Waste Neutralization Sump), 1.d (3LWC-RE65, Regenerate Evaporator Monitor), and 1.e (3SSR-RE08, Steam Generator Blowdown Monitor) in Table V.C.-1. The original issue of this requirement (as a Technical Specification) in January 1986 stated the applicability was "At all times." Technical Specification Amendment 22 added "APPLICABILITY" to Table V.C.-1 (then Tech Spec Table 3.3-). The applicability added in Amendment 22 is the present wording. The letter 1312821,

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

159 of 165

dated February 24, 1988, in the following sections discusses the change request and are quoted below:

- In "Discussion": "The proposed changes will now explicitly allow a monitor to be taken out of service for up to hours for maintenance/testing without entering the ACTION statement."
- In "Significant Hazards Consideration" item 1: "the proposed changes would only allow these radiation monitors to be out of service for a short period of time (12 hours)."
- In "Significant Hazards Consideration" item 2: "The proposed changes also have no effect on alarm setpoints or control functions. Further, no operator actions that are required to mitigate any accident rely solely on these monitors, and these monitors provide no protective functions."

Technical Specification Amendment 22 provided for the following:

- allowance for planned inoperability of monitoring instrumentation for up to hours for the purpose of maintenance and performance of required test, check, calibration or sampling
- a requirement to initiate auxiliary sampling within hours after inoperability of certain gaseous effluent monitors
- allowance for inoperability of certain effluent monitoring instrumentation, during MODE 6 (refueling) when the effluent pathway is not being used.

#### Section V.C.2. – Radioactive Gaseous Effluent Monitoring Instrumentation

The radioactive gaseous effluent instrumentation is provided to monitor and control, as applicable, the releases of radioactive materials in gaseous effluents during actual or potential releases of gaseous effluents. The Alarm/Trip Setpoints for these instruments shall be calculated and adjusted in accordance with the methodology and parameters in Section II to ensure that the alarm/trip will occur prior to exceeding the limits of Section V.D.2.a. The OPERABILITY and use of this instrumentation is consistent with the requirements of General Design Criteria 60, 63, and 64 of Appendix A to 10 CFR 20 Part 50.

The sensitivity of any noble gas activity monitors used to show compliance with the gaseous effluent release requirements of Specification V.C.2.a shall be such that concentrations as low as  $1 \times 10^{-6}$   $\mu\text{Ci/cc}$  are measurable.

The vent normal range radiation monitor, HVR\*10B, satisfies the requirements of Section V.C.2. for Unit 3 releases to the vent which is located on the turbine

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

160 of 165

building. There are no requirements in the REMODCM associated with the vent high range radiation monitor, HVR\*10A.

The SLCRS normal range radiation monitor, HVR\*19B, satisfies the requirements of Section V.C.2. for Unit 3 releases to the Millstone Stack. There are no requirements in the REMODCM associated with the SLCRS high range radiation monitor, HVR\*19A.

Section V.D.1.a. – Radioactive Liquid Effluents Concentrations

This specification is provided to ensure that the concentration of radioactive materials released in liquid waste effluents from the site will be less than ten times the concentration levels specified in 10 CFR Part 20, Appendix B, Table 2. This limitation provides additional assurance that the levels of radioactive materials in bodies of water outside the site will result in exposures within: (1) the Section II.A design objectives of Appendix I, 10 CFR Part 50, to an individual and (2) the limits of 10 CFR 20.1301 to the population. The concentration limit for noble gases is based upon the assumption that Xe-135 is the controlling radioisotope and its concentrations in air (submersion) was converted to an equivalent concentration in water using the methods described in International Commission on Radiological Protection (ICRP) Publication 2.

Section V.D.1.b. – Radioactive Liquid Effluents Doses

This specification is provided to implement the requirements of Sections II.A., III.A., and IV.A. of Appendix I, 10 CFR Part 50. The specification implements the guides set forth in Section II.A of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section III.A of Appendix I to assure that the releases of radioactive material in liquid effluents will be kept "as low as is reasonably achievable." The dose calculation methodology and parameters in Section II implement the requirements in Section III.A of Appendix I that conformance with the guides of Appendix I is to be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The equations specified in Section II for calculating the doses due to the actual release rates of radioactive materials in liquid effluents will be consistent with the methodology provided in Regulatory Guide 1.109, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, Revision 1, October 1977, and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I," April 1977.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

161 of 165

#### Section V.D.2.a. – Radioactive Gaseous Effluents Dose Rate

This specification will ensure that the dose from gaseous effluents from all units on the site will be within the annual dose limits of 10 CFR Part 20 for all areas offsite. The annual dose limits specified in this section are the dose limits from the version of 10 CFR Part 20 prior to 1994. Annual dose limit in the current version of 10CFR20 were reduced from 500 to 100 mrem. But REMODCM restrictions will not allow the current annual dose limit to be exceeded because the REMODCM requires termination, within fifteen minutes, of any release which exceed the setpoint and much lower annual dose limits from 10CFR50, Appendix I are implemented. For individuals who may, at times, be within the SITE BOUNDARY, the occupancy of that individual will be usually be sufficiently low to compensate for any increase in the atmospheric diffusion factor above that for the SITE BOUNDARY. The specified release rate limits restrict, at all times, the corresponding gamma and beta dose rates above background to an individual at or beyond the SITE BOUNDARY to less than or equal to 500 mrem/year to the whole body or to less than or equal to 3000 mrem/year to the skin. These release rate limits also restrict, at all times, the corresponding thyroid or any other organ dose rate above background to a child via the inhalation pathway to less than or equal to 1500 mrem/year.

#### Section V.D.2.b. – Radioactive Gaseous Effluents Noble Gas Dose

This specification is provided to implement the requirements of Sections II.B., III.A., and IV.A. of Appendix I, 10 CFR Part 50. The specification implements the guides set forth in Section II.B of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section V.A. of Appendix I to assure that the releases of radioactive material in gaseous effluents will be kept "as low as is reasonably achievable." The Surveillance Requirements implement the requirements in Section III.A. of Appendix I that conformance with the guides of Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through the appropriate pathways is unlikely to be substantially underestimated. The dose calculations established in Section II for calculating the doses due to the actual release rates of radioactive noble gases in gaseous effluents will be consistent with the methodology provided in Regulatory Guide 1.109, "Calculational of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I," Revision 1, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision 1, July 1977.

The Section II equations provided for determining the air doses at the site boundary are based upon utilizing successively more realistic dose calculational methodologies. More realistic dose calculational methods are used whenever simplified calculations indicate a dose approaching a substantial portion of the

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

162 of 165

regulatory limits. The methods used are, in order, previously determined air dose per released activity ratio, historical meteorological data and actual radionuclide mix released, or real time meteorology and actual radionuclides released.

Section V.D.2.c. – Radioactive Gaseous Effluents for Radionuclides Other Than Noble Gas

These specifications are provided to implement the requirements of Sections II.C., III.A., and IV.A. of Appendix I, 10 CFR Part 50. The specifications are the guides set forth in Section II.C. of Appendix I. The ACTION statements provide the required operating flexibility and at the same time implement the guides set forth in Section IV.A. of Appendix I to assure that the releases of radioactive materials in gaseous effluents will be kept "as low as is reasonably achievable." The Section II calculational methods specified in the surveillance requirements implement the requirements in Section III.A. of Appendix I that conformance with the guides for Appendix I be shown by calculational procedures based on models and data such that the actual exposure of an individual through appropriate pathways is unlikely to be substantially underestimated. The Section II calculational methodology and parameters for calculating the doses due to the actual release rates of the subject materials are consistent with the methodology provided in Regulatory Guide 1.109, "Calculating of Annual Dose to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50; Appendix I," Revision I, October 1977 and Regulatory Guide 1.111, "Methods for Estimating Atmospheric Transport and Dispersion of Gaseous Effluents in Routine Releases from Light-Water-Cooled Reactors," Revision I, July 1977. The release rate specifications for radioiodines, radioactive material in particulate form and radionuclides other than noble gases are dependent on the existing radionuclide pathways to man. The pathways that are examined in the development of these calculations are: 1) individual inhalation of airborne radionuclides, 2) deposition of radionuclides onto green leafy vegetation with subsequent consumption by man, (3) deposition onto grassy areas where milk animals and meat producing animals graze with consumption of the milk and meat by man, and 4) deposition on the ground with subsequent exposure of man.

Section V.E. – Total Radiological Dose from Station Operations

This specification is provided to meet the dose limitations of 40 CFR 190. For the purpose of the Special Report, it may be assumed that the dose commitment to any REAL MEMBER OF THE PUBLIC from other fuel cycle sources is negligible, with the exception that dose contributions from other nuclear fuel cycle facilities at the same site or within a radius of 5 miles must be considered.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

163 of 165

## Summary of Changes

Summary of Changes Rev 026-00

1. Corrected Figure I.C-2, "Simplified Liquid Effluent Flow Diagram Millstone Unit 2"
2. Corrected Figure I.C-3, "Simplified Liquid Effluent Flow Diagram Millstone Unit 3"
3. In Table I.D.-1, "Millstone Unit 1 Radioactive Gaseous Waste Sampling and Analysis Program," under B. Balance of Plant Vent, Minimum Analysis Frequency is changed to Quarterly Composite.
4. Table I.D.-2, "Millstone Unit 2 Radioactive Gaseous Waste Sampling and Analysis Program," under B. Containment & Aux Building Releases, Minimum Analysis Frequency is modified.
5. Table I.D.-3, "Millstone Unit 3 Radioactive Gaseous Waste Sampling and Analysis Program," Section A is modified to include frequency change and other enhancements.
6. Clarifying text is added to Gaseous Radioactive Waste Treatment on page 32.
7. Additional information is added to Figure I.D.-2, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Two."
8. Additional information is added to Figure I.D.-3, "Simplified Gaseous Effluent Flow Diagram Millstone Unit Three."
9. In Section I.E. Radiological Environmental Monitoring, under 1. Sampling and Analysis, the following language is included; "..., prepare and submit to the Commission within 30 days from receipt of sample results, a Special Report which includes...". This is a change from "..., prepare and submit to the Commission within 30 days from the end of the affected calendar quarter, a Special Report which includes...".
10. In Table I.E.-1, "Millstone Radiological Environmental Monitoring Program," the number of locations listed under 7. Well Water is changed from 2 to 6.
11. In table I.E.-2 four new locations are identified.
12. On page 61 under 6. "Quarterly Dose Calculations for Radioactive Effluent Release Report," additional guidance/clarification is added.
13. On page 76 under c. "Unit 3 Projection Method," sections 2, "Due to Steam Generator Blowdown Tank Vent (Unit 3), and section 3) "Due to Ventillation Releases (Unit 3)," are deleted.
14. On page 76 under 5. "Quarterly Dose Calculations for Radioactive Effluent Release Report," additional guidance/clarification is added.

STOP

THINK

ACT

REVIEW

MP-22-REC-BAP01

Rev. 026-00

164 of 165

15. On page 92, under 5. "Unit 2 Vent – Noble Gas Monitor – RM8132B," additional guidance/clarification is added.
16. On page 103 under ACTION STATEMENTS, the following is added to Action B, "Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours."
17. On page 103 under ACTION STATEMENTS, the following is added to Action D, "Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use."
18. On page 107 under SURVEILLANCE REQUIREMENTS, 1) Dose Calculations has the frequency "once every 31 days," added.
19. On page 119, 11. "DOSE EQUIVALENT I-131," has the following text added, "The thyroid dose conversion factors used for this calculation shall be those listed under Inhalation in Federal Guidance Report No. 11 (FGR 11), "Limiting Values of Radionuclide Intake and Air Concentration and Dose Conversion Factors for Inhalation, Submersion and Ingestion."
20. On page 127 under "Action B," the following wording is added; "Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours."
21. On page 127 under "Action C," the following wording is added; "Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use."
22. On page 149 under "Action B," the following wording is added; "Operation of the auxiliary sampling equipment shall be verified every twelve (12) hours."
21. On page 149 under "Action C," the following wording is added; "Sample flow rate need not be estimated if the auxiliary sampling equipment of Action B is in use."

