

Environmental, Inc.
Midwest Laboratory
an Allegheny Technologies Co.

700 Landwehr Road • Northbrook, IL 60062-2310
ph. (847) 564-0700 • fax (847) 564-4517

XCEL ENERGY CORPORATION
MONTICELLO NUCLEAR GENERATING PLANT
DOCKET NO. 50-263 LICENSE NO. DPR-22

ANNUAL REPORT
TO THE
UNITED STATES NUCLEAR REGULATORY COMMISSION

Radiological Environmental Monitoring Program


January 1 to December 31, 2008

Prepared under Contract by

ENVIRONMENTAL, Inc.
Midwest Laboratory

Project No. 8010

Approved:



Bronia Grob, M.S.
Laboratory Manager

PREFACE

The staff of Environmental, Inc., Midwest Laboratory was responsible for the acquisition of data presented in this report. Samples were collected by personnel of the Monticello Nuclear Generating Plant, operated by Northern States Power Co. -Minnesota for XCEL Energy Corporation. This report was prepared by Environmental, Inc., Midwest Laboratory.

TABLE OF CONTENTS

<u>No.</u>		<u>Page</u>
	Preface	ii
	List of Tables	iv
	List of Figures	v
1.0	INTRODUCTION	1
2.0	SUMMARY	2
3.0	RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP)	3
3.1	Program Design and Data Interpretation	3
3.2	Program Description	4
3.3	Program Execution	5
3.4	Laboratory Procedures	6
3.5	Program Modifications	6
3.6	Land Use Census	6
4.0	RESULTS AND DISCUSSION	7
4.1	Atmospheric Nuclear Detonations and Nuclear Accidents	7
4.2	Summary of Preoperational Data	7
4.3	Program Findings	8
5.0	FIGURES AND TABLES	12
6.0	REFERENCES	24

APPENDICES

A	Interlaboratory Comparison Program Results	A-1
B	Data Reporting Conventions	B-1
C	Maximum Permissible Concentrations of Radioactivity in Air and Water Above Natural Background in Unrestricted Area	C-1
D	Sampling Location Maps	D-1

LIST OF TABLES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5.1	Sample Collection and Analysis Program	13
5.2	Sampling Locations	14
5.3	Missed Collections and Analyses	16
5.4	Radiation Environmental Monitoring Program Summary	19

The following tables are in the Appendices:

Appendix A

A-1	Interlaboratory Comparison Program Results	A1-1
A-2	Thermoluminescent dosimeters (TLDs)	A2-1
A-3	In-house Spiked Samples	A3-1
A-4	In-house "Blank" Samples	A4-1
A-5	In-house "Duplicate" Samples	A5-1
A-6	Department of Energy MAPEP comparison results	A6-1
A-7	Environmental Resources Associates, Crosscheck Program Results (EML study replacement)	A7-1
	Attachment A: Acceptance criteria for spiked samples	A2

Appendix C

C-1	Maximum Permissible Concentrations of Radioactivity in air and water above background in unrestricted areas	C-2
-----	--	-----

LIST OF FIGURES

<u>No.</u>	<u>Title</u>	<u>Page</u>
5-1	Offsite Ambient Radiation (TLDs), inner versus outer ring locations.....	17
5-2	Airborne Particulates; analysis for gross beta, average mean of all indicator locations versus control location	18
<u>Appendix D</u>		
D-1	Sample collection and analysis program: TLD locations, Inner Ring	D-2
D-2	Sample collection and analysis program: TLD locations, Outer Ring	D-3
D-3	Sample collection and analysis program: TLD locations, Controls	D-4
D-4	Sample collection and analysis program: Radiation Environmental Monitoring Program, Milk sampling locations	D-5
D-5	Sample collection and analysis program: Radiation Environmental Monitoring Program, Milk, Sludge, Ground water and Shoreline sampling locations	D-6

1.0 INTRODUCTION

This report summarizes and interprets results of the Radiological Environmental Monitoring Program (REMP) conducted by Environmental, Inc., Midwest Laboratory for the Monticello Nuclear Generating Plant, Monticello, Minnesota, during the period January - December, 2008. This Program monitors the levels of radioactivity in the air, terrestrial, and aquatic environments in order to assess the impact of the Plant on its surroundings.

Tabulation of the individual analyses made during the year are not included in this report. These data are included in a reference document (Environmental, Inc., Midwest Laboratory, 2009a) available at the Monticello Nuclear Generating Plant, Chemistry and Radiation Protection Department.

The Monticello Nuclear Generating Plant is a boiling water reactor with a nominal generating capacity of 620 MWe. It is located on the Mississippi River in Wright County, Minnesota, owned by Xcel Energy Corporation and operated by Northern States Power Co.-Minnesota. Initial criticality was achieved on December 10, 1970. Full power was achieved March 5, 1971 and commercial operation began on June 30, 1971.

2.0 SUMMARY

The Radiological Environmental Monitoring Program (REMP) required by the U.S. Nuclear Regulatory Commission (NRC) Technical Specifications and the Offsite Dose Calculation Manual (ODCM) for the Monticello Nuclear Generating Plant is described. Results for the year 2008 are summarized and discussed.

Program findings show background levels of radioactivity in the environmental samples collected in the vicinity of the Monticello Nuclear Generating Plant.

No effect on the environment due to the operation of the Monticello Nuclear Generating Plant is indicated.

3.0 RADIOLOGICAL ENVIRONMENTAL MONITORING PROGRAM (REMP)

3.1 Program Design and Data Interpretation

The purpose of the Radiological Environmental Monitoring Program (REMP) at the Monticello Nuclear Generating Plant is to assess the impact of the Plant on its environment. For this purpose, samples are collected from the air, terrestrial, and aquatic environments and analyzed for radioactive content. In addition, ambient gamma radiation levels are monitored by thermoluminescent dosimeters (TLD's).

Sources of environmental radiation include the following:

- (1) Natural background radiation arising from cosmic rays and primordial radionuclides;
- (2) Fallout from atmospheric nuclear detonations;
- (3) Releases from nuclear power plants;
- (4) Industrial and medical radioactive waste; and
- (5) Fallout from nuclear accidents.

In interpreting the data, effects due to the Plant must be distinguished from those due to other sources.

A major interpretive aid in assessment of these effects is the design of the monitoring program at the Monticello Plant which is based on the indicator-control concept. Most types of samples are collected both at indicator locations (nearby, downwind, or downstream) and at control locations (distant, upwind, or upstream). A plant effect would be indicated if the radiation level at an indicator location was significantly larger than that at the control location. The difference would have to be greater than could be accounted for by typical fluctuations in radiation levels arising from other sources.

An additional interpretive technique involves analyses for specific radionuclides present in environmental samples collected from the Plant site. The Plant's monitoring program includes analyses for tritium and iodine-131. Most samples are also analyzed for gamma-emitting isotopes with results for the following groups quantified: zirconium-95, cesium-137, cerium-144, beryllium-7, and potassium-40. The first three gamma-emitting isotopes were selected as radiological impact indicators because of the different characteristic proportions in which they appear in the fission product mix produced by a nuclear reactor and that produced by a nuclear detonation. Each of the three isotopes is produced in roughly equivalent amounts by a reactor: each constitutes about 10% of the total activity of fission products 10 days after reactor shutdown. On the other hand, 10 days after a nuclear explosion, the contributions of zirconium-95, cerium-144, and cesium-137 to the activity of the resulting debris are in the approximate ratio 4:1:0.03 (Eisenbud, 1963). Beryllium-7 is of cosmogenic origin and potassium-40 is a naturally-occurring isotope. They were chosen as calibration monitors and should not be considered as radiological impact indicators. The other group quantified consists of niobium-95, ruthenium-103 and -106, cesium-134, barium-lanthanum-140, and cerium-141. These isotopes are released in small quantities by nuclear power plants, but to date their major source of injection into the general environment has been atmospheric nuclear testing. Nuclides of the final group, manganese-54, iron-59, cobalt-58 and -60, and zinc-65, are activation products and arise from activation of corrosion products. They are typical components of a nuclear power plant's effluents, but are not produced in significant quantities by nuclear detonations.

Program Design and Data Interpretation (continued)

Other means of distinguishing sources of environmental radiation are employed in interpreting the data. Current radiation levels are compared with previous levels, including those measured before the plant became operational. Results of the Plant's Monitoring Program can be related to those obtained in other parts of the world. Finally, results can be related to events known to cause elevated levels of radiation in the environment, e.g., atmospheric nuclear detonations.

3.2 Program Description

The sampling and analysis schedule for the Radiological Environmental Monitoring Program (REMP) at the Monticello Plant is summarized in Table 5.1 and briefly reviewed below. Table 5.2 defines the sampling location codes used in Table 5.1 and specifies for each location its type (indicator or control) and its distance, direction, and sector relative to the plant site. To assure that sampling is carried out in a reproducible manner, detailed sampling procedures have been prescribed (Monticello Generating Plant REMP Surveillances, Current Revision). Maps of sampling locations are included in Appendix D.

To monitor the air environment, airborne particulates are collected on membrane filters by continuous pumping at five locations. Also, airborne iodine is collected by continuous pumping through charcoal filters at all of these locations. Filters are changed and counted weekly. Particulate filters are analyzed for gross beta activity and charcoal filters for iodine-131. Quarterly composites of particulate filters from each location are determined by gamma spectroscopy. One of the five locations is a control (M-1), and four are indicators (M-2, M-3, M-4, M-5). One of the indicators is located in the geographical sector expected to be most susceptible to any atmospheric emissions from the Plant (highest D/Q sector).

Ambient gamma radiation is monitored at forty locations, using $\text{CaSO}_4:\text{Dy}$ dosimeters with four sensitive areas at each location: fourteen in an inner ring in the general area of the site boundary, sixteen in the outer ring within 4-5 mile radius, six at special interest locations and four control locations, outside a 10 mile radius from the plant. They are replaced and measured quarterly.

Milk samples are collected monthly from two farms (one indicator and one control). Milk is collected biweekly during the growing season (May - October), because the animals may be on pasture. Samples are analyzed for iodine-131 and gamma-emitting isotopes.

Leafy green vegetables (cabbage) are collected annually from the highest D/Q garden and a control location and analyzed for iodine-131. Corn and potatoes are collected annually only if the field is irrigated by water in which liquid radioactive effluent has been discharged. Analysis is for gamma-emitting isotopes.

Ground water is monitored by quarterly collections from three off-site locations (one control and two indicators) and one on-site Plant well. The samples are analyzed for tritium and gamma-emitting isotopes.

Twelve on-site monitoring wells were added to the program and sampled for tritium and gamma isotopic analyses. Four of the wells (M-29 to M-32) are deep water drinking wells and were only sampled until the shallow monitoring wells (M-36 to M-40) could be completed. The four deep drinking wells were not sampled after the first quarter, 2008.

River water is collected weekly at two locations, one upstream of the plant and one downstream. Monthly composites are analyzed for gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

Program Description (continued)

Drinking water is collected weekly from the City of Minneapolis water supply, which is taken from the Mississippi River downstream of the Plant. Monthly composites are analyzed for gross beta, iodine-131, and gamma-emitting isotopes. Quarterly composites are analyzed for tritium.

The aquatic environment is also monitored by semi-annual upstream and downstream collections of fish, invertebrates, and shoreline sediments. Shoreline sediment is also collected semi-annually from one downstream recreational location. All samples are analyzed for gamma-emitting isotopes.

3.3 Program Execution

The Program was executed as described in the preceding section with the following exceptions:

(1) Air Particulates / Air Iodine:

No air particulate / air iodine samples were available from location M-2 for the week ending May 28, 2008. The sampler pump failed, due to an open fuse.

No air particulate / air iodine samples were available from location M-5 for the week ending July 9, 2008. The sample was missed due to air sampler pump head leakage.

(2) Milk:

Milk samples were not available from M-28 (Hoglund Farm) after the April 9, 2008 collection. The herd was sold and the farm has gone out of the dairy business.

(3) Thermoluminescent Dosimeters:

The TLD for location M-01B was missing in the field for the first quarter, 2008.
The TLD for location M-01S was missing in the field for the second quarter, 2008.
The TLD for location M-11A was missing in the field for the fourth quarter, 2008.

(4) Surface Water:

Surface water was not collected at location M-08 for the months of January, February and March, 2008, due to unsafe ice conditions. Three of five weekly collections in December, 2008 could not be collected due to unsafe ice.

(5) Bottom Organisms:

The October, 2008 samples could not be collected at both upstream and downstream locations, due to unsafe river conditions.

Deviations from the program are summarized in Table 5.3.

3.4 Laboratory Procedures

The iodine-131 analyses in milk and drinking water were made using a sensitive radiochemical procedure which involves separation of the iodine using an ion-exchange method and solvent extraction and subsequent beta counting.

Gamma-spectroscopic analyses are performed using high-purity germanium (HPGe) detectors. Levels of iodine-131 in cabbage and natural vegetation and concentrations of airborne iodine-131 in charcoal samples were determined by gamma spectroscopy.

Tritium concentrations are determined by liquid scintillation.

Analytical Procedures used by Environmental, Inc. are on file and are available for inspection. Procedures are based on those prescribed by the Health and Safety Laboratory of the U.S. Dep't of Energy, Edition 28, 1997, U.S. Environmental Protection Agency for Measurement of Radioactivity in Drinking Water, 1980, and the U.S. Environmental Protection Agency, EERF, Radiochemical Procedures Manual, 1984.

Environmental, Inc., Midwest Laboratory has a comprehensive quality control/quality assurance program designed to assure the reliability of data obtained. Details of the QA Program are presented elsewhere (Environmental, Inc., Midwest Laboratory, 2003). The QA Program includes participation in Interlaboratory Comparison (crosscheck) Programs. Results obtained in the crosscheck programs are presented in Appendix A.

3.5 Program Modifications

M-28 (Hoglund Farm) discontinued dairy operations after April, 2008.

In September of 2008, triannual collections of pasture grass and vegetation were added to the program. Samples from locations M-41, M-42 and M-43 (C) were analyzed for iodine-131 and other gamma emitting isotopes, as substitute for dairy sampling.

3.6 Land Use Census

In accordance with the MNGP Chemistry Manual, Procedure I.05.41, "Annual Land Use Census and Critical Receptor Identification", a land use census shall be conducted and shall identify the location of the nearest milk animal, the nearest residence, and the nearest garden of greater than 500 ft² producing fresh leafy vegetables, in each of the 16 meteorological sectors within a distance of 5 miles. The census shall also identify the locations of all milk animals and all 500 ft² or greater gardens producing broad leaf vegetation in each of the meteorological sectors within a distance of three miles. This census shall be conducted at least once per year between the dates of May 1 and October 31. New locations shall be added to the radiation environmental monitoring program within 30 days and sampling locations having lower calculated doses or a lower dose commitment may be deleted from this monitoring program after October 31 of the year in which the land use census was conducted.

The 2008 land use census was conducted between September 15 and September 20, 2008.

There were two sectors (WNW, NW) in which the highest D/Q value increased by greater than 20%. No changes to the sampling procedures are required.

In summary, the highest D/Q locations for nearest resident, garden and nearest milk animal did not change from the 2007 census.

Details of the land use census are contained in the Land Use Census and Critical Receptor Report, Monticello Nuclear Generating Plant, Chemistry and Radiation Protection Department.

4.0 RESULTS AND DISCUSSION

All of the scheduled collections and analyses were made except those listed in Table 5.3.

All results are summarized in Table 5.4 in a format recommended by the Nuclear Regulatory Commission in Regulatory Guide 4.8. For each type of analysis of each sampled medium, this table lists the mean and range for all indicator locations and for all control locations. The locations with the highest mean and range are also shown.

4.1 Atmospheric Nuclear Detonations and Nuclear Accidents

There were no reported accidents at nuclear facilities and no atmospheric nuclear tests conducted in the year 2008. The last reported test was made by the People's Republic of China on October 16, 1980.

4.2 Summary of Preoperational Data

The following constitutes a summary of preoperational studies conducted at the Monticello Nuclear Generating Plant during the years 1968 to 1970, to determine background levels expected in the environment, and provided, where applicable, as a means for comparison with present day levels. Strict comparisons, however, are difficult to make, since background levels of radiation were much higher in these years due to radioactive fallout from the atmosphere. Gross beta measurements in fallout averaged 20,600 pCi/m² in 1969 and 12,000 pCi/m² in 1970. These levels are reflected throughout the various media tested.

In the air environment, ambient gamma radiation (TLDs) averaged 9.1 mRem/4 weeks during preoperational studies (1970). Gross beta in air particulates in 1969 and 1970 averaged 0.20 pCi/m³. Present day levels have stabilized at around 0.025 pCi/m³. Airborne radioiodine remained below detection levels.

In the terrestrial environment of 1968 to 1970, milk, agricultural crops, and soil were monitored. In milk samples, low levels of Cs-137 and Sr-90 were detected. Cs-137 levels averaged 16.7 pCi/L. Soybean crop measurements in 1969 averaged 35.5 pCi/g for gross beta and 0.3 pCi/g for Cs-137. Gross beta measured in soil averaged 51.7 pCi/g. Present day measurements for cesium-137 are below detection levels in milk and agricultural crops.

The aqueous environment was monitored by testing of river water, bottom sediments, fish, aquatic vegetation, and periphyton. Specific location comparison of drinking, river, and well water concentrations for tritium and gross beta are not possible. However, tritium background levels, measured at seven separate locations from 1968 to 1970, averaged 970 pCi/L. Present day environmental samples measure below detection levels. Values for gross beta, measured from 1968 to 1970, averaged 9.8 pCi/L in upstream and downstream Mississippi River water, 4.4 pCi/L for well waters, and 18.6 pCi/L for lake waters. Gamma emitters were below the lower limit of detection (LLD). In shoreline sediments, gross beta background levels in 1970 averaged 49.8 pCi/g for both upstream and downstream samples. Cs-137 activity averaged 0.10 pCi/g for both upstream and downstream samples. Low levels of Cs-137, occasionally observed today can still be attributed to residual activity from atmospheric fallout. Gross beta levels in fish flesh averaged 5.3 pCi/g in 1968 and 1969. Cs-137, measured in 1969 and 1970, averaged 0.044 pCi/g. Gross beta background levels, in 1970, for aquatic vegetation, algae, and periphyton samples measured 86.7 pCi/g, 76.5 pCi/g, and 28.1 pCi/g respectively.

4.3 Program Findings

Results obtained show background levels of radioactivity in the environmental samples collected in the vicinity of the Monticello Nuclear Generating Plant.

Ambient Radiation (TLD's)

Ambient radiation was measured in the general area of the site boundary, at an outer ring 4 - 5 mi. distant from the Plant, at special interest areas and at four control locations. The means were similar for both inner and outer rings (15.2 and 14.6 mRem/91 days, respectively). The mean for special interest locations was 14.3 mRem/91 days and the mean for the control locations was 15.4 mRem/91 days. Dose rates measured at the inner and outer ring locations were similar to those observed from 1993 through 2007 and are tabulated below. No plant effect on ambient gamma radiation is indicated (Figure 5-1).

<u>Year</u>	<u>Inner Ring</u>	<u>Outer Ring</u>
<u>Dose rate (mRem/91 days)</u>		
1993	15.6	15.9
1994	14.6	14.0
1995	14.4	13.6
1996	14.0	13.5
1997	13.3	12.8
1998	15.0	14.4
1999	15.1	14.3
2000	15.1	14.5
2001	14.3	13.7
2002	15.9	14.8
2003	15.6	15.0
2004	16.0	15.4
2005	15.6	15.2
2006	16.5	15.6
2007	16.1	15.1
2008	15.2	14.6

Ambient gamma radiation as measured by thermoluminescent dosimetry.
Average quarterly dose rates, Inner vs. Outer Ring locations

Airborne Particulates

The average annual gross beta concentrations in airborne particulates were almost identical at indicator and control locations (0.028 and 0.029 pCi/m³, respectively) and similar to levels observed from 1993 through 2007. The results are tabulated below.

Year	Indicators	Control
Concentration (pCi/m ³)		
1993	0.024	0.023
1994	0.023	0.024
1995	0.024	0.025
1996	0.023	0.023
1997	0.023	0.023
1998	0.023	0.023
1999	0.023	0.025
2000	0.027	0.026
2001	0.027	0.026
2002	0.028	0.028
2003	0.027	0.027
2004	0.024	0.024
2005	0.025	0.025
2006	0.024	0.025
2007	0.027	0.028
2008	0.028	0.029

Average annual gross beta concentrations in airborne particulates.

Typically, the highest average readings occur during the months of January and December, and the first and fourth quarters, as observed in 1993 through 2008.

Gamma spectroscopic analysis of quarterly composites of air particulate filters yielded similar results for indicator and control locations. Beryllium-7, which is produced continuously in the upper atmosphere by cosmic radiation (Arnold and Al-Salih, 1955) was detected in all samples, with an average activity of 0.075 pCi/m³ for all locations. All other gamma-emitting isotopes were below their respective LLD limits.

Airborne Iodine

Weekly levels of airborne iodine-131 were below the lower limit of detection (LLD) of 0.03 pCi/m³ in all samples.

Milk

Iodine-131 activity measured below the detection limit of 0.5 pCi/L in all samples.

No gamma-emitting isotopes, excepting naturally-occurring potassium-40, were detected. This is consistent with the findings of the National Center for Radiological Health (1968) that most radiocontaminants in feed do not find their way into milk due to the selective metabolism of the cow. Common exceptions are radioisotopes of potassium, cesium, strontium, barium, and iodine.

In summary, the milk data for 2008 show no radiological effects of the plant operation.

Pasture Grass

Three new locations for the sampling of grass and vegetation were established, as substitute for unavailable dairy farms. Pasture grass was collected twice in September, 2008. I-131 concentrations measured below 0.045 pCi/g wet weight in all samples. With the exceptions of naturally-occurring beryllium-7 and potassium-40, no other gamma-emitting isotopes were detected.

River Water and Drinking Water

Tritium activity measured below the LLD of 500 pCi/L in all samples. Gross beta activity in Minneapolis drinking water averaged 2.1 pCi/L and was similar to average levels observed from 1993 through 2007. Gross beta averages are tabulated below.

<u>Year</u>	<u>Gross Beta (pCi/L)</u>		<u>Year</u>	<u>Gross Beta (pCi/L)</u>
1993	2.6		2001	2.5
1994	2.0		2002	2.9
1995	2.3		2003	3.0
1996	2.1		2004	2.7
1997	2.3		2005	2.8
1998	2.4		2006	2.1
1999	2.2		2007	2.8
2000	2.5		2008	2.1

Average annual concentrations; Gross beta in drinking water.

Comparisons with data reported by the USEPA for Minneapolis drinking water samples collected from 1980 through 2005 indicate that concentrations of these nuclides are remaining fairly constant. Gamma-emitting isotopes were below detection limits in all surface water samples. There was no indication of a plant effect.

Well Water

At the four indicator and control locations, tritium measured below the LLD level of 500 pCi/L in all samples. Gamma isotopic results were below detection limits. The data for 2008 were consistent with previous years results and no plant operational effects were indicated.

In one sample, from location M-35, of one hundred monitoring well samples tested, tritium was detected at 520 pCi/L, above the concentration limit level of 500 pCi/L.

No gamma-emitting isotopes attributable to plant operation were detected.

Crops

Cabbage was collected in September from two locations and analyzed for iodine-131. Levels of I-131 measured below 0.018 pCi/g wet weight in both samples. With the exceptions of naturally-occurring beryllium-7 and potassium-40, no other gamma-emitting isotopes were detected.

No crops within five miles of the plant, were found using irrigation water from the Mississippi River. There was no indication of any plant effect.

Fish

Fish samples were collected in May and October. Flesh was separated from the bones and analyzed by gamma spectroscopy. Naturally-occurring potassium-40 was found to be similar in upstream and downstream samples (3.21 and 3.05 pCi/g wet weight, respectively). All gamma-emitting isotopes were below their respective LLD levels. There was no indication of a plant effect.

Invertebrates

Samples were collected in the third quarter of 2008, and analyzed by gamma spectroscopy. All gamma-emitting isotopes were below detection limits. There was no indication of a plant effect.

Shoreline Sediments

Upstream, downstream and downstream recreational area shoreline sediment collections were made in May and October and analyzed for gamma-emitting isotopes. Low levels of cesium-137 were detected in the four downstream samples, averaging, 0.071 pCi/g dry weight, and 0.037 pCi/g dry weight in one of two control samples. Similar levels of activity and distribution have been observed since 1978, and are indicative of the influence of fallout deposition. The only other gamma-emitting isotopes detected were naturally-occurring beryllium-7 and potassium-40. There was no indication of a plant effect.

5.0 FIGURES AND TABLES

Table 5.1. Sample collection and analysis program, Monticello Nuclear Generating Plant.

Medium	Location		Collection Type and Frequency ^b	Analysis Type and Frequency ^c
	No.	Codes (and Type) ^a		
Ambient radiation (TLDs)	40	M-01A - M-14A, M-01B - M-16B M-01S - M-06S, M-01C - M-04C	C/Q	Ambient gamma
Airborne Particulates	5	M-1(C), M-2, M-3, M-4, M-5	C/W	GB, GS (QC of each location)
Airborne Iodine	5	M-1(C), M-2, M-3, M-4, M-5	C/W	I-131
Milk	3	M-10 (C), M-28	G/M ^d	I-131, GS
Pasture grass, Vegetation	3	M-41, M-42, M-43(C)	3x/year	GS
Surface water	2	M-8(C), M-9	G/W	GS(MC), H-3(QC)
Drinking water	1	M-14	G/W	GB(MC), I-131(MC) GS (MC), H-3 (QC)
Well water	4	M-10(C), M-11, M-12, M-27	G/Q	H-3, GS
On-site monitoring wells	12	M-29 - M-40		
Edible cultivated crops -				
Corn ^e	1	M-19	G/A	GS
Leafy Vegetable	2	M-27, St. Cloud Farmer's Mkt. (C)	G/A	I-131
Potatoes ^e	1	M-21	G/A	GS
Fish (one species, edible portion)	2	M-8(C), M-9	G/SA	GS
Periphyton or invertebrates	2	M-8(C), M-9	G/SA	GS
Shoreline sediment	3	M-8(C), M-9, M-15	G/SA	GS

^a Location codes are defined in Table 5.2. Control stations are indicated by (C). All other stations are indicators.

^b Collection type is coded as follows: C/ = continuous, G/ = grab. Collection frequency is coded as follows: W= weekly, M = monthly, Q = quarterly, SA = semiannually, A = annually.

^c Analysis type is coded as follows: GB = gross beta, GS = gamma spectroscopy, H-3 = tritium, I-131 = iodine 131. Analysis frequency is coded as follows: MC = monthly composite, QC = quarterly composite.

^d Milk is collected biweekly during the grazing season (May - October), if milch animals are on pasture.

^e Pasture grass and vegetation collections added to supplement dairy sampling.

^e Collected only if the plant discharges radioactive effluent into the river, then only from river irrigated fields.

Table 5.2. Sampling locations, Monticello Nuclear Generating Plant.

Code	Type ^a	Collection Site	Sample Type ^b	Distance and Direction from Reactor
M-1	C	Air Station M-1	AP, AI	11.0 mi @ 307°/NW
M-2		Air Station M-2	AP, AI	0.8 mi @ 140°/SE
M-3		Air Station M-3	AP, AI	0.6 mi @ 104°/ESE
M-4		Air Station M-4	AP, AI	0.8 mi @ 147°/SSE
M-5		Air Station M-5	AP, AI	2.6 mi @ 134°/SE
M-8	C	Upstream of Plant Intake	SW, SS, BO, F	< 1000' upstream
M-9		Downstream of Plant Discharge	SW, SS, BO, F	< 1000' downstream
M-10	C	Campbell Farm	M, WW	10.6 mi @ 357°/N
M-11		City of Monticello	WW	3.3 mi @ 127°/SE
M-12		Plant Well #1	WW	0.26 mi @ 252°/SW
M-14		City of Minneapolis	DW	37.0 mi @ 132°/SE
M-15		Montissippi Park	SS	1.27 mi @ 114°/ESE
M-19		River Irrigated Corn Field ^c		
M-21		River Irrigated Potato Field ^c		
M-24		Weinand Farm	M	4.7 mi @ 180°/S
M-27		Wise residence (Highest D/Q Garden) a. Available Producer	VE, WW VE	0.64 mi @ 207°/SSW > 10.0 mi.
M-28		Hoglund Farm	M	3.8 mi @ 300°/WNW
M-29		Warehouse #5	WW	276' @ 32°/NNE
M-30		Receiving Warehouse	WW	0.27 mi @ 156°/SSE
M-31		Site Administration Building	WW	424' @ 192°/SSW
M-32		Shooting Range	WW	0.33 mi @ 111°/ESE
M-33		Monitoring Well #1	WW	593' @ 299°/WNW
M-34		Monitoring Well #2	WW	749' @ 301°/WNW
M-35		Monitoring Well #3	WW	770' @ 304°/NW
M-36		Monitoring Well #4	WW	0.1 mi @ 335°/NNW
M-37		Monitoring Well #5	WW	0.1 mi @ 253°/WSW
M-38		Monitoring Well #6	WW	229' @ 228°/SW
M-39		Monitoring Well #7	WW	0.2 mi @ 66°/ENE
M-40		Monitoring Well #8	WW	0.3 mi @ 150°/SSE
M-41		Training Center	VE	0.8 mi @ 151°/SSE
M-42		Biology Station Road	VE	0.6 mi @ 134°/SE
M-43	C	Imholte Farm	VE	12.3 mi @ 313°/NW
General Area of the Site Boundary				
M-01A		Sherburne Ave. So.	TLD	0.75 mi @ 353°/N
M-02A		Sherburne Ave. So.	TLD	0.79 mi @ 23°/NNE
M-03A		Sherburne Ave. So.	TLD	1.29 mi @ 55°/NE
M-04A		Biology Station Road	TLD	0.5 mi @ 86°/E
M-05A		Biology Station Road	TLD	0.48 mi @ 118°/ESE
M-06A		Biology Station Road	TLD	0.54 mi @ 135°/SE
M-07A		County Road 75	TLD	0.5 mi @ 155°/SSE
M-08A		County Road 75	TLD	0.48 mi @ 172°/S
M-09A		County Road 75	TLD	0.38 mi @ 209°/SSW
M-10A		County Road 75	TLD	0.38 mi @ 226°/SW
M-11A		County Road 75	TLD	0.4 mi @ 239°/WSW
M-12A		County Road 75	TLD	0.5 mi @ 262°/W
M-13A		North Boundary Road	TLD	0.89 mi @ 324°/NW
M-14A		North Boundary Road	TLD	0.78 mi @ 334°/NNW

Table 5.2. Sampling locations, Monticello Nuclear Generating Plant.

Code	Type ^a	Collection Site	Sample Type ^b	Distance and Direction from Reactor
Approximately 4 to 5 miles Distant from the Plant				
M-01B		Sherco #1 Air Station	TLD	4.66 mi @ 02°/N
M-02B		County Road 11	TLD	4.4 mi @ 18°/NNE
M-03B		County Road 73 & 81	TLD	4.3 mi @ 57°/NE
M-04B		County Road 73 (196th St.)	TLD	4.2 mi @ 67°/ENE
M-05B		City of Big Lake	TLD	4.3 mi @ 89°/E
M-06B		County Road 14 and 196th St.	TLD	4.3 mi @ 117°/ESE
M-07B		Monte Industrial Drive	TLD	4.3 mi @ 136°/SE
M-08B		Residence, Hwy 25 & Davidson Ave.	TLD	4.6 mi @ 162°/SSE
M-09B		Weinand Farm	TLD	4.7 mi @ 178°/S
M-10B		Reisewitz Farm, Acacia Ave.	TLD	4.2 mi @ 204°/SSW
M-11B		Vanlith Farm, 97th Ave.	TLD	4.0 mi @ 228°/SW
M-12B		Lake Maria State Park	TLD	4.2 mi @ 254°/WSW
M-13B		Bridgewater Station	TLD	4.1 mi @ 270°/W
M-14B		Anderson Residence, Cty Rd. 111	TLD	4.3 mi @ 289°/WNW
M-15B		Red Oak Wild Bird Farm	TLD	4.3 mi @ 309°/NW
M-16B		Sand Plain Research Farm	TLD	4.4 mi @ 341°/NNW
Special Interest Locations				
M-01S		Osowski Fun Market	TLD	0.66 mi @ 242°/WSW
M-02S		Krone Residence	TLD	0.5 mi @ 224°/SW
M-03S		Big Oaks Park	TLD	1.53 mi @ 102°/ESE
M-04S		Pinewood School	TLD	2.3 mi @ 131°/SE
M-05S		Rivercrest Christian Academy	TLD	3.0 mi @ 118°/ESE
M-06S		Monte Public Works	TLD	2.6 mi @ 134°/SE
M-01C	C	Kirchenbauer Farm	TLD	11.5 mi @ 323°/NW
M-02C	C	County Roads 4 and 15	TLD	11.2 mi @ 47°/NE
M-03C	C	County Rd 19 and Jason Ave.	TLD	11.6 mi @ 130°/SE
M-04C	C	Maple Lake Water Tower	TLD	10.3 mi @ 226°/SW

^a "C" denotes control location. All other locations are indicators.

^b Sample Codes:

AP	Airborne particulates	F	Fish
AI	Airborne Iodine	M	Milk
BS	Bottom (river) sediments	RW	River Water
BO	Bottom organisms	SS	Shoreline Sediments
DW	Drinking Water	VE	Vegetation / vegetables
		WW	Well Water

^c Collected only if the plant discharges radioactive effluent into the river, then only from river irrigated fields.

Table 5.3

MISSED COLLECTIONS AND ANALYSES

All required samples were collected and analyzed as scheduled with the following exceptions:					
Sample Type	Analysis	Location	Collection Date or Period	Reason for not conducting REMP as required	Plans for Preventing Recurrence
AP/AI	Beta, I-131	M-02	5/28/2008	Sampler pump failure, open fuse.	Sampler pump was replaced.
AP/AI	Beta, I-131	M-05	7/9/2008	Sampler pump failure, sampler head leakage.	Sampler pump was replaced.
MI	Gamma, I-131	M-28	4/9/2008-12/31/2008	Hoglund Farm no longer in the dairy business.	Pasture grass collections were initiated at locations M-41, M-42, M-43 in Sept. 2008
TLD	Ambient Gamma	M-01B	1st. Qtr. 2008	Missing in the field	None required.
TLD	Ambient Gamma	M-01S	2nd. Qtr. 2008	Missing in the field	None required.
TLD	Ambient Gamma	M-11A	4th. Qtr. 2008	Missing in the field	None required.
BO	Gamma	M-08, M-09	Oct., 2008	Collection missed due to unsafe river conditions.	None required.
SW	Surface Water Gamma	M-08	Jan, Feb, Mar, 2008	Missed due to unsafe ice.	None required.
		M-08	Dec, 2008	Three of five weekly samples missed due to unsafe ice.	None required.

Figure 5-1. Offsite Ambient Radiation (TLDs); Inner Ring versus Outer Ring locations.

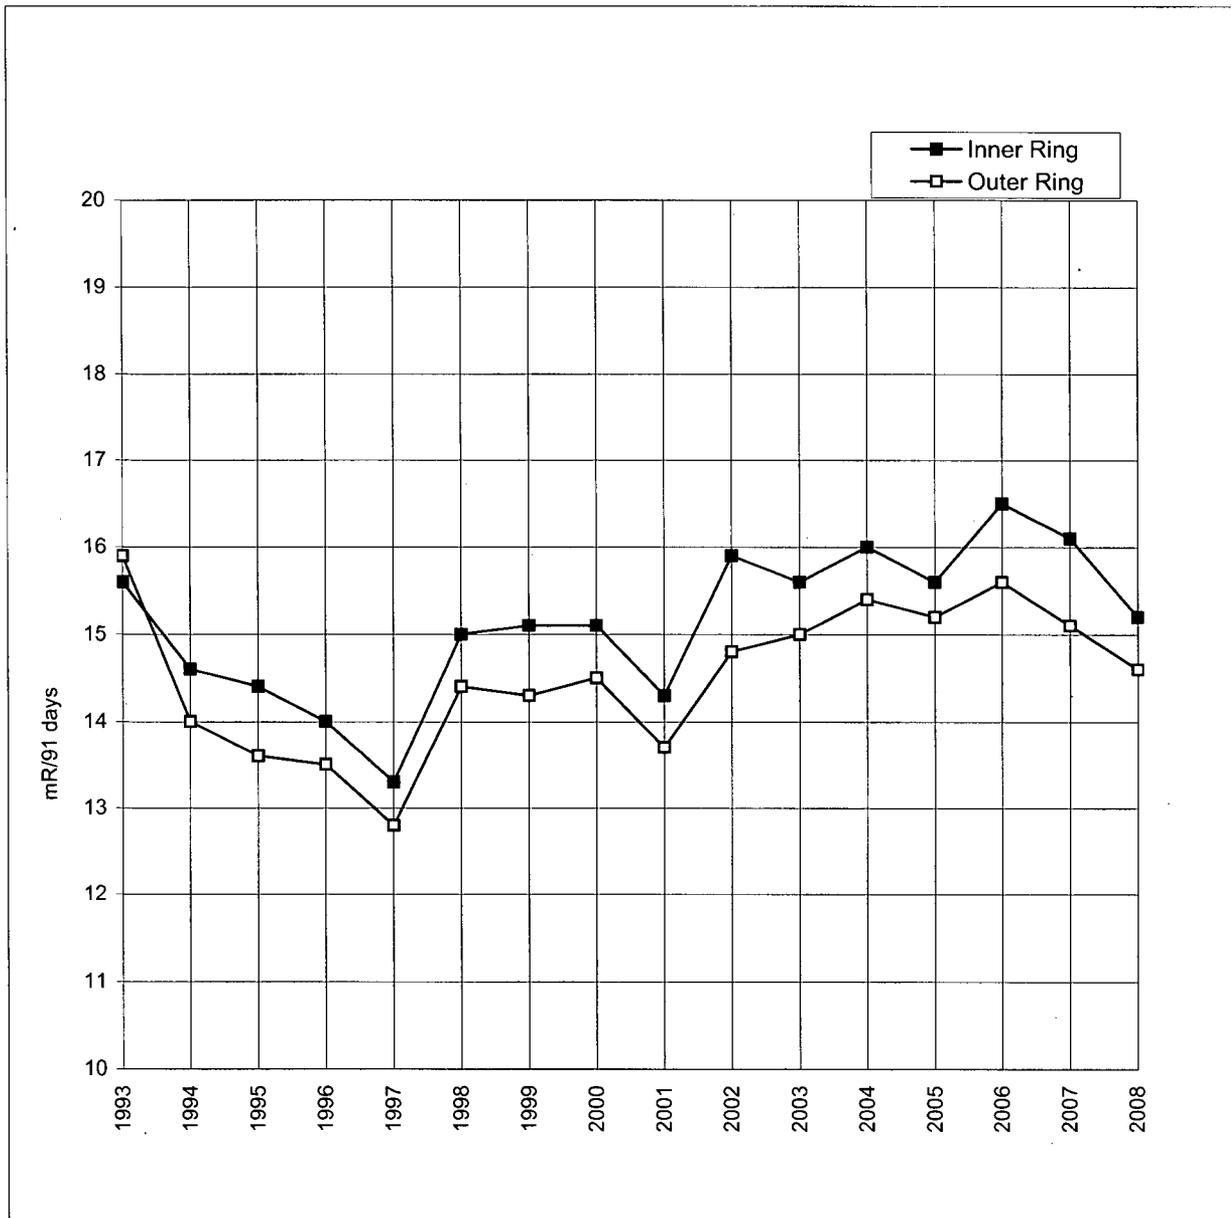


Figure 5-2. Airborne Particulates; analysis for gross beta, average mean of all indicator locations versus control location.

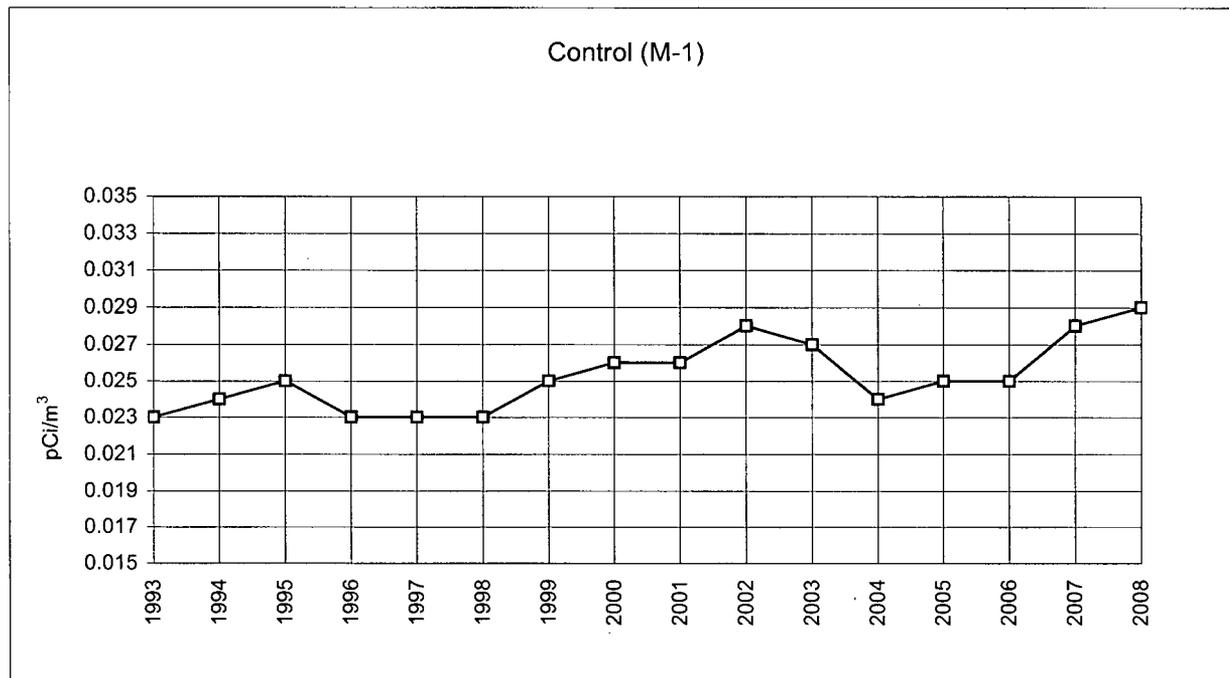
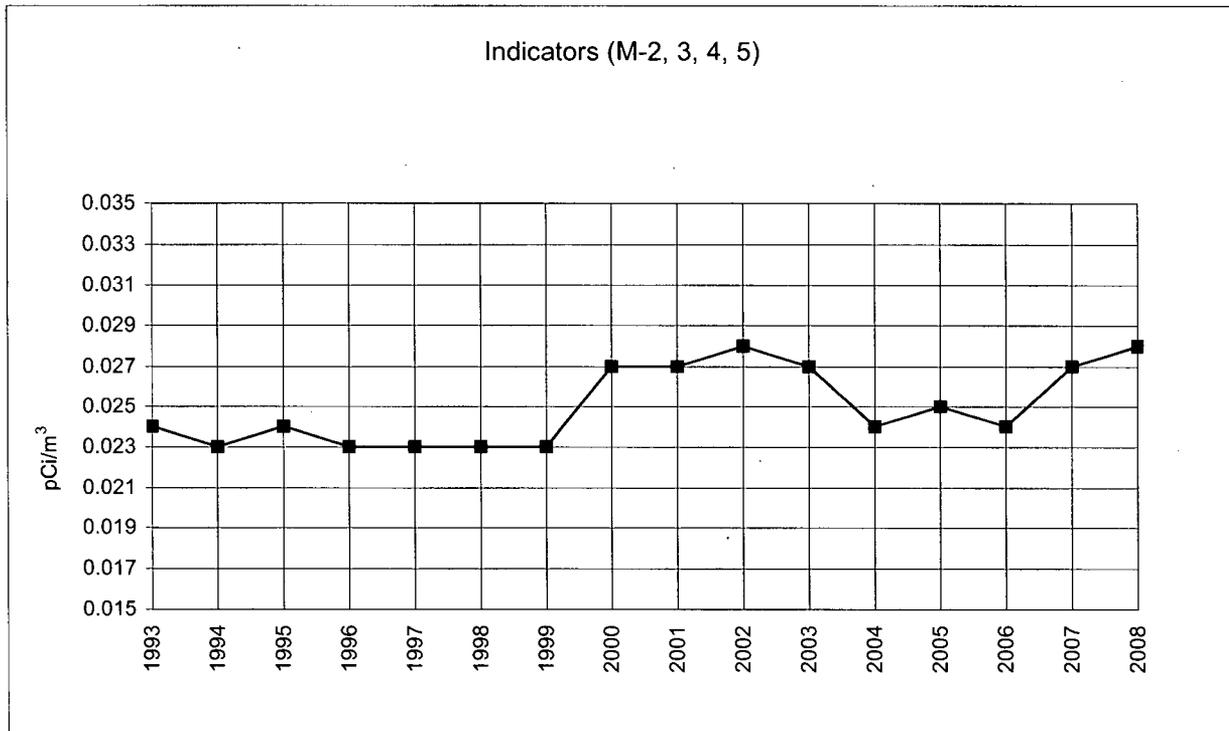


Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility	<u>Monticello Nuclear Generating Plant</u>	Docket No.	<u>50-263</u>
Location of Facility	<u>Wright, Minnesota</u>	Reporting Period	<u>January-December, 2008</u>
	(County, State)		

Sample Type (Units)	Type and Number of Analyses ^a	LLD ^b	Indicator Locations Mean (F) ^c Range ^c	Location with Highest Annual Mean		Control Locations Mean (F) ^c Range ^c	Number Non-Routine Results ^e
				Location ^d	Mean (F) ^c Range ^c		
TLD (Inner Ring, General Area at Site Boundary) mRem/91 days)	Gamma 55	3.0	15.2 (55/55) (12.1-19.2)	M-11A 0.4 mi @ 250°/WSW	17.5 (3 /3) (15.5-19.2)	(See Control below.)	0
TLD (Outer Ring, 4-5 mi. distant) mRem/91 days)	Gamma 59	3.0	14.6 (59/59) (11.1-18.5)	M-09B, Weinand Farm 4.7 mi @ 180°/S	16.2 (4 /4) (13.1-17.8)	(See Control below.)	0
TLD (Special Interest Areas) mRem/91 days)	Gamma 23	3.0	14.3 (23/23) (10.2-18.4)	M-06S, Mont. Pub. Wks. 2.7 mi @ 136°/SE	16.8 (4 /4) (15.1-18.4)	(See Control below.)	0
TLD (Control) mRem/91 days)	Gamma 16	3.0	None	M-03C, County Rd.19 & Jason, 11.6 mi. @ 130°/SE	15.4 (4/4) (13.9-18.7)	15.4 (16/16) (11.8-18.7)	0
Airborne Particulates (pCi/m ³)	GB 258	0.003	0.028 (206/206) (0.004-0.087)	M-1 (C) 11.0 mi @ 307°/NW	0.029 (51 /52) (0.009-0.065)	0.029 (51/52) (0.009-0.065)	0
	GS 20	0.015	0.075 (16/16) (0.059-0.106)	M-3 0.6 mi @ 104°/ESE	0.079 (4/4) (0.070-0.086)	0.077 (4/4) (0.062-0.089)	0
	Mn-54	0.0008	< LLD	-	-	< LLD	0
	Co-58	0.0007	< LLD	-	-	< LLD	0
	Co-60	0.0009	< LLD	-	-	< LLD	0
	Zn-65	0.0016	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.0010	< LLD	-	-	< LLD	0
	Ru-103	0.0011	< LLD	-	-	< LLD	0
	Ru-106	0.0066	< LLD	-	-	< LLD	0
	Cs-134	0.0009	< LLD	-	-	< LLD	0
	Cs-137	0.0009	< LLD	-	-	< LLD	0
	Ba-La-140	0.0022	< LLD	-	-	< LLD	0
	Ce-141	0.0013	< LLD	-	-	< LLD	0
	Ce-144	0.0047	< LLD	-	-	< LLD	0
Airborne Iodine (pCi/m ³)	I-131 258	0.03	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Monticello Nuclear Generating Plant
 Location of Facility Wright, Minnesota
 (County, State)

Docket No. 50-263
 Reporting Period January-December, 2008

Sample Type (Units)	Type and Number of Analyses ^a	LLD ^b	Indicator Locations Mean (F) ^c Range ^c	Location with Highest Annual Mean		Control Locations Mean (F) ^c Range ^c	Number Non-Routine Results ^e
				Location ^d	Mean (F) ^c Range ^c		
Milk (pCi/L)	I-131 24	0.5	< LLD	-	-	< LLD	0
	GS 24						
	K-40	200	1357 (4/4) (1279-1422)	M-10 (C), Campbell 10.6 mi @ 357°N	1371 (20 /20) (1275-1537)	1371 (20/20) (1275-1537)	0
	Cs-134	5	< LLD	-	-	< LLD	0
	Cs-137	5	< LLD	-	-	< LLD	0
	Ba-La-140	5	< LLD	-	-	< LLD	0
River Water (pCi/L)	H-3 7	500	< LLD	-	-	< LLD	0
	GS 21						
	Mn-54	10	< LLD	-	-	< LLD	0
	Fe-59	30	< LLD	-	-	< LLD	0
	Co-58	10	< LLD	-	-	< LLD	0
	Co-60	10	< LLD	-	-	< LLD	0
	Zn-65	30	< LLD	-	-	< LLD	0
	Zr-Nb-95	15	< LLD	-	-	< LLD	0
	Cs-134	10	< LLD	-	-	< LLD	0
	Cs-137	10	< LLD	-	-	< LLD	0
	Ba-La-140	15	< LLD	-	-	< LLD	0
	Ce-144	53	< LLD	-	-	< LLD	0

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Monticello Nuclear Generating Plant
 Location of Facility Wright, Minnesota
 (County, State)

Docket No. 50-263
 Reporting Period January-December, 2008

Sample Type (Units)	Type and Number of Analyses ^a	LLD ^b	Indicator Locations Mean (F) ^c Range ^c	Location with Highest Annual Mean		Control Locations Mean (F) ^c Range ^c	Number Non-Routine Results ^e
				Location ^d	Mean (F) ^c Range ^c		
Drinking Water (pCi/L)	GB 12	1.0	2.1 (12/12) (1.3-4.4)	M-14, Minneapolis 37.0 mi. @ 132° /SE	2.1 (12/12) (1.3-4.4)	None	0
	I-131 12	1.0	< LLD	-	-	None	0
	H-3 4	500	< LLD	-	-	None	0
	GS 12						
	Mn-54 10	10	< LLD	-	-	None	0
	Fe-59 30	30	< LLD	-	-	None	0
	Co-58 10	10	< LLD	-	-	None	0
	Co-60 10	10	< LLD	-	-	None	0
	Zn-65 30	30	< LLD	-	-	None	0
	Zr-Nb-95 15	15	< LLD	-	-	None	0
	Cs-134 10	10	< LLD	-	-	None	0
	Cs-137 10	10	< LLD	-	-	None	0
Ba-La-140 15	15	< LLD	-	-	None	0	
Ce-144 50	50	< LLD	-	-	None	0	
Well Water (pCi/L)	H-3 116	500	520(1/112) -	Monitoring Well #3 770' @304° /NW	520(1/12) -	< LLD	0
	GS 116						
	Mn-54 10	10	< LLD	-	-	< LLD	0
	Fe-59 30	30	< LLD	-	-	< LLD	0
	Co-58 10	10	< LLD	-	-	< LLD	0
	Co-60 10	10	< LLD	-	-	< LLD	0
	Zn-65 30	30	< LLD	-	-	< LLD	0
	Zr-Nb-95 15	15	< LLD	-	-	< LLD	0
	Cs-134 10	10	< LLD	-	-	< LLD	0
	Cs-137 10	10	< LLD	-	-	< LLD	0
	Ba-La-140 15	15	< LLD	-	-	< LLD	0
	Ce-144 48	48	< LLD	-	-	< LLD	0
Broadleaf Vegetation (pCi/gwet)	GS 8						
	I-131 0.045	0.045	< LLD	-	-	< LLD	0
	Cs-134 0.016	0.016	< LLD	-	-	< LLD	0
Cs-137 0.019	0.019	< LLD	-	-	< LLD	0	

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility	<u>Monticello Nuclear Generating Plant</u>	Docket No.	<u>50-263</u>
Location of Facility	<u>Wright, Minnesota</u>	Reporting Period	<u>January-December, 2008</u>
	(County, State)		

Sample Type (Units)	Type and Number of Analyses ^a	LLD ^b	Indicator Locations Mean (F) ^c Range ^c	Location with Highest Annual Mean		Control Locations Mean (F) ^c Range ^c	Number Non-Routine Results ^e
				Location ^d	Mean (F) ^c Range ^c		
Fish (pCi/g wet)	GS 4						
	K-40	0.10	3.05 (2/2) (2.52-3.57)	M-08, Upstream < 1000' of discharge	3.21 (2/2) (2.97-3.44)	3.21 (2/2) (2.97-3.44)	0
	Mn-54	0.024	< LLD	-	-	< LLD	0
	Fe-59	0.040	< LLD	-	-	< LLD	0
	Co-58	0.020	< LLD	-	-	< LLD	0
	Co-60	0.020	< LLD	-	-	< LLD	0
	Zn-65	0.028	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.023	< LLD	-	-	< LLD	0
	Cs-134	0.016	< LLD	-	-	< LLD	0
	Cs-137	0.017	< LLD	-	-	< LLD	0
	Ba-La-140	0.031	< LLD	-	-	< LLD	0
	Ce-144	0.10	< LLD	-	-	< LLD	0
Invertebrates (pCi/g wet)	GS 2						
	Be-7	0.63	< LLD	-	-	< LLD	0
	K-40	1.61	< LLD	-	-	< LLD	0
	Mn-54	0.066	< LLD	-	-	< LLD	0
	Fe-59	0.15	< LLD	-	-	< LLD	0
	Co-58	0.040	< LLD	-	-	< LLD	0
	Co-60	0.069	< LLD	-	-	< LLD	0
	Zn-65	0.10	< LLD	-	-	< LLD	0
	Zr-Nb-95	0.06	< LLD	-	-	< LLD	0
	Ru-103	0.06	< LLD	-	-	< LLD	0
	Ru-106	0.65	< LLD	-	-	< LLD	0
	Cs-134	0.046	< LLD	-	-	< LLD	0
	Cs-137	0.056	< LLD	-	-	< LLD	0
	Ba-La-140	0.10	< LLD	-	-	< LLD	0
Ce-144	0.38	< LLD	-	-	< LLD	0	

Table 5.4 Radiological Environmental Monitoring Program Summary

Name of Facility Monticello Nuclear Generating Plant Docket No. 50-263
 Location of Facility Wright, Minnesota Reporting Period January-December, 2008
 (County, State)

Sample Type (Units)	Type and Number of Analyses ^a	LLD ^b	Indicator Locations Mean (F) ^c Range ^c	Location with Highest Annual Mean		Control Locations Mean (F) ^c Range ^c	Number Non-Routine Results ^e
				Location ^d	Mean (F) ^c Range ^c		
Shoreline Sediments (pCi/g dry)	GS 6 Be-7	0.20	0.44 (3/4) (0.29-0.60)	M-09, Downstream < 1000' of discharge	0.60 (1/2)	0.45 (1/2)	0
	K-40	0.10	10.87 (4/4) (10.56-11.51)	M-09, Downstream < 1000' of discharge	11.06 (2/2) (10.62-11.51)	10.00 (2/2) (9.68-10.32)	0
	Mn-54	0.019	< LLD	-	-	< LLD	0
	Fe-59	0.052	< LLD	-	-	< LLD	0
	Co-58	0.019	< LLD	-	-	< LLD	0
	Co-60	0.017	< LLD	-	-	< LLD	0
	Zn-65	0.043	< LLD	-	-	< LLD	0
	Nb-95	0.031	< LLD	-	-	< LLD	0
	Zr-95	0.030	< LLD	-	-	< LLD	0
	Ru-103	0.023	< LLD	-	-	< LLD	0
	Ru-106	0.12	< LLD	-	-	< LLD	0
	Cs-134	0.016	< LLD	-	-	< LLD	0
	Cs-137	0.015	0.071 (4/4) (0.058-0.081)	M-09, Downstream < 1000' of discharge	0.078 (2/2)	0.037 (1/2)	0
	Ba-La-140	0.081	< LLD	-	-	< LLD	0
Ce-144	0.099	< LLD	-	-	< LLD	0	

^a GB = gross beta, GS = gamma scan.

^b LLD = nominal lower limit of detection based on a 4.66 sigma counting error for background sample.

^c Mean and range are based on detectable measurements only. Fraction of detectable measurements at specified locations is indicated in parentheses (F).

^d Locations are specified: (1) by name, and/or station code (Table 2) and (2) by distance (miles) and direction relative to reactor site.

^e Non-routine results are those which exceed ten times the control station value. If no control station value is available, the result is considered non-routine if it exceeds ten times the typical preoperational value for the medium or location.

6.0 REFERENCES CITED

Arnold, J. R. and H. A. Al-Salih. 1955. Beryllium-7 Produced by Cosmic Rays. Science 121: 451-453.

Eisenbud, M. 1963. Environmental Radioactivity, McGraw-Hill, New York, New York, pp. 213, 275, 276.

Environmental, Inc., Midwest Laboratory.

_____ 2001a through 2009a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January-December, 2000 through 2008.

_____ 2001b through 2009b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 2000 through 2008.

_____ 2003. Quality Assurance Program Manual, Rev. 1, 01 October 2003.

_____ 2005. Quality Control Procedures Manual, Rev. 0, 17 September 2005.

_____ 2003. Quality Control Program, Rev. 1, 21 August 2003.

Gold, S., H.W. Barkhau, B. Shlein, and B. Kahn, 1964. Measurement of Naturally Occurring Radionuclides in Air, in the Natural Environment, University of Chicago Press, Illinois, 369-382.

Hazleton Environmental Sciences Corporation.

_____ 1979a through 1983a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December 1978 through 1982.

_____ 1979b through 1983b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December 1978 through 1982.

Hohenemser, C. M. Deicher, A. Ernst, H. Hofsass, G. Lindner, E. Racknagel, 1986. "Chernobyl," Chemtech, October 1986, pp. 596-605.

National Center for Radiological Health, 1968. Radiological Helath and Data Reports, Vol. 9, Number 12, 730-746.

Northern States Power Company.

_____ 1969 through 1971. Monticello Nuclear Generating Plant, Environmental Radiation Monitoring Program, Annual Report, June 18, 1968 to December 31, 1968, 1969, 1970. Minneapolis, Minnesota.

Northern States Power Company.

_____ Monticello Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1, to December 31, 1977 through 1982 (prepared by Hazleton Environmental Sciences). Minneapolis, Minnesota.

_____ 1984 through 2000. Monticello Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 1983 through 1999 (prepared by Teledyne Brown Engineering Environmental Services, Midwest Laboratory). Northbrook, Illinois

6.0 REFERENCES CITED (continued)

Teledyne Brown Engineering Environmental Services, Midwest Laboratory.

_____ 1984a to 2000a. Radiation Environmental Monitoring for Monticello Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.

_____ 1984b to 2000b. Radiation Environmental Monitoring for Prairie Island Nuclear Generating Plant, Complete Analysis Data Tables, January - December, 1983 through 1999.

U.S. Dep't of Energy 1997 HASL-300, Edition 28, Procedures Manual, Environmental Measurements Laboratory, New York, NY.

U.S. Environmental Protection Agency .

_____ 1980. Prescribed Procedures for Measurement of Radioactivity in Drinking Water, Cincinnati, Ohio (EPA-600/4-80-032).

_____ 1984. Eastern Environmental Radiation Facility, Radiochemistry Procedures Manual, Montgomery, Alabama (EPA-520/5-84-006).

_____ 2007. RadNet, formerly Environmental Radiation Ambient Monitoring System, Gross Beta in Air, Gross Beta in Drinking Water (MN) 1981– 2005.

Wilson, D. W., G. M. Ward and J. E. Johnson. 1969. In Environmental Contamination by Radioactive Materials, International Atomic Energy Agency. p.125.

XCEL Energy Corporation.

_____ 2009. Prairie Island Nuclear Generating Plant, Annual Radiation Environmental Monitoring Report to the U.S. Nuclear Regulatory Commission, January 1 to December 31, 2000 through 2008. (prepared by Environmental, Inc., Midwest Laboratory). Northbrook, Illinois



Environmental, Inc.
Midwest Laboratory

an Allegheny Technologies Co.

700 Landwehr Road • Northbrook, IL 60062-2310
ph. (847) 564-0700 • fax (847) 564-4517

APPENDIX A

INTERLABORATORY COMPARISON PROGRAM RESULTS

NOTE: Environmental Inc., Midwest Laboratory participates in intercomparison studies administered by Environmental Resources Associates, and serves as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada. Results are reported in Appendix A. TLD Intercomparison results, in-house spikes, blanks, duplicates and mixed analyte performance evaluation program results are also reported. Appendix A is updated four times a year; the complete Appendix is included in March, June, September and December monthly progress reports only.

January, 2008 through December, 2008

Appendix A

Interlaboratory Comparison Program Results

Environmental, Inc., Midwest Laboratory has participated in interlaboratory comparison (crosscheck) programs since the formulation of its quality control program in December 1971. These programs are operated by agencies which supply environmental type samples containing concentrations of radionuclides known to the issuing agency but not to participant laboratories. The purpose of such a program is to provide an independent check on a laboratory's analytical procedures and to alert it of any possible problems.

Participant laboratories measure the concentration of specified radionuclides and report them to the issuing agency. Several months later, the agency reports the known values to the participant laboratories and specifies control limits. Results consistently higher or lower than the known values or outside the control limits indicate a need to check the instruments or procedures used.

Results in Table A-1 were obtained through participation in the environmental sample crosscheck program administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the U.S. EPA Environmental Monitoring Systems Laboratory, Las Vegas, Nevada.

The results in Table A-2 list results for thermoluminescent dosimeters (TLDs), via International Intercomparison of Environmental Dosimeters, when available, and internal laboratory testing.

Table A-3 lists results of the analyses on in-house "spiked" samples for the past twelve months. All samples are prepared using NIST traceable sources. Data for previous years available upon request.

Table A-4 lists results of the analyses on in-house "blank" samples for the past twelve months. Data for previous years available upon request.

Table A-5 lists REMP specific analytical results from the in-house "duplicate" program for the past twelve months. Acceptance is based on the difference of the results being less than the sum of the errors. Complete analytical data for duplicate analyses is available upon request.

The results in Table A-6 were obtained through participation in the Mixed Analyte Performance Evaluation Program.

Results in Table A-7 were obtained through participation in the environmental sample crosscheck program administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the Environmental Measurement Laboratory Quality Assessment Program (EML).

Attachment A lists the laboratory precision at the 1 sigma level for various analyses. The acceptance criteria in Table A-3 is set at ± 2 sigma.

Out-of-limit results are explained directly below the result.

Attachment A

ACCEPTANCE CRITERIA FOR "SPIKED" SAMPLES

LABORATORY PRECISION: ONE STANDARD DEVIATION VALUES FOR VARIOUS ANALYSES^a

Analysis	Level	One standard deviation for single determination
Gamma Emitters	5 to 100 pCi/liter or kg > 100 pCi/liter or kg	5.0 pCi/liter 5% of known value
Strontium-89 ^b	5 to 50 pCi/liter or kg > 50 pCi/liter or kg	5.0 pCi/liter 10% of known value
Strontium-90 ^b	2 to 30 pCi/liter or kg > 30 pCi/liter or kg	5.0 pCi/liter 10% of known value
Potassium-40	≥ 0.1 g/liter or kg	5% of known value
Gross alpha	≤ 20 pCi/liter > 20 pCi/liter	5.0 pCi/liter 25% of known value
Gross beta	≤ 100 pCi/liter > 100 pCi/liter	5.0 pCi/liter 5% of known value
Tritium	≤ 4,000 pCi/liter > 4,000 pCi/liter	± 1σ = 169.85 x (known) ^{0.0933} 10% of known value
Radium-226,-228	≥ 0.1 pCi/liter	15% of known value
Plutonium	≥ 0.1 pCi/liter, gram, or sample	10% of known value
Iodine-131, Iodine-129 ^b	≤ 55 pCi/liter > 55 pCi/liter	6 pCi/liter 10% of known value
Uranium-238, Nickel-63 ^b Technetium-99 ^b	≤ 35 pCi/liter > 35 pCi/liter	6 pCi/liter 15% of known value
Iron-55 ^b	50 to 100 pCi/liter > 100 pCi/liter	10 pCi/liter 10% of known value
Other Analyses ^b	---	20% of known value

^a From EPA publication, "Environmental Radioactivity Laboratory Intercomparison Studies Program, Fiscal Year, 1981-1982, EPA-600/4-81-004.

^b Laboratory limit.

TABLE A-1. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)^a.

Lab Code	Date	Analysis	Concentration (pCi/L)			Acceptance
			Laboratory Result ^b	ERA Result ^c	Control Limits	
STW-1148	03/24/08	Sr-89	50.6 ± 2.4	60.4	48.6 - 68.2	Pass
STW-1148	03/24/08	Sr-90	42.4 ± 1.4	39.2	28.8 - 45.1	Pass
STW-1149	03/24/08	Ba-133	56.9 ± 5.4	58.3	48.3 - 64.3	Pass
STW-1149	03/24/08	Co-60	73.9 ± 1.6	76.6	68.9 - 86.7	Pass
STW-1149	03/24/08	Cs-134	50.2 ± 1.9	46.6	37.4 - 51.3	Pass
STW-1149	03/24/08	Cs-137	97.7 ± 2.2	102.0	91.8 - 115.0	Pass
STW-1149	03/24/08	Zn-65	109.9 ± 5.8	106.0	95.4 - 126.0	Pass
STW-1150	03/24/08	Gr. Alpha	43.7 ± 7.5	50.8	26.5 - 63.7	Pass
STW-1150	03/24/08	Gr. Beta	36.4 ± 1.8	51.4	35.0 - 58.4	Pass
STW-1151	03/24/08	I-131	29.3 ± 1.4	28.7	23.9 - 33.6	Pass
STW-1152	03/24/08	Ra-226	15.0 ± 1.1	15.3	11.4 - 17.6	Pass
STW-1152	03/24/08	Ra-228	18.4 ± 1.8	17.0	11.4 - 20.4	Pass
STW-1152	03/24/08	Uranium	23.4 ± 1.3	24.6	19.8 - 27.6	Pass
STW-1153	03/24/08	H-3	12551.0 ± 207.0	12000.0	10400.0 - 13200.0	Pass
STW-1154	07/07/08	Sr-89	24.9 ± 3.5	28.7	20.4 - 35.3	Pass
STW-1154	07/07/08	Sr-90	39.7 ± 0.5	40.0	29.4 - 46.0	Pass
STW-1155	07/07/08	Ba-133	45.0 ± 1.2	46.6	38.1 - 51.8	Pass
STW-1155	07/07/08	Co-60	24.9 ± 3.0	25.7	22.3 - 31.0	Pass
STW-1155	07/07/08	Cs-134	90.4 ± 5.3	93.2	76.6 - 102.0	Pass
STW-1155	07/07/08	Cs-137	57.1 ± 2.8	54.6	49.1 - 62.9	Pass
STW-1155	07/07/08	Zn-65	102.9 ± 7.3	98.8	88.9 - 118.0	Pass
STW-1156	07/07/08	Gr. Alpha	24.8 ± 1.6	30.7	15.7 - 40.0	Pass
STW-1156	07/07/08	Gr. Beta	23.9 ± 0.9	25.8	16.1 - 33.7	Pass
STW-1157	07/07/08	Ra-226	8.0 ± 0.6	8.1	6.1 - 9.5	Pass
STW-1157	07/07/08	Ra-228	7.7 ± 0.8	7.4	4.7 - 9.5	Pass
STW-1157	07/07/08	Uranium	11.2 ± 0.3	11.3	8.9 - 13.0	Pass
STW-1164	10/06/08	Sr-89	42.2 ± 3.2	48.7	38.2 - 56.1	Pass
STW-1164	10/06/08	Sr-90	35.4 ± 1.2	33.6	24.6 - 38.8	Pass
STW-1165	10/06/08	Ba-133	56.9 ± 1.0	63.5	52.8 - 69.9	Pass
STW-1165	10/06/08	Co-60	47.6 ± 1.3	49.1	44.2 - 56.6	Pass
STW-1165	10/06/08	Cs-134	26.4 ± 4.0	25.6	19.7 - 28.4	Pass
STW-1165	10/06/08	Cs-137	24.3 ± 0.7	25.6	21.6 - 31.2	Pass
STW-1165	10/06/08	Zn-65	72.0 ± 2.9	68.6	61.2 - 83.0	Pass
STW-1166	10/06/08	Gr. Alpha	24.2 ± 4.8	26.9	13.6 - 35.5	Pass
STW-1166	10/06/08	Gr. Beta	32.6 ± 1.0	38.0	25.1 - 45.5	Pass
STW-1167	10/06/08	I-131	29.0 ± 0.3	28.1	23.4 - 33.0	Pass
STW-1168	10/06/08	Ra-226	15.0 ± 1.0	16.1	12.0 - 18.4	Pass
STW-1168	10/06/08	Ra-228	16.0 ± 1.0	14.1	9.4 - 17.1	Pass
STW-1168	10/06/08	Uranium	47.8 ± 2.0	50.3	40.8 - 55.9	Pass
STW-1169	10/06/08	H-3	2357.0 ± 66.0	2220.0	1830.0 - 2460.0	Pass

^a Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing in drinking water conducted by Environmental Resources Associates (ERA).

^b Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

^c Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

TABLE A-2. Crosscheck program results; Thermoluminescent Dosimetry, (TLD, CaSO₄: Dy Cards).

Lab Code	Date	Description	Known Value	mR		Control Limits	Acceptance
				Lab Result	± 2 sigma		
<u>Environmental, Inc.</u>							
2008-1	6/16/2008	40 cm.	30.23	33.87 ± 1.17		21.16 - 39.30	Pass
2008-1	6/16/2008	50 cm.	19.35	23.13 ± 0.57		13.55 - 25.16	Pass
2008-1	6/16/2008	60 cm.	13.44	16.25 ± 1.10		9.41 - 17.47	Pass
2008-1	6/16/2008	70 cm.	9.87	10.39 ± 0.52		6.91 - 12.83	Pass
2008-1	6/16/2008	80 cm.	7.56	7.44 ± 0.51		5.29 - 9.83	Pass
2008-1	6/16/2008	90 cm.	5.97	5.80 ± 1.04		4.18 - 7.76	Pass
2008-1	6/16/2008	100 cm.	4.84	4.32 ± 0.43		3.39 - 6.29	Pass
2008-1	6/16/2008	120 cm.	3.36	2.69 ± 0.15		2.35 - 4.37	Pass
2008-1	6/16/2008	150 cm.	2.15	2.05 ± 0.69		1.51 - 2.80	Pass
2008-1	6/16/2008	180 cm.	1.49	1.23 ± 0.80		1.04 - 1.94	Pass
<u>Environmental, Inc.</u>							
2008-2	11/17/2008	30 cm.	63.05	73.10 ± 1.84		44.14 - 81.97	Pass
2008-2	11/17/2008	40 cm.	35.46	40.80 ± 2.30		24.82 - 46.10	Pass
2008-2	11/17/2008	50 cm.	22.7	24.10 ± 0.58		15.89 - 29.51	Pass
2008-2	11/17/2008	60 cm.	15.76	15.98 ± 0.55		11.03 - 20.49	Pass
2008-2	11/17/2008	60 cm.	15.76	19.49 ± 0.93		11.03 - 20.49	Pass
2008-2	11/17/2008	70 cm.	11.58	11.97 ± 0.54		8.11 - 15.05	Pass
2008-2	11/17/2008	75 cm.	10.09	9.45 ± 0.28		7.06 - 13.12	Pass
2008-2	11/17/2008	80 cm.	8.87	9.30 ± 0.18		6.21 - 11.53	Pass
2008-2	11/17/2008	90 cm.	7.01	7.19 ± 0.43		4.91 - 9.11	Pass
2008-2	11/17/2008	90 cm.	7.01	6.84 ± 0.42		4.91 - 9.11	Pass
2008-2	11/17/2008	100 cm.	5.67	5.47 ± 0.19		3.97 - 7.37	Pass
2008-2	11/17/2008	110 cm.	4.69	3.98 ± 0.27		3.28 - 6.10	Pass
2008-2	11/17/2008	120 cm.	3.94	3.09 ± 0.21		2.76 - 5.12	Pass
2008-2	11/17/2008	120 cm.	3.94	3.12 ± 0.34		2.76 - 5.12	Pass
2008-2	11/17/2008	150 cm.	2.52	2.55 ± 0.12		1.76 - 3.28	Pass
2008-2	11/17/2008	150 cm.	2.52	2.24 ± 0.08		1.76 - 3.28	Pass
2008-2	11/17/2008	180 cm.	1.75	1.36 ± 0.08		1.23 - 2.28	Pass

TABLE A-3. In-House "Spike" Samples

Lab Code ^b	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			Laboratory results 2s, n=1 ^c	Known Activity	Control Limits ^d	
SPW-111	1/14/2008	Tc-99	32.20 ± 0.85	32.34	20.34 - 44.34	Pass
SPW-298	1/31/2008	Ni-63	213.55 ± 3.07	212.58	148.81 - 276.35	Pass
W-11708	1/17/2008	Ra-226	11.34 ± 0.43	12.69	8.88 - 16.50	Pass
SPW-711	2/25/2008	U-238	33.56 ± 1.74	41.70	29.19 - 54.21	Pass
SPAP-881	3/11/2008	Cs-134	19.29 ± 1.53	20.09	10.09 - 30.09	Pass
SPAP-881	3/11/2008	Cs-137	114.04 ± 3.03	113.90	102.51 - 125.29	Pass
SPAP-883	3/11/2008	Gr. Beta ^e	54.56 ± 0.12	51.64	30.98 - 72.30	Pass
SPMI-885	3/11/2008	Sr-90	45.93 ± 1.60	45.13	36.10 - 54.16	Pass
SPW-887	3/11/2008	Sr-90	38.82 ± 1.60	45.13	36.10 - 54.16	Pass
SPW-889	3/11/2008	H-3	67325.00 ± 725.00	67384.00	53907.20 - 80860.80	Pass
W-31808	3/18/2008	Gr. Alpha	19.51 ± 0.40	20.08	10.04 - 30.12	Pass
W-31808	3/18/2008	Gr. Beta	47.20 ± 0.42	45.67	35.67 - 55.67	Pass
SPMI-885	3/24/2008	Cs-134	40.93 ± 1.55	39.69	29.69 - 49.69	Pass
SPMI-885	3/24/2008	Cs-137	61.36 ± 2.82	56.91	46.91 - 66.91	Pass
SPW-887	3/24/2008	Cs-134	40.68 ± 1.44	39.69	29.69 - 49.69	Pass
SPW-887	3/24/2008	Cs-137	58.52 ± 2.93	56.91	46.91 - 66.91	Pass
SPW-1282	4/2/2008	U-238	41.30 ± 1.78	41.70	29.19 - 54.21	Pass
W-40308	4/3/2008	Ra-226	15.17 ± 0.50	12.69	8.88 - 16.50	Pass
SPW-5580	4/7/2008	H-3	211.02 ± 7.71	240.00	0.00 - 806.46	Pass
SPW-1562	4/8/2008	Ra-228	28.93 ± 2.09	30.51	21.36 - 39.66	Pass
SPW-1560	4/10/2008	Tc-99	29.74 ± 0.84	32.34	20.34 - 44.34	Pass
SPW-1621	4/16/2008	Fe-55	27205.80 ± 982.90	28370.00	22696.00 - 34044.00	Pass
W-51508	5/15/2008	Gr. Alpha	24.01 ± 0.41	20.08	10.04 - 30.12	Pass
W-51508	5/15/2008	Gr. Beta	47.97 ± 0.41	45.68	35.68 - 55.68	Pass
SPAP-2673	6/2/2008	Cs-134	17.39 ± 1.32	18.60	8.60 - 28.60	Pass
SPAP-2673	6/2/2008	Cs-137	106.82 ± 3.42	113.30	101.97 - 124.63	Pass
SPAP-2674	6/2/2008	Gr. Beta ^e	53.57 ± 0.13	51.40	30.84 - 71.96	Pass
SPF-2745	6/2/2008	Cs-134	0.34 ± 0.02	0.37	0.22 - 0.52	Pass
SPF-2745	6/2/2008	Cs-137	2.06 ± 0.04	2.27	1.36 - 3.18	Pass
SPMI-2677	6/3/2008	Cs-137	53.99 ± 6.15	56.66	46.66 - 66.66	Pass
SPMI-2677A	6/3/2008	I-131	26.64 ± 0.59	28.58	16.58 - 40.58	Pass
SPW-2677	6/3/2008	Cs-134	40.30 ± 3.35	37.21	27.21 - 47.21	Pass
SPW-2677	6/3/2008	I-131(G)	25.92 ± 4.48	28.58	18.58 - 38.58	Pass
SPMI-2679	6/3/2008	Cs-134	35.02 ± 2.93	37.21	27.21 - 47.21	Pass
SPMI-2679	6/3/2008	Cs-137	58.49 ± 6.05	56.66	46.66 - 66.66	Pass
SPMI-2679	6/3/2008	I-131(G)	25.30 ± 4.97	28.58	18.58 - 38.58	Pass
SPMI-2679A	6/3/2008	I-131	30.37 ± 0.50	28.58	16.58 - 40.58	Pass
SPVE-2681	6/3/2008	I-131(G)	1.11 ± 0.06	0.95	0.57 - 1.33	Pass
SPW-2683	6/2/2008	Ni-63	2151.70 ± 10.22	2119.30	1483.51 - 2755.09	Pass
SPW-2685	6/2/2008	H-3	64927.20 ± 704.80	66540.80	53232.64 - 79848.96	Pass
SPW-2689	6/2/2008	C-14	4405.40 ± 15.21	4742.00	2845.20 - 6638.80	Pass

TABLE A-3. In-House "Spike" Samples

Lab Code ^b	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			Laboratory results 2s, n=1	Known Activity	Control Limits ^c	
W-81408	8/14/2008	Ra-226	12.98 ± 0.35	12.69	8.88 - 16.50	Pass
SPW-1562	8/14/2008	Ra-228	29.09 ± 2.46	30.51	21.36 - 39.66	Pass
SPW-81808	8/18/2008	U-238	42.59 ± 1.96	41.70	29.19 - 54.21	Pass
W-81808	8/18/2008	Gr. Alpha	21.36 ± 0.42	20.08	10.04 - 30.12	Pass
W-81808	8/18/2008	Gr. Beta	49.33 ± 1.01	45.68	35.68 - 55.68	Pass
W-112008	11/20/2008	Gr. Alpha	20.13 ± 0.40	20.08	10.04 - 30.12	Pass
W-112008	11/20/2008	Gr. Beta	48.28 ± 0.42	45.60	35.60 - 55.60	Pass
SPAP-6839	12/5/2008	Cs-134	15.39 ± 2.72	15.68	5.68 - 25.68	Pass
SPAP-6839	12/5/2008	Cs-137	111.45 ± 9.85	112.00	100.80 - 123.20	Pass
SPAP-6841	12/5/2008	Gr. Beta ^e	49.26 ± 0.12	50.72	30.43 - 71.01	Pass
SPW-6843	12/5/2008	C-14	19377.50 ± 55.27	23708.00	14224.80 - 33191.20	Pass
SPW-6845	12/5/2008	Fe-55	7068.30 ± 692.30	6028.00	4822.40 - 7233.60	Pass
SPW-6847	12/5/2008	Tc-99	37.71 ± 1.33	32.34	20.34 - 44.34	Pass
SPW-6849	12/5/2008	Ni-63	232.56 ± 3.26	211.34	147.94 - 274.74	Pass
SPW-6851	12/5/2008	H-3	63664.00 ± 8745.00	64674.00	51739.20 - 77608.80	Pass
SPF-6859	12/5/2008	Cs-134	0.63 ± 0.02	0.63	0.38 - 0.88	Pass
SPF-6859	12/5/2008	Cs-137	2.35 ± 0.01	2.24	1.34 - 3.14	Pass
SPW-7059	12/19/2008	Sr-90	49.19 ± 2.62	44.33	35.46 - 53.20	Pass
SPMI-7061	12/19/2008	Sr-90	39.39 ± 2.19	44.33	35.46 - 53.20	Pass

^a Liquid sample results are reported in pCi/Liter, air filters (pCi/filter), charcoal (pCi/m³), and solid samples (pCi/g).

^b Laboratory codes as follows: W (water), MI (milk), AP (air filter), SO (soil), VE (vegetation),
CH (charcoal canister), F (fish).

^c Results are based on single determinations.

^d Control limits are established from the precision values listed in Attachment A of this report, adjusted to ± 2σ.

^e Control limits based on the laboratory limit, Attachment A ("Other Analyses").

NOTE: For fish, Jello is used for the Spike matrix. For Vegetation, cabbage is used for the Spike matrix.

TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis ^b	Concentration (pCi/L) ^a		
				Laboratory results (4.66σ)		Acceptance Criteria (4.66 σ)
				LLD	Activity ^c	
SPW-17	Water	1/3/2008	U-238	0.09	0.01 ± 0.07	1
SPW-112	Water	1/14/2008	Tc-99	4.70	-0.06 ± 2.85	10
W-11408	Water	1/14/2008	Ra-226	0.05	0.05 ± 0.04	1
SPAP-880	Air Filter	3/11/2008	Cs-134	0.91	-	100
SPAP-880	Air Filter	3/11/2008	Cs-137	1.13	-	100
SPW-888	Water	3/11/2008	H-3	159.99	-78.90 ± 80.40	200
W-31808	Water	3/18/2008	Gr. Alpha	0.42	-0.05 ± 0.29	1
W-31808	Water	3/18/2008	Gr. Beta	0.72	0.09 ± 0.51	3.2
SPMI-884	Milk	3/24/2008	Cs-134	2.79	-	10
SPMI-884	Milk	3/24/2008	Cs-137	3.36	-	10
W-40308	Water	4/3/2008	Ra-226	0.04	0.05 ± 0.03	1
SPW-1563	Water	4/8/2008	Ra-228	0.57	0.31 ± 0.30	2
SPW-1561	Water	4/10/2008	Tc-99	4.77	-3.42 ± 2.85	10
SPW-1621	Water	4/16/2008	Fe-55	668.50	-170.70 ± 397.20	1000
SPW-2451	Water	5/22/2008	U-238	0.21	0.35 ± 0.24	1
SPW-2676	Water	6/2/2008	Cs-134	2.03	-	10
SPW-2676	Water	6/2/2008	Cs-134	3.60	-	10
SPW-2676	Water	6/2/2008	Cs-137	2.38	-	10
SPW-2677	Water	6/2/2008	Cs-134	2.78	-	10
SPW-2677	Water	6/2/2008	I-131(G)	3.49	-	20
SPW-2677	Water	6/2/2008	I-131(G)	5.25	-	20
SPF-2744	Fish	6/2/2008	Cs-134	5.48	-	100
SPF-2744	Fish	6/2/2008	Cs-137	4.83	-	100
SPW-2676	Water	6/3/2008	I-131	0.18	0.01 ± 0.11	0.5
SPMI-2678	Milk	6/3/2008	I-131	0.22	0.12 ± 0.15	0.5
SPVE-2680	Vegetation	6/3/2008	I-131(G)	0.01	-	20
SPW-3581	Water	7/14/2008	U-238	0.10	0.13 ± 0.12	1
W-80708	Water	8/7/2008	Gr. Alpha	0.63	-0.02 ± 0.44	1
W-80708	Water	8/7/2008	Gr. Beta	1.43	-0.47 ± 0.99	3.2
W-81408	Water	8/14/2008	Ra-226	0.06	0.14 ± 0.04	1
SPW-1563	Water	8/14/2008	Ra-228	0.79	0.89 ± 0.47	2
SPW-81808	Water	8/18/2008	U-238	0.18	0.04 ± 0.13	1

TABLE A-4. In-House "Blank" Samples

Lab Code	Sample Type	Date	Analysis ^b	Concentration (pCi/L) ^a		
				Laboratory results (4.66 σ)		Acceptance Criteria (4.66 σ)
				LLD	Activity ^c	
W-112008	Water	11/20/2008	Gr. Alpha	0.40	0.02 \pm 0.28	1
W-112008	Water	11/20/2008	Gr. Beta	0.75	-0.16 \pm 0.52	3.2
SPAP-6838	Air Filter	12/5/2008	Cs-134	1.01	-	100
SPAP-6838	Air Filter	12/5/2008	Cs-137	0.95	-	100
SPAP-6840	Air Filter	12/5/2008	Gr. Beta	0.96	2.69 \pm 0.64	3.2
SPW-6842	Water	12/5/2008	C-14	7.79	-3.04 \pm 4.05	200
SPW-6844	Water	12/5/2008	Fe-55	715.10	21.70 \pm 435.10	1000
SPW-6846	Water	12/5/2008	Tc-99	1.36	-0.47 \pm 0.82	10
SPW-6848	Water	12/5/2008	Ni-63	1.94	3.08 \pm 1.23	20
SPF-6858	Fish	12/5/2008	Cs-134	1.53	-	100
SPF-6858	Fish	12/5/2008	Cs-137	3.92	-	100
SPW-7058	Water	12/19/2008	Cs-134	2.62	-	10
SPW-7058	Water	12/19/2008	Cs-137	2.39	-	10
SPW-7058	Water	12/19/2008	Sr-90	0.65	-0.28 \pm 0.26	1
SPMI-7060	Milk	12/19/2008	Cs-134	2.18	-	10
SPMI-7060	Milk	12/19/2008	Cs-137	3.87	-	10
SPMI-7060	Milk	12/19/2008	I-131(G)	2.80	-	20
SPMI-7060 ^d	Milk	12/19/2008	Sr-90	0.53	0.76 \pm 0.34	1

^a Liquid sample results are reported in pCi/Liter, air filters (pCi/filter), charcoal (pCi/charcoal canister), and solid samples (pCi/kg).

^b I-131(G); iodine-131 as analyzed by gamma spectroscopy.

^c Activity reported is a net activity result. For gamma spectroscopic analysis, activity detected below the LLD value is not reported.

^d Low levels of Sr-90 are still detected in the environment. A concentration of (1-5 pCi/L) in milk is not unusual.

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			First Result	Second Result	Averaged Result	
AP-8809, 8810	1/2/2008	Be-7	0.06 ± 0.02	0.06 ± 0.01	0.06 ± 0.01	Pass
CF-42, 43	1/2/2008	Gr. Beta	8.88 ± 0.19	8.99 ± 0.19	8.94 ± 0.13	Pass
CF-42, 43	1/2/2008	K-40	5.08 ± 0.29	5.19 ± 0.30	5.14 ± 0.21	Pass
DW-80020, 80021	1/7/2008	Gr. Alpha	2.28 ± 0.84	1.98 ± 0.86	2.13 ± 0.60	Pass
U-169, 170	1/10/2008	Beta-K40	7.50 ± 5.50	11.70 ± 5.10	9.60 ± 3.75	Pass
SO-8836, 8837	1/14/2008	Cs-137	0.80 ± 0.05	0.75 ± 0.05	0.77 ± 0.03	Pass
SO-8836, 8837	1/14/2008	Gr. Alpha	13.30 ± 4.31	15.58 ± 4.10	14.44 ± 2.98	Pass
SO-8836, 8837	1/14/2008	Gr. Alpha	33.68 ± 3.73	29.21 ± 3.10	31.45 ± 2.43	Pass
SO-8836, 8837	1/14/2008	K-40	12.31 ± 0.74	12.96 ± 0.73	12.64 ± 0.52	Pass
DW-80045, 80046	1/15/2008	Gr. Alpha	2.94 ± 1.13	3.41 ± 1.04	3.17 ± 0.77	Pass
DW-80045, 80046	1/15/2008	Gr. Beta	1.86 ± 0.66	1.36 ± 0.63	1.61 ± 0.45	Pass
MI-138, 139	1/15/2008	K-40	1262.40 ± 81.70	1396.20 ± 154.20	1329.30 ± 87.25	Pass
LW-190, 191	1/16/2008	Gr. Beta	2.85 ± 1.07	1.64 ± 1.02	2.24 ± 0.74	Pass
DW-8008, 8009	1/16/2008	Ra-226	2.77 ± 0.20	3.11 ± 0.22	2.94 ± 0.15	Pass
DW-8008, 8009	1/16/2008	Ra-228	3.95 ± 0.74	3.96 ± 0.77	3.96 ± 0.53	Pass
DW-80057, 80058	1/21/2008	Gr. Alpha	6.77 ± 0.66	7.91 ± 1.73	7.34 ± 0.92	Pass
DW-80057, 80058	1/21/2008	Gr. Beta	13.83 ± 0.97	14.78 ± 1.01	14.31 ± 0.70	Pass
SWU-479, 480	1/29/2008	Gr. Beta	4.49 ± 1.13	3.13 ± 1.14	3.81 ± 0.80	Pass
W-920, 921	2/4/2008	Gr. Beta	4.20 ± 1.30	3.30 ± 1.30	3.75 ± 0.92	Pass
SW-540, 541	2/12/2008	Gr. Alpha	2.75 ± 1.16	4.01 ± 1.18	3.38 ± 0.83	Pass
SW-540, 541	2/12/2008	Gr. Beta	6.46 ± 1.11	6.71 ± 1.03	6.59 ± 0.76	Pass
DW-80155, 80156	2/12/2008	Ra-226	2.55 ± 0.22	2.01 ± 0.16	2.28 ± 0.14	Fail
DW-80155, 80156	2/12/2008	Ra-228	1.86 ± 0.70	1.53 ± 0.67	1.70 ± 0.48	Pass
DW-80165, 80166	2/20/2008	Gr. Alpha	1.51 ± 0.90	0.80 ± 1.05	1.16 ± 0.69	Pass
DW-80166, 80167	2/20/2008	Ra-226	0.40 ± 0.09	0.46 ± 0.09	0.43 ± 0.06	Pass
DW-80166, 80167	2/20/2008	Ra-228	1.44 ± 0.52	1.42 ± 0.57	1.43 ± 0.39	Pass
DW-80166, 80167	2/20/2008	Uranium	0.69 ± 0.25	0.69 ± 0.26	0.69 ± 0.18	Pass
W-1413, 1414	3/3/2008	Gr. Beta	7.50 ± 3.00	3.70 ± 2.60	5.60 ± 1.98	Pass
DW-80189, 80190	3/11/2008	Ra-226	4.41 ± 0.30	4.09 ± 0.25	4.25 ± 0.20	Pass
DW-80189, 80190	3/11/2008	Ra-228	1.99 ± 0.65	2.17 ± 0.66	2.08 ± 0.46	Pass
MI-1006, 1007	3/12/2008	K-40	1451.90 ± 112.80	1409.50 ± 111.40	1430.70 ± 79.27	Pass
MI-1006, 1007	3/12/2008	Sr-90	0.48 ± 0.31	0.97 ± 0.38	0.72 ± 0.24	Pass
DW-80205, 80206	3/14/2008	Gr. Alpha	3.64 ± 0.80	3.39 ± 0.82	3.52 ± 0.57	Pass
DW-80202, 80203	3/14/2008	Ra-226	3.16 ± 0.21	3.00 ± 0.19	3.08 ± 0.14	Pass
DW-80202, 80203	3/14/2008	Ra-228	2.40 ± 1.00	2.07 ± 0.69	2.24 ± 0.61	Pass
DW-80208, 80209	3/14/2008	U-233/4	1.32 ± 0.25	1.29 ± 0.36	1.31 ± 0.22	Pass
SG-1080, 1081	3/18/2008	Pb-214	3.99 ± 0.30	4.15 ± 0.29	4.07 ± 0.21	Pass
SO-1195, 1196	3/18/2008	U-233/4	0.14 ± 0.02	0.14 ± 0.02	0.14 ± 0.01	Pass
SO-1195, 1196	3/18/2008	U-238	0.13 ± 0.02	0.13 ± 0.02	0.13 ± 0.01	Pass
WW-1242, 1243	3/24/2008	Gr. Beta	10.36 ± 1.63	9.06 ± 1.55	9.71 ± 1.13	Pass
AP-1519, 1520	4/2/2008	Be-7	0.07 ± 0.01	0.08 ± 0.01	0.08 ± 0.01	Pass
W-1565, 1566	4/2/2008	Gr. Alpha	0.82 ± 0.64	1.58 ± 0.72	1.20 ± 0.48	Pass
W-1565, 1566	4/2/2008	Gr. Beta	3.73 ± 0.86	5.51 ± 1.09	4.62 ± 0.69	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			First Result	Second Result	Averaged Result	
DW-80255, 80256	4/8/2008	Ra-226	0.19 ± 0.08	0.28 ± 0.11	0.24 ± 0.07	Pass
DW-80255, 80256	4/8/2008	Ra-228	1.79 ± 0.57	1.32 ± 0.55	1.56 ± 0.40	Pass
DW-80259, 80260	4/8/2008	Gr. Alpha	3.39 ± 0.82	3.62 ± 0.82	3.51 ± 0.58	Pass
DW-80301, 80302	4/11/2008	Ra-226	0.47 ± 0.09	0.47 ± 0.09	0.47 ± 0.06	Pass
DW-80301, 80302	4/11/2008	Ra-228	1.02 ± 0.42	0.82 ± 0.45	0.92 ± 0.31	Pass
SO-1913, 1914	4/15/2008	K-40	12.79 ± 0.73	13.88 ± 0.85	13.34 ± 0.56	Pass
DW-80313, 80314	4/16/2008	Ra-226	3.39 ± 0.22	3.28 ± 0.21	3.34 ± 0.15	Pass
DW-80313, 80314	4/16/2008	Ra-228	4.27 ± 0.72	5.14 ± 0.77	4.71 ± 0.53	Pass
SWU-2087, 2088	4/29/2008	Gr. Beta	2.20 ± 0.60	3.50 ± 0.90	2.85 ± 0.54	Pass
LW-2297, 2298	4/30/2008	Gr. Beta	1.41 ± 0.43	1.02 ± 0.40	1.22 ± 0.30	Pass
LW-2321, 2322	4/30/2008	Gr. Beta	1.33 ± 0.54	1.23 ± 0.54	1.28 ± 0.38	Pass
BS-2063, 2064	5/1/2008	Gr. Beta	13.71 ± 2.06	17.60 ± 2.49	15.66 ± 1.62	Pass
SG-2229, 2230	5/5/2008	Ac-228	26.25 ± 2.70	24.90 ± 2.55	25.58 ± 1.86	Pass
W-2792, 2793	5/5/2008	Gr. Beta	7.20 ± 2.30	7.00 ± 2.50	7.10 ± 1.70	Pass
SG-2229, 2230	5/5/2008	Pb-214	23.28 ± 0.30	23.54 ± 0.33	23.41 ± 0.22	Pass
F-2850, 2851	5/7/2008	Cs-137	3.37 ± 0.21	3.16 ± 0.19	3.27 ± 0.14	Pass
DW-80376, 80377	5/9/2008	Ra-226	0.94 ± 0.13	1.07 ± 0.13	1.01 ± 0.09	Pass
DW-80376, 80377	5/9/2008	Ra-228	2.05 ± 0.57	1.40 ± 0.51	1.73 ± 0.38	Pass
MI-2363, 2364	5/14/2008	K-40	1335.40 ± 111.20	1510.70 ± 124.30	1423.05 ± 83.39	Pass
SG-2752, 2753	5/14/2008	Be-7	264.60 ± 83.90	222.80 ± 93.10	243.70 ± 62.66	Pass
SG-2752, 2753	5/14/2008	Cs-137	64.80 ± 6.00	68.90 ± 5.80	66.85 ± 4.17	Pass
SG-2752, 2753	5/14/2008	Gr. Alpha	19.35 ± 3.48	22.88 ± 4.04	21.12 ± 2.67	Pass
SG-2752, 2753	5/14/2008	Gr. Beta	30.53 ± 2.40	33.31 ± 2.71	31.92 ± 1.81	Pass
SG-2752, 2753	5/14/2008	K-40	9121.90 ± 191.80	9183.70 ± 194.20	9152.80 ± 136.47	Pass
DW-80389, 80390	5/14/2008	Ra-226	2.99 ± 0.36	2.58 ± 0.31	2.79 ± 0.24	Pass
DW-80389, 80390	5/14/2008	Ra-228	2.87 ± 0.68	1.73 ± 0.57	2.30 ± 0.44	Pass
DW-80392, 80393	5/14/2008	Gr. Alpha	19.94 ± 1.30	17.89 ± 1.26	18.92 ± 0.91	Pass
DW-80394, 80395	5/14/2008	U-233/4	2.03 ± 0.27	2.54 ± 0.39	2.29 ± 0.24	Pass
BS-2490, 2491	5/16/2008	Cs-137	6.81 ± 1.20	6.76 ± 1.23	6.78 ± 0.86	Pass
WW-2462, 2463	5/19/2008	H-3	158.61 ± 80.90	205.63 ± 83.06	182.12 ± 57.97	Pass
W-2826, 2827	5/27/2008	Gr. Alpha	3.47 ± 2.23	4.22 ± 2.20	3.84 ± 1.57	Pass
W-2826, 2827	5/27/2008	Gr. Beta	10.67 ± 1.92	9.43 ± 1.76	10.05 ± 1.30	Pass
SG-3378, 3379	6/2/2008	Gr. Alpha	6.51 ± 1.15	7.83 ± 1.32	7.17 ± 0.88	Pass
SG-3378, 3379	6/2/2008	Gr. Beta	16.23 ± 0.95	15.76 ± 1.06	16.00 ± 0.71	Pass
SG-3393, 3394	6/4/2008	Be-7	0.82 ± 0.23	0.66 ± 0.33	0.74 ± 0.20	Pass
SG-3393, 3394	6/4/2008	Cs-137	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01	Pass
SG-3393, 3394	6/4/2008	Gr. Alpha	18.96 ± 3.49	16.96 ± 3.34	17.96 ± 2.42	Pass
SG-3393, 3394	6/4/2008	Gr. Beta	30.01 ± 2.49	30.17 ± 2.56	30.09 ± 1.79	Pass
SG-3393, 3394	6/4/2008	K-40	9.78 ± 0.30	10.00 ± 0.28	9.89 ± 0.21	Pass
LW-2939, 2940	6/12/2008	Gr. Beta	1.46 ± 0.59	1.74 ± 0.59	1.60 ± 0.42	Pass
WW-3053, 3054	6/17/2008	Gr. Beta	4.28 ± 0.83	5.27 ± 0.91	4.77 ± 0.61	Pass
SW-3154, 3155	6/24/2008	Gr. Beta	2.15 ± 1.01	2.79 ± 0.97	2.47 ± 0.70	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			First Result	Second Result	Averaged Result	
BS-3245, 3246	6/27/2008	Co-60	108.84 ± 44.14	91.10 ± 22.32	99.97 ± 24.73	Pass
BS-3245, 3246	6/27/2008	Cs-137	952.18 ± 52.78	941.56 ± 13.61	946.87 ± 27.25	Pass
XW-1080, 1081	6/30/2008	Fe-55	2.96 ± 0.32	2.71 ± 0.30	2.84 ± 0.22	Pass
XW-3786, 3787	6/30/2008	Fe-55	2.96 ± 0.32	2.71 ± 0.30	2.84 ± 0.22	Pass
G-3274, 3275	7/1/2008	Gr. Beta	7.65 ± 0.24	7.44 ± 0.24	7.55 ± 0.17	Pass
SL-3295, 3296	7/1/2008	Gr. Beta	3.76 ± 0.24	3.64 ± 0.24	3.70 ± 0.17	Pass
AP-3531, 3532	7/1/2008	Be-7	0.10 ± 0.01	0.08 ± 0.01	0.09 ± 0.01	Pass
AP-3663, 3664	7/2/2008	Be-7	0.08 ± 0.01	0.08 ± 0.02	0.08 ± 0.01	Pass
AP-3690, 3691	7/2/2008	Be-7	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01	Pass
W-4333, 4334	7/7/2008	Gr. Beta	7.20 ± 1.90	7.70 ± 1.70	7.45 ± 1.27	Pass
W-4840, 4841	7/7/2008	Gr. Beta	6.70 ± 1.60	6.70 ± 1.80	6.70 ± 1.20	Pass
DW-80415, 80416	7/7/2008	Ra-226	2.81 ± 0.47	2.00 ± 0.34	2.41 ± 0.29	Pass
SG-3964, 3965	7/9/2008	Be-7	1.35 ± 0.23	1.51 ± 0.22	1.43 ± 0.16	Pass
SG-3964, 3965	7/9/2008	Cs-137	0.04 ± 0.01	0.04 ± 0.01	0.04 ± 0.00	Pass
SG-3964, 3965	7/9/2008	Gr. Alpha	23.17 ± 3.39	18.76 ± 3.24	20.97 ± 2.34	Pass
SG-3964, 3965	7/9/2008	Gr. Beta	28.99 ± 2.12	29.25 ± 2.31	29.12 ± 1.57	Pass
SG-3964, 3965	7/9/2008	K-40	6.86 ± 0.19	6.84 ± 0.17	6.85 ± 0.13	Pass
DW-80427, 80428	7/9/2008	Ra-226	3.25 ± 0.24	3.27 ± 0.20	3.26 ± 0.16	Pass
DW-80427, 80428	7/9/2008	Ra-228	2.65 ± 0.67	3.25 ± 0.72	2.95 ± 0.49	Pass
DW-80451, 80452	7/15/2008	Ra-226	1.02 ± 0.10	0.96 ± 0.12	0.99 ± 0.08	Pass
DW-80451, 80452	7/15/2008	Ra-228	1.09 ± 0.62	1.14 ± 0.60	1.12 ± 0.43	Pass
DW-80481, 80482	7/16/2008	Ra-226	1.20 ± 0.13	1.40 ± 0.14	1.30 ± 0.10	Pass
DW-80481, 80482	7/16/2008	Ra-228	1.69 ± 0.68	1.65 ± 0.77	1.67 ± 0.51	Pass
MI-3842, 3843	7/21/2008	K-40	1282.60 ± 108.30	1379.00 ± 111.40	1330.80 ± 77.68	Pass
MI-3892, 3893	7/28/2008	K-40	1371.50 ± 102.90	1501.20 ± 111.80	1436.35 ± 75.97	Pass
DW-4067, 4068	7/29/2008	Gr. Beta	10.46 ± 2.37	14.25 ± 2.78	12.36 ± 1.83	Pass
SWT-4158, 4159	7/29/2008	Gr. Beta	1.58 ± 0.45	1.80 ± 0.47	1.69 ± 0.33	Pass
LW-4221, 4222	7/31/2008	Gr. Beta	1.35 ± 0.56	0.91 ± 0.52	1.13 ± 0.38	Pass
LW-4242, 4243	7/31/2008	Gr. Beta	1.36 ± 0.56	1.18 ± 0.53	1.27 ± 0.38	Pass
VE-4046, 4047	8/4/2008	Be-7	0.77 ± 0.13	0.82 ± 0.19	0.80 ± 0.12	Pass
VE-4046, 4047	8/4/2008	Gr. Beta	8.81 ± 0.36	8.34 ± 0.31	8.58 ± 0.24	Pass
VE-4046, 4047	8/4/2008	K-40	5.17 ± 0.34	5.33 ± 0.42	5.25 ± 0.27	Pass
W-4821, 4822	8/4/2008	Gr. Alpha	1.70 ± 0.80	1.70 ± 0.90	1.70 ± 0.60	Pass
W-4821, 4822	8/4/2008	Gr. Beta	3.90 ± 0.80	3.70 ± 0.90	3.80 ± 0.60	Pass
W-4801, 4802	8/5/2008	Gr. Alpha	4.40 ± 2.40	4.80 ± 2.30	4.60 ± 1.66	Pass
W-4801, 4802	8/5/2008	Gr. Beta	13.20 ± 1.30	14.50 ± 1.40	13.85 ± 0.96	Pass
DW-80522, 80523	8/5/2008	Ra-226	0.50 ± 0.12	0.28 ± 0.12	0.39 ± 0.08	Pass
DW-80522, 80523	8/5/2008	Ra-228	1.23 ± 0.60	1.09 ± 0.57	1.16 ± 0.41	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) ^a			Acceptance
			First Result	Second Result	Averaged Result	
DW-80531, 80532	8/5/2008	Gr. Alpha	18.90 ± 1.86	17.80 ± 1.96	18.35 ± 1.35	Pass
DW-80534, 80535	8/5/2008	Ra-226	3.01 ± 0.18	3.33 ± 0.18	3.17 ± 0.13	Pass
DW-80534, 80535	8/5/2008	Ra-228	2.24 ± 0.59	2.12 ± 0.59	2.18 ± 0.42	Pass
SG-4584, 4585	8/6/2008	Be-7	7.11 ± 0.20	7.44 ± 0.37	7.27 ± 0.21	Pass
SG-4584, 4585	8/6/2008	Cs-137	0.05 ± 0.01	0.04 ± 0.01	0.04 ± 0.00	Pass
SG-4584, 4585	8/6/2008	K-40	7.88 ± 10.18	8.02 ± 0.21	7.95 ± 5.09	Pass
SG-4584, 4585	8/6/2008	Ra-226	3.94 ± 0.18	3.74 ± 0.22	3.84 ± 0.14	Pass
SG-4573, 4574	8/13/2008	Gr. Alpha	240.72 ± 8.74	251.53 ± 9.56	246.13 ± 6.48	Pass
SG-4573, 4574	8/13/2008	Gr. Beta	201.60 ± 4.28	206.88 ± 4.71	204.24 ± 3.18	Pass
SG-4584, 4585	8/13/2008	Gr. Alpha	14.07 ± 3.10	12.97 ± 3.04	13.52 ± 2.17	Pass
SG-4584, 4585	8/13/2008	Gr. Beta	22.08 ± 2.36	23.02 ± 2.34	22.55 ± 1.66	Pass
DW-80547, 80548	8/13/2008	Gr. Alpha	3.33 ± 1.11	3.88 ± 1.07	3.61 ± 0.77	Pass
DW-80551, 80552	8/13/2008	U-233/4	2.57 ± 0.48	2.13 ± 0.46	2.35 ± 0.33	Pass
DW-80553, 80554	8/13/2008	Ra-226	0.92 ± 0.14	1.21 ± 0.17	1.07 ± 0.11	Pass
DW-80553, 80554	8/13/2008	Ra-228	2.20 ± 0.61	1.64 ± 0.56	1.92 ± 0.41	Pass
DW-80566, 80567	8/20/2008	Ra-226	1.10 ± 0.11	1.10 ± 0.10	1.10 ± 0.07	Pass
DW-80566, 80567	8/20/2008	Ra-228	2.01 ± 0.58	1.74 ± 0.58	1.88 ± 0.41	Pass
VE-4647, 4648	8/27/2008	K-40	1.97 ± 0.17	2.00 ± 0.21	1.99 ± 0.14	Pass
SL-4690, 4691	9/2/2008	Gr. Beta	2.28 ± 0.25	2.35 ± 0.24	2.32 ± 0.17	Pass
ME-4732, 4733	9/2/2008	Gr. Beta	2.86 ± 0.09	2.70 ± 0.09	2.78 ± 0.06	Pass
ME-4732, 4733	9/2/2008	K-40	2.44 ± 0.37	2.82 ± 0.51	2.63 ± 0.32	Pass
SG-5180, 5181	9/3/2008	Be-7	15.50 ± 0.43	15.54 ± 0.38	15.52 ± 0.29	Pass
SG-5180, 5181	9/3/2008	Cs-137	0.07 ± 0.01	0.07 ± 0.01	0.07 ± 0.01	Pass
SG-5180, 5181	9/3/2008	Gr. Alpha	18.74 ± 3.33	17.61 ± 3.15	18.18 ± 2.29	Pass
SG-5180, 5181	9/3/2008	Gr. Beta	29.19 ± 2.10	28.49 ± 2.15	28.84 ± 1.50	Pass
SG-5180, 5181	9/3/2008	K-40	8.55 ± 0.32	8.11 ± 0.27	8.33 ± 0.21	Pass
SG-5187, 5188	9/3/2008	Be-7	6.18 ± 0.54	5.90 ± 0.77	6.04 ± 0.47	Pass
SG-5187, 5188	9/3/2008	K-40	7.16 ± 0.60	7.29 ± 0.60	7.23 ± 0.42	Pass
SG-5193, 5194	9/3/2008	Gr. Alpha	5.80 ± 1.30	7.00 ± 1.50	6.40 ± 0.99	Pass
SG-5193, 5194	9/3/2008	Gr. Beta	15.60 ± 1.10	15.60 ± 1.10	15.60 ± 0.78	Pass
DW-4871, 4872	9/5/2008	I-131	1.15 ± 0.27	1.16 ± 0.31	1.16 ± 0.21	Pass
VE-5022, 5023	9/10/2008	K-40	1.27 ± 0.14	1.11 ± 0.06	1.19 ± 0.08	Pass
DW-5337, 5338	9/10/2008	Gr. Beta	3.00 ± 1.07	2.19 ± 1.05	2.60 ± 0.75	Pass
WW-4977, 4978	9/17/2008	Gr. Beta	3.71 ± 1.10	2.32 ± 1.11	3.01 ± 0.78	Pass
BS-5088, 5089	9/19/2008	K-40	10493 ± 607	10299 ± 470	10396 ± 384	Pass
DW-80584, 80585	9/19/2008	U-233/4	3.01 ± 0.52	2.44 ± 0.47	2.73 ± 0.35	Pass
DW-80584, 80585	9/19/2008	U-238	0.70 ± 0.25	0.27 ± 0.18	0.49 ± 0.15	Pass
DW-80579, 80580	9/25/2008	Gr. Alpha	10.69 ± 1.31	12.84 ± 1.51	11.77 ± 1.00	Pass
DW-80579, 80580	9/25/2008	Ra-226	3.13 ± 0.22	2.89 ± 0.21	3.01 ± 0.15	Pass
DW-80579, 80580	9/25/2008	Ra-228	3.03 ± 0.73	1.98 ± 0.69	2.51 ± 0.50	Pass
G-5389, 5390	10/1/2008	Be-7	1.49 ± 0.32	1.36 ± 0.28	1.43 ± 0.21	Pass
G-5389, 5390	10/1/2008	Gr. Beta	10.86 ± 0.24	11.18 ± 0.25	11.02 ± 0.17	Pass
G-5389, 5390	10/1/2008	K-40	7.42 ± 0.67	8.06 ± 0.63	7.74 ± 0.46	Pass

TABLE A-5. In-House "Duplicate" Samples

Lab Code	Date	Analysis	Concentration (pCi/L) ^a		Averaged Result	Acceptance
			First Result	Second Result		
AP-5814, 5815	10/1/2008	Be-7	0.08 ± 0.01	0.08 ± 0.01	0.08 ± 0.01	Pass
SG-6111, 6112	10/6/2008	Gr. Alpha	9.34 ± 1.82	8.95 ± 1.67	9.15 ± 1.24	Pass
SG-6111, 6112	10/6/2008	Gr. Beta	17.46 ± 1.46	18.86 ± 1.35	18.16 ± 0.99	Pass
DW-80592, 80593	10/7/2008	Gr. Alpha	2.30 ± 1.14	1.57 ± 0.88	1.94 ± 0.72	Pass
DW-80594, 80595	10/7/2008	Ra-228	1.41 ± 0.55	1.22 ± 0.50	1.32 ± 0.37	Pass
DW-80650, 80651	10/8/2008	Gr. Alpha	1.30 ± 0.86	0.12 ± 0.79	0.71 ± 0.58	Pass
DW-80650, 80651	10/8/2008	Gr. Beta	2.92 ± 0.69	3.03 ± 0.64	2.98 ± 0.47	Pass
DW-80629, 80630	10/13/2008	Ra-226	3.12 ± 0.18	2.87 ± 0.17	3.00 ± 0.12	Pass
DW-80629, 80630	10/13/2008	Ra-228	2.71 ± 0.80	3.28 ± 0.81	3.00 ± 0.57	Pass
DW-80663, 80664	10/13/2008	Gr. Alpha	5.91 ± 1.70	3.14 ± 1.44	4.53 ± 1.11	Pass
MI-5572, 5573	10/14/2008	K-40	1391.00 ± 97.39	1443.90 ± 110.60	1417.45 ± 73.68	Pass
MI-5603, 5604	10/14/2008	K-40	1412.80 ± 109.30	1413.80 ± 110.50	1413.30 ± 77.71	Pass
DW-80676, 80677	10/20/2008	Gr. Alpha	12.20 ± 1.48	11.87 ± 1.54	12.04 ± 1.07	Pass
DW-80676, 80677	10/20/2008	Ra-226	5.04 ± 0.25	5.10 ± 0.25	5.07 ± 0.18	Pass
DW-80676, 80677	10/20/2008	Ra-228	5.87 ± 0.86	6.98 ± 0.95	6.43 ± 0.64	Pass
SW-80687, 80688	10/22/2008	Gr. Alpha	3.42 ± 1.03	2.98 ± 1.01	3.20 ± 0.72	Pass
DW-80729, 80730	10/30/2008	Gr. Alpha	8.40 ± 1.45	7.76 ± 2.00	8.08 ± 1.24	Pass
DW-80729, 80730	10/30/2008	Gr. Beta	16.94 ± 1.45	15.41 ± 1.37	16.18 ± 1.00	Pass
DW-80738, 80739	10/31/2008	U-233/4	2.94 ± 0.50	3.06 ± 0.63	3.00 ± 0.40	Pass
DW-80747, 80748	10/31/2008	Ra-226	0.60 ± 0.09	0.50 ± 0.08	0.55 ± 0.06	Pass
DW-80747, 80748	10/31/2008	Ra-228	1.33 ± 0.59	1.38 ± 0.60	1.36 ± 0.42	Pass
BS-6271, 6272	11/3/2008	Gr. Beta	12.26 ± 1.69	13.78 ± 1.84	13.02 ± 1.25	Pass
SS-6593, 6594	11/19/2008	K-40	12.35 ± 0.57	13.10 ± 0.76	12.73 ± 0.48	Pass
MI-7046, 7047	12/16/2008	K-40	1380.10 ± 109.80	1477.30 ± 98.32	1428.70 ± 73.69	Pass
DW-80698, 80699	12/23/2008	Ra-226	3.13 ± 0.22	3.21 ± 0.23	3.17 ± 0.16	Pass
DW-80698, 80699	12/23/2008	Ra-228	5.48 ± 0.91	5.86 ± 0.93	5.67 ± 0.65	Pass
SW-7281, 7282	12/30/2008	Gr. Beta	0.87 ± 0.54	1.35 ± 0.54	1.11 ± 0.38	Pass

Note: Duplicate analyses are performed on every twentieth sample received in-house. Results are not listed for those analyses with activities that measure below the LLD.

^a Results are reported in units of pCi/L, except for air filters (pCi/Filter), food products, vegetation, soil, sediment (pCi/g).

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP)^a.

Lab Code ^c	Date	Analysis	Concentration ^b			Acceptance
			Laboratory result	Known Activity	Control Limits ^d	
STW-1137	01/01/08	Am-241	1.27 ± 0.06	1.23	0.86 - 1.60	Pass
STW-1137	01/01/08	Co-57	23.80 ± 0.60	22.80	16.00 - 29.60	Pass
STW-1137	01/01/08	Co-60	8.60 ± 0.50	8.40	5.88 - 10.92	Pass
STW-1137	01/01/08	Cs-134	-0.02 ± 0.10	0.00	-1.00 - 1.00	Pass
STW-1137	01/01/08	Cs-137	0.00 ± 0.10	0.00	-1.00 - 1.00	Pass
STW-1137	01/01/08	Fe-55	32.60 ± 11.60	36.50	25.60 - 47.50	Pass
STW-1137	01/01/08	H-3	515.10 ± 12.70	472.00	330.00 - 614.00	Pass
STW-1137	01/01/08	Mn-54	12.90 ± 0.80	12.10	8.50 - 15.70	Pass
STW-1137	01/01/08	Ni-63	29.50 ± 2.30	30.70	21.50 - 39.90	Pass
STW-1137	01/01/08	Pu-238	0.60 ± 0.06	0.73	0.51 - 0.95	Pass
STW-1137	01/01/08	Pu-239/40	0.019 ± 0.015	0.01	0.00 - 1.00	Pass
STW-1137	01/01/08	Sr-90	12.00 ± 1.50	11.40	7.98 - 14.82	Pass
STW-1137	01/01/08	Tc-99	9.40 ± 1.70	11.20	7.80 - 14.60	Pass
STW-1137	01/01/08	U-233/4	3.37 ± 0.20	3.63	2.54 - 4.72	Pass
STW-1137	01/01/08	U-238	3.63 ± 0.21	3.74	2.62 - 4.86	Pass
STW-1137	01/01/08	Zn-65	16.90 ± 1.40	16.30	11.40 - 21.20	Pass
STW-1138	01/01/08	Gr. Alpha	0.96 ± 0.14	1.40	0.00 - 2.80	Pass
STW-1138	01/01/08	Gr. Beta	2.30 ± 0.15	2.43	1.22 - 3.65	Pass
STAP-1139	01/01/08	Co-57	3.90 ± 0.07	3.55	2.49 - 4.62	Pass
STAP-1139	01/01/08	Co-60	1.43 ± 0.07	1.31	0.92 - 1.70	Pass
STAP-1139	01/01/08	Cs-134	2.59 ± 0.16	2.52	1.76 - 3.28	Pass
STAP-1139	01/01/08	Cs-137	3.05 ± 0.12	2.70	1.89 - 3.51	Pass
STAP-1139	01/01/08	Mn-54	0.43 ± 0.58	0.00	0.00 - 1.00	Pass
STAP-1139	01/01/08	Pu-238	0.080 ± 0.016	0.11	0.07 - 0.14	Pass
STAP-1139	01/01/08	Pu-239/40	0.12 ± 0.02	0.11	0.08 - 0.15	Pass
STAP-1139	01/01/08	Sr-90	1.30 ± 0.27	1.55	1.08 - 2.01	Pass
STAP-1139 ^e	01/01/08	U-233/4	0.43 ± 0.03	0.22	0.15 - 0.28	Fail
STAP-1139 ^e	01/01/08	U-238	0.44 ± 0.03	0.23	0.16 - 0.29	Fail
STAP-1139	01/01/08	Zn-65	2.36 ± 0.18	2.04	1.43 - 2.65	Pass
STAP-1140	01/01/08	Gr. Alpha	0.11 ± 0.03	0.35	0.00 - 0.70	Pass
STAP-1140	01/01/08	Gr. Beta	0.34 ± 0.04	0.29	0.14 - 0.43	Pass
STVE-1141	01/01/08	Co-57	8.30 ± 0.18	6.89	4.82 - 8.96	Pass
STVE-1141	01/01/08	Co-60	3.03 ± 0.13	2.77	1.94 - 3.60	Pass
STVE-1141	01/01/08	Cs-134	6.53 ± 0.29	6.28	4.40 - 8.16	Pass
STVE-1141	01/01/08	Cs-137	3.90 ± 0.19	3.41	2.39 - 4.43	Pass
STVE-1141	01/01/08	Mn-54	5.43 ± 0.21	4.74	3.32 - 6.16	Pass
STVE-1141	01/01/08	Zn-65	0.033 ± 0.10	0.00	0.00 - 1.00	Pass

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP)^a.

Lab Code ^c	Date	Analysis	Concentration ^b			Acceptance
			Laboratory result	Known Activity	Control Limits ^d	
STSO-1142	01/01/08	Co-57	483.00 ± 3.00	421.00	295.00 - 547.00	Pass
STSO-1142	01/01/08	Co-60	3.00 ± 0.80	2.90	0.00 - 5.00	Pass
STSO-1142	01/01/08	Cs-134	896.50 ± 7.40	854.00	598.00 - 1110.00	Pass
STSO-1142	01/01/08	Cs-137	624.40 ± 4.10	545.00	382.00 - 709.00	Pass
STSO-1142	01/01/08	Mn-54	667.20 ± 3.80	570.00	399.00 - 741.00	Pass
STSO-1142	01/01/08	Ni-63	536.00 ± 15.50	640.00	448.00 - 832.00	Pass
STSO-1142	01/01/08	Pu-238	78.60 ± 4.80	72.80	51.00 - 94.60	Pass
STSO-1142	01/01/08	Pu-239/40	89.10 ± 4.50	90.10	63.10 - 117.10	Pass
STSO-1142	01/01/08	U-233/4	134.41 ± 5.40	142.00	99.00 - 185.00	Pass
STSO-1142	01/01/08	U-238	139.00 ± 5.50	148.00	104.00 - 192.00	Pass
STSO-1142	01/01/08	Zn-65	0.093 ± 0.91	0.00	0.00 - 1.00	Pass
STSO-1158	08/01/08	Am-241	57.73 ± 4.78	69.10	48.40 - 89.80	Pass
STSO-1158	08/01/08	Co-57	353.02 ± 2.01	333.00	233.00 - 433.00	Pass
STSO-1158	08/01/08	Co-60	151.99 ± 1.58	145.00	102.00 - 189.00	Pass
STSO-1158	08/01/08	Cs-134	499.72 ± 2.65	581.00	407.00 - 755.00	Pass
STSO-1158	08/01/08	Cs-137	2.54 ± 0.25	2.80	0.00 - 5.00	Pass
STSO-1158	08/01/08	K-40	643.94 ± 15.50	570.00	399.00 - 741.00	Pass
STSO-1158	08/01/08	Mn-54	452.14 ± 2.96	415.00	291.00 - 540.00	Pass
STSO-1158	08/01/08	Ni-63	803.09 ± 17.01	760.00	532.00 - 988.00	Pass
STSO-1158	08/01/08	Pu-238	0.12 ± 0.54	0.00	0.00 - 5.00	Pass
STSO-1158	08/01/08	Pu-239/40	60.88 ± 5.89	55.60	38.90 - 72.30	Pass
STSO-1158	08/01/08	Sr-90	1.95 ± 2.04	0.00	0.00 - 5.00	Pass
STSO-1158 [†]	08/01/08	Tc-99	337.00 ± 17.30	335.00	235.00 - 436.00	Pass
STSO-1158	08/01/08	U-238	315.67 ± 11.29	303.00	212.00 - 394.00	Pass
STSO-1158	08/01/08	Zn-65	0.10 ± 2.04	0.00	0.00 - 5.00	Pass
STVE-1159	08/01/08	Co-57	8.52 ± 0.23	7.10	5.00 - 9.20	Pass
STVE-1159	08/01/08	Co-60	5.08 ± 0.19	4.70	3.30 - 6.10	Pass
STVE-1159	08/01/08	Cs-134	5.26 ± 0.18	5.50	3.90 - 7.20	Pass
STVE-1159	08/01/08	Cs-137	0.01 ± 0.14	0.00	0.00 - 1.00	Pass
STVE-1159	08/01/08	Mn-54	6.39 ± 0.28	5.80	4.10 - 7.50	Pass
STVE-1159	08/01/08	Zn-65	7.73 ± 0.45	6.90	4.80 - 9.00	Pass

TABLE A-6. Department of Energy's Mixed Analyte Performance Evaluation Program (MAPEP)^a.

Lab Code ^c	Date	Analysis	Concentration ^b			Acceptance
			Laboratory result	Known Activity	Control Limits ^d	
STW-1162 ^g	08/01/08	Am-241	0.20 ± 0.06	0.00	0.00 - 0.10	Fail
STW-1162	08/01/08	Co-57	0.03 ± 0.16	0.00	0.00 - 5.00	Pass
STW-1162	08/01/08	Co-60	11.27 ± 0.23	11.60	8.10 - 15.10	Pass
STW-1162	08/01/08	Cs-134	17.93 ± 0.52	19.50	13.70 - 25.40	Pass
STW-1162	08/01/08	Cs-137	23.72 ± 0.43	23.60	16.50 - 30.70	Pass
STW-1162	08/01/08	Fe-55	43.36 ± 16.81	46.20	32.30 - 60.10	Pass
STW-1162	08/01/08	H-3	385.15 ± 8.93	341.00	239.00 - 443.00	Pass
STW-1162	08/01/08	Mn-54	13.87 ± 0.37	13.70	9.60 - 17.80	Pass
STW-1162 ^h	08/01/08	Ni-63	10.77 ± 2.01	0.00	0.00 - 5.00	Fail
STW-1162 ⁱ	08/01/08	Pu-238	0.33 ± 0.06	0.50	0.40 - 0.70	Fail
STW-1162	08/01/08	Pu-239/40	0.14 ± 0.15	0.00	0.00 - 0.20	Pass
STW-1162	08/01/08	Sr-90	6.49 ± 1.12	6.45	4.52 - 8.39	Pass
STW-1162 ^j	08/01/08	Tc-99	1.80 ± 0.62	3.76	2.63 - 4.89	Fail
STW-1162	08/01/08	U-233/4	3.33 ± 0.18	3.44	2.41 - 4.47	Pass
STW-1162	08/01/08	U-238	3.38 ± 0.18	3.55	2.49 - 4.62	Pass
STW-1162	08/01/08	Zn-65	17.64 ± 0.61	17.10	12.00 - 22.20	Pass
STW-1163	08/01/08	Gr. Alpha	0.08 ± 0.04	0.00	0.00 - 0.56	Pass
STW-1163	08/01/08	Gr. Beta	0.12 ± 0.05	0.00	0.00 - 1.85	Pass

^a Results obtained by Environmental, Inc., Midwest Laboratory as a participant in the Department of Energy's Mixed Analyte Performance Evaluation Program, Idaho Operations office, Idaho Falls, Idaho

^b Results are reported in units of Bq/kg (soil), Bq/L (water) or Bq/total sample (filters, vegetation).

^c Laboratory codes as follows: STW (water), STAP (air filter), STSO (soil), STVE (vegetation).

^d MAPEP results are presented as the known values and expected laboratory precision (1 sigma, 1 determination) and control limits as defined by the MAPEP.

^e The results of a repeat analysis were still unacceptable. A spiked air filter was prepared (known activity 4.17 pCi/filter) to verify the methodology; results of the spike analysis were acceptable, 4.64 pCi/filter.

^f Corrected result. An error in calculation was found.

^g Included in the testing series as a "false positive". Result of reanalysis, 0.04 ± 0.01 Bq/L.

^h Included in the testing series as a "false positive". Result of reanalysis, 3.78 ± 2.03 Bq/L.

ⁱ The reason for the deviation is unknown. Result of the original sample recount: 0.47 ± 0.07 Bq/L. The analysis was then repeated from the beginning. Result of reanalysis: 0.51 ± 0.07 Bq/L.

^j The lower result was due to a higher than average background count used in the calculation. Average background result: 4.11 ± 0.6

TABLE A-7. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)^a.

Lab Code ^b	Date	Analysis	Concentration (pCi/L)		Control Limits	Acceptance
			Laboratory Result ^c	ERA Result ^d		
STAP-1143	03/24/08	Am-241	60.48 ± 3.52	50.1	29.3 - 68.7	Pass
STAP-1143	03/24/08	Co-60	650.72 ± 3.00	730.0	565.0 - 912.0	Pass
STAP-1143	03/24/08	Cs-134	467.50 ± 5.53	523.0	341.0 - 647.0	Pass
STAP-1143	03/24/08	Cs-137	1375.90 ± 25.41	1450.0	1090.0 - 1900.0	Pass
STAP-1143	03/24/08	Fe-55	145.60 ± 28.94	241.0	106.0 - 375.0	Pass
STAP-1143 ^e	03/24/08	Mn-54	0.00 ± 0.00	0.0	0.0 - 10.0	Pass
STAP-1143	03/24/08	Pu-238	53.65 ± 1.54	46.8	32.1 - 61.5	Pass
STAP-1143	03/24/08	Pu-239/40	70.44 ± 3.11	64.1	46.5 - 83.0	Pass
STAP-1143	03/24/08	Sr-90	157.60 ± 7.70	152.0	66.9 - 236.0	Pass
STAP-1143	03/24/08	U-233/4	62.15 ± 3.41	66.7	42.0 - 98.8	Pass
STAP-1143	03/24/08	U-238	64.11 ± 3.29	66.2	42.4 - 94.0	Pass
STAP-1143	03/24/08	Uranium	128.40 ± 3.29	136.0	69.5 - 216.0	Pass
STAP-1143	03/24/08	Zn-65	889.90 ± 15.90	872.0	604.0 - 1210.0	Pass
STAP-1144	03/24/08	Gr. Alpha	13.08 ± 1.09	8.8	4.56 - 13.2	Pass
STAP-1144	03/24/08	Gr. Beta	99.90 ± 3.09	92.2	56.80 - 135.0	Pass
STSO-1145	03/24/08	Ac-228	1269.02 ± 36.81	1180.0	757.0 - 1660.0	Pass
STSO-1145	03/24/08	Am-241	1268.50 ± 85.80	1230.0	735.0 - 1580.0	Pass
STSO-1145	03/24/08	Bi-212	1407.10 ± 56.64	1360.0	357.0 - 2030.0	Pass
STSO-1145	03/24/08	Bi-214	2145.50 ± 305.63	1790.0	1100.0 - 2570.0	Pass
STSO-1145	03/24/08	Co-60	5219.70 ± 90.30	5130.0	3730.0 - 6890.0	Pass
STSO-1145	03/24/08	Cs-134	5427.30 ± 102.94	5640.0	3630.0 - 6790.0	Pass
STSO-1145	03/24/08	Cs-137	6346.60 ± 201.80	6010.0	4600.0 - 7810.0	Pass
STSO-1145	03/24/08	K-40	11052.70 ± 181.80	11000.0	7980.0 - 14900.0	Pass
STSO-1145 ^e	03/24/08	Mn-54	0.00 ± 0.00	0.0	0.0 - 10.0	Pass
STSO-1145	03/24/08	Pb-212	1198.20 ± 96.58	1080.0	697.0 - 1520.0	Pass
STSO-1145	03/24/08	Pb-214	2253.30 ± 291.60	2020.0	1210.0 - 3010.0	Pass
STSO-1145	03/24/08	Sr-90	6407.00 ± 277.00	5360.0	1940.0 - 8750.0	Pass
STSO-1145	03/24/08	Th-234	2421.80 ± 321.00	2030.0	644.0 - 3870.0	Pass
STSO-1145 ^f	03/24/08	U-233/4	1227.93 ± 91.52	2050.0	1240.0 - 2580.0	Fail
STSO-1145	03/24/08	U-238	1319.90 ± 48.81	2030.0	1240.0 - 2580.0	Pass
STSO-1145	03/24/08	Uranium	2592.00 ± 140.50	4180.0	2380.0 - 5640.0	Pass
STSO-1145	03/24/08	Zn-65	2936.20 ± 73.50	2660.0	2110.0 - 3570.0	Pass

TABLE A-7. Interlaboratory Comparison Crosscheck program, Environmental Resource Associates (ERA)^a.

Lab Code ^b	Date	Analysis	Concentration (pCi/L)			Acceptance
			Laboratory Result ^c	ERA Result ^d	Control Limits	
STVE-1146	03/24/08	Am-241	1261.50 ± 73.90	1260.0	718.0 - 1730.0	Pass
STVE-1146	03/24/08	Cm-244	1152.50 ± 57.44	1200.0	591.0 - 1870.0	Pass
STVE-1146	03/24/08	Co-60	912.41 ± 13.59	888.0	600.0 - 1280.0	Pass
STVE-1146	03/24/08	Cs-134	1547.70 ± 38.81	1540.0	882.0 - 2130.0	Pass
STVE-1146	03/24/08	Cs-137	1163.80 ± 20.62	1100.0	807.0 - 1530.0	Pass
STVE-1146	03/24/08	K-40	22186.00 ± 339.40	24600.0	17700.0 - 34800.0	Pass
STVE-1146 ^e	03/24/08	Mn-54	0.00 ± 0.00	0.0	0.0 - 10.0	Pass
STVE-1146	03/24/08	Sr-90	3825.90 ± 140.66	4130.0	2310.0 - 5480.0	Pass
STVE-1146	03/24/08	U-233/4	2753.30 ± 227.90	3070.0	2110.0 - 4070.0	Pass
STVE-1146	03/24/08	U-238	2697.10 ± 143.20	3050.0	2140.0 - 3850.0	Pass
STVE-1146	03/24/08	Uranium	5586.10 ± 455.20	6260.0	4300.0 - 8080.0	Pass
STVE-1146	03/24/08	Zn-65	1676.80 ± 43.00	1430.0	1030.0 - 1960.0	Pass
STW-1147	03/24/08	Am-241	97.56 ± 1.02	90.9	62.0 - 124.0	Pass
STW-1147	03/24/08	Co-60	1430.00 ± 33.33	1420.0	1240.0 - 1680.0	Pass
STW-1147	03/24/08	Cs-134	730.18 ± 33.39	751.0	555.0 - 862.0	Pass
STW-1147	03/24/08	Cs-137	1947.80 ± 13.80	1990.0	1690.0 - 2380.0	Pass
STW-1147	03/24/08	Fe-55	1422.70 ± 172.16	2080.0	1210.0 - 2780.0	Pass
STW-1147 ^e	03/24/08	Mn-54	0.00 ± 0.00	0.0	0.0 - 10.0	Pass
STW-1147	03/24/08	Pu-238	144.16 ± 4.54	135.0	102.0 - 168.0	Pass
STW-1147	03/24/08	Pu-239/40	82.16 ± 2.50	80.7	62.4 - 99.8	Pass
STW-1147	03/24/08	Sr-90	512.03 ± 43.37	512.0	325.0 - 684.0	Pass
STW-1147	03/24/08	U-233/4	74.40 ± 1.20	81.0	61.0 - 104.0	Pass
STW-1147	03/24/08	U-238	75.10 ± 1.35	80.3	61.3 - 99.5	Pass
STW-1147	03/24/08	Uranium	152.10 ± 2.55	165.0	119.0 - 220.0	Pass
STW-1147	03/24/08	Zn-65	708.90 ± 29.00	694.0	588.0 - 865.0	Pass
STW-1120	03/19/07	Uranium	339.60 ± 10.66	391.0	282.0 - 521.0	Pass
STW-1120	03/19/07	Zn-65	2009.00 ± 36.40	1910.0	1600.0 - 2410.0	Pass

^a Results obtained by: Environmental, Inc., Midwest Laboratory as a participant in the crosscheck program for proficiency testing administered by Environmental Resources Associates, serving as a replacement for studies conducted previously by the Environmental Measurements Laboratory Quality Assessment Program (EML).

^b Laboratory codes as follows: STW (water), STAP (air filter), STSO (soil), STVE (vegetation).

^c Unless otherwise indicated, the laboratory result is given as the mean ± standard deviation for three determinations.

^d Results are presented as the known values, expected laboratory precision (1 sigma, 1 determination) and control limits as provided by ERA.

^e Included in the testing series as a "false positive". No activity expected.

^f The analysis was repeated by leaching and total dissolution methods. Total dissolution yielded results within expected range. Results of the reanalysis: U-233,4, 1655 ± 95 pCi/kg. U-238 1805 ± 97 pCi/kg.

APPENDIX B

DATA REPORTING CONVENTIONS

Data Reporting Conventions

1.0. All activities, except gross alpha and gross beta, are decay corrected to collection time or the end of the collection period.

2.0. Single Measurements

Each single measurement is reported as follows: $x \pm s$

where: x = value of the measurement;

$s = 2\sigma$ counting uncertainty (corresponding to the 95% confidence level).

In cases where the activity is less than the lower limit of detection L , it is reported as: $< L$,

where L = the lower limit of detection based on 4.66σ uncertainty for a background sample.

3.0. Duplicate analyses

3.1 Individual results: For two analysis results; $x_1 \pm s_1$ and $x_2 \pm s_2$

Reported result: $x \pm s$; where $x = (1/2)(x_1 + x_2)$ and $s = (1/2)\sqrt{s_1^2 + s_2^2}$

3.2. Individual results: $< L_1, < L_2$ Reported result: $< L$, where L = lower of L_1 and L_2

3.3. Individual results: $x \pm s, < L$ Reported result: $x \pm s$ if $x \geq L$; $< L$ otherwise.

4.0. Computation of Averages and Standard Deviations

4.1 Averages and standard deviations listed in the tables are computed from all of the individual measurements over the period averaged; for example, an annual standard deviation would not be the average of quarterly standard deviations. The average \bar{x} and standard deviation s of a set of n numbers x_1, x_2, \dots, x_n are defined as follows:

$$\bar{x} = \frac{1}{n} \sum x \qquad s = \sqrt{\frac{\sum (x - \bar{x})^2}{n-1}}$$

4.2 Values below the highest lower limit of detection are not included in the average.

4.3 If all values in the averaging group are less than the highest LLD, the highest LLD is reported.

4.4 If all but one of the values are less than the highest LLD, the single value x and associated two sigma error is reported.

4.5 In rounding off, the following rules are followed:

4.5.1. If the number following those to be retained is less than 5, the number is dropped, and the retained number s are kept unchanged. As an example, 11.443 is rounded off to 11.44.

4.5.2. If the number following those to be retained is equal to or greater than 5, the number is dropped and the last retained number is raised by 1. As an example, 11.445 is rounded off to 11.45.

APPENDIX C

Maximum Permissible Concentrations
of Radioactivity in Air and Water
Above Background in Unrestricted Areas

Table C-1. Maximum permissible concentrations of radioactivity in air and water above natural background in unrestricted areas^a.

Air (pCi/m ³)		Water (pCi/L)	
Gross alpha	1×10^{-3}	Strontium-89	8,000
Gross beta	1	Strontium-90	500
Iodine-131 ^b	2.8×10^{-1}	Cesium-137	1,000
		Barium-140	8,000
		Iodine-131	1,000
		Potassium-40 ^c	4,000
		Gross alpha	2
		Gross beta	10
		Tritium	1×10^6

^a Taken from Table 2 of Appendix B to Code of Federal Regulations Title 10, Part 20, and appropriate footnotes. Concentrations may be averaged over a period not greater than one year.

^b Value adjusted by a factor of 700 to reduce the dose resulting from the air-grass-cow-milk-child pathway.

^c A natural radionuclide.

APPENDIX D
Sampling Location Maps


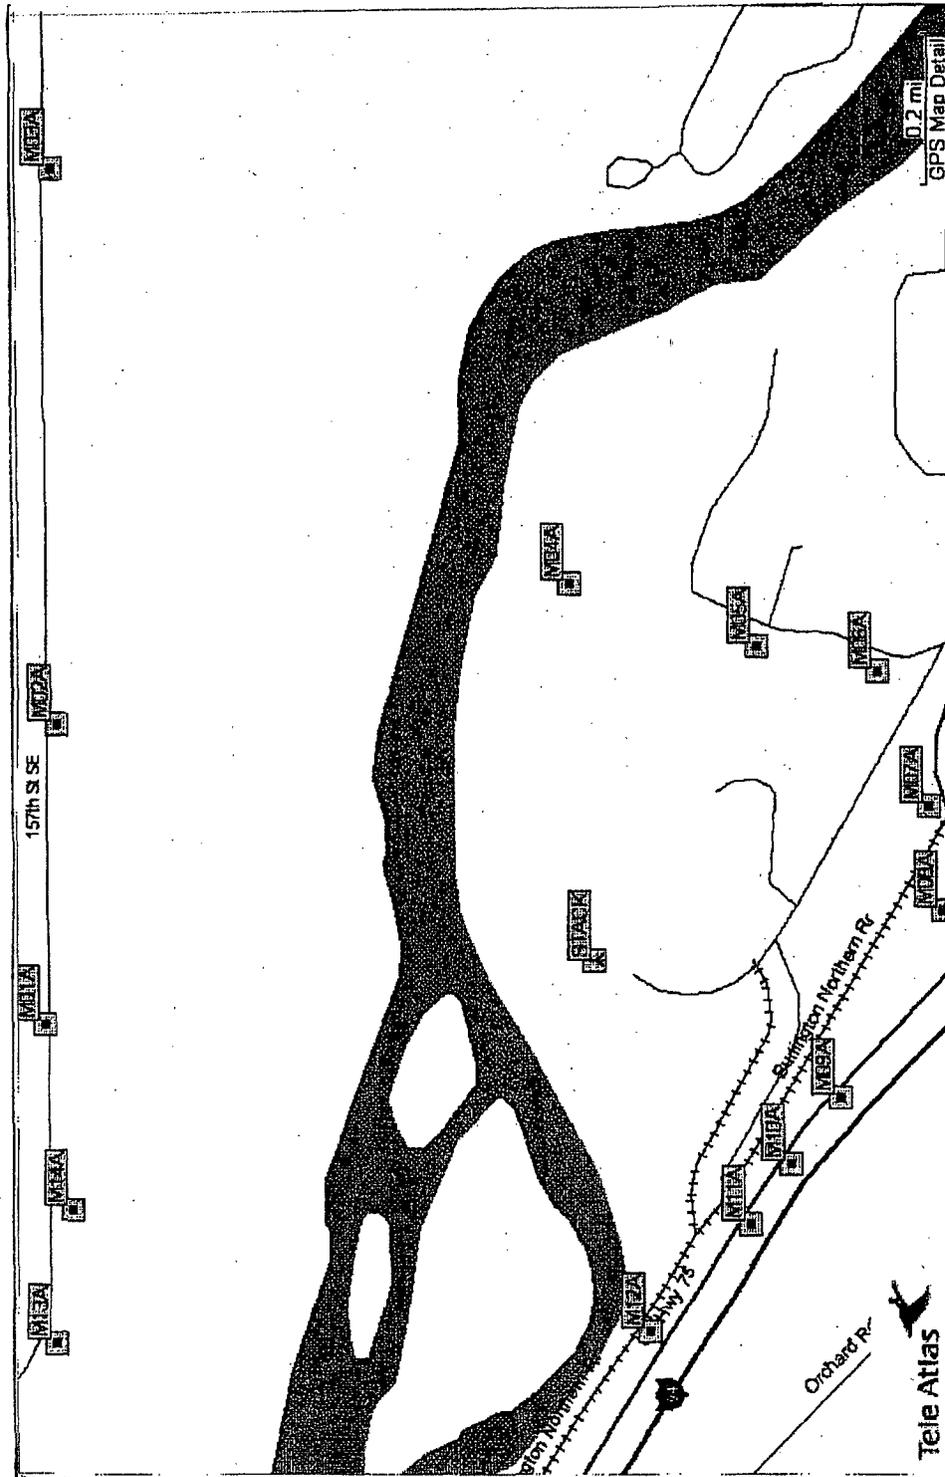


Figure D-1, Sample Collection and Analysis program: TLD locations, Inner ring (Table 5.2).

© Garth Corporation 1995-2002
 © 2011 Inco USA
 © 2011 Teje Atlas North America, Inc.
 © 2011 Interstate America db/a eGISource. All rights reserved.

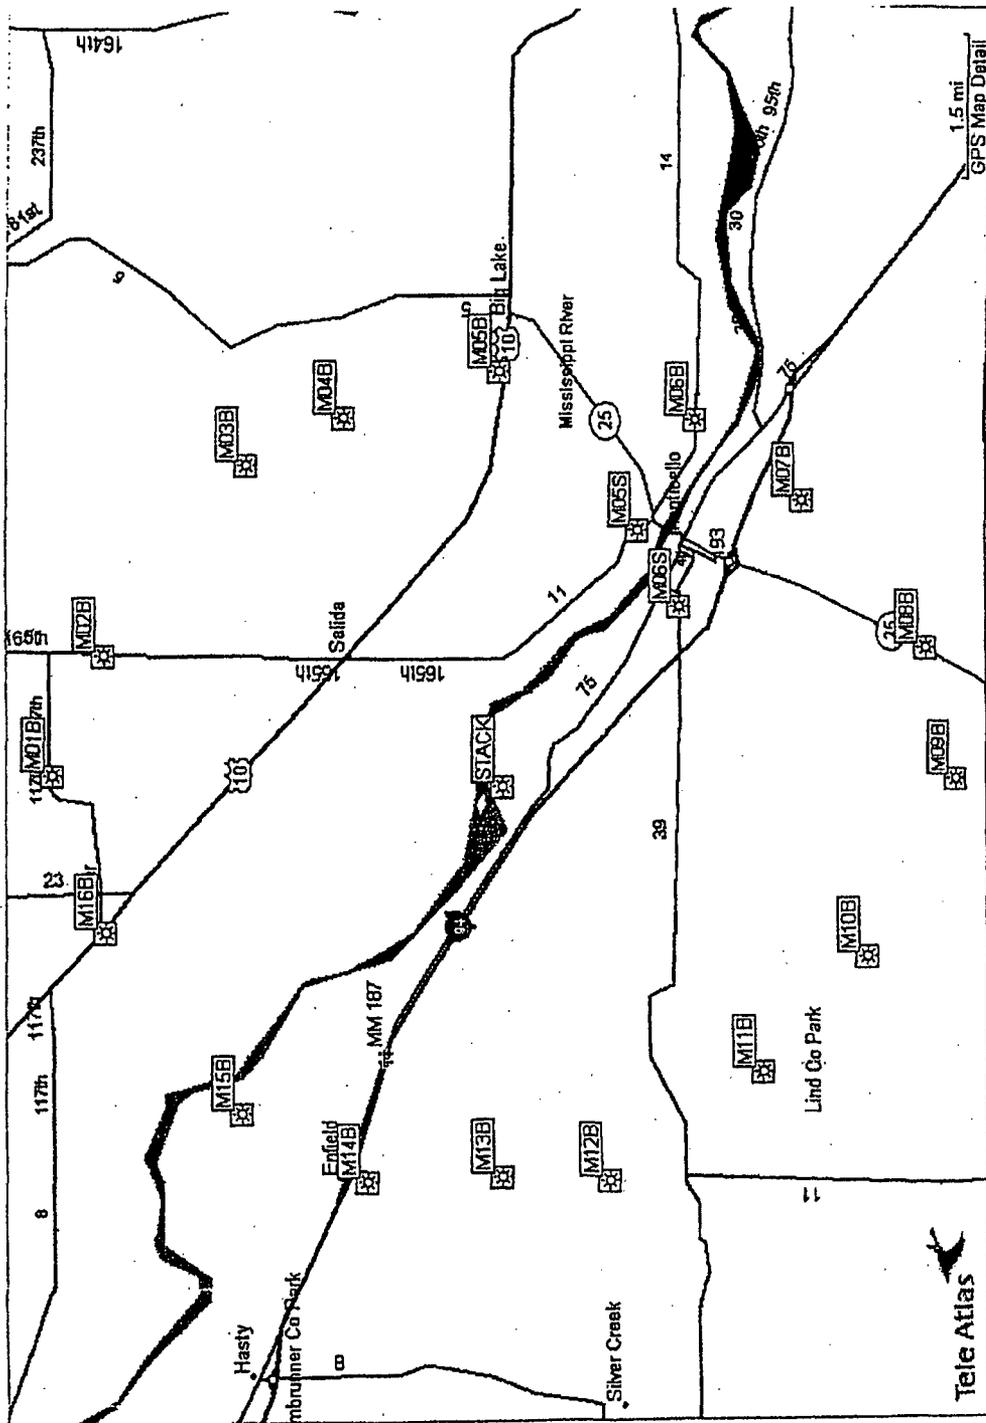

© Garmin Corporation 1995-2002
 © 2001 InRoadUSA
 © 2001 Tele Atlas North America, Inc.
 © 2001 Interstate America db/a eXtremeSource. All rights reserved.

Figure D-2. Sample Collection and Analysis program: TLD locations, Outer ring (Table 5.2).

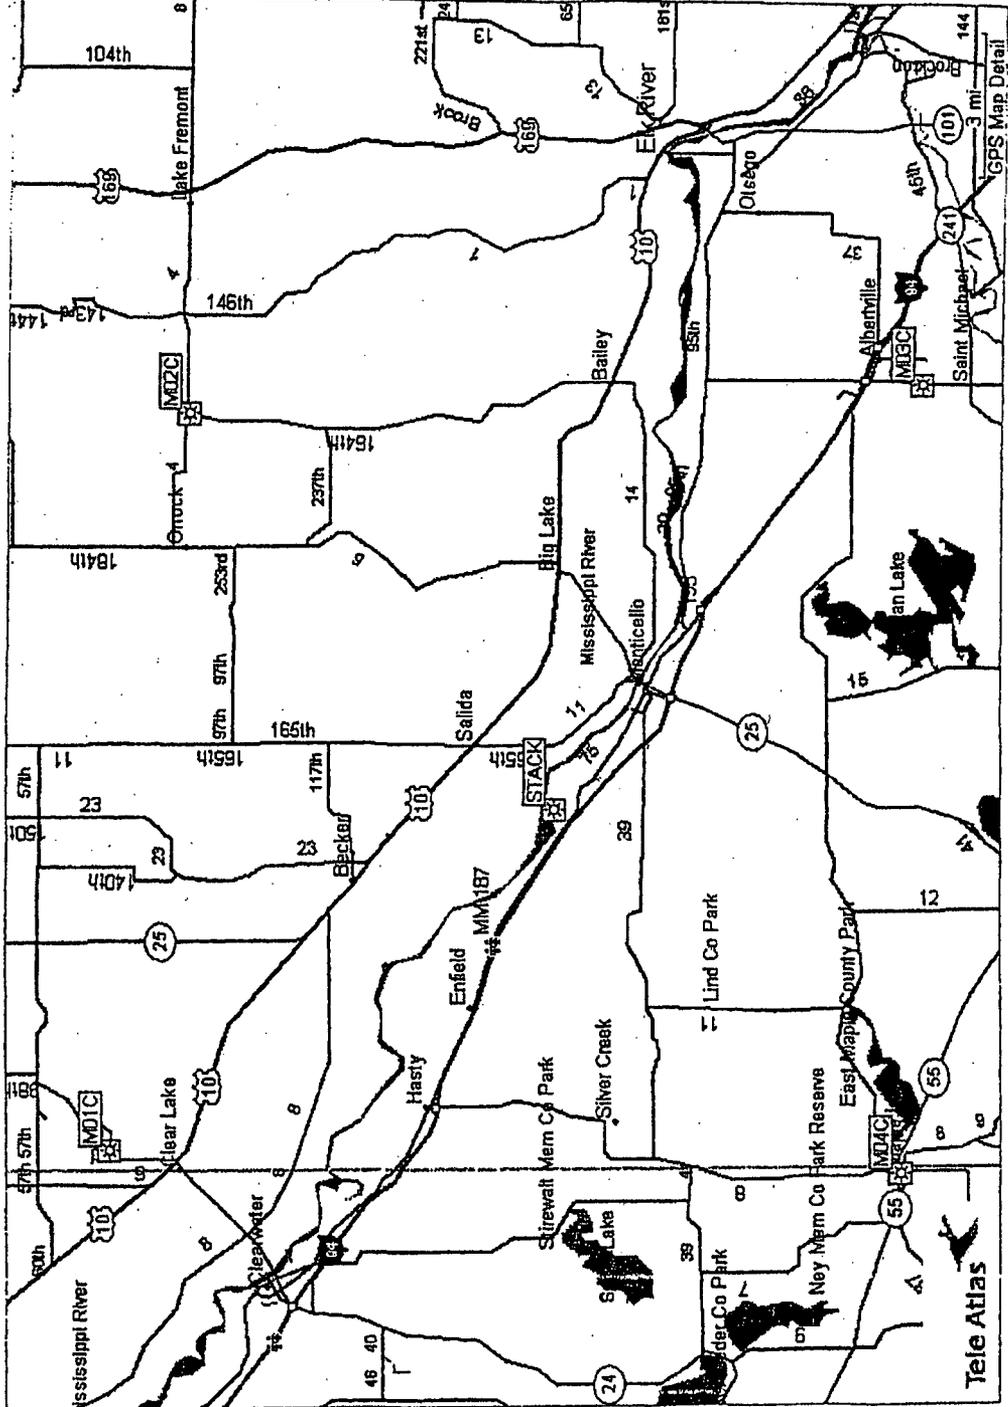


Figure D-3. Sample Collection and Analysis program: TLD locations, Controls (Table 5.2).

© Garmin Corporation 1995-2002
 © 2001 Tele Atlas North America, Inc.
 © 2001 Tele Atlas North America, Inc.
 © 2001 Tele Atlas North America, Inc. All rights reserved.

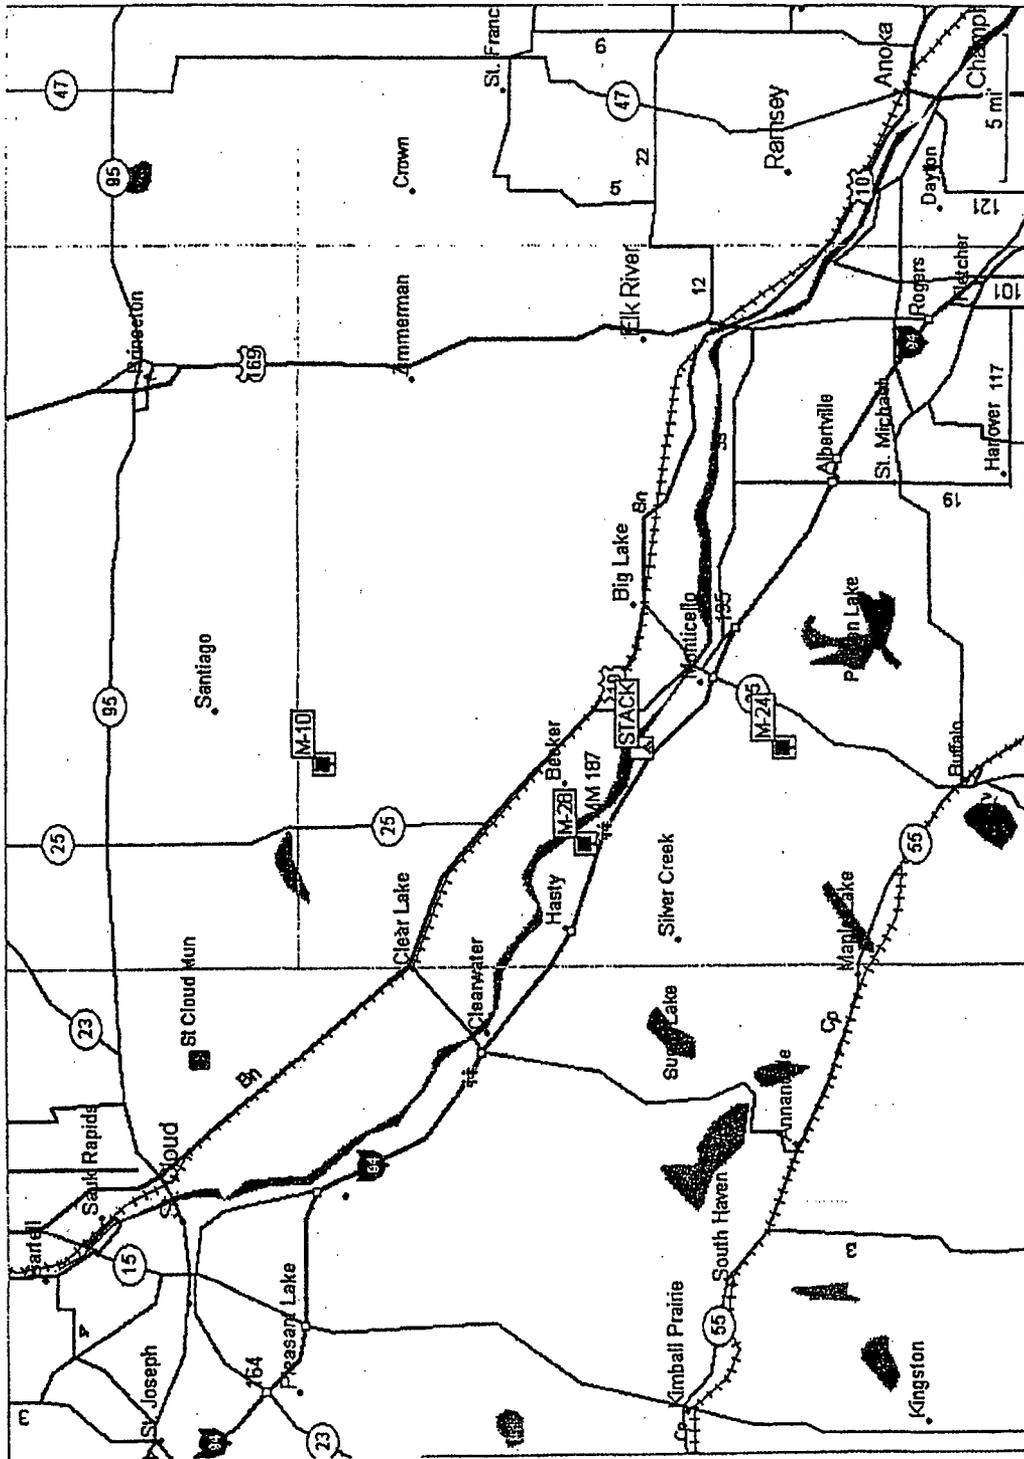


Figure D-4. Sample Collection and Analysis Program: Radiation Environmental Monitoring Program, Milk sampling locations. (Table 5.2)

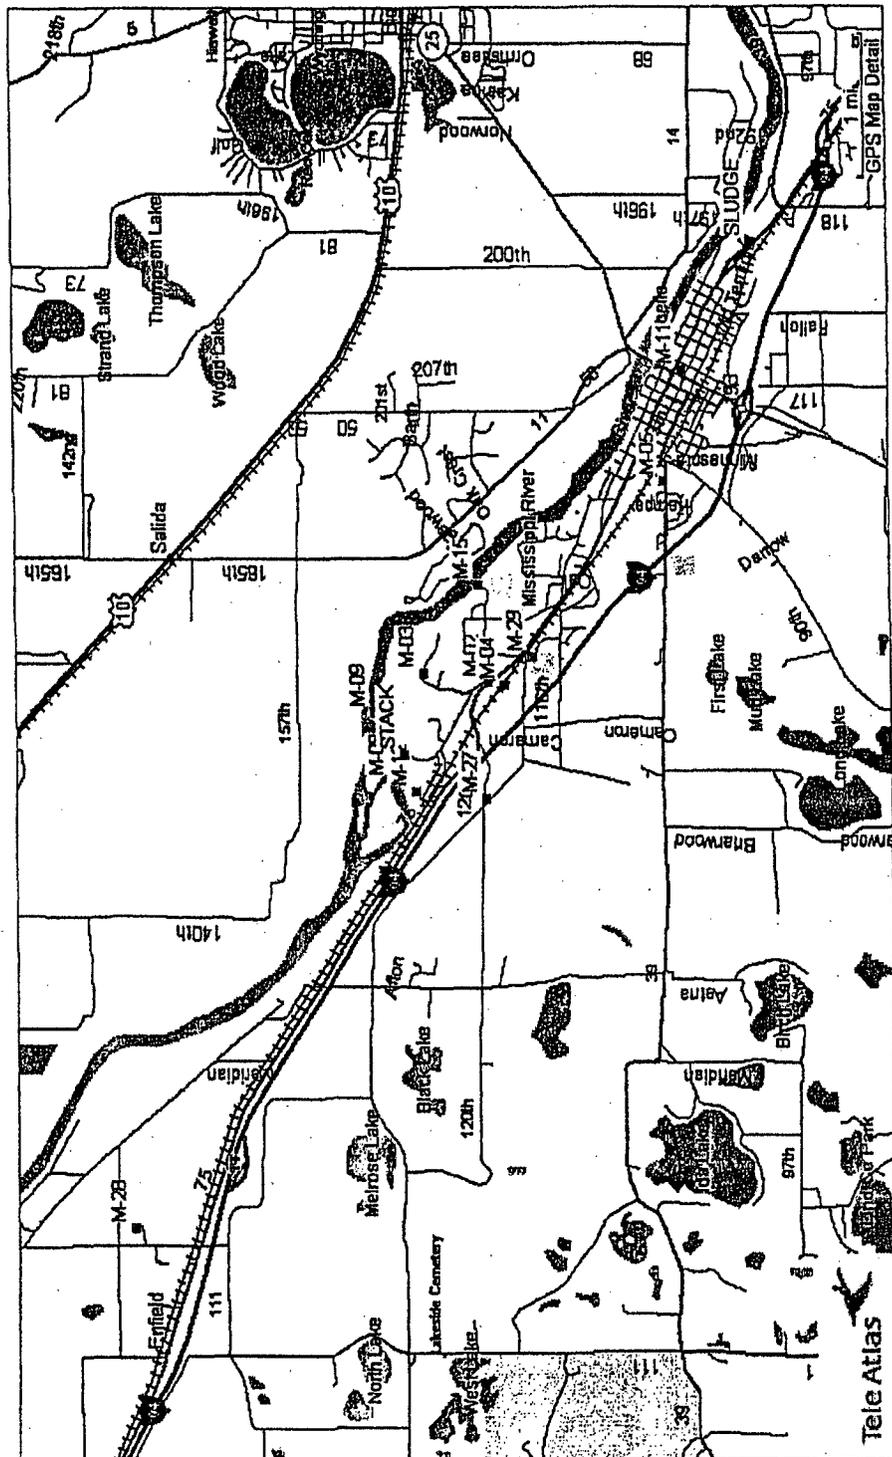


Figure D-5. Sample Collection and Analysis Program: Radiation Environmental Monitoring Program, Milk, Sludge, Ground Water and Shoreline sampling locations (Table 5-2.)

© Garmin Corporation 1995-2002
 © 2001 InfoUSA
 © 2001 Tele Atlas North America, Inc.