


26

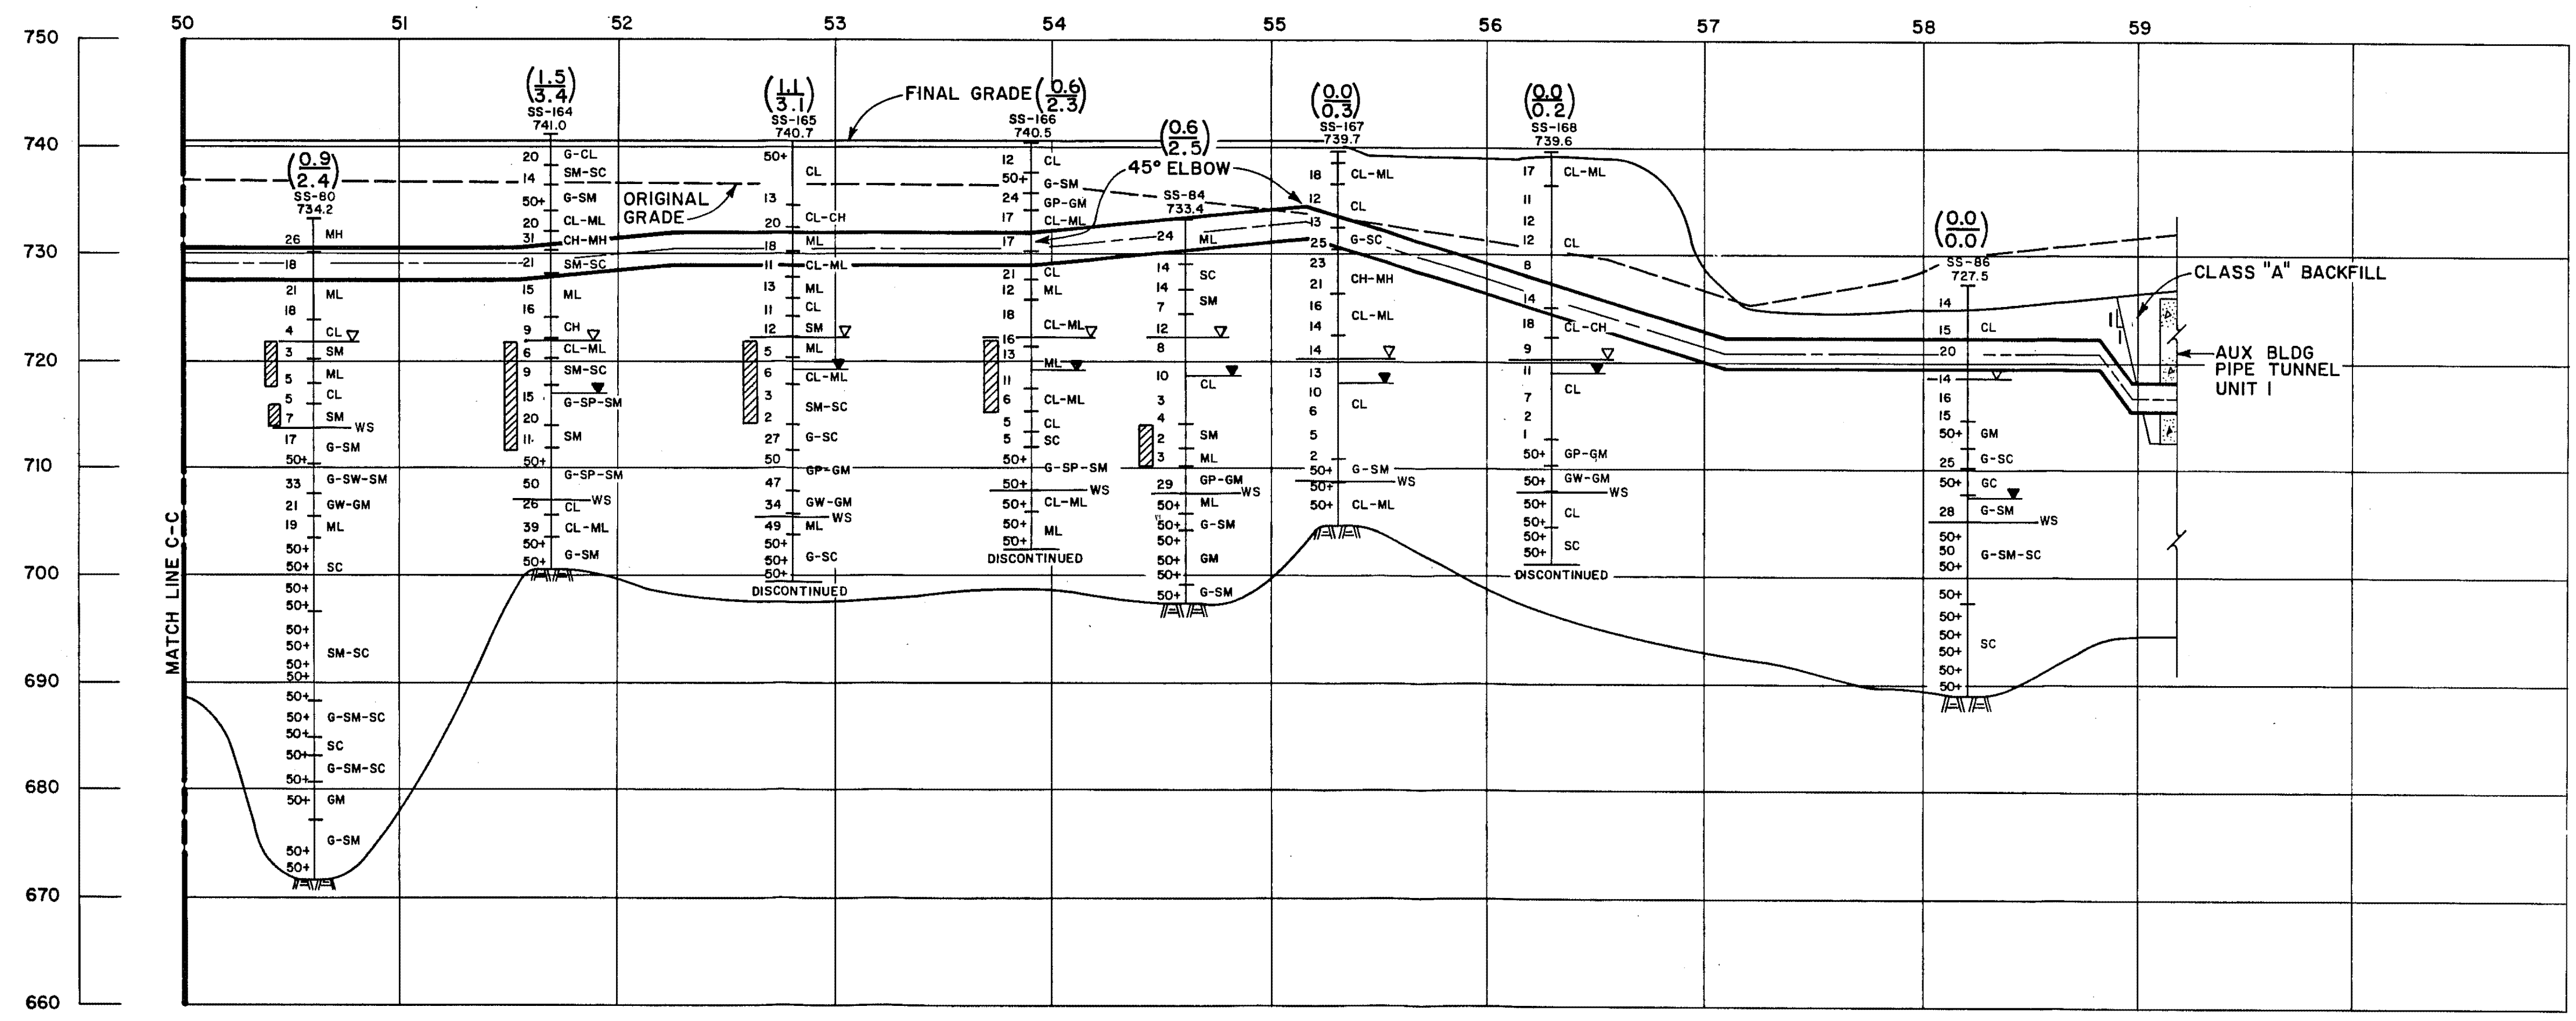

(0.6) POTENTIAL SETTLEMENT BASED ON 1.5% ϵ CRITERIA (INCHES)
 (2.3) POTENTIAL SETTLEMENT BASED ON 6% ϵ CRITERIA (INCHES)

- ▽ DESIGN WATER TABLE
- ▼ WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION
- I3 BLOW COUNT
- ▨ POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE:
 1. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRIS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY ANALYSIS REPORT

ERCW PIPELINE
 SECTION A-A SHEET 4 OF 4
 FIGURE 2.5-571

A-A