


37

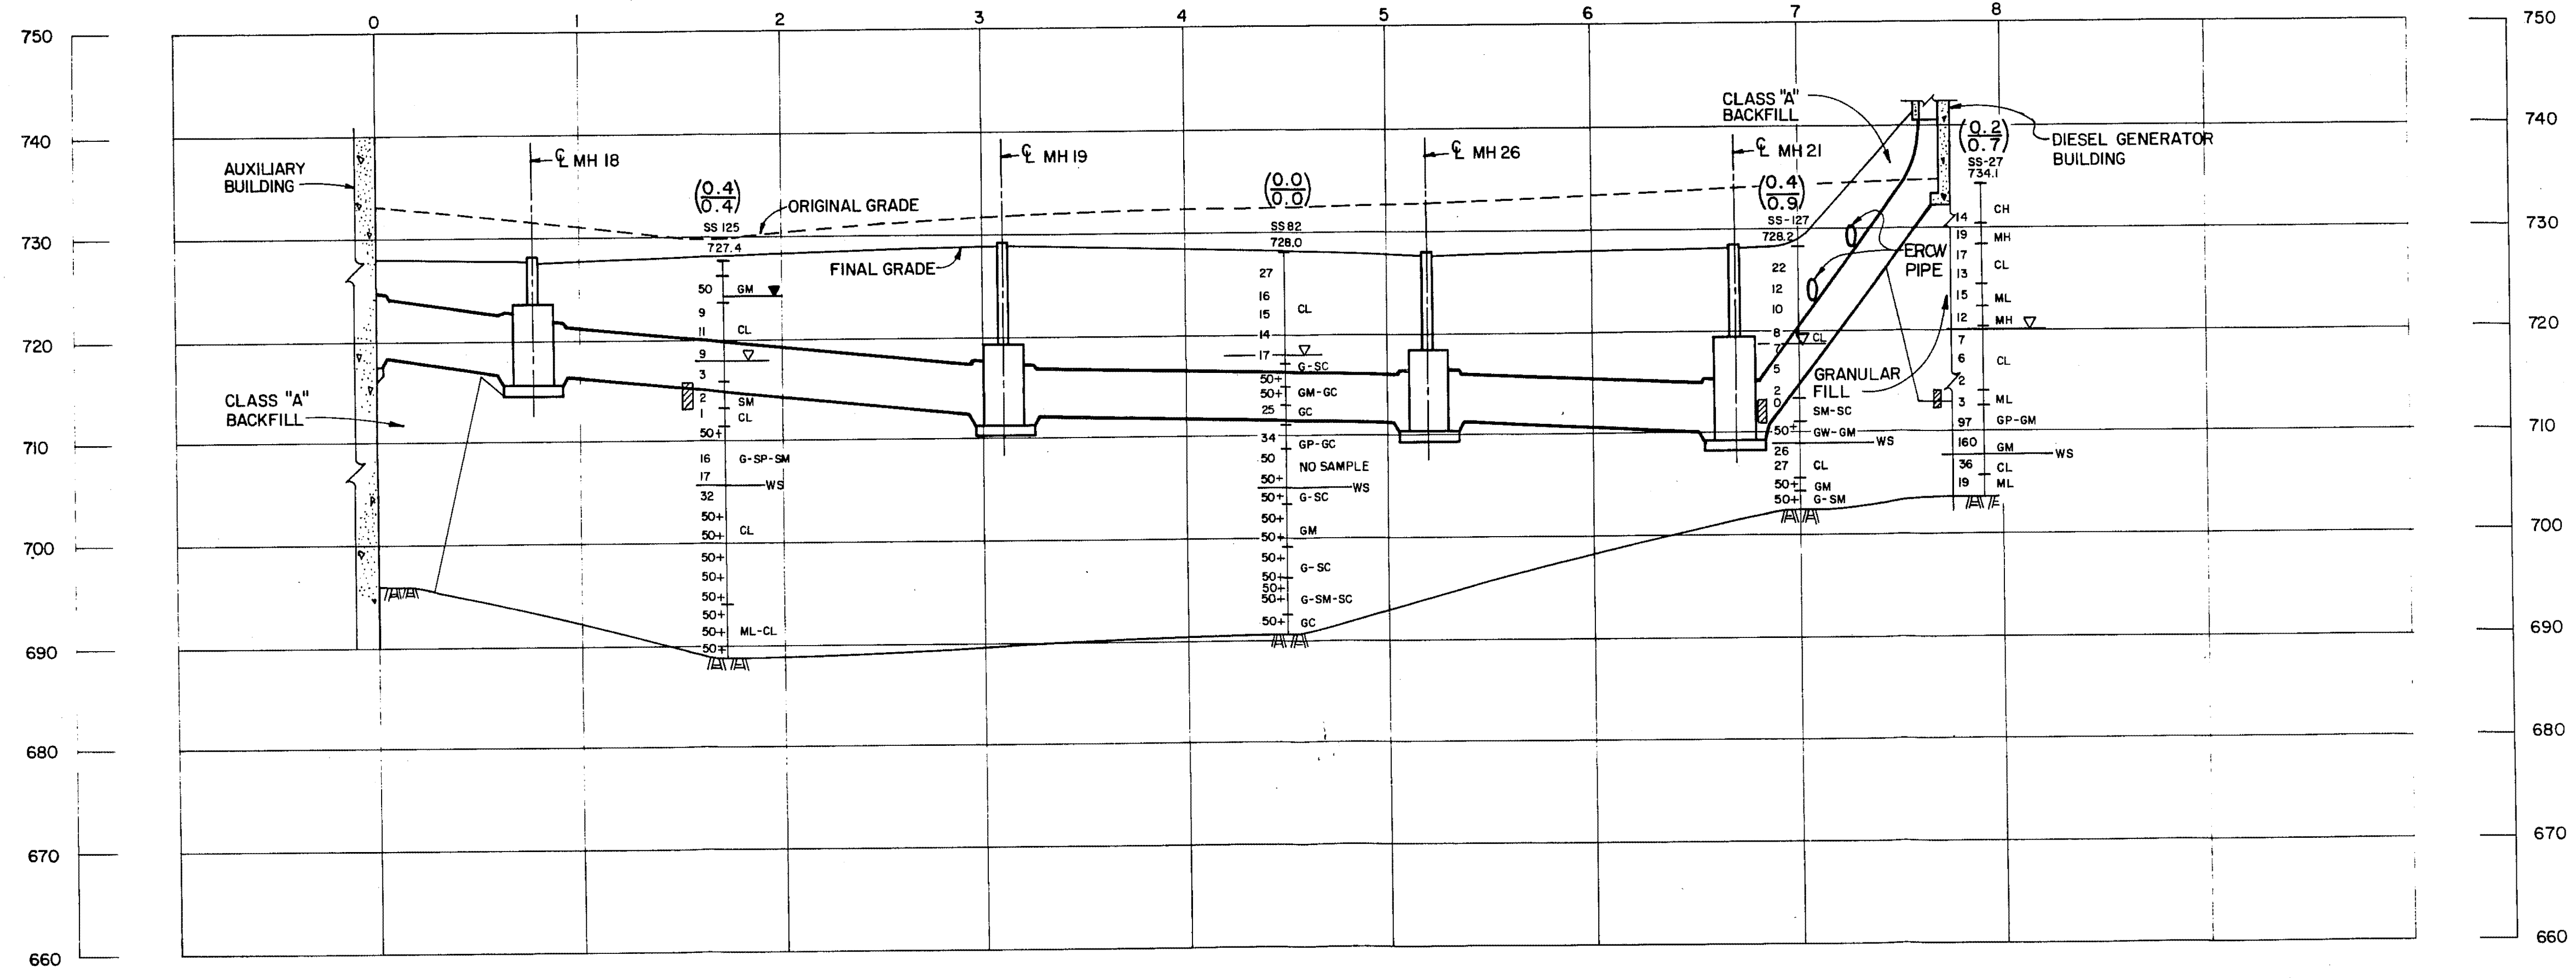

G-G

POTENTIAL SETTLEMENT BASED ON 1.5%  $\epsilon$  CRITERIA (INCHES)  
 (0.2)  
 (0.7) POTENTIAL SETTLEMENT BASED ON 6%  $\epsilon$  CRITERIA (INCHES)

- $\nabla$  DESIGN WATER TABLE
- $\blacktriangledown$  WATER TABLE (24 HR)
- MH SOIL CLASSIFICATION  
13 BLOW COUNT
- $\square$  POTENTIALLY LIQUEFIABLE SOIL (SEE NOTE)
- WS WEATHERED SHALE

NOTE:  
 I. LIQUEFACTION BASED ON TOP OF GROUND ACCELERATION OF 0.4g AND SEED - IDRISS (1971) CORRELATION FOR SANDS.

Added by Amendment 50

WATTS BAR NUCLEAR PLANT  
 FINAL SAFETY  
 ANALYSIS REPORT  
 CATEGORY I ELECTRICAL CONDUITS  
 SECTION G-G  
 FIGURE 2.5-577