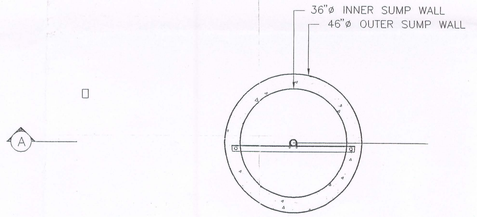

DETAIL CD6–1
PLAN VIEW
SUMP MANHOLE, VALVE AND METER BUILDING
SCALE 1/2" = 1'–0"

NOTES:
1. ALL SHADED ITEMS ARE TO BE INSTALLED BY OTHERS.
2. THE CONTRACTOR SHALL COORDINATE WORK WITH WASTEWATER TREATMENT FACILITY CONTRACTOR.

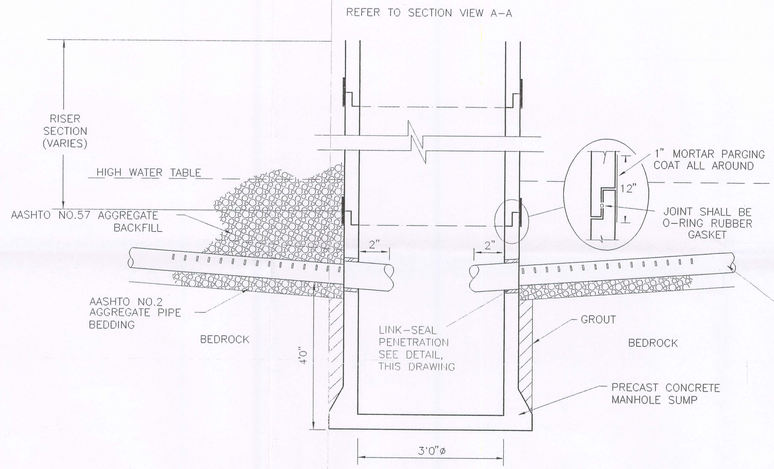

SECTION B
TYPICAL PRECAST CONCRETE MANHOLE SUMP
NOT TO SCALE

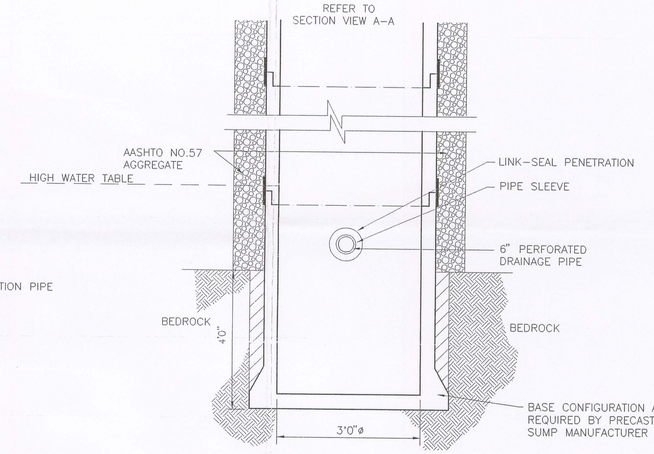

SECTION C
TYPICAL PRECAST CONCRETE MANHOLE SUMP
TRENCH LINE VIEW
NOT TO SCALE

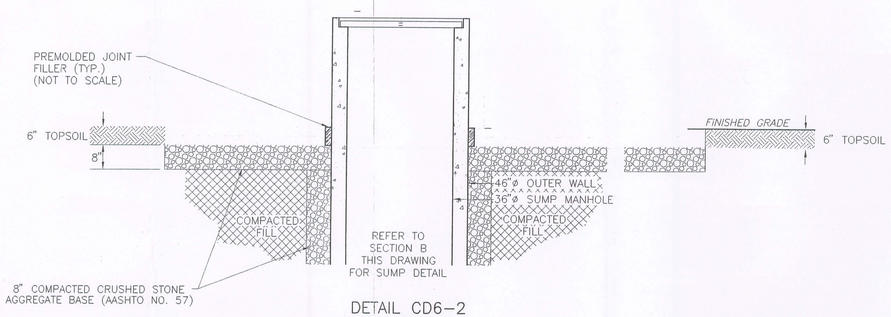

DETAIL CD6–2
SECTION VIEW A–A
MANHOLE, VALVE AND METER BUILDING
SCALE 1/2" = 1'–0"

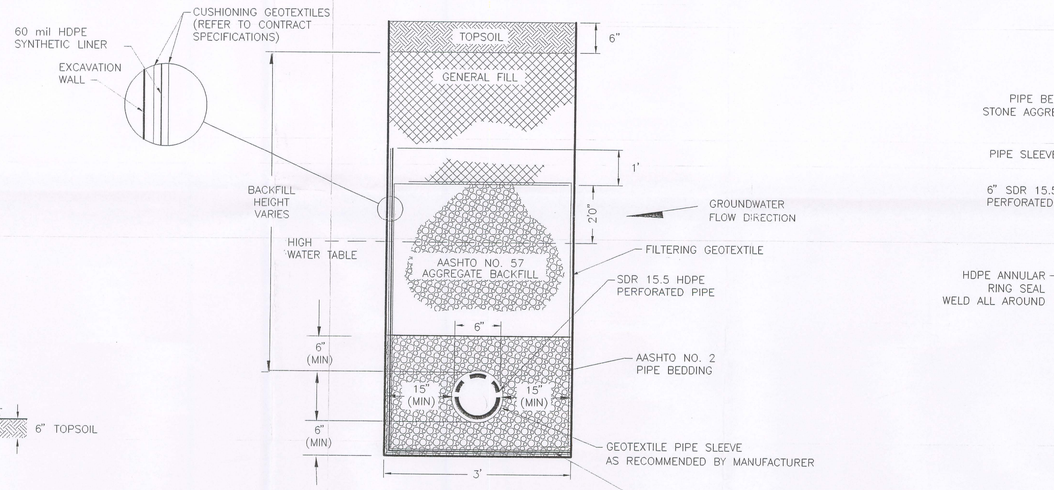

DETAIL CD6–3
GRAVITY PIPE
TYPICAL BEDDING AND BACKFILL DETAIL
NOT TO SCALE

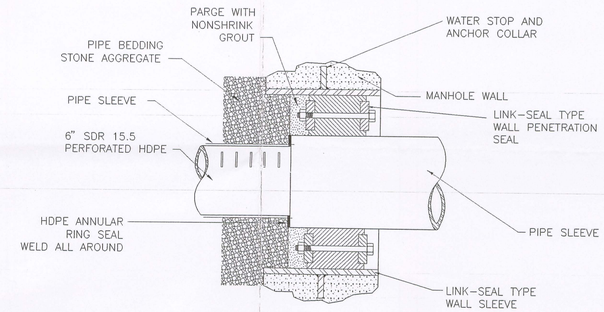

DETAIL CD6–4
TYPICAL LINK–SEAL DETAIL
NOT TO SCALE

REVISION	DATE	DESCRIPTION
⚠	11/18/99	AS–BUILT

CD–6
TRENCH DETAILS
EXCAVATION AND ON–SITE MANAGEMENT OF RADIOLOGICALLY AFFECTED SOILS AND GROUNDWATER COLLECTION TRENCH
CONTRACT DRAWING PACKAGE
MUSKOGEE, OKLAHOMA

PREPARED FOR
FANSTEEL, INC.
MUSKOGEE, OKLAHOMA D-06

APPROVED	JPKipling
CHECKED	RM 12/15/99
DRAWN	WJA/29JAN1998

DRAWING NUMBER
3789506

Earth Sciences Consultants, Inc.