

EDO Principal Correspondence Control

FROM: DUE: 07/24/09

EDO CONTROL: G20090359
DOC DT: 06/17/09
FINAL REPLY:

Tom Gurdziel
Oswego, New York

TO:

Borchardt, EDO

FOR SIGNATURE OF :

** GRN **

CRC NO:

Leeds, NRR

DESC:

2.206 - Entergy/Indian Point 2 & 3
(EDATS: OEDO-2009-0401)

ROUTING:

Borchardt
Virgilio
Mallett
Ash
Ordaz
Burns/Gray
Collins, RI
Burns, OGC
Mensah, NRR
Marco, OGC
Trocine, OEDO

DATE: 06/24/09

ASSIGNED TO:

CONTACT:

NRR

Leeds

SPECIAL INSTRUCTIONS OR REMARKS:

Template: EDO-001

E-RIDS: EDO-01

EDATS

Electronic Document and Action Tracking System

EDATS Number: OEDO-2009-0401

Source: OEDO

General Information

Assigned To: NRR

OEDO Due Date: 7/24/2009 5:00 PM

Other Assignees:

SECY Due Date: NONE

Subject: 2.206 - Entergy/Indian Point 2 & 3

Description:

CC Routing: Region I; OGC

ADAMS Accession Numbers - Incoming: NONE

Response/Package: NONE

Other Information

Cross Reference Number: G20090359

Staff Initiated: NO

Related Task:

Recurring Item: NO

File Routing: EDATS

Agency Lesson Learned: NO

Roadmap Item: NO

Process Information

Action Type: Letter

Priority: Medium

Sensitivity: None

Signature Level: NRR

Urgency: NO

OEDO Concurrence: NO

OCM Concurrence: NO

OCA Concurrence: NO

Special Instructions: Copies to T. Mensah, NRR and C. Marco, OGC.

Document Information

Originator Name: Tom Gurdziel

Date of Incoming: 6/17/2009

Originating Organization: Citizens

Document Received by OEDO Date: 6/24/2009

Addressee: R. W. Borchardt, EDO

Date Response Requested by Originator: 7/24/2009

Incoming Task Received: 2.206

9 Twin Orchard Drive
Oswego, NY 13126
June 17, 2009

Mr. R. William Borchardt, Executive Director for Operations
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

Dear Mr. R. William Borchardt:

This is a 2.206 request letter.


I am greatly disturbed by the lack of progress I see in repairing a boiler feedwater pump at Entergy/Indian Point 3. On the one hand, it is a non-safety related item. However, on the other hand, they just repaired it in their Spring 2009 Refuel Outage about 2 months ago. It ran only about 3 weeks before it failed. Currently, they have spent about another 3 weeks working on it unsuccessfully.

Request One

While this type of repair performance can be tolerated for non-safety related equipment, I do not find it acceptable for repair of safety-related equipment. Therefore, I am requesting that Entergy/Indian Point Unit 3 be shut down immediately if any journeyman (or higher) Entergy employee who has worked on the feedwater system from the outage to now is not restricted from working on Unit 3 safety-related equipment. Also, if all such employees are not restricted from working on Unit 2 safety-related equipment, I request that Entergy/Indian Point Unit 2 be shut down immediately, too. Also include all Unit 2 feedwater system engineers and all Unit 2 component engineers accountable for pumps. Do not include any helper-type mechanics.

Request Two


And, until Entergy/Indian Point 3 can prove that they can suitably maintain plant equipment less than 40 years old, I request that any NRC actions for relicensing Indian Point Unit 3 (to a 60 year life) be put on hold.

Thank you,

Tom Gurdziel


EDO --G20090359

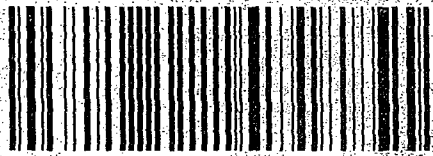

Thomas Gurdziel
9 Twin Orchard Dr.
Oswego, NY 13126



7008 3230 0002 8041 2808

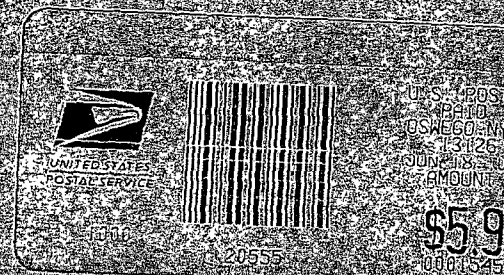

UNITED STATES POSTAL SERVICE
20555
\$5.90
0001545

Handwritten:
Fwd
20852

**RETURN RECEIPT
REQUESTED**

Handwritten:
Mr R. William Borchardt, Executive Director for Operations
US Nuclear Regulatory Commission
Washington, DC 20555-0001

