



NUREG-1437, Volume 1
Revision 1

Generic Environmental Impact Statement for License Renewal of Nuclear Plants

Main Report

Draft Report for Comment

AVAILABILITY OF REFERENCE MATERIALS IN NRC PUBLICATIONS

NRC Reference Material

As of November 1999, you may electronically access NUREG-series publications and other NRC records at NRC's Public Electronic Reading Room at <http://www.nrc.gov/reading-rm.html>.

Publicly released records include, to name a few, NUREG-series publications; *Federal Register* notices; applicant, licensee, and vendor documents and correspondence; NRC correspondence and internal memoranda; bulletins and information notices; inspection and investigative reports; licensee event reports; and Commission papers and their attachments.

NRC publications in the NUREG series, NRC regulations, and *Title 10, Energy*, in the Code of *Federal Regulations* may also be purchased from one of these two sources.

1. The Superintendent of Documents
U.S. Government Printing Office
Mail Stop SSOP
Washington, DC 20402-0001
Internet: bookstore.gpo.gov
Telephone: 202-512-1800
Fax: 202-512-2250
2. The National Technical Information Service
Springfield, VA 22161-0002
www.ntis.gov
1-800-553-6847 or, locally, 703-605-6000

A single copy of each NRC draft report for comment is available free, to the extent of supply, upon written request as follows:

Address: U.S. Nuclear Regulatory Commission
Office of Administration
Mail, Distribution and Messenger Team
Washington, DC 20555-0001
E-mail: DISTRIBUTION@nrc.gov
Facsimile: 301-415-2289

Some publications in the NUREG series that are posted at NRC's Web site address <http://www.nrc.gov/reading-rm/doc-collections/nuregs> are updated periodically and may differ from the last printed version. Although references to material found on a Web site bear the date the material was accessed, the material available on the date cited may subsequently be removed from the site.

Non-NRC Reference Material

Documents available from public and special technical libraries include all open literature items, such as books, journal articles, and transactions, *Federal Register* notices, Federal and State legislation, and congressional reports. Such documents as theses, dissertations, foreign reports and translations, and non-NRC conference proceedings may be purchased from their sponsoring organization.

Copies of industry codes and standards used in a substantive manner in the NRC regulatory process are maintained at—

The NRC Technical Library
Two White Flint North
11545 Rockville Pike
Rockville, MD 20852-2738

These standards are available in the library for reference use by the public. Codes and standards are usually copyrighted and may be purchased from the originating organization or, if they are American National Standards, from—

American National Standards Institute
11 West 42nd Street
New York, NY 10036-8002
www.ansi.org
212-642-4900

Legally binding regulatory requirements are stated only in laws; NRC regulations; licenses, including technical specifications; or orders, not in NUREG-series publications. The views expressed in contractor-prepared publications in this series are not necessarily those of the NRC.

The NUREG series comprises (1) technical and administrative reports and books prepared by the staff (NUREG-XXXX) or agency contractors (NUREG/CR-XXXX), (2) proceedings of conferences (NUREG/CP-XXXX), (3) reports resulting from international agreements (NUREG/IA-XXXX), (4) brochures (NUREG/BR-XXXX), and (5) compilations of legal decisions and orders of the Commission and Atomic and Safety Licensing Boards and of Directors' decisions under Section 2.206 of NRC's regulations (NUREG-0750).

Generic Environmental Impact Statement for License Renewal of Nuclear Plants

Main Report

Draft Report for Comment

Manuscript Completed: June 2009
Date Published: July 2009

Cover Sheet

Responsible Agency: U.S. Nuclear Regulatory Commission, Office of Nuclear Reactor Regulation

Title: *Draft Generic Environmental Impact Statement for License Renewal of Nuclear Plants*
(NUREG-1437) Volumes 1 and 2, Revision 1

**For additional information or copies of this
draft GEIS, contact:**

Jennifer Davis
Office of Nuclear Reactor Regulation
Mail Stop O-11F1
11555 Rockville Pike
Rockville, Maryland 20852
Phone: 1-800-368-5642, extension 3835
Fax: (301) 415-2002
Email: LRGEISUpdate@nrc.gov

To submit comments:

Chief, Rules Review and Directives Branch
U.S. Nuclear Regulatory Commission
Mail Stop TWB-05-B01
Washington, DC 20555-0001

Electronic comments may be submitted to the NRC
by e-mail at LRGEISUpdate@nrc.gov
Fax: (301) 415-2002

Abstract

U.S. Nuclear Regulatory Commission (NRC) regulations allow for the renewal of commercial nuclear power plant operating licenses, depending on the outcome of an assessment to determine whether the nuclear plant can continue to operate safely and protect the environment during the 20-year period of extended operation. Renewal of a nuclear power plant operating license requires the preparation of an environmental impact statement (EIS). To support the preparation of these EISs, the NRC published the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS) in 1996. The proposed action considered in the GEIS is the renewal of nuclear power plant operating licenses.

The NRC committed to review and revise the GEIS on a 10-year cycle, if necessary. Since publication of the GEIS, approximately 30 plant sites (50 reactor units) have applied for license renewal and undergone environmental reviews, the results of which were published as supplements to the 1996 GEIS. This GEIS revision reviews and reevaluates the issues and findings of the 1996 GEIS. Lessons learned and knowledge gained during previous license renewal reviews provides a significant source of new information for this assessment. In addition, new research, findings, and other information were considered in evaluating the significance of impacts associated with license renewal.

The intent of the GEIS is to determine which issues would result in the same impact at all nuclear power plants, and which issues could result in different levels of impact at different plants and thus require a plant-specific analysis for impact determinations. The GEIS is intended to improve the efficiency of the license renewal process by (1) providing an evaluation of the types of environmental impacts that may occur as a result of renewing the license of a nuclear power plant, (2) identifying and assessing the impacts that are expected to be generic (the same or similar), and (3) defining the number and scope of impacts that need to be addressed in plant-specific EISs. The GEIS revision identifies 78 environmental impact issues for consideration in plant-specific supplements to the GEIS.

In addition to the impacts of continued operations and refurbishment, the GEIS evaluates other consequences of license renewal, including the environmental effects of postulated accidents and the effects of an additional 20 years of operation on the impacts of shutdown and decommissioning and on the uranium fuel cycle. The GEIS evaluates a full range of alternatives to the proposed action, including a no-action alternative (denial of license renewal), fossil energy alternatives, nuclear energy alternatives, renewable energy alternatives, conservation (demand-side management), and the purchase of power. For most impact areas, the proposed action would have impacts that would be similar to or less than impacts of the alternatives, in large part because most alternatives would require new power plant construction, whereas the proposed action would not.

1
2 **Public Comments:** In preparation of this Draft GEIS, NRC considered comments received from the
3 public during the scoping period. Comments received after the close of the scoping comment period
4 have been considered to the extent practicable. Locations and times of public meetings on this document
5 will be announced in the *Federal Register*. Comments on this Draft GEIS will be accepted for a period of
6 75 days following publication of the Environmental Protection Agency's Notice of Availability in the
7 *Federal Register* and will be considered in the preparation of the Final GEIS. Any comments received
8 after the 75-day period will be considered to the extent practicable for the preparation of the Final GEIS.
9

10 **Paperwork Reduction Act Statement**

11 This NUREG contains information collection requirements that are subject to the Paperwork Reduction
12 Act of 1995 (44 U.S.C. 3501 et seq.). These information collections were approved by the Office of
13 Management and Budget, approval numbers 3150-0021.
14

15 **Public Protection Notification**

16 The NRC may not conduct or sponsor, and a person is not required to respond to, a request for
17 information or an information collection requirement unless the requesting document displays a currently
18 valid OMB control number.

Contents

Abstract/Cover Sheet	iii
List of Figures	xiii
List of Tables.....	xv
Abbreviations and Acronyms	xxi
Abbreviated Power Plant Names	xxix
Units of Measure	xxxi
Conversions	xxxv
Summary.....	S-1
S.1 Purpose and Need for the Proposed Action	S-2
S.2 Scope of the Generic Environmental Impact Statement.....	S-3
S.3 Impact Definitions and Categories.....	S-4
S.4 Affected Environment	S-6
S.5 Impacts from Continued Operations and Refurbishment Activities Associated with License Renewal	S-6
S.6 Comparison of Alternatives.....	S-19
1 Introduction	1-1
1.1 Purpose of the GEIS.....	1-2
1.2 Description of the Proposed Action	1-3
1.3 Purpose of and Need for the Proposed Action	1-3
1.4 Alternatives to the Proposed Action.....	1-4
1.5 Analytical Approach Used in the GEIS	1-4
1.5.1 Objectives.....	1-4
1.5.2 Methodology	1-4
1.6 Scope of the GEIS	1-7
1.7 Decisions to Be Supported by the GEIS.....	1-7
1.7.1 Changes to Plant Cooling Systems	1-9
1.7.2 Disposition of Spent Nuclear Fuel	1-9
1.7.3 Emergency Preparedness	1-10
1.7.4 Safeguards and Security	1-12
1.7.5 Need for Power.....	1-12
1.8 Implementation of the Rule (10 CFR Part 51)	1-13
1.8.1 General Requirements	1-13
1.8.2 Applicant’s Environmental Report	1-13
1.8.3 NRC’s SEIS	1-14
1.8.4 Public Scoping and Public Comments on NRC’s Draft SEIS	1-14
1.8.5 NRC’s Analysis and Preliminary Recommendation.....	1-15
1.8.6 NRC’s Final SEIS	1-15

Contents

1.9	Public Comment Process for the GEIS.....	1-16
1.10	Lessons Learned	1-16
1.11	New Organization of the GEIS.....	1-17
1.12	References	1-18
2	Alternatives Including the Proposed Action.....	2-1
2.1	Proposed Action	2-2
2.1.1	Plant Operations During the License Renewal Term	2-2
2.1.2	Refurbishment and Other Supporting Activities During the License Renewal Term.....	2-4
2.1.3	Termination of Nuclear Power Plant Operations and Decommissioning After the License Renewal Term.....	2-4
2.1.4	Impacts of the Proposed Action.....	2-5
2.2	No-Action Alternative	2-17
2.3	Alternative Energy Sources	2-17
2.3.1	Alternative Electricity Generation	2-18
2.3.2	Fossil Fuel Energy Alternatives	2-19
2.3.3	New Nuclear Power Plant Alternatives.....	2-20
2.3.4	Renewable Energy Alternatives	2-20
2.3.5	Other Alternatives.....	2-27
2.4	Comparison of Alternatives.....	2-29
2.5	References	2-36
3	Affected Environment.....	3-1
3.1	Description of Nuclear Power Plant Facilities and Operations	3-1
3.1.1	External Appearance and Settings.....	3-1
3.1.2	Nuclear Reactor Systems.....	3-4
3.1.3	Cooling Water Systems	3-11
3.1.4	Radioactive Waste Treatment Systems	3-18
3.1.4.1	Liquid Radioactive Waste	3-18
3.1.4.2	Gaseous Radioactive Waste.....	3-19
3.1.4.3	Solid Radioactive Waste	3-20
3.1.5	Nonradioactive Waste Treatment Systems	3-21
3.1.6	Utility and Transportation Infrastructure	3-22
3.1.6.1	Electricity.....	3-22
3.1.6.2	Fuel	3-22
3.1.6.3	Water	3-23
3.1.6.4	Transportation Systems	3-23
3.1.6.5	Power Transmission System.....	3-24
3.1.7	Nuclear Power Plant Operations and Maintenance.....	3-25

3.2	Land Use and Visual Resources	3-26
3.2.1	Land Use	3-26
3.2.2	Visual Resources.....	3-29
3.3	Meteorology, Air Quality, and Noise	3-30
3.3.1	Meteorology and Climatology	3-30
3.3.2	Air Quality	3-35
3.3.3	Noise	3-47
3.4	Soils, Geology, and Seismology	3-49
3.5	Hydrology.....	3-50
3.5.1	Surface Water.....	3-50
3.5.1.1	Surface Water Use.....	3-51
3.5.1.2	Surface Water Quality.....	3-53
3.5.2	Groundwater.....	3-56
3.6	Ecology	3-57
3.6.1	Terrestrial Ecology.....	3-57
3.6.1.1	Upland Vegetation and Habitats	3-57
3.6.1.2	Floodplain and Wetland Vegetation and Habitats	3-59
3.6.1.3	Wildlife	3-60
3.6.2	Aquatic Ecology.....	3-62
3.6.2.1	Description of Aquatic Resources near Nuclear Power Plants.....	3-62
3.6.2.2	Overview of the Effects of Existing Nuclear Plant Operations and Transmission Lines on Aquatic Resources	3-69
3.6.3	Threatened, Endangered, and Protected Species and Essential Fish Habitat.....	3-71
3.6.3.1	Terrestrial Threatened and Endangered Species	3-73
3.6.3.2	Aquatic Threatened, Endangered, and Protected Species, Marine Mammals, and Essential Fish Habitat.....	3-74
3.7	Historic and Cultural Resources	3-78
3.7.1	Regulatory Framework	3-78
3.7.2	Prehistoric and Historic Era Historic and Cultural Resources	3-80
3.7.3	Traditional Cultural Properties	3-81
3.8	Socioeconomics.....	3-81
3.8.1	Power Plant Employment and Expenditures	3-81
3.8.2	Regional Economic Characteristics.....	3-83
3.8.2.1	Rural Economies.....	3-83
3.8.2.2	Semi-Urban Economies	3-86
3.8.3	Demographic Characteristics	3-88

Contents

3.8.4	Housing and Community Services	3-90
3.8.5	Local Transportation	3-92
3.9	Human Health	3-92
3.9.1	Radiological Exposure and Risk	3-92
3.9.1.1	Regulatory Requirements	3-93
3.9.1.2	Occupational Radiological Exposures	3-97
3.9.1.3	Public Radiological Exposures	3-116
3.9.1.4	Risk Estimates from Radiation Exposure	3-130
3.9.1.5	Conclusion	3-131
3.9.2	Chemical Hazards	3-131
3.9.3	Microbiological Hazards	3-133
3.9.3.1	Background Information on Microorganisms of Concern	3-134
3.9.3.2	Studies of Microorganisms in Cooling Towers	3-135
3.9.3.3	Microbiological Hazards to Plant Workers	3-136
3.9.3.4	Microbiological Hazards to the Public	3-137
3.9.4	Electromagnetic Fields	3-138
3.9.5	Other Hazards	3-139
3.9.5.1	Occupational Hazards	3-139
3.9.5.2	Shock Hazard	3-140
3.10	Environmental Justice	3-143
3.10.1	Subsistence Consumption of Fish and Wildlife	3-145
3.11	Waste Management and Pollution Prevention	3-146
3.11.1	Radioactive Waste	3-146
3.11.1.1	Low-Level Radioactive Waste	3-147
3.11.1.2	Spent Nuclear Fuel	3-150
3.11.2	Hazardous Waste	3-154
3.11.3	Mixed Waste	3-155
3.11.4	Nonradioactive, Nonhazardous Waste	3-155
3.11.5	Pollution Prevention and Waste Minimization	3-156
3.12	References	3-156
4	Environmental Consequences and Mitigating Actions	4-1
4.1	Introduction	4-1
4.1.1	Environmental Consequences of the Proposed Action	4-2
4.1.2	Environmental Consequences of Continued Operations and Refurbishment Activities during the License Renewal Term	4-3
4.1.3	Environmental Consequences of the No-Action Alternative	4-4
4.1.4	Environmental Consequences of Alternative Energy Sources	4-4

4.1.5	Environmental Consequences of Terminating Nuclear Power Plant Operations and Decommissioning	4-5
4.2	Land Use and Visual Resources	4-6
4.2.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-6
4.2.1.1	Land Use	4-6
4.2.1.2	Visual Resources	4-8
4.2.2	Environmental Consequences of Alternatives to the Proposed Action	4-9
4.2.2.1	Fossil Energy Alternatives	4-10
4.2.2.2	New Nuclear Alternatives	4-10
4.2.2.3	Renewable Alternatives	4-10
4.3	Air Quality and Noise	4-12
4.3.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-12
4.3.1.1	Air Quality	4-13
4.3.1.2	Noise	4-17
4.3.2	Environmental Consequences of Alternatives to the Proposed Action	4-18
4.3.2.1	Fossil Energy Alternatives	4-19
4.3.2.2	New Nuclear Alternatives	4-20
4.3.2.3	Renewable Alternatives	4-20
4.4	Geology and Soils	4-28
4.4.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-28
4.4.2	Environmental Consequences of Alternatives to the Proposed Action	4-28
4.4.2.1	Renewable Alternatives	4-29
4.5	Hydrology	4-30
4.5.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-30
4.5.1.1	Surface Water	4-30
4.5.1.2	Groundwater	4-39
4.5.2	Environmental Consequences of Alternatives to the Proposed Action	4-47
4.5.2.1	Fossil Energy Alternatives	4-48
4.5.2.2	New Nuclear Alternative	4-49
4.5.2.3	Renewable Alternatives	4-50

Contents

4.6	Ecology	4-51
4.6.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment	4-51
4.6.1.1	Terrestrial Ecology	4-51
4.6.1.2	Aquatic Ecology	4-78
4.6.1.3	Threatened, Endangered, and Protected Species and Essential Fish Habitat	4-109
4.6.2	Environmental Consequences of Alternatives to the Proposed Action	4-114
4.6.2.1	Fossil Energy Alternatives	4-114
4.6.2.2	Renewable Alternatives	4-115
4.7	Historic and Cultural Resources	4-116
4.7.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment	4-116
4.7.2	Environmental Consequences of Alternatives to the Proposed Action	4-119
4.7.2.1	Renewable Alternatives	4-120
4.8	Socioeconomics.....	4-121
4.8.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-121
4.8.2	Environmental Consequences of Alternatives to the Proposed Action	4-127
4.8.2.1	Fossil Fuel Alternatives.....	4-127
4.8.2.2	New Nuclear Alternatives.....	4-128
4.8.2.3	Renewable Alternatives	4-128
4.9	Human Health.....	4-129
4.9.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-129
4.9.1.1	Environmental Consequences of Normal Operating Conditions	4-129
4.9.1.2	Environmental Consequences of Postulated Accidents	4-152
4.9.2	Environmental Consequences of Alternatives to the Proposed Action	4-156
4.9.2.1	Fossil Energy Alternatives	4-157
4.9.2.2	New Nuclear Alternatives.....	4-159
4.9.2.3	Renewable Alternatives	4-159

4.10	Environmental Justice.....	4-161
4.10.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-161
4.10.2	Environmental Consequences of Alternatives to the Proposed Action	4-162
4.11	Waste Management and Pollution Prevention.....	4-163
4.11.1	Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities	4-163
4.11.2	Environmental Consequences of Alternatives to the Proposed Action	4-171
	4.11.2.1 Fossil Fuel Alternatives.....	4-171
	4.11.2.2 New Nuclear Alternatives.....	4-172
	4.11.2.3 Renewable Alternatives	4-172
4.12	Impacts Common to All Alternatives.....	4-174
4.12.1	Environmental Consequences of Fuel Cycles.....	4-174
	4.12.1.1 Uranium Fuel Cycle	4-174
	4.12.1.2 Energy Alternative Fuel Cycles.....	4-187
4.12.2	Environmental Consequences of Terminating Nuclear Power Plant Operations and Decommissioning	4-191
	4.12.2.1 Termination of Nuclear Power Plant Operations and Decommissioning of Existing Nuclear Power Plants.....	4-191
	4.12.2.2 Termination of Plant Operations and Decommissioning of Energy Alternative Power Plants.....	4-214
4.13	Cumulative Impacts of the Proposed Action.....	4-220
4.13.1	Land Use	4-221
4.13.2	Visual Resources.....	4-222
4.13.3	Air Quality	4-222
4.13.4	Noise	4-222
4.13.5	Geology and Soils	4-223
4.13.6	Surface Water.....	4-223
4.13.7	Groundwater.....	4-223
4.13.8	Ecology.....	4-224
4.13.9	Historic and Cultural Resources	4-225
4.13.10	Socioeconomics	4-225
4.13.11	Human Health.....	4-226
4.13.12	Environmental Justice	4-226
4.13.13	Waste Management and Pollution Prevention	4-226

Contents

4.14	Resource Commitments Associated with the Proposed Action	4-227
4.14.1	Unavoidable Adverse Environmental Impacts	4-227
4.14.2	Relationship Between Short-Term Use of the Environment and Long-Term Productivity	4-229
4.14.3	Irreversible and Irretrievable Commitment of Resources	4-230
4.15	References	4-232
5	List of Preparers	5-1
6	Distribution List	6-1
7	Glossary	7-1

Figures

3.1-1	Operating Commercial Nuclear Power Plants in the United States	3-5
3.1-2	Pressurized Water Reactor	3-12
3.1-3	Boiling Water Reactor	3-12
3.1-4	Schematic Diagrams of Nuclear Power Plant Cooling Systems	3-16
3.3-1	Distribution of Tornado Strikes with Intensities of F2 or More over the Contiguous United States by One Degree of Latitude and Longitude Boxes	3-33
3.3-2	Expected Maximum Tornado Wind Speed with a Probability of One in 100,000 of Occurring over the Contiguous United States by Two Degrees of Latitude and Longitude Boxes	3-34
3.3-3	Locations of Operating Nuclear Plants Relative to EPA-Designated 8-Hour Ozone Nonattainment Areas	3-38
3.3-4	Locations of Operating Nuclear Plants Relative to EPA-Designated 1-Hour Ozone Nonattainment Areas	3-39
3.3-5	Locations of Operating Nuclear Plants Relative to EPA-Designated PM ₁₀ Nonattainment Areas	3-40
3.3-6	Locations of Operating Nuclear Plants Relative to EPA-Designated PM _{2.5} Nonattainment Areas	3-41
3.3-7	Locations of Operating Nuclear Plants Relative to EPA-Designated SO ₂ Nonattainment Areas	3-42
3.3-8	Locations of Operating Nuclear Plants Relative to EPA-Designated NO ₂ Nonattainment Areas	3-43
3.3-9	Locations of Operating Nuclear Plants Relative to EPA-Designated CO Maintenance and Nonattainment Areas	3-44

Figures

3.3-10	Locations of Operating Nuclear Plants Relative to EPA-Designated Pb Nonattainment Areas.....	3-45
3.9-1	Average, Median, and Extreme Values of the Annual Collective Dose per Reactor from 1992 to 2005.....	3-103
3.9-2	Collective Dose Distribution for All Commercial U.S. Reactors by Dose Range for 2001 Through 2005.....	3-116
3.11-1	Typical Dry Cask Storage Systems	3-152
3.11-2	Locations of Independent Spent Fuel Storage Installations	3-153

Tables

2.1-1	Summary of Impacts Associated with License Renewal Under the Proposed Action.....	2-6
2.4-1	Impacts of Construction Under the Proposed Action and Alternatives	2-31
2.4-2	Impacts of Operations Under the Proposed Action and Alternatives.....	2-32
2.4-3	Impacts of Postulated Accidents Under the Proposed Action and Alternatives	2-33
2.4-4	Impacts of Shutdown and Decommissioning Under the Proposed Action and Alternatives.....	2-34
2.4-5	Impacts of the Fuel Cycle Under the Proposed Action and Alternatives	2-35
3.1-1	Characteristics of Operating U.S. Commercial Nuclear Power Plants.....	3-6
3.1-2	Types of Cooling Systems Used at U.S. Commercial Nuclear Power Plants.....	3-13
3.2-1	Land Cover Within a 5-Mile Radius of U.S. Commercial Nuclear Power Plants	3-28
3.3-1	Fujita Tornado Intensity Scale	3-32
3.3-2	National Ambient Air Quality Standards.....	3-36
3.5-1	Overall Condenser Cooling Water Flow Rate and Consumptive Water Loss Rate per 1000 MW(e)	3-51
3.6-1	Factors That Influence the Impacts of Nuclear Power Plant Operation on Aquatic Resources.....	3-70
3.6-2	Number of ESA-Listed Species That Could Occur near Operating Nuclear Power Plants.	3-72
3.6-3	Operating Nuclear Power Plants for Which Essential Fish Habitat May Be a Consideration.....	3-77

Tables

3.8-1	State Employment, Expenditures, and Tax Revenues at 11 Nuclear Plants from 2003 Through 2006	3-82
3.8-2	Plant and Regional Employment and Earnings in Rural Locations.....	3-84
3.8-3	Local Economic Impacts of Plant Operations in Rural Locations	3-85
3.8-4	State Economic Impacts of Plant Operations in Rural Locations.....	3-85
3.8-5	Plant and Regional Employment and Earnings in Semi-Urban Locations ...	3-86
3.8-6	Local Economic Impacts of Plant Operations in Semi-Urban Locations.....	3-87
3.8-7	State Economic Impacts of Plant Operations in Semi-Urban Locations	3-88
3.8-8	Population Classification of Regions Around Selected Nuclear Power Plants.....	3-89
3.8-9	State and Local Tax Revenues Generated at Eight Nuclear Power Plants.....	3-91
3.9-1	Occupational Dose Limits for Adults Established by 10 CFR Part 20.....	3-93
3.9-2	Design Objectives and Annual Standards on Doses to the General Public from Nuclear Power Plants	3-96
3.9-3	Occupational Whole-Body Dose Data at U.S. Commercial Nuclear Power Plants	3-98
3.9-4	Annual Average Occupational Dose for U.S. Commercial Nuclear Power Plants.....	3-99
3.9-5	Collective and Individual Worker Doses at BWRs from 2003 through 2005.....	3-100
3.9-6	Collective and Individual Worker Doses at PWRs from 2003 through 2005.....	3-101
3.9-7	Annual Collective Dose and Annual Occupational Dose for Different Commercial Nuclear Power Plants from 1993 Through 2005.....	3-104

3.9-8	Annual Collective Dose for Commercial Nuclear Power Plants from 1993 Through 2005.....	3-107
3.9-9	Annual Average Measurable Occupational Doses at Commercial Nuclear Power Plant Sites from 1993 Through 2005.....	3-110
3.9-10	Annual Collective Occupational Dose per Plant for Commercial Nuclear Power Plants	3-113
3.9-11	Annual Individual Occupational Dose for Commercial Nuclear Power Plants.....	3-114
3.9-12	Number of Workers at BWRs and PWRs Who Received Whole-Body Doses Within Specified Ranges During 2005	3-115
3.9-13	Collective and Average CEDE for Commercial U.S. Nuclear Power Plant Sites in 2005.....	3-117
3.9-14	Doses from Gaseous Effluent Releases for 2004 Through 2006	3-121
3.9-15	Dose from Liquid Effluent Releases for 2004 Through 2006	3-123
3.9-16	Total Effective Dose Equivalent to the Maximally Exposed Individual for 2004 Through 2006	3-124
3.9-17	Average Annual Effective Dose Equivalent of Ionizing Radiation to a Member of the U.S. Population.....	3-125
3.9-18	Inadvertent Releases of Radioactive Liquids at Nuclear Power Plants	3-126
3.9-19	Dose from Inadvertent Releases of Radioactive Liquids at Nuclear Power Plants	3-128
3.9-20	Nominal Probability Coefficients Used in ICRP (1991).....	3-130
3.9-21	Number and Rate of Fatal Occupational Injuries by Industry Sector in 2005.....	3-141
3.9-22	Employment and Incidence Rate of Nonfatal Occupational Injuries and Illnesses in Different Utilities in 2005	3-142

Tables

3.9-23	Number and Rate of Fatal Occupational Injuries for Selected Occupations in 2005	3-142
3.11-1	Solid Low-Level Radioactive Waste Shipped Offsite per Reactor from 10 Power Plant Sites in 2006.....	3-150
4.3.2.1-1	Projected Air Quality Impacts for Selected Power Production Technologies Burning Various Ranks of Coal	4-21
4.3.2.1-2	Performance and Cost Data for Fossil-Fuel-Fired Power Plants That Are Likely Alternatives to Retired Nuclear Reactors.....	4-23
4.5.2.1-1	Raw Water Usage Estimates for Fossil Fuel Electric Power Technologies.....	4-49
4.6.1.1-1	Estimated Radiation Dose Rates to Terrestrial Ecological Receptors for Radionuclides Measured in Water, Sediment, and Soils at U.S. Nuclear Power Plants.....	4-58
4.6.1.1-2	Contaminants Evaluated in Cooling Systems at Selected Power Plants.....	4-60
4.6.1.1-3	Estimated Annual Bird Collision Mortality in the United States.....	4-66
4.6.1.2-1	Fish Species Commonly Impinged or Entrained at Power Plants.....	4-81
4.6.1.2-2	Estimated Radiation Dose Rates to Aquatic Animals from Radionuclides Measured in Water and Sediments at U.S. Nuclear Power Plants	4-99
4.6.1.2-3	Significance Level of Aquatic Resources Impacts for License Renewal of Existing Nuclear Power Plants that Use Once-Through Cooling Systems ..	4-110
4.9.1.1-1	Additional Collective Occupational Dose for Different Actions Under Typical and Conservative Scenarios During the License Renewal Term.....	4-131
4.9.1.1-2	Radioactive Effluent Releases for Three Nuclear Power Plants That Recently Replaced Steam Generators	4-138
4.9.1.1-3	Dose to the Maximally Exposed Individual from Gaseous and Liquid Effluent Releases for Three Nuclear Power Plants That Recently Replaced Steam Generators	4-139

4.9.1.1-4	Magnetic Fields at Different Distances from Household Appliances	4-149
4.9.1.2-1	Summary of Issues Covered in Appendix E	4-155
S-3	Table Taken from 10 CFR 51.51 on Uranium Fuel Cycle Environmental Data	4-177
S-4	Table Taken from 10 CFR 51.52 on the Environmental Impact of Transporting Fuel and Waste to and from One Light-Water-Cooled Nuclear Power Reactor	4-181
4.12.1.1-1	Population Doses from Uranium Fuel Cycle Facilities Normalized to One Reference Reactor Year	4-185

Abbreviations and Acronyms

ABWR	advanced boiling water reactor
AC	alternating current
ACS	American Cancer Society
ACRS	Advisory Committee on Reactor Safeguards
ADAMS	Agencywide Documents Access and Management System
AEA	Atomic Energy Act
AGNIR	Advisory Group on Non-ionizing Radiation
ALARA	as low as reasonably achievable
ALI	annual limit on intake
ALWR	advanced light water reactor
ASME	American Society of Mechanical Engineers
BEIR	Biological Effects of Ionizing Radiation (National Research Council Committee)
BLS	U.S. Bureau of Labor Statistics
BPA	Bonneville Power Administration
BWR	boiling water reactor
CAA	Clean Air Act
CADHS	California Department of Health Services
CCS	carbon capture and storage
CCW	coal combustion waste
CDC	Centers for Disease Control and Prevention
CDF	core damage frequency
CEC	Commission for Environmental Cooperation
CEDE	committed effective dose equivalent
CEG	Constellation Energy Group
CEQ	Council on Environmental Quality
CERCLA	Comprehensive Environmental Response Compensation and Liability Act
CF	capacity factor
CFR	<i>Code of Federal Regulations</i>
CH ₄	methane
CHP	combined heat and power
CO	carbon monoxide
CO ₂	carbon dioxide
COL	combined operating license

Abbreviations and Acronyms

CSP	concentrating solar power
CWA	Clean Water Act
CZMA	Coastal Zone Management Act
DC	direct current
DDREF	dose and dose rate effectiveness factor
DNC	Dominion Nuclear Connecticut
DOE	U.S. Department of Energy
DOL	U.S. Department of Labor
DSM	demand-side management
EA	environmental assessment
EAB	exclusion area boundary
ECRR	European Committee on Radiation Risk
EEL	Edison Electric Institute
EERE	Energy Efficiency and Renewable Energy
EEZ	Exclusive Economic Zone
EF	enhanced Fujita (scale)
EFH	essential fish habitat
EI	exposure index
EIA	Energy Information Administration
EIML	Environmental Incorporated Midwest Laboratory
EIS	environmental impact statement
EJ	environmental justice
ELF-EMF	extremely low frequency-electromagnetic field
EMF	electromagnetic field
EMF-RAPID	Electric and Magnetic Fields Research and Public Information Dissemination (Program)
EPA	U.S. Environmental Protection Agency
EPAct	Energy Policy Act of 2005
EPCRA	Emergency Planning and Community Right-to-Know Act
EPRI	Electric Power Research Institute
ER	environmental report
ERCOT	Electric Reliability Council of Texas
ERO	Electric Reliability Organization
ESA	Endangered Species Act
ESP	early site permit
F	Fujita (scale)
FAA	Federal Aviation Administration
FCC	Federal Communications Commission

Abbreviations and Acronyms

FDOH	Florida Department of Health
FEMA	Federal Emergency Management Agency
FERC	Federal Energy Regulatory Commission
FES	final environmental statement
FGD	flue gas desulfurization
FICN	Federal Interagency Committee on Noise
FIFRA	Federal Insecticide, Fungicide, and Rodenticide Act
FPL	Florida Power & Light Company
FR	<i>Federal Register</i>
FRCC	Florida Reliability Coordinating Council
FWS	U.S. Fish and Wildlife Service
GALL	Generic Aging Lessons Learned
GAO	U.S. General Accounting Office (now U.S. Government Accountability Office)
GEIS	generic environmental impact statement
GIS	geographic information system
GNEP	Global Nuclear Energy Partnership
GTCC	greater than Class C
HAP	hazardous air pollutant
HAPC	habitat area of particular concern
HAWT	horizontal axis wind turbine
HCCP	Harvard Center for Cancer Prevention
HDR	hot dry rock
HFC	hydrofluorocarbon
HCFC	hydrochlorofluorocarbon
HHV	higher heating value
HLW	high-level (radioactive) waste
HVAC	heating, ventilation, and air conditioning
IAEA	International Atomic Energy Agency
IARC	International Agency for Research on Cancer
ICRP	International Commission on Radiological Protection
IDPH	Illinois Department of Public Health
IEEE	Institute of Electrical and Electronic Engineers
IGCC	integrated gasification combined cycle
INIRC	International Non-Ionizing Radiation Commission
IPEEE	Individual Plant Examination of External Events
IRPA	International Radiation Protection Association
ISFSI	independent spent fuel storage installation
ISI	in-service inspection

Abbreviations and Acronyms

LERF	large early release frequency
LET	linear energy transfer
LLAP	<i>Legionella</i> -like amoebal pathogen
LLD	lower limit of detection
LLW	low-level (radioactive) waste
LLRWPA	Low-Level Radioactive Waste Policy Act
LLTF	Lessons Learned Task Force
LLWPAA	Low-Level Radioactive Waste Policy Act Amendments
LOEL	lowest observed effects level
LWR	light water reactor
MACT	maximum achievable control technology
MCAQ	Maricopa County Air Quality Department
MCL	maximum contaminant level
MEI	maximally exposed individual
MMPA	Marine Mammal Protection Act
MMS	Minerals Management Service
MSFCMA	Magnuson-Stevens Fishery Conservation and Management Act
MSW	municipal solid waste
MTBE	methyl tertiary butyl ether
NAAQS	National Ambient Air Quality Standards
NaCl	sodium chloride (salt)
NAICS	North American Industry Classification System
NAGPRA	Native American Graves Protection and Repatriation Act
NaNO ₂	sodium nitrate
NAS	National Academy of Sciences
NCDC	National Climatic Data Center
NCRP	National Council on Radiation Protection and Measurement
NEI	Nuclear Energy Institute
NEPA	National Environmental Policy Act of 1969
NERC	North American Electric Reliability Corporation
NESC	National Electrical Safety Code
NETL	National Energy Technology Laboratory
NGCC	natural gas combined cycle
NHPA	National Historic Preservation Act of 1966
(NH ₄)SO ₄	ammonium sulfate
NIEHS	National Institute of Environmental Health Sciences
NIH	National Institutes of Health
NJDEP	New Jersey Department of Environmental Protection

Abbreviations and Acronyms

NMC	Nuclear Management Company
NMFS	National Marine Fisheries Service
NO	nitrogen oxide
N ₂ O	nitrous oxide
NO ₂	nitrogen dioxide
NOAA	National Oceanic and Atmospheric Administration
NORM	naturally occurring radioactive material
NOS	National Oceanic Service
NO _x	nitrogen oxides
NPCC	Northeast Power Coordinating Council
NPDES	National Pollutant Discharge Elimination System
NRC	U.S. Nuclear Regulatory Commission
NREL	National Renewable Energy Laboratory
NRHP	<i>National Register of Historic Places</i>
NRPB	National Radiological Protection Board
NSPS	New Source Performance Standards
NWI	National Waste Initiative; National Wetland Inventory
NWPA	National Waste Policy Act
NYSDEC	New York State Department of Environmental Conservation
NYSDEL	New York State Department of Labor
O ₃	ozone
ODCM	Offsite Dose Calculation Manual
OPPD	Omaha Public Power District
OTA	Office of Technology Assessment
OSHA	Occupational Safety and Health Administration
PAH	polycyclic aromatic hydrocarbon
PARS	Publicly Available Record System
Pb	lead
PC	pulverized coal
PCB	polychlorinated biphenyl
PDR	Public Document Room
PEIS	programmatic environmental impact statement
PFC	perfluorinated carbon
PI	performance indicator
PILOT	payments in lieu of tax
PM _{2.5}	particulate matter with a mean aerodynamic diameter of 2.5 µm or less
PM ₁₀	particulate matter with a mean aerodynamic diameter of 10 µm or less
PPE	personal protective equipment
PSD	prevention of significant deterioration

Abbreviations and Acronyms

PTC	production tax credit
PURPA	Public Utility Regulatory Act of 1978
PV	photovoltaic
PWR	pressurized water reactor
RCRA	Resource Conservation and Recovery Act of 1976
RDF	refuse-derived fuel
REMP	Radiological Environmental Monitoring Program
RER	radiological effluent release
RERR	radiological effluent release report
RFC	Reliability First Corporation
ROW	right-of-way
RRC	Regional Reliability Council
RRY	reference reactor year
SAAQS	State Ambient Air Quality Standards
SAMA	severe accident mitigation alternatives
SCE	Southern California Edison
SCR	selective catalytic reduction
SDWA	Safe Drinking Water Act
SEIS	supplemental environmental impact statement
SER	safety evaluation report
SFP	spent fuel pool
SHPO	State Historic Preservation Office or Officer
SIP	State implementation plan
SMITTR	surveillance, monitoring, inspection, testing, trending, and recordkeeping
SO ₂	sulfur dioxide
SOARCA	state-of-the-art reactor consequence analysis
SPAR	standardized plant analysis risk
SPDES	State Pollutant Discharge Elimination System
SPP	Southwest Power Pool
SSCs	systems, structures, and components
Stat.	Statutes at Large
TDS	total dissolved solids
TEDE	total effective dose equivalent
TESS	threatened and endangered species system
TLD	thermoluminescence dosimeter
TSCA	Toxic Substances Control Act
TSS	total suspended solids
TTU	Texas Tech University

Abbreviations and Acronyms

TVA	Tennessee Valley Authority
TXU	TXU Generation Company
UCB	upper confidence bound
UCS	Union of Concerned Scientists
UF ₆	uranium hexafluoride
UNSCEAR	United Nations Scientific Committee on the Effects of Atomic Radiation
UO ₂	uranium dioxide
U ₃ O ₈	triuranium octaoxide
USACE	U.S. Army Corps of Engineers
USC	<i>United States Code</i>
USCB	U.S. Census Bureau
USDA	U.S. Department of Agriculture
USFWS	U.S. Fish and Wildlife Service
USGS	U.S. Geological Survey
VOC	volatile organic compound
WCGS	Wolf Creek Generating Station
WCNOC	Wolf Creek Nuclear Operating Corporation
WEC	wave energy capture
WHO	World Health Organization

Abbreviated Power Plant Names

Arkansas	Arkansas Nuclear One
Beaver Valley	Beaver Valley Power Station
Braidwood	Braidwood Station
Browns Ferry	Browns Ferry Nuclear Plant
Brunswick	Brunswick Steam Electric Plant
Byron	Byron Station
Callaway	Callaway Plant
Calvert Cliffs	Calvert Cliffs Nuclear Power Plant
Catawba	Catawba Nuclear Station
Clinton	Clinton Power Station
Columbia	Columbia Generating Station
Comanche Peak	Comanche Peak Steam Electric Station
Cooper	Cooper Nuclear Station
Crystal River	Crystal River Nuclear Power Plant
Davis-Besse	Davis-Besse Nuclear Power Station
Diablo Canyon	Diablo Canyon Power Plant
D.C. Cook	Donald C. Cook Nuclear Plant
Dresden	Dresden Nuclear Power Station
Duane Arnold	Duane Arnold Energy Center
Farley	Joseph M. Farley Nuclear Plant
Fermi	Enrico Fermi Atomic Power Plant
FitzPatrick	James A. FitzPatrick Nuclear Power Plant
Fort Calhoun	Fort Calhoun Station
Ginna	R.E. Ginna Nuclear Power Plant
Grand Gulf	Grand Gulf Nuclear Station
Harris	Shearon Harris Nuclear Power Plant
Hatch	Edwin I. Hatch Nuclear Plant
Hope Creek	Hope Creek Generating Station
Indian Point	Indian Point Energy Center
Kewaunee	Kewaunee Power Station
LaSalle	LaSalle County Station
Limerick	Limerick Generating Station

Abbreviated Power Plant Names

McGuire	McGuire Nuclear Station
Millstone	Millstone Power Station
Monticello	Monticello Nuclear Generating Plant
Nine Mile Point	Nine Mile Point Nuclear Station
North Anna	North Anna Power Station
Oconee	Oconee Nuclear Station
Oyster Creek	Oyster Creek Nuclear Generating Station
Palisades	Palisades Nuclear Plant
Palo Verde	Palo Verde Nuclear Generating Station
Peach Bottom	Peach Bottom Atomic Power Station
Perry	Perry Nuclear Power Plant
Pilgrim	Pilgrim Nuclear Power Station
Point Beach	Point Beach Nuclear Plant
Prairie Island	Prairie Island Nuclear Generating Plant
Quad Cities	Quad Cities Nuclear Power Station
River Bend	River Bend Station
H.B. Robinson	H.B. Robinson Steam Electric Plant
St. Lucie	St. Lucie Nuclear Plant
Salem	Salem Nuclear Generating Station
San Onofre	San Onofre Nuclear Generating Station
Seabrook	Seabrook Station
Sequoyah	Sequoyah Nuclear Plant
South Texas	South Texas Project Electric Generating Station
Summer	Virgil C. Summer Nuclear Station
Surry	Surry Power Station
Susquehanna	Susquehanna Steam Electric Station
Three Mile Island	Three Mile Island, Unit 1
Turkey Point	Turkey Point Nuclear Plant
Vermont Yankee	Vermont Yankee Nuclear Power Station
Vogtle	Vogtle Electric Generating Plant
Waterford	Waterford Steam Electric Station
Watts Bar	Watts Bar Nuclear Plant
Wolf Creek	Wolf Creek Generating Station

Units of Measure

ac	acre(s)
bbbl	barrel(s)
Btu	British thermal unit(s)
°C	degree(s) Celsius
cm	centimeter(s)
d	day(s)
dB	decibel(s)
°F	degree(s) Fahrenheit
ft	foot (feet)
ft ²	square foot (feet)
ft ³	cubic foot (feet)
gal	gallon(s)
gpd	gallon(s) per day
gpm	gallon(s) per minute
GWd/MT	gigawatt per day/metric tonne(s)
Gy	gray(s)
ha	hectare(s)
hr	hour(s)
Hz	hertz
in.	inch(es)
kg	kilogram(s)
km	kilometer(s)
kV	kilovolt(s)
kW	kilowatt(s)
kWh	kilowatt-hour(s)
L	liter(s)
lb	pound(s)
m	meter(s)
m ²	square meter(s)

Units of Measure

m ³	cubic meter(s)
mA	milliampere(s)
mg	milligram(s)
mG	milligauss
mGy	milligray(s)
MHz	megahertz
mi	mile(s)
min	minute(s)
mL	milliliter(s)
MMBtu	million Btu
MPa	megapascal(s)
mph	mile(s) per hour
mrad	milliard(s)
mrem	millirem(s)
mSv	millisievert(s)
mT	milliTesla(s)
MT	metric tonne(s)
MTHM	metric tonne(s) of heavy metal
MTU	metric tonne(s) of uranium
MW	megawatt(s)
MWe or MW(e)	megawatt(s) electric
MW(t)	megawatt(s) thermal
MWh	megawatt-hour(s)
pCi	picocurie(s)
ppm	part(s) per million
ppmv	parts per million by volume
ppmvd	parts per million by volume, dry
ppt	part(s) per thousand
psi	pound(s) per square inch
rad	radian
rem	roentgen-equivalent-man
s	second(s)
scf	standard cubic foot (feet)
sV	sievert(s)
T	tesla(s)
TPY	ton(s) per year

V	volt(s)
yr	year(s)
μCi	microcurie(s)
μGy	microgray(s)
μm	micrometer(s)
μT	microtesla(s)

Conversions

Multiply	By	To Obtain
<i>To Convert English to Metric Equivalents</i>		
acres	0.4047	hectares (ha)
cubic feet (ft ³)	0.02832	cubic meters (m ³)
cubic yards (yd ³)	0.7646	cubic meters (m ³)
curies (Ci)	3.7×10^{10}	becquerels (Bq)
degrees Fahrenheit (°F) -32	0.5555	degrees Celsius (°C)
feet (ft)	0.3048	meters (m)
gallons (gal)	3.785	liters (L)
gallons (gal)	0.003785	cubic meters (m ³)
inches (in.)	2.540	centimeters (cm)
miles (mi)	1.609	kilometers (km)
pounds (lb)	0.4536	kilograms (kg)
rads	0.01	grays (Gy)
rems	0.01	sieverts (Sv)
short tons (tons)	907.2	kilograms (kg)
short tons (tons)	0.9072	metric tons (t)
square feet (ft ²)	0.09290	square meters (m ²)
square yards (yd ²)	0.8361	square meters (m ²)
square miles (mi ²)	2.590	square kilometers (km ²)
yards (yd)	0.9144	meters (m)
<hr style="border-top: 1px dashed black;"/>		
<i>To Convert Metric to English Equivalents</i>		
becquerels (Bq)	2.7×10^{-11}	curies (Ci)
centimeters (cm)	0.3937	inches (in.)
cubic meters (m ³)	35.31	cubic feet (ft ³)
cubic meters (m ³)	1.308	cubic yards (yd ³)
cubic meters (m ³)	264.2	gallons (gal)
degrees Celsius (°C) +17.78	1.8	degrees Fahrenheit (°F)
grays (Gy)	100	rads
hectares (ha)	2.471	acres
kilograms (kg)	2.205	pounds (lb)
kilograms (kg)	0.001102	short tons (tons)
kilometers (km)	0.6214	miles (mi)
liters (L)	0.2642	gallons (gal)
meters (m)	3.281	feet (ft)
meters (m)	1.094	yards (yd)
metric tons (t)	1.102	short tons (tons)
sieverts (Sv)	100	rems
square kilometers (km ²)	0.3861	square miles (mi ²)
square meters (m ²)	10.76	square feet (ft ²)
square meters (m ²)	1.196	square yards (yd ²)

Summary

1
2
3
4 The Atomic Energy Act of 1954 authorizes the U.S. Nuclear Regulatory Commission (NRC) to
5 issue commercial nuclear power plant operating licenses for up to 40 years and permits the
6 renewal of the licenses upon expiration. NRC regulations allow for the renewal of these
7 operating licenses for up to an additional 20 years, depending on the outcome of safety and
8 environmental assessments. There are no specific limitations in the Atomic Energy Act or the
9 NRC's regulations restricting the number of times a license may be renewed.

10
11 The license renewal process is designed to assure safe operation of the nuclear power plant
12 and protection of the environment during the license renewal term. Under the NRC's
13 environmental protection regulations in Title 10, Part 51, of the *Code of Federal*
14 *Regulations* (10 CFR Part 51), which implement Section 102(2) of the National Environmental
15 Policy Act (NEPA), renewal of a nuclear power plant operating license requires the preparation
16 of an environmental impact statement (EIS).

17
18 To support the preparation of these EISs, the NRC prepared the *Generic Environmental Impact*
19 *Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437, in 1996. The original
20 1996 GEIS^(a) for license renewal was prepared to assess the environmental impacts associated
21 with the continued operation of nuclear power plants during the license renewal term. The
22 intent was to determine which environmental impacts would result in essentially the same
23 impact at all nuclear power plants, and which ones could result in different levels of impacts at
24 different plants and would require a plant-specific analysis to determine the impacts. For those
25 issues that the NRC staff could not generically address, the NRC staff will develop plant-specific
26 supplemental EISs (SEISs) to the GEIS.

27
28 The GEIS is intended to improve the efficiency of the license renewal process by (1) providing
29 an evaluation of the types of environmental impacts that may occur from renewing commercial
30 nuclear power plant operating licenses, (2) identifying and assessing impacts that are expected
31 to be generic (the same or similar) at all nuclear plants (or plants with specified plant or site
32 characteristics), and (3) defining the number and scope of environmental impact issues that
33 need to be addressed in plant-specific EISs.

34
35 The NRC committed to review and update the GEIS, if necessary, on a 10-year cycle. Since
36 publication of the GEIS in 1996, approximately 30 nuclear plant sites (50 reactor units) have
37 been the subject of plant-specific environmental reviews. This revision to the GEIS is intended

(a) Any reference in this document to the 1996 GEIS (NUREG-1437; NRC 1996) includes the two-volume set published in 1996 and Addendum 1 to the GEIS published in 1999.

Summary

1 to incorporate lessons learned and knowledge gained from these plant-specific environmental
2 reviews, as well as other pieces of new information and research published since the 1996
3 GEIS.

4 5 **S.1 Purpose and Need for the Proposed Action**

6
7 The proposed action is the renewal of commercial nuclear power plant operating licenses. The
8 NRC reviews each application submitted by licensees of operating nuclear power plants. A
9 renewed license is just one of a number of conditions that licensees must meet if the licensee is
10 to continue plant operations during the renewal term.

11
12 The purpose and need for NRC's proposed action is to provide an option to continue plant
13 operations beyond the current licensing term to meet future system generating needs. These
14 needs and, ultimately, the decision to operate a nuclear power plant under a renewed operating
15 license are to be determined by State, utility, system, and, where authorized, Federal (other
16 than NRC) decision makers. Unless there are findings in the safety or the environmental
17 reviews that would lead the NRC to reject a license renewal application, the NRC has no role in
18 energy planning decisions. State regulatory agencies, system operators, power plant owners,
19 and, in some cases other Federal agencies, ultimately decide whether the plant should continue
20 to operate. From the perspective of the licensee and the State or system regulatory authorities,
21 the purpose of renewing an operating license is to maintain the availability of the nuclear plant
22 to meet system energy requirements beyond the term of the plant's current license.

23
24 The NRC has no authority or regulatory control over the ultimate selection of future energy
25 alternatives. The NRC also cannot ensure that environmentally preferable energy alternatives
26 are used in the future. While the NRC staff considers a wide range of alternatives to license
27 renewal, the only alternative within NRC's decision-making authority is not to renew it. For the
28 purposes of this GEIS, the NRC considers this option to be the No-Action Alternative.

29
30 At some point, all plants will terminate operations and undergo decommissioning. Under the
31 No-Action Alternative, plant operations would terminate at or before the end of the current
32 license term. The No-Action Alternative, unlike the other alternatives, does not expressly meet
33 the purpose and need of the proposed action, as it does not provide a means of meeting future
34 electric system needs. No action, on its own, would likely create a need for replacement power,
35 conservation and energy efficiency (demand-side management), purchased power, or some
36 combination of these options.

37
38 A full range of power generation alternatives are evaluated in the GEIS, including fossil fuel,
39 new nuclear, and renewable energy sources. Conservation and power purchasing are also

1 considered as alternatives to license renewal, because they represent other options for electric
2 system planners.
3

4 **S.2 Scope of the Generic Environmental Impact Statement**

5
6 The GEIS documents the results of the systematic approach NRC used to evaluate the
7 environmental consequences of renewing the licenses of commercial nuclear power plants and
8 operating the plants for an additional 20 years beyond the current license term. The
9 environmental consequences of license renewal include (1) impacts associated with continued
10 operations and refurbishment activities similar to those that have occurred during the current
11 license term; (2) impacts of various alternatives to the proposed action; (3) impacts from the
12 termination of nuclear power plant operations and decommissioning after the license renewal
13 term (with emphasis on the incremental effect caused by an additional 20 years of operation);
14 (4) impacts associated with the uranium fuel cycle; (5) impacts of postulated accidents (design-
15 basis accidents and severe accidents); (6) cumulative impacts of the proposed action; and
16 (7) resource commitments associated with the proposed action, including unavoidable adverse
17 impacts, the relationship between short-term use and long-term productivity, and irreversible
18 and irretrievable commitment of resources. The environmental consequences of these activities
19 are evaluated in the GEIS.
20

21 In the 1996 GEIS, the NRC identified and assessed 92 environmental issues. This GEIS
22 revision reviews and reevaluates the environmental impact issues and findings in the original
23 GEIS. Experience gained from license renewal reviews conducted since the 1996 GEIS was
24 published provides a source of new information for the evaluation presented in this revision. In
25 addition, new research, findings, and other information were considered in evaluating the
26 significance of impacts associated with license renewal. The purpose of the evaluation was to
27 determine if the findings presented in the 1996 GEIS remain valid. In doing so, the NRC
28 considered the need to modify, add to, or delete any of the 92 issues in the 1996 GEIS.
29

30 In a Notice of Intent published in the *Federal Register* on June 3, 2003, the NRC notified the
31 public of its plan to revise the GEIS and to give people an opportunity to participate in the
32 environmental scoping process. This step was the initial opportunity for public participation in
33 the GEIS revision. In July 2003, the NRC held public scoping meetings in four locations (one in
34 each of the four NRC regions) – Atlanta, Georgia; Oak Lawn, Illinois; Anaheim, California; and
35 Boston, Massachusetts.
36

37 Participation in the scoping process by members of the public and local, State, Tribal, and
38 Federal government agencies was encouraged and used to (1) determine the scope of the
39 GEIS revision and identify whether there are any significant new issues that should be analyzed

Summary

1 in depth; (2) identify and eliminate from detailed study those issues that are peripheral, are not
2 significant, or have been covered by prior environmental reviews; (3) identify any environmental
3 assessments and other EISs that are being or will be prepared that are related to, but are not
4 part of, the scope of the proposed action; and (4) identify other environmental review and
5 consultation requirements related to the proposed action.
6

7 The initial scoping period for this GEIS revision was from June 3, 2003, to September 17, 2003,
8 but scoping was reopened between September 27, 2005, and December 30, 2005. The NRC
9 staff reviewed the transcripts and all written material received during the scoping period and
10 identified individual comments. All comments and suggestions received orally during the
11 scoping meetings or in writing were considered.
12

13 In evaluating the impacts of the proposed action and considering comments received from the
14 public and agencies during the scoping period, the NRC identified 78 impact issues: 70 impact
15 issues were associated with continued operations, refurbishment, and other supporting
16 activities; 2 with postulated accidents; 1 with termination of plant operations and
17 decommissioning; 4 with the uranium fuel cycle; and 1 with cumulative impacts. For all of these
18 issues, the incremental effect of license renewal was the focus of the evaluation.
19

20 For each potential environmental impact issue, the revised GEIS (1) describes the nuclear
21 power plant activity that could affect the resource, (2) identifies the resource that is affected,
22 (3) evaluates past license renewal reviews and other available information, (4) assesses the
23 nature and magnitude of the environmental impact on the affected resource, (5) characterizes
24 the significance of the effect, (6) determines whether the results of the analysis apply to all
25 nuclear power plants (whether the impact issue is Category 1 or Category 2), and (7) considers
26 additional mitigation measures for adverse impacts.
27

28 The scope of the revised GEIS also evaluates the impacts of alternatives to license renewal,
29 including alternative power generation (fossil, nuclear, and renewable energy), conservation
30 and energy efficiency (demand-side management), and purchased power. It also evaluates the
31 impacts from the no action alternative (not renewing the operating license). This GEIS includes
32 the NRC's evaluation of construction, operation, postulated accidents, decommissioning, and
33 fuel cycles for these alternatives.
34

35 **S.3 Impact Definitions and Categories**

36
37 The NRC's standard of significance for impacts uses the Council on Environmental Quality
38 (CEQ) terminology for "significantly" (40 CFR 1508.27), which requires consideration of both
39 "context" and "intensity." The NRC used the CEQ terminology to establish three significance

1 levels: small, moderate, and large. The definitions of the three significance levels, which are
2 presented in the footnotes to Table B-1 of 10 CFR Part 51, Subpart A, Appendix B, follow:
3

- 4 • Small impact: Environmental effects are not detectable or are so minor that they will
5 neither destabilize nor noticeably alter any important attribute of the resource. For the
6 purposes of assessing radiological impacts, the Commission has concluded that those
7 impacts do not exceed permissible level in the Commission's regulations are considered
8 small.
9
- 10 • Moderate impact: Environmental effects are sufficient to alter noticeably, but not to
11 destabilize, important attributes of the resource.
12
- 13 • Large impact: Environmental effects are clearly noticeable and are sufficient to
14 destabilize important attributes of the resource.
15

16 In addition to a determination of significance of environmental impacts associated with an issue,
17 a determination was made whether the analysis in the GEIS could be applied all nuclear plants
18 (as well as to all plants with certain plant or site characteristics). Issues were assigned a
19 Category 1 or Category 2 designation as follows:
20

21 Category 1 issues are those that meet all of the following criteria:
22

- 23 (1) The environmental impacts associated with the issue have been determined to apply
24 either to all plants or, for some issues, to plants having a specific type of cooling system
25 or other specified plant or site characteristics;
26
- 27 (2) A single significance level (i.e., small, moderate, or large) has been assigned to the
28 impacts (except for collective offsite radiological impacts from the fuel cycle and from
29 high-level waste and spent fuel);
30
- 31 (3) Mitigation of adverse impacts associated with the issue has been considered in the
32 analysis, and it has been determined that additional plant-specific mitigation measures
33 would probably not be sufficiently beneficial to warrant implementation.
34

35 For issues that meet the three Category 1 criteria, no additional plant-specific analysis is
36 required in future SEISs unless new and significant information is identified.
37

38 Category 2 issues are those that do not meet one or more of the criteria of Category 1, and,
39 therefore, require additional plant-specific review.
40

1 **S.4 Affected Environment**

2
3 For purposes of the evaluation in this GEIS revision, the “affected environment” is the
4 environment currently existing around operating commercial nuclear power plants. Current
5 conditions in the affected environment are the result of past construction and operations at the
6 plants. The NRC has considered the effects of these past and ongoing impacts and how they
7 have shaped the environment. The NRC evaluated impacts of license renewal that are
8 incremental to existing conditions. These existing conditions serve as the baseline for the
9 evaluation and include the effects of past and present actions at the plants.

10
11 The NRC described the affected environment in terms of the following resource areas and
12 activities: (1) land use and visual resources; (2) meteorology, air quality, and noise; (3) soils,
13 geology, and seismology; (4) hydrology (surface water and groundwater); (5) ecology (terrestrial
14 and aquatic resources; threatened, endangered, and protected species and essential fish
15 habitat); (6) historic and cultural resources; (7) socioeconomics; (8) human health;
16 (9) environmental justice; and (10) waste management and pollution prevention. The affected
17 environments of the operating plant sites represent diverse environmental conditions.

18 19 **S.5 Impacts from Continued Operations and Refurbishment** 20 **Activities Associated with License Renewal**

21
22 NRC identified 78 impact issues from continued operations and refurbishment associated with
23 license renewal. Nineteen of these issues were identified as Category 2 issues and would
24 require plant-specific evaluations in future SEISs. The conclusions in each resource topical
25 area are summarized here.

26 27 **Land Use**

- 28
- 29 • The impacts of continued operations and refurbishment on onsite land use are expected
30 to be small at all nuclear plants. Changes in onsite land use from continued operations
31 and refurbishment would be a small fraction of any nuclear power plant site and would
32 involve only land that is controlled by the licensee. This is a Category 1 issue.
 - 33
 - 34 • The impacts of continued operations and refurbishment on offsite land use are expected
35 to be small. Offsite land use would not be affected from continued operations and
36 refurbishment associated with license renewal. This is a Category 1 issue.
 - 37
 - 38 • Transmission line right-of-ways (ROWs) would continue with no change in offsite land
39 use restrictions. This is a Category 1 issue.
 - 40

1 **Visual Resources**

- 2
- 3 • No important changes to the visual appearance (aesthetics) of plant structures or
- 4 transmission lines are expected from continued operations and refurbishment. This is a
- 5 Category 1 issue.
- 6

7 **Air Quality**

- 8
- 9 • Air quality impacts of continued operations and refurbishment activities are expected to
- 10 be small. However, emissions during these activities could be a cause for concern at
- 11 locations in or near air quality nonattainment or maintenance areas. The significance of
- 12 the impact cannot be determined without considering the compliance status of each site
- 13 and the activities that could occur. These impacts would be short-lived and cease after
- 14 projects were completed.
- 15

16 Emissions from testing emergency diesel generators and fire pumps and from routine
17 operations of boilers used for space heating would not be a concern, even for those
18 plants located in or adjacent to nonattainment areas. Although particulate emissions
19 from cooling towers may be a concern for a very limited number of plants located in
20 States that regulate such emissions, the impacts in even these worst-case situations
21 have been small. Air quality in nonattainment and maintenance areas is plant-specific
22 and is therefore a Category 2 issue.

- 23
- 24 • Production of ozone and oxides of nitrogen from transmission lines is insignificant and
- 25 does not contribute measurably to ambient levels of these gases. This is a Category 1
- 26 issue.
- 27

28 **Noise**

- 29
- 30 • Noise levels would remain below regulatory guidelines for offsite receptors. This is a
- 31 Category 1 issue.
- 32

33 **Geology and Soils**

- 34
- 35 • Impacts on geology and soils would be small at all plants if best management practices
- 36 were employed to reduce erosion. This is a Category 1 issue.
- 37

Summary

1 **Surface Water**

- 2
- 3 • Impacts of continued operations and refurbishment on surface water quality and use are
- 4 expected to be negligible if best management practices are employed to control soil
- 5 erosion and spills. Water use would not increase significantly or would be reduced if a
- 6 plant outage is necessary to accomplish action. This is a Category 1 issue.
- 7
- 8 • Altered current patterns would be limited to the area in the vicinity of the intake and
- 9 discharge structures. These impacts have been small at operating nuclear power plants.
- 10 This is a Category 1 issue.
- 11
- 12 • Effects on salinity gradients would be limited to the area in the vicinity of the intake and
- 13 discharge structures. These impacts have been small at operating nuclear power plants.
- 14 This is a Category 1 issue.
- 15
- 16 • Effects on thermal stratification would be limited to the area in the vicinity of the intake
- 17 and discharge structures. These impacts have been small at operating nuclear power
- 18 plants. This is a Category 1 issue.
- 19
- 20 • Scouring effects would be limited to the area in the vicinity of the intake and discharge
- 21 structures. These impacts have been small at operating nuclear power plants. This is a
- 22 Category 1 issue.
- 23
- 24 • Discharges of metals have not been found to be a problem at operating nuclear power
- 25 plants with cooling-tower-based heat dissipation systems and have been satisfactorily
- 26 mitigated at other plants. Discharges are monitored as part of the National Pollutant
- 27 Discharge Elimination System (NPDES) permit process. This is a Category 1 issue.
- 28
- 29 • The effects of biocides, sanitary wastes, and minor chemical spills and discharges are
- 30 regulated by State and Federal environmental agencies. Discharges are monitored as
- 31 part of the NPDES permit process. These impacts have been small at operating nuclear
- 32 power plants. This is a Category 1 issue.
- 33
- 34 • Water use conflicts have not been found to be a problem at operating nuclear power
- 35 plants with once-through heat dissipation systems. This is a Category 1 issue.
- 36
- 37 • Water use conflicts could occur with plants that rely on cooling ponds or cooling towers
- 38 using makeup water from a river with low flow. Impacts could be of small or moderate
- 39 significance, depending on makeup water requirements, water availability, and
- 40 competing water demands. This is a Category 2 issue.
- 41

- 1 • Dredging to remove accumulated sediments in the vicinity of intake and discharge
2 structures and to maintain barge shipping has not been found to be a problem for
3 surface water quality. Dredging is performed under permit from the U.S. Army Corps of
4 Engineers. This is a Category 1 issue.
5
- 6 • Temperature effects on sediment capacity have not been found to be a problem at
7 operating nuclear power plants and are not expected to be a problem during the license
8 renewal term. This is a Category 1 issue.
9

10 **Groundwater**

- 11
- 12 • Impacts of continued operations and refurbishment on groundwater use and quality
13 would be small, as extensive dewatering is not anticipated. The application of best
14 management practices for handling any materials produced or used during activities
15 would reduce impacts. This is a Category 1 issue.
16
- 17 • Groundwater use conflicts are not anticipated for plants that withdraw less than
18 100 gpm. This is a Category 1 issue.
19
- 20 • Groundwater use conflicts could occur with plants that withdraw more than 100 gpm
21 (including those using Ranney wells). This is a Category 2 issue.
22
- 23 • For plants with closed-cycle cooling systems that withdraw makeup water from a river,
24 water use conflicts could result from water withdrawals from rivers during low-flow
25 conditions, which may affect aquifer recharge. The significance of impacts would
26 depend on makeup water requirements, water availability, and competing water
27 demands. This is a Category 2 issue.
28
- 29 • The impacts of groundwater withdrawals on groundwater quality are expected to be
30 small at all nuclear plants. Groundwater withdrawals at operating nuclear power plants
31 are not large enough to significantly affect groundwater quality. This is a Category 1
32 issue.
33
- 34 • The impacts of cooling ponds on groundwater quality are expected to be small at nuclear
35 plants that employ such a cooling system in salt marshes. The infiltration of cooling
36 water from unlined cooling ponds could potentially affect the quality of underlying
37 groundwater; however, because groundwater in salt marshes is naturally brackish and
38 not used for human consumption, this is not a concern for plants located in salt marshes.
39 This is a Category 1 issue.
40

Summary

- 1 • The impacts of cooling ponds on groundwater quality could be small, moderate, or large
2 at nuclear plants that employ such a cooling system at inland sites. The infiltration of
3 cooling water from unlined cooling ponds could potentially affect the quality of underlying
4 groundwater, and, for plants located inland, the quality of the groundwater in the vicinity
5 of the ponds could be affected. The significance of the impact would depend on cooling
6 pond water quality; site hydrogeologic conditions (including the interaction of surface
7 water and groundwater); and the location, depth, and pump rate of water wells. This is a
8 Category 2 issue.
9
- 10 • Groundwater and soil contamination could result in small or moderate impacts at all
11 nuclear plants. Industrial practices involving the use of solvents, hydrocarbons, heavy
12 metals, or other chemicals and unlined wastewater lagoons have the potential to
13 contaminate site groundwater, soil, and subsoil. Contamination is subject to State- and
14 U.S. Environmental Protection Agency (EPA)-regulated cleanup and monitoring
15 programs. This is a Category 2 issue.
16
- 17 • Radionuclides released to groundwater, particularly tritium, could result in small or
18 moderate impacts at all nuclear plants. Underground system leaks of process water
19 have been discovered in recent years at several plants. Groundwater protection
20 programs have been established at all operating nuclear power plants. This is a
21 Category 2 issue.
22

23 **Terrestrial Resources**

- 24
- 25 • The impacts of continued plant operations on terrestrial ecosystems could be small,
26 moderate, or large. The magnitude of impacts would depend on the nature of the
27 refurbishment or other supporting activities. Application of best management practices
28 would reduce the potential for impacts. The magnitude of impacts would depend on the
29 nature of the activity, the status of the resources that could be affected, and the
30 effectiveness of mitigation. This is a Category 2 issue.
31
- 32 • The impacts of the exposure of terrestrial organisms to radionuclides are expected to be
33 small at all nuclear plants. Doses to terrestrial organisms are expected to be well below
34 exposure guidelines developed to protect these organisms. This is a Category 1 issue.
35
- 36 • Cooling system impacts on terrestrial resources are expected to be small for all nuclear
37 plants with once-through cooling systems or cooling ponds. No significant adverse
38 effects to terrestrial plants or animals have been reported as a result of increased water
39 temperatures, fogging, humidity, or reduced habitat quality. Because of the low
40 concentrations of contaminants within the liquid effluent associated with cooling
41 systems, uptake and accumulation of contaminants in the tissues of wildlife exposed to

1 contaminated water or aquatic food sources are not expected to be significant. This is a
2 Category 1 issue.

- 3
- 4 • The impacts of cooling tower operations on vegetation are expected to be small for all
5 nuclear plants with this type of cooling system. Impacts from salt drift, icing, fogging, or
6 increased humidity associated with cooling tower operation have the potential to affect
7 adjacent plant communities; however, these impacts have been small at operating
8 nuclear power plants and are not expected to change over the license renewal term.
9 This is a Category 1 issue.
 - 10
 - 11 • The impacts from bird collisions with cooling towers and transmission lines are expected
12 to be small at all nuclear plants. Bird collisions with cooling towers and transmission
13 lines occur at rates that are unlikely to affect local or migratory populations. This is a
14 Category 1 issue.
 - 15
 - 16 • Water use conflicts with terrestrial resources for plants with cooling ponds or cooling
17 towers using makeup water from a river with low flow could be small or moderate.
18 Impacts on terrestrial resources in riparian communities affected by water use conflicts
19 could be of moderate significance in some situations. This is a Category 2 issue.
 - 20
 - 21 • Transmission line ROW management impacts on terrestrial resources are expected to
22 be small at all nuclear plants. Continued ROW management would not lower habitat
23 quality or cause significant changes in wildlife populations in the surrounding habitat.
24 This is a Category 1 issue.
 - 25
 - 26 • Impacts of electromagnetic fields on flora and fauna are expected to be small at all
27 nuclear plants. No significant impacts of electromagnetic fields on terrestrial flora and
28 fauna have been identified. Such effects are not expected to be a problem during the
29 license renewal term. This is a Category 1 issue.

30

31 **Aquatic Resources**

- 32
- 33 • The impacts of impingement and entrainment of aquatic organisms could be small,
34 moderate, or large at nuclear plants with once-through cooling systems or cooling
35 ponds. The impacts of impingement and entrainment are small at many plants but may
36 be moderate or even large at a few plants with once-through and cooling-pond cooling
37 systems, depending on cooling system withdrawal rates and volumes and the aquatic
38 resources at the site. This is a Category 2 issue.
 - 39
 - 40 • The impacts of impingement and entrainment of aquatic organisms are expected to be
41 small at plants with cooling towers. Impingement and entrainment rates are low at

Summary

- 1 plants that use closed-cycle cooling with cooling towers because the rates and volumes
2 of water withdrawal needed for makeup are minimized. This is a Category 1 issue.
3
- 4 • Thermal impacts on aquatic organisms are expected to be small at nuclear plants with
5 cooling towers. Thermal effects associated with plants that use cooling towers are small
6 because of the reduced amount of heated discharge from these types of systems. This
7 is a Category 1 issue.
8
 - 9 • Thermal impacts on aquatic organisms could be small, moderate, or large at nuclear
10 plants with once-through cooling systems or cooling ponds. Most of the effects
11 associated with thermal discharges are localized and are not expected to affect overall
12 stability of populations or resources. However, the magnitude of impacts would depend
13 on site-specific thermal plume characteristics and the nature of aquatic resources in the
14 area. This is a Category 2 issue.
15
 - 16 • The effects of cooling water discharge on dissolved oxygen, gas supersaturation, and
17 eutrophication are expected to result in small impacts at all nuclear plants. Gas
18 supersaturation was a concern at a small number of operating nuclear power plants with
19 once-through cooling systems but has been satisfactorily mitigated. Low dissolved
20 oxygen was a concern at one nuclear power plant with a once-through cooling system,
21 but the problem has been effectively mitigated. Eutrophication (nutrient loading) and
22 resulting effects on chemical and biological oxygen demands have not been found to be
23 a problem at operating nuclear power plants. This is a Category 1 issue.
24
 - 25 • The impacts of non-radiological contaminants on aquatic organisms are expected to be
26 small at all nuclear plants. Best management practices and discharge limitations of
27 NPDES permits are expected to minimize the potential for impacts to aquatic resources.
28 Accumulation of metal contaminants has been a concern at a few nuclear power plants
29 but has been satisfactorily mitigated by replacing copper alloy condenser tubes with
30 those of another metal. This is a Category 1 issue.
31
 - 32 • The impacts of radionuclides on aquatic organisms are expected to be small at all
33 nuclear plants. Doses to aquatic organisms are expected to be well below exposure
34 guidelines developed to protect these organisms. This is a Category 1 issue.
35
 - 36 • The impacts of dredging on aquatic resources are expected to be small at all nuclear
37 plants. Impacts of dredging on aquatic resources are relatively short-lived and localized.
38 Such activities would require permits from the USACE, State environmental agencies, or
39 other applicable regulatory authorities. This is a Category 1 issue.
40

- 1 • Water use conflicts with aquatic resources for plants with cooling ponds or cooling
2 towers could be small or moderate. Impacts on aquatic resources in instream
3 communities affected by water use conflicts could be of moderate significance in some
4 situations. This is a Category 2 issue.
5
- 6 • The impacts of refurbishment and other supporting activities on aquatic resources are
7 expected to be small at all nuclear plants. Application of best management practices to
8 refurbishment projects near aquatic systems would reduce the potential for impacts.
9 For actions that require plant shutdown, there would be short-term reductions in
10 entrainment and impingement rates and thermal plume characteristics. This is a
11 Category 1 issue.
12
- 13 • The impacts of transmission line ROW management on aquatic resources are expected
14 to be small at all nuclear plants. Application of best management practices to ROW
15 management near aquatic systems would reduce the potential for impacts. This is a
16 Category 1 issue.
17
- 18 • The impacts associated with losses from predation, parasitism, and disease among
19 organisms exposed to sublethal stresses are expected to be small at all nuclear plants.
20 These types of losses have not been found to be a problem at operating nuclear power
21 plants and are not expected to be a problem during the license renewal term. This is a
22 Category 1 issue.
23
- 24 • Stimulation of nuisance organisms has been satisfactorily mitigated at the single nuclear
25 power plant with a once-through cooling system where previously it was a problem and
26 is small at all nuclear plants. It has not been found to be a problem at operating nuclear
27 power plants with cooling towers or cooling ponds and is not expected to be a problem
28 during the license renewal term. This is a Category 1 issue.
29

30 **Threatened, Endangered, and Protected Species and Essential Fish Habitat**

- 31
- 32 • The impacts on threatened, endangered, and protected species and essential fish
33 habitats could be small, moderate, or large at nuclear plants. The magnitude of impacts
34 would depend on the occurrence of listed species and habitats and the effects of power
35 plant systems on them. Consultation with appropriate agencies would be needed to
36 determine whether special status species or habitats are present and whether they
37 would be adversely affected. This is a Category 2 issue.
38

Summary

1 **Historic and Cultural Resources**

- 2
- 3 • Impacts of continued operations and refurbishment activities on historic and cultural
- 4 resources could be small, moderate, or large at nuclear plants. Continued operations
- 5 and refurbishment are expected to have no more than small adverse impacts on historic
- 6 and cultural resources because most impacts could be mitigated by avoiding those
- 7 resources. The National Historic Preservation Act (NHPA) requires the Federal agency
- 8 to consult with the State Historic Preservation Officer (SHPO) and appropriate Native
- 9 American Tribes to determine the potential impacts and mitigation. This is a Category 2
- 10 issue.

11 **Socioeconomics**

- 12
- 13
- 14 • Impacts on employment and income and recreation and tourism would be small at all
- 15 plants. Although most nuclear plants have large numbers of employees with higher than
- 16 average wages and salaries, employment and income impacts from continued
- 17 operations and refurbishment are expected to be small. Nuclear plant operations,
- 18 employee spending, power plant expenditures, and tax payments have an effect on local
- 19 economies. Changes in plant operations, employment, and expenditures would have a
- 20 greater effect on rural economies than semi-urban economies. This is a Category 1
- 21 issue.
- 22
- 23 • Impacts on tax revenues would be small for all plants. Nuclear plants provide tax
- 24 revenue to local jurisdictions in the form of property tax payments, payments-in-lieu-of-
- 25 tax (PILOT) payments, or tax payments on energy production. The amount of tax
- 26 revenue paid during the license renewal term is not expected to change, since the
- 27 assessed value of the power plant, payments on energy production, and PILOT
- 28 payments are also not expected to change. This is a Category 1 issue.
- 29
- 30 • Community services and education impacts would be small at all plants. With no
- 31 increase in employment, value of the power plant, payments on energy production, and
- 32 PILOT payments expected during the renewal term, community and educational
- 33 services would not be affected by continued power plant operations. Changes in
- 34 employment and tax payments would have a greater effect on jurisdictions receiving a
- 35 large portion of annual revenues from the power plant than on jurisdictions receiving the
- 36 majority of its revenues from other sources. This is a Category 1 issue.
- 37
- 38 • Population and housing impacts would be small for all plants. Regional population and
- 39 housing availability and value would not change during the license renewal term unless
- 40 significant changes in plant employment would occur. With no increase in employment
- 41 expected during the license renewal term, population and housing availability and values

1 would not be affected by continued power plant operations. Any changes in population
2 and housing availability and value due to changes in the workforce at the plant would
3 have a greater effect on sparsely populated areas than areas with higher density
4 populations. This is a Category 1 issue.

- 5
6 • Transportation impacts would be small at all plants. Traffic volumes would not change
7 during the license renewal term unless significant changes in plant employment
8 occurred. Any changes in employment would have a greater effect on rural areas with
9 less developed local and regional networks. Impacts would be less noticeable in
10 semi-urban areas, depending on the quality and extent of local access roads and the
11 timing of plant shift changes when compared with typical local usage. This is a Category
12 1 issue.

13 **Human Health**

- 14
15
16 • Radiation exposures to the public from continued operations and refurbishment are
17 expected to result in small impacts at all nuclear plants. Radiation doses to the public
18 associated with license renewal are expected to continue at current levels and would be
19 well below regulatory limits. This is a Category 1 issue.
- 20
21 • Radiation exposures to workers from continued operations and refurbishment are
22 expected to result in small impacts at all nuclear plants. Occupational doses are
23 expected to be within the range of doses experienced during the current license term
24 and would continue to be well below regulatory limits. This is a Category 1 issue.
- 25
26 • Human health impacts from chemicals are expected to be small at all nuclear plants.
27 Chemical hazards to workers would be minimized by observing good industrial hygiene
28 practices. Chemical releases to the environment and the potential for impacts to the
29 public are minimized by adherence to discharge limitations of NPDES permits. This is a
30 Category 1 issue.
- 31
32 • Microbiological hazards to plant workers are expected to be small at all nuclear plants.
33 Occupational health impacts are expected to be controlled by continued application of
34 accepted industrial hygiene practices to minimize worker exposures. This is a
35 Category 1 issue.
- 36
37 • Microbiological hazards to the public could result in small, moderate, or large impacts at
38 plants with cooling ponds or canals or cooling towers that discharge to a river. These
39 organisms are not expected to be a problem at most operating plants except possibly at
40 plants using cooling ponds, lakes, or canals that discharge to rivers. Impacts would
41 depend on site-specific characteristics. This is a Category 2 issue.

Summary

- 1
2
- The chronic effects of electromagnetic fields (EMFs) associated with nuclear plants and associated transmission lines are uncertain. Studies of 60-Hz EMFs have not uncovered consistent evidence linking harmful effects with field exposures. EMFs are unlike other agents that have a toxic effect (e.g., toxic chemicals and ionizing radiation) in that dramatic acute effects cannot be forced and longer-term effects, if real, are subtle. Because the state of the science is currently inadequate, no generic conclusion on human health impacts is possible. This issue has not been categorized.
- 9
- Physical occupational hazards are expected to result in small impacts at all nuclear plants. Occupational safety and health hazards are generic to all types of electrical generating stations, including nuclear power plants, and are of small significance if the workers adhere to safety standards and use personal protective equipment. This is a Category 1 issue.
- 15
- Electric shock hazards could result in small, moderate, or large impacts. Electrical shock potential is of small significance for transmission lines that are operated in adherence with the National Electrical Safety Code (NESC). Without a review of the conformance of each nuclear plant transmission line conformance with NESC criteria, it is not possible to determine the generic significance of the electrical shock potential. This is a Category 2 issue.
- 22

Postulated Accidents

- 23
- The NRC staff has concluded that the environmental impacts of design-basis accidents are of small significance for all nuclear plants. This is a Category 1 issue.
- 27
- The impacts of severe accidents are expected to be small at all nuclear plants. The probability-weighted consequences of atmospheric releases, fallout onto open bodies of water, releases to groundwater, and societal and economic impacts from severe accidents are small for all plants. However, alternatives to mitigate severe accidents must be considered for all plants that have not considered such alternatives. This is a Category 2 issue.
- 34

Environmental Justice

- 35
- Impacts of continued operations and refurbishment on minority and low-income populations associated with license renewal could be small, moderate, or large. Impacts to minority and low-income populations and subsistence consumption will be addressed in plant-specific reviews. See NRC Policy Statement on the Treatment of Environmental
- 40

1 Justice Matters in NRC Regulatory and Licensing Actions (69 FR 52040). This is a
2 Category 2 issue.

3 4 **Solid Waste Management**

5
6 Because many of the offsite waste processing or disposal facilities also handle waste from other
7 nuclear-fuel-cycle facilities, the evaluation of these issues considered wastes originating
8 not just at the nuclear power plants but also at all other nuclear-fuel-cycle facilities.

- 9
- 10 • The impacts on low-level waste (LLW) storage and disposal are expected to be small at
11 all nuclear plants. The comprehensive regulatory controls that are in place and the low
12 public doses being achieved at reactors ensure that the radiological impacts on the
13 environment would remain small during the term of a renewed license. This is a
14 Category 1 issue.
 - 15
16 • The impacts on onsite storage of spent nuclear fuel are expected to be small at all
17 nuclear plants. The expected increase in the volume of spent fuel from an additional
18 20 years of operation can be safely accommodated onsite with small environmental
19 effects through dry or pool storage at all plants, if a permanent repository or monitored
20 retrievable storage is not available. This is a Category 1 issue.
 - 21
22 • The offsite radiological impacts of spent nuclear fuel and high-level waste (HLW)
23 disposal are expected to be small for all nuclear plants. With regard to the HLW and
24 spent fuel disposal component of the fuel cycle, the EPA established a dose limit
25 of 15 millirem (0.15 mSv) per year for the first 10,000 years and 100 millirem (1.0 mSv)
26 per year between 10,000 years and 1 million years for offsite releases of radionuclides at
27 the proposed repository at Yucca Mountain, Nevada. These limits are within the NRC's
28 public dose limits contained in 10 CFR Part 20. This is a Category 1 issue.
 - 29
30 • The impacts on mixed-waste storage and disposal are expected to be small at all
31 nuclear plants. The comprehensive regulatory controls and the facilities and procedures
32 that are in place ensure proper handling and storage, as well as negligible doses and
33 exposure to toxic materials for the public and the environment at all plants. License
34 renewal would not increase the small continuing risk to human health and the
35 environment posed by mixed waste at all plants. The radiological and nonradiological
36 environmental impacts of long-term disposal of mixed waste from any individual plant at
37 licensed sites are small. This is a Category 1 issue.
 - 38
39 • The impacts on nonradioactive waste storage and disposal are expected to be small at
40 all nuclear plants. No changes to systems that generate nonradioactive waste are
41 anticipated during the license renewal term. Facilities and procedures are in place to

Summary

1 ensure continued proper handling, storage, and disposal, as well as negligible exposure
2 to toxic materials for the public and the environment at all plants. This is a Category 1
3 issue.

4 5 **Cumulative Impacts**

- 6
- 7 • Cumulative impacts are those impacts on the environment that result from the
8 incremental impact of the proposed action when added to other past, present, and
9 reasonably foreseeable future actions, regardless of what agency (Federal or non-
10 Federal) or person undertakes such other actions. The cumulative impacts of license
11 renewal must be considered on a plant-specific basis. Impacts will depend on regional
12 resource characteristics, the resource-specific impacts of license renewal, and the
13 cumulative significance of other factors affecting the resource. This is a Category 2
14 issue.

15 16 **Uranium Fuel Cycle**

- 17
- 18 • The individual offsite radiological impacts resulting from portions of the uranium fuel
19 cycle, other than the disposal of spent fuel and HLW, are expected to be small for all
20 nuclear plants. The impacts on individuals from radioactive gaseous and liquid releases
21 during the license renewal term would remain at or below the NRC's regulatory limits.
22 This is a Category 1 issue.
 - 23
24 • The collective offsite radiological impacts from portions of the uranium fuel cycle other
25 than the disposal of spent fuel and HLW are expected to be small for all nuclear plants.
26 There are no regulatory limits applicable to collective doses to the general public from
27 fuel-cycle facilities. The practice of estimating health effects based on collective doses
28 may not be meaningful. All fuel-cycle facilities are designed and operated to meet the
29 applicable regulatory limits and standards. The Commission concludes that the
30 collective impacts are acceptable. The Commission concludes that the impacts would
31 not be sufficiently large to require the NEPA conclusion, for any plant, that the option of
32 extended operation under 10 CFR Part 54 should be eliminated. This is a Category 1
33 issue.
 - 34
35 • The nonradiological impacts of the uranium fuel cycle are expected to be small for all
36 nuclear plants. The nonradiological impacts of the uranium fuel cycle resulting from the
37 renewal of an operating license for any plant would be small. This is a Category 1 issue.
 - 38
39 • The transportation impacts of the uranium fuel cycle are expected to be small for all
40 nuclear plants. The impacts of transporting materials to and from uranium-fuel-cycle
41

1 facilities on workers, the public, and the environment are expected to be small.
2 Transportation of radioactive materials is governed by the applicable regulatory limits
3 and standards. This is a Category 1 issue.
4

5 **Termination of Nuclear Power Plant Operations and Decommissioning**

6

- 7 • Termination of plant operations and decommissioning would occur eventually regardless
8 of license renewal. The additional 20-year period of operation under the license renewal
9 term would not affect the impacts of shutdown and decommissioning on any resource or
10 at any plant. This is a Category 1 issue.
11

12 **S.6 Comparison of Alternatives**

13

14 The GEIS also evaluates the impacts of the proposed action (license renewal) and alternatives,
15 including the No-Action Alternative (not renewing the operating license). It also evaluates the
16 impacts of alternative power generation (fossil, nuclear, and renewable energy), conservation
17 and energy efficiency (demand-side management), and purchased power. The impacts of
18 renewing the operating license of a nuclear power plant are comparable to the impacts of
19 energy alternatives. Replacement power alternatives would require the construction of a new
20 power plant or modification of the electric transmission grid. The new power plants would also
21 have operational impacts. Conversely, license renewal does not require major construction and
22 operational impacts would not change beyond what is currently being experienced. Other
23 alternatives that would not have construction or operational impacts include conservation and
24 energy efficiency (demand-side management), delayed retirement, repowering, and purchased
25 power.
26

27 Operational impacts of license renewal are comparable to replacement power alternatives and
28 some renewable alternatives in some resource areas (socioeconomics), but quite different in
29 other resource areas (air emissions, fuel cycle, land use, and water consumption). Renewable
30 energy alternatives (wind, ocean wave, and ocean current alternatives) have very few
31 operational impacts, while others (biomass combustion and conventional hydropower) can have
32 considerable impacts. Some renewable energy alternatives (wind and solar) have relatively low
33 but regionally variable capacity factors.
34

35 License renewal and alternatives differ in other respects, including the consequences of
36 accidents. License renewal and new nuclear energy alternatives may have low-probability but
37 potentially high-consequence accidents. In addition, fuel cycle impacts vary across alternatives.
38 Some, like fossil fuel, require large amounts of land for fuel extraction.
39

Summary

- 1 Impacts from terminating power plant operations and decommissioning would vary between
- 2 license renewal and alternatives. License renewal delays the date of reactor shutdown and
- 3 decommissioning but does not alter the impact levels. Impacts would be small in all resource
- 4 areas. In comparison, impacts from terminating operations and decommissioning of most
- 5 alternatives would be larger than impacts from license renewal.
- 6

1. Introduction

1
2
3
4 The Atomic Energy Act of 1954
5 authorizes the U.S. Nuclear Regulatory
6 Commission (NRC) to issue commercial
7 nuclear power plant operating licenses
8 for up to 40 years. The 40-year length of
9 the original license period was imposed
10 for economic and antitrust reasons
11 rather than the technical limitations of
12 the nuclear power plant. NRC
13 regulations allow for the renewal of these
14 operating licenses for up to an additional
15 20 years, depending on the outcome of
16 an assessment determining whether the
17 nuclear power plant can continue to
18 operate safely and protect the
19 environment during the 20-year period of
20 extended operation. There are no
21 specific limitations in the Atomic Energy
22 Act or the NRC's regulations restricting
23 the number of times a license may be
24 renewed.

Contents of Chapter 1

- Purpose of the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437 (Section 1.1)
- Description of the Proposed Action (Section 1.2)
- Purpose and Need for the Proposed Action (Section 1.3)
- Alternatives to the Proposed Action (Section 1.4)
- Analytical Approach Used in the GEIS (Section 1.5)
- Scope of the GEIS (Section 1.6)
- Decisions to Be Supported by the GEIS (Section 1.7)
- Implementation of the Rule (Section 1.8)
- The Public Comment Process (Section 1.9)
- Lessons Learned (Section 1.10)
- New Organization of the GEIS (Section 1.11)

25
26 The license renewal process is designed to assure the safe operation of the nuclear power plant
27 and protection of the environment for up to an additional 20 years. Under the NRC's
28 environmental protection regulations in Title 10, Part 51 of the *Code of Federal Regulations*
29 (10 CFR Part 51), which implement the National Environmental Policy Act (NEPA), renewal of a
30 nuclear power plant operating license requires the preparation of an environmental impact
31 statement (EIS).

32
33 To support the preparation of these EISs, the NRC prepared the *Generic Environmental Impact*
34 *Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437 (NRC 1996, 1999).
35 The original 1996 GEIS^(a) for license renewal was prepared to assess the environmental

(a) Any reference in this document to the 1996 GEIS (NUREG-1437; NRC 1996) includes the two-volume set published in 1996 and Addendum 1 to the GEIS published in 1999.

1 impacts associated with the continued operation of nuclear power plants during the license
 2 renewal term. The intent of the GEIS is to determine which impacts would essentially be the
 3 same at all nuclear power plants and which ones could be different at different plants and would
 4 require a plant-specific analysis to determine the impacts.
 5

6 **1.1 Purpose of the GEIS**

7
 8 The GEIS for license renewal of nuclear power
 9 plants assesses the environmental impacts that
 10 could be associated with license renewal and
 11 an additional 20 years of power plant
 12 operation. This assessment is summarized in
 13 this GEIS. This GEIS also provides the
 14 technical basis for license renewal
 15 amendments to the Commission's regulations,
 16 10 CFR Part 51, "Environmental Protection
 17 Regulations for Domestic Licensing and
 18 Related Regulatory Functions." In the 1996
 19 GEIS and related rulemaking, the Commission
 20 determined that certain impacts associated
 21 with the renewal of a nuclear power plant
 22 operating license were the same or similar for all plants and could be treated on a generic basis.
 23 In this way, repetitive reviews of these impacts could be avoided. The Commission based its
 24 generic assessment of certain environmental impacts on the following factors:
 25

- 26 (1) License renewal will involve nuclear power plants for which the environmental impacts
 27 of operation are well understood as a result of lessons learned and knowledge gained
 28 from operating experience and completed license renewals.
- 29 (2) Activities associated with license renewal are expected to be within this range of
 30 operating experience; thus, environmental impacts can be reasonably predicted.
- 31 (3) Changes in the environment around nuclear power plants are gradual and predictable.

32
 33 The GEIS is intended to improve the efficiency of the license renewal process by (1) providing
 34 an evaluation of the types of environmental impacts that may occur from renewing commercial
 35 nuclear power plant operating licenses, (2) identifying and assessing impacts that are expected
 36 to be generic (the same or similar) at all nuclear plants (or plants with specified plant or site
 37 characteristics), and (3) defining the number and scope of environmental impact issues that
 38 need to be addressed in plant-specific EISs. The GEIS provides information that will aid in the
 39 preparation of plant-specific EISs.
 40
 41

Generic Environmental Impact Statement (GEIS)

A GEIS is an environmental impact statement that assesses the scope and impact of the environmental effects that would be associated with an action (such as license renewal) at numerous sites.

Supplemental Environmental Impact Statement (SEIS)

A SEIS updates or supplements an existing EIS (such as the GEIS). The Commission directed the NRC staff to issue plant-specific supplements to the GEIS for each license renewal application.

1 The Commission has stated that, on a 10-year cycle, it intends to review its assessment of
2 impacts in the GEIS and revise it, if necessary. The first 10-year cycle ended in 2006, and this
3 draft GEIS is the first revision of the original 1996 statement.
4

5 **1.2 Description of the Proposed Action**

6

7 Under NRC's environmental protection regulations in 10 CFR Part 51.20, renewal of a nuclear
8 power plant operating license is identified as a major Federal action that requires the
9 preparation of an EIS to address the impacts of renewing a plant's operating license. The EIS
10 requirements for a plant-specific license renewal review are specified in 10 CFR Parts 51.71
11 and 51.95. NRC's public health and safety and other technical requirements for the renewal of
12 operating licenses are found in 10 CFR Part
13 54. Part 54 requires applicants to perform
14 safety evaluations and assessments of nuclear
15 plants and provide the NRC with sufficient
16 information to analyze the impacts of continued
17 operation for the requested renewal term.
18 Applicants are required to assess the effects of
19 aging on passive systems, structures, and
20 components.
21

The Proposed Action

To renew commercial nuclear power plant operating licenses.

Purpose and Need for the Proposed Action

To provide the option to continue plant operations beyond the current operating license term.

22 Most utilities are expected to begin preparation
23 for license renewal about 10 to 20 years before
24 expiration of their current operating licenses. Inspection, surveillance, test, and maintenance
25 programs for continued plant operations would be integrated gradually over a period of years.
26 Any refurbishment-type activities undertaken for the purposes of license renewal have generally
27 been completed during normal plant refueling or maintenance outages before the original
28 license expires. Activities associated with license renewal and operation of a plant for an
29 additional 20 years are discussed in Chapter 2.
30

31 **1.3 Purpose and Need for the Proposed Action**

32

33 The Commission acts on each application submitted by a licensee for the renewal of
34 commercial nuclear power plant operating licenses per Section 103 of the Atomic Energy Act. A
35 renewed license is just one of a number of conditions that licensees must meet to operate its
36 nuclear plant during the license renewal term. State regulatory agencies and the owners of the
37 plant ultimately decide whether the plant will continue to operate. Economic and environmental
38 considerations play a primary role in this decision. Therefore, the purpose and need for the
39 proposed action (i.e., renewal of a commercial nuclear power plant operating license) is to
40 provide the option to continue plant operations beyond the current operating license term.

1
2 The purpose and need for the proposed action have no role in the energy planning decisions of
3 State regulators and utility officials as to whether a particular nuclear power plant should
4 continue to operate. From the perspective of the licensee and the State regulatory authority, the
5 purpose of renewing an operating license is to maintain the availability of the nuclear plant to
6 meet system energy requirements beyond the term of the plant's current license. In cases of
7 interstate generation or other special circumstances, Federal agencies such as the Federal
8 Energy Regulatory Commission (FERC) or the Tennessee Valley Authority (TVA) may be
9 involved in making these decisions.

10 11 **1.4 Alternatives to the Proposed Action**

12
13 The NRC has considered the environmental consequences of the no-action alternative (i.e., not
14 renewing the license) and the environmental consequences of various alternatives for replacing
15 generating capacity. No conclusions are made in the GEIS about the relative environmental
16 consequences of license renewal and the construction and operation of alternative facilities for
17 generating electric energy. The information in the GEIS is used by the NRC and applicants in
18 performing the plant-specific analysis of alternatives.

19
20 For plant-specific reviews, the NRC will compare the environmental impacts of license renewal
21 with those of alternative energy sources to determine whether the adverse environmental
22 impacts of license renewal are so great that preserving the option of license renewal for energy
23 planning decision makers would be unreasonable.

24 25 **1.5 Analytical Approach Used in the GEIS**

26 27 **1.5.1 Objectives**

28
29 The GEIS serves to streamline NRC's environmental review process by identifying and
30 evaluating environmental impacts that are generic and common to all power plants. Plant-
31 specific impacts will be addressed in supplemental EISs (SEISs) to the GEIS. The SEISs will
32 examine a generic impact only if there is new and significant information.

33 34 **1.5.2 Methodology**

35
36 Environmental impacts of license renewal and the resources that could be affected by continued
37 operation were identified. The general analytical approach for identifying environmental impacts
38 was to (1) describe the nuclear power plant activity that could affect the resource, (2) identify the
39 resource that is affected, (3) evaluate past license renewal reviews and other available
40 information, (4) assess the nature and magnitude of the environmental impact on the affected

1 resource, (5) characterize the significance of the effects, (6) determine whether the results of
2 the analysis apply to all nuclear power plants (whether the impact issue is Category 1 or
3 Category 2), and (7) consider additional mitigation measures for adverse impacts. Identifying
4 environmental impacts (or issues) was conducted in an iterative rather than a stepwise manner.
5 For example, after information was collected and levels of significance were reviewed, impacts
6 were reexamined to determine if any should be removed, added, recombined, or split apart.

8 **Defining Environmental Issues**

9
10 An initial list of 92 environmental issues (or impacts) was identified in the 1996 GEIS. Public
11 and stakeholder comments on previous plant-specific license renewal reviews were analyzed in
12 an effort to reevaluate the existing issues and identify new issues. Environmental issues in this
13 GEIS are arranged by resource area. This perspective is a change from the 1996 GEIS, in
14 which environmental issues were arranged by power plant systems.

16 **Collecting Information**

17
18 Information from previous license renewal reviews was collected and reviewed. Searches of the
19 open scientific literature reports, databases, and Web sites were conducted for each resource
20 area. This information was collected and evaluated to determine if the environmental issues
21 and findings in the 1996 GEIS needed to be revised.

23 **Determining Significance Levels for Issues**

24
25 A standard of significance was established for assessing environmental issues. Significance
26 indicates the importance of likely environmental impacts and is determined by considering two
27 variables: context and intensity. Context is the geographic, biophysical, and social context in
28 which the effects will occur. In the case of license renewal, the context is the environment
29 surrounding the facility. Intensity refers to the severity of the impact, in whatever context it
30 occurs. The NRC developed a three-level standard of significance based upon the President's
31 Council on Environmental Quality (CEQ) guidelines (40 CFR 1508.27):

- 32
33 • Small – environmental effects are not detectable or are so minor that they will neither
34 destabilize nor noticeably alter any important attribute of the resource. For the purposes
35 of assessing radiological impacts, the Commission has concluded that those impacts that
36 do not exceed permissible levels in the Commission's regulations are considered small.
- 37
38 • Moderate – environmental effects are sufficient to noticeably alter important attributes of
39 the resource but not to destabilize them.
- 40
41 • Large – environmental effects are clearly noticeable and are sufficient to destabilize.

1
2 The discussion of each environmental issue in the GEIS includes an explanation of how the
3 significance category was determined. For issues in which the probability of occurrence is a key
4 consideration (i.e., accident consequences), the probability of occurrence has been factored into
5 the determination of significance.
6

7 In addition to determining the significance of environmental impacts associated with an issue, a
8 determination was made whether the analysis in the GEIS could be applied to all plants. The
9 categories to which an issue may be assigned are presented below.

- 10
- 11 • **Category 1** – the analysis reported in the GEIS has shown the following:
12
13 (1) The environmental impacts associated with the issue have been determined to
14 apply either to all plants or, for some issues, to plants having a specific type of
15 cooling system or other specified plant or site characteristics;
16
17 (2) A single significance level (i.e., small, moderate, or large) has been assigned to the
18 impacts (except for collective offsite radiological impacts from the fuel cycle and
19 from high-level waste and spent fuel); and
20
21 (3) Mitigation of adverse impacts associated with the issue has been considered in the
22 analysis, and it has been determined that additional plant-specific mitigation
23 measures would probably not be sufficiently beneficial to warrant implementation.
24

25 The generic analysis of an issue may be adopted in each plant-specific review.

- 26
- 27 • **Category 2** – the analysis reported in the GEIS has shown that one or more of the
28 criteria of Category 1 cannot be met, and therefore, additional plant-specific review is
29 required.
30

31 If all three Category 1 criteria apply to a particular issue, then the generic analysis presented in
32 this GEIS is relied upon by the NRC in evaluating license renewal applications and plant-
33 specific SEISs provided there is no new and significant information requiring further analysis.
34 For issues that do not meet all three Category 1 criteria, then the issue is considered a
35 Category 2 issue, and a plant-specific analysis is required for that issue.
36
37

1.6 Scope of the GEIS

In the 1996 GEIS, the NRC staff assessed 92 environmental issues. Sixty-nine of these issues were determined to be Category 1 and were identified as not requiring additional plant-specific analysis. Guidance on plant-specific analyses required for the other 23 (Category 2) issues is provided in 10 CFR Part 51. Those environmental issues were listed in Table B-1 of Appendix B to Subpart A of 10 CFR Part 51 (Table B-1). This GEIS revision reviews and reevaluates the issues and findings of the 1996 GEIS. Lessons learned and knowledge gained during previous license renewal reviews provide significant sources of new information for this assessment. Since 1996, over 30 nuclear plants have undergone license renewal and environmental review. In addition, new research, findings, and other information were considered when the significance of impacts associated with license renewal was being evaluated. The purpose of the evaluation was to determine if the findings presented in the 1996 GEIS remain valid. In doing so, the NRC staff considered the need to modify, add to, or delete any of the 92 issues in the 1996 GEIS. After this evaluation, the staff carried forward 78 impact issues for detailed consideration in this GEIS revision.

1.7 Decisions to Be Supported by the GEIS

The decisions to be supported by the GEIS are whether to renew the operating licenses of individual nuclear power plants for an additional 20 years of operation. The GEIS was developed to support these decisions and to serve as a basis for tiering future NEPA analyses regarding the license renewal of individual nuclear power plants. The GEIS provides the NRC decision maker with important environmental information considered common to all nuclear power plants.

The scope consists of the range of actions, alternatives, and impacts to be considered in an EIS. The purpose of scoping is to identify the significant issues related to the proposed action. Scoping also identifies and eliminates from detailed study issues that are not significant or have been covered by a prior environmental review. Having a defined scope for the environmental review allows the NRC to concentrate on the essential issues of actions being considered rather than on issues that may have been or are being evaluated in different regulatory review processes, such as the safety review (NRC 2006).

Environmental Impact Statements

10 CFR 51.70(b): The draft environmental impact statement . . . will state how alternatives considered in it and decisions based on it will or will not achieve the requirements of sections 101 and 102(1) of NEPA. (See also the Council on Environmental Quality (CEQ) Regulations for Implementing NEPA, 40 CFR 1502.2(d).)

1 The NEPA process focuses on environmental impacts rather than on issues related to safety.
2 Safety issues become important to the environmental review when they could result in
3 environmental impacts, which are why the environmental effects of postulated accidents are
4 considered in a plant-specific supplement to the GEIS on license renewal (SEIS). Since NEPA
5 regulations do not provide for a safety review, the license renewal process includes an
6 environmental review that is distinct and separate from the safety review. Since the two reviews
7 are separate, operational safety issues and safety issues related to aging are considered
8 outside the scope for the environmental review, just as the environmental issues are not
9 considered as part of the safety review. However, safety issues that are raised during the
10 environmental review are forwarded to the appropriate NRC organization for consideration and
11 appropriate action (NRC 2006).

12
13 Actions subject to NRC approval for license renewal are limited to continued nuclear power
14 plant operation consistent with the plant design and operating conditions for the current
15 operating license and to the performance of specific activities and programs necessary to
16 manage the effects of aging on the passive, long-lived structures and components identified in
17 accordance with 10 CFR Part 54. Accordingly, the GEIS does not serve as the NEPA review for
18 other activities or programs outside the scope of NRC's Part 54 license renewal review.

19
20 Separate NEPA reviews must be prepared regardless of whether the action is necessary as a
21 consequence of receiving a renewed license, even if the activity were specifically addressed in
22 the GEIS. For example, the environmental impacts of spent fuel pool expansion are addressed
23 in the GEIS in the context of the environmental consequences of approving a renewed
24 operating license, rather than in the context of a specific application to expand spent fuel pool
25 capacity, which would require a separate NEPA review. These separate NEPA reviews may
26 reference and otherwise use applicable environmental information contained in the GEIS. For
27 example, an environmental assessment prepared for a separate spent fuel pool expansion
28 request may use the information in the GEIS to support a finding of no significant impact (see
29 June 5, 1996 Final Rule [61 FR 28467]).

30
31 There are many factors that NRC takes into consideration when deciding whether to renew the
32 operating license of a nuclear power plant. The analyses of environmental impacts evaluated in
33 this GEIS will provide NRC's decision maker (in this case, the Commission) with important
34 environmental information for use in the overall decision-making process.

35
36 There are also decisions outside the regulatory scope of license renewal that cannot be made
37 on the basis of the final GEIS analysis. These decisions include the following five issues.
38

1 **1.7.1 Changes to Plant Cooling Systems**

2
3 The NRC will not make a decision or any recommendations on the basis of information
4 presented in this GEIS regarding changes to nuclear power plant cooling systems, other than
5 those involving safety-related issues, to mitigate adverse impacts under the jurisdiction of State
6 or other Federal agencies. Implementation of the provisions of the Clean Water Act, including
7 those regarding cooling system operations and design specifications, is the responsibility of the
8 U.S. Environmental Protection Agency (EPA). In many cases, the EPA delegates such
9 authority to the individual States. To operate a nuclear power plant, licensees must comply with
10 the Clean Water Act and associated requirements imposed by the EPA or the State as part of
11 the National Pollutant Discharge Elimination System (NPDES) permitting system. The EPA or
12 the State, not the NRC, sets the limits of effluents and operational parameters in plant-specific
13 NPDES permits. Nuclear power plants cannot operate without a valid NPDES permit.

14
15 **1.7.2 Disposition of Spent Nuclear Fuel**

16
17 The NRC will not make a decision or any recommendations on the basis of the information
18 presented in this GEIS regarding the disposition of spent nuclear fuel at nuclear power plants.
19 The NRC's Waste Confidence Rule (10 CFR 51.23) leaves the onsite storage of spent nuclear
20 fuel during the term of plant operation as the only option at the time of license renewal. Within
21 the context of a license renewal environmental review, the NRC concluded that the storage of
22 spent nuclear fuel can be accomplished safely and without significant environmental impacts.
23 Human health impacts continue to be well within regulatory limits, and the radiological impacts
24 of onsite storage continue to meet the standard for a conclusion of small impact.
25 Nonradiological environmental impacts continue to be small. The overall conclusion for onsite
26 storage of spent nuclear fuel during the license renewal term is that the environmental impacts
27 will be small for each plant. Within the context of renewal, the NRC concludes that its regulatory
28 requirements already in place provide adequate mitigation incentives for the onsite storage of
29 spent nuclear fuel.

30
31 The NRC is confident that there will eventually be a licensed high-level waste repository. If the
32 site near Yucca Mountain is eventually found to be unsuitable, alternative sites will be
33 considered. Until a permanent high-level waste repository is operational, the spent nuclear fuel
34 will be safely stored either onsite or at offsite interim storage facilities (NRC 2006).

35
36 In 1982, the Congress enacted the Nuclear Waste Policy Act (NWPA), and on January 7, 1983,
37 the President signed it into law. This legislation defined the Federal Government's responsibility
38 to provide permanent disposal in a deep geologic repository for spent fuel and high-level
39 radioactive waste from commercial and defense activities. Under amended provisions (1987) of
40 this Act, the Department of Energy (DOE) has the responsibility to locate, build, and operate a
41 repository for such wastes. The NRC has the responsibility to establish regulations governing

1 the construction, operation, and closure of the repository, consistent with environmental
2 standards established by the EPA.

3
4 The 1987 amendments required DOE to evaluate only the suitability of the site at Yucca
5 Mountain, Nevada, for a geologic disposal facility. In addition, the amendments outlined a
6 detailed approach for the disposal of high-level radioactive waste involving review by the
7 President, Congress, State and Tribal governments, NRC, and other Federal agencies. In
8 February 2002, after many years of studying the suitability of the site, DOE recommended to the
9 President that the Yucca Mountain site be developed as a long-term geologic repository for
10 high-level waste. In April 2002, the Governor of Nevada notified Congress of his State's
11 objection to the proposed repository. Subsequently, Congress voted to override the objection of
12 the State.

13
14 DOE submitted a license application to the NRC for construction authorization for a repository at
15 Yucca Mountain in June 2008. The Act specifies that the NRC will issue a decision on the
16 license application within three years after receiving the DOE application. The NRC will issue a
17 license only if DOE can demonstrate that it can construct and operate the repository safely and
18 comply with NRC regulations. NRC decisions and recommendations concerning the ultimate
19 disposition of spent nuclear fuel are ongoing and outside the regulatory scope of this GEIS.

20 21 **1.7.3 Emergency Preparedness**

22
23 The NRC will not make a decision or any recommendations on the basis of information
24 presented in this GEIS regarding emergency preparedness at nuclear power plants. Nuclear
25 power plant owners, government agencies, and State and local officials work together to create
26 a system for emergency preparedness and response that will serve the public in the unlikely
27 event of an emergency. The emergency plans for nuclear power plants cover preparations for
28 evacuation, sheltering, and other actions to protect residents near plants in the event of a
29 serious incident.

30
31 In the United States, 104 commercial nuclear power reactors are licensed to operate at 65 sites
32 in 31 States. For each site, there are onsite and offsite emergency plans to assure that
33 adequate protective measures can be taken to protect the public in the event of a radiological
34 emergency. Federal oversight of emergency preparedness for licensed nuclear power plants is
35 shared by the NRC and Federal Emergency Management Agency (FEMA). The NRC and
36 FEMA have a Memorandum of Understanding (44 CFR Appendix A to Part 353), under which
37 FEMA has the lead in overseeing offsite planning and response and the NRC assists FEMA in
38 carrying out this role. The NRC has statutory responsibility for the radiological health and safety
39 of the public and retains the lead for oversight of onsite preparedness.

40

Introduction

1 Before a plant is licensed to operate, the NRC must have “reasonable assurance that adequate
2 protective measures can and will be taken in the event of a radiological emergency.” The
3 NRC’s decision of reasonable assurance is based on licensees complying with NRC regulations
4 and guidance. In addition, licensees and area response organizations must demonstrate they
5 can effectively implement emergency plans and procedures during periodic evaluated
6 exercises. As part of the reactor oversight process, the NRC reviews licensees’ emergency
7 planning procedures and training. These reviews include regular drills and exercises that assist
8 licensees in identifying areas for improvement, such as in the interface of security operations
9 and emergency preparedness. Each plant owner is required to exercise its emergency plan
10 with the NRC, FEMA, and offsite authorities at least once every two years to ensure that State
11 and local officials remain proficient in implementing their emergency plans. Licensees also self-
12 test their emergency plans regularly by conducting drills.

13
14 FEMA findings and determinations as to the adequacy and capability of implementing offsite
15 plans are communicated to the NRC. The NRC reviews the FEMA findings and determinations
16 as well as the onsite findings. The NRC then makes a determination on the overall state of
17 emergency preparedness. These overall findings and determinations are used by the NRC to
18 make radiological health and safety decisions before issuing licenses and in the continuing
19 oversight of operating reactors. The NRC has the authority to take action, including shutting
20 down any reactor deemed not to provide reasonable assurance of the protection of public health
21 and safety.

22
23 The Commission considered the need for a review of emergency planning issues in the context
24 of license renewal during its rulemaking proceedings on 10 CFR Part 54, which included public
25 notice and comment. As discussed in the statement of consideration for rulemaking
26 (56 FR 64966), the programs for emergency preparedness at nuclear power facilities apply to all
27 nuclear power facility licensees and require the specified levels of protection from each licensee
28 regardless of plant design, construction, or license date. Requirements related to emergency
29 planning are in the regulations at 10 CFR 50.47 and Appendix E to 10 CFR Part 50. These
30 requirements apply to all operating licenses and will continue to apply to facilities with renewed
31 licenses. Through its standards and required exercises, the Commission reviews existing
32 emergency preparedness plans throughout the life of any facility, keeping up with changing
33 demographics and other site-related factors.

34
35 After the terrorist attacks of September 2001, the NRC issued security related orders and
36 guidance to nuclear power plants. These orders and guidance include interim measures for
37 emergency planning. Nuclear industry groups and Federal, State, and local government
38 agencies assisted in the prompt implementation of these measures and participated in drills and
39 exercises to test these new planning elements. The NRC has reviewed licensees’ commitments
40 to address these requirements and verified the implementation through inspections to ensure
41 public health and safety.

1
2 The NRC and other Federal agencies have heightened vigilance and implemented initiatives to
3 evaluate and respond to possible threats posed by terrorists, including the use of aircraft against
4 commercial nuclear power facilities and independent spent fuel storage installations. These
5 acts remain speculative and beyond the regulatory scope of a license renewal review. The
6 NRC routinely assesses threats and other information provided by other Federal agencies and
7 sources. The NRC also ensures that licensees meet appropriate security-level requirements
8 through the ongoing regulatory process (routine inspections) as a current and generic regulatory
9 issue that affects all nuclear power plants. The issue of security and risk from terrorist acts
10 against nuclear power plants is not unique to facilities that have requested a renewal to their
11 licenses (NRC 2006).

12
13 The Commission has determined that there is no need for a special review of emergency
14 planning issues in the context of an environmental review for license renewal (NUREG-1850).
15 Therefore, decisions and recommendations concerning emergency preparedness at nuclear
16 plants are ongoing and outside the regulatory scope of license renewal.

17 18 **1.7.4 Safeguards and Security**

19
20 The NRC requires that nuclear power plants be both safe and secure. Safety refers to
21 operating the plant in a manner that protects the public and the environment. Security refers to
22 protecting the plant (i.e., using people, equipment, and fortifications) from intruders who wish to
23 damage or destroy it in order to harm people and the environment.

24
25 Security issues such as safeguards planning are not tied to a license renewal action but are
26 considered to be issues that need to be dealt with constantly as a part of the current (and
27 renewed) operating license. Security issues are periodically reviewed and updated at every
28 operating plant. These reviews continue throughout the period of an operating license, whether
29 the original or renewed license. If issues related to security are discovered at a nuclear plant,
30 they are addressed immediately, and any necessary changes are reviewed and incorporated
31 under the operating license (NRC 2006). As such, decisions and recommendations concerning
32 safeguards and security at nuclear power plants are ongoing and outside the regulatory scope
33 of this GEIS.

34 35 **1.7.5 Need for Power**

36
37 The NRC will not make a decision or any recommendations on the basis of information
38 presented in this GEIS regarding the need for power at nuclear power plants. The regulatory
39 authority over licensee economics (including the need for power) falls within the jurisdiction of
40 the states and to some extent within the jurisdiction of FERC. The proposed rule for license
41 renewal had originally included a cost-benefit analysis and consideration of licensee economics

1 as part of the NEPA review. However, during the comment period, State, Federal, and licensee
2 representatives expressed concern about the use of economic costs and cost-benefit balancing
3 in the proposed rule and the 1996 GEIS. They noted that CEQ regulations interpret NEPA to
4 require only an assessment of the cumulative effects of a proposed Federal action on the
5 natural and man-made environment and that the determination of the need for generating
6 capacity has always been a State responsibility. For this reason, the purpose and need for the
7 proposed action (i.e., license renewal) was defined in the GEIS as follows (NRC 2006):
8

9 The purpose and need for the proposed action (renewal of an operating license) is to
10 provide an option that allows for power generation capability beyond the term of a current
11 nuclear power plant operating license to meet future system generating needs, as such
12 needs may be determined by State, licensee, and, where authorized, Federal (other than
13 NRC) decision-makers.
14

15 10 CFR 51.95(c)(2) states that:
16

17 The supplemental environmental impact statement (SEIS) for license renewal is not required
18 to include discussion of need for power or the economic costs and economic benefits of the
19 proposed action or of alternatives to the proposed action except insofar as such benefits and
20 costs are either essential for a determination regarding the inclusion of an alternative in the
21 range of alternatives considered or relevant to mitigation.
22

23 **1.8 Implementation of the Rule (10 CFR Part 51)**

24 **1.8.1 General Requirements**

25 The regulatory requirements for performing a NEPA review for a license renewal application are
26 similar to the NEPA review requirements for other major plant licensing actions. Consistent with
27 the current NEPA practice for major plant licensing actions, an applicant is required to submit an
28 environmental report that analyzes the environmental impacts associated with the proposed
29 action, considers alternatives to the proposed action, and evaluates any alternatives for
30 reducing adverse environmental effects. For license renewal, the NRC prepares a SEIS for
31 public comment, and issues a final SEIS after considering public comments on the draft.
32
33
34

35 **1.8.2 Applicant's Environmental Report**

36 The applicant's environmental report must contain an analysis of the environmental impacts of
37 renewing a license, the environmental impacts of alternatives, and mitigation alternatives. In
38 preparing the analysis of environmental impacts contained in the environmental report, the
39 applicant should refer to the data provided in 10 CFR Part 51, Appendix B. The applicant is not
40

1 required to provide an analysis in the environmental report of those issues identified as
2 Category 1 issues in Table B-1 in Appendix B unless the applicant is aware of new and
3 significant information. For those issues identified as Category 2 in Table B-1, the applicant
4 must provide a plant-specific analysis. Section 10 CFR 51.53(c)(3)(ii) specifies the subject
5 areas of the analysis that must be addressed for the Category 2 issues.
6

7 10 CFR 51.45(c) and 10 CFR 51.53(c)(2) require the applicant to consider alternatives available
8 for reducing or avoiding adverse environmental effects associated with the proposed action.
9 This consideration is limited to designated Category 2 issues. Pursuant to 10 CFR 51.45(d), the
10 environmental report must include a discussion of the status of compliance with applicable
11 Federal, State, and local environmental standards. Also, 10 CFR 51.53(c)(2) specifically
12 excludes from consideration in the environmental report the issues of need for power, the
13 economic costs and benefits of the proposed action, economic costs and benefits of alternatives
14 to the proposed action, or other issues not related to environmental effects of the proposed
15 action and associated alternatives. NRC regulations do not require a discussion of the
16 economic costs and benefits of these alternatives in the environmental report for the operating
17 license renewal stage, except as necessary to determine whether an alternative should be
18 included in the range of alternatives considered or whether certain mitigative actions are
19 appropriate. The analysis should also demonstrate consideration of a reasonable set of
20 alternatives to license renewal. In preparing the alternatives analysis, the applicant is not
21 limited to the technologies presented in this GEIS. Information provided in the applicant's
22 environmental report will be used in preparing the SEIS.
23

24 **1.8.3 NRC's SEIS**

25

26 As required by 10 CFR 51.20(b)(2), the NRC is required to prepare an SEIS. The SEIS will
27 serve as the NRC's analysis of the environmental impacts of license renewal as well as a
28 comparison of these impacts to the environmental impacts of alternatives. This document will
29 also present the NRC's preliminary recommendation. SEISs for license renewal do not need to
30 include a discussion of the need for power or the economic costs and economic benefits of the
31 proposed action or of alternatives to the proposed action (10 CFR 51.95(c)(2)).
32

33 **1.8.4 Public Scoping and Public Comments on NRC's Draft SEIS**

34

35 NRC conducts public scoping meetings in order to inform the public about the license renewal
36 process and receive comments. At the conclusion of the scoping period, NRC reviews and
37 addresses public comments in a scoping summary report. In addition, the draft SEIS is issued
38 for public comment (see 10 CFR 51.73). In both the scoping and the public comment process,
39 the NRC will consider comments and will determine whether these comments provide any
40 information that is new and significant compared with that previously considered in the GEIS. If

1 the comments are determined to provide new and significant information that could change the
2 conclusions in the GEIS, these comments will be considered and addressed in the SEIS.

3 4 **1.8.5 NRC's Analysis and Preliminary Recommendation**

5
6 The NRC's draft SEIS will include its analysis of the environmental impacts of the proposed
7 license renewal action and the environmental impacts of the alternatives to the proposed action.
8 The NRC will utilize and integrate (1) the environmental impacts of license renewal as provided
9 in Table B-1 of 10 CFR Part 51, Appendix B, (2) the appropriate plant-specific analyses of
10 Category 2 issues, and (3) any new and significant information identified in the applicant's
11 environmental report during the scoping and public comment process to arrive at a conclusion
12 regarding the environmental impacts of license renewal. These impacts will then be compared
13 with the environmental impacts of the alternatives presented in the SEIS.

14 15 **1.8.6 NRC's Final SEIS**

16
17 The NRC will issue a final SEIS in accordance with 10 CFR 51.91 and 51.93 after considering
18 (1) the public comments, (2) the analysis of Category 2 issues, and (3) any new and significant
19 information involving Category 1 issues. The NRC will provide a record of its decision regarding
20 the environmental impacts of the proposed action (see 10 CFR 51.102 and 51.103). All
21 comments on the draft SEIS will be addressed by the NRC in the final SEIS in accordance with
22 40 CFR 1503.2. Comments will be addressed in following manner:

- 23
- 24 (a) NRC's response to a comment regarding the applicability of the analysis of an impact
25 codified in the rule to the plant in question may be a statement and explanation of its
26 view that the analysis is adequate including, if applicable, consideration of the
27 significance of new information. A commenter dissatisfied with such a response may
28 file a petition for rulemaking under 10 CFR 2.802. Procedures for the submission of
29 petitions for rulemaking are explained in 10 CFR Part 2. If the commenter is successful
30 in persuading the Commission that the new information does indicate that the analysis
31 of an impact codified in the rule is incorrect in significant respects (either in general or
32 with respect to the particular plant), then a rulemaking proceeding will be initiated.
 - 33
34 (b) If the commenter provides new information that is relevant to the plant and is also
35 relevant to other plants (i.e., generic information) and that information demonstrates that
36 the analysis of an impact codified in the final rule is incorrect, the NRC staff will seek
37 Commission approval either to suspend the application of the rule on a generic basis
38 with respect to the analysis or to delay granting the renewal application (and possibly
39 other renewal applications) until the rule can be amended. The revised GEIS would
40 reflect the corrected analysis and any additional consideration of alternatives as
41 appropriate.

- 1
2 (c) If a commenter provides new, site-specific information that demonstrates that the
3 analysis of an impact codified in the rule is incorrect with respect to the particular plant,
4 then the NRC staff will seek Commission approval to waive the application of the rule
5 with respect that analysis in that specific renewal proceeding. The SEIS would reflect
6 the corrected analysis as appropriate.
7

8 **1.9 Public Comment Process for the GEIS**

9

10 The public comment process for the GEIS is similar to that used for SEISs and other NRC
11 NEPA documents. Public review and comments on the draft GEIS revision will begin with
12 publication of the EPA's Notice of Filing of the draft GEIS. During the ensuing 75-day public
13 comment period, public meetings will be held in each of the four NRC regions. At these
14 meetings, the NRC staff will describe the preliminary results of the GEIS environmental review
15 and answer questions related to the review and provide members of the public with information
16 to help them formulate their comments. The NRC will use public comments gathered during the
17 meetings and comment period when developing the final GEIS. NRC responses to comments
18 will be included in the final GEIS.
19

20 **1.10 Lessons Learned**

21

22 The NRC staff assessed 92 environmental issues in the original GEIS. Lessons learned and
23 knowledge gained during previous license renewal reviews provides a significant source of new
24 information for this assessment. Over 30 nuclear plants have undergone license renewal and
25 environmental review. The purpose of the evaluation was to determine if the findings presented
26 in the 1996 GEIS remain valid. In doing so, the NRC staff considered the need to modify, add
27 to, or delete any of the 92 issues in the 1996 GEIS. After this evaluation, the staff carried
28 forward 78 impact issues for detailed consideration in this GEIS revision. The issues identified
29 in the 1996 GEIS have served to accurately categorize most environmental impacts associated
30 with license renewal, and there have been no cases where new and significant information
31 called into question the original findings of the GEIS. There have been a number of instances
32 where new (but not significant) information was uncovered during a license renewal review. In
33 most cases, the new information identified was information that did not fit into one of the
34 environmental issues covered in the 1996 GEIS but still warranted review in the plant-specific
35 SEIS. For example, the environmental review for license renewal at the D.C. Cook plant in
36 Michigan considered the effects of sanitary sewage lagoons on groundwater quality as a new
37 issue. The review for the Oyster Creek plant considered the effects of a small dam built to
38 impound water for fire-fighting purposes. Neither of these topics fit into the 1996 GEIS issues.
39 The license renewal evaluation process established in 10 CFR Part 51 has proven to be robust

1 because it allows new information and lessons learned to be addressed in subsequent license
2 renewal environmental reviews.
3

4 **1.11 New Organization of the GEIS**

5

6 This GEIS revision adopts the NRC's standard format for EISs as established in 10 CFR 51,
7 Subpart A, Appendix A. Consequently, the organizational structure of this GEIS revision is quite
8 different from that of the 1996 GEIS. The 1996 GEIS presented impacts organized around plant
9 systems (e.g., cooling systems, transmission lines) and activities (e.g., refurbishment). This
10 GEIS revision takes a more typical NEPA resource-based approach to presenting impacts
11 where all components of the proposed action and alternatives are presented for each resource
12 area. The following list describes the contents of each chapter of the GEIS revision:
13

- 14 • **Chapter 2** presents brief descriptions of the activities (including operations,
15 refurbishment, accidents, and decommissioning) and impacts associated with the
16 proposed action and alternatives.
17
- 18 • **Chapter 3** presents descriptions of the affected environment in the vicinity of operating
19 commercial nuclear plants in the United States. Included are descriptions of nuclear
20 power plant operations and facilities and descriptions of existing conditions in the
21 following topical areas: (1) land use and visual resources; (2) meteorology, air quality,
22 and noise; (3) geology, seismology, and soils; (4) hydrology (surface water and
23 groundwater); (5) ecology (terrestrial ecology, aquatic ecology, threatened, endangered,
24 and protected species and essential fish habitat); (6) historic and cultural resources;
25 (7) socioeconomics; (8) human health (radiological and nonradiological hazards);
26 (9) environmental justice; and (10) waste management and pollution prevention.
27
- 28 • **Chapter 4** presents the environmental consequences and mitigating actions associated
29 with the proposed action and alternatives (including operations, construction and
30 refurbishment, accidents, fuel cycles, and decommissioning) in each of the topical areas
31 presented in Chapter 3. Cumulative impacts and resource commitments associated with
32 the proposed action are also discussed.
33
- 34 • **Chapter 5** presents a list of the preparers of the GEIS revision, their affiliations,
35 authorship responsibilities, and qualifications.
36
- 37 • **Chapter 6** provides a list of the agencies, organizations, and persons receiving copies of
38 the GEIS.
39
- 40 • **Chapter 7** provides for a glossary of terms used in the GEIS.

1.12 References

10 CFR Part 2. *Code of Federal Regulations*, Title 10, *Energy*, Part 2, “Rules of Practice for Domestic Licensing Proceedings and Issuance of Orders.”

10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, “Domestic Licensing of Production and Utilization Facilities.”

10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions.”

10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, “Requirements for Renewal of Operating Licenses for Nuclear Power Plants.”

40 CFR Part 1502. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 1502, “Environmental Impact Statement.”

40 CFR Part 1503. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 1503, “Commenting.”

40 CFR Part 1508. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 1508, “Terminology and Index.”

44 CFR Appendix A to Part 353. *Code of Federal Regulations*, Title 44, Appendix A to Part 353, “Memorandum of Understanding Between Federal Emergency Management Agency and Nuclear Regulatory Commission.”

National Environmental Policy Act of 1969 (NEPA). 42 USC 4321 et seq.

U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement for License Renewal of Nuclear Plants*. NUREG-1437, Vols. 1 and 2, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 1999. “Section 6.3 – Transportation, Table 9.1, Summary of Findings on NEPA Issues for License Renewal of Nuclear Power Plants, Final Report.” *Generic Environmental Impact Statement for License Renewal of Nuclear Plants Main Report*. NUREG-1437, Vol. 1, Addendum 1, Washington, D.C.

U.S. Nuclear Regulatory Commission (NRC). 2006. *Frequently Asked Questions on License Renewal of Nuclear Power Reactors*. NUREG-1850. Washington, D.C. (March 2006).

2 Alternatives Including the Proposed Action

The proposed action considered in this generic environmental impact statement (GEIS) is the renewal of commercial nuclear power plant operating licenses. Although the U.S. Nuclear Regulatory Commission's (NRC's) decision-making authority is limited to deciding whether to renew a nuclear power plant's operating license, the NRC's implementation of the National

Environmental Policy Act (NEPA) requires the NRC to consider the environmental impacts of potential alternatives to renewing a plant's operating license. In plant-specific environmental reviews, the NRC compares the impacts of renewing the operating license and the impacts from continued plant operations to the environmental impacts of alternatives. This process allows the NRC to determine whether

the environmental impacts of license renewal are so great that preserving the option of license renewal for energy-planning decision makers would be unreasonable. If the NRC decides not to renew the operating license of a nuclear plant, then energy decision makers will have to find alternative means to address their energy needs. Alternatives to license renewal include other means of generating electricity, as well as offsetting demand using conservation and energy efficiency measures (demand-side management) or purchasing sufficient power to replace the capacity supplied by the existing nuclear power plant.

If the NRC renews the operating license, the decision on whether or not to continue nuclear plant operations will be made by the licensee and State or other Federal (non-NRC) decision makers. This decision would be based on economics, increased energy efficiency production and use, conservation, reliable generation and distribution of electric power, improved fuel diversity, and environmental objectives.

A full range of power generation alternatives are evaluated in the GEIS, including fossil fuel, new nuclear, and renewable energy sources.

Conservation and energy efficiency, as well as power purchasing, are also considered as alternatives to license renewal. Section 2.1 describes the proposed action, including continued

Contents of Chapter 2

- Proposed Action (Section 2.1)
- No-Action Alternative (Section 2.2)
- Alternative Energy Sources (Section 2.3)
- Comparison of Alternatives (Section 2.4)

Alternatives to the Proposed Action Considered in the GEIS

- Not renewing the operating licenses of commercial nuclear power plants (no-action alternative).
- Replacing existing nuclear generating capacity using other energy sources (including fossil fuel, new nuclear, and renewable energy).
- Offsetting generation capacity using conservation and energy efficiency (demand-side management) or purchased power.

Alternatives Including the Proposed Action

1 operations that would occur during the license renewal term, refurbishment, and activities that
2 are similar to those that occurred during the current license term. Termination of nuclear power
3 plant operations would occur at or before the end of the license renewal term.
4 Decommissioning activities would commence after operations have ceased. This impact
5 summary identifies each of the 78 impact issues, their significance (small, moderate, or large,
6 as defined in Section 1.5), and whether the impact designation would apply to all plants.
7 Section 2.2 describes the no-action alternative (not renewing the operating license), and
8 Section 2.3 presents alternatives to replace existing nuclear power capacity, including fossil
9 fuel, new nuclear, renewable energy, conservation and energy efficiency, and purchased power.
10 Section 2.4 presents a summary comparison of the impacts of the proposed action and the
11 alternatives.
12

13 **2.1 Proposed Action**

14
15 As stated in Section 1.2, the proposed action is the renewal of commercial nuclear power plant
16 operating licenses. For NRC to determine whether the license should be renewed, an applicant
17 is required to perform certain analyses to demonstrate that the plant could continue safe
18 operations beyond its current licensing period. These analyses include an assessment of the
19 effects of potential age-related degradation on certain long-lived, passive systems, structures,
20 and components. This requires applicants to describe the conditions under which the plant
21 would operate during the license renewal term. A summary of these conditions under normal
22 operations is provided in Section 2.1.1.
23

24 Applicants for license renewal may perform certain refurbishment activities (replacement of
25 major components and systems) to continue operating beyond the current license term. These
26 activities are discussed in Section 2.1.2, and impacts are described in Chapter 4. Section 2.1.3
27 provides an overview of the termination of nuclear power plant operations and decommissioning
28 process and site use options after decommissioning. The impacts associated with termination
29 of operations and decommissioning of nuclear and energy alternative power plants are
30 presented in Section 4.11.2.
31

32 **2.1.1 Plant Operations During the License Renewal Term**

33
34 This section describes plant operations, routine maintenance, and refueling operations during
35 the license renewal term. It also provides an overview of the aging management reviews
36 required for license renewal applications. During the license renewal term, commercial nuclear
37 power plants would continue to operate in the same manner as they had during the original
38 license term. All nuclear reactors currently operating in the United States are light water
39 reactors, of which there are two basic types – pressurized water reactors and boiling water

1 reactors. A brief description of these reactors and the baseline conditions during their operation
2 are presented in Chapter 3.

3
4 The types of activities that are conducted at nuclear power plants can be classified as:

- 5
- 6 • Reactor operations (includes all work related to running the reactor, usually conducted
7 from the control room);
- 8
- 9 • Waste management (processing, storage, packaging, and offsite shipment of wastes);
- 10
- 11 • Security (includes site security personnel);
- 12
- 13 • Office and clerical work (management, public relations, and support staff);
- 14
- 15 • Laboratory analysis;
- 16
- 17 • Surveillance, monitoring, and maintenance (personnel involved in equipment testing,
18 inspections, and monitoring activities); and
- 19
- 20 • Refueling and other outages (usually involves additional workers brought on site during
21 the outage)
- 22

23 These activities are expected to continue during the license renewal term. Certain systems,
24 structures, and components such as the reactor pressure vessel, reactor containment building,
25 and piping are expected to operate into the license renewal term. Title 10, Part 54, of the *Code*
26 *of Federal Regulations* (10 CFR Part 54) places certain requirements on the licensees to make
27 sure that such systems, structures, and components continue to operate safely. In the 1996
28 GEIS, the incremental aging management activities implemented to allow operation of a nuclear
29 power plant beyond the original 40-year license term were assumed to fall under one of two
30 broad categories: (1) surveillance, monitoring, inspection, testing, trending, and recordkeeping
31 actions, most of which are repeated at regular intervals, and (2) major refurbishment actions,
32 which usually occur infrequently and possibly only once in the life of the plant for any given item.
33 Refurbishment activities are discussed in the following section.

34
35 The NRC finds that the approaches to environmental impacts from refurbishment activities
36 contained in the 1996 GEIS are valid and conservative. The approaches yield environmental
37 impacts that are likely greater than – or at least equal to – the actual impacts during the license
38 renewal term.

39

1 **2.1.2 Refurbishment and Other Activities Associated with License Renewal**

2
3 In the 1996 GEIS, the NRC assumed that licensees would need to conduct major refurbishment
4 activities to ensure the safe and economic operation of nuclear plants beyond the current
5 license term. Activities included replacement and repair of major components and systems,
6 upgrades, and equipment. Replacement of many systems, structures, and components
7 included steam generators and pressurizers for PWRs and recirculation piping systems for
8 BWRs. It was assumed that many plants would also undertake construction projects to replace
9 or improve infrastructure. Such projects could include construction of new parking lots, roads,
10 storage buildings, structures, and other facilities.

11
12 The number of systems, structures, and components involved in refurbishment and the
13 frequency and duration of each activity could vary. Many refurbishment activities have already
14 taken place (e.g., steam generator and vessel head replacement). These activities were
15 conducted during refueling or maintenance outages. Most nuclear plants have not identified
16 any refurbishment activities associated with license renewal. Impacts from refurbishment
17 activities outside of license renewal are assumed to have been accounted for in annual site
18 evaluation reports, environmental operating reports, and radiological environmental monitoring
19 program reports. Detailed analyses have not been performed for refurbishment actions in this
20 GEIS revision. Instead, the impacts of typical activities during the license renewal term,
21 including any refurbishment activities, are addressed for each resource area in Chapter 4.

22
23 **2.1.3 Termination of Nuclear Power Plant Operations and Decommissioning**
24 **After the License Renewal Term**

25
26 The impacts of decommissioning are described in the *Generic Environmental Impact Statement*
27 *on Decommissioning of Nuclear Facilities: Regarding the Decommissioning of Nuclear Power*
28 *Reactors*, NUREG-0586 (NRC 2002a). The majority of the activities associated with plant
29 operations would cease with reactor shutdown, although some activities would remain
30 unchanged, while others would continue at reduced or altered levels. Systems dedicated to
31 reactor operations would cease; however, impacts from their physical presence may continue if
32 not removed after reactor shutdown. For sites with more than one unit, systems that continue to
33 operate could be reduced in proportion to the decreased demand on those systems. Impacts
34 associated with dedicated systems that remain in place or shared systems that continue to
35 operate would remain unchanged.

36
37 Termination of nuclear power plant operations would result in the cessation of activities
38 necessary to maintain the reactor, as well as a significant reduction in plant workforce. It is
39 assumed that the termination of operations would not immediately lead to the dismantlement of
40 the reactor or other infrastructure. For sites with just one unit, some facilities could remain in
41 operation to ensure the site is maintained in safe shutdown condition.

1 The NRC has developed regulations and guidance for the decommissioning of nuclear facilities,
2 including nuclear power plants. These regulations are found in Subpart E to 10 CFR Part 20
3 and the guidance document *Consolidated NMSS Decommissioning Guidance*, NUREG-1757
4 (NRC 2002b).

5
6 The decommissioning process for a nuclear power plant begins with the licensee informing the
7 NRC that it intends to decommission the plant. The licensee then prepares a decommissioning
8 plan and submits it to the NRC. If the plan is acceptable, the NRC then conducts a detailed
9 technical review and evaluates the plan from safety and environmental perspectives. As part of
10 the safety evaluation, the NRC prepares a safety evaluation report (SER) to document the
11 methods used in the evaluation and the conclusions reached. For environmental evaluation,
12 the NRC prepares an environment impact statement or an environmental assessment,
13 depending on the scope of the proposed work. At the end of the detailed technical review, the
14 NRC determines whether to approve the decommissioning plan. Upon approval, the NRC
15 amends the existing license of the plant to allow decommissioning to proceed. Once the
16 decommissioning plan is approved and the license amendment is issued, the licensee
17 implements the plan. The NRC conducts inspections to verify compliance with the plan.

18
19 At the completion of decommissioning, the licensee conducts a final status survey to
20 demonstrate compliance with criteria established in the decommissioning plan. The NRC
21 verifies the survey by one or more of the following: a quality assurance/quality control review,
22 side-by-side or split sampling, and independent confirmatory surveys. When the NRC confirms
23 that the criteria in the decommissioning plan for releasing the site have been met, the NRC
24 either terminates or amends the license, depending on the intended use of the site.

25
26 At the end of the decommissioning process, the site of a nuclear power plant and any remaining
27 structures on the site can be released for unrestricted or restricted use. The radiological criteria
28 for releasing sites for unrestricted use are given in 10 CFR 20.1402. The criteria for restricted
29 conditions and alternate criteria that the NRC may approve under certain conditions are listed in
30 10 CFR 20.1403 and 10 CFR 20.1404, respectively.

31 32 **2.1.4 Impacts of the Proposed Action**

33
34 In evaluating the impacts of the proposed action, 78 impact issues were identified: 70 impact
35 issues were associated with continued operations and refurbishment; 2 with postulated
36 accidents; 1 with the termination of nuclear power plant operations and decommissioning; 4 with
37 the uranium fuel cycle; and 1 with cumulative impacts. For all of these issues, the incremental
38 effect of license renewal relative to the no-action alternative was the focus of the evaluation.
39 Significance levels and impact categories are defined in Section 1.5.

40
41 A summary of the environmental impacts of the proposed action are presented in Table 2.1–1.

Alternatives Including the Proposed Action

Table 2.1–1. Summary of Impacts Associated with License Renewal Under the Proposed Action

Issue	Impact
Land Use	
Onsite land use	Small impact (Category 1). Changes in onsite land use from continued operations and refurbishment associated with the license renewal term would be a small fraction of any nuclear power plant site and would involve only land that is controlled by the licensee.
Offsite land use	Small impact (Category 1). Offsite land use would not be affected from continued operations and refurbishment associated with the license renewal term.
Offsite land use in transmission line rights-of-way (ROWs)	Small impact (Category 1). Use of transmission line ROWs from continued operations and refurbishment associated with the license renewal term would continue with no change in land use restrictions.
Visual Resources	
Aesthetic impacts	Small impact (Category 1). No important changes to the visual appearance of plant structures or transmission lines are expected from continued operations and refurbishment associated with the license renewal term.
Air Quality	
Air Quality (non-attainment and maintenance areas)	Small, moderate, or large impact (Category 2). Air quality impacts of continued operations and refurbishment activities associated with the license renewal term are expected to be small. However, emissions during these activities could be a cause for concern at locations in or near air quality nonattainment or maintenance areas. The significance of the impact cannot be determined without considering the compliance status of each site and the activities that could occur. These impacts would be short-lived and cease after projects were completed. Emissions from testing emergency diesel generators and fire pumps and from routine operations of boilers used for space heating would not be a concern, even for those plants located in or adjacent to nonattainment areas. Although particulate emissions from cooling towers may be a concern for a very limited number of plants located in States that regulate such emissions, the impacts in even these worst-case situations have been small.
Air quality effects of transmission lines	Small impact (Category 1). Production of ozone and oxides of nitrogen is insignificant and does not contribute measurably to ambient levels of these gases.

1
2

Table 2.1–1. (cont.)

Issue	Impact
Noise	
Noise impacts	Small impact (Category 1). Noise levels would remain below regulatory guidelines for offsite receptors during continued operations and refurbishment associated with the license renewal term.
Geology and Soils	
Impacts of nuclear plants on geology and soils	Small impact (Category 1). Impacts on geology and soils would be small at all nuclear plants if best management practices were employed to reduce erosion associated with continued operations and refurbishment.
Surface Water	
Surface-water use and quality	Small impact (Category 1). Impacts are expected to be negligible if best management practices are employed to control soil erosion and spills. Water use associated with continued operation and refurbishment projects for license renewal would not increase significantly or would be reduced if a plant outage is necessary to accomplish the action.
Altered current patterns at intake and discharge structures	Small impact (Category 1). Altered current patterns would be limited to the area in the vicinity of the intake and discharge structures. These impacts have been small at operating nuclear power plants.
Altered salinity gradients	Small impact (Category 1). Effects on salinity gradients would be limited to the area in the vicinity of the intake and discharge structures. These impacts have been small at operating nuclear power plants.
Altered thermal stratification of lakes	Small impact (Category 1). Effects on thermal stratification would be limited to the area in the vicinity of the intake and discharge structures. These impacts have been small at operating nuclear power plants.
Scouring caused by discharged cooling water	Small impact (Category 1). Scouring effects would be limited to the area in the vicinity of the intake and discharge structures. These impacts have been small at operating nuclear power plants.
Discharge of metals in cooling system effluent	Small impact (Category 1). Discharges of metals have not been found to be a problem at operating nuclear power plants with cooling-tower-based heat dissipation systems and have been satisfactorily mitigated at other plants. Discharges are monitored as part of the National Pollutant Discharge Elimination System (NPDES) permit process.

Alternatives Including the Proposed Action

Table 2.1–1. (cont.)

Issue	Impact
Surface Water (cont.)	
Discharge of biocides, sanitary wastes, and minor chemical spills	Small impact (Category 1). The effects of these discharges are regulated by State and Federal environmental agencies. Discharges are monitored as part of the NPDES permit process. These impacts have been small at operating nuclear power plants.
Water use conflicts (plants with once-through cooling systems)	Small impact (Category 1). These conflicts have not been found to be a problem at operating nuclear power plants with once-through heat dissipation systems.
Water use conflicts (plants with cooling ponds or cooling towers using makeup water from a river with low flow)	Small or moderate impact (Category 2). Impacts could be of small or moderate significance, depending on makeup water requirements, water availability, and competing water demands.
Effects of dredging on water quality	Small impact (Category 1). Dredging to remove accumulated sediments in the vicinity of intake and discharge structures and to maintain barge shipping has not been found to be a problem for surface water quality. Dredging is performed under permit from the U.S. Army Corps of Engineers.
Temperature effects on sediment transport capacity	Small impact (Category 1). These effects have not been found to be a problem at operating nuclear power plants and are not expected to be a problem during the license renewal term.
Groundwater	
Groundwater use and quality	Small impact (Category 1). Extensive dewatering is not anticipated from continued operations and refurbishment activities associated with the license renewal term. The application of best management practices for handling any materials produced or used during activities would reduce impacts.
Groundwater use conflicts (plants that withdraw less than 100 gallons per minute [gpm])	Small impact (Category 1). Plants that withdraw less than 100 gpm are not expected to cause any groundwater use conflicts.
Groundwater use conflicts (plants that withdraw more than 100 gpm including those using Ranney wells)	Small, moderate, or large impact (Category 2). Plants that withdraw more than 100 gpm could cause groundwater use conflicts with nearby groundwater users.
Groundwater use conflicts (plants with closed-cycle cooling systems that withdraw makeup water from a river)	Small, moderate, or large impact (Category 2). Water use conflicts could result from water withdrawals from rivers during low-flow conditions, which may affect aquifer recharge. The significance of impacts would depend on makeup water requirements, water availability, and competing water demands.
Groundwater quality degradation resulting from water withdrawals	Small impact (Category 1). Groundwater withdrawals at operating nuclear power plants would not contribute significantly to groundwater quality degradation.

Table 2.1–1. (cont.)

Issue	Impact
Groundwater (cont.)	
Groundwater quality degradation (plants with cooling ponds in salt marshes)	Small impact (Category 1). Sites with closed-cycle cooling ponds could degrade groundwater quality; however, because groundwater in salt marshes is brackish, this is not a concern for plants located in salt marshes.
Groundwater quality degradation (plants with cooling ponds at inland sites)	Small, moderate, or large impact (Category 2). Sites with closed-cycle cooling ponds could degrade groundwater quality. For plants located inland, the quality of the groundwater in the vicinity of the ponds could be affected. The significance of the impact would depend on cooling pond water quality, site hydrogeologic conditions (including the interaction of surface water and groundwater), and the location, depth, and pump rate of water wells.
Groundwater and soil contamination	Small or moderate impact (Category 2). Industrial practices involving the use of solvents, hydrocarbons, heavy metals, or other chemicals and unlined wastewater lagoons have the potential to contaminate site groundwater, soil, and subsoil. Contamination is subject to State- and U.S. Environmental Protection Agency (EPA)-regulated cleanup and monitoring programs.
Radionuclides released to groundwater	Small or moderate impact (Category 2). Underground system leaks of process water have been discovered in recent years at several plants. Groundwater protection programs have been established at all operating nuclear power plants.
Terrestrial Resources	
Impacts of continued plant operations on terrestrial ecosystems	Small, moderate, or large impact (Category 2). Continued operations, refurbishment, and maintenance activities are expected to keep terrestrial communities in their current condition. Application of best management practices would reduce the potential for impacts. The magnitude of impacts would depend on the nature of the activity, the status of the resources that could be affected, and the effectiveness of mitigation.
Exposure of terrestrial organisms to radionuclides	Small impact (Category 1). Doses to terrestrial organisms are expected to be well below exposure guidelines developed to protect these organisms.
Cooling system impacts on terrestrial resources (plants with once-through cooling systems or cooling ponds)	Small impact (Category 1). No adverse effects to terrestrial plants or animals have been reported as a result of increased water temperatures, fogging, humidity, or reduced habitat quality. Due to the low concentrations of contaminants in cooling system effluents, uptake and accumulation of contaminants in the tissues of wildlife exposed to the contaminated water or aquatic food sources are not expected to be significant issues.

Alternatives Including the Proposed Action

Table 2.1–1. (cont.)

Issue	Impact
Terrestrial Resources (cont.)	
Cooling tower impacts on vegetation (plants with cooling towers)	Small impact (Category 1). Impacts from salt drift, icing, fogging, or increased humidity associated with cooling tower operation have the potential to affect adjacent vegetation, but these impacts have been small at operating nuclear power plants and are not expected to change over the license renewal term.
Bird collisions with cooling towers and transmission lines	Small impact (Category 1). Bird collisions with cooling towers and transmission lines occur at rates that are unlikely to affect local or migratory populations.
Water use conflicts with terrestrial resources (plants with cooling ponds or cooling towers using make-up water from a river with low flow)	Small or moderate impact (Category 2). Impacts on terrestrial resources in riparian communities affected by water use conflicts could be of moderate significance in some situations.
Transmission line ROW management impacts on terrestrial resources	Small impact (Category 1). Continued ROW management during the license renewal term is expected to keep terrestrial communities in their current condition. Application of best management practices would reduce the potential for impacts.
Electromagnetic field effects on flora and fauna (e.g., plants, agricultural crops, honeybees, wildlife, livestock)	Small impact (Category 1). No significant impacts of electromagnetic fields on terrestrial flora and fauna have been identified. Such effects are not expected to be a problem during the license renewal term.
Aquatic Resources	
Impingement and entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)	Small, moderate, or large impact (Category 2). The impacts of impingement and entrainment are small at many plants but may be moderate or even large at a few plants with once-through and cooling-pond cooling systems, depending on cooling system withdrawal rates and volumes and the aquatic resources at the site.
Impingement and entrainment of aquatic organisms (plants with cooling towers)	Small impact (Category 1). Impingement and entrainment rates are lower at plants that use closed-cycle cooling with cooling towers because the rates and volumes of water withdrawal needed for makeup are minimized.
Thermal impacts on aquatic organisms (plants with once-through cooling systems or cooling ponds)	Small, moderate, or large impact (Category 2). Most of the effects associated with thermal discharges are localized and are not expected to affect overall stability of populations or resources. The magnitude of impacts, however, would depend on site-specific thermal plume characteristics and the nature of aquatic resources in the area.
Thermal impacts on aquatic organisms (plants with cooling towers)	Small impact (Category 1). Thermal effects associated with plants that use cooling towers are small because of the reduced amount of heated discharge.

Table 2.1–1. (cont.)

Issue	Impact
Aquatic Resources (cont.)	
Effects of cooling water discharge on dissolved oxygen, gas supersaturation, and eutrophication	Small impact (Category 1). Gas supersaturation was a concern at a small number of operating nuclear power plants with once-through cooling systems but has been satisfactorily mitigated. Low dissolved oxygen was a concern at one nuclear power plant with a once-through cooling system but has been effectively mitigated. Eutrophication (nutrient loading) and resulting effects on chemical and biological oxygen demands have not been found to be a problem at operating nuclear power plants.
Effects of non-radiological contaminants on aquatic organisms	Small impact (Category 1). Best management practices and discharge limitations of NPDES permits are expected to minimize the potential for impacts to aquatic resources. Accumulation of metal contaminants has been a concern at a few nuclear power plants but has been satisfactorily mitigated by replacing copper alloy condenser tubes with those of another metal.
Exposure of aquatic organisms to radionuclides	Small impact (Category 1). Doses to aquatic organisms are expected to be well below exposure guidelines developed to protect these aquatic organisms.
Effects of dredging on aquatic organisms	Small impact (Category 1). Effects of dredging on aquatic resources tend to be of short duration (years or less) and localized. Dredging requires permits from the U.S. Army Corps of Engineers, State environmental agencies, and other regulatory agencies.
Water use conflicts with aquatic resources (plants with cooling ponds or cooling towers using make-up water from a river with low flow)	Small or moderate impact (Category 2). Impacts on aquatic resources in instream communities affected by water use conflicts could be of moderate significance in some situations.
Refurbishment impacts on aquatic resources	Small impact (Category 1). Refurbishment impacts with appropriate mitigation are not expected to change aquatic communities from their current condition.
Impacts of transmission line ROW management on aquatic resources	Small impact (Category 1). Application of best management practices to ROW near aquatic systems would reduce the potential for impacts.
Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses	Small impact (Category 1). These types of losses have not been found to be a problem at operating nuclear power plants and are not expected to be a problem during the license renewal term.
Stimulation of aquatic nuisance species (e.g., shipworms)	Small impact (Category 1). Stimulation of nuisance organisms has been satisfactorily mitigated at the single nuclear power plant with a once-through cooling system where previously it was a problem. It has not been found to be a problem at operating nuclear power plants with cooling towers or cooling ponds and is not expected to be a problem during the license renewal term.

Alternatives Including the Proposed Action

Table 2.1–1. (cont.)

Issue	Impact
Threatened, Endangered, and Protected Species and Essential Fish Habitat	
Threatened, endangered, and protected species and essential fish habitat	Small, moderate, or large impact (Category 2). The magnitude of impacts on threatened, endangered, and protected species and essential fish habitat would depend on the occurrence of listed species and habitats and the effects of power plant systems on them. Consultation with appropriate agencies would be needed to determine whether special status species or habitats are present and whether they would be adversely affected by activities associated with license renewal.
Historic and Cultural Resources	
Historic and cultural resources	Small, moderate, or large impact (Category 2). Continued operations and refurbishment associated with the license renewal term are expected to have no more than small impacts on historic and cultural resources located onsite and in the transmission line ROW because most impacts could be mitigated by avoiding those resources. The National Historic Preservation Act (NHPA) requires the Federal agency to consult with the State Historic Preservation Officer (SHPO) and appropriate Native American Tribes to determine the potential impacts and mitigation. See § 51.14(a).
Socioeconomics	
Employment and income, recreation and tourism	Small impact (Category 1). Although most nuclear plants have large numbers of employees with higher than average wages and salaries, employment and income impacts from continued operations and refurbishment are expected to be small. Nuclear plant operations, employee spending, power plant expenditures, and tax payments have an effect on local economies. Changes in plant operations, employment, and expenditures would have a greater effect on rural economies than on semi-urban economies.
Tax revenues	Small impact (Category 1). Nuclear plants provide tax revenue to local jurisdictions in the form of property tax payments, payments in lieu of tax (PILOT), or tax payments on energy production. The amount of tax revenue paid during the license renewal term from continued operations and refurbishment is not expected to change, since the assessed value of the power plant, payments on energy production and PILOT payments are also not expected to change.

Table 2.1–1. (cont.)

Issue	Impact
Socioeconomics (cont.)	
Community services and education	Small impact (Category 1). Changes to local community and educational services would be small from continued operations and refurbishment associated with the license renewal term. With no increase in employment, value of the power plant, payments on energy production, and PILOT payments expected during the license renewal term, community and educational services would not be affected by continued power plant operations. Changes in employment and tax payments would have a greater effect on jurisdictions receiving a large portion of annual revenues from the power plant than on jurisdictions receiving the majority of their revenues from other sources.
Population and housing	Small impact (Category 1). Changes to regional population and housing availability and value would be small from continued operations and refurbishment associated with the license renewal term. With no increase in employment expected during the license renewal term, population and housing availability and values would not be affected by continued power plant operations. Changes in housing availability and value would have a greater effect on sparsely populated areas than areas with higher density populations.
Transportation	Small impact (Category 1). Changes to traffic volumes would be small from continued operations and refurbishment activities associated with the license renewal term. Changes in employment would have a greater effect on rural areas, with less developed local and regional networks. Impacts would be less noticeable in semi-urban areas depending on the quality and extent of local access roads and the timing of plant shift changes when compared to typical local usage.
Human Health	
Radiation exposures to the public	Small impact (Category 1). Radiation doses to the public from continued operations and refurbishment associated with the license renewal term are expected to continue at current levels, and would be well below regulatory limits.
Radiation exposures to occupational workers	Small impact (Category 1). Occupational doses from continued operations and refurbishment associated with the license renewal term are expected to be within the range of doses experienced during the current license term, and would continue to be well below regulatory limits.
Human health impact from chemicals	Small impact (Category 1). Chemical hazards to workers would be minimized by observing good industrial hygiene practices. Chemical releases to the environment and the potential for impacts to the public are minimized by adherence to discharge limitations of NPDES permits.

Alternatives Including the Proposed Action

Table 2.1–1. (cont.)

Issue	Impact
Human Health (cont.)	
Microbiological hazards to the public (plants with cooling ponds or canals or cooling towers that discharge to a river)	Small, moderate, or large impact (Category 2). These organisms are not expected to be a problem at most operating plants except possibly at plants using cooling ponds, lakes, or canals that discharge to rivers. Impacts would depend on site-specific characteristics.
Microbiological hazards to plant workers	Small impact (Category 1). Occupational health impacts are expected to be controlled by continued application of accepted industrial hygiene practices to minimize worker exposures.
Chronic effects of electromagnetic fields (EMFs)	Uncertain impact. Studies of 60-Hz EMFs have not uncovered consistent evidence linking harmful effects with field exposures. EMFs are unlike other agents that have a toxic effect (e.g., toxic chemicals and ionizing radiation) in that dramatic acute effects cannot be forced and longer-term effects, if real, are subtle. Because the state of the science is currently inadequate, no generic conclusion on human health impacts is possible.
Physical occupational hazards	Small impact (Category 1). Occupational safety and health hazards are generic to all types of electrical generating stations, including nuclear power plants, and is of small significance if the workers adhere to safety standards and use protective equipment.
Electric shock hazards	Small, moderate, or large impact (Category 2). Electrical shock potential is of small significance for transmission lines that are operated in adherence with the National Electrical Safety Code (NESC). Without a review of each nuclear plant transmission line conformance with NESC criteria, it is not possible to determine the significance of the electrical shock potential.
Postulated Accidents	
Design-basis accidents	Small impact (Category 1). The NRC staff has concluded that the environmental impacts of design-basis accidents are of small significance for all plants.
Severe accidents	Small impact (Category 2). The probability-weighted consequences of atmospheric releases, fallout onto open bodies of water, releases to groundwater, and societal and economic impacts from severe accidents are small for all plants. However, alternatives to mitigate severe accidents must be considered for all plants that have not considered such alternatives.

Table 2.1–1. (cont.)

Issue	Impact
Environmental Justice	
Minority and low-income populations	Small or moderate impact (Category 2). Impacts to minority and low-income populations and subsistence consumption will be addressed in plant-specific reviews. See NRC Policy Statement on the Treatment of Environmental Justice Matters in NRC Regulatory and Licensing Actions (69 FR 52040).
Solid Waste Management	
Low-level waste storage and disposal	Small impact (Category 1). The comprehensive regulatory controls that are in place and the low public doses being achieved at reactors ensure that the radiological impacts to the environment would remain small during the term of a renewed license.
Onsite storage of spent nuclear fuel	Small impact (Category 1). The expected increase in the volume of spent fuel from an additional 20 years of operation can be safely accommodated onsite with small environmental effects through dry or pool storage at all plants, if a permanent repository or monitored retrievable storage is not available.
Offsite radiological impacts of spent nuclear fuel and high-level waste disposal	(Category 1). For the high-level waste and spent-fuel disposal component of the fuel cycle, the EPA established a dose limit of 15 millirem (0.15 mSv) per year for the first 10,000 years and 100 millirem (1.0 mSv) per year between 10,000 years and 1 million years for offsite releases of radionuclides at the proposed repository at Yucca Mountain, Nevada. The Commission concludes that the impacts would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 should be eliminated. Accordingly, while the Commission has not assigned a single level of significance for the impacts of spent fuel and high level waste disposal, this issue is considered Category 1.
Mixed-waste storage and disposal	Small impact (Category 1). The comprehensive regulatory controls and the facilities and procedures that are in place ensure proper handling and storage, as well as negligible doses and exposure to toxic materials for the public and the environment at all plants. License renewal would not increase the small, continuing risk to human health and the environment posed by mixed waste at all plants. The radiological and nonradiological environmental impacts of long-term disposal of mixed waste from any individual plant at licensed sites are small.
Nonradioactive waste storage and disposal	Small impact (Category 1). No changes to systems that generate nonradioactive waste are anticipated during the license renewal term. Facilities and procedures are in place to ensure continued proper handling, storage, and disposal, as well as negligible exposure to toxic materials for the public and the environment at all plants.

Alternatives Including the Proposed Action

Table 2.1–1. (cont.)

Issue	Impact
Cumulative Impacts	
Cumulative impacts	(Category 2). Cumulative impacts of license renewal must be considered on a plant-specific basis. Impacts would depend on regional resource characteristics, the resource-specific impacts of license renewal, and the cumulative significance of other factors affecting the resource.
Uranium Fuel Cycle	
Offsite radiological impacts – individual impacts from other than the disposal of spent fuel and high-level waste	Small impact (Category 1). The impacts to the public from radiological exposures have been considered by the Commission in Table S-3 of this part. Based on information in the GEIS, impacts to individuals from radioactive gaseous and liquid releases including radon-222 and technetium-99 would remain at or below the NRC’s regulatory limits.
Offsite radiological impacts – collective impacts from other than the disposal of spent fuel and high-level waste	(Category 1). There are no regulatory limits applicable to collective doses to the general public from fuel-cycle facilities. The practice of estimating health effects on the basis of collective doses may not be meaningful. All fuel-cycle facilities are designed and operated to meet the applicable regulatory limits and standards. The Commission concludes that the collective impacts are acceptable. The Commission concludes that the impacts would not be sufficiently large to require the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54 should be eliminated. Accordingly, while the Commission has not assigned a single level of significance for the collective impacts of the uranium fuel cycle, this issue is considered Category 1.
Nonradiological impacts of the uranium fuel cycle	Small impact (Category 1). The nonradiological impacts of the uranium fuel cycle resulting from the renewal of an operating license for any plant would be small.
Transportation	Small impact (Category 1). The impacts of transporting materials to and from uranium-fuel-cycle facilities on workers, the public, and the environment are expected to be small.
Termination of Nuclear Power Plant Operations and Decommissioning	
Termination of plant operations and decommissioning	Small impact (Category 1). License renewal is expected to have a negligible effect on the impacts of terminating operations and decommissioning on all resources.

1
2

2.2 No-Action Alternative

The no-action alternative represents a decision by the NRC not to renew the operating license of a nuclear power plant beyond the current operating license term. At some point, all nuclear plants will terminate operations and undergo decommissioning. Under the no-action alternative, plant operations would terminate at or before the end of the current license term.

Not renewing the license and ceasing operation under the no-action alternative may lead to a variety of potential outcomes, but these would be essentially the same regardless of when decommissioning occurs. Termination of nuclear power plant operations would result in a net reduction in power production capacity.

The No-Action Alternative, unlike the other alternatives, does not expressly meet the purpose and need of the proposed action, as it does not provide a means of meeting future electric system needs. No action, on its own, would likely create a need for replacement power, conservation and energy efficiency (demand-side management), purchased power, or some combination of these options.

2.3 Alternative Energy Sources

The NRC evaluated the environmental impacts of energy sources that may serve as alternatives to license renewal. Alternative energy sources included a variety of fossil fuel, new nuclear, renewable energy, and other alternatives such as conservation and energy efficiency as well as purchased power. These evaluations are presented to compare the impacts between the alternatives and license renewal.

North American Electric Reliability Corporation

For the purpose of ensuring continued reliability of electric service, the Energy Policy Act of 2005 (EPAAct) authorized the creation of an independent, international Electric Reliability Organization (ERO) and directed the Federal Energy Regulatory Commission (FERC) to establish rules for EROs as well as a process for certification. In July 2006, FERC approved the North American Electric Reliability Corporation's (NERC) application to become the ERO for the United States.

Established in 1968, NERC is a regulatory organization that develops and enforces reliability standards; monitors the bulk power system; assesses future adequacy; audits owners, operators, and users for preparedness; and educates and trains industry personnel. NERC is composed of eight Regional Reliability Councils (RRCs), each responsible for a specific geographic area. RRC membership typically includes investor-owned utilities; Federal power agencies; rural electric cooperatives; State, municipal, and provincial utilities; Canadian Crown corporations (only for some RRCs); independent power producers; power marketers; and end-use customers. These entities account for virtually all bulk electricity (i.e., electricity provided at 100 kV or higher) supplied in the United States, Canada, and a portion of Baja California Norte, Mexico. NERC's proposal to delegate enforcement authority for reliability standards to eight regional entities is pending before the Federal Energy Regulatory Commission.

Alternatives Including the Proposed Action

1 The following sections describe the alternatives identified by the NRC as capable of meeting
2 the purpose and need of the proposed action (license renewal) or replacing the power
3 generated by a nuclear power plant. A reasonable alternative must be commercially viable or
4 expected to become so in the near future prior to the expiration of the operating license. The
5 replacement power generated must equal the base load capacity previously supplied by the
6 nuclear plant.

7
8 Should the need arise to replace the generating capacity of a nuclear reactor, power could be
9 provided by a suite of alternatives and combinations of alternatives, including expanding the
10 capacities of one or more existing power generating plants within a region. The number of
11 possible combinations of alternatives that could replace the generating capacity of a nuclear
12 power plant is large. Based on this, the NRC has only evaluated individual alternatives rather
13 than combinations of alternatives in this GEIS. However, combinations of alternatives may be
14 considered during plant-specific license reviews.

15 16 **2.3.1 Alternative Electricity Generation**

17
18 The following sections describe alternative means of generating electricity that could serve to
19 replace the power produced by an existing nuclear plant. These alternatives must be viable on
20 a utility scale or be expected to become so within the foreseeable future. Should the need arise
21 to replace the generating capacity of a nuclear reactor, the necessary alternative power is likely
22 to be provided by a suite of alternatives, which could include expanding the capacities of one or
23 more existing power-generating facilities within the region. As discussed in Chapter 1, the NRC
24 does not engage in energy planning decisions and makes no judgment on which energy
25 alternatives evaluated would be the most likely alternative in any given case.

26
27 Also addressed are several non-generation alternatives that may serve to offset or replace the
28 electricity generated by nuclear power plants. These options include purchased power and
29 conservation and energy efficiency (demand-side management).

30
31 The NRC relies on many sources of information to determine which alternatives are available
32 and commercially viable. DOE's Energy Information Administration (EIA) maintains the official
33 energy statistics of the Federal Government. The NRC uses information from four EIA reports:
34 *Electric Power Annual*, *Annual Energy Review*, *Renewable Energy Annual*, *Renewable Energy*
35 *Trends in Consumption and Electricity*, *Annual Energy Outlook*, and *Assumptions to the Annual*
36 *Energy Outlook* to identify alternatives to the proposed action (license renewal). The NRC also
37 uses state, regional, and in some cases, utility or system level assessments and projections.

38
39 In the EIA's *Annual Energy Outlook 2007 with Projections to 2030*, EIA projects a continued
40 nationwide increase in energy consumption and generating capacity throughout the 2030

1 forecast period (EIA 2007a). The EIA also forecasts continued growth in coal, natural gas,
2 renewable, and nuclear-powered generation through 2030.

3
4 In the following sections, the NRC presents a variety of alternatives to license renewal. In
5 Chapter 4, NRC compares the environmental impacts of alternatives to the environmental
6 impacts of license renewal.

7 8 **2.3.2 Fossil Fuel Energy Alternatives**

9
10 The EIA indicates that fossil fuels will likely continue to provide the bulk of commercial electric
11 power generation through 2030. The EIA projects that natural-gas-fired, combined-cycle, or
12 combustion turbine technology will account for most new generating capacity. As natural gas
13 prices increase, coal-fired generation will begin to account for the largest share of generating
14 capacity (EIA 2007a). The EIA projects that coal will account for the majority (54 percent) of
15 new capacity through 2030 and that advanced coal technologies, such as coal-fueled integrated
16 gasification combined-cycle (IGCC) generation, will become less costly relative to improved
17 natural-gas-fired, combined-cycle technologies (EIA 2007a). EIA suggests that changes in
18 electricity generation costs, which are highly dependent on emission control costs, will drive
19 utilities' choices in generating technologies (EIA 2007a).

20
21 The EIA asserts that oil-fired plants will account for virtually no new generation capacity in the
22 United States through 2030, projecting a 0.6-percent annual decrease in electric sector oil
23 consumption because of higher fuel costs and lower efficiencies (EIA 2007a).

24
25 Advanced coal technologies will likely become increasingly important as regulations on power
26 plant emissions evolve. Technologies often referred to as "clean coal technologies," which
27 include coal cleaning processes during combustion, coal gasification technologies, improved
28 combustion technologies, and improved devices for capturing pollutants, will play an important
29 role. Emissions controls and advanced-combustion technologies will likely play an increasingly
30 important role for other fossil-fuel power generating systems.

31
32 Greenhouse gas controls may be required for future fossil fuel power plants. Though
33 nationwide greenhouse gas regulations do not yet exist, regional-, State-, and local-level
34 initiatives have begun to restrict CO₂ and other greenhouse gas emissions or implement
35 emissions-trading schemes. Fossil fuel alternatives – especially those burning coal, the most
36 carbon-intensive of the fossil fuels – have the greatest exposure to risk from carbon regulation,
37 and, in some areas, state-level permitting authorities have denied permits for new coal plants.

38
39 The technology needed for capture and removal of greenhouse gases in fossil fuel emissions
40 (primarily CO₂) will require additional development to become commercially viable. The

Alternatives Including the Proposed Action

1 infrastructure necessary to remove greenhouse gases on a scale sufficient to support utility-
2 scale power generation does not presently exist, though it is the subject of ongoing research.
3

4 **2.3.3 New Nuclear Power Plant Alternatives**

5
6 The last nuclear power plant to come on line in the U.S. was Watts Bar in 1996. Since then,
7 nuclear power generating capacity has only been increased through power uprates at existing
8 plants. The EIA projects that by 2030, power uprates would increase nuclear power generating
9 capacity by 3 GW. The EIA also projects an additional 12.5 GW of nuclear power from new
10 plants, partly because of tax credits and other incentives. Nuclear plant retirements would
11 result in the loss of 2.6 GW of generating capacity. In proportion to other sources of electrical
12 power, the EIA projects that the percent from nuclear will decrease slightly through 2030 (EIA
13 2007a).
14

15 Currently, four nuclear reactor designs have been certified, and seven additional designs are
16 undergoing review. These include the 1300 MW(e) U.S. Advanced Boiling Water Reactor (10
17 CFR Part 52, Appendix A), the 1300 MW(e) System 80+ Design (10 CFR Part 52, Appendix B),
18 the 600 MW(e) AP600 Design (10 CFR Part 52 Appendix C), and the 1100 MW(e) AP1000
19 Design (10 CFR Part 52, Appendix D).
20

21 The NRC has received a number of combined operating license (COL) applications and has
22 completed reviews on several early site permits (ESPs). The issuance of a COL authorizes the
23 applicant to construct and operate a nuclear power facility at a specific site. An ESP is not a
24 license to build a nuclear power plant; however, it initiates a process to assess whether the
25 proposed site is suitable for the construction of a nuclear power plant.
26

27 **2.3.4 Renewable Energy Alternatives**

28
29 The EIA projects that total renewable energy power generating capacity will increase through
30 2030, primarily due to tax credits and other incentives. In proportion to other sources of
31 electrical power, the EIA expects renewable energy power generation to remain relatively
32 constant (EIA 2007a).
33

34 The NRC considers the following renewable energy alternatives for possible replacement
35 power: hydroelectric, geothermal, wind (both land-based and offshore), biomass (energy crops,
36 agricultural crop residues, and urban wood and forest wastes), refuse-derived biomass
37 (municipal solid waste, refuse-derived fuel, and landfill gas), solar (thermal), solar (photovoltaic),
38 and ocean wave and current. Combinations of energy renewable alternatives may be
39 considered during plant-specific license reviews.
40

1 Few renewable energy alternatives are capable of providing total replacement power. Most
2 renewable energy alternatives could not replace a nuclear reactor, and would be part of a
3 combination of energy alternatives.

4
5 Environmental impacts of construction and operation of renewable energy alternatives are quite
6 different. Resource areas with the greatest range of impacts include air quality, hydrology, and
7 land use. Air quality impacts from hydroelectric, wind, solar, and wave and current would be
8 negligible; however, biomass-fueled energy would emit air pollutants, some of them hazardous.
9 All renewable energy alternatives would rely on modest amounts of water; however, those that
10 would rely on conventional steam cycles to power turbine generators (biomass, geothermal,
11 solar [thermal]) would have higher water demands. All renewable energy alternatives, except
12 for offshore wind and ocean wave and current would require land. Hydroelectric and solar
13 would require significant amounts of land.

14
15 EIA projections through 2030 suggest that hydroelectric power will provide the bulk of
16 renewable electric power generation. Biomass, wind, and geothermal energy will likely
17 constitute the remaining sources of renewable energy. A brief overview of renewable energy
18 alternatives are discussed in the following paragraphs.

19 20 *Hydroelectric Energy*

21
22 Currently, there are 2000 operating hydroelectric plants in the United States. Hydroelectric
23 technology operates by capturing the energy of flowing water and directing it to a turbine and
24 generator to produce electricity. There are two fundamental hydropower facility designs: “run-
25 of-the-river” facilities that simply redirect the natural flow of a river, stream, or canal through a
26 hydroelectric facility, and “store-and-release” facilities that block the flow of the river by using
27 dams that cause the water to accumulate in an upstream reservoir.

28
29 Hydropower has provided 80 percent of commercial electricity generated by all renewable
30 alternatives and is projected to remain so through the year 2030. However, the potential for
31 future construction of large dams has diminished due to increased public concerns over
32 flooding, habitat alteration and loss, and destruction of natural river courses. Additional
33 demands for river water have also reduced water flow.

34
35 Large hydroelectric facilities constructed on major rivers can have peak power capacities as
36 high as 10,000 MW(e). However, river flow conditions and other circumstances and factors
37 (spawning periods of anadromous fish) often require dam operators to divert river flow around
38 power-generating turbines over various periods of time, thereby reducing the amount of power
39 generated.

Alternatives Including the Proposed Action

1 *Geothermal Energy*

2

3 Geothermal energy is energy in the form of heat contained below the earth's surface in
4 hydrothermal zones (hot water or steam trapped in an aquifer), hot and dry geologic formations
5 (referred to as hot dry rock resources), or in geopressurized resources (hot brine aquifers
6 existing under pressure). The technical approaches to exploiting geothermal energy resources
7 are quite similar. Wells are drilled to extract the heat energy. Hot water or steam is brought to
8 the surface where the heat energy is used to generate electricity. Hydrothermal resources are
9 the only geothermal resources that have been exploited to date.

10

11 Most geothermal resources exist in the western United States (see Figure D.10-16,
12 Appendix D). Development of geothermal energy has been limited to California, Nevada, Utah,
13 and Hawaii. The greatest concentration of geothermal power is in California. As of 2002,
14 3000 MW(e) were being produced in California geothermal power plants. Estimates of
15 available geothermal resources in California range from 2000 to 10,000 MW(e) (Sass and
16 Priest 2002). The estimate of the electricity generating capacity of all U.S. geothermal
17 resources accessible by current technology is 23,000 MW. However, some resources are
18 located in remote areas and their connection to load centers would occur only at substantial
19 cost (EERE 2007).

20

21 Historically, geothermal resources have been used to commercially produce electricity.
22 However, these systems have been relatively small (generating from 250 kW to 70 MW).
23 Recent advances in hydrothermal technology have increased the potential for electricity
24 generation at larger scales.

25

26 *Wind Energy*

27

28 Wind energy facilities (wind farms or wind parks) consist of an array of wind turbines designed
29 to capture the energy of the wind. The wind turbine's rotor blade captures wind energy and
30 converts it to mechanical energy to produce electricity.

31

32 Early wind turbine designs required the turbine's rotor to spin at very high speeds to produce
33 power. This resulted in bird collisions and a considerable amount of aerodynamic noise.
34 Advances in wind technology allow wind turbines to efficiently generate electricity at lower rotor
35 speeds. Improvements in blade aerodynamics permit wind turbines to capture energy from
36 lower wind speeds. Lower rotational speeds have reduced the potential for bird strikes and
37 aerodynamic noise.

38

39 The percentage of time that a wind farm produces electricity is relatively low due to the
40 unpredictability of adequate wind. Presently, energy extracted from wind cannot be stored.

1 Equipping wind turbines with batteries or other energy-storage systems would allow the
2 harvesting of wind energy when the wind is available.

3
4 Modern wind turbines have rotor diameters greater than 100 m (300 ft) on towers that are
5 hundreds of feet tall and are capable of generating as much as 5 MW(e) under ideal wind
6 conditions. A large number of wind turbines are required to generate commercial levels of
7 power (greater than 500 MW). Considerable distances are required between wind turbines to
8 avoid turbulence and guarantee optimal performance. Consequently, land area requirements
9 for commercial-scale wind farms can be substantial, though actual land area used for turbines
10 and infrastructure (including roads and buried power or communications cables) may be only a
11 small fraction – typically 5 percent – of the total land required.

12
13 Wind resources exist throughout the United States and in offshore areas, but are most
14 prevalent in the upper Midwest and western states. (See Figures D.10-17 and D.10-18 for wind
15 resource distributions in the United States and in offshore areas, respectively.) The most ideal
16 settings for wind farms are in rural or remote areas. If transmission facilities do not already
17 exist, additional development costs and environmental impacts would result from the
18 construction of electric transmission lines.

19
20 Offshore wind turbines are identical in appearance and function to their land-based
21 counterparts. Typically, power is delivered from each turbine by underwater cable to a land-
22 based substation. Currently no offshore wind farms exist in the United States, although some
23 have been proposed. Offshore wind farms are operational in Europe, and are typically located
24 on the outer continental shelf. The Minerals Management Service of the Department of Interior
25 recently published a Programmatic Environmental Impact Statement (PEIS) for offshore
26 renewable energy facilities (MMS 2007). The Minerals Management Service identified potential
27 environmental impacts of offshore facilities and established minimal controls and stipulations for
28 future leases. Offshore wind farms could produce some adverse impacts including visual
29 resource degradation, fish and marine mammal habitat alteration, bird collision hazards,
30 shipping lane interference, and noise that could cause avoidance behavior in aquatic species.

31 32 *Biomass Energy*

33
34 Biomass energy sources include a wide variety of materials, including municipal solid waste,
35 refuse-derived fuel, landfill gas, urban wood wastes, forest residues, agricultural crop residues
36 and wastes, energy crops. Biomass resources are widely available throughout the United
37 States (see Figure D.10-19). Biomass energy conversion is accomplished using a wide variety
38 of technologies, some of which are similar in appearance and operation to fossil fuel plants.
39 Some biomass technologies include: direct combustion in a boiler or incinerator to produce
40 steam, biomass cofiring along with fossil fuels (primarily coal) in boilers to produce steam,
41 producing synthetic liquid fuels that are subsequently combusted, gasification to produce

Alternatives Including the Proposed Action

1 gaseous fuels that are subsequently combusted, and anaerobic digestion to produce biogas.
2 Synthetic fuel production, gasification, and anaerobic digestion technologies have not been
3 used to produce utility-scale electricity. Biogas is typically consumed in combined heat and
4 power plants with relatively small power generating capacities. Despite operational similarities,
5 the environmental impacts of biomass energy plants differ from those of fossil fuel plants.
6 Although fossil- and biomass-fueled facilities both release CO, biomass-fueled facilities utilizing
7 energy crops or forest industry wastes are said to be carbon-neutral since the energy crops
8 offset the amount of CO₂ produced. This is not true for biomass facilities relying on municipal
9 solid waste, refuse-derived fuel, or landfill gas. Depending on the fuel, the combustion
10 technology, and the operating conditions, some biomass energy systems impact air quality and
11 generate solid wastes that must be properly managed. Biomass fuel from wood, energy crops,
12 or crop residues generate fewer criteria pollutants per unit of energy delivered than coal.
13 However, toxic pollutants could be released from unprocessed municipal solid waste due to
14 incomplete combustion.

15
16 Biomass cofiring with coal is technically feasible and is a potential near-term alternative for
17 commercial power generation. Additionally, it would reduce emissions of criteria pollutants.
18 Wood has been the most widely used biomass fuel for electricity generation. Of the nearly
19 1,000 operating biomass power plants, the majority involve direct biomass combustion while
20 only a small number involve biomass cofiring with coal (NREL 2006).

21
22 DOE conducted a review of biomass technologies and projected future performance based on
23 anticipated technological advances through 2030 (EERE 1997). The technologies studied
24 included biomass-only integrated gasification combined-cycle, direct burn biomass facilities,
25 and biomass cofired with coal facilities. Energy crops (wood) or agricultural crop residues offer
26 the greatest potential for energy production. There are three types of municipal solid waste
27 incinerators: mass burn, modular, or refuse-derived fuel incinerators. Mass burn incinerators
28 generally burn unprocessed municipal solid waste. Modular units are smaller in capacity and
29 more selective of the type of waste utilized as fuel and often contain dual combustion chambers
30 to ensure more complete combustion. Refuse-derived fuel incinerators utilize processed
31 municipal solid waste which removes hazardous and recyclable constituents. While it is
32 technically feasible to operate a biomass combustion plant on municipal solid waste or refuse-
33 derived fuel, source material may not be reliable or consistent. Consequently, municipal solid
34 waste is often cofired with other fuels such as coal in modified boilers.

35
36 Landfill gas is another potential source of biomass energy for electric power production.
37 Landfills in which organic materials are disposed represent the largest source of methane in the
38 United States. Landfill gas composition varies depending on the type of waste. Collecting
39 landfill gas is a relatively straightforward process that involves placing recovery wells and
40 simple gas collection systems. Of the approximately 2300 operating or recently closed landfills
41 in the United States, 427 landfills are currently equipped with gas collection systems. In 2006,

1 landfills produced enough gas to generate 10 billion kWh of electricity. An additional 560
 2 landfills could be adapted to landfill gas-to-energy production (see Figure D.10-23). Since gas
 3 is produced continuously, landfill gas-to-energy plants can have capacity factors greater than 90
 4 percent and can be relied upon as a source of replacement power.

5
 6 *Solar Power*
 7

8 Solar power technologies that are commercially viable for the production of electricity are
 9 thermal and photovoltaic. However, neither technology has been widely used for grid-
 10 connected power production. Thermal systems or concentrating solar power systems are
 11 designed to concentrate solar energy by as much as 10,000 times to generate high-
 12 temperature thermal energy. Photovoltaic systems use semiconductors that convert solar
 13 energy to electricity. Some photovoltaic designs also concentrate the solar energy but do not
 14 use heated working fluid-like concentrated solar power systems.

15
 16 Concentrating solar power systems use mirrors to reflect solar radiation to heat a fluid
 17 (typically, a high-boiling synthetic oil) to temperatures as high as 400 to 800°C (752 to 1472°F).
 18 The fluid then transfers its heat to a conventional steam cycle turbine generator to produce
 19 electricity. Three principal configurations of concentrating solar power systems have been
 20 developed: (1) a power trough system consisting of a series of mirrors arranged to reflect
 21 energy along a line to a pipe containing the working fluid; (2) mirrors that move with the sun to
 22 direct solar radiant energy into a central reservoir containing working fluid; and (3) a system of
 23 mirrors arranged on a dish that reflects solar energy to a focal point where a working fluid is
 24 heated and directed to engines that generate electricity. These systems only differ in how the
 25 mirrors are arranged. Of the three designs, power trough systems are the only mirror
 26 configurations that have been used in commercial applications for electricity development.

27
 28 While most concentrating solar power plants use solar radiation to heat a working fluid, direct
 29 steam production is also feasible. Most concentrating solar power plants also have back-up
 30 capabilities, typically using natural gas, to provide steam to address load demands during off-
 31 peak solar radiation periods.

32
 33 Solar photovoltaic systems convert solar radiation directly into electricity. Three types of solar
 34 collectors have been developed: single crystal, polycrystalline, and amorphous silicon. Single
 35 crystals exhibit the highest efficiency, but polycrystalline cells now represent the majority of the
 36 photovoltaic market. Historically, photovoltaic systems have not been used for commercial
 37 power generation, but have been used to power appliances and homes in remote locations that
 38 cannot be easily connected to the transmission grid. As with concentrating solar power
 39 systems, designs of photovoltaic power systems can include mirrors or concentrators that can
 40 enhance the power generating capacity of the photovoltaic cells. Schematics of photovoltaic
 41 power systems appear in Figures D.10-25 and D.10-26.

Alternatives Including the Proposed Action

1 To serve as a source of commercial power, photovoltaic systems and concentrating solar power
2 systems would need to work in conjunction with energy storage systems such as batteries.
3 Solar intensity varies by a small amount and solar cells can be effectively utilized within the
4 United States. The greatest power generating potential is in the southwestern states (see
5 Figure D.10-27).
6

7 Because of the relatively low power output of individual solar cells, utility-scale photovoltaic
8 systems would involve a vast array of multiple solar cells. Given current technology, large
9 amounts of land would be required to support commercial scale photovoltaic power generation
10 (UCS 2007).
11

12 The manufacture of solar cells involves the use of many hazardous chemicals, including toxic
13 gases (e.g., arsine, phosphine, silane, sulfur hexafluoride, molybdenum hexafluoride, tungsten
14 hexafluoride, and hydrogen selenide, hydrochloric and hydrofluoric acids), toxic metals (e.g.,
15 arsenic, cadmium, selenium, and various other heavy metals), and numerous flammable,
16 corrosive, or highly reactive chemicals. In addition, the photocells contain cadmium, selenium,
17 and other heavy metals. A 2003 study conducted jointly by the Electric Power Research
18 Institute and the California Energy Commission concluded that the manufacture and use of
19 photocells presented no significant health or environmental risk (EPRI and CEC 2003).
20

21 *Ocean Wave and Current Energy* 22

23 Offshore technologies that harness the energy of ocean waves and current are in their infancy,
24 and have not been used at utility scale. These technologies may become commercially viable
25 in the near future.
26

27 A variety of wave energy technologies have been considered. Research and development
28 efforts have focused on point absorbers, attenuators, overtopping devices, and terminators.
29 These technologies differ in size, anchoring method, spacing, interconnection, array patterns,
30 and water depth limitations.
31

32 Point absorbers and attenuators allow waves to interact with a floating buoy. The wave motion
33 is converted into mechanical energy to drive a generator. Overtopping devices trap some
34 portion of an incident wave at a higher elevation than the average height of the surrounding sea
35 surface, while terminators allow waves to enter a tube, compressing air that is then used to
36 drive a generator.
37

38 No point absorber facilities are currently in commercial operation. A 50-MW commercial facility
39 is proposed for installation off the coast of Oregon, with an estimated total power output of
40 153,300 MWh/yr. It is expected that the proposed wave facility would consist of 200 devices
41 deployed in an array of four rows that are parallel to the beach. Each row would consist of

1 roughly 54 250-kW buoys. Although no wave energy capture devices are currently deployed
 2 along the U.S. coastlines, feasibility studies and prototype tests have been conducted for
 3 locations off the coasts of Hawaii, Oregon, California, Massachusetts, and Maine.

4
 5 Ocean current energy technology is also in its infancy. Existing prototypes capture ocean
 6 energy with submerged turbines that are similar to wind turbines. Although the functions of
 7 ocean turbines and wind turbines are identical, ocean turbines have substantially greater power
 8 generating capacity since the energy contained in moving water is approximately 800 times
 9 greater than air. In relatively constant currents with average velocities of 3.5 mph (5.6 km/h) or
 10 variable tidal currents averaging 5.8 mph (9.3 km/h), ocean turbines can produce sufficient
 11 capacity factors for baseload demand. Various ocean turbine designs are undergoing
 12 research, development, and demonstration.

13
 14 **2.3.5 Other Alternatives**

15
 16 As discussed in Section 2.3.1, various electric power generating technologies can be employed
 17 to replace the power provided by a nuclear power plant. The preceding sections have identified
 18 those technologies that the NRC considers to be viable candidates as alternatives. However,
 19 as suggested in Section 2.3.1, in addition to these technological options, alternatives of an
 20 administrative nature also exist. Two such alternatives that the NRC believes are the most
 21 likely candidates for consideration are purchased power from within or outside of the region, as
 22 well as conservation and energy efficiency measures (collectively, part of a range of demand-
 23 side management measures).

24
 25 *Purchased Power*

26
 27 Bulk electricity purchases currently take place within geographic regions established by the
 28 North American Electric Reliability Corporation (NERC), the authorized Electric Reliability
 29 Organization (ERO) for the United States. However, interconnections exist between NERC
 30 regions that allow for power exchanges between the regions when necessary to satisfy short-
 31 term demand. The NRC recognizes the possibility that replacement power may be imported
 32 from outside a nuclear power plant's region. In most instances, importing power from distant
 33 generating sources would have little or no measurable environmental impact in the vicinity of
 34 the nuclear power plant; however it could cause environmental impacts where the power is
 35 generated. Importing power from outside of the region is one of many sources of replacement
 36 power.

37
 38 Many factors influence power purchasing decisions, with respect to both technical feasibility and
 39 cost. The existing transmission grid may not support every possible power transfer agreement.
 40 Incremental power transfer capacities have been established between grid segments both
 41 within and across NERC regions, and modest amounts of power routinely transfer across those

Alternatives Including the Proposed Action

1 points. However, those capabilities were established to ensure overall grid stability and
2 reliability under both routine and non-routine conditions and would not be compromised to
3 support a power purchase agreement even though some transfer capacities are in the
4 thousands of megawatts.

5
6 Long-term transfers of utility-scale power would require modification of one or more existing
7 transmission grid segments (as well as modifications to substations and power synchronization
8 equipment) and could require construction of new transmission line segments, even when the
9 power transfer occurs between utilities within the same NERC region. The more geographically
10 distant the exporting source, the greater the likelihood that new or modified interconnecting
11 transmission line segments would be necessary. Power purchase agreements would also be
12 used in emergency situations or to alleviate a capacity shortfall in the near term; however,
13 large-scale, long-term agreements would be less cost effective than other technological
14 options.

15 16 *Conservation and Energy Efficiency Measures (Demand-Side Management) Programs*

17
18 Conservation and energy efficiency programs have been in place since the passage of the
19 Public Utility Regulatory Act of 1978 (PURPA), which required utilities to offer programs that
20 resulted in increased conservation of electric energy and to identify and pursue load
21 management techniques. The need for alternative or replacement power can precipitate or
22 invigorate conservation and energy efficiency efforts designed to either reduce electricity
23 demand at the retail level or alter the shape of the electricity load. All such efforts are broadly
24 categorized as demand-side management. Conservation and energy efficiency measures may
25 be championed by the nuclear power plant operator, which may offer its customers incentives
26 to undertake power conservation actions or may provide materials or information that would
27 facilitate such actions.

28
29 Conservation and energy efficiency measures implemented by electric utilities are designed to
30 shape and modify customer electric power usage habits and/or alter load profiles.

31 Conservation and energy efficiency programs can take many forms and have widely different
32 return-on-investment schedules. Program objectives can include:

- 33
- 34 • Energy efficiency programs that reduce energy use primarily through the use of
35 technologically advanced devices and equipment for lighting (e.g., compact fluorescent
36 lamps), heating and cooling systems, electric power driven equipment, or advanced
37 building materials and construction techniques;
 - 38
39 • Peak load reduction programs aimed at reducing load at peak times by the use of
40 programs such as interruptible load tariffs, time-of-use rates, and direct load controls;
 - 41

- 1 • Increased flexibility in load shaping by programs that modify prices, real-time pricing,
2 and time-of-use rates for periods with hours that adjust to specific parameters such as
3 resource availability or changes in power costs; and
4
- 5 • Load-building programs that attempt to encourage expanded consumption of electricity
6 in off-peak hours
7

8 Data contained in the latest EIA power annual report (EIA 2007b) indicate that conservation and
9 energy efficiency programs have had a relatively stable impact on actual total peak load
10 production over the period 1995 through 2006.

11
12 EIA data show that historically, residential electricity consumers have been responsible for the
13 majority of peak load reductions achieved by conservation and energy efficiency programs.
14 However, participation in most conservation programs is voluntary, and the existence of a
15 program does not guarantee that reductions in electricity demand would occur.

16
17 Conservation and energy efficiency programs could reduce overall environmental impacts
18 associated with energy production. Historically, due to modest levels of participation
19 nationwide, the NRC concludes it is unlikely that conservation and energy efficiency programs
20 would generate sufficient participation needed to replace the power from a nuclear reactor.
21 Consequently, conservation and energy efficiency programs are not considered to be viable
22 alternatives by themselves, but could play an important role in a combination of alternative
23 power strategies.
24

25 **2.4 Comparison of Alternatives**

26
27 This section provides a summary comparison of the environmental impacts of the proposed
28 action and alternatives. Tables 2.4-1 through 2.4-5 provide an overview of the findings of the
29 impact analyses (presented in Chapter 4) for the proposed action and alternatives, including the
30 No-Action Alternative, alternative generation technologies (fossil energy, nuclear energy, and
31 renewable energy), energy conservation, and power purchases. Impacts related to
32 construction (Table 2.4-1), operations (Table 2.4-2), postulated accidents (Table 2.4-3),
33 termination of nuclear power plant operations and decommissioning (Table 2.4-4), and the fuel
34 cycle (Table 2.4-5) are provided. In each of these tables, important aspects of each alternative
35 that serve as the basis of the assessment are identified as well as the magnitude of the
36 anticipated impact in each resource area. Impacts are evaluated and compared in a general
37 fashion. More detailed analyses incorporating relevant site-specific factors will be provided in
38 each plant-specific SEIS.
39

Alternatives Including the Proposed Action

1 The impacts of renewing the operating license of a nuclear power plant are comparable to the
2 impacts of energy alternatives. Replacement power alternatives would require the construction
3 of a new power plant or modification of the electric transmission grid. Each plant-specific SEIS
4 must analyze the impacts of the proposed action (license renewal) as well as alternatives. The
5 new power plants would also have operational impacts. Conversely, license renewal does not
6 require major construction and operational impacts would not change beyond what is currently
7 being experienced. Other alternatives that would not have construction or operational impacts
8 include conservation and energy efficiency (demand-side management), delayed retirement,
9 repowering, and purchased power.

10
11 Operational impacts of license renewal are comparable to replacement power alternatives and
12 some renewable alternatives in some resource areas (socioeconomics), but quite different in
13 other resource areas (air emissions, fuel cycle, land use, and water consumption). Renewable
14 energy alternatives (wind, ocean wave, and ocean current alternatives) have very few
15 operational impacts, while others (biomass combustion and conventional hydropower) can have
16 considerable impacts. Some renewable energy alternatives (wind and solar) have relatively low
17 but regionally variable capacity factors.

18
19 The proposed action and alternatives differ in other respects, including the consequences of
20 accidents. The proposed action and new nuclear energy alternatives all may have low-
21 probability but potentially high-consequence accidents in comparison to non-nuclear
22 alternatives.

23
24 Termination of nuclear power plant operations and decommissioning impacts at existing nuclear
25 plant sites would eventually occur regardless of a decision to renew their licenses. In this
26 analysis, those impacts are not attributed to the proposed action, and the effects of the
27 proposed action on the impacts from the termination of nuclear power plant operations and
28 decommissioning are small in all resource areas. Because this analysis is intended to
29 demonstrate the impacts of the full life cycle of any alternative, termination of
30 plant operations and decommissioning impacts of other alternatives are considered.
31 Decommissioning of an alternative nuclear reactor would be addressed by a separate licensing
32 decision, and an associated NEPA assessment as would be the case for decommissioning of
33 the reactor for which license renewal is under consideration.

34
35 Fuel cycle impacts have been evaluated for license renewal and were found to be small for all
36 resource areas. Other alternatives would have larger fuel cycle impacts mostly associated with
37 land disturbance at extraction sites or no impacts for alternatives such as wind, wave, current,
38 or solar alternatives that do not have fuel cycles.

39

Table 2.4-1. Impacts of Construction Under the Proposed Action and Alternatives

Resource Area	Proposed Action ^(b)	No-Action Alternative ^(c)	Assessment Basis and Impact Magnitude ^(a)				
			Fossil Energy Alternatives	Nuclear Energy Alternatives	Renewable Energy Alternatives	Demand-Side Management	Power Purchases
General	Only minor construction projects are associated with the proposed action. Original plant construction is not part of the proposed action.	No construction at the plant sites would occur if license renewal is denied. Construction could occur in other areas if new power plants are needed to replace lost capacity.	Major construction projects would be required to build replacement fossil, nuclear, or renewable energy generation capacity. Impacts would vary according to the specific alternative technology selected and site-specific resource conditions that would be reviewed under separate National Environmental Policy Act of 1969 (NEPA) assessments. Impacts at brownfield sites would be smaller than at greenfield sites. Power may also be replaced by a portfolio of alternative technologies; in such cases, impacts would be additive, occurring at each facility commensurate with the technology and the percentage of replacement power it provides.			No construction would be associated with energy conservation programs implemented to offset lost generation capacity.	No construction would occur if available excess capacity is sufficient to offset losses. Construction could occur in those instances where modification to the transmission grid was required to bring the imported power to the load centers affected by reactor retirement.

(a) Impact magnitudes are defined in the text of Section 2.1.

(b) Refer to Table 2.1-1 for a more detailed presentation of the impacts of construction under the proposed action. These impacts are discussed in detail in Chapter 4.

(c) Refer to Section 4.1.3 for a discussion of the impacts of the No-Action Alternative.

Table 2.4-2. Impacts of Operations Under the Proposed Action and Alternatives

Resource Area	Proposed Action ^(b)	No-Action Alternative ^(c)	Assessment Basis and Impact Magnitude ^(a)				
			Fossil Energy Alternatives	Nuclear Energy Alternatives	Renewable Energy Alternatives	Demand-Side Management	Power Purchases
General	Continued operations under the proposed action would be comparable to what has occurred during the current license term.	Termination of plant operations would occur sooner than under the proposed action. After plant shutdown, some systems would remain in operation but at reduced levels. Operational impacts could occur in other areas if new power plants are needed to replace lost capacity.	Operation of a new fossil energy, nuclear, or renewable energy facility would introduce new impacts to the facility site and vicinity. Impacts would vary according to site-specific resource conditions that would be reviewed under separate NEPA assessments. If lost power capacity is replaced with a portfolio of alternatives, impacts would be additive, occurring at each of the facilities within the portfolio based on the nature of the technology employed and commensurate with the amount of power produced. Impacts at brownfield sites may be less than at greenfield sites.			No new operational impacts are anticipated to result from energy conservation programs implemented to offset lost generation capacity.	Impacts would occur in areas where purchased power is produced. Impact magnitude would be incremental and reflective of the increased amount of power being produced.
			Fossil energy alternatives would have similar operational impacts on the proposed action, nuclear, and some renewable alternatives (e.g., biomass), but would produce more air emissions.	Nuclear energy alternatives would have similar operational impacts on fossil and some renewable technologies, but would produce fewer air emissions than fossil and biomass technologies.	Renewable technologies differ greatly in terms of operational impacts.		

(a) Impact magnitudes are defined in the text of Section 2.1.
 (b) Refer to Table 2.1-1 for a more detailed presentation of the impacts of operations under the proposed action. These impacts are discussed in detail in Chapter 4.
 (c) Refer to Section 4.1.3 for a discussion of the impacts of the No-Action Alternative.

Table 2.4-3. Impacts of Postulated Accidents Under the Proposed Action and Alternatives

Resource Area	Proposed Action ^(b)	No-Action Alternative ^(c)	Assessment Basis and Impact Magnitude ^(a)				
			Fossil Energy Alternatives	Nuclear Energy Alternatives	Renewable Energy Alternatives	Demand-Side Management	Power Purchases
General	Postulated accidents associated with continued operations under the license renewal term include design-basis accidents and severe accidents. The impacts presented take into consideration the low probability of an accident occurring. Design-basis accidents have a small impact. Severe accidents could have moderate or large consequences.	Plant shutdown would occur sooner than under the proposed action. A reduction in accident risk would also occur sooner.	Accidents associated with fossil energy facilities would have short-term, localized effects.	Same as proposed action.	Accidents associated with biomass facilities would be comparable to those of fossil energy facilities. Accidents associated with hydropower (e.g., dam collapse) could have farther-reaching effects. Accidents associated with other renewable technologies would be inconsequential.	No accidents are associated with energy conservation.	Impacts would occur in areas where purchased power is produced. Nature and magnitude of the impact would depend on the technology used to produce the power and characteristics of the plant site. Because existing facilities would be used, little change in impact would be expected.

(a) Impact magnitudes are defined in the text of Section 2.1.

(b) Refer to Table 2.1-1 for a more detailed presentation of the impacts of accidents under the proposed action. These impacts are discussed in detail in Section 4.9.1.2.

(c) Refer to Section 4.1.3 for a discussion of the impacts of the No-Action Alternative.

Table 2.4-4. Impacts of Termination of Nuclear Power Plant Operations and Decommissioning Under the Proposed Action and Alternatives

Resource Area	Proposed Action ^(b)	No-Action Alternative ^(c)	Assessment Basis and Impact Magnitude ^(a)				
			Fossil Energy Alternatives	Nuclear Energy Alternative	Renewable Energy Alternatives	Demand-Side Management	Power Purchases
General	Termination of plant operations and decommissioning eventually would occur regardless of implementation of the proposed action. The proposed action would not contribute substantially to the impacts from the termination of plant operations and decommissioning.	The no-action alternative would not contribute to the impacts of termination of plant operations and decommissioning. Impacts would occur in other areas if new power plants are needed to replace lost capacity.	Termination of plant operations and decommissioning of a fossil energy, nuclear, or renewable energy facility would result in short-term impacts during facility dismantlement and longer-term waste management impacts. Impacts would vary according to site-specific resource conditions that would be reviewed under separate NEPA assessments. Analysis assumes that dams would remain in place for flood control after hydroelectric power generation ceases. Impacts at brownfield sites may be less than at greenfield sites.			No termination of operations and decommissioning impacts are anticipated to result from DSM programs implemented to offset lost generation capacity.	Because existing facilities would be used to produce purchased power, no termination of operations and decommissioning impacts would be associated with this alternative.

(a) Impact magnitudes are defined in the text of Section 2.1.
 (b) Refer to Table 2.1-1 for a more detailed presentation of the impacts of decommissioning under the proposed action. These impacts are discussed in detail in Section 4.12.2.
 (c) Refer to Section 4.1.3 for a discussion of the impacts of the No-Action Alternative.

Table 2.4-5. Impacts of the Fuel Cycle Under the Proposed Action and Alternatives

Resource Area	Assessment Basis and Impact Magnitude ^(a)						
	Proposed Action ^(b)	No-Action Alternative ^(c)	Fossil Energy Alternatives	Nuclear Energy Alternative	Renewable Energy Alternatives	Energy Conservation	Power Purchases
General	During the license renewal term, the proposed action would result in the need for continued mining and milling of uranium; fuel fabrication, reprocessing of spent fuel (if approved); and storage, transport, and disposal of spent fuel and other wastes.	The no-action alternative would result in a reduced need for nuclear fuel and a reduction in impacts associated with the uranium fuel cycle. Impacts associated with other fuel cycle(s) would occur if new power plants are needed to replace lost capacity.	The fuel cycle of fossil energy alternatives includes the extraction of coal (mining) or natural gas (pumping); transport of extracted fuel; and storage, transport, and disposal of combustion waste. Impacts would depend on characteristics of extraction sites.	Same as the proposed action	Of renewables, only biomass technologies have a fuel cycle per se. Biomass projects would have impacts associated with producing and transporting biomass fuel and storage and disposal of combustion waste. Impacts would depend on characteristics of areas used to produce fuel.	There is no fuel cycle associated with energy conservation.	The fuel cycle associated with power purchases would depend on the mix of plants that are used to produce purchased power.

(a) Impact magnitudes are defined in the text of this section.

(b) Refer to Table 2.1-1 for a more detailed presentation of the impacts of operations under the proposed action. These impacts are discussed in detail in Section 4.12.1.

(c) Refer to Section 4.1.3 for a discussion of the impacts of the No-Action Alternative.

2.5 References

- 10 CFR Part 20. *Code of Federal Regulations*, Title 10, *Energy*, Part 20, “Standards for Protection Against Radiation.”
- 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions.”
- 10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, “Requirements for Renewal of Operating Licenses for Nuclear Power Plants.”
- 40 CFR Part 1508. *Code of Federal Regulations*, Title 40, *Energy*, Part 1508, *Protection of Environment*, “Terminology and Index.”
- Electric Power Research Institute and Commission for Environmental Cooperation (EPRI and CEC). 2003. *Potential Health and Environmental Impacts Associated with Manufacture and Use of Photovoltaic Cells, Final Report*. Report 1000095, Prepared by Tetra Tech, Inc., Lafayette, California, for EPRI, Palo Alto, California, and CEC, Sacramento, California. (November). Available URL: http://www.energy.ca.gov/pier/final_project_reports/500-04-053.html (Accessed October 26, 2007).
- Energy Information Administration (EIA). 2007a. “Annual Energy Outlook 2007 with Projections to 2030.” DOE/EIA-0383(2007). Washington, DC. Available URL: [http://tonto.eia.doe.gov/FTP/ROOT/forecasting/0383\(2007\).pdf](http://tonto.eia.doe.gov/FTP/ROOT/forecasting/0383(2007).pdf). Accessed March 16, 2007.
- Energy Information Administration (EIA). 2007b. *Electric Power Annual 2006*. DOE/EIA-0348(2006), U.S. Department of Energy, Washington, D.C. (November). Available URL: http://www.eia.doe.gov/cneaf/electricity/epa/epa_sum.html (Accessed December 6, 2007).
- Minerals Management Service (MMS). 2007. *Programmatic Environmental Impact Statement for Alternative Energy Development and Production and Alternate Use of Facilities on the Outer Continental Shelf*, OCS EIS/EA MMS 2007-046, U.S. Department of Interior, Washington, D.C. (October). Available URL: <http://ocsenergy.anl.gov/news/index.cfm> (Accessed November 8, 2007).
- National Renewable Energy Laboratory (NREL). 2006. *Power Technologies Energy Data Book, Fourth Edition*. Technical Report NREL/TP-620-39728, U.S. Department of Energy, Golden, Colorado. (August). Available URL: <http://www.nrel.gov/docs/fy06osti/39728.pdf> (Accessed October 18, 2007).

Alternatives Including the Proposed Action

- 1 Office of Energy Efficiency and Renewable Energy (EERE). 2007. *Information Resources:*
2 *States with Renewable Portfolio Standards*. U.S. Department of Energy, Washington, D.C.
3 (June). Available URL: http://www.eere.energy.gov/states/maps/renewable_portfolio_states.cfm#chart
4 (Accessed November 14, 2007).
5
- 6 Union of Concerned Scientists (UCS). 2007. *Clean Energy: Environmental Impacts of*
7 *Renewable Energy Technologies*. Available URL: http://www.ususa.org/clean_energy/renewable_energy_basics/
8 (Accessed December 17, 2007).
9
- 10 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*
11 *for License Renewal of Nuclear Plants*. NUREG-1437, Vols. 1 and 2, Office of Nuclear Reactor
12 Regulation, Washington, D.C.
13
- 14 U.S. Nuclear Regulatory Commission (NRC). 2002a. *Generic Environmental Impact Statement*
15 *on Decommissioning of Nuclear Facilities, Supplement 1, Regarding the Decommissioning of*
16 *Nuclear Power Reactors*. NUREG-0586, Supplement 1, Vols. 1 and 2, Office of Nuclear
17 Reactor Regulation, Washington, D.C. (November 2002)
18
- 19 U.S. Nuclear Regulatory Commission (NRC). 2002b. *Consolidated NMSS Decommissioning*
20 *Guidance*. NUREG-1757, Vols. 1 and 2, Washington, D.C.

3. Affected Environment

For purposes of the evaluation in this GEIS revision, the “affected environment” is the environment that currently exists at and around operating U.S. commercial nuclear power plants. Because existing conditions are at least partially the result of past construction and operations at the plants, the impacts of these past and ongoing impacts and how they have shaped the environment are summarized here. The impacts of license renewal that are presented in Section 4 are incremental to these baseline conditions, which include the effects of past and present actions at the plants.

3.1 Description of Nuclear Power Plant Facilities and Operations

3.1.1 External Appearance and Settings

Nuclear power plants contain a number of buildings or structures. Among them are containment or reactor building(s), turbine building(s), auxiliary buildings, vent stacks, meteorological tower(s), and cooling systems, particularly cooling towers. A plant site layout also includes large parking areas, security fencing, switchyards, water intake and discharge facilities, and transmission lines (see Section 3.1.6). While reactor, turbine, and auxiliary buildings are often clad or painted in colors that are intended to reduce or mitigate their visual presence, the heights of many of the structures, coupled with red and/or white safety lights, make plants visible from many directions. Typical heights of plant facilities are as follows: reactor buildings are 300 ft (90 m), turbine buildings are 100 ft (30 m), stacks are 300 ft (90 m), meteorological towers are 200 ft (60 m), natural-draft cooling towers are higher than 500 ft

Contents of Chapter 3

- Current nuclear power plant facilities and operations (Section 3.1)
- Existing conditions at operating nuclear power plants (including the impacts of past construction and operational effects) in the following environmental resource areas:
 - Land use and visual resources (Section 3.2)
 - Meteorology, air quality, and noise (Section 3.3)
 - Soils, geology, and seismology (Section 3.4)
 - Hydrology (surface water and groundwater) (Section 3.5)
 - Ecology (Section 3.6)
 - Historic and cultural resources (Section 3.7)
 - Socioeconomics (Section 3.8)
 - Human health (Section 3.9)
 - Environmental justice (Section 3.10)
 - Waste management and pollution prevention (Section 3.11)

Affected Environment

1 (150 m), and mechanical-draft cooling towers are 100 ft (30 m) tall. In addition, condensation
2 from cooling towers is generally visible for many miles. Transmission line towers are between
3 70 ft (20 m) and 170 ft (50 m) in height, depending on the voltage being carried.

4
5 There are two types of power reactors used in the United States – boiling water reactors
6 (BWRs) and pressurized water reactors (PWRs). All nuclear power plant sites are generally
7 similar in terms of the types of facilities they contain. All plant sites contain a nuclear steam
8 supply system. In addition, there are a number of common structures necessary for plant
9 operation. However, the layout of buildings and structures varies considerably among the sites.
10 For example, control rooms may be located in the auxiliary building, in a separate control
11 building, or in a radwaste and control building. The following list describes typical structures
12 located on most sites.

- 13
14 • Containment or reactor building. The containment or reactor building in a PWR is a
15 massive concrete or steel structure that houses the reactor vessel, reactor coolant
16 piping and pumps, steam generators, pressurizer, pumps, and associated piping. The
17 reactor building structure of a BWR generally includes a containment structure and a
18 shield building. The reactor containment building is a massive concrete or steel
19 structure that houses the reactor vessel, the reactor coolant piping and pumps, and the
20 suppression pool. It is located inside a somewhat less substantive structure called the
21 shield building. The shield building for a BWR also generally contains the spent fuel
22 pool and the new fuel pool.

23
24 The reactor containment building for both PWRs and BWRs is designed to withstand
25 natural disasters, such as tornados, hurricanes, and earthquakes. The containment
26 building's ability to withstand such events and to contain the effects of accidents initiated
27 by system failures constitutes the principal protection against releasing radioactive
28 material to the environment.

- 29
30 • Fuel building. For PWRs, the fuel building has a fuel pool that is used to store and
31 service spent fuel and prepare new fuel for insertion into the reactor. This building is
32 connected to the reactor containment building by a transfer tube or channel that is used
33 to move new fuel into the reactor and move spent fuel out of the reactor for storage.
34
35 • Turbine building. The turbine building houses the turbine generators, condenser,
36 feedwater heaters, condensate and feedwater pumps, waste-heat rejection system,
37 pumps, and equipment that support those systems. In BWRs, primary coolant is
38 circulated through these systems, thereby causing them to become slightly
39 contaminated. In PWRs, primary coolant is not circulated through the turbine building
40 systems. However, it is not unusual for portions of the turbine building to become mildly

1 contaminated because of leaks from the primary system into the secondary side during
2 power generation at PWRs.

- 3
- 4 • Auxiliary buildings. Auxiliary buildings house support systems, such as the ventilation
5 system, emergency core cooling system, laundry facilities, water treatment system, and
6 waste treatment system. An auxiliary building may also contain the emergency diesel
7 generators and, in some PWRs, the fuel storage facility. The facility's control room is
8 often located in the auxiliary building.
9
 - 10 • Diesel generator building. Often a separate building houses the emergency diesel
11 generators if they are not located in the auxiliary building. The emergency diesel
12 generators do not become contaminated or activated.
13
 - 14 • Pump houses. Various pump houses for circulating water, standby service water, or
15 makeup water may be onsite.
16
 - 17 • Cooling towers. Cooling towers are structures designed to remove excess heat from the
18 condenser without dumping the heat directly into water bodies, such as lakes or rivers.
19 There are two principal types of cooling towers: mechanical draft towers and natural
20 draft towers. Most nuclear plants that have once-through cooling do not have cooling
21 towers associated with them. However, five facilities with once-through cooling also
22 have cooling towers that are used to reduce the temperature of the water before it is
23 released to the environment.
24
 - 25 • Radwaste facilities. Radioactive waste facilities may be contained in an auxiliary
26 building or located in a separate solid radwaste building. For example, the radwaste
27 storage facility may be a separate building.
28
 - 29 • Ventilation stack. Many older nuclear power plants, particularly BWRs, have ventilation
30 stacks to discharge gaseous waste effluents and ventilation air directly to the outside.
31 These stacks can be 300 ft (90 m) tall or higher and contain monitoring systems to
32 ensure that radioactive gaseous discharges are below fixed release limits. Radioactive
33 gaseous effluents are treated and processed before being discharged out the stack.
34
 - 35 • Switchyard and transmission lines. Plant sites also typically contain a large switchyard,
36 where the electric voltage is stepped up and fed into the regional power distribution
37 system. Electricity generated at the plant is carried off the site by transmission lines.
38 Only those transmission lines that connect the plant to the switchyard are considered
39 within the scope of this review. The remaining lines that would remain energized
40 regardless of a decision regarding license renewal are considered outside of the scope
41 of this GEIS review.

Affected Environment

- 1 • Administrative, training, and security buildings. Normally, the administrative, training,
2 and security buildings are located outside the radiation protection zones; no radiological
3 contamination is present; and radiation exposures are at general background levels.
4
- 5 • Independent spent fuel storage installations (ISFSIs). An ISFSI is designed and
6 constructed for the interim storage of spent nuclear fuel and other radioactive materials
7 associated with spent fuel storage. ISFSIs may be located at the site of a nuclear power
8 plant or at another location. The most common design for an ISFSI, at this time, is a
9 concrete pad with dry casks containing spent fuel bundles. ISFSIs are used by
10 operating plants that require increased spent fuel storage capability because their spent
11 fuel pools have reached capacity (see Section 3.11.1.2).
12

13 Nuclear power plant site areas range from 84 ac (34 ha) to 30,000 ac (12,000 ha), with most
14 sites encompassing 500 to 2000 ac (200 to 800 ha). Larger land-use areas are associated with
15 plant cooling systems that include reservoirs, artificial lakes, and buffer areas.
16

17 Nuclear power plant sites are located in a range of political jurisdictions, including towns,
18 townships, service districts, counties, parishes, and States. At more than 50 percent of the
19 sites, the population density within a 50-mi (80 km) radius is fewer than 200 persons per square
20 mile (77 persons per square kilometer), and at more than 80 percent of the sites, the density
21 within 50 mi (80 km) is fewer than 500 persons per square mile (193 persons per square
22 kilometer). Within the 50-mi (80-km) radius, State, Federal, and Native American lands are
23 present to various extents. Typically, nuclear plant sites and their surrounding areas consist of
24 flat to rolling countryside in wooded or agricultural areas. See Appendix C for summary
25 descriptions of the characteristics of nuclear power plant sites and their surroundings.
26

27 **3.1.2 Nuclear Reactor Systems**

28
29 In the United States, all of the currently operating reactors used for commercial power
30 generation are conventional (thermal) light water reactors (LWRs) that use water as a
31 moderator and coolant. The two types of LWRs are PWRs and BWRs. Of the 104 operating
32 LWRs, 69 are PWRs and 35 are BWRs (Figure 3.1-1 and Table 3.1-1). They are located at
33 65 sites in 31 States (NRC 2007a). Some of the reactors have undergone power uprates
34 increasing their power levels. Uprate information is incorporated into Table 3.1-1, and other
35 reactors are likely to undergo similar power uprates in the future.
36

37 The nuclear fuel used in both types of reactors is uranium enriched to 2 to 5 percent in the
38 uranium-235 isotope. The fuel is in the form of cylindrical uranium dioxide (UO₂) pellets,
39 approximately 0.4 in. (1 cm) in diameter and 0.4 to 0.6 in. (1 to 1.5 cm) in height. The fuel
40 pellets are stacked and sealed inside a hollow cylindrical fuel rod made of zircaloy, an alloy of



GEIS01

Figure 3.1-1. Operating Commercial Nuclear Power Plants in the United States

Table 3.1-1. Characteristics of Operating U.S. Commercial Nuclear Power Plants^(a)

Plant	Unit	Year Operating License Granted	Year License Expires	Net Capacity [MW(e)]	Reactor Type ^(b)	Condenser Flow Rate (10 ³ gpm)	Total Site Area (acres)	Nearest City	2000 Population within 50 mi
Arkansas Nuclear One	1	1974	2034	836	PWR	657	1164	Little Rock, AR	267,664
	2	1978	2038	988	PWR	16			
Beaver Valley Power Station	1	1976	2016	849	PWR	480	453	Pittsburgh, PA	3,274,451
	2	1987	2027	832	PWR				
Braidwood Station	1	1987	2027	1178	PWR	730	4457	Joliet, IL	4,272,003
	2	1988	2028	1152	PWR				
Browns Ferry Nuclear Plant	1	1973	2033	1065	BWR	734	840	Huntsville, AL	872,478
	2	1974	2034	1118	BWR				
	3	1976	2036	1114	BWR				
Brunswick Steam Electric Plant	1	1976	2036	938	BWR	675	1200	Wilmington, NC	361,872
	2	1974	2034	937	BWR				
Byron Station	1	1985	2025	1164	PWR	632	1398	Rockford, IL	1,300,282
	2	1987	2027	1136	PWR				
Callaway Plant	1	1984	2024	1190	PWR	530	5228	Columbia, MO	491,072
Calvert Cliffs Nuclear Power Plant	1	1974	2034	873	PWR	1200	2108	Washington, D.C.	3,919,397
	2	1976	2036	862	PWR				
Catawba Nuclear Station	1	1985	2045	1129	PWR	660	391	Charlotte, NC	2,041,465
	2	1986	2046	1129	PWR				
Clinton Power Station	1	1987	2027	1043	BWR	569	14,000	Decatur, IL	789,754
Columbia Generating Station	1	1984	2023	1131	BWR	550	1089	Spokane, WA	360,573
Comanche Peak Steam Electric Station	1	1989	2029	1150	PWR	1030	7669	Fort Worth, TX	1,431,094
	2	1993	2033	1150	PWR				
Cooper Nuclear Station	1	1974	2014	760	BWR	631	1251	Lincoln, NE	156,157
Crystal River Nuclear Power Plant	3	1977	2017	838	PWR	680	4700	Gainesville, FL	1,273,146
Donald C. Cook Nuclear Plant	1	1974	2034	1029	PWR	800	650	South Bend, IN	1,447,303
	2	1977	2037	1077	PWR				

Table 3.1-1. (cont.)

Plant	Unit	Year Operating License Granted	Year License Expires	Net Capacity [MW(e)]	Reactor Type ^(b)	Condenser Flow Rate (10 ³ gpm)	Total Site Area (acres)	Nearest City	2000 Population within 50 mi
Davis-Besse Nuclear Power Station	1	1977	2017	889	PWR	480	733	Toledo, OH	2,617,550
Diablo Canyon Power Plant	1	1984	2024	1122	PWR	863	750	Santa Barbara, CA	836,031
	2	1985	2025	1118	PWR				
Dresden Nuclear Power Station	2	1969	2029	867	BWR	940 (once-through); 630 (mechanical draft cooling tower)	2500	Joliet, IL	7,337,564
	3	1971	2031	867	BWR				
Duane Arnold Energy Center	1	1974	2014	581	BWR	290	500	Cedar Rapids, IA	613,736
Joseph M. Farley Nuclear Plant	1	1977	2037	851	PWR	635	1850	Columbus, GA	393,639
	2	1981	2041	860	PWR				
Enrico Fermi Atomic Power Plant	2	1985	2025	1122	BWR	837	1120	Detroit, MI	7,803,464
James A. FitzPatrick Nuclear Power Plant	1	1974	2014	852	BWR	353	702	Syracuse, NY	914,668
Fort Calhoun Station	1	1973	2033	478	PWR	360	660	Omaha, NE	852,717
R.E. Ginna Nuclear Power Plant		1969	2029	498	PWR	340	488	Rochester, NY	1,250,000
Grand Gulf Nuclear Station	1	1984	2024	1266	BWR	572	2100	Jackson, MS	357,525
Shearon Harris Nuclear Power Plant	1	1987	2027	900	PWR	483	10,744	Raleigh, NC	2,035,797
Edwin I. Hatch Nuclear Plant	1	1974	2034	876	BWR	556	2240	Savannah, GA	366,508
	2	1978	2038	883	BWR				
Hope Creek Generating Station	1	1986	2026	1061	BWR	552	740	Wilmington, DE	5,999,588

Table 3.1-1. (cont.)

Plant	Unit	Year Operating License Granted	Year License Expires	Net Capacity [MW(e)]	Reactor Type ^(b)	Condenser Flow Rate (10 ³ gpm)	Total Site Area (acres)	Nearest City	2000 Population within 50 mi
Indian Point Energy Center	2	1973	2013	1020	PWR	840	239	White Plains, NY	17,732,469
	3	1976	2016	1025	PWR				
Kewaunee Power Station		1973	2013	556	PWR	420	900	Green Bay, WI	1,585,415
LaSalle County Station	1	1982	2022	1118	BWR	645	3060	Joliet, IL	1,498,644
	2	1984	2024	1120	BWR				
Limerick Generating Station	1	1985	2025	1134	BWR	450	595	Reading, PA	7,651,537
	2	1990	2030	1134	BWR				
McGuire Nuclear Station	1	1981	2041	1100	PWR	675	577	Charlotte, NC	2,425,097
	2	1983	2043	1100	PWR				
Millstone Power Station	2	1975	2035	882	PWR	523	500	New Haven, CT	2,868,207
	3	1986	2046	1155	PWR	907			
Monticello Nuclear Generating Plant		1970	2030	572	BWR	292	1250	Minneapolis, MN	2,740,995
Nine Mile Point Nuclear Station	1	1968	2028	621	BWR	250	900	Syracuse, NY	914,668
	2	1987	2047	1140	BWR	580			
North Anna Power Station	1	1978	2038	924	PWR	940	1043	Richmond, VA	1,614,983
	2	1980	2040	910	PWR				
Oconee Nuclear Station	1	1973	2033	846	PWR	680	510	Greenville, S.C.	1,226,479
	2	1973	2033	846	PWR				
	3	1974	2034	846	PWR				
Oyster Creek Nuclear Generating Station		1969	2009	619	BWR	115	800	Atlantic City, PA	4,243,462
Palisades Nuclear Plant		1972	2032	778	PWR	98	432	Kalamazoo, MI	1,287,558
Palo Verde Nuclear Generating Station	1	1985	2025	1311	PWR	560	4050	Phoenix, AZ	1,781,095
	2	1986	2026	1314	PWR				
	3	1987	2027	1247	PWR				
Peach Bottom Atomic Power Station	2	1973	2033	1112	BWR	750	620	Lancaster, PA	5,270,600
	3	1974	2034	1112	BWR				

Table 3.1-1. (cont.)

Plant	Unit	Year Operating License Granted	Year License Expires	Net Capacity [MW(e)]	Reactor Type ^(b)	Condenser Flow Rate (10 ³ gpm)	Total Site Area (acres)	Nearest City	2000 Population within 50 mi
Perry Nuclear Power Plant	1	1986	2026	1231	BWR	545	1100	Euclid, OH	4,923,662
Pilgrim Nuclear Power Station	1	1972	2012	685	BWR	156	140	Boston, MA	4,629,116
Point Beach Nuclear Plant	1	1970	2030	512	PWR	350	1260	Green Bay, WI	1,622,052
	2	1972	2033	514	PWR				
Prairie Island Nuclear Generating Plant	1	1973	2013	551	PWR	294	560	Minneapolis, MN	2,731,953
	2	1974	2014	545	PWR				
Quad Cities Nuclear Power Station	1	1972	2032	867	BWR	970	817	Davenport, IA	656,527
	2	1972	2032	867	BWR				
River Bend Station	1	1985	2025	967	BWR	508	3300	Baton Rouge, LA	866,314
H.B. Robinson Steam Electric Plant	2	1970	2030	710	PWR	448	6020	Columbia, SC	809,582
St. Lucie Nuclear Plant	1	1976	2036	839	PWR	491	1130	West Palm Beach, FL	1,180,000
	2	1983	2043	839	PWR				
Salem Nuclear Generating Station	1	1976	2016	1174	PWR	1,100	700	Wilmington, DE	5,975,864
	2	1981	2021	1130	PWR				
San Onofre Nuclear Generating Station	2	1982	2022	1070	PWR	797	84	Oceanside, CA	12,404,757
	3	1983	2023	1080	PWR	797			
	1	1967	2007						
Seabrook Station	1	1990	2032	1244	PWR	399	889	Lawrence, MA	6,932,660
Sequoyah Nuclear Plant	1	1980	2020	1150	PWR	522	525	Chattanooga, TN	954,430
	2	1981	2021	1127	PWR				
South Texas Project Electric Generating Station	1	1988	2028	1280	PWR	907	12,350	Galveston, TX	402,902
	2	1989	2029	1280	PWR				
Virgil C. Summer Nuclear Station	1	1982	2042	966	PWR	485	2245	Columbia, SC	1,032,330
Surry Power Station	1	1972	2032	799	PWR	840	840	Newport News, VA	2,387,353
	2	1973	2033	799	PWR				

Table 3.1-1. (cont.)

Plant	Unit	Year Operating License Granted	Year License Expires	Net Capacity [MW(e)]	Reactor Type ^(b)	Condenser Flow Rate (10 ³ gpm)	Total Site Area (acres)	Nearest City	2000 Population within 50 mi
Susquehanna Steam Electric Station	1	1982	2022	1135	BWR	968	1173	Wilkes-Barre, PA	1,684,794
	2	1984	2024	1140	BWR				
Three Mile Island	1	1974	2014	786	PWR	430	814	Harrisburg, PA	2,466,679
Turkey Point Nuclear Plant	3	1972	2032	693	PWR	624	2400	Miami, FL	7,490,123
	4	1973	2033	693	PWR				
Vermont Yankee Nuclear Power Station	1	1973	2013	650	BWR	360	125	Holyoke, MA	1,513,282
Vogtle Electric Generating Plant	1	1987	2027	1152	PWR	510	3169	Augusta, GA	670,000
	2	1989	2029	1149	PWR				
Waterford Steam Electric Station	3	1985	2025	1152	PWR	975	3000	New Orleans, LA	2,072,270
Watts Bar Nuclear Plant	1	1996	2035	1121	PWR	410	1170	Chattanooga, TN	1,044,454
Wolf Creek Generating Station	1	1985	2025	1166	PWR	500	9818	Topeka, KS	176,301

(a) The 1996 GEIS included a number of nuclear plants that are not being considered for license renewal and are not included in this table. They include the following plants:
 Bellefonte: Never finished; mothballed in 1988.
 Big Rock: Shut down in 1997; decommissioning complete in August 2006. Stored spent fuel is still onsite.
 Haddam (Connecticut Yankee): Shut down in 1996; decommissioned in 2004. Stored spent fuel is still onsite.
 Maine Yankee: Closed in 1997; decommissioned in 2005. Stored spent fuel is still onsite.
 Millstone, Unit 1: Shut down in 1995; awaiting decontamination and dismantlement as part of decommissioning.
 Rancho Seco: Shut down in 1989; still undergoing decommissioning.
 Shoreham: Fully decommissioned in 1994; it never produced power.
 Trojan: Closed in 1992; decommissioning and demolition expected to be complete in 2008. Stored spent fuel is still onsite.
 Watts Bar, Unit 2: Construction halted in 1988, but approval to complete construction was approved in August 2007. Construction was to begin in 2007, with operation beginning in 2013.
 Yankee Rowe: Shut down in 1992; decommissioning completed in 2006.
 Zion: Shut down in 1998, has been placed in safe storage (SAFSTOR), and decommissioning will begin in 2013.

(b) PWR = pressurized-water reactor; BWR = boiling-water reactor.

1 zirconium. The fuel rods, also called fuel pins or fuel elements, are approximately 12 ft (3.6 m)
2 long. They are bundled into fuel assemblies that generally consist of 15 x 15 or 17 x 17 rods for
3 PWRs and 8 x 8 or 10 x 10 rods for BWRs. When new fuel is loaded into the reactors or spent
4 fuel is removed from reactors, the fuel is handled as intact assemblies. Similarly, when spent
5 fuel is stored onsite awaiting shipment offsite, the fuel assemblies remain intact.

6
7 Fission reactions that occur inside the fuel, primarily by the uranium-235 isotopes, are the
8 source of thermal energy generated in a nuclear reactor. This energy is transferred to the
9 coolant, which is ordinary water, circulating in the primary coolant system in LWRs. The vessel,
10 which encloses the reactor, is part of the primary coolant system.

11
12 In PWRs, water is heated to a high temperature under pressure inside the reactor
13 (Figure 3.1-2). The water is then pumped in the primary circulation loop to the steam
14 generator. Within the steam generator, water in the secondary circulation loop is converted to
15 steam that drives the turbines. The turbines turn the generator to produce electricity. The
16 steam leaving the turbines is condensed by water in the tertiary loop and returned to the steam
17 generator. The tertiary loop water flows to cooling towers where it is cooled by evaporation, or
18 it is discharged directly to a body of water, such as a river, lake, or other heat sink
19 (see Section 3.1.3). The tertiary loop is open to the atmosphere, but the primary and
20 secondary cooling loops are not.

21
22 BWRs generate steam directly within the reactor vessel (Figure 3.1-3). The steam passes
23 through moisture separators and steam dryers and then flows to the turbines. Because it
24 generates steam directly in the reactor vessel, the power generation system contains only two
25 heat transfer loops. The primary loop transports the steam from the reactor vessel directly to
26 the turbines, which generate electricity. The secondary coolant loop removes excess heat from
27 the primary loop in the condenser. From the condenser, the primary condensate proceeds into
28 the feedwater stage, and the secondary coolant loop removes the excess heat and discharges
29 it to the receiving water body. As is the case for PWRs, the coolant water from the condenser
30 is pumped to cooling towers or it is discharged directly to a water body.


31 32 **3.1.3 Cooling Water Systems**

33
34 The predominant use of water at a nuclear power plant is for removing excess heat generated
35 in the reactor. The volumetric flow rate of water used for condenser cooling is a function of
36 several factors, including the power rating of the plant and the increase in cooling water
37 temperature from the intake to the discharge. The larger the plant, the greater the quantity of
38 waste heat to be dissipated, and the greater the flow rate of cooling water required.

39
40 Table 3.1-2 shows some types of cooling systems used at the existing nuclear power plant
41 sites. There are two major types of cooling systems for operating plants: once-through cooling


Affected Environment

1 and closed-cycle cooling. In a once-through cooling system, circulating water for condenser
2 cooling is obtained from a nearby source of water, such as a lake or river, passed through the
3 condenser tubes, and returned at a higher temperature to the same water body (Figure 3.1-4a).
4

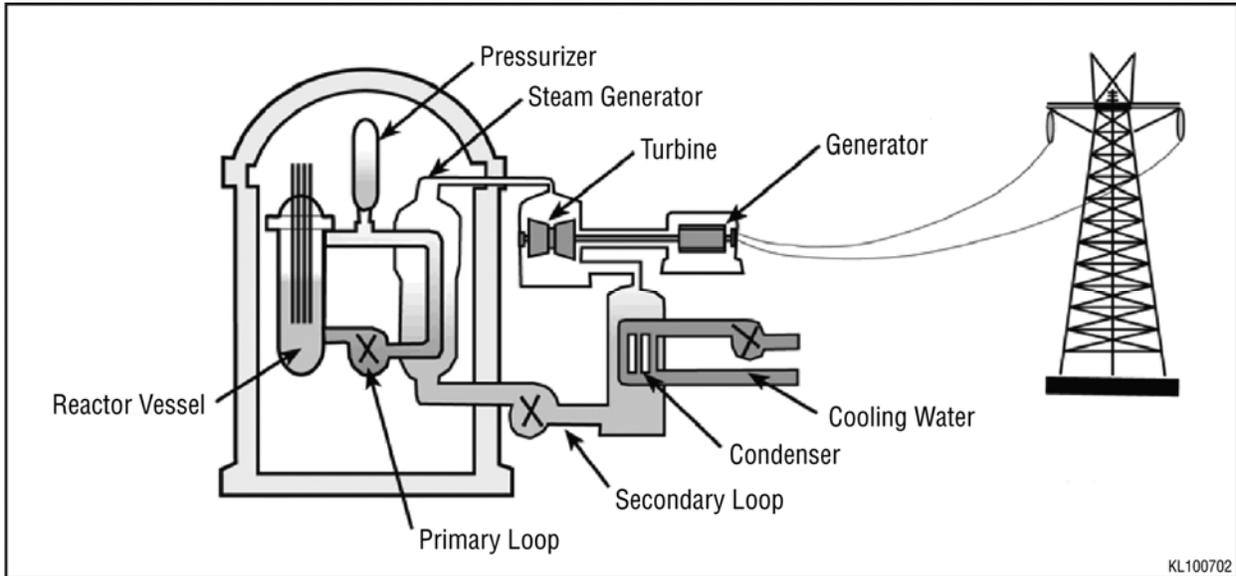

5
6
7
8

Figure 3.1-2. Pressurized Water Reactor (Source: NRC 2002a)

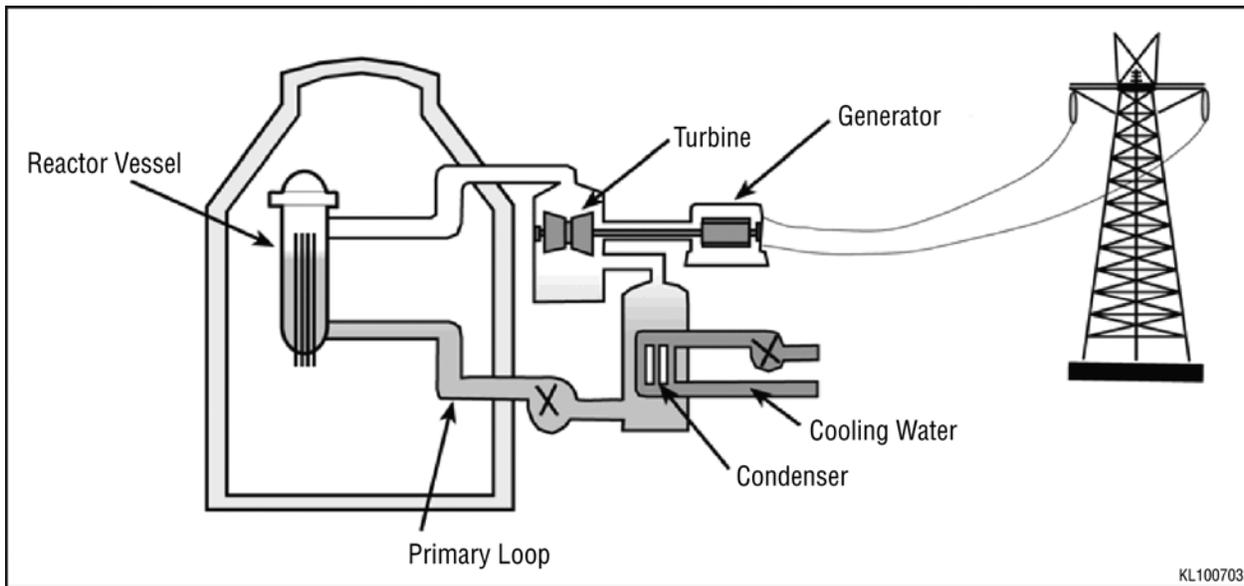

9
10
11
12

Figure 3.1-3. Boiling Water Reactor (Source: NRC 2002a)

1

Table 3.1-2. Types of Cooling Systems Used at U.S. Commercial Nuclear Power Plants

Plant	State	Cooling System	Cooling Water Source
Coastal or Estuarine Environment			
Diablo Canyon	California	Once-through	Pacific Ocean
San Onofre Nuclear	California	Once-through	Pacific Ocean
Millstone	Connecticut	Once-through	Long Island Sound
Crystal River	Florida	Once-through	Gulf of Mexico
St. Lucie	Florida	Once-through	Atlantic Ocean
Turkey Point	Florida	Cooling canal	Biscayne Bay
Calvert Cliffs	Maryland	Once-through	Chesapeake Bay
Pilgrim	Massachusetts	Once-through	Cape Cod Bay
Seabrook	New Hampshire	Once-through	Atlantic Ocean
Hope Creek	New Jersey	Natural draft cooling towers	Delaware River
Oyster Creek	New Jersey	Once-through	Barnegat Bay
Salem	New Jersey	Once-through	Delaware River
Indian Point	New York	Once-through	Hudson River
Brunswick	North Carolina	Once-through	Cape Fear River
South Texas	Texas	Closed-cycle cooling pond	Colorado River
Surry	Virginia	Once-through	James River
Great Lakes Environment			
D.C. Cook	Michigan	Once-through	Lake Michigan
Fermi	Michigan	Natural draft cooling towers and cooling pond	Lake Erie
Palisades	Michigan	Mechanical draft cooling towers	Lake Michigan
FitzPatrick	New York	Once-through	Lake Ontario
Ginna	New York	Once-through	Lake Ontario
Nine Mile Point	New York	Unit 1: Once-through Unit 2: Natural draft cooling towers	Lake Ontario
Davis-Besse	Ohio	Natural draft cooling towers	Lake Erie
Perry	Ohio	Natural draft cooling towers	Lake Erie
Kewaunee	Wisconsin	Once-through	Lake Michigan
Point Beach	Wisconsin	Once-through	Lake Michigan

Affected Environment

1

Table 3.1-2. (cont.)

Plant	State	Cooling System	Cooling Water Source
Freshwater Riverine or Impoundment Environment			
Browns Ferry	Alabama	Once-through (helper towers)	Tennessee River
Farley	Alabama	Mechanical draft cooling towers	Chattahoochee River
Palo Verde	Arizona	Mechanical draft cooling towers	Phoenix City Sewage
Arkansas	Arkansas	Unit 1: once-through Unit 2: natural draft cooling towers	Lake Dardanelle
Hatch	Georgia	Mechanical draft cooling towers	Altamaha River
Vogtle	Georgia	Natural draft cooling towers	Savannah River
Braidwood	Illinois	Cooling pond	Kankakee River
Byron	Illinois	Natural draft cooling towers	Rock River
Clinton	Illinois	Once-through (cooling pond)	Salt Creek
Dresden	Illinois	Closed-cycle and once-through (cooling canals, cooling pond, mechanical draft cooling towers)	Kankakee River
LaSalle	Illinois	Cooling pond	Illinois River
Quad Cities	Illinois	Once-through	Mississippi River
Duane Arnold	Iowa	Mechanical draft cooling towers	Cedar River
Wolf Creek	Kansas	Cooling pond	Coffey County Lake
River Bend	Louisiana	Mechanical draft cooling towers	Mississippi River
Waterford	Louisiana	Once-through	Mississippi River
Monticello	Minnesota	Once-through and mechanical draft cooling towers	Mississippi River
Prairie Island	Minnesota	Once-through and mechanical draft cooling towers	Mississippi River
Grand Gulf	Mississippi	Natural draft cooling towers	Mississippi River
Callaway	Missouri	Natural draft cooling towers	Missouri River
Cooper	Nebraska	Once-through	Missouri River
Fort Calhoun	Nebraska	Once-through	Missouri River
Harris	North Carolina	Natural draft cooling towers	Buckhorn Creek
McGuire	North Carolina	Once-through	Lake Norman
Beaver Valley	Pennsylvania	Natural draft cooling towers	Ohio River
Limerick	Pennsylvania	Natural draft cooling towers	Schuylkill River

Table 3.1-2. (cont.)

Plant	State	Cooling System	Cooling Water Source
Peach Bottom	Pennsylvania	Unit 2: Once-through Unit 3: Once-through (mechanical draft cooling towers)	Conowingo Pond
Susquehanna	Pennsylvania	Natural draft cooling towers	Susquehanna River
Three Mile Island	Pennsylvania	Natural draft cooling towers	Susquehanna River
Catawba	South Carolina	Mechanical draft cooling towers	Lake Wylie
Oconee	South Carolina	Once-through	Lake Keowee
H.B. Robinson	South Carolina	Once-through (cooling pond)	Lake Robinson
Summer	South Carolina	Once through (cooling pond)	Monticello Reservoir
Sequoyah	Tennessee	Once-through and natural draft cooling towers	Chickamauga Lake
Watts Bar	Tennessee	Natural draft cooling towers	Chickamauga Lake
Comanche Peak	Texas	Once-through	Squaw Creek Reservoir
Vermont Yankee	Vermont	Once-through and mechanical draft cooling towers	Connecticut River
North Anna	Virginia	Once-through	Lake Anna
Columbia	Washington	Mechanical draft cooling towers	Columbia River

1

2 Flow through the condenser for a 1000-MW(e) plant during operations is typically 250,000 to
3 900,000 gpm (16 to 57 m³/s) (NRC 1996). The waste heat is dissipated to the atmosphere
4 mainly by evaporation from the water body and, to a much smaller extent, by conduction,
5 convection, and thermal radiation loss.

6

7 In a closed-cycle system at an operating plant, the cooling water is recirculated through the
8 condenser after the waste heat is removed by dissipation to the atmosphere, usually by
9 circulating the water through large cooling towers constructed for that purpose (Figure 3.1-4b).
10 The average for makeup water withdrawals for a 1000-MW(e) plant during operations is
11 typically about 14,000 to 18,000 gpm (0.9 to 1.1 m³/s) (NRC 1996). Recirculating cooling
12 systems consist of natural draft or mechanical draft cooling towers, cooling ponds, lakes,
13 reservoirs, or canals. Because the predominant cooling mechanism associated with closed-
14 cycle systems is evaporation, much of the water used for cooling is consumed and is not
15 returned to the water source. Blowdown (water that is periodically rinsed from the cooling
16 system to remove impurities and sediment that may degrade performance) is typically released
17 to a receiving body of surface water next to the plant.

Affected Environment

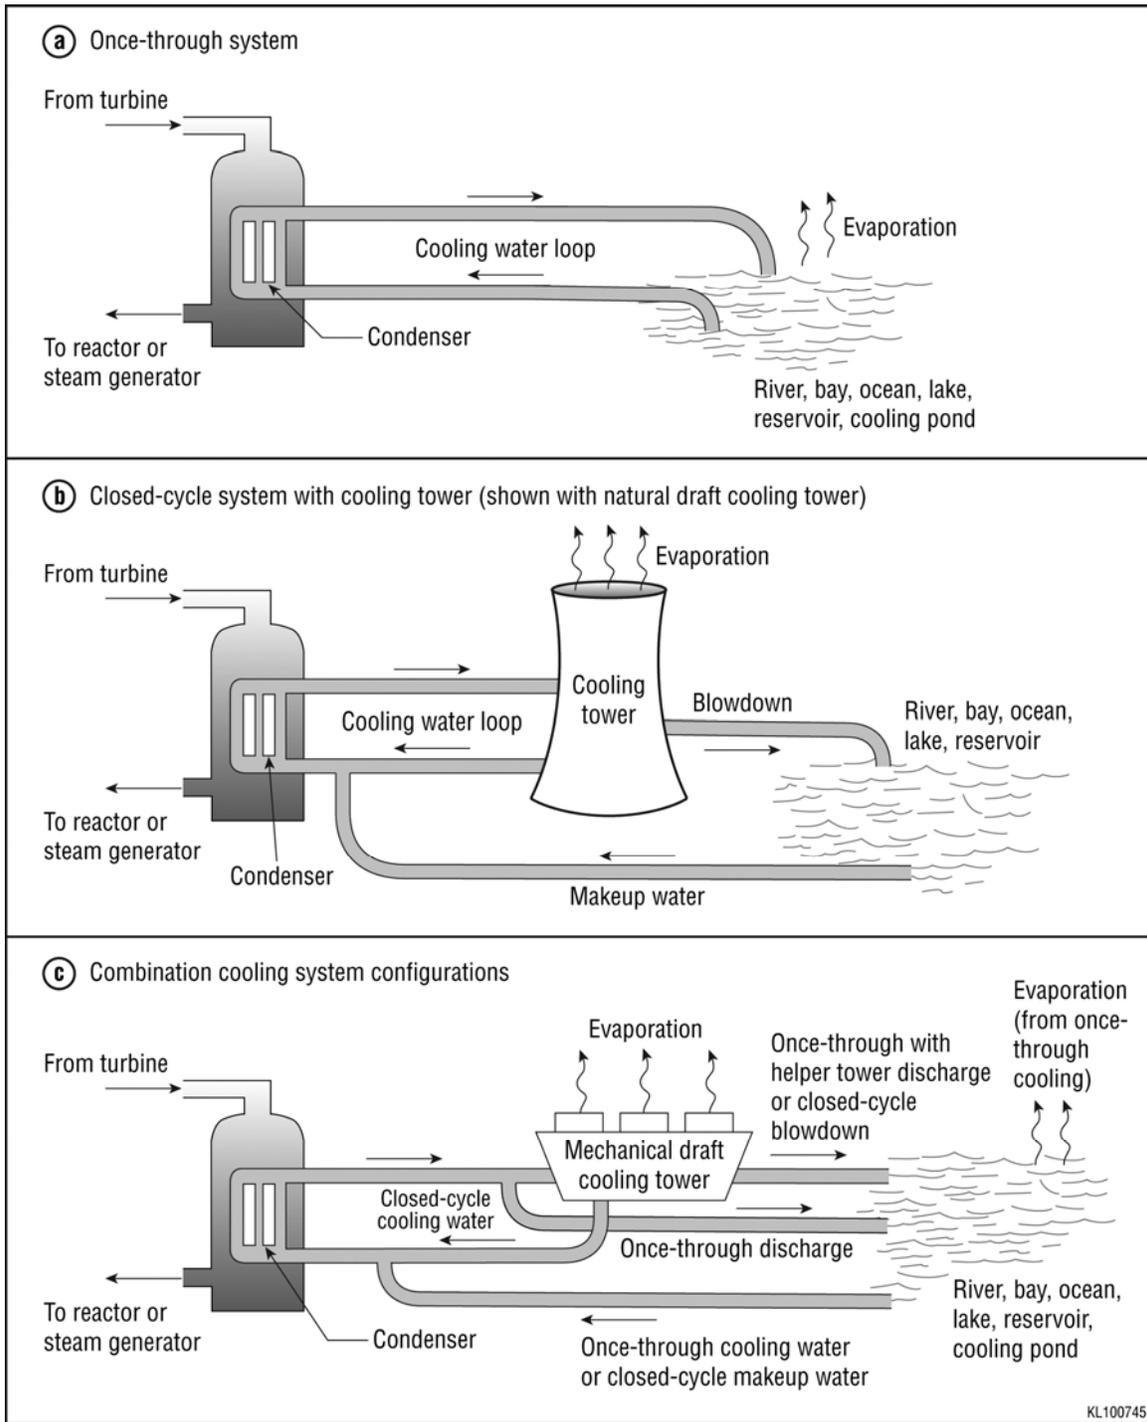


Figure 3.1-4. Schematic Diagrams of Nuclear Power Plant Cooling Systems

1
2
3

1 Several nuclear plants use combination cooling systems that may be used in different
2 configurations, especially during different times of the year (Figure 3.1-4c). Cooling towers may
3 be included in a once-through system to cool the effluent prior to release to the receiving body
4 of water. These are referred to as helper towers. Peach Bottom (NRC 2003d) has helper
5 mechanical draft cooling towers that can receive up to 60 percent of the heated discharge, with
6 the remainder of the water discharged as part of a traditional once-through system. Monticello
7 (NRC 2006f) uses once-through cooling in the winter but has mechanical draft cooling towers
8 for closed-cycle cooling in the summer. Dresden (NRC 2004a) is similar in that it relies on a
9 closed-cycle cooling pond in the winter but includes the use of helper mechanical draft cooling
10 towers in the summer. Browns Ferry (NRC 2005a) also uses mechanical draft cooling towers in
11 helper mode. Although closed-cycle recirculation of the cooled water is possible, the plant does
12 not expect to use this option. Vermont Yankee (NRC 2007f) is capable of operating in one of
13 three modes: once-through, combined, or completely closed. The mode of operation is
14 selected by the licensee to limit the thermal discharge to the Connecticut River to ensure
15 compliance with the National Pollutant Discharge Elimination System (NPDES) permit
16 requirements. In the combined mode, the plant operates both the closed cycle and the open
17 (once-through) cycle systems, with the proportion of water running through each system varying
18 depending on the temperature increase in the river water due to discharge from the plant.

19

20 All existing sites with two or three reactor units use the same cooling system for all units, except
21 for two sites: Arkansas Nuclear One in Arkansas and Nine Mile Point in New York. These two
22 sites use once-through cooling for one unit and closed-cycle for the other. Other cooling system
23 types might be added to existing sites if new units are constructed.

24

25 For each type of cooling system, the configurations of the water intake and discharge structures
26 vary to accommodate the source water body and minimize any impact to the aquatic
27 ecosystem. The intake structures generally are located along the shoreline of the body of water
28 and are equipped with fish-protection devices. The discharge structures are usually jets or
29 diffusers and designed to promote rapid mixing of the effluent stream with the receiving body of
30 water. Biocides and other chemicals used for corrosion control and other water treatment
31 purposes are mixed with the condenser cooling water and discharged from the system, with
32 limits on flow, concentrations, and thermal changes authorized by the States under the
33 appropriate NPDES permit.

34

35 In addition to removing heat from the reactor of an operating facility, cooling water is also
36 provided to the service water system and to the auxiliary cooling water system. Service water is
37 special-purpose water that may or may not be treated for use. The auxiliary cooling water
38 systems include emergency core cooling systems, the containment spray and cooling system,
39 the emergency feedwater system, the component cooling water system, and the spent fuel pool
40 water systems. The volumetric flow rate of water required for these systems is usually less
41 than 15 percent of the volume required for condenser cooling in once-through cooling. In

Affected Environment

1 closed-cycle cooling, the additional water needed is usually less than 5 percent of that needed
2 for condenser cooling (NRC 1996).

3
4 In addition to surface water sources, some nuclear power plants use groundwater as a source
5 for service, makeup, or potable water. Only Grand Gulf uses groundwater as a source of
6 makeup water to the condenser cooling system. This plant employs a Ranney well collection
7 system to draw groundwater from the Mississippi River alluvial aquifer.

8 9 **3.1.4 Radioactive Waste Management Systems**

10
11 During the fission process, a large inventory of radioactive fission products builds up within the
12 fuel. Virtually all of the fission products are contained within the fuel pellets. The fuel pellets are
13 enclosed in hollow metal rods (cladding), which are hermetically sealed to further prevent the
14 release of fission products. However, a small fraction of the fission products escape from the
15 fuel rods and contaminate the reactor coolant. The primary system coolant also has radioactive
16 contaminants as a result of neutron activation. The radioactivity in the reactor coolant is the
17 source of liquid, gaseous, and most of the solid radioactive wastes at LWRs. The following
18 sections describe the basic design and operation of PWR and BWR radioactive waste
19 treatment systems.

20 21 **3.1.4.1 Liquid Radioactive Waste**

22
23 Radionuclide contaminants in the primary coolant are the source of liquid radioactive waste in
24 LWRs. The specific sources of these wastes, the modes of collection and treatment, and the
25 types and quantities of liquid radioactive wastes released to the environment are similar in
26 many respects in BWRs and PWRs. Accordingly, the following discussion applies to both
27 BWRs and PWRs; distinctions are made only when important differences exist.

28
29 Liquid wastes resulting from LWR operation may be placed into the following categories: clean
30 wastes, dirty wastes, detergent wastes, turbine building floor-drain water, and steam generator
31 blowdown (PWRs only). Clean wastes include all liquid wastes with normally low conductivity
32 and variable radioactivity. They consist of reactor-grade water, which is amenable to
33 processing for reuse as reactor coolant makeup water. Clean wastes are collected from
34 equipment leaks and drains, certain valve and pump seal leaks from which water was not
35 collected in the reactor coolant drain tank, and other aerated leakage sources. Dirty wastes
36 include all liquid wastes with moderate conductivity and variable radioactivity that, after
37 processing, may be used as reactor coolant makeup water. Dirty wastes consist of liquid
38 wastes collected in the containment building sump, auxiliary building sumps and drains,
39 laboratory drains, sample station drains, and other floor drains. Detergent wastes consist
40 principally of laundry wastes and personnel and equipment decontamination wastes and
41 normally have low radioactivity. Turbine building floor-drain wastes usually have high

1 conductivity and a low radionuclide content. In PWRs, steam generator blowdown can have
2 relatively high concentrations of radionuclides, depending on the amount of primary-to-
3 secondary leakage. Following processing, the water may be reused or discharged.

4
5 Each of these sources of liquid wastes receives varying degrees and types of treatment before
6 being stored for reuse or discharged to the environment under the site NPDES permit. The
7 extent and types of treatment depend on the chemical content of the waste; to increase the
8 efficiency of waste processing, wastes with similar characteristics are batched before treatment.

9
10 Controls for limiting the release of radiological liquid effluents at each plant are described in the
11 facility's Offsite Dose Calculation Manual (ODCM). Controls are based on (1) concentrations of
12 radioactive materials in liquid effluents and projected dose and (2) dose commitments to a
13 member of the public. Concentrations of radioactive material that are allowed to be released
14 in liquid effluents to unrestricted areas are limited to the concentration specified in
15 10 CFR Part 20, Appendix B, Table 2.

16
17 The degree of processing, storing, and recycling of liquid radioactive waste has steadily
18 increased among operating plants. For example, extensive recycling of steam generator
19 blowdown in PWRs is now the typical mode of operation, and secondary side wastewater is
20 routinely treated. In addition, the plant systems that process wastes are often augmented by
21 commercial mobile processing systems. As a result, radionuclide releases in liquid effluent from
22 LWRs have generally declined for most plants or remained the same over time.

23 24 **3.1.4.2 Gaseous Radioactive Waste**

25
26 The gaseous waste management system collects fission products, mainly noble gases, which
27 accumulate in the primary coolant. A small portion of the primary coolant flow is continually
28 diverted to the primary coolant purification, volume, and chemical control system to remove
29 contaminants and adjust the coolant chemistry and volume. During this process,
30 noncondensable gases are stripped and routed to the gaseous waste management system,
31 which consists of a series of gas storage tanks. The storage tanks allow the short-half-life
32 radioactive gases to decay, leaving only relatively small quantities of long-half-life radionuclides
33 to be released to the atmosphere. Some LWRs currently use charcoal delay systems rather
34 than gas storage tanks.

35
36 For BWRs, the sources of routine radioactive gaseous emissions to the atmosphere are the air
37 ejector, which removes noncondensable gases from the coolant to improve power conversion
38 efficiency, and gaseous and vapor leakages, which, after monitoring and filtering, are
39 discharged to the atmosphere via the building ventilation systems.

Affected Environment

1 PWRs have three primary sources of gaseous radioactive emissions: (1) discharges from the
2 gaseous waste management system; (2) discharges associated with the exhaust of
3 noncondensable gases at the main condenser if a primary-to-secondary system leak exists;
4 and (3) radioactive gaseous discharges from the building ventilation exhaust, including the
5 reactor building, reactor auxiliary building, and fuel-handling building.
6

7 The quantities of gaseous effluents released from operating plants are controlled by the
8 administrative limits that are defined in the ODCM, which is specific for each plant. Controls are
9 based on (1) dose rates to a member of the public and (2) dose commitments to a member of
10 the public. The limits in the ODCM are designed to provide reasonable assurance that
11 radioactive material discharged in gaseous effluents are not in excess of the limits specified in
12 10 CFR Part 20, Appendix B, thereby limiting the exposure of a member of the public in an
13 unrestricted area.
14

15 **3.1.4.3 Solid Radioactive Waste**

16
17 Solid low-level radioactive waste (LLW) from nuclear power plants is generated from the
18 removal of radionuclides from liquid waste streams, filtration of airborne gaseous emissions,
19 and removal of contaminated material from various reactor areas. Liquid contaminated with
20 radionuclides comes from primary and secondary coolant systems, spent fuel pools,
21 decontaminated wastewater, and laboratory operations.
22

23 Solid waste is packaged in containers to meet the applicable requirements of 49 CFR Parts 171
24 through 177. Disposal and transportation are performed in accordance with the applicable
25 requirements of 10 CFR Part 61 and 10 CFR Part 71, respectively.
26

27 Solid radioactive waste generated during operations is shipped to a LLW processor or directly
28 to a LLW disposal site. Volume reduction may occur both onsite and offsite. The most
29 common onsite volume reduction techniques are high-pressure compacting in waste drums,
30 dewatering and evaporating wet wastes, monitoring waste streams to segregate wastes, and
31 sorting. Offsite waste management vendors compact wastes at ultra-high pressures, incinerate
32 dry active waste, separate and incinerate oily and organic wastes, and concrete-solidify resins
33 and sludges before the waste is sent to a LLW disposal site.
34

35 Spent fuel contains fission products and actinides produced when nuclear fuel is irradiated in
36 reactors, as well as any unburned, unfissioned nuclear fuel remaining after the fuel rods have
37 been removed from the reactor core. Currently in the United States, the spent fuel is
38 considered waste and is being stored at the reactor sites, either in spent fuel pools or dry
39 storage facilities, also called ISFSIs, awaiting the opening of the nation's first high-level waste
40 (HLW) geologic repository (see Section 3.11.1.2).
41

1 Mixed wastes, which contain both radioactive and hazardous components, are generally
2 accumulated in designated areas onsite and then shipped offsite for treatment and disposal.
3 Mixed wastes are regulated both by the U.S. Environmental Protection Agency (EPA) or the
4 State under authority granted by the Resource Conservation and Recovery Act (RCRA) and by
5 the NRC or the State under authority granted by the Atomic Energy Act (see Section 3.11.3).
6

7 **3.1.5 Nonradioactive Waste Management Systems**

8

9 Nonradioactive wastes from nuclear power plants include both hazardous and nonhazardous
10 wastes. Hazardous wastes, as defined by RCRA Subtitle C, may include organic materials,
11 heavy metals, solvents, paints, cutting fluids, and lubricating oils that have been used at a
12 nuclear power plant, and, after use, declared to be waste. These wastes are generally
13 accumulated in designated areas onsite and then shipped offsite for treatment and disposal.
14 Certain hazardous waste streams may receive treatment at some sites. For example, waste oil
15 is incinerated at some sites. Common treatment methods for these nonradioactive wastes
16 include incineration, neutralization, biological treatment, and removal and recovery. All
17 activities related to hazardous wastes – including storage, treatment, shipment, and disposal –
18 are conducted pursuant to permits issued by the EPA or the State, if authorized, per the
19 regulations issued under RCRA (see Section 3.11.2).
20

21 There are also some routine or nonroutine releases from power plants that may have
22 hazardous components, including boiler blowdown (continual or periodic purging of impurities
23 from plant boilers), water treatment wastes (sludges and high-saline streams whose residues
24 are disposed of as solid waste and biocides), boiler metal cleaning wastes, floor and yard
25 drains, and stormwater runoff. Principal chemical and biocide waste sources include the
26 following:

- 27
- 28 • Boric acid used to control reactor power and lithium hydroxide used to control pH in the
29 coolant. These chemicals could be inadvertently released because of pipe or steam
30 generator leakage.
- 31
- 32 • Sulfuric acid, which is added to the circulating water system to control scale.
- 33
- 34 • Hydrazine, which is used for corrosion control. It is released in steam generator
35 blowdown.
- 36
- 37 • Sodium hydroxide and sulfuric acid, which are used to regenerate resins. These are
38 discharged after neutralization.

Affected Environment

- 1 • Phosphate in cleaning solutions.
- 2
- 3 • Biocides used for condenser defouling.
- 4

5 Other small volumes of wastewater are released from other plant systems depending on the
6 design of each plant. These are discharged from such sources as the service water and
7 auxiliary cooling systems, laboratory and sampling wastes, and metal treatment wastes. These
8 waste streams are discharged as separate point sources or are combined with the cooling
9 water discharges.

10
11 Nonradioactive and nonhazardous wastes such as office trash are picked up by a local waste
12 hauler and sent to a local landfill without any treatment. Sanitary wastes are treated at a
13 sewage treatment plant that is located either onsite or offsite. If the treatment plant is offsite,
14 the sanitary waste is collected in underground tanks, tested for radioactivity, and sent offsite
15 periodically. Any releases to surface water from onsite sewage plants are subject to NPDES
16 permit limits.

17 **3.1.6 Utility and Transportation Infrastructure**

18
19
20 The utility and transportation infrastructure at nuclear power plants typically interfaces with
21 public infrastructure systems available in the region. This infrastructure includes utilities, such
22 as suppliers of electricity, fuel, and water, as well as roads and railroads used to gain access to
23 the sites.

24 **3.1.6.1 Electricity**

25
26
27 Nuclear power plants generate electricity for other users; however, they also use electricity to
28 operate. The amount of electrical power needed to run a 1000-MW(e) nuclear power plant is
29 relatively small when compared to the amount it generates. The plants use some of the power
30 they generate; however, they also have connections to the electrical grid system to receive
31 power from offsite sources. Offsite power is provided to run the engineered safety features and
32 emergency equipment in case of a malfunction and interruption of power generation at the
33 plant. The plants also have independent backup generators that run on diesel fuel. The
34 backup generators are tested periodically and come on line automatically in case electrical
35 power to the plant from internal generation and external sources is interrupted.

36 **3.1.6.2 Fuel**

37
38
39 An operating 1000-MW(e) PWR contains approximately 220,000 lb (100 MT) of nuclear fuel in
40 the form of UO₂ at any one time. Only about one-third of that fuel is replaced at every refueling.
41 Assuming that the reactor is refueled once every 18 months, the amount of nuclear fuel needed

1 (and also spent fuel generated) would be roughly 44,000 lb (20 MT) per year. Fresh fuel is
2 brought to the site and stored at the site until needed.

3
4 In addition to nuclear fuel, a nuclear power plant needs a certain amount of diesel fuel to
5 operate the emergency diesel power generators. To meet emergency demands, a certain
6 quantity of diesel fuel is stockpiled on site in fuel storage tanks. Fuel is also needed for space
7 heating, ventilating, and air conditioning (HVAC) purposes. Plants use a variety of energy
8 sources for HVAC, including electricity, natural gas, or fuel oil. Some plants have waste oil
9 incinerators onsite to burn their used oil. The heat generated by such an incinerator is used to
10 heat buildings during winter.

11 12 **3.1.6.3 Water**

13
14 Systems designed to provide cooling water at nuclear power plants are described in
15 Section 3.1.3. In addition to needing water for cooling, plants need water for sanitary reasons
16 and for everyday use by the personnel (e.g., drinking, showering, cleaning, laundry, toilets, and
17 eye washes). Plants generally rely on groundwater or, at times, on surface water bodies
18 (e.g., nearby rivers and lakes) to obtain potable water. Because the plants are generally in rural
19 areas away from population centers, they are often not connected to community water systems
20 and are self-sufficient in meeting their water needs.

21
22 The quantity of water needed for cooling purposes was discussed in Section 3.1.3. The
23 amount of water needed for sanitary reasons is generally much smaller than the amount
24 needed for cooling. After use, the potable water is processed as part of the sanitary water
25 treatment system. As described in Section 3.11.4, sanitary waste is either treated onsite or
26 collected in underground tanks and then shipped offsite to be treated at a local sewage
27 treatment plant.

28 29 **3.1.6.4 Transportation Systems**

30
31 All nuclear power plants are served by controlled access roads. In addition to the roads, many
32 of the plants also have railroad connections for moving heavy equipment and other materials.
33 Some of the plants that are located on navigable waters, such as rivers, Great Lakes, or
34 oceans, have facilities to receive and ship loads on barges.

35
36 Trucks are the most common mode of transportation for delivering materials to and from the
37 sites. Deliveries are accepted at and shipments are made from designated areas on the sites
38 under controlled conditions and by following established procedures. Workers generally use
39 their personal vehicles to commute to work. Visitors use passenger cars or light pickup trucks
40 to get to and from the sites. There are parking areas available on every site for workers and

Affected Environment

1 visitors. There is also a network of roads and sidewalks for vehicles and pedestrians on each
2 site.

3 4 **3.1.6.5 Power Transmission System**

5
6 Each nuclear power plant is connected to the regional electrical grid. Power-transmission
7 systems associated with nuclear power plants and considered within the scope of this review
8 consist of switching stations (or substations) usually located on the plant site and the
9 transmission lines that connect the plant to those substations. These systems are required to
10 transfer power from the plant to the utility's network of power lines in its service area (the
11 regional electrical distribution grid).

12
13 The final environmental statements (FESs) prepared for the original plant construction and
14 operation licensing actions evaluated the impacts of those transmission lines built to connect
15 the nuclear power plant to the regional electrical grid. Since the original construction of those
16 lines, regional expansion of the electrical distribution grid has resulted in incorporation of those
17 lines originating at the power plant substations. In most cases, the transmission lines originating
18 at the power plant substations are no longer owned or managed by the nuclear power plant
19 licensees. These lines would remain in place and energized regardless of a decision
20 concerning license renewal. For this reason, the lines whose existences no longer depend on a
21 license renewal decision are considered outside of the scope of the GEIS revision. It should be
22 noted that this is a departure from the treatment in the *Generic Environmental Impact*
23 *Statement for License Renewal of Nuclear Plants* (GEIS), NUREG-1437 (1996 GEIS)^(a)
24 (NRC 1996) and the SEISs prepared to date. Those reviews considered the transmission lines
25 originally constructed to connect the plant to the grid.

26
27 Switching stations transfer power from generating sources to power lines and regulate the
28 operation of the power system. Transformers in switching stations convert the generated
29 voltage to voltage levels appropriate for the power lines. Equipment for regulating system
30 operation includes switches, power circuit breakers, meters, relays, microwave communication
31 equipment, capacitors, and a variety of other electrical equipment. This equipment meters and
32 controls power flow; improves the performance characteristics of the generated power; and
33 protects generating equipment from short circuits, lightning strikes, and switching surges that
34 may occur along the power lines. Switching stations occupy onsite areas generally two to four
35 times as large as areas occupied by reactor and generator buildings, but they are generally not
36 as visible as other plant structures.

(a) Any reference in this document to the 1996 GEIS (NUREG-1437; NRC 1996) includes the two-
volume set published in 1996 and Addendum 1 to the GEIS published in 1999.

1 **3.1.7 Nuclear Power Plant Operations and Maintenance**

2
3 Nuclear power reactors are capable of generating electricity continuously for long periods of
4 time. However, they operate neither at maximum capacity nor continuously for the entire term
5 of their license. Plants can typically operate continuously for periods of time ranging from
6 1 year to 2 years on a single fuel load.

7
8 Maintenance activities are routinely performed on systems and components to help ensure the
9 safe and reliable operation of the plant. In addition, inspection, testing, and surveillance
10 activities are conducted throughout the operational life of a nuclear power plant to maintain the
11 current licensing basis of the plant and ensure compliance with Federal, State, and local
12 requirements regarding the environment and public safety.

13
14 Nuclear power plants must periodically discontinue the production of electricity for refueling,
15 periodic in-service inspection (ISI), and scheduled maintenance. Refueling cycles occur
16 approximately every 12 to 24 months. The duration of a refueling outage is typically about 1 to
17 2 months. Enhanced or expanded inspection and surveillance activities are typically performed
18 at 5- and 10-year intervals. These enhanced inspections are performed to comply with NRC
19 and/or industry standards or requirements, such as the American Society of Mechanical
20 Engineers Boiler and Pressure Vessel Code. Five-year ISIs are scheduled for the 5th, 15th,
21 25th, and 35th years of operation, and 10-year ISIs are performed in the 10th, 20th, and 30th
22 years. For economic reasons, many of these activities are conducted simultaneously
23 (e.g., refueling activities typically coincide with the ISI and maintenance activities).

24
25 Many plants also undertake various major refurbishment activities during their operational lives.
26 These activities are performed to ensure both that the plant can be operated safely and that the
27 capacity and reliability of the plant remain at acceptable levels. Typical major refurbishments
28 that have occurred in the past include replacing PWR steam generators, reactor vessel heads,
29 BWR recirculation piping, and rebuilding main steam turbine stages. The need to perform
30 major refurbishments is plant-specific and depends on factors such as design features,
31 operational history, and construction and fabrication details. The plants may remain out of
32 service for extended periods of time several months while these major refurbishments are
33 made. Outage durations vary considerably, depending on factors such as the scope of the
34 repairs or modifications undertaken, the effectiveness of the outage planning, and the
35 availability of replacement parts and components.

36
37 Each nuclear power plant is part of a utility system that may own several nuclear power plants,
38 fossil-fired plants, or other means of generating electricity. An onsite staff is responsible for the
39 actual operation of each plant, and an offsite staff may be headquartered at the plant site or
40 some other location. Typically, 800 to 2300 people are employed at nuclear power plant sites
41 during periods of normal operation, depending on the number of operating reactors located at a

Affected Environment

1 particular site. The permanent onsite workforce is usually in the range of 600 to 800 people per
2 reactor unit. However, during outage periods, the onsite workforce typically increases by 200 to
3 900 additional workers. The additional workers include engineering support staff, technicians,
4 specialty crafts persons, and laborers called in both to perform specialized repairs,
5 maintenance, tests, and inspections, and to assist the permanent staff with the more routine
6 activities carried out during plant outages.

8 **3.2 Land Use and Visual Resources**

10 **3.2.1 Land Use**

12 Nuclear power plants are large industrial complexes with land requirements generally
13 amounting to 100 to 125 ac (40 to 50 ha) for the reactor containment building, auxiliary
14 buildings, cooling system structures, administration and training offices, and other facilities
15 (e.g., switchyards, security facilities, and parking lots). Areas disturbed during construction of
16 the power plant generally have been returned to prior uses or were ecologically restored when
17 construction ended. Site areas range from 84 ac (34 ha) for the San Onofre plant in California
18 to 14,000 ac (5700 ha) for the Clinton plant in Illinois (Table 3.1-1). Almost 60 percent of plant
19 sites encompass 500 to 2000 ac (200 to 800 ha), with 28 site areas ranging from 500 to
20 1000 ac (200 to 400 ha) and an additional 12 sites encompassing 1000 to 2000 ac (400 to 800
21 ha). Larger land areas are often associated with elaborate man-made closed-cycle cooling
22 systems that include cooling lagoons, spray canals, reservoirs, artificial lakes, and buffer areas.

24 While many utilities use the land for the sole purpose of generating electricity, other utilities
25 allow other uses for the land. Some sites lease land for agricultural and forestry production,
26 promote their ecology nature centers and preservation areas, allow recreational use, and permit
27 cemetery and historical site access. Most sites have closed their visitor centers as a result of
28 security concerns after September 11, 2001. Sites have improved their security fencing, altered
29 their landscaping to enhance visibility from the plant, reduced site access, and increased
30 signage detailing site access and restrictions. Some sites have constructed onsite dry cask
31 storage facilities for spent fuel.

33 The land cover and land use percentages at each site depend on the total site area and amount
34 of land required for electricity generation. Land cover on sites is often designated within the
35 land use "resource-oriented" classification system, which includes urban or built-up land,
36 agricultural land (e.g., cropland, pasture, orchards, nurseries, fields, and fallow lands),
37 rangeland, forest land, water, wetland (e.g., marshes and swamps), and barren land
38 (e.g., beaches and gravel pits). Land cover designations at other sites use visually descriptive
39 categories that include open areas (e.g., fields, cemeteries), forested areas, scrub forest,

1 deciduous forest, hardwood forest, beach, wetlands, open water (e.g., ponds, streams, lakes,
2 and canals), natural lands, recreational lands, and parking areas.

3
4 Land use within transmission line rights-of-way (ROWs) is both precluded and restricted under
5 the easement rights acquired by the utility from private landowners or from local, State, or
6 Federal governments. Land use within cleared ROWs often, but not always, differs from that in
7 adjacent areas. Land cover within ROWs is managed through a variety of oversight and
8 maintenance procedures so that vegetation growth and building construction do not interfere
9 with power line operation and access. Land use within ROWs is limited to activities that do not
10 endanger line operation and can include recreation, off-road vehicle use, grazing, agricultural
11 cultivation, irrigation, recreation, roads, and environmental conservation and wildlife areas.

12
13 One of the siting criteria for nuclear power plant sites was access to rail or water transport so
14 that rail or barge deliveries of reactor vessels and other large operating equipment could be
15 received. The rail spurs and barge docking facilities still remain at many sites and are used
16 occasionally. Because of the large number of workers commuting daily to and from the site, a
17 quality road network connecting the site to urban locations was and continues to be essential.

18
19 Information on land cover within 5 mi (8 km) of commercial nuclear power plants is summarized
20 in Table 3.2-1. The land cover types in the vicinity of each plant site are presented in
21 Table D.1-1 in Section D.1 of Appendix D. For all NRC regions, most of the cover near plants is
22 undeveloped land, agricultural land, or open water. There are differences in land use and land
23 cover in the four NRC regions. In Region I (Northeast) and Region II (Southeast), more than
24 two-thirds of the area surrounding most plants is open water, forest, and wetlands. Region III
25 (northern Midwest) plants are mostly surrounded (80 percent) by agricultural land, open water,
26 and forests. In Region IV (West and Southern Midwest), plants are surrounded (77 percent) by
27 agricultural land, shrub/scrub land, forests, herbaceous cover, and wetland.

28
29 Section 307(c)(3)(A) of the Coastal Zone Management Act of 1972 (16 USC 1456) requires that
30 applicants for Federal licenses certify that the proposed activity in a coastal zone or coastal
31 watershed boundary, as defined by each State participating in the National Coastal Zone
32 Management Program, is consistent with the enforceable policies of that State's Coastal Zone
33 Management Program. States define their coastal zone boundaries by using a variety of
34 parameters, such as the entire State, county or county-equivalent boundaries, political features
35 (e.g., town boundaries), and geographic features (adjacency to tidal waters). Licensees must
36 coordinate with the State agency that manages the State Coastal Zone Management Program,
37 which is a voluntary Federal-State program that oversees the compatibility certification process
38 for Federal projects within coastal zones.

Table 3.2-1. Land Cover Within a 5-Mile Radius of U.S. Commercial Nuclear Power Plants

Land Cover Classes	Percent of Land Cover Type in NRC Region				
	Region I	Region II	Region III	Region IV	Overall
Open water	31.7	20.6	24.6	14.9	23.0
Undeveloped land					
Barren land	0.7	0.7	0.3	0.3	0.5
Forest (deciduous, evergreen, and mixed)	30.6	35.9	14.6	13.3	23.6
Wetlands	8.4	13.4	5.9	10.3	9.5
Herbaceous	0.3	5.4	3.7	11.5	5.2
Shrub/scrub	0.8	2.3	0.2	18.3	5.4
Total undeveloped land	40.8	57.7	24.7	53.7	44.2
Developed land					
Agriculture (cultivated crops and hay/pasture)	15.6	14.2	40.4	23.7	23.5
Developed open space	5.2	4.9	5.0	3.6	4.7
Low- to high-density developed land	6.7	2.7	5.2	4.0	4.7
Total developed land	27.5	21.8	50.6	31.3	32.9
Total	100	100	100	100	100

Source: USGS 2007

1
2 The population densities in the vicinity of nuclear plants and the distances of plants from a
3 medium- or large-sized metropolitan center vary among sites. Most sites are not very remote
4 (i.e., they are not more than about 20 mi (32 km) from a community of 25,000 people or 50 mi
5 (80 km) from a community of 100,000 people). During the period from 1960 to 1980, with utility
6 and local government activities actively encouraging growth (Metz 1983), commercial,
7 industrial, recreational, and industrial land uses tended to expand in the 10-mi (16-km) radius
8 around nuclear plants at the expense of agriculture. New major highways, expanded municipal
9 services, proximity to major urban areas, recreation facilities, and low taxes are indirect factors
10 that promoted population and industrial growth. In some instances, the roads and water lines
11 built for plant purposes encouraged area growth because they were available for other users.
12 In many communities, recent changes in the legislation and tax codes on electricity generation
13 in several States have resulted in significant reductions in the tax revenue stream from nuclear
14 power plants.
15

1 Some form of land use control exists in nearly every local jurisdiction that adopted a
2 comprehensive land use or master plan to control residential and commercial developments
3 and preserve shrinking agriculture areas. A specific prohibition on particular land uses in the
4 vicinity of a plant was adopted in only in one percent of the 43 plant sites surveyed (Metz 1983).

5
6 For example, in 1976, New Jersey imposed a three-year moratorium on large-scale residential
7 developments within 4 mi (6 km) of the Oyster Creek plant and within 6 mi (10 km) of the larger
8 Salem plant. Some communities enacted laws to specifically regulate land use density around
9 nuclear power plants (e.g., in recognition of natural resources, infrastructure constraints, or the
10 population's generally anti-growth attitude since the 1940s). An inadvertent buffering of the
11 Crystal River plant in Florida was caused by the host county's industrial zoning around two
12 contiguous large coal-fired power plants that excluded residential development.

13
14 The residential settlement patterns of nuclear power plant workers are well established. Area
15 population-driven and tax-driven indirect impacts on land use development have occurred in
16 local jurisdictions and service districts that receive tax payments from the owners of the nuclear
17 power plant. The manner in which offsite land use has changed during plant operations has
18 been directly related to the influence of tax payments to the communities' total tax revenue and
19 the controls and plans approved and enacted to steer and manage growth and land use
20 changes. A case study of land use changes that resulted from the operation of seven nuclear
21 power plants that was conducted for the 1996 GEIS determined that impacts were small at two
22 sites, moderate at four sites, and significant at one site depending on the local jurisdiction's
23 ability to provide the public services necessary to support substantial industrial development.
24 Impacts at the Wolf Creek plant in Kansas were determined to be potentially significant if the
25 plant was shut down. Property tax payments allowed host Coffey County to lower its property
26 taxes and upgrade its provision of municipal services as well as purchase industrial buildings
27 and machinery. The county was able to lease them back at a discount on a lease-purchase
28 basis, thereby successfully encouraging industrial and commercial development in the area
29 (NRC 1996).

30 31 **3.2.2 Visual Resources**

32
33 Aesthetic resources are related to physical elements that represent pleasing sensory stimuli
34 and include natural and man-made landscapes and the ways in which the two are integrated.
35 Nuclear power plants – particularly those with natural draft cooling towers – stand out from their
36 backgrounds. Their site features (Section 3.1.1) are often visible from neighborhoods, roads,
37 and recreation-based water bodies over a wide area. While plant structures can be visible from
38 as far away as 10 mi (16 km), most structures are typically partially obscured because of the
39 large size (distance) of the site and by changes in site topography, buildings next to the site,
40 and vegetation. Cooling towers at a site can draw attention to the plant's existence because
41 vapor plumes can rise more than 5000 ft (1500 m) above the towers and can extend as much

Affected Environment

1 as 9 mi (14 km) downwind. These plumes, although visible only under certain meteorological
2 and seasonal conditions, extend the plant-related viewshed considerably beyond that of a tower
3 alone.

4
5 During the current operating license term, most nuclear power plants have employed a variety
6 of mitigation measures to decrease the visual intrusion of plant structures, including the choice
7 of exterior cladding and paint colors to blend with surroundings, use of nonreflective surfaces,
8 strategic placement of tree plantings and landscaping, and structure placement. In some
9 instances, as a result of security requirements, landscaping was reduced and exterior lighting
10 was increased. Federal regulations require that tall structures, including reactor containment
11 buildings, cooling towers, stacks, and meteorological towers, be fitted with arrays of lights to
12 alert aircraft pilots of their presence. Often these structures can be visible for miles away,
13 depending on the amount of topographic and vegetation screening.

14
15 Because nuclear power plants are frequently sited near water bodies, views of the facilities and
16 their associated transmission lines often intrude into recreational, historic, or scenic areas. To
17 date, most of the visual impact from transmission lines has been associated with crossings of
18 rivers, wetlands, wildlife areas, roads, lakes, cemeteries, and battlefields. Various design,
19 engineering, siting, construction, and metallic surface treatments have been used to mitigate
20 these conflicts.

21 **3.3 Meteorology, Air Quality, and Noise**

22 **3.3.1 Meteorology and Climatology**

23
24 The NRC requires that basic meteorological information be available for use in assessing (1)
25 the environmental effects of radiological and nonradiological emissions and effluents resulting
26 from the construction or operation of a nuclear power plant and (2) the benefits of design
27 alternatives. All nuclear power plants in the United States have a required onsite
28 meteorological monitoring program to provide the data needed to determine dispersion
29 conditions in the vicinity of the plant for assessment of safety and environmental factors. These
30 data are used with air dispersion models to assess and protect public health, safety, and
31 property during plant operations (NRC 2007b).
32
33
34

35 The most recent update to NRC Regulatory Guide 1.23, which covers meteorological monitoring
36 programs for nuclear power plants, provides new guidance for onsite meteorological
37 measurements at stationary licensed power reactors. The guidance covers the siting of
38 instruments to provide representative measures at plant sites, the accuracy and range of
39 specified measured parameters, and special considerations for plants located near influences

1 of complex terrain (e.g., coastal areas, hills of significant grade or valleys), among other criteria
2 and specifications.

3
4 Onsite meteorological conditions at commercial nuclear power plants are monitored at primary
5 fixed meteorological towers with instrumentation at two levels (e.g., 10 and 60 m), and, if
6 necessary, one additional higher level on the tower to better represent dispersion of elevated
7 releases from stacks. A secondary onsite tower is typical at many installations as a backup if
8 primary tower measures fail. Basic meteorological measurements from tower instruments at
9 these levels include: (1) wind speed and direction from at least two levels, (2) temperature for
10 an ambient reading at 10 m (33 ft) and to determine deltas or change with height, and
11 (3) precipitation, which is typically measured near ground level by the tower base.

12 Supplemental measures can include moisture at 10 m (33 ft), and, if applicable, incoming solar
13 and net radiation, barometric pressure, soil temperature, and moisture at the top of the cooling
14 tower. Atmospheric stability is determined from temperature differences at the two lowest
15 levels on the tower. If a backup tower is present, measurements include wind speed and
16 direction and horizontal wind direction variation, usually taken at one level.

17
18 Weather conditions at each of the plants can be quite variable depending on the year, season,
19 time of day, and site-specific conditions, such as whether the site is near coastal zones or
20 located in or near terrain with complex features (e.g., steep slopes, ravines, valleys). These
21 conditions can be generally described by climate zones according to average temperatures.
22 On the basis of temperature alone, there are three major climate zones: polar, temperate, and
23 tropical. Within each of the three major climate zones, there are marine and continental
24 climates. Areas near an ocean or other large body of water have a marine climate. Areas
25 located within a large landmass have a continental climate. Typically, areas with a marine
26 climate receive more precipitation and have a more moderate climate. A continental climate
27 has less precipitation and a greater range in climate. Regional or localized refinements in
28 climate descriptions and assessments can be made by considering other important climate
29 variables and climate-influencing geographic variables, such as precipitation, humidity, surface
30 roughness, proximity to oceans or large lakes, soil moisture, albedo, snow cover, and
31 associated linkages and feedback mechanisms. Localized microclimates can be defined by
32 considering factors such as urban latent and sensible heat flux and building-generated
33 turbulence. Both national and regional maximum and minimum average annual temperature
34 and precipitation climatologies over the 30 years from 1971 through 2000 are summarized in
35 Section D.2 in Appendix D.

36
37 The intensities of historical tornado events are recorded and archived by the National Climatic
38 Data Center (NCDC) (NOAA 2007). Table 3.3-1 provides the current enhanced Fujita (EF)
39 scale next to the original Fujita (F) scale, adjusted to represent peak winds averaged over
40 3 seconds, which are used to identify a tornado event's intensity. The number of recorded
41 tornado events or strikes having intensities greater than or equal to EF2 (wind speeds ranging

Affected Environment

1 from 111 to 135 miles per hour or mph (50 to 60 m/s), with 3-second gusts, EF scale) in the
 2 three regions (Western, Central, and Eastern) of the continental United States over
 3 approximately the last 50 years (1950 through August 2003) are shown in Figure 3.3-1. The
 4 size of each square in the figure is 1 degree of latitude per side and represents an area of
 5 approximately 5000 mi². The EF scale (Texas Tech University 2006) is based on the highest
 6 wind speed estimated in the tornado path with maximum 3-second average wind gusts within
 7 the range specified for each EF intensity level. The range in damage to structures in the EF2
 8 through EF5 range is described as considerable to incredible, and the damage depends highly
 9 on the building's structural design. Computer programs were used to analyze NCDC data, and
 10 tornado strike probabilities were estimated for the three U.S. regions: Western, Central, and
 11 Eastern (NRC 2006a). The expected value structure strike probabilities were estimated to
 12 range from 1.7 chances of a strike in 100,000 tornado events in the Western region to
 13 s35.8 chances in 100,000 in the Central region. Figure 3.3-2 provides estimates of the
 14 expected maximum tornado wind speeds with a 1 in 100,000 chance of occurrence.
 15 Approximately 48 percent of the rated licensed reactor capacity is located in the Eastern region,
 16 41 percent is in the Central region, and 11 percent is in the Western region.
 17

Table 3.3-1. Fujita Tornado Intensity Scale

Intensity	Description of Damage	Original Fujita Scale (3-s gust) (mph)	Operational Enhanced Fujita Scale (3-s gust) (mph)
F0/EF0	Light	45 to 78	65 to 85
F1/EF1	Moderate	79 to 117	86 to 110
F2/EF2	Considerable	118 to 161	111 to 135
F3/EF3	Severe	162 to 209	136 to 165
F4/EF4	Devastating	210 to 261	166 to 200
F5/EF5	Incredible	262 to 31	>200

Source: Texas Tech University 2006

18

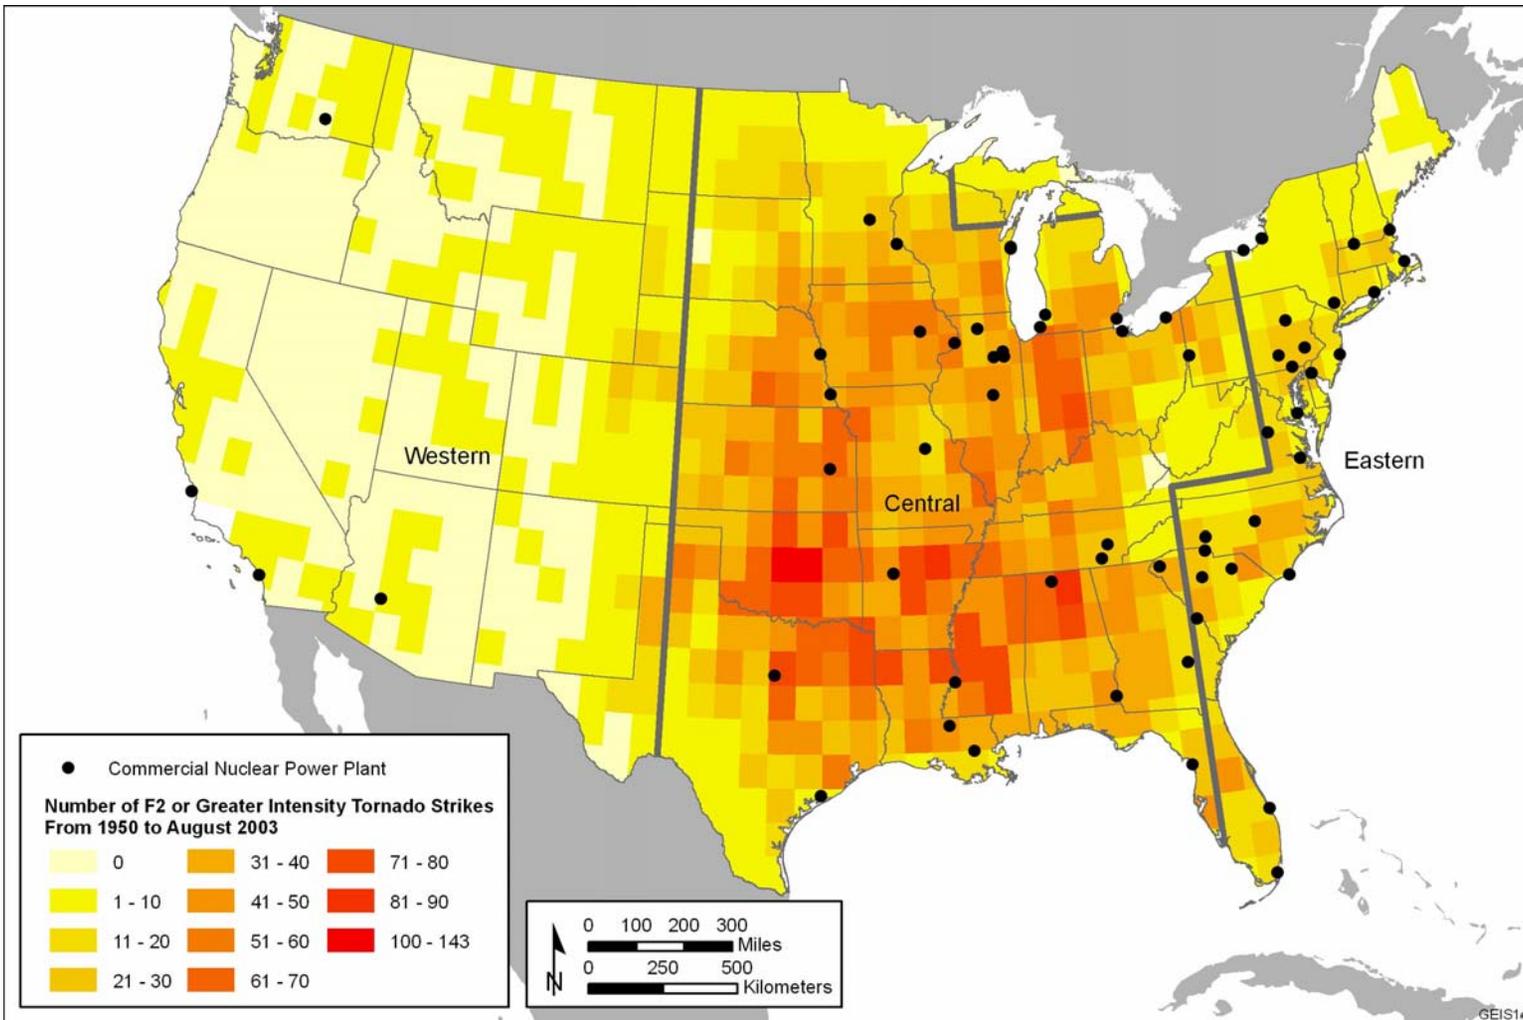


Figure 3.3-1. Distribution of Tornado Strikes with Intensities of F2 or More over the Contiguous United States by One Degree of Latitude and Longitude Boxes (1950 through August 2003) (Source: Adapted from Figure 2-2 in NRC 2006a)

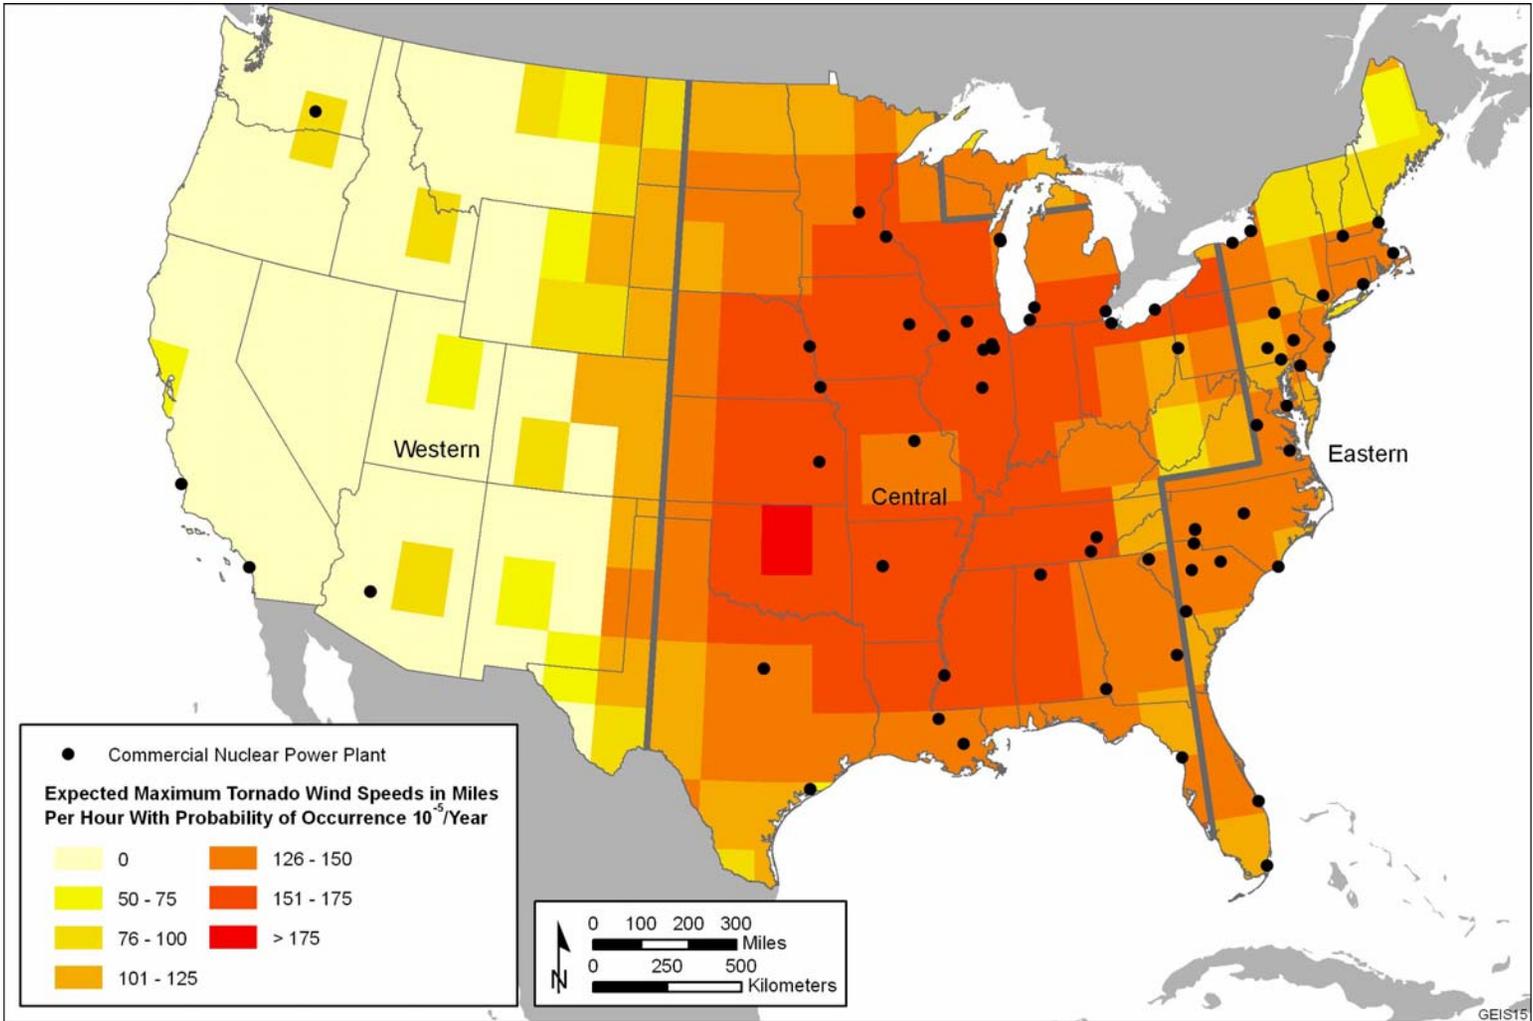


Figure 3.3-2. Expected Maximum Tornado Wind Speed with a Probability of One in 100,000 of Occurring over the Contiguous United States by Two Degrees of Latitude and Longitude Boxes (Source: Adapted from Figure 5-8 in NRC 2006a)

1 3.3.2 Air Quality

2
3 Air emissions related to criteria air pollutants and volatile organic compounds (VOCs) are
4 released to the atmosphere from ancillary non-nuclear facilities at nuclear power plants. These
5 emissions of criteria air pollutants include particulate matter (PM) with a mean aerodynamic
6 diameter of 10 μm or less (PM_{10}), PM with a mean aerodynamic diameter of 2.5 μm or
7 less ($\text{PM}_{2.5}$), sulfur dioxide (SO_2), nitrogen oxides (NO_x), carbon monoxide (CO), lead (Pb), and
8 volatile organic compounds (VOCs). The facilities include backup diesel generators, boilers,
9 pump engines, and cooling towers. The emissions from these facilities (and, if applicable,
10 emissions from the incineration of any waste products) must comply with State and local
11 regulatory air quality permitting requirements. Because nuclear power plant ancillary facilities
12 are generally low emitters of criteria air pollutants and VOCs, the impact on potential ambient
13 air quality is minimal. However, special permit conditions may be applicable under various
14 regulatory jurisdictions for facilities located in EPA-designated nonattainment areas.

15
16 The U.S. Environmental Protection Agency (EPA) has set National Ambient Air Quality
17 Standards (NAAQS) for six criteria pollutants, including sulfur dioxide (SO_2), nitrogen
18 dioxide (NO_2), carbon monoxide (CO), ozone (O_3), particulate matter (PM; PM_{10} , and $\text{PM}_{2.5}$), and
19 lead (Pb), as shown in Table 3.3-2. Primary NAAQS specify maximum ambient (outdoor air)
20 concentration levels of the criteria pollutants with the aim of protecting public health with an
21 adequate margin of safety. Secondary NAAQS specify maximum concentration levels with the
22 aim of protecting public welfare. The NAAQS specify different averaging times as well as
23 maximum concentrations. Some of the NAAQS for averaging times of 24 hours or less allow
24 the standard values to be exceeded a limited number of times per year, and others specify
25 other procedures for determining compliance. States can have their own State Ambient Air
26 Quality Standards (SAAQS). SAAQS must be at least as stringent as the NAAQS and they can
27 include standards for additional pollutants. If a State has no standard corresponding to one of
28 the NAAQS, the NAAQS apply.

29
30 An area where air quality is above NAAQS levels is called a nonattainment area. Previous
31 nonattainment areas where air quality has improved to meet the NAAQS are redesignated
32 maintenance areas and are subject to an air quality maintenance plan.

Table 3.3-2. National Ambient Air Quality Standards (NAAQS)

Pollutant ^(a)	Averaging Time	NAAQS ^(b)	
		Value	Type ^(c)
SO ₂	3-hour	0.50 ppm (1,300 µg/m ³)	S
	24-hour	0.14 ppm	P
	Annual	0.03 ppm	P
NO ₂	Annual	0.053 ppm (100 µg/m ³)	P, S
CO	1-hour	35 ppm (40 mg/m ³)	P
	8-hour	9 ppm (10 mg/m ³)	P
O ₃	1-hour	0.12 ppm ^d	P, S
	8-hour	0.075 ppm	P, S
PM ₁₀	24-hour	150 µg/m ³	P, S
PM _{2.5}	24-hour	35 µg/m ³	P, S
	Annual	15.0 µg/m ³	P, S
Pb	Rolling	0.15 µg/m ³	P, S
	3-month		

(a) Notation: CO = carbon monoxide; NO₂ = nitrogen dioxide; O₃ = ozone; Pb =lead; PM_{2.5} = particulate matter ≤ 2.5 µm; PM₁₀ = particulate matter ≤ 10 µm; and SO₂ = sulfur dioxide.

(b) Refer to 40 CFR 50 for detailed information on attainment determination and reference method for monitoring.

(c) P = Primary standard whose limits were set to protect public health; S= Secondary standard whose limits were set to protect public welfare.

(d) On June 15, 2005, the 1-hour ozone standard was revoked for all areas except the 8-hour ozone nonattainment Early Action Compact Areas (EAC) areas (those do not yet have an effective date for their 8-hour designations). The 1-hour standard will be revoked for these areas one year after the effective date of their designation as attainment or nonattainment for the 8-hour ozone standard.

Source: EPA (2008).

1
2

1 The currently designated nonattainment areas (as of September 2007)^(a) for each criteria air
2 pollutant (ozone [O₃], PM₁₀, PM_{2.5}, SO₂, NO₂, CO, and Pb) and their relative locations with
3 respect to operating nuclear power plants are shown on the maps in Figures 3.3-3
4 through 3.3-10. There are currently more than 30 operating plants located within or adjacent to
5 counties with designated nonattainment areas. The designations shown on the maps in
6 Figures 3.3-4, 3.3-5, and 3.3-7 through 3.3-10 for O₃ (1-hour), PM₁₀, SO₂, NO₂, CO, and Pb
7 should be considered preliminary because they are being reviewed by the respective
8 EPA regional offices. These plants are shown on county-level maps with the associated
9 nonattainment designations in Section D.2 in Appendix D.

10
11 The operation of wet cooling towers results in the emission of salt and other inorganic and/or
12 organic particles to the air. These releases are called drift emissions. Salt is the dominant drift
13 component – being typically greater than 70 percent of the total suspended PM released – for
14 coastal plants with wet towers that use seawater as the coolant. Drift emissions from cooling
15 towers are also associated with deposits on downwind surfaces (e.g., vegetation, automobiles,
16 and structures), known as drift deposition, and a resulting increase in downwind PM
17 concentrations. The magnitude and pattern of these impacts could include both near-field and
18 far-field receptors. The degree of impacts would depend on a number of factors, such as the
19 size of the particles, the steam condenser flow rate or throughput, and the cooling tower height.

20
21 Cooling tower particulate emissions are formed entirely as secondary particles from evaporation
22 of wet tower drift droplet releases to the atmosphere. Because the drift droplets generally
23 contain the same chemical impurities (primarily dissolved solids) as those in the cooling water
24 circulating through the tower, these impurities wind up in the drift that escapes the tower. Large
25 drift droplets settle out of the tower's exhaust air stream and are deposited on surfaces near the
26 tower. This process can lead to wetting, icing, and salt deposition and cause related problems,
27 such as damage to equipment or vegetation. Other drift droplets may evaporate and form
28 mixed chemical particles from water-soluble materials (total dissolved solids or TDS), such as
29 sea salt, and water-insoluble (total suspended solids or TSS) droplet-encapsulated particles
30 (Pruppacher and Klett 1980) that are transported in the air as suspended PM before being
31 deposited on surfaces downwind. Both PM₁₀ and PM_{2.5} are generated when the drift droplets
32 evaporate and leave fine PM formed by the crystallization of dissolved solids. Dissolved solids
33 found in cooling tower drift can consist of salt compounds [e.g., NaCl, NaNO₃, (NH₄)₂SO₄] and
34 other mineral matter, corrosion inhibitors, and biocides.

(a) Nonattainment area designations are ever-changing and redesignations are expected due to EPA's recent standard revisions for PM₁₀ and PM_{2.5} (Dec. 17, 2006), 8-hour O₃ (May 27, 2008), and Pb (Oct. 15, 2008). Please refer to the Web at <http://www.epa.gov/oaqps/greenbk/index/html> for the most updated nonattainment area designations.

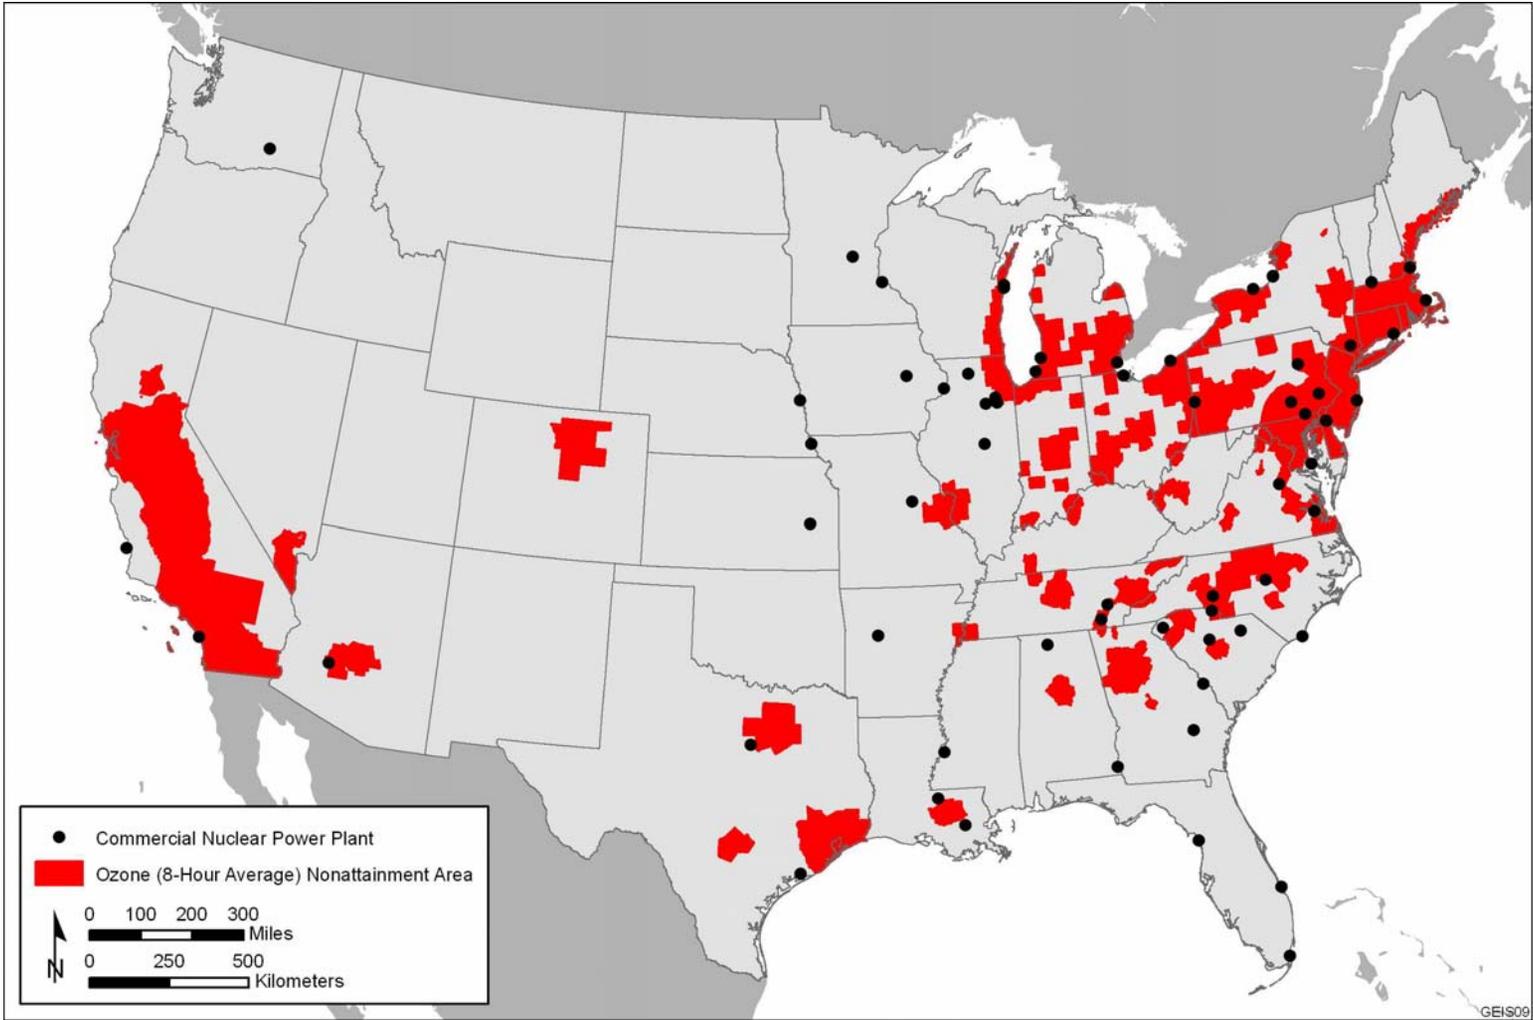


Figure 3.3-3. Locations of Operating Nuclear Plants Relative to EPA-Designated 8-Hour Ozone Nonattainment Areas

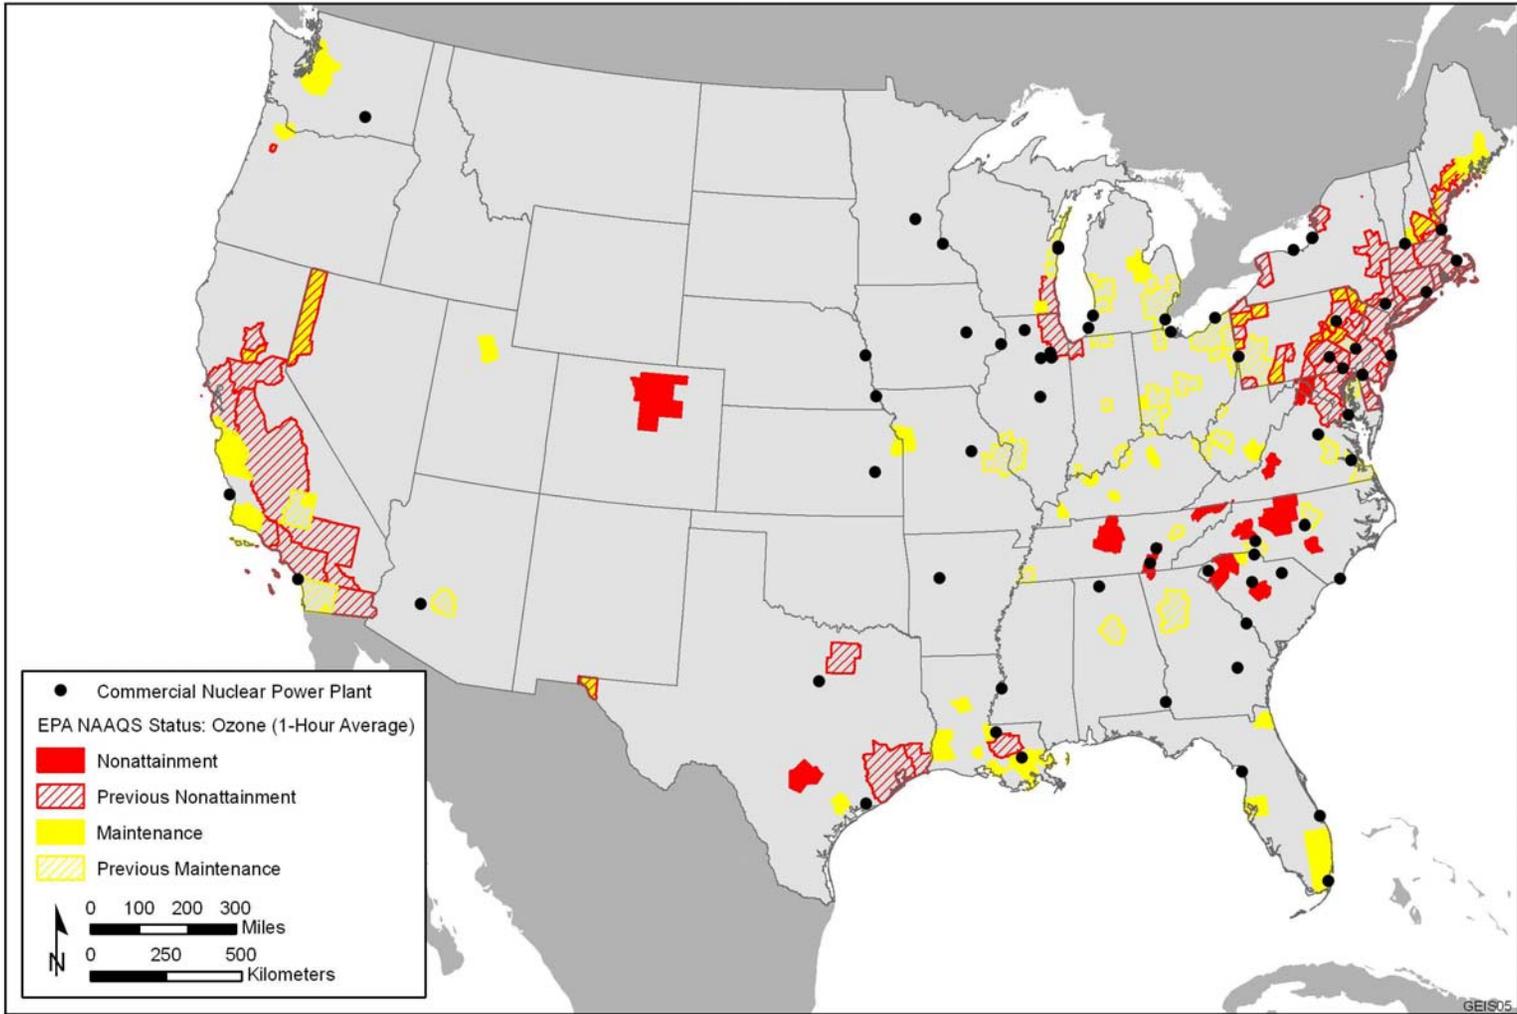


Figure 3.3-4. Locations of Operating Nuclear Plants Relative to EPA-Designated 1-Hour Ozone Nonattainment Areas

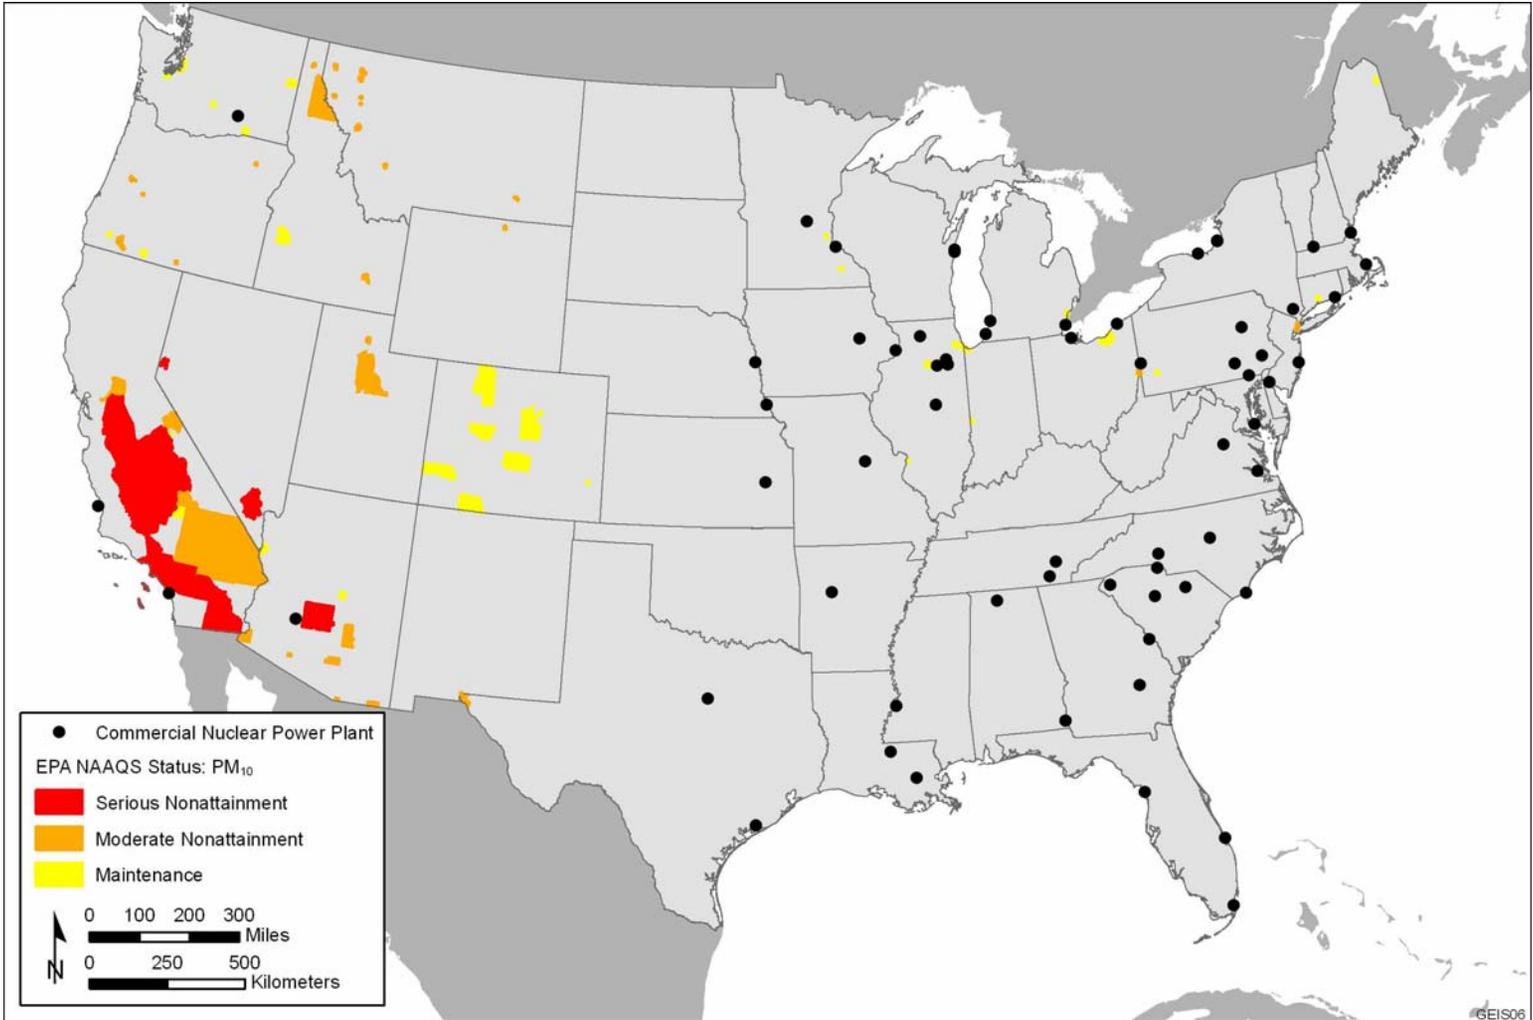


Figure 3.3-5. Locations of Operating Nuclear Plants Relative to EPA-Designated PM₁₀ Nonattainment Areas

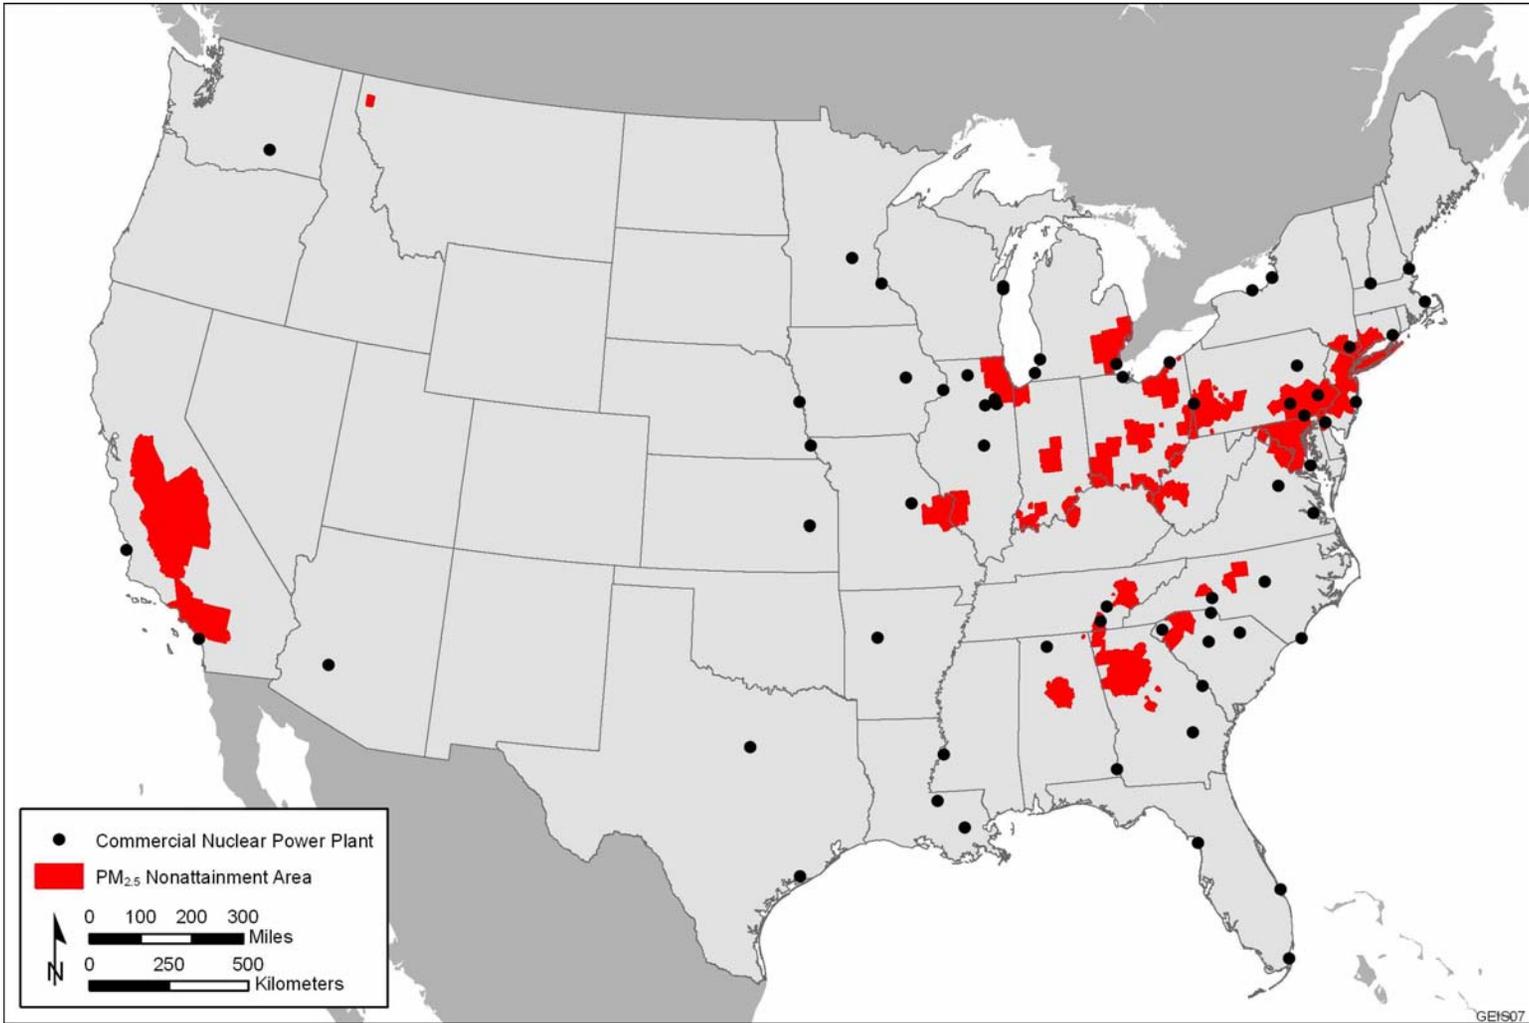


Figure 3.3-6. Locations of Operating Nuclear Plants Relative to EPA-Designated PM_{2.5} Nonattainment Areas

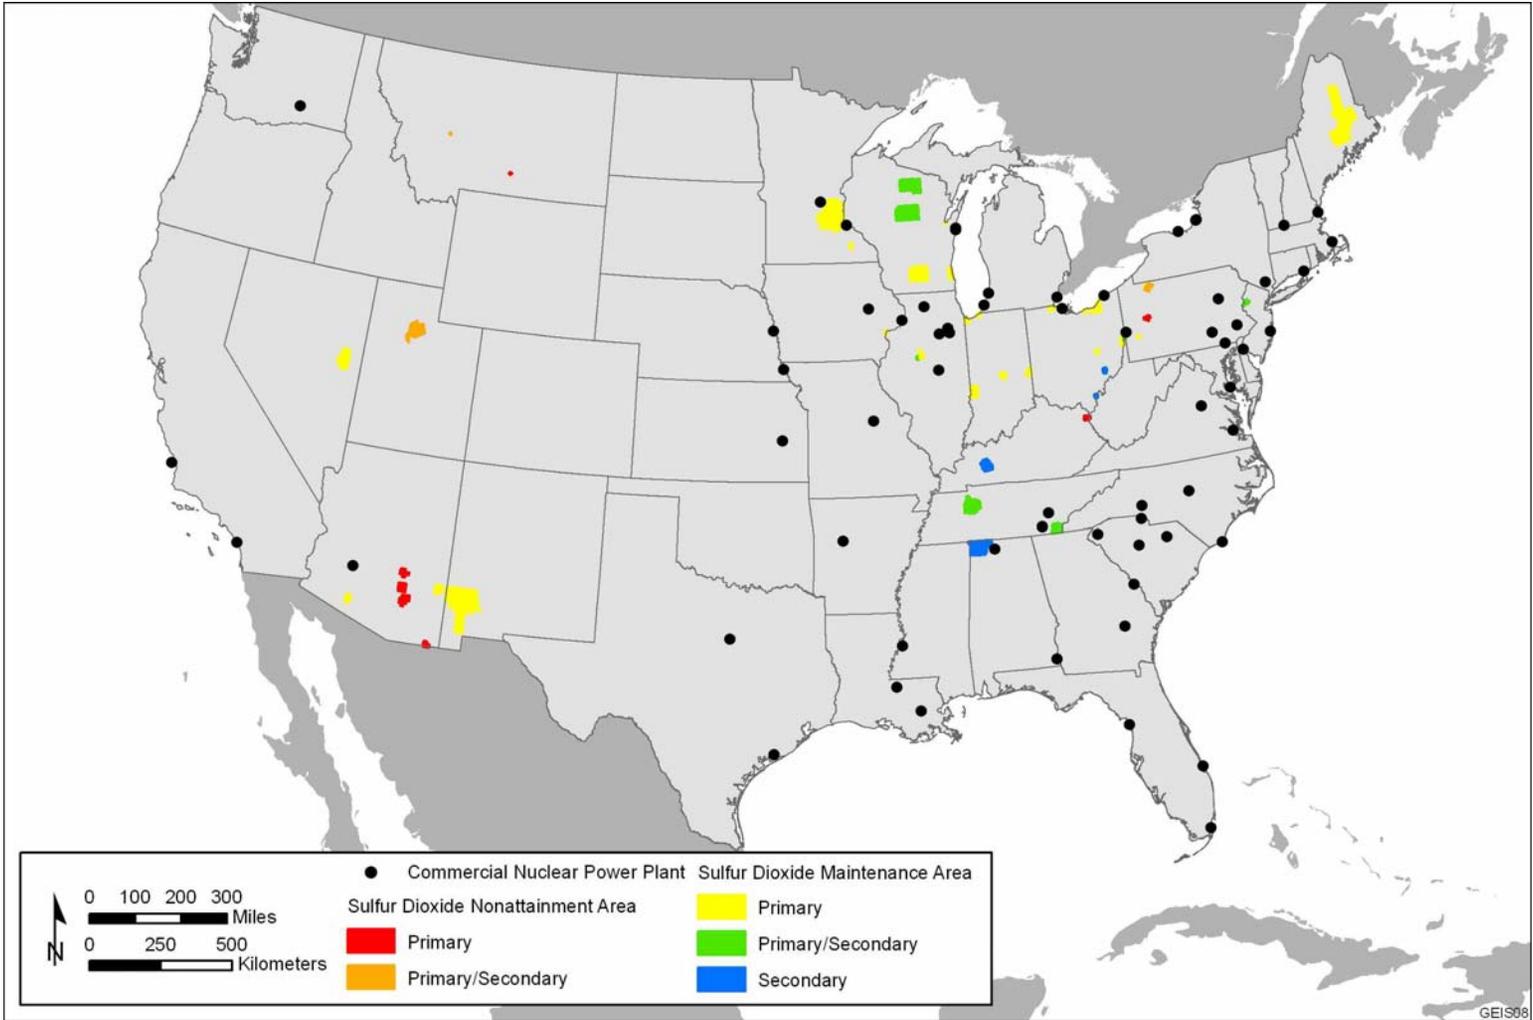


Figure 3.3-7. Locations of Operating Nuclear Plants Relative to EPA-Designated SO₂ Nonattainment Areas

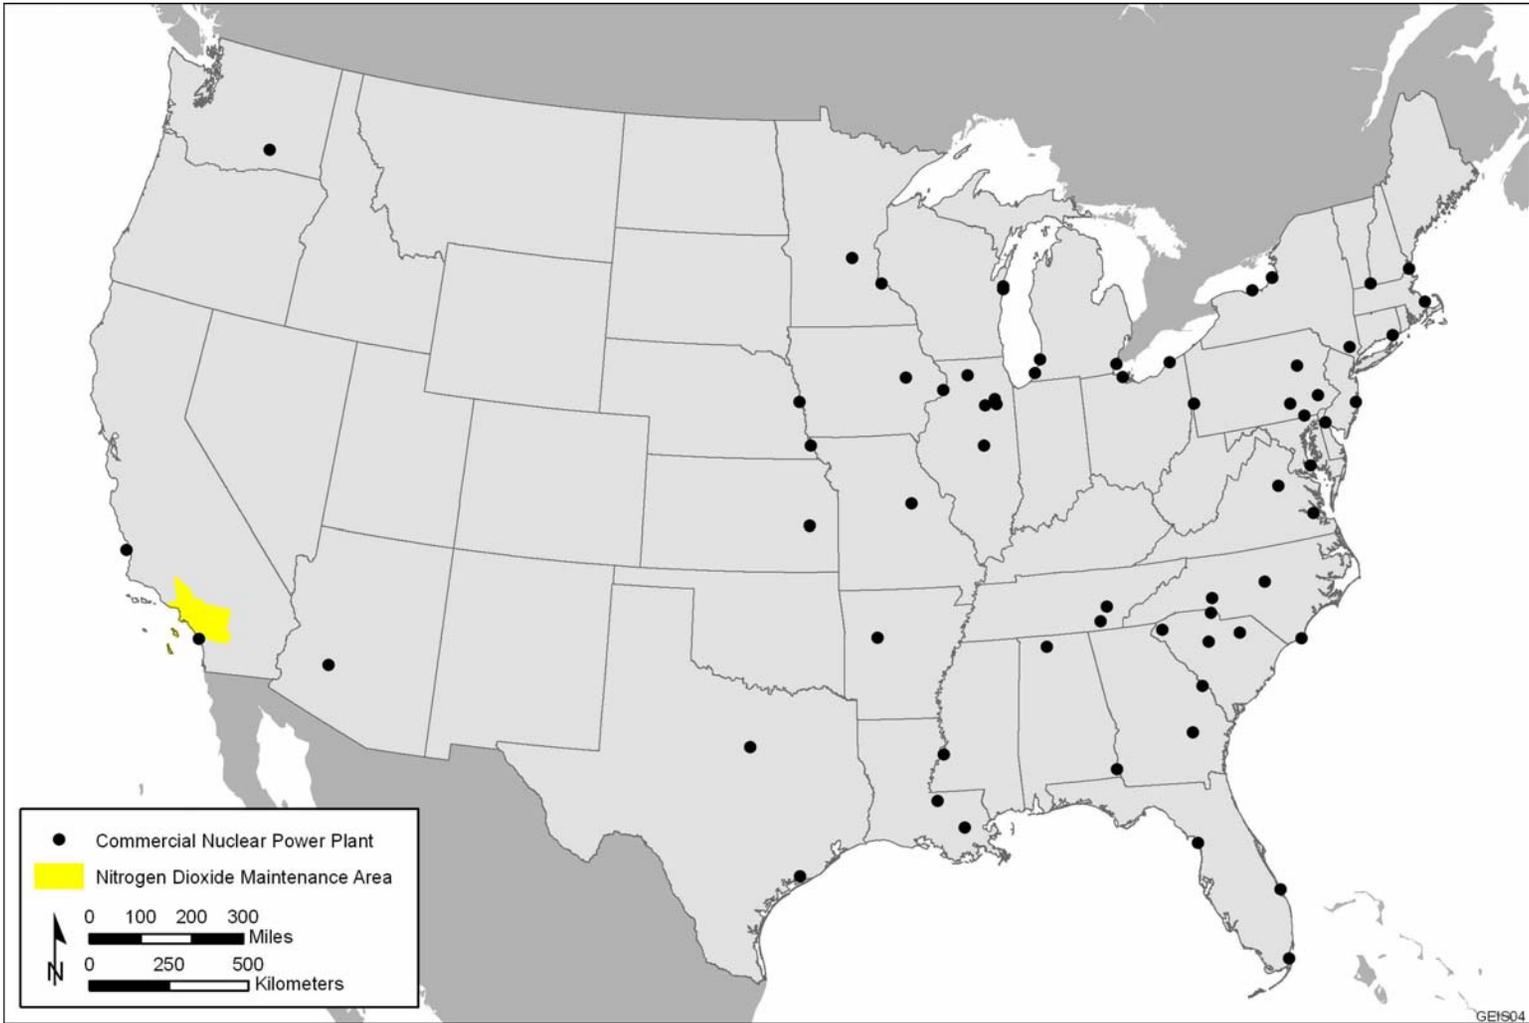


Figure 3.3-8. Locations of Operating Nuclear Plants Relative to EPA-Designated NO₂ Nonattainment Areas

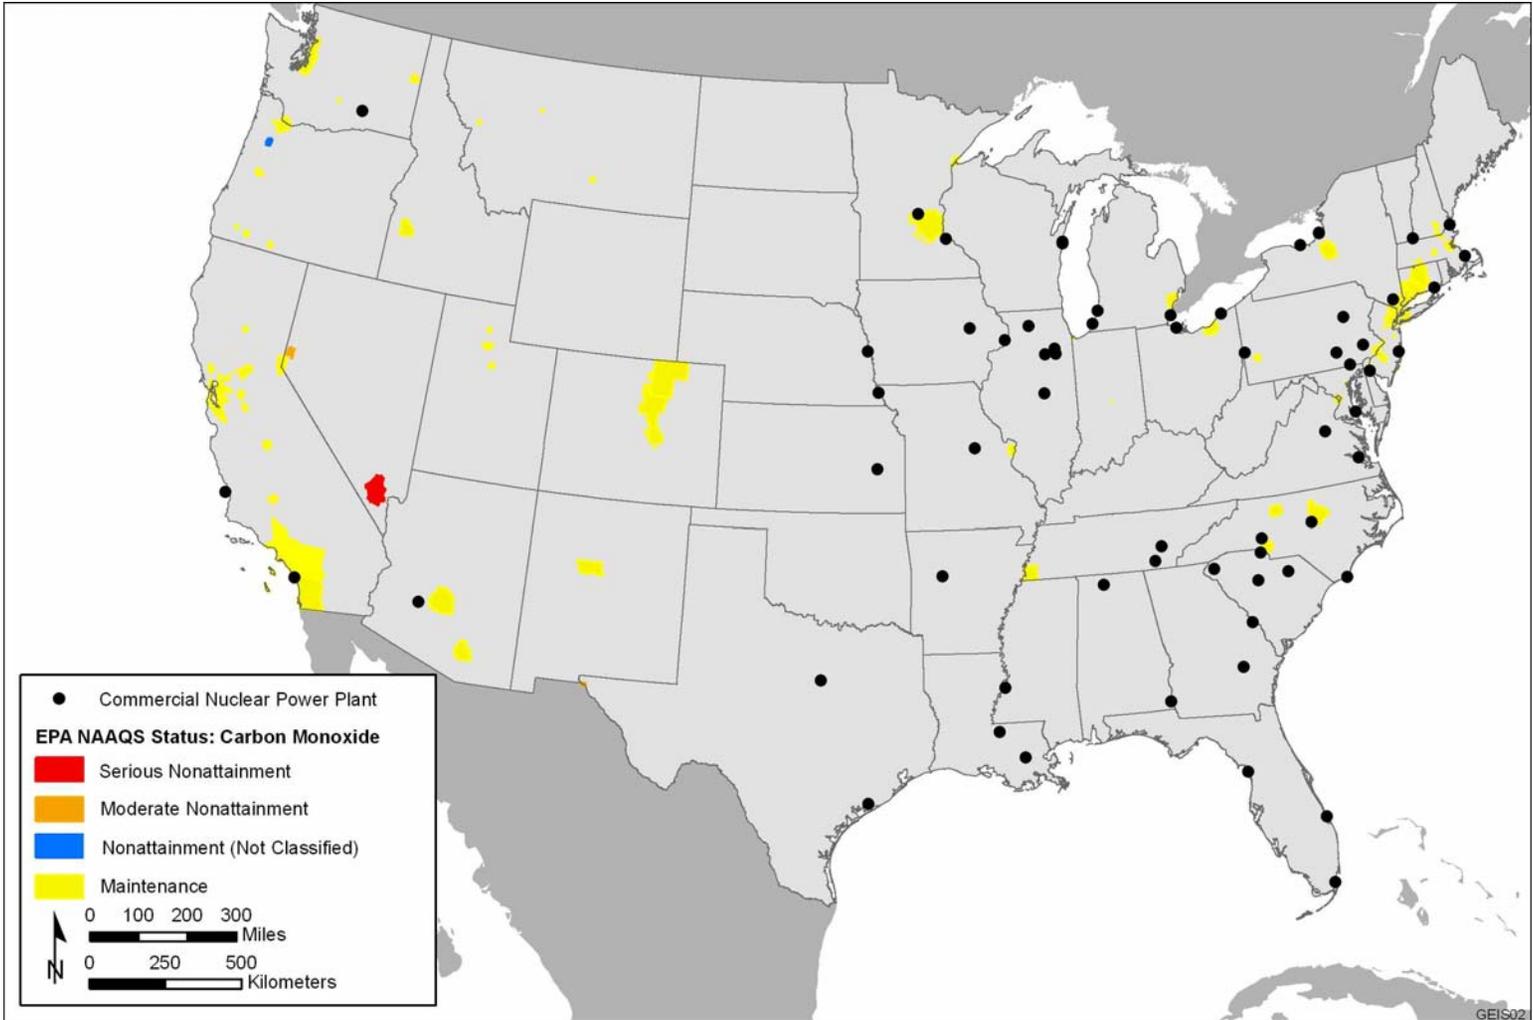


Figure 3.3-9. Locations of Operating Nuclear Plants Relative to EPA-Designated CO Maintenance and Nonattainment Areas

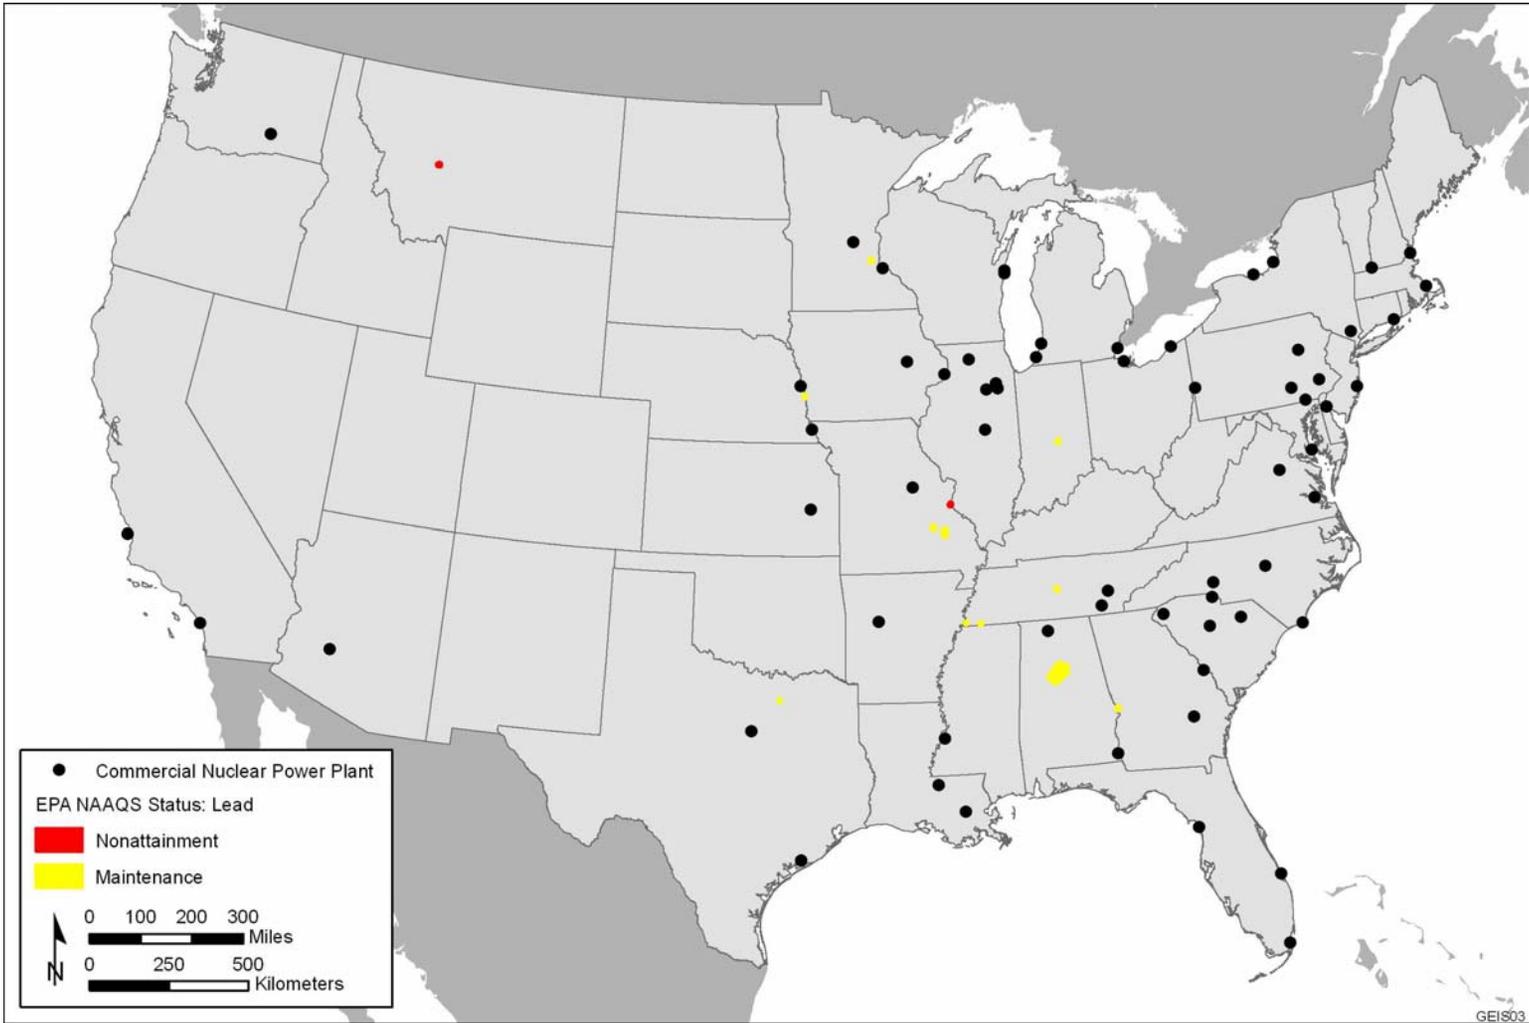


Figure 3.3-10. Locations of Operating Nuclear Plants Relative to EPA-Designated Pb Nonattainment Areas

Affected Environment

1 The magnitude of drift-related PM₁₀ and PM_{2.5} emissions from wet towers depends on several
2 conditions and parameters, such as the makeup water composition, concentrations of TDS
3 (organic matter, biocides, corrosion inhibitors, NaCl), steam condenser flow rate, and drift
4 eliminator efficiency. In comparison, drift emissions from cooling tower systems using seawater
5 are over 7 times greater than those from systems supplied with freshwater makeup feeds, if
6 everything else is held constant. However, one plant (Palo Verde in Arizona) uses makeup
7 water derived from the Phoenix City Sewage Treatment Plant. Reported emission data indicate
8 that wastewater treatment at this facility is good. The associated drift emissions from the six
9 mechanical draft cooling towers at the Palo Verde plant are estimated at 7.7 and 6.4 lb/hr
10 (3.5 and 2.9 kg/hr) for PM₁₀ and PM_{2.5}, respectively (MCAQD 2006). These emissions are
11 relatively small and typical for a well-controlled cooling tower using a water supply with low TDS
12 concentration levels. Palo Verde's cooling tower operates in compliance with operating permit
13 conditions issued by the Maricopa County Air Quality Department and is located in a PM_{2.5}
14 nonattainment area.

15
16 There is only one plant, Hope Creek in New Jersey, that uses high-salinity water (from the
17 Delaware River Estuary) as the reactor coolant in a natural draft cooling tower. On the basis of
18 recent air quality modeling conducted in support of an extended power uprate from about 3300
19 to about 3800 megawatts-thermal [MW(t)], the analysis of drift emissions and air impacts from
20 Hope Creek's natural draft cooling tower was assessed (NRC 2007b). The analysis showed
21 that the upgrade would increase the particulate cooling tower drift emissions from the current
22 rate of 29.4 lb/hr (13.3 kg/hr) to an average rate of 35.6 lb/hr (16.1 kg/hr, with a maximum of
23 42.0 lb/hr [19.1 kg/hr]). Particulates (primarily salts) from the cooling tower are primarily PM₁₀.
24 Although smaller suspended drift particles would also likely be generated from evaporation of
25 cooling tower plume droplets, estimates of the size distribution of generated drift particles to
26 determine the PM_{2.5} fraction were not made. The NRC determined that the estimated increase
27 in particulate emissions would exceed the New Jersey Department of Environmental
28 Protection's (NJDEP) regulatory maximum hourly emission limit of 30 lb/hr (13.6 kg/hr) for
29 particulates (NJDEP 1998). However the NJDEP's Bureau of Technical Services reviewed the
30 air quality modeling conducted in support of the proposed power uprate and determined that the
31 cooling tower emissions would not exceed the NAAQS for PM₁₀ or New Jersey's Ambient Air
32 Quality Standards for PM₁₀. On the basis of this determination, the NRC concluded that there
33 would be no significant particulate emission impacts associated with the Hope Creek Plant's
34 cooling tower at the associated higher makeup water throughput necessary to sustain the
35 higher requested plant operating loads. On June 13, 2007, NJDEP issued its final Title V air
36 permit for the Hope Creek cooling tower, authorizing a variance to the plant's air operating
37 permit with an hourly emission rate of 42 lb/hr (19.1 kg/hr) (NJDEP 2007). In addition, a
38 prevention of significant deterioration (PSD) applicability determination by the EPA concluded
39 that the requested power uprate would not result in a significant increase in emissions and

1 would not be subject to PSD review (NJDEP 2007). Further regulatory review was not required
2 since the Hope Creek plant is located in an attainment area for PM₁₀.

3
4 Although there is the potential for some air quality impacts to occur as a result of equipment
5 and cooling tower operations, even in the worst case situation (Hope Creek), the impacts would
6 be considered small, at least in part because of the fact that licensees would be required to
7 operate within State permit requirements.

8
9 Transmission lines have been associated with the production of minute amounts of O₃ and NO_x.
10 These pollutants are associated with corona – the breakdown of air that is very near high-
11 voltage conductors. Corona is a phenomenon associated with all energized transmission lines.
12 Under certain conditions, the localized electric field near an energized conductor can be
13 sufficiently concentrated to produce a tiny electric discharge that can ionize air close to the
14 conductors (EPRI 1982). This partial discharge of electrical energy is called corona discharge,
15 or corona. Corona is most noticeable for higher-voltage lines during rain or fog conditions. In
16 addition to the small quantities of O₃ and NO_x that form, other manifestations of corona events
17 include energy loss, interference with radio or television transmission, and ambient noise
18 (see Section 3.3.3). Typically, corona interference with radio and television reception is not a
19 design problem. Interference levels in both fair and rainy weather are extremely low at the
20 ROW edge for 230-kV and lower transmission lines, and they usually meet or exceed the
21 reception guidelines of the Federal Communications Commission (FCC). Through the years,
22 line designs that greatly reduce corona effects have been developed. Because transmission
23 line emissions associated with corona discharge are so small when compared with emissions
24 from other sources of air pollution (e.g., ozone precursors from automobiles, power plants, and
25 large industrial boilers), these emissions are not a regulated source of air pollution in the
26 United States.

27
28 Airborne radiological releases during normal plant operation and associated doses to downwind
29 populations are discussed in Section 3.9.

30 31 **3.3.3 Noise**

32
33 The principal sources of noise from nuclear power plant operations are natural-draft and
34 mechanical-draft cooling towers, transformers, and loudspeakers. Other occasional noise
35 sources may include auxiliary equipment (such as pumps to supply cooling water) and corona
36 discharge. Generally, these plant noise sources are not perceived by a large number of people
37 offsite because the level of noise from the surrounding community and highway is high
38 (60 to 65 dB(A)) (FICN 1992). In rural or low-population areas, where background noise levels
39 are in a range of 35 to 45 dB(A), plant noises are more noticeable.

40

Affected Environment

1 In most cases, the sources of noise are far enough away from sensitive receptors outside plant
2 boundaries that the noise is attenuated to nearly ambient levels and is scarcely noticeable.
3 However, during the original license application process, some sites identified sensitive
4 receptors near plant boundaries that would experience noise greater than 10 dB(A) above
5 ambient levels. Those levels would increase the difficulty in communicating by speech
6 outdoors, requiring people to speak louder to be heard. In no case is the offsite noise level
7 from a plant sufficient to cause hearing loss.

8
9 There are no Federal regulations for public exposures to noise. When noise levels are below
10 the levels that result in hearing loss, impacts have been judged primarily in terms of adverse
11 public reactions to noise. The Department of Housing and Urban Development (24 CFR
12 51.101(a)(8)) uses day-night average sound levels of 55 dBA, recommended by EPA as
13 guidelines or goals for outdoors in residential areas (EPA 1974). However, noise levels are
14 considered acceptable if the day-night average sound level outside a residence is less
15 than 65 dBA.

16
17 Natural draft and mechanical draft cooling towers emit noise of a broadband nature, whereas
18 transformers emit a humming noise of a specific tonal nature at twice the normal voltage or
19 current cycle (core expansion and contraction twice its 60 Hz cycle) with a vibration or noise
20 harmonic of 120 Hz. This is called the fundamental noise frequency. Transformer noise
21 originates almost entirely in the reactor core as a result of the restrictive effects of steel on the
22 generated magnetic field, a phenomenon called magnetostriction, which causes the core and its
23 clamps to vibrate (Ellingson 1979). Since the core is not symmetrical and the magnetic effects
24 do not behave in a simple way, the resultant noise is not pure in tone. This is the noise or
25 vibration produced. The noise radiated by transformers is primarily composed of discrete tones
26 at even harmonics of line frequency (e.g., 120, 240, 360 Hz) when the line frequency is 60 Hz
27 (Vér and Beranek 2006).

28
29 Loudspeakers emit noise at audible frequencies, generally below 5000 Hz. Because of the
30 broadband character of the noise at cooling towers, the noise associated with the towers is less
31 obtrusive and is largely indistinguishable from the noise from transformers or loudspeakers.
32 Transformer noise is distinct because of its specific low frequencies. The low frequencies are
33 not attenuated with distance and intervening materials as much as higher frequencies are; thus,
34 low frequencies are more noticeable and obtrusive. However, at most sites employing cooling
35 towers, transformer noise is masked by the broadband cooling tower noise.

36
37 Cooling tower and transformer noise from existing equipment does not change appreciably
38 during the time when the plant is operating, nor does the crackling sound of transmission lines
39 during storms. Increases or decreases in site noise levels can occur when equipment is
40 upgraded or modified to meet life-cycle maintenance requirements or when the power level is
41 uprated.

1 Transmission lines can generate a small amount of sound energy during corona activity.
2 During corona events (see Section 3.3.2), the ionization of the air that surrounds conductors of
3 the high-voltage transmission lines, which is caused by electrostatic fields in these lines,
4 generates impulse corona currents. When the voltage on a particular phase is high enough, a
5 corona burst occurs, and a noise is generated. This noise occurs primarily on the positive
6 power line voltage wave and is referred to as positive corona noise (Maruvada 2000). Although
7 conductors are designed to minimize corona discharges, surface irregularities caused by
8 damage, insects, raindrops, or contamination may locally enhance the electric field strength
9 enough for corona discharges to occur (D'Amore 1985). This audible noise from the line can
10 barely be heard in fair weather on higher-voltage lines. During wet weather, water drops collect
11 on the conductor and increase corona activity so that a crackling or humming sound may be
12 heard near the line. This noise is caused by small electrical discharges from the water drops.
13

14 **3.4 Soils, Geology, and Seismology**

15
16 During the original construction of U.S. commercial nuclear power plants, large areas of land
17 were disturbed for the buildings, roads, parking lots, underground utilities (including cooling
18 water system intake and discharge systems), aboveground utility structures (including
19 transmission lines), cooling towers, and other structures. Nuclear power plant sites range in
20 size from 84 ac (34 ha; at the San Onofre plant in California) to 14,000 ac (5700 ha; at the
21 Clinton plant in Illinois) (Table 3.1-1). The proportions of land that were disturbed by
22 construction activities or remain undeveloped vary from site to site.
23

24 The soil resources available at each power plant are site-specific in terms of their potential
25 erodibility and their potential use for agricultural activities, and vary spatially on the basis of the
26 distribution of different soil types on the site. Many of the plants in the Midwest, Great Plains,
27 East, and Southeast (with the exception of plants in Florida) are located in areas with prime
28 farmland (USDA 2001). Nuclear plants in Florida and the West are not located near prime
29 farmland. Undeveloped or restored portions of each site may be leased by the licensees for
30 agricultural production. However, some areas may not be made available for leasing if they are
31 within a security zone.
32

33 Soils and subsoils at nuclear plant sites also vary in terms of their geotechnical properties
34 relative to site construction projects and their hydraulic properties relative to the movement of
35 infiltration, groundwater, and contaminants. Depending on the nuclear plant's location and
36 design, riverbanks or coastlines may need to be protected to prevent erosion, especially at
37 water intake or discharge structures.
38

39 Nuclear power plants are located in a variety of physiographic provinces, though the largest
40 numbers are in the Atlantic Coastal Plain and Central Lowlands provinces. Each physiographic

Affected Environment

1 province consists of a regional geologic terrain with a broadly similar structure and character.
2 However, within each province, the local geology may differ significantly from the regional
3 conditions. The geologic setting of each plant is therefore a site-specific function of the local
4 geology rather than the physiographic province in which it is located. Plants are located in a
5 wide variety of settings, including uplands along rivers, glaciated till plains, Great Lakes
6 shorelines, and coastal sites.

7
8 The geologic resources in the vicinity of each nuclear plant vary with the location and may
9 support extraction industries. These industries may include sand and gravel pit operations or
10 quarrying for crushed stone. In general, there is little if any interaction between plant
11 operations and local extraction industries, although some nuclear plants may purchase
12 materials for landscaping and site construction from local sources. Commercial mining or
13 quarrying operations are not allowed within plant boundaries.

14
15 Nuclear power plants are constructed according to seismic specifications in 10 CFR Part 50,
16 Appendix S. Their spent fuel pools are designed with reinforced concrete, allowing them to
17 remain operable through the largest earthquake that has occurred or is expected to occur in the
18 area. The U.S. Geological Survey (Frankel et al. 2005) mapped seismic hazards across the
19 United States. In terms of the peak horizontal acceleration with a 10 percent probability of
20 exceedance in 50 years, most nuclear power plants are located in seismically low-hazard areas,
21 with peak accelerations of 0 to 8 percent of gravity. However, the two California plants – Diablo
22 Canyon and San Onofre – are in locations with peak acceleration of 25 to 30 percent of gravity.
23 These plants have been designed to safely withstand the seismic effects associated with
24 earthquakes with epicenters at various locations and at various depths, magnitudes, and
25 ground accelerations (AEC 1973; Southern California Edison 2007).

26 27 **3.5 Hydrology**

28 29 **3.5.1 Surface Water**

30
31 The dominant water requirement at most nuclear power plants is cooling water, which, in most
32 cases, is obtained from surface water bodies. For this reason, most plants are located near
33 suitable supplies of surface water, such as rivers, reservoirs, lakes, the Great Lakes, oceans,
34 bays, or manmade impoundments. An exception is the Palo Verde plant in Arizona, which
35 relies on treated municipal wastewater for cooling. Because of the interaction between power
36 plants and surface water, issues arise in terms of both usage and quality. These are discussed
37 in separate sections below.
38

1 **3.5.1.1 Surface Water Use**

2
 3 Nuclear power plants withdraw large amounts of surface water to meet a variety of plant needs,
 4 especially for condenser cooling (Section 3.1.3). The commercial nuclear power plants
 5 considered in the 1996 GEIS are compared in Table 3.5-1 in terms of their condenser flow
 6 rates, when normalized to energy production. Included in the table are two plants (Nine Mile
 7 Point and Arkansas) that have two reactors each: one with a cooling tower and one with a
 8 once-through system. These were tallied separately in the table. The condenser flow rates are
 9 similar in magnitude for the various types of cooling systems. Although plants in warmer
 10 geographical locations might be expected to have higher water requirements for cooling, a
 11 comparison of the locations of the plants and the normalized water use by their cooling systems
 12 suggests there is not a correlation between high water use and warmer climate. Design factors
 13 are likely responsible for the overlapping ranges in condenser flow rates.

14
 15 For closed-cycle cooling systems featuring cooling towers, the amount of water consumed
 16 equates approximately to the amount of water lost through evaporation and drift. In this type of
 17 cooling system, the condenser flow rate is much larger than the withdrawal rate from a surface
 18 water body, and this withdrawal rate is essentially the water consumption rate of the system.
 19 For once-through cooling systems, the condenser flow rate is nearly equal to the surface water
 20 withdrawal rate, and the consumption rate is much less since water is returned directly to the
 21 surface water body and undergoes less evaporation than in a cooling tower.
 22

Table 3.5-1. Overall Condenser Cooling Water Flow Rate and Consumptive Water Loss Rate per 1000 MW(e)

Cooling System ^(a)	Number of Sites	Condenser Cooling Water Flow Rate per 1000 MW(e) in gpm (m ³ /s) ^(b)	Average Consumptive Water Loss per 1000 MW(e) in gpm (m ³ /s) ^(c)
Pond and/or canal	6	300,000 to 650,000 (19 to 41)	9300 (0.59)
Mechanical draft cooling tower	8	140,000 to 760,000 (9 to 48)	14,000 (0.89)
Natural draft cooling tower	19	170,000 to 760,000 (11 to 48)	13,000 (0.82)
Once-through cooling	37	250,000 to 900,000 (16 to 57)	8100 (0.51)
Once-through cooling with tower	6	220,000 to 680,000 (14 to 43)	Not available

(a) For cases of multiple reactors per site, the water use was combined if the reactors used the same type of cooling system. If multiple reactors at a site used different cooling systems (Nine Mile Point Nuclear Station and Arkansas Nuclear One), water use for each system was tallied separately.

(b) Source: NRC (1996).

(c) Source Giusti and Meyer (1977). Note that Giusti and Meyer calculated consumptive use for a different set of plants.

Affected Environment

1 Cooling towers consume water at 13,000 to 14,000 gpm (0.82 to 0.88 m³/s), normalized to
2 1000 MWe, as a result of evaporation and drift (Table 3.5-1) (Giusti and Meyer 1977).
3 Additional water requirements offset the blowdown returned to the surface water body. Water
4 withdrawal for plants with closed-cycle cooling systems is 5 to 10 percent of the withdrawal for
5 plants with once-through cooling systems, with much of this water being used for makeup of
6 water lost to evaporation (NRC 1996). An estimate of typical makeup water needs for plants
7 having closed-cycle cooling, normalized to a 1000 MW(e) reactor, is about 14,000 to
8 18,000 gpm (0.9 to 1.1 m³/s) for all makeup needs (NRC 1996). This range of makeup water
9 requirements includes not only the consumed water but also the offset of blowdown, which is
10 returned to the surface water body. Variation in water use among plants results from the
11 design of the cooling tower, concentration factor of recirculated water, climate at the site, plant
12 operating conditions, and other plant-specific factors.

13
14 Once-through cooling systems are somewhat more common than closed-cycle systems
15 (Table 3.5-1). For once-through systems, the water withdrawn is returned to the surface water
16 body with less consumptive loss (8100 gpm or 0.51 m³/s) per 1000 MW(e) because there is
17 less evaporation than that associated with cooling towers (Giusti and Meyer 1977). The
18 withdrawal rate from the surface water body, however, is much higher than that of a closed-
19 cycle system (e.g., in Table 3.5-1, compare the condenser flow rates needed for once-through
20 systems (which corresponds to their surface water withdrawal) with the consumptive loss of
21 closed-cycle systems (which corresponds to their makeup water requirements) and, therefore,
22 their surface water withdrawal). The thermal discharge from once-through cooling systems is
23 generally higher than that from cooling towers, as discussed below.

24
25 Additional operational surface-water-related needs at power plants include service water,
26 auxiliary system supplies, and radioactive waste systems. These needs combined are small
27 relative to the flow needed for condenser cooling (NRC 1996).

28
29 Nuclear plant water usage must comply with State, local, and regional regulations regarding
30 water supply. Most States require permits regulating surface water usage.

31
32 For plants relying on river water, consumptive water losses reduce surface water supplies for
33 other users downstream. In areas experiencing water availability problems, nuclear power plant
34 consumption could conflict with other existing or potential uses (e.g., municipal and agricultural
35 water withdrawals) and instream uses (e.g., adequate instream flows to protect aquatic biota,
36 recreation, and riparian communities). Water availability issues have not been generally noted
37 in past license renewal evaluations and are likely to occur only during times of extended
38 drought. Both water availability and water temperature are important factors in maintaining
39 operations at power plants. In August 2007, a heat wave resulted in high river water
40 temperatures at the Browns Ferry plant in Alabama (*Huntsville Times* 2007). Because of the
41 reduced capability of the river water to cool the condensers, one of the plant's three reactors

1 was shut down, while operations at its other two reactors were cut by 25 percent. In summer
 2 2006, the Quad Cities plant in Illinois had to reduce operations because the Mississippi River
 3 was warm, and other plants in Illinois and Minnesota had to cut back as a result of drought
 4 effects (Nuclear Information and Resource Service 2007). High surface water temperature at
 5 the intake does not represent an impact on the environment but rather an effect of the natural
 6 conditions on operations.

7
 8 **3.5.1.2 Surface Water Quality**

9
 10 Discharges from the circulating cooling water
 11 system account for the largest volumes of
 12 water and usually the greatest potential
 13 impacts on water quality and aquatic systems,
 14 although other systems may contribute heat
 15 and chemical contaminants to the effluent. All
 16 effluent discharges are regulated under the
 17 provisions of the Clean Water Act (CWA) and
 18 the effluent guidelines, limitations, and
 19 standards established by the EPA and
 20 individual States. Conditions of discharge for
 21 each plant are specified in its NPDES permit
 22 issued by the State or EPA. CWA Section 401

<p>Clean Water Act</p> <ul style="list-style-type: none"> • National Pollutant Discharge Elimination System (NPDES) permitting is required for wastewater discharge rate and chemical concentration limits. • Section 316(a) establishes thermal discharge restrictions. • Section 316(b) establishes standards for impingement and entrainment of aquatic organisms. Impingement and entrainment standards for individual plants are to be determined through best professional judgment.
--

23 requires an applicant for a Federal license to conduct activities that produce discharge into
 24 navigable waters to provide the licensing agency with a certification from the State. This
 25 certification implies that discharges will comply with CWA requirements (33 USC 1341). If the
 26 applicant has not received Section 401 certification, the NRC cannot issue a license, including a
 27 renewed license (10 CFR 51.10(c)). NRC recognizes that some states include a 401
 28 certification in the NPDES permit.

29
 30 **3.5.1.2.1 Thermal Effluents**

31
 32 NPDES permits for nuclear power plants may impose maximum temperature limits for effluents
 33 (which may vary by season) and/or a maximum temperature increase above the ambient water
 34 temperature (referred to as “delta-T,” which also may vary by season). Another approach used
 35 to regulate temperature effects is to specify a heat addition, which is calculated as a function of
 36 flow rate and temperature. Other aspects of the permit may include the compliance measuring
 37 location and restrictions against plant shutdowns during winter to avoid drastic temperature
 38 changes in surface water bodies.

39
 40 The area affected by heated releases to surface water bodies (the thermal plume) varies with
 41 site-specific conditions (e.g. discharge temperature, discharge rate, discharge structure location

Affected Environment

1 and design, flow of the surface water body, and temperature of the surface water body).
2 A plume may be assessed in the field through plume mapping or dye tracing. Generally, the
3 use of cooling towers decreases the thermal influence of a plant (e.g., NRC 2006c).

4
5 Sections 316(a) and 316(b) of the CWA are relevant to the operation of a nuclear power plant
6 cooling system. Section 316(a) addresses thermal discharges, allowing alternative thermal
7 discharge limits if the applicant can demonstrate protection of aquatic life. Section 316(b) deals
8 with cooling water intakes and ensures that intake structures are designed with the best
9 available technology to minimize impingement and entrainment of aquatic organisms. For this
10 section of the CWA, there are three implementation phases. Phase I (enacted in
11 December 2001) is for new facilities that use more than 2 million gpd (7.6 million L/d), with more
12 than 25 percent used for cooling purposes. Phase II (enacted in July 2004) is for existing
13 facilities that use more than 50 million gpd (189 million L/d). Phase III applies to existing
14 manufacturing facilities with a design intake flow of at least 50 million gpd (189 million L/d) and
15 new offshore and coastal oil and gas extraction facilities designed for withdrawing at least
16 2 million gpd (7.6 million L/d).

17
18 Phase II called for reducing impingement by 80 to 95 percent from an uncontrolled level and
19 reducing entrainment by 60 to 90 percent from an uncontrolled level. Included in Phase II were
20 compliance alternatives to existing technology, additional fish protection technologies
21 (e.g., screens and fish return systems), and restoration measures. However, effective
22 July 9, 2007, Phase II was suspended. According to the Clean Water Act, intakes are to be
23 designed by using the best technology available for minimizing any environmental impact.
24 Under EPA's interim guidance, intakes are now to be designed on a case-by-case basis by
25 using best professional judgment (EPA 2007).

26 27 **3.5.1.2.2 Other Effluents**

28
29 Liquids containing chemicals and other parameters are discharged to surface water from
30 nuclear power plants, as discussed in Section 3.1.4.1. The concentrations and flow rates of the
31 liquids vary with activities involving the systems associated with floor drains, blowdown,
32 laundries, decontamination, and other facilities. The liquids may also undergo treatment before
33 reuse or discharge. These effluents are regulated under the plant's NPDES permit. As part of
34 the permitting process, concentration limits are established, and monitoring takes place at
35 specific outfalls or other monitoring locations. The frequency of sampling is also covered by
36 permit. State regulatory agencies also provide the reporting requirements, and they may post
37 results on a publicly accessible Web site. Noncompliance issues may range from
38 administrative matters to exceedances of concentration, temperature, or flow limits. The
39 exceedance of a parameter limit will trigger the permitting agency to review the history and
40 magnitude of exceedance recurrences. Actions may include reviewing the permit for

1 appropriate parameter levels, setting a compliance schedule for the applicant, and, in a worst
2 case scenario, withdrawing a permit and disallowing the legal ability to discharge.

3
4 Sanitary sewage wastes are treated before their release to the environment to minimize
5 environmental impacts. The treatment may be through discharge to a municipal wastewater
6 treatment system, an onsite wastewater treatment plant, or an onsite septic system. In cases
7 where nonradioactive sanitary or other wastes cannot be processed by onsite wastewater
8 treatment systems, the wastes are collected by independent contractors and trucked to offsite
9 treatment facilities. Waste collection and offsite disposal can occur during a planned outage,
10 when portable toilets may be required to accommodate the additional workforce. Water quality
11 issues related to sanitary waste treatment include the adequacy of the wastewater treatment
12 capacity for handling the increased flow and loading associated with operational changes to the
13 plant, emission of phosphates from onsite laundries, suspended solids, coliform bacteria from
14 sewage treatment discharges, and other effluents that cause excessive biochemical oxygen
15 demand. State regulators are typically involved in site inspections, review of monitoring reports,
16 and handling of any violations.

17
18 The control of biological pests is critical to maintaining optimum system performance and
19 minimizing operating costs. Consequently, many nuclear power plant cooling systems are
20 periodically treated with molluscides to control the Asiatic clam (*Corbicula fluminea*) and the
21 zebra mussel (*Dreissena polymorpha*), which are generally found in the portions of the cooling
22 system where water temperatures are ambient rather than heated.

23
24 Biocides also are commonly used in cooling towers, although they may also be used in once-
25 through systems or cooling ponds (Veil et al. 1997). Discharge of these chemicals to the
26 receiving body of water can have toxic effects on aquatic organisms. Chlorine is commonly
27 used as a biocide at nuclear power plants and represents the largest potential source of
28 chemically toxic release to the aquatic environment. It may be injected at the intake or targeted
29 at various points (such as the condensers) on an intermittent or continuous basis. Chlorine
30 gas, which was commonly used in the past, has been replaced by many users with other forms,
31 such as bleach (sodium hypochlorite) (Veil et al. 1997). Bromide compounds have been used
32 increasingly in recent years, either in place of or in addition to chlorine treatments. Non-
33 oxidizing biocides used to control zebra mussels and other organisms include quaternary
34 ammonia salts, triazine, glutaraldehyde, and other organic compounds.

35
36 Most plants have a storm water management plan, with the parameter limits of the storm water
37 outfalls included in the NPDES permit. Plants may also have a spill prevention, control, and
38 countermeasures plan that contains information on potential liquid spill hazards and the
39 appropriate absorbent materials to use if a spill occurs.

40

1 **3.5.2 Groundwater**
2

3 Some nuclear power plants also use groundwater as a source of water for some of their
4 operational needs. The rate of usage varies greatly among the plants. Many plants use
5 groundwater only for the potable water system and require less than 100 gpm (0.006 m³/s). At
6 some plants, the original construction required dewatering of a shallow aquifer by using
7 pumping wells or a drain system. Some plants operate dewatering systems to lower the
8 groundwater table near buildings. This is accomplished either by pumping or by having footing
9 drains along foundations. Groundwater may also be used for sanitary uses or landscaping, and
10 it may undergo processing to be used for makeup or service water systems. Groundwater
11 usage regulations vary considerably from State to State, and State allocation permits are
12 typically required.
13

14 At the Grand Gulf plant in Mississippi, Ranney wells are used to withdraw groundwater along
15 the Mississippi River at relatively high rates. Ranney wells are large-diameter wells with radial
16 collector arms. They are installed in alluvial aquifers along rivers to obtain a mixture of
17 groundwater and surface water through induced infiltration. At Grand Gulf, the average
18 groundwater pumping rate by their well systems was higher than 21,000 gpm (1.3 m³/s) in 2001
19 (System Energy Resources, Inc. 2005). The water withdrawn at Grand Gulf may be used as
20 makeup, service, potable, or sanitary water or for landscaping or fire protection.
21

22 The quality of groundwater may be affected by water from nuclear power plant cooling ponds
23 that has seeping into the underlying surficial aquifer. Activities at power plants typically include
24 general industrial practices, such as the storage and use of hydrocarbon fuels (diesel and/or
25 gasoline), solvents, and other chemicals. These practices have the potential to contaminate
26 soil and groundwater, and, at some plants, this contamination has occurred. Examples from
27 plant-specific SEISs include leakages or spills of gasoline (with methyl tertiary butyl ether, or
28 MTBE) at fuel tank storage areas, spills of fuel at transfer or filling stations, solvent leakages
29 from storage area drums, spilled or sprayed solvents, and underground line leaks of hydraulic
30 oil or diesel fuel (NRC 2006b, 2007c). These incidents have involved regulatory oversight, with
31 authority falling under State regulations for hydrocarbons and under RCRA for other chemicals.
32

33 Radionuclide releases, primarily tritium, to groundwater have become an issue in recent years
34 because of incidents at the Indian Point, Braidwood, Callaway, Dresden, Byron, and Palo Verde
35 plants (NRC 2007d). The NRC (2006c) has examined the issue and noted the leaks are
36 generally not observable because they are underground and because many plants do not have
37 on-site groundwater monitoring wells. Although the plants are not under any specific regulatory
38 requirements to have on-site groundwater monitoring programs, they are required to perform
39 surveys, evaluate, and document the event and the hazard of known spills or leaks of
40 radioactive material. The NRC has reporting requirements based on the amount of radioactivity
41 released; thus any large spills or leaks will be reported. Additionally it is important to note that

1 all plants are required to submit an annual report, which is publically available, to the NRC
2 which summarizes the types and quantities of radioactive material released into the
3 environment. In response to these groundwater events, the Nuclear Energy Institute (2007a),
4 which represents the nuclear industry, committed to the NRC to have site-specific groundwater
5 protection programs in place at each site by July 31, 2006. These programs cover the
6 assessment of plant systems and components, site hydrogeology, and implementation of
7 groundwater monitoring programs. To monitor the actions of the nuclear industry, the NRC
8 updated its inspection procedure to include this issue as part of its routine radiological
9 inspection at all nuclear power plants.

10 11 **3.6 Ecology**

12
13 A wide variety of ecological resources exist at and in the vicinity of operating nuclear power
14 plants across the United States. This section presents an overview of those resources.
15 Terrestrial resources (including wetlands and floodplains, which are transitional areas between
16 terrestrial and aquatic systems), aquatic resources, and threatened, endangered, and protected
17 species and essential fish habitat are discussed in Sections 3.6.1, 3.6.2, and 3.6.3,
18 respectively. The effects of past activities, including construction and operations, and current
19 operations at plant sites are summarized.

20 21 **3.6.1 Terrestrial Ecology**

22
23 Operating commercial nuclear power plants are located in 31 States across the continental
24 United States. These power plants have been sited in a wide variety of terrestrial habitat types.
25 For the purposes of this analysis, terrestrial ecological resources in the vicinity of nuclear power
26 plants are described in terms of upland vegetation and habitats, floodplain and wetland
27 vegetation and habitats, and wildlife. A discussion of threatened and endangered terrestrial
28 species is provided in Section 3.6.3.1.

29 30 **3.6.1.1 Upland Vegetation and Habitats**

31
32 Terrestrial vegetation and habitats include habitats such as forests, grasslands, and
33 shrublands. These habitats were affected by the initial construction of nuclear power plants,
34 normal operations associated with nuclear power plants, and successional changes occurring
35 within vegetation communities. In general, the level of land management varies by area at a
36 nuclear power plant. See Section 3.2.1 for a general description of land use at a nuclear power
37 plant.

38
39 Impacts on terrestrial vegetation and habitats can result from a number of activities or
40 processes during normal operations at a nuclear power plant. Since startup of operations,

Affected Environment

1 areas on the nuclear plant sites within the security fence have typically been maintained as
2 modified landscapes, but they may also include disturbed early successional habitats, or areas
3 of relatively undisturbed habitat. Maintenance of portions of the site by mowing and herbicide
4 or pesticide application keeps the diversity of plant species at a reduced level. Native plant
5 species are often replaced by cultivated varieties or weedy species tolerant of disturbance.
6 Areas of the plant site outside the security fence may include natural areas, such as forest or
7 shrubland, in various degrees of disturbance.

8
9 Terrestrial habitats near nuclear plants can be subject to radiological releases under normal
10 plant operations. These habitats are exposed to small amounts of radionuclides that result
11 from the deposition of particulates released from power plant vents during normal operations.
12 Releases typically include noble gases (which are not deposited), tritium, isotopes of iodine,
13 and cesium, and they may also include carbon-14, strontium, cobalt, and chromium. Exposure
14 to these radionuclides results in a dose rate to terrestrial plants of much less than 0.1 rad/d
15 (0.001 Gy/d).^(a) This rate is considerably lower than 1.0 rad/d (0.01 Gy/d), which is the DOE
16 guideline level for impacts on terrestrial plant species (DOE 2002). Radionuclides, such as
17 tritium, and other constituents in cooling water systems, such as biocides, that enter shallow
18 groundwater from cooling ponds can be taken up by terrestrial plant species.

19
20 Terrestrial habitats near plants with closed-cycle cooling water systems are subject to the
21 deposition of cooling tower drift particulates (including salt); the deposition of water droplets on
22 vegetation from drift; structural damage from freezing vapor plumes; and increased humidity
23 from cooling towers and cooling ponds. Small amounts of particulates from cooling towers are
24 dispersed over a wide area, with particulates from natural draft towers being dispersed over a
25 larger area and at a lower deposition rate than those from mechanical draft towers (NRC 1996).
26 However, most of the deposition from cooling towers occurs in relatively close proximity to the
27 towers. Generally, deposition rates are below those that are known to result in measurable
28 adverse effects to plants, and no deposition effects on agricultural crops or plant communities
29 have been observed at most of the power plants. However, exceptions have been observed at
30 some nuclear plants (NRC 1996). Impacts from icing, when they have occurred, have been
31 minor and localized near cooling towers.

32
33 Effects of nuclear power plant operations on terrestrial habitats also include the effects of
34 transmission line ROWs and their maintenance. ROWs through undeveloped areas contribute
35 to habitat fragmentation and affect the distribution of species in undisturbed areas near the
36 corridors. These effects may result in gradual, ongoing changes in the composition and
37 diversity of species in these undisturbed areas. Plant communities in and along ROWs are
38 maintained in a modified condition for safe and efficient operation of the transmission lines.

(a) Dose rates were calculated on the basis of media concentrations provided in nuclear power plant radiological monitoring reports (see Section D.5 in Appendix D).

1 ROW management typically includes the periodic cutting of tall woody vegetation and use of
 2 herbicides. Management activities and transmission line repair occasionally result in the
 3 erosion of exposed soils where vegetation is removed or where soils are disturbed by
 4 equipment. ROW corridors occasionally provide a means for the introduction or expansion of
 5 populations of invasive species.

6 7 **3.6.1.2 Floodplain and Wetland Vegetation** 8 **and Habitats**

9
10 Floodplains occur as lowlands along rivers and
11 coastlines near many nuclear plants. They are
12 typically identified as areas that have a chance
13 of at least 1 percent of flooding in any given
14 year; these are also described as 100-year
15 floodplains. Activities related to nuclear plant
16 construction and operations that have occurred
17 in floodplains include the construction and
18 maintenance of cooling water intakes and
19 outfalls and transmission line ROWs. Activities
20 undertaken by Federal agencies are regulated
21 under Executive Order 11988, *Floodplain*
22 *Management*. One requirement of this order is
23 for Federal agencies to restore and preserve
24 the natural and beneficial values served by
25 floodplains. Floodplain values include
26 attenuation of the extent of flooding, which
27 supports wetlands, fish, and wildlife.

28
29 A wide variety of wetland types occur near
30 nuclear power plants. These include riverine, palustrine, lacustrine, estuarine, and marine
31 wetland types as described by the U.S. Fish and Wildlife Service (USFWS) (Cowardin
32 et al. 1979) for the National Wetlands Inventory (NWI). Most nuclear plants have wetlands
33 nearby (within a radius of 5 mi), and wetlands cover an average of 3 percent of the land area
34 near the plants, as mapped by the NWI (USFWS 2007a). The National Land Cover Database
35 (USGS 2007) and New Jersey State database were used for the sites that were lacking digital
36 NWI data. Wetlands exclude deepwater habitats, which are permanently flooded coastal areas
37 and which occupy, on average, 10 percent of the area within 5 mi of the plants. The proportion
38 of wetlands and deepwater habitats within 5 mi (8 km) of nuclear plants is presented in
39 Table D.5-3 in Appendix D.
40

Wetland Types That Occur near Nuclear Power Plants

- ***Riverine wetlands*** are contained within a channel that has moving water, at least periodically, and they lack persistent vegetation.
- ***Palustrine wetlands*** primarily support trees, shrubs, or persistent emergent plants, or they can be small (generally under 20 ac or 8 ha), shallow wetlands lacking such plant communities.
- ***Lacustrine wetlands*** are large or deep bodies of water that lack persistent vegetation.
- ***Estuarine wetlands*** occur near land with access to the ocean, are influenced by tides, and are diluted to a variable extent by freshwater.
- ***Marine wetlands*** are exposed to open ocean waves and currents and may be slightly diluted by freshwater.

Source: Cowardin et al. 1979

Affected Environment

1 Wetlands were affected by the initial plant construction and various aspects of plant operation
2 during the period of the initial plant operating license. These effects included those associated
3 with facility construction, transmission line ROW construction and maintenance, the
4 construction and operation of cooling systems, and storm water management. Effects to
5 wetlands from construction activities and storm water runoff often include changes in vegetative
6 plant community characteristics, altered hydrology, decreased water quality, and sedimentation
7 (Wright et al. 2006; EPA 1996). Wetland losses occurred during the construction of many
8 nuclear power plants. For example, construction of the Oyster Creek plant in New Jersey
9 resulted in the loss of 200 acres of several types of wetlands (AEC 1974). However, at plants
10 using cooling ponds, new wetland habitats may form along the margins of those ponds such as
11 can be found along portions of the Robinson Reservoir, the H.B. Robinson nuclear plant cooling
12 pond (NRC 2003b), and Parr Reservoir used for storage exchange and makeup water for the
13 Summer plant cooling pond (NRC 2004b). Forested wetlands in ROWs are converted to
14 scrub/shrub or emergent wetland types when trees are removed, and ROW management
15 programs maintain the ROW in these habitat types. The operation of heavy equipment in
16 wetlands during ROW maintenance or transmission line repair can damage or compact wetland
17 soils and vegetation and may promote the establishment of invasive species (BPA 2000).

18
19 The operation of cooling water intake and discharge systems can increase the salinity of stream
20 segments, as has occurred at the Oyster Creek plant (NRC 2007c), or expose wetland habitats
21 to thermal impacts and contaminants in discharged cooling water or cooling tower blowdown.
22 The maintenance of intake or discharge structures may damage wetland habitats, and the
23 disposal of dredged sediments may affect wetlands. Maintenance activities on the plant sites or
24 ROWs may also result in chemical or fuel spills that may affect wetlands. Contaminants that
25 enter groundwater may affect wetlands that receive groundwater discharge. Executive
26 Order 11990, *Protection of Wetlands*, requires Federal agencies not only to minimize the
27 destruction, loss, or degradation of wetlands while they are conducting their activities but also to
28 preserve and enhance the natural and beneficial values of wetlands. Many activities that occur
29 in wetlands are regulated under Section 404 of the Clean Water Act (CWA). Actions that result
30 in the discharge of dredge or fill material into wetlands that are under the jurisdiction of the
31 CWA require a permit from the U.S. Army Corps of Engineers (USACE).

32

33 **3.6.1.3 Wildlife**

34

35 Wildlife populations on and in the vicinity of nuclear power plants have also been affected by
36 plant construction and operations. The initial construction of the plants and transmission line
37 ROWs reduced the available terrestrial habitat at sites; habitat losses in many cases total
38 hundreds of acres. Because habitats along transmission line ROWs are maintained in a
39 modified condition, the wildlife communities they support are different than those found in
40 undisturbed habitats. Some predator species, such as skunks and raccoons, more readily use
41 ROW habitats, and ROWs may therefore provide a means for new or easier access to some

1 areas, thereby affecting populations of prey species (Evans and Gates 1997; Crooks and
2 Soulé 1999). Wildlife species in the vicinity of transformers or cooling towers are exposed to
3 elevated noise levels that disrupt behavior patterns. Wildlife species near transmission lines
4 are exposed to electromagnetic fields. However, there is currently a lack of conclusive
5 evidence that biological systems are affected by electromagnetic fields (see Section 3.9.4).
6 Atmospheric or surface water releases can result in the exposure of wildlife to contaminants.
7 Wildlife is exposed to small amounts of radionuclides from the deposition of particulates
8 released from power plant vents during normal operations. Exposure of upland and riparian
9 wildlife to these radionuclides results in a dose rate of much less than 0.1 rad/d (0.001 Gy/d),
10 which is the guideline for protection of riparian and terrestrial wildlife (DOE 2002).^(a) This rate is
11 considerably lower than rates known to result in measurable impacts.

12
13 Natural draft cooling towers and transmission lines create collision hazards for migratory and
14 local bird species. Monitoring of bird collisions has been done at several nuclear plants with
15 natural draft cooling towers. The results of those monitoring efforts indicate that cooling towers
16 at nuclear power plants do cause some collision mortality for migrating songbird species;
17 however, these deaths represent only a fraction of the total annual bird collision mortality from
18 all man-made sources. See Section 4.6.1.1 for a detailed description of bird collision mortality
19 at nuclear power plants.

20
21 There are no reports of relatively high collision mortality occurring at the transmission lines
22 associated with nuclear power plants in the United States. The length of these lines is
23 considerably less than the total 500,000 mi (800,000 km) of transmission lines estimated within
24 the United States (Manville 2005). Although the data are not available, transmission lines
25 associated with nuclear power plants are likely responsible for only a small fraction of total bird
26 collision mortality associated with transmission lines nationwide. See Section 4.6.1.1 for a
27 detailed description of bird collision mortality at nuclear power plants.

28
29 Cooling system intakes can create an impingement hazard for waterfowl, and water demands
30 for cooling can create water-use conflicts with wildlife. At the Nine Mile Point plant in New York,
31 for example, approximately 100 greater scaup (*Aythya marila*) and lesser scaup (*Aythya affinis*)
32 ducks were impinged at the cooling water intake structure in 2000 (NRC 2006d).

33
34 Species that occupy onsite habitats are exposed to a variety of factors associated with plant
35 operations and maintenance. The maintenance required for landscaped areas generally keeps
36 the diversity of wildlife located there less than it is in surrounding habitats. Wildlife species
37 occurring on the sites within the security areas are typically limited by the low quality of the
38 habitat and generally include common species adapted to industrial developments.

(a) Dose rates were calculated based on information provided in nuclear power plant radiological monitoring reports (see Section D.5 in Appendix D).

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38

3.6.2 Aquatic Ecology

Nuclear power plants are usually located near relatively large water bodies, such as major rivers and reservoirs, the Great Lakes, and estuarine and marine coastal areas, because of the amount of water that is needed to meet cooling system demands (Table 3.1-2). In the few cases where a power plant is located near small streams (e.g., the Summer plant in South Carolina and the Clinton plant in Illinois), the streams have been impounded to create cooling lakes. The water bodies in the vicinity of the power plants contain a complex assemblage of habitats and species that may be affected by a plant's cooling system and by maintenance of the transmission line ROWs. The following text presents an overview of the habitats and aquatic biota in the vicinity of nuclear power plants, followed by an overview of the effects of existing power plant operations on aquatic resources.

3.6.2.1 Description of Aquatic Resources near Nuclear Power Plants

This section presents an overview of the aquatic habitats and biota that occur in the vicinity of nuclear power plants. Emphasis is placed on the major ecosystem types (i.e., freshwater rivers, reservoirs, and lakes and coastal estuarine and marine systems) and major groups of aquatic biota (i.e., fish, other aquatic vertebrates, macroinvertebrates, zooplankton, phytoplankton, and macrophytes). An overview of the effects of existing power plant operations on aquatic resources is provided in Section 3.6.2.2. A discussion of threatened and endangered aquatic species, marine mammals, and essential fish habitat is provided in Section 3.6.3.2.

3.6.2.1.1 Aquatic Habitats

The aquatic ecological communities that occur in the vicinity of U.S. nuclear power plants are very diverse because of the differences in their geographies and habitat types and in the physical and chemical conditions of the water bodies located near them. The geographical setting, physical conditions (e.g., substrate type, temperature, turbidity, and light penetration), chemical factors (e.g., dissolved oxygen levels and nutrient concentrations), biological interactions (e.g., competition and predation), seasonal influences, and man-made modifications and actions all interact to influence the types of species present and the nature of the aquatic community in a particular aquatic ecosystem. Nuclear plants use freshwater, estuarine, and marine ecosystems as their cooling water sources, except for the Palo Verde plant, which uses Phoenix City sewage effluent (Table 3.1-2).

1 Freshwater systems can be broadly
 2 categorized as lentic or lotic, depending on the
 3 degree of water movement. Lentic systems
 4 refer to water bodies that have standing or
 5 slow-flowing water, such as that found in
 6 ponds, lakes, reservoirs, and some canals.
 7 Most lentic habitats stratify during summer
 8 (monomictic) or during summer and winter
 9 (dimictic). Lotic habitats generally have a
 10 measurable velocity and include natural rivers
 11 and streams and also some artificial
 12 waterways. Most lotic habitats do not generally
 13 stratify (Morrow and Fischenich 2000).
 14 Although some freshwater aquatic species
 15 occur in both lentic and lotic habitats, many
 16 species are adapted to the physical, chemical,
 17 and ecological characteristics of one system or
 18 the other, and the overall ecological
 19 communities present within these aquatic
 20 ecosystem types will differ for a given region of
 21 the country.

22
 23 Species composition and ecological conditions
 24 within riverine environments are largely determined by the geographic area, gradient of the river
 25 bed, velocity of the current, and source of nutrients and organic matter at the base of the food
 26 chain. Thus, ecological communities in rivers become altered if the river is impounded, with the
 27 degree of alteration depending on the degree to which various physical and chemical conditions
 28 are affected. Environmental threats to rivers include depletion of water, dams that alter flow
 29 and temperature characteristics and can block the upstream or downstream movement of
 30 aquatic organisms, chemical pollution, and the introduction of nonnative species. For example,
 31 the USFWS was concerned that a pond created by damming Oyster Creek to supply a source
 32 of water for fighting fires at the Oyster Creek plant in New Jersey could impede the movement
 33 of migratory species, such as the American shad (*Alosa sapidissima*) or American eel (*Anguilla*
 34 *rostrata*) (NRC 2007c).

35
 36 Major rivers that serve as cooling water sources include the Mississippi River (Minnesota,
 37 Illinois, Mississippi, and Louisiana; six plants), Missouri River (Nebraska and Missouri; three
 38 plants), Susquehanna River (Pennsylvania; three plants), Delaware River (New Jersey; two
 39 plants), Hudson River (New York; one plant), and Columbia River (Washington; one plant)
 40 (Table 3.1-2). Some power plants that use rivers for cooling are located on sections of rivers
 41 that have been impounded to slow the rate of flow and create pooled areas in the vicinity of

Aquatic Ecosystem Types

- **Freshwater:** Waters that contain a salt concentration of less than 1 percent.
 - **Lentic:** Standing or slow-flowing fresh water (e.g., lakes and ponds).
 - **Lotic:** Flowing fresh water with a measurable velocity (e.g., rivers and streams).
- **Marine:** Waters that contain a salt concentration of about 3 percent (e.g., ocean overlying the continental shelf and associated shores).
- **Estuarine:** Coastal bodies of water, often semi-enclosed, which have a free connection with marine ecosystems (e.g., bays, inlets, lagoons, and ocean-flooded river valleys). In these areas, freshwater merges with marine waters; salinity concentrations vary spatially and temporally due to location and tidal activity.

Affected Environment

1 cooling water withdrawal or discharge structures. These sections are not as clearly lentic in
2 nature as are reservoirs.

3
4 Lentic ecosystems can be broadly divided into littoral, pelagic, and profundal habitat zones on
5 the basis of water depth and light penetration in the water. Littoral habitats refer to nearshore
6 shallower waters where sufficient light reaches the bottom so that rooted plants are able to
7 grow. Pelagic habitats include open offshore waters where light intensity is great enough for
8 photosynthesis to occur. Profundal habitats are found in deep-water areas that are beyond the
9 depth at which light penetration is great enough to support photosynthesis (Armantrout 1998).
10 The ecological communities that inhabit these zones differ, reflecting the preferences and
11 tolerances of aquatic species at various life stages for the physical and chemical conditions that
12 exist. Within the United States, 10 nuclear power plants use water from natural lakes for
13 cooling (Table 3.1-2): Lake Erie (Ohio and Michigan; three plants), Lake Michigan (Michigan
14 and Wisconsin; four plants), and Lake Ontario (New York; three plants).

15
16 The species diversity and biomass of fish are greater in the nearshore than in the offshore
17 areas of the Great Lakes (Edsall and Charlton 1997). The nearshore areas offer a variety of
18 habitat conditions (e.g., morphometric features, current velocities, substrates, and aquatic
19 vegetation) that provide conditions that are optimal to most species of fish in the Great Lakes
20 for at least some portion of their life cycle. Of 139 Great Lakes fish species reviewed by
21 Lane et al. (1996, as reported in Edsall and Charlton [1997]), all but five species (four species
22 of deepwater ciscoes [*Coregonus* spp.] and the deepwater sculpin [*Myoxocephalus thompsoni*])
23 use waters less than 33 ft (10 m) deep for nursery habitat. Some of the threats to the
24 ecological integrity of the Great Lakes are reviewed in Beeton (2002); they include
25 eutrophication (nutrient enrichment), land-use changes, overfishing, invasive species, and
26 pollution (Beeton 2002). Constraints have been implemented in recent years to reduce nutrient
27 inputs and control land use changes, such as shoreline alteration and destruction of wetlands.
28 Invasive species have become a major problem as nonindigenous species gain access to the
29 Great Lakes. Examples of invasive nonnative aquatic organisms that have become established
30 in the Great Lakes include the round goby (*Neogobius melanostomus*), zebra mussel
31 (*Dreissena polymorpha*), spiny waterflea (*Bythotrephes cederstroemi*), and quagga mussel
32 (*Dreissena bugensis*). The introduction of such species can result in changes to native
33 ecological communities (Dermott and Kerec 1997). These threats to the integrity of the Great
34 Lakes are likely to continue (Beeton 2002).

35
36 Reservoirs refer to areas of rivers or streams that are impounded by a dam or water control
37 structure such that they have become physically, chemically, and ecologically more similar to
38 lakes instead of the lotic system from which they are formed (Armantrout 1998). In the
39 United States, 14 nuclear power plants use water from reservoirs for cooling (Table 3.1-2).
40 Fish species that thrive in the habitat conditions that exist within a given reservoir are often
41 stocked and managed to support recreational fisheries.

1
2 Brackish to saltwater estuarine and marine ecosystems occur along the coastlines of the United
3 States. General habitat types found within these ecosystems include the mouths of rivers, tidal
4 streams, shorelines, salt marshes, beaches, mangroves, submerged aquatic vegetation, coral
5 reefs, and open water. Estuaries are particularly important as staging points during the
6 migration of certain fish species (e.g., salmon and eels), giving them time to form schools and
7 to physiologically adjust to the changes in salinity. Many marine fish and invertebrate species
8 use estuaries for spawning or as places where young fish can feed and grow before moving to
9 other marine habitats. Estuarine and marine habitats support important commercial or
10 recreational finfish and shellfish species. In the United States, 16 nuclear power plants use
11 water from estuarine or marine environments (Table 3.1-2).

12 13 **3.6.2.1.2 Aquatic Organisms**

14
15 A great diversity of aquatic organisms could be affected by nuclear plant operations. Power
16 plant effects can be analyzed by studying representative important species (e.g., indicator
17 species or species groups). McLean et al. (2002) identified the following representative
18 important species:

- 19
20 • Species sensitive to adverse harm from plant operations (e.g., thermally sensitive
21 species);
- 22
23 • Species that use the local area for spawning or nursery grounds (including those
24 species that migrate past the plant to spawn);
- 25
26 • Species of commercial or recreational value;
- 27
28 • Species that are habitat formers and critical to the functioning of the local ecosystem;
- 29
30 • Species that are important links in the local food web;
- 31
32 • Rare, threatened, or endangered species; and
- 33
34 • Potential nuisance species likely to be enhanced by plant operations.

35 36 **Fish**

37
38 Fish can be characterized as freshwater, estuarine, marine, and migratory (e.g., anadromous
39 and catadromous) species. The first three categories are based on salinity regimes, whereas
40 the migratory category is composed of reproductively specialized fish that migrate between
41 freshwater and saltwater (or vice versa) to reproduce (Murdy et al. 1997). Murdy et al. (1997)

Affected Environment

1 defined freshwater fish as those that usually inhabit waters with a salinity of less than 0.5 parts
2 per thousand (ppt) (although some species can tolerate a salinity as high as 10 ppt); estuarine
3 fish as those that inhabit tidal waters with salinities that range between 0 and 30 ppt; and
4 marine fish as those that typically live and reproduce in coastal and oceanic waters with
5 salinities that are more than 30 ppt. Anadromous species migrate from the ocean waters to
6 freshwater to spawn, while the opposite situation occurs for catadromous species.
7 Anadromous species include sturgeons, clupeids, salmonids, smelts, striped bass (*Morone*
8 *saxatilis*), and the sea lamprey (*Petromyzon marinus*). Within the United States, the only
9 catadromous species is the American eel. For some species, migratory movements may be
10 confined within a freshwater system (e.g., species tend to move to upstream areas for
11 spawning) or in the ocean (e.g., species tend to move northward as waters warm and
12 southward as they cool). A few species such as the tarpon (*Megalops atlanticus*) move freely
13 between fresh and marine waters for purposes not related to spawning (Lagler et al. 1962).
14 Many of the fish species that occur in the vicinity of the power plants are of considerable
15 commercial and/or recreational importance, while others serve as forage for those species.
16

17 Fish have developed various regulatory mechanisms to maintain their overall performance at a
18 wide range of body temperatures as a result of being subjected to large diurnal or seasonal
19 changes in water temperature (Claireaux et al. 2006). Nevertheless, freshwater fish can be
20 classified as coldwater, coolwater, or warmwater species. Coldwater fish (e.g., trout and
21 salmon) have an upper lethal temperature of about 77°F (25°C), warmwater species
22 (e.g., gizzard shad [*Dorosoma cepedianum*], common carp [*Cyprinus carpio*], largemouth bass
23 [*Micropterus salmoides*], and sunfish [*Lepomis* spp.]) have an upper lethal limit as high as
24 97°F (36°C), and coolwater species have upper lethal temperature limits similar to or slightly
25 lower than those of warmwater species (e.g., freshwater drum [*Aplodinotus grunniens*], yellow
26 perch [*Perca flavescens*], smallmouth bass [*Micropterus dolomieu*], walleye [*Sander vitreus*],
27 and sauger [*S. canadensis*]), but they usually require cooler average temperatures during their
28 growing season (Morrow and Fischenich 2000). Preferred summer temperatures are below
29 59°F (15°C) for coldwater species, 70 to 77°F (21 to 25°C) for coolwater species, and 81 to
30 88°F (27 to 31°C) for warmwater species (Magnuson et al. 1979). As summarized by
31 Armour (1991), the highest average mean weekly temperatures tolerated by coldwater,
32 coolwater, and warmwater fish species are 72°F (22°C), 84°F (29°C), and 86°F (30°C); while
33 their respective spawning temperatures are less than 55°F (12.8°C), 40 to 60°F (4.4 to 15.6°C),
34 and above 60°F (15.6°C).
35

36 The swimming performance of fish is influenced by temperature. Maximum swimming speed
37 and endurance peak at an optimum temperature, are reduced at low temperatures, and
38 decrease as temperatures approach the upper thermal limit (Claireaux et al. 2006). Many of
39 the marine fish species have buoyant eggs, while most stream fish have eggs that are heavy
40 and sink (demersal). Most demersal eggs are also, at least temporarily, adhesive
41 (Lagler et al. 1962). Most marine fish species have high fecundity (e.g., a female may produce

1 thousands to millions of eggs per year); while most freshwater fish produce hundreds to
2 thousands of eggs per year. However, newly hatched larvae undergo mortality rates of 5 to
3 30 percent per day as a result of predation, starvation, disease, pollution, and other causes
4 (Batty and Blaxter 1992).

5 6 **Other Aquatic Vertebrates**

7
8 In addition to fish, other vertebrate species can be present in the aquatic ecosystems near
9 nuclear plants. These include sea turtles, American crocodile (*Crocodylus acutus*), waterfowl,
10 seals, and the West Indian manatee (*Trichechus manatus*). The effects that power plant
11 operations have had on these species are discussed in Section 4.6.1.2.

12 13 **Aquatic Macroinvertebrates**

14
15 Aquatic macroinvertebrates include a diverse range of taxa, including immature and adult
16 insects, crustaceans, mollusks, and worms. They can occur on a variety of substrates, plants,
17 debris, and submerged portions of manmade structures and within the water column (Fremling
18 and Drazkowski 2000). Macroinvertebrates control key ecosystem processes, such as primary
19 production, decomposition, nutrient regeneration, water chemistry, and water clarity. High
20 densities of macroinvertebrates can be attained, as exemplified by midge (Chironomidae)
21 larvae – 4650/ft² (50,000/m²); Asiatic clams (*Corbicula fluminea*) – 2325/ft² (25,000/m²); and
22 zebra mussels (*Dreissena polymorpha*) – 46,500/ft² (500,000/m²) (GSMFC 2005; Pennak 1953;
23 Sprecher and Getsinger 2000).

24
25 Mussels are planktivores and are prey items for some fish and other vertebrates. They depend
26 on good water quality and physical habitat conditions and on an environment that will support
27 populations of their host fish species. Williams et al. (1993) reported the nearly 300 native
28 freshwater mussels in the United States and Canada, nearly 72 percent are considered
29 endangered, threatened, or of special concern; almost 5 percent are of undetermined status;
30 and less than 24 percent are considered stable. Mussels occur in the vicinity of most plants
31 that use freshwater as a cooling water source.

32
33 In addition to native freshwater mussels, several species of mussels and clams have been
34 introduced to the United States and have reached nuisance levels. Most notable among these
35 are the Asiatic clam and the zebra mussel. These species can alter trophic and nutrient
36 dynamics of aquatic ecosystems and displace native mussels. The ability of Asiatic clams and
37 zebra mussels to clog water systems makes them a serious and costly problem for utilities
38 (Morgan et al. 2003). Densities of zebra mussels can be as high as 78,000/ft² (840,000/m²) in
39 utility water pipes (IDNR undated). Many of the nuclear plants have programs in place to
40 monitor for these species, and, as appropriate, to control them, usually using biocides.

Affected Environment

1 **Zooplankton**

2

3 Zooplankton is the animal component of the plankton community and includes protozoans,
4 crustaceans, and the drifting larvae of fish and macroinvertebrates. Rotifers, cladocerans, and
5 copepods are primary components of the zooplankton community in freshwater ecosystems.

6 The zooplankton of estuarine and marine ecosystems include eggs, larvae, juveniles, and/or

7 adults of anemones, jellyfish, bristleworms, sea urchins, starfish, copepods, isopods,

8 amphipods, shrimp, crabs, lobsters, bryozoans, and mollusks. Ichthyoplankton (fish eggs and

9 larvae) are a seasonal component of the zooplankton in all aquatic ecosystems. Zooplankton is
10 an important link between phytoplankton and fish or other secondary consumers.

11

12 **Phytoplankton and Aquatic Macrophytes**

13

14 Phytoplankton is an important food source for some invertebrate and fish species and is

15 important for carbon fixation (converting carbon dioxide to organic materials via

16 photosynthesis). Periphyton (algae attached to solid submerged objects) includes species of

17 diatoms and other algae that grow on natural or artificial substrates. These species can

18 become planktonic as a result of scouring or other actions that separate individuals from their

19 substrate. Components of the phytoplankton include green algae (Chlorophyta), bluegreen

20 algae (Cyanophyta), and golden brown algae (Chrysophyta). Brown algae and kelp

21 (Phaeophyta) and red algae (Rhodophyta) also occur in marine waters. Diatoms

22 (Bacillariophyta) are a major component of the phytoplankton in many aquatic systems.

23 Macrophytes can stabilize sediments, act as important links in nutrient cycling, provide shelter

24 and protection for animal communities, and provide important nursery areas (Hall et al. 1978).

25 Factors that affect the distribution and condition of submersed aquatic vascular plants include

26 weather and hydrology, sedimentation, suspended solids and water clarity, and consumption

27 and disturbance by fish and wildlife (USGS 1999).

28

3.6.2.2 Overview of the Effects of Existing Nuclear Plant Operations and Transmission Lines on Aquatic Resources

During the initial license period, the operations of nuclear plants had effects on aquatic resources. The withdrawal of cooling water affected aquatic organisms by means of impingement and entrainment. Impingement occurs when organisms (e.g., fish, shellfish [e.g., shrimp, crabs, and crayfish], and, more rarely, sea turtles, birds, and marine mammals) are held against the intake screen or netting placed within intake canals. Entrainment occurs when smaller organisms (e.g., phytoplankton, zooplankton, and the planktonic eggs and larvae of fish and shellfish) pass through the intake screens and travel through the entire condenser cooling system. Aquatic organisms that might otherwise avoid impingement by swimming away may enter and become entrapped in enclosed cooling water intake canals that hinder escape.

Temperature can have an effect on most biochemical, physiological, and life history activities of aquatic organisms (Beitinger et al. 2000). Thermal effects on aquatic biota can result from heat shock; cold shock; interference with fish migration; premature emergence of aquatic insects; enhanced susceptibility to parasitism, predation, and disease; stimulation of nuisance organisms; gas bubble disease; and lower dissolved oxygen level (NRC 1996). Nuclear power plants also affect aquatic organisms through thermal and chemical releases (NRC 1996). In addition, radionuclides are released into aquatic systems. Radionuclides can be environmentally significant as they have a strong tendency to adsorb onto particles (e.g., suspended and settled solids), can accumulate in biological organisms, or can be concentrated through trophic transfers (Jones and McLean 2005).

The impact from any type of power plant on aquatic resources can be difficult to determine because biotic populations also respond to changes in environmental conditions (EPA 2002).

Impingement

Impingement is the entrapment of all life stages of fish and shellfish on the outer part of an intake structure or against a screening device during periods of water withdrawal (40 CFR § 125.83).

Entrainment

Entrainment is incorporation of all life stages of fish and shellfish with intake water flow entering and passing through a cooling-water intake structure and into a cooling water system (40 CFR § 125.83).

Thermal Shock

Heat Shock: Acute thermal stress caused by exposure to a sudden elevation of water temperature that adversely affects the metabolism and behavior of an organism and can lead to its death.

Cold Shock: Acute thermal stress caused by exposure to a sudden decrease of water temperature that adversely affects the metabolism and behavior of an organism and can lead to its death.

Affected Environment

1 Table 3.6-1 lists various characteristics of power plants, water bodies, and aquatic species that
 2 influence the effects of impingement, entrainment, or thermal or chemical discharge on aquatic
 3 resources.
 4

Table 3.6-1. Factors That Influence the Impacts of Nuclear Power Plant Operation on Aquatic Resources

Power Plant Factors	Ecosystem Factors
<ul style="list-style-type: none"> • Intake and discharge location (e.g., distance from shoreline and to each other) and type (e.g., size and operation) • Intake depth and approach velocities • Proximity to areas of biological concern (e.g., spawning and rearing habitats) • Fish protection technologies (e.g., intake screen design, fish diversion/avoidance systems, screen wash return systems) • Timing, duration, frequency, and quantity of water withdrawal • Ratio of cooling water intake to source water flow • Water temperature change and duration in cooling system • Biocide use • Corrosive potential of condenser tubing • Type of cooling system (e.g., once through, combination cycle, closed cycle, cooling lake, or canal) • Thermal plume characteristics (e.g., cross-sectional area of elevated discharge temperatures) 	<p>Abiotic Factors</p> <ul style="list-style-type: none"> • Type of water body (e.g., riverine, lacustrine, estuarine, marine) • Ambient water temperatures • Ambient water quality (e.g., salinity, dissolved oxygen, pollutant levels) • Current or tidal conditions • Direction and rate of ambient flows <p>Biological Factors</p> <ul style="list-style-type: none"> • Spatial and temporal distributions • Abundance or density • Habitat preference • Ability to detect and avoid intake • Swimming speeds • Body size • Age and developmental stage • Physiological tolerance (e.g., temperature, dissolved oxygen, and salinity) • Reproductive strategy • Mode of egg and larval dispersal • Generation time • Condition and health
<p>Source: EPA 2002; NRC 1996</p>	

5
 6 Chemical effects on aquatic biota can occur from exposure to biocides and other contaminants
 7 (e.g., heavy metals such as copper, zinc, and chromium that may be leached from condenser
 8 tubing and other heat exchangers). Blowdown from closed-cycle cooling systems can contain
 9 concentrated levels of constituents present in the makeup water, residual biocides, process
 10 contaminants, and other chemicals added for controlling corrosion or deposits (Veil et al. 1997).

1 Radionuclides are released to aquatic systems at or below permitted levels at nuclear power
2 plants.

3 4 **3.6.3 Threatened, Endangered, and Protected Species and Essential Fish Habitat**

5
6 A variety of Federal and State Acts protect
7 certain species and habitats. Federally listed
8 threatened and endangered species are
9 protected under the Endangered Species Act of
10 1973, while State-listed species are protected
11 under provisions of various State regulations.
12 Prior to the initial construction of the power
13 plants and transmission line ROWs built after
14 1973, the NRC consulted with the U.S. Fish and
15 Wildlife Service (USFWS) to determine the
16 presence of any Federally listed species or
17 critical habitat at or near sites and assess the
18 potential for impacts from the construction and
19 operation of plants or associated transmission
20 lines. Before the Endangered Species Act was
21 enacted, consultation was not required;
22 however, species or habitats that were rare
23 were often considered in project planning. Any
24 ongoing or proposed activity associated with the
25 operation or maintenance of existing nuclear
26 power plants during the license renewal term
27 that has the potential to affect a listed species
28 requires the initiation of consultation under
29 Section 7 of the Endangered Species Act with
30 the USFWS for terrestrial and freshwater
31 species or the National Marine Fisheries
32 Service (NMFS) for offshore and migratory
33 species. Federally managed marine and
34 anadromous fishery resources, including
35 essential fish habitat, are protected under the
36 Magnuson-Stevens Fishery Conservation and
37 Management Act (Magnuson-Stevens Act; 16 USC 1801 *et seq.*). Marine mammals are offered
38 protection under the Marine Mammal Protection Act (MMPA; 16 USC 1361 *et seq.*), which
39 establishes a Federal responsibility to conserve marine mammals. Both of these regulations
40 are administered by the NMFS.

Terms Related to Threatened, Endangered, and Protected Species and Habitats

- ***Endangered Species:*** Animal or plant species in danger of extinction throughout all or a significant portion of its range.
- ***Threatened Species:*** Animal or plant species likely to become endangered within the foreseeable future throughout all or a significant portion of its range.
- ***Candidate Species:*** Animal or plant species for which the USFWS or NMFS has on file sufficient information on vulnerability and threats to support a proposal to list it as endangered or threatened.
- ***Proposed Species:*** Animal or plant species that is proposed in the *Federal Register* to be listed under Section 4 of the Endangered Species Act.
- ***Critical Habitat:*** Specific geographic areas, whether occupied by a listed species or not, that are essential for its conservation and that have been formally designated by rule published in the *Federal Register*.
- ***Essential Fish Habitat:*** Those waters and substrates needed by Federally managed marine and anadromous fish for spawning, breeding, feeding, or growth to maturity.

Affected Environment

1
2 Many listed species occur in the vicinity of U.S. commercial nuclear plants. Sackschewsky
3 (1997) reported that there were 484 Federally listed threatened, endangered, proposed, or
4 candidate species potentially occurring near one or more of the 75 nuclear reactor sites
5 (including sites that have now been shut down or decommissioned). In a follow-up report,
6 452 species^(a) were identified at 63 sites for which data were available (the Pilgrim and
7 Seabrook plants were not included); critical habitat for 18 species was identified near the
8 facilities (Sackschewsky 2004). The number of species by taxonomic group is given in
9 Table 3.6-2. Although a number of species were identified for most nuclear plants, the
10 probability of occurring at sites was considered low for most species. At the time of the study,
11 there were 59 known occurrences of listed species on nuclear plant sites. Some of the known
12 or potentially occurring species may have been affected by the construction and subsequent
13 operation of the plants, with effects similar to those described in Sections 3.6.1
14 and 3.6.2.

15

Table 3.6-2. Number of Endangered Species
Act-Listed Species That Could
Occur near Operating Nuclear
Power Plants

Taxonomic Group	No. of Species
Plants	218
Clams	58
Snails	12
Crustaceans	8
Insects and arachnids	16
Fish	44
Amphibians	9
Reptiles	21
Birds	32
Mammals	34
Total	452

Source: Sackschewsky 2004

(a) Five species that were included in this report have been removed from the list of threatened and endangered species: the Arizona agave (*Agave arizonica*), bald eagle (*Haliaeetus leucocephalus*), cactus ferruginous pygmy-owl (*Glaucidium brasilianum cactorum*), Eggert's sunflower (*Helianthus eggertii*), and gray wolf (*Canis lupus*) in the western Great Lakes and Minnesota.

1 The USFWS maintains a threatened and endangered species system (TESS) Web site
2 (USFWS 2007b) for all Federally listed species (as well as proposed and candidate species),
3 which has lists organized by state, taxonomic group, species with critical habitats and recovery
4 plans, and so forth.

6 **3.6.3.1 Terrestrial Threatened, Endangered, and Protected Species**

8 Nuclear plants known to support listed terrestrial species on the site or along transmission line
9 ROWs generally maintain monitoring programs to identify changes in populations or report
10 impacts to the USFWS and State agencies. Factors that could affect listed terrestrial species
11 include construction-related habitat loss, cooling tower drift, operation and maintenance of
12 cooling systems, transmission line ROW maintenance, avian collisions with cooling towers and
13 transmission lines, exposure to radionuclides, and site operations and maintenance.

15 In cases where there have been concerns regarding potential impacts on listed species from
16 plant operation, mitigation has been implemented. For example, the bald eagle (*Haliaeetus*
17 *leucocephalus*), which was listed by the USFWS as a threatened species until August 2007,
18 occurs near many nuclear plants and nests near the Monticello plant in Minnesota; one nest is
19 located on one of its transmission towers. Flight diverters were installed on transmission lines
20 associated with the Monticello plant to reduce the potential for avian collisions, thereby reducing
21 the likelihood of impacts on bald eagles (NRC 2006f). At the Calvert Cliffs plant in Maryland,
22 restrictions are placed on activities (such as timber harvest) within 0.4 km (0.25 mi) of active
23 bald eagle nests. The cooling canals at the Turkey Point plant in Florida support a breeding
24 population of the American crocodile (*Crocodylus acutus*). The cooling canal system, including
25 freshwater ponds between canals, is managed to provide suitable habitat for all life stages of
26 the crocodile (NRC 2002b).

28 Listed plant species occur along transmission line ROWs associated with many of the nuclear
29 plants. The open canopy maintained in the ROWs provides habitat conditions required by
30 many of these species. However, these species could be adversely affected by ROW
31 management or line maintenance activities. Individuals could be affected by mowing, cutting,
32 equipment or vehicle operation, and herbicide applications. Many nuclear plants have
33 developed ROW management programs in cooperation with the USFWS or State resource
34 agency. Management activities are designed to avoid impacts on these species and maintain
35 habitat conditions conducive to the survival of these populations. For example, at the
36 Brunswick Nuclear Plant in North Carolina, the golden sedge (*Carex lutea*), Cooley's
37 meadowrue (*Thalictrum cooleyi*), and rough-leaf loosestrife (*Lysimachis asperulaefolia*), all
38 listed by the USFWS as endangered, occur within transmission line ROWs. These populations
39 are managed in cooperation with the State of North Carolina, and vegetation management
40 practices have been adopted to protect these species (NRC 2006e).

Affected Environment

1 ROW management efforts at the St. Lucie plant in Florida provide and maintain habitat for the
2 Florida scrub jay (*Aphelocoma coerulescens*) and other species that prefer open shrubby
3 habitat (NRC 2003a). A small number of bald eagles were killed by collisions with the Rock
4 Creek transmission line associated with the Quad Cities plant in Illinois, at the Mississippi River
5 crossing; however, the impact on the local population was considered small (NRC 2004c).
6

7 **3.6.3.2 Aquatic Threatened, Endangered, and Protected Species, Marine Mammals, and** 8 **Essential Fish Habitat** 9

10 The potential for Federally and State-listed aquatic species to occur in the vicinity of specific
11 nuclear power plants depends on the distribution and habitat preferences of the listed species
12 and the specific water bodies and habitat types that are present on or near the power plant.
13 Species that occur in aquatic habitats with enough water to support power plant cooling water
14 needs (e.g., large rivers and lakes, estuaries, and inshore marine areas) are more likely to be
15 affected by power plant operations than species that occur in smaller bodies of water that would
16 not be capable of providing sufficient cooling water (EPA 2002). Listed aquatic species would
17 generally be considered less likely to be present in constructed habitats, such as cooling ponds,
18 that historically would not have provided suitable habitat and that do not provide ready
19 connections to more natural habitats from which colonization or immigration could occur.
20

21 Examples of listed freshwater fish species that have been identified as occurring in the vicinity
22 of nuclear power plants include the pallid sturgeon (*Scaphirhynchus albus*), which occurs in the
23 Missouri River near the Fort Calhoun plant in Nebraska (NRC 2003c), and the Neosho madtom
24 (*Noturus placidus*), which may inhabit streams in the immediate vicinity of the Wolf Creek plant
25 in Kansas (Sackschewsky 2004). None of the operating nuclear power plants or their
26 transmission lines are located in areas designated as critical habitat under the Endangered
27 Species Act for Federally listed aquatic species.
28

29 North America has the highest diversity of freshwater mussels in the world, Williams et al.
30 (1993) reported that about 72 percent of North American mussel species are considered
31 endangered, threatened, or of special concern as a result of habitat destruction and reduced
32 water quality (Williams et al. 1993). This high percentage of imperiled species is reflected in
33 the large numbers of listed mussel species that could occur in the vicinity of nuclear power
34 plants that obtain cooling water from freshwater aquatic habitats. Sackschewsky (2004)
35 identified 32 nuclear plants where listed mussel species could occur. There was the potential
36 for more than 20 listed mussel species to occur in the immediate vicinity of three of these plants
37 (Browns Ferry, Sequoyah, and Watts Bar) (Sackschewsky 2004).
38

39 A number of listed fish, shellfish, and sea turtles occur in the vicinity of nuclear plants located on
40 estuaries and marine habitats. Some marine mammals (e.g., seals and the West Indian
41 manatee), which, depending on the species, may be protected under Endangered Species Act

1 Section 7 or under the MMPA, occur in the vicinity of some coastal plant sites. Federally listed
2 estuarine and marine fish species that are known to occur in the vicinity of nuclear plants
3 include shortnose sturgeon (*Acipenser brevirostrum*) and smalltooth sawfish (*Pristis pectinata*).
4 Although the West Indian manatee occurs in the vicinity of the Turkey Point plant in Florida, it
5 has not been found in the cooling water canals and is considered unlikely to be affected by
6 operations of the plant (NRC 2002b). The West Indian manatee also occurs in the vicinity of the
7 Crystal River plant in Florida, and in the heated effluent of other non-nuclear power plants in
8 Florida (Laist and Reynolds 2005).

9
10 In addition to those marine mammals protected under the Endangered Species Act, marine
11 mammals are also protected under the MMPA. The MMPA gives the NMFS the responsibility
12 for managing cetaceans (porpoises and whales) and pinnipeds (seals, fur seals, and sea lions).
13 The USFWS is responsible for managing all other marine mammals, including the sea otter,
14 walrus, polar bear, dugong, and manatee. The MMPA prohibits, with certain exceptions, the
15 “take” (i.e., harming) of marine mammals in U.S. waters. Concerns about the potential impacts
16 of nuclear power plants on marine mammals have been expressed for only a small number of
17 plants, and typically, intake structures and discharge systems are modified to reduce the
18 potential for harming marine mammals. In cases where there is a potential for small numbers of
19 marine mammals to be inadvertently affected by plant operations, the NMFS or the USFWS
20 may allow the unintentional take of up to a certain number of individuals. For example, a letter
21 of authorization under the MMPA has been issued by the NMFS for the unintentional take of
22 small numbers of seals incidental to operations of the cooling water intake system at the
23 Seabrook plant in New Hampshire (NMFS 2002). That letter of authorization specifies that up
24 to 20 harbor seals (*Phoca vitulina*) and up to a combined total of four gray (*Halichoerus*
25 *grypus*), harp (*Pagophilus groenlandicus*), and hooded seals (*Cystophora cristata*) may be
26 taken annually (NMFS 2002). As part of the take authorization, the licensee of the Seabrook
27 plant is required to monitor the intake facilities for seals and report the impingement of any
28 seals to the NMFS. No seals have been impinged at the Seabrook plant since the installation
29 of seal deterrent barriers in August 1999 (NMFS 2002).

30
31 Under the Magnuson-Stevens Act, the NMFS is responsible for the management of commercial
32 and recreational fisheries within the Exclusive Economic Zone (EEZ) of the United States,
33 which includes marine waters that extend seaward for up to 200 nautical miles from State-
34 managed coastal waters. The Magnuson-Stevens Act calls for the description, identification,
35 and management of essential fish habitat (EFH) to help conserve and manage Federal fishery
36 resources. EFH is defined as those waters and substrates that are necessary to fish for
37 spawning, breeding, feeding, or growth to maturity. The Magnuson-Stevens Act established
38 Fishery Management Councils and requires them to describe and identify EFH in their
39 respective regions and to specify actions to conserve and enhance that EFH. The Magnuson-
40 Stevens Act also requires Federal agencies to consult with NMFS on activities that may
41 adversely affect the EFH designated in fishery management plans.

Affected Environment

1
2 In addition to designating EFH, the NMFS requires Fishery Management Councils to identify
3 habitat areas of particular concern (HAPCs) within fishery management plans. These HAPCs
4 are discrete subsets of EFH that provide important ecological functions or are especially
5 vulnerable to degradation. Councils may designate a specific habitat area as an HAPC on the
6 basis of the (1) importance of the ecological function provided by the habitat; (2) extent to which
7 the habitat is sensitive to human-induced environmental degradation; (3) whether, and to what
8 extent, development activities are or will be stressing the habitat type; or (4) the rarity of the
9 habitat type. While the HAPC designation does not confer additional protection for or
10 restrictions on an area, it can help prioritize conservation efforts.

11
12 Fishery management plans for Federally managed species are typically prepared by the
13 appropriate regional Fishery Management Council(s) and submitted to the NMFS for review,
14 approval, and implementation. Because some of these Federally managed fish and
15 invertebrate species use coastal habitats (e.g., estuaries, coastal rivers, submerged aquatic
16 vegetation, salt marshes, coral reefs, rocky intertidal areas, and hard or live bottom areas)
17 during their lives, some coastal habitats outside of the EEZ have been designated as EFH for
18 one or more managed species. Because of this, some activities on land and in the water have
19 a potential to alter, damage, or destroy EFH components, thereby affecting the fishery
20 resources that use them. Thus, operations of nuclear power plants located in marine,
21 estuarine, and coastal areas have the potential to affect EFH. To date, EFH assessments have
22 been completed as part of the license renewal process for three nuclear power plants (Pilgrim,
23 Vermont Yankee, and Oyster Creek) and as part of the extended power uprate evaluation for
24 the Hope Creek plant.

25
26 Overall, there are 17 nuclear power plants where potential impacts on EFH may be a
27 consideration (Table 3.6-3), primarily because cooling water is withdrawn from or discharged to
28 estuarine or marine habitats. However, cooling water withdrawn from or discharged to
29 freshwater sources that provide habitat for some Federally managed anadromous species
30 (e.g., salmon) could also affect EFH.

31
32
33

Table 3.6-3. Operating Nuclear Power Plants for Which Essential Fish Habitat May Be a Consideration

Plant	State	Cooling Water Source
Brunswick ^(a)	North Carolina	Cape Fear River
Calvert Cliffs	Maryland	Chesapeake Bay
Columbia	Washington	Columbia River
Crystal River	Florida	Gulf of Mexico
Diablo Canyon	California	Pacific Ocean
Hope Creek ^(b)	New Jersey	Delaware River
Indian Point	New York	Hudson River
Millstone	Connecticut	Long Island Sound
Oyster Creek ^(c)	New Jersey	Barnegat Bay
Pilgrim ^(d)	Massachusetts	Cape Cod Bay
St. Lucie	Florida	Atlantic Ocean
Salem	New Jersey	Delaware River
San Onofre	California	Pacific Ocean
Seabrook	New Hampshire	Atlantic Ocean
Surry	Virginia	James River
Turkey Point	Florida	Biscayne Bay
Vermont Yankee ^(e)	Vermont	Connecticut River

(a) EFH assessment completed as part of SEIS for Brunswick license renewal (NRC 2006e).

(b) EFH assessment completed as part of the evaluation for the Hope Creek extended power uprate.

(c) EFH assessment completed as part of SEIS for Oyster Creek license renewal (NRC 2007c).

(d) EFH assessment completed as part of SEIS for Pilgrim license renewal (NRC 2007e).

(e) EFH assessment completed as part of SEIS for Vermont Yankee license renewal (NRC 2007f).

3.7 Historic and Cultural Resources

Historic and cultural resources include prehistoric era and historic era archaeological sites, historic districts, and buildings, as well as any site, structure, or object that may be considered eligible for listing on the *National Register of Historic Places* (NRHP). Historic and cultural resources also include traditional cultural properties that are important to Native American Tribes for maintaining their culture.

3.7.1 Regulatory Framework

The National Historic Preservation Act (NHPA) of 1966, as amended (*United States Code*, Title 16, Section 470 [16 USC 470 et seq.]), is the primary Federal law that addresses undertakings. Undertakings are defined in the NHPA as any project or activity that is funded or under the direct jurisdiction of a Federal agency, or, most importantly for the actions addressed in this document, any project or activity that requires a Federal permit, license, or approval. License renewal is a Federal undertaking that requires compliance with the NHPA. Although the NRC is not a land-managing agency and the sites are privately owned, license renewal is a Federal undertaking that requires compliance with Section 106 of the NHPA.

Section 106 of the NHPA requires federal agencies to take into account the effects of their undertakings on historic properties and afford the Advisory Council on Historic Preservation a reasonable opportunity to comment on such undertakings. The NHPA created a State Historic Preservation Office (SHPO) for each State to maintain a record of all historic and cultural resources in the State and to review any undertakings that could impact historic and cultural resources to ensure compliance with the NHPA. The Advisory Council on Historic Preservation is an independent Federal agency that provides guidance on the application of Federal historic and cultural resource laws and serves as an arbiter when disputes arise.

Section 106 of the NHPA identifies the process for considering historic and cultural resources during a Federal undertaking (36 CFR Part 800). The process requires that the SHPO, the appropriate Federally recognized Native American Tribes, and the public be given the

Historic and Cultural Resources

- **Historic and cultural resources** include prehistoric and historic era archaeological sites, historic structures, and traditional cultural properties.
- **Prehistoric era resources** are the remains of human activities from the time period prior to the arrival of Europeans in North America in the 1490s.
- **Historic era resources** are those resources created after Europeans arrived in North America and are most often associated with Europeans or their descendants.
- **Traditional cultural properties** are historic and cultural resources that are important for a group to maintain its cultural heritage. Examples include traditionally used plants, gathering areas, and landscape features.

1 opportunity to comment on undertakings that could affect historic and cultural resources. The
 2 SHPOs are authorized only to comment on an undertaking. The lead Federal agency or the
 3 designated applicant must determine if historic and cultural resources eligible for listing on the
 4 NRHP are present. A determination is generally accomplished through a combination of a
 5 literature search, a review of the SHPO files for the region, and field investigations conducted
 6 by individuals who meet the Secretary of the Interior’s Guidelines for Historic Preservation
 7 (cultural resource professionals). Only cultural resource professionals can make the
 8 determination if significant resources are present. If resources are present, their significance is
 9 determined through application of the *National Register* criteria (see text box). Impacts
 10 resulting from an undertaking to properties eligible for the NRHP must be mitigated. Mitigation
 11 is commonly achieved through documentation of the resource.

12
 13 Information on where historic and cultural resources are located is considered proprietary. This
 14 designation is intended to protect historic and cultural resources (primarily archaeological
 15 resources) from illegal collecting. The NHPA requires that information on the locations of
 16 historic and cultural resources be withheld from the public to protect the resources (36 CFR
 17 800.11(c)(1)).

18
 19 Most nuclear power plants in the United States
 20 were constructed in the 1960s, 1970s, and
 21 early 1980s. Although the NHPA was passed
 22 in 1966, the process for complying with the law
 23 was developing during the 1970s and early
 24 1980s. Over the last 30 years, the process for
 25 complying with the NHPA has been modified.
 26 Some of the changes involve the role of the
 27 SHPO in the Section 106 consultation process,
 28 the role of Native American Tribes, and the
 29 methods used for field investigations. Ground-
 30 disturbing activities have taken place at most
 31 plants (both during construction and
 32 operations), and the potential for historic and
 33 cultural resources in heavily disturbed areas
 34 may be considered unlikely. However, developed and less-developed portions of a plant site,
 35 including areas that were previously examined, could still contain unknown historic and cultural
 36 resources. Any areas that would be disturbed at a plant need to be reviewed for the presence
 37 of historic and cultural resources by qualified professionals and in consultation with the SHPO.

National Register Criteria (36 CFR 60.4 a-d)

To be listed on the *National Register of Historic Places*, historic properties must meet one of the following criteria:

- Be associated with an important historical event,
- Be associated with a historically important person,
- Be representative of a period or have high artistic value, or
- Have the potential to provide important information for history or prehistory.

1 **3.7.2 Prehistoric and Historic Era Historic and Cultural Resources**

2
3 Prehistoric and historic era historic and cultural resources are the remains of past human
4 activity. The prehistoric era refers to the period before Europeans arrived in North America in
5 the 1490s. Evidence of prehistoric peoples in North and South America suggests that humans
6 have been in the Americas for at least 12,000 years. During the first several thousands of
7 years that humans were in North America, the climate was much different than today. The
8 exact weather fluctuations that occurred across the continent are not well understood. It is
9 known that the modern climate developed around 8000 years ago. Some of the most heavily
10 used areas on the landscape for prehistoric era people were along rivers, lakes, and the
11 seashore. These locations provided freshwater and the most abundant food sources, as well
12 as the most efficient ways to travel. Waterways formed the primary transportation routes in
13 North America for thousands of years. As a result, prehistoric era archaeological sites tend to
14 be found along these waterways. The types of prehistoric archaeological resources found
15 include small temporary camps, larger seasonal camps that were returned to year after year,
16 large village sites that were occupied continuously over several years or potentially centuries, or
17 specialized-use areas associated with fishing or hunting or with tool and pottery manufacture.

18
19 Historic era resources are those associated with Europeans or their descendants. Like sites
20 used by prehistoric peoples, historic era sites tend to cluster near waterways because water
21 was the most efficient form of transportation. Historic era resources include farmsteads, mills,
22 forts, residences, industrial sites (such as mines or canals), and shipwrecks.

23
24 The fact that past human activities were focused along waterways is important to note because
25 most nuclear power plants are located along major rivers, lakes, or the ocean. Consequently,
26 the potential for the presence of historic and cultural resources near most nuclear power plants
27 is high. A review of historic and cultural resources at 27 nuclear plants that have already
28 undergone license renewal indicates that generally very few archaeological sites have been
29 identified at the power plant locations. In the cases where field investigations were undertaken,
30 the average number of historic and cultural resources present was 35 per plant. At plants
31 where field investigations did not take place, no sites were known. Some of the historic and
32 cultural resources identified include village sites, town sites, and cemeteries.

33
34 Activities that take place as part of continued operations and refurbishment activities that could
35 affect archaeological sites include grading for parking lots, construction of security barriers, any
36 new construction or ground clearing, vegetation removal, and landscaping activities. Even a
37 small amount of ground clearing could critically alter a small but very significant historic and
38 cultural resource. For instance, a small short-term-occupation site can be a time capsule for
39 understanding past lifeways, even if the site is only 0.5 ac.

1 **3.7.3 Traditional Cultural Properties**

2
3 Traditional cultural properties are historic and cultural resources that are important for a group
4 to maintain its cultural heritage. Traditional cultural properties are most often associated with
5 Native American religious or cultural practices. Examples of traditional cultural properties
6 include traditional gathering areas where particular plants or materials were harvested, a sacred
7 mountain or landscape that was crucial to a Tribe's identity, or burial locations that connect
8 Native Americans with their ancestors. Most traditional cultural properties can be identified only
9 through consultation with Federally recognized Native American Tribes. The location of
10 traditional cultural properties is often kept private by Native Americans. Often SHPOs are
11 unaware of these locations. The identification of traditional cultural properties is an important
12 part of the consultation requirement of Section 106 of the NHPA.
13

14 **3.8 Socioeconomics**

15
16 Nuclear power plants affect socioeconomic conditions in the area surrounding them, including
17 local, regional, and State employment and income; regional population and housing; local
18 community services; and local transportation. To describe the general socioeconomic
19 environment in the vicinity of nuclear power plants, economic data compiled by the Nuclear
20 Energy Institute (NEI) was used. This information describes economic conditions in the vicinity
21 of nuclear plants located in both rural and semi-urban regions (see Section D.7 in Appendix D).
22

23 **3.8.1 Power Plant Employment and Expenditures**

24
25 Nuclear plant operations generate employment and expenditures at each plant site. Wage and
26 salary and nonlabor expenditures create demand for a range of durable and nondurable goods
27 provided by wholesalers and retailers, while wage and salary spending also create demand for
28 health and professional services and for housing. Power plants also provide tax revenues for
29 governmental entities to spend on education, public safety, local government services, and
30 transportation.
31

32 Employment at nuclear power plants varies according to a number of factors, including the
33 number of reactors, power production, and the type and age of the plant. At 11 nuclear plants
34 for which detailed economic annual data have been collected, employment averaged
35 1337 individuals, ranging from 528 at Three Mile Island to 2385 at Palo Verde (Table 3.8-1).
36 Annual wage and salary expenditures at the State level reflected the size of the labor force at
37 each plant, ranging from \$59.2 million at Grand Gulf to \$194.2 million at Palo Verde. Annual

Affected Environment

Table 3.8-1. State Employment, Expenditures, and Tax Revenues at 11 Nuclear Plants from 2003 Through 2006^(a)

Plant	Employment	Labor Expenditures (\$ million)	Nonlabor Expenditures (\$ million)	Total Expenditures (\$ million)	Tax Revenues (\$ million)
Diablo Canyon	1638	123.1	48.8	171.9	27.0
Grand Gulf	621	59.2	1.8	61.0	26.2
Indian Point	1559	145.9	54.9	200.8	35.3
Limerick	705 ^(b)	NA ^(c)	NA	NA	NA
Millstone	1406	96.4	63.0	159.4	25.0
Oconee	1328 ^(b)	NA	NA	NA	NA
Palo Verde	2385	194.2	21.1	215.3	90.6
Peach Bottom	666 ^(b)	NA	NA	NA	NA
Susquehanna	1528	196.7	56.1	252.8	35.3
Three Mile Island	528	61.6	26.2	87.8	0.9
Wolf Creek	1028	103.6	5.6	109.2	24.8

(a) Data for Millstone are for 2003; data for Diablo Canyon, Indian Point, Oconee, and Palo Verde are for 2004; data for Three Mile Island and Wolf Creek are for 2005; data for Grand Gulf, Limerick, Peach Bottom, and Susquehanna are for 2006.

(b) National employment data.

(c) NA = not available.

Sources: Nuclear Energy Institute, 2003, 2004a,b,c,d, 2005a,b, 2006a,b,c

1
2 labor expenditures averaged \$122.6 million, or \$95,029 per permanent full-time worker. In
3 addition to labor expenditures, each plant also had expenditures for materials, equipment, and
4 services to support power plant operations. Some plants, such as Millstone (\$63.0 million),
5 Susquehanna (\$56.1 million), and Indian Point (\$54.9 million), had significant nonlabor
6 expenditures, while others spent less than \$10 million. Annual nonlabor expenditures at the
7 11 plants averaged \$34.7 million.

8
9 Nuclear power plants provide annual tax revenues to State and local government entities. State
10 and local taxes paid by power plants ranged from \$0.9 million at Three Mile Island to \$90.6
11 million at Palo Verde, averaging \$27.6 million. Differences in tax revenues among plants are
12 related to variations in State and local taxation laws, electricity output, plant size, and plant
13 employment.

14
15 Additional employment and expenditures occur during refueling activities at each plant, when
16 between 200 and 900 people may be employed over a 1 to 2-month period (NRC 1996).
17 Refueling occurs on an approximate 18-month cycle.

3.8.2 Regional Economic Characteristics

The impacts of nuclear power plant operations occur at the local level (i.e., in the county in which a plant is located), at the regional level (i.e., in the counties in which the majority of the plant's employees reside), and at the State level. Impacts at each level can vary considerably, depending on the type of local and State economy. In general, nuclear power plants in the United States are located in one of two broad types of economic setting: rural or semi-urban. Impacts in these settings are described here.

3.8.2.1 Rural Economies

Many nuclear power plants are located in rural areas, where agriculture is the primary economic activity. Rural areas often have relatively simple economies, without many of the industries that provide equipment and services important to plant operations, and with smaller, less diversified labor markets that are often composed of lower-paying occupations requiring less skill. In addition to agriculture and related activities, a range of other activities, including those associated with the resource extraction, manufacturing, and transportation industries, may provide employment and income.

Average employee earnings at nuclear power plants are high when compared to the regional average. Among the 11 plants located in rural areas shown in Table 3.8-2, only Diablo Canyon and Wolf Creek provided 1 percent or more of regional employment, while average plant earnings at most plants (particularly Oconee, Wolf Creek, and Diablo Canyon) were higher than the regional average.

Employment, wages, salaries, and nonlabor expenditures are directly associated with plant operations. As direct expenditures circulate through the economy, producing additional economic activity, spending in the local and regional economy also produces indirect employment and income. The size of the indirect local impact depends closely on both the extent to which plant employees live in the local area (and consequently the size of the wage and salary bill paid to local residents) and the presence of local vendors of material and supplies. These determine the ability of the local economy to absorb nonlabor spending.

Indirect impacts occur annually in the local area at a number of power plants as a result of direct plant expenditures. For example, 882 indirect jobs were created at Diablo Canyon and 952 jobs were created at Oconee; these are the two plants with the largest direct employment

Table 3.8-2. Plant and Regional Employment and Earnings in Rural Locations

Plant	Plant Regional Employment	Total Regional Employment	Percent of Total Regional Employment	Annual Avg. Plant Earnings per Worker (\$)	Annual Avg. Regional Earnings per Worker (\$)	Percent of Regional Avg. Earnings
Diablo Canyon	1260	118,500	1.1	85,200	52,400	163
Grand Gulf	593	162,100	0.4	70,400	50,000	141
Oconee	1312	161,108	0.8	83,100	45,700	182
Peach Bottom	523	652,903	0.1	75,700	63,500	119
Susquehanna	305	151,869	0.2	69,500	52,000	134
Three Mile Island	512	742,700	0.1	71,300	53,500	133
Wolf Creek	838	82,243	1.0	72,400	43,100	168

Source: Nuclear Energy Institute 2004a,c, 2005a,b, 2006a,c

1
2 (Table 3.8-3). Almost 2300 total jobs are created in the local area at these two plants annually.
3 On average, an additional 0.4 job is created locally for every direct job at each plant.
4 Expenditures at the Oconee plant produced \$25.3 million in indirect income in the local area,
5 \$135.6 million in total. At Diablo Canyon, \$19.1 million in income was produced in the host
6 county, and \$128.1 million was produced in total. On average, an additional 11 cents in income
7 was produced in the local area for every dollar of direct income paid at each plant site.
8
9 Plant expenditures associated with wages, salaries, procurement, and tax revenues create
10 additional direct and indirect impacts beyond the local area. At Diablo Canyon, 1616 indirect
11 jobs in the State were created by expenditures at the plant, in addition to 1638 direct jobs
12 (Table 3.8-4). At Susquehanna, the plant created 2639 indirect jobs in the State, in addition to
13 1528 direct jobs; at Wolf Creek, 1028 direct and 986 indirect jobs were created in the host
14 State. On average, 1.3 additional jobs are created in the State for every direct job at each
15 plant. Although the largest impacts occurred at the three plants that had the largest direct
16 employment, the sizes of the indirect impact and total impact of each plant are related to
17 variations in the extent of wage, salary, and procurement expenditures within each State.
18
19 Annual expenditures at each plant also produced indirect income and tax revenues at the State
20 level. The Susquehanna plant produced \$96.6 million of indirect income in the State, \$293.3 in
21 total. The Diablo Canyon plant produced \$50.8 million of income in the State, and
22 \$173.9 million in total (Table 3.8-4). Expenditures at Susquehanna also produced \$14.8 million

Table 3.8-3. Local Economic Impacts of Plant Operations in Rural Locations^(a)

Plant	Employment			Income (\$ million)		
	Direct	Indirect	Total	Direct	Indirect	Total
Diablo Canyon	1405	882	2287	109.0	19.1	128.1
Grand Gulf	411	152	563	38.8	3.8	42.6
Oconee	1328	952	2280	110.3	25.3	135.6
Peach Bottom	248	71	319	28.4	2.0	30.4
Susquehanna	305	76	381	37.3	2.2	39.5
Three Mile Island	208	67	275	22.8	2.0	24.8
Wolf Creek	561	121	682	55.4	2.3	57.7

(a) Impacts from Diablo Canyon occur in San Luis Obispo County; from Grand Gulf occur in Warren and Claiborne Counties; from Oconee occur in Anderson, Oconee, and Pickens Counties; from Peach Bottom occur in York County; from Susquehanna occur in Luzerne County; from Three Mile Island occur in Dauphin County; and from Wolf Creek occur in Coffey County.

Source: Nuclear Energy Institute 2004a,c; 2005a,b; 2006a,c

1
2

Table 3.8-4. State Economic Impacts of Plant Operations in Rural Locations

Plant	Employment			Income (\$ million)			State and Local Taxes (\$ million)		
	Direct	Indirect	Total	Direct	Indirect	Total	Direct	Indirect	Total
Diablo Canyon	1638	1616	3254	123.1	50.8	173.9	27.0	11.6	38.6
Grand Gulf	625	695	1316	59.2	19.5	78.7	26.2	3.3	29.5
Susquehanna	1528	2639	4167	196.7	96.6	293.3	35.3	14.8	50.2
Three Mile Island	528	848	1376	69.6	29.6	91.2	0.9	4.8	5.7
Wolf Creek	1028	986	2014	103.6	25.6	129.3	24.8	5.0	29.9

Source: Nuclear Energy Institute 2004a,c; 2005a,b; 2006a,c

3
4
5
6
7
8
9

of indirect tax revenues at the State and local level, with \$11.6 million of indirect tax revenues generated by the Diablo Canyon plant. An additional 40 cents in income is produced in the State on average for every dollar of direct income paid at each plant site, and an additional \$1.25 in tax revenues is produced on average for each dollar of direct State and local taxes paid at each plant.

1 **3.8.2.2 Semi-Urban Economies**

2
 3 Many nuclear power plants are located in semi-urban areas. These areas have more complex
 4 economic structures than rural areas, containing a wider range of industries, with larger and
 5 more diverse labor markets. Semi-urban areas may also serve specialized economic functions,
 6 including maritime shipping, fishing, and boatbuilding; recreation; and tourism. Numerous
 7 locations serve residential areas containing second homes and hosting retirement communities.

8
 9 The economies of many of the semi-urban areas in which nuclear plants are located have
 10 changed since these plants were constructed. Gradual residential and commercial
 11 development and the associated diversification of economic activity in these areas have
 12 changed the local and regional economic profile, with a decline in the importance of agriculture
 13 and other related activities and their replacement by manufacturing, retailing, and professional
 14 services. At other sites, especially those in coastal locations, participation in outdoor
 15 recreational activities by both the local and nonresidential population has also changed the
 16 focus of local and regional economic activity; this, together with the often-associated growth of
 17 retirement communities, rivals the importance of traditional economic activities in the vicinity of
 18 a power plant site in providing employment and income.

19
 20 Among the 11 plants located in semi-urban economies shown in Table 3.8-5, none provided
 21 1 percent or more of regional employment, while average plant earnings at most plants
 22 (particularly Millstone and Indian Point) were higher than the regional average.
 23

Table 3.8-5. Plant and Regional Employment and Earnings in Semi-Urban Locations

Plant	Plant Regional Employment	Total Regional Employment	Percent of Total Regional Employment	Annual Avg. Plant Earnings per Worker (\$)	Annual Avg. Regional Earnings per Worker (\$)	Percent of Regional Avg. Earnings
Indian Point	1053	899,331	0.2	121,700	85,800	142
Limerick	590	786,824	0.1	75,900	74,300	102
Millstone	1066	130,721	0.8	80,200	52,100	154
Palo Verde	2385	1,427,292	0.1	66,000	58,600	113

Source: Nuclear Energy Institute 2003; 2004b,d; 2006b

24
 25 Employment, wages, salaries, and nonlabor expenditures are directly associated with plant
 26 operations. As direct expenditures circulate through the economy, producing additional
 27 economic activity, spending in the local and regional economy also produces indirect
 28 employment and income. Local impacts shown in Table 3.8-6 are those impacts that occur in
 29 the county hosting the power plant and in the adjacent counties. The size of the indirect local

1 impact depends closely on both the extent to which plant employees live in the host county or
 2 counties (and consequently the size of the wage and salary bill paid to local residents) and the
 3 presence of local vendors of material and supplies. These determine the ability of the local
 4 economy to absorb nonlabor spending.

5
 6 Indirect impacts occur annually in the local area at a number of power plants as a result of
 7 direct plant expenditures. For example, 1570 indirect jobs were created at Palo Verde, 1272
 8 were created at Millstone, and 1198 were created at Indian Point. These are the three plants
 9 with the largest direct employment (Table 3.8-6). More than 3900 total jobs are created
 10 annually in the local area at the Palo Verde plant. On average, an additional 0.8 job is created
 11 for every direct job at each plant. Expenditures at the Palo Verde plant produced \$51.7 million
 12 in indirect income in the local area, \$244.9 in total. At Millstone, \$45.1 million in income was
 13 produced in the local area, and \$44.8 million was produced at Indian Point. At Indian Point, a
 14 total of \$171.4 million in income was produced annually, compared with \$118.2 million at
 15 Millstone, because employment and direct wage and salary expenditures were higher at Indian
 16 Point. On average, an additional 40 cents in income is produced in the local area for every
 17 dollar of direct income paid at each plant site.

18
 19 In addition to impacts in the local area, nuclear power plants also generate employment and
 20 income in the economies as a whole of the States in which plants are located, since plant
 21 expenditures associated with wages, salaries, procurement, and tax revenues
 22

**Table 3.8-6. Local Economic Impacts of Plant Operations
 in Semi-Urban Locations^(a)**

Plant	Employment			Income (\$ million)		
	Direct	Indirect	Total	Direct	Indirect	Total
Indian Point	1355	1198	2553	126.6	44.8	171.4
Limerick	253	132	385	31.3	5.7	36.9
Millstone	1066	1272	2338	73.1	45.1	118.2
Palo Verde	2373	1570	3943	193.2	51.9	245.2

(a) Impacts from Indian Point occur in Westchester, Dutchess, Orange, Putnam, and Rockland Counties; from Limerick occur in Montgomery County; from Millstone occur in New London County; from Palo Verde occur in Maricopa County.

Source: Nuclear Energy Institute 2003; 2004b,d; 2006b

23
 24 create additional direct and indirect impacts beyond the local area. In 2006, expenditures at
 25 Millstone created 1841 indirect jobs in the State, in addition to 1406 direct jobs (Table 3.8-7).
 26 At Palo Verde, the plant created 1800 indirect jobs in the State, in addition to 2385 direct jobs.
 27 At Indian Point, 1559 direct and 1620 indirect jobs were created in the host State. On average,

Affected Environment

1 one additional job is created in the State for every direct job at each plant. Although the largest
 2 impacts occurred at the three plants with the largest direct employment, the sizes of the indirect
 3 impact and total impact of each plant are related to variations in the extent of wage, salary, and
 4 procurement expenditures within each State.

5
 6 Annual expenditures at each plant also produced indirect income and tax revenues at the State
 7 level. The Millstone plant produced \$78.4 million in indirect income in the host county,
 8 \$174.8 in total (Table 3.8-7). At Indian Point, \$65.2 million in income was produced in the local
 9 area, and \$211.1 million in total. Expenditures at Millstone also produced \$39.7 million in
 10 indirect tax revenues at the State and local level, with \$14.4 million in indirect tax revenues
 11 generated by the Indian Point plant, and \$7.8 million by Palo Verde. On average, an additional
 12 51 cents in income is produced in the State for every dollar of direct income paid at each plant
 13 site, and an additional 96 cents in tax revenues is produced for each dollar of direct State and
 14 local taxes paid at each plant.

3.8.3 Demographic Characteristics

15
 16
 17
 18 Although the majority of nuclear power plant sites are situated in smaller, rural communities, the
 19 population density within 20 mi (50 km) of most sites is relatively high, and most sites are within
 20 50 mi (80 km) of a community with a population of 100,000 (see Section D.7 in Appendix D).
 21 The magnitude of the impact of a power plant on the local population, housing, community
 22 services, and transportation may be related to the remoteness of the plant location.

23
Table 3.8-7. State Economic Impacts of Plant Operations in Semi-Urban Locations

Plant ^(a)	Employment			Income (\$ million)			State and Local Taxes (\$ million)		
	Direct	Indirect	Total	Direct	Indirect	Total	Direct	Indirect	Total
Indian Point	1559	1620	3179	145.9	65.2	211.1	35.3	14.4	49.7
Millstone	1406	1841	3247	96.4	78.4	174.8	17.1	39.7	56.8
Palo Verde	2385	1800	4185	194.2	55.1	249.3	54.1	7.8	62.0

(a) Data for Limerick are not included because impact estimates are not available at the State level.
 Source: Nuclear Energy Institute 2003; 2004b,d; 2006b

24
 25
 26 To evaluate the remoteness of areas in which nuclear plants are located, in the 1996 GEIS, the
 27 NRC developed two measures of remoteness, namely "sparseness" and "proximity," which
 28 combine data on population density and the distance to larger cities to place nuclear plants into
 29 three population classes. Population classifications of 11 selected power plant sites are shown
 30 in Table 3.8-8.

1
 2 Some communities in which nuclear power plants are located have transient populations.
 3 These are often associated with regional tourist and recreational activities, weekend and
 4 summer homes, or populations of students who attend regional colleges and other educational
 5 institutions. Coastal regions hosting nuclear power plants, notably D.C. Cook and Palisades on
 6 Lake Michigan and Oyster Creek on the New Jersey shore north of Atlantic City, have summer,
 7 weekend, and retirement populations and a range of recreational and environmental amenities
 8 that attract visitors from nearby metropolitan population centers. Some areas, such as the
 9 region around Vermont Yankee, offer specific outdoor recreational activities, such as skiing,
 10 that attract visitors.

11
 12 In addition to transient populations, communities in rural areas in which power plants are
 13 located also have varying numbers of migrant workers employed on a seasonal basis on farms
 14 and in factories that process farm produce. For example, berry production near the D.C. Cook
 15 and Palisades Nuclear Plants is a local agricultural activity that employs a sizable migrant labor
 16 force in the summer.
 17

Table 3.8-8. Population Classification of Regions Around Selected Nuclear Power Plants

Population	Plant	Population Density Within 20 mi	Sparseness Measure	Population Density Within 50 mi	Proximity Measure
Low	Palo Verde	13.3	1	227.5	4
	Wolf Creek	11.0	1	22.0	1
	Oconee	154.1	4	156.7	3
-----	-----	-----	-----	-----	-----
Medium	Diablo Canyon	286.7	4	106.8	3
High	Susquehanna	250.4	4	215.7	4
	Peach Bottom	299.3	4	698.6	4
	Millstone	440.4	4	699.9	4
	Three Mile Island	639.5	4	315.1	4
	Limerick	869.9	4	977.5	4
	Indian Point	839.7	4	2265.5	4

Source: Argonne National Laboratory calculations.

3.8.4 Housing and Community Services

Housing markets in the vicinity of nuclear power plants vary considerably, with ranges in the number of housing units and the type and quality of housing. Much of the variation is related to the nature of the economy in which each plant is located, particularly regional population and income levels; proximity to metropolitan areas; and the importance of recreation, tourism, second homes, and retirement communities. Although housing demand in local communities in the vicinity of each site is related to the number of permanent onsite employees, there may be significant variation in housing demand during periodic outages, when temporary maintenance and refueling workers may occupy vacant rental accommodations and may significantly affect local and regional vacancy rates for this type of housing. Where suitable housing is not available, some workers may occupy motels and other temporary accommodations, including housing provided onsite at some power plants.

Plants located in rural communities, where traditional employment is in agriculture, may have relatively small housing markets, stable prices for most types of housing, lower median house values, and moderate and stable vacancy rates. Given the large differential between power plant employee earnings and average regional earnings (see Section 3.8.2), power plant workers may occupy housing with a higher price than the regional median price. Limits to housing growth are less likely in rural communities.

In semi-urban regions, housing markets are likely to change more rapidly with suburban and exurban population growth near metropolitan areas, including influxes of temporary populations to support recreational and tourist activities and the development of retirement communities. Each activity can potentially produce more housing turnover, higher prices for most types of

Sparseness Indices

Most Sparse	1	There are fewer than 40 people/mi ² (15 people/km ²) and there is no community with 25,000 or more people within 20 mi (32 km) of the plant.
	2	There are 40 to 60 people/mi ² (15 to 23 people/km ²) and there is no community with 25,000 or more people within 20 mi (32 km) of the plant.
	3	There are 60 to 120 people/mi ² (23 to 46 people/km ²) and there is at least one community with more than 25,000 people/mi ² (10,000 people/km ²) within 20 mi (32 km) of the plant.
Least Sparse	4	There are more than 120 people/mi ² (46 people/km ²) within 20 mi (32 km) of the plant.

Proximity Indices

Not in Close Proximity	1	There are fewer than 50 people/mi ² (19 people/km ²) and there is no city with more than 100,000 people within 50 mi (80 km) of the plant.
	2	There are 50 to 190 people/mi ² (19 to 73 people/km ²) and there is no city with 100,000 people within 50 mi (80 km) of the plant.
	3	There are fewer than 190 people/mi ² (73 people/km ²) and there are one or more cities with more than 100,000 people within 50 mi (80 km) of the plant.
In Close Proximity	4	There are more than 190 people/mi ² (73 people/km ²) within 50 mi (80 km) of the plant.

1 housing, and lower vacancy rates. Given the smaller differential between power plant
 2 employee earnings and average regional earnings (see Section 3.8.2), power plant workers
 3 may occupy housing with prices close to the regional median price. Controls on housing
 4 development are more likely in semi-urban communities, particularly where there is a transient
 5 seasonal population.

6
 7 Nuclear power plants provide tax revenues to local and State government entities. Although the
 8 most important source of revenue for local communities is property taxes, other sources of
 9 revenue include levies of electricity output and direct funding for local educational facilities and
 10 programs. In 2006, State and local taxes paid by power plants ranged from \$0.9 million at
 11 Three Mile Island to \$90.6 million at Palo Verde, averaging \$24.1 million (Table 3.8-9).
 12 Differences in tax revenues among plants are related to variations in local and State taxation
 13 laws, electricity output, power plant size, and plant employment. Tax revenues may be used by
 14 local, regional, and State governmental entities to fund education, public safety, local
 15 government services, and transportation. In smaller rural communities, power plant tax
 16 revenues can affect the level and quality of public services available to local residents, with
 17 property tax revenues paid by power plants contributing more than 50 percent of total property
 18 taxes in some communities (e.g., at the D.C. Cook and Palisades plants in Michigan and
 19

Table 3.8-9. State and Local Tax Revenues Generated at Eight Nuclear Power Plants

Plant ^(a)	Tax Revenues (\$ million)
Diablo Canyon	27.0
Grand Gulf	26.2
Indian Point	35.3
Millstone	25.0
Palo Verde	90.6
Susquehanna	35.3
Three Mile Island	0.9
Wolf Creek	24.8

(a) Data for Limerick, Oconee, and Peach Bottom are not included because impact estimates are not available at the State level.

Source: Nuclear Energy Institute 2003; 2004a,b,c; 2005a,b; 2006a,b,c

Affected Environment

1 the Nine Mile Point plant in New York). Even in semi-urban regions, revenues from power
2 plants provide support for public services at the local level (e.g., at the Oyster Creek plant in
3 New Jersey).

4
5 The restructuring of utilities has occurred in some States with the deregulation of electricity
6 markets, and this has led to changes in the methods used to estimate property values at some
7 nuclear power plants. At some plants, these changes have had an impact on the property
8 taxes that utilities pay to State and local taxing jurisdictions. Any changes in tax revenues
9 following utility deregulation would not occur as a direct result of license renewal.

10 11 **3.8.5 Local Transportation**

12
13 Local and regional transportation networks in the vicinity of nuclear power plant sites may vary
14 considerably depending on the regional population density, location, and size of local
15 communities, nature of economic development patterns, location of the region relative to
16 interregional transportation corridors, and land surface features, such as mountains, rivers, and
17 lakes. The impacts of employee commuting patterns on the transportation network in the
18 vicinity of nuclear power plants depend on the extent to which these factors limit or facilitate
19 traffic movements and on the size of the plant workforce that uses the network at any given
20 time. Impacts at the local level in the immediate vicinity of power plant sites vary depending on
21 the capacity of the local road network, local traffic patterns, and particularly the availability of
22 alternate routes for power plant workers. Given the rural locations of most power plant sites,
23 site traffic has a small impact on the local road system, since often there is not much other
24 traffic on local roads in the immediate vicinity of the plant. Because most sites have only one
25 access road, there may be congestion on this road at certain times, such as during shift
26 changes.

27 28 **3.9 Human Health**

29 30 **3.9.1 Radiological Exposure and Risk**

31
32 Radiological exposures from nuclear power plants include offsite doses to members of the
33 public and onsite doses to the workforce. Each of these impacts is common to all commercial
34 U.S. reactors. The Atomic Energy Act requires the NRC to promulgate, inspect, and enforce
35 standards that provide an adequate level of protection for public health and safety and the
36 environment. The NRC continuously evaluates the latest radiation protection recommendations
37 from international and national scientific bodies to establish the requirements for nuclear power
38 plant licensees. The NRC has established multiple layers of radiation protection limits to
39 protect the public against potential health risks from exposure to effluent discharges from
40 nuclear power plant operations. If the licensees exceed a certain fraction of these dose levels

1 in a calendar quarter, they are required to notify the NRC, investigate the cause, and initiate
 2 corrective actions within the specified time frame. Section 3.9.1.1 discusses regulatory
 3 requirements at nuclear power plants. Sections 3.9.1.2 and 3.9.1.3 discuss occupational and
 4 public exposure, respectively. These sections evaluate the performance of licensees in
 5 implementing these requirements, and they compare the doses and releases with permissible
 6 levels. Risk estimates are provided in Section 3.9.1.4.

7
 8 **3.9.1.1 Regulatory Requirements**

9
 10 Nuclear power reactors in the United States must be licensed by the NRC and must comply
 11 with NRC regulations and conditions specified in the license in order to operate. The licensees
 12 are required to comply with 10 CFR Part 20, Subpart C, "Occupational Dose Limits for Adults,"
 13 and 10 CFR Part 20, Subpart D, "Radiation Dose Limits for Individual Members of the Public."
 14

15 **3.9.1.1.1 Regulatory Requirements for Occupational Exposure**

16
 17 10 CFR 20.1201 establishes occupational dose limits (see Table 3.9-1).

18
 19 Under 10 CFR 20.2206, the NRC requires licensees to submit an annual report of the results of
 20 individual monitoring carried out by the licensee for each individual for whom monitoring was
 21 required by 10 CFR 20.1502 during that year.
 22

Table 3.9-1. Occupational Dose Limits for Adults Established by 10 CFR Part 20

Tissue	Dose Limit ^(a)
Whole body or any individual organ or tissue other than the lens of the eye	More limiting of 5 rem/yr TEDE to whole body or 50 rem/yr sum of the deep dose equivalent and the committed dose equivalent to any individual organ or tissue other than the lens of the eye
Lens of the eye	15 rem/yr dose equivalent
Extremities, including skin	50 rem/yr shallow dose equivalent

(a) See text box for definitions
 Note: To convert rem to sievert, multiply by 0.01.

23

Definitions

- **Total effective dose equivalent (TEDE):** Sum of the dose equivalent (for external exposure) and the committed effective dose equivalent (for internal exposure).
- **Committed effective dose equivalent (CEDE):** Sum of the products of the weighting factors for body organs or tissues that are irradiated and the committed dose equivalent to these organs or tissues.
- **Deep dose equivalent:** Applies to external whole-body exposure and is the dose equivalent at a tissue depth of 1 cm.
- **Committed dose equivalent:** Dose equivalent to organs or tissues from an intake of radioactive material for the 50-year period following the intake.
- **Dose equivalent:** Product of the absorbed dose in the tissue, quality factor, and all other necessary modifying factors at the location of interest.
- **Shallow dose equivalent:** Applies to the external exposure of the skin, as the dose equivalent at a tissue depth of 0.007 cm averaged over an area of 1 cm².
- **Organ dose:** Dose received as a result of radiation energy absorbed in a specific organ.
- **Total body dose or whole body dose:** Sum of the dose received from external exposure to the total body, gonads, active blood-forming organs, head and trunk, or lens of the eye and the dose due to the intake of radionuclides by inhalation and ingestion, where a radioisotope is uniformly distributed throughout the body tissues rather than being concentrated in certain parts.

1 Under 10 CFR 20.2202 and 10 CFR 20.2203, the NRC requires all licensees to submit reports
2 of all occurrences involving personnel radiation exposures that exceed certain control levels.
3 The control levels are used to investigate occurrences and to take corrective actions as
4 necessary. Depending on the magnitude of the exposure, the occurrence reporting is required
5 immediately, within 24 hours, or within 30 days. On the basis of the reporting requirement, the
6 control levels can be placed in one of three categories (A, B, or C), as follows (Burrows and
7 Hagemeyer 2006):

- 8
9 • Category A, immediate notification. A TEDE of 25 rem or more to any individual, an eye
10 dose equivalent of 75 rem or more, or a shallow dose equivalent to the skin or
11 extremities of 250 rad or more (10 CFR 20.2202(a)(1)).
12
- 13 • Category B, notification within 24 hours. A TEDE of 5 rem or more to any individual, an
14 eye dose equivalent of 15 rem or more, or a shallow dose equivalent to the skin or
15 extremities of 50 rem or more (10 CFR 20.2202(b)(1)).
16
17

- Category C, written report within 30 days. Any incident for which notification was required and doses or releases that exceed the limits in the license set by the NRC or EPA (10 CFR 20.2203).

3.9.1.1.2 Regulatory Requirements for Public Exposure

NRC regulations in 10 CFR Part 20 identify maximum allowable concentrations of radionuclides in air and water above background at the boundary of unrestricted areas to control radiation exposures of the public and releases of radioactivity. These concentrations are derived on the basis of an annual TEDE of 0.1 rem to individual members of the public. In addition, pursuant to 10 CFR 50.36a, nuclear power reactors have special license conditions called technical specifications for radioactive gaseous and liquid releases from the plant that are required to minimize the radiological impacts associated with plant operations to levels that are as low as is reasonably achievable (ALARA).

Appendix I to 10 CFR Part 50 provides numerical values on dose-design objectives for operation of LWRs to meet the ALARA requirement. The design objective doses for Appendix I are summarized here in Table 3.9-2.

In addition to keeping within NRC requirements, nuclear power plant releases to the environment must comply with EPA standards in 40 CFR Part 190, "Environmental Radiation Protection Standards for Nuclear Power Operations." These standards specify limits on the annual dose equivalent from normal operations of uranium fuel-cycle facilities (except mining, waste disposal operations, transportation, and reuse of recovered non-uranium special nuclear and by-product materials). The standards are given in Table 3.9-2. Radon and its daughters are covered by Subpart D of 40 CFR Part 192 (the conforming NRC regulations are in Appendix A of 10 CFR Part 40).

EPA standards in 40 CFR Part 61, "National Emission Standards for Hazardous Air Pollutants," apply only to airborne releases. The EPA specified an annual effective dose equivalent limit of 10 mrem for airborne releases from nuclear power plants; however, no more than 3 mrem can be caused by any isotope of iodine. However, the EPA has stayed the rule for NRC-licensed commercial nuclear power reactors on the basis of its finding that NRC's ALARA program for power reactor air effluents protects and is likely to continue to protect public health and safety with an ample margin of safety.

Affected Environment

Table 3.9-2. Design Objectives and Annual Standards on Doses to the General Public from Nuclear Power Plants^(a)

Tissue	Gaseous Effluents	Liquid Effluents
Design objectives, Appendix I to 10 CFR 50		
Total body, mrem	5 ^(b)	3
Any organ (all pathways), mrem		10
Ground-level air dose, ^(b) mrad	10 (gamma) and 20 (beta)	
Any organ ^(c) (all pathways), mrem	15	
Skin, mrem	15	
Dose standards, 40 CFR Part 190, Subpart B		
Whole body, ^(d) mrem	25	
Thyroid, ^(d) mrem	75	
Any other organ, ^(d) mrem	25	

(a) Calculated doses.

(b) The ground-level air dose has always been limiting because an occupancy factor cannot be used. The 5-mrem total body objective could be limiting only in the case of high occupancy near the restricted area boundary.

(c) Particulates, radioiodines.

(d) All effluents and direct radiation except radon and its daughters.

1
2 Experience with the design, construction, and operation of nuclear power reactors indicates that
3 compliance with the design objectives of Appendix I to 10 CFR Part 50 will keep average annual
4 releases of radioactive material in effluents at small percentages of the limits specified in
5 10 CFR Part 20 and 40 CFR Part 190. At the same time, the licensee is given the flexibility in
6 operations, compatible with considerations of health and safety, to ensure that the public is
7 provided with a dependable source of power, even under unusual operating conditions that
8 might temporarily result in releases that were higher than such small percentages but still well
9 within the regulatory limits.

10
11 Another 10 CFR Part 20 requirement is that the sum of the external and internal doses (TEDE)
12 for a member of the public shall not exceed 100 mrem/yr. This value is an annual limit and is
13 not intended to be applied as a long-term average goal. The dose limits in 10 CFR Part 20 are
14 based on the methodology described in International Commission on Radiological Protection
15 (ICRP) Publication 26 (ICRP 1977). The radiation levels at any unrestricted area should not
16 exceed 2 mrem in any single hour. Licensees may comply with the 100-mrem limit by
17 demonstrating (1) by measurement or calculation that the dose to the individual likely to receive
18 the highest dose from sources under the licensee's control does not exceed the limit or (2) that
19 the concentrations of radioactive material released in gaseous and liquid effluents averaged
20 over a single year do not exceed the levels specified in 10 CFR 20, Appendix B, Table 2; and at

1 the unrestricted area boundary, the dose from external sources would not exceed 2 mrem in
2 any given hour and 50 mrem in a single year. The concentration values given in Table 2 of
3 Appendix B to 10 CFR 20 are equivalent to the radionuclide concentrations that, if inhaled or
4 ingested continuously in a year, would produce a TEDE of 50 mrem. Nuclear power reactors,
5 as discussed earlier in this section, are subject to additional regulatory controls which maintain
6 doses to members of the public to the ALARA dose-design objectives in Appendix I to 10 CFR
7 Part 50.

8 9 **3.9.1.2 Occupational Radiological Exposures**

10
11 This section provides an evaluation of the radiological impacts on nuclear power plant workers.
12 This evaluation extends to all nuclear power reactors. Currently there are 104 operating
13 reactors in the United States, and all are LWRs. Among them, 35 are BWRs and 69 are
14 PWRs.

15
16 Plant workers conducting activities involving radioactively contaminated systems or working in
17 radiation areas can be exposed to radiation. Individual occupational doses are measured by
18 NRC licensees as required by the basic NRC radiation protection standard, 10 CFR part 20 (see
19 Section 3.9.1.1). Most of the occupational radiation dose to nuclear plant workers results from
20 external radiation exposure rather than from internal exposure from inhaled or ingested
21 radioactive materials. Workers also receive radiation exposure during the storage and handling
22 of radioactive waste and during the inspection of stored radioactive waste. However, this
23 source of exposure is small compared with other sources of exposure at operating nuclear
24 plants.

25
26 Table 3.9-3 shows the radiation exposure data from all commercial U.S. nuclear power plants
27 for the years 1993 through 2005. The year 1993 was chosen as a starting date because the
28 dose data for years before 1993 were presented in the original GEIS. For each year, the
29 number of reactors, the number of workers receiving measurable exposures, the collective
30 dose^(a) for all reactors combined, and the number of individuals receiving a dose in the range of
31 4 to 5 rem are given. Data indicate that no worker received a dose in the range of 4 to 5 rem
32 from 2003 to 2005. The collective dose has been about 12,000 person-rem or less since 2001.

33
34 Table 3.9-4 shows the occupational dose history (since 1993) for all commercial U.S. reactors.
35 Average collective occupational dose information and average annual individual worker doses
36 are presented for plants that operated between 1993 and 2005. For the period from 1993 to
37 2005, the annual average dose per plant worker decreased from 0.31 to 0.18 rem for BWRs

(a) The collective dose is the sum of all personal doses and is expressed as person-rem.

Table 3.9-3. Occupational Whole-Body Dose Data at U.S. Commercial Nuclear Power Plants

Year	Number of Workers with Measurable Doses	Collective Dose (person-rem)	Number of Reactors	Number of Workers with Dose in the Range of 4 to 5 rem
1993	93,749	26,364	106	5
1994	83,454	21,704	107	0
1995	85,671	21,688	107	2
1996	84,644	18,883	109	0
1997	84,711	17,149	109	0
1998	71,485	13,187	105	1
1999	75,420	13,599	104	0
2000	74,108	12,652	104	0
2001	67,570	11,109	104	0
2002	73,242	12,126	104	1
2003	74,813	11,956	104	0
2004	69,849	10,368	104	0
2005	78,127	11,456	104	0

Source: Burrows and Hagemeyer 2006

Note: To convert rem to sievert (Sv), multiply by 0.01.

1
 2 and from 0.25 to 0.12 rem for PWRs. During 2005, at all operating nuclear power plants, the
 3 annual average individual dose was 0.15 rem compared with an exposure limit of 5 rem. The
 4 average collective occupational exposure for the year 2005 was roughly 1.71 person-Sv
 5 (171 person-rem) per plant at BWRs and about 0.79 person-Sv (79 person-rem) per plant at
 6 PWRs.

7
 8 Tables 3.9-5 and 3.9-6 show the 3-year collective dose per reactor, number of workers with
 9 measurable doses, and average dose per worker for BWRs and PWRs, respectively, for the
 10 years 2003 to 2005. For the years 2003 to 2005, the average collective occupational
 11 exposure for the BWRs was 1.63 person-Sv (163 person-rem) per plant, and for the PWRs,
 12 it was 0.81 person-Sv (81 person-rem).

13
 14 Deviations higher than these averages in the table are routinely experienced, depending largely
 15 on whether a plant had an outage during a given year and the nature and extent of
 16 refurbishment or repair activities undertaken during outages.

17

Table 3.9-4. Annual Average Occupational Dose for U.S. Commercial Nuclear Power Plants

Year	Average Collective Occupational Dose Per Plant (person-rem)			Average Individual Whole-Body Dose Per Plant (rem)		
	LWR	BWR	PWR	LWR	BWR	PWR
1993	241	330	194	0.27	0.31	0.25
1994	203	327	137	0.26	0.31	0.22
1995	198	256	168	0.25	0.27	0.24
1996	173	256	131	0.22	0.25	0.20
1997	157	205	133	0.20	0.22	0.19
1998	126	190	92	0.18	0.21	0.17
1999	131	184	105	0.18	0.20	0.17
2000	122	174	95	0.17	0.20	0.15
2001	107	138	91	0.16	0.17	0.16
2002	117	175	87	0.17	0.20	0.14
2003	115	162	91	0.16	0.18	0.14
2004	100	156	71	0.15	0.16	0.14
2005	110	171	79	0.15	0.18	0.12

Source: Burrows and Hagemeyer 2006
 Note: To convert rem to Sv, multiply by 0.01.

1
 2 To identify trends, Figure 3.9-1 provides the average and median values of the annual collective
 3 dose per reactor for BWRs and PWRs for the years 1992 through 2005. The reported ranges
 4 of the values are shown by the vertical lines that extend to the minimum and maximum
 5 observed values. The rectangles indicate the range of values of the collective dose exhibited
 6 by those plants ranked in the 25th through the 75th percentiles. The median values do not
 7 normally fluctuate as much as the average values from year to year because they are not
 8 affected as much by the extreme values of the collective doses. The median collective dose
 9 was 64 person-rem for PWRs and 153 person-rem for BWRs in 2005. Figure 3.9-1 also shows
 10 that, in 2005, 50 percent of the PWRs reported collective doses between 44 and 107 person-
 11 rem, while 50 percent of the BWRs reported collective doses between 94 and 198 person-rem.
 12

13 Table 3.9-7 presents the average, maximum, and minimum collective and individual
 14 occupational doses for all commercial nuclear power plants operating between 1993
 15 and 2005. For PWRs, the maximum variation in collective dose and annual average
 16 occupational dose was observed for Indian Point Unit 2. From 1993 to 2005, the collective
 17 dose varied from 11 to 675 person-rem, and the annual average occupational dose varied

Affected Environment

Table 3.9-5. Collective and Individual Worker Doses at BWRs from 2003 through 2005

Plant	Number of Reactor-Years	Collective TEDE per Reactor per Year (person-rem)	Number of Workers with Measurable TEDE	Average Annual TEDE per Worker (rem)
Limerick 1, 2	6	81	4023	0.12
Hatch 1, 2	6	93	3792	0.15
Duane Arnold	3	94	1928	0.15
Oyster Creek	3	99	2078	0.14
FitzPatrick	3	100	1771	0.17
Susquehanna 1, 2	6	117	5976	0.12
Grand Gulf	3	119	2859	0.13
Fermi 2	3	125	3047	0.12
Clinton	3	125	2292	0.16
Monticello	3	126	2056	0.18
Brunswick 1, 2	6	133	5878	0.14
Hope Creek 1	3	149	4918	0.09
Cooper	3	153	2629	0.17
Peach Bottom 2, 3	6	154	4864	0.19
Vermont Yankee	3	155	2843	0.16
Pilgrim	3	166	3076	0.16
Dresden 2, 3	6	166	6148	0.16
River Bend 1	3	170	3172	0.16
LaSalle 1, 2	6	193	6716	0.17
Columbia	3	199	4052	0.15
Nine Mile Point 1, 2	6	204	4229	0.29
Browns Ferry 1, 2, 3	9	212	9593	0.20
Quad Cities 1, 2	6	318	6201	0.31
Perry	3	366	4110	0.27
Totals and averages	105	–	98,251	0.17
Average per reactor-yr	–	163	–	–

Source: Burrows and Hagemeyer 2006
 Note: To convert rem to Sv, multiply by 0.01.

1

Table 3.9-6. Collective and Individual Worker Doses at PWRs from 2003 through 2005

Plant	Number of Reactor-Years	Collective TEDE per Reactor per Year (person-rem)	Number of Workers with Measurable TEDE	Average Annual TEDE per Worker (rem)
Seabrook	3	43	2306	0.06
Harris	3	45	1697	0.08
Farley 1, 2	6	48	2739	0.10
Prairie Island 1, 2	6	48	2562	0.11
Summer 1	3	51	1679	0.09
GINNA	3	52	1185	0.13
Vogtle 1, 2	6	53	2670	0.12
Point Beach 1, 2	6	54	2105	0.15
Kewaunee	3	56	1101	0.15
Indian Point 3	3	58	2029	0.09
H.B. Robinson 2	3	63	1852	0.10
North Anna 1, 2	6	63	2692	0.14
Byron 1, 2	6	63	3272	0.12
Wolf Creek 1	3	66	1769	0.11
Palo Verde 1, 2, 3	9	68	5281	0.12
Catawba 1, 2	6	70	3551	0.12
Braidwood 1, 2	6	71	3484	0.12
Indian Point 2	3	73	1847	0.12
McGuire 1, 2	6	74	3358	0.13
Comanche Peak 1, 2	6	74	2868	0.16
Three Mile Island 1	3	75	2290	0.10
D.C. Cook 1, 2	6	76	3275	0.14
Waterford 3	3	78	1672	0.14
Turkey Point 3, 4	6	79	3667	0.13
Crystal River 3	3	84	2031	0.13
Oconee 1, 2, 3	9	85	5991	0.13
South Texas 1, 2	6	85	3019	0.17
Beaver Valley 1, 2	6	85	3871	0.13

1

Table 3.9-6. (cont.)

Plant	Number of Reactor-Years	Collective TEDE per Reactor per Year (person-rem)	Number of Workers with Measurable TEDE	Average Annual TEDE per Worker (rem)
Salem 1,2	6	86	5959	0.09
Diablo Canyon 1,2	6	86	3189	0.16
Surry 1,2	6	89	3533	0.15
Davis-Besse	3	93	1785	0.16
Calvert Cliffs 1,2	6	96	3818	0.15
San Onofre 2,3	6	97	3341	0.17
Sequoyah 1,2	6	102	4770	0.13
Watts Bar	3	105	2856	0.11
Millstone 2,3	6	110	3407	0.19
Arkansas 1,2	6	113	4535	0.15
Callaway 1	3	117	2976	0.12
St. Lucie 1,2	6	118	4356	0.16
Fort Calhoun	3	169	2198	0.23
Palisades	3	195	1952	0.30

Totals and averages	207	—	—	0.13
Average per reactor-yr	—	81	602	—

Source: Burrows and Hagemeyer 2006

Note: To convert rem to Sv, multiply by 0.01.

2

3 from 0.02 to 0.45 rem. For BWRs, the maximum variation in collective dose was observed for
 4 the Quad Cities plant. From 1993 to 2005, the collective dose varied from 72 to 893 person-
 5 rem. The maximum variation in the annual average occupational dose was observed for the
 6 Brunswick plant; from 1993 to 2005, it varied from 0.11 to 0.70 rem.

7

8 Table 3.9-8 shows the yearly annual collective occupational dose for all commercial nuclear
 9 power plants operating between 1993 and 2005 and Table 3.9-9 shows the yearly annual
 10 individual average occupational dose for all commercial nuclear power plants operating
 11 between 1993 and 2005. The year 1993 was chosen as a starting date because the dose data
 12 for years before 1993 were presented in the 1996 GEIS. From 1993 through 2005, operating
 13 nuclear power plants would have gone through many refueling outages, 5-year ISI, 10-year ISI,
 14 and also some refurbishment activities. To check for trends, data were divided into two time
 15 frames: from 1993 to 1999 and from 2000 to 2005. The averages for these two time frames
 16 were calculated and compared. The yearly average collective dose from 2000 to 2005

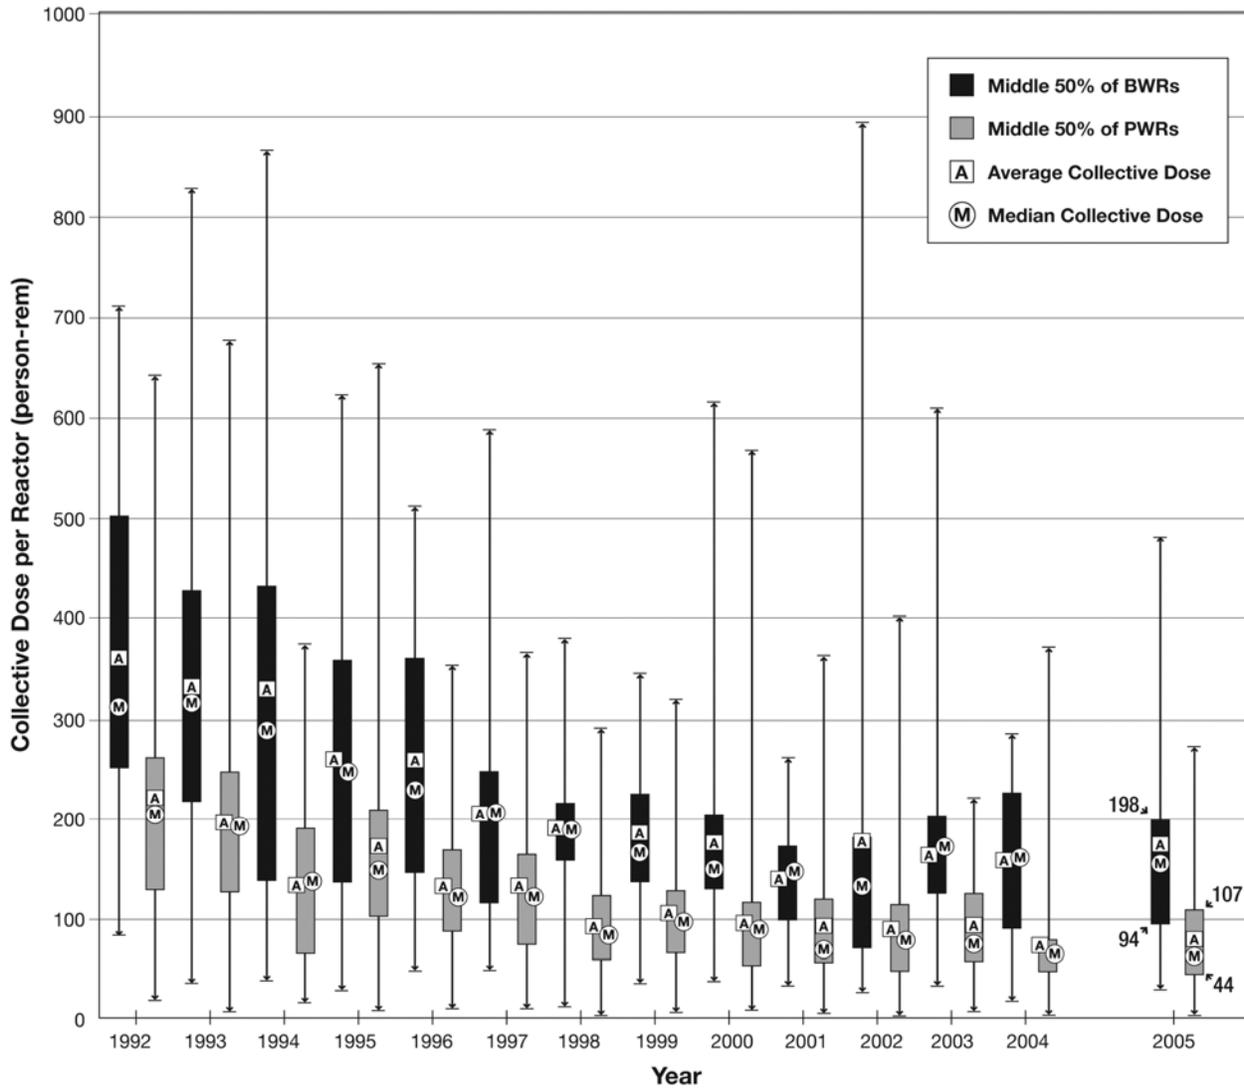


Figure 3.9-1. Average, Median, and Extreme Values of the Annual Collective Dose per Reactor from 1992 to 2005 (Source: Burrows and Hagemeyer 2006)

1
2
3
4
5
6
7
8
9
10
11
12
13

was mostly lower than the dose from 1993 to 1999. For a few nuclear power plants, the average annual collective dose from 2000 to 2005 was higher, but in all cases, the yearly average occupational dose was less than 0.4 rem. The yearly average occupational dose was mostly lower from 2000 to 2005 than from 1993 to 1999.

The data in Tables 3.9-8 and 3.9-9 show that although there are variations from year to year, there is no consistent trend that shows that occupational doses are increasing over time.

Affected Environment

Table 3.9-7. Annual Collective Dose and Annual Occupational Dose for Different Commercial Nuclear Power Plants from 1993 through 2005

Plant	Collective Dose (person-rem/reactor)			Annual Occupational Dose (rem)		
	Average	Maximum	Minimum	Average	Maximum	Minimum
PWRs						
Arkansas 1, 2	107	238	50	0.13	0.20	0.09
Beaver Valley 1, 2	121	311	22	0.17	0.30	0.08
Braidwood 1, 2	103	167	44	0.16	0.26	0.09
Byron 1, 2	117	228	30	0.19	0.32	0.08
Callaway 1	137	321	8	0.14	0.29	0.03
Calvert Cliffs 1, 2	118	227	68	0.19	0.31	0.12
Catawba 1,2	104	231	41	0.15	0.25	0.08
Comanche Peak 1, 2	83	144	33	0.16	0.24	0.09
D.C. Cook 1, 2	110	275	14	0.15	0.30	0.06
Crystal River 3	117	353	4	0.12	0.30	0.03
Davis-Besse 1	132	403	6	0.13	0.28	0.03
Diablo Canyon 1, 2	121	295	59	0.17	0.29	0.11
Farley 1, 2	125	230	34	0.20	0.31	0.08
Fort Calhoun	146	273	22	0.21	0.31	0.10
Ginna	94	193	7	0.16	0.27	0.07
Harris 1	95	252	7	0.10	0.20	0.04
Indian Point 2	237	675	11	0.19	0.45	0.02
Indian Point 3	68	234	4	0.09	0.15	0.02
Kewaunee	80	200	4	0.18	0.27	0.04
McGuire 1, 2	116	246	36	0.17	0.27	0.08
Millstone Unit 2, 3	122	279	57	0.17	0.27	0.10
North Anna 1, 2	120	454	30	0.18	0.33	0.09
Oconee 1, 2, 3	102	193	50	0.17	0.29	0.10
Palisades	201	462	10	0.23	0.38	0.07
Palo Verde 1, 2, 3	90	197	47	0.16	0.28	0.10
Point Beach 1, 2	79	138	43	0.22	0.35	0.14
Prairie Island 1, 2	56	87	31	0.16	0.23	0.10

Table 3.9-7. (cont.)

Plant	Collective Dose (person-rem/reactor)			Annual Occupational Dose (rem)		
	Average	Maximum	Minimum	Average	Maximum	Minimum
H.B. Robinson 2	117	337	5	0.13	0.28	0.04
Salem 1, 2	108	204	21	0.15	0.27	0.08
San Onofre 2, 3	125	384	6	0.16	0.35	0.04
Seabrook	63	186	6	0.07	0.13	0.02
Sequoyah 1, 2	130	216	43	0.15	0.23	0.07
South Texas 1, 2	106	165	24	0.17	0.22	0.07
St. Lucie 1, 2	152	323	50	0.20	0.34	0.10
Summer 1	117	374	10	0.13	0.26	0.05
Surry 1, 2	122	203	44	0.19	0.27	0.10
Three Mile Island 1	99	213	0	0.10	0.19	0.00
Turkey Point 3, 4	105	238	37	0.17	0.32	0.09
Vogtle 1, 2	100	226	41	0.18	0.32	0.10
Waterford	89	191	3	0.12	0.16	0.04
Wolf Creek 1	113	265	3	0.13	0.27	0.04
Watts Bar 1	84	166	3	0.08	0.12	0.03
BWRs						
Duane Arnold	166	407	19	0.20	0.39	0.09
Browns Ferry 1, 2, 3	174	290	98	0.21	0.26	0.16
Brunswick 1, 2	238	500	123	0.24	0.70	0.11
Clinton 1	195	498	34	0.20	0.40	0.10
Columbia	291	866	47	0.20	0.46	0.07
Cooper	155	391	39	0.18	0.35	0.10
Dresden 2, 3	282	828	130	0.23	0.60	0.11
Fermi 2	112	213	28	0.11	0.19	0.07
FitzPatrick	204	358	51	0.18	0.26	0.10
Grand Gulf	190	357	31	0.17	0.23	0.11
Hatch 1, 2	201	432	84	0.24	0.39	0.13
Hope Creek 1	175	350	26	0.14	0.25	0.08
LaSalle 1, 2	238	427	42	0.24	0.50	0.14
Limerick 1, 2	114	179	74	0.16	0.20	0.11

Table 3.9-7. (cont.)

Plant	Collective Dose (person-rem/reactor)			Annual Occupational Dose (rem)		
	Average	Maximum	Minimum	Average	Maximum	Minimum
Monticello	186	494	35	0.27	0.52	0.10
Nine Mile Point 1, 2	210	380	75	0.25	0.33	0.16
Oyster Creek	263	844	28	0.17	0.35	0.09
Peach Bottom 2, 3	189	290	133	0.21	0.31	0.17
Perry	266	691	42	0.19	0.33	0.11
Pilgrim 1	231	588	38	0.21	0.37	0.08
Quad Cities 1, 2	388	893	72	0.35	0.52	0.20
River Bend	229	519	35	0.18	0.26	0.09
Susquehanna 1, 2	167	238	91	0.20	0.28	0.10
Vermont Yankee	146	231	38	0.20	0.26	0.15

Source: Burrows and Hagemeyer 2006
 Note: To convert rem to Sv, multiply by 0.01.

1
 2 The average, maximum, and minimum collective occupational doses are presented in Table
 3 3.9-10 for plants operated between 1993 and 2005. The average collective doses, however,
 4 are based on widely varying yearly doses. For example, between 1993 and 2005,
 5 annual collective doses for operating PWRs ranged from 0 to 675 person-rem; for operating
 6 BWRs, they ranged from 19 to 893 person-rem. From 1993 to 1998, the average collective
 7 dose decreased more than 50 percent for PWRs and 40 percent for BWRs. From 1999
 8 through 2005, the average collective dose for PWRs was in a range 71 to 105 person-rem, and
 9 for BWRs, it was in a range of 138 to 184 person-rem.

10
 11 Average, maximum, and minimum individual occupational doses per reactor are presented in
 12 Table 3.9-11 for plants that operated between 1993 and 2005. From 1993 through 1998, the
 13 average annual dose per plant worker decreased more than 30 percent for both PWRs and
 14 BWRs. From 1999 through 2005, the average annual dose per plant worker for PWRs ranged
 15 from 0.12 to 0.17 rem, and for BWRs, ranged from 0.16 to 0.20 rem. The annual dose per
 16 plant worker for operating PWRs ranged from 0.0 to 0.45 rem; for operating BWRs, it ranged
 17 from 0.07 to 0.70 rem.

18
 19 Table 3.9-12 provides the distribution of individual doses for 2005. The dose distribution
 20 indicates that no worker received doses greater than 3 rem in 2005. Only 17 workers
 21 (0.01 percent) received whole-body doses exceeding 2 rem during 2005. At BWRs, less than
 22 0.03 percent of the workers received doses greater than 2 rem. At PWRs, no worker received

Table 3.9-8. Annual Collective Dose for Commercial Nuclear Power Plants from 1993 through 2005

Plant	Annual Collective Dose (person-rem/reactor)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
PWRs													
Arkansas 1, 2	134	86	193	102	60	84	92	121	53	133	50	53	238
Beaver Valley 1, 2	311	22	227	225	153	30	50	169	92	45	139	79	40
Braidwood 1, 2	137	149	118	167	161	130	73	97	51	46	123	48	44
Byron 1, 2	216	140	153	228	121	138	120	97	30	98	44	45	100
Callaway 1	225	14	187	248	12	201	321	16	107	96	8	121	223
Calvert Cliffs 1, 2	203	227	118	120	115	94	96	68	84	123	133	72	84
Catawba 1,2	198	104	231	151	133	81	60	94	58	41	106	62	42
Comanche Peak 1, 2	55	45	90	144	73	116	126	39	58	113	33	68	121
D.C. Cook 1, 2	22	240	102	107	275	53	86	169	14	139	105	78	46
Crystal River 3	60	228	8	353	179	19	251	15	148	5	127	4	123
Davis-Besse 1	348	144	7	167	10	155	28	168	6	403	220	7	51
Diablo Canyon 1, 2	141	295	143	88	110	87	225	91	59	75	68	127	62
Farley 1, 2	167	125	230	116	139	216	95	180	161	48	56	54	34
Fort Calhoun	157	23	139	226	41	224	159	35	226	164	212	22	273
Ginna	193	138	136	168	81	15	175	76	10	80	75	7	73
Harris 1	31	222	174	17	149	133	16	101	252	7	68	57	8
Indian Point 2	675	48	548	54	367	290	41	567	22	248	12	196	11
Indian Point 3	60	58	67	22	234	15	117	9	118	7	96	4	74
Kewaunee	106	72	109	126	56	88	5	100	200	4	73	91	4
McGuire 1, 2	232	199	69	119	246	71	129	67	69	91	36	98	87
Millstone Unit 2, 3	279	94	208	63	127	57	126	72	87	146	162	68	101
North Anna 1, 2	454	97	184	146	52	133	47	33	155	72	94	65	30
Oconee 1, 2, 3	79	179	101	86	74	122	67	91	193	75	82	123	50
Palisades	289	60	462	318	48	217	218	26	363	24	203	371	10

Table 3.9-8. (cont.)

Plant	Annual Collective Dose (person-rem/reactor)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
Palo Verde 1, 2, 3	197	154	161	101	82	64	49	53	61	47	70	66	67
Point Beach 1, 2	93	85	95	138	46	85	97	70	66	91	43	55	65
Prairie Island 1, 2	53	55	54	56	87	59	36	53	63	64	31	72	42
H.B. Robinson 2	337	63	215	167	13	170	124	8	125	111	5	118	65
Salem 1, 2	204	94	109	150	88	21	159	99	77	147	62	75	121
San Onofre 2, 3	384	16	228	65	171	98	177	58	66	68	82	204	6
Seabrook	6	113	102	10	186	19	106	70	9	67	71	6	52
Sequoyah 1, 2	187	148	184	135	210	133	83	179	73	54	216	43	48
South Texas 1, 2	126	24	146	69	137	92	130	116	119	165	72	60	124
St. Lucie 1, 2	246	253	207	193	323	67	89	50	114	78	71	80	203
Summer 1	297	374	13	97	163	14	120	167	69	60	71	10	72
Surry 1, 2	192	189	203	105	160	95	69	97	165	44	163	60	44
Three Mile Island 1	206	40	213	16	204	17	155	9	197	7	155	0	66
Turkey Point 3, 4	138	238	108	94	207	78	64	110	51	37	124	59	55
Vogtle 1, 2	184	109	100	226	79	81	115	61	65	122	42	41	76
Waterford	15	191	153	27	148	24	123	132	5	109	95	3	136
Wolf Creek 1	183	235	14	171	265	10	148	143	5	100	89	3	107
Watts Bar 1 ^(a)					113	3	99	122	6	94	166	6	144
BWRs													
Duane Arnold	407	120	357	270	63	237	201	44	138	35	124	19	140
Browns Ferry 1, 2, 3	290	287	138	130	174	123	149	111	98	119	201	224	212
Brunswick 1, 2	436	500	342	358	206	198	209	161	152	138	125	123	153
Clinton	498	63	316	350	172	177	87	253	34	208	57	283	36
Columbia	469	866	456	373	251	286	155	53	227	47	205	66	325
Cooper	391	79	228	48	174	182	48	200	169	39	135	47	276

Table 3.9-8. (cont.)

Plant	Annual Collective Dose (person-rem/reactor)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
Dresden 2, 3	828	417	438	228	234	214	296	131	201	178	179	191	130
Fermi 2	35	213	28	157	49	208	36	146	169	38	168	145	62
FitzPatrick	232	322	327	357	91	358	68	301	63	231	51	186	63
Grand Gulf	332	56	342	357	105	304	226	35	185	176	31	158	168
Hatch 1, 2	335	432	244	221	361	160	165	201	115	107	84	90	104
Hope Creek 1	98	326	196	158	350	55	279	188	156	26	139	240	67
LaSalle 1, 2	427	363	256	410	158	211	288	130	42	225	232	180	168
Limerick 1, 2	109	138	130	117	117	179	136	131	105	80	74	75	94
Monticello	494	395	44	240	106	209	70	216	221	40	169	35	175
Nine Mile Point 1, 2	317	75	380	145	215	189	224	142	172	259	188	225	201
Oyster Creek	416	844	90	449	50	308	42	614	46	266	43	227	28
Peach Bottom 2, 3	276	290	199	141	245	183	160	166	172	167	178	133	153
Perry	278	691	64	307	272	42	326	56	258	70	607	73	417
Pilgrim 1	435	200	482	116	588	71	344	51	180	38	250	41	206
Quad Cities 1, 2	425	564	368	513	327	381	101	447	72	893	219	256	481
River Bend	180	519	85	473	347	58	344	216	208	35	217	236	56
Susquehanna 1, 2	168	221	238	145	217	181	216	166	144	130	125	136	91
Vermont Yankee	217	38	182	231	57	199	176	38	143	150	54	212	198

(a) 1st commercial operation in May 1996
Source: Burrows and Hagemeyer 2006
Note: To convert rem to Sv, multiply by 0.01.

Table 3.9-9. Annual Average Measurable Occupational Doses at Commercial Nuclear Power Plant Sites from 1993 through 2005

Plant	Average Measurable Occupational Doses (rem)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
PWRs													
Arkansas 1, 2	0.14	0.13	0.17	0.14	0.10	0.13	0.13	0.12	0.10	0.17	0.10	0.09	0.20
Beaver Valley 1, 2	0.30	0.09	0.29	0.27	0.22	0.08	0.12	0.20	0.15	0.09	0.17	0.12	0.08
Braidwood 1, 2	0.26	0.24	0.21	0.25	0.19	0.14	0.13	0.12	0.11	0.09	0.16	0.10	0.10
Byron 1, 2	0.32	0.29	0.28	0.28	0.16	0.15	0.16	0.20	0.08	0.15	0.11	0.10	0.13
Callaway 1	0.20	0.07	0.18	0.25	0.05	0.22	0.29	0.07	0.12	0.10	0.03	0.11	0.14
Calvert Cliffs 1, 2	0.28	0.31	0.20	0.20	0.21	0.18	0.17	0.15	0.19	0.16	0.16	0.12	0.18
Catawba 1, 2	0.25	0.16	0.24	0.19	0.17	0.14	0.12	0.16	0.12	0.09	0.15	0.11	0.08
Comanche Peak 1, 2	0.12	0.09	0.19	0.20	0.17	0.24	0.19	0.10	0.13	0.20	0.10	0.16	0.18
D.C. Cook 1, 2	0.07	0.27	0.15	0.19	0.30	0.09	0.10	0.14	0.06	0.17	0.15	0.15	0.11
Crystal River 3	0.09	0.21	0.04	0.30	0.18	0.06	0.19	0.06	0.16	0.04	0.13	0.03	0.13
Davis-Besse 1	0.28	0.17	0.03	0.18	0.05	0.16	0.07	0.15	0.05	0.20	0.21	0.04	0.09
Diablo Canyon 1, 2	0.19	0.26	0.18	0.12	0.17	0.13	0.29	0.17	0.11	0.15	0.13	0.21	0.13
Farley 1, 2	0.26	0.24	0.29	0.20	0.25	0.31	0.17	0.21	0.18	0.13	0.14	0.09	0.08
Fort Calhoun	0.22	0.11	0.22	0.31	0.16	0.28	0.24	0.14	0.29	0.22	0.23	0.10	0.26
Ginna	0.23	0.20	0.18	0.17	0.15	0.09	0.27	0.18	0.07	0.15	0.15	0.07	0.13
Harris 1	0.09	0.20	0.16	0.04	0.13	0.14	0.06	0.11	0.16	0.05	0.09	0.08	0.05
Indian Point 2	0.45	0.13	0.32	0.14	0.27	0.25	0.12	0.28	0.06	0.18	0.05	0.17	0.02
Indian Point 3	0.13	0.11	0.11	0.08	0.15	0.07	0.13	0.06	0.12	0.04	0.11	0.02	0.08
Kewaunee	0.24	0.20	0.26	0.27	0.20	0.23	0.05	0.25	0.18	0.04	0.17	0.16	0.04
McGuire 1, 2	0.27	0.24	0.11	0.15	0.22	0.14	0.20	0.14	0.14	0.16	0.08	0.18	0.12
Millstone Unit 2, 3	0.27	0.15	0.25	0.13	0.18	0.10	0.15	0.10	0.13	0.19	0.25	0.17	0.15
North Anna 1, 2	0.33	0.19	0.24	0.24	0.12	0.22	0.13	0.09	0.25	0.16	0.18	0.13	0.09

Table 3.9-9. (cont.)

Plant	Average Measurable Occupational Doses (rem)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
Oconee 1, 2, 3	0.16	0.28	0.19	0.17	0.16	0.22	0.13	0.16	0.29	0.13	0.11	0.16	0.10
Palisades	0.32	0.15	0.38	0.29	0.14	0.24	0.23	0.10	0.35	0.11	0.25	0.38	0.07
Palo Verde 1, 2, 3	0.28	0.23	0.26	0.18	0.16	0.14	0.11	0.12	0.13	0.10	0.11	0.15	0.10
Point Beach 1, 2	0.33	0.31	0.35	0.27	0.14	0.19	0.20	0.18	0.18	0.19	0.14	0.17	0.15
Prairie Island 1, 2	0.20	0.10	0.21	0.20	0.23	0.20	0.13	0.17	0.18	0.13	0.10	0.12	0.11
H.B. Robinson 2	0.28	0.15	0.20	0.16	0.04	0.17	0.15	0.06	0.15	0.13	0.04	0.12	0.08
Salem 1, 2	0.11	0.20	0.18	0.18	0.20	0.10	0.27	0.17	0.12	0.12	0.10	0.10	0.08
San Onofre 2, 3	0.35	0.06	0.24	0.10	0.21	0.18	0.24	0.11	0.12	0.12	0.13	0.23	0.04
Seabrook	0.05	0.13	0.13	0.05	0.12	0.03	0.08	0.06	0.02	0.06	0.07	0.02	0.05
Sequoyah 1, 2	0.23	0.17	0.22	0.19	0.21	0.17	0.12	0.18	0.11	0.09	0.17	0.07	0.08
South Texas 1, 2	0.22	0.07	0.20	0.12	0.17	0.16	0.20	0.17	0.18	0.22	0.16	0.14	0.20
St. Lucie 1, 2	0.34	0.27	0.28	0.27	0.28	0.11	0.16	0.10	0.17	0.16	0.15	0.14	0.18
Summer 1	0.26	0.24	0.05	0.14	0.20	0.05	0.15	0.18	0.14	0.09	0.10	0.05	0.10
Surry 1, 2	0.27	0.25	0.22	0.21	0.24	0.16	0.14	0.16	0.26	0.11	0.20	0.12	0.10
Three Mile Island 1	0.11	0.09	0.17	0.06	0.19	0.06	0.13	0.05	0.16	0.04	0.13	0.00	0.07
Turkey Point 3, 4	0.22	0.32	0.19	0.16	0.26	0.15	0.14	0.17	0.12	0.09	0.17	0.11	0.10
Vogtle 1, 2	0.27	0.21	0.21	0.32	0.16	0.16	0.17	0.14	0.15	0.21	0.10	0.11	0.14
Waterford	0.08	0.16	0.14	0.08	0.13	0.09	0.15	0.16	0.05	0.14	0.13	0.04	0.15
Wolf Creek 1	0.19	0.22	0.06	0.17	0.27	0.05	0.18	0.17	0.05	0.12	0.11	0.04	0.12
Watts Bar 1 ^(a)					0.10	0.03	0.10	0.12	0.03	0.10	0.12	0.03	0.12
BWRs													
Duane Arnold	0.39	0.24	0.32	0.25	0.18	0.23	0.24	0.14	0.15	0.11	0.15	0.09	0.16
Browns Ferry 1, 2, 3	0.24	0.26	0.16	0.20	0.23	0.23	0.26	0.20	0.19	0.18	0.23	0.21	0.17
Brunswick 1, 2	0.30	0.70	0.26	0.26	0.19	0.20	0.23	0.20	0.19	0.16	0.14	0.11	0.16
Clinton 1	0.40	0.15	0.27	0.30	0.23	0.17	0.14	0.20	0.10	0.15	0.15	0.17	0.12

Table 3.9-9. (cont.)

Plant	Average Measurable Occupational Doses (rem)												
	1993	1994	1995	1996	1997	1998	1999	2000	2001	2002	2003	2004	2005
Columbia	0.34	0.46	0.27	0.26	0.21	0.23	0.15	0.08	0.15	0.07	0.13	0.09	0.19
Cooper Station	0.35	0.24	0.21	0.10	0.16	0.19	0.15	0.21	0.13	0.11	0.15	0.10	0.22
Dresden 2, 3	0.60	0.36	0.35	0.26	0.17	0.18	0.18	0.11	0.14	0.13	0.17	0.19	0.13
Fermi 2	0.10	0.19	0.07	0.11	0.08	0.15	0.08	0.12	0.14	0.08	0.14	0.11	0.11
FitzPatrick	0.16	0.20	0.26	0.26	0.14	0.20	0.12	0.24	0.10	0.19	0.17	0.17	0.16
Grand Gulf	0.18	0.12	0.22	0.23	0.20	0.22	0.19	0.12	0.17	0.17	0.11	0.13	0.13
Hatch 1, 2	0.39	0.39	0.33	0.29	0.37	0.20	0.18	0.21	0.16	0.17	0.13	0.15	0.16
Hope Creek 1	0.14	0.18	0.12	0.15	0.20	0.09	0.25	0.15	0.10	0.12	0.09	0.10	0.08
LaSalle 1, 2	0.50	0.40	0.32	0.29	0.19	0.20	0.21	0.14	0.15	0.22	0.21	0.15	0.16
Limerick 1, 2	0.17	0.18	0.16	0.14	0.16	0.19	0.15	0.20	0.19	0.13	0.11	0.12	0.13
Monticello	0.52	0.50	0.22	0.32	0.27	0.31	0.16	0.27	0.26	0.10	0.20	0.13	0.19
Nine Mile Point 1, 2	0.27	0.19	0.33	0.18	0.30	0.22	0.26	0.16	0.25	0.21	0.25	0.33	0.29
Oyster Creek	0.16	0.35	0.12	0.24	0.10	0.22	0.09	0.30	0.10	0.18	0.10	0.17	0.09
Peach Bottom 2, 3	0.31	0.27	0.21	0.17	0.26	0.19	0.20	0.19	0.24	0.17	0.22	0.19	0.17
Perry	0.23	0.33	0.11	0.19	0.18	0.11	0.19	0.11	0.19	0.16	0.32	0.15	0.24
Pilgrim 1	0.33	0.26	0.37	0.22	0.36	0.13	0.28	0.12	0.16	0.08	0.17	0.10	0.17
Quad Cities 1, 2	0.39	0.52	0.36	0.46	0.26	0.35	0.20	0.32	0.20	0.47	0.44	0.22	0.33
River Bend	0.21	0.24	0.13	0.23	0.21	0.12	0.26	0.20	0.17	0.09	0.17	0.17	0.11
Susquehanna 1, 2	0.23	0.28	0.27	0.20	0.26	0.23	0.24	0.18	0.16	0.14	0.13	0.13	0.10
Vermont Yankee	0.26	0.17	0.25	0.24	0.22	0.21	0.21	0.19	0.17	0.16	0.15	0.15	0.18

(a) 1st commercial operation in May 1996
Source: Burrows and Hagemeyer 2006.
Note: To convert rem to Sv, multiply by 0.01.

Table 3.9-10. Annual Collective Occupational Dose per Plant for Commercial Nuclear Power Plants

Year	Collective Occupational Dose (person-rem) per Plant for PWRs			Collective Occupational Dose (person-rem) per Plant for BWRs		
	Average	Maximum	Minimum	Average	Maximum	Minimum
1993	194	675	6	330	828	35
1994	137	374	14	327	866	38
1995	168	548	7	256	482	28
1996	131	353	10	256	513	48
1997	133	367	10	205	588	49
1998	92	290	3	190	381	42
1999	105	321	5	184	344	36
2000	95	567	8	174	614	35
2001	91	363	5	138	258	34
2002	87	403	4	175	893	26
2003	91	220	5	162	607	31
2004	71	371	0	156	283	19
2005	79	273	4	171	481	28

Source: Burrows and Hagemeyer 2006
 Note: To convert rem to sV, multiply by 0.01.

1
 2 a dose greater than 2 rem, and less than 0.3 percent of the workers received a dose greater
 3 than 1 rem. No worker exposure exceeded 5 rem during that calendar year. Figure 3.9-2
 4 shows the collective dose distribution by dose range for all commercial U.S. reactors from 2001
 5 to 2005. The distribution of collective dose has been fairly constant over the past 5 years, with
 6 a slight decrease noted from 2002 to 2005 in each dose range.

7
 8 As mentioned in Section 3.9.1.1.1, under 10 CFR 20.2206, the NRC requires licensees to
 9 submit an annual report of the results of individual monitoring. In addition to reporting data on
 10 external exposures, licensees are required to report information about internal exposures.
 11 Licensees are required to list for each intake, the radionuclide, pulmonary clearance class,
 12 intake mode, and amount of the intake in microcuries. Twenty-five intakes by ingestion and
 13 other modes were reported by licensees during 2005 (5 for cobalt-58, 14 for cobalt-60, 1 for
 14 cesium-134, 1 for iron-59, and 1 for manganese-54). Many more intakes were reported for the
 15 inhalation mode. The inhalation intakes were mainly from cobalt-60, cobalt-58, manganese-54,
 16 americium-241, curium-242, curium-243, plutonium-238, and plutonium-239 (Burrows and
 17 Hagemeyer 2006). Table 3.9-13 lists the number of individuals with measurable CEDE,

Affected Environment

1 collective CEDE, and average measurable CEDE per individual as reported by different nuclear
 2 power reactor stations.
 3

Table 3.9-11. Annual Individual Occupational Dose for Commercial Nuclear Power Plants

Year	Whole-Body Dose (rem) per Plant for PWRs			Whole-Body Dose (rem) per Plant for BWRs		
	Average	Maximum	Minimum	Average	Maximum	Minimum
1993	0.25	0.45	0.05	0.31	0.60	0.10
1994	0.22	0.32	0.06	0.31	0.70	0.12
1995	0.24	0.38	0.03	0.27	0.37	0.07
1996	0.20	0.32	0.04	0.25	0.46	0.10
1997	0.19	0.30	0.04	0.22	0.37	0.08
1998	0.17	0.31	0.03	0.21	0.35	0.09
1999	0.17	0.29	0.05	0.20	0.28	0.08
2000	0.15	0.28	0.05	0.20	0.32	0.08
2001	0.16	0.35	0.02	0.17	0.26	0.10
2002	0.14	0.22	0.04	0.20	0.47	0.07
2003	0.14	0.25	0.03	0.18	0.44	0.09
2004	0.14	0.38	0.00	0.16	0.33	0.09
2005	0.12	0.26	0.02	0.18	0.33	0.08

Source: Burrows and Hagemeyer 2006
 Note: To convert rem to Sv, multiply by 0.01.

4
 5 A portion of the total workforce can be defined as “transient.” These individuals are usually
 6 employed for special functions and may be employed at multiple reactor sites during a given
 7 year. Data for individual reactors described earlier include these people, but only for each
 8 power plant. Thus, some people are counted more than once, and some people receive
 9 greater annual doses than are reported by individual plants. In 1993, there were about
 10 27,000 of these people (Burrows and Hagemeyer 2006). Over the years, doses to transient
 11 workers at nuclear power plants have been decreasing in the same way as doses to more
 12 permanent workers, going from an average of 0.49 rem in 1993 to 0.32 rem in 2005
 13 (Burrows and Hagemeyer 2006). In 2005, three transient workers received whole body doses
 14 between 3 and 4 rem, and none received more than 4 rem (Burrows and Hagemeyer 2006).
 15
 16 A decreasing trend in the highest annual collective dose is somewhat apparent, as is a
 17 decreasing trend for the average collective dose. In addition to decreases in collective dose,

1

Table 3.9-12. Number of Workers at BWRs and PWRs Who Received Whole-Body Doses Within Specified Ranges During 2005

Dose Range (rem)	BWRs	PWRs	Total
<0.1 (measurable)	18,235	28,209	46,444
0.1 to 0.25	7443	10,311	17,754
0.25 to 0.50	4848	4343	9191
0.50 to 0.75	1,74	1160	2904
0.75 to 1.00	706	398	1104
1.00 to 2.00	521	162	683
2.00 to 3.00	17	0	17
3.00 to 4.00	0	0	0
4.00 to 5.00	0	0	0
5.00 to 6.00	0	0	0
6.00 to 12.00	0	0	0
>12	0	0	0
Total	25,449	57,125	82,574

Source: Burrows and Hagemeyer 2006
Note: To convert rem to Sv, multiply by 0.01.

2

3 the average annual dose per nuclear plant worker decreased during this period (1993 through
4 2005) from 0.31 to 0.18 rem for BWRs and from 0.25 to 0.12 rem for PWRs (Table 3.9-11). A
5 breakdown of the number of individual workers receiving doses in different ranges for 2005 is
6 provided in Table 3.9-12. These data demonstrate that 94 percent of plant radiation workers
7 received less than 1 rem, and no worker received more than 4 rem. Overall data presented in
8 Tables 3.9-1 through 3.9-6 provide evidence that doses to nearly all radiation workers are far
9 below the worker dose limit established by 10 CFR Part 20, and that the continuing efforts to
10 maintain doses at ALARA levels have been successful.

11

12 As mentioned in Section 3.9.1.1, under 10 CFR 20.2202 and 10 CFR 20.2203, the NRC
13 requires that all licensees submit reports of all occurrences involving personnel radiation
14 exposures and releases of radioactive material that exceed certain control levels. For 2003
15 through 2005, there was no occurrence reported for nuclear power reactors (Burrows and
16 Hagemeyer 2006).

17

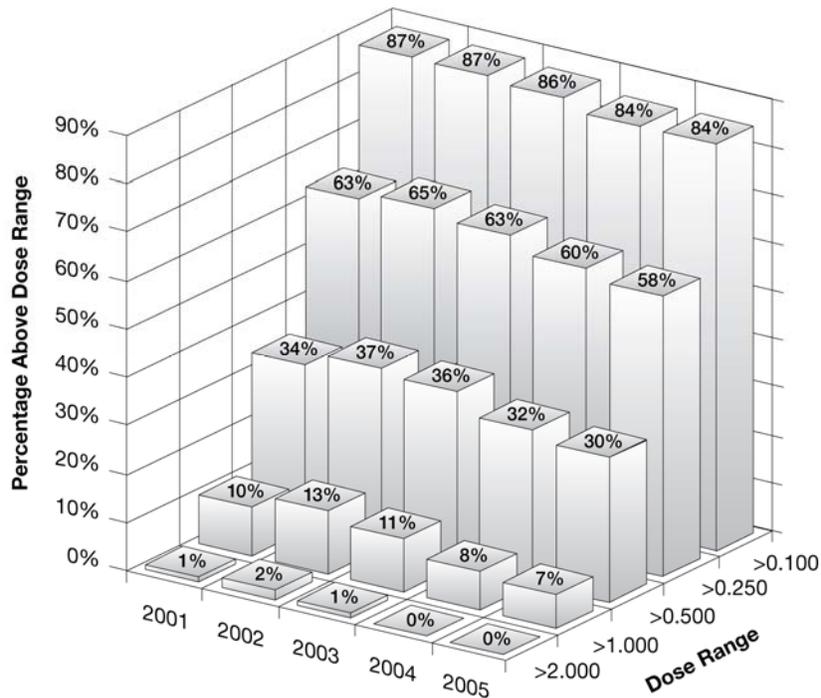


Figure 3.9-2. Collective Dose Distribution for All Commercial U.S. Reactors by Dose Range (rem) for 2001 through 2005 (Source: Burrows and Hagemeyer 2006)

3.9.1.3 Public Radiological Exposures

Commercial nuclear power plants, under controlled conditions, release small amounts of radioactive materials to the environment during normal operation. Radioactive waste management systems are incorporated into each plant. They are designed to remove most of the fission-product radioactivity that leaks from the fuel, as well as most of the activation- and corrosion-product radioactivity produced by neutrons in the vicinity of the reactor core. The amounts of radioactivity released through vents and discharge points to areas outside the plant boundaries are recorded and published annually in the radioactive effluent release reports for each facility. These reports are publicly available on the NRC's document management system, ADAMS. The effluent releases result in radiation doses to humans. Nuclear power plant licensees must comply with Federal regulations (e.g., 10 CFR Part 20, Appendix I to 10 CFR Part 50, 10 CFR Part 50.36a, and 40 CFR Part 190) and technical specifications in the operating license.

Table 3.9-13. Collective and Average CEDE for Commercial U.S. Nuclear Power Plant Sites in 2005

Plant	Number of Individuals with Measurable CEDE	Collective CEDE (person-rem)	Average Measurable CEDE (rem)
Duane Arnold	1	0.010	0.010
Arkansas	6	0.226	0.038
Browns Ferry	117	0.396	0.003
Brunswick	1	0.029	0.029
Columbia	2	0.019	0.010
Comanche Peak	3	0.072	0.024
Cooper	12	0.189	0.016
Davis-Besse	1	0.002	0.002
Hatch	1	0.022	0.022
Limerick	11	0.074	0.007
Millstone 1	2	0.025	0.013
Monticello	1	0.011	0.011
North Anna	1	0.017	0.017
Oconee	11	0.224	0.020
Palo Verde	9	0.264	0.029
Point Beach	2	0.018	0.009
Quad Cities	5	0.070	0.014
San Onofre	1	0.001	0.001
Sequoyah	23	0.063	0.003
St. Lucie	6	0.039	0.007
Summer	3	0.030	0.010
Susquehanna	4	0.021	0.005
Three Mile Island 1	1	0.018	0.018
Vermont Yankee	10	0.072	0.007
Vogtle	1	0.015	0.015
Watts Bar	170	2.869	0.017
Wolf Creek	3	0.007	0.002

Source: Burrows and Hagemeyer 2006
Note: To convert rem to Sv, multiply by 0.01.

Affected Environment

1 Potential environmental pathways through which persons may be exposed to radiation
2 originating in a nuclear power plant include the atmospheric and aquatic pathways. Radioactive
3 materials released under controlled conditions include fission products and activation products.
4 Fission product releases consist primarily of the noble gases and some of the more volatile
5 materials like tritium, isotopes of iodine, and cesium. These materials are monitored carefully
6 before release to determine whether the limits on releases can be met. Releases to the aquatic
7 pathways are similarly monitored. Radioactive materials in the liquid effluents are processed in
8 radioactive waste treatment systems. The major radionuclides released to aquatic systems
9 have been tritium, isotopes of cobalt, and cesium.

10
11 When an individual is exposed to radioactive materials released by the plant into air or water
12 pathways, the dose is determined in part by the amount of time spent in the vicinity of the
13 source or the amount of time the radionuclides inhaled or ingested are retained in the
14 individual's body (exposure). The consequences associated with this exposure are evaluated
15 by calculating the dose. The major exposure pathways include the following:

- 16 • Inhalation of contaminated air;
- 17
- 18 • Drinking milk or eating meat from animals that graze on open pasture on which
19 radioactive contamination may be deposited;
- 20
- 21 • Eating vegetables grown near the site; and
- 22
- 23 • Drinking (untreated) water or eating fish caught near the point of discharge of liquid
24 effluents.
- 25
- 26

27 Radiation doses are calculated for the maximally exposed individual (MEI) (that is, the real or
28 hypothetical individual potentially subject to maximum exposure). Doses are calculated by
29 using site-specific data where available. For those cases in which site-specific data are not
30 readily available, conservative (overestimating) assumptions are used to estimate dose.
31 Members of the general public are also exposed when the LLW is shipped offsite. The public
32 radiation exposures from radioactive material transportation have been addressed in Table S-4
33 of 10 CFR Part 51. Table S-4 indicates that the cumulative dose to the exposed public from the
34 transport of both LLW and spent fuel is estimated to be about 0.03 person-Sv (3 person-rem)
35 per reactor year (see Section 4.12.1.1).

37 **3.9.1.3.1 Effluent Pathways for Calculations of Dose Commitment to the Public**

38
39 Radioactive effluents can be divided into several groups on the basis of their physical
40 characteristics. Among the airborne effluents, the radioisotopes of the noble gases krypton,
41 xenon, and argon neither deposit on the ground nor are absorbed and accumulated within living

1 organisms; therefore, the noble gas effluents act primarily as a source of direct external
2 radiation emanating from the effluent plume. For these effluents, dose calculations are
3 performed for the site boundary where the highest external-radiation doses to a member of the
4 general public are estimated to occur.

5
6 A second group of airborne radioactive effluents – the fission-product radioiodines and
7 tritium – are also gaseous, but some of them can be deposited on the ground or inhaled during
8 respiration. For this class of effluents, estimates are made of direct external radiation doses
9 from ground deposits (as well as exposure to the plume). Estimates are also made of internal
10 radiation doses to total body, thyroid, bone, and other organs from inhalation and from
11 vegetable, milk, and meat consumption.

12
13 A third group of airborne effluents consists of particulates and includes fission products, such
14 as cesium and strontium, and activated corrosion products, such as cobalt and chromium.
15 These effluents contribute to direct external radiation doses and to internal radiation doses
16 through the same pathways as those described above for the radioiodine. Doses from the
17 particulates are combined with those from the radioiodines and tritium for comparison with one
18 of the design objectives of Appendix I to 10 CFR Part 50.

19
20 Liquid effluent constituents could include fission products such as strontium and iodine;
21 activation and corrosion products, such as sodium, iron, and cobalt; and tritiated water. These
22 radionuclides contribute to the internal doses through the pathways described above from fish
23 consumption, water ingestion (as drinking water), and consumption of meat or vegetables
24 raised near a nuclear plant and using irrigation water, as well as from any direct external
25 radiation from recreational use of the water near the point of a plant's discharge.

26
27 The release of each radioisotope and the site-specific meteorological and hydrological data
28 serve as input to radiation-dose models that estimate the maximum radiation dose that would be
29 received outside the facility by way of a number of pathways for individual members of the
30 public and for the general public as a whole. These models and the radiation-dose calculations
31 are discussed in Revision 1 of Regulatory Guide 1.109 (NRC 1977).

32
33 Doses from all airborne effluents except the noble gases are calculated for individuals at the
34 location or source point (e.g., site boundary, garden, residence, milk cow or goat, meat animal)
35 where the highest radiation dose to a member of the public has been established from each
36 applicable pathway (e.g., ground deposition, inhalation, vegetable consumption, milk
37 consumption, meat consumption). Only those pathways associated with airborne effluents that
38 are known to exist at a single location are combined to calculate the total maximum exposure to
39 an exposed individual. Pathway doses associated with liquid effluents are conservatively
40 combined without regard to any single location but are assumed to be associated with the
41 maximum exposure of an individual.

Affected Environment

1 A number of possible exposure pathways to humans are evaluated to determine the impact of
2 routine releases from each nuclear facility on members of the general public living and working
3 outside the site boundaries. A detailed listing of these exposure pathways would include
4 external radiation exposure from gaseous effluents, inhalation of iodines and particulate
5 contaminants in the air, drinking milk from a cow or goat or eating meat from an animal that
6 grazes on open pasture near the site on which iodines or particulates may be deposited, eating
7 vegetables from a garden near the site (that may be contaminated by similar deposits), and
8 drinking water or eating fish or invertebrates caught near the point of liquid effluent discharge.
9 Other, less important exposure pathways may include external irradiation from surface
10 deposition; eating of animals and crops grown near the site and irrigated with water
11 contaminated by liquid effluents; shoreline, boating, and swimming activities; drinking potentially
12 contaminated water; and direct radiation being emitted from the plant itself. Calculations for
13 most pathways are limited to a radius of 80 km (50 mi). For this study, effluent and MEI dose
14 information was collected from a series of publicly available annual radioactive effluent release
15 reports that licensees submit to NRC every year.

16

17 **3.9.1.3.2 Radiological Monitoring**

18

19 Background measurements at all reactor sites were obtained during the preoperational phase of
20 the monitoring program. Thus, each facility has characterized the background levels of
21 radioactivity and radiation and their variations among the anticipated important exposure
22 pathways in the areas surrounding the facilities. The operational, offsite radiological monitoring
23 program is conducted at each site to provide data on measurable levels of radiation and
24 radioactive materials in the site environs in accordance with 10 CFR Parts 20 and 50. The
25 program assists and provides backup support to the effluent-monitoring program described in
26 NRC Regulatory Guide 1.21 (NRC 1974). Such environmental monitoring programs are
27 conducted to augment effluent monitoring and dose calculations and to ensure that
28 unanticipated buildups of radioactivity have not occurred in the environment.

29

30 The environmental monitoring programs can also identify the existence of effluents from
31 unmonitored release points. An annual survey (land census) identifies changes in the use of
32 unrestricted areas to provide a basis for modifying the monitoring programs to reflect a new
33 exposure pathway or a different site-specific dose calculation parameter. The results of the
34 environmental monitoring program are documented by each licensee in the annual radiological
35 environmental monitoring reports and submitted to NRC every year.

36

37 **3.9.1.3.3 Public Radiation Doses**

38

39 Table 3.9-14 shows the total body dose to the public, ground-level air dose, and dose to a
40 critical organ for three years (2004 through 2006) from gaseous effluent releases for several
41 PWRs and BWRs. The dose varies from year to year and also from reactor to reactor. The

Table 3.9-14. Doses from Gaseous Effluent Releases for 2004 through 2006

Reactor Name	No. of Reactors	2004			Critical Organ (mrem)
		Total Body (mrem)	Gamma (mrad)	Beta (mrad)	
PWRs					
Comanche Peak ^(b)	2	1.95×10^{-2}	2.05×10^{-3}	8.00×10^{-4}	1.95×10^{-2}
D.C. Cook ^(b)	2	8.00×10^{-2}	9.50×10^{-4}	2.65×10^{-3}	NR ^(a)
Indian Point 2	1	NR	4.35×10^{-3}	1.75×10^{-2}	6.00×10^{-3}
Indian Point 3	1	NR	1.20×10^{-4}	7.70×10^{-4}	8.00×10^{-4}
H.B. Robinson	1	NR	4.00×10^{-3}	1.70×10^{-3}	8.20×10^{-2}
San Onofre ^(b)	2	NR	4.05×10^{-2}	5.00×10^{-2}	6.50×10^{-3}
Surry ^(b)	2	NR	3.40×10^{-4}	4.55×10^{-4}	3.75×10^{-2}
BWR					
Hatch 1	1	7.20×10^{-3}	5.20×10^{-5}	6.80×10^{-5}	7.20×10^{-3}
Hatch 2	1	1.00×10^{-2}	4.30×10^{-5}	5.80×10^{-5}	1.10×10^{-2}
Vermont Yankee	1	NR	0	0	8.00×10^{-3}
Limerick ^(b)	2	1.05×10^{-3}	1.65×10^{-3}	1.00×10^{-3}	3.55×10^{-3}
Columbia	1	3.70×10^{-2}	1.90×10^{-3}	6.80×10^{-4}	3.80×10^{-2}
2005					
Reactor Name	No. of Reactors	Total Body (mrem)	Gamma (mrad)	Beta (mrad)	Critical Organ (mrem)
PWRs					
Comanche Peak ^(b)	2	1.85×10^{-2}	2.05×10^{-2}	5.00×10^{-2}	1.65×10^{-1}
D.C. Cook ^(b)	2	7.00×10^{-2}	1.30×10^{-3}	2.00×10^{-3}	NR
Indian Point 2	1	NR	9.00×10^{-5}	6.00×10^{-4}	6.50×10^{-4}
Indian Point 3	1	NR	1.10×10^{-3}	6.00×10^{-3}	3.60×10^{-3}
H.B. Robinson	1	NR	9.70×10^{-3}	3.60×10^{-3}	7.40×10^{-2}
San Onofre ^(b)	2	NR	3.50×10^{-2}	4.90×10^{-2}	1.95×10^{-3}
Surry ^(b)	2	NR	8.00×10^{-4}	1.45×10^{-3}	7.50×10^{-2}
BWRs					
Hatch 1	1	8.60×10^{-3}	0	0	8.70×10^{-3}
Hatch 2	1	1.20×10^{-2}	0	0	1.20×10^{-2}
Vermont Yankee	1	NR	3.30×10^{-2}	3.20×10^{-3}	1.10×10^{-2}
Limerick ^(b)	2	1.20×10^{-3}	1.80×10^{-3}	1.25×10^{-3}	4.35×10^{-2}
Columbia	1	2.80×10^{-2}	2.70×10^{-3}	9.50×10^{-4}	3.00×10^{-2}

1

Table 3.9-14. (cont.)

Reactor Name	No. of Reactors	2006			
		Total Body (mrem)	Gamma (mrad)	Beta (mrad)	Critical Organ (mrem)
PWRs					
Comanche Peak ^(b)	2	2.30×10^{-2}	3.60×10^{-3}	9.00×10^{-4}	8.50×10^{-2}
D.C. Cook ^(b)	2	1.35×10^{-1}	2.60×10^{-3}	2.80×10^{-2}	NR
Indian Point 2	1	NR	2.55×10^{-3}	9.00×10^{-3}	6.00×10^{-3}
Indian Point 3	1	NR	5.40×10^{-5}	1.60×10^{-4}	1.10×10^{-3}
H.B. Robinson	1	NR	2.50×10^{-3}	8.80×10^{-4}	1.40×10^{-1}
San Onofre ^(b)	2	NR	3.70×10^{-2}	6.00×10^{-2}	6.30×10^{-3}
Surry ^(b)	2	NR	5.50×10^{-4}	8.50×10^{-4}	7.00×10^{-2}
BWRs					
Hatch 1	1	7.20×10^{-3}	4.40×10^{-6}	1.30×10^{-5}	7.20×10^{-3}
Hatch 2	1	2.30×10^{-2}	0	0	2.30×10^{-2}
Vermont Yankee	1	NR	8.80×10^{-5}	1.40×10^{-2}	9.60×10^{-3}
Limerick ^(b)	2	7.50×10^{-4}	1.10×10^{-3}	7.00×10^{-4}	2.35×10^{-3}
Columbia	1	2.00×10^{-2}	6.10×10^{-3}	2.10×10^{-3}	2.00×10^{-2}

(a) NR = not reported in the site's effluent release report.

(b) There is more than one plant operating at these reactor sites, and the combined doses were reported in the annual effluent release report. The reported doses were divided by the number of reactors to get the dose per reactor.

Sources: Each site's annual effluent release reports

Note: To convert mrem to mSv, multiply by 0.01.

2

3 maximum total body dose is 0.14 mrem, maximum dose to a critical organ is 0.17 mrem,
 4 maximum ground-level air dose from gamma radiation is 0.04 mrad, and maximum ground-level
 5 dose from beta radiation is 0.06 mrad. All doses are much less than the design objectives
 6 shown in Table 3.9-2.

7

8 Table 3.9-15 shows the total body dose to the public and dose to a critical organ for 3 years
 9 (2004 through 2006) from liquid effluent releases for the same PWRs and BWRs. The total
 10 body dose and dose to critical organ of the MEI from liquid effluent releases varies from year to
 11 year and also from reactor to reactor. The maximum total body dose is 0.06 mrem, and the
 12 maximum dose to a critical organ is 0.06 mrem. The doses are much less than the design
 13 objectives shown in Table 3.9-2.

14

15 Table 3.9-16 presents the dose to the MEI for the years 2004 to 2006 for a few PWRs and
 16 BWRs. Under most circumstances, the dose calculations, which were made by the sites,

Table 3.9-15. Dose from Liquid Effluent Releases for 2004 through 2006

Reactor Name	No. of Reactors	2004		2005		2006	
		Total Body (mrem)	Critical Organ (mrem)	Total Body (mrem)	Critical Organ (mrem)	Total Body (mrem)	Critical Organ (mrem)
PWRs							
Comanche Peak ^(a)	2	5.50×10^{-2}	5.50×10^{-2}	6.00×10^{-2}	6.00×10^{-2}	5.00×10^{-2}	5.00×10^{-2}
D.C. Cook ^(a)	2	1.30×10^{-2}	1.40×10^{-2}	8.50×10^{-3}	1.00×10^{-2}	1.30×10^{-2}	1.30×10^{-2}
H.B. Robinson	1	6.60×10^{-4}	7.20×10^{-4}	9.20×10^{-5}	9.60×10^{-5}	3.50×10^{-4}	3.60×10^{-4}
Indian Point 2	1	3.20×10^{-3}	1.10×10^{-2}	8.10×10^{-4}	1.30×10^{-3}	8.80×10^{-4}	1.30×10^{-3}
Indian Point 3	1	2.00×10^{-4}	5.50×10^{-4}	4.50×10^{-4}	5.40×10^{-4}	1.30×10^{-4}	1.60×10^{-4}
San Onofre ^(a)	2	2.55×10^{-3}	1.00×10^{-2}	1.35×10^{-3}	4.00×10^{-3}	1.10×10^{-3}	3.90×10^{-3}
Surry ^(a)	2	1.30×10^{-4}	3.60×10^{-4}	1.20×10^{-4}	4.55×10^{-4}	1.55×10^{-4}	5.50×10^{-4}
BWRs							
Hatch 1	1	4.20×10^{-3}	6.30×10^{-3}	3.20×10^{-3}	4.80×10^{-3}	2.60×10^{-3}	3.80×10^{-3}
Hatch 2	1	9.50×10^{-4}	1.40×10^{-3}	1.20×10^{-3}	1.90×10^{-3}	3.50×10^{-4}	4.50×10^{-4}
Vermont Yankee	1	0	0	0	0	0	0
Limerick ^(a)	2	7.50×10^{-4}	1.05×10^{-3}	5.50×10^{-4}	5.50×10^{-4}	1.10×10^{-3}	1.15×10^{-3}
Columbia	1	0	0	0	0	0	0

(a) There are two or more plants operating at these reactor sites. The reported doses in the annual effluent release reports were divided by 2 to get the dose per reactor.

Source: Each site's annual effluent release reports

Note: To convert mrem to mSv, multiply by 0.01.

1
2 overestimate the dose because of conservative assumptions. The table shows that the MEI
3 doses varied from about 0.02 mrem at the Columbia Generating Station in 2006 to about 15
4 mrem at Vermont Yankee in 2006. For most reactors, the annual MEI doses are a few millirem
5 or less. At Vermont Yankee, the dose is relatively high because of the close proximity of the
6 MEI to the plant. Over 99.9 percent of the individual's dose is attributed to direct radiation from
7 the plant (NRC 2007f).

8
9 **3.9.1.3.4 Radiological Exposure from Naturally Occurring and Artificial Sources**

10
11 Table 3.9-17 identifies background doses to a typical member of the U.S. population as
12 summarized in NCRP (1987). A total average annual effective dose equivalent of 360 mrem/yr
13 to members of the U.S. population is contributed by two primary sources: naturally occurring
14 radiation and artificial sources (including human enhancement of natural sources) of radiation.
15 Natural radiation sources other than radon result in 27 percent of the typical radiation dose
16 received. The larger source of radiation dose (55 percent) is from radon, particularly because

Table 3.9-16. Total Effective Dose Equivalent (mrem) to the Maximally Exposed Individual (MEI) for 2004 Through 2006

Site ^(a)	No. of Reactors	2004	2005	2006
PWRs				
D.C. Cook	2	0.108	0.095	0.182
Indian Point	2	<4.0	<4.1	<7.1
San Onofre	2	0.29	0.4	0.6
BWRs				
Vermont Yankee	1	13.3	13.5	15.3
Columbia	1	0.037	0.028	0.019

(a) Some of the reactors in Tables 3.9-9 and 3.9-10 are not included because the dose to the MEI was not reported in the site's effluent release reports for these reactors.
Source: Each site's annual effluent release reports

1
2 of homes and other buildings that trap radon and significantly enhance its dose contribution
3 over open-air living. The remaining 18 percent of the average annual effective dose equivalent
4 consists of radiation from medical procedures (x-ray diagnosis, 11 percent, and nuclear
5 medicine, 4 percent) and from consumer products (3 percent). For consumer products, the
6 chief contributor is radon in domestic water supplies, building materials, mining, and agricultural
7 products, as well as coal burning. Smokers are additionally exposed to the natural radionuclide
8 polonium-210 in tobacco, resulting in the irradiation of a small region of the bronchial epithelium
9 to up to 16,000 mrem/yr. Tobacco products are the dominant contributor to individual body
10 organ doses, but the conversion of the organ dose to the effective dose equivalent is too
11 uncertain for NCRP to include it in its tables. However, NCRP used a weighting factor of 0.08
12 and estimated effective dose equivalents to an average smoker of 1300 mrem/yr and to an
13 average member of the U.S. population of 280 mrem/yr (NCRP 1987). Radiation exposures
14 from occupational activities, the nuclear fuel cycle, and miscellaneous environmental sources
15 (including nuclear weapons testing fallout) contribute insignificantly to the total average effective
16 dose equivalent.

17
18 **3.9.1.3.5 Inadvertent Liquid Radioactive Releases**

19
20 As mentioned before, all commercial nuclear power plants routinely release radioactive material
21 to the environment in the form of liquids and gases in accordance with regulations
22 (Table 3.9-2). Each year, plant operators submit an effluent release report that documents the
23 amount of radioactive material released to the environment during the year. This report also
24 includes the public dose impact from the releases. Plant operators also conduct environmental

Table 3.9-17. Average Annual Effective Dose Equivalent of Ionizing Radiation to a Member of the U.S. Population

Source	Effective Dose Equivalent	
	mrem	Percent of Total
Natural		
Cosmic	27	8
Terrestrial	28	8
Internal	39	11
Total natural	94	27
Artificial		
Radon (human enhanced)	200	55
Medical		
X-ray diagnosis	39	11
Nuclear medicine	14	4
Consumer products	11	3
Other		
Occupational	0.9	< 0.3
Nuclear fuel cycle	< 1.0	< 0.03
Fallout	< 1.0	< 0.03
Miscellaneous	< 1.0	< 0.03
Total artificial	266	73
Total natural and artificial	360	100

Source: Adapted from NCRP 1987

1
2 monitoring in the vicinity and submit an environmental monitoring report every year to the NRC.
3 However, some sites have had inadvertent radioactive liquid releases that were not initially
4 monitored.
5
6 After the discovery of a leak, each licensee performed appropriate monitoring and assessed the
7 radiation exposure to a member of the public. In all cases, the calculated dose to a member of
8 the public was below the ALARA design objectives in Appendix I to 10 CFR Part 50.
9
10 Table 3.9-18 provides a list of the known inadvertent releases to the environment primarily from
11 1996 through 2006.

Affected Environment

Table 3.9-18. Inadvertent Releases of Radioactive Liquids at Nuclear Power Plants

Site	Date of Release Discovery	Source of Release	Radionuclides Detected
Braidwood	March 2005	Vacuum breaker valves on the circulating water blowdown line	Tritium
Byron	February 2006	Vacuum breaker valves on the circulating water blowdown line	Tritium
Callaway	June 2006	Vacuum breaker valves on the circulating water blowdown line	Tritium, cobalt-58, cobalt-60, cesium-134, and cesium-137
Dresden	August 2004, January 2006	Non-safety-related high-pressure coolant injection suction and return line	Tritium
Hatch	December 1986	Fuel transfer canal, because of operator action	Tritium
Indian Point	August 2005 – Unit 1 leakage predates August 2005	Unit 1 and Unit 2 spent fuel pools	Tritium, nickel-63, cesium-137, strontium-90, and cobalt-60
Oyster Creek	September 1996	Condensate transfer system, because of operator action	Tritium
Palo Verde	March 2006	Rain condensing onto property after a gaseous release	Tritium
Perry	March 2006	Feedwater system venturi	Tritium
Point Beach	1999	Retention pond	Tritium, cesium-137
Seabrook	June 1999	Spent fuel pool	Tritium
Salem	September 2002	Spent fuel pool	Tritium
Three Mile Island	May 2006	Condensate storage tank	Tritium
Watts Bar	August 2002	Effluent release pipe and spent fuel pool transfer tube sleeve	Tritium and mixed fission products

Source: NRC 2006c

- 1
- 2 After inadvertent releases of tritium that resulted in groundwater contamination at the
- 3 Braidwood, Indian Point, Byron, and Dresden nuclear sites were recently detected, the NRC
- 4 chartered a task force to conduct a lessons-learned review of these incidents. The task force
- 5 also reviewed and evaluated public health and environmental impacts, along with many other
- 6 aspects, such as regulatory framework and NRC inspection.
- 7
- 8 The impacts from inadvertent releases would be in addition to the impacts from routine effluent
- 9 releases and would depend on many factors, such as the amount and type of radionuclide,

1 environmental transport, and how the receptor would come in contact with the contaminated
2 media. For example, tritium enters the body when people eat or drink food or water that
3 contains tritium or when they absorb it through their skin. People can also inhale tritium as a
4 gas in the air. Once tritium enters the body, it quickly distributes uniformly throughout the soft
5 tissue. At the Braidwood site between March 2005 and 2006, the plant operator sampled water
6 in the drinking water wells of several nearby residents and found tritium contamination levels in
7 a range of 1400 to 1600 pCi/L above background levels. These tritium contamination levels are
8 much lower than the EPA's drinking water standard of 20,000 pCi/L for tritium.

9
10 The task force focused on the inadvertent releases that had the potential to have a measurable
11 dose impact on a member of the public and/or the offsite environment on the basis of the
12 source's strength and its potential for movement offsite. Table 3.9-19 lists the maximum tritium
13 contamination detected onsite and at offsite locations from the inadvertent release events. The
14 table shows that currently, for most locations, contamination has not migrated offsite.

15
16 The most significant conclusion of the task force regarded the lack of public health impacts.
17 Although there have been number of industry events in which radioactive liquid was released to
18 the environment in an unplanned and unmonitored fashion, based on the data available, the
19 task force did not identify any instances where the health of the public was impacted
20 (NRC 2006c).

21 22 **3.9.1.3.6 Tooth Fairy Issue**

23
24 Studies published by the Radiation Public Health Project assert that strontium-90 levels in the
25 environment are rising and are responsible for cancers in children and infant mortality. This
26 group of studies also claim that radioactive effluents from nuclear power plants are directly
27 responsible for the increases in strontium-90 concentrations in baby teeth (Gould et al. 2000;
28 Mangano et al. 2003). Consequently, the issue is often referred to as the "tooth fairy" issue.

29
30 Strontium-90 does not occur naturally. It comes from three sources: (1) fallout from
31 aboveground explosions from testing of nuclear weapons worldwide from 1963 to 1980,
32 (2) radioactive releases from the 1986 Chernobyl nuclear power plant accident in the Ukraine,
33 and (3) radioactive releases from nuclear power plants into the environment.

34
35 Approximately 16.8 million Ci of strontium-90 were produced and globally dispersed in
36 atmospheric nuclear weapons testing until 1980. Also, as a result of the Chernobyl accident,
37 approximately 216,000 Ci of strontium-90 were released into the atmosphere
38 (UNSCEAR 2000). The total annual release of strontium-90 into the atmosphere from all
39 104 commercial nuclear power plants operating in the United States is typically 1/1000th of a
40 curie (NRC 1993). At an individual nuclear power plant, the amount of strontium-90 is so low
41

Affected Environment

Table 3.9-19. Dose from Inadvertent Releases of Radioactive Liquids at Nuclear Power Plants

Site	Maximum Tritium Contamination (pCi/L) Detected Within the Site Boundary	Maximum Water Contamination (pCi/L) at Offsite Locations	Receptor and Pathways	Yearly Dose (mrem)
Braidwood	225,000 to 250,000	1400 to 1600	Child: water ingestion; Adult: fish and water ingestion	Child: 0.16 Adult: 0.07
Byron	3800	None detected	NA ^(a)	NA
Callaway	20,000 to 200,000	None detected	NA	NA
Dresden	486,000 to 680,000	None detected	NA	NA
Hatch ^(b)	See footnote (a)	None detected at offsite water sources – long-term monitoring in place	Negligible	Negligible
Indian Point ^(c)	200,000 for tritium 100 for nickel-63 50 for strontium-90	Approximation made in dose calculations	MEI ^(d)	0.0021
Oyster Creek	16,000	None detected	NA	NA
Palo Verde	71,400	None detected	NA	NA
Perry	60,000	None detected	NA	NA
Point Beach	14,250	None detected	NA	NA
Seabrook	750,000	Groundwater plume has not migrated offsite	Negligible	Negligible
Salem ^(e)	15,000,000	None detected	NA	NA
Three Mile Island	45,000	None detected	NA	NA
Watts Bar	30,000	Groundwater plume has not migrated offsite	Negligible	Negligible

(a) NA = Not applicable because water contamination was not detected at offsite locations.

(b) Approximately 124,000 gal of liquid containing 0.2 Ci of tritium and 0.373 Ci of mixed fission products were released to a swamp onsite.

(c) Source for data is Indian Point (2005).

(d) MEI = Maximally Exposed Individual.

(e) Extensive groundwater remediation program in place.

Source: NRC 2006c

Note: To convert mrem to mSv, multiply by 0.01.

1
2 that it is usually at or below the minimum detectable activity of sensitive detection equipment.
3 For this reason, any strontium-90 detected in areas near a nuclear power plant would probably
4 not have come from the plant but would instead be attributed to fallout from nuclear weapons
5 testing or from the Chernobyl accident.

6
7 The NRC has established strict limits on the amount of radioactive emissions allowed to be
8 released from nuclear plants to the environment and the resulting exposure for members of the

1 public and plant workers (see Table 3.9-2). All power plant operators are required to monitor
2 radioactive airborne and liquid discharges from the plant and to file a report of these discharges
3 annually with the NRC. These reports, which are publicly available, list the radioactive isotopes
4 released, the quantity released, and the radiation dose to the public. The concentrations of
5 radionuclides released into the environment from a nuclear facility are generally too low to be
6 measurable outside the plant's boundary. In addition to limits on effluent releases, plant
7 operators maintain an environmental monitoring program that is reviewed and inspected
8 regularly by the NRC to ensure that the program complies with its requirements. To
9 demonstrate that the plant is within the regulatory limits, operators regularly sample and
10 analyze the surrounding soil, vegetation, cow's milk, air, aquatic biota, and water. In a given
11 year, a plant operator samples and analyzes hundreds of environmental samples. The results
12 of environmental monitoring and assessment efforts are provided to the NRC in an annual
13 report, which is available to the public. It is reasonable to conclude that strontium-90 would be
14 seen in the environment well before it is seen in baby teeth. In order for it to be in the
15 environment from nuclear power plants, it would have to be seen in significant quantities in the
16 effluent stream from these facilities. However, strontium-90 is not present in the effluents at
17 such levels (NRC 2007g).

18
19 Several studies have been conducted to examine health effects around nuclear power plants
20 (National Cancer Institute 1990; ACS 2001; FDOH 2001; IDPH 2000, 2006). The National
21 Cancer Institute looked at cancer mortality rates around 52 nuclear power plants and 10 other
22 nuclear facilities. The study concluded there was no evidence that nuclear facilities may be
23 linked causally with excess deaths from leukemia or from other cancers in populations living
24 nearby. The ACS in 2001 concluded that cancer clusters do not occur more often near nuclear
25 plants than they do by chance elsewhere. In 2001, the Florida Bureau of Environmental
26 Epidemiology reviewed claims that there are striking increases in cancer rates in southeastern
27 Florida counties caused by increased radiation exposures from nuclear power plants. However,
28 when they used the same data to reconstruct the calculations on which the claims were based,
29 Florida officials were not able to identify unusually high rates of cancers in these counties when
30 rates were compared with rates in the rest of the state of Florida and the nation (FDOH 2001).
31 In 2000, the Illinois Department of Public Health compared childhood cancer statistics for
32 counties with nuclear power plants to similar counties without nuclear plants and found no
33 statistically significant difference (IDPH 2000). In 2006, the IDPH studied pediatric cancer
34 incidence and mortality rates for children near nuclear reactor sites. No evidence of an
35 increased trend in the cancer incidence rate after startup of nuclear power plants was found
36 (IDPH 2006). Boice et al. (2005) evaluated the rates of total cancer, leukemia, and cancer of
37 brain tissue and other nervous tissue in children and across all ages in St Lucie County with
38 respect to the years before and after the nuclear power station began operation and compared
39 the results with rates in two similar counties in Florida (Polk and Volusia). Over the prolonged
40 period 1950 through 2000, no unusual patterns of childhood cancer mortality were found for
41 St Lucie County as a whole. In particular, no unusual patterns of childhood cancer mortality

Affected Environment

1 were seen in relation to the startup of the St Lucie nuclear power station in 1976. Further, there
2 were no significant differences in mortality between the study and comparison counties for any
3 cancer in the time period after the power station was in operation (Boice et al. 2005).
4

5 On the basis of all the preceding discussion, there is little or no credibility to the claims made in
6 the studies published by the Radiation Public Health Project.
7

8 **3.9.1.4 Risk Estimates from Radiation Exposure**

9

10 In estimating the health effects resulting from both occupational and offsite radiation exposures
11 as a result of operating nuclear power facilities, the normal probability coefficients for stochastic
12 effects recommended by the ICRP (ICRP 1991) were used. The coefficients consider the most
13 recent radiobiological and epidemiological information available and are consistent with the
14 United Nations Scientific Committee on the Effects of Atomic Radiation. The coefficients used
15 (Table 3.9-20) are the same as those recently published by ICRP in connection with a revision
16 of its recommendations (ICRP 1991). Excess hereditary effects are listed separately because
17 radiation-induced effects of this type have not been observed in any human population, as
18 opposed to excess malignancies that have been identified among populations receiving
19 instantaneous and near-uniform exposures in excess of 10 rem. Details regarding the risk of
20 radiation-induced health effects are provided in Section D.8 in Appendix D.
21

22 In 2006, the National Research Council's Advisory
23 Committee on the Biological Effects of Ionizing
24 Radiation (BEIR) published BEIR-VII, entitled *Health*
25 *Risks from Exposure to Low Levels of Ionizing*
26 *Radiation* (BEIR 2006).
27

28 BEIR-VII provides estimates of the risk of incidence
29 and mortality for males and females (see Table D.8-4
30 in Appendix D). If the total fatal cancer risk is the sum
31 of cancer deaths from all solid cancers and leukemia,
32 then the fatal cancer risk coefficient for the general
33 public would be 6×10^{-4} /person-rem (see Table D.8-5
34 in Appendix D). The fatal cancer risk for the general
35 public based on ICRP is 5×10^{-4} /person-rem (Table 3.9-20). There is a difference of
36 approximately 20 percent in the fatal cancer risk coefficient based on ICRP recommendation
37 and the BEIR-VII report. The difference of 20 percent is within the margin of uncertainty
38 associated with these estimates. See Section D.8.1.4 in Appendix D for a detailed discussion
39 of the BEIR VII report.
40

41 The NRC completed a review of the BEIR VII report and documented its findings in the
42 Commission paper SECY-05-0202, "Staff Review of the National Academies Study of the

Table 3.9-20. Nominal Probability Coefficients Used in ICRP (1991)^(a)

Health Effect	Occupational	Public
Fatal cancer	4	5
Hereditary	0.6	1

(a) Estimated number of excess effects among 10,000 people receiving 10,000 person-rem. Coefficients are based on "central" or "best" estimates.
Source: ICRP 1991

1 Health Risks from Exposure to Low Levels of Ionizing Radiation (BEIR VII),” dated October 29,
2 2005 (NRC 2005b) (ADAMS accession number ML052640532). In this paper, the NRC
3 concluded that the findings presented in the BEIR VII report agree with the NRC's current
4 understanding of the health risks from exposure to ionizing radiation. The NRC agreed with the
5 BEIR VII report's major conclusion that current scientific evidence is consistent with the
6 hypothesis that there is a linear, no-threshold dose response relationship between exposure to
7 ionizing radiation and the development of cancer in humans. This conclusion is consistent with
8 the process the NRC uses to develop its standards of radiological protection. Therefore, the
9 NRC's regulations continue to be adequately protective of public health and safety and the
10 environment.

11
12 If the occupational worker is exposed at 10 CFR Part 20 dose limits for 1 year, the probability of
13 developing fatal cancer (on the basis of ICRP recommendations) from exposure due to an
14 operating nuclear reactor is equal to 2×10^{-3} on the basis of ICRP recommendations. However,
15 the average individual worker doses are much less than the dose limits (see Table 3.9-4), and,
16 at the doses observed, the probability of developing fatal cancer would be in the range of
17 1.2×10^{-4} to 4.8×10^{-5} .

18
19 If the member of the public is exposed at 40 CFR Part 190 dose limits, the probability of
20 developing fatal cancer (on the basis of ICRP recommendations) from exposure resulting from
21 operating a nuclear reactor is equal to 1.25×10^{-5} . However, the MEI doses are much less than
22 the dose limits (see Table 3.9-16), and, at the doses observed, the probability of developing
23 fatal cancer would be in the range of 7.7×10^{-6} to 1.0×10^{-8} .

24 25 **3.9.1.5 Conclusion**

26
27 Radiation doses to nuclear power plant workers and members of the public from the current
28 operation of nuclear power plants have been examined from a variety of perspectives. The
29 radiation doses were found to be well within design objectives and regulations in each instance.
30 Therefore, the health impacts from radiation to the workers and the public are considered to be
31 small.

32 33 **3.9.2 Chemical Hazards**

34
35 Chemicals enter the body through the skin, by inhalation, or by ingestion. Chemical exposure
36 produces different effects on the body depending on the chemical and the amount of exposure.
37 Chemicals can cause cancer, affect reproductive capability, disrupt the endocrine system, or
38 have other health effects. Acute effects from chemical exposure occur immediately (e.g., when
39 somebody inhales or ingests a poisonous substance such as cyanide). Chronic or delayed
40 effects result in symptoms such as skin rashes, headaches, breathing difficulties, and nausea.
41

Affected Environment

1 In nuclear power plants, chemical effects could result from discharges of chlorine or other
2 biocides, small-volume discharges of sanitary and other liquid wastes, chemical spills, and
3 heavy metals leached from cooling system piping and condenser tubing. Impacts of chemical
4 discharges to human health are considered to be small if the discharges of chemicals to water
5 bodies are within effluent limitations designed to ensure protection of water quality and if
6 ongoing discharges have not resulted in adverse effects on aquatic biota.

7
8 The discharged chemicals, including chlorine and other biocides, are regulated by the NPDES
9 permitting system of each nuclear power plant. Regulatory concerns about the toxic effects of
10 chlorine and its combination products, as well as operating experience with controlling
11 biofouling, have led many plants to eliminate the use of chlorine or reduce the amount used
12 below the levels that were originally anticipated in the environmental statements associated with
13 issuing the construction permit and operating license. Some power plants use mechanical
14 cleaning methods or, because of the abrasive properties of particulates in the intake water, do
15 not have to clean the condenser cooling system at all. Other plants chlorinate the condenser
16 cooling or service water systems but can isolate certain portions for treatment (e.g., a single unit
17 of a multi-unit plant), thereby allowing dilution to reduce the concentration of chlorine in the
18 discharge. Because of these refinements and the process for modifying NPDES permit
19 conditions as needed, water quality degradation from existing biocide usage at once-through
20 nuclear power plants is controlled (see Section 3.5).

21
22 Minor chemical spills or temporary off-specification discharges from sanitary waste treatment
23 systems and other low-volume effluents (e.g., excessive coliform counts or total suspended
24 solids levels, pH outside of permitted range) were cited as common NPDES permit violations in
25 the 1996 GEIS (NRC 1996). Such NPDES noncompliances have been variable, random in
26 occurrence, and readily amenable to correction. These minor discharges or spills do not
27 constitute widespread, consistent water quality degradation. Effects on water quality from minor
28 chemical discharges and spills have been of small significance and have been mitigated as
29 needed (NRC 1996). Significant cumulative impacts to water quality would not be expected
30 because the small amounts of chemicals released by these minor discharges or spills are
31 readily dissipated in the receiving water body. Spills and off-specification discharges occur
32 seldom enough that regulatory agencies have expressed no concern about them with regard to
33 operating nuclear power plants (NRC 1996).

34
35 Heavy metals (e.g., copper, zinc, and chromium) may be leached from condenser tubing and
36 other heat exchangers and discharged by power plants as small-volume waste streams or
37 corrosion products. Although all are found in small quantities in natural waters (and many are
38 essential micronutrients), concentrations in the power plant discharge are controlled in the
39 NPDES permit because excessive concentrations of heavy metals can be toxic to aquatic
40 organisms (see Section 3.6). The ability of aquatic organisms to bioaccumulate heavy metals,
41 even at low concentrations, has led to concerns about toxicity to both the humans and the biota

1 that consume contaminated fish and shellfish. For example, the bioconcentration of copper
2 discharged from the Chalk Point plant (a fossil-fuel power plant on Chesapeake Bay) resulted in
3 oyster “greening” (Roosenburg 1969). The bioaccumulation of copper released from the H.B.
4 Robinson plant resulted in malformations and decreased reproductive capacity among bluegill
5 in the cooling reservoir (Harrison 1985). At the Diablo Canyon nuclear plant, it was observed
6 that the concentration of soluble copper in effluent water was high during the startup of water
7 circulation through the condenser system after a shutdown (Harrison 1985). In all three
8 examples of excessive accumulation of copper (Diablo Canyon, Chalk Point, and H.B.
9 Robinson), replacement of the copper alloy condenser tubes with another material
10 (e.g., titanium) eliminated the problem.

11
12 The EPA is responsible for the regulation of most chemicals that can enter the environment.
13 The EPA administers the following Federal acts related to chemical contamination: the Federal
14 Insecticide, Fungicide, and Rodenticide Act (FIFRA); Toxic Substances Control Act (TSCA);
15 Resource Conservation and Recovery Act (RCRA); Safe Drinking Water Act (SDWA); Clean Air
16 Act (CAA); and Comprehensive Environmental Response, Compensation and Liability Act
17 (CERCLA).

18
19 Nuclear power plants are required to submit to the EPA and the State annual reports of the
20 environmental releases of listed toxic chemicals manufactured, processed, or otherwise used
21 above Federally and State-identified threshold quantities. Disposal of essentially all of the
22 hazardous chemicals used at nuclear power plants is regulated by RCRA or NPDES permits.
23 Nuclear power plants are required by the NRC to operate in compliance with all permits,
24 therefore minimizing the impact on the environment, workers, and the public. Therefore, the
25 health impacts from chemicals on workers and the public are considered small.

26 27 **3.9.3 Microbiological Hazards**

28
29 Some microorganisms associated with nuclear power plant cooling towers and thermal
30 discharges can have deleterious impacts on the health of plant workers and the public.
31 Microorganisms of concern include the enteric pathogens *Salmonella* spp. and *Shigella* spp.,
32 as well as *Pseudomonas aeruginosa* and thermophilic fungi. Tests for these pathogens are
33 well established, and factors germane to their presence in aquatic environments are known
34 and, in some cases, controllable. Other aquatic microorganisms normally present in surface
35 waters have only recently been recognized as pathogenic for humans. Among these are
36 Legionnaires’ disease bacteria (*Legionella* spp.) and free-living amoebae of the genera
37 *Naegleria* and *Acanthamoeba*, the causative agents of various, although rare, human
38 infections. Factors affecting the distribution of *Legionella* spp. and pathogenic free-living
39 amoebae are not well understood. Simple, rapid tests for their detection and procedures for
40 their control are not yet available.

41

Affected Environment

1 Potential adverse health effects of microorganisms on nuclear power plant workers are an issue
2 for plants that use cooling towers. The potential for adverse health effects on the public from
3 microorganisms in thermal effluents is an issue for nuclear plants that use cooling ponds, lakes,
4 or canals and that discharge to small rivers (defined in NRC 1996 as having an average flow of
5 less than 2830 m³/s [100,000 ft³/s]). These issues are evaluated here by reviewing what is
6 known about the organisms that are potentially enhanced by plant operation. Potential effects
7 are described below.

8 9 **3.9.3.1 Background Information on Microorganisms of Concern**

10
11 *Salmonella typhimurium*, and *S. enteritidis* are two of the more common species of the
12 Enterobacteriaceae that cause fever, abdominal cramps, and diarrhea. *Salmonella* spp. can
13 occasionally establish localized infection (e.g., septic arthritis) or progress to sepsis. The
14 affected groups include all ages, but groups at greatest risk for severe or complicated disease
15 include infants, the elderly, and persons with compromised immune systems. *Salmonella* spp.
16 can thrive at temperatures from 50 to 120°F (CDC 2007; Kendall 2007).

17
18 *Shigella* spp. is similar to *Salmonella* spp. in its mode of transmission but has a much shorter
19 incubation period (1 to 7 days). It produces severe dysentery with production of a potent
20 exotoxin. The optimum growth temperature for the organism is 99°F, but it can grow at much
21 higher temperatures (NRC 1996).

22
23 *Pseudomonas aeruginosa* can be found in soil, humidifiers, hospital respirators, water, and
24 sewage, and on the skin of healthy individuals. Certain strains can produce a potent endotoxin,
25 and the organism can cause symptoms that include fever, bacteriuria, bacteremia, pneumonia,
26 otitis, and opportunistic wound and ophthalmic infections. *Pseudomonas aeruginosa* is an
27 opportunistic pathogen that causes serious and sometimes fatal infections in
28 immunocompromised individuals. The organism produces toxins that are harmful to humans
29 and animals. It has an optimal growth temperature of 98.6°F and can tolerate a temperature as
30 high as 107.6°F (Todar 2004).

31
32 Thermophilic microorganisms can have optimum growth at temperatures of 122°F or more, a
33 maximum temperature tolerance of up to 158°F, and a minimum tolerance of about 68°F
34 (Deacon 2003).

35
36 *Legionella* spp. consists of at least 46 species and 70 serogroups. It is responsible for
37 Legionnaires' disease, with the onset of pneumonia in the first two weeks of exposure. Risk
38 groups for *Legionella* spp. include the elderly, cigarette smokers, persons with chronic lung or
39 an immunocompromising disease, and persons receiving immunosuppressive drugs.
40 A temperature range of 90 to 105°F is best for *Legionella* spp. growth (CDC 2005).

1 Populations of the pathogenic amoeba flagellate *Naegleria fowleri* is the causative agent of
2 human primary amoebic meningoencephalitis. The affected groups include all ages, but groups
3 at greatest risk for severe or complicated disease include infants, the elderly, and persons with
4 compromised immune systems. *Naegleria* spp. is ubiquitous in nature and can be enhanced in
5 heated water bodies at temperatures ranging from 95 to 106°F or higher. This organism is
6 rarely found in water cooler than 95°F, and infection rarely occurs in water temperatures of
7 95°F or less (Tyndall et al. 1989).

8
9 During the scoping meeting for the Calvert Cliffs license renewal SEIS, one member of the
10 public raised an issue about the microorganisms that live in high radiation and extreme heat
11 conditions (such as within the spent fuel pool) based on the article “Something’s Bugging
12 Nuclear Fuel” published in *Science News* (1998). The commenter asked that consideration be
13 given to these types of organisms, the possibility of their mutation, and consequences if they
14 escaped from the plant into the natural aquatic environment. The NRC consulted specialists in
15 the field; the following is a summary of their conclusions as presented in the SEIS (NRC 1999):

- 16
17 • Many types of organisms can live in the temperature range of the spent fuel pools
18 (100 to 150°F).
- 19
20 • There is a potential for mutation in all living organisms, but microbes that have high
21 levels of radiation resistance have also developed extremely efficient repair systems.
- 22
23 • Organisms that are associated with thermal waters of the spent fuel pool are likely to die
24 if they are transferred into the relatively much lower water temperatures typical of
25 surface waters. If the organisms are truly adapted to the high temperatures typical of the
26 spent fuel pool, they probably would not be able to survive and compete with the
27 indigenous microorganisms of the relatively cold waters of the natural water sources.

28
29 In summary, the NRC concluded that microorganisms that live in high radiation and extreme
30 heat conditions typical of the spent fuel pool do not pose a risk to humans or the environment.

31 32 **3.9.3.2 Studies of Microorganisms in Cooling Towers**

33
34 In 1981, cooling water systems at 11 nuclear power plants and associated control source
35 waters were studied for the presence of thermophilic free-living amoebae, including *N. fowleri*.
36 The presence of pathogenic *N. fowleri* in these waters was tested, and while all but one test site
37 was positive for thermophilic free-living amoebae, only two test sites were positive for
38 pathogenic *N. fowleri*. Pathogenic *N. fowleri* were not found in any control source waters
39 (Tyndall 1981). In addition to testing for pathogenic amoebae in cooling water, testing for the
40 presence of *Legionella* spp. was also done (Tyndall 1981). The concentrations of
41 *Legionella* spp. in these waters were determined. In general, the artificially heated waters

Affected Environment

1 showed only a slight increase (i.e., no more than tenfold) in concentrations of *Legionella* spp.
2 relative to source water. In a few cases, source waters had higher levels than did heated
3 waters. Infectious *Legionella* spp. were found in 7 of 11 test waters and 5 of 11 control source
4 waters.

5
6 Subsequently, a more detailed study of *Legionella* spp. in the environs of coal-fired power
7 plants was undertaken to determine the distribution, abundance, infectivity, and aerosolization
8 of *Legionella* spp. in power plant cooling systems (Tyndall 1983; Christensen et al. 1983;
9 Tyndall et al. 1985). This study found that positive air samples did not occur often at locations
10 that were not next to cleaning operations, which suggests that aerosolized *Legionella* spp.
11 associated with downtime procedures have minimal impact beyond these locations. Even
12 within plant boundaries, detectable airborne *Legionella* spp. appear to be confined to very
13 limited areas. In these areas, however, the more contact individuals have with the most
14 concentrated *Legionella* spp. populations, particularly if they become aerosolized (as they do in
15 some downtime operations), the more likely it is that workers are exposed.

16
17 There is new evidence that suggests that *Legionella*-like amoebal pathogens (LLAPs) may be
18 an unrecognized significant cause of respiratory disease (Berk et al. 2006). In this study, the
19 occurrence of infected amoebae in water, biofilm, and sediment samples from 40 cooling
20 towers (non-nuclear sites) and 40 natural aquatic environments were compared. The natural
21 samples were collected from rivers, creeks, lakes, and ponds from Tennessee, Kentucky, New
22 Jersey, Florida, and Texas. The cooling tower samples were collected from industries,
23 hospitals, municipal buildings, universities, and other public sites from Tennessee, Kentucky,
24 and Texas. The infected amoebae were found in 22 cooling tower samples and 3 natural
25 samples. According to this study, the probability of infected amoebae occurring in cooling
26 towers is 16 times higher than in natural environments, which justifies the need for monitoring.

27 28 **3.9.3.3 Microbiological Hazards to Plant Workers**

29
30 Exposure to *Legionella* spp. from power plant operations is a potential problem for a subset of
31 the workforce. Plant personnel most likely to come in contact with *Legionella* aerosols would be
32 workers who dislodge biofilms, where *Legionella* are often concentrated, such as during the
33 cleaning of condenser tubes and cooling towers. Since Legionellosis is a respiratory disease,
34 workers engaged in such activities should be protected by wearing appropriate respiratory
35 protection.

36
37 Because the route of infection for *N. fowleri* is nasal, workers exposed to aerosols of this
38 pathogen also should be protected with respiratory protection. If workers are involved in
39 underwater maintenance or other activities associated with thermally altered discharge waters
40 known to harbor *N. fowleri*, they should wear appropriate gear to prevent entry of the amoebae
41 into the nasal cavity.

1
2 In response to these various studies, workers at nuclear power plants are typically required to
3 use respiratory protection when cleaning cooling towers and condensers. Also, for worker
4 protection, one nuclear plant with high concentrations of *N. fowleri* in the circulating water
5 successfully controlled the pathogen through chlorination before its yearly downtime operation
6 (Tyndall 1983). It is anticipated that plant operators would continue to use proven industrial
7 hygiene principles to minimize worker exposures to these organisms in mists of cooling towers
8 (NRC 1996).

9 10 **3.9.3.4 Microbiological Hazards to the Public**

11
12 From the above studies, it is clear that heavily used bodies of freshwater merit special attention
13 and possibly routine monitoring for pathogenic *Naegleria*. Since *Naegleria* concentrations in
14 freshwater can be enhanced by thermal additions, nuclear power plants that utilize cooling
15 lakes, canals, ponds, or small rivers may enhance the naturally occurring thermophilic
16 organisms. The observed risk to swimmers from waters infected with *N. fowleri* is low but not
17 zero (Hallenbeck and Brenniman 1989). Exposure to *Legionella* spp. from power plant
18 operations would not generally impact the public because concentrated aerosols of the bacteria
19 would not traverse plant boundaries. On the basis of the information available on
20 microorganisms that may inhabit high-radiation, high-temperature environments (such as the
21 spent fuel pool), the NRC concludes they have little potential for significantly increasing in
22 number in the environment, and they would not have a deleterious effect on public health.

23
24 It is possible that the operations of the plants that use cooling ponds, lakes, canals, or small
25 rivers may enhance the presence of thermophilic organisms (NRC 1996). There are currently
26 23 reactor sites that fit this category. Data for 14 sites from this category (Arkansas, Browns
27 Ferry, Dresden, Farley, Fort Calhoun, Hatch, McGuire, Monticello, North Anna, Oconee, Peach
28 Bottom, Quad Cities, H.B. Robinson, and Vermont Yankee) that have gone through or are going
29 through license renewal were reviewed to predict the level of thermophilic microbiological
30 organism enhancement at any given site. Health departments were contacted by many sites
31 (Arkansas, Browns Ferry, Dresden, Farley, McGuire, Quad Cities, Oconee, and H.B. Robinson),
32 and none of them had any concerns regarding the threat to the public from the thermophilic
33 pathogens attributable to the plant operations. For some plants, such as Hatch, Quad Cities,
34 Peach Bottom, and Monticello, NPDES permits had set limits on the maximum daily
35 temperature for the discharge. At most of the sites where the public has access to the
36 freshwater sources, temperatures could support survival of the thermophilic microorganisms in
37 the summer but are generally below the range that is known to be conducive to their growth.
38 For all 14 sites, the actual hazard to public health from enhancement of thermophilic
39 microbiological organisms was not identified, documented, or substantiated.

40

1 **3.9.4 Electromagnetic Fields**

2
3 All nuclear power plants have power transmission systems associated with them. They consist
4 of switching stations (or substations) located on the plant site and the transmission lines
5 needed to connect the plant to the regional electrical distribution grid. Transmission lines
6 operate at a frequency of 60 Hz (60 cycles per second), which is low compared with the
7 frequencies of 55 to 890 MHz for television transmitters and 1000 MHz and greater for
8 microwaves.

9
10 Electric fields are produced by voltage, and their strength increases with increases in voltage.
11 An electric field is present as long as equipment is connected to the source of electric power.
12 The unit of electric field strength is V/m or kV/m (1 kV/m = 1000 V/m). A magnetic field is
13 produced from the flow of current through wires or electrical devices, and its strength increases
14 as the current increases. The unit of magnetic field strength is gauss (G), milligauss (mG), or
15 tesla (T). One tesla equals 10,000 G and 1 G equals 1000 mG. The electric field and magnetic
16 field, collectively referred to as the electromagnetic field (EMF), are produced by operating
17 transmission lines. Members of the public near the transmission lines may be exposed to the
18 EMFs produced by transmission lines. The EMF varies in time as the current and voltage
19 change, so that the frequency of the EMF is the same (e.g., 60 Hz for standard alternate
20 current or AC). Electrical fields can be shielded by objects such as trees, buildings, and
21 vehicles. Magnetic fields, however, penetrate most materials, but their strength decreases with
22 increasing distance from the source.

23
24 Power lines associated with nuclear plants usually have voltages of 230 kV, 345 kV, 500 kV, or
25 765 kV (a voltage occurring primarily in the eastern United States). EMF strength at ground
26 level varies greatly under these lines, generally being stronger for higher-voltage lines, a flat
27 configuration of conductors, relatively flat terrain, terrain with no shielding obstructions
28 (e.g., trees or shrubs), and a closer approach of the lines to the ground. At locations where the
29 field strength is at a maximum, the measured values under 500-kV lines often average about
30 4 kV/m but sometimes exceed 6 kV/m. Maximum electric field strengths at ground level are
31 9 kV/m for 500-kV lines and 12 kV/m for 765-kV lines (NRC 1996).

32
33 Measured magnetic field strengths at the location of maximum values beneath 500-kV lines
34 often average about 70 mG. During peak electricity use, when line current is high, the field
35 strength may peak at 140 mG (about 1 percent or less of the time) (NRC 1996).

36
37 The EMFs resulting from 60-Hz power transmission lines fall under the category of nonionizing
38 radiation. Much of the general population has been exposed to power line fields since near the
39 turn of the 20th century. There was little concern about health effects from such exposures until
40 the 1960s. A series of events during the 1960s and 1970s heightened public interest in the
41 possibility of health effects from nonionizing radiation exposures and resulted in increased

1 scientific investigation in this area (NRC 1996). Then, in 1979, results of an epidemiological
2 study suggested a correlation between proximity to high-current wiring configurations and
3 incidence of childhood leukemia (Wertheimer and Leeper 1979). This report resulted in
4 additional interest and scientific research; however, no consistent evidence linking harmful
5 effects with 60-Hz exposures has been presented. Many studies have been conducted on the
6 safety of the electric field, but no health effects have been associated with the magnitude of the
7 electric fields that are associated with electrical power usage (Patty and Hill 2006). Most
8 research on health effects has focused on magnetic fields.

9 10 **3.9.5 Other Hazards**

11
12 Nuclear power plants are industrial facilities having many of the typical occupational hazards
13 found at any other electric power generation utility. Workplace hazards can be grouped into
14 physical hazards (e.g., slips and trips, falls from height, and those related to transportation,
15 temperature, humidity, and electricity), physical agents (noise, vibration, and ionizing radiation),
16 chemical agents, biological agents, and psychosocial issues (work-related stress due to
17 excessive working time and overnight shifts). The hazards from ionizing radiation, chemical
18 agents, and biological hazards are discussed in Sections 3.9.1, 3.9.2, and 3.9.3, respectively.
19 Power plant and maintenance workers could be working under potentially hazardous physical
20 conditions (e.g., excessive heat, cold, and pressure), including electrical work, power line
21 maintenance, and repair work.

22
23 Transmission lines are necessary to transfer energy from all types of electrical generating
24 facilities, including nuclear power plants, to consumers. The potential exposure to workers and
25 the public from the EMF is discussed in Section 3.9.4. The workers and general public at or
26 around the nuclear power plants and along the transmission lines are exposed to the potential
27 for acute electrical shock from transmission lines. This hazard is discussed in the following
28 section.

29 30 **3.9.5.1 Occupational Hazards**

31
32 The Occupational Safety and Health Administration (OSHA) is responsible for developing and
33 enforcing workplace safety regulations. OSHA was created by the Occupational Safety and
34 Health Act of 1970 (29 USC 651 et seq.), which was enacted to safeguard the health of
35 workers. Occupational hazards can be minimized when workers adhere to safety standards
36 and use appropriate protective equipment; however, fatalities and injuries from accidents can
37 still occur.

38
39 Table 3.9-21 lists the total number of fatal occupational injuries that occurred in 2005 in
40 different industry sectors. For the utility sector, of which the nuclear industry is a part,
41 30 workers suffered fatal occupational injuries, 22 of which were from electric power

Affected Environment

1 generation, transmission, and distribution. The rate of fatal injuries in the utility sector was less
2 than the rate in the construction; transportation and warehousing; agriculture, forestry, fishing,
3 and hunting; wholesale trade; and mining sectors. Table 3.9-22 lists the incidence rates of
4 nonfatal occupational injuries and illnesses in different utilities for 2005. The incidence rate of
5 nonfatal occupational injuries and illnesses is least for electric power generation, followed by
6 electric power transmission control and distribution.

7
8 Table 3.9-23 lists the number and rate of fatal occupational injuries that occurred in 2005 for
9 selected occupations. The fatality rate for installers and repairers of electrical power lines can
10 be estimated at 0.032 percent (BLS 2005b). The occupational safety and health hazards issue
11 is generic to all types of electrical generating stations, including nuclear power plants, and is of
12 small significance if the workers adhere to safety standards and use protective equipment.

13 14 **3.9.5.2 Shock Hazard**

15
16 For purposes of evaluating the impacts of license renewal, the transmission lines of concern are
17 those lines that currently connect the nuclear plant to the regional electrical distribution grid and
18 that would remain energized only if the plant's operating license was renewed. The greatest
19 hazard from a transmission line is direct electrical contact with the conductors. The electrical
20 contact can occur without physical contact between a grounded object and the conductor
21 (e.g., when arcing occurs across an air gap) (BPA 1998). The electric field created by a high-
22 voltage line extends from the energized conductors to other conducting objects, such as the
23 ground, vegetation, buildings, vehicles, and persons. Potential field effects can include induced
24 currents, steady-state current shocks, spark-discharge shocks, and, in some cases, field
25 perception and neurobehavioral responses.

26
27 The shock hazard issue is evaluated by referring to the National Electric Safety Code (NESC).
28 The purpose of the NESC is the practical safeguarding of persons during the installation,
29 operation, or maintenance of electric supply and communication lines and associated
30

Table 3.9-21. Number and Rate of Fatal Occupational Injuries by Industry Sector in 2005

Industry Sector	Number	Rate (per 100,000 employees)
Construction	1192	11.0
Transportation and warehousing	885	17.6
Agriculture, forestry, fishing, and hunting	715	32.6
Government	520	2.4
Professional and business services	482	3.5
Manufacturing	393	2.4
Retail trade	400	2.4
Leisure and hospitality	213	1.8
Wholesale trade	204	4.4
Mining	159	25.6
Other services	210	3.0
Educational and health services	150	0.8
Financial activities	99	1.0
Information	65	2.1
Utilities ^(a)	30	3.6
Electric utilities ^(b)	22	NA ^(c)
Power generation ^(d)	11	NA
Hydroelectric power generation	4	NA
Fossil fuel electric power generation	4	NA
Power transmission control and distribution ^(e)	9	NA
Natural gas distribution	4	NA
Water sewage and other system	3	NA
All sectors	5734	4.0

(a) The numbers of fatalities from transportation, falls, and exposure to harmful substances or the environment were 10, 7, and 11, respectively.

(b) The numbers of fatalities from transportation, falls, and exposure to harmful substances or the environment were 7, 5, and 9, respectively.

(c) NA = not available.

(d) The numbers of fatalities from transportation, falls, and exposure to harmful substances or the environment were 3, 3, and 5, respectively.

(e) The numbers of fatalities from transportation and exposure to harmful substances or the environment were 3 and 4, respectively.

Source: U.S. Bureau of Labor Statistics (BLS) 2005a,b

Affected Environment

Table 3.9-22. Employment and Incidence Rate of Nonfatal Occupational Injuries and Illnesses in Different Utilities in 2005

Utility	Rate (per 100 Employees)	Employment (in 1000s)
Electric utilities	4.0	400.6
Power generation	3.3	240.1
Power transmission control and distribution	5.1	160.5
Natural gas distribution	5.9	107.0
Water sewage and other system	7.6	45.7
Overall	4.6	553.3

Source: BLS 2005c

1
2

Table 3.9-23. Number and Rate of Fatal Occupational Injuries for Selected Occupations in 2005

Occupation	Number	Rate per 100,000 Employed
Fishers and related fishing work	48	118.4
Aircraft pilots and flight engineers	81	66.9
Logging workers	80	92.9
Structural iron and steel workers	35	55.6
Refuse and recyclable material collectors	32	43.8
Farmers and ranchers	341	41.1
Electrical power-line installers and repairers	36	32.7
Drivers/sales workers and truck drivers	993	29.1
Miscellaneous agricultural workers	176	23.2
Construction laborers	339	22.7

Source: BLS 2005b

3
4
5
6
7
8
9
10

equipment. The NESC contains the basic provisions that are considered necessary for the safety of employees and the public under the specified conditions (IEEE 2007).

Primary shock currents are produced mainly through direct contact with conductors and have effects ranging from a mild tingling sensation to death by electrocution. Tower designs preclude direct public access to the conductors. Secondary shock currents are produced when humans make contact with (1) capacitively charged bodies, such as a vehicle parked near a

1 transmission line, or (2) magnetically linked metallic structures, such as fences near
 2 transmission lines. A person who contacts such an object could receive a shock and
 3 experience a painful sensation at the point of contact. The intensity of the shock depends on
 4 the EMF strength, the size of the object, and how well the object and the person are insulated
 5 from ground.

6
 7 Design criteria that limit hazards from steady-state currents are based on the NESC, which
 8 requires that utility companies design transmission lines so that the short-circuit current to
 9 ground, produced from the largest anticipated vehicle or object, is limited to less
 10 than 5 milli Amps (mA) (IEEE 2007). No similar code exists for the limitation of the magnetic
 11 fields of transmission lines; however, because of concerns about the safety of magnetic fields,
 12 several States have created their own regulations (NRC 1996).

13
 14 With respect to shock safety issues and license renewal, three points must be made. First, in
 15 the licensing process for the earlier licensed nuclear plants, the issue of electrical shock safety
 16 was not addressed. Second, some plants that received operating licenses with a stated
 17 transmission line voltage may have chosen to upgrade the line voltage for reasons of efficiency,
 18 possibly without reanalysis of induction effects. Third, since the initial NEPA review for those
 19 utilities that evaluated potential shock situations under the provision of the NESC, land use may
 20 have changed, resulting in the need for a reevaluation of this issue. Electrical shock potential is
 21 minimized for transmission lines that are operated in adherence with the NESC.

22 23 **3.10 Environmental Justice**

24
 25 Under Executive Order 12898 (59 FR 7629),
 26 Federal agencies are responsible for identifying
 27 and addressing potential disproportionately
 28 high and adverse human health and
 29 environmental impacts on minority and low-
 30 income populations. In 2004, the Commission
 31 issued a *Policy Statement on the Treatment of*
 32 *Environmental Justice Matters in NRC*
 33 *Regulatory and Licensing Actions* (69 FR
 34 52040), which states “The Commission is
 35 committed to the general goals set forth in E.O.
 36 12898, and strives to meet those goals as part
 37 of its NEPA review process.”

***Executive Order 12898, Federal Actions to
Address Environmental Justice in Minority
Populations and Low-Income Populations***

“Each federal agency, whenever practicable and appropriate, shall collect, maintain, and analyze information assessing and comparing environmental and human health risks borne by populations identified by race, national origin, or income. To the extent practical and appropriate, Federal agencies shall use this information to determine whether their programs, policies, and activities have disproportionately high and adverse human health or environmental effects on minority populations and low-income populations.”

38
 39 The Council of Environmental Quality (CEQ) provides the following information in
 40 *Environmental Justice: Guidance Under the National Environmental Policy Act* (CEQ 1997a):

Affected Environment

- 1
- 2 • **Disproportionately High and Adverse Human Health Effects.** Adverse health effects are
- 3 measured in risks and rates that could result in latent cancer fatalities, as well as other fatal
- 4 or nonfatal adverse impacts on human health. Adverse health effects may include bodily
- 5 impairment, infirmity, illness, or death. Disproportionately high and adverse human health
- 6 effects occur when the risk or rate of exposure to an environmental hazard for a minority or
- 7 low-income population is significant (as defined by CEQ) and appreciably exceeds the risk
- 8 or exposure rate for the general population or for another appropriate comparison group
- 9 (CEQ 1997b).
- 10
- 11 • **Disproportionately High and Adverse Environmental Effects.** A disproportionately high
- 12 environmental impact that is significant (as defined by CEQ) refers to an impact or risk of an
- 13 impact on the natural or physical environment in a low-income or minority community that
- 14 appreciably exceeds the environmental impact on the larger community. Such effects may
- 15 include ecological, cultural, human health, economic, or social impacts. An adverse
- 16 environmental impact is an impact that is determined to be both harmful and significant (as
- 17 defined by CEQ). In assessing cultural and aesthetic environmental impacts, impacts that
- 18 uniquely affect geographically dislocated or dispersed minority or low-income populations or
- 19 American Indian tribes are considered (CEQ 1997b).
- 20
- 21 The environmental justice analysis assesses the potential for disproportionately high and
- 22 adverse human health or environmental effects on minority and low-income populations that
- 23 could result from the continued operation of a nuclear power plant during the renewal term. In
- 24 assessing the impacts, the following CEQ definitions of minority individuals and populations and
- 25 low-income population were used:
- 26
- 27 • **Minority individuals.** Individuals who identify themselves as members of the following
- 28 population groups: Hispanic or Latino, American Indian or Alaska Native, Asian, Black or
- 29 African American, Native Hawaiian or Other Pacific Islander, or two or more races meaning
- 30 individuals who identified themselves on a Census form as being a member of two or more
- 31 races, for example, Hispanic and Asian.
- 32
- 33 • **Minority populations.** Minority populations are identified when (1) the minority population
- 34 of an affected area exceeds 50 percent or (2) the minority population percentage of the
- 35 affected area is meaningfully greater than the minority population percentage in the general
- 36 population or other appropriate unit of geographic analysis. Minority populations may be
- 37 communities of individuals living in close geographic proximity to one another, or they may
- 38 be a geographically dispersed or transient set of individuals, such as migrant workers or
- 39 American Indians, who, as a group, experience common conditions with regard to
- 40 environmental exposure or environmental effects. The appropriate geographic unit of

1 analysis may be a political jurisdiction, county, region, or State, or some other similar unit
2 that is chosen so as not to artificially dilute or inflate the affected minority population.
3

- 4 • **Low-income population.** Low-income population is defined as individuals or families living
5 below the poverty level as defined by the U.S. Census Bureau's Current Population Reports,
6 Series P-60 on Income and Poverty (USCB 2007). Low-income populations may be
7 communities of individuals living in close geographic proximity to one another, or they may
8 be a set of individuals, such as migrant workers, who, as a group, experience common
9 conditions.

10
11 Consistent with the definition used in the impact analysis for public and occupational health and
12 safety, affected populations are defined as minority and low-income populations who reside
13 within a 50-mi (80-km) radius of a nuclear plant. Data on low-income and minority individuals
14 are usually collected and analyzed at the census tract level or census block group level.^(a)
15

16 The presence of minority and low-income individuals located within 50 mi (80 km) of each
17 nuclear power plant site vary considerably depending on the proximity of larger communities to
18 power plant sites, the location of Native American Tribal lands, historical population trends in
19 the region around each site, and the nature of regional economic activity. Typically, plant sites
20 in rural areas in the southern and southwestern United States are more likely to have larger
21 minority populations. Examples are the Browns Ferry, Brunswick, Catawba, Farley, North
22 Anna, H.B. Robinson, Summer, and Surry plants. Sites closer to metropolitan areas may have
23 both larger minority populations and larger low-income populations. These include the
24 Dresden, Ginna, Indian Point, and Pilgrim plants.
25

26 **3.10.1 Subsistence Consumption of Fish and Wildlife**

27

28 Section 4-4 of Executive Order 12898 directs Federal agencies, whenever practical and
29 appropriate, to (a) collect and analyze information on the consumption patterns of populations
30 who rely principally on fish and/or wildlife for subsistence and (b) communicate the risks of
31 these consumption patterns to the public. Consideration is given to whether there are any ways
32 in which minority or low-income populations could be disproportionately affected by means of
33 examining impacts on American Indian, Hispanic, and other traditional-lifestyle, special-pathway
34 receptors. Special pathways take into account the levels of contamination in native vegetation,

(a) A census block group is a combination of census blocks, which are statistical subdivisions of a census tract. A census block is the smallest geographic entity for which the U.S. Census Bureau (USCB) collects and tabulates decennial census information. A census tract is a small, relatively permanent statistical subdivision of counties delineated by local committees of census data users in accordance with USCB guidelines for the purpose of collecting and presenting decennial census data. Census block groups are subsets of census tracts (USCB 2005).

Affected Environment

1 crops, soils and sediments, surface water, fish, and game animals on or near power plant sites
2 in order to assess the risk of radiological exposure through subsistence consumption of fish,
3 native vegetation, surface water, sediment, and local produce; the absorption of contaminants
4 in sediments through the skin; and the inhalation of airborne particulate matter. The
5 identification of special-pathway receptors can be important in an environmental justice analysis
6 because consumption patterns may reflect the traditional or cultural practices of minority and
7 low-income populations in the area.

8
9 Many nuclear plants have a comprehensive radiological environmental monitoring program to
10 assess the impact of site operations on the environment (see Section 3.9.1). Samples are
11 collected from the aquatic and terrestrial pathways applicable to the site. Aquatic pathways
12 generally include fish, surface water, and sediment, while terrestrial pathways include airborne
13 particulates, radioiodine, milk, food products, crops, and direct radiation. The concentrations of
14 contaminants that are found in native vegetation, crops, soils, sediment, surface water, fish, and
15 game animals in areas surrounding nuclear power plants are usually quite low (at or near the
16 threshold of detection) and seldom above background levels. Consequently, no
17 disproportionately high and adverse human health impacts have been implicated in special-
18 pathway receptor populations in the regions around most nuclear power plants as a result of
19 subsistence consumption of fish and wildlife.

20 21 **3.11 Waste Management and Pollution Prevention**

22
23 As part of their normal operations and as a result of equipment repairs and replacements due to
24 normal maintenance activities, nuclear power plants routinely generate both radioactive and
25 nonradioactive wastes. Nonradioactive wastes include hazardous and nonhazardous wastes.
26 There is also a class of waste, called mixed waste, that is both radioactive and hazardous. The
27 systems used to manage (i.e., treat, store, and dispose of) these wastes are described in
28 Sections 3.1.4 and 3.1.5. The basic characteristics and current disposition paths for these
29 waste streams are discussed in Section 3.11.1 for radioactive waste, 3.11.2 for hazardous
30 waste, 3.11.3 for mixed waste, and 3.11.4 for nonradioactive nonhazardous waste. Waste
31 minimization and pollution prevention measures commonly employed at nuclear power plants
32 are reviewed in Section 3.11.5.

33 34 **3.11.1 Radioactive Waste**

35
36 There are basically two types of radioactive waste generated at nuclear power plants: (1) low-
37 level waste (LLW) and (2) spent nuclear fuel. These two waste types are discussed in
38 Sections 3.11.1.1 and 3.11.1.2, respectively.

3.11.1.1 Low-Level Radioactive Waste

The NRC's definition of LLW is included in 10 CFR 61.55. Depending on the types and concentrations of radionuclides in the waste, the NRC classifies LLW as belonging to Class A, Class B, Class C, or greater-than-Class C. Class A wastes generally contain short-lived radionuclides at relatively low concentrations, whereas the half-lives and concentrations of radionuclides in the Class B and C wastes are progressively higher. In addition, Class B wastes must meet more rigorous requirements with regard to their form to ensure stability after disposal (e.g., by adding chemical stabilizing agents such as cement to the waste or placing the waste in a disposal container or structure that provides stability after disposal). Class C wastes must not only meet the more rigorous requirements above but also require the implementation of additional measures at the disposal facility to protect against inadvertent intrusion (e.g., by increasing the thickness and hardness of the cover over the waste disposal cell). Wastes containing radionuclides at concentrations that are higher than what is allowed for Class C wastes are classified as greater-than-Class C. Disposal of greater-than-Class C waste is the responsibility of the U.S. Department of Energy (DOE). DOE is currently preparing an EIS to evaluate the various alternatives for disposing of these wastes (DOE 2007).

LLW generated at nuclear power plants generally consists of air filters, cleaning rags, protective tape, paper and plastic coverings, discarded contaminated clothing, tools, equipment parts, and solid laboratory wastes (all these are collectively known as dry active waste) and wet wastes that result during the processing and recycling of contaminated liquids at the plants. Wet wastes generally consist of evaporator bottoms, spent demineralizer or ion exchange resins, and spent filter material from the equipment drain, floor drain, and water cleanup systems. The wet wastes are generally solidified, dried, or dewatered to make them acceptable at a disposal site. Some plants perform these operations onsite, while others ship their waste to a third-party vendor offsite for processing before it is sent to a disposal facility. The transportation and disposal of solid radioactive wastes are performed in accordance with the applicable requirements of 10 CFR Part 71 and 10 CFR Part 61, respectively.

LLW shipments from nuclear power plants to disposal facilities or waste processing centers and from waste processing centers to disposal facilities are generally made by trucks. Wastes are

Radioactive Wastes Associated with Commercial Nuclear Power Plants

Low-Level Waste: Radioactive material that (a) is not high-level radioactive waste, spent nuclear fuel, or by-product material (as defined in Section 11e(2) of the Atomic Energy Act of 1954 [42 USC 2014(e)(2)]) and (b) is classified by the NRC, consistent with existing law, as low-level radioactive waste (as defined in the Low-Level Radioactive Waste Policy Act, as amended, Public Law 99-240).

Spent Nuclear Fuel: Fuel that has been withdrawn from a nuclear reactor following irradiation, the constituent elements of which have not been separated by reprocessing (as included in the Nuclear Waste Policy Act of 1982, as amended, Public Law 97-425).

Affected Environment

1 segregated and packaged by class. For load leveling purposes, the wastes may be stored
2 onsite at the plant temporarily before shipment offsite. Construction and operation of any LLW
3 storage areas and any activities related to storage and processing of LLW onsite, including the
4 preparation of waste for shipment and loading on vehicles before shipment, are carried out in
5 accordance with the licensing requirements imposed by the NRC. All such operations are
6 accounted for when the applicants prepare their annual radioactive effluent release reports to
7 demonstrate compliance with the applicable Federal standards and requirements. The primary
8 standards applicable to all the power plants are contained in 10 CFR Part 20, 40 CFR Part 190,
9 and Appendix I to 10 CFR Part 50.

10
11 There are currently three operating disposal facilities in the United States that are licensed to
12 accept commercial-origin LLW. They are located in Barnwell, South Carolina; Richland,
13 Washington; and Clive, Utah. The facility in Utah, operated by EnergySolutions, is licensed to
14 accept only Class A LLW, whereas the other two facilities can accept Class A, B, and C wastes
15 (GAO 2004). In 2001, the South Carolina legislature imposed restrictions on the Barnwell
16 facility that state that after June 2008, the facility can accept waste from generators in only three
17 States: South Carolina, New Jersey, and Connecticut. The Richland facility accepts LLW from
18 only 11 States: Washington, Alaska, Hawaii, Idaho, Montana, Oregon, Utah, Wyoming,
19 Colorado, Nevada, and New Mexico. It is expected to close in 2056. The EnergySolutions
20 facility in Utah accepts only Class A waste, but it can come from any State. This facility
21 currently does not have a projected closing date.

22
23 The Low Level Radioactive Waste Policy Act (Public Law 96-573) was enacted in 1980. This
24 act made each State responsible for providing for the disposal of the LLW generated within the
25 State, either by itself or in cooperation with other States, with the exception of waste produced
26 by DOE and the nuclear propulsion component of the Department of the Navy. The aims of the
27 Low Level Radioactive Waste Policy Act were to provide more LLW disposal capacity on a
28 regional basis and to more equitably distribute responsibility for the management of LLW among
29 the States. As an incentive for States to manage waste on a regional basis, Congress
30 consented to the formation of interstate agreements known as compacts, and it granted
31 compact member States the authority to exclude LLW from States that are members of other
32 compacts or unaffiliated with a compact.

33
34 In January 1986, Congress passed the Low-Level Radioactive Waste Policy Amendments Act
35 (Public Law 99-240). This act extended the original January 1, 1986, deadline for developing
36 new disposal facilities by 7 years to January 1, 1993. It also made the Federal government
37 responsible for disposing of commercial-origin greater-than-Class C waste.

38
39 Figure 3.11-1 shows the compact arrangements as agreed to by the States. It also shows the
40 location of the three active disposal facilities in South Carolina, Washington, and Utah. As of
41 the writing of this GEIS revision, no new disposal facilities had been developed as a result of

1 either act. Two of the existing disposal facilities (Barnwell and Richland) were licensed before
2 1980. The EnergySolutions facility was developed by a private entity outside of these
3 mandates. The Richland facility is the designated disposal site for the States in the Northwest
4 and Rocky Mountain compacts. The Barnwell facility is the designated disposal site for the
5 Atlantic compact. The EnergySolutions facility is not affiliated with any compacts.
6

7 Annual quantities of LLW generated at the nuclear power plants vary from year to year
8 depending on the number of maintenance activities undertaken and the number of unusual
9 occurrences taking place in that year. However, on average, the volume and radioactivity of
10 LLW generated at a PWR are approximately 10,600 ft³ (300 m³) and 1000 Ci (3.7×10^{13} Bq) per
11 year, respectively (Table 6.6 in NRC 1996). The annual volume and activity of LLW generated
12 at a BWR are approximately twice the values indicated for a PWR. The total volume and
13 activity of LLW generated at all the LWRs in the United States are approximately 706,000 ft³
14 (20,000 m³) and 60,000 Ci (2.2×10^{15} Bq), respectively (Table 6.6 in NRC 1996).

15 Approximately 95 percent of this waste is Class A (NEI 2007b). Table 3.11-1 shows the volume
16 and activity of LLW shipped offsite per operating reactor unit from 10 power plant sites in 2006.
17 For example, there are two operating units at the Comanche Peak site, and the volume and
18 activity of LLW shipped from the Comanche Peak site in 2006 were 5720 ft³ (162 m³) and
19 178 Ci (6.59×10^{12} Bq) per unit, with the total volume and activity shipped from the site being
20 twice these values, namely 11,400 ft³ (324 m³) and 374 Ci (1.38×10^{13} Bq), respectively. The
21 numbers in Table 3.11-1 were obtained from the annual radioactive effluent release reports
22 issued by each plant for 2006.
23

24 Almost all of the LLW generated at the reactor sites is shipped offsite, either directly to a
25 disposal facility or to a processing center for volume reduction or another type of treatment
26 before being sent to a disposal site. The number of shipments leaving each reactor site vary
27 but generally range from a few to about 100 per year. 10 CFR 20, Subpart K, discusses the
28 various means by which the licensees may dispose of their waste. In addition to transferring it
29 to an authorized disposal or treatment facility as described above, licensees may also (1) let the
30 waste decay to acceptable levels in storage (this is not practical for most power reactor LLWs
31 and is not practiced), (2) release it in effluents within the limits set in 10 CFR 20.1301 (certain
32 liquid and gaseous wastes are released when this method is used), (3) obtain special approval
33 from the NRC or an Agreement State pursuant to 10 CFR 20.2002,^(a) (4) release it into
34

(a) Some licensees have used this method to dispose of low-activity wastes onsite subject to certain limitations. For example, owners of the Vermont Yankee Nuclear Power Station have disposed of certain quantities of soil, sewage sludge, and cooling tower silt onsite by using this method, with the limitations that (a) the dose received by an MEI not exceed 1 mrem (0.01 mSv) in any year while the licensee maintains control of the site, and (b) after the licensee gives up control of the disposal area, an intruder not receive a whole body dose exceeding 5 mrem in any one year.

Table 3.11-1. Solid Low-Level Radioactive Waste Shipped Offsite per Reactor from 10 Power Plant Sites in 2006^(a)

Plant	Volume (m ³)	Activity (Ci)	Number of Shipments	Number of Reactors
PWRs				
Comanche Peak	162	187	6.5	2 (Units 1 and 2)
D.C. Cook	97.2	60	32	2 (Units 1 and 2)
Indian Point	501	316	16.3	3 (Units 1, 2, and 3) ^(b)
H.B. Robinson 2	145	173	6	1 (Unit 2)
San Onofre	3210	150	116.3	3 (Units 1, 2, and 3) ^(b)
Surry	391	223	11	2 (Units 1 and 2)
BWRs				
Hatch	148	445	55	2 (Units 1 and 2)
Vermont Yankee	61	18,800 ^(c)	104	1
Limerick	55	291	27	2 (Units 1 and 2)
Columbia	368	1570	28	1

(a) The numbers in the table were obtained from each plant's 2006 Annual Radioactive Effluent Release Report.

(b) Unit 1 is shut down at both Indian Point and San Onofre.

(c) Includes shipment of irradiated components.

1
 2 sanitary sewage as discussed in 10 CFR 20.2003 (this is not practical for most power reactor
 3 LLWs and is not practiced), (5) incinerate it as provided in 10 CFR 20.2004 (certain quantities of
 4 low-activity used oils are incinerated at a few sites to provide heat and dispose of the oils), or
 5 (6) dispose of wastes containing low levels of tritium and carbon-14 in accordance with the
 6 criteria discussed in 10 CFR 20.2005.

7
 8 **3.11.1.2 Spent Nuclear Fuel**

9
 10 Spent nuclear fuel is fuel that has been withdrawn from a nuclear reactor following irradiation,
 11 the constituent elements of which have not been separated. When spent fuel is removed from a
 12 reactor, it is stored in racks placed in a pool (called the spent fuel pool) to isolate it from the
 13 environment and to allow the fuel rods to cool. Licensing plans contemplate disposal of spent
 14 fuel in a deep geological repository. Siting and developing a permanent repository is required
 15 by the Nuclear Waste Policy Act of 1982. Delays in siting a permanent repository, coupled with
 16 rapidly filling spent fuel pools at some

17

1 plants, have led utilities to seek means of continued onsite storage. These include
2 (1) expanded pool storage, (2) aboveground dry storage, (3) longer fuel burnup to reduce the
3 amount of spent fuel requiring interim storage, and (4) shipment of spent fuel to other plants.
4 Any modification to the spent fuel storage configuration at a nuclear power plant is subject to
5 NRC review and approval. Each review consists of a safety review and the preparation of an
6 EAan environmental review. As part of the environmental review for such a modification, the
7 NRC generally prepares an environmental assessment (EA).

8
9 Expanded pool storage options include (1) enlarging the capacity of spent fuel racks, (2) adding
10 racks to existing pool arrays (“dense-racking”), (3) reconfiguring spent fuel with neutron-
11 absorbing racks, and (4) employing double-tiered storage (installing a second tier of racks
12 above those on the pool floor).


13
14 Aboveground dry storage involves moving the spent fuel assemblies, which have been stored in
15 the spent fuel pool for a certain period of time, to aboveground, shielded enclosures that are air
16 cooled (also known as dry storage). The fuel is stored in the spent fuel pool to cool, typically for
17 several years, before it may be moved to a dry cask storage facility. In the late 1970s and early
18 1980s, the need for alternative storage began to grow when pools at many nuclear reactors
19 began to fill up with stored spent fuel. Utilities began looking at options such as dry cask
20 storage for increasing their storage capacity for spent fuel.

21
22 Dry cask storage allows spent fuel to be surrounded by inert gas inside a container called a
23 cask. The casks are typically steel cylinders that are either welded or bolted closed. The steel
24 cylinder provides a leak-proof containment for the spent fuel. Each cylinder is surrounded by
25 additional steel, concrete, or other material to provide radiation shielding to workers and
26 members of the public. Some of the cask designs can be used for both storage and
27 transportation.

28
29 There are various dry storage cask system designs. With some designs, the steel cylinders
30 containing the fuel are placed vertically in a concrete vault; other designs orient the cylinders
31 horizontally. The concrete vaults provide the radiation shielding. Other cask designs orient the
32 steel cylinder vertically on a concrete pad at a dry cask storage site and use both metal and
33 concrete outer cylinders for radiation shielding. Figure 3.11-2 shows two of the typical dry cask
34 storage designs. The location of the dry casks is in a facility known as an Independent Spent
35 Fuel Storage Installation or ISFSI. This is a complex designed and constructed for the interim
36 storage of spent nuclear fuel, solid reactor-related greater than class C waste, and other
37 radioactive materials associated with spent nuclear fuel and reactor-related greater than class C
38 waste storage. The ISFSI is generally located within the same site where the nuclear fuel is
39 used. They are licensed by the NRC under either a general license or a site-specific license
40 (see 10 CFR Part 72). Figure 3.11-3 shows the locations of currently licensed ISFSIs.

Affected Environment

1 Longer-burnup fuel is fuel from which more energy can be obtained before it is taken out of the
2 reactor and declared spent. As a result of using this fuel, less spent fuel is generated for the
3 same amount of energy produced in a reactor.
4
5

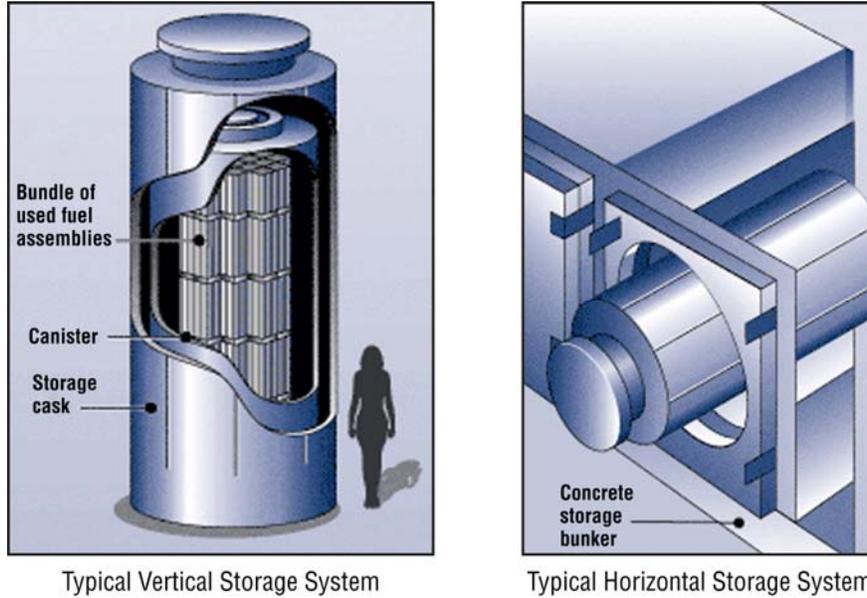

6
7
8 **Figure 3.11-1.** Typical Dry Cask Storage Systems (Source: NRC 2007i)
9
10
11

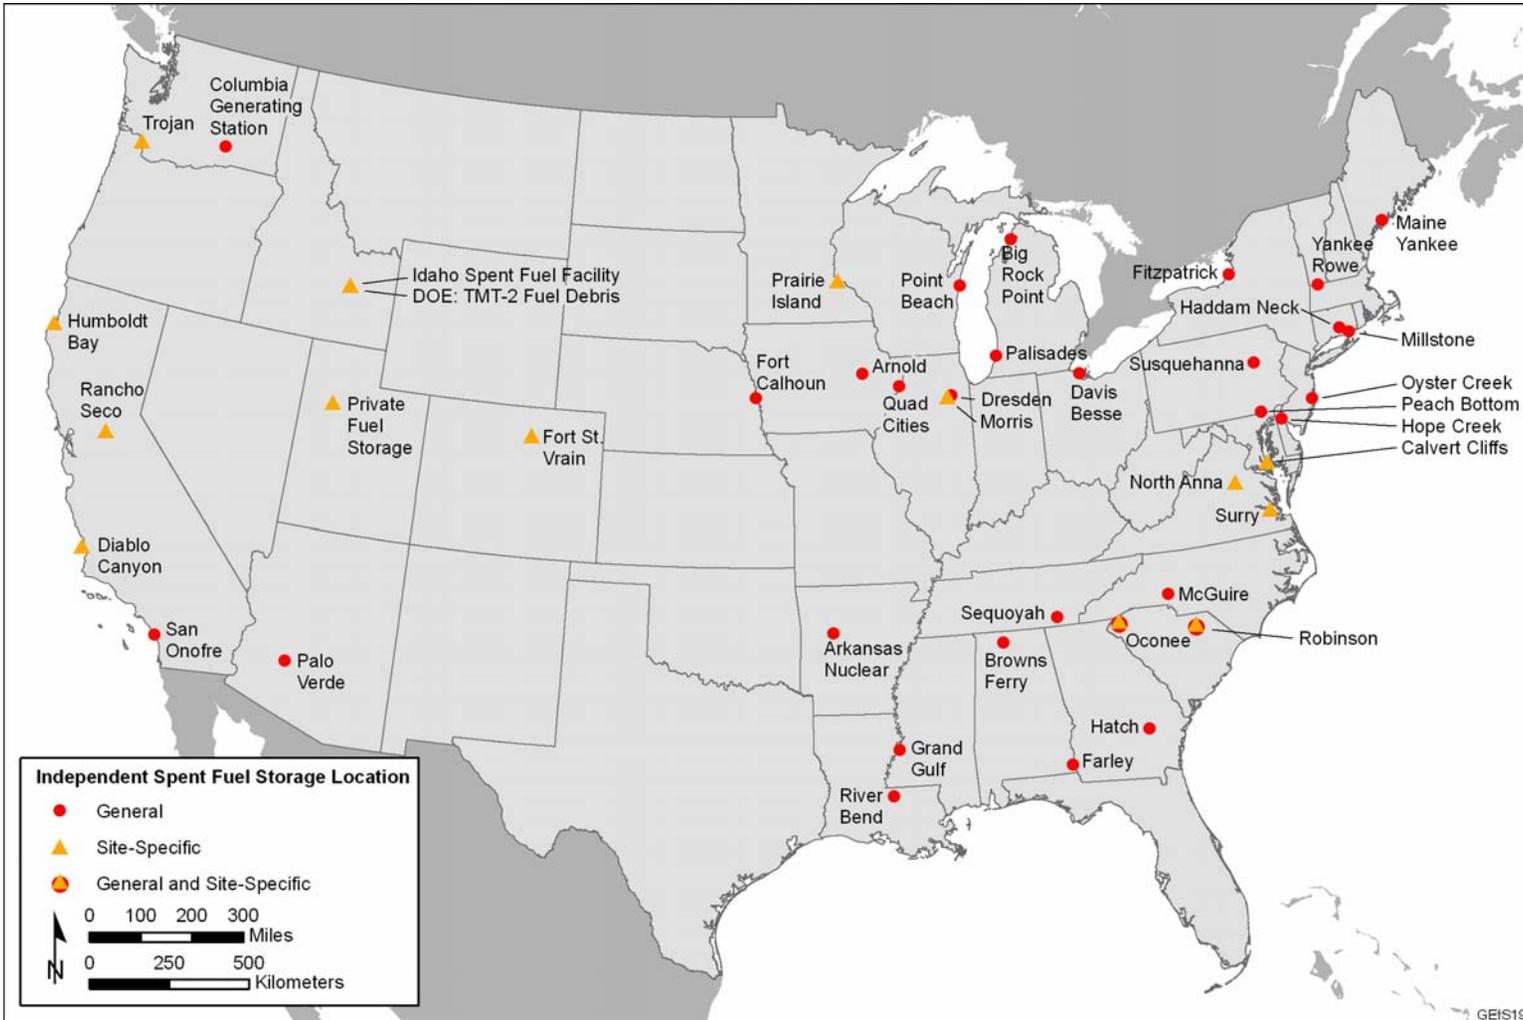


Figure 3.11-2. Locations of Independent Spent Fuel Storage Installations Licensed by the NRC (Source: NRC 2007)

1 Longer-burnup fuel is fuel from which more energy can be obtained before it is taken out of the
2 reactor and declared spent. As a result of using this fuel, less spent fuel is generated for the
3 same amount of energy produced in a reactor.

4
5 Although plants running out of storage space
6 may enter into agreements with others that
7 have space for sale or lease, this approach is
8 widely viewed as an interim measure, practical
9 only for utilities that own more than one nuclear
10 plant (NRC 1996).

11 12 **3.11.2 Hazardous Waste**

13
14 Hazardous waste is defined by the EPA in
15 40 CFR Part 261, "Identification and Listing of
16 Hazardous Waste," as solid waste that (1) is
17 listed by the EPA as being hazardous;
18 (2) exhibits one of the characteristics of
19 ignitability, corrosivity, reactivity, or toxicity; or
20 (3) is not excluded by the EPA from regulation
21 as being hazardous. All aspects of hazardous
22 waste generation, treatment, transportation,
23 and disposal are strictly regulated by the EPA
24 or by the States under agreement with the EPA
25 per the regulations promulgated under RCRA
26 (PL 94-580).

27
28 The types of hazardous waste that nuclear power plants generate include waste paints, lab
29 packs, solvents, and lead batteries. The quantities of these wastes generated at individual
30 plants are highly variable but, generally, relatively small when compared with the quantities at
31 most other industrial facilities that generate hazardous waste. Most nuclear power plants
32 accumulate their hazardous waste onsite as authorized under RCRA and transport it to a
33 treatment facility where it undergoes treatment. The remaining residues are sent to a
34 permanent disposal facility. There are quite a few RCRA-permitted treatment and disposal
35 facilities throughout the United States that are used by the owners of nuclear power plants.

36
37 There is a class of hazardous waste, called universal waste, that the EPA has authorized to be
38 handled differently from the other kinds of hazardous waste. The EPA's universal waste
39 regulations streamline hazardous waste management standards for Federally designated
40 universal wastes, which include batteries, pesticides, mercury-containing equipment, and

Other Wastes Associated with Commercial Nuclear Power Plants

Hazardous Waste: A solid waste or combination of solid wastes that, because of its quantity, concentration, or physical, chemical, or infectious characteristics, may (1) cause or significantly contribute to an increase in mortality or an increase in serious irreversible or incapacitating reversible illness or (2) pose a substantial present or potential hazard to human health or the environment when improperly treated, stored, transported, disposed of, or otherwise managed (as defined in the Resource Conservation and Recovery Act, as amended, Public Law 94-580).

Mixed Waste: Waste that is both hazardous and radioactive.

Nonradioactive Nonhazardous Waste: Waste that is neither radioactive nor hazardous.

1 lamps. The regulations govern the collection and management of these widely generated
2 wastes, thus facilitating environmentally sound collection and proper recycling or treatment.

3
4 The Federal universal waste regulations are set forth in 40 CFR Part 273. States can modify
5 the universal waste rule and add additional universal waste(s) in individual State regulations.
6 Nuclear power plants follow the regulations set forth by the EPA or by their State agencies, as
7 applicable, to manage their universal waste.

8 9 **3.11.3 Mixed Waste**

10
11 Wastes that are both radioactive and hazardous are called mixed waste. They are subject to
12 dual regulation: by the EPA or an authorized State for their hazardous component, and by the
13 NRC or an agreement State for their radioactivity. The types of mixed wastes generated at
14 nuclear power plants include organics (e.g., liquid scintillation fluids, waste oils, halogenated
15 organics), metals (e.g., lead, mercury, chromium, and cadmium), solvents, paints, and cutting
16 fluids. The quantity of mixed waste generated varies considerably from plant to plant
17 (NRC 1996). Overall, the quantities generated during operations are generally relatively small,
18 but because of the added complexity of dual regulation, it is more problematic for plant owners
19 to manage and dispose of mixed wastes than the other types of wastes. Similar to hazardous
20 waste, mixed waste is generally accumulated onsite in designated areas as authorized under
21 RCRA, then shipped offsite for treatment as appropriate and for disposal. The only disposal
22 facility that is authorized to receive mixed LLW for disposal at present is the EnergySolutions
23 facility discussed under Section 3.11.1.1 on LLW.

24
25 Occupational exposures and any releases from onsite treatment of these and any other types of
26 wastes are considered in evaluating compliance with the applicable Federal standards and
27 regulations, for example, 10 CFR Part 20, 40 CFR Part 190, and Appendix I to 10 CFR Part 50.

28 29 **3.11.4 Nonradioactive, Nonhazardous Waste**

30
31 Like any other industrial facility, nuclear power plants generate wastes that are not
32 contaminated with either radionuclides or hazardous chemicals. These wastes include trash,
33 paper, wood, and sewage. Solid wastes, defined as nonhazardous by 40 CFR Part 261, are
34 collected and disposed of in a local landfill. Sanitary wastes defined as nonhazardous by
35 40 CFR Part 261 are generally treated at an onsite sewage treatment plant, and the residues
36 are sent to local landfills. Some power plants collect their sanitary waste in septic tanks and
37 empty the tanks periodically, shipping the pumped sewage to a local sanitary waste treatment
38 plant. The uncontaminated wastes and sewage are tested for radionuclides before being sent
39 offsite to make sure that there is no inadvertent contamination. Any offsite releases from the
40 onsite sewage treatment plants are conducted under NPDES permits. Most plants also collect
41 and test the stormwater runoff from their sites before discharging it offsite.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40

3.11.5 Pollution Prevention and Waste Minimization

Waste minimization and pollution prevention are important elements of operations at all nuclear power plants. The licensees are required to consider pollution prevention measures as dictated by the Pollution Prevention Act (Public Law 101-508) and RCRA (PL 94-580).

In addition, licensees have waste minimization programs in place that are aimed at minimizing the quantities of waste sent offsite for treatment or disposal. Waste minimization techniques employed by the licensees may include (1) source reduction, which includes (a) changes in input materials (e.g., using materials that are not hazardous or are less hazardous), (b) changes in technology, and (c) changes in operating practices; and (2) recycling of materials either onsite or offsite. For example, the licensees tend to reuse lead shielding components onsite until they have no further use for them. The establishment of a waste minimization program is also a requirement for managing hazardous wastes under RCRA.

3.12 References

10 CFR Part 20. *Code of Federal Regulations*, Title 10, *Energy*, Part 20, “Standards for Protection Against Radiation.”

10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, “Domestic Licensing of Production and Utilization Facilities.”

10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental Protection Regulations for Domestic Licensing and Related Regulatory Functions.”

10 CFR Part 61. *Code of Federal Regulations*, Title 10, *Energy*, Part 61, “Licensing Requirements for Land Disposal of Radioactive Waste.”

10 CFR Part 71. *Code of Federal Regulations*, Title 10, *Energy*, Part 71, “Packaging and Transportation of Radioactive Material.”

10 CFR Part 72. *Code of Federal Regulations*, Title 10, *Energy*, Part 72, “Licensing Requirements for the Independent Storage of Spent Nuclear Fuel, High-Level Radioactive Waste, and Reactor-Related Greater than Class C Waste.”

24 CFR Part 51. *Code of Federal Regulations*, Title 24, *Housing and Urban Development*, Part 51, “Environmental Criteria and Standards.”

- 1
2 36 CFR Part 60. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
3 Part 60, "National Register of Historic Places."
4
5 36 CFR Part 800. *Code of Federal Regulations*, Title 36, *Parks, Forests, and Public Property*,
6 Part 800, "Protection of Historic Properties."
7
8 40 CFR Part 50. *Code of Federal Regulations*, Title 40, *Protection of the Environment*, Part 50,
9 "National Primary and Secondary Ambient Air Quality Standards."
10
11 40 CFR Part 61. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 61,
12 "National Emission Standards for Hazardous Air Pollutants."
13
14 40 CFR Part 125. *Code of Federal Regulations*, Title 40, *Protection of the Environment*,
15 Part 125, "Criteria and Standards for the National Pollutant Discharge Elimination System."
16
17 40 CFR Part 190. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 190,
18 "Environmental Radiation Protection Standards for Nuclear Power Operations."
19
20 40 CFR Part 261. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 261,
21 "Identification and Listing of Hazardous Waste."
22
23 40 CFR Part 273. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 273,
24 "Standards for Universal Waste Management."
25
26 49 CFR Part 171. *Code of Federal Regulations*, Title 49, *Transportation*, Part 171, "General
27 Information, Regulations, and Definitions."
28
29 49 CFR Part 172. *Code of Federal Regulations*, Title 49, *Transportation*, Part 172, "Hazardous
30 Materials Table, Special Provisions, Hazardous Materials Communications, Energy Response
31 Information, and Training Requirements."
32
33 49 CFR Part 173. *Code of Federal Regulations*, Title 49, *Transportation*, Part 173, "Shippers
34 General Requirements for Shipments and Packagings."
35
36 49 CFR Part 174. *Code of Federal Regulations*, Title 49, *Transportation*, Part 174, "Carriage by
37 Rail."
38
39 49 CFR Part 175. *Code of Federal Regulations*, Title 49, *Transportation*, Part 175, "Carriage by
40 Aircraft."
41

Affected Environment

- 1 49 CFR Part 176. *Code of Federal Regulations*, Title 49, *Transportation*, Part 176, “Carriage by
2 Vessel.”
3
- 4 49 CFR Part 177. *Code of Federal Regulations*, Title 49, *Transportation*, Part 177, “Carriage by
5 Public Highway.”
6
- 7 Advisory Committee on the Biological Effects of Ionizing Radiation (BEIR). 2006. *Health Risks
8 from Exposure to Low Levels of Ionizing Radiation*. BEIR-VII, National Research Council,
9 National Academy of Sciences, Washington, D.C.
- 10
- 11 American Cancer Society (ACS). 2001. *Cancer Facts and Figures*. Available URL:
12 <http://www.cancer.org/statistics/cff98/environmental.html> (Accessed October 4, 2007).
13
- 14 Armantrout, N.B. (compiler). 1998. *Glossary of Aquatic Habitat Inventory Terminology*.
15 American Fisheries Society, Bethesda, Maryland.
- 16
- 17 Armour, C.L. 1991. *Guidance for Evaluating and Recommending Temperature Regimes to
18 Protect Fish*. Biological Report 90(22). U.S. Fish and Wildlife Service, Washington, D.C.
19 (December).
20
- 21 Atomic Energy Act of 1954, as amended. 42 USC 2011 et seq.
- 22
- 23 Batty, R.S., and J.H.S. Blaxter. 1992. “The Effect of Temperature on the Burst Swimming
24 Performance of Fish Larvae.” *Journal of Experimental Biology* 170:187–201.
25
- 26 Beeton, A.M. 2002. “Large Freshwater Lakes: Present State, Trends, and Future.”
27 *Environmental Conservation* 29(1):21-38.
28
- 29 Beitinger, T.L., W.A. Bennett, and R.W. McCauley. 2000. “Temperature Tolerances of North
30 American Freshwater Fishes Exposed to Dynamic Changes in Temperature.” *Environmental
31 Biology of Fishes* 58:237–275.
32
- 33 Berk, S.G., J.H. Gunderson, A.L. Newsome, A.L. Farone, B.J. Hayes, K.S. Redding, N. Uddin,
34 E.L. Williams, R.A. Johnson, M. Farsian, A. Reid, J. Skimmyhorn, and M.B. Farone. 2006.
35 “Occurrence of Infected Amoebae in Cooling Towers Compared with Natural Aquatic
36 Environments: Implications for Emerging Pathogens.” *Environmental Science and Technology*
37 40(23):7440–7444.
38
- 39 Boice Jr., J.D., M.T. Mumma, W.J. Blot, and C.W. Heath Jr. 2005. “Childhood Cancer
40 Mortality in Relation to St. Lucie Nuclear Power Plant.” *Journal of Radiological
41 Protection* 25:229–240.

- 1
2 Bonneville Power Administration (BPA). 1998. *Living and Working Safely Around High-Voltage*
3 *Power Lines*. DOE/BP-1821, U.S. Department of Energy. (January).
4
- 5 Bonneville Power Administration (BPA). 2000. *Transmission System Vegetation Management*
6 *Program Final Environmental Impact Statement*. DOE/EIS-0285, U.S. Department of Energy,
7 Portland, Oregon. (May).
8
- 9 Burrows, S., and D.A. Hagemeyer. 2006. *Occupational Radiation Exposure at Commercial*
10 *Nuclear Power Reactors and Other Facilities 2005*. NUREG-0713, U.S. Nuclear Regulatory
11 Commission. (December).
12
- 13 Centers for Disease Control and Prevention (CDC). 2005. *Legionellosis: Legionnaires' Disease*
14 *(LD) and Pontiac Fever*. Atlanta, Georgia. Available URL: [http://www.cdc.gov/ncidod/](http://www.cdc.gov/ncidod/dbmd/diseaseinfo/legionellosis_g.htm)
15 [dbmd/diseaseinfo/legionellosis_g.htm](http://www.cdc.gov/ncidod/dbmd/diseaseinfo/legionellosis_g.htm) (Accessed September 7, 2007).
16
- 17 Centers for Disease Control and Prevention (CDC). 2007. *Salmonellosis*. Atlanta, Georgia.
18 Available URL: http://www.cdc.gov/ncidod/dbmd/diseaseinfo/salmonellosis_g.htm (Accessed
19 September 10, 2007).
20
- 21 Christensen, S.W, J.A. Solomon, S.B. Gough, R.L. Tyndall, and C.B. Fliermans. 1983.
22 *Legionnaire's Disease Bacterium in Power Plant Cooling Systems: Phase I Final Report*.
23 EPRI/EA-3153, Electric Power Research Institute, Palo Alto, California.
24
- 25 Claireaux, G., C. Couturier, and A.-L. Groison. 2006. "Effect of Temperature on Maximum
26 Swimming Speed and Cost of Transport in Juvenile European Sea Bass (*Dicentrarchus*
27 *labrax*).” *Journal of Experimental Biology* 209:3420–3428.
28
- 29 Clean Air Act (CAA). 1970. 42 USC 7401 et seq.
30
- 31 Clean Water Act (CWA). 33 USC 1251 et seq.
32
- 33 Coastal Zone Management Act. 1972. 16 USC 1456.
34
- 35 Comprehensive Environmental Response, Compensation and Liabilities Act (CERCLA).
36 42 USC 9601 et seq (1980).
37
- 38 Council on Environmental Quality (CEQ). 1997a. *Environmental Justice: Guidance Under the*
39 *National Environmental Policy Act*. Executive Office of the President, Washington, D.C.
40
- 41 Council on Environmental Quality (CEQ). 1997b. 40 CFR 1500–1508.

Affected Environment

- 1
2 Cowardin, L., V. Carter, F. Golet, and E. LaRoe. 1979. *Classification of Wetlands and*
3 *Deepwater Habitats of the United States*. FWS/OBS-79/31, Office of Biological Services,
4 U.S. Fish and Wildlife Service, U.S. Department of the Interior.
5
6 Crooks, K.R., and M.E. Soule. 1999. "Mesopredator Release and Avifaunal Extinctions in a
7 Fragmented System." *Nature* 400:563–566.
8
9 D'Amore, S.C. 1985. "Digital Analytical Method for Calculating Corona Noise on HVC Power
10 Line, Carrier Communication Channels." *IEEE Transactions on Power Apparatus and Systems*,
11 Vol. PAS-104 (5):1018–1024.
12
13 Deacon, J. 2003. *The Microbial World: Thermophilic Microorganisms*. The University of
14 Edinburgh, Institute of Cell and Molecular Biology, Edinburgh, United Kingdom. Available URL:
15 <http://helios.bto.ed.ac.uk/bto/microbes/thermo.htm> (Accessed September 7, 2007).
16
17 Dermott, R., and D. Kerec. 1997. "Changes to the Deepwater Benthos of Eastern Lake Erie
18 since the Invasion of *Dreissena*: 1979–1993." *Canadian Journal of Fisheries and Aquatic*
19 *Sciences* 54:922–930.
20
21 Edsall, T., and M. Charlton. 1997. *Nearshore waters of the Great Lakes*. Published by
22 U.S. Environmental Protection Agency and Environment Canada. Available URL:
23 <http://www.on.ec.gc.ca/solec/nearshore-water/paper/part5.html>.
24
25 Electric Power Research Institute (EPRI). 1982. *Transmission Line Reference Book: 345 kV*
26 *and Above*. Second Edition, Palo Alto, California.
27
28 Ellingson, E.F. 1979. *Transformer Noise Abatement Tuned Using Tuned Sound Enclosure*
29 *Panels*. Institute of Electrical and Electronics Engineers.
30
31 Endangered Species Act of 1973. 16 USC 1531–1544.
32
33 Evans, D.R., and J.E. Gates. 1997. "Cowbird Selection of Breeding Areas: The Role of Habitat
34 and Bird Species Abundance." *Wilson Bulletin* 109:470–480.
35
36 Executive Order 11988. 1977. *Floodplain Management*. 42 FR 26951. (May 24).
37
38 Executive Order 11990. 1977. *Protection of Wetlands*. 42 FR 26961. (May 24).
39
40 Executive Order 12898. 1994. *Federal Actions to Address Environmental Justice in Minority*
41 *Populations and Low-Income Populations*. 59 FR 7629. (February 16).

- 1
2 Federal Insecticide, Fungicide, and Rodenticide Act (FIFRA). 1996. 7 USC 135 et seq.
3
4 Federal Interagency Committee on Noise (FICN). 1992. *Federal Agency Review of Selected*
5 *Airport Noise Analysis Issues*. Technical Report, Vol. 2. (August).
6
7 Florida Department of Health (FDOH). 2001. *Report Concerning Cancer Rate in Southeastern*
8 *Florida*. Bureau of Environmental Epidemiology, Division of Environmental Health, Tallahassee,
9 Fla. (July 17).
10
11 Frankel, A.D., M.D. Petersen, C.S. Mueller, K.M. Haller, R.L. Wheeler, E.V. Leyendecker,
12 R.L. Wesson, S.C. Harmsen, C.H. Cramer, D.M. Perkins, and K.S. Rukstales. 2005. *Scientific*
13 *Investigations Map 2883, Seismic-Hazard Maps for the Conterminous United States*.
14 U.S. Geological Survey. Available URL: <http://pubs.usgs.gov/sim/2005/2883/> (Accessed
15 October 3, 2007).
16
17 Fremling, C., and B. Drazkowski. 2000. *Ecological, Institutional, and Economic History of the*
18 *Upper Mississippi River*. Upper Mississippi Basin Stakeholders Network, Winona, Minnesota.
19 Available URL: http://www.umbsn.org/news/documents/UMR_Ecological_History.htm
20 (Accessed February 21, 2003).
21
22 Giusti, E.V., and E.L. Meyer. 1977. *Water Consumption by Nuclear Powerplants and Some*
23 *Hydrological Implications*. Circular 745, U.S. Geological Survey, Washington, D.C.
24
25 Gould, J.M., E.J. Sternglass, J.D. Sherman, J. Brown, W. McDonnell, and J.J. Mangano. 2000.
26 "Strontium-90 in Deciduous Teeth as a Factor in Early Childhood Cancer." *International Journal*
27 *of Health Services* 30:519–539.
28
29 Gulf States Marine Fisheries Commission (GSMFC). 2005. *Corbicula fluminea (Muller, 1774)*.
30 Ocean Springs, Mississippi. Available URL: [http://nis.gsmfc.org/nis_factsheet.php?](http://nis.gsmfc.org/nis_factsheet.php?toc_id=128)
31 [toc_id=128](http://nis.gsmfc.org/nis_factsheet.php?toc_id=128) (Accessed February 5, 2008).
32
33 Hall, C.A.S., R. Howarth, B. Moore, III, and C.J. Vörösmarty. 1978. "Environmental Impacts of
34 Industrial Energy Systems in the Coastal Zone." *Annual Review of Energy* 3:395–475.
35
36 Hallenbeck, W.H., and G.R. Brenniman. 1989. "Risk of Fatal Amoebic Meningoencephalitis
37 from Waterborne *Naegleria fowleri*." *Environmental Management* 13(2):227–232.
38
39 Harlow, J.H. 2003. *Electric Power Transformer Engineering*. Electric Power Engineering
40 Series, Vol. 11, Harlow Engineering Associates, Mentone, Alabama.
41

Affected Environment

- 1 Harrison, F.L. 1985. "Effect of Physiochemical Form on Copper Availability to Aquatic
2 Organisms." Pages 469–484 in R.D. Cardwell et al., eds., *Seventh Symposium on Aquatic*
3 *Toxicology and Hazard Assessment*. ASTM STP 854, American Society for Testing and
4 Materials, Philadelphia, Pennsylvania.
5
- 6 *Huntsville Times*. 2007. "Hot Weather Forces Partial Shutdown of Alabama Nuclear Plant."
7 Posted by Associated Press. (August 17). Available URL: [http://blog.al.com/breaking/2007/](http://blog.al.com/breaking/2007/08/hot_weather_forces_partial_shu.html)
8 [08/hot_weather_forces_partial_shu.html](http://blog.al.com/breaking/2007/08/hot_weather_forces_partial_shu.html) (Accessed November 11, 2007).
9
- 10 Illinois Department of Public Health (IDPH). 2000. *Health and Hazardous Substances Registry*
11 *Newsletter*. Division of Epidemiologic Studies, Springfield, Illinois. (January).
12
- 13 Illinois Department of Public Health (IDPH). 2006. *Pediatric Cancer Incidence and Mortality in*
14 *the Vicinity of Nuclear Power Plants in Illinois*. Division of Epidemiologic Studies, Springfield,
15 Illinois. (January).
16
- 17 Indian Point Energy Center (Indian Point). 2005. *Annual Radioactive Effluent Release Report*.
18
- 19 Institute of Electrical and Electronic Engineers, Inc. (IEEE). 2007. *National Electrical Safety*
20 *Code*. C2-2007, New York, New York.
21
- 22 International Commission on Radiological Protection (ICRP). 1977. *Recommendations of the*
23 *International Commission on Radiological Protection*. Publication 26. Pergamon Press, Oxford,
24 U.K.
25
- 26 International Commission on Radiological Protection (ICRP). 1991. *1990 Recommendations of*
27 *the International Commission on Radiological Protection*. ICRP Publication 60. Pergamon
28 Press, Oxford, United Kingdom.
29
- 30 Iowa Department of Natural Resources (IDNR). Undated. *Zebra Mussel Dreissena*
31 *polymorpha*. Des Moines, Iowa. Available URL: [http://www.iowadnr.com/fish/news/exotics/](http://www.iowadnr.com/fish/news/exotics/zebra.html)
32 [zebra.html](http://www.iowadnr.com/fish/news/exotics/zebra.html) (Accessed February 5, 2008).
33
- 34 Jones, T.S., and R.I. McLean. 2005. *Environmental Radionuclide Concentrations in the Vicinity*
35 *of the Calvert Cliffs Nuclear Power Plant and Peach Bottom Atomic Power Station: 2002–03*.
36 PPRP-R-29, Maryland Department of Natural Resources, Maryland Power Plant Research
37 Program, Annapolis, Maryland. (December). Available URL:
38 http://esm.versar.com/PPRP/bibliography/PPRP_R_29/PPRP_R_29.pdf (Accessed
39 November 28, 2007).
40

- 1 Kendall, P. 2007. *Bacterial Food-Borne Illness*. Fact Sheet No. 9.300. Cooperative Extension,
2 Colorado State University, Fort Collins, Colorado. Available URL: [http://www.ext.
3 colostate.edu/pubs/foodnut/09300.html](http://www.ext.colostate.edu/pubs/foodnut/09300.html) (Accessed September 7, 2007).
4
- 5 Lagler, K.F., J.E. Bardach, and R.R. Miller. 1962. *Ichthyology*. John Wiley & Sons, Inc.,
6 New York, New York.
7
- 8 Laist, D.L., and J.E. Reynolds, III. 2005. "Influence of Power Plants and Other Warm-Water
9 Refuges on Florida Manatees." *Marine Mammal Science* 21(4):739–764.
10
- 11 Lane, J.A., C.B. Portt, and C.K. Minns. 1996. "Nursery Habitat Characteristics of Great Lake
12 Fishes." *Canadian Manuscript Report of Fisheries and Aquatic Sciences* 2338.
13
- 14 Low-Level Radioactive Waste Policy Act (LLRWPA). 1980. 42 USC 2021 et seq.
15
- 16 Low-Level Radioactive Waste Policy Amendments Act (LLWPAA). 1985.
17 42 USC 2021b et seq.
18
- 19 Magnuson, J.J., L.B. Crowder, and P.A. Medvick. 1979. "Temperature as an Ecological
20 Resource." *American Zoologist* 19(1):331–343. (abstract)
21
- 22 Magnuson-Stevens Fishery Conservation and Management Act (MSFCMA). 1976.
23 16 USC 1801–1884.
24
- 25 Mangano, J.J., J.M. Gould, E.J. Sternglass, J.D. Sherman, and W. McDonnell. 2003. "An
26 Unexpected Rise in Strontium-90 in U.S. Deciduous Teeth in the 1990s." *The Science of the
27 Total Environment* 317(1-3):37–51. (December 30).
28
- 29 Manville, A.M. 2005. "Bird Strikes and Electrocutions at Power Lines, Communication Towers,
30 and Wind Turbines: State of the Art and State of the Science – Next Steps Toward Mitigation."
31 In *Bird Conservation Implementation in the Americas: Proceedings 3rd International Partners in
32 Flight Conference 2002*, C.J. Ralph and T.D. Rich, Editors. USDA Forest Service General
33 Technical Report PSW-GTR-191, Pacific Southwest Research Station, Albany, California.
34
- 35 Maricopa County Air Quality Department (MCAQD). 2006. *Periodic Emissions Inventory for
36 PM₁₀, 2002, Maricopa County, Arizona, Nonattainment Area*. Available URL:
37 http://www.maricopa.gov/airquality/divisions/planning_analysis/docs/02PM-EI-revised.pdf. (Accessed
38 November 25, 2008).
39
- 40 Marine Mammal Protection Act (MMPA). 1972. 16 USC 1361–1421h.
41

Affected Environment

- 1 Maruvada, S. 2000. *Corona Performance of High-Voltage Transmission Lines*. Research
2 Studies Press Ltd., Philadelphia, Pennsylvania.
3
- 4 McLean, R., W.A. Richkus, S.P. Schreiner, and D. Fluke. 2002. *Maryland Power Plant Cooling*
5 *Water Intake Regulations and Their Application in Evaluation of Adverse Environmental Impact*.
6 PPRP-R-127, Maryland Department of Natural Resources, Maryland Power Plant Research
7 Program, Annapolis, Maryland. (March). Available URL: [http://esm.versar.com/PPRP/](http://esm.versar.com/PPRP/316/PPRP-127.pdf)
8 [316/PPRP-127.pdf](http://esm.versar.com/PPRP/316/PPRP-127.pdf) (Accessed November 28, 2007).
9
- 10 Metz, W. (editor). 1983. *Population and Land Use Change in the Vicinity of Operating Nuclear*
11 *Power Station – An Anthology*. Prepared for U.S. Nuclear Regulatory Commission, Office of
12 Regulatory Research, Division of Health, Siting, and Waste Management, by Brookhaven
13 National Laboratory, Upton, Long Island, New York. (April).
14
- 15 Morgan, D.E., M. Keser, J.T. Swenarton, and J.F. Foertch. 2003. “Population Dynamics of the
16 Asiatic Clam, *Corbicula fluminea* (Müller) in the Lower Connecticut River: Establishing a
17 Foothold in New England.” *Journal of Shellfish Research* 22(1):193–203.
18
- 19 Morrow, J. V., and J.C. Fischenich. 2000. *Habitat Requirements for Freshwater Fishes*.
20 EMRRP Technical Notes Collection, ERDC TN-EMRRPSR-06, U.S. Army Engineer Research
21 and Development Center, Vicksburg, Mississippi. (May). Available URL:
22 <http://el.erd.c.usace.army.mil/elpubs/pdf/sr06.pdf> (Accessed November 12, 2007).
23
- 24 Murdy, E.O., R.S. Birdsong, and J.A. Musick. 1997. *Fishes of Chesapeake Bay*. Smithsonian
25 Institution Press, Washington, D.C.
26
- 27 National Cancer Institute. 1990. *Cancer in Populations Living near Nuclear Facilities*.
28 Bethesda, Maryland.
29
- 30 National Council on Radiation Protection and Measurement (NCRP). 1987. *Radiation*
31 *Exposure of the U.S. Population from Consumer Products and Miscellaneous Sources*. NCRP
32 Report 95. Bethesda, Maryland. (December 30).
33
- 34 National Environmental Policy Act of 1969 (NEPA). 42 USC 4321 et seq.
35
- 36 National Historic Preservation Act of 1966, as amended (NHPA). 16 USC 470aa et seq.
37
- 38 National Marine Fisheries Service (NMFS). 2002. “Small Takes of Marine Mammals Incidental
39 to Specified Activities; Taking of Marine Mammals Incidental to Power Plant Operations.”
40 *Federal Register* 67(1):61–62. (January 2).
41

1 National Oceanic and Atmospheric Administration (NOAA). 2007. *Tornado Climatology*.
 2 Available URL: <http://www.ncdc.noaa.gov/oa/climate/severeweather/tornadoes.html> (Accessed
 3 October 3, 2007).
 4
 5 New Jersey Department of Environmental Protection (NJDEP). 1998. "Control and Prohibition
 6 of Particles from Manufacturing Processes." *New Jersey Administrative Code*, Title 7,
 7 Chapter 27, Subchapter 6.
 8
 9 New Jersey Department of Environmental Protection (NJDEP). 2007. *Hope Creek Air*
 10 *Operating Permit*, Title V, Permit No. BOP05003, FID 65500.
 11
 12 Nuclear Energy Institute (NEI). 2003. *Economic Benefits of Millstone Power Station: An*
 13 *Economic Impact Study by the Nuclear Energy Institute*. (July).
 14
 15 Nuclear Energy Institute (NEI). 2004a. *Economic Benefits of Diablo Canyon Power Plant: An*
 16 *Economic Impact Study by the Nuclear Energy Institute in Cooperation with Pacific Gas &*
 17 *Electric Company*. (February).
 18
 19 Nuclear Energy Institute (NEI). 2004b. *Economic Benefits of Indian Point Energy Center: An*
 20 *Economic Impact Study by the Nuclear Energy Institute*. (April).
 21
 22 Nuclear Energy Institute (NEI). 2004c. *Economic Benefits of the Duke Power-Operated*
 23 *Nuclear Power Plants: An Economic Impact Study by the Nuclear Energy Institute*.
 24 (December).
 25
 26 Nuclear Energy Institute (NEI). 2004d. *Economic Benefits of Palo Verde Nuclear Generating*
 27 *Station: An Economic Impact Study by the Nuclear Energy Institute*. (November).
 28
 29 Nuclear Energy Institute (NEI). 2005a. *Economic Benefits of Three Mile Island Unit 1: An*
 30 *Economic Impact Study by the Nuclear Energy Institute*. (November).
 31
 32 Nuclear Energy Institute (NEI). 2005b. *Economic Benefits of Wolf Creek Generating Station:*
 33 *An Economic Impact Study by the Nuclear Energy Institute*. (July).
 34
 35 Nuclear Energy Institute (NEI). 2006a. *Economic Benefits of Grand Gulf Nuclear Station: An*
 36 *Economic Impact Study by the Nuclear Energy Institute in Cooperation with Entergy*.
 37 (December).
 38
 39 Nuclear Energy Institute (NEI). 2006b. *Economic Benefits of the Exelon Pennsylvania Nuclear*
 40 *Fleet: An Economic Impact Study by the Nuclear Energy Institute*. (August).
 41

Affected Environment

- 1 Nuclear Energy Institute (NEI). 2006c. *Economic Benefits of PPL Susquehanna Nuclear Power*
2 *Plant: An Economic Impact Study by the Nuclear Energy Institute in Cooperation with PPL*
3 *Corporation*. (November).
4
- 5 Nuclear Energy Institute (NEI). 2007a. *Industry Ground Water Protection Initiative – Final*
6 *Guidance Document*. NEI 07-07 [Final], Washington D.C. (August). Available URL:
7 [http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=072670589)
8 [=072670589](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=072670589) (Accessed November 5, 2007).
9
- 10 Nuclear Energy Institute (NEI). 2007b. *Disposal of Low-Level Radioactive Waste*.
11 Washington, D.C. (April). Available URL: [http://www.nei.org/keyissues/nuclearwastedisposal/](http://www.nei.org/keyissues/nuclearwastedisposal/lowlevelradioactivewaste/)
12 [lowlevelradioactivewaste/](http://www.nei.org/keyissues/nuclearwastedisposal/lowlevelradioactivewaste/) (Accessed October 24, 2007).
13
- 14 Nuclear Information and Resource Service. 2007. *Rising Temperatures Undermine Nuclear*
15 *Power’s Promise*. Available URL: [http://www.nirs.org/climate/background/ucsrisingtemps](http://www.nirs.org/climate/background/ucsrisingtemps82307.pdf)
16 [82307.pdf](http://www.nirs.org/climate/background/ucsrisingtemps82307.pdf) (Accessed November 11, 2007).
17
- 18 Nuclear Waste Policy Act (NWPA). 1982. 42 USC 10101 et seq.
19
- 20 Nuclear Waste Policy Amendments Act of 1987. 1987. PL 100-203. 42 USC 10261 et seq.
21
- 22 Occupational Safety and Health Act. 1970. 29 USC 651, et seq.
23
- 24 Patty, S.S., and D. Hill. 2006. *Status Report on Investigations of Potential Human Health*
25 *Effects Associated with Power Frequency Electric and Magnetic Fields (EMF)*. DNR 12-
26 1232007-183, PPSE-T-44. Prepared for Public Service Commission of Maryland. (October).
27
- 28 Pennak, R.W. 1953. *Fresh-water Invertebrates of the United States*. The Ronald Press
29 Company, New York, New York.
30
- 31 Pollution Prevention Act. 1990. 42 USC 13101 et seq.
32
- 33 Pruppacher, H.R., and J.D. Klett. 1980. *Microphysics of Clouds and Precipitation*. D. Reidel
34 Publishing Company, Dordrecht, Holland.
35
- 36 Resource Conservation and Recovery Act (RCRA). 1976. 42 USC 6901 et seq.
37
- 38 Roosenburg, W.H. 1969. “Greening and Copper Accumulation in the American Oyster,
39 *Crassostrea virginica*, in the Vicinity of a Steam Electric Generating Station.” *Chesapeake*
40 *Science* 10:41–252.
41

1 Sackschewsky, M.R. 1997. *Threatened and Endangered Species Evaluation for 75 Licensed*
2 *Commercial Nuclear Power Generating Plants*. Pacific Northwest National Laboratory,
3 Richland, Washington.
4
5 Sackschewsky, M.R. 2004. *Threatened and Endangered Species Evaluation for Operating*
6 *Commercial Nuclear Power Generating Plants*. PNNL-14468, prepared by Pacific Northwest
7 National Laboratory for the U.S. Nuclear Regulatory Commission and U.S. Department of
8 Energy.
9
10 Safe Drinking Water Act (SDWA). 1974. 42 USC 300F et seq.
11
12 *Science News*. 1998. "Something's Bugging Nuclear Fuel." 153(21):325. (May 23).
13
14 Southern California Edison. 2007. "Power Generation - San Onofre Nuclear Generating
15 Station." Available URL: [http://www.sce.com/PowerandEnvironment/PowerGeneration/
16 SanOnofreNuclearGeneratingStation/PublicSafety.htm](http://www.sce.com/PowerandEnvironment/PowerGeneration/SanOnofreNuclearGeneratingStation/PublicSafety.htm) (Accessed November 7, 2007).
17
18 Sprecher, S.L., and K.D. Getsinger. 2000. *Zebra Mussel Chemical Control Guide*. ERDC/EL
19 TR-00-1. U.S. Army Corps of Engineers, Engineer Research and Development Center,
20 Vicksburg, Mississippi. (January).
21
22 System Energy Resources, Inc. 2005. Early Site Permit Application for the Grand Gulf Nuclear
23 Station Site, Part 3, Environmental Report Section 2.0, revision 2. Available URL: [http://adams
24 websearch2.nrc.gov/idmws/ViewDocByAccession.asp?AccessionNumber=ML052780449](http://adamswebsearch2.nrc.gov/idmws/ViewDocByAccession.asp?AccessionNumber=ML052780449)
25 (Accessed October 17, 2007).
26
27 Texas Tech University (TTU). 2006. *A Recommendation for an Enhanced Fujita Scale*.
28 Submitted to the National Weather Service and Other Interested Users by TTU Wind Science
29 and Engineering Center, Lubbock, Texas. (January 26).
30
31 Todar, K. 2004. "Pseudomonas aeruginosa." In *Todar's Online Textbook of Bacteriology*.
32 University of Wisconsin-Madison, Department of Bacteriology, Madison, Wisconsin. Available
33 URL: <http://textbookofbacteriology.net/pseudomonas.html> (Accessed September 7, 2007).
34
35 Toxic Substances Control Act (TSCA). 1976. 15 USC 2601 et seq.
36
37 Tyndall, R.L. 1981. *Presence of Pathogenic Micro-Organisms in Power Plant Cooling Waters,*
38 *Report for October 1, 1979 to September 30, 1981*. NUREG/CR-2980 (ORNL/TM-8523),
39 Oak Ridge National Laboratory, Oak Ridge, Tennessee.
40

Affected Environment

- 1 Tyndall, R.L. 1983. *Presence of Pathogenic Microorganisms in Power Plant Cooling Waters: Final Report for October 1, 1981, to June 30, 1983*. NUREG/CR-3364 (ORNL/TM-8809),
2 Oak Ridge National Laboratory, Oak Ridge, Tennessee.
3
4
- 5 Tyndall, R.L., S.W. Christensen, and J.A. Solomon. 1985. *Legionnaires' Disease Bacteria in Power Plant Cooling Systems: Phase II Final Report*. EPRI/EA-4017, Electric Power Research
6 Institute, Palo Alto, California.
7
8
- 9 Tyndall, R.L., K.S. Ironside, P.L. Metler, E.L. Tan, T.C. Hazen, and C.B. Fliermans. 1989.
10 "Effect of Thermal Additions on the Density and Distribution of Thermophilic Amoebae and
11 Pathogenic Naegleria fowleri in a Newly Created Cooling Lake." *Applied and Environmental
12 Microbiology* 55(3):722–732.
13
- 14 U.S. Atomic Energy Commission (AEC). 1973. *Final Environmental Statement Related to the
15 Nuclear Generating Station Diablo Canyon Units 1 & 2*. (May).
16
- 17 U.S. Atomic Energy Commission (AEC). 1974. *Final Environmental Statement Related to the
18 Operation of Oyster Creek Nuclear Generating Station*. Jersey Central Power and Light
19 Company. (December).
20
- 21 U.S. Bureau of Labor Statistics (BLS). 2005a. *Fatal Occupational Injuries by Event or
22 Exposure, All United States, 2005*. U.S. Department of Labor, Washington, D.C. Available
23 URL: <http://www.bls.gov/iif/oshwc/foi/cfch0005.pdf> (Accessed October 14, 2007).
24
- 25 U.S. Bureau of Labor Statistics (BLS). 2005b. *2005 News Release, National Census of Fatal
26 Occupational Injuries in 2005*. USDL-06-1364, U.S. Department of Labor, Washington, D.C.
27 Available URL: <http://www.bls.gov/iif/oshwc/foi/cfnr0012.pdf> (Accessed October 14, 2007).
28
- 29 U.S. Bureau of Labor Statistics (BLS). 2005c. *Incidence Rates of Nonfatal Occupational
30 Injuries and Illnesses by Industry and Case Types, 2005*. U.S. Department of Labor,
31 Washington, D.C. Available URL: <http://www.bls.gov/iif/oshwc/osh/os/ostb1619.pdf> (Accessed
32 October 14, 2007).
33
- 34 U.S. Census Bureau (USCB). 2005. *Glossary, Definitions and Explanations of Terms,
35 Decennial Census Terms*. Available URL: <http://www.census.gov/main/www/glossary.html>
36 (Accessed September 15, 2007).
37
- 38 U.S. Census Bureau (USCB). 2007. *Current Population Reports*. Series P60, Washington,
39 D.C. Available URL: <http://www.census.gov/main/www/cprs.html> (Accessed September 2007).
40

1 U.S. Department of Agriculture (USDA). 2001. *Acres of Prime Farmland, 1997: National*
 2 *Resources Conservation Service Map m4983*. Available URL: [http://www.nrcs.usda.gov/](http://www.nrcs.usda.gov/technical/land/meta/m4983.html)
 3 [technical/land/meta/m4983.html](http://www.nrcs.usda.gov/technical/land/meta/m4983.html) (Accessed October 8, 2007).
 4

5 U.S. Department of Energy (DOE). 2002. *A Graded Approach to Evaluating Radiation Doses*
 6 *to Aquatic and Terrestrial Biota*. DOE-STD-1153-2002, Washington, D.C. (July 2002).
 7

8 U.S. Department of Energy (DOE). 2007. *Notice of Intent to Prepare an Environmental Impact*
 9 *Statement for the Disposal of Greater-Than-Class C Low-Level Radioactive Waste*. Office of
 10 Environmental Management, Washington, D.C. (see 72 FR 40135). Available URL:
 11 <http://www.gtccceis.anl.gov/> (Accessed October 19, 2007).
 12

13 U.S. Environmental Protection Agency (EPA). 1974. *Information on Levels of Environmental*
 14 *Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety*.
 15 EPA-550/9-74-004, Washington, D.C. Available URL: [http://www.nonoise.org/library/levels74/](http://www.nonoise.org/library/levels74/levels74.htm)
 16 [levels74.htm](http://www.nonoise.org/library/levels74/levels74.htm) (Accessed November 17, 2008).
 17

18 U.S. Environmental Protection Agency (EPA). 1996. *Protecting Natural Wetlands, A Guide to*
 19 *Stormwater Best Management Practices*. EPA-843-B-96-001, Office of Water (October).
 20

21 U.S. Environmental Protection Agency (EPA). 2002. *Case Study Analysis for the Proposed*
 22 *Section 316(b) Phase II Existing Facilities Rule*. EPA-821-R-02-002, Office of Science and
 23 Technology, Washington, D.C. (February).
 24

25 U.S. Environmental Protection Agency (EPA). 2007. *National Pollutant Discharge Elimination*
 26 *System — Suspension of Regulations Establishing Requirements for Cooling Water Intake*
 27 *Structures at Phase II Existing Facilities*. Available URL: [http://www.epa.gov/fedrgstr/](http://www.epa.gov/fedrgstr/EPA-WATER/2007/July/Day-09/w13202.htm)
 28 [EPA-WATER/2007/July/Day-09/w13202.htm](http://www.epa.gov/fedrgstr/EPA-WATER/2007/July/Day-09/w13202.htm) (Accessed October 17, 2007).
 29

30 U.S. Environmental Protection Agency (EPA). 2008. *National Ambient Air Quality Standards*
 31 *(NAAQS)*. Available URL: <http://www.epa.gov/air/criteria.html>, last updated March 28, 2008
 32 (Accessed August 2008).
 33

34 U.S. Fish and Wildlife Service (USFWS). 2007a. *National Wetlands Inventory*.
 35 U.S. Department of the Interior. Available URL: <http://wetlandsfws.er.usgs.gov/NWI/index.html>
 36 (Accessed November 7, 2007).
 37

38 U.S. Fish and Wildlife Service (USFWS). 2007b. *USFWS Threatened and Endangered*
 39 *Species System (TESS)*. Available URL: http://ecos.fws.gov/tess_public/StartTESS.do
 40 (Accessed November 20, 2007).
 41

Affected Environment

- 1 U.S. General Accounting Office (GAO). 2004. *Low-Level Radioactive Waste – Disposal*
2 *Availability Adequate in Short Term, but Oversight Needed to Identify Any Future Shortfalls.*
3 GAO-04-604, Washington, D.C. (June). Available URL: [http://www.gao.gov/new.items/](http://www.gao.gov/new.items/d04604.pdf)
4 [d04604.pdf](http://www.gao.gov/new.items/d04604.pdf) (Accessed October 24, 2007).
5
- 6 U.S. Geological Survey (USGS). 1999. *Ecological Status and trends of the Upper Mississippi*
7 *River System 1998: A Report of the Long Term Resource Monitoring Program.*
8 TRMP 99-T001, Upper Midwest Environmental Science center, La Crosse, Wisconsin.
9 Available URL: http://www.umesc.usgs.gov/reports_publications/status_and_trends.html
10 (Accessed November 28, 2007).
11
- 12 U.S. Geological Survey (USGS). 2007. *National Land Cover Database 2001 (NLCD 2001).*
13 Available URL: <http://www.mrlc.gov/nlcd.php> (Accessed September 5, 2007).
14
- 15 U.S. Nuclear Regulatory Commission (NRC). 1974. *Measuring, Evaluating, and Reporting*
16 *Radioactivity in Solid Wastes and Releases of Radioactive Materials in Liquid and Gaseous*
17 *Effluents from Light-Water-Cooled Nuclear Power Plants, Revision 1. Regulatory Guide 1.21.*
18 (June).
19
- 20 U.S. Nuclear Regulatory Commission (NRC). 1977. *Calculation of Annual Doses to Man from*
21 *Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR*
22 *Part 50, Appendix 1. Regulatory Guide 1.109, Office of Standards Development. (October).*
23
- 24 U.S. Nuclear Regulatory Commission (NRC). 1993. Vol. 14 in *Radioactive Materials Released*
25 *from Nuclear Power Plants. NUREG/CR-2907.*
26
- 27 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*
28 *for License Renewal of Nuclear Plants. NUREG-1437, Vols. 1 and 2, Office of Nuclear*
29 *Regulatory Research, Washington, D.C.*
30
- 31 U.S. Nuclear Regulatory Commission (NRC). 1999. *Generic Environmental Impact Statement*
32 *for License Renewal of Nuclear Plants, Supplement 1: Regarding the Calvert Cliffs Nuclear*
33 *Power Plant. NUREG-1437, Supplement 1, Office of Nuclear Reactor Regulation, Washington,*
34 *D.C. (October).*
35
- 36 U.S. Nuclear Regulatory Commission (NRC). 2002a. *Generic Environmental Impact Statement*
37 *for Decommissioning of Nuclear Facilities, Supplement 1: Regarding the Decommissioning of*
38 *Nuclear Power Reactors. NUREG-0586, Supplement 1, Washington, D.C.*
39

- 1 U.S. Nuclear Regulatory Commission (NRC). 2002b. *Generic Environmental Impact Statement*
 2 *for License Renewal of Nuclear Plants, Supplement 5: Regarding Turkey Point, Units 3 and 4.*
 3 NUREG-1437, Supplement 5, Office of Nuclear Reactor Regulation, Washington, D.C.
 4 (January).
 5
- 6 U.S. Nuclear Regulatory Commission (NRC). 2003a. *Generic Environmental Impact Statement*
 7 *for License Renewal of Nuclear Plants, Supplement 11: Regarding the St. Lucie Units 1 and 2.*
 8 NUREG-1437, Supplement 11, Washington, D.C., Office of Nuclear Reactor Regulation,
 9 Washington, D.C. (May).
 10
- 11 U.S. Nuclear Regulatory Commission (NRC). 2003b. *Generic Environmental Impact Statement*
 12 *for License Renewal of Nuclear Plants, Supplement 13: Regarding H.B. Robinson Steam*
 13 *Electric Plant, Unit No. 2.* NUREG-1437, Supplement 13, Office of Nuclear Reactor Regulation,
 14 Washington, D.C. (December).
 15
- 16 U.S. Nuclear Regulatory Commission (NRC). 2003c. *Generic Environmental Impact Statement*
 17 *for License Renewal of Nuclear Plants, Supplement 12: Regarding the Fort Calhoun Station,*
 18 *Unit 1.* NUREG-1437, Supplement 12, Office of Nuclear Reactor Regulation, Washington, D.C.
 19 (August).
 20
- 21 U.S. Nuclear Regulatory Commission (NRC). 2003d. *Generic Environmental Impact Statement*
 22 *for License Renewal of Nuclear Plants, Supplement 10: Regarding Peach Bottom Atomic*
 23 *Power Station, Units 2 and 3.* NUREG-1437, Supplement 10, Office of Nuclear Reactor
 24 Regulation, Washington, D.C. (January).
 25
- 26 U.S. Nuclear Regulatory Commission (NRC). 2004a. *Generic Environmental Impact Statement*
 27 *for License Renewal of Nuclear Plants, Supplement 17: Regarding Dresden Nuclear Power*
 28 *Station, Units 2 and 3.* NUREG-1437, Supplement 17, Office of Nuclear Reactor Regulation,
 29 Washington, D.C. (June).
 30
- 31 U.S. Nuclear Regulatory Commission (NRC). 2004b. *Generic Environmental Impact Statement*
 32 *for License Renewal of Nuclear Plants, Supplement 15: Regarding Virgil C.*
 33 *Summer Station.* NUREG-1437, Supplement 15, Office of Nuclear Reactor Regulation,
 34 Washington, D.C. (February).
 35
- 36 U.S. Nuclear Regulatory Commission (NRC). 2004c. *Generic Environmental Impact Statement*
 37 *for License Renewal of Nuclear Plants, Supplement 16: Regarding the Quad Cities Nuclear*
 38 *Power Station, Units 1 and 2.* NUREG-1437, Supplement 16, Office of Nuclear Reactor
 39 Regulation, Washington, D.C. (June).
 40

Affected Environment

- 1 U.S. Nuclear Regulatory Commission (NRC). 2005a. *Generic Environmental Impact Statement*
2 *for License Renewal of Nuclear Plants, Supplement 21: Regarding Browns Ferry Nuclear Plant,*
3 *Units 1, 2, and 3.* NUREG-1437, Supplement 21, Office of Nuclear Reactor Regulation,
4 Washington, D.C. (June).
5
- 6 U.S. Nuclear Regulatory Commission (NRC). 2005b. *Staff Review of the National Academies*
7 *Study of the Health Risks from Exposure to Low Levels of Ionizing Radiation (BEIR VII).*
8 Commission paper SECY-05-0202. ADAMS Accession Number ML052640532. (October 29).
9
- 10 U.S. Nuclear Regulatory Commission (NRC). 2006a. *Tornado Climatology of the Contiguous*
11 *United States.* NUREG/CR-4461, Rev. 2, Division of Risk Assessment and Special Projects,
12 Office of Nuclear Regulatory Research, Washington, D.C.
13
- 14 U.S. Nuclear Regulatory Commission (NRC). 2006b. *Generic Environmental Impact Statement*
15 *for License Renewal of Nuclear Plants, Supplement 27: Regarding Palisades Nuclear Plant.*
16 NUREG-1437, Supplement 27, Office of Nuclear Reactor Regulation, Washington, D.C.
17 (October).
18
- 19 U.S. Nuclear Regulatory Commission (NRC). 2006c. *Liquid Radioactive Release Lessons*
20 *Learned Task Force Final Report.* (September).
21
- 22 U.S. Nuclear Regulatory Commission (NRC). 2006d. *Generic Environmental Impact Statement*
23 *for License Renewal of Nuclear Plants, Supplement 24: Regarding Nine Mile Point Nuclear*
24 *Station, Units 1 and 2.* NUREG-1437, Supplement 24, Office of Nuclear Reactor Regulation,
25 Washington, D.C. (May).
26
- 27 U.S. Nuclear Regulatory Commission (NRC). 2006e. *Generic Environmental Impact Statement*
28 *for License Renewal of Nuclear Plants, Supplement 25: Regarding Brunswick Steam Electric*
29 *Plant, Units 1 and 2.* NUREG-1437, Supplement 25, Office of Nuclear Reactor Regulation,
30 Washington, D.C. (April).
31
- 32 U.S. Nuclear Regulatory Commission (NRC). 2006f. *Generic Environmental Impact Statement*
33 *for License Renewal of Nuclear Plants, Supplement 26: Regarding Monticello Nuclear*
34 *Generating Plant.* NUREG-1437, Supplement 26, Office of Nuclear Reactor Regulation,
35 Washington, D.C. (September).
36
- 37 U.S. Nuclear Regulatory Commission (NRC). 2007a. *2007–2008 Information Digest.* NUREG-
38 1350, Vol. 19, Washington, D.C. (August). Available URL: [http://www.nrc.gov/reading-rm/doc-](http://www.nrc.gov/reading-rm/doc-collection/nuregs/staff/sr1350/v19/sr1350v19.pdf)
39 [collection/nuregs/staff/sr1350/v19/sr1350v19.pdf](http://www.nrc.gov/reading-rm/doc-collection/nuregs/staff/sr1350/v19/sr1350v19.pdf) (Accessed November 8, 2007).
40

- 1 U.S. Nuclear Regulatory Commission (NRC). 2007b. *Meteorological Monitoring Programs for*
2 *Nuclear Power Plants*. Regulatory Guide 1.23, Rev. 1. (March).
3
- 4 U.S. Nuclear Regulatory Commission (NRC). 2007c. *Generic Environmental Impact Statement*
5 *for License Renewal of Nuclear Plants, Supplement 28: Regarding Oyster Creek Nuclear*
6 *Generating Station*. NUREG-1437, Supplement 28, Office of Nuclear Reactor Regulation,
7 Washington, D.C. (January).
8
- 9 U.S. Nuclear Regulatory Commission (NRC). 2007d. *Plant Sites with Groundwater*
10 *Contamination*. Available URL: [http://www.nrc.gov/reactors/operating/ops-](http://www.nrc.gov/reactors/operating/ops-experience/tritium/sites-grndwtr-contam.html)
11 [experience/tritium/sites-grndwtr-contam.html](http://www.nrc.gov/reactors/operating/ops-experience/tritium/sites-grndwtr-contam.html) (Accessed October 17, 2007).
12
- 13 U.S. Nuclear Regulatory Commission (NRC). 2007e. *Generic Environmental Impact Statement*
14 *for License Renewal of Nuclear Plants, Supplement 29: Regarding Pilgrim Nuclear Power*
15 *Station*. NUREG-1437, Supplement 29, Office of Nuclear Reactor Regulation, Washington,
16 D.C. (July).
17
- 18 U.S. Nuclear Regulatory Commission (NRC). 2007f. *Generic Environmental Impact Statement*
19 *for License Renewal of Nuclear Plants, Supplement 30: Regarding Vermont Yankee Nuclear*
20 *Power Station*. NUREG-1437, Supplement 30, Office of Nuclear Reactor Regulation,
21 Washington, D.C. (August).
22
- 23 U.S. Nuclear Regulatory Commission (NRC). 2007g. *Radiation Protection and the "Tooth*
24 *Fairy" Issue*. Available URL: [http://www.nrc.gov/reading-rm/doc-collections/fact-sheets/tooth-](http://www.nrc.gov/reading-rm/doc-collections/fact-sheets/tooth-fairy.html)
25 [fairy.html](http://www.nrc.gov/reading-rm/doc-collections/fact-sheets/tooth-fairy.html) (Accessed October 4, 2007).
26
- 27 U.S. Nuclear Regulatory Commission (NRC). 2007h. *Low-Level Waste Compacts*. Available
28 URL: <http://www.nrc.gov/waste/llw-disposal/compacts.html> (Accessed October 18, 2007).
29
- 30 U.S. Nuclear Regulatory Commission (NRC). 2007i. *Typical Dry Cask Storage System*.
31 Available URL: [http://www.nrc.gov/waste/spent-fuel-storage/diagram-typical-dry-cask-](http://www.nrc.gov/waste/spent-fuel-storage/diagram-typical-dry-cask-system.html)
32 [system.html](http://www.nrc.gov/waste/spent-fuel-storage/diagram-typical-dry-cask-system.html) (Accessed October 18, 2007).
33
- 34 U.S. Nuclear Regulatory Commission (NRC). 2007j. *Locations of Independent Spent Fuel*
35 *Storage Installations*. Available URL: [http://www.nrc.gov/waste/spent-fuel-storage/](http://www.nrc.gov/waste/spent-fuel-storage/locations.html)
36 [locations.html](http://www.nrc.gov/waste/spent-fuel-storage/locations.html) (Accessed October 25, 2007).
37
- 38 United Nations Scientific Committee on the Effects of Atomic Radiation (UNSCEAR). 2000.
39 *Sources and Effects of Ionizing Radiation: UNSCEAR 2000 Report to the General Assembly,*
40 *with Scientific Annexes. Vol. I: Sources*. New York, New York. Available URL:
41 http://www.unscear.org/unscear/en/publications/2000_1.html (Accessed October 4, 2007).

Affected Environment

- 1 Veil, J.A., J.K. Rice, and M.E.S. Raivel. 1997. *Biocide Usage in Cooling Towers in the Electric*
2 *Power and Petroleum Refining Industries*. Prepared by Argonne National Laboratory, Argonne,
3 Illinois, for the U.S. Department of Energy, Office of Fossil Energy, Washington, D.C.
4 (September). Available URL: http://www.ead.anl.gov/pub/doc/ANL-Biocide_Usage.pdf
5 (Accessed November 1, 2007).
6
- 7 Vér, I.L., and L.L. Beranek. 2006. *Noise and Vibration Control Engineering: Principles and*
8 *Applications, 2nd ed.*, John Wiley & Sons, Inc., Hoboken, N.J.
9
- 10 Wertheimer, N., and E. Leeper. 1979. "Electrical Wiring Configurations and Childhood Cancer."
11 *American Journal of Epidemiology* 109:273–284.
12
- 13 Williams, J.D., M.L. Warren, K.S. Cummings, J.L. Harris, and R.J. Neves. 1993. "Conservation
14 Status of Freshwater Mussels of the United States and Canada." *Fisheries* 18:6–22.
15
- 16 Wright, T., J. Tomlinson, T. Schueler, K. Cappiella, A. Kitchell, and D. Hirschman. 2006. *Direct*
17 *and Indirect Impacts of Urbanization on Wetland Quality: Wetlands and Watersheds Article # 1*.
18 Prepared by Center for Watershed Protection for U.S. Environmental Protection Agency (EPA),
19 Office of Wetlands, Oceans and Watersheds, Washington, D.C. (December).

4. Environmental Consequences and Mitigating Actions

4.1 Introduction

The U.S. Nuclear Regulatory Commission (NRC) evaluated the environmental consequences of the proposed action (i.e., license renewal) including the (1) impacts associated with continued operations and refurbishment activities similar to those that have occurred during the current license term; (2) impacts of various alternatives to the proposed action; (3) impacts from the termination of nuclear power plant operations and decommissioning after the license renewal term (with emphasis on the incremental effect caused by an additional 20 years of operation); (4) impacts associated with the uranium fuel cycle; (5) impacts of postulated accidents (design-basis accidents and severe accidents); (6) cumulative impacts of the proposed action; and (7) resource commitments associated with the proposed action, including unavoidable adverse impacts, the relationship between short-term use and long-term productivity, and irreversible and irretrievable commitment of resources.

In evaluating impacts for this revision of the *Generic Environmental Impact Statement for License Renewal of Nuclear Plants* and its Addendum 1 (NRC 1996, 1999a; referred to collectively in this document as the “1996 GEIS”), the staff used the NRC’s standard of significance that is based on the Council on Environmental Quality (CEQ) terminology for “significantly” (see Title 40, Section 1508.27 in the *Code of Federal Regulations* [40 CFR 1508.27]), which considers both “context” and “intensity.” The NRC established three significance levels – small, moderate, and large – and has used these levels and associated definitions as standard practice in preparing its environmental

Contents of Chapter 4

- Introduction (Section 4.1)
- Land use and visual resources (Section 4.2)
- Air quality, and noise (Section 4.3)
- Geology and soils (Section 4.4)
- Hydrology (Section 4.5)
- Ecology (Section 4.6)
- Historic and cultural resources (Section 4.7)
- Socioeconomics (Section 4.8)
- Human health (Section 4.9)
- Environmental justice (Section 4.10)
- Waste management and pollution prevention (Section 4.11)
- Impacts Common to All Alternatives (Section 4.12)
- Cumulative Impacts of the Proposed Action (Section 4.13)
- Resource commitments

Environmental Consequences and Mitigating Actions

1 impact statements (EISs). As indicated in Section 1.5, the definitions of the three significance
2 levels are as follows:

- 3
- 4 • **Small impact:** Environmental effects are not detectable or are so minor that they will
5 neither destabilize nor noticeably alter any important attribute of the resource.
6
- 7 • **Moderate impact:** Environmental effects are sufficient to alter noticeably, but not to
8 destabilize, important attributes of the resource.
9
- 10 • **Large impact:** Environmental effects are clearly noticeable and are sufficient to
11 destabilize important attributes of the resource.
12

13 These levels are used for describing the impacts of all aspects of the proposed action as well
14 as the impacts of alternatives to the proposed action. Resource-specific definitions are
15 provided where applicable.
16

17 **4.1.1 Environmental Consequences of the Proposed Action**

18
19 As described in Section 2.1, a number of activities associated with the proposed action could
20 have environmental consequences. The proposed action includes the activities associated with
21 normal operations during the license renewal term, including (1) plant operation, (2) activities
22 needed to support operations and meet infrastructure requirements (e.g., road improvements,
23 new parking lots, waste storage facilities, and new ancillary buildings), and (3) refurbishment
24 actions needed to replace critical portions of reactor systems.
25

26 The assessment includes a determination of the magnitude of the impact (small, moderate, or
27 large, as defined above) and whether or not the analysis of the environmental issue could be
28 applied to all plants. Issues are assigned a Category 1 or a Category 2 designation as follows:
29

30 **Category 1** issues are those that meet all of the following criteria:

- 31
- 32 (1) The environmental impacts associated with the issue were determined to apply either
33 to all plants or, for some issues, to plants having a specific type of cooling system or
34 other specified plant or site characteristics.
35
- 36 (2) A single significance level (i.e., small, moderate, or large) was assigned to the impacts
37 (except for collective offsite radiological impacts from the fuel cycle and from the
38 disposal of high-level waste and spent fuel).
39

1 (3) The mitigation of adverse impacts associated with the issue was considered in the
2 analysis, and it was determined that additional plant-specific mitigation measures
3 would probably not be sufficiently beneficial to warrant implementation.
4

5 For issues that meet the three Category 1 criteria, no additional plant-specific analysis is
6 required in future supplemental EISs (SEISs) unless new and significant information is
7 identified.
8

9 **Category 2** issues are those that do not meet one or more of the criteria of Category 1 and for
10 which, therefore, an additional plant-specific review is required.
11

12 A total of 78 impact issues that are related to the proposed action were identified (summarized
13 in Table 2.1-1). For each potential environmental impact issue identified, the GEIS revision
14 (1) describes the nuclear power plant activity that could affect the resource, (2) identifies the
15 resource that is affected, (3) evaluates past license renewal reviews and other available
16 information, (4) assesses the nature and magnitude of the environmental impact on the
17 affected resource, (5) characterizes the significance of the effect, (6) determines whether the
18 results of the analysis apply to all nuclear power plants (whether the impact issue is Category 1
19 or Category 2), and (7) considers additional mitigation measures for adverse impacts. In cases
20 for which the issue differs from that presented in the 1996 GEIS, the rationale for the new
21 treatment is presented.
22

23 **4.1.2 Environmental Consequences of Continued Operations and Refurbishment** 24 **Activities during the License Renewal Term** 25

26 The activities that would occur during normal
27 operations of the license renewal term and that
28 are thus the subject of this evaluation are
29 discussed in Section 2.1. It is important to note
30 that the impacts of the original construction of the
31 nuclear power plants and past operational impacts
32 are not the focus of this evaluation of
33 environmental consequences. Both the impacts of
34 original construction and the impacts of past operations have affected and, in many cases,
35 established the current conditions at each plant and vicinity. These conditions serve as the
36 baseline for the impact analyses presented in this section. Past impacts are presented in the
37 description of the affected environment in Chapter 3. In most cases, impacts of the proposed
38 action would not represent a change from current conditions and are considered small. In other
39 cases, the proposed action could result in a change from current conditions, and the impacts
40 could be considered moderate or large.
41

In most cases, the impacts of continued operations and refurbishment activities during the license renewal term are similar to the impacts that have resulted from the operation of licensed nuclear power plants during the current license term.

Environmental Consequences and Mitigating Actions

1 A total of 78 impact issues (including 5 issues related to waste management at both nuclear
2 power plants and other nuclear fuel cycle facilities) that are related to continued operations and
3 refurbishment activities during the license renewal term were identified and evaluated; they are
4 summarized in Table 2.1-1). These impact issues are discussed by resource topic in the
5 remainder of this section. The assessment approaches specific to each resource area are
6 described in Appendix D.

8 **4.1.3 Environmental Consequences of the No-Action Alternative**

10 The no-action alternative represents a decision by the NRC not to issue a renewed operating
11 license. If a license is not renewed, the licensee would have to shut the plant down. At some
12 point in time, all plants eventually would be required to shut down and undergo
13 decommissioning. Under the no-action alternative, these eventualities would occur sooner than
14 if the NRC issued a renewed license.

16 Denying license renewal and ceasing operation under the no-action alternative may lead to a
17 variety of potential outcomes, but these are essentially the same as the ones that would
18 eventually occur once plant operations ceased after license renewal (see Section 4.12.2 for a
19 discussion of these effects). Reactor shutdown would result in a net reduction in power
20 production capacity. The power not generated by the nuclear plant during a license renewal
21 term would likely be replaced by (1) generating alternatives other than the nuclear plant,
22 (2) demand-side management, (3) power purchased from other electricity providers, or
23 (4) some combination of these options. Note that NRC's consideration of the no-action
24 alternative does not involve the determination of whether any power is needed or should be
25 generated. 2.2The decision to generate power and the determination of how much power is
26 needed are at the discretion of State, Federal (non-NRC) and utility officials.

28 **4.1.4 Environmental Consequences of Alternative Energy Sources**

30 This alternative considers the potential environmental impacts that could result from
31 construction and operation of alternative electricity generation technologies (including a new
32 nuclear reactor) that could replace the power contributed by an existing nuclear plant. The
33 analyses provided in each resource area in this chapter apply to a discrete set of electricity-
34 generating technologies that the NRC, on the basis of reviews of energy technologies and
35 available literature, believes are either currently viable on a utility scale or can be expected to
36 become so within the foreseeable future. Other technologies that hold promise for becoming
37 part of the bulk electricity portfolio sometime in the future are mentioned but are not evaluated
38 fully after their probable development path and schedule toward utility-scale bulk electricity
39 production are considered. Although the analyses below are provided for individual discrete
40 technologies, the NRC recognizes that, should the need arise to replace the generating
41 capacity of a reactor, either because its operating license will not be renewed or because of

1 changes in strategies to meet changing regional or local demand, the necessary alternative
2 power is likely to be provided by a suite or portfolio of technologies, including, perhaps,
3 expansions of the capacities of one or more existing power-generating facilities within the
4 region. The number of possible combinations of the technologies discussed below to replace
5 lost capacity is quite large. An evaluation of even a small fraction of these possible
6 combinations would not significantly advance the knowledge base supporting the licensing
7 decision. Consequently, individual technologies rather than combinations are explicitly
8 evaluated as alternatives in this GEIS. Data on commercial products or services are included
9 for information purposes only. No endorsement is implied. The NRC does not engage in
10 energy planning decisions and makes no judgment as to which of the energy alternatives
11 evaluated herein would be the most likely alternative in any given case.

12
13 In addition to the installation of alternative energy technologies, replacement power could also
14 be provided by importing power over the bulk electricity grid. Power replaced through energy
15 purchases would likely have similar characteristics to some of the alternatives evaluated below,
16 and would be dependent on available energy sources at the time of the purchase. At the time of
17 publication, coal, natural gas, and nuclear are the most-prevalent sources of purchased
18 replacement power, though an increasing number of renewable sources are emerging. As
19 such, the effects of purchased power are likely to be similar to the effects of operating a
20 combination of other alternatives, or similar to the fossil or nuclear alternatives. Impacts overall
21 are likely to be lower for purchased power (if existing generation and transmission capacity is
22 available) since no construction is necessary. On the other hand, since existing plants are likely
23 to have less-stringent emissions controls, operational impacts to air quality, human health,
24 ecology, and environmental justice may be slightly greater for purchased power than for new
25 construction.

26 27 **4.1.5 Environmental Consequences of Terminating Nuclear Power Plant** 28 **Operations and Decommissioning**

29
30 All operating nuclear power plants will terminate operations and be decommissioned at some
31 point after the end of their operating licenses or after a decision is made to cease operations.
32 License renewal would potentially delay this eventuality for an additional 20 years beyond the
33 current license period. The impacts of decommissioning nuclear plants were evaluated in the
34 *Generic Environmental Impact Statement for Decommissioning Nuclear Facilities:*
35 *Supplement 1, Regarding the Decommissioning of Nuclear Power Reactors*, NUREG-0586
36 (NRC 2002a). The effects of license renewal on the impacts of terminating nuclear power plant
37 operations and decommissioning are considered a single environmental issue. Because the
38 impacts are expected to be small at all plants and for all environmental resources, it is
39 considered a Category 1 issue. The impacts of terminating nuclear power plant operations and
40 decommissioning for each resource area are discussed in Section 4.12.2.

4.2 Land Use and Visual Resources

4.2.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities

Since September 11, 2001, changes in onsite land use have occurred at nuclear power plants across the nation, with increased restrictions on site access and changes in barricades and landscaping to enhance security. Generally, land use conditions are expected to continue unchanged until plant decommissioning. Similarly, the use of transmission line rights-of-way (ROWs) is projected to continue with few, if any, changes in restrictions and easements.

In addition, the presence and visual profiles of operating nuclear power plants and transmission lines have been well established during the current licensing term. These conditions would remain unchanged during the 20-year license renewal term.

4.2.1.1 Land Use

In the 1996 GEIS, the impacts of nuclear power plant operations on onsite land use, power line right of way, and offsite land use (license renewal term and refurbishment) were evaluated separately. While impacts to onsite land use and power line right of ways were determined to be small at all plants, anticipated changes in population and tax revenues attributed to license renewal and power plant refurbishment were predicted to have small to moderate impacts on offsite land use. Subsequent license renewal reviews have shown, however, that license renewal and power plant refurbishment have had little or no effect on offsite land use.

Land use impact issues evaluated for the revised GEIS include: (1) the impacts of continued plant operations and refurbishment activities on onsite land use; (2) the impacts of continued plant operations and refurbishment activities on offsite land use; and (3) the impacts of transmission line ROWs on offsite land use.

Impacts on Onsite Land Use

Operational activities at a nuclear power plant during the license renewal term would be similar to those occurring during the current license term. Generally, onsite land use conditions would remain unchanged. However, additional spent nuclear fuel and low-level radioactive waste generated during the license renewal term could require the construction of new or expansion of existing onsite storage facilities. Should additional storage facilities be required, this action would be addressed in separate license reviews conducted by the NRC. The NRC has not identified any information or situations during previous license renewal reviews that would alter the conclusion that impacts would be small for all commercial nuclear power plants.

1
2 On the basis of these considerations, the NRC concludes that the impact of continued plant
3 operations during the license renewal term and refurbishment on onsite land use would be
4 small for all nuclear plants and remains a Category 1 issue.

5
6 *Impacts on Offsite Land Use*
7

8 The impacts of continued plant operations during the license renewal term and refurbishment
9 on offsite land use were evaluated separately in the 1996 GEIS. The NRC predicted that
10 impacts associated with refurbishment and changes in population and tax revenue on offsite
11 land use could range from small to moderate. Subsequent license renewal reviews, however,
12 have shown no power plant-related population changes or significant tax revenue changes due
13 to license renewal. Non-outage employment levels at nuclear power plants have remained
14 relatively unchanged or have decreased. With no increase in the number of workers, there has
15 been no increase in housing, infrastructure, or demand for services beyond what has already
16 occurred. Operational activities during the license renewal term would be similar to those
17 occurring during the current license term and would not affect offsite land use beyond what has
18 already been affected. The NRC has not identified any information or situations, including low
19 population areas or population and tax revenue changes resulting from license renewal that
20 would alter the conclusion that impacts would be small for all nuclear power plants.

21
22 For plants that have the potential to impact a coastal zone or coastal watershed, as defined by
23 each State participating in the National Coastal Zone Management Program, licensees must
24 certify that the proposed activity is consistent with the State Coastal Zone Management
25 Program. Licensees must coordinate with the State agency that manages the State Coastal
26 Zone Management Program with regard to the compatibility certification process for Federal
27 projects within coastal zones.

28
29 On the basis of these considerations, the NRC concludes that the impact of continued plant
30 operations during the license renewal term and refurbishment on offsite land use would be
31 small at all plants and is considered a Category 1 issue.

32
33 *Impacts of Transmission Line ROWs on Offsite Land Use*
34

35 Operational activities during the license renewal term would be similar to those occurring during
36 the current license term and would not affect offsite land use in transmission line ROWs beyond
37 what has already been affected. Certain land use activity in the ROW is usually restricted.
38 Land cover is generally managed through a variety of maintenance procedures so that
39 vegetation growth and building construction do not interfere with power line operation and
40 access. Land use within ROWs are limited to activities that do not endanger power line
41 operation; these include recreation, off-road vehicle use, grazing, agricultural cultivation,

Environmental Consequences and Mitigating Actions

1 irrigation, roads, environmental conservation, and wildlife areas. Transmission lines do not
2 preclude the use of the land for farming or environmental and recreational use. Transmission
3 lines connecting nuclear power plants to the electrical grid are no different from transmission
4 lines connecting any other power plant.

5
6 The impact of transmission lines on offsite land use during the license renewal term were
7 considered to be small for all plants and were designated as a Category 1 issue in the 1996
8 GEIS. No new information that would alter that conclusion has been identified in subsequent
9 license renewal reviews.

10
11 On the basis of these considerations, the NRC concludes that the impact of transmission lines
12 on offsite land use during the license renewal term would be small for all plants and remains a
13 Category 1 issue.

14 15 **4.2.1.2 Visual Resources**

16
17 In the 1996 GEIS, the NRC considered the visual resource impacts of continued plant
18 operations, refurbishment, and transmission lines separately. Subsequent license renewal
19 environmental reviews conducted by the NRC have shown that the appearance of nuclear
20 power plants and transmission lines have not changed significantly over time, so aesthetic
21 impacts are not anticipated. The three issues identified in the 1996 GEIS were combined and
22 are evaluated as a single issue.

23 24 *Aesthetic Impacts*

25
26 As previously discussed, the NRC considered the impacts of continued plant operations during
27 the license renewal term and refurbishment on visual resources separately in the 1996 GEIS.
28 The NRC concluded that for both issues the impacts on visual resources would be small for all
29 plants and both were determined to be Category 1 issues, because the existing visual profiles
30 of nuclear power plants were not expected to change during the license renewal term.

31
32 A case study performed for the 1996 GEIS found a limited number of situations where nuclear
33 power plants had a negative effect on visual resources. Negative perceptions were based on
34 aesthetic considerations (for instance, the plant is out of character or scale with the community
35 or the viewshed), physical environmental concerns, safety and perceived risk issues, an anti-
36 plant attitude, or an anti-nuclear orientation. It is believed that these negative perceptions would
37 persist regardless of mitigation measures. Subsequent license renewal reviews have not
38 revealed any new information that would change this perception.

39
40 In addition, the visual appearance of transmission lines is not expected to change during the
41 license renewal term. After the containment building and cooling towers, transmission line

1 towers are probably the most frequently observed structure associated with nuclear power
2 plants. Transmission lines from nuclear power plants are generally indistinguishable from those
3 from other power plants. Since electrical transmission lines are common throughout the U.S.,
4 they are generally perceived with less prejudice than the nuclear power plant itself. Also, the
5 visual impact of transmission lines tends to wear off when viewed repeatedly. Replacing or
6 moving towers or burying cables to reduce the visual impact would be impractical from both an
7 efficiency and cost-benefit perspective. The impact of transmission lines during the license
8 renewal term on visual resources was considered to be small for all plants and designated as a
9 Category 1 issue in the 1996 GEIS. No new information that would alter that conclusion has
10 been identified in subsequent license renewal reviews.

11
12 On the basis of these considerations, the NRC concludes that the aesthetic impacts of
13 continued plant operations during the license renewal term, refurbishment, and transmission
14 lines on visual resources would be small for all plants and remains a Category 1 issue.

15 16 **4.2.2 Environmental Consequences of Alternatives to the Proposed Action**

17
18 *Construction* – Construction of a new power plant would involve the permanent commitment of
19 land for the power plant, plant intake and discharge structures, water treatment facilities, and
20 cooling towers. Other construction-related land use impacts would include land clearing,
21 excavations, drilling of monitoring wells, and the installation of temporary support facilities.
22 Material laydown areas and onsite concrete batch plants would also represent additional
23 temporary land use and visual impacts. These would be removed after the power plant is
24 completed. Depending on location, construction of electrical substation, switchyards,
25 transmission lines, railroad spurs, access roads may also be required. Some of these facilities
26 could affect offsite land use.

27
28 Construction at an existing nuclear power plant site or brownfield site would have less of an
29 impact on land use and visual resources than a greenfield site. Construction at an existing
30 nuclear power plant site would have the least impact on land use, because the plant could
31 make use of existing intake and discharge structures, substations, transmission lines, office
32 buildings, parking lots, and access roads. Constructing a power plant at a greenfield site would
33 remove land from other productive uses such as agriculture. It could convert potential prime
34 farmland to industrial use. In addition, construction at a greenfield site would have a more
35 dramatic impact on visual resources, since the industrial power plant would likely be
36 significantly different from the surrounding landscape. Constructing at a brownfield site would
37 have less of an impact on the land use than a greenfield site.

38
39 The increase in traffic to and from the construction site could require changes to existing
40 transportation infrastructure and traffic patterns resulting in offsite land use impacts and visual
41 impacts. These impacts would cease at the end of construction.

Environmental Consequences and Mitigating Actions

1
2 *Operations* – Land would be in use throughout the period of power plant operation. Visual
3 resources would also be affected. Visual impacts would be similar to other industrial activities
4 at an existing nuclear power plant site or brownfield site. However, the height of new buildings
5 structures as well as transmission line, meteorological, and cooling towers could add to the
6 visual impact. Condensate plumes during plant operations may be visible for some distance
7 during certain weather conditions.

8 9 **4.2.2.1 Fossil Energy Alternatives**

10
11 *Construction* – Impacts on land use from constructing coal- or natural gas-fired power plants
12 would be similar. However, a coal-fired power plant would need more land than a natural gas-
13 fired plant due to the need for coal fuel delivery and waste storage facilities. As a result, the
14 coal-fired power plant would also have a higher visual impact.

15 16 **4.2.2.2 New Nuclear Alternatives**

17
18 *Construction* – Land would be required for the construction of spent nuclear fuel and low-level
19 radioactive waste storage facilities. The appearance of the reactor containment and turbine
20 buildings would add to the visual impact.

21 22 **4.2.2.3 Renewable Alternatives**

23
24 *Construction* – Land requirements for renewable energy facilities vary greatly. Biomass fueled
25 energy facilities with utility-scale capacities could require at least 300 ac (122 ha). Flat plate
26 solar photovoltaic systems would require approximately 6.2 ac (2.5 ha)/MW; however,
27 improvements in photovoltaic cell efficiency could reduce the amount of land required to 0.68 ac
28 (0.28 ha)/MW by 2030. Solar thermal facilities with concentrators would require substantial
29 land area. Projected land requirements for advanced power tower facilities generating 200
30 MW(e) in the year 2030 would be 612 ac (247 ha). Given the expected capacity factor of
31 advanced power tower facilities, the land requirements equate to 1.1×10^{-3} ha/MWh/yr (EERE
32 1997). Land area required for an advanced solar power trough facility operating in 2030 with a
33 rated capacity of 320 MW would be 792 ac (320 ha) (EERE 1997).

34
35 Wind energy facilities would require approximately 0.3 ac (0.12 ha)/MW. Utility-scale wind
36 farms would require relatively large areas. However, unlike solar technologies, once
37 construction is completed, land areas between the turbines can be put to other beneficial
38 (nonintrusive) use. Substantially lesser amounts of land area would be required for geothermal
39 facilities (estimated at 173 ac [70 ha] for a 49 MW facility) (BLM 1999), and very small amounts
40 of land (for cable landings and substations, estimated at 100 ac [40.4 ha] for utility-scale
41 offshore energy facilities) would be required for offshore wind and current facilities.

1
2 For renewable energy technologies that utilize combustion and/or steam cycles, the
3 appearance of buildings, height and prominence of smokestacks, and condensate plumes,
4 would have a visual impact.

5
6 *Operations* – The operational impacts of alternative energy technologies on land use and visual
7 resources are presented in the following subsections.

8 9 **Hydroelectric Energy Sources**

10 Hydroelectric dams and reservoirs capable of generating utility-scale power would be
11 substantial in scale and prominence and have a visual impact. Large dams that also serve as
12 flood control could significantly affect land use patterns upstream and downstream beyond the
13 decommissioning of the facility.

14 **Geothermal**

15 Geothermal facilities would be less prominent, typically located in remote areas and may
16 generate a steam plume that is visible from long distances. Visual resources would be affected
17 by wellheads, exposed transfer piping, and power plant structures, and could have a dramatic
18 impact on a remote area. The intermittent creation of steam condensate plumes would be
19 visible from great distances.

20 **Wind**

21 A relatively large area of land would be required for wind energy; however, only about 5 to 10
22 percent of the land area would be utilized by turbines, power collection and conditioning
23 systems, and other support facilities. Land affected by the installation of buried power and
24 communication cables interconnecting each turbine with a power substation would be minimally
25 intrusive. Wind farms, although less complex than combustion-based facilities in their visual
26 appearance, would have a visual impact due to the height of the turbines. Offshore wind farms
27 could be sufficiently distant from the shore to attenuate most, if not all, of the visual impacts on
28 onshore observers.

29 **Biomass**

30 The physical appearance of a biomass fuel-fired energy facility would be similar to that of a
31 fossil fuel fired facility. The industrial footprint would be less. Additional land would be
32 required, however, for growing biomass crops.

33 **Municipal Solid Waste, Refuse-Derived Fuel and Landfill Gas**

34 The physical appearance of a municipal solid waste, refuse-derived and landfill gas-fired energy
35 facility would be similar to that of a fossil fuel fired facility. The industrial footprint would be less.

Environmental Consequences and Mitigating Actions

1 Additional land would be required, however, for refuse-derived fuel, or landfill gas handling
2 facilities (e.g., storage piles, hammermills, grinders, bucket conveyors, blowers, pneumatic
3 conveyance systems). Buildings, smokestacks, cooling towers, and condensate plumes would
4 have a visual impact.

5 **Solar Thermal**

6 Land would be required for the powerblock (steam cycle, turbine/generator building, substation,
7 cooling towers, condensate plume, and support equipment). Visual impacts would occur if a
8 power tower technology is employed as well as the array of solar collectors.

9 **Solar Photovoltaic**

10 Utility-scale facility would require a very large area of land. Visual resources would be affected
11 by the size of the facility.

12 **Ocean Wave and Current**

13 Land use would be only slightly affected by land-based support systems (cable landing,
14 substation, and warehouse and repair facility); existing piers and docks are expected to be
15 sufficient to support the offshore facility during operation. Above-water components are
16 expected to be relatively inconspicuous, even when equipped with marker lights; their relatively
17 small height above the water, their distance from shore, and the curvature of the earth may
18 serve to partially or completely conceal them from onshore observers.

19 **4.3 Air Quality and Noise**

20

21 **4.3.1 Environmental Consequences of the Proposed Action – Continued** 22 **Operations and Refurbishment Activities**

23

24 Ambient air quality and noise conditions at all nuclear power plants and associated transmission
25 lines have been well established during the current licensing term. Notwithstanding significant
26 changes to the nature and type of industrial activities in the area, these conditions are expected
27 to remain unchanged during the 20-year license renewal term.

28

29 The focus of this section is the impacts of continued operations and refurbishment activities
30 during the license renewal term on air quality and noise. Refurbishment and associated
31 construction activities can affect air quality (e.g., fugitive dust, vehicle and equipment exhaust
32 emissions, and automobile exhaust from commuter traffic). Baseline air quality, noise, and
33 related meteorological conditions at operating plants are discussed in Sections 3.3.1 and 3.3.2,
34 respectively. License renewal is expected to result in a continuation of similar conditions for an
35 extended period commensurate with the license renewal term, typically 20 years. As a result,

1 the criteria air pollutants emitted and the noise generated during normal continued plant
2 operations over the license renewal term are not expected to change substantially and thus
3 should remain small.

4 5 **4.3.1.1 Air Quality** 6

7 Two issues related to impacts on air quality during the license renewal term are considered in
8 this section:

- 9
- 10 • Impacts of continued operations (not considered in the 1996 GEIS) and refurbishment
11 activities on air quality (this issue was evaluated in the 1996 GEIS); and
- 12
- 13 • Impacts of transmission lines on air quality. This issue was evaluated in the 1996 GEIS.
14

15 *Impacts of Continued Operations and Refurbishment Activities on Air Quality* 16

17 *Continued Operations* – The impact of continued plant operations during the license renewal
18 term on air quality was not identified as an issue in the 1996 GEIS. It is evaluated here
19 because of the potential for air quality to be affected by the operations of fossil-fuel-fired
20 equipment needed for normal operations and by the operations of cooling towers in plants that
21 use a closed-cycle cooling system. These potential impacts are discussed below.
22

23 Impacts on air quality during normal plant operations can result from operations of fossil-fuel-
24 fired equipment needed for various plant functions (see Section 3.3.2). Each licensed plant
25 typically employs emergency diesel generators for use as a backup power source. Emergency
26 diesel generators and fire pumps typically require State or local operating permits. These
27 generators provide a standby source of electric power for essential equipment required during
28 plant upset or an emergency event. They also provide for safe reactor shutdown and for the
29 maintenance of safe conditions at the power station during such an event. These diesel
30 generators are typically tested once a month with several test burns of various durations
31 (e.g., 1 to several hours). In addition to these maintenance tests, longer-running endurance
32 tests are also typically conducted at each plant. Each generator is typically tested for 24 hours
33 on a staggered test schedule (e.g., once every refueling outage). Plants with nonelectric fire
34 pumps, typically also diesel-fired, usually employ test protocols identical or similar to those used
35 for emergency generators. Maintenance procedures during these tests would include, for
36 example, checks for leaks of lubricating oil or fuel from equipment, and pumps would be
37 replaced as required. Most, if not all, State air pollution regulations provide exemptions for air
38 pollution sources that are not routinely operated, which can be defined as sources with
39 insignificant activity meeting specified operating criteria (e.g., so many hours of continuous
40 operation over specified periods or so many hours of operation per year).
41

Environmental Consequences and Mitigating Actions

1 In addition to the emergency diesel generators, fossil fuel (i.e., diesel-, oil-, or natural-gas-fired)
2 boilers are used primarily for evaporator heating, plant space heating, and/or feed water
3 purification. These units typically operate at a variable load on a continuous basis throughout
4 the year unless end use is restricted to one application, such as space heating. Air emissions
5 include carbon monoxide (CO), nitrogen oxides (NO_x), carbon dioxide (CO₂), methane (CH₄),
6 nitrous oxide (N₂O), particulate matter (PM), and volatile organic compounds (VOCs) for diesel-,
7 natural-gas-, and oil-fired units. Natural-gas-fired units emit only trace amounts of VOCs and
8 PM that has an aerodynamic diameter of 10 μm or less (PM₁₀). The utility boilers at commercial
9 plants are relatively small when compared with most industrial boilers and are typically
10 regulated through State-level operating permits.

11
12 The potential impact from emergency generators and boilers on air quality would be expected
13 to be small for all plants, and, given the infrequency and short duration of maintenance testing,
14 it would not be an air quality concern even at those plants located in or adjacent to
15 nonattainment areas. The locations of the currently designated nonattainment areas near
16 nuclear plants are shown in Section 3.3.2.

17
18 As discussed in Section 3.3, cooling tower drift can increase downwind PM concentrations,
19 impair visibility, ice roadways, cause drift deposition, and damage vegetation and painted
20 surfaces. There are currently 24 licensed nuclear power plants that use wet cooling towers in
21 closed-cycle cooling systems. Most of the plants use two or more towers for reactor heat
22 removal. Of the 47 operating towers, 24 are natural draft cooling towers and 23 are mechanical
23 draft cooling towers. There are currently no dry or hybrid (combinations incorporating elements
24 of both dry and wet design) systems being used at operating nuclear plants. Only 1 of the
25 47 towers (a natural draft cooling tower at the Hope Creek plant in New Jersey) is operating at a
26 plant that uses high-salinity water for cooling system makeup. A recent air quality impact
27 analysis associated with emissions related to cooling tower drift droplets and PM for this worst-
28 case situation found that the impacts of cooling tower operations on air quality were small, as
29 summarized in Section 3.3.2.

30
31 Thus, although there is the potential for some air quality impacts to occur as a result of
32 equipment and cooling tower operations, even in the worst-case situation (Hope Creek), the
33 impacts would be considered small, at least in part because licensees would be required to
34 operate within State permit requirements. On the basis of these considerations, the NRC
35 concludes that the impact of continued operations during the license renewal term on air quality
36 would be small for all plants, and would be a Category 1 issue.

37
38 *Refurbishment Activities* – Potential sources of impacts on air quality during refurbishment
39 activities associated with continued operations during the license renewal term include
40 (1) fugitive dust from site excavation and grading and (2) emissions from motorized equipment,

Environmental Consequences and Mitigating Actions

1 construction vehicles, and workers' vehicles. Some refurbishment activities would be
2 performed on equipment inside existing buildings and would not generate air emissions.

3
4 With application of adequate controls or mitigation measures and best practices, the air quality
5 impacts from these air pollution sources would be small and of relatively short duration. The
6 disturbed area for refurbishment actions, if required, is expected to be 4 ha (10 ac) or less (see
7 Section 4.2.1). During site excavation and grading, some PM in the form of fugitive dust would
8 be released into the atmosphere. Because of the (1) small size of the disturbed area, (2)
9 relatively short construction period, (3) availability of paved roadways at existing facilities, and
10 (4) use of best management practices (such as watering, chemical stabilization, and seeding),
11 fugitive dust resulting from these construction activities would likely be minimal.

12
13 Construction vehicles and other motorized equipment would generate exhaust emissions that
14 include small amounts of CO, NO_x, VOCs, and PM. These emissions would be temporary
15 (restricted to the construction period) and localized (occurring only in the immediate vicinity of
16 construction areas). Emissions from construction equipment and vehicles (e.g., CO,
17 hydrocarbons, and PM from use of diesel fuels) and from fugitive dust emissions from ground-
18 clearing and grading activities could be small or moderate. For refurbishment occurring in
19 geographical areas with poor or marginal air quality, the emissions generated from these
20 activities could be cause for concern in a few cases (e.g., building demolition, debris removal,
21 and new construction). However, the 1990 Clean Air Act Amendments include a provision that
22 no Federal agency shall support any activity that does not conform to a State Implementation
23 Plan designed to achieve the National Ambient Air Quality Standards (NAAQS) for criteria
24 pollutants (sulfur dioxide [SO₂], nitrogen dioxide [NO₂], CO, ozone [O₃], lead [Pb], PM₁₀, and
25 PM with a mean aerodynamic diameter of 2.5 μm or less [PM_{2.5}]).

26
27 On November 30, 1993, the EPA issued its Final General Conformity Rule in the *Federal*
28 *Register* (58 FR 63214) implementing the new requirements in the Clean Air Act, effective
29 January 31, 1994. The regulations are codified in 40 CFR Part 51, Subpart W, and Part 93,
30 Subpart B. The final rule requires Federal agencies to ensure that a proposed Federal action in
31 air quality nonattainment or maintenance areas conforms to the applicable State Implementation
32 Plan before the action is taken and to prepare a written conformity analysis and determination
33 for each pollutant for which the total of direct and indirect emissions caused by a proposed
34 Federal action would exceed established threshold emission levels in a nonattainment or
35 maintenance area. An area is designated as nonattainment for a criteria pollutant if it does not
36 meet NAAQS for the pollutant. A maintenance area is one that a State has redesignated from
37 nonattainment to attainment. The current nationwide designations of nonattainment and
38 maintenance areas are identified in Section 3.3.2, with county-specific maps of nuclear power
39 plants shown in Section D.2 in Appendix D.

40

Environmental Consequences and Mitigating Actions

1 The EPA recommends that mobile emissions from construction vehicles and equipment should
2 generally be considered as indirect emissions in a conformity analysis. Emissions from
3 construction equipment and vehicles are expected to be small for anticipated refurbishment
4 projects on the basis of activities that have occurred to date; however, larger projects may
5 require a sizeable workforce that could contribute vehicle exhaust emissions that could exceed
6 the *de minimis* thresholds for CO, NO_x, and VOCs (the latter two contribute to the formation of
7 O₃) in nonattainment and maintenance areas. In addition, the amount of fugitive dust generated
8 by dust resuspension from larger projects involving construction vehicle use onsite or vehicle
9 use in the vicinity of construction activities may approach or exceed the threshold for PM₁₀ in
10 serious nonattainment areas (70 tons/yr). However, dust suppression measures could be
11 implemented in areas of concern. In addition, the EPA suggests that there may be some
12 flexibility in the rigor of a conformity analysis, particularly with regard to the specific site, extent
13 of activities, pollutants that are in nonattainment, severity of the nonattainment, State regulatory
14 agency involved, and the Federal agency's control over workers' vehicles. In summary,
15 emissions from vehicle exhaust and fugitive dust could result in impacts, but a general
16 conclusion about the significance of the potential impact cannot be drawn without considering
17 the compliance status of each site and specific information about the activities expected during
18 the license renewal term.

19
20 In the 1996 GEIS, the NRC concluded that the impacts from plant refurbishment associated with
21 license renewal on air quality could range from small to large, although these impacts were
22 expected to be small for most plants. Air quality impacts resulting from construction vehicle,
23 equipment, and fugitive dust emissions could be small or moderate depending on project and
24 plant-specific details. On the basis of these considerations, the NRC concludes that the impact
25 of refurbishment activities on air quality during the license renewal term would be small for most
26 plants, but could be moderate for plants located in or near air quality nonattainment or
27 maintenance areas, depending on the nature of the planned activity. The impacts would be
28 temporary and cease once projects were completed. Therefore, the impact on air quality from
29 refurbishment activities remains a Category 2 issue.

30 31 *Air Quality Effects on Transmission Lines*

32
33 Small amounts of ozone and substantially smaller amounts of oxides of nitrogen are produced
34 by transmission lines during corona, a phenomenon that occurs when air ionizes near isolated
35 irregularities on the conductor surface such as abrasions, dust particles, raindrops, and insects.
36 Several studies have quantified the amount of ozone generated and concluded that the amount
37 produced by even the largest lines in operation (765 kV) is insignificant (SNYPSC 1978; Scott-
38 Walton et al. 1979; Janes 1980; Varfalvy et al. 1985). Monitoring of ozone levels for two years
39 near a Bonneville Power Administration 1200-kV prototype line revealed no increase in ambient
40 ozone levels caused by the line (Bracken and Gabriel 1981; Lee et al. 1989). Ozone
41 concentrations generated by transmission lines are therefore too low to cause any significant

1 effects. The minute amounts of oxides of nitrogen produced are similarly insignificant. A
2 finding of small significance is supported by the evidence that production of ozone and oxides
3 of nitrogen are insignificant and does not measurably contribute to ambient levels of those
4 gases. Potential mitigation measures (e.g., burying transmission lines) would be very costly
5 and would not be warranted. This is a Category 1 issue.
6

7 Impacts on crop production that may have been caused by transmission line interference with
8 aerial spraying have been reported by one field study of cotton, rice, and soybean fields
9 crossed by a 500-kV line in eastern Arkansas (Parsch and Norman 1986). This study
10 hypothesized that crop yields could be reduced either by electromagnetic fields (EMFs) or by
11 inadequate aerial spraying directly under the power lines. Only cotton yields were found to be
12 reduced; 15 percent less lint was produced under the lines than 150 ft from the lines. The
13 resulting loss of income from cotton was estimated as \$85.25 per year for an 1100-ft (335-m)
14 span of the lines, based on a 15 percent yield reduction and an average lint yield of 480 lb/acre.
15 The field sampling and statistical analyses were extensive; the observed yield reduction
16 appeared to be real rather than a sampling error. However, the study could not determine
17 whether the EMF or line interference with aerial spraying caused the yield reduction.
18

19 **4.3.1.2 Noise**

20
21 One issue related to noise impacts during the license renewal term and refurbishment is
22 considered in this section:

- 23
24 • Impacts of continued operations and refurbishment activities on noise. This issue was
25 evaluated in the 1996 GEIS.
26

27 Noise from nuclear plant operations can often be detected offsite relatively close to the plant
28 site boundary. Sources of noise and the relative magnitude of impacts during normal nuclear
29 power plant operations are discussed in Section 3.3.3. Major sources of noise at an operating
30 nuclear power plants are cooling towers, turbines, transformers, large pumps, and cooling water
31 system motors. Nuclear plant operations have not changed appreciably with time, and no
32 change in noise levels or noise-related impacts are expected during the license renewal term.
33 Since no change is expected in the amount of noise generated during the license renewal term,
34 the only issue of concern is the number of people now living close to the nuclear power plant
35 who are exposed to operational noise.
36

37 Given the industrial nature of the power plant and the number of years of plant operation, noise
38 from a nuclear plant is generally nothing more than a continuous minor nuisance. However,
39 noise levels may sometimes exceed the 55 dBA level that the U.S. Environmental Protection
40 Agency (EPA) uses as a threshold level to protect against excess noise during outdoor
41 activities (EPA 1974). However, according to the EPA this threshold does “not constitute a

Environmental Consequences and Mitigating Actions

1 standard, specification, or regulation,” but was intended to provide a basis for state and local
2 governments establishing noise standards. Nevertheless, noise levels at the site boundary are
3 expected to remain well below regulatory standards for offsite residents.

4
5 Noise would also be generated by construction-related activities and equipment used during
6 refurbishment. However this noise would occur for relatively short periods of time (several
7 weeks) and is not expected to be distinguishable from other operational noises at the site
8 boundary nor create an adverse impact on nearby residents.

9
10 In the 1996 GEIS, the NRC concluded that noise was not a problem at operating plants and was
11 not expected to be a problem at any nuclear plant during the license renewal term. The
12 magnitude of noise impacts was therefore determined to be small for all plants, and the issue
13 was designated as Category 1. No new information altering this conclusion has been identified
14 in subsequent license renewal reviews.

15
16 On the basis of these considerations, the NRC concludes that the noise impact of continued
17 nuclear plant operations during the license renewal term and refurbishment would be small for
18 all plants, and remains a Category 1 issue.

19 20 **4.3.2 Environmental Consequences of Alternatives to the Proposed Action**

21
22 *Construction* –Air quality impacts would include criteria pollutants from construction vehicles
23 and equipment and dust from land clearing and grading. VOCs could be released from organic
24 solvents used in cleaning, during the application of protective coatings, and the onsite storage
25 and use of petroleum-based fuels. Construction vehicles and equipment would also generate
26 noise. Impacts, however, would be temporary, and both air quality and noise impacts would
27 return to pre-construction levels after construction was completed.

28
29 Air quality and noise impacts from construction activities would be similar whether occurring at a
30 greenfield site, brownfield site, or at an existing nuclear power plant. The impacts would be
31 greatest, however, at a greenfield site because cleaner ambient air quality and noise conditions,
32 even though greenfield sites may also be found in NAAQS nonattainment areas. Onsite
33 concrete batch plants, if required, would also contribute to construction-related dust and noise.

34
35 *Operations* – Air quality would be affected during operations by cooling tower drift; auxiliary
36 power equipment, building heating, ventilation, and air conditioning (HVAC) systems; and
37 vehicle emissions. Auxiliary power equipment could include standby diesel generators and
38 power systems for emergency power and auxiliary steam.

1 Ambient noise levels would be affected by cooling towers (water pumps, cascading water, or
2 fans), transformers, turbines, pumps, compressors, loudspeakers, other auxiliary equipment
3 such as standby generators, and vehicles. Air quality and noise impacts would be the greatest
4 at greenfield sites.

6 **4.3.2.1 Fossil Energy Alternatives**

8 *Construction* – Air quality and noise impacts would be the same as described in Section 4.3.2.
9 The impact analysis for fossil energy alternatives is based on projected impacts of facilities
10 studied by the U.S. Department of Energy’s (DOE’s) National Energy Technology Laboratory
11 (NETL). Baseline performance and cost data for 12 technologies are presented in a report
12 issued by NETL (NETL 2007).

14 An independent study conducted by the U.S. Environmental Protection Agency (EPA) on some
15 of the technologies in the NETL report provides additional environmental impact data
16 (EPA 2006). However, due to different power plant designs and fuel used in the NETL and EPA
17 studies the data are not directly comparable. Nevertheless, data from both studies are
18 presented to provide a range of environmental impacts. Most of the data presented in the
19 following sections are extracted from those two reports.

21 *Operations* – Fossil fuel power plants without pollution-control devices can have a significant
22 impact on air quality. The burning of fossil fuels is a major source of criteria pollutants and
23 greenhouse gases, primarily CO₂, as well as other hazardous air pollutants. The exact nature
24 of these pollutants depends on the chemical constituency of the fuel, combustion technology, air
25 pollution control devices, and onsite management of fuel (e.g., coal) and waste material.
26 Sources of noise include coal delivery, coal crushing, and fuel and waste handling activities.

28 The EPA has identified 13 trace elements likely to be emitted from an integrated gasification
29 combined cycle (IGCC) facility, including arsenic, cadmium, lead, mercury, and selenium. The
30 average concentrations of trace elements emitted in pounds emitted per million Btu input (lb/10⁶
31 Btu) are as follows: antimony (4), arsenic (2.1), beryllium (0.09), cadmium (2.9), chloride (740),
32 chromium (2.7), cobalt (0.57), fluoride (38), lead (2.9), manganese (3.1), mercury (1.7), nickel
33 (3.9), and selenium (2.9) (EPA 2006).

35 Table 4.3.2.1–1 displays some of the anticipated air quality impacts of coal-burning
36 technologies (EPA 2006). Table 4.3.2.1-2 shows projected emissions of criteria and hazardous
37 air pollutants from fossil fuel plants (NETL 2007). The values presented in the two tables
38 represent the possible range of operational emissions that could result from fossil-fuel-fired
39 power plants.

Environmental Consequences and Mitigating Actions

1 Fossil fueled power plants not equipped with carbon capture and storage devices will emit large
2 amounts of CO₂ and lesser amounts of other greenhouse gases. EPA projections of CO₂
3 emissions from a 500-MW integrated gasification combined cycle facility burning bituminous,
4 sub-bituminous, and lignite coals are 1441 lb/MWh (or 199 lb/MMBtu), 1541 lb/MWh (208
5 lb/MMBtu), and 1584 lb/MWh (211 lb/MMBtu), respectively (EPA 2006). However, as can be
6 seen from the data presented in Table 4.3.2.1-2, CO₂ emissions can be reduced by as much as
7 90 percent with the installation of carbon capture and storage devices.

8

9 **4.3.2.2 New Nuclear Alternatives**

10

11 *Construction* – Air quality and noise impacts for the construction of a new nuclear power plant
12 would be the same as described in Section 4.3.2.

13

14 *Operations* – An operating nuclear plant would have minor air emissions associated with diesel
15 generators and other small-scale intermittent sources. Air quality and noise impacts would be
16 the same as described in Section 4.3.2.

17

18 **4.3.2.3 Renewable Alternatives**

19

20 *Construction* – Air quality and noise impacts for the construction of land-based alternative
21 energy technologies would be the same as described in Section 4.3.2. Air quality impacts
22 associated with the construction of offshore power generating facilities and support structures
23 include the emission of criteria pollutants from construction barges and equipment (e.g., cranes,
24 compressors) and vehicles delivering materials and crews to embarkation locations on the
25 shore, and dust from the construction of onshore facilities (e.g., cable landings, substations).
26

Table 4.3.2.1-1. Projected Air Quality Impacts for Selected Power Production Technologies Burning Various Ranks of Coal^(a)

Fuel	Technology ^(b)	Projected Air Quality Impacts (lb/MWh)							SO ₂ Removal Percent	NO _x Removal Basis ^(f)
		NO _x (NO ₂)	SO ₂	CO	Particulate ^(c)	VOCs	Lead ^(d)	Mercury ^(e)		
Bituminous coal	IGCC	0.355	0.311	0.217	0.051	–	1.0 × 10 ⁻⁶ to 2.4 × 10 ⁻⁶	5.50 × 10 ⁻⁶	99	15 ppmvd @ 15 percent O ₂
	Subcritical PC	0.528	0.757	0.880	0.106	0.021	3.40 × 10 ⁻⁵ to 18 × 10 ⁻⁵	6.69 × 10 ⁻⁶	98	0.06 lb/MMBtu
	Supercritical PC	0.494	0.709	0.824	0.099	0.020	3.18 × 10 ⁻⁵ to 17 × 10 ⁻⁵	6.26 × 10 ⁻⁶	98	0.06 lb/MMBtu
	Ultra-Supercritical PC	0.442	0.634	0.737	0.088	0.018	2.84 × 10 ⁻⁵ to 15 × 10 ⁻⁵	5.6 × 10 ⁻⁶	98	0.06 lb/MMBtu
Sub-bituminous coal	IGCC	0.326	0.089	0.222	0.052	–	1.0 × 10 ⁻⁶ to 2.4 × 10 ⁻⁶	3.11 × 10 ⁻⁶	97.5	15 ppmvd @ 15 percent O ₂
	Subcritical PC	0.543	0.589	0.906	0.109	0.025	18 × 10 ⁻⁵ to 23 × 10 ⁻⁵	3.80 × 10 ⁻⁶	87 ^(g)	0.06 lb/MMBtu
	Supercritical PC	0.500	0.541	0.832	0.100	0.023	16.6 × 10 ⁻⁵ to 21 × 10 ⁻⁵	3.49 × 10 ⁻⁶	87 ^(g)	0.06 lb/MMBtu
	Ultra-supercritical PC	0.450	0.488	0.750	0.090	0.020	15 × 10 ⁻⁵ to 19 × 10 ⁻⁵	3.15 × 10 ⁻⁶	87 ^(g)	0.06 lb/MMBtu
Lignite coal	IGCC	0.375	0.150	0.225	0.053	–	1.0 × 10 ⁻⁶ to 2.4 × 10 ⁻⁶	5.48 × 10 ⁻⁶	99	15 ppmvd @ 15 percent O ₂
	Subcritical PC	0.568	0.814	0.947	0.114	0.026	18.9 × 10 ⁻⁵ to 24 × 10 ⁻⁵	6.9 × 10 ⁻⁶	95.8	0.06 lb/MMBtu
	Supercritical PC	0.524	0.751	0.873	0.105	0.024	17.5 × 10 ⁻⁵ to 22 × 10 ⁻⁵	6.37 × 10 ⁻⁶	95.8	0.06 lb/MMBtu
	Ultra-supercritical PC	0.498	0.714	0.830	0.100	0.022	16.6 × 10 ⁻⁵ to 21 × 10 ⁻⁵	6.06 × 10 ⁻⁶	95.8	0.06 lb/MMBtu

Footnotes on next page.

Table 4.3.2.1–1. (cont.)

IGCC = integrated gasification combined cycle.

- (a) Proximate analyses values (weight percent) for bituminous/sub-bituminous/lignite study coals include: weight percent ash 9.70/4.50/17.92; moisture 11.12/27.40/31.24; fixed carbon 44.19/36.70/22.96; volatiles 34.99/31.40/28.08. Higher heating values (btu/lb) for study coals are: 11,667/8,800/6,312.
- (b) None of the technologies represented in this table is equipped with carbon capture and storage (CCS) capability. The EPA study (EPA 2006) on which data in this table are based included only coal combustion technologies.
- (c) Particulate removal is 99.9 percent or greater for IGCC cases and 99.8 percent for bituminous coal, 99.7 percent for sub-bituminous coal, and 99.9 percent for lignite coal in the pulverized coal (PC) cases. Particulate matter emission rates shown include the overall filterable particulate matter only.
- (d) Little empirical evidence exists on the behavior of lead in IGCC facilities. The EPA anticipates that approximately 5 percent of the lead in the input coal will be emitted to the air, while the remaining lead will remain with gasifier slag and other solid wastes generated in other gas cleaning units.
- (e) As with lead, the behavior of mercury in IGCC systems is not well understood. It is anticipated that as much as 60 percent of coal-derived mercury will be potentially emitted to the atmosphere; however, fabric filters and scrubbers installed for particulate and SO₂ controls may effectively capture as much as 98 percent of the mercury present in exhaust gases. With the advent of mercury emission regulations and the installation of other devices specifically designed to capture mercury, the EPA expects that a larger fraction of mercury contained in the coal will ultimately be found in solid wastes generated in those mercury capture devices.
- (f) A percent removal for NO_x cannot be calculated with a basis (i.e., an uncontrolled unit), for comparison. Also, the PC and IGCC technologies use multiple technologies (e.g., combustion controls, selective catalytic reduction [SCR]) to control NO_x. NO_x emission comparisons are based on emission levels expressed in parts per million volume (dry basis) (ppmvd) at 15 percent oxygen for IGCC and lb/MMBtu for PC cases.
- (g) A relatively low SO₂ removal efficiency of 87 percent results from a relatively low sulfur content in sub-bituminous coal of only 0.22 percent. Higher removal efficiencies occur with higher sulfur-content coals.

Source: EPA 2006

Environmental Consequences and Mitigating Actions

Table 4.3.2.1-2. Performance and Cost Data for Fossil-Fuel-Fired Power Plants That Are Likely Alternatives to Retired Nuclear Reactors

Parameter	Integrated Gasification Combined Cycle					
	General Electric Energy		ConocoPhillips		Shell	
	No	Yes	No	Yes	No	Yes
CO ₂ capture	No	Yes	No	Yes	No	Yes
Gross power output (kWe)	770,350	744,960	742,510	693,840	748,020	693,555
Auxiliary power requirement (kWe)	130,100	189,285	119,140	175,600	112,170	176,420
Net power output (kWe)	640,250	555,675	623,370	518,240	635,850	517,135
Coal flow rate (lb/hr)	489,634	500,379	463,889	477,855	452,620	473,176
Natural gas flow rate (lb/hr)	NA ^(a)	NA	NA	NA	NA	NA
Higher heating value (HHV) thermal input (kWe)	1,674,044	1,710,780	1,685,023	1,633,771	1,547,493	1,617,772
Net plant HHV efficiency (percent)	38.2	32.5	39.3	31.7	41.1	32.0
Net plant HHV heat rate (Btu/kWh)	8,922	10,505	8,681	10,757	8,304	10,674
CO ₂ emissions (lb/hr)	1,123,781	114,476	1,078,144	131,328	1,054,221	103,041
CO ₂ emissions (tons/yr) @ CF ^(b)	3,937,728	401,124	3,777,815	460,175	3,693,990	361,056
CO ₂ emissions (lb/MMBtu)	197	19.6	199	23.6	200	18.7
CO ₂ emissions (kg/MWh) ^(b)	662	69.7	659	85.9	639	67.4
CO ₂ emissions (lb/MWh) ^(b)	1,469	154	1,452	189	1,409	149
CO ₂ emissions (lb/MWh) ^(c)	1,755	206	1,730	253	1,658	199
SO ₂ emissions (lb/hr)	73	56	68	48	66	58
SO ₂ emissions (tons/yr) @ CF ^(b)	254	196	237	167	230	204
SO ₂ emissions (lb/MMBtu)	0.012	0.0096	0.0125	0.0085	0.0124	0.0105
SO ₂ emissions (kg/MWh) ^(c)	0.0427	0.0341	0.0413	0.0311	0.0398	0.0380
SO ₂ emissions (lb/MWh) ^(c)	0.0942	0.0751	0.0909	0.0686	0.0878	0.0837
NO _x emissions (lb/hr)	313	273	321	277	309	269
NO _x emissions (tons/yr) @ CF ^(b)	1,096	955	1,126	972	1,082	944
NO _x emissions (lb/MMBtu)	0.055	0.047	0.059	0.050	0.058	0.049
NO _x emissions (kg/MWh) ^(c)	0.184	0.166	0.196	0.181	0.187	0.176
NO _x emissions (lb/MWh) ^(c)	0.406	0.366	0.433	0.400	0.413	0.388
PM emissions (lb/hr)	41	41	38	40	37	39
PM emissions (tons/yr) @ CF ^(b)	142	145	135	139	131	137
PM emissions (lb/MMBtu)	0.0071	0.0071	0.0071	0.0071	0.0071	0.0071
PM emissions (kg/MWh) ^(c)	0.024	0.025	0.023	0.026	0.023	0.026
PM emissions (lb/MWh) ^(c)	0.053	0.056	0.052	0.057	0.050	0.057
Hg emissions (lb/hr)	0.0033	0.0033	0.0031	0.0032	0.0030	0.0032
Hg emissions (tons/yr) @ CF ^(b)	0.011	0.012	0.011	0.011	0.011	0.011
Hg emissions (lb/MMBtu)	0.571	0.571	0.571	0.571	0.571	0.571
Hg emissions (kg/MWh) ^(b)	1.92E-06	2.03E-06	1.89E-06	2.08E-06	1.83E-06	2.08E-06
Hg emissions (lb/MWh) ^(b)	4.24E-06	4.48E-06	4.16E-06	4.59E-06	4.03E-06	4.55E-06

1
2
3
4

Environmental Consequences and Mitigating Actions

1

Table 4.3.2.1-2. (cont.)

Parameter	Pulverized Coal Boiler				NGCC	
	PC Subcritical		PC Supercritical		Advanced F Class	
	No	Yes	No	Yes	No	Yes
CO ₂ capture						
Gross power output (kWe)	583,315	679,923	580,260	663,445	570,200	520,090
Auxiliary power requirement (kWe)	32,870	130,310	30,110	117,450	9,840	38,200
Net power output (kWe)	550,445	549,613	550,150	545,995	560,360	481,890
Coal flow rate (lb/hr)	437,699	646,589	411,282	586,627	NA	NA
Natural gas flow rate (lb/hr)	NA	NA	NA	NA	165,182	165,182
HHV thermal input (kWe)	1,496,479	2,210,668	1,406,161	2,005,660	1,103,363	1,103,363
Net plant HHV efficiency (%)	36.8%	24.9%	39.1%	27.2%	50.8%	43.7%
Net plant HHV heat rate (Btu/kWh)	9,276	13,724	8,721	12,534	6,719	7,813
CO ₂ emissions (lb/hr)	1,038,110	152,975	975,370	138,681	446,339	44,634
CO ₂ emissions (tons/yr) @ CF ^(b)	3,864,884	569,524	3,631,301	516,310	1,661,720	166,172
CO ₂ emissions (lb/MMBtu)	203	20.3	203	20.3	119	11.9
CO ₂ emissions (kg/MWh) ^(c)	807	102	762	94.8	355	38.9
CO ₂ emissions (lb/MWh) ^(c)	1,780	225	1,681	209	783	85.8
CO ₂ emissions (lb/MWh) ^(d)	1,886	278	1,773	254	797	93
SO ₂ emissions (lb/hr)	433	Negligible	407	Negligible	Negligible	Negligible
SO ₂ emissions (tons/yr) @ CF ^(b)	1,613	Negligible	1,514	Negligible	Negligible	Negligible
SO ₂ emissions (lb/MMBtu)	0.0848	Negligible	0.0847	Negligible	Negligible	Negligible
SO ₂ emissions (kg/MWh) ^(c)	0.3369	Negligible	0.3179	Negligible	Negligible	Negligible
SO ₂ emissions (lb/MWh) ^(c)	0.7426	Negligible	0.7007	Negligible	Negligible	Negligible
NO _x emissions (lb/hr)	357	528	336	479	34	34
NO _x emissions (tons/yr) @ CF ^(b)	1,331	1,966	1,250	1,784	127	127
NO _x emissions (lb/MMBtu)	0.070	0.070	0.070	0.070	0.009	0.009
NO _x emissions (kg/MWh) ^(c)	0.278	0.352	0.263	0.328	0.027	0.030
NO _x emissions (lb/MWh) ^(c)	0.613	0.777	0.579	0.722	0.060	0.066
PM emissions (lb/hr)	66	98	62	89	Negligible	Negligible
PM emissions (tons/yr) @ CF ^(b)	247	365	232	331	Negligible	Negligible
PM emissions (lb/MMBtu)	0.0130	0.0130	0.0130	0.0130	Negligible	Negligible
PM emissions (kg/MWh) ^(c)	0.052	0.065	0.049	0.061	Negligible	Negligible
PM emissions (lb/MWh) ^(c)	0.114	0.144	0.107	0.134	Negligible	Negligible
Hg emissions (lb/hr)	0.0058	0.0086	0.0055	0.0078	Negligible	Negligible
Hg emissions (tons/yr) @ CF ^(b)	0.022	0.032	0.020	0.029	Negligible	Negligible
Hg emissions (lb/MMBtu)	1.14	1.14	1.14	1.14	Negligible	Negligible
Hg emissions (kg/MWh) ^(c)	4.54E-06	5.75E-06	4.29E-06	5.35E-06	Negligible	Negligible
Hg emissions (lb/MWh) ^(c)	1.00E-05	1.27E-05	9.45E-06	1.18E-05	Negligible	Negligible

(a) NA = not applicable.
 (b) Capacity factor (CF) is 80% for IGCC cases and 85% for PC and NGCC cases.
 (c) Value is based on gross output.
 (d) Value is based on net output.
 Source: NETL 2007a

2

3 Construction-related noise impacts would be substantially different offshore than those
 4 associated with onshore construction since these activities would be distant from most human
 5 receptors and because noise propagates much greater distances in water. Marine animals that
 6 use noise for navigation (e.g., echolocation) would be affected by construction-related noise.

1 Sources of noise would include crew vessels and construction and equipment barges; seismic
2 technologies used to characterize the site; explosives or pile driving to construct foundations for
3 offshore wind turbines or anchoring devices for wave, tidal, and current energy capturing
4 equipment; and excavation of sea bottoms for installation of buried power and communication
5 cables. Construction-related impacts on air quality and noise would generally be temporary.
6

7 *Operations* – The operational impacts of alternative energy technologies on air quality and
8 noise are presented in the following subsections.

9 **Hydroelectric Energy Sources**

10 Air quality would be affected by minor emissions of criteria pollutants during plant operations,
11 primarily from workforce vehicles and internal combustion engines on pumps, air compressors,
12 emergency power generators, and other support equipment.

13 **Geothermal**

14 Air quality would be affected by the release of criteria pollutants from vehicles and equipment
15 utilizing internal combustion engines. Air quality would be affected by the release of dissolved
16 hydrogen sulfide from geothermal fluids during well operation; installation of hydrogen sulfide
17 control/capture devices on wellheads would be required to regulate release to acceptable
18 levels. Air quality would be affected by the release of greenhouse gases, estimated to be 1570
19 lb/hr of greenhouse gases (carbon dioxide 92.3 percent, methane 0.1 percent) during
20 operation. Greenhouse gas emission rate is approximately 26 times less than the rate of
21 release from a fossil fuel-fired power plant. Air quality could also be affected by the release of
22 small amounts of acid rain precursors (NO_x, SO₂).

23 During winter months, air quality and visibility would be affected by ground-level fogging/icing
24 that could occur from cooling towers. Ambient noise levels would be affected by cooling
25 towers, compressors, and internal combustion engines and manipulation of fluids under high
26 pressure. Noise could be as much as 45 dB above background at offsite locations.

27 **Wind**

28 Wind farms would have no discernible impacts on air quality. Noise impacts would include
29 aerodynamic noise from the turbine rotor and mechanical noise from turbine drivetrain
30 components.

31 Noise from offshore wind farms consisting of aerodynamic and mechanical noise from the wind
32 turbine transmitted underwater via the tower could affect marine species, especially those that
33 use echolocation to navigate. Onshore components of offshore wind facilities would affect land
34 animals when located at or near important habitats. Because of water density, noise travels
35 proportionally greater distances under water; thus, the area over which noise impacts may
36 occur would be much greater for offshore wind farms

Environmental Consequences and Mitigating Actions

1 **Biomass**

2 Air impacts would result from feedstock handling activities (storage, crushing/grinding, loading
3 conveyors, etc.) and combustion. Combustion of biomass generally results in smaller amounts
4 of greenhouse gas (primarily CO₂) than combustion of fossil fuel. For some biomass sources
5 such as energy crops, the amount of CO₂ released during their combustion is roughly
6 equivalent to the amount absorbed by the plants during their growing cycle. Except for
7 greenhouse gas emissions of vehicles and equipment used to plant, cultivate, and harvest,
8 energy crops are considered to be greenhouse gas-neutral with respect to their application in
9 electrical energy production. Conversion to energy of biomass that would otherwise be
10 managed as a solid waste represents a net greenhouse gas “sink” since combustion for energy
11 production avoids the greenhouse gas emissions (primarily methane) that would have resulted
12 from the landfilling and decomposition of such materials. Example criteria pollutant impacts (in
13 lb/MWh) include:

14	SO _x	Wood waste burned in stoker boiler	0.08
15		Fluidized bed combustion	0.08
16		Energy crops combusted in IGCC system	0.05
17	NO _x	Wood waste burned in stoker boiler	2.1
18		Fluidized bed combustion	0.9
19		Energy crops combusted in IGCC system	2.2
20	CO	Wood waste burned in stoker boiler	12.2
21		Fluidized bed combustion	0.17
22		Energy crops combusted in IGCC system	0.23
23	PM ₁₀	Wood waste burned in stoker boiler	0.50
24		Fluidized bed combustion	0.3
25		Energy crops combusted in IGCC system	0.01
26		(NREL 2003).	

27

28 A 200-MW cofiring wood biomass coal facility (where biomass is 15 percent of the total heat
29 input) operating in 2030 with an 80 percent capacity factor providing 771 GWh/yr electricity
30 would have the following air emissions:

31	SO ₂	36,200 MT/yr (40,544 T/yr)
32	CO ₂	2,900,200 MT/yr (3,248,224 T/yr)
33		(EERE 1997).

34 Noise impacts from biomass combustion facilities would be similar in nature and magnitude to
35 coal-fired plants of equivalent size and capacity.

1 **Municipal Solid Waste, Refuse-Derived Fuel and Landfill Gas**

2 Air impacts from combustion of refuse-derived fuel would be dependent on the quality of the
3 fuel. Criteria and hazardous air pollutants could be released if not removed during refuse-
4 derived fuel production. Air pollutants of concern include hydrochloric acid, NO, sulfuric acid,
5 arsenic, cadmium, chromium (VI), dioxins/furans, various PAHs, chlorinated benzenes, dienes,
6 phenols, and PCBs. Air quality could be affected by the release of dioxins and other PAHs from
7 the incomplete combustion of fuel. Noise impacts from municipal solid waste, refuse-derived
8 fuel, and landfill gas combustion facilities would be similar in nature and intensity to coal-fired
9 and natural gas-fired power plants. Noise sources would include municipal solid waste
10 feedstock preparation activities (cutting grinding, etc., to produce a feedstock of uniform size)
11 and pump and compressor noise from the collection and transfer of landfill gas.

12 **Solar Thermal**

13 Dust could be released due to the removal of vegetation. Noise during operations would
14 include mechanical noise from operation of powerblock components (steam cycle and cooling
15 system pumps, turbines, and generators), and pump noise from circulation of heat transfer
16 fluids, cooling tower noise (fans, cascading water).

17 **Solar Photovoltaic**

18 Dust could be released from the plant site due to the removal of vegetation. Individual
19 photovoltaic cells could release toxic heavy metals to the atmosphere (primarily cadmium,
20 selenium, and arsenic) in the event of fire. Virtually no discernible noise or air quality impacts
21 would result from the routine operation of the facility.

22 **Ocean Wave and Current**

23 Air quality would be only minimally affected by facility operation; air quality would be affected by
24 the release of criteria pollutants during periodic inspection, maintenance, and repair; vessels are
25 expected to burn low-sulfur diesel fuel. Onshore air quality would be affected by the release of
26 criteria pollutants from workforce vehicles and the possible release of fugitive dust from onshore
27 support facilities. Mechanical noise from moving parts and hydrodynamic noise from the
28 interaction of turbine blades with water would minimally affect the ambient above-water noise
29 environment; underwater noise sources (primarily turbine blades, mechanical noise from other
30 moving parts, and vessel propellers) could travel great distances and could affect marine
31 organisms, especially those utilizing echolocation.

32

4.4 Geology and Soils

4.4.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities

The impacts on geology and soils during the license renewal term were not considered in the 1996 GEIS. Geology and soils conditions at all nuclear power plants and associated transmission lines have been well established during the current licensing term. These conditions are expected to remain unchanged during the 20-year license renewal term.

The impact of continued operations and refurbishment activities during the license renewal term on geologic and soil resources would consist of soil disturbance for projects, such as replacing or adding buildings, roads, parking lots, and belowground and aboveground utility structures. Implementing best management practices would reduce soil erosion and subsequent impacts on surface water quality. These practices include, but are not limited to, minimizing the amount of disturbed land, stockpiling topsoil before ground disturbance, mulching and seeding in disturbed areas, covering loose materials with geotextiles, using silt fences to reduce sediment loading to surface water, using check dams to minimize the erosive power of drainages, and installing proper culvert outlets to direct flows in streams or drainages. Detailed geotechnical analyses would be required to address the stability of slope cuts in the creation of roads or other refurbishment-related construction projects. Depending on the plant location and design, riverbank or coastline protection might need to be upgraded, especially at water intake or discharge structures, if natural flows, such as storm surges, cause an increase in erosion. In addition, the Farmland Protection Policy Act requires Federal agencies to take into account agency actions affecting the preservation of farmland.

As discussed in Section 3.4, nuclear power plants are constructed according to seismic specifications in 10 CFR Part 50, Appendix S. Spent fuel pools are designed with reinforced concrete, allowing them to remain operable through the largest earthquake that has occurred or is expected to occur in the vicinity of a nuclear power plant.

Plant-specific environmental reviews conducted by the NRC have not identified any significant impact issues related to geology and soils. Consequently, the impact of continued operations and refurbishment activities would be small for all nuclear plants and a Category 1 issue.

4.4.2 Environmental Consequences of Alternatives to the Proposed Action

Construction – Land would be cleared of vegetation during construction. Soils would be stored onsite for redistribution at the end of construction. Land clearing during construction and the

1 installation of power plant structures and impervious pavements would alter surface drainage.
2 Natural drainage patterns at brownfield sites have been previously altered.

3
4 *Operation* – No additional impacts on geology and soils are anticipated beyond those occurring
5 during construction.

6 **4.4.2.1 Renewable Alternatives**

7
8 *Operations* – The operational impacts of alternative energy technologies on geology and soils
9 are presented in the following subsections.

10

11 **Hydroelectric Energy Sources**

12 Geology and soils in the immediate area of a dam and reservoir would be affected by
13 sedimentation in the reservoir basin and changes in upstream and downstream erosion
14 patterns. Dams would induce downstream impacts such as low and high flow conditions,
15 changes in sediment transport and deposition patterns, and channel erosion or scouring.

16 **Geothermal**

17 The power plant could be affected by earthquakes or volcanic activity in the seismically active
18 area in which the geothermal resource is located. The injection of cooled geothermal fluids
19 might induce microseismic activity. The removal of large quantities of groundwater and
20 geothermal fluids could result in land subsidence.

21 **Biomass**

22 Soils would be affected by contaminants potentially present in runoff from unprotected piles of
23 feedstock materials, fly ash and bottom ash, and scrubber sludge. Farming could result in soil
24 erosion and the release of pesticides and fertilizers to nearby water bodies or to shallow
25 groundwater aquifers.

26 **Solar Thermal and Photovoltaic**

27 This alternative requires a large amount of land. To avoid a fire hazard, solar collection devices
28 would need to be kept free of vegetation. This practice could result in soil erosion in cleared
29 areas by wind and precipitation runoff.

30

31

4.5 Hydrology

Hydrologic conditions at all nuclear power plants and associated transmission lines have been well established during the current licensing term. However, continued operations and refurbishment activities could have an impact on water resources during the license renewal term. This section describes the potential impact of these activities on surface water and groundwater resources.

4.5.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities

Continued operations and refurbishment activities during the license renewal term could affect surface water and groundwater resources in a manner similar to what has occurred during the current license term (see Sections 3.5.1 and 3.5.2, respectively).

4.5.1.1 Surface Water

For the most part, no significant surface water impacts are anticipated during the license renewal term that would be different from those occurring during the current license term. Certain operational changes (such as a power uprate) affecting surface water would be evaluated by the NRC in a separate environmental assessment. For potential impacts to water resources, the use of surface water is of greatest concern because of the high volumetric flow rates required for condenser cooling at power plants. Withdrawals from surface water bodies are high for both once-through and closed-cycle cooling systems. Consumptive water use occurs through evaporation and drift, especially from cooling towers, and may affect water availability downstream of plants along rivers. Associated impacts on surface water quality may result from the discharge of thermal effluent containing chemical additives. Other potential impacts on surface water are the result of normal industrial plant activities during the license renewal term.

The following issues concern impacts on surface water that may occur during the license renewal term:

- Impacts of continued operations and refurbishment activities on surface water use and quality (combination of two issues evaluated in the 1996 GEIS: (1) impacts of refurbishment on surface water quality and (2) impacts of refurbishment on surface water use);
- Altered current patterns at intake and discharge structures (evaluated in the 1996 GEIS);

Environmental Consequences and Mitigating Actions

- 1
- 2 • Altered salinity gradients (evaluated in the 1996 GEIS);
- 3
- 4 • Altered thermal stratification of lakes (evaluated in the 1996 GEIS);
- 5
- 6 • Scouring caused by discharged cooling water (evaluated in the 1996 GEIS);
- 7
- 8 • Discharge of metals in cooling system effluent (evaluated in the 1996 GEIS);
- 9
- 10 • Discharge of biocides, sanitary wastes, and minor chemical spills (combination of two
- 11 issues evaluated in the 1996 GEIS: (1) discharge of chlorine or other biocides and
- 12 (2) discharge of sanitary wastes and minor chemical spills);
- 13
- 14 • Water use conflicts for plants with once-through cooling systems (evaluated in
- 15 the 1996 GEIS);
- 16
- 17 • Water use conflicts for plants with cooling ponds or cooling towers using makeup water
- 18 from a river with low flow (evaluated in the 1996 GEIS);
- 19
- 20 • Effects of dredging on water quality (new issue not considered in the 1996 GEIS); and
- 21
- 22 • Temperature effects on sediment transport capacity (evaluated in the 1996 GEIS).
- 23

24 *Impacts of Continued Operations and Refurbishment on Surface Water Use and Quality*

25
26 This issue is a combination of two 1996 GEIS issues (impacts of refurbishment on surface water
27 quality and impacts of refurbishment on surface water use). Continued operations and
28 refurbishment activities could result in soil erosion and spills of hydrocarbon fuels, paints, or
29 other chemicals which may affect the quality of receiving waters. Because best management
30 practices (e.g., minimizing the amount of disturbed land, mulching and seeding in disturbed
31 areas, using silt fences to reduce sediment loading to surface water, using check dams and
32 installing proper culvert outlets to minimize the erosive power of drainages) are expected to be
33 followed during such activities, soil erosion would be minimized. Implementation of spill
34 prevention and control plans would reduce the likelihood of any liquid chemical spills.

35
36 Water is used during refurbishment activities for concrete production or dust control; however,
37 the volume used would be insignificant when compared with that used by the cooling system.
38 Depending on site factors, the facility might opt to use groundwater for refurbishment purposes.
39 In addition, if the refurbishment took place during a reactor shutdown, the overall water use by
40 the facility would be greatly reduced.

41

Environmental Consequences and Mitigating Actions

1 The impacts of continued operations and refurbishment on surface water use and quality during
2 the license renewal term were considered to be small for all plants and were designated as
3 Category 1 issues in the 1996 GEIS. No new information in plant-specific SEISs or associated
4 literature has been identified that would change this conclusion. On the basis of these
5 considerations, the impact of continued operations and refurbishment activities on surface
6 water resources would be small for all nuclear plants and remains a Category 1 issue.

7

8 *Altered Current Patterns at Intake and Discharge Structures*

9

10 The large flow rates associated with cooling system water use have the potential to alter current
11 patterns. The degree of influence depends on the design and location of the intake and
12 discharge structures and the characteristics of the surface water body. The effect on currents
13 near the intake and discharge locations is expected to be localized, and any problems would
14 have been mitigated during the early operational period of a plant (NRC 1996). Most nuclear
15 power plants are sited on large bodies of water to make use of the water for cooling purposes.
16 The size of large rivers, lakes, or reservoirs precludes significant current alterations except in
17 the vicinity of the structures. For ocean shore or bay settings, the effect is further reduced
18 when compared with the strong natural water movement patterns. For example, current
19 patterns have been modified at the Oyster Creek plant, which is located inland from Barnegat
20 Bay in New Jersey. The once-through cooling system for this plant was created by modifying
21 two small rivers originally flowing parallel into the bay. On the north side of the plant, the South
22 Branch of the Forked River was enlarged between the plant and the bay to serve as an intake
23 canal. On the south side of the plant, Oyster Creek was enlarged between the plant and the
24 bay for use as a discharge canal. Near the plant, the two waterways were joined. Bay water is
25 pulled from the bay through the intake canal to the plant, against the original flow direction of
26 the lowest reach of the South Branch of the Forked River. Flow at the mouth of this river is
27 therefore both reversed and significantly increased, while flow at the mouth of the Oyster Creek
28 discharge canal is significantly increased. While current patterns in Barnegat Bay in the
29 immediate vicinity of the intake and discharge canals are affected by operations, the effect is
30 minor on the overall Barnegat Bay system (NRC 1996, 2007b).

31

32 This issue has no relevance to plants relying on cooling ponds because they are man-made
33 features without natural currents.

34

35 Impacts from altered current patterns at intake and discharge structures during the license
36 renewal term were considered to be small for all plants and were designated as a Category 1
37 issue in the 1996 GEIS. No new information has been identified in plant-specific SEISs or
38 associated literature that would change this conclusion. On the basis of these considerations,
39 the impact of altered current patterns at intake and discharge structures would be small for all
40 nuclear plants and remains a Category 1 issue.

41

1 *Altered Salinity Gradients*

2

3 This issue relates to plants located on estuaries and addresses changes in salinity caused by
4 cooling system water withdrawals and discharges. Using the same example site as for the
5 current patterns issue, the Oyster Creek plant's construction included modification of the lower
6 reaches of two creeks. These portions of the creeks were originally brackish, with a mix of
7 freshwater from their upper reaches and tidally influenced bay water. Because of the cooling
8 system operations, the water quality of these lower reaches now essentially matches that of
9 Barnegat Bay, with contributions of freshwater from their upper reaches being relatively minor.
10 These lower reaches are also affected by occasional dredging activities, and the discharge
11 canal receives water to which heat and chemicals have been added. The salinity changes do
12 not affect the upper portions of these streams. In the 1996 GEIS, only minor effects had been
13 noted in Barnegat Bay.

14

15 In the 1996 GEIS and Calvert Cliffs SEIS (NRC 1999b), the Calvert Cliffs plant on the
16 Chesapeake Bay, has not had important effects on bay salinity. Altered salinity gradients are
17 expected to be noticeable only in the immediate vicinity of intake and discharge structures.

18

19 Impacts from altered salinity gradients at intake and discharge structures during the license
20 renewal term were considered to be small for all plants and were designated as Category 1
21 issues in the 1996 GEIS. No new information has been identified in plant-specific SEISs or
22 associated literature that would alter this conclusion. On the basis of these considerations, the
23 impact of altered salinity gradients would be small for all nuclear plants and remains a Category
24 1 issue.

25

26 *Altered Thermal Stratification of Lakes*

27

28 Because cooling systems typically withdraw from the deeper, cooler portion of the water column
29 of lakes or reservoirs and discharge to the surface, they have the ability to alter the thermal
30 stratification of the surface water. This is not considered an issue for rivers or oceans because
31 of mixing caused by natural turbulence.

32

33 A thermal plume of discharge water loses heat to the atmosphere and to the receiving surface
34 water body. It also undergoes mixing with the surface water. In the 1996 GEIS, examples
35 included the Oconee plant in South Carolina, where the withdrawal of cool, deep water for
36 cooling purposes favors warmwater fish species at the expense of coolwater fish. Mitigation of
37 this effect is possible by modifying the allowable discharge water temperature. In an example
38 from the McGuire power plant in North Carolina, a modeling study indicated that increasing the
39 permitted discharge temperature would reduce the withdrawal of cool, deep water and conserve
40 coolwater species habitat.

41

Environmental Consequences and Mitigating Actions

1 Thermal plumes may be studied through field measurements and modeling studies. For plants
2 on lakes or reservoirs, the thermal effect on stratification is examined periodically through the
3 National Pollutant Discharge Elimination System (NPDES) permit renewal process. Problems
4 with thermal stratification due to nuclear power plant operations have not been encountered.
5

6 Impacts from altered thermal stratification of lakes and reservoirs during the license renewal
7 term were considered to be small for all plants and were designated as Category 1 issues in the
8 1996 GEIS. No new information has been identified in plant-specific SEISs or associated
9 literature that would alter this conclusion. On the basis of these considerations, the impact of
10 altered thermal stratification of lakes would be small for all nuclear plants and remains a
11 Category 1 issue.
12

13 *Scouring Caused by Discharged Cooling Water* 14

15 The high flow rate of water from a cooling system discharge structure has the potential to scour
16 sediments and redeposit them elsewhere. The scouring will remove fine-grained sediments,
17 resulting in turbidity, and leave behind coarse-grained sediments.
18

19 The degree of scouring depends on the design of the discharge structure and the character of
20 the sediments. Scouring is expected to occur only in the vicinity of the discharge structure
21 where flow rates are high. While scouring is possible during reactor startup, operational
22 periods would typically have negligible scouring. Natural sediment transport processes could
23 bring fresh sediment into the discharge flow area. These processes include transport due to
24 ocean currents, tides, river meandering, and storm events.
25

26 In the 1996 GEIS, scouring had not been noted as a problem at most plants and had been
27 observed at only three nuclear power plants (Calvert Cliffs, Connecticut Yankee [no longer
28 operating], and San Onofre). The effects at these plants were localized and minor.
29

30 Impacts from scouring caused by discharged cooling water during the license renewal term
31 were considered to be small for all plants and were designated as a Category 1 issue in the
32 1996 GEIS. No new information has been identified in plant-specific SEISs or associated
33 literature that would alter this conclusion. On the basis of these considerations, the impact of
34 scouring caused by discharged cooling water is small for all nuclear plants and remains a
35 Category 1 issue.
36

37 *Discharge of Metals in Cooling System Effluent* 38

39 Heavy metals such as copper, zinc, and chromium can be leached from condenser tubing and
40 other components of the heat exchange system by circulating cooling water. These metals are
41 normally addressed in NPDES permits because high concentrations of them can be toxic to

1 aquatic organisms. During normal operations, concentrations are normally below laboratory
 2 detection levels. However, plants occasionally undergo planned outages for refueling, with
 3 stagnant water remaining in the heat exchange system. During an outage at the Diablo Canyon
 4 plant in California, the longer residence time of water in the cooling system resulted in elevated
 5 copper levels in the discharge when operations resumed; abalone (*Haliotis spp.*) deaths were
 6 attributed to the increased copper (NRC 1996). At the Robinson plant in South Carolina, the
 7 gradual accumulation of copper in its reservoir resulted in impacts on the bluegill (*Lepomis*
 8 *macrochirus*) population. In both cases, copper condenser tubes were replaced with titanium
 9 ones, and the problem was eliminated (NRC 1996).

10
 11 Impacts from the discharge of metals in cooling system effluent during the license renewal term
 12 were considered to be small for all plants and were designated as a Category 1 issue in the
 13 1996 GEIS. No new information has been identified in plant-specific SEISs or associated
 14 literature that would alter this conclusion. On the basis of these considerations, the impact of
 15 the discharge of metals in cooling system effluent would be small for all nuclear plants and
 16 remains a Category 1 issue.

17
 18 *Discharge of Biocides, Sanitary Wastes, and Minor Chemical Spills*

19
 20 The use of biocides is common and is required to control biofouling and nuisance organisms in
 21 plant cooling systems. However, the types of chemicals, their amounts or concentrations, and
 22 the frequency of their use may vary. The use of biocides at nuclear power plants was
 23 discussed generally in Section 3.5.1. Ultimately, any biocides used in the cooling system are
 24 discharged to surface water bodies. The discharge of treated sanitary waste also occurs at
 25 plants. Discharge may occur via onsite wastewater treatment facilities, via an onsite septic
 26 field, or through a connection to a municipal sewage system. Minor chemical spills collected in
 27 floor drains are associated with industry in general and are a possibility at all plants. Each of
 28 these factors represents a potential impact on surface water quality. In the 1996 GEIS, the
 29 impacts of these releases were evaluated as two issues: (1) discharge of chlorine or other
 30 biocides and (2) discharge of sanitary wastes and minor chemical spills. Here they are treated
 31 as a single issue.

32
 33 Discharge of cooling water is monitored through individual State NPDES programs. The flow
 34 rate and chemical content of the water at discharge outfalls are regulated by State oversight in
 35 accordance with the NPDES permit. Wastewater discharge is also covered through NPDES
 36 permitting, and it includes biochemical monitoring parameters. Discharge from building drains
 37 is also addressed in the NPDES permit. Because of State regulatory involvement, and because
 38 regulatory and resource agencies have not found significant problems with outfall monitoring,
 39 the impacts from the discharge of chlorine and other biocides and minor spills of sanitary
 40 wastes and chemicals during license renewal and refurbishment were considered to be small
 41 for all plants and designated as Category 1 issues in the 1996 GEIS. No new information has

Environmental Consequences and Mitigating Actions

1 been identified in plant-specific SEISs or associated literature that would alter this conclusion.
2 On the basis of these considerations, the discharge of biocides, sanitary wastes, and minor
3 chemical spills would be small for all nuclear plants and remains a Category 1 issue.

4 5 *Water Use Conflicts (Plants with Once-Through Cooling Systems)* 6

7 Nuclear power plant cooling systems may compete with other users relying on surface water
8 resources, including downstream municipal, agricultural, or industrial users. Once-through and
9 closed-cycle cooling systems have different water consumption rates. Once-through cooling
10 systems return most of their withdrawn water to the same surface water body, with evaporative
11 losses of less than 3 percent (Solley et al. 1998). Consumptive use by plants with once -
12 through cooling systems during the license renewal term is not expected to change unless
13 power uprates, with associated increases in water use, are proposed. Such uprates would
14 require an environmental assessment by the NRC.

15
16 Future scenarios for water availability focus on climate change and associated changes in
17 precipitation and temperature patterns. Increased temperatures and/or decreased rainfall
18 would result in lower river flows, increased cooling pond evaporation, and lowered water levels
19 in the Great Lakes or reservoirs. While weather will vary from year to year, the results of
20 climate change models and the projected changes to surface water runoff in the 21st century
21 (NETL 2006) predicted increases in runoff in the eastern United States and decreases in runoff
22 in the western United States, where water is currently less available. Regardless of overall
23 climate change, droughts could result in problems with water supplies and allocations. Because
24 future agricultural, municipal, and industrial users would continue to share their demands for
25 surface water with power plants, conflicts might arise if the availability of this resource
26 decreased. This situation would then necessitate decisions by local, State, and regional water
27 planning officials.

28
29 Population growth around nuclear power plants has caused increased demand caused
30 increased demand on municipal water systems, including systems that rely on surface water.
31 Municipal intakes located downstream of a nuclear power plant could experience water
32 shortages, especially in times of drought. Water demands upstream of a plant could impact the
33 water availability at the plant's intake.

34
35 In the 1996 GEIS, impacts of continued operations and refurbishment on water use conflicts
36 associated with once-through cooling systems were considered to be small and were
37 designated as a Category 1 issue. No new information has been identified in plant-specific
38 SEISs or associated literature that would alter this conclusion. On the basis of these
39 considerations, the NRC concludes that the impact on water use conflicts from the continued
40 operation and refurbishment activities would be small for plants that utilize once-through cooling
41 and remains a Category 1 issue.

1
2 *Water Use Conflicts (Plants with Cooling Ponds or Cooling Towers Using Makeup Water*
3 *from a River with Low Flow)*

4
5 Nuclear power plant cooling systems may compete with other users relying on surface water
6 resources, including downstream municipal, agricultural, or industrial users. Closed-cycle
7 cooling is not completely closed, because the system discharges blowdown water to a surface
8 water body and withdraws water for makeup of both the consumptive water loss due to
9 evaporation and drift (for cooling towers) and blowdown discharge. For plants using cooling
10 towers, the makeup water needed to replenish the consumptive loss of water to evaporation can
11 be significant and is reported at 60 percent or more of the condenser flow rate by
12 Solley et al. (1998). Cooling ponds will also require makeup water as a result of naturally
13 occurring evaporation, evaporation of the warm effluent, and possible seepage to groundwater.
14

15 Consumptive use by plants with cooling ponds or cooling towers using makeup water from a
16 river with low flow during the license renewal term is not expected to change unless power
17 uprates, with associated increases in water use, are proposed. Such uprates would require an
18 environmental assessment by the NRC.
19

20 As stated earlier, increased temperatures and/or decreased rainfall would result in lower river
21 flows, increased cooling pond evaporation, and lowered water levels in the Great Lakes or
22 reservoirs. Regardless of overall climate change, droughts could result in problems with water
23 supplies and allocations. Conflicts might arise due to competing agricultural, municipal, and
24 industrial user demands for surface water with power plants. Closed cooling systems are more
25 susceptible to these issues than once-through cooling systems because they consume more
26 water. For this reason, climate change is more of a potential concern for water use conflicts
27 among closed systems.
28

29 Population growth around nuclear power plants has caused increased demand on municipal
30 water systems, including systems that rely on surface water. Municipal intakes located
31 downstream of a nuclear power plant could experience water shortages, especially in times of
32 drought. Similarly, water demands upstream of a plant could impact the water availability at the
33 plant's intake.
34

35 The SEIS for the Wolf Creek plant in Kansas identified a site-specific water use conflict with a
36 small to moderate impact (NRC 2008a). Makeup water for the Wolf Creek cooling lake (Coffee
37 County Lake) is withdrawn from the Neosho River downstream of John Redmond Reservoir.
38 The ecosystem downstream of this reservoir includes an endangered fish species, the Neosho
39 madtom (*Noturus placidus*), which may be affected by the plant's water use during periods
40 when the lake level is low and makeup water is obtained from the Neosho River.
41

Environmental Consequences and Mitigating Actions

1 As discussed in the 1996 GEIS, water use conflicts have also been observed for plants with
2 closed-cycle cooling systems. The Limerick plant on the Schuylkill River in Pennsylvania is
3 cited as an example of a plant on which limits were imposed on the rate of withdrawal from a
4 river for the purpose of avoiding water use conflicts, including downstream water availability and
5 water quality. Availability problems for downstream habitat and users have also been identified
6 as a conflict at the Palo Verde plant in Arizona and may be anticipated at other plants.

7
8 Water use conflicts associated with plants with cooling ponds or cooling towers using make-up
9 water from a river with low flow were considered to vary among sites because of differing site-
10 specific factors, such as makeup water requirements, water availability (especially in terms of
11 varying river flow rates), changing or anticipated changes in population distributions, or changes
12 in agricultural or industrial demands. No new information has been identified in plant-specific
13 SEISs or associated literature has been identified that would alter this conclusion.

14
15 On the basis of these considerations, the impact of water use conflicts from the continued
16 operation and refurbishment activities at plants with cooling ponds or cooling towers using
17 makeup water from a river with low flow could be small or moderate, depending on factors such
18 as plant-specific design characteristics affecting consumptive water use, the characteristics of
19 the water body serving as the source for makeup water, and the amount of competing use for
20 that water. Because the impact could vary among nuclear plants, the issue is considered to be
21 Category 2.

22 *Effects of Dredging on Water Quality*

23
24
25 Dredging in the vicinity of surface water intakes, canals, and discharge structures takes place in
26 order to remove deposited sediment and maintain the function of plant cooling systems.
27 Dredging may also be needed to maintain barge shipping lanes. Whether accomplished by
28 mechanical, suction, or other methods, dredging disturbs sediments in the surface water body
29 and affects surface water quality. In pristine locations, the impact will affect the turbidity of the
30 water column. In areas affected by industries, dredging can also mobilize heavy metals,
31 polychlorinated biphenyls (PCBs), or other contaminants in the sediments.

32
33 The frequency of dredging depends on the rate of sedimentation. At the Oyster Creek plant in
34 New Jersey, dredging took place during site construction to create canals for the once-through
35 cooling system (NRC 2007b). Depth measurements are performed here every two years, and
36 dredging has taken place on portions of the canal system since construction. At the
37 Susquehanna plant in Pennsylvania, the plant's river intake and diffuser pipe are dredged
38 annually (NRC 2008b). In general, maintenance dredging affects localized areas for a brief
39 period of time. Dredging operations are performed under permits issued by the U.S. Army
40 Corps of Engineers (USACE). State permits may also be required. The permitting process
41 may include planning for the sampling and disposal of the dredged sediments.

1
2 The impact of dredging has not been found to be a problem at operating nuclear power plants.
3 Dredging has localized effects on water quality that tend to be short-lived. The impact of
4 dredging on water quality would be small for all nuclear plants and is considered a Category 1
5 issue.

6 7 *Temperature Effects on Sediment Transport Capacity*

8
9 Increased temperature and the resulting decreased viscosity have been hypothesized to
10 change the sediment transport capacity of water, leading to potential sedimentation problems,
11 altered turbidity of rivers, and changes in riverbed configuration. Coutant (1981) discussed the
12 theoretical basis for such possible changes, as well as relevant field investigations, and
13 concluded that there is no indication that this is a significant problem at operating power
14 stations. Examples of altered sediment characteristics are more likely the result of power plant
15 structures (e.g., jetties or canals) or current patterns near intakes and discharges; such
16 alterations are readily mitigated.

17
18 Based on review of literature and operational monitoring reports, consultations with utilities and
19 regulatory agencies, and public comments on previous license renewal reviews, there is no
20 evidence that temperature effects on sediment transport capacity have caused adverse
21 environmental effects at any existing nuclear power plant. Regulatory agencies have
22 expressed no concerns regarding the impacts of temperature effects on sediment transport
23 capacity. Furthermore, because of the small area near the plant affected by increased water
24 temperature, it is not expected that plant operations would have a significant impact. Effects are
25 considered to be of small significance for all plants. No change in the operation of the cooling
26 system is expected during the license renewal term so no change in effects on sediment
27 transport capacity is anticipated. This is considered a Category 1 issue.

28 29 **4.5.1.2 Groundwater**

30
31 Operational activities during the license renewal term would be similar to those occurring during
32 the current license term and would not affect groundwater resources. The impact issues of
33 concern are availability of groundwater and the effect of nuclear plant operations on water
34 quality.

35
36 The following nine issues concern impacts on groundwater that may occur during the license
37 renewal term:

- 38
39 • Impacts of continued operations and refurbishment activities on groundwater use and
40 quality (issue modified from the 1996 GEIS to include the impacts of continued
41 operations);

Environmental Consequences and Mitigating Actions

- 1
- 2 • Groundwater use conflicts for plants that withdraw less than 100 gallons per
- 3 minute (gpm) (378 L/min) (evaluated in the 1996 GEIS);
- 4
- 5 • Groundwater use conflicts for plants that withdraw more than 100 gpm (378 L/min)
- 6 including those using Ranney wells (combination of two issues from the 1996
- 7 GEIS: (1) groundwater use conflicts for potable and service water and dewatering for
- 8 plants that use more than 100 gpm (378 L/min) and (2) groundwater use conflicts for
- 9 plants that use Ranney wells);
- 10
- 11 • Groundwater use conflicts for plants with closed-cycle cooling systems that withdraw
- 12 makeup water from a river (issue modified from the 1996 GEIS to include all rivers);
- 13
- 14 • Groundwater quality degradation resulting from water withdrawals (combination of two
- 15 issues from the 1996 GEIS: (1) groundwater quality degradation for plants that use
- 16 Ranney wells and (2) groundwater quality degradation from saltwater intrusion);
- 17
- 18 • Groundwater quality degradation for plants using cooling ponds in salt marshes
- 19 (evaluated in the 1996 GEIS);
- 20
- 21 • Groundwater quality degradation for plants using cooling ponds at inland sites
- 22 (evaluated in the 1996 GEIS);
- 23
- 24 • Groundwater and soil contamination (new issue not considered in the 1996 GEIS); and
- 25
- 26 • Radionuclides released to groundwater (new issue not considered in the 1996 GEIS);
- 27

Impacts of Continued Operations and Refurbishment Activities on Groundwater Use and Quality

30

31 As mentioned in Section 3.5.2, the original construction of some plants required dewatering of a

32 shallow aquifer, and operational dewatering takes place at some plants. This is accomplished

33 by systems of pumping wells or drain tiles. Continued operations and refurbishment activities

34 during the license renewal term are not expected to require any significant dewatering that

35 would have an incremental effect over that which has already taken place. During continued

36 operations and refurbishment, any wastes or spills (e.g., fuels and paints) affecting groundwater

37 quality would be addressed in a manner consistent with best management practices, such as

38 using secondary containment for fuels and implementing spill prevention and control plans.

39 Soils contaminated by spills may need to be excavated for remediation before the chemicals

40 leach to the shallow groundwater.

41

1 In the 1996 GEIS, the groundwater impacts associated with refurbishment activities were
2 considered to be small for all nuclear plants and designated as Category 1. No new information
3 has been identified in plant-specific SEISs or associated literature that would alter this
4 conclusion. On the basis of these considerations, the impact of continued operations and
5 refurbishment activities during the license renewal term on groundwater use and quality would
6 be small for all nuclear plants and remains a Category 1 issue.

7
8 *Groundwater Use Conflicts for Plants That Withdraw Less Than 100 Gallons per Minute*
9

10 Water wells are commonly used at sites to provide water for the potable water system, although
11 municipal water is available at some nuclear plants. Groundwater may also be used for
12 landscaping (see Section 3.5.2). At some sites, groundwater is the source for the makeup and
13 service water systems. In this case, the water undergoes treatment to prepare it for the
14 intended use.

15
16 The pumping of groundwater creates a cone of depression in the potentiometric surface around
17 the pumping well. The amount the water table or potentiometric surface declines and the
18 overall extent of the cone depend on the pumping rate, characteristics of the aquifer (e.g., its
19 permeability), whether the aquifer is confined or unconfined, and certain boundary conditions
20 (including the nearby presence of a hydrologically connected surface water body). Generally,
21 plants with a peak withdrawal rate of less than 100 gpm (378 L/min) do not have a significant
22 cone of depression. Their potential for causing conflict with other groundwater users would
23 depend largely on the proximity of the other wells. As stated in the 1996 GEIS, cones of
24 depression usually do not extend past the property boundary, reducing the possibility of a
25 groundwater use conflict.

26
27 In the 1996 GEIS, the groundwater impacts associated with continued operations during the
28 license renewal term were considered to be small for all nuclear plants and designated as
29 Category 1. No new information has been identified in plant-specific SEISs or associated
30 literature that would alter this conclusion. On the basis of these considerations, the impact on
31 groundwater use conflicts from continued operations during the license renewal term for all
32 nuclear plants that withdraw less than 100 gpm (378 L/min) would be small and remains a
33 Category 1 issue.

34
35 *Groundwater Use Conflicts for Plants That Withdraw More Than 100 Gallons per Minute*
36

37 This issue is a combination of two issues in the 1996 GEIS: (1) groundwater use conflicts
38 (potable and service water and dewatering; plants that use greater than 100 gpm [378 L/min])
39 and (2) groundwater use conflicts (plants that use Ranney wells).
40

Environmental Consequences and Mitigating Actions

1 Nuclear power plants withdraw groundwater for various purposes (see Section 3.5.2). Most
2 plants use groundwater to supply their potable water and service water needs. In some cases,
3 groundwater is pumped to intentionally lower high water tables. At the Grand Gulf plant in
4 Mississippi, Ranney wells in the Mississippi River alluvium are used to provide cooling system
5 makeup water (see Section 3.5.2).
6

7 As described in the section above, the pumping of groundwater is expected to create a cone of
8 depression around the well, with the degree of aquifer dewatering dependent on various
9 factors. A nuclear plant may have several wells, with combined pumping in excess of 100 gpm
10 (378 L/min). Overall site pumping rates of this magnitude have the potential to create conflicts
11 with other local groundwater users if the cone of depression extends to the offsite well(s).
12 Large offsite pumping rates for municipal, industrial, or agricultural purposes may, in turn, lower
13 the water level at power plant wells. For any user, allocation is normally determined through a
14 State-issued permit.
15

16 Groundwater use conflicts have not been observed at any nuclear power plants, and no
17 significant change in water well systems is expected over the license renewal term. If a conflict
18 did occur, it might be possible to resolve it if the power plant relocated its well or wellfield to a
19 different part of the property. The siting of new wells would be determined through a
20 hydrogeologic assessment.
21

22 In the 1996 GEIS, groundwater use conflicts were considered for plants that withdraw more
23 than 100 gpm (378 L/min) or plants that use Ranney wells. The staff concluded that the
24 impacts of continued operations and refurbishment would not necessarily be the same at all
25 nuclear plant sites (i.e., a Category 2 issue) because of site-specific factors (e.g., well pump
26 rates, well locations, and hydrogeologic factors) and that the impacts could be small, moderate,
27 or large. No new information has been identified in plant-specific SEISs or associated literature
28 that would alter this conclusion. On the basis of these considerations, groundwater use
29 conflicts for plants that withdraw more than 100 gpm (378 L/min) could be small, moderate, or
30 large, depending on the plant-specific characteristics described above and remains a Category
31 2 issue.
32

33 *Groundwater Use Conflicts for Plants with Closed-Cycle Cooling Systems That Withdraw* 34 *Makeup Water from a River* 35

36 In the case of plants with cooling towers that rely on a river for makeup of consumed
37 (evaporated) cooling water, it is possible water withdrawals from the river could lead to
38 groundwater use conflicts with other users. This situation could occur because of the
39 interaction between groundwater and surface water, especially in the setting of an alluvial
40 aquifer in a river valley. Consumptive use of the river water, if significant enough to lower the
41 river's water level, would also influence water levels in the alluvial aquifer. Shallow wells of

1 nearby groundwater users could therefore have reduced water availability or go dry. During
2 times of drought, the effect would be occurring naturally, although withdrawals for makeup
3 water would increase the effect. In the 1996 GEIS, a situation at the Duane Arnold plant in Iowa
4 was described in which a reservoir on a small tributary is used as a secondary supply of
5 makeup water for the plant's cooling towers. During low-flow conditions in the plant's usual
6 source of water, the Cedar River, the plant is not allowed to withdraw the river water. Instead, it
7 uses the reservoir temporarily. Because the high rate of water usage can lower the water level
8 in the reservoir significantly, local users of shallow groundwater may be affected. As described
9 for other issues above, this situation is highly dependent on the vicinity's hydrogeologic
10 framework and the locations, depths, and pump rates of wells, in addition to the amount that the
11 surface water level declines.

12
13 In the 1996 GEIS, groundwater use conflicts for plants that use cooling towers withdrawing
14 makeup water from a river during continued operations and refurbishment would not
15 necessarily be the same at all nuclear plant sites because of site-specific factors (e.g., the
16 amount of surface water decline, well pump rates, well locations, and hydrogeologic factors)
17 and that the impact could be small, moderate, or large. Therefore, this issue was considered
18 Category 2. No new information has been identified in plant-specific SEISs or associated
19 literature that would alter this conclusion. On the basis of these considerations, groundwater
20 use conflicts for nuclear plants that use closed-cycle cooling systems that withdraw makeup
21 water from a river could have small, moderate, or large impacts depending on the plant-specific
22 characteristics of surrounding areas described above and remains a Category 2 issue.

23
24 *Groundwater Quality Degradation Resulting from Water Withdrawals*

25
26 This issue is a combination of two related issues in the 1996 GEIS: (1) groundwater quality
27 degradation for plants that use Ranney wells and (2) groundwater quality degradation (saltwater
28 intrusion). These two issues both consider the possibility of groundwater quality becoming
29 degraded as a result of drawing water of potentially lower quality into the aquifer. For this
30 reason, they are discussed here as a single issue.

31
32 A well near a river may draw lower-quality river water into the aquifer as a function of the
33 interaction between groundwater and surface water. An example of Ranney wells (see Section
34 3.5.2) at the Grand Gulf plant in Mississippi causing induced infiltration of Mississippi River
35 water into the alluvial aquifer was discussed in the 1996 GEIS. While site-specific
36 hydrogeologic factors and well design may provide some control on the flow of surface water to
37 the well, the bulk of the groundwater pumped by a well in an alluvial aquifer near a river is
38 expected to be induced surface water, with a smaller component of groundwater from the
39 direction opposite the river. If well pumping is continuous, the only portion of the shallow
40 aquifer significantly affected by induced infiltration remains in the capture zone of the well(s).

Environmental Consequences and Mitigating Actions

1 Therefore, the portion of the aquifer with water quality parameters approaching those of the
2 river water would usually be located on the power plant's property.

3
4 Wells in a coastal setting (ocean shore or estuary) have the potential to cause saltwater
5 intrusion into the aquifer. This water quality problem is a common concern for large pumping
6 centers associated with municipal or industrial users. The degree of saltwater intrusion
7 depends on the cumulative pumping rates of wells, their screen depths, and hydrogeologic
8 conditions. Deep, confined aquifers, for example, may be separated from saline aquifers closer
9 to the surface.

10
11 Impacts related to groundwater quality degradation for nuclear plants that use Ranney wells
12 and groundwater quality degradation (saltwater intrusion) were designated as Category 1
13 issues in the 1996 GEIS. No new information has been identified in plant-specific SEISs or
14 associated literature that would alter this conclusion. On the basis of these considerations,
15 groundwater quality degradation resulting from water withdrawals would be small for all nuclear
16 plants and remains a Category 1 issue.

17 *Groundwater Quality Degradation for Plants Using Cooling Ponds in Salt Marshes*

18
19
20 Nuclear plants that use cooling ponds as part of their cooling water system discharge effluent to
21 the pond. The effluent's concentration of contaminants and other solids increases relative to
22 that of the makeup water as it passes through the cooling system. These changes include
23 increased total dissolved solids (since they concentrate as a result of evaporation), increased
24 heavy metals (because cooling water contacts the cooling system components), and increased
25 chemical additives to prevent biofouling. Because all the ponds are unlined (NRC 1996), the
26 water discharged to them can interact with the shallow groundwater system and may create a
27 groundwater mound. In this case, groundwater below the pond can flow radially outward, and
28 this groundwater would have some of the characteristics of the cooling system effluent.

29
30 In salt marsh locations, the groundwater is naturally brackish and cannot be used for human
31 use other than in industrial applications. Two nuclear plants, South Texas in Texas and Turkey
32 Point in Florida, have cooling systems (cooling pond and cooling canal system, respectively)
33 located in salt marshes. Plants relying on brackish water cooling systems would not further
34 degrade the quality of the shallow aquifer relative to its use classification. Plants relying on
35 cooling ponds in salt marsh settings are expected to have a small impact on groundwater
36 quality. This is the same conclusion reached in the 1996 GEIS. No new information has been
37 identified in plant-specific SEISs or associated literature that would alter this conclusion. On the
38 basis of these considerations, the impact of groundwater quality degradation for nuclear plants
39 using cooling ponds in salt marshes would be small and is considered a Category 1 issue.

1 *Groundwater Quality Degradation for Plants Using Cooling Ponds at Inland Sites*

2
3 The above discussion on cooling ponds relates to this issue. Some nuclear power plants that
4 rely on unlined cooling ponds are located at inland sites surrounded by farmland or forest or
5 undeveloped open land. Degraded groundwater has the potential to flow radially from the
6 ponds and reach offsite groundwater wells. The degree to which this occurs depends on the
7 water quality of the cooling pond; site hydrogeologic conditions (including the interaction of
8 surface water and groundwater); and the location, depth, and pump rate of water wells.
9 Mitigation of significant problems stemming from this issue could include lining existing ponds,
10 constructing new lined ponds, or installing subsurface flow barrier walls. Groundwater
11 monitoring networks would be necessary to detect and evaluate groundwater quality
12 degradation. The degradation of groundwater quality associated with cooling ponds has not
13 been reported for any inland nuclear plant sites.

14
15 The 1996 GEIS considered the impacts of this issue during continued operations and
16 concluded that the impact would not necessarily be the same at all sites (i.e., a Category 2
17 issue) and could be small, moderate, or large. No new information has been identified in plant-
18 specific SEISs or associated literature that would alter this conclusion.

19
20 On the basis of these considerations, the impacts of groundwater quality degradation for plants
21 using cooling ponds at inland sites could be small, moderate, or large, depending on site-
22 specific differences in the cooling pond's water quality; site hydrogeologic conditions (including
23 the interaction of surface water and groundwater); and the location, depth, and pump rate of
24 water wells. The issue is considered a Category 2 issue.

25
26 *Groundwater and Soil Contamination During Continued Operations and Refurbishment*
27 *Activities*

28
29 The contamination of groundwater and soil can result from general industrial practices at any
30 site and is not limited to those occurring at nuclear power plants. Activities that result in
31 contamination may include the use of solvents, hydrocarbon fuels (diesel and gasoline), heavy
32 metals, or other chemicals. These materials all have the potential to affect groundwater and soil
33 if released. Furthermore, contaminants present in the soil can act as long-term sources of
34 contamination to underlying groundwater.

35
36 Based on previous plant-specific reviews, these types of groundwater and soil contamination
37 problems have occurred at many operating plants. Examples of the types of contamination that
38 may be present at a plant include hydrocarbon leaks or spills at a storage tank, leaked or spilled
39 solvents from barrels, and a hydraulic oil line break (NRC 2006d), thallium in soil at a seepage
40 pit, heavy metals in soil at a sand blasting site, a diesel fuel line leak, methyl tertiary butyl ether
41 (MTBE) from spills of a gasoline storage tank, PCBs in soil as a result of former dielectric fluid

Environmental Consequences and Mitigating Actions

1 use (NRC 2007b), and hydrocarbon spills and sulphuric acid leaks (NRC 2008b). These
2 situations have required regulatory involvement by State agencies during both monitoring and
3 remediation phases. Remediation has taken place in the form of excavation and recovery
4 wells. The number of occurrences of such problems can be minimized by means of proper
5 chemical storage, secondary containment, and leak detection equipment.
6

7 An additional source of groundwater contamination can be the use of wastewater lagoons. At
8 the Cook plant in Michigan, permitted wastewater ponds are used for receiving treated sanitary
9 wastewater and for process wastes from the turbine room sump. Groundwater monitoring has
10 shown that concentrations of water quality parameters have increased to levels above
11 background but below drinking water standards (NRC 2005a). As a result, in an arrangement
12 with the county, the use of groundwater by other users in a designated area has been
13 restricted.
14

15 Remediation of groundwater contamination can involve long-duration cleanup processes that
16 depend on the types, properties, and concentrations of the contaminants; aquifer properties;
17 groundwater flow field characteristics; and remedial objectives. Contaminants may be able to
18 migrate to onsite potable wells or to the wells of offsite groundwater users. Groundwater
19 monitoring programs would be expected to identify problems before contaminated groundwater
20 reached receptors; however, monitoring wells need to be present and in proper locations in
21 order to detect contaminants. On the basis of these considerations, the impact of groundwater
22 and soil contamination during operations and refurbishment activities could be small or
23 moderate, depending on the factors described above and is considered a Category 2 issue.
24

25 *Radionuclides Released to Groundwater*

26

27 There is growing concern about radionuclides detected in groundwater at nuclear power plants.
28 These releases have occurred as leaks in at least 14 plants (NRC 2006a). Tritium, being the
29 most mobile radionuclide in soil and groundwater, is of particular concern. Concentrations of
30 tritium in sampled onsite groundwater at many of these plants ranged well above the EPA
31 drinking water standard of 20,000 pCi/L. Examples include onsite monitoring well samples of up
32 to 250,000 pCi/L at the Braidwood plant in Illinois, up to 211,000 pCi/L at the Indian Point plant
33 in New York (NRC 2008c), up to 486,000 pCi/L at the Dresden plant in Illinois, more than
34 30,000 pCi/L at the Watts Bar plant in Tennessee, and 71,400 pCi/L at the Palo Verde plant in
35 Arizona. Examples of samples taken either directly from the source of the leak or from nearby
36 onsite monitoring wells include samples with up to 200,000 pCi/L of tritium at the Callaway plant
37 in Missouri, up to 15,000,000 pCi/L at the Salem plant in New Jersey, and up to 750,000 pCi/L
38 at the Seabrook plant in New Hampshire. At the Byron plant in Illinois, tritium in monitoring
39 wells was above the background level but below drinking water standards (up to 3800 pCi/L).
40 The location and construction of the monitoring wells relative to potential leak locations have

1 not been evaluated. For each example, it is possible that a different well placement could
2 detect higher or lower activity concentrations.

3
4 Other reported instances (NRC 2006a) of tritium above background levels have been a result of
5 operator error, licensed discharge, or leaks or discharges to drain systems. At the Oyster
6 Creek plant in New Jersey, a mistake involving a valve allowed tritium-contaminated water to
7 flow to the discharge canal. Sampling of this water showed levels of 16,000 pCi/L. At the Wolf
8 Creek plant in Kansas, an onsite lake receiving liquid effluent was found to have a tritium
9 activity concentration of 13,000 pCi/L (NRC 2008a). The Perry plant in Ohio had water samples
10 in its drainage system with an activity concentration of 60,000 pCi/L. In each of these cases,
11 the tritium present at the surface could infiltrate or seep into the groundwater system.

12
13 The NRC does not consider these tritium releases to be a health risk to the public or onsite
14 workers in any of these cases (NRC 2006a) because the tritiated groundwater is expected to
15 remain onsite. However, an exception is the event at Braidwood, which resulted in detectable
16 concentrations of tritium at an offsite location. Sampling of an offsite residential well at
17 Braidwood showed 1600 pCi/L of tritium which is above the background level but well below
18 EPA's drinking water standard. Risk to workers would arise if onsite wells were used for the
19 potable water system and if the leak was in the capture zone of the well. However, the NRC
20 requires that the onsite potable well water be monitored for radioactivity to protect the workers.

21
22 As discussed in Section 3.5.2, groundwater monitoring efforts are increasing in accordance with
23 industry guidelines (Nuclear Energy Institute 2007). With these monitoring networks, the
24 presence and extent of any tritium plumes (both onsite and offsite) will become clearer. These
25 new monitoring well networks are expected to provide information about any existing tritium
26 groundwater plumes and future system leaks by siting additional wells at key locations. Well
27 design and depth would be determined through a site-specific assessment of the hydrogeology
28 and the subsurface infrastructure. Because the leaks are typically underground, detection does
29 not occur promptly. In addition to monitoring wells, leak detection equipment or surveillance of
30 accessible piping and components containing radioactive materials would improve the chance
31 of discovery of a tritium leak before significant activity reached an aquifer.

32
33 On the basis of occurrences at several nuclear plants, the impact of radionuclide releases to
34 groundwater quality could be small or moderate, depending on the occurrence and frequency of
35 leaks and the ability to respond to leaks in a timely fashion. The issue is considered a
36 Category 2 issue.

37 38 **4.5.2 Environmental Consequences of Alternatives to the Proposed Action**

39
40 *Construction* – Construction-related impacts on hydrology (land clearing during and impervious
41 pavements) would alter surface drainage patterns and groundwater recharge zones. Surface

Environmental Consequences and Mitigating Actions

1 water runoff over disturbed ground and material stockpiles could increase levels of dissolved
2 and suspended solids and other contaminants. Groundwater withdrawn from onsite wells and
3 dewatering systems could depress the water table and possibly change the direction of
4 groundwater flow near the plant. Concrete production and wetting of ground surfaces and
5 unpaved roadways for fugitive dust control could require substantial amounts of water.
6 Appropriate permits, including a Clean Water Act Section 404 permit, Section 401 certification,
7 and Section 402(p) NPDES general stormwater permit, would be required prior to construction.
8 Surface drainage patterns would be affected.

9
10 *Operation* – Most electrical power plants require water for cooling. As a result, fossil-fueled and
11 nuclear power plants are generally located near large surface water bodies, including lakes,
12 rivers, or oceans. Water cooling systems at power plants use either once-through or closed-
13 cycle systems. Water can also be purchased from municipalities or commercial water providers
14 or obtained from onsite wells or a combination of the above.

15
16 Potential impacts to surface waters could occur from blowdown and evaporative losses in the
17 steam cycle and cooling system and from drift of chemically treated cooling water from the
18 cooling tower. Releases of industrial wastewaters would be controlled by an NPDES permit.

19

20 **4.5.2.1 Fossil Energy Alternatives**

21

22 *Operation* – Fossil fuel power plants require a continuous supply of water to operate. Water
23 demands vary greatly among technologies, ranging from a low of 3,760 gpm (14,222 L/m) for an
24 integrated gasification combined cycle (IGCC) technology without carbon capture and storage to
25 more than 14,000 gpm (53,000 L/m) for a subcritical pulverized coal unit with carbon capture
26 and storage. EPA estimates of raw water usage for various coal-burning technologies,
27 normalized to a nominal generating capacity of 500 MW(e), appear in Table 4.5.2.1–1.
28 Hydrology would be affected not only by water withdrawals but by reintroduction of water from
29 steam cycle, cooling tower, and gasifier blowdown water. Hydrology would also be affected by
30 wastewater generated by coal and exhaust-gas cleaning devices that may be operating and by
31 other ancillary industrial activities.

32

Table 4.5.2.1–1. Raw Water Usage Estimates for Fossil Fuel Electric Power Technologies

Technology	Coal Rank		
	Bituminous	Sub-Bituminous	Lignite
Water Usage expressed as lb/MWh (lb/MMBtu input) [gal/min]			
IGCC	4,960 (685) [4,950] ^(a)	5,010 (676) [5,000] ^(a)	5,270 (700) [5,259] ^(b)
Subcritical PC ^(c)	9,260 (1,050) [9,241]	9,520 (1,050) [9,501]	9,960 (1,050) [9,940]
Supercritical PC ^(c)	8,460 (1,050) [8,443]	8,830 (1,060) [8,812]	9,200 (1,055) [9,182]
Ultra-supercritical PC ^(c)	7,730 (1,050) [7,717]	7,870 (1,050) [7,857]	8,710 (1,050) [8,695]

IGCC = integrated gasification combined cycle.
 (a) 500-MW(e) (net) unit equipped with a slurry-feed gasifier.
 (b) 500-MW(e) (net) unit equipped with a solid-feed gasifier.
 (c) 500-MW(e) (net) unit.
 Source: EPA 2006

1
 2 Water usage is a function of the coal combustion technology, heating value of the coal being
 3 consumed, the design of the primary cooling systems (e.g., once-through versus closed-cycle,
 4 mechanical versus natural draft, dry cooling, and wet/dry hybrid cooling), and the operation of
 5 various other devices, such as gasifiers and gas-cleaning units (including flue gas
 6 desulfurization), all of which require water.

7
 8 **4.5.2.2 New Nuclear Alternatives**

9
 10 *Operation* – Hydrology would be affected by operation of the cooling system and by discharges
 11 of blowdown water from the cooling system and steam cycle, both of which can introduce
 12 chemical contaminants and heat to the receiving surface water body. Operation of these
 13 systems could also affect hydrology by reducing available surface water volume, altering
 14 current patterns at intake and discharge structures, altering salinity gradients, scouring and
 15 increases in sediment caused by discharges of treated cooling water, and increasing water
 16 temperature. Hydrologic impacts would vary, depending on the surface water source used for
 17 cooling as well as the cooling water system employed. Hydrology can also be affected by the
 18 plant’s service water system, which provides water for turbine and reactor auxiliary equipment
 19 cooling, reactor shutdown cooling, and other services. Surface water and groundwater can also
 20 be affected by discharges authorized under permits and by accidental spills and leaks of
 21 radionuclides, chemicals, and fuels to the ground surface. Overall, impacts on hydrology at a
 22 greenfield site could be significant and depend highly on local circumstances and factors such
 23 as other dependencies on the hydrologic resources. Hydrologic impacts on a brownfield site or
 24 an existing nuclear facility could also be significant, depending on whether or not the new
 25 nuclear plant could use the existing cooling water system.

Environmental Consequences and Mitigating Actions

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41

4.5.2.3 Renewable Alternatives

Operations – The operational impacts of alternative energy technologies on water resources are presented in the following subsections.

Hydroelectric Energy Sources

Reservoirs could be affected by changes in water temperature and amounts of dissolved oxygen. Surface water temperatures in the reservoir could be affected when water flow is reduced. Warm water released from the top of the dam and cooler water released from the lower portions of the dam could affect river water temperatures downstream. Additionally, both low- and high-flow conditions would alter sediment transport and deposition patterns.

Geothermal

Hydrology would be affected by water consumed by the facility; the project could consume up to 6.8 ac-ft/yr of water during operation. Degradation and loss of integrity of geothermal wells could affect shallow groundwater quality through the release of contaminants. Liners installed on any surface impoundments should be sufficient to protect surface water resources from contamination by industrial fluids (including geothermal fluids) during routine operation.

Wind

No impacts on hydrology are expected to result from routine operation of either onshore or offshore wind farms.

Biomass

Water demands for cooling and steam would be similar to those of a fossil fuel-fired power plants. Water demand could equal evaporative water loss from cooling tower and flue gas scrubbers, and blowdown waters discharged from steam cycle and cooling water systems. Water demand could range from 3000 to 5000 gpm. Water quality would be affected by contaminants released in runoff from piles of feedstock materials, fly and bottom ash, and scrubber sludge.

Solar Thermal

There is a potential for contamination from accidental release of working fluids (heat transfer fluids) or thermal storage media (molten salts) contained in binary systems. For an advanced power tower facility operating in 2030 and using a wet mechanical cooling tower, projected

1 water demands (i.e., consumptive use as a result of water lost to evaporation) would be 2.4
2 m³/MWh (EERE 1997).
3
4

5 **4.6 Ecology**

7 **4.6.1 Environmental Consequences of the Proposed Action – Continued** 8 **Operations and Refurbishment** 9

10 Environmental conditions at all nuclear power plants and associated transmission lines have
11 been well established during the current licensing term. These conditions are expected to
12 remain unchanged during the 20-year license renewal term. The following section describes
13 the effects of continued operations and refurbishment activities on terrestrial and aquatic
14 resources over the license renewal term.
15

16 Continued operations and refurbishment are not expected to change substantially over the
17 license renewal term. Therefore, license renewal generally represents a continuation of current
18 environmental stresses that have existed over many years of operation. However, due to the
19 ever-changing nature of biological communities, the impacts of continued operation may
20 change. These conditions are described in Sections 3.6.1 (Terrestrial Ecology), 3.6.2 (Aquatic
21 Ecology), and 3.6.3 (Threatened, Endangered, and Protected Species and Essential Fish
22 Habitat). The factors associated with continued operations and refurbishment activities that
23 could affect these resources over the 20-year license renewal term are presented in the
24 following sections.
25

26 **4.6.1.1 Terrestrial Ecology** 27

28 Continued operations of the nuclear power plants during the 20-year license renewal term are
29 expected to include operation of cooling towers, operation of once-through cooling systems and
30 cooling ponds, management of transmission line ROWs, maintenance of site facilities, releases
31 of gaseous and liquid effluents, and potentially, and refurbishment-related construction
32 activities. Terrestrial habitats and wildlife would continue to be exposed to cooling tower drift;
33 maintenance activities associated with ROWs, cooling systems, and site facilities; and chemical
34 and radiological releases. Cooling towers and transmission lines would continue to be potential
35 collision hazards for birds, wildlife near the site would be exposed to elevated noise levels, and
36 refurbishment-related construction activities could result in habitat loss and disturbance of
37 wildlife. Details regarding these impacting factors are presented in Section 3.6.1.
38

Environmental Consequences and Mitigating Actions

1 This section considers the following issues related to terrestrial resources:

- 2
- 3 • Effects of continued operations, maintenance, and refurbishment activities on terrestrial
- 4 resources (issue modified from the 1996 GEIS to include the impacts of continued
- 5 operations and maintenance activities);
- 6
- 7 • Exposure of terrestrial biota to radionuclides (new issue not considered in the 1996
- 8 GEIS);
- 9
- 10 • Cooling system (excluding cooling tower) impacts on terrestrial resources (issue
- 11 modified from the 1996 GEIS to include once-through cooling systems as well as cooling
- 12 ponds);
- 13
- 14 • Cooling tower impacts on vegetation (combination of two issues from the 1996 GEIS: (1)
- 15 cooling tower impacts on agricultural crops and ornamental vegetation, and (2) cooling
- 16 tower impacts on terrestrial ecology);
- 17
- 18 • Bird collisions with cooling towers and transmission lines (combination of two issues in
- 19 the 1996 GEIS: (1) bird collisions with cooling towers and (2) bird collision with
- 20 transmission lines);
- 21
- 22 • Water use conflicts with terrestrial resources (plants with cooling ponds or cooling
- 23 towers using makeup water from a river with low flow) (separated from water use
- 24 conflicts for surface water in 1996 GEIS);
- 25
- 26 • Transmission line ROW management impacts on terrestrial resources (combination of
- 27 two issues from the 1996 GEIS: (1) power line ROW management effects on wildlife
- 28 and (2) floodplains and wetlands on power line ROWs. This issue includes impacts on
- 29 upland plant communities); and
- 30
- 31 • Effects of electromagnetic fields on flora and fauna (plants, agricultural crops,
- 32 honeybees, wildlife, livestock) (issue from the 1996 GEIS).
- 33

34 *Effects of Continued Operations on Terrestrial Resources*

35

36 Continued operations, refurbishment, and maintenance activities could continue to affect onsite

37 terrestrial resources during the license renewal term at all operating nuclear power plants.

38 Factors that could potentially result in impacts include landscape maintenance activities, storm

39 water management, and elevated noise levels. These impacts would, for the most part, be

40 similar to past and ongoing impacts. The 1996 GEIS did not evaluate the impact of continued

41 operations and maintenance on onsite biota, but this issue has been identified by the NRC for

1 consideration in this GEIS revision on the basis of environmental reviews performed for plant-
2 specific SEISs.

3
4 Nuclear power plant sites are typically maintained as modified habitats with lawns and other
5 landscaped areas; however, they may also include disturbed early successional habitats or
6 even small areas of relatively undisturbed habitat. Onsite developed areas are generally
7 maintained by mowing and the application of herbicides or pesticides. The diversity of plant
8 species in these areas is generally kept at a reduced level. Plant species often consist of
9 cultivated varieties or weedy species tolerant of disturbance. Areas of the nuclear plant site
10 outside the security fence may include natural areas, such as forests or shrublands, in various
11 degrees of disturbance. Onsite wetlands may be affected by storm water management.
12 Effects may include changes in plant community characteristics, altered hydrology, decreased
13 water quality, and sedimentation (EPA 1993, 1996; Wright et al. 2006). Impervious surfaces
14 within the watershed generally result in increased runoff and reduced infiltration, causing
15 changes in the frequency or duration of inundation or soil saturation and greater fluctuations in
16 wetland water levels. Runoff may contain sediments, contaminants from road and parking
17 surfaces, or herbicides. Erosion of wetland substrates and plants can result from increased flow
18 velocities from impervious surfaces. Onsite wildlife near transformers or cooling towers are
19 exposed to elevated noise levels that could disrupt behavioral patterns. Maintenance of
20 landscaped areas generally keeps wildlife diversity lower than in surrounding habitats. Wildlife
21 species occurring on sites within the security areas are typically limited by low habitat quality
22 and generally include common species adapted to industrial sites.

23
24 The characteristics of terrestrial habitats and wildlife communities currently on nuclear power
25 plant sites have generally developed in response to many years of typical operations and
26 maintenance programs. While some may have reached a relatively stable condition, some
27 habitats and populations of some species may have continued to change gradually over time.
28 Operations and maintenance activities during the license renewal term are expected to be
29 similar to current activities (see Section 2.1). Because the species and habitats present on the
30 sites (i.e., weedy species and habitats they make up) are generally tolerant of disturbance, it is
31 expected that continued operations during the license renewal term would maintain these
32 habitats and wildlife communities in their current state, or maintain current trends of change.

33
34 Terrestrial habitats and wildlife could be affected by ground disturbance from refurbishment-
35 related construction activities. Land disturbed during the construction of new independent spent
36 fuel storage installations (ISFSIs) would range from about 1 to 4 ha (2.5 to 10 ac). Other
37 activities may include new parking areas for plant employees, access roads, buildings, and
38 facilities. Temporary project support areas for equipment storage, worker parking, and material
39 laydown areas could also result in the disturbance of habitat and wildlife. In the 1996 GEIS, the
40 NRC considered only the impacts of refurbishment on terrestrial habitats and concluded that the

Environmental Consequences and Mitigating Actions

1 impacts would not necessarily be the same at all sites (i.e., a Category 2 issue) and could
2 range from small to large.

3
4 Operational activities occurring in undeveloped portions of the site would affect terrestrial
5 habitats and wildlife. Some wildlife would be displaced to nearby available habitats. However,
6 competition would increase for many species, reducing the likelihood of survival of displaced
7 individuals. Indirect effects could include fugitive dust, alteration of hydrology from changes in
8 surface water flow patterns and infiltration to shallow groundwater, water quality degradation, or
9 establishment of invasive species. Species that are more sensitive to disturbance may be
10 displaced by more tolerant species. Affected habitats may include uplands or wetlands on or
11 near the activity as well as wetlands within the watershed. Alterations in vegetative cover, the
12 compaction of upland soils, or the development of impervious surfaces within the watershed
13 generally result in more runoff and less infiltration to shallow groundwater, causing an increase
14 or decrease in the hydrologic input to nearby wetlands (EPA 1993; 1996; Wright et al. 2006).
15 Effects include changes in the frequency or duration of inundation or soil saturation and greater
16 fluctuations in wetland water levels. Runoff often contains sediments, contaminants from road
17 and parking surfaces, or herbicides used in managing ROW or site vegetation (EPA 1993, 1996;
18 Wright et al. 2006). The erosion of wetland substrates and plants can result from increased flow
19 velocities. Actions that result in the discharge of dredge or fill material into wetlands that are
20 under the jurisdiction of the Clean Water Act (CWA) require a Section 404 permit from the U.S.
21 Army Corps of Engineers (USACE). Actions that could potentially affect threatened or
22 endangered species would require consultation with the U.S. Fish and Wildlife Service
23 (USFWS) under Section 7 of the ESA, or with State resource agencies. Rare or unique plant
24 communities, sensitive habitats such as wetlands or rookeries, or high-quality undisturbed
25 habitats may occur in or near potentially affected areas. Impacts on such habitats could be
26 considered large if they caused the destabilization of a resource. Impacts would be considered
27 small if only previously disturbed or other lower-quality habitats were affected.

28
29 Successful application of environmental review procedures, employed by the licensees at many
30 of the operating nuclear plant sites, would result in the identification and avoidance of important
31 terrestrial habitats. In addition, the application of best management practices to minimize the
32 area affected; to control fugitive dust, runoff, and erosion from project sites; to reduce the
33 spread of invasive nonnative plant species; and to reduce disturbance of wildlife in adjacent
34 habitats could greatly reduce the impacts of continued operations and refurbishment activities.

35
36 Site-specific factors related to refurbishment activities may vary considerably among nuclear
37 power plant sites. The habitats present on or in the vicinity of nuclear power plants also vary
38 greatly. Therefore, a generic determination of potential impacts on terrestrial resources from
39 refurbishment or other activities is not possible. Impacts on terrestrial habitats and wildlife
40 would depend on site-specific factors, and impact assessments would need to be conducted on
41 a site-specific basis prior to license renewal. Consistent with this finding, the NRC concluded in

1 the 1996 GEIS that the impacts of refurbishment actions could be significant if important
2 resources are affected, depending on site-specific conditions.

3
4 On the basis of these considerations, the NRC concludes that the impact of continued
5 operations, refurbishment, and maintenance activities similar to those occurring during the
6 current license term on terrestrial resources could be small, moderate, or large, depending on
7 site-specific differences in the terrestrial resources present, project-specific activities, and the
8 effectiveness of mitigation measures. The issue is therefore considered a Category 2 issue.

9
10 *Exposure of Terrestrial Organisms to Radionuclides*

11
12 This section addresses the issue of potential impacts of radionuclides on terrestrial organisms
13 resulting from normal operations of a nuclear power plant during the license renewal term. This
14 issue was not evaluated in the 1996 GEIS. However, public concerns about the impacts of
15 radionuclides on terrestrial organisms at some nuclear power plants have led to an evaluation of
16 the issue in this GEIS revision.

17
18 Radionuclides may be released from nuclear power plants into the environment via a number of
19 pathways. Releases into terrestrial environments often result from deposition of small amounts
20 of radionuclide particulates released from power plant vents during normal operations. These
21 releases typically include noble gases such as krypton, xenon, and argon (which are not
22 deposited), tritium, isotopes of iodine, and cesium, and they may also include strontium, cobalt,
23 and chromium. Radionuclides may also be released into the aquatic environment in the liquid
24 effluent discharged from the plant's cooling system. Radionuclides, such as tritium, that enter
25 shallow groundwater from cooling ponds, can be taken up by terrestrial plant species, including
26 both upland species and wetland species, where wetlands receive groundwater discharge.
27 Terrestrial biota may be exposed to ionizing radiation from radionuclides through direct contact
28 with water or other media, inhalation, or ingestion of food, water, or soil.

29
30 The uptake of radionuclides, such as tritium and cesium, from soil and water by many plant
31 species and their incorporation into plant tissues have been well demonstrated (Bell et al. 1988;
32 Hinton et al. 1996; Hinton et al. 1999; Hitchcock et al. 2005; Kaplan et al. 2005; Sahr
33 et al. 2005; NCRP 2006; Pinder et al. 2006). The degree of uptake varies according to the
34 degree to which the radionuclide binds to the sediment particles (the partition coefficient [Kd] of
35 the nuclide and sediment constituents, such as clay particles) as well as other environmental
36 factors, such as pH or the concentrations of other elements such as potassium (NCRP 2006).
37 The effects on plants of chronic exposure to radionuclides range from reduced trunk growth,
38 canopy cover, stem growth, photosynthetic capacity, seed production and germination in trees,
39 and reduced reproductive potential in herbaceous plants, to chromosome damage as well as
40 mortality in both groups (IAEA 1992; Real et al. 2004; Sahr et al. 2005). Growth effects have
41 been observed at dose rates above 0.01 rad/h (100 μ Gy/h), while chromosome effects have

Environmental Consequences and Mitigating Actions

1 occurred at 2.0×10^{-6} rad/h (0.02 μ Gy/h) (Real et al. 2004). Radionuclides are transferred to
2 herbivores and subsequently to higher trophic levels, such as predators (Meyers-Schone and
3 Walton 1990; Kelsey-Wall et al. 2005; Beresford et al. 2005; NCRP 2006).

4
5 The DOE guideline for radiation dose rates from environmental media recommends limiting the
6 radiation dose to riparian and terrestrial mammals to less than 0.1 rad/d (0.001 Gy/d) and
7 limiting the dose to terrestrial plants to less than 1.0 rad/d (0.01 Gy/d) (DOE 2002a). These
8 guidelines were developed on the basis of experimental evidence that negative effects would
9 not occur at these doses. The effects of ionizing radiation on populations of terrestrial
10 organisms have been given considerable attention in the literature. A report by the International
11 Atomic Energy Agency (IAEA 1992) described invertebrate organisms as being less sensitive to
12 ionizing radiation than are vertebrates. There is additional evidence indicating that some
13 terrestrial wildlife species may be more resistant to ionizing radiation than are humans. For
14 instance, Ulsh et al. (2000) examined the effects of cesium-137 radiation on cellular processes
15 of wild turtles and humans. They discovered that human fibroblasts were 1.7 times more
16 sensitive to ionizing radiation than the fibroblasts of wild turtles.

17
18 Eisler (1994) summarized studies examining the effects of ionizing radiation on aquatic and
19 terrestrial organisms and reported that chronic doses at the minimum treatment dose of
20 90 rad/d (0.9 Gy/d) reduced the growth of some bird species. Few studies examine the effects
21 of ionizing radiation on birds at doses lower than 90 rad/d (0.9 Gy/d), and none of them
22 observed any adverse effects. For example, Zach et al. (1993) found no negative effects on
23 the breeding performance of adults or the growth of nestling tree swallows (*Tachycineta bicolor*)
24 at doses as low as 0.014 rad/d (1.4×10^{-4} Gy/d). Eisler (1994) also reported that an acute
25 exposure of 1.1 rad (0.011 Gy) was demonstrably harmful to small mammals. In a summary by
26 Real et al. (2004), radiological dose rates as low as 1 rad/d (0.01 Gy/d) could be potentially
27 harmful to some terrestrial plant species, although most effects were observed at doses greater
28 than 100 rad/d (1 Gy/d). Furthermore, IAEA (1992) concluded that irradiation at chronic dose
29 rates of 1 rad/d (0.01 Gy/d) or less are not likely to negatively affect plant populations.

30
31 Genetic effects of ionizing radiation on terrestrial biota have not been demonstrated at doses
32 below the DOE guidelines. Turner et al. (1971) found that doses as low as 4 rad/d (0.04 Gy/d)
33 adversely affect the reproductive capabilities of the leopard lizard (*Crotaphytus wislizenii*), and
34 Nagasawa et al. (1990) observed chromosomal aberrations in the cells of hamsters at acute
35 radiation doses as low as 2 rad (0.02 Gy). The European Committee on Radiation Risk
36 (ECRR) reviewed studies concerning the effects of low-level radiation exposures on a variety of
37 animal species. Although study details were not provided, the ECRR noted that a wide range of
38 animal studies show juvenile mortality effects from internal irradiation, which have not been
39 addressed by the International Commission on Radiological Protection (ICRP) or other risk
40 agencies (ECRR 2003).

Environmental Consequences and Mitigating Actions

1 The NRC conducted a review of all operating nuclear power plants to evaluate the potential
2 impacts of radionuclides on terrestrial biota from continued operations. Site-specific
3 radionuclide concentrations in water, sediment, and soils were obtained from Radiological
4 Environmental Monitoring Program (REMP) reports for 15 nuclear plants. These 15 plants
5 were selected to represent sites with a range of radionuclide concentrations in the media,
6 including plants with high annual worker total effective dose equivalent (TEDE) values
7 (Tables 3.9-5 and 3.9-6) or public exposures (Tables 3.9-9, 3.9-10, and 3.9-11) for both boiling
8 water reactors (BWRs) and pressurized water reactors (PWRs). The RESRAD-BIOTA dose
9 evaluation model (DOE 2004e) was used to calculate estimated dose rates for terrestrial biota
10 by using the media concentrations presented in the REMP reports (see Section D.5 in Appendix
11 D for further details on the approach used).

12
13 Results of the RESRAD-BIOTA dose modeling are presented in Table 4.6.1.1–1, showing the
14 total dose estimates for three different terrestrial ecological receptors: riparian animal (an
15 animal that was assumed to spend approximately 50 percent of its time in aquatic environments
16 and 50 percent of its time in terrestrial environments), terrestrial animal, and terrestrial plant.
17 The maximum estimated dose rate calculated for any of the nuclear power plants is
18 0.0354 rad/d (3.54×10^{-4} Gy/d) (riparian animal at the Browns Ferry plant), which is below the
19 guideline value of 0.1 rad/d (0.001 Gy/d) for a riparian animal receptor. It is unlikely that the
20 normal operations of these power plants would have adverse effects on terrestrial biota
21 resulting from radionuclide releases because the calculated doses are below protective
22 guidelines and thus would not significantly affect populations.

23

Environmental Consequences and Mitigating Actions

Table 4.6.1.1–1. Estimated Radiation Dose Rates to Terrestrial Ecological Receptors from Radionuclides Measured in Water, Sediment, and Soils at U.S. Nuclear Power Plants

Power Plant	Sum of Total Dose (rad/d) for Receptor ^(a)			Source
	Riparian Animal	Terrestrial Animal	Terrestrial Plant	
Arkansas Nuclear	4.62×10^{-4}	3.37×10^{-7}	1.04×10^{-7}	Entergy 2006a
Browns Ferry	3.54×10^{-2}	1.10×10^{-2}	1.03×10^{-2}	TVA 2003
Calvert Cliffs	2.90×10^{-7}	2.65×10^{-3}	2.49×10^{-4}	CEG 2003
Columbia	2.62×10^{-3}	4.45×10^{-4}	2.82×10^{-5}	Energy Northwest 2005
Comanche Peak	1.50×10^{-2}	2.89×10^{-6}	9.37×10^{-7}	TXU 2004
D.C, Cook	2.48×10^{-3}	2.22×10^{-3}	2.44×10^{-4}	IMP 2006
Hatch	2.39×10^{-3}	1.82×10^{-6}	5.19×10^{-7}	Southern Company 2003
Fort Calhoun	5.26×10^{-4}	3.41×10^{-7}	1.06×10^{-7}	OPPD 2004
Indian Point	2.30×10^{-3}	2.22×10^{-3}	2.44×10^{-4}	Entergy 2006b
Millstone	3.31×10^{-3}	2.20×10^{-3}	2.20×10^{-4}	DNC 2004
Nine Mile Point	2.40×10^{-3}	1.83×10^{-6}	5.24×10^{-7}	CEG 2004
Palisades	6.00×10^{-6}	2.89×10^{-7}	9.48×10^{-8}	NMC 2004
Point Beach	7.79×10^{-3}	2.48×10^{-2}	2.12×10^{-2}	EIML 2005
San Onofre	7.79×10^{-3}	2.48×10^{-2}	2.12×10^{-2}	SCE 2005
Vermont Yankee	7.56×10^{-3}	1.85×10^{-6}	5.30×10^{-7}	Entergy 2003

(a) Dose rates were estimated with RESRAD-BIOTA (DOE 2004e) by using site-specific radionuclide concentrations in water, sediment, and soils obtained from the REMP reports.

- 1
2 On the basis of these calculations and a review of the available literature, the NRC concludes
3 that the impact of routine radionuclide releases from past and current operations on terrestrial
4 biota would be small at all nuclear plants and would not be expected to appreciably change
5 during the renewal period. It is considered a Category 1 issue.
6
7 *Cooling System Impacts on Terrestrial Resources*
8
9 Terrestrial vegetation and wildlife could be affected by the continued operation of cooling
10 systems at nuclear power plants during the 20-year license renewal term. This issue applies to
11 nuclear power plants with once-through cooling systems and cooling ponds. In the 1996 GEIS,
12 the NRC evaluated the impacts to terrestrial ecology from cooling ponds but not the impacts
13 from once-through cooling systems. Impacts of cooling ponds on terrestrial resources were

Environmental Consequences and Mitigating Actions

1 considered to be small for all plants that used cooling ponds and were designated as
2 Category 1 issues in the 1996 GEIS. The impact on terrestrial resources from the operations of
3 other cooling systems has been identified by the NRC for consideration in this GEIS revision.
4 The impacts of cooling tower operations are considered as a separate issue elsewhere in this
5 section.
6

7 Primary impacts of continued operation of the cooling systems at nuclear power plants include
8 alterations of the physical environment that terrestrial organisms inhabit. Such changes to the
9 physical environment may include increased water temperatures; humidity and fogging;
10 contaminants in surface water or groundwater; and disturbance of wetlands from dredging,
11 disposal of dredged material, and erosion of shoreline wetlands. Water temperatures in cooling
12 ponds, canals, and reservoirs may increase as warmwater effluent is discharged from the power
13 plants. The elevated water temperatures associated with the cooling system may affect the
14 distributions of some terrestrial plant and animal species associated with riparian or wetland
15 communities. For example, the growth of plants along the cooling pond shoreline is restricted
16 by the thermal effluent at the H.B. Robinson plant in South Carolina (NRC 2003b). Increased
17 humidity and fogging around the cooling system discharge resulting from elevated water
18 temperatures may alter the distributions of some vegetation communities. The cooling system
19 may also transport contaminants generated during normal power plant operations to animal and
20 plant receptors. Terrestrial biota may be exposed to contaminants released from the power
21 plant's cooling system, either by direct contact with the cooling system effluent or through
22 uptake from aquatic food sources near the cooling system. Terrestrial plants and wildlife
23 associated with wetland or riparian communities along the receiving water body may be
24 exposed, as well as wildlife that forage in these waters, such as waterfowl. In these cases,
25 contaminants associated with the cooling system may have adverse impacts on terrestrial
26 organisms. Maintenance dredging near cooling system intakes or outfalls may disturb wetland
27 habitats along with accumulated sediments, and sedimentation from dredging disposal may
28 indirectly affect wetlands. Shoreline wetlands or riparian habitats may be affected by erosion
29 resulting from high-velocity effluent discharges or altered current patterns. The impacts of the
30 cooling system are of concern if water temperature, humidity and fogging levels, contaminants
31 associated within the discharged effluent, maintenance activities, or discharge flows have
32 adverse effects on local plant and animal populations.
33

34 The NRC examined the potential impacts of the operation of nuclear power plant cooling
35 systems on terrestrial resources during the 20-year license renewal term by reviewing published
36 site-specific radiological effluent release (RER) reports, site environmental reports (ERs), and
37 SEISs. For this analysis, a total of eight nuclear power plants with different types of cooling
38 systems were investigated to determine the effects of cooling system operation on terrestrial
39 resources. The type of cooling system that operated at each of the eight power plants
40 reviewed, and a summary of the contaminants evaluated in the aquatic effluent, are shown in
41 Table 4.6.1.1–2.

Environmental Consequences and Mitigating Actions

1

Table 4.6.1.1–2. Contaminants Evaluated in Cooling Systems at Selected Power Plants

Power Plant	Cooling System	Contaminants	References
Dresden	Cooling lake and spray canal	Chlorine, tritium, heavy metals	NRC 2004a; Exelon 2003
Oyster Creek	Once-through cooling	Chlorine, tritium, VOCs	NRC 2007b
Palisades	Mechanical draft cooling tower	Chlorine, tritium, bromine, oil	NRC 2006d
Peach Bottom	Once-through cooling with towers	Chlorine, tritium, strontium	NRC 2003a; Exelon 2001
Pilgrim	Once-through cooling	Chlorine, tritium, heavy metals	NRC 2007c
Turkey Point	Closed-cycle canal	Chlorine, tritium	NRC 2002b; FPL 2000
Vermont Yankee	Once-through cooling and towers	Chlorine, copper, iron, zinc	NRC 2007a
Wolf Creek	Closed-cycle cooling pond	Chlorine, tritium	WCNOC 2002; WCGS 2003

2

3 Contaminants investigated to be of potential concern in the liquid effluent associated with
 4 cooling systems at nuclear power plants include chlorine and other biocides, tritium, heavy
 5 metals, volatile organic compounds (VOCs), oil products, and strontium. The concentrations of
 6 these contaminants have been found to be low within the liquid effluent discharged from the
 7 nuclear power plants. Although water screening guidelines have not been established for
 8 terrestrial biota, compliance with NPDES permits ensures that nonradioactive contaminant
 9 concentrations discharged from the cooling system are low enough to have only small impacts
 10 on water quality and aquatic communities. Although these requirements are not designed
 11 specifically to be protective of terrestrial biota, the water concentrations of contaminants
 12 associated with cooling systems are much lower than the lowest concentrations known to have
 13 adverse effects on terrestrial organisms. For instance, chlorine-contaminated drinking water
 14 begins to damage the cells of laboratory rodents at concentrations as low as 25 to 30 parts per
 15 million (ppm) (EPA 1989), whereas Carlton et al. (1986) found no effects of chlorine
 16 concentrations of 1, 2, or 5 ppm on the growth or reproductive capabilities of laboratory rats.
 17 The NPDES permits at nuclear power plants limit chlorine discharges to a maximum of
 18 0.2 ppm, which is less than those concentrations reported to have no adverse effects on
 19 laboratory animals. At the Wolf Creek plant in Kansas, the use of a biocide (chlorine) in the
 20 cooling system was predicted to cause periodic mortality to organisms in the discharge area of
 21 the plant's cooling lake (Wolf Creek Lake). It was estimated that 0.68 to 1.08 mg/L of total
 22 residual chlorine was required to be discharged in order for any negative impacts on aquatic or
 23 terrestrial organisms to be observed. Impacts on terrestrial species could include toxicity

1 effects of chlorine as well as potential reductions in availability of aquatic food species.
2 However, the implementation of the NPDES limits the discharge of biocides to a maximum of
3 0.2 mg/L (WCNOC 2002), thus ensuring that the impacts of the discharge of biocides in the
4 cooling system effluent on aquatic and terrestrial organisms are minimal.

5
6 From a review of the 2006 RER reports for the power plants, quarterly tritium releases in liquid
7 effluent may be as high as 1.69×10^{-5} $\mu\text{Ci/mL}$. These concentrations do not exceed the public
8 health-regulated tritium concentrations specified in 10 CFR 20, Appendix B, Table 2, which is
9 set at 0.001 $\mu\text{Ci/mL}$ for water effluent concentrations. Tritium concentrations discharged in
10 liquid effluent are much lower than those reported to have adverse effects on terrestrial wildlife.
11 For example, Cahill et al. (1975) exposed rats to 1, 10, 50, or 100 $\mu\text{Ci/mL}$ of tritium in drinking
12 water per day. They found that rats exposed to the higher doses (50 and 100 $\mu\text{Ci/mL}$)
13 experienced shorter life spans, whereas no adverse chronic effects were observed in rats at the
14 two lower doses (1 and 10 $\mu\text{Ci/mL}$). Therefore, the discharge of contaminants on terrestrial
15 resources during the license renewal term is considered to be of small significance.

16
17 In the operation of the cooling system, contaminants (e.g., heavy metals) may be leached from
18 condenser tubing and discharged by the power plant's cooling system. Elevated concentrations
19 of these contaminants are toxic to aquatic and terrestrial organisms. In the past, the use of
20 copper alloy condenser tubes in the cooling systems at the H.B. Robinson plant in South
21 Carolina and Diablo Canyon plant in California resulted in the discharge of copper in the liquid
22 effluent, which was observed to have adverse effects on the morphology and reproduction of
23 resident bluegill populations (Harrison 1985). Terrestrial wildlife that feed on these fish in the
24 receiving waters could be exposed to elevated copper levels. Also, potential reductions in
25 populations of prey species could affect predator species. However, the replacement of the
26 copper alloy condenser tubes with tubes made of different materials (e.g., titanium) has rectified
27 this problem.

28
29 Thermal impacts on terrestrial habitats or wildlife exposed to elevated temperatures have not
30 been identified at the nuclear power plants; however, as noted above, the growth of plants
31 along portions of cooling pond shorelines may be restricted by high-temperature effluents.
32 Temperature increases in receiving water bodies due to effluent discharges are regulated
33 through NPDES permits to limit the extent of temperature increases for the protection of biota.
34 In addition, because the plant communities present have been influenced by many years of
35 facility operation, the elevated temperatures are unlikely to result in mortality of wetland and
36 riparian plants that may be exposed to the discharges because species that are intolerant of
37 elevated temperatures are unlikely to be growing near the outfall. The heated effluents could
38 lengthen the growing season for wetland or riparian plant communities present. A potentially
39 beneficial effect of the heated discharges at the Turkey Point plant in Florida has been the
40 development of suitable habitat for the American crocodile (*Crocodylus acutus*), an established
41 population of which occupies the cooling canal system. In addition, ice-free open water areas

Environmental Consequences and Mitigating Actions

1 that provide foraging opportunities for the bald eagle (*Haliaeetus leucocephalus*) and various
2 waterfowl species are often maintained by heated discharges during winter months at a number
3 of nuclear plants in northern states. These benefits would be expected to continue during the
4 license renewal term.

5
6 The impingement of waterfowl at the cooling water intakes has been observed at some nuclear
7 plants, such as the Cook plant in Michigan, the Nine Mile Point plant in New York, and the Point
8 Beach plant in Wisconsin. About 400 ducks, primarily lesser scaup (*Aythya affinis*), were
9 impinged at the D.C. Cook plant in December 1991 (Mitchell and Carlson 1993); about 100
10 ducks, both greater scaup (*Aythya marila*) and lesser scaup, were impinged in January 2000 at
11 the Nine Mile Point plant (NRC 2006e). At Point Beach, a number of double-crested
12 cormorants (*Phalacrocorax auritus*) were impinged in September 1990, and 33 birds (mostly
13 gulls) were impinged from June 2001 through December 2003 (NRC 2005b). Changes in
14 operational procedures, such as the periodic cleaning of zebra mussels off intake structures,
15 and changes in intake structure design, have been implemented to minimize the impacts on
16 waterfowl. It is likely that any impingement over the license renewal term would result in only
17 minor effects on waterfowl populations.

18
19 Groundwater quality can be degraded by contaminants present in cooling ponds and cooling
20 canals. Deep-rooted terrestrial plants could be exposed to these contaminants. In addition,
21 biota could be exposed to contaminants at locations of groundwater discharge, such as
22 wetlands or riparian areas. However, as noted above, contaminant concentrations are typically
23 very low, and any effects on terrestrial plants would be expected to be small. Mitigation may
24 also be implemented where sensitive resources could be affected. At the Turkey Point plant in
25 Florida, for example, the flow of hypersaline groundwater from the cooling canals toward the
26 Everglades to the west is prevented by an interceptor ditch, located along the west side of the
27 canal system, from which groundwater inflow is extracted (NRC 2002b).

28
29 Surface water or groundwater that is withdrawn by nuclear power plants may potentially reduce
30 the availability of water to terrestrial biota, such as those associated with wetlands or riparian
31 areas along surface water bodies used as sources of cooling water, or those supported by
32 groundwater discharges to wetlands or riparian areas. For once-through cooling systems, flow
33 reductions from consumptive use generally represent a small decrease in water availability and
34 have not resulted in water use conflicts for terrestrial resources. For example, losses due to the
35 operation of the cooling system at the Peach Bottom plant in Pennsylvania, which operates as a
36 once-through system with helper cooling towers, represent less than 2 percent of the minimum
37 monthly average river flow of the cooling water source (NRC 2003a). However, for some
38 closed-cycle systems, consumptive water use may result in conflicts with requirements for the
39 protection of riparian, wetland, or other communities, primarily where the nuclear plants are
40 located on small bodies of water or small streams. Although water withdrawal rates are much
41 lower for closed-cycle systems (which require makeup water as a result of evaporative losses)

1 than for once-through systems, consumptive losses may be relatively high. Because of
2 restrictions imposed on water withdrawal and consumption rates, which are protective of biotic
3 resources, reductions in plant operations may be required under certain conditions when there
4 are low water levels, such as during droughts. During extensive droughts, temporary impacts
5 on riparian and wetland communities could occur.
6

7 Impacts on terrestrial biota associated with the operation of the cooling system have not been
8 reported as a problem at any of the nuclear power plants evaluated. No adverse effects on
9 terrestrial plants or animals have been reported as a result of increased water temperatures,
10 fogging, humidity, or reduced habitat quality. Because of the low concentrations of
11 contaminants within the liquid effluents associated with the cooling systems, the uptake and
12 accumulation of contaminants in the tissues of wildlife exposed to the contaminated water or
13 aquatic food sources are not expected to be a significant issue, and the impacts are expected
14 to be small for all plants. Potential mitigation measures would include regular monitoring of the
15 cooling systems for water quality and measures to exclude wildlife from contaminated ponds.
16 On the basis of these considerations, the NRC concludes that the impact of continued
17 operation of the cooling systems on terrestrial resources would be small for all nuclear plants
18 and is considered a Category 1 issue.
19

20 *Cooling Tower Impacts on Vegetation*

21

22 Continued operation of cooling towers could affect vegetation during the license renewal term.
23 This issue applies only to operating nuclear power plants with cooling towers. The issue is a
24 combination of two issues evaluated in the 1996 GEIS: (1) impacts of cooling tower drift on
25 agricultural crops and ornamental vegetation and (2) impacts of cooling tower drift on terrestrial
26 ecology. Impacts of cooling tower emissions on these resources were considered to be small
27 for all plants and were designated as Category 1 issues in the 1996 GEIS.
28

29 As discussed in Section 3.6.1, terrestrial habitats in the vicinity of nuclear power plant cooling
30 towers have been exposed to deposition of cooling tower drift particulates (including salt),
31 deposition of water droplets on vegetation from drift, structural damage from freezing vapor
32 plumes, and increased humidity. Drift contains small amounts of particulates that are dispersed
33 from cooling towers over a wide area, with particulates from natural draft towers dispersing over
34 a larger area and at a lower deposition rate than from mechanical draft towers (NRC 1996).
35 However, most of the deposition from cooling towers occurs in relatively close proximity to the
36 towers. Generally, deposition rates from these cooling towers have been below those that are
37 known to result in measurable adverse impacts on plants, and no deposition effects on
38 agricultural crops or plant communities have been observed at most of the nuclear power plants
39 (NRC 1996). Exceptions have been observed at some nuclear plants; however, the impacts
40 have been addressed by changes to cooling tower operations. For example, high levels of
41 sulfate deposition, along with temporary excessive icing conditions at the Palisades plant on the

Environmental Consequences and Mitigating Actions

1 southeast shoreline of Lake Michigan, resulted in the loss of about 5 ac (2 ha) of dune forest
2 near the cooling towers and its replacement with a dense scrub-shrub community within several
3 years of the startup of operations (NRC 2006b). These conditions were subsequently resolved
4 by changes made to the cooling system.
5

6 Salt deposition from cooling tower drift is a potential impacting factor that can affect coastal
7 power plants that use high-salinity water for cooling. The only such nuclear plant is the Hope
8 Creek plant in New Jersey, which has natural draft cooling towers and withdraws cooling water
9 from the Delaware River estuary (see Section 3.3.2 for a discussion of Hope Creek cooling
10 tower drift emissions). High rates of deposition on plants or soil can result in injury to plants
11 from acute effects and may result in changes to plant communities from chronic effects
12 (Talbot 1979). Salt-tolerant species may increase in abundance, while sensitive species may
13 decrease. Some salt-tolerant species are invasive and may become dominant in affected
14 areas. However, no measurable effects from cooling tower drift on plant communities in the
15 vicinity of Hope Creek have been observed (NRC 1996). The Palo Verde plant in Arizona uses
16 cooling water with somewhat elevated salt concentrations. Studies have detected elevated
17 levels of salt in plant leaves near the plant; however, the studies showed that no changes to
18 native plants or crop production occurred (see Section 3.3.2 for a discussion of cooling tower
19 drift emissions from the Palo Verde plant).
20

21 Impacts from icing have been rare, minor, and localized near nuclear power plant cooling
22 towers and have been corrected by changes in tower operation at the plants where they
23 occurred. For example, icing damaged oak trees adjacent to the cooling towers at the Prairie
24 Island plant in Minnesota, changing the tree canopy structure and reducing acorn viability.
25 Changes in tower operations eliminated the impacts (NRC 1996). Impacts from increased
26 humidity have not been observed at nuclear power plants.
27

28 The continued operation of nuclear power plants would not be expected to result in increases in
29 deposition rates from cooling towers or the accumulation of deposition constituents in soils.
30 Because of the solubility of these materials, they are generally removed through precipitation.
31 Plant communities in the vicinity of cooling towers have been exposed to many years of cooling
32 tower operations, and are unlikely to change during the license renewal term. Any effects of
33 icing during the renewal period would continue to be rare, minor, and localized. On the basis of
34 these considerations, the NRC concludes that the impact of continued operation of cooling
35 towers on plant communities would be small for all nuclear plants and is considered a Category
36 1 issue.
37

38 *Bird Collisions with Cooling Towers and Transmission Lines*

39

40 This section addresses the issue of avian mortality resulting from collisions of birds with natural
41 draft cooling towers and transmission lines at nuclear power plants. Natural draft towers, which

1 are tall structures (usually taller than 100 m [330 ft]), cause some mortality, whereas
2 mechanical draft towers, which are smaller (usually shorter than 30 m [100 ft]), cause negligible
3 mortality (NRC 1996). Because of these facts, mechanical draft towers are not addressed
4 here. The impacts from birds colliding with cooling towers and transmission lines were
5 evaluated by reviewing the primary literature for avian collision mortality associated with all
6 types of man-made objects, as well as the results of monitoring studies conducted at six
7 nuclear plants. The magnitude of the impact of the mortality caused by cooling towers is
8 determined by examining the actual numbers and species of birds killed and comparing this
9 mortality with the total avian mortality resulting from other man-made objects relative to bird
10 population size.

11
12 Throughout the United States, it has been estimated that millions of birds are killed each year
13 when they collide with man-made objects, including cooling towers, radio and television towers,
14 buildings, vehicles, wind generation facilities, transmission lines, and numerous other objects
15 (Erickson et al. 2001). Many of these deaths can be considered unlawful take under the
16 Endangered Species Act or the Migratory Bird Treaty Act. Bird mortality resulting from
17 collisions with man-made structures is of concern if the stability of the local or migratory
18 population of any bird species is threatened or if the reduction in numbers within any bird
19 population significantly impairs its function within the ecosystem.

20
21 The number of collision-related bird deaths varies, depending on the type of man-made object.
22 For example, Table 4.6.1.1–3 shows the estimated annual bird collision mortality in the United
23 States. Collisions with buildings and windows account for the greatest number of collision
24 mortalities annually, whereas wind generation facilities account for the least number of collision-
25 related deaths (Table 4.6.1.1–3; Erickson et al. 2001). These estimates differ largely as a result
26 of the density of the man-made structures in the study areas. It is estimated that more than
27 98 million commercial and residential buildings exist across the United States (Klem 1990;
28 Erickson et al. 2001); compare this number with the number of wind turbines, which is less than
29 20,000 in 29 States (Manville 2005).

30
31 There are nearly 100,000 communication towers registered with the Federal Communications
32 Commission (FCC 2003), some of which have been observed to cause a large number of avian
33 collision mortalities (Able 1973; Kemper 1996; Crawford and Engstrom 2001). Most of these
34 large mortality events at communication towers occur at night during spring and fall migration
35 periods involving songbirds that appear to become confused by tower lights (Taylor and
36 Kershner 1986; Larkin and Frase 1988; Manville 2005). For example, a single television tower
37 in northern Florida, Crawford and Engstrom (2001) reported more than 44,000 bird collision
38 mortalities over a 29-year period. Communication towers involved with the most bird collisions
39 are tall (exceeding 1000 ft [305 m]), illuminated at night with incandescent lights, guyed, and
40 located near wetlands and bird migration pathways (Manville 2005). During nights of heavy
41

Environmental Consequences and Mitigating Actions

Table 4.6.1.1–3. Estimated Annual Bird Collision Mortality in the United States

Source	Annual Mortality ^(a)
Vehicles ^(b)	60 million to 80 million
Buildings and windows ^(c)	98 million to 980 million
Powerlines ^(d)	10,000 to 174 million
Communication towers ^(e)	4 million to 50 million
Wind generation facilities ^(f)	10,000 to 40,000

(a) Estimated annual mortality was extrapolated from literature reviews.

(b) Includes automobiles, trains, and airplanes.

(c) Includes buildings and attached structures such as smokestacks and windows.

(d) Includes all electric communication lines and transmission lines.

(e) Includes radio, television, cellular, microwave, and public safety towers.

(f) Includes wind turbines and supporting structures.

Source: Erickson et al. 2001

1
2 cloud cover or fog, the incandescent lights illuminating the communication towers may attract
3 migrating songbirds to the towers, increasing the likelihood of collisions. Compared to
4 communication towers, cooling towers at nuclear power plants are shorter (less than 650 ft
5 [200 m]) and are illuminated with low-intensity light sources (1.0 ft candle or less), such that
6 migrating birds may not be as attracted to them, thus decreasing the likelihood of collision.

7
8 Natural draft cooling towers and transmission lines create collision hazards for migratory and
9 local bird species. Monitoring of bird collisions has been done at several nuclear plants with
10 natural draft cooling towers, including the Susquehanna plant on the Susquehanna River near
11 Berwick in eastern Pennsylvania, the Davis-Besse plant on the shore of Lake Erie in north
12 central Ohio, the Beaver Valley plant on the Ohio River in extreme western Pennsylvania, the
13 former Trojan plant on the Columbia River in extreme northwestern Oregon, the Three Mile
14 Island plant near Harrisburg in southeastern Pennsylvania, and the Arkansas plant on
15 Dardanelle Lake in northwestern Arkansas. The following information regarding those plants
16 was obtained from nuclear plant annual monitoring reports and from Temme and
17 Jackson (1979).

18
19 At the Susquehanna plant, surveys were conducted on weekdays during the spring and fall bird
20 migrations from 1978 through 1986. (Unit 1 began operating in 1983 and Unit 2 came online in
21 1985.) The plant's natural draft towers are 165-m (540-ft) tall and illuminated at the top with
22 480-V aircraft warning strobe lights. About 1500 dead birds (total for all survey years, an
23 average of 166 per year) representing 63 species were found; they had apparently collided with
24 the cooling towers. Other birds were probably lost in the tower basin water during plant
25 operation. Most of the birds were songbirds. Fewer collisions seemed to occur during plant

1 operation, when cooling tower plumes and noise may have frightened birds away from the
2 towers.

3
4 At Davis-Besse, extensive surveys for dead birds were conducted from fall 1972 to fall 1979.
5 Early morning surveys at the 152-m-tall (499-ft-tall) cooling tower were made almost daily from
6 mid-April to mid-June and from the first of September to late October. After the tower began
7 operating in the fall of 1976, some dead birds were lost through the water outlets of the tower
8 basin. A total of 1561 dead birds were found, an average of 195 per year. The dead birds
9 included 1229 at the cooling tower, 224 around Unit 1 structures, and 108 at the meteorological
10 tower. Most were night-migrating songbirds, particularly wood-warblers (family Parulidae),
11 vireos (*Vireo* spp.), and kinglets (*Regulus* spp.). Waterfowl that were abundant in nearby
12 marshes and ponds suffered little collision mortality. Most collision mortalities at the cooling
13 tower occurred during years when the cooling tower was not well illuminated (1974 to spring
14 1978). After the completion of Unit 1 structures and installation of many safety lights around the
15 buildings in the fall of 1978, collision mortality was significantly reduced (average of 236 per
16 year from 1974 through 1977, 135 in 1978, and 51 in 1979). This reduction was accomplished
17 by installing low-intensity light sources (1.0-ft-candle or less) to illuminate the cooling tower,
18 which allowed birds to see and avoid it. It appears that the lights at nuclear plants do not
19 confuse birds to the extent that lights on radio or TV towers sometimes do.

20
21 At Beaver Valley, surveys were conducted at the natural draft tower in the spring and fall
22 seasons from 1974 through 1978. A total of 27 dead birds were found. At the Trojan plant,
23 surveys were conducted weekly in 1984 and 1988 at the 152-m-tall (499-ft-tall) cooling tower,
24 meteorological tower, switchyard, and generation building. No dead birds were found. At the
25 113-m-tall (371-ft-tall) cooling towers at Three Mile Island, 66 dead birds were found from 1973
26 through 1975. No dead birds were found at the Arkansas plant, where monitoring at the natural
27 draft tower was done twice weekly from October 15 through April 15 in 1978–79 and 1979–80.

28
29 The available data on cooling-tower collision mortality suggest that cooling towers at nuclear
30 power plants cause only a very small fraction of the total annual bird collision mortality from all
31 sources. A very high percentage of all collision mortalities occur during the spring and fall bird
32 migration periods and involve primarily songbirds migrating at night. The relatively few nuclear
33 power plants in the United States that have natural draft towers (24 towers at operating nuclear
34 power plants), combined with the relatively low bird mortality at individual natural draft towers,
35 indicates that (1) bird populations are not greatly affected by collisions with nuclear power plant
36 cooling towers and (2) the contribution of cooling towers to the cumulative effects of bird
37 collision mortalities is very small. Mechanical draft cooling towers, which are not nearly as tall
38 as natural draft towers, pose little risk to migrating birds.

39
40 Because the frequency of avian mortality resulting from collisions with cooling towers is small
41 for any species, it is unlikely that the losses would threaten the stability of local migratory bird

Environmental Consequences and Mitigating Actions

1 populations or result in a noticeable impairment of the function of a species within local
2 ecosystems. There is no reason to believe that the annual mortality rate resulting from collision
3 of birds with any cooling tower would be different during the license renewal term. Mitigation
4 measures may include illuminating the natural draft cooling towers at night with low-intensity
5 lights so birds can see the towers and avoid collisions. Because cooling towers represent only
6 a small part of total bird collision mortality, it is not expected that there will be any incremental
7 impact on bird populations from cooling tower collision mortality as a result of license renewal.
8 The impact from bird collisions with cooling towers during the license renewal term was
9 considered to be small for all nuclear plants and was designated as a Category 1 issue in the
10 1996 GEIS. No new information has been identified in the plant-specific SEISs prepared to
11 date or the literature that would alter that conclusion.

12
13 The potential for birds to collide with transmission lines depends on a number of factors, such
14 as bird species, migration behavior, and location and physical characteristics of the
15 transmission line (Bevanger 1988; Janss 2000; Manville 2005). Larger-bodied bird species
16 such as raptors are more likely to collide with transmission lines (Harness and Wilson 2001;
17 Manville 2005), whereas smaller-bodied birds such as migrating songbirds are more likely to
18 collide with towers (Temme and Jackson 1979). This difference is most likely the result of
19 differences in the behavior of raptors and songbirds. Raptors are known to use utility structures
20 as perch locations and nest sites more often than do songbirds (Blue 1996; Manville 2005),
21 whereas nocturnal migrating songbirds may become confused by the lights on communication
22 towers (Crawford and Engstrom 2001). Lights are not a contributing factor in bird collisions at
23 transmission lines because lights are not generally used to mark transmission lines.

24
25 It is unknown to what extent bird populations are negatively affected by deaths caused by
26 collisions with transmission lines. Generally, bird mortality resulting from collisions with
27 transmission lines has appeared to be only a small fraction of total mortality; therefore, it has
28 not been considered to have significant population impacts (Stout and Cornwell 1976; Banks
29 1979). However, rare, threatened, or endangered species may be affected by transmission
30 lines, particularly if the lines pass through areas where such species are concentrated
31 (Sergio et al. 2004; Sundar and Choudhury 2005). There are no reports of relatively high
32 collision mortality occurring at the transmission lines associated with nuclear power plants in the
33 United States. The length of transmission lines associated with nuclear plants is considerably
34 less than the total 500,000 mi (800,000 km) of transmission lines estimated within the United
35 States (Manville 2005). Therefore, transmission lines associated with nuclear power plants are
36 likely responsible for only a small fraction of total bird collision mortality.

37
38 Because the literature does not indicate there is a significant impact from collision mortality on
39 overall species populations and because there are no known instances in which nuclear plant
40 transmission lines have affected local bird populations, it is not expected that the mortality

1 resulting from bird collisions with transmission lines associated with nuclear plants and an
2 additional 20 years of plant operation would cause long-term reductions in bird populations.

3
4 The impact of bird collisions with transmission lines during the license renewal term was
5 considered to be small for all plants and was designated as a Category 1 issue in the 1996
6 GEIS. No new information was identified in the site-specific SEISs prepared to date or the
7 literature that would alter that conclusion. On the basis of these considerations, the NRC
8 concludes that the impact of bird collisions with cooling towers and transmission lines during the
9 license renewal term would be small for all nuclear plants and remains a Category 1 issue.

10
11 *Water Use Conflicts with Terrestrial Resources (Plants with Cooling Ponds or Cooling Towers*
12 *Using Makeup Water from a River with Low Flow)*

13
14 In the 1996 GEIS, water use conflicts water use conflicts included ecological impacts on aquatic
15 and riparian communities. Water use conflicts with terrestrial resources in riparian communities
16 could occur when water that supports these resources is diminished either because of
17 decreased availability due to droughts; increased water demand for agricultural, municipal, or
18 industrial usage; or a combination of such factors. For example, Wolf Creek uses Coffee
19 County Lake for cooling (NRC 2008a). Makeup water for the lake is withdrawn from the Neosho
20 River downstream of John Redmond Reservoir. The Neosho River is a small river with low
21 water flow during drought conditions. The riparian communities downstream of this reservoir
22 may be affected by the plant's water use during periods when the lake level is low and makeup
23 water is obtained from the Neosho River. For the Wolf Creek plant, the water use conflict
24 impact is small to moderate and a site-specific condition. The potential range of impact levels at
25 plants with cooling ponds or cooling towers using makeup water from a small river with low flow
26 applying for license renewal in the future cannot be determined at this time. The NRC
27 concludes that the impact of water use conflicts with riparian communities is a plant-specific
28 Category 2 issue.

29
30 *Transmission Line Right-of-Way (ROW) Management Impacts on Terrestrial Resources*

31
32 This section evaluates the extent to which plant communities and wildlife populations could be
33 affected by transmission line ROW management during the license renewal term at all nuclear
34 power plants. This issue is a combination of two issues that were evaluated in the 1996
35 GEIS: (1) impacts of ROW management on terrestrial resources and (2) impacts of ROW
36 management on floodplains and wetlands. Impacts on these resources were considered to be
37 small for all plants and were designated as Category 1 issues in the 1996 GEIS.

38
39 Generally, ROW management involves clearcutting, selective cutting of tall woody vegetation,
40 mowing, or herbicide application. These activities alter the physical features of vegetation
41 communities by reducing vegetation height, density, and species diversity, which may impact

Environmental Consequences and Mitigating Actions

1 wildlife populations inhabiting those areas. The cutting of woody vegetation is usually not
2 needed in grassland, desert, or shrub habitats, so associated impacts are not an issue there.
3 Habitat quality in the ROW and nearby areas may be affected, and ROW management may
4 affect local wildlife populations. Data on the effects of maintenance of transmission line ROWs
5 specifically associated with nuclear power plants are not available, but the literature applies to
6 such transmission lines because the methods used to maintain transmission line ROWs are
7 similar for any transmission line ROW at any facility.

8
9 Plant communities are affected by the presence of maintained ROWs as well as other ongoing
10 maintenance activities. The principal impacts associated with transmission line ROWs occur as
11 a result of the initial clearing activities during transmission line installation. During installation,
12 forested upland and wetland habitats in ROWs are typically converted to scrub-shrub
13 communities, herbaceous upland, or emergent wetland types when trees are removed. Effects
14 are less extensive where ROWs are established in grassland, desert, or shrub habitats. ROW
15 effects extend beyond the area of direct disturbance. Transmission line ROWs established in
16 otherwise undeveloped areas contribute to habitat fragmentation and affect the distribution of
17 species in undisturbed areas along the corridors. The effects of habitat fragmentation
18 associated with clearings and the creation of edges may continue to develop over a
19 considerable period of time, since some species are lost while others become established
20 (Saunders et al. 1991). Clearings in wooded areas tend to contribute to an increase in deer
21 populations and increased access to forest interior areas (Alverson et al. 1988). The gradual
22 loss of some plant species from these areas due to browsing may extend over many decades.

23
24 The operation of heavy equipment during ROW maintenance activities can result in soil
25 compaction, affecting the establishment of some native plant species. ROW corridors
26 occasionally provide a route for the introduction or expansion of invasive species populations
27 into new areas. Significant changes in vegetation cover, such as removal of the tree canopy,
28 and compaction of upland soils within the watershed of a wetland generally result in increased
29 runoff and reduced infiltration to shallow groundwater, causing an increase or decrease in
30 hydrologic input to nearby wetlands (EPA 1993, 1996; Wright et al. 2006). Effects include
31 changes in the frequency or duration of inundation or soil saturation and greater fluctuations in
32 wetland water levels. Runoff often contains sediments, contaminants from road and parking
33 surfaces, or herbicides used in ROW or site vegetation management. Erosion of wetland
34 substrates and plants can result from increased flow velocities that result from the changes in
35 runoff and surface drainage patterns.

36
37 The presence of the ROWs would continue to affect the habitats within and adjacent to the
38 transmission line corridors during the license renewal term; there would be more light and less
39 soil moisture than found in undisturbed habitats. The plant communities that became
40 established during the years of the initial operating license would generally remain altered
41 communities, with a different species composition and community structure than undisturbed

1 habitats. In many areas, ROW management would prevent the development of mature plant
2 communities. Plant species that are typically associated with high-quality, undisturbed native
3 habitats and are intolerant of disturbed conditions would generally continue to be excluded from
4 ROWs. Although species diversity may be high in these disturbed habitats, many of the
5 species may be common or weedy native species or nonnatives. However, in some areas, rare
6 or protected species that require open canopies, such as the golden sedge (*Carex lutea*),
7 Cooley's meadowrue (*Thalictrum cooleyi*), and rough-leaf loosestrife (*Lysimachia*
8 *asperulaefolia*), which occur within the Brunswick Steam Electric Plant ROWs in North Carolina,
9 would continue to occur under the conditions existing within the ROWs. Invasive upland or
10 wetland species that became established within the ROWs during the initial operating license
11 would continue to exclude native species and reduce species diversity (BPA 2000). Invasive
12 species populations may continue to expand unless aggressive management efforts are
13 implemented.

14
15 Plant communities in and along ROWs are generally maintained in a modified condition for safe
16 and efficient operation of the transmission lines. To protect the electric conductors, ROW
17 management typically includes the periodic cutting of tall trees and application of herbicides.
18 Tree cutting is a minor management activity in regions where tree growth in ROWs is limited,
19 such as in grasslands, desert, or shrubland areas. Mowing is also frequently used as a
20 management method to control the growth of woody species and promote the establishment of
21 grassland or other herbaceous habitat types. Management activities and transmission line
22 repair occasionally result in the erosion of exposed soils where vegetation has been removed or
23 where soils are disturbed by equipment. Management activities that result in the disturbance,
24 compaction, or exposure of soils may promote the establishment of invasive species
25 (BPA 2000). Erosion of upland soils may result in sedimentation or increased turbidity in
26 wetlands within the watershed. Herbicides used to manage undesirable species may drift onto
27 nontarget species or affect wetland communities through runoff from treated areas (BLM 2007).
28 The operation of heavy equipment in wetlands during ROW maintenance or transmission line
29 repair can damage or compact wetland soils and vegetation.

30
31 Many of the nuclear power plants incorporate mitigation into their ROW management plans to
32 protect wetlands or other sensitive or high-quality habitats. For example, within the ROWs of
33 the Millstone plant in Connecticut, precautions are taken to protect and promote quality
34 habitats. Herbicide use is prohibited within 10 ft of wetlands or surface water, and mowing is
35 conducted only from November through April to protect saturated soils and minimize loss of fruit
36 and seeds (NRC 2005c). ROW maintenance practices used at the Brunswick plant in North
37 Carolina, such as methods of herbicide use, are designed to preserve and protect rare and
38 listed plant species and sensitive natural areas known to occur within the ROWs. Established
39 procedures are in place to protect rare and listed plant species if they are encountered by
40 maintenance crews (NRC 2006b). At the Browns Ferry plant in Alabama, field studies are
41 conducted to inventory and protect listed plant species and sensitive habitats. Species

Environmental Consequences and Mitigating Actions

1 populations are monitored, and habitats are managed and maintained. In the most sensitive
2 areas, vehicles and equipment are prohibited, and all vegetation clearing is done by hand
3 (NRC 2005d).

4
5 Most data on the impacts of transmission line ROWs on wildlife are for relatively moist areas of
6 the United States where vegetation growth is rapid and vegetation must be controlled to prevent
7 its interference with the transmission lines. In arid regions, little or no vegetation control is
8 required, and the potential effects on wildlife are small. Potential effects are also small where
9 lines cross croplands, because no vegetation management is required. The following
10 discussion is therefore applicable primarily to forested regions where the utility must control
11 vegetation on transmission line ROWs.

12
13 The maintenance of a transmission line ROW could directly affect wildlife as the result
14 of (1) continued habitat loss or alteration; (2) displacement due to noise during maintenance
15 activities; (3) mortality from maintenance equipment, conductors, or wires; (4) reduced mobility
16 of some species, such as amphibians, across the cleared ROW; and (5) toxicity from herbicide
17 or fuel spills. ROW creation establishes, and maintenance activities maintain, a new habitat
18 type that divides a pre-existing and usually much larger habitat type, such as a forest
19 (Yahner et al. 2004). The increased amount of edge along the boundary of the two habitats
20 may affect wildlife by (1) increasing rates of predation among nesting birds, (2) restricting
21 wildlife dispersal and migration patterns, (3) negatively affecting wildlife species that require
22 large undisturbed areas, or (4) increasing local wildlife abundance and diversity.

23
24 Many studies identify the potential effects of ROW maintenance on wildlife populations.
25 Transmission line ROWs may represent a barrier for species, such as large mammalian
26 carnivores, that require large tracts of contiguous forested habitat (Crooks 2002). ROW
27 maintenance may also have negative effects on smaller, less mobile wildlife species. For
28 example, studies have shown that some amphibian species have difficulty crossing disturbed
29 habitat and may experience increased rates of mortality as a result of physiological stress
30 (Gibbs 1998; Rothermel 2004).

31
32 Traditionally, habitat edges have been considered to be beneficial to wildlife because species
33 diversity is usually greater there (Yahner 1988). However, some species such as neotropical
34 migrating songbirds that prefer interior forest habitat may be adversely affected by the increase
35 in edge habitat associated with ROW clearings. These species require large blocks of forest
36 for successful reproduction and survival (Wilcove 1988). Studies have found that nests of
37 these bird species placed near edges are more likely to fail as a result of predation or nest
38 parasitism than nests located near the forest interior (Paton 1994; Robinson et al. 1995). This
39 failure is often due to an increase in the abundance of predators (e.g., skunks and raccoons)
40 and nest parasites (e.g., brown-headed cowbirds [*Molothrus ater*] that lay their eggs in the
41 nests of other birds), which are capable of proliferating in disturbed areas and edge habitats

1 (Evans and Gates 1997; Crooks and Soulé 1999). Increased predation and nest parasitism
2 rates along edge habitats have reduced the populations of some neotropical bird species to the
3 point where they have become locally extinct (Crooks and Soulé 1999).

4
5 Numerous studies indicate that wildlife populations can benefit from ROW management.
6 Ongoing research on the effects of ROW management on wildlife has been conducted for more
7 than 50 years at the State Game Lands 33 Research Project in Pennsylvania (Yahner 2004).
8 Results of the studies conducted at that site indicate that long-term management of the ROW
9 may provide an essential food source and cover habitat for insects, amphibians and reptiles,
10 numerous bird species, and mammals such as black bear (*Ursus americanus*) and white-tailed
11 deer (*Odocoileus virginianus*). Even species of concern, such as neotropical migrant birds,
12 have been commonly observed using the brushy habitats provided by the ROW.
13 Yahner et al. (2002, 2004) found that herbicide treatments in the ROW did not have any
14 adverse effects on the nesting success of neotropical migrating bird species like the eastern
15 towhee (*Pipilo erythrophthalmus*). King and Byers (2002) discovered that songbird nesting
16 success was greater within the brushy ROW habitat than in nearby vegetation communities.

17
18 In a study of rodent populations in Oregon, Wolff et al. (1997) found higher densities of gray-
19 tailed voles (*Microtus canicaudus*) in disturbed open habitats than in other habitats. They also
20 found no effect of habitat disturbance on vole survival, reproductive success, or population size.
21 Johnson et al. (1979) found that the diversity of small mammals was greater in ROW habitats
22 than in adjacent forest habitats. There is also evidence that ROW maintenance can provide
23 suitable habitat for some important insect populations, such as butterflies (Bramble et al. 1999).
24 Thus, the management of ROW habitats may provide suitable habitat for a number of wildlife
25 species, including some sensitive species such as neotropical migrant songbirds.

26
27 An important aspect of ROW management is the consideration of management strategies that
28 limit the adverse effects on wildlife species. Herbicides are generally not highly toxic to wildlife
29 when they are properly applied for ROW management. Therefore, toxic effects of herbicides on
30 wildlife are generally of little concern to wildlife biologists or wildlife managers. Of the papers
31 reviewed for this analysis, none expressed serious concern about toxic effects. In fact, some
32 management techniques using herbicides have been proposed to maintain the function of the
33 ROW and maximize the amount of suitable habitat for wildlife species. Yahner et al. (2002)
34 proposed a phased approach to control the growth of undesirable plants, such as large trees,
35 and maintain an early successional shrub-like plant community along the ROW. This objective
36 could be accomplished through a combination of mechanical treatments (e.g., mowing) and
37 selective herbicide applications. This approach could minimize the costs associated with
38 vegetation management along a ROW and might be an important conservation tool for
39 numerous wildlife species (Marshall and Vandruff 2002; Yahner et al. 2002).

Environmental Consequences and Mitigating Actions

1 The overall impact of transmission line ROW areas appears to be neither significantly adverse
2 nor significantly beneficial. The consensus among wildlife biologists appears to be that
3 although the initial habitat destruction associated with ROW clearing can have numerous
4 consequences on wildlife populations, the proper management of transmission line ROW areas
5 does not have significant adverse impacts on current wildlife populations, and ROW
6 management can provide valuable wildlife habitats. Of the papers reviewed for this evaluation,
7 none identified any significant impact of transmission line corridors on wildlife. The evidence
8 supports a conclusion that continued ROW management during the license renewal term will
9 not lower habitat quality or cause significant changes in wildlife populations in the surrounding
10 habitat. On the basis of these considerations, the NRC concludes that the impact of continued
11 transmission line ROW management on terrestrial resources is small for all nuclear plants and
12 remains a Category 1 issue.

13

14 *Effects of Electromagnetic Fields on Flora and Fauna (Plants, Agricultural Crops, Honeybees,* 15 *Wildlife, Livestock)*

16

17 The effects of electromagnetic fields on terrestrial biota are considered to be of small
18 significance if the overall health, productivity, and reproduction of individual species appear
19 unaffected.

20

21 The EMFs produced by operating transmission lines up to 1100 kV have not been reported to
22 have any biologically or economically significant impact on plants, wildlife, agricultural crops, or
23 livestock (Lee et al. 1989; Miller 1983). Areas under and in the vicinity of the lines have been
24 studied numerous times. Vegetation, foliar damage due to EMF-induced corona at leaf
25 margins, agricultural crop production, wildlife population abundance, livestock production, and
26 potential livestock avoidance of the lines have been investigated. Also, many laboratory
27 experiments with plants and laboratory animals have been conducted, often using electric fields
28 much stronger than those occurring under transmission lines.

29

30 *Plants* – Studies have shown that minor damage to plant foliage and buds can occur in the
31 vicinity of strong electric fields. For example, tree foliage and buds that are close to
32 transmission lines can be damaged and upward or outward growth of branches can be
33 reduced. Damage typically occurs only to the tips and margins of leaves in the uppermost plant
34 parts that are the closest to the lines. The damage in the form of a leaf burn is most prevalent
35 on small pointed leaves and is similar to leaf damage that might occur as a result of drought or
36 other environmental stresses. The damage generally does not interfere with overall plant
37 growth (Miller 1983).

38

39 The damage is thought to result from heating caused by induced corona at the leaf tips and
40 margins. The electric field is greatly focused by leaf points or marginal teeth, thus increasing its
41 strength to the point that corona (Section 4.6.1.3) occurs. Night-vision instruments have shown

1 this corona as a glow of light concentrated at leaf tips and margins. The damage apparently
2 does not extend to lower levels of the plant because the electric field weakens with distance
3 from the lines and because the upper plant parts shield the lower parts from the electric field.
4

5 In one experiment under an 1100-kV prototype line, the upward growth of alder and Douglas fir
6 trees was reduced by this damage, with the result that the crowns of the trees became
7 somewhat flattened on top and the overall crown developed a broader appearance than usual
8 (Rogers et al. 1984). The growth of the lower parts of the trees and of lower-growing plants
9 such as pasture grass, barley, and peas appeared unaffected (Rogers and Hinds 1983). In
10 another experiment, 50-kV/m fields had no apparent effect on corn germination or the growth of
11 corn seedlings; and the growth of corn, bluegrass, and alfalfa apparently was not affected by
12 fields of 25–50 kV even though minor damage occurred to the outer fringes of the uppermost
13 leaves (Bankoske et al. 1976). Germination of sunflower seeds in a 5-kV/m electric field was
14 reduced by about 5 percent in some cases [4 out of 11 replicates (Marino et al. 1983)]. An
15 experiment with several species of agricultural plants found that a maximum of about 1 percent
16 of the total plant tissue was damaged by exposing the plants to 50-kV/m fields (Poznaniak and
17 Reed 1978).
18

19 Lee et al. (1989) reviewed several papers reporting studies in Indiana, Tennessee, and
20 Arkansas. The productivity of corn and other crop plants was not affected by electric fields of
21 12 to 16 kV/m under a 765-kV line and a UHV test line in Indiana, although plants under the
22 larger line suffered some leaf tip damage from induced corona. Corn production in Tennessee
23 may have been reduced by electric fields up to 8.5 kV/m, but the authors indicated the results
24 were inconclusive. An Arkansas study found normal yields of rice and soybeans, but a
25 15 percent reduced yield of cotton beneath a 500-kV line (see Section 4.3.1.1). The
26 researchers could not determine whether the reduced cotton yield resulted from electric field or
27 ineffective aerial application of agricultural chemicals beneath the line.
28

29 *Honeybees* – Several studies have shown that honeybees in hives under transmission lines are
30 affected by EMF (Greenburg et al. 1985; Rogers and Hinds 1983; Warren et al. 1981).
31 Adverse effects include increased propolis (a reddish resinous cement) production, reduced
32 growth, greater irritability, and increased mortality. These effects can be greatly reduced by
33 shielding the hives with a grounded metal screen or by moving the hives away from the lines
34 (Rogers and Hinds 1983; Lee 1980). Bindokas et al. (1988) showed that these impacts were
35 not caused by direct effects of the electric fields on the bees but by voltage buildup and electric
36 currents within the hives and the resultant shocks to bees. Bees kept in moisture-free
37 nonconductive conditions were not adversely affected, even in electric fields as strong as
38 100 kV/m.
39

40 *Wildlife and Livestock* – Chronic exposure to EMF is experienced by small birds and mammals
41 that primarily inhabit ROW corridors and by birds (primarily raptors) that nest in transmission

Environmental Consequences and Mitigating Actions

1 line towers. EMF exposures to larger animals and livestock are usually relatively brief because
2 these animals inhabit relatively large areas instead of small areas beneath the lines. Exposures
3 occur as these larger animals pass beneath the lines or as birds fly by the lines.

4
5 The voluminous literature on population studies of small bird and mammal species in
6 transmission line corridors (presented earlier in this section) has expressed virtually no concern
7 for possible impacts of EMF. These species apparently thrive underneath the lines, where their
8 abundance appears to depend on habitat quality rather than on the strength of the electric
9 fields to which they are exposed or the size of the line. For example, the density of breeding
10 birds under 500-kV lines in eastern Tennessee is greater than that in adjacent forests
11 (Kroodsma 1984, 1987) and appears to be greater than bird density in most grassland habitats
12 or agricultural fields. Also, the density of small mammal populations near these lines appears
13 to depend on habitat type rather than on the presence of the lines (Schreiber et al. 1976). A
14 Minnesota study of a 500-kV line found little evidence of either a positive or negative effect of
15 the power line on bird populations (Niemi and Hanowski 1984). Bird and small mammal
16 populations under an 1100-kV line in Oregon were also apparently unaffected by line
17 operations (Rogers and Hinds 1983). Habitat use by elk in western Montana was apparently
18 unaffected by operation of a 500-kV line, as the elk used habitats along the power line in
19 proportion to their availability (Canfield 1988).

20
21 Raptors, ravens, and some water bird species frequently nest and perch on transmission line
22 towers, particularly in grassland areas where other suitable nest sites are lacking. Thus, the
23 birds are able to use habitats without suitable nest sites – habitats that they otherwise would not
24 have used (Gilmer and Stewart 1983; Williams and Colson 1989). On high-voltage lines
25 supported by metal lattice towers, the birds usually nest on the top (bridge) of the tower where
26 the strength of the electric field is minimal (e.g., 5 kV/m or less) (Lee 1980). Lee
27 found 80 percent of 110 nests on towers to be located on the tower bridge and cited
28 previous studies that showed similar results.

29
30 The success of these tower nests in producing young appears to be no different from nests
31 located in areas not exposed to EMF. In central North Dakota, 113 ferruginous hawk nests in
32 high-voltage transmission line towers (18 percent of a total of 628 nests found) had a higher
33 success rate (87 percent) than nests in other locations (however, a hail storm that missed the
34 lines reduced the success of some other nests). The number of fledglings per occupied nest
35 was 2.8 for ground nests (which were larger than tower or tree nests), 2.6 for tower nests,
36 2.3 for haystack nests, and 2.0 for tree nests (Gilmer and Stewart 1983). In Idaho,
37 Steenhof et al. (1993) studied nesting success of ravens and raptors on a 576-km (370-mile)
38 segment of 500-kV transmission line constructed in 1981. From 1981 through 1989 (the last
39 year reported by Steenhof et al. 1993), the numbers of these species nesting on transmission
40 towers increased to 133 pairs, including roughly 64 percent common ravens, 21 percent
41 red-tailed hawks, 9 percent ferruginous hawks, 6 percent golden eagles, and 0.3 percent great

1 horned owls. Nesting success of these birds averaged 65 percent to 86 percent and was similar
2 to or better than that of the same species nesting on other structures. Lee (1980) reported
3 finding 110 hawk and raven nests on 260 miles of 230-kV and 500-kV lines of the Bonneville
4 Power Administration. Although the success of these nests was not monitored, the author
5 reported that, based on a literature review, it was unlikely that nesting would be adversely
6 affected by EMF found in most locations in transmission line towers.

7
8 Livestock in both field and laboratory studies have shown no significant impacts when exposed
9 to EMF. Lee et al. (1989) reviewed about 10 reports on effects of transmission lines on livestock
10 in the United States and Sweden. These studies found no evidence that the growth, production,
11 or behavior of beef and dairy cattle, sheep, hogs, or horses were affected by EMF. The studies
12 involved 11 farms along a 765-kV line in Indiana, 55 dairy farms near 765-kV lines in Ohio, 36
13 herds of cattle near 400-kV lines in Sweden, a mail survey of 106 farms in Sweden, a study of
14 fertility of 58 cows under a 400-kV line in Sweden compared with 58 in a control area, 30 swine
15 raised beneath a 345-kV line in Iowa compared with 30 raised in a control area, and cattle
16 behavior under an 1100-kV prototype line in Oregon. Cattle under the 1100-kV test line in
17 Oregon were startled by the first occurrence of corona noise when the line was reenergized
18 after a reactor shutdown period (Rogers and Hinds 1983). From 1977 through 1981, grazing of
19 cattle in pasture under the line appeared to be unaffected by line operation. In 1980–1981, the
20 cattle spent more time near the line during periods when it was deenergized than when it was
21 operating, but spent an increasing amount of time under the line when it was operating as the
22 growing season progressed (Rogers and Hinds 1983).

23
24 In the Indiana study (Amstutz and Miller 1980), performance of livestock frequently under
25 a 765-kV line on 11 farms was studied during a 2-year period (1977–1979; 9 farms participated
26 for the full 2 years). Animals included 10 horses, 55 sheep, 149 beef cattle, 337 hogs,
27 and 429 dairy cattle. Maximum field voltage levels recorded near ground level were about
28 9.1 kV/m. General health, behavior, and performance of the animals were not affected by the
29 transmission line EMF.

30
31 In the Swedish study of cow fertility, 58 heifers were exposed to a 400-kV, 50-Hz transmission
32 line from June to mid-October 1985 (Algers and Hultgren 1987). The length of exposure was
33 15 to 20 times longer than the average exposure per year for Swedish dairy herds exposed
34 to 400-kV lines. No effects were observed on the frequency of malformations, the length or
35 variation of the estrous cycle, the midcycle plasma progesterone level, the intensity of estrus,
36 the number of inseminations per pregnancy, the overall conception rate, or the fetal viability.
37 Previous studies of cattle showed no significant effects of EMF on reproduction.

38
39 *Conclusion* – No significant impacts of EMF on terrestrial biota have been identified. Although
40 foliage very close to lines can be damaged, the overall productivity and reproduction of native
41 and agricultural plants appear unaffected. Also, no evidence suggests significant impacts on

Environmental Consequences and Mitigating Actions

1 individual animals or wildlife populations that are chronically exposed to EMF under
2 transmission lines or in the towers. Livestock behavior and production also appear unaffected
3 by line operation. Therefore, the potential impact of EMF on terrestrial biota is expected to be of
4 small significance for all plants. The only potential mitigation would be to exclude plants and
5 animals from the right of way, a measure with very severe impacts of its own. However,
6 because the impact is of small significance and because mitigation measures could create
7 additional environmental impacts and would be costly, no mitigation measures beyond those
8 implemented during the current term license would be warranted. This is a Category 1 issue.
9

10 **4.6.1.2 Aquatic Ecology**

11
12 Continued operations of the nuclear power plants during the 20-year license renewal term
13 includes the operation of the cooling system (once-through, cooling ponds, or cooling towers),
14 transmission line ROW maintenance, releases of gaseous and liquid effluents, facility
15 maintenance, and refurbishment-related construction activities. Aquatic organisms would
16 continue to be subject to impingement, entrainment, thermal discharges, chemical and
17 radiological contaminants, and erosion and sedimentation. This section considers eleven
18 issues concerning impacts of the proposed action on aquatic resources:
19

- 20 • Impingement and entrainment of aquatic organisms at plants with once-through cooling
21 or cooling ponds (combination of three issues from the 1996 GEIS: (1) impingement of
22 fish and shellfish, (2) entrainment of fish and shellfish in early life stages,
23 and (3) entrainment of phytoplankton and zooplankton);
24
- 25 • Impingement and entrainment of aquatic organisms at plants with cooling towers
26 (combination of three issues from the 1996 GEIS: (1) impingement of fish and
27 shellfish, (2) entrainment of fish and shellfish in early life stages, and (3) entrainment of
28 phytoplankton and zooplankton);
29
- 30 • Thermal impacts on aquatic organisms of plants with once-through cooling or cooling
31 ponds (combination of five issues from the 1996 GEIS: (1) heat shock, (2) cold
32 shock, (3) thermal plume barrier to migrating fish, (4) distribution of aquatic organisms,
33 and (5) premature emergence of aquatic insects);
34
- 35 • Thermal impacts on aquatic organisms of plants with cooling towers (combination of five
36 issues from the 1996 GEIS: (1) heat shock, (2) cold shock, (3) thermal plume barrier to
37 migrating fish, (4) distribution of aquatic organisms, and (5) premature emergence of
38 aquatic insects);
39

Environmental Consequences and Mitigating Actions

- 1 • Effects of cooling water discharges on dissolved oxygen and gas supersaturation
2 (combination of three issues from the 1996 GEIS: (1) gas supersaturation,
3 (2) low dissolved oxygen in the discharge, (3) and eutrophication);
4
- 5 • Effects of non-radiological contaminants on aquatic organisms (issue modified from the
6 1996 GEIS – accumulation of contaminants in sediments or biota – to include
7 contaminant effects other than just accumulation);
8
- 9 • Impact of radionuclides on aquatic organisms (new issue not considered in the 1996
10 GEIS);
11
- 12 • Impact of dredging on aquatic organisms (new issue not considered in the 1996 GEIS);
13
- 14 • Water use conflicts with aquatic resources (plants with cooling ponds or cooling tower
15 using makeup water from a river with low flow);
16
- 17 • Refurbishment impacts on aquatic resources (issue in the 1996 GEIS);
18
- 19 • Impacts of transmission line ROW management on aquatic resources (new issue not
20 considered in the 1996 GEIS);
21
- 22 • Losses from parasitism, predation, and disease among organisms exposed to sublethal
23 stresses (issue in the 1996 GEIS); and
24
- 25 • Stimulation of nuisance organisms (e.g., shipworms) (issue in the 1996 GEIS).
26

Environmental Consequences and Mitigating Actions

Impingement and Entrainment of Aquatic Organisms

Impingement occurs when organisms are held against the intake screen or netting placed within intake canals. Most impingement involves fish and shellfish. Table 4.6.1.2-1 lists some of the fish species commonly impinged at power plants. At some nuclear power plants, other vertebrate species may also be impinged on the traveling screens or on intake netting placed within intake canals. These include five species of sea turtle: loggerhead (*Caretta caretta*), green (*Chelonia mydas*), Kemp's ridley (*Lepidochelys kempi*), leatherback (*Dermochelys coriacea*), and hawksbill (*Eretmochelys imbricata*).

Impingement of these sea turtles has occurred at the Diablo Canyon and San Onofre plants on the California coast and at the Salem, Oyster Creek, Brunswick, St. Lucie, and Crystal River plants on the Atlantic coast (Gunter et al. 2001). Waterfowl have also been impinged at several plants; examples are double-crested cormorants (*Phalacrocorax auritus*) at Point Beach plant in Wisconsin (NRC 2005b), lesser scaup (*Aythya affinis*) at Cook in Michigan (Mitchell and Carlson 1993), and lesser scaup and greater scaup (*A. marila*) at Nine Mile Point in New York (NRC 2006d). Isolated incidents of impingement or other impacts from power plants have been reported for other vertebrates, such as the American crocodile (*Crocodylus acutus*) at Turkey Point in Florida and the West Indian manatee (*Trichechus manatus*) at Turkey Point and St. Lucie in Florida (Gunter et al. 2001). Small numbers of harbor (*Phoca vitulina*), gray (*Halichoerus grypus*), harp (*Pagophilus groenlandicus*), and hooded (*Cystophora cristata*) seals have been impinged at Seabrook in New Hampshire (NMFS 2002). Impingement impacts are expected to continue during the license renewal term. The impacts of impingement are different for once-through and closed-cycle cooling systems and are therefore discussed separately below.

Entrainment occurs when planktonic organisms pass through the intake screens and travel through the condenser cooling system. Aquatic organisms that can be entrained include ichthyoplankton (fish eggs and larvae), larval stages of shellfish and other macroinvertebrates, zooplankton, and phytoplankton. Table 4.6.1.2-1 lists fish species commonly entrained at power plants. In addition to the entrainment of fish and shellfish in early life stages, the entrainment of a phytoplankton and zooplankton was evaluated in the 1996 GEIS, and entrainment was categorized as a Category 1 issue for all cooling systems. This issue has been combined with the issue of entrainment of fish and shellfish in early life stages in this

Impingement

Impingement is the entrapment of all life stages of fish and shellfish on the outer part of an intake structure or against a screening device during periods of water withdrawal (40 CFR § 125.83).

Entrainment

Entrainment is incorporation of all life stages of fish and shellfish with intake water flow entering and passing through a cooling-water intake structure and into a cooling water system (40 CFR § 125.83).

Environmental Consequences and Mitigating Actions

1 GEIS revision. Entrainment impacts are expected to continue during the license renewal term.
 2 The impingement and entrainment are different for once-through and closed-cycle cooling
 3 systems and are therefore discussed separately below.
 4
 5

Table 4.6.1.2–1. Fish Species Commonly Impinged or Entrained at Power Plants

Ecosystem Type	Fish Species
Rivers	Alewife (<i>Alosa pseudoharengus</i>) Gizzard shad (<i>Dorosoma cepedianum</i>) Common carp (<i>Cyprinus carpio</i>) White bass (<i>Morone chrysops</i>) Sunfish (<i>Lepomis</i> spp.) Crappie (<i>Pomoxis</i> spp.) Yellow perch (<i>Perca flavescens</i>) Freshwater drum (<i>Aplodinotus grunniens</i>)
Great Lakes	Alewife (<i>Alosa pseudoharengus</i>) Gizzard shad (<i>Dorosoma cepedianum</i>) Yellow perch (<i>Perca flavescens</i>) Rainbow smelt (<i>Osmerus mordax</i>)
Estuaries	Bay anchovy (<i>Anchoa mitchilli</i>) Tautog (<i>Tautoga onitis</i>) Atlantic menhaden (<i>Brevoortia tyrannus</i>) Gulf menhaden (<i>Brevoortia patronus</i>) Winter flounder (<i>Pleuronectes americanus</i>) Weakfish (<i>Cynoscion regalis</i>)
Oceans	Bay anchovy (<i>Anchoa mitchilli</i>) Striped anchovy (<i>Anchoa hepsetus</i>) Silver perch (<i>Bairdiella chrysura</i>) Cunner (<i>Tautoglabrus adspersus</i>) Scaled sardine (<i>Harengula jaquana</i>) Queenfish (<i>Seriphus politus</i>)

6

Environmental Consequences and Mitigating Actions

1 *Impingement and Entrainment of Aquatic Organisms at Plants with Once-Through Cooling and* 2 *Cooling Ponds*

3

4 In the 1996 GEIS, the NRC considered that for plants with a once-through cooling systems or
5 cooling ponds, the impacts of impingement and entrainment of aquatic organisms were small at
6 many plants but moderate to large at a few nuclear plants. Therefore, impingement and
7 entrainment were considered Category 2 issues. For plants that operate in a hybrid mode,
8 impingement and entrainment would be small at most nuclear plants, but could be moderate or
9 large at a few plants, and were also considered Category 2 issues.

10

11 Impingement is more of a concern at nuclear plants that have once-through cooling because
12 these plants require a larger amount of water than plants that operate under
13 closed-cycle (NRC 1996). Impingement monitoring at the Palisades nuclear power plant in
14 Michigan demonstrated this difference. In 1972, when the plant used once-through cooling,
15 654,000 fish were impinged yearly at a water withdrawal rate of 400,000 gpm. In 1976,
16 cooling towers were added to the plant, and it began operating as a closed-cycle plant.
17 Intake withdrawal rate was reduced to 78,000 gpm, and impingement dropped to 7200 fish
18 per year (Consumers Energy Company and Nuclear Management Company 2001).
19 McLean et al. (2002) reported that the magnitude of impingement at Maryland power plants with
20 similar intake designs within Chesapeake Bay differed greatly according to the location of the
21 intake.

22

23 Impingement at the Quad Cities plant in Illinois is often an order of magnitude higher from
24 February through April than during summer and fall, even though the cooling water intake flow is
25 only half that of the rest of the year (Bodensteiner and Lewis 1992). Impingement at Quad
26 Cities was primarily composed of young-of-year and juveniles; in the case of gizzard shad
27 (*Dorosoma cepedianum*) and freshwater drum (*Aplodinotus grunniens*), fish of these ages
28 cannot tolerate near-freezing to freezing temperatures during winter and early spring. Other
29 species, such as the bluegill (*Lepomis macrochirus*), channel catfish (*Ictalurus punctatus*), and
30 white bass (*Morone chrysops*), are also prominent in winter impingement collections
31 (Bodensteiner and Lewis 1992, 1994; LaJeone and Monzingo 2000). Although the number of
32 fish impinged at Quad Cities was relatively high (e.g., nearly 3 million in 1989), most (up
33 to 90 percent) of the fishes that entered the intake forebay were dead or moribund. Therefore,
34 even if these fish were not impinged, they would have still been lost from the fishery (LaJeone
35 and Monzingo 2000). Similar results have been noted for impingement of threadfin shad
36 (*D. petenense*) at the McGuire plant in North Carolina (NRC 2002c) and gizzard shad at the
37 Summer plant in South Carolina (NRC 2004b).

38

39 For the Pilgrim plant in Massachusetts, the NRC concluded that impingement during continued
40 operation of the plant would have a moderate impact on the Jones River population of the
41 rainbow smelt (*Osmerus mordax*) on the basis of an observed decline of that population,

1 uncertainty about the stock's status, impingement rates, and low impingement survivability.
2 Impingement had a small to moderate impact on all other species (NRC 2007c).

3
4 For the Wolf Creek plant in Kansas, the NRC concluded that impingement during continued
5 operation of the plant could have small to moderate impacts at the makeup water screen house
6 during periods when river water levels were low, because fish would have less available habitat
7 to use as a refuge and would likely be exposed to greater pumping frequency and volume
8 removals from the Neosho River (NRC 2008a). During most of the license renewal term, the
9 impacts of impingement would be small (NRC 2007d).

10
11 Various methods that have been used to reduce impingement include returning impinged fish to
12 the water source, bypassing fish at the intake screens, and preventing the approach of fish to
13 the intake area (Lieberman and Muessio 1978). Various deflection methods that have been
14 used at power plants to reduce impingement include physical barriers, visual stimuli (e.g., air-
15 bubble screens and static or strobe lights), water velocity and pressure changes, electrical
16 shocks, and sound (Maes et al. 2004). Stocking, restoring habitat, and installing cooling towers
17 are also mitigation options.

18
19 At the Doel nuclear power plant on the Scheldt Estuary in Belgium, an acoustic deterrent
20 system decreased total impingement of estuarine fishes by about 60 percent. Avoidance
21 response varied among species from no effect to highly efficient (Maes et al. 2004). As
22 observed at most plants that have used sound deterrent, decreases in impingement at the Doel
23 plant were most noticeable for clupeids, with a 94.7 percent decrease for the Atlantic herring
24 (*Clupea harengus*) and 87.9 percent decrease for the European sprat (*Sprattus sprattus*)
25 (Maes et al. 2004).

26
27 At the Fitzpatrick plant in New York, the sound deterrent system reduced the density of fishes
28 near the intake by as much as 96 percent (Ross et al. 1993). Alewife (*Alosa pseudoharengus*)
29 impingement was reduced by 81 to 84 percent during a year following an unusually cold winter
30 and was predicted to reduce alewife impingement by 87 percent during most years
31 (Ross et al. 1996). Similar decreases in alewife impingement have been observed at the D.C.
32 Cook plant in Michigan (NRC 2005a) and Point Beach plant in Wisconsin (NRC 2005b). During
33 or following unusually cold winters, alewife populations can experience high mortalities, so a
34 proportion of the impinged alewives would undoubtedly consist of dead or moribund
35 individuals. Also, a decline in an alewife's condition (e.g., after spawning) may result in a
36 weaker response to sound systems, thus increasing its potential to be impinged
37 (Ross et al. 1993; Dunning et al. 1992).

38
39 At the Surry plant in Virginia, about 94 percent of all fish impinged were returned alive to the
40 river through the fish return system. Only five species had less than 80 percent survival. These
41 were the spot (*Leiostomus xanthurus*), Atlantic menhaden (*Brevortia tyrannus*), blueback

Environmental Consequences and Mitigating Actions

1 herring (*A. aestivalis*), threadfin shad, and bay anchovy (*Anchoa mitchilli*) (NRC 2002d). These
2 species generally are susceptible to physical injuries while impinged (e.g., because of their
3 delicate scales). A mitigation program at St. Lucie involves Florida Power and Light Company
4 periodically trapping fish from the intake canal, tagging them, and releasing them in the ocean.
5 The goal is to tag and release 1000 fish per year (NRC 2003a). At the Calvert Cliffs plant in
6 Maryland, about 5.25 million blue crabs (*Callinectes sapidus*) were impinged between 1975
7 and 1982, but impingement survival was 99 percent (NRC 1999b).

8
9 Physical stresses present during impingement are affected by screen wash frequency, screen
10 rotation speed, and screen modifications intended to reduce stress associated with fish
11 separation and handling. When screens are infrequently washed, impinged organisms may
12 become moribund from repeated attempts to free themselves and may suffocate against the
13 screen (Jinks 2005). Generally, species with heavier skeletal structures, thick scales or bony
14 scutes, thick protective slimes, or hard exoskeletons are most likely to resist physical injury and
15 desiccation during impingement (Jinks 2005).

16
17 Although fish return systems can decrease impingement mortality, some stressed and injured
18 fish returned to the water body may take a number of days to die. Even those with minor
19 damage may develop a bacterial or fungal infection that eventually leads to mortality. Also,
20 returned fish may be exhausted, disoriented, and damaged, which makes them more
21 susceptible to predation (Henderson et al. 2003). Replacing conventional intake screens with
22 Ristroph screens is unlikely to result in a significant reduction in impingement mortality at
23 localities where clupeid and sciaenid species predominate (Henderson et al. 2003).

24
25 While planktonic organisms are generally not uniformly distributed throughout a water body, it is
26 often assumed that withdrawal of a certain percentage of the source water would result in
27 entrainment of that percentage of the planktonic organisms that pass by a plant (EPA 2002). At
28 Browns Ferry in Alabama, the portion of the river flow that passed through the plant was found
29 to be higher than the percentage of larval fishes in the river that were entrained (NRC 2005c).
30 Fish species with free-floating early life stages are those most susceptible to entrainment
31 (EPA 2002). For power plants (nuclear and fossil) located in the Great Lakes, the number of
32 fish entrained increased with increasing power capacity (Kelso and Milburn 1979).

33
34 Entrained organisms are exposed to heat, mechanical, pressure, and chemical stresses
35 (NRC 1996). Entrained organisms are basically exposed to a rapid temperature rise that is
36 essentially equivalent to the temperature rise across the condensers during their passage
37 through the plant (Schubel et al. 1977). It has been conservatively concluded that mortality of
38 planktonic organisms is assumed to be 100 percent. For ichthyoplankton, this assumption is
39 based on the extreme delicacy of eggs and the fact that their skeleton, musculature, and
40 integument are soft, thereby providing only a minimal amount of protection for vital organs
41 (EPA 2002). Nevertheless, these killed organisms provide food for consumers and

1 decomposers in the receiving water body (Fox and Moyer 1973). Conversely, bacteria and
2 other microorganisms that are entrained may increase in number as a result of prolonged
3 exposure to increased heat (Fox and Moyer 1973; see Section 3.9.3). At the Quad Cities plant
4 in Illinois, LaJeune and Monzingo (2000) concluded that as long as discharge temperatures do
5 not exceed 37.8°C (100°F), some entrainment survival would occur.
6

7 Fish eggs and larvae have a high natural mortality rate; thus, the number of entrained
8 ichthyoplankton that would have survived to become adult fish is much lower than the number
9 of eggs and larvae entrained (EPA 2002). In a laboratory study on the exposure of larval
10 common shrimp (*Crangon crangon*) and lobster (*Homarus gammarus*) and adult copepods
11 (*Acartia tonsa*) to simulated entrainment stresses (i.e., thermal, mechanical, chlorine, and
12 pressure effects, both alone and in combination), it was concluded that most individuals of each
13 species would survive passage through a nuclear power station under normal operating
14 conditions. Since the experiments on these crustaceans demonstrated that each species has
15 different responses to different stressors, the only generalization that could be made is that
16 mortality from the totality of entrainment passage would be 10 to 20 percent (Bamber and
17 Seaby 2004). About 70 percent of the copepod entrained at the Millstone plant in Connecticut
18 suffered mortality, but this loss only represented 0.1 to 0.3 percent of the copepod production of
19 eastern Long Island Sound (Carpenter et al. 1974). At the Calvert Cliffs plant in Maryland,
20 entrainment survival for the five most abundant zooplankton species was 65 to 100 percent
21 (NRC 1999b).
22

23 Except for one sample (when discharge temperatures at the D.C. Cook plant in Michigan
24 exceeded 35°C [95°F] and resulted in a 14 to 22 percent mortality difference in zooplankton),
25 there was no relationship between zooplankton mortality and discharge water temperatures,
26 suggesting that mechanical stress was the major cause of zooplankton entrainment mortality.
27 During the period of the study, chlorination was infrequent because entrained sand provided
28 sufficient scouring action to negate the need for biocides. The sand may have added to the
29 mechanical stress experienced by entrained zooplankton. Zooplankton mortality was
30 significantly greater in the discharge waters than the intake waters, but differences averaged
31 less than 3 percent. Such small losses due to entrainment cannot be detected in the lake. It
32 was concluded that fish predation rather than entrainment was the major source of zooplankton
33 mortality in inshore waters during most of the year (Evans et al. 1986).
34

35 Mitigation has been used to minimize entrainment losses. This includes several measures that
36 also minimize impingement impacts (e.g., using closed-cycle cooling and designing intakes to
37 minimize velocities through the intake screens). At the McGuire plant in North Carolina,
38 about 45 percent of the cooling water is obtained from the low-level intake, which pulls water
39 from the hypolimnion at a depth of about 30 m (100 ft), where few planktonic organisms occur.
40 Therefore, entrainment is minimized (NRC 2002c). Skimmer walls inside the intake bays at the
41 Robinson plant in South Carolina similarly reduce entrainment (NRC 2003b). At the Millstone

Environmental Consequences and Mitigating Actions

1 plant, potential mitigation measures that were identified included reducing intake flows during
2 the winter flounder (*Pleuronectes americanus*) spawning season; conducting regular
3 inspections, maintenance, or refueling during the spawning season; importing fish into the
4 areas; installing fine mesh screens on the intakes; or installing cooling towers (NRC 2005c).^(a)
5

6 On July 9, 2004, the EPA published a final rule in the *Federal Register* (EPA 2004b) that
7 addressed cooling water intake structures at existing power plants, including nuclear plants,
8 where flow levels exceed a minimum threshold value of 50 million gallons per day (gpd). The
9 rule was Phase II in the EPA's development of CWA 316(b) regulations that established
10 national requirements applicable to the location, design, construction, and capacity of cooling
11 water intake structures at existing facilities that exceed the threshold value for water
12 withdrawals. Section 316(b) of the CWA requires that the location, design, construction, and
13 capacity of the cooling water intake structures reflect the best technology available for
14 minimizing adverse environmental impacts. On July 9, 2007, the EPA (2007a) published a
15 suspension of regulations establishing requirements for cooling water intake structures at
16 Phase II existing facilities. As a result, all permits for Phase II facilities should include
17 conditions under Section 316(b) of the CWA that are developed on a best professional
18 judgment basis. Best professional judgment is used by NPDES permit writers to develop
19 technology-based permit conditions on a case-by-case basis by using all reasonably available
20 and relevant data. Any site-specific mitigation required under the NPDES permitting process
21 would result in a reduction in the impacts of continued plant operations.
22

23 In the 1996 GEIS, the NRC considered the impacts of license renewal on impingement and
24 entrainment of aquatic organisms to be small, moderate, or large at plants with once-through
25 cooling or cooling ponds (i.e., a Category 2 issue). No new information has been identified in
26 the plant-specific SEISs prepared to date or in the literature that would alter those conclusions.
27

28 On the basis of these considerations, the NRC concludes that the impingement and
29 entrainment of aquatic organisms over the license renewal term at nuclear plants with once-
30 through cooling or cooling ponds could be small, moderate, or large and is considered a
31 Category 2 issue. The magnitude of the impact would depend on plant-specific characteristics
32 of the cooling system (including location, intake velocities, screening technologies, and
33 withdrawal rates) and characteristics of the aquatic resource (including population distribution,
34 status, management objectives, and life history).

^(a) It should be noted that the NRC cannot impose mitigation requirements on licensees. The Atomic Safety and Licensing Appeal Board, in the "Yellow Creek" case, determined that the EPA has sole jurisdiction over the regulation of water quality with respect to the withdrawal and discharge of waters for nuclear power stations, and it also determined that the NRC is prohibited from placing any restrictions or requirements on the licensees of those facilities with regard to water quality (Tennessee Valley Authority [Yellow Creek Nuclear Plant, Units 1 and 2], ALAB-515, 8 NRC 702, 712-13 [1978]).

1
2 *Impingement and Entrainment of Aquatic Organisms at Plants with Cooling Towers*
3

4 Removal of any substantial volume of water from a natural body of water by a cooling system
5 will likely also remove or kill some of the aquatic organisms that live there through impingement
6 or entrainment. However, the number of individuals that could be removed from a population
7 before detectable negative effects would occur is often not known. The potential for
8 impingement and entrainment of aquatic organisms is influenced by a variety of factors such
9 as:

- 10
- 11 • Amount of water withdrawn relative to the size of the cooling water source,
 - 12
 - 13 • Location and configuration of intake structures,
 - 14
 - 15 • Type of water body from which water is withdrawn and the conditions within that water
16 body,
 - 17
 - 18 • Proximity of withdrawal structures to sensitive biological habitats (e.g., spawning and
19 nursery habitats),
 - 20
 - 21 • Sensitivity of populations of impinged and entrained organisms to potential losses of
22 individuals, and
 - 23
 - 24 • Mitigation measures in place to reduce impingement and entrainment.
25

26 Of these factors, the volume of water withdrawn relative to the size of the water source appears
27 to be the best predictor of the number of organisms that would be impinged or entrained within a
28 given aquatic system (Henderson and Seaby 2000). Because the volume of water withdrawn
29 by a power plant is minimized when a closed-cycle cooling system is employed, the impacts to
30 aquatic organisms from impingement and entrainment would be smaller than the impacts from
31 impingement and entrainment that would occur if a once-through cooling system was employed
32 instead.
33

34 In the 1996 GEIS, the NRC determined that impingement and entrainment of fish and shellfish
35 was a Category 1 issue for plants with cooling towers, because the level of impingement and
36 entrainment of fish and shellfish with this type of cooling system was not found to be a problem
37 at operating plants, and was not expected to be a problem during the license renewal term
38 (NRC 1996). This finding was also based on the lower rates of water withdrawal required for
39 plants with cooling towers when operating in a closed-cycle mode. Withdrawal rates would not
40 be reduced in situations where cooling towers are used in a helper mode to cool discharge

Environmental Consequences and Mitigating Actions

1 temperatures under once-through operating conditions. These types of systems are included
2 under the evaluation of once-through systems above.

3
4 In considering the impingement and entrainment effects of closed-cycle cooling systems on
5 aquatic ecology, the NRC evaluated the same issues that were evaluated for plants with once-
6 through cooling systems or cooling ponds. On the basis of reviews of the literature and license
7 renewal SEISs published to date, reduced populations of aquatic biota attributable to
8 occurrences of impingement and entrainment have not been reported for any existing nuclear
9 power plants with cooling towers operated in closed-cycle mode.

10
11 On the basis of these considerations, the NRC concludes that the impingement and
12 entrainment of aquatic organisms at plants with cooling towers operating as a closed-cycle
13 cooling system over the license renewal term would be small and remains a Category 1 issue.

14 Effects of Thermal Discharges on Aquatic Organisms

15
16
17 During the license renewal term, aquatic resources would continue to be affected by thermal
18 discharges from the cooling system. The potential impacts of thermal discharges are different
19 for once-through and closed-cycle cooling systems and are therefore discussed separately
20 below.

21 *Thermal Impacts on Aquatic Organisms (Plants with Once-Through Cooling and Cooling Ponds)*

22
23
24 In the 1996 GEIS, the NRC determined that for plants with a once-through cooling system or
25 cooling ponds, the effects of thermal discharge on aquatic biota (primarily due to heat shock)
26 was small at many plants. However, because the effects were considered moderate or large at
27 a few nuclear plants, heat shock was considered a Category 2 issue that required a site-specific
28 assessment before license renewal. The potential for thermal discharge effect is considered to
29 be greatest at plants with once-through cooling systems (NRC 1996), primarily because of the
30 higher discharge temperatures and larger thermal plume area.

31
32 The potential impacts of thermal discharges during the 20-year license renewal term were
33 evaluated by reviewing published site ERs, license renewal SEISs, and the scientific literature.
34 For all of these plants, it was determined that the impacts of thermal discharges during the
35 license renewal term were small. However, according to York et al. (2005), thermal discharges
36 from the Diablo Canyon and San Onofre plants (located along the California coast) have had
37 significant impacts on aquatic habitats. (Both of these plants employ once-through cooling
38 systems and have not yet been reviewed for license renewal.) Thus, thermal discharges could
39 be a concern during the license renewal term for plants with once-through cooling systems,
40 especially for plants located in areas where restoration efforts are underway to increase fish

Environmental Consequences and Mitigating Actions

1 populations or reestablish migratory fish species or where thermal discharge plumes could
2 encompass otherwise high-quality habitats.

3
4 In general, adverse thermal environmental effects have been minimized at many power plants
5 through design features, such as locating the discharge structures in areas where warmer
6 water would be rapidly diluted (Beitinger et al. 2000). The potential for thermal discharge
7 impacts is greatest in shallow, enclosed, and/or poorly mixed water bodies (Hall et al. 1978).

8
9 Heat shock occurs when the water temperature meets or exceeds the thermal tolerance of a
10 species. The duration of exposure to elevated temperatures is a major factor contributing to
11 heat shock (NRC 2007e). In most situations, fish are capable of moving out of an area as their
12 thermal tolerance limits are approached. However, occasional heat shock events have been
13 reported at some nuclear power plants. At the Pilgrim plant in Massachusetts, only two fish
14 mortality incidents that could be attributed to heat shock have occurred. In 1975, about
15 3000 Atlantic menhaden were killed, and in 1978, about 2300 clupeids (schooling fish such as
16 menhaden sardines, and shad) were killed (NRC 2007e). At the McGuire plant in North
17 Carolina, five dead striped bass (*Morone saxatilis*) were found in and near the discharge; their
18 deaths may or may not have been related to heat shock (NRC 2002c). About 300 dead fish,
19 mostly striped bass, were killed when cooling lake temperatures near the La Salle County
20 Station in Illinois exceeded 35°C (95°F). A similar heat shock event happened at the
21 Braidwood Nuclear Station's cooling lake when about 1000 fish, mostly gizzard shad, died
22 (NRC 2005f).

23
24 Cold shock can occur when organisms acclimated to the elevated temperatures of a thermal
25 plume are abruptly exposed to temperature decreases when the artificial source of heating
26 stops. Such events are most likely to occur during winter. Cold shock events have only rarely
27 occurred at nuclear plants (e.g., Haddam Neck [no longer operating], Prairie Island, Monticello,
28 and Oyster Creek). Fish mortalities usually involved only a few fish and did not result in
29 population-level effects (NRC 1996). Gradual shutdown of plant operations generally precludes
30 cold shock events.

31
32 The potential exists for thermal plumes to create a barrier to migrating fishes if the mixing zone
33 covers an extensive cross-sectional area of a river and exceeds the fish avoidance temperature
34 (NRC 1996). For example, concerns were expressed that thermal discharge from the Vermont
35 Yankee plant could effect both spawning and outmigration of American shad (*Alosa*
36 *sapidissima*) and Atlantic salmon (*Salmo salar*) and potentially cause a reduction in Atlantic
37 salmon smoltification, particularly since a hydroelectric facility was located immediately
38 downstream of the plant and because the fish passage facility and thermal discharge were
39 located on the same side of the river (NRC 2007a). In the 316(b) demonstration to support
40 increased discharge temperature limits at the Vermont Yankee plant, it was determined that the
41 smolts would not be delayed because the thermal plume covered only a small cross section of

Environmental Consequences and Mitigating Actions

1 the Connecticut River. To date, significant impacts on migratory fishes have not been reported
2 for nuclear power plants.

3
4 Heated effluents could accelerate the development of immature stages of aquatic insects in
5 freshwater systems, resulting in premature emergence. If adults emerge before the normal
6 seasonal cycle, they may be unable to feed or reproduce. Premature emergence has been
7 observed in laboratory investigations (e.g., Nebeker 1971) but not in field investigations
8 (e.g., Langford 1975). Heated effluents could also stimulate population growth of
9 macroinvertebrates. Thermal discharges from the Oconee plant in South Carolina stimulated
10 the population growth of oligochaetes (aquatic worms) in the immediate vicinity of the power
11 plant (less than 5 percent of the total cooling reservoir surface). However, the local changes in
12 oligochaete populations could not be linked to the direct increases in water temperatures, but
13 they may have been directly or indirectly affected by increases in zooplankton, vegetation, and
14 current velocities in the area of the discharge (Nichols 1981).

15
16 Sublethal effects from thermal discharges (e.g., stunning or disorientation of fishes) could alter
17 predator-prey interactions by increasing the susceptibility of affected individuals to predation.
18 Schubel et al. (1977) concluded that the exposure of fish larvae (e.g., blueback herring,
19 American shad, striped bass) to an excess of 15°C (59°F) in temperature would significantly
20 increase their vulnerability to predation. However, population- or community-level effects from
21 power plant influences on predator-prey relationships have not been demonstrated in the field
22 (NRC 1996). Malnutrition is also a chronic effect that fish can experience when overwintering
23 within thermal plumes (Hall et al. 1978). Thermal discharges have also been hypothesized to
24 increase the susceptibility of fishes to diseases and parasites as a result of a combination of the
25 increased density of fish within the thermal plume (potentially leading to increased exposure to
26 infectious diseases or other stresses), the fish being more prone to infection in warmer water,
27 and the ability of diseases and parasites to develop faster at higher temperatures. Other
28 potential temperature-related impacts on aquatic resources could include the loss of smolt
29 characteristics in salmon (McCormick et al. 1999) or premature spawning (Hall et al. 1978).
30 These sublethal effects would be related to a multitude of cumulative activities that can occur
31 with an aquatic ecosystem and cannot be attributed to a single stressor.

32
33 Thermal discharges can allow nuisance species, such as the Asiatic clam (*Corbicula fluminea*)
34 and zebra mussel (*Dreissena polymorpha*), to become established or proliferate (NRC 1996).
35 The heated discharges from the Oyster Creek plant in New Jersey increased the distribution
36 and abundance of a nonnative, tropical-subtropical, wood-boring shipworm species (*Teredo*
37 *bartschi*). However, this species has not been observed in Oyster Creek or Barnegat Bay since
38 1982, possibly because of a combination of low winter temperatures that occurred in Oyster
39 Creek during a station outage, the pathological effects of a parasite, the removal of a
40 substantial amount of driftwood, and the replacement of untreated structural wood (NRC 1996).
41 At the North Anna plant in Virginia, the higher water discharges related to plant operation were

Environmental Consequences and Mitigating Actions

1 found to increase the growing season of the water hyacinth (*Hydrilla verticillata*). Nuisance
2 levels of this plant resulted. The water hyacinth was brought under control by stocking triploid
3 (sterile) herbivorous grass carp (*Ctenopharyngodon idella*) (NRC 2002e).

4
5 Mitigative measures that have been employed to reduce thermal discharge effects include
6 lowering the effluent temperatures before discharges reach the receiving water body (e.g., the
7 cooling pond at the Dresden plant in Illinois or the cooling canal system at the Turkey Point
8 plant in Florida) or enhancing rapid mixing and heat dissipation (e.g., high-velocity jet diffusers
9 at Fitzpatrick in New York) (NRC 1996). At the Surry plant in Virginia, the thermal discharge
10 was located about 6 mi (9.7 km) upstream of the intake structure to protect downstream oyster
11 beds from potential thermal discharge impacts (NRC 2002d). Fish kills that occurred in the
12 1980s within the discharge canal at the Summer plant in South Carolina were eliminated by
13 removing a hump in the discharge canal, limiting reservoir drawdowns, and dredging the
14 discharge canal (NRC 2004b).

15
16 In the 1996 GEIS, the NRC considered the impacts of heat shock on aquatic biota during the
17 license renewal term to be small, moderate, or large at plants with once-through cooling or
18 cooling ponds (i.e., a Category 2 issue), and it considered the impacts of cold shock,
19 interference with fish migration, distribution of aquatic organisms, and premature emergence of
20 aquatic insects to be small for all plants (i.e., Category 1). No new information that would alter
21 those conclusions was identified in the plant-specific SEISs prepared to date or in the literature.

22
23 On the basis of these considerations, the NRC concludes that the impact of thermal discharges
24 on aquatic organisms at nuclear plants with once-through cooling systems or cooling ponds
25 over the license renewal term could be small, moderate, or large, and is considered a Category
26 2 issue. The magnitude of the impact would depend on plant-specific characteristics of the
27 cooling system (including location and type of discharge structure, discharge velocities and
28 volume, and three-dimensional characteristics of the thermal plume) and characteristics of the
29 aquatic resource (including the species present and their physiology, habitat, population
30 distribution, status, management objectives, and life history).

31

Environmental Consequences and Mitigating Actions

1 *Thermal Impacts on Aquatic Organisms (Plants with Cooling Towers)*

2

3 In the 1996 GEIS, the NRC determined that for plants with cooling towers, the effects of
4 thermal discharges (including heat shock, cold shock, interference with fish migration,
5 distribution of aquatic organisms, and premature emergence of aquatic insects) on aquatic
6 biota were Category 1 issues because thermal effects associated with this type of cooling
7 system were not found to be a problem at operating plants and are not expected to be a
8 problem during the license renewal term (NRC 1996). This finding was based, in part, on the
9 presence of smaller thermal plumes at plants with closed-cycle cooling towers than would occur
10 if a once-through cooling system was used at those plants.

11

12 In considering the thermal discharge effects of closed-cycle cooling systems on aquatic
13 resources, the NRC evaluated the same issues that were evaluated for the once-through
14 systems discussed above. On the basis of reviews of the literature and license renewal SEISs
15 published to date, it was determined that these potential effects would not significantly reduce
16 the population of aquatic organisms near any existing nuclear power plants.

17

18 In the 1996 GEIS, the NRC considered the impacts of thermal discharges on aquatic organisms
19 during the license renewal term to be small at nuclear plants with cooling towers (i.e., a
20 Category 1 issue). No new information has been identified in the plant-specific SEISs prepared
21 to date or in the literature that would alter those conclusions. On the basis of these
22 considerations, the NRC concludes that the impact of thermal discharges on aquatic organisms
23 at nuclear plants with cooling towers over the license renewal term would be small and remains
24 a Category 1 issue.

25

26 *Effects of Cooling Water Discharge on Dissolved Oxygen, Gas Supersaturation, and* 27 *Eutrophication*

28

29 The potential effects on aquatic biota from low dissolved oxygen levels, gas supersaturation,
30 and eutrophication in the cooling water discharge of nuclear power plants were identified as
31 Category 1 issues in the 1996 GEIS. These three issues are combined and discussed together
32 here.

33

34 The availability of oxygen is a requirement for the metabolism of aerobic organisms. It also
35 influences inorganic chemical reactions. For aquatic organisms with gills, the concentration of
36 dissolved oxygen in the water is one of the most important parameters to consider for
37 evaluating water quality. In general, dissolved oxygen concentrations of less than 3 ppm in
38 warmwater habitats or less than 5 ppm in coldwater habitats can adversely affect fish
39 (Morrow and Fischenich 2000). Oxygen dissolves into water via diffusion from the surrounding
40 air, by aeration (i.e., mixing with atmospheric air due to turbulent movement of the water), and
41 as a product of photosynthesis. The level of dissolved oxygen in water is highly dependent on

1 temperature, and the amount of oxygen that can dissolve in a given volume of water (i.e., the
2 saturation point) is inversely proportional to the temperature of the water. Thus, when other
3 chemical and physical conditions are equal, the warmer the water is, the less dissolved oxygen
4 it can hold. An increase in water temperature also affects the amount of oxygen that aquatic
5 organisms need by increasing the chemical reaction rates and metabolic rates. The rates of
6 many chemical reactions in water approximately double for every 10°C (18°F) increase in
7 temperature. Thus, the addition of a heat load to an aquatic ecosystem via the discharge of
8 cooling water has the potential to stress aquatic biota by simultaneously increasing metabolic
9 rates and the need for oxygen and by reducing dissolved oxygen concentrations to suboptimal
10 levels.

11
12 The potential for effects on biota from a reduction in the dissolved oxygen concentration is
13 greater in ecosystems where dissolved oxygen levels are already approaching suboptimal
14 levels as a result of other factors that affect the environment. Thus, organisms in ecosystems
15 where (1) the biological demand for dissolved oxygen is elevated as a result of increased levels
16 of detritus or nutrients (e.g., eutrophication from runoff containing fertilizers or manure or from
17 the release of dead, entrained organisms in the discharge of once-through cooling systems)
18 or (2) low flow levels and high ambient temperatures already exist (e.g., as a result of drought
19 conditions or hot weather) may be more susceptible to negative effects if dissolved oxygen
20 levels are reduced further. For this reason, dissolved oxygen limits are regulated in many
21 NPDES permits to ensure that minimum levels will be maintained.

22
23 After cooling water is discharged, additional oxygen dissolves in the water as a result of
24 diffusion and the introduction of oxygen released by aquatic plants and algae is a by-product of
25 photosynthesis (during daylight hours only). The saturation point for the water increases as it
26 cools, and aeration due to turbulent movement can further increase the rate of oxygenation. For
27 these reasons, effects on aquatic biota due to low dissolved oxygen levels are not expected to
28 extend beyond the thermal mixing zone. Thus, even in cases where dissolved oxygen levels in
29 the immediate vicinity of the discharge structures of power plants may be too low to support
30 some aquatic biota, the amount of aquatic habitat affected is typically small relative to that
31 available in the receiving water body as a whole. Discharge systems are typically designed to
32 minimize the affected area by promoting mixing of introduced warmer water with ambient water
33 from the receiving system, by increasing turbulence near the discharge point, or by introducing
34 air into the water.

35
36 The impacts of low dissolved oxygen concentrations in the discharge are considered to be of
37 small significance if populations of aquatic organisms in the vicinity of the plant are not reduced.
38 On the basis of reviews of literature and operational monitoring reports, dissolved oxygen
39 concentrations have been adequate for maintaining aquatic ecosystems in the water bodies that
40 receive cooling water from currently operating nuclear power plants. Operational mitigation
41 measures (increasing the oxygenation of water released from an upstream dam) have been

Environmental Consequences and Mitigating Actions

1 effective at the one plant (Sequoyah plant in Tennessee) for which periodic low dissolved
2 oxygen levels in the receiving water (Chickamauga Reservoir) were identified as potentially
3 affecting downstream mussel beds and sauger (*Sander canadensis*) reproduction during the
4 initial license term.
5

6 In addition to the effects of cooling systems on dissolved oxygen described above, rapid heating
7 of water in the condenser cooling system also decreases the solubility and saturation point for
8 other dissolved gases. Thus, as the water passing through the cooling system is heated, the
9 water becomes supersaturated with gases. Although the levels of dissolved gases will
10 equilibrate to normal values as the water cools and mixes with ambient waters, tissues of
11 aquatic organisms that remain in the supersaturated effluent for extended periods can become
12 equilibrated to the increased partial pressures of gases within the effluent. If these organisms
13 are subsequently exposed to water with lower partial pressures (which occurs when the water
14 cools or when the organisms move to water in other locations or at other depths), dissolved gas
15 (especially nitrogen) within the tissues may come out of solution and form embolisms (bubbles)
16 within the affected tissues, most noticeably the eyes and fins. The resulting condition is known
17 as gas bubble disease. Swelling and hemorrhages in tissues can cause behavioral
18 abnormalities or death, depending on the number of bubbles that form and the tissues that are
19 affected (Noga 2000). Fish mortalities generally occur at gas supersaturation levels above
20 110 to 115 percent (EPA 1986). Aquatic insects and crustaceans appear to be more tolerant of
21 supersaturated water than fish (Nebeker et al. 1981).
22

23 The ability to detect and avoid supersaturated waters varies among species. A fish can avoid
24 supersaturated waters by either not entering the affected area or by diving to avoid the onset of
25 supersaturated conditions near the surface. Some species, however, may not avoid
26 supersaturated waters until symptoms of gas bubble disease occur; at that point, some fish
27 may already have been lethally exposed. Other species may be attracted to supersaturated
28 waters due to stimuli such as warmwater discharges (Gray et al. 1983).
29

30 Gas supersaturation and gas bubble disease have resulted in the death of fish in the discharge
31 of some steam-electric power plants, as has been reported in the past from the Pilgrim plant in
32 Massachusetts (NRC 1996, 2007c). Gas supersaturation and gas bubble disease are also
33 commonly associated with hydroelectric dams, typically resulting when water that is mixed with
34 air while traveling over spillways is subsequently pushed to depth within stilling basins
35 (Parametrix, Inc. 1975). The death of organisms due to gas supersaturation in heated effluents
36 from power plants appears to be most likely at plants that have discharge canals where fish
37 may reside for extended periods of time (i.e., long enough to equilibrate with supersaturated
38 effluents). Gas solubility tends to increase with decreases in water temperatures; therefore,
39 gas bubble disease at steam-electric stations would be most likely to occur during winter
40 months (McInerney 1990). As reported in the 1996 GEIS, observed incidences of gas bubble
41 disease at the Waukegan Generating Station (a coal-fired plant on Lake Michigan), Marshall

1 Steam Station (a coal-fired plant on Lake Norman), and the Pilgrim plant involved fish residing
2 in discharge canals. At the Pilgrim plant, the loss of approximately 43,000 Atlantic menhaden in
3 1973 was attributed to gas bubble disease (McInerney 1990), and other species of fish may also
4 have been affected (Fairbanks and Lawton 1977). Promoting the rapid mixing of effluents with
5 receiving waters (e.g., with jet diffuser systems) appears to effectively prevent such mortalities
6 by inhibiting residence of organisms in the thermal plume (Lee and Martin 1975) and by limiting
7 the extent of the area where supersaturated conditions may occur. Restricting entry of fish into
8 discharge canals may also be effective at controlling mortality. A fish barrier net was installed in
9 the discharge canal at the Pilgrim plant after the mortality events observed during the 1970s,
10 although subsequent implementation of engineering controls have mitigated conditions so that
11 the use of the net has not been required since then.

12
13 Impacts from gas supersaturation are considered to be of small significance if populations of
14 aquatic organisms in the vicinity of the plant are not reduced. On the basis of reviews of the
15 available scientific literature, plant-specific ERs, and the SEISs that have been completed to
16 date, deaths of aquatic organisms attributable to gas supersaturation have not been a concern
17 at most existing nuclear power plants. Operational and structural mitigation measures have
18 been effective at controlling effects on fish at the Pilgrim plant, where fish kills attributable to
19 gas supersaturation occurred during the initial license period. In no case has a substantial
20 effect on populations of aquatic organisms been observed. Use of engineering controls
21 (e.g., use of jet diffusers for cooling water discharge systems) that prevent the occurrence of
22 mortality due to gas bubble disease at individual power plants also reduces the likelihood that
23 discharges from cooling systems would contribute to cumulative effects.

24
25 Unless the operation of the cooling system or the ambient conditions that affect levels of
26 dissolved oxygen or gas supersaturation in the receiving waters were to change substantially, it
27 is anticipated that there would be no change in effects of low dissolved oxygen concentrations
28 or gas supersaturation on aquatic biota during the license renewal term. Overall, effects of low
29 dissolved oxygen concentrations and gas supersaturation attributable to cooling water
30 discharges are considered to be of small significance for all plants.

31
32 For some plants, the potential for effects of low dissolved oxygen concentrations or gas
33 supersaturation on aquatic resources could be further reduced by changing from a once-
34 through cooling system to a closed-cycle cooling system or by reducing the plant's generation
35 rate. However, because the continued effects of operations on dissolved oxygen
36 concentrations and gas supersaturation are considered to be of small overall significance to
37 populations of aquatic resources and because implementation of these changes would be
38 costly, it is believed that such changes are not warranted on the basis of controlling levels of
39 dissolved gases. Impacts of license renewal on dissolved oxygen levels and on the incidence
40 of gas bubble disease were considered to be small for all nuclear plants and were designated

Environmental Consequences and Mitigating Actions

1 as Category 1 issues in the 1996 GEIS. No new information has been identified in the plant-
2 specific SEISs prepared to date or in the literature that would alter those conclusions.

3
4 On the basis of these considerations, the NRC concludes that the impact on aquatic biota from
5 the alteration of dissolved oxygen levels and gas supersaturation associated with continued
6 operations over the license renewal term would be small for all nuclear plants and remains a
7 Category 1 issue.

8 9 *Effects of Nonradiological Contaminants on Aquatic Organisms*

10
11 The potential for nonradiological contaminants to accumulate in sediments or aquatic biota was
12 identified as a Category 1 issue in the 1996 GEIS. This was originally raised as an issue of
13 concern at a few power plants that used copper alloy condenser tubes, but this concern has
14 been successfully mitigated by replacing copper alloy tubes with those made from other metals
15 (e.g., titanium). An operating nuclear power plant can contribute other contaminants by
16 concentrating existing constituents from the water body (e.g., in blowdown at closed-cycle
17 plants) or by the addition of chemicals to cooling water during plant operations (e.g., biocides).

18
19 Biocides are used in cooling water systems to prevent the buildup of microorganisms that can
20 impede heat transfer across heat exchange surfaces. Biocides are also used to prevent
21 excessive growth of algae or other organisms that attach to structures, which can reduce
22 cooling water flow by blocking pipes, tubing, and other water conveyances. For example, zebra
23 mussels and Asiatic clams within the intakes or cooling systems of power plants can cause
24 partial to total blockage of grates and pipes or cause damage to pipes and facilities, requiring
25 the plants to temporarily suspend operations in order to remove the blockage or repair the
26 damage. To prevent this from happening, plants in areas where these mollusks occur generally
27 use nonoxidizing molluscicides (e.g., quaternary ammonium salts, glutaraldehyde, isothiazoline,
28 triazine, and carbamates). The amount of a biocide that is applied to the cooling waters is
29 controlled so that the concentrations that are discharged from the cooling system are too low to
30 cause adverse effects to native mussels in the receiving water body. Allowable concentrations
31 for biocides in discharged cooling waters are governed by NPDES permit restrictions to reduce
32 the potential for toxic effects on nontargeted organisms (e.g., native mussels and fishes). At the
33 Browns Ferry plant in Alabama, small sponge rubber balls are continuously recirculated through
34 the condenser tubes to keep them clear of Asiatic clams and thus reduce the use of
35 molluscicides (NRC 2005c). Also, various means can be used to minimize the discharged
36 concentrations of biocides in the blowdown, including closing the blowdown valve before
37 biocides are added, discharging blowdown to large sediment or retention ponds, and
38 dechlorination (Veil et al. 1997).

39
40 As reported in the 1996 GEIS, heavy or toxic metals (e.g., copper, zinc, and chromium) may be
41 leached from condenser tubing and other heat exchangers and discharged by power plants as

1 small-volume waste streams or corrosion products. Although heavy metals are found in small
2 quantities in natural waters (and many are essential micronutrients), concentrations in the
3 power plant discharge are typically controlled in the NPDES permit because excessive
4 concentrations of heavy metals can be toxic to aquatic organisms. Discharge of metal and other
5 toxic contaminants may also be subject to individual control strategies developed by the States
6 to control toxic pollutants under the CWA. These strategies for point source discharges of toxic
7 pollutants are implemented through the NPDES permit program. Heavy metal concentrations in
8 discharges during normal operations are generally low. However, reactor shutdowns for testing
9 and refueling keep stagnant water in contact with condenser tubes and other metal structures
10 for extended periods and may allow abnormally large amounts of metals to be leached into the
11 water.

12
13 The ability of aquatic organisms to bioaccumulate heavy metals, even at low concentrations,
14 has led to concerns about toxicity both to the humans and biota that consume contaminated fish
15 and shellfish. For example, the bioconcentration of copper discharged from the Chalk Point
16 plant (a fossil fuel power plant on Chesapeake Bay) resulted in discoloration (“greening”) effects
17 on eastern oysters (*Crassostrea virginica*) (Roosenburg 1969), and the bioaccumulation of
18 copper released from the Robinson plant in South Carolina resulted in malformations and
19 decreased reproductive capacity among bluegill in the cooling reservoir. Replacement of
20 copper alloy tubes with tubes made from other metals (e.g., titanium) alleviated the elevated
21 copper levels in both of these cases (NRC 1996, 2003b).

22
23 Concentrations of heavy metals and other contaminants in the discharges of nuclear power
24 plants are normally quickly diluted or flushed from the area by the large volumes of the
25 receiving water. The discharge of metals and other toxic contaminants may also be subject to
26 controls implemented by State or Federal agencies through the NPDES permit process.
27 Impacts of contaminant discharges are considered to be of small significance if water quality
28 criteria (e.g., NPDES permits) are not violated and if aquatic organisms in the vicinity of the
29 plant are not bioaccumulating the contaminants.

30
31 The accumulation of contaminants in sediments and biota was designated as a Category 1
32 issue in the 1996 GEIS. No new information has been identified in plant-specific SEISs
33 prepared to date or in the reviewed literature that would alter those conclusions. However, this
34 issue has been modified to look at contaminant effects other than accumulation. As long as
35 changes to the cooling system do not occur during the license renewal term and the discharge
36 requirements of the NPDES permit are met, no impact of contaminants on aquatic biota would
37 be anticipated. On the basis of these considerations, the NRC concludes that the impact of
38 contaminants on aquatic organisms associated with continued operations would be small for all
39 nuclear plants and remains a Category 1 issue.

40

Environmental Consequences and Mitigating Actions

1 *Exposure of Aquatic Organisms to Radionuclides*

2
3 The potential impacts of radionuclides on aquatic organisms from normal operations of a
4 nuclear power plant during the license renewal term were not identified as an issue in the 1996
5 GEIS. However, the impact of radionuclides on aquatic organisms has been raised as an issue
6 by the public for several of the plants that have undergone license renewal, and that issue is
7 reviewed here.

8
9 Aquatic biota can be exposed externally to ionizing radiation from radionuclides in water,
10 sediment, and other biota, and aquatic biota can be exposed internally via ingested food and
11 water and, in certain situations, absorption through the skin and respiratory organs (Blaylock
12 et al. 1993). No evidence of significant differences in sensitivity to radionuclides between
13 marine and freshwater organisms has been reported (Blaylock et al. 1993). Some
14 radionuclides tend to follow pathways similar to their nutrient analogs and can therefore be
15 transferred rapidly through the food chain. These include (1) radionuclides such as
16 strontium-90, barium-140, radon-226, and calcium-46 that behave like calcium and are therefore
17 accumulated in bony tissues; (2) radionuclides such as iodine-129 and iodine-131 that act like
18 stable iodine and accumulate in thyroid tissue; (3) radionuclides such as potassium-40,
19 cesium-137, and rubidium-86 that follow the general movement of potassium and can be
20 distributed throughout the body; and (4) radionuclides such as tritium, which resembles stable
21 hydrogen, that are distributed throughout the body of an organism (Ahier and Tracy 1995).

22
23 Fish, especially developing eggs and young, appear to be the aquatic organisms that are the
24 most sensitive to the effects of ionizing radiation, while phytoplankton and zooplankton are
25 relatively resistant to effects from exposure (NCRP 1991; Blaylock et al. 1993). DOE's guideline
26 for radiation dose rates from environmental sources recommends limiting the
27 radiation dose to aquatic biota to no more than 1 rad/d (0.01 Gy/d). As described in
28 Blaylock et al. (1993), this guideline was derived by reviewing the results of experimental
29 data (NCRP 1991) that indicated there would not be any negative population-level effects on
30 aquatic biota at doses up to 1 rad/d (0.01 Gy/d). That review reported that significant
31 histological effects on the gonads of small tropical fish were detected at a dose of 1 rad/d
32 (0.01 Gy/d), although the majority of controlled studies that examined the potential chronic
33 effects of ionizing radiation on aquatic organisms did not find significant effects unless the dose
34 was much greater than 1 rad/d (0.01 Gy/d) (NCRP 1991). Real et al. (2004) summarized
35 several chronic irradiation studies on fish (mostly from gamma radiation at dose rates of 0.2 to
36 120 rad/d [0.02 to 1.2 Gy/d]) that reported effects, such as lowered fecundity, delayed
37 spawning, reduced testis mass and sperm production, reduced immune response, reduced
38 larval survival, and increased vertebral anomalies. They concluded that dose rates of less than
39 approximately 10 rad/d (0.1 Gy/d) to any life stage are unlikely to affect survival (Real et al.
40 2004). Kryshev and Sazykina (1998) reported that ecological effects of ionizing radiation on
41 aquatic biota occur at dose rates between 0.2 and 80,000 rad/d (0.002 and 800 Gy/d)]. For

1 comparison, Brown et al. (2004) used models to estimate doses to aquatic biota from naturally
 2 occurring radionuclides as ranging from 0.00024 to 0.11 rad/d (2.4×10^{-6} to 1.1×10^{-3} Gy/d) for
 3 European freshwater ecosystems and 0.00024 to 0.06 rad/d (2.4×10^{-6} to 6.0×10^{-4} Gy/d) for
 4 European marine waters.

5
6

Table 4.6.1.2–2. Estimated Radiation Dose Rates to Aquatic Animals from Radionuclides Measured in Water and Sediments at U.S. Nuclear Power Plants

Plant	Estimated Dose Rates (rad/d) ^(a)		
	Water	Sediment	Total
Arkansas Nuclear	1.87×10^{-4}	1.98×10^{-6}	1.89×10^{-4}
Browns Ferry	1.43×10^{-2}	2.88×10^{-5}	1.43×10^{-2}
Calvert Cliffs	1.53×10^{-7}	1.09×10^{-10}	1.54×10^{-7}
Columbia	5.01×10^{-2}	2.17×10^{-5}	5.01×10^{-2}
Comanche Peak	5.82×10^{-2}	1.03×10^{-4}	5.83×10^{-2}
D.C. Cook	5.01×10^{-2}	1.46×10^{-4}	5.02×10^{-2}
Hatch	5.02×10^{-2}	1.22×10^{-5}	5.02×10^{-2}
Fort Calhoun	1.06×10^{-1}	5.71×10^{-6}	1.06×10^{-1}
Indian Point	5.01×10^{-2}	2.03×10^{-5}	5.01×10^{-2}
Millstone	5.02×10^{-2}	5.73×10^{-4}	5.08×10^{-2}
Nine Mile Point	5.02×10^{-2}	1.02×10^{-5}	5.02×10^{-2}
Palisades	1.34×10^{-7}	3.65×10^{-6}	3.78×10^{-6}
Point Beach	2.67×10^{-3}	2.73×10^{-4}	2.95×10^{-3}
San Onofre	1.12×10^{-2}	3.00×10^{-4}	1.15×10^{-2}
Vermont Yankee	5.02×10^{-2}	1.11×10^{-3}	5.13×10^{-2}

(a) Dose rates were estimated with RESRAD-BIOTA (DOE 2004e) by using site-specific radionuclide concentrations in water and sediments obtained from REMP reports.

7

8 Dose rates for aquatic biota were calculated with the RESRAD-BIOTA dose evaluation model
 9 (DOE 2004e) using site-specific radionuclide concentrations in water and sediments reported in
 10 the REMP reports for 15 NRC-licensed power plants (Table 4.6.1.2–2). (See Section D.5 in
 11 Appendix D for a description of the methodology used.) These 15 plants represent plants with
 12 a range of radionuclide concentrations in environmental media. The total estimated dose rates
 13 for aquatic biota for these plants were all less than 0.2 rad/d (0.002 Gy/d), considerably less
 14 than the guideline value of 1 rad/d (0.01 Gy/d). Thus, it is anticipated that normal operations of
 15 these facilities would not result in negative effects on aquatic biota. Effects on populations of

Environmental Consequences and Mitigating Actions

1 aquatic biota from such doses would be small. A 25-year study of gamma-ray-emitting
2 radionuclide levels near the Susquehanna plant in Pennsylvania indicated that there have been
3 no known environmental impacts on aquatic resources (Patrick et al. 2007). On the basis of the
4 reviewed literature and the dose rates that have been estimated for aquatic biota from site-
5 specific data, the NRC concludes that the impact of radionuclides on aquatic biota from past
6 operations would be small for all plants, and it would not be expected to change appreciably
7 during the renewal period. Therefore, the impact of radionuclides on aquatic biota that would
8 result from continued operations is considered a Category 1 issue.

9 10 *Effects of Dredging on Aquatic Biota*

11
12 Dredging is an activity that is performed at some power plants to remove accumulated
13 sediments from intake and discharge areas (or, more rarely, to maintain barge slips) and may
14 have localized impacts on aquatic biota. The impacts of dredging were not evaluated in the
15 1996 GEIS.

16
17 Sediment (especially sand and silt) that enters water bodies through the process of erosion can
18 accumulate and gradually fill in some areas. Because of this, maintenance dredging may be
19 required at some power plants to keep cooling water intakes and discharges clear of sediment
20 (Allen et al. 2004; NRC 2007b,c). Dredging may also occur as part of power plant operation to
21 maintain appropriate water circulation in water bodies that provide cooling water (e.g., at the
22 Millstone plant; NRC 2005c) or to maintain access for barges (e.g., at the Calvert Cliffs plant in
23 Maryland; NRC 1999b). Dredging can be accomplished in a number of ways (e.g., using
24 various types of mechanical or hydraulic dredges), but it generally entails excavating a layer of
25 sediment from the affected areas and transporting it to onshore or offshore areas for disposal.

26
27 Dredging can affect aquatic biota in a variety of ways. Except for some deep-burrowing animals
28 or motile animals, such as larger crustaceans and fish, that may survive dredging through
29 avoidance, it is assumed that organisms living on or in the affected sediments will be killed.
30 Sediments suspended in the water column during dredging activities may settle onto and bury
31 adjacent habitats, clog the feeding structures of filter-feeding organisms, or reduce light
32 penetration. The potential for impacts on aquatic organisms as a result of direct effects of
33 suspended sediment depends on the types of organisms present in the affected area, the
34 amount and particle sizes of the sediment, and the duration of dredging activities
35 (Nichols et al. 1990; Wilber and Clarke 2001).

36
37 The recovery of benthic communities in habitats disturbed by dredging depends, in part, on
38 the characteristics of the remaining sediments (Diaz 1994; Haynes and Makarewicz 1982),
39 the sources and types of organisms available to recolonize from surrounding areas, and
40 the size of the disturbed area (Whitlatch et al. 1998). In soft-sediment environments,
41 such as those that are most likely to require dredging in the vicinity of power plant intakes,

Environmental Consequences and Mitigating Actions

1 recovery of animal communities generally occurs relatively quickly (sometimes within
2 weeks) especially if the dredged areas are relatively small (e.g., Diaz 1994). In some cases,
3 however, recovery of benthic communities may take several years (e.g., Kaplan et al. 1975;
4 Guerra-García et al. 2003). Recovery of benthic communities following dredging also tends to
5 be faster in areas exposed to periodic disturbances, such as tidally influenced habitats
6 (Diaz 1994).

7
8 Sediments in and around cities and industrial areas are often contaminated with a variety of
9 pollutants. These pollutants are introduced to waterways from point sources such as combined
10 sewer overflows, municipal and industrial discharges and spills, or may be introduced from
11 nonpoint sources such as surface runoff and atmospheric deposition (EPA 2004a).
12 Contaminants that have accumulated in buried layers of sediment are often less readily
13 bioavailable or less chemically active (EPA 2004a). Depending on the concentrations of
14 specific contaminants in accumulated sediments, there could be increased bioavailability and
15 increased toxicity of those contaminants if they are resuspended in the water column due to
16 dredging activities (Petersen et al. 1997; Su et al. 2002; EPA 2004a). On the basis of a review
17 of the information in the ERs and SEISs that have been prepared for previous renewal
18 applications, the levels of chemical and radionuclide contamination of sediments in the areas
19 near power plant intakes and discharges that would need to be dredged are likely to be
20 relatively low. For example, as reported in the SEIS for license renewal for the Pilgrim Nuclear
21 Power Station in Massachusetts, the toxicity of sediments to marine organisms, which was
22 evaluated prior to dredging the intake channel, was found to be low (NRC 2007c).

23
24 In general, maintenance dredging for nuclear power plant operations would occur infrequently,
25 would be of relatively short duration, and would affect relatively small areas. For example, at the
26 Peach Bottom Atomic Power Station in Pennsylvania, it is estimated that dredging of the intake
27 basins is performed approximately once every 20 years and a total area of approximately
28 2.4 ha (6 ac) would need to be dredged (NRC 2003a). The intake and discharge canals at the
29 Oyster Creek Nuclear Generating Station in New Jersey have been dredged approximately
30 every 3 to 10 years (NRC 2007b), and the intake area for the Monticello Nuclear Generating
31 Plant in Minnesota requires dredging every 6 to 8 years (NRC 2006c). It is anticipated that
32 maintenance dredging would be primarily undertaken in areas containing soft sediments that
33 would be recolonized fairly rapidly by benthic organisms in surrounding areas. In addition,
34 permits from the USACE, State environmental agencies, or other applicable regulatory
35 authorities would be required prior to initiating dredging. Site-specific evaluation of potential
36 environmental impacts, including potential impacts on listed species of aquatic organisms,
37 would be considered as part of the permitting process, and appropriate mitigation measures, if
38 needed, could be identified and implemented.

39
40 Available scientific literature, plant-specific ERs, and the SEISs that were reviewed indicate that
41 the effects of these dredging activities on populations or communities of aquatic organisms

Environmental Consequences and Mitigating Actions

1 would likely be small at all plants where they occur. On the basis of these considerations, the
2 NRC concludes that the impact of dredging on aquatic resources would be small for all nuclear
3 plants and is considered a Category 1 issue.

4 5 *Water Use Conflicts with Aquatic Resources (Plants with Cooling Ponds or Cooling Towers* 6 *Using Make-Up Water from a River with Low Flow)*

7
8 In the 1996 GEIS, water use conflicts included ecological impacts on aquatic and riparian
9 communities. Water use conflicts with aquatic resources in instream communities could occur
10 when water that supports these resources is diminished either because of decreased availability
11 due to droughts; increased water demand for agricultural, municipal, or industrial usage; or a
12 combination of such factors.

13
14 Increased temperatures and/or decreased rainfall would result in lower river flows, increased
15 cooling pond evaporation, and lowered water levels in the Great Lakes or reservoirs.
16 Regardless of overall climate change, droughts could result in problems with water supplies and
17 allocations. Because future agricultural, municipal, and industrial users would continue to share
18 their demands for surface water with power plants, conflicts might arise if the availability of this
19 resource decreased.

20
21 Water use conflicts with aquatic resources could occur when water to support these resources
22 is diminished either because of decreased water availability due to droughts; increased demand
23 for agricultural, municipal, or industrial usage; or due to to a combination of such factors.
24 Water use conflicts with biological resources in instream communities is a concern due to to the
25 duration of license renewal and potentially increasing demands on surface water.

26
27 For example, Wolf Creek uses Coffee County Lake for cooling (NRC 2008a). Makeup water for
28 the lake is withdrawn from the Neosho River downstream of John Redmond Reservoir. The
29 Neosho River is a river with low water flow during drought conditions. The aquatic communities
30 in the Neosho River downstream include an endangered fish species, the Neosho madtom
31 (*Noturus placidus*), that may be affected by the plant's water use during periods when the lake
32 level is low and makeup water is obtained from the Neosho River. For the Wolf Creek plant,
33 the water use conflict impact is small to moderate and a site-specific condition. The potential
34 range of impact levels at plants with cooling ponds or cooling towers using makeup water from a
35 river with low flow applying for license renewal in the future cannot be determined at this time.
36 The impact of water use conflicts with instream communities is considered a plant-specific
37 Category 2 issue.

1 *Refurbishment Impacts on Aquatic Resources*

2
3 Impacts on aquatic resources from refurbishment activities could occur at all operating nuclear
4 power plants during the license renewal term as a result of (1) direct disturbance of aquatic
5 habitats within project areas, (2) sedimentation of nearby aquatic habitats as a consequence of
6 soil erosion, (3) changes in water quantity or water quality (e.g., grading that affects surface
7 runoff patterns or depletions or discharges of water into aquatic habitats), or (4) releases of
8 chemical contaminants into nearby aquatic systems. In some cases, impacts have a potential
9 to continue to occur throughout the period covered by license renewal. In the 1996 GEIS, the
10 NRC considered only the impact of refurbishment on aquatic habitats and concluded that the
11 impact would be small at all nuclear plants (i.e., a Category 1 issue).

12
13 The surface area disturbed during construction of new waste storage facilities (e.g., ISFSIs)
14 would be expected to range from about 1 to 4 ha (2.5 to 10 ac). Other supporting activities that
15 could occur at specific sites may include the construction of new parking areas for plant
16 employees, utility corridors, access roads, or new buildings or facilities, or the demolition of
17 existing buildings. Land used for equipment storage, worker parking, and material laydown
18 areas could result in disturbance to aquatic resources within the plant boundaries. Surface
19 water habitats could also be affected by drain ponds, block or redirect streams, or place rip-rap
20 along shorelines. The size and nature of the water body, and other project-specific aspects,
21 organisms within the affected habitats could be displaced or killed, or the community structure
22 within the water body could be altered.

23
24 The potential for soil erosion and sediment loading of nearby aquatic habitats is typically
25 proportional to the amount of surface disturbance, erosion potential of the soil, slope, condition
26 of disturbed areas at any given time, and proximity to aquatic habitats. Ground-disturbing
27 activities have a higher erosion potential. Mitigation measures include controlling surface runoff
28 with ditches, berms, and sedimentation basins; prompt revegetation to control erosion;
29 stockpiling and reusing excavated topsoil; and various other techniques used to control soil
30 erosion and water pollution. These mitigation measures (often referred to as best management
31 practices) are expected to be implemented as part of project activities undertaken during the
32 license renewal term to minimize impacts on surface water quality and aquatic resources.

33
34 During refurbishment, effluent discharges from the cooling system of a nuclear power plant
35 would either remain similar to those occurring during normal operations during refurbishment or
36 would decrease if the plant was partially or totally shut down. Consequently, effects of changes
37 in water withdrawals and discharges during refurbishment would be of small significance. The
38 impact on aquatic biota from water use would not be expected to substantially change during
39 refurbishment or maintenance activities from the impact during existing operations.

40

Environmental Consequences and Mitigating Actions

1 During ground-disturbing activities, contaminants could enter aquatic habitats as a result of
2 runoff from project sites or from accidental releases of fuels or lubricants. The level of impacts
3 from releases of toxicants would depend on the type and volume of chemicals entering the
4 waterway, the location of the release, the nature of the water body (e.g., size, volume, flow
5 rates, and water chemistry), and the types and life stages of organisms present in the affected
6 area. In general, lubricants and fuel would not be expected to enter waterways as long as
7 construction machinery and fuel storage areas and fueling locations were located away from
8 water bodies, and spill prevention and control measures are in place.

9
10 Obstructions to fish movement could occur in streams with low flows. Restrictions on fish
11 movement would likely be most significant if they occurred in streams that supported species
12 that need to move to specific areas in order to reproduce.

13
14 The impact of refurbishment on aquatic habitats was evaluated in the 1996 GEIS and
15 considered a Category 1 issue. Permits from various Federal, State, and local governmental
16 authorities are typically required for ground-disturbing activities. For example, refurbishment
17 may require the issuance of permits under Section 404 of the CWA if the activities were to
18 directly affect aquatic habitats. With proper application of environmental reviews, permitting
19 processes, and best management practices, impacts on sensitive aquatic habitats would likely
20 be avoided. The NRC concludes that the impact of refurbishment activities on aquatic
21 resources is small and remains a Category 1 issue.

22 *Impacts of Transmission Line ROW Maintenance on Aquatic Resources*

23
24
25 Impacts on aquatic resources from transmission line ROW maintenance could occur as a result
26 of the direct disturbance of aquatic habitats, soil erosion, changes in water quality (from
27 sedimentation and thermal effects), or inadvertent releases of chemical contaminants from
28 herbicide use. These impacts could occur throughout the license renewal term. The NRC did
29 not evaluate the impact of transmission line ROW maintenance on aquatic biota in the 1996
30 GEIS, but this issue has been identified by the NRC for consideration in this GEIS revision on
31 the basis of past environmental reviews conducted for plant-specific SEISs.

32
33 Water quality impacts could result from maintaining transmission line ROWs and, as necessary,
34 service roads. Where access roads cross or border on surface waters, soil erosion could cause
35 elevated turbidity and sedimentation. Application of appropriate control techniques
36 (e.g., establishing and maintaining vegetated buffer strips between the road and the body of
37 water) would reduce impacts. Because ROWs are normally maintained by mowing, selective
38 cutting, and/or selective application of herbicides, soil erosion from transmission line corridors
39 should not normally be a problem. Potential toxic effects of herbicides that are applied to
40 transmission line ROWs and subsequently transported to surface waters should be considered
41 in the ROW maintenance program. By using herbicides approved for ROW use in accordance

Environmental Consequences and Mitigating Actions

1 with the Federal Insecticide, Fungicide, and Rodenticide Act, significant adverse effects of
2 herbicides on aquatic ecosystems should be minimized. Maintenance activities in the vicinity of
3 stream and river crossings employ procedures to minimize erosion and shoreline disturbance
4 (e.g., control of vegetation within streamside buffer zones is generally accomplished by manual
5 techniques) while encouraging small tree, shrub, and other low-growth vegetative cover. The
6 nature or frequency of these activities is not expected to change substantially during the license
7 renewal term.

8
9 For small streams in particular, trees may have grown sufficiently between cutting cycles to
10 provide stream shading. Removal of these trees to maintain required conductor clearance
11 could increase water temperature. Coldwater species may avoid such areas. The normal
12 reaction of fish exposed to stressful temperatures is to move along the temperature gradient
13 until preferred temperatures are encountered. Fish could avoid elevated temperatures within
14 the opened ROW by swimming upstream or downstream to areas of groundwater inflow, to
15 deep holes, or to shaded areas. However, effects that result in avoidance of specific areas by
16 some species could represent a partial loss of available habitat. Thermal conditions of larger
17 streams (e.g., those that are 3 m [10 ft] wide or wider) would be generally unaltered, since they
18 are mostly unshaded.

19
20 Most transmission line ROWs are maintained on a 3- to 6-year cycle, so impacts on a water
21 body would be infrequent. Any adverse impacts would be localized and temporary and would
22 occur primarily on small streams. To minimize potential impacts from siltation and
23 sedimentation, herbicide application, and stream warming, the licensee or owner of the
24 transmission line typically adheres to standard mitigation practices (application of herbicides
25 according to label instructions and by licensed personnel) listed in the vegetation management
26 plan. Most operators establish stream buffer setbacks within which herbicides cannot be
27 applied, and most widely used herbicides (e.g., glyphosate, fosamine, and imazapyr) pose
28 minimal risks to aquatic organisms.

29
30 Changes in aquatic species diversity, abundance, or health from transmission line ROW
31 maintenance are likely to be small. The continued use of proper management practices with
32 respect to soil erosion and application of herbicides is expected. Consequently, it is anticipated
33 that the impact of transmission lines on surface water quality and aquatic resources would be
34 small. The decision to renew the license for a specific plant would affect only the portion of the
35 transmission line that connects the power plant to the first substation. In many cases, the first
36 substation is within or near the boundary of the plant property, and only a short distance of
37 transmission line would be affected by the license renewal decision. Consequently, the amount
38 of aquatic habitat crossed by this portion of a transmission line is also likely to be small.

39
40 The impact on aquatic resources of maintaining transmission line ROWs was not identified as
41 an issue in the 1996 GEIS. However, the impact is expected to be small, short term, and

Environmental Consequences and Mitigating Actions

1 localized. The NRC concludes that the impact of transmission line ROW maintenance on
2 aquatic resources would be small for all nuclear plants and is considered a Category 1 issue.

3 4 *Losses from Predation, Parasitism, and Disease Among Organisms Exposed to Sublethal* 5 *Stresses*

6
7 Sublethal power plant stresses may alter predator-prey interactions in the receiving body of
8 water. Aquatic organisms that are stunned but not killed by entrainment, impingement, or
9 thermal effects may still suffer "indirect" mortality through increased susceptibility to predators.
10 Numerous laboratory studies have been carried out to evaluate the level of indirect mortality
11 that might occur following heat and cold shocks or entrainment (reviews in Cada et al. 1981;
12 Coutant 1981). These studies have commonly demonstrated increased susceptibility to
13 predation, but field evidence of such effects is often limited to anecdotal information such as
14 observations of enhanced feeding activity of seagulls and predatory fish near power plant
15 outfalls. For example, Barkley and Perrin (1971) and Romberg et al. (1974) reported increased
16 concentrations of predators feeding on forage fish attracted to thermal plumes. Neither
17 quantification of the levels of stress needed to increase predation rates, nor prediction of the
18 subsequent population- and community-level effects of such changes can be made easily in the
19 field. It is likely that operation of once-through cooling systems will cause some changes in
20 predator-prey relationships, but the best evidence for impacts (or lack of impacts) may come
21 from long-term monitoring of fish populations. Neither the literature reviews nor consultations
22 with agencies and utilities (Appendix F) have revealed studies that demonstrate population- or
23 community-level effects from power-plant-induced alterations of predator-prey relationships.

24
25 Elevated water temperatures in power plant discharges have been hypothesized to increase the
26 susceptibility of fish to diseases and parasites. Langford (1983) cites a number of factors that
27 could contribute to such an effect, including the tendency for fish to congregate in the heated
28 discharge area in greater than normal concentrations, increased stresses on fish in warmer
29 water that makes them more prone to infection, and the ability of some diseases and parasites
30 to develop faster at higher temperatures. Additionally, it has been suggested that stress and
31 injury from entrainment and impingement contribute to increased susceptibility of fish to
32 disease, parasites, and predation. Coutant (1981) noted that although some studies of
33 increased disease and parasitism in heated waters have found localized effects, most were not
34 adequately designed to determine the significance of the effects to the overall population. The
35 greatest risks appear to be associated with changes in animal concentrations; crowding can
36 occur among fish that are attracted to heated effluents in the winter or that avoid heated water
37 in the summer by occupying limited cool-water refugia. Crowding increases the chances of
38 exposure to infectious diseases and may also lead to other stresses (decreased food supply or
39 reduced oxygen concentrations) that increase susceptibility to disease (Coutant 1987). Despite
40 limited laboratory studies that confirm this phenomenon, population-level effects in the vicinity
41 of plants have not been observed.

1
2 Effects of sublethal stresses on the susceptibility of aquatic organisms to predation, parasitism,
3 and disease are considered to be of small significance if changes are localized and populations
4 in the receiving waterbody are not reduced. Based on reviews of literature and operational
5 monitoring reports, consultations with utilities and regulatory agencies, and comments on the
6 draft GEIS, these forms of indirect, power plant-induced mortality have not been shown to cause
7 reductions in the overall populations near any existing nuclear power plants. Effects are
8 considered to be of small significance for all plants. Although sublethal power plant stresses
9 could contribute to cumulative impacts experienced by aquatic biota, monitoring has revealed
10 no evidence for significant effects; the regulatory and resource agencies consulted in the
11 preparation of this GEIS did not express concerns about the contribution of sublethal power
12 plant stresses to cumulative impacts. No change in operation of the cooling system is expected
13 during the license renewal term, so no change in effects of sublethal stresses is anticipated.
14 Effects of sublethal stresses could be reduced by changing to a closed cycle cooling system or
15 by reducing the plant's generation rate. However, because the effects of sublethal stresses are
16 considered to be impacts of small significance this is considered a Category 1 issue.

17 18 *Stimulation of Aquatic Nuisance Species (e.g., Shipworms)*

19
20 An aquatic nuisance species is "a nonindigenous species that threatens the diversity or
21 abundance of native species or the ecological stability of infested waters, or commercial,
22 agricultural, aquacultural or recreational activities dependent on such waters" (Nonindigenous
23 Aquatic Nuisance Prevention and Control Act of 1990). A variety of nuisance or nonnative
24 species may become established or proliferate as a result of power plant operations, including
25 fouling organisms such as the Asiatic clam and the recently introduced zebra mussel. Aspects
26 of the operation of the power plants (e.g., warm temperatures or high flow rates that bring food
27 to filter-feeding organisms) may be conducive to the growth and development of these
28 organisms. Asiatic clams and zebra mussels may become so abundant as to cause operational
29 difficulties for the power plant and may out-compete native clams and mussels in thermally
30 enriched waters. A population of tropical, nonnative blue tilapia (*Oreochromis aureus*) became
31 established in the Susquehanna River in Pennsylvania by congregating in thermal effluents
32 during the winter. Exposure to rapid temperature decreases (cold shock) killed these fish and
33 eradicated the population from the vicinity of a steam-electric power plant.

34
35 Langford (1983) reports a number of instances in which wood-boring crustaceans and
36 mollusks, notably "shipworms," have caused concern in British waters. Although increased
37 abundance of shipworms in the area influenced by heated power plant effluents caused
38 substantial damage to wooden structures, replacement of old wood with concrete or metal
39 structures eliminated the problem. Langford concluded that increased temperatures could
40 enhance the activity and reproduction of wood-boring organisms in enclosed or limited areas
41 but that elevated temperature patterns were not sufficiently stable to cause widespread effects.

Environmental Consequences and Mitigating Actions

1
2 In the United States, the influence of the operation of Oyster Creek Nuclear Generating Station
3 on shipworm abundance and distribution has been extensively studied (see summary in
4 Richards et al. 1984). Although numerous studies have varied somewhat in their conclusions,
5 there is agreement that heated effluents from the plant increased the distribution and
6 abundance of shipworms (Kennish et al. 1984). This species has not been found in
7 Oyster Creek or Barnegat Bay since 1982, perhaps because of low water temperatures in
8 Oyster Creek during a station outage in the winter of 1981–82 and the pathological effects of a
9 parasite [GPU Nuclear Corporation response to NUMARC survey (NUMARC 1990)]. In
10 addition, the removal of substantial amounts of driftwood and the replacement of untreated
11 structural wood is thought to have contributed to reducing the populations of wood-boring
12 organisms in Oyster Creek. No other concerns about nuisance organisms were cited by the
13 regulatory or resource agencies contacted for this GEIS (Appendix F). Measures taken by
14 licensees to control nuisance species (e.g., increased chlorination or use of molluscicides) may
15 result in impacts on other species. This impact is also controlled by the NPDES permitting
16 procedures.

17
18 The effects of stimulating the growth of nuisance organisms are considered to be of small
19 significance to aquatic resources if these organisms are restricted to the condenser cooling
20 system (e.g., Asiatic clam; zebra mussel) or do not proliferate beyond the immediate vicinity of
21 the plant. Based on review of literature and operational monitoring reports, consultations with
22 utilities and regulatory agencies, and comments on the draft GEIS, nuisance organisms such as
23 Asiatic clam may be an operational problem, but they have not impacted aquatic resources near
24 most existing nuclear power plants. Mitigation measures were effective at the one plant that
25 experienced problems with nuisance organisms (e.g., shipworms). Effects are considered to be
26 of small significance for all plants. The regulatory and resource agencies consulted in the
27 preparation of this GEIS did not express concerns about the contribution of power plant
28 operations to other activities that might encourage the growth of nuisance organisms
29 (i.e., cumulative effects). No change in operation of the cooling system is expected during the
30 license renewal term, so no change in the growth or distribution of nuisance organisms is
31 anticipated. Effects on nuisance organisms could be reduced by changing to a closed-cycle
32 cooling system or by reducing the plant's generation rate. The stimulation of nuisance aquatic
33 organisms by operation of existing power plants is a Category 1 issue.

34 35 **Summary**

36
37 The issues and the need for these issues to be addressed in license renewal applications of
38 existing nuclear power plants with once-through cooling systems are summarized
39 in Table 4.6.1.2–3. The operational experience of existing nuclear power plants indicates that
40 many early aquatic resource issues that caused a concern in the 1970s when nuclear power

1 generation was new have not materialized as problems at any facility and some problems at a
2 few nuclear power plants with once-through cooling systems have since been mitigated.

3
4 Some aquatic resource issues warrant further monitoring and, in some cases, mitigative
5 measures to define and correct adverse impacts. The entrainment and impingement of fish and
6 the discharge of large volumes of heated effluents into small or warm ambient waters were a
7 source of concern at some nuclear power plants. Such issues were examined and resolved
8 through either the National Environmental Policy Act (NEPA) process during the licensing of the
9 facility or the mechanisms of NPDES permitting and associated 316(a) and (b) determinations.
10 They were found either acceptable or mitigated. For some plants with once-through cooling
11 systems, the large volumes of water withdrawn, heated, and discharged back to the receiving
12 water may cause adverse effects to fish and shellfish populations during the license renewal
13 term. Because impacts of entrainment of fish and shellfish, impingement, and thermal
14 discharge effects could be small, moderate, or large, depending on the plant, these are
15 Category 2 issues for plants with once-through cooling systems. These issues will need to be
16 analyzed in the supplemental NEPA document at the time of license renewal.

17 18 **4.6.1.3 Threatened, Endangered, and Protected Species and Essential Fish Habitat**

19
20 The impacts associated with continued nuclear power plant operations and refurbishment
21 activities during the license renewal term that could affect threatened and endangered species
22 and special status species and habitats are similar to those described for terrestrial resources
23 (Section 4.6.1.1) and aquatic resources (Section 4.6.1.2). Continued operations during the
24 20-year license renewal term would be expected to include such stressors as operation of
25 cooling towers, operation of once-through cooling systems and cooling ponds, transmission line
26 ROW management, maintenance of site facilities, releases of gaseous and liquid effluents,
27 withdrawal of surface water, and potentially refurbishment activities. Details are presented in
28 Section 3.6.3. There are several Federal Acts that provide protection to certain species and
29 habitats are treated here as a single issue that includes impacts to biological resources such as
30 threatened and endangered species and their critical habitat (issue modified from the 1996
31 GEIS to include the impacts on both Federally and State-listed species and the impacts of
32 continued operations and refurbishment activities), and essential fish habitats (EFH) protected
33 under the Magnuson-Stevens Act, and mammalian species protected under the Marine
34 Mammal Protection Act.

Environmental Consequences and Mitigating Actions

Table 4.6.1.2–3. Significance Level of Aquatic Resources Impacts for License Renewal of Existing Nuclear Power Plants that Use Once-Through Cooling Systems

Issue	Impact Significance ^(a)
Surface Water Quality, Hydrology, and Use Issues	
Water use conflicts (plants with once-through cooling)	1
Water use conflicts (plants with cooling ponds or cooling towers using makeup water from a river with low flow)	1
Altered current patterns at intake and discharge structures	1
Altered salinity gradients	1
Temperature effects on sediment transport capacity	1
Altered thermal stratification of lakes	1
Scouring from discharged cooling water	1
Discharge of chlorine or other biocides	1
Discharge of metals in waste water	1
Discharge of sanitary wastes and minor chemical spills	1
Effects of consumptive water use on riparian communities	1
Aquatic Ecology	
Impingement and entrainment of aquatic organisms (plants with once-through cooling systems or cooling ponds)	2
Thermal impacts to aquatic organisms (plants with once-through cooling or cooling ponds)	2
Effects of cooling water discharge on dissolved oxygen and gas supersaturation	1
Effects of nonradiological contaminants on aquatic organisms	1
Stimulation of nuisance species (e.g., shipworms)	1
Losses from predation, parasitism, and disease among organisms exposed to sublethal stresses	1
Effects of dredging on aquatic organisms	1
Water use conflicts with aquatic organisms (plants with cooling ponds or cooling towers using makeup water from a river with low flow)	2
Refurbishment impacts on aquatic resources	1
Impacts of transmission line ROW maintenance	1
Impingement and entrainment of aquatic organisms (plants with cooling towers)	1
Thermal impacts to aquatic organisms (plants with cooling towers)	1
Effects of cooling water discharge on dissolved oxygen, gas supersaturation, and eutrophication	1
(a) A "1" means impact significance expected to be small at all sites. A "2" means that the impact may be of moderate or large significance at some sites.	

1 *Threatened, Endangered, and Protected Species and Essential Fish Habitat*

2
3 *Terrestrial Threatened and Endangered Species* – Continued operations and refurbishment
4 activities at all nuclear plants could have an impact on Federally or State-listed threatened and
5 endangered species during the license renewal term. Factors that could potentially result in
6 impacts on listed terrestrial species include habitat disturbance, cooling tower drift, operation
7 and maintenance of cooling systems, transmission line ROW maintenance, collisions with
8 cooling towers and transmission lines, and exposure to radionuclides. In the 1996 GEIS, the
9 NRC considered only the impacts of refurbishment on threatened and endangered terrestrial
10 species and concluded that the impacts would not necessarily be the same at all sites (i.e., a
11 Category 2 issue) and could range from small to large. For this GEIS revision, the impacts of
12 continued operations were also considered.

13
14 Federally listed threatened and endangered terrestrial species are protected under the
15 Endangered Species Act (ESA) of 1973, while State-listed species are protected under
16 provisions of various State regulations. Prior to license renewal, the NRC must consult with the
17 U.S. Fish and Wildlife Service (USFWS) to determine the presence of any Federally listed
18 species or critical habitat at or near the site and assess the potential for impacts from continued
19 operation of the plant or associated transmission lines. The appropriate State agencies also
20 would be contacted regarding procedures for assessing impacts to State-listed species. The
21 impacts of refurbishment activities on threatened or endangered species must also be
22 considered during project planning, and consultation with the USFWS must be initiated if the
23 possibility for impacts exists. Guidance for the consultation process is provided in the
24 *Endangered Species Consultation Handbook* (USFWS and NMFS 1998).

25
26 Site-specific factors related to continued operations and refurbishment activities may vary
27 widely among nuclear power plants. The listed species on or in the vicinity of nuclear power
28 plants also range widely, depending on numerous factors such as the plant location and habitat
29 types present (see Section 3.6.3). In addition, the list of threatened and endangered species is
30 not static and is frequently modified by the USFWS and State agencies, with new listings being
31 added as some species are determined to be eligible, other species being delisted (removed
32 from the list), or the listing category of some species being changed because of changes in the
33 status of or threats to the species population. Therefore, a generic determination of potential
34 impacts on listed species during a nuclear power plant's license renewal term is not possible.
35 Impacts on threatened and endangered species would depend on site-specific factors, and
36 impact assessments would need to be conducted on a site-specific basis. Nuclear plants
37 known to support terrestrial listed species on the site or along transmission line ROWs
38 generally have monitoring programs to identify changes in populations and report impacts to the
39 USFWS and State agencies. Monitoring provides information that can be used for developing
40 or adjusting mitigation during the license renewal term.

Environmental Consequences and Mitigating Actions

1 *Aquatic Threatened or Endangered Species, Marine Mammals, and Essential Fish Habitat –*

2
3 Potential impacts of continued operations and refurbishment activities on Federally or State-
4 listed threatened and endangered species, protected marine mammals, and EFH could occur
5 during the license renewal term. This issue applies to all operating nuclear power plants.
6 Impacts to these resources that have occurred at operating nuclear plants are discussed in
7 Section 3.6.3.1. Factors that could potentially result in impacts to these species and habitats
8 include impacts of refurbishment, other ground-disturbing activities, release of contaminants,
9 effects of cooling water discharge on dissolved oxygen, gas supersaturation, eutrophication,
10 thermal discharges, entrainment, impingement, reduction in water levels due to the cooling
11 system operations, dredging, radionuclides, and transmission line ROW maintenance. In the
12 1996 GEIS, the NRC considered potential impacts on threatened and endangered aquatic
13 species from the operation of all nuclear power plants as a Category 2 issue and concluded that
14 the impacts could range from small to large.

15
16 Power plants (nuclear and otherwise) that use estuarine or marine waters for cooling could
17 entrain or impinge sea turtles (National Research Council 1990). The impingement mortality of
18 sea turtles (all of which are Federally listed) has been one of the most pressing concerns to
19 date with regard to the effects of nuclear power plant operations on listed species. Sea turtles
20 are commonly encountered at some coastal nuclear plants, including the St. Lucie plant in
21 Florida, the Oyster Creek plant in New Jersey, and the Brunswick plant in North Carolina.
22 Between 1977 and 1997, the average number of sea turtles removed from the intake canal at
23 the St. Lucie plant was 266 per year (Gunter et al. 2001). These included loggerhead, green,
24 leatherback, hawksbill, and Kemp's ridley sea turtles. Most were loggerhead and green sea
25 turtles, with an average of 150 and 103 removed per year, respectively. Among the sea turtles
26 removed, about 4 percent of the loggerheads, 2 percent of the green, and 13 percent of the
27 Kemp's ridley sea turtles were dead (Gunter et al. 2001). Sixty-eight sea turtles were impinged
28 on intake screens at the Oyster Creek plant between 1992 and 2005, and 28 (41 percent) of
29 those individuals died (NRC 2007c). The incidental take limit established by the NMFS for
30 Kemp's ridley sea turtles was exceeded at the Oyster Creek plant in 2004, which required
31 re-initiation of ESA Section 7 consultation with the NMFS (NRC 2007c). All three sea turtle
32 species have been collected, as recently as 2004, in the vicinity of the Brunswick plant intake
33 canal in North Carolina (NRC 2006e). Seventy-five percent of these turtles were released
34 unharmed to the ocean or transported to a sea turtle facility for rehabilitation. Special panels
35 have been installed at the diversion structure of the Brunswick plant, located at the entrance to
36 the intake canal, to minimize the potential for sea turtles to enter the intake canal (NRC 2006e).
37 The licensees of the St. Lucie, Oyster Creek, and Brunswick plants have also implemented
38 programs to monitor the intake canals for sea turtles and to capture and release to the wild
39 any sea turtles observed in the intake canals (NRC 2003a, 2007c, 2006e). In addition, the
40 licensee of the St. Lucie plant has initiated programs to monitor turtle nests on nearby beaches
41 and has implemented facility lighting restrictions (NRC 2003a). Incidental takes of sea turtles

1 have also been recorded for other plants that use estuarine or marine waters for cooling,
2 including the Crystal River and Salem plants (Sackschewsky 2004). Sea turtles also have the
3 potential to occur in the vicinity of other nuclear power plants located near estuarine or marine
4 ecosystems, including the Calvert Cliffs, Diablo Canyon, Hope Creek, and Millstone plants
5 (Sackschewsky 2004). In the SEISs prepared for the Calvert Cliffs plant (NRC 1999b) and the
6 Millstone plant (NRC 2005c), it was determined that continued operations would not adversely
7 affect endangered sea turtles.

8
9 Many nuclear plants whose operations are known to affect special status aquatic species or for
10 which special status species are known to occur within the waterbodies crossed by
11 transmission line ROWs have established monitoring programs and implemented mitigations in
12 consultation with the USFWS or National Marine Fisheries Service (NMFS). For some plants,
13 incidental take limits have been established to ensure that effects on species do not exceed
14 specific levels. Exceeding these incidental take limits would require the NRC to reinstate
15 consultation with USFWS or NMFS. Continued implementation of these actions would reduce
16 the potential for adverse impacts to listed species during the license renewal term.

17
18 Prior to license renewal, the NRC should consult with the USFWS and NMFS to determine the
19 presence of and possible impacts on any ESA-listed aquatic species. Guidance for the ESA
20 consultation process is provided in the *Endangered Species Consultation Handbook* (USFWS
21 and NMFS 1998). The NRC should also contact the NMFS for license renewal applications for
22 plants located in areas that may contain EFH for Federally managed marine or anadromous
23 fisheries or for plants that may have an effect on protected marine mammals. In addition, the
24 appropriate State agencies should be contacted to determine the potential for State-listed
25 species to be affected by continued operations and refurbishment activities during the license
26 renewal term. Subsequent consultation could be required for specific maintenance or
27 refurbishment activities undertaken at a plant during the license renewal term.

28
29 Site-specific factors related to operations and refurbishment varies widely among nuclear power
30 plants. The special status aquatic species and habitats in the vicinity of nuclear power plants
31 and their transmission lines also vary widely, depending on numerous factors such as the plant
32 location and habitat types present (see Section 3.6.3.2). In addition, the lists of special status
33 species and habitats are not static and are frequently modified by the USFWS, NMFS, and
34 State agencies, with new listings being added as some species are determined to be eligible,
35 other species being delisted (removed from the list), or the listing category of some species
36 being changed because of changes in the status of or threats to the species population. EFH
37 designations and status also can change through time. Therefore, a generic determination of
38 potential impacts on species and habitats during a nuclear power plant's license renewal term is
39 not possible. Impacts on special status species and habitats would depend on site-specific
40 factors, and impact assessments would need to be conducted on a site-specific basis in the
41 plant-specific SEISs prepared for license renewal applications.

Environmental Consequences and Mitigating Actions

1
2 On the basis of these considerations, the NRC concludes that the impact of continued
3 operations and refurbishment activities on threatened, endangered, and protected species and
4 habitats could be small, moderate, or large, depending on plant-specific design and operating
5 characteristics, environmental review procedures established for ground-disturbing activities,
6 the occurrence of species and habitats, and other site-specific considerations. This issue is a
7 plant-specific, or Category 2 issue.

8 9 **4.6.2 Environmental Consequences of Alternatives to the Proposed Action**

10
11 *Construction* – Ecological impacts are site-dependent. Impacts would depend on the location of
12 proposed facilities, the size of the area affected, and the specific ecological characteristics of
13 the area to be developed. Vegetation would be removed from construction and material
14 storage areas, and along utility pathways. Some disturbed areas would be re-vegetated after
15 plant construction. Native vegetation could be displaced by invasive species in areas disturbed
16 by construction. Some areas near access roads may be affected by the release of fugitive
17 dust.

18
19 Construction-related noise could disturb wildlife. Permanent habitat loss could occur for some
20 species. Despite reclamation efforts, a certain amount of natural habitat at greenfield sites could
21 be permanently lost. Industrial development at brownfield and existing nuclear power plant
22 sites have already affected or altered the natural habitat.

23
24 *Operations* – Various impacts on ecological resources can be anticipated throughout the
25 operating period of an electrical power plant. Impacts include fugitive dust; impingement and
26 entrainment of fish and other aquatic organisms; heated effluent from cooling water discharge
27 and blowdown; gasifier and boiler blowdowns; steam water treatment; cooling tower drift
28 (fogging and ice); salt deposition; maintenance of transmission line ROWs; bird collisions; and
29 wildlife avoidance behavior due to operational activities and noise. Aquatic ecosystems would
30 be affected by cooling water discharge, steam-cycle blowdown, and other (NPDES-permitted)
31 wastewater. Onsite maintenance, accumulation of contaminants in sediment or biota, changes
32 in levels of dissolved oxygen in surface water, dredging, and possible deposition of
33 radionuclides would also impact aquatic resources.

34 35 **4.6.2.1 Fossil Energy Alternatives**

36
37 *Operations* – Operational impacts include acid precipitation. EPA estimates acid emission rates
38 from coal-fired power plants could range from: IGCC, 0.004 to 0.30 lb/ MWh; subcritical PC,
39 0.018 to 0.088 lb/MWh; supercritical PC, 0.017 to 0.082 lb/ MWh; ultra-supercritical PC, 0.015
40 to 0.074 lb/MWh.

1 **4.6.2.2 Renewable Alternatives**

2
3 *Construction* – Dams and reservoirs would alter river flow and temperature, which could affect
4 aquatic and terrestrial resources downstream. Dams create a barrier to fish migration if fish
5 passages are not installed. Aquatic and terrestrial resources would have to adapt to the newly
6 created reservoir. Disruptions to the sea bottom for installation of power and communication
7 cables would affect benthic populations and other species that rely on benthic organisms for
8 food. Unique ecological impacts could result from construction of offshore facilities from boat
9 traffic to and from the construction site. Other impacts include underwater noise, alteration of
10 sediment transport and deposition patterns, and possible disruption of onshore and nearshore
11 nesting areas.

12
13 *Operations* – The operational impacts of alternative energy technologies on terrestrial and
14 aquatic ecology are presented in the following subsections.

15
16 **Hydroelectric Energy Sources**

17
18 Downstream conditions could be affected by dam operations (store-and-release of water) that
19 could vary river flow conditions. Aquatic and terrestrial resources would be affected by
20 fluctuating water levels downstream of the dam. Aquatic organisms could become stranded
21 temporarily when river levels are lowered. Temperature and nutrient stratification in the
22 reservoir and reduced levels of dissolved oxygen could result in hypoxic or anoxic conditions
23 for aquatic organisms. Aquatic and riparian ecosystems downstream would be affected by a
24 variety of dam-induced conditions, such as changes in sediment transport and deposition
25 patterns, and channel erosion or scouring. Hydropower operations could enhance populations
26 of nonnative aquatic biota and riparian plants.

27
28 **Geothermal**

29
30 Birds and bats could be affected by contact with geothermal fluids temporarily stored in surface
31 impoundments.

32
33 **Wind**

34
35 Aerodynamic and mechanical noise from wind turbines would affect wildlife. Collisions with
36 wind turbines would increase bird and bat mortality. However technological advances allow
37 rotors to turn at lower speeds, thus reducing the potential for bird and bat strikes. Underwater
38 noise impacts from offshore facilities would extend to great distances due to the density of
39 water. Offshore facilities could impact threatened and endangered species, marine mammals,
40 birds, or sea turtles. Other impacts include disturbance of nesting areas, alteration of key
41 habitat, underwater noise, or fuel spills.

Environmental Consequences and Mitigating Actions

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40

Biomass

Habitat loss could occur from the cultivation of energy crops. Deposition of toxic constituents from municipal solid waste feedstock could affect aquatic and terrestrial ecosystems.

Solar Thermal and Photovoltaic

Synthetic organic heat transfer fluids could affect surrounding vegetation. Misalignment of mirrors could also increase fire risk.

Ocean Wave and Current

Boat traffic, noise, navigation safety lights, inspection and maintenance activities could affect marine mammals, fish, and sea turtles. Sea turtles could be affected by wave-topping devices. Onshore nesting areas could be affected. Fish, sea turtles, and marine mammals could collide with underwater turbines.

4.7 Historic and Cultural Resources

4.7.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment

Historic and cultural resources include archaeological sites, historic structures, and traditional cultural properties. Continued operations and refurbishment activities at a nuclear power plant during the license renewal term can affect historic and cultural resources through (1) ground-disturbing activities associated with plant operations, supporting activities (e.g., new parking lots or buildings), major refurbishment actions, landscaping, or recreational use of plant property and (2) activities associated with transmission line maintenance (e.g., maintenance of access roads or removal of danger trees).

The area of potential effect for license renewal is generally considered to be the area at the power plant site and its immediate environs that may be affected by continued operations and refurbishment activities. The area of potential effect may extend beyond the immediate environs in those instances where continued operations and refurbishment activities could affect known and unknown historic and cultural resources. This determination is made irrespective of ownership or control of the lands of interest.

1 The historic and cultural resources present at each site can be quite different and can be
2 assessed only at a plant-specific level. However, some factors related to license renewal can
3 be discussed generically. Most plant sites have not been examined for the presence of historic
4 and cultural resources. As discussed in Section 3.7, there was the potential for historic and
5 cultural resources to be present at most sites prior to construction. However, much of the land
6 immediately surrounding the power block was disturbed down to bedrock at the time of
7 construction. This construction would have eliminated any potential for historic and cultural
8 resources to be present in portions of the plant site. A review of past plant activities conducted
9 by cultural resource professionals and approved by the appropriate State Historic Preservation
10 Office (SHPO) would identify areas that have the potential to contain historic and cultural
11 resources.

12
13 The National Historic Preservation Act of 1966 (NHPA) requires consideration of project impacts
14 on “significant” historic and cultural resources only. Significance is determined through an
15 evaluation by a cultural resource professional, as discussed in Section 3.7. Only through
16 consultation with the SHPO and the NRC could the appropriate mitigation of impacts be
17 determined for the resources being impacted.

18
19 Only one impact issue is evaluated:

- 20
21 • Impact of continued operations and refurbishment activities on historic and cultural
22 resources located onsite and in transmission line rights-of-way.

23
24 This issue was addressed in the 1996 GEIS; however, some changes to the process for
25 considering historic and cultural resources have been made, and the range of historic and
26 cultural resources has been expanded to include traditional cultural properties.

27
28 *Impact of Continued Operations and Refurbishment on Historic and Cultural Resources*

29
30 Most nuclear plant sites were not investigated for the presence of historic and cultural
31 resources prior to construction; therefore, most licensees are not aware of the occurrence or
32 status of historic and cultural resources on their site. Archaeological sites are generally
33 identifiable only through field investigations and are expected to be the most common resource
34 present. Historic era cultural resources are more easily identifiable without field investigations.
35 In some cases, the power plant may be considered a historic resource that is eligible for listing
36 on the *National Register of Historic Places (National Register)* for its design or engineering and
37 would require consideration under the NHPA. Traditional cultural properties are generally
38 identifiable only through consultation. Although it is unlikely that any traditional cultural
39 properties would be known at existing plants, there is the potential for these resources to be
40 present at nuclear power plants.

41

Environmental Consequences and Mitigating Actions

1 Activities associated with continued operations of a nuclear power plant have the potential to
2 affect historic and cultural resources if present. The activities associated with plant operations
3 would need to be reviewed on a plant-specific basis to determine if they could affect historic and
4 cultural resources. Some operational activities, construction projects, refurbishment actions,
5 landscaping activities, and recreational activities have the potential to disturb the ground
6 surface. Ground-surface disturbance can result in the alteration of historic and cultural
7 resources. These activities could include, but are not limited to, grading an area for use,
8 excavating soil to be used in landscaping or filling, driving large vehicles over undisturbed
9 areas, or making new agricultural use of previously undisturbed portions of the site. All of these
10 activities can damage or move artifacts.

11
12 The consideration of an undertaking's effect on historic and cultural resources applies only to
13 Federal actions. The Federal undertaking considered in this document is license renewal. It is
14 acknowledged that plant operations could affect significant historic and cultural resources.
15 Some support activities that take place after renewal are not necessarily reviewed by the NRC
16 and are not considered individual undertakings. Under Section 106 of the NHPA, the NRC
17 must take into account the effect of the undertaking on any historic and cultural resources
18 included in or eligible for inclusion in the *National Register*. Therefore, to assess the impact of
19 continued operations on these resources, all historic and cultural resources that could be
20 affected must be known at the time of license renewal. To achieve this objective, field
21 investigations should be performed on the entire plant site. The eligibility of a historic and
22 cultural resource for listing on the *National Register* should be determined, and a process for
23 considering these resources should be developed before renewing the license.

24
25 Many nuclear power plant sites have environmental review procedures that aid in ensuring that
26 no known or unknown historic or cultural resources are affected by a project or activity.
27 Procedures that incorporate the process identified in Section 106 of the NHPA would provide
28 the greatest protection to the resource. The Section 106 process begins with consultation with
29 the SHPO and Federally recognized Native American Tribes. The Section 106 process also
30 includes determining if any historic and cultural resources that are over 50 years in age are
31 present in the area of potential effects through field identification, document reviews, and
32 consultation with Federally recognized Native American Tribes. If a historic or cultural resource
33 that is eligible for the *National Register* is present, a determination of adverse or no adverse
34 effect would be developed in consultation with the SHPO for the action as well as any
35 necessary mitigation.

36
37 Most transmission line ROWs were not surveyed prior to construction; therefore, the location of
38 historic and cultural resources along the lines is generally not known. Of the three types of
39 historic and cultural resources (historic structures, archaeological resources, and traditional
40 cultural properties), archaeological resources have the greatest potential to remain within
41 transmission line ROWs. It is unlikely that any historic-era structures would remain within the

1 ROW, and traditional cultural properties are generally identifiable only through consultation.
2 Most maintenance activities would not affect historic and cultural resources within a
3 transmission line ROW. Activities such as mowing or spreading herbicides would not be
4 expected to affect most historic and cultural resources. Only activities that could result in
5 ground disturbance or erosion would be of concern. These activities would include the removal
6 of danger trees and improvement of access roads.
7

8 Section 106 of the NHPA applies only to undertakings in the transmission ROW in which there
9 is Federal involvement. For license renewal, this would only apply to those transmission lines
10 that are currently needed to connect the power plant to the regional electrical distribution grid
11 because these are the only lines whose existence is dependent on license renewal. Potential
12 effects on historic and cultural resources within the transmission line ROWs associated with the
13 nuclear plants are considered only during license renewal by the NRC. Some activities that
14 take place along the transmission lines have the potential to affect historic and cultural
15 resources. For activities connected to license renewal, the resources in the transmission line
16 ROWs must be identified. The means for considering the effects of transmission line
17 maintenance on these resources should be determined before renewal of the license.
18

19 Transmission line maintenance plans are developed and followed by power line companies.
20 These plans could address the appropriate treatment of historic and cultural resources within
21 the ROW. Incorporation of the procedures identified in Section 106 of the NHPA would provide
22 the greatest protection for cultural resources. These procedures could include a process for
23 addressing unexpected discovery of historic and cultural resources in the ROW. If a historic or
24 cultural resource was affected by maintenance activities, the appropriate mitigation would be
25 developed in consultation with the SHPO.
26

27 Most plant-specific SEISs have reviewed impacts associated with transmission line ROW
28 maintenance activities. In the 1996 GEIS, the NRC considered the impact of continued
29 operations and refurbishment on historic and cultural resources at the plants and concluded
30 that it would not be the same at all plants (i.e., a Category 2 issue) and could range from small
31 to large. No new information has been identified that would alter this conclusion.
32

33 On the basis of these considerations, the NRC concludes that the impact of continued
34 operations and refurbishment activities on onsite historic and cultural resources could be small,
35 moderate, or large, depending on the nature and type of the resources at a site and remains a
36 Category 2 issue.
37

38 **4.7.2 Environmental Consequences of Alternatives to the Proposed Action**

39

40 *Construction* – Before constructing a new power plant at a greenfield, brownfield, or existing
41 nuclear power plant site, a cultural resource inventory would need to be performed for any

Environmental Consequences and Mitigating Actions

1 property that has not been previously surveyed. Any land acquired to support the power plant
2 would also need to be surveyed for cultural resources, as well as identification and recording
3 existing historic and cultural resources. Studies would be needed for all areas of potential
4 disturbance at the proposed power plant site and along associated corridors where new
5 construction would occur (e.g., roads, transmission corridors, rail lines, or other ROWs).
6

7 *Operation* – Activities associated with power plant operations have the potential to affect historic
8 and cultural resources if present. Some operational activities, construction projects,
9 landscaping activities, and recreational activities have the potential to disturb the ground
10 surface. Ground disturbance can adversely affect historic and cultural resources. These
11 activities could include, but are not limited to, grading an area for use, excavating soil to be
12 used in landscaping or filling, driving large vehicles over undisturbed areas, or making use of
13 previously undisturbed portions of the site. All of these activities can damage or move artifacts.
14

15 **4.7.2.1 Renewable Alternatives**

16
17 *Operations* – The operational impacts of alternative energy technologies on historic and cultural
18 resources are presented in the following subsections.
19

20 **Hydroelectric Energy Sources**

21
22 Fluctuations of river flow could erode embankments affecting downstream historic and cultural
23 resources.
24

25 **Wind**

26
27 Historic and cultural resources would be affected by the presence of wind turbines in the
28 viewshed.
29

30 **Ocean Wave and Current**

31
32 Historic and cultural resources located offshore could be affected by kinetic energy by ocean
33 wave and/or current-energy-capturing devices.
34
35

4.8 Socioeconomics

4.8.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities

This section describes the socioeconomic impacts associated with the continued operation and refurbishment of nuclear power plants. Regional socioeconomic conditions have already been affected by the construction and initial operation of the plant. The socioeconomic impact of plant operations is ongoing and has become well established during the current licensing term for all nuclear power plants.

The number of jobs created by license renewal and refurbishment activities at a nuclear power plant can have an effect on socioeconomic conditions in the region around each plant. Job creation can be differentiated by two types: (1) refurbishment/construction-related jobs, which are transient in nature, short in duration, and less likely to have a lasting impact on community services; and (2) operations-related jobs, which tend to be more stable, longer in duration, and more likely to have a permanent impact on community services. Because of the relatively short duration of refurbishment activities, construction workers generally seek temporary/rental housing and require a limited range of goods and services from the community. Operations workers relocating to the region for long-term employment require more permanent housing and a full range of goods and services from the community.

A review of license renewal applications received by the NRC since the 1996 GEIS has shown little or no need to increase the number of workers at a nuclear power plant during the license renewal term. In addition, refurbishment activities, such as steam generator and vessel head replacement, have not required the large numbers of workers and months of time that was conservatively estimated in the 1996 GEIS. Therefore, license renewal is not likely to affect socioeconomic conditions in the vicinity of a nuclear power plant beyond what is currently being experienced, and any impacts from refurbishment activities would be similar to what has been experienced during regularly scheduled plant refueling and maintenance outages.

The analysis presented in this section considers five socioeconomic impact issues including the original impact issues addressed in the 1996 GEIS. The impacts of refurbishment are also included. The five issues are:

- Impacts on employment and income, recreation and tourism (impacts on employment and income were not addressed in the 1996 GEIS). Also included in this issue are the impacts on recreation and tourism (impacts on tourism and recreation were addressed in the 1996 GEIS as part of the impact on “Public services: public safety, social services, and tourism and recreation”);

Environmental Consequences and Mitigating Actions

- Impacts on tax revenue (considered in the 1996 GEIS, but not identified as an issue in Table B-1);
- Impacts on community services and education (impacts on “Public services: public safety, social services...”; “Public services: public utilities”; “Public services, education (license renewal term)”; “Public services, education (refurbishment)” were considered as separate impact issues in the 1996 GEIS. All but “Public services: ...tourism and recreation” are considered in this combined issue);
- Impacts on population and housing (both impacts were considered in the 1996 GEIS, although population impacts was not identified as an issue in Table B-1); and
- Impacts on local transportation (considered in the 1996 GEIS as part of the impact on “Public services, Transportation”).

Impacts on Employment and Income, Recreation and Tourism

A nuclear power plant creates employment and income opportunities in the communities around it. Consequently, the plant and the people and communities surrounding it can be described as a dynamic socioeconomic system. A power plant needs people, goods, and services from the communities to operate the plant and generate electric power; and the communities, in turn, benefit from the electrical power and provide the people, goods, and services to run the plant. Plant employees residing in the community receive income from the plant in the form of wages, salaries, and benefits. Employees and their families, in turn, spend this income on goods and services within the community thereby creating additional opportunities for employment and income. In addition, people and businesses in the community receive income for the goods and services sold to the power plant. Payments for these goods and services create additional employment and income opportunities in the community. The measure of a communities' ability to support the operational demands of a power plant depends on the ability of the community to respond to changing socioeconomic conditions.

As previously discussed, it is unlikely that the number of permanent operations workers would increase at a nuclear power plant during the license renewal term. While it was estimated in the 1996 GEIS that up to 60 additional workers per unit could be required during the license renewal term, subsequent environmental reviews have shown little or no need for additional operations workers. In addition, refurbishment activities, such as steam generator and vessel head replacement, have not required the numbers of workers and the months of time conservatively estimated in the 1996 GEIS. Consequently, employment levels at a nuclear power plant are not expected to change as a result of license renewal.

1 Some communities also experience seasonal transient population growth associated with local
2 regional tourism and recreational activities. Income from these activities creates additional
3 employment and income opportunities in the regions around nuclear power plants. Nuclear
4 power plants located in coastal regions, notably Pilgrim located near Plymouth and Cape Cod,
5 Massachusetts; the D.C. Cook and Palisades plants on the eastern shore of Lake Michigan and
6 the Oyster Creek plant on the New Jersey shore north of Atlantic City, have summer, weekend,
7 and retirement populations and a range of recreational and environmental amenities that attract
8 visitors. Some areas, such as the region around the Vermont Yankee plant in Vermont, attract
9 visitors interested in outdoor recreational activities, such as camping, hiking, and skiing.

10
11 As discussed in Section 4.2.1.2, the NRC considered the impacts of continued plant operations
12 during the license renewal term and refurbishment on visual resources in the 1996 GEIS, which
13 could affect tourism and recreational business interests. The NRC concluded in the 1996 GEIS
14 that the impacts on visual resources would be small for all plants and was a Category 1 issue,
15 primarily because the impact had already occurred and the visual profile of nuclear power
16 plants were not expected to change as a result of license renewal. Also, visual impacts tend to
17 wear off over time when viewed repeatedly.

18
19 However, a case study performed for the 1996 GEIS found situations where nuclear power
20 plants have had a negative effect on visual resources. Negative perceptions were based on
21 aesthetic considerations (for instance, the plant is out of character or scale with the community
22 or the viewshed), physical environmental concerns, safety and perceived risk issues, an anti-
23 plant (or utility) attitude, or an anti-nuclear orientation. It is believed that some of these
24 negative perceptions would persist regardless of mitigation measures. Subsequent license
25 renewal reviews have not revealed any new information that would change this perception.

26
27 Nevertheless, the effects of nuclear power plant operations on employment and income,
28 tourism and recreation are ongoing and have become well established during the current
29 licensing term for all nuclear plants. The impacts from plant operations in support of license
30 renewal and during the license renewal term on employment and income in the region around
31 each nuclear power plant would be no different from what is currently being experienced. In
32 addition, tourism and recreational activities in the vicinity of nuclear plants are not expected to
33 change as a result of license renewal. On the basis of these considerations, the NRC
34 concludes that the impact of continued nuclear plant operations and refurbishment activities on
35 employment and income, recreation and tourism would be small and is therefore considered a
36 Category 1 issue.

37 38 *Impacts on Tax Revenues*

39
40 Operating nuclear power plants are an important source of tax revenue for many local
41 governments and public school systems. Tax revenue from power plants generally comes from

Environmental Consequences and Mitigating Actions

1 property tax payments or other forms of payments such as payments in lieu of (property) taxes
2 (PILOT) levied on the utility, although taxes on energy production have also been collected from
3 a number of nuclear power plants. County and municipal governments and local public school
4 districts receive tax revenue either directly or indirectly through state tax and revenue-sharing
5 programs.
6

7 Counties and municipal governments in the vicinity of a nuclear power plant also receive
8 revenue from sales taxes and fees paid by the power plant and its employees. Changes in the
9 number of workers and the amount of taxes paid to county, municipal governments, and public
10 schools can affect socioeconomic conditions in the counties around the nuclear plant.
11

12 A review of license renewal applications received by the NRC since the 1996 GEIS has shown
13 that refurbishment activities, such as steam generator and vessel head replacement, have not
14 had a noticeable affect on the assessed value of nuclear plants, thus changes in tax revenues
15 are not anticipated from future refurbishment activities. Refurbishment activities involving the
16 one-for-one replacement of existing components and equipment are generally not considered a
17 taxable improvement. Also, property tax assessments; proprietary payments in lieu of tax
18 stipulations, settlements, and agreements; and state tax laws are continually changing the
19 amount of taxes paid to taxing jurisdictions by nuclear plant owners. These changes are
20 independent of license renewal and refurbishment activities.
21

22 The primary impact of license renewal would be the continuation or change in the amount of
23 taxes paid by nuclear power plant owners to local governments and public school systems. The
24 impact of nuclear plant operations on tax revenues in local communities and the impact that the
25 expenditure of tax revenues has on the region are not expected to change appreciably from the
26 amount of taxes paid during the current license term. Tax payments during the license renewal
27 term would be similar to those currently being paid by each nuclear plant. On the basis of these
28 considerations, the NRC concludes that the impact of continued nuclear plant operations and
29 refurbishment on tax revenue would be small and is therefore considered a Category 1 issue.
30

31 *Impacts on Community Services and Education*

32

33 In the 1996 GEIS, impacts on public (community) services and education were determined
34 based on the projected number of "in-migrating" workers accompanied by their families. In
35 addition, impacts on "Public services: public safety, social services..."; "Public services: public
36 utilities"; "Public services, education (license renewal term)"; "Public services, education
37 (refurbishment)" were considered as separate impact issues in the 1996 GEIS. All but "Public
38 services: ...tourism and recreation" are considered in this combined issue.
39

40 The four 1996 GEIS issues are combined because all public services are equally affected by
41 changes in plant operations and refurbishment activities at nuclear plants. Any changes in the

1 number of workers at a nuclear plant will affect the demand for public services from local
2 communities. Environmental reviews conducted by NRC since the 1996 GEIS have shown,
3 however, that the number of workers at relicensed nuclear plants has not changed significantly
4 because of license renewal, so demand-related impacts on community services, including
5 public utilities, are no longer anticipated from future license renewals.
6

7 In addition, refurbishment activities, such as steam generator and vessel head replacement,
8 have not required the large numbers of workers and the months of time that was conservatively
9 analyzed in the 1996 GEIS, so significant impacts on community services are no longer
10 anticipated. Because of the relatively short duration of refurbishment-related activities, workers
11 are not expected to bring families and school-age children with them; therefore, impacts from
12 refurbishment on educational services are also no longer anticipated.
13

14 Taxes paid by nuclear power plant owners support a range of community services, including
15 public water, safety, fire protection, health, and judicial, social, and educational services. In
16 some communities, tax revenues from power plants can have a noticeable impact on the quality
17 of services available to local residents. Although many of the community services paid for by
18 tax revenues from power plants are used by plant workers and their families, the impact of
19 nuclear plant operations on the availability and quality of community services and education is
20 small and is not expected to change as a result of license renewal. On the basis of these
21 considerations, the NRC concludes that the impact of continued nuclear plant operations and
22 refurbishment activities on community services and education would be small and is therefore
23 considered a Category 1 issue.
24

25 *Impacts on Population and Housing*

26

27 Socioeconomic impact analyses of resources (e.g., housing) affected by changes in regional
28 population are based on employment trends at nuclear power plants. Population growth from
29 increased employment and spending at a nuclear power plant is important because it is one of
30 the main drivers of socioeconomic impacts. Plant-induced population growth, while not an
31 impact itself, was studied as a potential influence on a number of impact issues analyzed in the
32 1996 GEIS. As previously discussed, however, employment levels at nuclear power plants are
33 expected to remain relatively constant with little or no population growth or increased demand
34 for permanent housing during the license renewal term. The operational effects on population
35 and housing values and availability in the vicinity of nuclear power plants are not expected to
36 change from what is currently being experienced, and no demand-related impacts are expected
37 during the license renewal term.
38

39 The increased number of workers at nuclear power plants during regularly scheduled plant
40 refueling and maintenance outages does create a short-term increase in the demand for
41 temporary (rental) housing units in the region around each plant. However, because of the

Environmental Consequences and Mitigating Actions

1 short duration and the repeated nature of these scheduled outages and the general availability
2 of rental housing units (including portable trailers) in the vicinity of nuclear power plants,
3 employment-related housing impacts have had little or no long-term impact on the price and
4 availability of rental housing. Refurbishment impacts would be similar to what is experienced
5 during routine plant refueling and maintenance outages.
6

7 License renewal reviews conducted since the 1996 GEIS have shown that housing has not
8 been an issue at relicensed nuclear plants including those plants located in “sparsely populated
9 areas.” Therefore, impacts to these resources are no longer anticipated from future license
10 renewals. On the basis of these considerations, the NRC concludes that the impact of
11 continued nuclear plant operations and refurbishment activities on population and housing
12 would be small and is therefore considered a Category 1 issue.
13

14 *Impacts on Local Transportation*

15

16 Transportation impacts depend on the size of the workforce, the capacity of the local road
17 network, traffic patterns, and the availability of alternate commuting routes to and from the
18 plant. Because most sites have only a single access road, there is often congestion on these
19 roads during shift changes.
20

21 Nevertheless, license renewal is not likely to affect local transportation conditions in the vicinity
22 of a nuclear power plant beyond what is currently being experienced. Transportation impacts
23 are ongoing and have become well established during the current licensing term for all nuclear
24 power plants. As previously discussed, it is unlikely that the number of permanent operations
25 workers would increase at a nuclear power plant during the license renewal term. While it was
26 estimated in the 1996 GEIS that up to 60 additional workers per unit could be required during
27 the license renewal term, subsequent environmental reviews have shown little or no need for
28 additional operations workers. In addition, refurbishment activities, such as steam generator
29 and vessel head replacement, have not required the numbers of workers and the months of
30 time conservatively estimated in the 1996 GEIS. Consequently, employment at nuclear power
31 plants during the license renewal term is expected to remain unchanged. Refurbishment
32 impacts would be similar to what has been experienced during routine plant refueling and
33 maintenance outages.
34

35 The increased number of workers at nuclear power plants during regularly scheduled plant
36 refueling and maintenance outages have caused short-term increases in traffic volumes on
37 roads in the vicinity of each plant. However, because of the relative short duration of these
38 outages, increased traffic volumes have had little or no lasting impact. Therefore, there would
39 be no transportation impacts during the license renewal term beyond those already being
40 experienced. On the basis of these considerations, the NRC concludes that the impact of

1 continued operations and refurbishment activities on local transportation would be small and is
2 therefore considered a Category 1 issue.

3 4 **4.8.2 Environmental Consequences of Alternatives to the Proposed Action**

5
6 *Construction* – The scale of the socioeconomic impacts would be related to the complexity of
7 the facility and the size of the workforce. The duration of the impact would be determined by the
8 time required to complete construction. Socioeconomic impacts may be more dramatic and
9 disproportionately larger at greenfield sites located in rural areas. Overall, construction is
10 expected to have a temporary effect on the local economy.

11
12 Most construction workers would be local. However, additional workers may be required from
13 outside the immediate area. Because construction is temporary, most of the workforce would
14 likely commute to the job site rather than relocate. Construction is likely to have limited impacts
15 on most local services such as public utilities, public safety, tourism, and recreation. Materials
16 needed for construction (e.g., sand, gravel, fill, etc.) are expected to be provided locally.
17 However, the majority of construction materials and technology components are expected to be
18 imported. Transportation impacts during construction would include commuter and truck
19 material and equipment delivery traffic to and from the construction site.

20
21 *Operation* – A new power plant would have an ongoing effect on the local economy. The
22 operational workforce would increase demand for social services. Impacts on socioeconomics
23 would depend on site location. Property values for nearby private residences could be affected.

24
25 Impacts may be greater on communities in rural areas. Local economies have the potential to
26 be directly or indirectly affected by changes in power plant operations. The power plant and the
27 communities that support it can be described as a dynamic socioeconomic system. The
28 communities provide the people, goods, and services required by power plant operations. Plant
29 operations, in turn, create the demand and pay for the people, goods, and services in the form
30 of wages, salaries, and benefits for jobs and dollar expenditures for goods and services. The
31 measure of the communities' ability to support the demands of the power plant depends on their
32 ability to respond to changing environmental, social, economic, and demographic conditions.
33 Transportation impacts include increased commuter traffic during shift changes and deliveries
34 of materials and equipment to the power plant.

35 36 **4.8.2.1 Fossil Fuel Alternatives**

37
38 *Operation* – Impacts would include transportation impacts associated with coal deliveries to the
39 power plant (primarily by rail) and the removal of wastes and by-products.

Environmental Consequences and Mitigating Actions

1 **4.8.2.2 New Nuclear Alternatives**

2

3 *Operation* – The existence of the nuclear power plant could have a negative effect on recreation
4 and tourism.

5

6 **4.8.2.3 Renewable Alternatives**

7

8 *Operations* – The operational impacts of alternative energy technologies on socioeconomics are
9 presented in the following subsections. A small workforce would be required to operate
10 alternative technology power plants.

11

12 **Hydroelectric Energy Sources**

13

14 The reservoir would create recreational opportunities including construction of parks,
15 campgrounds, and boat ramps. Traffic in the vicinity of the dam could increase as a result of
16 recreational opportunities created by the reservoir.

17

18 **Geothermal**

19

20 Recreation in the area could be adversely affected by noise, sites, and odors from plant
21 operations.

22

23 **Wind**

24

25 Recreation may be adversely affected by the visual impact of the wind turbines. Transportation
26 impacts are expected to be limited. Large vehicles could be required for the replacement of
27 equipment.

28

29 **Biomass**

30

31 Increased truck and rail traffic bringing biomass fuel to the facility and removing solid wastes to
32 offsite disposal facilities could impact local transportation.

33

34 **Ocean Wave and Current**

35

36 Some tourists and recreational users on coastal beaches could be affected by the sight and
37 sound (helicopter and boat traffic). Wave energy devices that float on the ocean surface could
38 affect navigation.

1
2
3 **4.9 Human Health**
4

5 **4.9.1 Environmental Consequences of the Proposed Action – Continued**
6 **Operations and Refurbishment Activities**
7

8 Human health conditions at all nuclear power plants and associated transmission lines have
9 been well established during the current licensing term. These conditions are expected to
10 remain unchanged during the 20-year license renewal term.
11

12 **4.9.1.1 Environmental Consequences of Normal Operating Conditions**
13

14 This section provides an evaluation of the impacts of radiological, chemical, microbiological,
15 EMFs, and other hazards on occupational personnel and members of the public from continued
16 operation and refurbishment activities during the license renewal term. This evaluation extends
17 to all U.S. commercial nuclear power reactors. For safe and reliable operation of a nuclear
18 power plant, it is necessary to perform routine maintenance on plant systems and components.
19 Maintenance activities conducted at nuclear power plants include inspection, surveillance, and
20 repair and/or replacement of material and equipment to maintain the current licensing basis of
21 the plant and ensure compliance with environmental and public safety requirements. Certain
22 activities can be performed while the reactor is operating, and others require that the reactor be
23 shut down. Long-term outages are scheduled for refueling and for certain types of repairs or
24 maintenance activities, such as the replacement of steam generators for PWRs.
25

26 Radiological Impacts
27

28 Two environmental issues related to radiological exposure and risk are reviewed here:
29 (1) occupational radiological exposure and (2) radiological exposure to the public, both of which
30 would result from continued operation and refurbishment activities during the license renewal
31 term. These issues were evaluated in the 1996 GEIS, but the impacts of refurbishment were
32 considered separately from those of operations.
33

34 For the purposes of assessing radiological impacts, impacts are considered to be “small” if
35 releases and doses do not exceed permissible levels in the NRC’s regulations. This definition of
36 “small” applies to occupational doses as well as to doses to individual members of the public.
37 Accidental releases or noncompliance with the standards could conceivably result in releases
38 that would cause moderate or large radiological impacts. Such conditions are beyond the
39 scope of regulations for controlling normal operations and providing an adequate level of
40

Environmental Consequences and Mitigating Actions

1 protection. Environmental consequences and human health effects of potential accidents are
2 addressed in Section 4.9.1.2.

3 4 *Occupational Radiological Exposure*

5
6 The occupational radiological exposures from current operations at nuclear power plants are
7 discussed in Section 3.9.1.2, and the risk estimates from this radiation exposure are discussed
8 in Section 3.9.1.4.

9
10 In the 1996 GEIS, the impacts from occupational radiological exposure from refurbishment and
11 continued operations were evaluated separately. To estimate radiation-related impacts on
12 workers over the license renewal term, occupational radiation exposure was used as the
13 environmental impact initiator that was quantified. It was assumed that occupational radiation
14 exposure would change relative to current nuclear plant operations as a result of actions taken
15 to support license renewal. To evaluate the impacts, two types of license renewal programs
16 were considered: a “typical” or “mid-stream” license renewal program, and a “conservative” or
17 “bounding” program (NRC 1996). Each program applied to both PWRs and BWRs. Thus, in all,
18 four scenarios were considered. It was assumed that activities carried out in support of license
19 renewal would be performed primarily during selected outages. Five types of outages were
20 considered: normal refuelings, 5-year in-service inspection (ISI) outages, 10-year ISI outages,
21 current-term refurbishment outages, and major refurbishment outages. The potential actions
22 and activities that would be undertaken during these outages were identified. All of the rules
23 and regulations, in particular, the Maintenance Rule (10 CFR 50.65, *Requirements for*
24 *Monitoring the Effectiveness of Maintenance at Nuclear Power Plants*), were taken into account
25 in developing typical license renewal or plant-life extension (NRC 1996). The occupational
26 exposure for each of the five types of outages was estimated for all four scenarios
27 (see Table 4.9.1.1–1).

28
29 For refurbishment efforts, dose estimates for activities during each of the four current-term
30 refurbishment outages were 11 and 10 person-rem for PWRs and BWRs, respectively, for the
31 typical case; and 200 and 191 person-rem, respectively, for the conservative case. Dose
32 estimates for the assumed single period of major refurbishment were 79 and 153 person-rem for
33 PWRs and BWRs, respectively, for the typical case; and 1380 and 1561 person-rem,
34 respectively, for the conservative case. The issue was designated as a Category 1 issue in the
35 1996 GEIS.

Table 4.9.1.1–1. Additional Collective Occupational Dose (person-rem) for Different Actions Under Typical and Conservative Scenarios During the License Renewal Term

Outage Type	Typical BWR	Conservative BWR	Typical PWR	Conservative PWR
Normal refueling ^(a)	4	10	3	7
5-yr ISI ^(b) refueling ^(c)	71	27	30	35
10-yr ISI refueling ^(d)	91	108	51	66
Current-term refurbishment ^(e)	10	191	11	200
Major refurbishment outage ^(f)	153	1561	79	1380
Total all occurrences	457	2666	261	2374

(a) 8 occurrences, 2-month duration each.

(b) ISI = in service inspection.

(c) 2 occurrences, 3-month duration each.

(d) 1 occurrence, 4-month duration for conservative and 3-month duration for typical scenario.

(e) 4 occurrences, 4-month duration for conservative and 3-month duration for typical scenario.

(f) 1 occurrence, 9-month for conservative and 4-month duration for typical scenario.

Source: Tables 2.8 and 2.11 in the 1996 GEIS.

1
 2 For continued operations during the license renewal term, the NRC observed in the 1996 GEIS
 3 that the greatest increment to occupational dose over the present dose would occur during a
 4 10-year ISI refueling. In a typical case, the occupational dose would increase over the present
 5 dose by 91 person-rem for a BWR and by 51 person-rem for a PWR. In a conservative case,
 6 the occupational dose would increase over the present dose by 108 person-rem and 66 person-
 7 rem, respectively, for BWRs and PWRs. It was noted that there is about an 8 percent increase
 8 in collective radiation dose over current operating experience. The individual occupational
 9 doses would be well below regulatory limits (i.e., the impact would be small), and the issue was
 10 designated as a Category 1 issue.

11
 12 For estimating the impacts from continued operation and refurbishment activities during the
 13 license renewal term in this GEIS revision, the occupational exposure histories for all
 14 commercial nuclear power plants were evaluated for trends.

15
 16 Throughout the nuclear power industry, modification and upgrade activities have continued at
 17 each operating plant. They have included a broad range of activities in response to NRC
 18 requirements and industry initiatives, including post-Three-Mile-Island upgrades, radioactive
 19 waste system modifications, and spent fuel storage upgrades. In addition, several nuclear
 20 power plants have undergone major refurbishment efforts, such as PWR steam generator
 21 replacement and the replacement of coolant recirculation piping in BWRs. These activities
 22 offered a significant potential for occupational exposure. Thus, occupational exposure histories

Environmental Consequences and Mitigating Actions

1 accumulated to date reflect normal operation plus modifications and additions to existing
2 systems. This information forms the basis for evaluating the occupational doses that result
3 from refurbishment and continued operations during the license renewal term. The data in
4 Tables 3.9-8 and 3.9-9 show that there are variations in occupational dose from year to year,
5 but there is no consistent trend that shows that occupational doses are increasing over time.
6

7 Since 1996, about 30 nuclear power plants have undergone an environmental review for license
8 renewal. Many nuclear power plants have already replaced major components like steam
9 generators during their current license term. Moreover, as part of the license renewal
10 application, the plants have conducted an aging management review. All of the plants expect to
11 conduct the activities related to managing impacts from aging during plant operation or normal
12 refueling and other outages, but they do not plan any outage specifically for the purpose of
13 refurbishment. The applicants have indicated that the activities conducted during the license
14 renewal term are expected to be within the bounds of normal operations; thus, even the typical
15 scenario in the 1996 GEIS can be considered conservative.
16

17 Overall, data presented in Tables 3.9-3 to 3.9-13 provide ample evidence that occupational
18 doses at all commercial power plants are far below the occupational dose limit of 5 rem/yr
19 established by 10 CFR Part 20 and that the continuing efforts to maintain doses at as low as is
20 reasonably achievable (ALARA) levels have been successful.
21

22 The wide range of annual collective doses experienced at PWRs and BWRs in the United
23 States results from a number of factors, such as the reactor design, amount of required
24 maintenance, and amount of reactor operations and in-plant surveillance. Because these
25 factors can vary widely and unpredictably, it is very difficult to determine in advance a specific
26 year-to-year annual occupational radiation dose for a particular plant throughout its operating
27 lifetime. On occasion, relatively high collective occupational doses (as compared with the
28 average annual collective dose) may be unavoidable, even at plants with radiation protection
29 programs designed to ensure that occupational doses will be kept to ALARA levels.
30

31 During 2005, with occupational radiation protection programs in place, nuclear power plants
32 maintained an annual average individual dose of 0.12 rem and 0.18 rem for PWRs and BWRs,
33 respectively (Table 3.9-11), compared with an exposure limit of 5 rem. For all nuclear power
34 plants combined, the occupational doses to individual workers are estimated to average
35 0.15 rem/yr (Table 3.9-4). At these dose levels, the average increase in fatal individual cancer
36 risk to a worker is approximately 6×10^{-5} /yr (using the ICRP risk coefficient of 4×10^{-4} /rem from
37 Table 3.9-20). If the reactor operates for 60 years, the cumulative increase in fatal cancer to an
38 individual worker is estimated to be 3.6×10^{-3} (a 50 percent increase over the baseline of
39 40 years of operations). However, it is very unlikely that the same worker would be employed
40 for all 60 years of plant operations.
41

Environmental Consequences and Mitigating Actions

1 The average collective occupational exposure for the year 2005 was roughly 171 person-rem
2 per plant at BWRs and about 79 person-rem per plant at PWRs (Table 3.9-10). For 2005,
3 50 percent of the PWRs reported collective doses between 44 and 107 person-rem, while
4 50 percent of the BWRs reported collective doses between 94 and 198 person-rem
5 (see Figure 3.9-1). For 2005, no worker received doses greater than 3 rem. Only 17 workers
6 (0.01 percent) received an occupational dose exceeding 2 rem during 2005. At BWRs, less
7 than 0.03 percent of the workers received doses greater than 2 rem. At PWRs, no worker
8 received a dose greater than 2 rem, and less than 0.3 percent of the workers received doses
9 greater than 1 rem (Table 3.9-12).

10
11 Over the years, ALARA programs continue to limit occupational doses. Occupational doses
12 have shown a declining trend over the past 10 years and have recently leveled off. As plants
13 age, there may be slight increases in radioactive inventories, which would result in slight
14 increases in occupational radiation doses, but that trend has not yet appeared.

15
16 Overall, data presented in Tables 3.9-1 to 3.9-13 provide evidence that doses to nearly all
17 radiation workers are far below the worker dose limit established by 10 CFR Part 20 and that
18 the continuing efforts to maintain doses at ALARA levels have been successful.

19
20 It is expected that occupational doses from refurbishment activities associated with license
21 renewal and occupational doses for continued operations during the license renewal term would
22 be similar to the doses during the current operations and bounded by the analysis conducted in
23 the 1996 GEIS. It is estimated that the occupational doses would be much less than the
24 regulatory dose limits, as described above. Expected occupational radiation exposures meet
25 the standard for being of small significance. No mitigation measures beyond those
26 implemented during the current license term would be warranted, because the ALARA process
27 continues to be effective in reducing radiation doses. The risks to an individual worker from
28 radiological exposure would increase by 50 percent as a result of the plant operating
29 for 20 more years, but it is unlikely that the same worker would be employed for all 60 years of
30 plant operations.

31
32 In the 1996 GEIS, the NRC concluded that the occupational radiological exposure impact
33 during license renewal and refurbishment would be small for all plants; it was therefore
34 designated as a Category 1 issue. No new information has been identified in the SEISs
35 prepared to date or the literature that would alter that conclusion. On this basis, the NRC
36 concludes that the impact of continued operations and refurbishment activities on occupational
37 radiological exposure would be small for all nuclear plants and remains a Category 1 issue.

Environmental Consequences and Mitigating Actions

1 *Radiological Exposure to the Public*

2

3 Radiological exposures to the public from current operations at nuclear power plants are
4 discussed in Section 3.9.1.3. That section includes a discussion of the effluent pathways used
5 in calculating dose and the radiological monitoring performed by each site to ensure that
6 unanticipated buildup of radioactivity have not occurred in the environment. The risk estimates
7 for the public from radiation exposure are discussed in Section 3.9.1.4.

8

9 *Refurbishment Activities* – To determine the relative significance of the estimated public dose
10 from refurbishment, the public dose during the year refurbishment activities occurred was
11 compared with the doses in consecutive years. Exposure from other ongoing support activities
12 similar to those that occurred during the current license term (e.g., construction of new parking
13 lots, access roads, and buildings) would be less than or equal to the impacts associated with
14 refurbishment.

15

16 In the 1996 GEIS, the NRC identified the replacement of steam generators at PWRs and the
17 replacement of recirculation piping at BWRs as the major anticipated refurbishment activities.
18 Public radiation exposures from refurbishment activities during the license renewal term can be
19 evaluated on the basis of information derived from past occurrences and projections for other
20 repairs. Effluents anticipated during major refurbishment actions were estimated on the basis of
21 historical information derived for steam generator replacements at PWRs and replacements of
22 recirculation piping at BWRs. These refurbishment tasks have already taken place several
23 times within the commercial nuclear power reactor industry. From these estimates, the
24 maximum individual dose to the member of the public was compared with the design objective
25 of Appendix I to 10 CFR Part 50 (Table 3.9-2) and with baseline effluents produced during
26 normal reactor operations.

27

28 Public radiation exposures from gaseous and liquid effluents produced during refurbishment can
29 be evaluated on the basis of effluent data from the replacement of steam generators and
30 recirculation piping. During the replacement of steam generators and recirculation piping,
31 releases of effluents have occurred under controlled conditions and in accordance with ALARA
32 principles. Similar refurbishment efforts that may occur as part of the license renewal process
33 would also take place under controlled conditions and in accordance with ALARA principles.

34

35 The first several plants to replace steam generators estimated the amounts of radioactivity
36 expected to be released in liquid and gaseous effluents as a result of the repair
37 (Parkhurst et al. 1983). Actual effluent measurements were performed in several cases. In the
38 1996 GEIS, the NRC listed the radioactive effluent releases for early steam generator
39 replacements and compared them with typical 1986 effluent releases for PWRs and BWRs
40 (see Table 3.10 in NRC 1996). It was found that the effluent releases were approximately the
41 same or much less than those from normal operations for a year. For BWR recirculation piping

1 replacement, the NRC compared the annual release and dose commitment information for five
2 reactor sites (Cooper, Monticello, Nine Mile Point, Peach Bottom, and Vermont Yankee) during
3 recirculation piping replacement with the data from normal operations of the same plants. It was
4 found that the radiation doses to the public were similar to or less than those resulting from
5 normal operations (see Table 3.11 in NRC 1996). On the basis of this finding, the NRC
6 concluded in the 1996 GEIS that gaseous effluents and liquid discharges occurring during
7 a 9-month refurbishment action would not be expected to result in maximum individual doses
8 exceeding the design objectives of Appendix I to 10 CFR 50 or the allowable EPA standards of
9 40 CFR Part 190 (Table 3.9-2).

10
11 For estimating the impacts from refurbishment activities during the license renewal term in this
12 GEIS revision, radioactive effluent releases and the dose to the public from the gaseous and
13 liquid effluent releases were evaluated for the three sites that have gone through steam
14 generator replacement in recent years. The effluent releases and the doses that occurred
15 during the year refurbishment was done are compared with the values for prior and subsequent
16 years.

17
18 Table 4.9.1.1–2 presents the radioactive effluent releases at three sites that have had their
19 steam generators replaced in recent years. For Arkansas Unit 2, the steam generator was
20 replaced in 2000, and the effluent releases are listed from 1999 to 2003. For Calvert Cliffs
21 Unit 1, the steam generator was replaced in 2002, for Unit 2, it was replaced in 2003. The
22 effluent releases are listed from 2000 to 2004. For Palo Verde Unit 2, the steam generator was
23 replaced in 2003. The effluent releases are listed from 2001 to 2005. For this site, there are no
24 liquid effluent releases beyond the site boundary. The data show that the effluent releases for
25 the year that the steam generators were replaced are on the same order of magnitude or much
26 less than the effluent releases for the following year. The effluent releases were also much less
27 than or on the same order of magnitude as those shown in Table 3.10 of the 1996 GEIS.

28
29 Table 4.9.1.1–3 presents the dose to the public from the gaseous and liquid effluent releases for
30 the same three sites. No significant difference in the dose from normal operations was
31 observed when the steam generator was replaced. All doses are much less than the design
32 objectives shown in Table 3.9-2. Tables 4.9.1.1–2 and 4.9.1.1–3 show that effluents and dose
33 impacts during the year when a steam generator replacement is performed do not differ
34 significantly from those in years of normal operations.

35
36 It is expected that doses during any future recirculation piping replacement would not be much
37 different than the doses shown in Table 3.11 in the 1996 GEIS. The NRC is updating these
38 tables for recent year data. The NRC will also assess dose contributions from the numerous
39 plants that have replaced reactor vessel heads.

40

Environmental Consequences and Mitigating Actions

1 When a major refurbishment is performed, it is expected that more work will be performed and
2 thus the amounts of some of the effluents, especially atmospheric particulates and possibly
3 some liquid effluents associated with decontamination, may be slightly greater than those found
4 during the steam generator changeouts or recirculation piping replacements.

5
6 *Continued Operations* – During normal operations after license renewal, small quantities of
7 radioactivity (fission, corrosion, and activation products) will continue to be released to the
8 environment in a manner similar to that occurring during present operations (see Section 3.9.1).
9 The concentration of radioactive materials in soils and sediments increases in the environment
10 at a rate that depends on the rate of release and the rate of removal. Removal can take place
11 through radioactive decay or through chemical, biological, or physical processes. For a given
12 rate of release, the concentrations of longer-lived radionuclides and, consequently, the dose
13 rates attributable to them would continue to increase if license renewal was granted.

14
15 Regulatory Guide 1.109 (NRC 1977) provides guidance for calculating the dose for significant
16 release pathways. To account for the buildup of radioactive materials, buildup factors are
17 included in the calculations. Initially, most of the calculations for the construction and operating
18 stage permits used 15 years as the approximate midpoint of a facility's operating life. This
19 value is now more often taken to be 20 years. The potential license renewal term is an
20 additional 20 years; thus, the effective midlife is 30 years.

21
22 The accumulation of radioactive materials in the environment is of concern not only with regard
23 to license renewal but also with regard to operation under current licenses. NRC reporting rules
24 require that pathways that may arise as a result of unique conditions at a specific site be
25 considered in licensees' evaluations of radiation exposures. If an exposure pathway is likely to
26 contribute significantly to total dose (10 percent or more to the total dose from all pathways), it
27 must be routinely monitored and evaluated. Environmental monitoring programs are in place at
28 all sites to provide a backup to the calculated doses based on effluent release measurements.
29 Since these programs are ongoing for the duration of the license, locations where unique
30 situations give rise to significant pathways that are not detailed in NRC Regulatory Guide 1.109
31 are to be identified if and when they become significant. If such pathways result in doses at a
32 plant exceeding the design objectives of Appendix I to 10 CFR Part 50, action is required.

33
34 The radiation dose to the public from current operations results from gaseous effluent releases
35 and from liquid effluent releases, as presented in Section 3.9.1.3.3. At present, for all operating
36 nuclear plants, doses to the maximally exposed individual (MEI) are much less than the design
37 objectives of Appendix I to 10 CFR Part 50 (Table 3.9-2). No aspect of future operation has
38 been identified that would substantially alter this situation.

39
40 Maximum individual doses are reported in annual effluent release reports, and if these doses
41 exceed Appendix I to 10 CFR Part 50 design objectives, the NRC would pursue remedial

Environmental Consequences and Mitigating Actions

1 action. Thus these issues are handled on a case-by-case basis. Many plants have gone
2 through license renewal, and no aging phenomenon that would increase public radiation doses
3 has been identified. The operating reactors are not expected to reach regulatory dose limits
4 more often in the period after license renewal than they do at present. For these reasons, dose
5 impacts on MEIs in the public during future operation under license renewal are judged to be
6 unchanged from those during present operations. The MEI dose ranges from 0.02
7 to 15.3 mrem/yr (see Table 3.9-16). At these dose levels, the increase in fatal cancer risk
8 (using ICRP risk coefficients) to the MEI ranges from 1×10^{-8} to 7.7×10^{-6} for 1 year of reactor
9 operations. Although dose rates (mrem/yr) are not expected to change during license renewal,
10 the cumulative dose (total mrem) would increase as a result of 20 more years of operations. If
11 the reactor operates for 60 years, it is estimated that the increase in fatal cancer risk to the MEI
12 would range from 6×10^{-7} to 4.6×10^{-4} (a 50 percent increase over the baseline of 40 years of
13 operation). However, it is unlikely that the same person would be exposed to these doses for
14 60 years of plant operations.
15

Table 4.9.1.1–2. Radioactive Effluent Releases for Three Nuclear Power Plants That Recently Replaced Steam Generators

Year ^(a)	Releases (Ci) in Gaseous Effluent					Releases (Ci) in Liquid Effluent			
	Fission and Activation Products	Gross Alpha	Iodines	Particulates	Tritium	Dissolved and Entrained Gases	Fission and Activation Products	Gross Alpha	Tritium
Arkansas Unit 2									
1999	3.9 × 10 ¹	0	0	3.9 × 10 ⁻⁵	3.7 × 10 ¹	2.3 × 10 ⁻²	8.5 × 10 ⁻²	4.4 × 10 ⁻⁴	5.9 × 10 ²
2000	4.5	3.4 × 10⁻⁷	0	7.4 × 10⁻⁶	2.0 × 10¹	2.1 × 10⁻¹	2.6 × 10⁻¹	1.2 × 10⁻¹	5.0 × 10²
2001	1.7 × 10 ⁻¹	0	0	0	2.4 × 10 ¹	5.0 × 10 ⁻³	7.2 × 10 ⁻²	8.9 × 10 ⁻⁴	4.9 × 10 ²
2002	4.6 × 10 ⁻¹	0	1.7 × 10 ⁻⁵	0	2.8 × 10 ¹	5.3 × 10 ⁻²	2.0 × 10 ⁻²	0	5.6 × 10 ²
2003	3.9 × 10 ⁻¹	0	1.0 × 10 ⁻⁶	0	2.5 × 10 ¹	9.9 × 10 ⁻²	3.7 × 10 ⁻²	0	7.0 × 10 ²
Calvert Cliffs Units 1 and 2^(b)									
2000	9.7 × 10 ¹	ND ^(c)	5.8 × 10 ⁻⁴	ND	3.7 × 10 ¹	1.2 × 10 ⁻¹	2.7 × 10 ⁻¹	1.4 × 10 ⁻⁴	1.1 × 10 ³
2001	7.3 × 10 ¹	ND	1.2 × 10 ⁻³	ND	2.0 × 10 ¹	6.3 × 10 ⁻²	6.8 × 10 ⁻¹	4.7 × 10 ⁻⁵	1.4 × 10 ³
2002	1.1 × 10²	ND	2.7 × 10⁻³	ND	2.4 × 10¹	1.9 × 10⁻¹	3.1 × 10⁻¹	ND	9.6 × 10²
2003	1.6 × 10²	ND	1.8 × 10⁻³	ND	2.8 × 10¹	8.9 × 10⁻²	6.7 × 10⁻²	ND	8.1 × 10²
2004	1.6 × 10 ²	ND	1.5 × 10 ⁻³	2.7 × 10 ⁻⁴	2.5 × 10 ¹	3.5 × 10 ⁻¹	2.8 × 10 ⁻²	ND	1.5 × 10 ³
Palo Verde Unit 2^(d)									
2001	1.9 × 10 ²	ND	7.2 × 10 ⁻⁴	2.8 × 10 ⁻⁴	6.3 × 10 ²	None	None	None	None
2002	1.7 × 10 ²	ND	9.7 × 10 ⁻³	2.2 × 10 ⁻⁴	2.7 × 10 ²	None	None	None	None
2003	9.2 × 10¹	ND	6.4 × 10⁻³	7.3 × 10⁻⁴	1.1 × 10³	None	None	None	None
2004	8.7 × 10 ⁻¹	ND	1.2 × 10 ⁻⁵	3.3 × 10 ⁻¹⁰	4.8 × 10 ²	None	None	None	None
2005	4.6	ND	1.1 × 10 ⁻⁴	5.6 × 10 ⁻⁵	6.2 × 10 ²	None	None	None	None

(a) Years in which steam generators were replaced are presented in bold text.

(b) Steam generator was replaced for Unit 1 in 2002 and for Unit 2 in 2003. The site reported releases from both units together.

(c) ND = Not detected.

(d) There were no liquid effluent releases beyond the site boundary.

Sources: Sites' annual effluent release reports

Environmental Consequences and Mitigating Actions

Table 4.9.1.1–3. Dose to the Maximally Exposed Individual (MEI) from Gaseous and Liquid Effluent Releases for Three Nuclear Power Plants That Recently Replaced Steam Generators

Year ^(a)	Gaseous Effluents				Liquid Effluents	
	Total Body (mrem)	Gamma (mrad)	Beta (mrad)	Critical Organ (mrem)	Total Body (mrem)	Critical Organ (mrem)
Arkansas Unit 2						
1999	2.3×10^{-2}	1.2×10^{-3}	3.8×10^{-3}	2.4×10^{-2}	1.7×10^{-3}	2.1×10^{-3}
2000	NA^(b)	NA	NA	NA	NA	NA
2001	1.5×10^{-2}	0	0	1.5×10^{-2}	1.0×10^{-3}	1.2×10^{-3}
2002	1.7×10^{-2}	0	1.0×10^{-4}	2.1×10^{-2}	1.6×10^{-3}	1.9×10^{-3}
2003	1.6×10^{-2}	0	1.0×10^{-4}	1.6×10^{-2}	1.3×10^{-3}	1.5×10^{-3}
Calvert Cliffs Units 1 and 2^(c)						
2000	NR ^(d)	1.0×10^{-3}	7.0×10^{-3}	7.6×10^{-1}	3.0×10^{-1}	2.1×10^{-1}
2001	NR	1.0×10^{-3}	4.0×10^{-3}	3.5×10^{-2}	5.0×10^{-3}	4.3×10^{-1}
2002	NR	1.0×10^{-3}	6.0×10^{-3}	1.7×10^{-2}	6.0×10^{-3}	2.0×10^{-1}
2003	NR	2.0×10^{-3}	1.0×10^{-2}	5.0×10^{-2}	2.0×10^{-3}	2.0×10^{-2}
2004	NR	2.0×10^{-3}	8.0×10^{-3}	4.0×10^{-2}	2.0×10^{-3}	5.0×10^{-3}
Palo Verde Unit 2^(e)						
2001	NR	1.6×10^{-2}	6.1×10^{-2}	2.4×10^{-1}	None	None
2002	NR	1.8×10^{-2}	5.3×10^{-2}	3.7×10^{-1}	None	None
2003	NR	9.3×10^{-3}	3.1×10^{-2}	4.8×10^{-1}	None	None
2004	NR	1.0×10^{-3}	5.0×10^{-4}	1.7×10^{-1}	None	None
2005	NR	2.9×10^{-3}	2.0×10^{-3}	2.2×10^{-1}	None	None

(a) Years in which steam generators were replaced are presented in bold text.

(b) NA = Site's effluent release report not available.

(c) Steam generator was replaced for Unit 1 in 2002 and for Unit 2 in 2003. The site reported doses from both units together.

(d) NR = Not reported in the site's effluent release report.

(e) There were no liquid effluent releases beyond the site boundary.

Sources: Sites' annual effluent release reports

To convert mrem to mSv multiply by 0.01.

Environmental Consequences and Mitigating Actions

1 One of the pathways considered in calculating the MEI doses is direct radiation from operating
2 plants. Radiation fields are produced around nuclear plants as a result of radioactivity within
3 the reactor and its associated components, low-level storage containers, and components such
4 as steam generators that have been removed from the reactor (as described in Section 3.9).
5 Direct radiation from sources within a light water reactor (LWR) plant is due primarily to
6 nitrogen-16, a radionuclide produced in the reactor core by neutron activation of oxygen-16
7 from the water. Because the primary coolant of an LWR is contained in a heavily shielded
8 area, dose rates in the vicinity of LWRs are generally undetectable and less than 1 mrem/yr at
9 the site boundary. Some plants (mostly BWRs) do not have completely shielded secondary
10 systems and may contribute some measurable offsite dose. However, these sources of direct
11 radiation will be unaffected by license renewal.

12
13 In addition to the regulations within 10 CFR Part 20.1101 that speak directly to required
14 operation under ALARA principles, 10 CFR Part 50.36a imposes conditions on licensees in the
15 form of technical specifications on effluents from nuclear power reactors. These specifications
16 are intended to keep releases of radioactive materials to unrestricted areas during operations to
17 ALARA levels. Appendix I to 10 CFR Part 50 provides numerical guidance on dose-design
18 objectives and limiting conditions for the operation of LWRs to meet the ALARA requirements.
19 These regulations will remain in effect during the period of license renewal (see
20 Section 3.9.1.1.2).

21
22 About 30 nuclear power plants that have gone through license renewal since 1996 have
23 concluded that the radiation dose to the public will continue at current levels associated with
24 normal operations and are expected to remain much lower than the applicable standards.

25
26 Offsite doses to the public attributable to refurbishment activities were examined for the MEI.
27 Because the focus of the analysis is on annual dose, only the results based on the most likely
28 major refurbishment action were examined (i.e., replacing steam generators in PWRs and
29 primary recirculation piping in BWRs). For this action, doses to the public were found to be
30 small. To date, effluents and doses during periods of major refurbishments have not been seen
31 to differ significantly from those during normal operations. Consequently, gaseous effluents
32 and liquid discharges occurring during major refurbishment actions are not expected to result in
33 maximum individual doses exceeding the design objectives of Appendix I to 10 CFR Part 50 or
34 the allowable EPA standards of 40 CFR Part 190 (Table 3.9-2).

35
36 Radiation doses to members of the public from the current operations of nuclear power plants
37 have been examined from a variety of perspectives, and the impacts were found to be well
38 within design objectives and regulations in each instance. No effect of aging that would
39 significantly affect the radioactive effluents has been identified. Public doses are expected to
40 remain well within design objectives and regulations. The cumulative cancer risk to the MEI

41

1 would increase by 50 percent because the plant would operate for 20 more years, but the risk
2 would still be small when compared with the cancer risk from background radiation.

3
4 Because there is no reason to expect effluents to increase in the period after license renewal,
5 doses from continued operation are expected to be well within regulatory limits. No mitigation
6 measures beyond those implemented during the current term license would be warranted,
7 because current mitigation practices have kept public radiation doses well below regulatory
8 standards and are expected to continue to do so.

9
10 Public radiological exposure impacts during license renewal and refurbishment were considered
11 to be small for all plants and were designated as Category 1 issues in the 1996 GEIS. No new
12 information has been identified in the plant-specific SEISs prepared to date, the literature, or
13 effluent and monitoring reports prepared by operating plants that would alter that conclusion.
14 On the basis of these considerations, the NRC concludes that the impact of continued
15 operations and refurbishment activities on public radiological exposure would be small for all
16 nuclear plants and remains a Category 1 issue.

17 18 Chemical Hazards

19
20 In nuclear power plants, chemical effects could result from discharges of chlorine or other
21 biocides, small-volume discharges of sanitary and other liquid wastes, chemical spills, or heavy
22 metals leached from cooling system piping and condenser tubing. Impacts of chemical
23 discharges to human health are considered to be small if the discharges of chemicals to water
24 bodies are within effluent limitations designed to ensure protection of water quality, and if
25 ongoing discharges have not resulted in adverse effects on aquatic biota. During the license
26 renewal term, human health impacts from chemicals are expected to be the same as those
27 experienced during operations in the original license term (see Section 3.9.2 for more details).

28
29 One environmental issue related to chemical hazards is reviewed here: the impact on human
30 health from chemicals. This issue was not evaluated in the 1996 GEIS.

31 32 *Human Health Impact from Chemicals*

33
34 The types of chemical hazards that exist at a nuclear power plant are discussed in
35 Section 3.9.2. Plant workers may encounter hazardous chemicals when the chemistries of the
36 primary and secondary coolant systems are being adjusted, biocides are being applied to
37 address the fouling of cooling system components, equipment containing hazardous oils or
38 other chemicals is being repaired or replaced, solvents are being used for cleaning, or other
39 equipment is being repaired. Exposures to hazardous chemicals are minimized when plant
40 workers follow good industrial hygiene practices.

Environmental Consequences and Mitigating Actions

1 Reviews of the literature and operational monitoring reports and consultations with utilities and
2 regulatory agencies that were done for the 1996 GEIS indicated that the effects of the
3 discharge of chlorine and other biocides on water quality would be of small significance for all
4 plants. Small quantities of biocides are readily dissipated and/or chemically altered in the body
5 of water receiving them, so significant cumulative impacts to water quality would not be
6 expected. Major changes in the operation of the cooling system are not expected during the
7 license renewal term, so no change in the effects of biocide discharges on the quality of the
8 receiving water is anticipated. Any such changes would require a separate NEPA review that
9 would include an examination of human health effects. Effects of biocide discharges could be
10 reduced by increasing the degree to which discharge water is treated, reducing the
11 concentration of biocides, or treating only a portion of the plant cooling and service water
12 systems at one time. Discharges of sanitary wastes are regulated by NPDES permit, and
13 discharges that do not violate the permit limits are considered to be of small significance.

14
15 The effects of minor chemical discharges and spills at nuclear plants on water quality have
16 been of small significance and mitigated as needed. Significant cumulative impacts on water
17 quality would not be expected because the small amounts of chemicals released by these minor
18 discharges or spills are readily dissipated in the receiving water body. Spills and off-
19 specification discharges occur so seldom that regulatory agencies have not expressed any
20 concern about them with regard to operating nuclear power plants. While there may be
21 additional management practices or discharge-control devices that could further reduce the
22 frequency of accidental spills and off-specification discharges, they are not warranted because
23 impacts are already small and occur at a low frequency.

24
25 Heavy metals (e.g., copper, zinc, and chromium) may be leached from condenser tubing and
26 other heat exchangers and discharged by power plants as small-volume waste streams or
27 corrosion products. Although all are found in small quantities in natural waters (and many are
28 essential micronutrients), concentrations in the power plant discharge are controlled in the
29 NPDES permit because excessive concentrations of heavy metals can be toxic to aquatic
30 organisms.

31
32 Nuclear power plants are required to submit to the Federal EPA and the State in which they are
33 located annual reports on the environmental releases of listed toxic chemicals manufactured,
34 processed, or otherwise used that are above Federally and State-identified threshold quantities.
35 The disposal of essentially all of the hazardous chemicals used at nuclear power plants is
36 regulated by Resource Conservation and Recovery Act (RCRA) or NPDES permits. The NRC
37 requires nuclear power plants to operate in compliance with all of its permits, thereby
38 minimizing adverse impacts to the environment and on workers and the public. It is anticipated
39 that all plants will continue to operate in compliance with all applicable permits, and no
40 mitigation measures beyond those implemented during the current term license would be
41 warranted as a result of license renewal.

42

1 On the basis of these considerations, the health impact from chemicals to workers and the
2 public is considered small at all nuclear plants. This is a Category 1 issue.

3
4 Microbiological Hazards

5
6 Some microorganisms associated with nuclear power plant cooling towers and thermal
7 discharges can have deleterious impacts on the health of plant workers and the public. Certain
8 microorganisms can benefit from thermal effluents. The potential for adverse health effects
9 from microorganisms on nuclear power plant workers is an issue for plants that use cooling
10 towers. Potential adverse health effects on the public from microorganisms in thermal effluents
11 is an issue for nuclear plants that use cooling ponds, lakes, or canals, and that discharge to
12 rivers. During the license renewal term, plant workers and members of the public would be
13 exposed to microbiological hazards in the same way that they are exposed during operations in
14 the original license term (see Section 3.9.3 for details).

15
16 Two environmental issues related to microbiological hazards are reviewed here:
17 microbiological hazards to plant workers and microbiological hazards to the public. These two
18 issues are the same as those evaluated in the 1996 GEIS (NRC 1996).

19
20 *Microbiological Hazards to Plant Workers*

21
22 The types of microbiological hazards that exist for nuclear power plant workers are discussed in
23 Section 3.9.3. Pathogens of concern include *Salmonella* spp, *Shigella* spp, *Pseudomonas*
24 *aeruginosa*, thermophilic fungi, *Legionella* spp, and *N. fowleri*. These species are all associated
25 with nuclear plants that use cooling towers as part of their cooling water system. Because of
26 the presence of these microorganisms, workers at nuclear power plants are typically required to
27 use respiratory protection when cleaning cooling towers and condensers. Prairie Island Nuclear
28 Generating Plant, which had high concentrations of *N. fowleri* in the circulating water,
29 successfully controlled the pathogen and protected workers through chlorination before its
30 yearly downtime operation (NRC 1980). The NRC has concluded that microorganisms that live
31 in high-radiation and extreme heat conditions typical of the spent fuel pool do not pose a risk to
32 plant workers (NRC 1999a).

33
34 No change in existing microbiological hazards is expected over the license renewal term. It is
35 considered unlikely that any plants that have not already experienced occupational
36 microbiological hazards would do so during the license renewal term or that hazards would
37 increase over that period. It is anticipated that all plants will continue to employ proven
38 industrial hygiene principles so that adverse occupational health effects associated with
39 microorganisms will be of small significance at all sites, and no mitigation measures beyond
40 those implemented during the current term license would be warranted. Aside from continued
41

Environmental Consequences and Mitigating Actions

1 application of accepted industrial hygiene procedures, no additional mitigation measures are
2 expected to be warranted as a result of license renewal. This is a Category 1 issue.

3 4 *Microbiological Hazards to the Public*

5
6 *N. fowleri* which is the pathogenic strain of the free-living amoebae *Naegleria spp.*, appears to
7 be the most likely microorganism that may pose a public health hazard resulting from nuclear
8 power plant operations. Increased populations of *N. fowleri* may have significant adverse
9 impacts. On entry into the nasal passage of a susceptible individual, *N. fowleri* will penetrate
10 the nasal mucosa. The ensuing infection results in a rapidly fatal form of encephalitis.
11 Fortunately, humans in general are resistant to infection with *N. fowleri*. Hallenbeck and
12 Brenniman (1989) have estimated individual annual risks for primary amebic
13 meningoencephalitis caused by the free-living *N. fowleri* to swimmers in freshwater to be
14 approximately 4×10^{-6} . Exposure to *Legionella spp.* from power plant operations would not
15 generally impact the public because concentrated aerosols of the bacteria would not traverse
16 plant boundaries. The information available on microorganisms that may inhabit high-radiation,
17 high-temperature environments (such as the spent fuel pool) indicates that they are very
18 unlikely to significantly increase in number in the environment and that they would not have a
19 deleterious effect on public health (NRC 1999a).

20
21 From the studies presented in Section 3.9.3, it is clear that heavily used bodies of freshwater
22 merit special attention and also possibly routine monitoring for pathogenic *Naegleria*. Since
23 *Naegleria* concentrations in freshwater can be enhanced by thermal effluents, nuclear power
24 plants that use cooling lakes, canals, ponds, or rivers may enhance the populations of naturally
25 occurring thermophilic organisms. There are currently 23 reactor sites that fit this category.
26 Data for 14 sites from this category that have gone through license renewal were reviewed to
27 predict the level of thermophilic microbiological organism enhancement at any given site with
28 current knowledge. For all 14 sites, no actual hazards to public health from enhancement of
29 thermophilic microbiological organisms were identified, documented, or substantiated.
30 However, without site-specific data, the same conclusion cannot be drawn for all reactor sites
31 that would go through license renewal.

32
33 Changes in microbial populations and in the public use of water bodies might occur after the
34 operating license is issued and the application for license renewal is filed. Other factors could
35 also change, including the average temperature of the water, which could result from climate
36 change that affected water levels and air temperature. Finally, the long-term presence of a
37 power plant might change the natural dynamics of harmful microorganisms within a body of
38 water. Therefore, the magnitude of the potential public health impacts associated with thermal
39 enhancement of thermophilic organisms could be small, moderate, or large, depending on
40 plant-specific conditions. This hazard is a Category 2 issue.

1 Electromagnetic Fields

2
3 Nuclear power plants use power-transmission systems that consist of switching stations or
4 substations located on the plant site and transmission lines located primarily offsite that connect
5 the power plant to the regional electric grid. Electric fields and magnetic fields, collectively
6 referred to as the electromagnetic field (EMF), are produced by operating transmission lines.
7 During the license renewal term, members of the public who live, work, or pass near an
8 associated operating transmission line may be exposed to the EMF in the same way that they
9 are exposed during operations during the current license term (see Section 3.9.4 for more
10 detail). The issue of potential chronic effects from the EMF surrounding a transmission line is
11 the same as that presented in the 1996 GEIS. The issue is evaluated below by reviewing the
12 relevant literature. It should be noted that the scope of the evaluation of transmission lines in
13 this GEIS revision is reduced from that of the 1996 GEIS. For this revision, only those
14 transmission lines currently needed to connect the nuclear power plants to the regional electric
15 distribution grid are considered within scope. Thus, the number and length of the transmission
16 lines being evaluated are greatly reduced.

17
18 *Ongoing Research on the Effect of Electromagnetic Fields*

19
20 In 1990, the EPA's Office of Health and Environmental Assessment reviewed epidemiology
21 studies, chronic lifetime animal tests, and laboratory studies of biological phenomena related to
22 carcinogenesis. The review indicated that some epidemiological studies found an association
23 between EMF and certain types of cancers, but others did not find any association. It was
24 concluded that the scientific issues concerning the relationship between EMF and adverse
25 health effects are very complex and difficult to interpret (EPA 1990). Without an understanding
26 of how these EMF fields are interacting with biological functions, the knowledge gained from
27 scientific studies was of limited value both in evaluating the importance of the study results and
28 in devising protection strategies for the public and for utility workers.

29
30 A substantial body of evidence has been accumulated indicating that EMF fields may influence
31 biological function at exposure levels capable of producing relatively high current densities
32 (10 to 100 mA/m²) (IRPA/INIRC 1990). Such exposures have been suggested to induce
33 chromosome aberrations, alter the distribution in molecular weights during protein synthesis,
34 inhibit production of melatonin, alter calcium binding in brain tissue, influence RNA transcription,
35 and produce a variety of other effects (OTA 1989). Questions concerning the potential
36 carcinogenic effects of EMF field exposure have been raised as a result of suggestive
37 epidemiological findings and some laboratory experiments. One accepted model on the
38 development of cancer is the initiation-promotion paradigm (Easterly 1981). Most investigators
39 conclude that EMF fields are not likely to act as initiators because they have not been shown to
40 cause genetic damage (Aldrich and Easterly 1987). EMF effects on RNA transcription,
41 however, could imply increased reduction of oncogene products, and some investigators

Environmental Consequences and Mitigating Actions

1 consider such data to be indicative of genetic effects (Goodman et al. 1987; Goodman and
2 Henderson 1986, 1988). It has not been shown that EMF fields are cancer promoters, but the
3 presence of some reported EMF biological effects reveals the need for further study of this
4 issue (Byus et al. 1987).

5
6 In 1992, the U.S. Congress authorized the Electric and Magnetic Fields Research and Public
7 Information Dissemination Program (EMF-RAPID) in the Energy Policy Act (Public
8 Law 102-486). The National Institute of Environmental Health Sciences (NIEHS), National
9 Institutes of Health (NIH), and DOE were designated to direct and manage a program of
10 research and analysis aimed at providing scientific evidence to clarify the potential for health
11 risks from exposure to EMF (NIEHS 1999).

12
13 Over the course of this program, DOE and NIEHS managed more than 100 cellular and animal
14 studies, exposure assessment studies, and engineering studies. No additional epidemiology
15 studies were conducted; however, analyses of the studies that had already been conducted
16 were an important part of the assessments (NIEHS 2002). In 1998, NIEHS completed the
17 review of a comprehensive body of scientific research on the potential health effects of EMF.
18 NIEHS organized several technical symposia and a working group meeting to review EMF
19 research. The working group was made up of scientists representing a wide range of
20 disciplines (including engineering, epidemiology, cellular biology, medicine, toxicology,
21 statistics, and pathology) brought together to review and evaluate the RAPID research and
22 other research.

23
24 In June 1999, the NIEHS submitted the report, *NIEHS Report on Health Effects from Exposure*
25 *to Power-Line Frequency Electric and Magnetic Fields* (i.e., extremely low frequency
26 electromagnetic fields [ELF-EMFs]) to Congress. In part, the report (NIEHS 1999) concluded
27 the following:

28
29 The scientific evidence suggesting that ELF-EMF exposures pose any health risk
30 is weak. The strongest evidence for health effects comes from associations
31 observed in human populations with two forms of cancer: childhood leukemia
32 and chronic lymphocytic leukemia in occupationally exposed adults... In
33 contrast, the mechanistic studies and the animal toxicology literature fail to
34 demonstrate any consistent pattern across studies and the animal toxicology
35 literature fail to demonstrate any consistent pattern across studies although some
36 sporadic findings of biological effects have been reported. No indication of
37 increased leukemia in animals has been observed.... Virtually all of the
38 laboratory evidence in animals and humans and most of the mechanistic work
39 done in cells fail to support a causal relationship between ELF-EMF at
40 environmental levels and changes in biological function or disease status. The
41 lack of consistent, positive findings in animal or mechanistic studies weakens the

1 belief that this association is actually due to ELF-EMF, but it cannot completely
2 discount the epidemiological findings.
3

4 The NIEHS concluded that ELF-EMF exposure cannot be recognized as entirely safe because
5 of weak scientific evidence that exposure may pose a leukemia hazard. In the NIEHS opinion,
6 this finding is insufficient to warrant aggressive regulatory concern. However, because virtually
7 everyone in the United States uses electricity and is therefore routinely exposed to ELF-EMF,
8 passive regulatory action is warranted, such as a continued emphasis on educating both the
9 public and the regulatory community on ways in which to reduce exposure. NIEHS suggested
10 that the power industry continue its current practice of siting power lines to reduce exposure
11 and continue to explore ways to reduce the creation of magnetic fields around transmission and
12 distribution lines without creating new hazards. NIEHS also encourages the use of
13 technologies that lower exposures from neighborhood distribution lines, provided they do not
14 increase other risks, such as those from accidental electrocution or fire. NIEHS does not
15 believe that other cancers or noncancer outcomes provide sufficient evidence of a risk to
16 warrant concern (NIEHS 1999).
17

18 In the United Kingdom, the National Radiological Protection Board (NRPB) established an
19 independent Expert Advisory Group on Non-Ionizing Radiation (AGNIR) that reviewed scientific
20 evidence relating possible adverse health effects to low-frequency EMFs (NRPB 2001, 2004).
21 The earlier review (NRPB 2001) provided no firm evidence of a carcinogenic hazard to children
22 or adults from exposure to normal levels of low-frequency EMFs, but made a number of
23 recommendations for epidemiological studies and experimental work. The NRPB review in
24 2004 (NRPB 2004) concluded that currently, the results of these studies on EMF and health do
25 not warrant quantitative restrictions on exposure to EMF. However, such studies, together with
26 people's concerns, provide a basis for precautionary measures (NRPB 2004).
27

28 The World Health Organization (WHO) recently published an environmental health criteria
29 monograph (WHO 2007) that addresses the possible health effects of ELF-EMF exposure. It
30 reviewed the scientific literature on biological effects to assess the health risk from ELF-EMF
31 exposure. It concluded the following about childhood leukemia:
32

33 Scientific evidence suggesting that everyday, chronic low-intensity (above 0.3 to
34 0.4 μT) low-frequency magnetic field exposure poses a health risk is based on
35 epidemiological studies demonstrating a consistent pattern of increased risk for
36 childhood leukemia. Uncertainties in the hazard assessment include the role that
37 control selection bias and exposure misclassification might have on the observed
38 relationship between magnetic fields and childhood leukemia. In addition,
39 virtually all of the laboratory evidence and the mechanistic evidence fail to
40 support a relationship between low-level ELF magnetic fields and changes in
41 biological function or disease status. Thus, on balance, the evidence is not

Environmental Consequences and Mitigating Actions

1 strong enough to be considered causal, but sufficiently strong to remain a
2 concern.
3

4 The potential for transmission line EMF to cause adverse health impacts in humans has been
5 reviewed by many scientific groups. The hazard is assessed by a standard scientific approach
6 that considers data from epidemiologic, laboratory, and biophysical studies. A number of
7 epidemiologic studies have reported a small degree of association between measures of EMF
8 and several diseases such as childhood leukemia. Other studies have failed to find an
9 association. A causal basis for the EMF associations is not supported by laboratory and
10 biophysical evidence, and the actual basis remains unexplained. Nonetheless, in 2002, the
11 International Agency for Research on Cancer (IARC 2002) designated EMF as a class 2B
12 carcinogen (“possibly carcinogenic”), on the basis of “consistent statistical associations of
13 high-level residential magnetic fields with a doubling of the risk of childhood leukemia.” The
14 WHO (2007) monograph did not change the EMF classification on the basis of new human,
15 animal, and in vitro studies published since the IARC (2002). In 2002, the California
16 Department of Health Services issued a report (CADHS 2002) concluding that “EMFs can
17 cause some degree of increased risk of childhood leukemia, adult brain cancer, Lou Gehrig’s
18 disease, and miscarriage.” Kheifets et al. (2005) assessed the potential susceptibility of
19 children to EMFs and recommended additional research and the development of precautionary
20 policies.
21

22 The WHO (2007) monograph also reviewed literature that looked at a number of other diseases
23 such as cancers in children and adults, depression, suicide, reproductive dysfunction,
24 developmental disorders, immunological modifications, and neurological disease. On the basis
25 of this review, it concluded the following:
26

27 The scientific evidence supporting a linkage between ELF magnetic fields and
28 any of these diseases is much weaker than for childhood leukemia and in some
29 cases (for example, for cardiovascular disease or breast cancer) the evidence is
30 sufficient to give confidence that magnetic fields do not cause the disease.
31

32 Extensive investigations of animals exposed at much higher levels of magnetic fields
33 (up to 5 mT) have not demonstrated adverse health effects (Boorman et al. 2000). The
34 elevated levels of EMF exposure in occupational settings likewise do not show a consistent
35 pattern of increased risk for acute myocardial infarction or chronic coronary heart disease
36 (Sahl et al. 2002). Laboratory studies of cells and tissues do not support the hypothesis that
37 EMF exposure at ambient levels is a significant risk factor for human disease (NIEHS 1999).
38 The failure to observe biological effects from EMF exposure may be due to the fact that,
39 mechanistically, effects of EMF on biology are very weak (Valberg et al. 1997) or the
40 association between the epidemiological results on childhood leukemia and EMF be the result
41 of chance or a confounding factor (Draper et al. 2005).
42

1 *Transmission Line Exposures Relative to Domestic Exposures*

2
 3 An important question regarding regulations is whether transmission line exposures contribute
 4 significantly to total EMF field exposures. In most cases, fields produced inside the home by
 5 appliances and electrical wiring are greater than the contributions from transmission line fields.
 6 Exceptions to this rule are individuals living next to a high-voltage transmission line ROW. Also
 7 relevant is the fact that exposures to transmission line fields are considered more continuous
 8 than those to appliance fields because transmission line fields permeate large areas (e.g., an
 9 entire home). Fields generated by appliances are generally more localized, resulting in
 10 intermittent exposures as individuals move around and as the appliances are turned on and off.

11
 12 The earth's atmosphere produces slowly varying electric fields that average less than a few
 13 hundred V/m, and the earth's core produces a steady magnetic field in a range from
 14 about 0.3 to 0.6 G. Near appliances, the magnetic fields can be high, but they diminish sharply
 15 with distance. Table 4.9.1.1–4 shows the magnetic fields at different distances from household
 16 appliances (HCCP 2007). Typical house wiring and appliances contribute a 60-Hz magnetic
 17 field that can be up to about 3 mG (not in the vicinity of appliances). Some comparisons (of
 18 induced currents) among transmission line exposures, domestic exposures, and exposures
 19

Table 4.9.1.1–4. Magnetic Fields at Different Distances from Household Appliances

Household Appliance	Magnetic Fields (mG) at Different Distances		
	3 cm	30 cm	100 cm
Microwave oven	750–2000	40–80	3–8
Fluorescent lamp	400–4000	5–20	0.1–3
Electric cooking stove	60–2000	4–40	0.1–1
Television	25–500	0.4–20	0.1–2
Clothes washer	8–400	2–30	0.1–2

Source: HCCP 2007

20
 21 used in biological effects experiments can be made by using induced current density as an
 22 exposure metric. According to data provided in OTA (1989), field strengths on the ROW of a
 23 500-kV line induce body currents that are higher than those induced by domestic exposures
 24 produced by typical electrical appliances. A comparison with the results of biological effects
 25 experiments (OTA 1989) shows that while current densities in many biological effects
 26 experiments are higher than those typically induced by household exposures, some current
 27 densities are significantly lower. These comparisons are based, however, on average current

Environmental Consequences and Mitigating Actions

1 densities predicted in humans, because EMF dosimetry has not advanced to the point of
2 determining specific current densities in various tissues and organs. Moreover, researchers
3 have not identified what field characteristics are important biologically.

4 5 *Conclusion on Electromagnetic Fields*

6
7 A review of the biological and physical studies of 60-Hz EMFs did not find any consistent
8 evidence that would link harmful effects with field exposures. EMF fields are unlike other
9 agents that have a toxic effect (e.g., toxic chemicals and ionizing radiation) in that dramatic
10 acute effects cannot be forced, and longer-term effects, if real, are subtle. Nonetheless, a wide
11 range of biological responses have been reported to be affected by EMF fields.

12
13 Even if clear adverse effects were apparent in the epidemiology literature or with some
14 biological assay, considerable additional work would be required to determine how and what to
15 mitigate, because evidence suggests that some EMF biological effects do not follow the typical
16 “more intensity is worse” relationship. Furthermore, there may be a subtle relationship between
17 the intensity of the local geomagnetic field and the appearance of effects for some intensities
18 of 60-Hz fields. This complicating evidence points to the fact that, while much experimental and
19 epidemiological evidence has been accrued, the pieces still do not fit together very well.

20
21 Because of inconclusive scientific evidence, the chronic effects of EMF are considered
22 uncertain, and currently, no generic conclusion on human impacts is possible. The NRC will
23 continue to monitor the research initiatives – both those within the national EMF program and
24 others internationally – to evaluate the potential carcinogenicity of EMF fields as well as other
25 progress in the EMF study disciplines. If the NRC finds that the appropriate Federal health
26 agencies have reached a consensus that there are adverse health effects, all future license
27 renewal applicants will have to address the health effects in the license renewal process.

28 29 Other Hazards

30
31 Two additional human health issues are addressed in this section: (1) human health impacts
32 from physical occupational hazards and (2) human health impacts from shock hazards from
33 transmission lines. The human health impact from occupational hazards was not discussed in
34 the 1996 GEIS. The human health impact from shock hazards is the same as that evaluated in
35 the 1996 GEIS.

36
37 Nuclear power plants are industrial facilities that have many of the typical occupational hazards
38 found at any other electric power generation utility. Workers at or around nuclear power plants
39 would be involved in some electrical work, electric power line maintenance, repair work, and
40 maintenance activities and exposed to some potentially hazardous physical conditions

1 (e.g., excessive heat, cold, and pressure). The issue of physical occupational hazards is
2 generic to all nuclear power plants.
3

4 Transmission lines are needed to transfer energy from the nuclear power plant to consumers.
5 The workers and general public at or around the nuclear power plants and along the
6 transmission lines are exposed to the potential for acute electrical shock from these lines. The
7 issue of electrical shock is generic to all nuclear power plants.
8

9 During the license renewal term, human health impacts from physical occupational hazards and
10 acute shock hazards would be the same as those from operations during the original license
11 term (see Section 3.9.5 for more detail).
12

13 *Physical Occupational Hazards*

14

15 The types of occupational hazards that exist at a nuclear power plant are discussed in
16 Section 3.9.5. The issue of occupational hazards is evaluated by comparing the rate of fatal
17 injuries and nonfatal occupational injuries and illnesses in the utility sector with the rate in all
18 industries combined. Occupational hazards can be minimized when workers adhere to safety
19 standards and use appropriate personal protective equipment; however, fatalities and injuries
20 from accidents can still occur. Data for occupational injuries from the U.S. Bureau of Labor
21 Statistics for 2005 (BLS 2005a,b,c) indicate that the rate of fatal injuries in the utility sector is
22 less than the rate for many sectors (construction; transportation and warehousing; agriculture,
23 forestry, fishing, and hunting; wholesale trade; and mining) and that the incidence rate for
24 nonfatal occupational injuries and illnesses is the least for electric power generation, followed
25 by electric power transmission control and distribution (see Section 3.9.5). The fatality rate for
26 electric power line installers and repairers can be estimated at 0.032 percent (BLS 2005a). It is
27 expected that over the license renewal term, workers would continue to adhere to safety
28 standards and use protective equipment, so adverse occupational impacts would be of small
29 significance at all sites, and no mitigation measures beyond those implemented during the
30 current license term would be warranted. The impact of these hazards is a Category 1 issue.
31

32 *Shock Hazards*

33

34 The greatest hazard from a transmission line is direct contact with the conductors. Tower
35 designs preclude direct public access to the conductors. However, electrical contact can be
36 made without physical contact between a grounded object and the conductor. Secondary
37 shock currents are produced when humans make contact with (1) capacitively charged bodies,
38 such as a vehicle parked near a transmission line, or (2) magnetically linked metallic structures,
39 such as fences near transmission lines. A person who contacts such an object could receive a
40 shock and experience a painful sensation at the point of contact. The intensity of the shock
41

Environmental Consequences and Mitigating Actions

1 would depend on the EMF strength, size of the object, and how well the object and person were
2 insulated from ground.

3
4 Design criteria for nuclear power plants that limit hazards from steady-state currents are based
5 on the National Electrical Safety Code (NESC), adherence to which requires that utility
6 companies design transmission lines so that the short-circuit current to ground produced from
7 the largest anticipated vehicle or object is limited to less than 5 mA (IEEE 2007). With respect
8 to shock safety issues and license renewal, three points must be made. First, in the licensing
9 process for the earlier licensed nuclear plants, the issue of electrical shock safety was not
10 addressed. Second, some plants that received operating licenses with a stated transmission
11 line voltage may have chosen to upgrade the line voltage for reasons of efficiency, possibly
12 without reanalysis of induction effects. Third, since the initial NEPA review for those utilities
13 that evaluated potential shock situations under the provision of the NESC, land use may have
14 changed, resulting in the need for a reevaluation of this issue. The electrical shock issue,
15 which is generic to all types of electrical generating stations, including nuclear plants, is of small
16 significance for transmission lines that are operated in adherence with the NESC. Without a
17 review of the conformance of each nuclear plant's transmission lines with NESC criteria, it is not
18 possible to determine the significance of the electrical shock potential generically; it could be
19 small, moderate, or large. The impact of this hazard is a Category 2 issue.

20 21 **4.9.1.2 Environmental Consequences of Postulated Accidents**

22
23 Chapter 5 of the 1996 GEIS assessed the impacts of postulated accidents at nuclear power
24 plants (NPPs) on the environment. The postulated accidents included design basis accidents
25 and severe accidents (e.g., those with core melt). The impacts considered included:

- 26 • Dose and health effects of accidents (5.3.3.2 through 5.3.3.4);
- 27 • Economic impacts of accidents (5.3.3.5); and
- 28 • Impact of uncertainties on results (5.3.4).

29
30
31
32
33 The estimated impacts were based upon the analysis of severe accidents at 28 NPPs,^(a) as
34 reported in the Environmental Impact Statements (EIS) and/or Final Environmental Statements
35 (FES) prepared for each of the 28 plants in support of their operating licenses. With few
36 exceptions, the severe accident analyses were limited to consideration of reactor accidents

(a) The 28 sites are listed in Table 5.1 of the 1996 GEIS. There are a total of 44 units included in this list, but 4 of these units never operated (Grand Gulf 2, Harris 2, Perry 2, and Seabrook 2). For the purpose of this document, this list will be referred to as containing 28 NPPs, but when mean values are calculated for this subset of NPPs, all 40 units that operated are considered.

1 caused by internal events. The GEIS addressed the impacts from external events qualitatively.
2 The severe accident analysis for the 28 plants was extended to the remainder of plants whose
3 EISs did not consider severe accidents (since such analysis was not required at the time the
4 other plants' EISs were prepared). The estimates of environmental impact contained in the
5 1996 GEIS used 95th percentile upper confidence bound (UCB) estimates whenever available.
6 This provides conservatism to cover uncertainties, as described in Section 5.3.3.2.2 of the 1996
7 GEIS. The 1996 GEIS concluded that the probabilistically weighted consequences and impacts
8 were small compared to other risks to which the populations surrounding NPPs are routinely
9 exposed.

10
11 Appendix E of this document provides an update on postulated accident risk. Since the NRC's
12 understanding of accident risk has naturally evolved since the issuance of the 1996 GEIS,
13 Appendix E assesses more recent information on postulated accidents that might alter the
14 conclusions in Chapter 5 of the 1996 GEIS. This update considers how these developments
15 would affect the conclusions in the original GEIS, and provides comparative data where
16 appropriate.

17
18 The different sources of new information can be generally categorized by their effect of either
19 decreasing, not affecting, or increasing the best-estimate environmental impacts associated
20 with postulated severe accidents. Those areas where a decrease in best-estimate impacts
21 would be expected are:

- 22
- 23 • New internal events information (decreases by an order of magnitude), and
- 24
- 25 • New source term information (significant decreases).
- 26

27 Areas likely leading to either a small change or no change include:

- 28
- 29 • Use of BEIR-VII risk coefficients.
- 30

31 Last, those areas leading to an increase in best-estimate impacts would consist of:

- 32
- 33 • Consideration of external events (comparable to internal event impacts),
- 34
- 35 • Power uprates (small to moderate increase),
- 36
- 37 • Higher fuel burnup (small to moderate increases),
- 38
- 39 • Low power and reactor shutdown events (could be comparable to internal event
- 40 impacts), and
- 41
- 42

Environmental Consequences and Mitigating Actions

- 1 • Spent fuel pool accidents (could be comparable to internal event impacts).

2
3 Given the difficulty in conducting a rigorous aggregation of these results, with the differences
4 in the information sources utilized, a fairly simple approach is taken. The latter group contains
5 three areas where the increase could be comparable to the current risk and two areas where
6 the increase could approach 30–40 percent. The net increase from these five areas would
7 therefore be (in a simplistic sense) approximately 470 percent^(a) (increase by a factor of 4.7).
8 The reduction in risk due to newer internal event information would account for a decrease by a
9 factor of 5 to 100. Some of the reduction in internal event risk is due to newer source term
10 information, so this area will not be double-counted here. The net effect of an increase on the
11 order of 500 percent and a decrease on the order of 500 percent to 10,000 percent would be
12 than lower estimated impacts.

13
14 Furthermore, even if one assumed that the net effect of the new information was no change in
15 risk, the information provided throughout Appendix E demonstrates that the level of
16 conservatism in the upper bound estimates utilized in the 1996 GEIS is much larger than the
17 individual (or cumulative) deltas from the updated information. In particular, Section E.3.1 of
18 Appendix E demonstrated that the 1996 GEIS values were a factor of 2 to 4 higher than the
19 underlying EIS values.

20
21 With respect to uncertainties, the 1996 GEIS contained an assessment of uncertainties in the
22 information used to estimate the environmental impacts. Section 5.3.5 of the 1996 GEIS
23 discusses the uncertainties and concludes that they could cause the impacts to vary anywhere
24 from a factor of 10 to a factor of 1,000. This range of uncertainties bounds the uncertainties
25 discussed in Section E.3.9 of Appendix E of this document, which ranged from a factor
26 of 3 to 10, as well as the uncertainties brought out by the other sources of new information.

27
28 Given the discussion in Sections E.3.1 through E.3.8 in Appendix E of this document, it is
29 concluded that the reduction in environmental impacts from the use of new information
30 outweighs any increases resulting from new considerations. As a result, the findings in the
31 1996 GEIS remain valid. In addition, it is reasonable based on the discussion in Appendix E
32 that, in license renewal applications, the impacts from reactor accidents at full power (including
33 internal and external events) should continue to be considered in assessing Severe Accident
34 Mitigation Alternatives (SAMAs). The impacts of all other new information do not contribute
35 sufficiently to the environmental impacts to warrant their inclusion in the SAMA analysis, since
36 the likelihood of finding cost-effective plant improvements is small. However, alternatives to
37
38

(a) This approximation simply assumes that each comparable area results in an increase of 100% and the other two areas (uprates and burnup) each result in an increase of 35%.

Environmental Consequences and Mitigating Actions

1 mitigate severe accidents still must be considered for all plants that have not considered such
 2 alternatives. The table below provides a summary of the conclusions discussed above.
 3

Table 4.9.1.2–1. Summary of Issues Covered in Appendix E

Topic (Section)	Conclusions
New Internal Events Information (Section E.3.1)	New information on the risk and environmental impacts of severe accidents caused by internal events indicates that PWR and BWR core damage frequencies (CDFs) are generally comparable to or less than those forming the basis of the 1996 GEIS. In some cases, these differences are significant (approaching 1 order of magnitude). Comparison of population dose from newer assessments illustrates a reduction in impact by a factor of 5 to 100 when compared to older assessments, and an additional factor of 2 to 4 due to the conservatism built into the 1996 GEIS values. This would also mean that contamination of open bodies of water and economic impacts would, in most cases, be significantly less. Additionally, the likelihood of basemat melt-through accidents is significantly less than that used in the analysis supporting the 1996 GEIS.
Consideration of External Events (Section E.3.2)	The 1996 GEIS did not explicitly consider severe accidents initiated by external events in assessing environmental impacts. When the environmental impacts of external events are considered, they can be comparable to those from internal events; however, they are generally significantly lower than the estimates used in the 1996 GEIS. This conclusion would also apply to the contamination of open bodies of water, groundwater and economic impacts.
New Source Term Information (Section E.3.3)	Increased peak fuel burn-up from 42 to 75 Gwd/mt for PWRs, and 60 to 75 Gwd/mt for BWRs, is estimated to result in small to moderate increases (up to 38%) in the environmental impacts in the event of a severe accident.
Power Upgrades (Section E.3.4)	Based on a comparison of the change in large early release frequency (LERF) for extended power upgrades, a small to moderate increase in environmental impacts results from the increase in operating power level.
Higher Fuel Burn-up (Section E.3.5)	Increased peak fuel burn-up from 42 to 75 GWd/MT for PWRs, and 60 to 75 GWd/MT for BWRs, is estimated to result in small to moderate increases (up to 38 percent) in the environmental impacts in the event of a severe accident.
Consideration of Low Power and Reactor Shutdown Events (Section E.3.6)	In summary, it is concluded that the environmental impacts from accidents at low power and reactor shutdown conditions are generally comparable to those from accidents at full power when comparing the NUREG/CR-6143 and NUREG/CR-6144 values to NUREG-1150 values. Even so, the 1996 GEIS estimates of the environmental impact of severe accidents bound the potential impacts from accidents at low power and reactor shutdown. Finally, as cited above and discussed in SECY-97-168, industry initiatives taken during the early 1990s have also contributed to the improved safety of low power and reactor shutdown operation.

4
5

Environmental Consequences and Mitigating Actions

Table 4.9.1.2–1. (Cont.)

Topic (Section)	Conclusions
Consideration of Spent Fuel Pool Accidents (Section E.3.7)	In summary, it is concluded that the environmental impacts from accidents at spent fuel pools (SFPs) (as quantified in NUREG-1738) can be comparable to those from reactor accidents at full power (as estimated in NUREG-1150). Subsequent analyses performed, and mitigative measures employed since 2001 have further lowered the risk of this class of accidents. In addition, even the conservative estimates from NUREG-1738 are much less than the impacts from full power reactor accidents as estimated in the 1996 GEIS.
Use of BEIR-VII Risk-Coefficient (Section E.3.8)	The current process and scope of SAMA analysis is sufficient for determining the need for additional mitigative measures.
Uncertainties (Section E.3.9)	The impact and magnitude of uncertainties, as estimated in the 1996 GEIS, bound the uncertainties introduced by the new information and considerations.
SAMAs (Section E.4)	The current process and scope of SAMA analysis is sufficient for determining the need for additional mitigative measures.
Summary/Conclusion (Section E.5)	Given the new and updated information, the reduction in estimated environmental impacts from the use of new internal event and source term information outweighs any increases from the consideration of external events, power uprates, higher fuel burn-up, low power and reactor shutdown risk, and SFP risk.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18

4.9.2 Environmental Consequences of Alternatives to the Proposed Action

Construction – Impacts on workers are expected to be similar to those experienced during construction of any major industrial facility. Impacts from construction of combustion-based renewable energy facilities are expected to be the same as those for construction of fossil fuel facilities. Construction would increase traffic on local roads, which could affect the health of the general public. Human health impacts would be the same for all facilities whether located on greenfield sites, brownfield sites, or at an existing nuclear plant. Personal protective equipment, training, and engineered barriers would protect the workforce.

Summaries of statistics maintained by the U.S. Department of Labor, Bureau of Labor Statistics (Meyer and Pegula 2006) indicate that construction activities are responsible for a significant share of workplace accidents. In 2004, the construction industry accounted for 1 in 5 fatal workplace injuries and 1 in 10 nonfatal workplace injuries. With a workforce of 10,272,000 workers in 2004, the private construction industry registered 1234 total fatalities in the following categories: falls, 445 (36 percent); transportation incidents, 287 (23 percent) (highway 148,

1 non-highway 45, worker struck by vehicle/mobile equipment, 78); contact with objects and
2 equipment, 267 (18 percent) (struck by object, 150; caught in or crushed in collapsing materials
3 71); exposure to harmful substances and environments, 170 (14 percent); and contact with
4 electric current, 122 (10 percent). Over that same period, of a total of 401,000 nonfatal injuries
5 and illnesses in the construction industry (nonfatal injuries that resulted in at least one day away
6 from work) totaled 153,200 in the following categories: overexertion, 30,460 (20 percent); struck
7 by object, 27,950 (18 percent); fall to lower level, 20,950 (14 percent); fall to same level, 12,700
8 (8 percent); and struck against object, 12,720 (8 percent).

9 10 **4.9.2.1 Fossil Energy Alternatives**

11 12 **Environmental Consequences of Normal Operating Conditions**

13
14 *Operations* – In 2006, the U.S. Department of Labor’s (DOL’s) Bureau of Labor Statistics
15 revealed 134,400 individuals employed in the fossil fuel electric power generation industrial
16 sector (North American Industry Classification System (NAICS) Code 221112) (DOL 2007a).
17 For 2006 (DOL 2007b), DOL documented 17 total fatalities for all of the electric power
18 generating industrial sector (NAICS Code 22111) and 5 fatalities for fossil fuel electric power
19 generation. In 2006, the nonfatal injury and illness incident rate was 3.9 cases per 100 fulltime
20 workers, slightly higher than the incident rate of 3.1 cases per 100 full-time workers for the
21 entire electric power generation sector. Total reportable incidents occurred at a rate of 2.2 per
22 100 full-time workers. Those incidents that resulted from lost time at work occurred at a rate of
23 1.2 cases per 100 full-time workers.

24
25 Human health risks are associated with the management and disposal of coal combustion
26 waste. Human health risks may extend beyond the facility workforce to human and are
27 proximate to the coal combustion waste disposal facility. The character and the constituents of
28 coal combustion waste depend on both the chemical composition of the source coal and the
29 technology used to combust it. Generally, the primary sources of adverse consequences from
30 coal combustion waste are the presence of leachable, toxic (and, in some cases, carcinogenic)
31 heavy metals primarily contained in fly ash and bottom ash, especially arsenic, selenium, and
32 mercury. With future implementation of regulations limiting mercury emissions, the amount of
33 mercury present in coal combustion waste is expected to rise, and, depending on the particular
34 chemical speciation, the amount of leachable mercury in coal combustion waste may also
35 increase. Depending on the coal source, radionuclides may also be present in coal combustion
36 waste.

37
38 The EPA is considering regulations specific to disposal of coal combustion waste under the
39 authority of Subtitle D of the Resource Conservation and Recovery Act (RCRA) (EPA 2007b).
40 Preliminary (draft) risk assessments of historical disposal practices for coal combustion waste in
41 landfills and surface water impoundments identified both direct and indirect (food chain

Environmental Consequences and Mitigating Actions

1 contamination) pathways for human exposure. Overall, when all types of landfills and surface
2 impoundments are evaluated in aggregate, the cancer risk criterion for arsenic (1×10^{-6}) can be
3 exceeded for both unlined units (5×10^{-4}) and clay-lined units (2×10^{-4}). Arsenic cancer risks
4 are higher for unlined surface impoundments (9×10^{-3}) and for clay-lined units (3×10^{-3}).
5 Composite (synthetic) liners, which have been used in the majority of the most recently
6 constructed landfills and surface impoundments, greatly reduce infiltration of leachable
7 constituents, so much so that risks at all percentiles fall below both the cancer and noncancer
8 risk criteria for both landfills and surface impoundments.

9
10 Although future alternative power generating facilities are most likely to use offsite disposal of
11 coal combustion waste, some short-term storage of coal combustion waste (either in open piles
12 or in surface impoundments) is likely to take place onsite, thus establishing the potential for
13 leaching of toxic constituents into the local environment. Mobility studies indicate that toxic
14 constituents take hundreds to thousands of years to leach through the bottoms of landfills and
15 less than 100 years to leach through the bottom surface impoundments. However, because
16 each batch of coal combustion waste would likely remain in interim onsite storage for only a
17 short period, the potential for release of toxic constituents into the environment is greatly
18 reduced. Offsite disposal facilities would be designed and operated in a manner that minimizes
19 impacts from leached constituents.

20 21 **Environmental Consequences of Accidents**

22
23 Accidents involving fossil fuel energy sources that affect the functionality of the boiler or the
24 steam cycle would have the most significant impacts. Steam explosions and other mechanical
25 failures have the potential for adverse consequences on the workforce, but are not likely to
26 directly affect the surrounding public or natural resources. Failures of pollution control devices
27 would have an immediate but short-term impact on the environment because of the resulting
28 release of pollutants. However, operating permits would require immediate shutdown of
29 combustion sources whose pollution control devices became inoperative and prohibit continued
30 operation that bypasses the failed control device. However, pollution control device failures, as
31 well as other accidents that are sufficiently severe so as to require the shutdown of operations,
32 would result in indirect impacts on the public in the form of reduced available power and
33 possible short-term brownouts or blackouts. Although power might be restored relatively
34 quickly, longer-term impacts may include a temporary rise in the levelized cost of electricity.

35
36 Overall, impacts on the environment from accidents at a fossil-fuel fired plant are expected to be
37 short-lived and small. Longer-term impacts on socioeconomics could be anticipated both as a
38 result of job loss and (temporary) higher costs of energy, but overall would be expected to be
39 small.

1 **4.9.2.2 New Nuclear Alternatives**

2
3 **Environmental Consequences of Normal Operating Conditions**

4
5 *Operations* – Operational human health impacts for a new nuclear plant would include radiation
6 exposure to the public (at very low levels) and to the operational workforce; impacts from
7 exposure to microbiological organisms; occupational safety risks; impacts from electromagnetic
8 fields; and exposure to chemicals used onsite by the workers. Impacts on human health, in
9 most cases, were determined to be small in 10 CFR Part 51, Appendix B, Table B-1, and
10 although the table is specific to license renewal, similar human health impacts would be
11 expected from the operation of a new nuclear facility. Human health impacts would be the
12 same for all facilities, whether located on greenfield sites, brownfield sites, or sites located at a
13 previously existing nuclear plant, and are expected to be small.

14
15 **Environmental Consequences of Accidents**

16
17 A detailed analysis of postulated accidents in currently operating reactors (affected by license
18 renewal) is provided in Section 4.9.1.2. Although the analysis is specific to license renewal, the
19 impacts are representative of the impacts expected for new reactors. As previously discussed,
20 the new reactor designs incorporate additional safety features not found in currently operating
21 reactors. As a result, it is expected that the risks associated with the new reactors would be
22 comparable to or less than the risks associated with currently operating reactors. Before a
23 license is granted, the application for a new reactor would undergo a detailed safety and
24 environmental review to ensure that the plant, if constructed, would operate in accordance with
25 all applicable NRC rules and regulations.

26
27 **4.9.2.3 Renewable Alternatives**

28
29 *Operations* – The operational impacts of alternative energy technologies on human health are
30 presented in the following subsections.

31
32 **Hydroelectric Energy Sources**

33
34 Impacts on workers include working near energized systems and high pressure water.

35
36 **Geothermal**

37
38 Operating workers could be affected by exposure to toxic gases and other constituents present
39 in geothermal fluids, energized systems, including high pressure and high temperature gases
40 and fluids, and electromagnetic fields associated with the generation, conditioning, and
41

Environmental Consequences and Mitigating Actions

1 transmission of electricity. Workers could be affected by exposure to toxic constituents,
2 including boron, arsenic, radon, and mercury.

3 4 **Wind**

5
6 Operational hazards for the workforce include working at heights, near rotating mechanical or
7 energized equipment, and working in extreme weather. Additional hazards unique to offshore
8 wind farms include navigating and working in heavy seas. Potential impacts to workers and the
9 public include ice thrown from rotor blades and blades thrown from mechanical failure and
10 disintegration. Potential impacts also include EMF exposure, aviation safety, electromagnetic
11 interference, and exposure to low-frequency sound.

12 13 **Biomass**

14
15 Human health risks to workers are expected to be similar to workers in a coal combustion
16 facility. Work hazards include exposure to heat, gases, chemicals, high temperature liquids,
17 and energized mechanical and electrical equipment. The potential exists for exposure to
18 inhalable particulates and polyaromatic hydrocarbons (PAHs) resulting from incomplete
19 combustion of complex organic molecules. The public could be affected by fugitive dust and
20 contaminated water.

21 22 **Municipal Solid Waste, Refuse-Derived Fuel and Landfill Gas**

23
24 Combustion of municipal solid waste and/or refuse-derived fuel may result in the release of
25 constituents that are persistent, bioaccumulative, and toxic, PAHs, and chlorinated
26 hydrocarbons. The workforce as well as nearby residents could be affected by the release of
27 toxic constituents to the air. The workforce could also be affected by exposure to toxic wastes.

28 29 **Solar Thermal**

30
31 Potential hazards to workforce include exposure to extremely hot heat transfer fluids or burned
32 from misaligned mirrors and contact with energized system components.

33 34 **Solar Photovoltaic**

35
36 Workers could be exposed to airborne toxic heavy metals (e.g., cadmium) and silicon if the
37 photovoltaic cell loses integrity from a fire. Workers could also inhale silicon dust if the integrity
38 of photovoltaic cells was compromised by an accident.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40

Ocean Wave and Current

Operation of wave- and current-energy capturing systems would not be expected to affect human health. Workers could be affected by possible exposure to energized systems, inclement weather conditions, and high sea states. Workers could be affected by work underwater inspecting and repairing cables and tethers.

4.10 Environmental Justice

4.10.1 Environmental Consequences of the Proposed Action – Continued Operations and Refurbishment Activities

Impacts of nuclear plant operations and refurbishment on minority and low-income populations living in the vicinity of nuclear power plants were not addressed in the 1996 GEIS because guidance for implementing Executive Order 12898 was not available at the time. Environmental justice was listed in Table B-1 in Appendix B, Subpart A, of 10 CFR Part 51, but was not assigned an issue category or impact significance. The finding stated that “The need for and the content of an analysis of environmental justice will be addressed in plant-specific reviews.”

The analysis evaluated the potential for disproportionately high and adverse human health and environmental effects on minority and low-income populations that could result from nuclear plant operations and refurbishment of a nuclear power plant. Adverse health effects are measured in terms of the risk and rate of fatal or nonfatal adverse impacts on human health. Disproportionately high and adverse human health effects occur when the risk or rate of exposure to an environmental hazard for a minority or low-income population is significant and exceeds the risk or exposure rate for the general population or for another appropriate comparison group. Minority and low-income populations are subsets of the general public residing around the site, and all are exposed to the same risks and hazards generated from various operations at the nuclear plant site. Continued operations and other activities associated with license renewal could affect air, land, water, and ecological resources in the region around each nuclear power plant site, which might, create health and other environmental effects on the general population. Depending on the proximity of minority and low-income populations in relation to each nuclear plant, the environmental impacts of license renewal could have a disproportionate effect on these populations.

There is considerable variation in the representation of minority and low-income populations within 50 mi (80 km) of each nuclear power plant site. Sites located in the southern and southwestern United States have large minority populations (e.g., Browns Ferry, Brunswick,

Environmental Consequences and Mitigating Actions

1 Catawba, Farley, North Anna, Robinson, Summer, and Surry plants). Sites located close to
2 metropolitan areas also have larger minority populations as well as larger low-income
3 populations (e.g., Dresden, Ginna, Indian Point, and Pilgrim plants).
4

5 The location and significance of environmental impacts may affect population groups that are
6 particularly sensitive because of their resource dependencies or practices (e.g., subsistence
7 agriculture, hunting, or fishing) that reflect the traditional or cultural practices of minority and
8 low-income populations. The analysis of special pathway receptors can be an important part of
9 the identification of resource dependencies or practices. Special pathways take into account
10 the levels of contaminants in native vegetation, crops, soils and sediments, surface water, fish,
11 and game animals on or near the power plant sites in order to assess the risk of radiological
12 exposure through subsistence consumption of fish, native vegetation, surface water, sediment,
13 and local produce; the absorption of contaminants in sediments through the skin; and the
14 inhalation of airborne particulates. All licensed nuclear plants have a comprehensive
15 radiological environmental monitoring program to assess the impact of site operations on the
16 environment. Samples are collected from the aquatic and terrestrial pathways applicable to
17 these sites. Aquatic pathways include fish, surface water, and sediment; terrestrial pathways
18 include airborne particulates, radioiodine, milk, food products, crops, and direct radiation.
19 Concentrations of contaminants in native vegetation, crops, soil, sediment, surface water, fish,
20 and game animals in areas surrounding nuclear power plants have generally been found to be
21 quite low (at or near the threshold of detection) and seldom above background levels.
22

23 Pathways associated with continued operations and other activities at nuclear plants associated
24 with the license renewal might affect human populations were considered. Also considered was
25 the extent to which minority and low-income populations in the area around these plants could
26 be disproportionately affected, through resource dependencies and practices (e.g., subsistence
27 agriculture, hunting, or fishing). In addition, plant-specific impacts that could affect minority and
28 low-income populations were also identified at nuclear power plants. Although the overall
29 impact of nuclear plants on the general population has usually been found to be small, because
30 of these unique considerations, the additional examination of the nature and geographic extent
31 of impacts and population demographics should be considered on a plant-specific basis.
32

33 On the basis of these considerations, the impact of continued operations and other activities on
34 minority and low-income populations could be small to moderate, depending on the plant and
35 site-specific conditions, and is therefore determined to be a Category 2 issue.
36

37 **4.10.2 Environmental Consequences of Alternatives to the Proposed Action**

38
39 *Construction* – Minority and low-income populations could be affected by the construction of a
40 power plant. The extent of disproportionate effect is difficult to determine since it would depend
41 on the location of the plant. For example, increased demand for rental housing during

1 construction could disproportionately affect low-income populations. However, demand for
2 rental housing could be mitigated if the plant is constructed near a metropolitan area. Power
3 plants would likely be sited at brownfield sites situated near low-income and minority
4 populations. Construction would also create employment opportunities for minority and low-
5 income individuals. However, construction at a brownfield site could disproportionately affect
6 minority and low-income populations residing in the vicinity of the proposed plant site. Minority
7 and low-income populations may be disproportionately affected by air emissions and noise from
8 construction and by increased truck and commuter traffic.

9
10 Increased fossil fuel consumption may affect employment opportunities and environmental
11 conditions in low-income regions that supply the fossil fuel. Power plants that rely on fossil
12 fuels would likely be sited at brownfield sites situated near low-income and minority populations.

13
14 *Operation* – Low-income populations that rely on subsistence consumption of fish and wildlife,
15 living near power plants could be disproportionately affected. Minority and low-income
16 populations may be disproportionately affected by air emissions and noise from facility
17 operation and by increased truck and commuter traffic.

20 **4.11 Waste Management and Pollution Prevention**

22 **4.11.1 Environmental Consequences of the Proposed Action – Continued** 23 **Operations and Refurbishment Activities**

24
25 The effects of license renewal (including operations and refurbishment that would occur during
26 the license renewal term) on waste management is presented in this section. Baseline
27 conditions at operating reactors are discussed in Section 3.11. License renewal is expected to
28 result in a continuation of these conditions for an extended period commensurate with the
29 license renewal term, usually 20 years. The annual quantities of waste generated during the
30 license renewal term are not expected to change from the amount generated during the current
31 licensed term. However, the accumulated quantity of waste material needing long-term storage
32 or disposal is expected to be approximately 50 percent larger.

33
34 The impacts associated with onsite waste management activities at nuclear plants are
35 addressed in other parts of Chapter 4 under various resource discussions. These activities
36 include waste collection, treatment, packaging, and loading onto conveyance vehicles for
37 shipment offsite. These activities are considered to be part of the normal operations at the site.
38 For example, the annual radioactive effluent release reports issued by the sites include a
39 summary of radioactive effluent releases from all the facilities on the site, including the waste
40 management and storage facilities. The same reports also provide data on volume and

Environmental Consequences and Mitigating Actions

1 radioactivity content of solid radioactive waste shipped offsite for processing and disposal.
2 Similarly, the radiological environmental monitoring program conducted at each site measures
3 the direct radiation as well as environmental concentrations of all radionuclides originating at the
4 site as well as background radiation. The impact from the transportation of wastes from the
5 reactor to a third-party waste treatment center or directly to a disposal site is addressed
6 generically in Table S-4 in 10 CFR 51.52 (see Section 4.2.212.1.1).

7
8 The issues that are addressed in this section are

- 9
- 10 • Low-level radioactive waste (LLW) storage and disposal,
- 11
- 12 • Onsite storage of spent nuclear fuel,
- 13
- 14 • Offsite radiological impacts of spent nuclear fuel and high-level waste disposal,
- 15
- 16 • Mixed waste storage and disposal, and
- 17
- 18 • Nonradiological waste storage and disposal.
- 19

20 These are five of the nine issues evaluated in the 1996 GEIS (NRC 1996) in the chapter on the
21 uranium fuel cycle and waste management. They relate to waste management at all nuclear
22 fuel cycle facilities, including nuclear power plants. The other four issues, which pertain
23 specifically to aspects of the uranium fuel cycle other than the nuclear power plants themselves,
24 are addressed in Section 4.2.212.1.1. As discussed in Section 4.2.212.1.1, the other nuclear
25 fuel cycle facilities include uranium mining and milling, uranium hexafluoride (UF₆) production,
26 isotopic enrichment, fuel fabrication, fuel reprocessing, and disposal facilities.

27 *Low-Level Radioactive Waste Storage and Disposal*

28
29
30 Section 3.11.1.1 provides the quantities and characteristics of LLW that are normally generated
31 at nuclear plants under routine operating conditions. As stated in the introduction to
32 Section 4.11.1, these baseline conditions are expected to continue during the license renewal
33 term.

34
35 Prior to July 1, 2008, most of the LLW generated at reactor sites is shipped offsite for disposal
36 either immediately after generation or after a brief storage period onsite (see Section 3.11.1.1).
37 This trend is expected to continue. However, the Barnwell disposal facility in South Carolina,
38 ceased accepting waste from States that are not a part of the Atlantic compact as of July 2008.
39 As a result, the only remaining disposal facility that is available to those 36 States and to the
40 nuclear power plant operators in those States is the EnergySolutions facility in Clive, Utah,
41 which is licensed to accept only Class A LLW. Under these circumstances, the options

1 available to the nuclear power plants in those States are to store their Class B and C (and
2 Class A as appropriate) wastes onsite or offsite until a disposal facility becomes available.
3 Such activities are conducted in accordance with NRC regulations and any applicable State or
4 local requirements. One new facility is being developed by the Waste Control Specialists in
5 Texas for the Texas compact, comprised of Texas and Vermont. That facility is currently
6 undergoing licensing procedures by the State of Texas (an NRC agreement State).

7
8 The NRC believes that the comprehensive regulatory controls that are in place and the low
9 public doses being achieved at reactors ensure that the radiological impacts on the
10 environment will remain small during the term of a renewed license. The maximum additional
11 onsite land that may be required for LLW storage during the term of a renewed license and
12 associated impacts would be small. Nonradiological impacts on air and water would be
13 negligible. The radiological and nonradiological environmental impacts of long-term disposal of
14 LLW from any individual plant at licensed sites are small. In addition, the NRC concludes that
15 there is reasonable assurance that sufficient LLW disposal capacity will be made available
16 when needed for facilities to be decommissioned consistent with NRC decommissioning
17 requirements.

18
19 On the basis of the above considerations, the impact of license renewal on LLW storage and
20 disposal is considered small for all sites. As in the 1996 GEIS, this issue is considered to be a
21 Category 1 issue.

22
23 In addition to being generated at the reactor sites, LLW is also generated from the rest of the
24 uranium fuel cycle as part of the front-end operations during the mining and milling of uranium
25 ores and during the steps leading up to the manufacture of new fuel. If the recycling option is
26 made available and the decision is made to reprocess the spent fuel in the United States, the
27 reprocessing operations would also generate LLW. The impacts associated with management
28 of LLW from these other fuel cycle operations are addressed in Table S-3 in 10 CFR 51.51
29 (see Section 4.12.1.1).

30 31 *Onsite Storage of Spent Nuclear Fuel*

32
33 The Commission determined, in the 1996 GEIS, that on-site storage of spent fuel during the
34 term of a renewed operating license is a Category 1 issue. Under the Waste Confidence Rule,
35 the NRC has determined that spent fuel can be stored onsite for at least 30 years beyond the
36 current license (which may include the term of a revised or renewed license) operating life of
37 nuclear power plants safely and with minimal environmental impact. Further, the Commission
38 also concluded that continued storage of existing spent fuel and storage of spent fuel
39 generated during the license renewal term can be accomplished safely and without significant
40 environmental impacts, as radiological impacts will be well within regulatory limits. The
41

Environmental Consequences and Mitigating Actions

1 following discussion provides information regarding the NRC staff's further consideration of
2 additional potential impacts of onsite storage of spent nuclear fuel.

3
4 As discussed in Section 3.11.1.2, spent nuclear fuel is currently stored at reactor sites either in
5 spent fuel pools or in ISFSIs. This onsite storage practice is expected to continue until an
6 ultimate repository for spent fuel and HLW is established and DOE takes possession of the
7 spent fuel. DOE's current plans estimate that the Yucca Mountain repository will start operating
8 sometime around the 2017 to 2020 time frame. However, the license application for the Yucca
9 Mountain repository is a separate and independent review that is being performed by the NRC
10 outside the regulatory scope of license renewal.

11
12 Interim storage needs vary among plants, with older units likely to lose pool storage capacity
13 sooner than newer ones. Given the uncertainties in the opening of a geologic repository at
14 Yucca Mountain and the lack of other options for DOE to take possession of spent fuels, as
15 originally envisioned in the Nuclear Waste Policy Act (NWPA), it is likely that future expanded
16 spent fuel storage capacity will be needed at all nuclear power plants. The NWPA, as
17 amended, prohibits the emplacement of more than 70,000 metric tonnes of heavy metal
18 (MTHM) (154 million lb of heavy metal) in the first repository for spent nuclear fuel disposal until
19 a second repository is in operation. DOE has indicated that of the 70,000 MTHM initially to be
20 approved for the first repository, 63,000 MTHM (139 million lb of heavy metal) will come from
21 commercial spent nuclear fuel and the remaining 7000 MTHM (15.4 million lb of heavy metal)
22 will be DOE materials (DOE 2002b). Under existing licenses, the cumulative spent fuel
23 generation for commercial plants could exceed 63,000 MTHM in the early to mid 2010s. To be
24 able to dispose of all of the spent fuel in a geologic repository like Yucca Mountain, even
25 without any license renewals, additional disposal capacity would be required in the form of an
26 expansion of the capacity of the first repository or construction of a second repository.

27
28 In 2006, The DOE announced a new initiative called the Global Nuclear Energy Partnership
29 (GNEP), and is currently preparing an EIS for its implementation. The GNEP initiative calls for
30 recycling of spent nuclear fuel in advanced reactors and, in the process, decrease the quantity
31 of material that needs to be disposed of in a geologic repository by an estimated factor of 50 to
32 100 (DOE 2007b). Consequently, if GNEP is implemented, there will be sufficient disposal
33 capacity in the first repository for all the existing reactors, with or without license renewal.
34 However, the outcome of GNEP is still uncertain, and the demonstration of the proposed GNEP
35 fuel recycling facilities is not expected until about 2020 (DOE 2006a). The actual facilities
36 would be expected to come on line some time after that if the implementation phase proceeds
37 as planned. A full implementation of the GNEP initiative, in its intended form, would likely
38 further reduce the onsite storage burden for commercial nuclear plants, and potentially further
39 reduce the impacts of onsite storage of spent nuclear fuel.

Environmental Consequences and Mitigating Actions

1 As discussed in the 1996 GEIS, current and potential environmental impacts from spent fuel
2 storage onsite at the current reactor sites have been studied extensively and are well
3 understood. The storage of spent fuel in spent fuel pools was considered for each plant in the
4 safety and environmental reviews at the construction permit and operating license stage. The
5 NRC has studied the safety and environmental effects from the temporary storage of spent fuel
6 after the cessation of reactor operations, and it published a generic determination of no
7 significant environmental impact (the Waste Confidence Rule) in its regulations at
8 10 CFR 51.23. 10 CFR 51.23 (a) states:

9
10 The Commission has made a generic determination that, if necessary, spent fuel
11 generated in any reactor can be stored safely and without significant
12 environmental impact for at least 30 years beyond the licensed life for operation
13 (which may include the term of a revised or renewed license) of that reactor at its
14 spent-fuel storage basin or at either on-site or off-site independent fuel storage
15 installations. Further, the Commission believes that there is reasonable
16 assurance that at least one mined geological repository will be available within
17 the first quarter of the twenty-first century, and sufficient repository capacity will
18 be available within 30 years beyond the licensed life for operation of any reactor
19 to dispose of the commercial high-level waste and spent fuel originating in such
20 reactor and generated up to that time.

21
22 As cited in the *Federal Register* on October 9, 2008 (73 FR 59547), the Commission undertook
23 another review of its Waste Confidence findings as part of an effort to enhance the efficiency of
24 combined operating license proceedings for applications for nuclear power plants anticipated in
25 the near future. To assure that its Waste Confidence findings are up to date, the Commission
26 has proposed to update two of the rule's findings. Public comment was requested on the
27 proposed changes. After a thorough review of the comments, a final version of the rule will be
28 issued. The Commission proposed that the second and fourth findings in the Waste
29 Confidence Decision be revised as follows:

30
31 Finding 2: The Commission finds reasonable assurance that sufficient mined geologic
32 repository capacity can reasonably be expected to be available within 50–60 years beyond the
33 licensed life for operation (which may include the term of a revised or renewed license) of any
34 reactor to dispose of the commercial high-level radioactive waste and spent fuel originating in
35 such reactor and generated up to that time.

36
37 Finding 4: The Commission finds reasonable assurance that, if necessary, spent fuel generated
38 in any reactor can be stored safely without significant environmental impacts for at least
39 60 years beyond the licensed life for operation (which may include the term of a revised or
40 renewed license) of that reactor in a combination of storage in its spent fuel storage basin and
41 either onsite or offsite independent spent fuel storage installations.
42

Environmental Consequences and Mitigating Actions

1 In its proposed amendments to 10 CFR 51.23 (a), the Commissions stated:

2

3

4

5

6

7

8

9

10 If revised, the proposed 10 CFR 51.23(a) would continue to support the NRC staff's finding in
11 the 1996 GEIS that spent fuel can be stored onsite with minimal environmental impact.

12

13

14

15

16

17

18

19 *Offsite Radiological Impacts from Disposal of Spent Nuclear Fuel and High-Level Waste*
20
21 In the 1996 GEIS, the Commission determined offsite radiological impacts (spent fuel and high
22 level waste disposal) to be a Category 1 issue. Furthermore, the ultimate disposal of spent
23 nuclear fuel in a potential future geologic repository is a separate and independent licensing
24 action that is outside the regulatory scope of license renewal. However, because of questions
25 and concerns that have been raised regarding this issue during scoping for the GEIS, the
26 following discussion provides relevant information with respect to developments pertaining to
27 the consideration of an ultimate repository site for the disposal of spent nuclear fuel.

28

29

30

31

32

33

34

35

36

37

38

39

40

41

On February 15, 2002, on the basis of a recommendation by the Secretary of Energy, the President recommended the Yucca Mountain site for the development of a repository for the geologic disposal of spent nuclear fuel and HLW. Congress approved this recommendation on July 9, 2002, in Joint Resolution 87, which designated Yucca Mountain as the repository for spent nuclear waste. On July 23, 2002, the President signed Joint Resolution 87 into law. Public Law 107-200, 116 *Statutes at Large* (Stat.) 735 of 2002 designates Yucca Mountain as the site for the development of the repository for spent nuclear waste.

1 Subsequently, the EPA developed Yucca-Mountain-specific repository release standards, which
2 were also adopted by the NRC in 10 CFR Part 63 (see 74 *FR* 10811). These standards:

- 3
- 4 • Establish a dose limit of 15 millirem (0.15 mSv) per year for the first 10,000 years after
5 disposal;
- 6
- 7 • Establish a dose limit of 100 millirem (1.0 mSv) annual exposure per year between
8 10,000 years and 1 million years;
- 9
- 10 • Require the Department of Energy to consider the effects of climate change,
11 earthquakes, volcanoes, and corrosion of the waste packages to safely contain the
12 waste during the 1 million-year period; and
- 13
- 14 • Are consistent with the recommendations of the NAS by establishing a radiological
15 protection standard for this facility at the time of peak dose up to 1 million years after
16 disposal.
- 17

18 On June 3, 2008, the DOE submitted a license application to the NRC, seeking authorization to
19 construct a geologic repository for the disposal of spent nuclear fuel and high-level waste at
20 Yucca Mountain, Nevada. As part of the site characterization and recommendation process for
21 the proposed geologic repository at Yucca Mountain, Nevada, the DOE is required by the
22 Nuclear Waste Policy Act of 1982 to prepare an EIS. By law, the NRC is required to adopt
23 DOE's EIS, to "the extent practicable," as part of any possible NRC construction authorization
24 decision. DOE submitted the following NEPA documents along with its application, which
25 include analyses that address radiological impacts to workers and the public.

- 26
- 27 • *Final Environmental Impact Statement for a Geologic Repository for the Disposal of*
28 *Spent Nuclear Fuel and High-Level Radioactive Waste at Yucca Mountain, Nye County,*
29 *Nevada* (FEIS) (February 2002) (DOE/EIS-0250F) (ML032690321)
- 30
- 31 • *Final Supplemental Environmental Impact Statement for a Geologic Repository for the*
32 *Disposal of Spent Nuclear Fuel and High-Level Radioactive Waste at Yucca Mountain,*
33 *Nye County, Nevada* (Repository SEIS) (June 2008) (DOE/EIS-0250F-S1)
34 (ML081750191)
- 35

36 The NRC formally accepted for docketing DOE's license application for Yucca Mountain,
37 Nevada on September 8, 2008. In its acceptance, NRC staff also recommended that the
38 Commission adopt, with further supplementation, the EIS and supplements prepared by DOE
39 (73 *FR* 53284). With respect to radiological impacts, DOE's FEIS and Repository SEIS indicate
40 that the disposal of spent nuclear fuel and high-level waste would be small with exposures well
41 below regulatory limits. As of the publishing date of this draft GEIS, the license application for
42

Environmental Consequences and Mitigating Actions

1 Yucca Mountain continues to be reviewed by the NRC staff as a separate and independent
2 licensing action outside the regulatory scope of license renewal and the GEIS.

3
4 This information regarding the ultimate disposal of spent nuclear fuel and high-level waste does
5 not alter the 1996 GEIS findings that impacts associated with such a proposed spent nuclear
6 fuel and high-level radioactive waste disposal facility would not be sufficiently large to require
7 the NEPA conclusion, for any plant, that the option of extended operation under 10 CFR Part 54
8 should be eliminated. Accordingly, although the Commission has not assigned a single level of
9 significance to the impact of spent fuel and HLW disposal, this issue is considered to be a
10 Category 1 issue.

11 12 *Storage and Disposal of Nonradioactive Waste*

13
14 This issue addresses the storage and disposal of nonradioactive waste generated at
15 commercial nuclear power plants and during the rest of the uranium fuel cycle during the
16 license renewal term. Nonradioactive waste consists of hazardous and nonhazardous waste.
17 Storage and disposal of hazardous waste generated at nuclear plants is discussed in
18 Section 3.11.2. As indicated in that section, nuclear plants generate small quantities of
19 hazardous waste during operation and refurbishment. A special class of hazardous waste,
20 known as universal waste, consisting of commonly used yet hazardous materials (batteries,
21 pesticides, mercury-containing equipment, and lamps), is also generated. Similar types of
22 hazardous wastes are also generated at other uranium-fuel-cycle facilities. The management
23 of hazardous wastes generated at all of these facilities, both onsite and offsite, is strictly
24 regulated by the EPA or the responsible State agencies per the requirements of RCRA.

25
26 As does any industrial facility, nuclear power plants and the rest of the uranium-fuel-cycle
27 facilities also generate nonradioactive nonhazardous waste (see Section 3.11.4). These wastes
28 are managed by following good housekeeping practices and are generally disposed of in local
29 landfills permitted under RCRA Subtitle D regulations.

30
31 In the 1996 GEIS, the impacts associated with managing nonradioactive wastes at uranium fuel
32 cycle facilities, including nuclear power plants, were found to be small. It was indicated that no
33 changes to nonradioactive waste generation would be anticipated for license renewal, and that
34 systems and procedures are in place to ensure continued proper handling and disposal of the
35 wastes at all plants. The issue was considered a Category 1 issue in the 1996 GEIS, and no
36 new information that would alter this conclusion has been identified.

37 38 *Storage and Disposal of Mixed Waste*

39
40 This issue addresses the storage and disposal of mixed waste generated at nuclear power
41 plants and other uranium-fuel-cycle facilities during the license renewal term. As discussed in

1 Section 3.11.3, nuclear power plants generate small quantities of mixed waste. Other uranium-
2 fuel-cycle facilities are also expected to generate small quantities of mixed waste. Mixed waste
3 is regulated both by the EPA or the authorized State agency under RCRA and by the NRC or
4 the Agreement State agency under the Atomic Energy Act (AEA; Public Law 83-703). The
5 waste is either treated onsite or sent offsite for treatment followed by disposal at a permitted
6 landfill.

7
8 The comprehensive regulatory controls and the facilities and procedures that are in place at
9 nuclear power plants ensure that the mixed waste is properly handled and stored and that
10 doses to and exposure to toxic materials by the public and the environment are negligible at all
11 plants. License renewal will not increase the small but continuing risk to human health and the
12 environment posed by mixed waste at all plants. The radiological and nonradiological
13 environmental impacts from the long-term disposal of mixed waste at any individual plant at
14 licensed sites are considered small for all sites. The issue was considered a Category 1 issue
15 in the 1996 GEIS, and no new information that would alter this conclusion has been identified.

16 17 **4.11.2 Environmental Consequences of Alternatives to the Proposed Action**

18
19 *Construction* – Construction-related wastes include various fluids from the onsite maintenance
20 of construction vehicles and equipment (e.g., used lubricating oils, hydraulic fluids, glycol-based
21 coolants, spent lead-acid storage batteries) and incidental chemical wastes from the
22 maintenance of equipment and the application of corrosion-control protective coatings
23 (e.g., solvents, paints, coatings), construction-related debris (e.g., lumber, stone, and brick), and
24 packaging materials (primarily wood and paper). All materials and wastes would be
25 accumulated onsite and disposed of or recycled through licensed offsite disposal and treatment
26 facilities. Life-cycle management of chemicals and wastes generated during construction and
27 pollution prevention initiatives (such as spill prevention plans) will serve to mitigate the impact of
28 wastes. The impacts of waste management are expected to be the same for greenfield,
29 brownfield, and existing nuclear power plant sites.

30
31 *Operation* – Solid wastes would be generated throughout the period of plant operations. The
32 character of wastes would depend on chemical constituents of the fuel, efficiency of
33 combustion, and operational efficiencies of the various air pollution control devices. Wastes
34 routinely associated with the maintenance of mechanical and electrical equipment include: used
35 lubricating oils and hydraulic fluids, cleaning solvents, corrosion control paints and coatings,
36 and dielectric fluids.

37 38 **4.11.2.1 Fossil Fuel Alternatives**

39
40 *Operation* – Solid wastes in the form of coal combustion waste (and, in some instances, flue
41 gas desulfurization sludge and spent catalysts) would be generated during plant operations.

Environmental Consequences and Mitigating Actions

1 The exact character of the coal combustion waste would depend on the chemical constituents
2 of the coal, efficiency of the combustion device, and operational efficiencies of the various air
3 pollution control devices.

4 5 **4.11.2.2 New Nuclear Alternatives** 6

7 *Operation* – Liquid, gaseous, and solid radioactive waste management systems would be used
8 to collect and treat radioactive materials during operations. Waste processing systems would
9 be designed to meet the objectives of Appendix I to 10 CFR Part 50. The primary source of
10 radioactive waste from a new nuclear facility is fission products that escape from the fuel rods
11 into the reactor coolant. Coolant could also become contaminated from neutron activation of
12 the primary cooling system. LLW disposal is assumed to occur at an offsite location, while
13 spent fuel would be stored onsite either in spent fuel pool storage or aboveground dry storage.
14

15 Nonradioactive effluent and wastes include cooling water and steam condensate blowdowns
16 that contain various water-treatment chemicals or biocides, wastes from the onsite treatment of
17 cooling water and steam cycle water, floor and equipment drain effluent, stormwater runoff,
18 laboratory waste, trash, hazardous waste, effluent from the sanitary sewer system,
19 miscellaneous gaseous emissions, and liquid and solid effluent. Liquid effluents would be
20 regulated by NPDES permits. All other wastes would be properly disposed of in accordance
21 with Federal, State, and local regulations. Waste impacts for a nuclear plant are described in
22 Section 4.11.1 and in 10 CFR 51, Appendix B, Table B-1. Impacts are expected to be small for
23 all facilities, whether located on greenfield sites, brownfield sites, or at existing nuclear plant
24 sites.
25

26 **4.11.2.3 Renewable Alternatives** 27

28 *Operations* – The operational impacts of alternative energy technologies on waste management
29 are presented in the following subsections.
30

31 **Geothermal** 32

33 Small amounts of industrial solid wastes associated with onsite maintenance of equipment and
34 infrastructure would be generated, including: used oils, used glycol-based antifreeze, waste
35 lead-acid storage batteries, spent cleaning solvents, and excess corrosion control coatings.
36 Operational solid wastes could include precipitates (scale) resulting from cooling and
37 depressurized hydrothermal fluids that must be periodically removed from equipment; some
38 precipitates may include naturally occurring radioactive material (NORM).
39

1 **Wind**

2
3 Minimal amounts of wastes are generated from the maintenance of wind turbines; wastes
4 consist mainly of spent lubricating and gear oils removed from equipment during routine
5 preventive maintenance, small amounts of battery electrolyte from onsite back-up power
6 systems, and minor amounts of solvents and coatings from ongoing corrosion control activities.
7 Modern turbine designs allow for the easy removal of malfunctioning equipment for replacement
8 and repair; consequently, wastes generated onsite would be limited to preventive maintenance-
9 related wastes.

10
11 **Biomass**

12
13 Major operating wastes would include fly ash and bottom ash that results from the combustion
14 of the carbonaceous fuels. Scrubbers for control of sulfur oxide emissions would not be
15 expected to be needed for units combusting wood and energy crops that have little to no sulfur
16 content. Temporary storage of operational solid wastes onsite could affect local ecological
17 systems, especially surface waters.

18
19 **Municipal Solid Waste, Refuse-Derived Fuel and Landfill Gas**

20
21 Small amounts of industrial solid wastes typically associated with maintenance of equipment
22 and infrastructure would be generated, including used oils and lubricants, used glycol-based
23 coolants, waste lead-acid batteries, spent cleaning solvents, and excess corrosion control
24 wastes. Operating wastes also would include small amounts of sanitary wastewaters and
25 sanitary solid wastes from support of the workforces. Toxic constituents in municipal solid
26 waste or refuse-derived fuel could cause solid wastes from air pollution devices to become
27 hazardous due to leachability of toxic constituents. Sanitary wastewater and well as
28 wastewaters from industrial operations would be containerized and removed to offsite
29 treatment; cooling water blowdown and steam cycle blowdown may be discharged to the land
30 surface or to surface impoundments. Temporary storage of operational solid wastes on site
31 could impact local ecological systems, especially surface waters.

32
33 **Solar Thermal**

34
35 Spills and leaks of the heat transfer fluids could occur; affected soil would need to be removed
36 and disposed of properly. Routine maintenance-related wastes would be expected. Spills or
37 leaks from electrical components could create waste dielectric fluids (all assumed to be free of
38 polychlorinated biphenyls [PCBs]).
39

Environmental Consequences and Mitigating Actions

1 **Solar Photovoltaic**

2

3 Proper precautions would have to be made for the disposal of solar cells, although recycling of
4 materials would reduce impacts.

5

6 **Ocean Wave and Current**

7

8 Wastes associated with facility operation would include small amounts of wastes related to
9 facility maintenance, including waste lubricating oils, hydraulic fluids, cleaning solvents, and
10 protective corrosion-control paints and coatings. Wastes also include those associated with the
11 application of antifouling agents to the underwater portions of components to control
12 interference by marine organisms. Major repairs of electrical components could result in waste
13 dielectric fluids (mineral oil).

14

15

16

17 **4.12 Impacts Common to All Alternatives**

18

19 **4.12.1 Environmental Consequences of Fuel Cycles**

20

21 **4.12.1.1 Uranium Fuel Cycle**

22

23 This section addresses the environmental impacts associated with the uranium fuel cycle as
24 they apply to license renewal. In the United States, all currently operating commercial plants
25 are light water reactors and use uranium for fuel. Therefore, in this section and in the rest of
26 this GEIS, the term “uranium fuel cycle” is used interchangeably with “nuclear fuel cycle.”

27

28 **Uranium Fuel Cycle Facilities**

29

30 The NRC evaluated the environmental impacts that would be associated with operating uranium
31 fuel cycle facilities other than the reactors themselves in two NRC documents: WASH-1248
32 (NRC 1974) and NUREG-0116 (NRC 1976). The types of facilities considered in these two
33 documents include:

34

35 • Uranium mining – facilities where the uranium ore is mined.

36

37 • Uranium milling – facilities where the uranium ore is refined to produce uranium
38 concentrates in the form of triuranium octaoxide (U₃O₈).

39

40

Environmental Consequences and Mitigating Actions

- 1 • Uranium hexafluoride (UF₆) production – facilities where the uranium concentrates are
2 converted to UF₆.
3
- 4 • Isotopic enrichment – facilities where the isotopic ratio of the uranium-235 isotope in
5 natural uranium is increased to meet the requirements of light water reactors.
6
- 7 • Fuel fabrication – facilities where the enriched UF₆ is converted to uranium dioxide (UO₂)
8 and made into sintered UO₂ pellets. The pellets are subsequently encapsulated in fuel
9 rods, and the rods are assembled into fuel assemblies ready to be inserted into the
10 reactors. Two options were considered: (1) carrying out all steps involved in
11 manufacturing the fuel assemblies at the same location and (2) carrying the steps out at
12 two separate facilities (at one facility, UO₂ is produced in powder form from the enriched
13 UF₆, and at the other facility, the fuel assemblies are manufactured).
14
- 15 • Reprocessing – facilities that disassemble the spent fuel assemblies, chop up the fuel
16 rods into small sections, chemically dissolve the spent fuel out of sectioned fuel rod
17 pieces, and chemically separate the spent fuel into reusable uranium, plutonium, and
18 other radionuclides (primarily fission products and actinides).
19
- 20 • Disposal – facilities where the radioactive wastes generated at all fuel cycle facilities
21 including the reactors, are buried. Spent nuclear fuel that is removed from the reactors
22 and not reprocessed was also assumed to be disposed of at a geologic repository.
23

24 In addition to impacts occurring at the above facilities, the impacts associated with the
25 transportation of radioactive materials among these facilities, including the transportation of
26 wastes to disposal facilities, were evaluated. The results were summarized in a table and
27 promulgated as Table S–3 in 10 CFR 51.51(b). Table S–3 is provided for ease of reference.
28 10 CFR 51.51(a) states:

29
30 Every environmental report prepared for the construction permit stage of a light-
31 water-cooled nuclear power reactor, and submitted on or after September 4,
32 1979, shall take Table S–3, Table of Uranium Fuel Cycle Environmental Data, as
33 the basis for evaluating the contribution of the environmental effects of uranium
34 mining and milling, the production of uranium hexafluoride, isotopic enrichment,
35 fuel fabrication, reprocessing of irradiated fuel, transportation of radioactive
36 materials and management of low level wastes and high level wastes related to
37 uranium fuel cycle activities to the environmental costs of licensing the nuclear
38 power reactor. Table S–3 shall be included in the environmental report and may
39 be supplemented by a discussion of the environmental significance of the data
40 set forth in the table as weighed in the analysis for the proposed facility.
41
42

Environmental Consequences and Mitigating Actions

1 Consideration of Environmental Justice

2

3 As stated in NRC's *Policy Statement on the Treatment of Environmental Justice Matters in NRC*
4 *Regulatory and Licensing Actions* (69 FR 52040), "An NRC EJ [environmental justice] analysis
5 should be limited to the impacts associated with the proposed action (*i.e.*, the communities in
6 the vicinity of the proposed action). EJ-related issues differ from site to site and normally
7 cannot be resolved generically. Consequently, EJ, as well as other socioeconomic issues, are
8 normally considered in site-specific EISs. Thus, due to the site-specific nature of an EJ
9 analysis, EJ-related issues are usually not considered during the preparation of a generic or
10 programmatic EIS. EJ assessments would be performed as necessary in the underlying
11 licensing action for each particular facility." (See 69 FR 52046).

12

13 The environmental impacts of various individual operating uranium fuel cycle facilities are
14 addressed in separate EISs prepared by NRC. These documents include analyses that
15 address human health and environmental impacts to minority and low-income populations.
16 Electronic copies of these EISs are available through the NRC's public Web site under
17 Publications Prepared by NRC Staff document collection of the NRC's Electronic Reading
18 Room at <http://www.nrc.gov/reading-rm/doc-collections/>; and the NRC's Agency wide
19 Documents Access and Management System (ADAMS) at [http://www.nrc.gov/reading-](http://www.nrc.gov/reading-rm/adams.html)
20 [rm/adams.html](http://www.nrc.gov/reading-rm/adams.html).

21

22 Specific categories of natural resource use included in Table S-3 relate to land use; water
23 consumption and thermal effluents; radioactive releases; burial of transuranic waste, HLW, and
24 LLW; and radiation doses from transportation and occupational exposures. The contributions in
25 the table for reprocessing, waste management, and transportation of wastes are maximized for
26 either of the two fuel cycles (uranium only and no recycle); that is, the cycle that results in the
27 greater impact is used. For each resource area, Table S-3 presents a result that has been
28 integrated over the entire fuel cycle except the reactors. The only exception to this is that the
29 waste quantities provided under the entry called "solids (buried on site)" also includes wastes
30 generated at the reactor. The environmental impact values are expressed in terms normalized
31 to show the potential impacts attributable to processing the fuel required for the operation of a
32 1000-MW(e) nuclear power plant for one year at an 80 percent availability factor to produce
33 about 800 MW-yr (0.8 GW-yr) of electricity. This is referred to as 1 reference reactor year.

34

Environmental Consequences and Mitigating Actions

1

Table S-3. Table Taken from 10 CFR 51.51 on Uranium Fuel Cycle Environmental Data
(Normalized to model light water reactor annual fuel requirement
[WASH-1248] or reference reactor year [NUREG-0116])^(a)

Environmental Considerations	Total	Maximum Effect per Annual Fuel Requirement or Reference Reactor Year of Model 1,000 MWe Light Water Reactor
Natural Resource Use		
Land (acres)		
Temporarily committed ^(b)	100	
Undisturbed area	79	
Disturbed area	22	Equivalent to a 110 MWe coal-fired power plant.
Permanently committed	13	
Overburden moved (millions of MT)	2.8	Equivalent to 95 MWe coal-fired power plant.
Water (millions of gallons)		
Discharged to air	160	Equal to 2 percent of model 1,000 MWe light water reactor with cooling tower.
Discharged to water bodies	11,090	
Discharged to ground	127	
Total	11,377	Less than 4 percent of model 1,000 MWe light water reactor with once-through cooling.
Fossil Fuel		
Electrical energy (thousands of MW-hour)	323	Less than 5 percent of model 1,000 MWe output.
Equivalent coal (thousands of MT)	118	Equivalent to the consumption of a 45 MWe coal-fired power plant.
Natural gas (millions of scf)	135	Less than 0.4 percent of model 1,000 MWe energy output.
Effluents-Chemical (MT)		
Gases (including entrainment)^(c)		
SO _x	4,400	
NO _x ^(d)	1190	Equivalent to emissions from 45 MWe coal-fired plant for a year.
Hydrocarbons	14	
CO	29.6	
Particulates	1154	
Other gases		
F	0.67	Principally from UF ₆ production, enrichment, and reprocessing. Concentration within range of State standards and below level that has effects on human health.
HCl	0.014	

2

Environmental Consequences and Mitigating Actions

Table S-3. (cont.)

Environmental Considerations	Total	Maximum Effect per Annual Fuel Requirement or Reference Reactor Year of Model 1,000 MWe Light Water Reactor	
Liquids			
SO ₄ ⁻	9.9	From enrichment, fuel fabrication, and reprocessing steps. Components that constitute a potential for adverse environmental effects are present in dilute concentrations and receive additional dilution by receiving bodies of water to levels below permissible standards. The constituents that require dilution and the flow of dilution water are NH ₃ : 600 cfs, NO ₃ : 20 cfs, fluoride: 70 cfs.	
NO ₃ ⁻	25.8		
Fluoride	12.9		
Ca ⁺⁺	5.4		
Cl ⁻	8.5		
Na ⁺	12.1		
NH ₃	10.0		
Fe	0.4		
Tailings solutions (thousands of MT)	240	From mills only – no significant effluents to environment.	
Solids	91,000	Principally from mills – no significant effluents to environment.	
Effluents – Radiological (curies)			
Gases (including entrainment)			
Rn-222	–	Presently under reconsideration by the Commission.	
Ra-226	0.02		
Th-230	0.02	Principally from fuel reprocessing plants.	
Uranium	0.034		
Tritium (thousands)	18.1		
C-14	24		
Kr-85 (thousands)	400		
Ru-106	0.14		
I-129	1.3		
I-131	0.83		
Tc-99	–		Presently under consideration by the Commission.
Fission products and transuranics	0.203		
Liquids			
Uranium and Progeny	2.1	Principally from milling – included tailings liquor and returned to ground – no effluents; therefore, no effect on the environment.	
Ra-226	0.0034	From UF ₆ production.	
Th-230	0.0015	From fuel fabrication plants – concentration 10 percent of 10 CFR 20 for total processing 26 annual fuel requirements for model light water reactor.	
Th-234	0.01		
Fission and activation products	5.9 x 10 ⁻⁶		

Environmental Consequences and Mitigating Actions

Table S-3. (cont.)

Environmental Considerations	Total	Maximum Effect per Annual Fuel Requirement or Reference Reactor Year of Model 1,000 MWe Light Water Reactor
Solids (buried on site)		
Other than high level (shallow)	11,300	9,100 Ci comes from low-level reactor wastes and 1,500 Ci comes from reactor decontamination and decommissioning – buried at land burial facilities. 600 Ci comes from mills – included in tailing returned to ground. Approximately 60 Ci comes from conversion and spent fuel storage. No significant effluent to the environment.
Transuranic and high level waste (deep)	1.1 x 10 ⁷	Buried at Federal Repository.
Effluents – thermal (billions of Btu)	4,063	Less than 5 percent of model 1000 MWe light water reactor.
Transportation (person-rem)		
Exposure of workers and general public	2.5	
Occupational exposure	22.6	From reprocessing and waste management.

- (a) In some cases where no entry appears, it is clear from the background documents that the matter was addressed and that, in effect, the table should be read as if a specific zero entry had been made. However, there are other areas that are not addressed in the table. Table S-3 does not include health effects from the effluents described in the table, estimates of releases of radon-222 from the uranium fuel cycle, or estimates of technetium-99 released from waste management or reprocessing activities. These issues may be the subject of litigation in the individual licensing proceedings. Data supporting this table are given in the *Environmental Survey of the Uranium Fuel Cycle*, WASH-1248, April 1974; the *Environmental Survey of the Reprocessing and Waste Management Portion of the LWR Fuel Cycle*, NUREG-0116 (Supp. 1 to WASH-1248); the *Public Comments and Task Force Responses Regarding the Environmental Survey of the Reprocessing and Waste Management Portions of the LWR Fuel Cycle*, NUREG-0216 (Supp. 2 to WASH-1248); and in the record of the final rulemaking pertaining to *Uranium Fuel Cycle Impacts from Spent Fuel Reprocessing and Radioactive Waste Management*, Docket RM-50-3. The contributions from reprocessing, waste management, and transportation of wastes are maximized for either of the two fuel cycles (uranium only and no recycle). The contribution from transportation excludes transportation of cold fuel to a reactor and of irradiated fuel and radioactive wastes from a reactor, which are considered in Table S-4 of Sec. 51.20(g). The contributions from the other steps of the fuel cycle are given in columns A-E of Table S-3A of WASH-1248.
- (b) The contributions to temporarily committed land from reprocessing are not prorated over 30 years, since the complete temporary impact accrues regardless of whether the plant services one reactor for one year or 57 reactors for 30 years.
- (c) Estimated effluents based upon combustion of equivalent coal for power generation.
- (d) 1.2 percent from natural gas use and process.

Source: 10 CFR 51.51

1
2
3 A detailed discussion of impacts associated with the production and processing of fuel needed
4 for one reference reactor year operation of the model light water reactor was provided in the
5 1996 GEIS (NRC 1996). Included in the discussion were the collective offsite radiological
6 impacts that would be associated with radon-222 and technetium-99 releases to the
7 environment during the fuel cycle operations, which Table S-3 does not address. The 1996
8 GEIS also provided a discussion on the sensitivity of the impacts to recent changes in the fuel
9 cycle (Section 6.2.3 in the 1996 GEIS). For example, when Table S-3 was originally prepared,
10 the model reactor was assumed to be refueled once a year, and the fuel was assumed to
11 remain in the reactor to a burnup level of 33,000 MWd/MTU. The 1996 GEIS discussed the
12

Environmental Consequences and Mitigating Actions

1 effects of higher fuel burnups up to 62,000 MWd/MTU and the fact that most reactors now refuel
2 once every 18 months or 24 months. The technological changes in the various fuel cycle
3 operations (e.g., the in situ mining of uranium rather than the open pit mining assumed in
4 WASH-1248, and the potential for using more efficient isotopic enrichment processes through
5 the gaseous centrifuge rather than the energy-intensive gaseous diffusion process that was and
6 is still being used in the United States) were also discussed. It was concluded that even though
7 certain fuel cycle operations and fuel management practices have changed over the years, the
8 assumptions and methodology used in preparing Table S-3 were conservative enough that the
9 impacts described by the use of Table S-3 would still be bounding. The NRC believes that this
10 conclusion still holds.

11
12 One part of the fuel cycle that was not discussed either in the technical support documents for
13 the original Table S-3 or in the 1996 GEIS was the disposition of the depleted UF₆ tails
14 generated during the enrichment process. Originally, these tails were intended to be used as a
15 feedstock to make fuel for proposed fast breeder reactors. However, the United States
16 abandoned the fast breeder reactor program in 1978. Before the creation of the United States
17 Enrichment Corporation in 1993, DOE was the custodian of all the depleted UF₆ generated in
18 the United States at the three gaseous diffusion plants (in Oak Ridge, Tennessee; Portsmouth,
19 Ohio; and Paducah, Kentucky). DOE prepared several NEPA documents evaluating the
20 impacts associated with the disposition of approximately 700,000 MT (1.54 billion lb) of
21 depleted UF₆ (DOE 1999, 2004a,b, 2007a). DOE decided to convert the depleted UF₆ back to
22 U₃O₈ and dispose of it as LLW (DOE 2004c,d). The results of these analyses indicate that the
23 operational impacts of the depleted UF₆ management facilities would not be very different from
24 the impacts estimated for other parts of the fuel cycle in Table S-3. In particular, the impacts of
25 the depleted UF₆ conversion facilities, where the depleted UF₆ is converted to U₃O₈, would be
26 similar to the impacts of the UF₆ production facilities, where U₃O₈ is converted to UF₆. If the
27 depleted uranium oxide is disposed of as LLW, the conversion product corresponding to one
28 reference reactor year would be in addition to the LLW quantities already listed in Table S-3.
29 This value is estimated to be approximately 12 Ci (4.4×10^{11} Bq) (35 MT of uranium per RRY
30 multiplied by 0.34 Ci/MT of depleted uranium).

31 32 **Transportation**

33
34 The impacts associated with transporting fresh fuel to one 1000 MW(e) model light water
35 reactor and with transporting spent fuel and radioactive waste (LLW and mixed waste) from that
36 light water reactor are provided in Table S-4 in 10 CFR 51.52. Similar to Table S-3, and as
37 indicated in 10 CFR 51.52, every environmental report prepared for the construction permit
38 stage of a commercial nuclear power plant must contain a statement concerning the transport
39 of fuel and radioactive waste to and from the reactor. A similar statement is also required in
40 license renewal applications. Table S-4 forms the basis of such a statement.

1
2

Table S-4. Table Taken from 10 CFR 51.52 on the Environmental Impact of Transporting Fuel and Waste to and from One Light-Water-Cooled Nuclear Power Reactor^(a)

Normal Conditions of Transport			
		Environmental Impact	
Heat (per irradiated fuel cask in transit)		250,000 Btu/hr	
Weight (governed by Federal or State restrictions)		73,000 lb per truck; 100 tons per cask per rail car	
Traffic density:			
Truck		Less than 1 per day	
Rail		Less than 3 per month	
Exposed Population	Estimated No. of Persons Exposed	Range of Doses to Exposed Individuals^(b) (per reactor year)	Cumulative Dose to Exposed Population (per reactor year)^(c)
Transportation workers	200	0.01 to 300 millirem	4 person-rem
General public:			
Onlookers	1100	0.003 to 1.3 millirem	3 person-rem
Along route	600,000	0.0001 to 0.06 millirem	
Accidents in Transport			
		Environmental Risk	
Radiological effects		Small ^(d)	
Common (nonradiological) causes		1 fatal injury in 100 reactor years; 1 nonfatal injury in 10 reactor years; \$475 property damage per reactor year	
<p>(a) Data supporting this table are given in the Commission's <i>Environmental Survey of Transportation of Radioactive Materials to and from Nuclear Power Plants</i>, WASH-1238, December 1972, and Supp. 1, NUREG-75/038, April 1975.</p> <p>(b) The Federal Radiation Council has recommended that the radiation doses from all sources of radiation other than natural background and medical exposures should be limited to 5000 millirem per year for individuals as a result of occupational exposure and should be limited to 500 millirem per year for individuals in the general population. The dose to individuals due to average natural background radiation is about 130 millirem per year.</p> <p>(c) Man-rem is an expression for the summation of whole body doses to individuals in a group. Thus, if each member of a population group of 1,000 people received a dose of 0.001 rem (1 millirem), or if 2 people received a dose of 0.5 rem (500 millirem) each, the total man-rem dose in each case would be 1 man-rem.</p> <p>(d) Although the environmental risk of radiological effects stemming from transportation accidents is currently incapable of being numerically quantified, the risk remains small, regardless of whether it is being applied to a single reactor or a multireactor site.</p> <p>Source: 10 CFR 51.52</p>			

3
4

Environmental Consequences and Mitigating Actions

1 A discussion of the values included in Table S-4 and how they may change during the license
2 renewal term was included in Section 6.3 of the 1996 GEIS. However, after the 1996 GEIS was
3 issued and during the rulemaking process for codifying Table B-1 in 10 CFR Part 51, a number
4 of comments were received from the public that raised some questions about the adequacy of
5 Table S-4 for license renewal application reviews. As a result, the NRC reevaluated the
6 transportation issues and the adequacy of Table S-4 for license renewal application reviews.
7 In 1999, the NRC issued an addendum to the 1996 GEIS (NRC 1999a) in which the agency
8 evaluated the applicability of Table S-4 to future license renewal proceedings, given that the
9 spent fuel is likely to be shipped to a single repository (as opposed to several destinations, as
10 originally assumed in the preparation of Table S-4) and given that shipments of spent fuel are
11 likely to involve more highly enriched fresh fuel (more than 4 percent as assumed in Table S-4)
12 and higher-burnup spent fuel (longer than 33,000 MWd/MTU as assumed in Table S-4). In the
13 addendum, the NRC evaluated the impacts of transporting the spent fuel from reactor sites to
14 the candidate repository at Yucca Mountain and the impacts of shipping more highly enriched
15 fresh fuel and higher-burnup spent fuel. On the basis of the evaluations, the NRC concluded
16 that the values given in Table S-4 would still be bounding, as long as the (1) enrichment of the
17 fresh fuel was 5 percent or less, (2) burnup of the spent fuel was 62,000 MWd/MTU or less,
18 and (3) higher-burnup spent fuel (higher than 33,000 MWd/MTU) was cooled for at least
19 5 years before being shipped offsite. The conditions evaluated in Addendum 1 have not
20 changed, and no new conditions have been introduced that would alter the conclusions in
21 Addendum 1 (NRC 1999a). A later study found that the impacts presented in Table S-4 would
22 bound the potential environmental impacts that would be associated with transportation of spent
23 nuclear fuel with up to 75,000 MWd/MTU burnup, provided that the fuel is cooled for at least 5
24 years before shipment (Ramsdell et al. 2001). Table S-4 as currently encoded in 10 CFR
25 51.52 is provided.

26

Consideration of Environmental Justice

28

29 The human health impacts of transporting spent nuclear fuel are addressed in an addendum to
30 the 1996 GEIS (NRC 1999a) in which the agency evaluated the applicability of Table S-4 to
31 future license renewal proceedings given that the spent fuel is likely to be shipped to a single
32 repository. As part of the site characterization and recommendation process for the proposed
33 geologic repository at Yucca Mountain, Nevada, the DOE is required by the Nuclear Waste
34 Policy Act of 1982 to prepare an EIS. By law, the NRC is required to adopt DOE's EIS, to "the
35 extent practicable," as part of any possible NRC construction authorization decision. As a
36 result, DOE prepared and submitted to NRC the *Supplemental Environmental Impact
37 Statement for a Geologic Repository for the Disposal of Spent Nuclear Fuel and High-Level
38 Radioactive Waste at Yucca Mountain, Nye County, Nevada* (Repository SEIS) DOE/EIS-
39 0250F-S1) (DOE 2008). This document includes analyses that address human health and
40 environmental impacts to minority and low-income populations.

41

1 As noted in DOE's Repository SEIS, shipments of spent nuclear fuel (as well as fresh fuel)
2 would use the nation's existing railroads and highways. DOE estimates that transportation-
3 related impacts to land use; air quality; hydrology; biological resources and soils; cultural
4 resources; socioeconomics; noise and vibration; aesthetics; utilities, energy, and materials; and
5 waste management would be small. The small effect on the population as a whole would be
6 likely for any segment of the population, including minority and low-income populations, as well
7 as members of American Indian tribes.

8
9 DOE did not identify any potentially high and adverse impacts to members of the public from
10 the transport of spent nuclear fuel. DOE determined that subsections of the population,
11 including minority or low-income populations, would not receive disproportionate impacts, and
12 no unique exposure pathways, sensitivities, or cultural practices that would expose minority or
13 low-income populations to disproportionately high and adverse impacts were identified. DOE
14 concluded that no disproportionately high and adverse impacts would result from the national
15 transportation of spent nuclear fuel to Yucca Mountain (DOE 2008). On September 8, 2008,
16 NRC staff recommended that the Commission adopt, with supplementation, DOE's Repository
17 EIS and supplements (73 FR 53284).

18 19 **Impact Issues**

20
21 Nuclear fuel is needed for the operation of light water reactors during the license renewal term
22 in the same way that it is needed during the current license period. Therefore, the factors that
23 affect the data presented in Tables S-3 and S-4 do not change whether a light water reactor is
24 operating under its original license or a renewed license. In the 1996 GEIS, there are nine
25 issues that relate to uranium fuel cycle and waste management. Five of these issues that
26 relate to waste management are addressed in Section 4.11.

27
28 The remaining four impact issues, which are discussed here, are:

- 29
30 • Offsite radiological impacts (individual effects from other than the disposal of spent fuel
31 and HLW),
- 32
33 • Offsite radiological impacts (collective effects from other than the disposal of spent fuel
34 and HLW),
- 35
36 • Nonradiological impacts of the uranium fuel cycle, and
- 37
38 • Transportation impacts.
- 39

Environmental Consequences and Mitigating Actions

1 *Individual Offsite Radiological Impacts (individual effects from sources other than the disposal of* 2 *spent fuel and HLW)*

3
4 This issue addresses the radiological impacts on individuals who live near uranium fuel cycle
5 facilities. The primary indicators of impact are the concentrations of radionuclides in the
6 effluents from the fuel cycle facilities and the radiological doses received by a maximally
7 exposed individual (MEI) on the site boundary or at some location away from the site boundary.
8 As discussed in Section 3.9.1, an MEI can be exposed to radiation from radionuclides found in
9 the effluents of nuclear fuel cycle facilities and from radiation “shine” from buildings, storage
10 facilities, and storage tanks containing radioactive material. The basis for establishing the
11 significance of individual effects is the comparison of the releases in the effluents and the MEI
12 doses with the permissible levels in applicable regulations. The analyses performed by the
13 NRC in the preparation of Table S-3 and found in the 1996 GEIS indicate that as long as the
14 facilities operate under a valid license issued by either the NRC or an agreement State, the
15 individual effects meet the applicable regulations. On the basis of these considerations, the
16 NRC has concluded that the impacts on individuals from radioactive gaseous and liquid
17 releases during the license renewal term would remain at or below the NRC’s regulatory limits.
18 Accordingly, the NRC concludes that offsite radiological impacts of the uranium fuel cycle
19 (individual effects from sources other than the disposal of spent fuel and high-level waste) are
20 small. The efforts to keep the releases and doses as low as is reasonably achievable (ALARA)
21 will continue to apply to fuel-cycle-related activities. This was considered a Category 1 issue in
22 the 1996 GEIS. No new information has been identified that would alter this conclusion.

23 24 *Collective Offsite Radiological Impacts (collective effects from sources other than the disposal* 25 *of spent nuclear fuel and HLW)*

26
27 The focus of this issue is the collective radiological doses to and health effects on the general
28 public resulting from uranium fuel cycle facilities over the license renewal term. The radiological
29 doses received by the general public are calculated on the basis of releases from the facilities
30 to the environment, as provided in Table S–3. These estimates were provided in the 1996
31 GEIS for the gaseous and liquid releases listed in Table S–3 as well as for radon-222 and
32 technetium-99 releases, which are not listed in Table S–3. The population dose commitments
33 were normalized for each year of operation of the model 1000-MW(e) LWR (RRY).

34
35 On the basis of the analyses provided in the 1996 GEIS, the estimated involuntary 100-year
36 dose commitment to the U.S. population resulting from the radioactive gaseous releases from
37 uranium fuel cycle facilities (excluding the reactors and releases of Rn-222 and Tc-99) was
38 estimated to be 400 person-rem (4 person-Sv) for 1 RRY. Similarly, the environmental dose
39 commitment to the U.S. population from the liquid releases was estimated to be 200 person-
40 rem (3 person-Sv) per RRY. As a result, the total estimated involuntary 100-year dose
41 commitment to the U.S. population from radioactive gaseous and liquid releases listed in

1 Table S-3 was given as 600 person-rem (6 person-Sv) per RRY (see Section 6.2.2 of
 2 NRC 1996).

3
 4 The 1996 GEIS also provided a detailed analysis of potential doses to the U.S. population from
 5 Rn-222 releases, which primarily occur during mining and milling operations and as emissions
 6 from mill tailings, and Tc-99 releases, which primarily occur during the enrichment process
 7 (Section 6.2.2 of NRC 1996). The U.S. population doses resulting from the Rn-222 releases
 8 and Tc-99 releases for 1 RRY are summarized in Table 4.12.1.1–1. The total population dose
 9 from all releases to the environment, including the Rn-222 and Tc-99 releases, is given as
 10 938.6 person-rem (9.386 person-Sv) per RRY. Because of an oversight in the 1996 GEIS, the
 11 sum of population doses was given as 740 person-rem, and the total dose over the 20-year
 12

Table 4.12.1.1–1. Population Doses from Uranium Fuel Cycle Facilities Normalized to One Reference Reactor Year

Source	Collective Dose (person-rem) ^(a)
Gaseous releases	400
Liquid releases	200
Rn-222 releases from uranium mining and milling	140
Rn-222 releases from unreclaimed open-pit mines	96
Rn-222 releases from stabilized tailings piles	2.6
Tc-99 releases from enrichment plants	100
Total	938.6

(a) To convert person-rem to person-Sv, multiply by 0.01.
 Source: modified from NRC 1996

13
 14 renewal period was listed as 14,800 person-rem (148 person-Sv) (740 person-rem per RRY
 15 multiplied by 20 years). The correct values would be approximately 940 person-rem per RRY
 16 and 18,800 person-rem (188 person-Sv) for 20 years.

17
 18 As discussed in the 1996 GEIS, the dose estimates given above were based on highly
 19 conservative assumptions (i.e., the doses are overestimated). In actuality, the doses received
 20 by most members of the public would be so small that they would be indistinguishable from the
 21 variations in natural background radiation. The 1996 GEIS further estimated the health effects
 22 on the general public in terms of cancer fatalities by multiplying the calculated doses by risk
 23 conversion factors obtained from the literature. The estimated health effect was stated as
 24 0.6 cancer fatality per RRY, or 12 cancer fatalities for each additional 20-year LWR operating
 25 term. The 1996 GEIS also stated that these estimates were highly uncertain and that much of

Environmental Consequences and Mitigating Actions

1 the calculated doses, especially the contribution of radon releases from mines and tailing piles,
2 consisted of tiny doses summed over large populations. It was stated that this practice may
3 result in health effect estimates that may not be meaningful.

4
5 There are no regulatory limits applicable to collective doses to the general public from fuel cycle
6 facilities. All regulatory limits are based on individual doses. All fuel cycle facilities are
7 designed and operated to meet the applicable regulatory limits.

8
9 As discussed in the 1996 GEIS, despite the lack of definitive data, some judgment as to the
10 regulatory NEPA implications of these matters should be made and it makes no sense to repeat
11 the same judgment in every case. The Commission concludes that these impacts are
12 acceptable in that these impacts would not be sufficiently large to require the NEPA conclusion,
13 for any plant, that the option of extended operation under 10 CFR Part 54 should be eliminated.
14 Accordingly, while the Commission has not assigned a single level of significance for the
15 collective effects of the fuel cycle, this issue is considered Category 1.

16 *Nonradiological Impacts of the Uranium Fuel Cycle*

17
18
19 This section addresses the nonradiological impacts associated with the uranium fuel cycle
20 facilities as they relate to license renewal. Data on the nonradiological impacts of the fuel cycle
21 are provided in Table S-3. These data cover land use, water use, fossil fuel use, and chemical
22 effluents. The significance of the environmental impacts associated with these data was
23 evaluated in the 1996 GEIS on the basis of several relative comparisons. The land
24 requirements were compared to those for a coal-fired power plant that could be built to replace
25 the nuclear capacity if the operating license is not renewed. Water requirements for the
26 uranium fuel cycle were compared to the annual requirements for a nuclear power plant. The
27 amount of fossil fuel (coal and natural gas) consumed to produce electrical energy and process
28 heat during the various phases of the uranium fuel cycle was compared to the amount of fossil
29 fuel that would have been used if the electrical output from the nuclear plant were supplied by a
30 coal-fired plant. Similarly, the gaseous effluents sulfur dioxide (SO₂), nitrogen oxide (NO),
31 hydrocarbons, CO, and PM released as a consequence of the coal-fired electrical energy used
32 in the uranium fuel cycle were compared with equivalent quantities of the same effluents that
33 would be released from a 45-MW(e) coal-fired plant. It was noted that the impacts associated
34 with uses of all of the above resources would be small. Any impacts associated with
35 nonradiological liquid releases from the fuel cycle facilities would also be small. As a result, the
36 aggregate nonradiological impact of the uranium fuel cycle resulting from the renewal of an
37 operating license for a plant would be small, and it was considered a Category 1 issue in the
38 1996 GEIS. No new information has been identified that would alter this conclusion.

1 *Transportation Impacts*

2
3 This section addresses the impacts associated with transportation of fuel and waste to and from
4 one light water reactor during the license renewal term. Table S–4 in 10 CFR 51.52 forms the
5 basis for analysis of these impacts in evaluating the applications for license renewal from
6 owners of light water reactors. As discussed previously in this section, the applicability of Table
7 S–4 for license renewal applications was extensively studied in the 1996 GEIS (NRC 1996) and
8 its Addendum 1 (NRC 1999a). The impacts were found to be small, and the findings were
9 stated as follows:

10
11 The impacts of transporting spent fuel enriched up to 5 percent uranium-235 with
12 average burnup for the peak rod to current levels approved by NRC up to
13 62,000 MWd/MTU and the cumulative impacts of transporting high-level waste to
14 a single repository, such as Yucca Mountain, Nevada are found to be consistent
15 with the impact values contained in 10 CFR 51.52(c), Summary Table S–4 –
16 Environmental Impact of Transportation of Fuel and Waste to and from One
17 Light-Water-Cooled Nuclear Power Reactor. If fuel enrichment or burnup
18 conditions are not met, the applicant must submit an assessment of the
19 implications for the environmental impact values reported in §51.52.

20
21 The issue was assigned to Category 1. No new information has been identified that would alter
22 this conclusion.

23
24 **4.12.1.2 Energy Alternative Fuel Cycles**

25
26 **Fossil Energy Alternatives**

27
28 The environmental consequences of the fuel cycle for a fossil-fuel-fired plant result from the
29 initial extraction of the fuel from its natural setting, fuel cleaning and processing, transport of the
30 fuel to the facility, and management and ultimate disposal of solid wastes resulting from
31 combustion of the fuel.

32
33 The environmental impacts of coal mining vary with the location and type of mining technology
34 employed, but generally includes:

- 35
36
- Significant change in land uses, especially when surface mining is employed.
 - Degradation of visual resource values.
 - Air quality impacts, including release of criteria pollutants from vehicles and equipment, release of fugitive dust from ground disturbance and vehicle travel on unpaved surfaces,
- 37
38
39
40
41
42

Environmental Consequences and Mitigating Actions

- 1 release of VOCs from the storage and dispensing of vehicle and equipment fuels and
2 the use of solvents and coatings in maintenance activities, and release of coalbed
3 methane into the atmosphere as coal seams are exposed and overburden removed.
4
- 5 • Noise impacts from the operation of vehicles and equipment and the possible use of
6 explosives.
7
 - 8 • Impacts on geology and soils due to land clearing, excavations, soil and overburden
9 stockpiling (for strip mining operations), and mining.
10
 - 11 • Hydrological impacts, including degradation of surface water quality due to increased
12 sediment and runoff to surface water bodies, possible degradation of groundwater
13 resources due to consumptive use and potential contamination (especially when shaft
14 mining techniques are employed), as well as generation of wastewater from coal
15 cleaning operations and other supporting industrial activities.
16
 - 17 • Ecological impacts, including extensive loss of natural habitat, loss of native vegetative
18 cover, disturbance of wildlife, possible introduction of invasive species, changes to
19 surface hydrology, and degradation of aquatic systems.
20
 - 21 • Impacts on historic and cultural resources within the mine footprint, as well as additional
22 potential impacts resulting from auxiliary facilities and appurtenances (e.g., access
23 roads, rail spurs).
24
 - 25 • Direct socioeconomic impacts from employment of the workforce and indirect impacts
26 from increased employment in service and support industries.
27
 - 28 • Potential environmental justice impacts as a result of the presence of low-income or
29 minority populations in the surrounding communities and/or within the workforce.
30
 - 31 • Potential health impacts on workers from exposure to airborne dust, gases such as
32 methane, and exhaust from internal combustion engines on vehicles and mining
33 machinery.
34
 - 35 • Generation of coal wastes and industrial wastes associated with the maintenance of
36 vehicles and equipment; increased potential for spills of fuels from onsite fuel storage
37 and dispensing.
38

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37

New Nuclear Alternatives

Environmental impacts of the fuel cycle result from the initial extraction of the fuel from its natural setting, transport of the fuel to the facility, and management and ultimate disposal of solid wastes resulting from combustion of the fuel. For the fuel cycle associated with a nuclear power plant, these activities include uranium mining and milling, the production of uranium hexafluoride, isotopic enrichment, fuel fabrication, reprocessing of irradiated fuel, transportation of radioactive materials, and management of low-level wastes and high-level wastes (10 CFR 51). The NRC has summarized environmental data associated with the uranium fuel cycle in Table S-3 of 10 CFR 51.51. The analysis provides a basis for evaluating environmental effects of the fuel cycle for all nuclear power plants, regardless of site location. The information is based on a 1000-MW LWR with an 80 percent capacity factor. The impacts associated with the transportation of fuel and waste to and from a power reactor are summarized in Table S-4 of 10 CFR 51.52. Detailed analysis of the uranium fuel cycle is also considered in Section 4.12.1.1. Although it is specific to the impacts of license renewal, it is applicable to the new nuclear plant alternative because the advanced reactor designs use the same type of fuel as existing operational designs. One difference may be that the new reactor may have a power rating of greater than 1000 MW(e), in which case the impacts would be proportionally higher. However, all impacts associated with the uranium fuel cycle, as discussed in Section 4.12.1.1, would still be small.

Renewable Alternatives

The term “fuel cycle” has varying degrees of relevance for renewable energy facilities. Clearly, the term has meaning for renewable energy technologies that rely on combustion of fuels such as biomass grown or harvested for the express purpose of power production. The term is somewhat more difficult to define for renewable technologies such as wind, solar, geothermal, and ocean wave and current. Those natural energy resources exist regardless of any effort to harvest them for electricity production. The common technological strategy for harvesting energy from such natural resources is to convert the kinetic or thermal energy inherent in that resource to mechanical energy or torque. The torque is then applied directly (e.g., as in the case of a wind turbine) or indirectly (e.g., for those facilities that utilize conventional steam cycles to drive turbines that drive generators) to produce electricity. However, because those renewable technologies capture very small fractions of the total kinetic or thermal energy contained in those resources, impacts from the presence or absence of the renewable energy technology are often indistinguishable.

Environmental Consequences and Mitigating Actions

1 Environmental consequences of fuel cycles for biomass (e.g., energy crops, wood wastes,
2 municipal solid waste, refuse-derived fuel, landfill gas) include the following:

- 3
- 4 • Land use impacts from the growing and harvesting of the energy crops.
- 5
- 6 • Reduced impacts on land from the avoidance of land disposal of anthropogenic biomass
- 7 feedstocks such as municipal solid waste and refuse-derived fuel.
- 8
- 9 • Visual impacts from the establishment of farm fields and forest areas and processing
- 10 facilities for the growing, harvesting, and preparation of biomass feedstocks.
- 11
- 12 • Air impacts from operation of vehicles and equipment used in the planting, cultivating,
- 13 and harvesting of energy crops.
- 14
- 15 • Reductions in greenhouse gas emissions from landfills as a result of the capture and
- 16 destruction by combustion of landfill gas for energy production.
- 17
- 18 • Removal of greenhouse gases from the air (e.g., CO₂) by growing crops.
- 19
- 20 • Noise impacts from the operation of agriculture and silviculture equipment and transport
- 21 vehicles in otherwise rural settings with low ambient noise levels.
- 22
- 23 • Soil impacts from the cultivation of fields and the potential for increased sediment in
- 24 precipitation runoff.
- 25
- 26 • Hydrologic impacts from irrigation of the energy crops; impacts on groundwater
- 27 resources from water removal for agricultural or silvicultural purposes or industrial water
- 28 uses associated with the preparation of biomass feedstocks.
- 29
- 30 • Ecological impacts from the loss of habitat resulting from crop production; loss of
- 31 hydrologic resources due to diversion for irrigation purposes; potential intrusion of
- 32 invasive species on disturbed land surfaces, and potential contamination of adjacent
- 33 habitat by pesticide and fertilizer runoff.
- 34
- 35 • Ecological impacts from the alteration of habitat due to human presence and activities in
- 36 agricultural and silvicultural areas.
- 37
- 38 • Historic and cultural resource impacts from inadvertent destruction of resources in virgin
- 39 fields that have not undergone appropriate efforts to survey, identify, and relocate
- 40 cultural resources that may be present.
- 41

- 1 • Human health impacts from the exposure of workers to pesticides and fertilizers used in
2 growing biomass fuels; work around mechanical planting, cultivating, and harvesting
3 equipment; work in weather extremes; and exposure to dangerous plants and wildlife.
4
- 5 • Waste impacts in the form of residual wastes from the application of pesticides and
6 fertilizers and wastes associated with the routine maintenance of equipment and
7 vehicles used in crop production and transport (used lubricating oils, hydraulic fluids,
8 glycol-based coolants, and battery electrolytes from maintenance of equipment and
9 vehicles with internal combustion engines).
- 10
- 11 • Positive economic impacts from the creation of jobs in the agriculture, silviculture, and
12 transportation sectors.
13
14

15 **4.12.2 Environmental Consequences of Terminating Nuclear Power Plant** 16 **Operations and Decommissioning**

17

18 **4.12.2.1 Termination of Nuclear Power Plant Operations and Decommissioning of** 19 **Existing Nuclear Power Plants**

20

21 This section describes and discusses the environmental consequences of terminating nuclear
22 power plant operations and decommissioning, but the only impacts attributable to the proposed
23 action (license renewal) are the effects of an additional 20 years of operations on the impacts of
24 decommissioning. The majority of the impacts associated with plant operations would cease
25 with reactor shutdown; however, some impacts would remain unchanged, while others would
26 continue at reduced or altered levels. Some new impacts might also result directly from
27 terminating nuclear power plant operations. Ancillary systems that are dedicated solely to
28 reactor operations would cease operations completely; however, impacts from their physical
29 presence could continue if they were not removed coincident with reactor shutdown. For sites
30 with more than one unit, the operation of any ancillary systems that supported the units that
31 continued to operate would be reduced in proportion to the reduced demand on them but would
32 not stop entirely. Impacts associated with the mere physical presence of dedicated systems
33 that remained in place or shared ancillary systems that continued to operate would remain
34 unchanged.
35

36 Terminating nuclear power plant operations would result in the cessation of actions necessary
37 to maintain the reactor, as well as a significant reduction in the workforce. NRC presumes that
38 terminating nuclear power plant operations would not immediately lead to the dismantlement of
39 the reactor or other infrastructure, much of which would still be in use to support other units
40 onsite that continued to operate. Even for sites with just one unit, some facilities would remain
41 in operation to ensure that the site was maintained in safe shutdown condition. Electrical

Environmental Consequences and Mitigating Actions

1 generators might continue to operate as synchronous condensers to stabilize voltage on the
2 bulk electricity grid to which the reactor was connected.

3 4 **Land Use**

5
6 The termination of nuclear power plant operations would cause a reduction in the workforce at a
7 nuclear plant, and the value placed on the facility for tax purposes would likely depreciate. The
8 impact on taxing authorities that receive revenue from the nuclear power plant would depend on
9 the percentage of revenue that they derived from the plant. Depending on the future need to
10 replace electrical generating capacity, a replacement power plant could change the tax base
11 and impact offsite land use. However, existing substations are expected to remain and be
12 maintained after the termination of reactor operations to support the power grid.

13
14 Temporary onsite land use changes during decommissioning are anticipated to be comparable
15 to changes that occur during construction and operations and would not require additional land.
16 The major activities that require land temporarily include the staging of equipment,
17 accommodation of workers (e.g., parking, training, site security access, office space, changing
18 facilities), and removal of large components. The locations of these areas would depend on the
19 layout of the plant. Temporary changes in onsite land use would not change the fundamental
20 use of the reactor site.

21
22 There would be no difference in offsite land use impacts whether decommissioning occurred at
23 the end of its current 40-year operating license or following a 20-year license renewal term. In
24 either case, the impact of license renewal after terminating plant operations and
25 decommissioning on onsite and offsite land use would be small and generic at all nuclear
26 plants.

27 28 **Visual Resources**

29
30 Terminating nuclear power plant operations would not change the visual appearance of the
31 nuclear power plant. The most notable change, however, would be the elimination of the
32 condensate plumes from cooling towers (under certain meteorological conditions). The
33 appearance of the plant would change as structures are removed.

34
35 Decommissioning may involve the demolition and dismantlement of one or more of the main
36 buildings or structures at a nuclear power plant. A case study conducted for the 1996 GEIS
37 found a limited number of situations in which the presence of nuclear power plants fostered
38 perceptions of adverse impacts on visual resources. License renewal would delay
39 decommissioning and prolong the visual impact. As discussed in the decommissioning GEIS
40 (NRC 2002a), the visual impact of the nuclear plant site may not improve following
41 decommissioning because the site could remain in industrial use.

1 Transmission lines and ROWs are expected to continue operating and to cause little or no
2 additional impacts beyond those that have already occurred. A 20-year delay caused by
3 license renewal would have no visual impact from continued transmission line operation.

4
5 Visual resource impacts associated with terminating plant operations and decommissioning
6 after a 20-year license renewal will not change as a consequence of the delay. The impact of
7 license renewal on visual resources would be small at all nuclear plants.

8 9 **Air Quality**

10
11 After the termination of operations, air emissions from the nuclear power plant would continue,
12 but at greatly reduced levels. Air quality impacts would range from very small and would
13 approach undetectable levels. Natural or mechanical draft cooling tower drift would be greatly
14 reduced or would be eliminated. Air emissions from ancillary facility operations (e.g., boilers,
15 emergency diesel generators) would continue until decommissioning.

16
17 The NRC evaluated the following activities in the decommissioning GEIS (NRC 2002a) that
18 could impact air quality:

- 19
20 • Worker transportation to and from the site;
- 21
22 • Demolition of buildings and structures, including new structures added during
23 refurbishment;
- 24
25 • Shipment of materials and debris to offsite locations;
- 26
27 • Operation of concrete batch plants (e.g., ENTOMB decommissioning options);
- 28
29 • Dismantling of systems and removing of equipment; and
- 30
31 • Movement and open storage of material onsite.

32
33 These activities typically occur over a period of years, from the time the facility ceases
34 operation until the decommissioning is complete. The magnitude and the timing of the potential
35 impacts of each decommissioning activity would vary from plant to plant.

36
37 Building and major plant structure demolition and the operation of the batch plant during
38 decommissioning would have the greatest impact on air quality. Fugitive dust would vary in the
39 size of the particles released. Depending on meteorological conditions, larger particles would
40 settle to the ground near the demolition site.

Environmental Consequences and Mitigating Actions

1 Demolition would generally be limited to a small number of short-duration events. Mitigation
2 measures, such as synchronized scheduling and the application of water sprays or chemical
3 dust suppressants, could minimize the amount of fugitive dust released from the site.

4
5 The decommissioning option to ENTOMB the plant would require large amounts of concrete
6 and aggregate. Unloading dry cement at the concrete batch plant and loading mixers or trucks
7 would generate large amounts of dust. Depending on meteorological conditions, large particles
8 of dust would settle out of the air quickly and air quality impacts would be localized near the
9 concrete batch plant. Dust control measures used at concrete batch plants include enclosed
10 dumping and unloading areas and conveyors and filters and water sprays.

11
12 The NRC concluded that the impact of decommissioning on air quality would be small for all
13 plants in the decommissioning GEIS (NRC 2002a). The impact on air quality after the license
14 renewal term is not expected to be different from the impact that would have occurred without
15 license renewal.

16 17 **Noise**

18
19 During decommissioning, noise would generally be far enough away from sensitive receptors
20 outside the plant boundaries that the noise would be attenuated to nearly ambient levels and
21 would be scarcely noticeable offsite (NRC 2002a). However, during the demolition of concrete,
22 the noise levels offsite could be loud enough (60 to 65 dBA at the nearest receptor site) that
23 activities might need to be curtailed during early morning and evening hours. It is highly
24 unlikely, on the basis of past decommissioning experience, that the offsite noise level from a
25 plant during decommissioning would be sufficient to cause hearing loss. However, in one case,
26 noise from decommissioning of a spent fuel pool's cooling system was reported to be up
27 to 107 dB near the source, but it dropped to 50 dB at distances less than 1.6 km (1 mi) away
28 (NRC 2002a). Nearby residents complained about these noise levels; engineering changes
29 were made to the fans that were causing the noise, and the issue was resolved. Noise
30 abatement procedures could also be used during decommissioning in order to reduce noise.

31
32 The NRC concluded that the noise impact of decommissioning would be small for all plants in
33 the decommissioning GEIS (NRC 2002a). The noise impact from terminating nuclear plant
34 operations and decommissioning after the license renewal is not expected to be different from
35 the impact that would have occurred without license renewal.

36 37 **Geology and Soils**

38
39 Termination of nuclear plant operations is not expected to impact geology and soils. Heavy
40 construction equipment would be engaged in demolition activities during decommissioning.

1 These vehicles would primarily use paved surfaces, but would also cross open ground in some
2 locations. This would create the possibility for soil erosion from areas formerly covered with
3 lawns or natural grasses. The demolition and removal of buildings, foundation slabs, parking
4 lots, and roads, would expose more soil to possible erosion.

5
6 High slopes and surface runoff increase erosion potential. The soil distribution across a site
7 may include some soils that are more susceptible to water or wind erosion. The loss of soil
8 increases the turbidity in surface water draining off the site.

9
10 Erosion problems could be mitigated by using best management practices during
11 decommissioning. These include, but are not limited to, minimizing the amount of disturbed
12 land; stockpiling topsoil before construction or regrading; replacing the topsoil and adding seed
13 and mulch in disturbed areas as soon as possible after disturbance; using silt fences to reduce
14 sediment loading to surface water; using check dams to minimize the erosive power of
15 drainages or creeks; and installing proper culvert outlets to minimize erosion in creeks.

16
17 Site geologic resources would not be affected by decommissioning. Geologic resources in the
18 form of gravel or crushed stone might be needed to construct temporary roads that would be
19 used by the heavy equipment involved in demolition.

20
21 The impact from terminating plant operations and decommissioning on geology and soils after a
22 license renewal is not expected to be significantly different from the impacts that would have
23 occurred without license renewal.

24 25 **Hydrology – Surface Water and Groundwater**

26
27 After the termination of plant operations, water use would be dramatically reduced; however,
28 water demands would continue for the service water system to support such activities as
29 temperature control of the spent fuel pool and other miscellaneous industrial maintenance
30 applications. Surface water or groundwater intake and consumptive use would be very low
31 compared with use during the operational phase. Discharge of liquid wastes and biocides
32 would also be proportionately reduced.

33
34 Because the site workforce would be reduced, the volume of sanitary sewage effluent would be
35 less than it had been during the operational period. Pumping rates for groundwater used for
36 the potable water system after the termination of plant operations would also decrease because
37 of the reduced workforce.

38
39 Impacts to site hydrology from soil erosion and storm events are expected to be unchanged
40 from the operational period. Such erosion would be mitigated as part of general site
41 maintenance during any phase in the power plant's life cycle.

Environmental Consequences and Mitigating Actions

1 The possibility of groundwater becoming contaminated through chemical spills or radionuclide
2 release would be smaller after operations cease.

3

4 Dewatering, if needed to maintain the stability of structure foundations, is expected to continue
5 as it did during the operational phase.

6

7 During decommissioning, the activities that have the potential to affect water use include:

8

- 9 • Maintenance of the spent fuel pool,
- 10
- 11 • Staffing changes (generally the staff size is decreased),
- 12
- 13 • Cooling of cutting equipment during removal of the reactor vessel and internals,
- 14
- 15 • High-pressure sprays of water on surfaces during decontamination,
- 16
- 17 • Dust suppression during destruction of structures, and
- 18
- 19 • The making of concrete for facility entombment.

20

21 The activities identified in the decommissioning GEIS (NRC 2002a) that have the potential to
22 affect water quality include:

23

- 24 • Maintenance of the spent fuel pool,
- 25
- 26 • Draining and flushing of the cooling systems and processing of the liquid,
- 27
- 28 • High-pressure sprays of water on surfaces during decontamination, and
- 29
- 30 • Management of water used in dust suppression during destruction of structures.

31

32 At individual sites, the source of water for each of these uses may be surface water or
33 groundwater. The decision on which source of water to use may ultimately be based on a
34 combination of availability, infrastructure, permitting, and water quality and chemistry.

35

36 Some of the activities listed above could affect surface water quality. These include the use of
37 high-pressure sprays of water during decontamination, dust suppression, and equipment
38 cooling, and the discharge of various process waters. For decontamination, best management
39 practices would need to be followed to manage the sprayed water. Both the decontamination

1 water and the process waters would need to be discharged in accordance with NPDES permit
2 requirements.

3
4 The early stages of decommissioning and dismantling may involve a temporary, slight increase
5 in the size of the overall site staff (NRC 2002a). The amount of sanitary system discharge
6 would therefore increase slightly. Depending on when any onsite wastewater treatment plant,
7 onsite septic system, or municipal sewage system connection would stop operating, temporary
8 portable toilet facilities might be used for the decommissioning workforce. The number and
9 capacity of such facilities would depend on the size of the workforce, which could vary during
10 different phases of the decommissioning process.

11
12 In the decommissioning GEIS (NRC 2002a), evaluations focused on water use and water
13 quality. The following activities were identified as having the potential to affect surface water.

- 14 • Cooling water systems,
- 15 • Discharge from dewatering systems, and
- 16 • Stormwater management and erosion control.

17
18
19
20
21 Surface water would remain the largest source of water used during decommissioning; it would
22 be used to cool the spent fuel. However, this usage, as well as makeup water requirements,
23 would be significantly smaller than during reactor cooling at an operating power plant. Demand
24 for spent fuel cooling water would decrease over time as the fuel aged. Other activities listed
25 above would also require amounts of water that would be low compared to cooling and makeup
26 water requirements.

27
28 Dewatering systems would continue to discharge to surface water. The effect on surface water
29 quality would be unchanged from the effect during the operational phase.

30
31 Stormwater management and erosion control would continue to be maintained during
32 decommissioning to reduce the potential for effects on surface water quality, especially turbidity.
33 Soil erosion can be minimized through best management practices, as discussed in
34 Section 4.4.1. Chemical spills during decommissioning also have the potential to affect surface
35 water quality. However, best management practices for handling fuels and other chemicals
36 used in the operational phase should continue to be in place.

37
38 The natural variability in the climate, especially precipitation, has the potential to influence the
39 availability of surface water. However, because it seems that there have not been any surface
40 water availability problems at operating power plants with relatively higher water requirements
41 for reactor cooling, severe drought is not expected to affect decommissioning.

Environmental Consequences and Mitigating Actions

1 In the decommissioning GEIS (NRC 2002a), the NRC concluded that the impacts on water use
2 and water quality from decommissioning would be small for all plants. The effect of license
3 renewal on the water quality impacts from decommissioning was considered a Category 1 issue
4 in the 1996 GEIS. On the basis of a review of current information, these conclusions are
5 considered valid for surface water. An additional 20 years of operation during the license
6 renewal term would not change the magnitude of these impacts.

7
8 The activities listed above include some that may affect groundwater quality through the
9 infiltration of water used for various purposes (e.g., cooling of cutting equipment,
10 decontamination spray, and dust suppression). Best management practices are expected to be
11 employed as appropriate to collect and manage these waters.

12
13 In the decommissioning GEIS (NRC 2002a), evaluations focused on water use and water
14 quality. The following activities were identified as having the potential to affect groundwater:

- 15 • Potable water from wells,
- 16 • Dewatering systems, and
- 17 • Leachate from rubble.

18
19
20
21
22 Potable water would be required during decommissioning. The typical source for this supply is
23 onsite groundwater, though surface water or an offsite municipal source of surface water or
24 groundwater may be used at some sites. The early stages of decommissioning and
25 dismantling may involve a temporary, slight increase in the size of the overall site staff, and a
26 proportional increase in the need for potable water may occur (NRC 2002a).

27
28 Dewatering is expected to continue as it does during the operational phase, without increased
29 drawdown at nearby onsite or offsite wells.

30
31 The NRC proposed that groundwater chemistry may change as rainwater infiltrates through
32 rubble. The increased pH could promote the subsurface transport of radionuclides and metals.
33 However, this effect is expected to occur only over a short distance as a function of the
34 buffering capacity of soil (NRC 2002a). Offsite transport of groundwater contaminants is not
35 expected.

36
37 In the decommissioning GEIS (NRC 2002a), the NRC concluded that the impacts on water use
38 and water quality from decommissioning would be small for all plants. The effect of license
39 renewal on the water quality impacts from decommissioning was considered a Category 1 issue
40 in the 1996 GEIS. On the basis of a review of current information, these conclusions are

1 considered valid for groundwater. An additional 20 years of operation during the license
2 renewal term would not change the magnitude of these impacts.

3 4 **Ecology**

5
6 The termination of nuclear power plant operations would reduce some impacts and eliminate
7 others. Impacts from systems that continue operating to support other units (i.e., where the
8 license term for each unit does not end at the same time) on the plant site may continue to
9 affect terrestrial or aquatic biota, but at a reduced level of impact.

10
11 Impacting factors that would cease following reactor shutdown would include cooling tower drift,
12 cooling system maintenance and effluent discharges, and atmospheric emissions of
13 radionuclides. If there are other reactor units at the power plant and they continue to operate,
14 these factors would be reduced, but not eliminated. A number of impacting factors would
15 continue to affect terrestrial resources, however. Until removed during decommissioning,
16 cooling towers and transmission lines would continue to be collision hazards for birds.

17
18 Impacting factors on aquatic resources that are expected to stop or decrease after reactor
19 shutdown include the withdrawal of water for cooling, discharge of heated cooling water,
20 dredging activities, and onsite construction activities. Cooling demands of a reactor in cold
21 shutdown will be greatly reduced, as will be the rate of water withdrawal to maintain appropriate
22 water volumes and chemical quality in the cooling system. However, water withdrawal may not
23 be completely eliminated unless or until fuel assemblies are removed from the reactor core.
24 Also, water withdrawal rates will continue unchanged to support other units and facilities onsite
25 that remain operational. Nevertheless, the impingement and entrainment of aquatic organisms
26 would substantially decrease after plant operations cease, and the potential for impacts on
27 aquatic communities from these factors would be reduced. In general, the termination of
28 entrainment and impingement would have positive effects on affected organisms.

29
30 As identified in Section 4.6.1.2, the discharge of heated cooling water during operations has the
31 potential to affect aquatic resources by altering the thermal regimes to which aquatic organisms
32 are exposed, lowering the level of dissolved oxygen, and promoting gas supersaturation.
33 Because the plant would discharge significantly smaller volumes of heated water after
34 operations cease, the NRC anticipates that the plant's influence on the thermal conditions in the
35 receiving waters would be greatly reduced.

36
37 During the years of plant operations, it is likely that an aquatic community that was acclimated to
38 warmer temperatures and biocides would have developed within the mixing zone. Some
39 aquatic organisms may have become established in the mixing zone because of the warmer
40 environment, and these organisms likely would be adversely affected as the water temperature
41 cooled and the original conditions were restored within the body of water. Organisms

Environmental Consequences and Mitigating Actions

1 susceptible to cold shock could be affected, depending on the timing and rate of change in
2 water temperatures. Such effects, which occur primarily during winter months, would occur only
3 during the initial period after the plant ceases operations, and they could be minimized by
4 initiating reactor shutdown during seasons when cold shock would be less likely to occur and by
5 gradually reducing inputs of heated effluent to the system. As a consequence of the return to a
6 more natural thermal regime, it is anticipated that the composition of the aquatic organisms in
7 that area would return to a composition similar to that in the surrounding areas of the receiving
8 waters. Recovery of an aquatic community to the normal background composition is a process
9 of variable duration that depends on the mobility of the organisms, sources of colonists, rate of
10 growth and maturation of the species, and other factors (Cairns 1990). Populations of some
11 invasive species, such as the water hyacinth (*Hydrilla verticillata*) that proliferates at the North
12 Anna plant in Virginia as a result of the elevated temperature of discharges, may decline as
13 water temperatures in the receiving body of water fall.

14
15 The impacts from the termination of nuclear power plant operations on a cooling pond depend
16 largely on whether the pond continues to exist. For cooling ponds that are maintained during
17 plant operation by pumping water from another water body, the ponds would likely revert to a
18 terrestrial system after pumping stopped. Even if ponds are maintained by natural flow, water
19 may no longer be impounded. Restoration of these previously impounded areas may be
20 necessary to minimize adverse ecological impacts associated with the exposure of previously
21 inundated substrates. If the ponds continued to exist, the nuclear plant's thermal effects on
22 them would cease. Cessation of the heated effluent would change the composition and
23 dynamics of the pond community until it resembled that of other ponds in the region not used
24 for cooling.

25
26 Because there would no longer be a need to withdraw or discharge cooling water, it is also
27 anticipated that dredging would no longer be needed in the vicinity of cooling water structures.
28 Therefore, the potential for dredging to affect aquatic biota would also be eliminated, unless the
29 cooling water system was still needed to cool other electrical generating systems. As described
30 in Section 4.6.1.2, gas supersaturation has the potential to occur within the mixing zone of
31 some power plants. Even though such effects have been reduced with mitigation measures,
32 such as the use of diffusers in the discharge area, the potential for gas supersaturation and
33 subsequent effects on biota as a result of plant operations would be eliminated or decrease
34 from the potential under the proposed action. Activities that result in ground disturbance (e.g.,
35 new construction, maintenance of some areas) may also cease or decrease at power plants
36 that are shut down as a consequence of the no-action alternative, but there would be some
37 level of maintenance needed until the plant was decommissioned. This would result in a
38 decrease or the cessation of potential effects on aquatic resources from the direct disturbance
39 of aquatic habitats and the sedimentation that could occur as a result of ground disturbance in
40 adjacent areas.

41

Environmental Consequences and Mitigating Actions

1 Because some structures may be left in place until decommissioning has been completed,
2 there is a potential for some effects on aquatic resources to continue regardless of whether or
3 not the reactor at a plant is operating. For example, dams constructed to maintain supplies of
4 water for operational needs may continue to prevent migration of anadromous fish unless the
5 structures are removed. In addition, maintenance activities would continue along the
6 transmission line ROWs regardless of whether the plant is operating or not.

7
8 At coastal plants, the termination of nuclear plant operations could have a beneficial impact on
9 the Federally listed loggerhead sea turtle (threatened), green sea turtle (*Chelonia mydas*,
10 threatened), leatherback sea turtle (endangered), hawksbill sea turtle (endangered), and
11 Kemp's ridley sea turtle (endangered), which have been impinged at several nuclear power
12 plants (e.g., St. Lucie and Oyster Creek). Similarly, potential benefits to the Federally
13 endangered West Indian manatee and pinnipeds, protected under the Marine Mammal
14 Protection Act, could occur. For example, the West Indian manatee has been impinged at
15 St. Lucie, and incidental takes of harbor seals, gray seals, harp seals, and hooded seals occur
16 at the Seabrook plant. Potential impingement and entrainment losses of special status fish
17 species could also decrease. Reactor shutdown could also decrease impacts on EFH, although
18 only minimal adverse effects have been identified for the operating plants for which EFH
19 assessments have been prepared (i.e., Pilgrim, Vermont Yankee, and Oyster Creek plants).
20 Elimination of high-temperature discharges at plants in Florida may reduce habitat suitability for
21 the West Indian manatee, particularly during winter. However, the West Indian manatee
22 occupies other habitats in Florida that do not have artificially elevated temperatures, and it uses
23 a number of thermal discharges from fossil fuel plants along both coasts of
24 Florida (Laist and Reynolds 2005).

25
26 The NRC evaluated the potential impacts of decommissioning on ecological resources in the
27 decommissioning GEIS (NRC 2002a). The conclusions of that evaluation are summarized here,
28 but the focus of the present evaluation is on the incremental effects that would result from
29 deferring decommissioning to a later date as a result of renewing the license for plant
30 operations. In the 1996 GEIS, the NRC concluded that the ecological impacts of
31 decommissioning activities would be the same with or without license renewal and was
32 designated a Category 1 issue.

33
34 The NRC (2002a) evaluated potential impacts on terrestrial ecological resources during the
35 decommissioning process via both direct and indirect disturbance of native plant or animal
36 communities in the vicinity of the plant site. In most cases, the impacting factors and the
37 potential impacts from decommissioning activities are similar to impacts that could occur as a
38 consequence of continued operations and refurbishment activities at operating facilities. Direct
39 impacts of decommissioning on terrestrial ecological resources could result from activities such
40 as the clearing of native vegetation or filling of a wetland. Indirect impacts could result from
41 erosion, dust, or noise. In most cases, land disturbances during decommissioning would result

Environmental Consequences and Mitigating Actions

1 in relatively short-term impacts, and the land would either recover naturally or would be
2 landscaped appropriately for an alternative use after completion of decommissioning
3 (NRC 2002a). The NRC determined that impacts on terrestrial resources from dust generation,
4 noise, surface erosion and runoff, and migratory bird collisions associated with
5 decommissioning would be minor and would continue only until decommissioning activities were
6 completed (NRC 2002a). The effects of such impacts could be minimized by using standard
7 best management practices.

8
9 At most commercial nuclear facilities, there is a relatively distinct operational area where most
10 or all site activities occur. This operational area usually includes all areas within the protected
11 area fence; the intake, discharge, cooling, and other associated structures; and adjacent paved,
12 graveled, and maintained landscaped areas. The operational area may include the entire area
13 disturbed during facility construction, but it is often considerably smaller. In most cases, the
14 amount of land required to support the decommissioning process is relatively small and is a
15 small portion of the overall plant site. Usually, the areas disturbed or used to support
16 decommissioning are within the operational areas of the site and are also within the protected
17 area. Decommissioning activities conducted within the operational areas are not expected to
18 have a detectable impact on important terrestrial resources (NRC 2002a). However, it is
19 expected that some sites will require the reconstruction or installation of new transportation
20 links, such as railroad spurs, road upgrades, or barge slips, for the completion of
21 decommissioning. The NRC (2002a) concluded that for facilities at which the decommissioning
22 activities would be limited to existing operational areas, the potential impacts on terrestrial
23 ecology would be small. It was further concluded that if habitat disturbance beyond the
24 operational areas is anticipated, the impact on terrestrial resources could be small, moderate,
25 or large and would have to be determined through a site-specific analysis.

26
27 In most cases, the impacting factors and the potential impacts on aquatic resources from
28 decommissioning activities are similar in nature to impacts that could occur as a consequence
29 of refurbishment activities for operating facilities. Direct impacts of decommissioning on aquatic
30 resources could result from activities, such as removing shoreline or in-water structures (i.e.,
31 the intake or discharge facilities); dredging a stream, river, or ocean bottom; or depositing fill in
32 a stream or bay. Indirect impacts could result from effects such as runoff and sedimentation
33 from disturbed upland areas (NRC 2002a). During decommissioning, aquatic habitats at the
34 plant site might also be disturbed in order to construct support facilities, such as a dock for
35 barges or a bridge over a stream or some other body of water. In addition, aquatic
36 environments away from the plant site could be disturbed during the upgrading or installation of
37 new transportation systems (e.g., a new rail line to support the removal of large components) or
38 during the installation or modification of transmission lines. In most cases, aquatic habitat
39 disturbances from decommissioning would result in relatively short-term impacts on small
40 areas, and either the affected aquatic habitats would recover naturally or the impacts could be

1 mitigated (NRC 2002a). Typically, these impacts would be temporary and would not detectably
2 alter or destabilize important ecological attributes (NRC 2002a).

3
4 If decommissioning did not include removal of shoreline or in-water structures and if all
5 decommissioning activities were confined to the plant operational areas, impacts from
6 decommissioning on aquatic resources would be expected to be minor and would result
7 primarily from increased sediment from physical alterations of the site. In such cases, it is
8 expected that the impact on aquatic resources would be nondetectable, nondestabilizing, and
9 easily mitigated (NRC 2002a). Greater impacts on aquatic resources could occur if
10 decommissioning entailed the removal of structures from the shoreline or in-water environment,
11 removal of contaminated soil in or near an aquatic environment, or dredging and significant
12 modification of barge loading facilities (NRC 2002a).

13
14 Permits for discharge to the aquatic environment during operations are almost always for
15 discharge amounts that are greater than planned or realized during decommissioning. In
16 almost all cases examined, licensees expect to restrict activities to previously disturbed areas
17 and operate within the limits of operational permits (NRC 2002a). The NRC (2002a) concluded
18 that for facilities at which the decommissioning activities would be limited to existing operational
19 areas, the potential impacts on aquatic resources would be small. It further concluded that if
20 habitat disturbance beyond the operational areas was anticipated, the impacts on aquatic
21 resources could be small, moderate, or large and would have to be determined through site-
22 specific analysis.

23
24 In most cases, the impacting factors and the potential impacts on threatened or endangered
25 species (including other special status species or habitats) from decommissioning activities are
26 similar in nature to impacts that could occur as a consequence of refurbishment activities for
27 operating facilities. These species could be affected during the decommissioning process,
28 either through direct effects or through disturbances of habitats on which the species rely for
29 food or shelter. If a nuclear plant ceased operations for an extended period of time, the
30 situation could allow the establishment of onsite populations of protected species that could be
31 adversely affected by subsequent facility decommissioning at the end of the storage period
32 (NRC 2002a).

33
34 The greatest potential for impacts from decommissioning on protected species is associated
35 with physical alteration or dismantlement of the facilities, landscape, or aquatic environment.
36 The impacts of decommissioning could result from activities similar to those described for
37 terrestrial and aquatic resources. The NRC (2002a) concluded that the potential impacts on
38 threatened and endangered species may be small, moderate, or large and that the adverse
39 impacts and associated significance of the impacts must be determined on a site-specific basis.

Environmental Consequences and Mitigating Actions

1 The impacts of decommissioning on ecological resources depend primarily on the types of
2 decommissioning activities that are conducted and whether those activities occur inside or
3 outside the existing operational area. Although many of the activities that could affect
4 ecological resources during decommissioning are the same as the activities that occur during
5 the normal operation of a nuclear power plant, the length of time that operations have been
6 ongoing will not change the level of impacts associated with decommissioning. Therefore,
7 deferring decommissioning by renewing a plant's license would have the same impacts on
8 ecological resources, if any, as would occur as a result of starting decommissioning sooner.
9 The impact from the termination of plant operations and decommissioning on ecological
10 resources attributable to license renewal would be small for all nuclear plants.

11 12 **Historic and Cultural Resources**

13
14 The termination of nuclear plant operations would not affect historic or cultural resources.

15
16 The NRC conducted an analysis of the potential effects of decommissioning on historic and
17 archaeological (cultural) resources and found that the potential onsite impacts at sites where
18 the disturbance of lands would not go beyond the operational areas would be small (NRC
19 2002a). The continued operation of a plant under a renewed license would not be expected to
20 alter this conclusion. Similar activities are expected to continue before and after license
21 renewal. The majority of impacts on historic and cultural resources would have occurred during
22 the original construction of the plant. Continued use has the potential to affect these resources,
23 as discussed in Section 4.7.1. There is nothing inherent in using a plant for a longer time that
24 would increase or decrease the impact on these resources from decommissioning. Adherence
25 to procedures that take into account the impact on historic and cultural resources would
26 mitigate any additional impacts.

27
28 Delaying decommissioning is not expected to have any effect on historic and cultural resources
29 within a transmission line ROW. Impacts on historic and cultural resources would likely have
30 occurred during initial construction. On the basis of these considerations, the effect of license
31 renewal on the impacts from the termination of plant operations and decommissioning would be
32 small at all nuclear plant sites.

33 34 **Socioeconomics**

35
36 Terminating nuclear plant operations and reducing plant staff would have an impact on regional
37 employment and income and the quality and availability of community services. Nuclear power
38 plants generate a significant amount of employment and income in the local economies, which
39 would no longer occur with the cessation of plant operations. Plant wage and salary
40 expenditures as well as other expenditures would decrease. Demand for services and housing

1 would disappear or substantially decline. Indirect employment and income created as a result
2 of nuclear power plant operations would also disappear or be reduced.

3
4 The termination of plant operations would also have an impact on population and housing.
5 Plants located in rural communities have relatively small housing markets, low median house
6 values, and stable vacancy rates. Loss of plant employment in rural communities would likely
7 mean plant workers and their families would leave the area in search of jobs elsewhere,
8 creating a decline in demand for housing, depressing housing prices and values. Conversely,
9 housing markets in semi-urban regions in the vicinity of metropolitan areas generally
10 experience more rapid, housing turnover, higher prices, and lower vacancy rates. While the
11 loss of plant employment in semi-urban regions may mean some out-migration of workers,
12 many plant employees would be able to find more opportunities for employment. In addition,
13 the impact on the housing market could be offset by demand for housing with employment
14 growth in other parts of the regional economy.

15
16 The impacts from the loss of tax revenue due to the termination of plant operations and the
17 availability of community services and public education could be small to large. Nuclear power
18 plants generally provide significant tax revenue to state, county, township, municipal, and public
19 school districts. This revenue is spent on education, public safety, transportation, and
20 community services. The loss of tax revenues from the nuclear plant could mean the reduction
21 and/or the elimination of some community services and a potential deterioration in the quality of
22 public educational services. Any traffic congestion caused by the nuclear plant workforce would
23 be reduced due to plant closure. The impacts of decommissioning are summarized from the
24 NRC Decommissioning GEIS (NRC 2002a).

25
26 Although the socioeconomic impact from the termination of plant operations and
27 decommissioning could be large, license renewal would only delay the timing of the impact and
28 would not affect its magnitude. On the basis of these considerations, the NRC concludes that
29 the incremental effect of license renewal on the impact of decommissioning would be small for
30 all socioeconomic issues at all nuclear plants.

31 32 **Human Health**

33
34 With the termination of plant operations, there would be a period between the time when a
35 reactor stopped operating and when the decommissioning of the plant began that could range
36 from months to years. During that period, the reactor would be placed in a cold shutdown
37 condition and maintained. The fuel might be removed from the core and put in the spent fuel
38 storage pool. Activities related to placing the reactor in shutdown status could result in potential
39 radiation exposure to workers. There might be some liquid effluent releases to the
40 environment, although at a lower level, that could result in radiation exposure to the public. The
41 regulatory requirements and dose limits during this period for workers and the public are the

Environmental Consequences and Mitigating Actions

1 same as those for operating reactors (see Section 3.9.1.1). The radiological impacts on
2 workers and members of the public during this time period would be less than those during
3 current operations and those expected during decommissioning.

4
5 Public exposure to EMFs would decrease after transmission lines were de-energized. Power
6 would still be provided to the site, and workers might be exposed to EMFs during this period. It
7 is expected that the impacts from EMFs during this period would be less than the impacts from
8 current operations.

9
10 Because reactor shutdown would result in the cessation or reduction of cooling system
11 operations, the public would not be exposed to chemical and microbiological hazards
12 associated with these operations. The plant workers might be exposed to chemical,
13 microbiological, and other hazards during this period, but the hazards would be small and
14 bounded by the hazards either during operations or decommissioning.

15
16 The remainder of this section evaluates the effects of license renewal on the human health
17 impacts from the termination of nuclear power plant operations and decommissioning. The
18 issues considered here include the impacts from radiological exposure and risk, chemical
19 hazards, microbiological hazards, physical occupational hazards, and electrical hazards. Work
20 during decommissioning activities is generally done according to an environmental safety and
21 health plan that serves as a guidebook for anticipating hazards and preventing any injury or
22 harm. In the 1996 GEIS, the NRC considered the effect of license renewal on only the radiation
23 dose impacts of decommissioning.

24
25 The human health impacts from physical, chemical, and microbiological hazards during the
26 termination of plant operations and decommissioning would be small for all plants. The effect of
27 license renewal on the impact from terminating plant operations and decommissioning on
28 human health also would be small at all plants. Doses to the public would be well below
29 applicable regulatory standards, regardless of which decommissioning option was used.
30 Collective occupational doses would increase no more than 0.1 person-rem, attributable to the
31 buildup of long-lived radionuclides during the license renewal term, but the individual worker
32 doses would be well below the existing dose limits. On the basis of these considerations, the
33 NRC concludes that the effect of license renewal on the impact from decommissioning on
34 human health would be small for all nuclear plants.

35 36 Radiological Exposure

37
38 During decommissioning activities, workers are exposed to radioactive materials that are
39 present in the reactor and support facilities, and members of the public may be exposed to
40 radioactive materials that are released to the environment. The regulatory requirements and
41 dose limits during decommissioning are the same as those for operating reactors (see

1 Section 3.9.1.1). Many activities during decommissioning are similar to the activities that occur
2 during normal maintenance outages, such as decontamination of piping and surfaces; removal
3 of piping, pumps, and valves; and removal of heat exchangers. Some of the activities, such as
4 removal of the reactor vessel or demolition of facilities, are unique to decommissioning. The
5 decommissioning GEIS (NRC 2002a) evaluated the potential radiological impacts of
6 decommissioning activities for both PWRs and BWRs. Public and occupational radiation
7 exposures from decommissioning activities were evaluated on the basis of information derived
8 from recent decommissioning experience.

9
10 *Occupational Radiation Exposure*

11
12 Both the 1996 GEIS and the decommissioning GEIS provide estimated collective occupational
13 radiation doses for decommissioning PWRs and BWRs for the three decommissioning options.
14 The decommissioning GEIS also includes the estimated collective occupational radiation dose
15 for plants that are currently in the decommissioning process. The DECON method had the
16 highest dose, followed by ENTOMB and then SAFSTOR. According to the decommissioning
17 GEIS, occupational doses to individual workers during decommissioning activities are estimated
18 to average approximately 5 percent of the regulatory dose limits established in 10 CFR Part 20
19 and to be similar to, or lower than, the doses experienced by workers in operating facilities.

20
21 A 20-year extension in operations would increase the occupational doses from long-lived
22 radionuclides such as niobium-94, but these increases would not be significant for the DECON
23 option because short-lived radionuclides (primarily cobalt-60) are the principal contributor to the
24 occupational dose (NRC 1996). For the SAFSTOR option, an additional 20 years of operations
25 would increase the amount of niobium-94 by 50 percent. The contribution of niobium-94 to the
26 collective dose for this decommissioning option for 40 years of plant operation is less than 0.2
27 person-rem; therefore, the increase in dose during decommissioning after 20 additional years of
28 operations would be less than 0.1 person-rem. Total worker doses may increase, but individual
29 worker doses would be well below the regulatory limits. The NRC concluded that the impact of
30 an additional 20 years of plant operation on the radiological doses to workers would be of small
31 significance for all nuclear plants.

32
33 *Radiation Exposure to the Public*

34
35 According to the 1996 GEIS, the radiation dose to the public during decommissioning would
36 result primarily from waste shipment for both PWRs and BWRs, and the dose would be almost
37 exclusively attributable to the shipment of short-lived radionuclides, mainly cobalt-60. During
38 decommissioning, the estimated increased risk of fatal cancer to an average member of the
39 public would be much less than 1×10^{-6} (NRC 2002a). If a plant operated an additional
40 20 years, only the quantities of long-lived radionuclides would increase, and only the dose
41 caused by the long-lived radionuclides would increase. As discussed in the 1996 GEIS, the

Environmental Consequences and Mitigating Actions

1 dose to the public from long-lived radionuclides after 40 years of plant operation is expected to
2 be negligible, and the increase in quantities of long-lived radionuclides after an additional
3 20 years would result in a negligible dose (less than 0.1 person-rem). Accordingly, the NRC
4 concluded that the contribution of license renewal to radiological impacts to the public from
5 decontamination would be of small significance at all nuclear plants.
6

7 *Chemical Hazards* – Decommissioning involves many activities that expose workers to chemical
8 hazards, including paints, asbestos, lead, polychlorobiphenyls, mercury, quartz, and other
9 hazardous materials in building materials. During decommissioning, workers may also be
10 exposed to fumes (that often include lead and arsenic) and smoke from flame cutting and
11 welding. According to the decommissioning GEIS, with proper planning, workplace design, and
12 engineering controls, supplemented by the use of personal protective equipment and
13 administrative solutions, the impact of chemical hazards on workers would be of small
14 significance at all nuclear plants. A 20-year delay caused by license renewal would not change
15 the projected human health impact from chemical hazards because (1) there would not be any
16 more hazardous chemicals present, (2) the workers would still would have a proper work plan,
17 and (3) all required controls would be in place.
18

19 *Microbiological Hazards* – During decommissioning, workers may be exposed to molds and
20 other biological organisms that grow in and on buildings. Proven industrial hygiene principles
21 mitigate the risk of developing diseases from these organisms. According to the
22 decommissioning GEIS, if a thorough inspection of the facility is conducted and proper
23 cleansing and personal protective equipment are used when biological agents are identified, the
24 impacts of biological agents on workers would be small. A 20-year license renewal would not
25 change the microbiological hazards associated with decommissioning at any nuclear plant
26 because the workers would still be using proper cleansing and personal protective equipment
27 when biological hazards were identified.
28

29 *Electromagnetic Fields* – Operating transmission lines produce an EMF. When a nuclear power
30 plant ceases to operate, no electricity is transmitted. Therefore, the public's exposure to EMF
31 could decrease unless the power that was no longer being generated at the plant was replaced
32 by new power generation. Power would still be provided to the site, and workers might be
33 exposed to EMF during decommissioning. It is expected that the impacts during
34 decommissioning would be bounded by the impacts from current operations. The EMF impact
35 associated with decommissioning after a 20-year license renewal term would not differ from that
36 without renewal.
37

1 *Other Hazards* – The major sources of physical occupational hazards during decommissioning
2 involve the operation and use of construction and transportation equipment. Workers may be
3 exposed to extreme temperatures while working outdoors. They may operate cranes near
4 power lines, dig near buried cables, and encounter electrical hazards. During demolition or
5 dismantlement, the workers may use cutting torches, which can start fires. It is expected that
6 all of the activities would be anticipated in advance, and that proper precautions would be taken
7 to minimize any adverse impacts. A 20-year delay in decommissioning caused by license
8 renewal would have no effect on the projected human health impact from other hazards,
9 because the workers would have the proper work planning, workplace design, and controls in
10 place. Moreover, the conditions would not be more hazardous after an additional 20 years.

11
12 Accidents During the Termination of Nuclear Plant Operations and Decommissioning

13
14 The impacts of postulated accidents during the license renewal term are discussed in
15 Section 4.9.1.2. The general characteristics, including the source terms, of postulated
16 accidents are expected to be similar after reactor shutdown; therefore, the consequences would
17 also be expected to be similar. Because of the enhanced aging management activities and
18 extended life of certain systems, structures, and components, there may be small differences in
19 the probabilities of occurrence of these accidents after reactor shutdown. These differences,
20 however, are not expected to be significant, and the risks of accidents after reactor shutdown
21 would be expected to be similar to or less than the risks discussed in Section 4.9.1.2 for the
22 proposed action.

23
24 The impacts associated with accidents that can occur during the decontamination and
25 decommissioning of nuclear power plants were analyzed in the Decommissioning GEIS
26 (NRC 2002a). The radiological impacts of accidents were discussed in Section 4.3.9 of the
27 same document, and nonradiological impacts were discussed in Section 4.3.10. Radiological
28 accidents that were considered in the analysis included both those that relate to onsite storage
29 and handling of spent nuclear fuel and those that are unrelated to spent nuclear fuel. The non-
30 fuel-related accidents centered on decontamination, dismantlement, and storage-type
31 accidents. The accidents included fires, handling accidents, explosions (e.g., explosion of liquid
32 propane gas tanks), and accidental releases of liquid radioactive wastes from storage tanks.

33
34 Nonradiological accidents were considered under occupational issues and included physical,
35 chemical, ergonomic, and biological hazards. The category of physical hazards included
36 potential injuries or deaths resulting from the operation and use of construction and
37 transportation equipment. Electrical hazards, including the potential for electrocution, were also
38 considered. The potential exposure of workers to chemical and biological agents was
39 considered under both normal operations and accidents. Ergonomic conditions were evaluated
40 from the point of view of ergonomic stress such as discomfort and fatigue affecting the workers'
41 performance and safety.

Environmental Consequences and Mitigating Actions

1 The NRC made the following conclusions regarding radiological accidents associated with
2 decommissioning on the basis of the evaluations conducted for the decommissioning GEIS
3 (NRC 2002a):
4

5 The NRC has considered available information, including comments received on
6 the draft of Supplement 1 of NUREG-0586, concerning the potential impacts of
7 non-spent-fuel-related radiological accidents resulting from decommissioning.
8 This information indicates that, with the mitigation procedures in place, the
9 impacts of radiological accidents are neither detectable nor destabilizing.
10 Therefore, the NRC makes the generic conclusion that the impacts of non-spent-
11 fuel-related radiological accidents are SMALL. The NRC has considered
12 mitigation and concludes that no additional measures are likely to be sufficiently
13 beneficial to be warranted.
14

15 The NRC has considered available information, including comments received on
16 the draft of Supplement 1 of NUREG-0586, on the potential impacts of spent-
17 fuel-related radiological accidents resulting from decommissioning. The NRC
18 affirms the conclusions in the Waste Confidence Rule and concludes that the
19 impacts of spent fuel storage are SMALL. The NRC concludes that additional
20 mitigation measures are not likely to be sufficiently beneficial to be warranted.
21

22 The conclusion regarding the occupational issues, which included nonradiological accidents,
23 was as follows:
24

25 The NRC has considered available information, including comments received on
26 the draft of Supplement 1 of NUREG-0586, on the potential impacts of
27 decommissioning activities on occupational issues. This information indicates
28 that the impacts on occupational issues are not detectable or destabilizing.
29 Therefore, the NRC makes a generic conclusion that, for all plants, the potential
30 impacts on occupational issues are SMALL. The NRC has considered mitigation
31 measures and concludes that no additional mitigation measures are likely to be
32 sufficiently beneficial to be warranted.
33

34 License renewal would merely delay when accidents associated with the termination of nuclear
35 power plant operations and decommissioning could occur and would not affect their probability
36 or consequence.
37

1 **Environmental Justice**

2

3 Termination of nuclear plant operations could have small to moderate adverse impact on
4 minority and low-income populations resulting from loss of employment and income. The
5 curtailment of plant tax revenues affecting the coverage and quality of community services and
6 education could disproportionately affect low-income and minority populations. Many of the
7 regions surrounding nuclear plants have lower-than-average per capita income and larger-than-
8 average populations living below the poverty line, and minority individuals may rely more heavily
9 on community-funded services than the general population. Impacts from the loss of
10 employment, income, and tax revenues could be offset if replacement power generating
11 facilities were built or other employment opportunities were created at or near existing nuclear
12 power plant sites.

13

14 Decommissioning activities following the termination of plant operations could affect air, land,
15 water, and ecological resources in the area around each nuclear power plant site, which might
16 produce high and adverse health and other environmental impacts on the general population.
17 Population groups that have particular resource dependencies or practices (e.g., subsistence
18 agriculture, hunting, fishing) could be disproportionately affected. It is unlikely that license
19 renewal would substantially alter the impact of decommissioning on minority and low-income
20 populations around each nuclear plant.

21

22 The pathways through which the environmental impacts associated with decommissioning
23 activities at nuclear plants might affect human populations, and the extent to which minority and
24 low-income populations could be disproportionately affected, have been identified in the
25 decommissioning GEIS (NRC 2002a). At some plants, resource dependencies and practices
26 (e.g., subsistence agriculture, hunting, fishing) have been identified. In addition, location-
27 dependent disproportionately high and adverse impacts affecting minority and low-income
28 populations have been also identified near some nuclear plants. It is expected that the impact
29 of decommissioning after a license renewal term would be similar to that identified in the
30 decommissioning GEIS (NRC 2002a).

31

32 Although the impact from the termination of nuclear power plant operations and
33 decommissioning on minority and low-income populations could be more than small, license
34 renewal would merely delay the occurrence of this impact and would not affect its magnitude.

35

36 On the basis of these considerations, the NRC concludes that the effect of license renewal on
37 the environmental justice impacts from the termination of nuclear power plant operations and
38 decommissioning would be small for all nuclear plants.

39

1 **Waste Management and Pollution Prevention**

2
3 After termination of nuclear plant operations, there would be a period before the beginning of
4 decommissioning when the reactor would be placed in a cold shutdown condition and
5 maintained. The fuel might be removed from the core and put in the spent fuel storage pool.
6 There might also be activities related to placing the reactor in shutdown status that could result
7 in the generation of some waste. The types of waste generated during this period would be the
8 same as the types of waste generated during operations and decommissioning. The quantities
9 of waste generated would be smaller than the quantities generated during either operations or
10 decommissioning. The impacts associated with the management of LLW, hazardous waste,
11 mixed waste, and nonradioactive and nonhazardous waste during operations and
12 decommissioning would be small. These impacts would also be small when the reactor was in
13 shutdown status pending decommissioning. All pollution prevention and waste minimization
14 measures instituted during operations would likely continue to be used to minimize releases to
15 the environment and minimize the quantities of waste generated. As discussed in
16 Section 4.11.1, under the Waste Confidence Rule, the NRC has determined that spent nuclear
17 fuel could be stored onsite safely and with a minimal environmental impact for at least 30 years
18 beyond the operating life (including the license renewal term when applicable) of nuclear power
19 plants.

20
21 The decommissioning process, by its very nature, generates wastes. The wastes generated
22 are shipped offsite, where they are permanently disposed of, or stored onsite for a certain
23 period or indefinitely. Under the three decommissioning options analyzed in the
24 decommissioning GEIS (NRC 2002a), the DECON process would generate the most waste. In
25 this process, the equipment, structures, and portions of the facility and site that contain
26 radioactive contaminants are removed and decontaminated to a level that permits termination
27 of the license after cessation of operations. In the SAFSTOR process or ENTOMB process, the
28 materials are left onsite temporarily or permanently, respectively.

29
30 The impacts from decommissioning that result in the generation of wastes and their onsite
31 management until they are loaded onto vehicles to be shipped offsite are addressed under
32 other disciplines discussed in Section 4.12.2.1. This section addresses the impacts from
33 transporting the wastes to disposal facilities and from their disposal. If there are interim
34 locations offsite where wastes undergo treatment before being sent to a disposal facility, they
35 are also discussed here.

36
37 The types of wastes generated during decommissioning would include LLW, mixed waste,
38 hazardous waste, and nonradioactive, nonhazardous waste (see Section 3.11 for waste type
39 definitions). No spent fuel, HLW, or transuranic waste would be generated during
40 decommissioning because spent fuel would have been removed from the reactor and stored in
41 either the reactor's spent fuel pool or in an ISFSI before the start of decommissioning.

Environmental Consequences and Mitigating Actions

1 It is expected that most of the waste generated during decommissioning would be LLW and
2 nonradioactive, nonhazardous waste. There would be small quantities of mixed waste (mostly
3 paints, waste oils, solvents, and metals such as lead or cadmium) that would be managed per
4 the requirements of the Resource Conservation and Recovery Act (RCRA) for its hazardous
5 component and the Atomic Energy Act (AEA) for its radioactive component, as described in
6 Section 3.11.3. The quantities of hazardous waste that would be generated would also be
7 small and would mainly consist of paints, solvents, and batteries. Some of the materials used
8 to decontaminate surfaces could also end up being classified as mixed waste. Both mixed
9 wastes and hazardous wastes could be sent to an authorized waste treatment center for
10 incineration or some other form of treatment before being sent to a disposal facility authorized
11 to accept such waste. All of these activities would be conducted according to permits and
12 requirements established under RCRA. The nonradioactive, nonhazardous waste, consisting
13 mainly of rubble and debris, would be sent to a local landfill.
14

15 The impacts associated with transporting equipment and materials (radiological and
16 nonradiological) offsite during decommissioning are analyzed in Section 4.3.17 of the
17 decommissioning GEIS (NRC 2002a). The materials transported offsite would include all
18 wastes generated onsite. Radiological impacts would include exposure of transportation
19 workers and the general public along the transportation routes. Nonradiological impacts would
20 include increased traffic volume, additional wear and tear on roadways, and potential traffic
21 accidents. It was concluded that the transportation impacts would not be destabilizing.
22 Therefore, the NRC made the generic conclusion that for all plants, the potential transportation
23 impacts would be small.
24

25 There might be small differences in the quantities and characteristics of the waste that would be
26 generated during decommissioning after the license renewal term and the waste that would be
27 generated after the original license period. If the plant license was not renewed, the reactor
28 could be decommissioned at the end of the current license term, whereas if the license was
29 renewed, the decommissioning would take place approximately 20 years later. Additional
30 waste might accumulate at the site, or the radioactivity of some components undergoing
31 decommissioning might be slightly higher at the end of the license renewal term. For example,
32 if there were any refurbishment activities during the license renewal term that resulted in
33 equipment (e.g., steam generators) being taken out of service and subsequently stored onsite
34 awaiting disposition during decommissioning, the amounts of certain types of waste (e.g., LLW)
35 generated from decommissioning under the proposed action would be more than the amounts
36 generated during the original license period. Because of the differences in timing, some of the
37 materials in and around the core of the reactor might have slightly higher radioactivity under the
38 proposed action as a result of a buildup in long-lived radionuclides. This situation would mainly
39 affect the amount of greater-than-Class C LLW at the site. Assuming that the spent nuclear
40 fuel continued to be stored onsite during the license renewal term, there would also be more

Environmental Consequences and Mitigating Actions

1 spent fuel to manage. Similarly, if certain LLW classes (e.g., Class A, B, and C wastes) had to
2 be stored onsite for long periods (for the reasons discussed in Section 4.11.1), the amounts of
3 those wastes that would have to be addressed during decommissioning might be larger after
4 the license renewal term. However, it is not expected that these differences would significantly
5 alter the practices employed to manage the wastes or the impacts associated with managing
6 the wastes generated during decommissioning.

7
8 The decommissioning activities would be designed and implemented in ways to prevent
9 pollution and minimize the amount of waste generated. All the methods mentioned in
10 Section 3.11.5, including source reduction and recycling of materials either onsite or offsite,
11 would be used. Under source reduction, the licensees would use decontaminating agents and
12 technologies that would generate less waste, particularly mixed and hazardous waste. They
13 would also implement procedures and practices that would be aimed at preventing or
14 minimizing gaseous and liquid releases to the environment and the quantities of waste
15 generated.

16
17 The quantity of LLW that would be generated from the decommissioning of a model
18 1000-MW(e) power plant is included in the quantities of LLW reported on in Section 4.12.1.1.
19 The quantities of mixed waste and hazardous waste that would be generated from
20 decommissioning of nuclear power plants would be relatively small and managed in a way that
21 would protect human health and the environment to meet RCRA requirements. Clean wastes
22 (wastes that are neither radioactive nor hazardous) would be disposed of at a local permitted
23 landfill. The transportation of wastes from a model LWR is also reported on in Section 4.12.1.1.
24 The offsite transportation of equipment and wastes from a power plant undergoing
25 decommissioning was also analyzed in the decommissioning GEIS (NRC 2002a), and the
26 impact was found to be small.

27
28 On the basis of these considerations, the NRC concludes that the effect of license renewal on
29 the waste management impacts from the termination of nuclear power plant operations and
30 decommissioning would be small for all plants.

31 32 **4.12.2.2 Termination of Plant Operations and Decommissioning of Energy Alternative** 33 **Power Plants**

34 35 **Fossil Energy Alternatives**

36
37 The environmental consequences from the termination of power plant operations and the
38 decommissioning a fossil fuel energy facility are dependent on the completeness and
39 sufficiency of the approved decommissioning plan. It is reasonable to expect that approvable
40 decommissioning plans would include, at least, the following elements and requirements:
41

Environmental Consequences and Mitigating Actions

- 1 • Removal of all unneeded structures and facilities to at least 3 ft (1 m) below grade
2 (in order to provide an adequate root zone for site revegetation).
3
- 4 • Removal of all coal, all coal combustion waste, and all FGD sludge and/or by-products.
5
- 6 • Removal of water intake and discharge structures.
7
- 8 • Dismantlement and/or removal of all ancillary facilities, including rail spurs, coal handling
9 and preparation facilities, cooling towers, natural gas pipelines, onsite wastewater
10 treatment facilities, and access roads.
11
- 12 • Removal of all surface water intake and discharge structures.
13
- 14 • Removal of all accumulated sludge, and closure and removal of all surface water
15 impoundments.
16
- 17 • Proper closure of all onsite groundwater wells.
18
- 19 • An aggressive recycling program for removed equipment and dismantled building
20 components; materials awaiting recycling would be stored at an offsite facility.
21
- 22 • Minimal delay times for removed materials and equipment at temporary laydown areas.
23
- 24 • Expedient disposal of solid and hazardous wastes at approved facilities; as necessary,
25 remediation of waste handling and storage areas.
26
- 27 • Cleanup and remediation of all incidental spills and leaks.
28
- 29 • Successful execution of an approved revegetation plan for the site.
30
- 31 • Other actions as necessary to ensure restoration of the site to a condition equivalent in
32 character and value to the greenfield or brownfield site on which the facility was first
33 constructed.
34

35 Assuming that decommissioning occurs according to a decommissioning plan as described
36 above, environmental consequences (at either a greenfield site or a brownfield site) would
37 include:
38

- 39 • Short-term impacts on air quality and noise from the operation of vehicles and
40 equipment used to deconstruct structures and facilities and the increased number of
41 workforce vehicles traveling to and from the site; impacts include release of criteria

Environmental Consequences and Mitigating Actions

1 pollutants and generation of fugitive dust and noise (including from the possible use of
2 explosives to deconstruct buildings or structures); impacts would be similar to, but of
3 shorter duration than, those experienced during facility construction.
4

- 5 • Short-term impacts on land use and visual resources due to increased human activities
6 on the site and establishment of temporary holding areas for dismantled components
7 and other deconstruction debris (some of which may be at offsite locations – e.g., at rail
8 headers).
9
- 10 • Short-term increase in local traffic as a result of increases in workforce personnel onsite
11 and truck and rail traffic bringing deconstruction equipment to the site and transporting
12 dismantled structures, removed equipment, and deconstruction debris.
13
- 14 • Long-term reestablishment of vegetation and wildlife communities.
15
- 16 • Restoration of visual values through removal of manmade structures and restoration of
17 native vegetative and wildlife communities.
18
- 19 • Short-term increase in local economic activity with the increased dismantlement
20 workforce and other related functions such as transportation, followed by a longer-term
21 downturn of local economy due to loss of jobs of operational personnel.
22
- 23 • Reestablishment of original land use opportunities.
24
- 25 • Elimination of health and safety impacts on operating personnel and the general public
26 from routine operation of the facility and as a result of accidents involving the facility;
27 short-term increase in health and safety risk to decommissioning workforce due to
28 complex and concentrated industrial activities, and short-term increase in risk of
29 transportation-related accidents, due to increased traffic densities throughout
30 decommissioning.
31

32 **New Nuclear Alternatives**

33
34 According to 10 CFR Part 52, decommissioning impacts for a nuclear power plant include all
35 activities related to the safe removal of the facility or site from service and the reduction of
36 residual radioactivity to a level that permits release of the property under restricted conditions or
37 unrestricted use and termination of a license. The decommissioning process and the activities
38 occurring during decommissioning would be similar to those associated with current reactors,
39 (see Sections 2.1.3 and 4.12.2.1).
40
41

Environmental Consequences and Mitigating Actions

1 Environmental consequences would also be similar to those discussed in Section 4.12.2.1 and
2 would include:

- 3
- 4 • Temporary impacts on land use and visual resources, including the construction of
5 temporary buildings and parking lots and the addition or expansion of laydown areas.
6 (Many plants have existing, previously disturbed areas available for these temporary
7 land use activities.)
8
- 9 • Reduced (small) water use and water quality impacts as water consumption decreases
10 significantly after cessation of operations. Dewatering and water used for spent fuel
11 cooling would continue until spent fuel was removed from the site. Surface water runoff
12 or release of substances would be possible but should not have a detectable effect on
13 the environment.
14
- 15 • Temporary increases in local traffic that would result from the additional workforce
16 onsite; truck and rail traffic bringing deconstruction equipment to the site; and the
17 transport of dismantled structures, removed equipment, and waste from the site.
18
- 19 • Long-term reestablishment of vegetation and wildlife communities.
20
- 21 • Short-term improvements in the local economy because of the increased workforce for
22 decommissioning activities, followed by a long-term downturn of the local economy
23 because of the loss of jobs of operational personnel.
24
- 25 • Potential (regulated) radiological doses to the public and decommissioning workforce at
26 the facility from activities such as removal of the reactor vessel and demolition of
27 facilities.
28
- 29 • Increased but temporary occupational safety and health risk to the workforce due to
30 complex and concentrated industrial activities.
31

32 Impacts on threatened and endangered species and environmental justice impacts are
33 considered site-specific impacts. Land use involving offsite areas to support decommissioning,
34 aquatic and terrestrial ecology for activities beyond the operational area, and historic and
35 cultural resources for activities beyond the operational area that have not been surveyed for
36 historic and cultural resources are all considered conditionally site-specific.
37

Environmental Consequences and Mitigating Actions

1 **Renewable Alternatives**

2
3 In most instances, the termination of power plant operations and the decommissioning of
4 renewable energy systems would follow the reverse of construction. Impacts would be similar in
5 nature to the impacts discussed in the Environmental Consequences of Construction of
6 Renewable Energy Alternatives section above, albeit likely for shorter periods of time.
7 Decommissioning is expected to follow a preapproved decommissioning plan and would involve
8 not only removal of facility components and operational wastes and residues, but also
9 reclamation of the land to its original state. Decommissioning scenarios are expected to involve
10 the following actions:

- 11
- 12 • Removal of all unneeded structures and facilities to at least 3 ft (1 m) below grade
13 (to provide an unencumbered root zone for site revegetation).
- 14
- 15 • Removal of all unspent biomass fuel and all solid wastes from combustion and facility
16 maintenance.
- 17
- 18 • Removal of water intake and discharge structures (if present to support combustion
19 facilities and steam cycles).
- 20
- 21 • Dismantlement and/or removal of all ancillary facilities, including rail spurs, biomass
22 (and coal) fuel handling and preparation facilities, cooling towers, natural gas pipelines,
23 onsite wastewater treatment facilities, and access roads.
- 24
- 25 • Removal of all surface water intake and discharge structures.
- 26
- 27 • Removal of all accumulated sludge, and closure and removal of all surface water
28 impoundments.
- 29
- 30 • Proper closure of all onsite groundwater wells.
- 31
- 32 • Aggressive recycling program for removed equipment and dismantled building
33 components; materials awaiting recycling would be stored at an offsite facility.
- 34
- 35 • Minimal delay times for removed materials and equipment at temporary laydown areas.
- 36
- 37 • Expedient disposal of solid and hazardous wastes at approved facilities; remediation
38 as necessary of waste handling and storage areas.
- 39
- 40 • Cleanup and remediation of all incidental spills and leaks.
- 41
- 42 • Successful execution of an approved revegetation plan for the site.

Environmental Consequences and Mitigating Actions

- Offsite ancillary facilities (access roads, utilities, pipelines, electrical transmission towers) would be removed unless it is determined that they can serve other purposes; buried utilities and pipelines could be abandoned in place if their removal would result in significant disruption to ecosystems.
- Other actions as necessary to ensure restoration of the site to a condition equivalent in character and value to the greenfield or brownfield site on which the facility was first constructed.

Termination of operations and decommissioning of offshore facilities could involve the following unique actions and strategies, depending on location:

- Wind turbine tower foundations and communication and power cables buried in the seafloor could be allowed to remain to avoid the disruption that would result from their removal.
- Underwater structures could be allowed to remain in place to serve as artificial fish habitats.
- Structures that served as electrical service platforms could be allowed to remain in place to serve as artificial reefs.

The termination of operations and the decommissioning of hydroelectric facilities could follow unique paths. For large store-and-release facilities, eliminating the dam and reservoir and restoring the river to its natural flow could have dramatic and adverse consequences to both upstream and downstream ecosystems. Especially where store-and-release dams serve purposes other than power generation (e.g., flood control and irrigation), complete elimination of the structures and reservoir and restoration of original river conditions would be at cross purposes. While turbines, generators, and other equipment associated with power production could be removed, the dam and reservoir would be expected to remain largely intact, as would fish ladders and passages. Penstocks and other devices that control the release of water from the reservoir are expected to remain functional. A reduced workforce would also remain to operate the dam for flood control and irrigation purposes. Impacts on upstream land uses would remain generally unaltered from the impacts during the dam's operating period.

1 Smaller scale, run-of-the-river dams (so called low-impact hydro facilities^(a)) that have limited
2 impact on upstream water levels and downstream water flow rates would likely be completely
3 dismantled and removed during decommissioning.
4
5

6 **4.13 Cumulative Impacts of the Proposed Action**

7

8 Cumulative impact is defined by the CEQ in 40 CFR 1508.7. Actions to be considered in
9 cumulative impact analyses include new and continuing activities, such as license renewal, that
10 are conducted, regulated, or approved by a Federal agency. The cumulative impacts analysis
11 takes into account all actions, however minor, since impacts from individually minor actions may
12 be significant when considered collectively over time. The goal of the analysis is to identify
13 potentially significant impacts to improve decisions and move toward more sustainable
14 development (CEQ 1997; EPA 1999).
15

16 The analysis of cumulative impacts focuses on
17 the resources that could be affected by the
18 incremental impacts from continued operations
19 of the nuclear plant. The CEQ discusses the
20 assessment of cumulative effects in detail in its
21 report entitled, *Considering Cumulative Effects*
22 *Under the National Environmental Policy Act*
23 (CEQ 1997). On the basis of the guidance
24 provided in the CEQ report, a cumulative impact
25 analysis would consider the following:
26

Definition of Cumulative Impact

The impact on the environment that results from the incremental impact of an action when added to other past, present, and reasonably foreseeable future actions, regardless of what agency (Federal or non-Federal) or person undertakes such other actions.

- 27 1. The geographic scope (i.e., regions of influence). The regions of influence encompass
28 the areas of affect and the distances at which impacts associated with license renewal
29 may occur. Geographic boundaries may vary by the resource area being evaluated and
30 the distances over which an impact may occur (e.g., the evaluation of impacts on air
31 quality may have a greater regional extent than that of impacts on historic and cultural
32 resources).
33
- 34 2. The time frame for the analysis. The time frame incorporates the sum of the effects of
35 renewal in combination with past, present, and future actions, since impacts may
36 accumulate or develop over time. The reasonably foreseeable time frame for future
37 actions evaluated is 20 years (based on the typical license renewal term) from the time
38 the license renewal is granted. Past and present actions include all actions up to and
39

(a) Low-impact hydro facilities are considered to have a power capacity of less than 30 MW.

1 including the time of the license renewal application; future actions are those that are
2 “reasonably foreseeable”; that is, they are ongoing (and will continue into the future), are
3 funded for future implementation, or are included in firm, near-term plans. Past and
4 present actions are generally accounted for in the baseline assessment presented in the
5 affected environment sections for each resource area (Chapter 3 of this GEIS). The
6 direct and indirect impact analyses present in Chapter 4 address the incremental
7 impacts of license renewal. These analyses are carried forward to the cumulative
8 impact analysis, which expands the analysis to consider other past, present, and future
9 actions.

- 10
11 3. The potential impacting factors of each past, present, or reasonably foreseeable future
12 action or activity. Both the license renewal and other actions (related and nonrelated)
13 will generate factors that could contribute to cumulative impacts. The impacts of
14 activities associated with the proposed action (license renewal) are discussed for each
15 resource area in this chapter. In cases where the contributions of activities to an
16 impacting factor are uncertain or not well known, a qualitative evaluation is made.

17
18 For some resource areas (e.g., water and aquatic resources), the contributions of ongoing
19 actions within a region on cumulative impacts are regulated and monitored through a permitting
20 process (e.g., NPDES) under State or Federal authority. In these cases, it may be assumed
21 that cumulative impacts are managed as long as these actions (facilities) are in compliance with
22 their respective permits. If, however, the analysis determines that a significant contribution to
23 cumulative impacts would occur as a result of license renewal, measures to ensure that adverse
24 impacts are avoided, minimized, or compensated could be identified. Several recent
25 environmental analyses for license renewal applications have found that overall cumulative
26 impacts in the region of influence of the power plant were significant (e.g., the Oyster Creek
27 plant in New Jersey and the Susquehanna plant in Pennsylvania).

28
29 The following sections generically describe the potential impacting factors of past, present, and
30 future actions that, together with the proposed action, could result in significant cumulative
31 impacts. For the most part there would be no change to environmental conditions in the vicinity
32 of nuclear power plants during the license renewal term beyond what is currently being
33 experienced. Issues that could contribute to cumulative impacts are considered Category 2
34 issues and would require a plant-specific analysis as part of the license renewal review.

35 36 **4.13.1 Land Use**

37
38 Cumulative impacts on offsite land use typically result from the incompatibility of past, present,
39 and reasonably foreseeable activities associated with many types of actions that occur in close
40 proximity (e.g., urban development, industrial and commercial development, agricultural
41 development, transportation development, and regional tourism and recreation). Because

Environmental Consequences and Mitigating Actions

1 communities manage growth and development through their land use control policies and
2 regulations, these kinds of impacts are generally considered to be small. The magnitude of
3 cumulative impacts resulting from all actions taking place within the region in which a power
4 plant is located would depend on current land use patterns and proposed land use changes.
5

6 **4.13.2 Visual Resources**

7
8 Cumulative visual impacts result from an intrusion or perceptible contrast that affects the scenic
9 quality of the landscape. Contrast results when there is a measurable difference between a
10 structure and its surrounding landscape in terms of color, form (including scale), texture, or line.
11 Visual impacts are related to activities (e.g., vegetation clearing and facility construction) and
12 structures (e.g., houses, office buildings, and transmission lines) associated with urban sprawl
13 and industrial and commercial development, and they tend to be higher in areas where
14 structures are visible from a large area and therefore visible to a large number of people. The
15 magnitude of cumulative impacts resulting from all actions taking place within the region in
16 which a power plant is located would depend on the number of structures affecting the
17 landscape, the degree of contrast, the degree of visibility (which, in turn, depends on the
18 distance and angle from which the landscape is viewed), the value of the landscape, the
19 number of viewers, the frequency and duration of views, and viewer perception of the impact
20 level.
21

22 **4.13.3 Air Quality**

23
24 Cumulative impacts on air quality generally result from activities (e.g., earthmoving and vehicle
25 traffic) associated with urban, industrial and commercial, agricultural, and transportation
26 development. These activities give rise to dust, exhaust, and evaporative emissions that
27 degrade air quality. The magnitude of cumulative impacts resulting from all actions taking place
28 within the region in which a power plant is located would depend on the type (and intensity) of
29 development within the airshed and its location relative to air quality nonattainment areas.
30

31 **4.13.4 Noise**

32
33 Noise levels in the vicinity of a power plant could result from activities (e.g., traffic) associated
34 with urban development, industrial and commercial development, water projects, and
35 transportation development. The magnitude of cumulative impacts resulting from these
36 activities would depend on a plant's proximity to major urban centers, industrial complexes, and
37 highways.
38

4.13.5 Geology and Soils

Cumulative impacts on geologic resources relate to issues concerning access to mineral or energy resources, destruction of unique geologic features, and mass movement induced by construction activities. These impacts typically result from land disturbance activities (e.g., earthmoving, blasting, grading, and excavation) associated with urban development, industrial and commercial development, water projects, and transportation development. Existing land use designations may also affect the access to mineral or energy resources. Impacts on soil resources relate to increases in the potential for soil erosion, which also occurs as a result of land disturbance activities. Vegetation clearing can increase the potential for soil erosion in the absence of soil erosion protection measures. The magnitude of cumulative impacts resulting from all actions taking place within the region in which a power plant is located would depend on the nature and location of the actions and whether appropriate mitigation measures are implemented to reduce the impacts.

4.13.6 Surface Water

Cumulative impacts on surface water resources relate to issues concerning water use and quality. Impacts typically result from activities (e.g., water withdrawal, effluent discharges, accidental spills) associated with urban development, industrial and commercial development, agricultural development, water projects (e.g., dredging), and grazing. Short-duration construction projects (e.g., vegetation clearing and road construction) can also result in surface water impacts if they increase soil erosion, which, in turn, increases sediment loading to nearby surface water bodies. The magnitude of cumulative impacts resulting from all actions taking place within the region in which a power plant is located would depend on the nature and location of the actions relative to surface water bodies, the number of actions (facilities or projects), and whether facilities comply with regulating agency requirements (e.g., permitted discharge limits).

Perhaps the most important source of surface water impacts is the withdrawal of water for plant cooling systems (both once-through and closed-cycle). These impacts relate to water use conflicts with other users. Although once-through systems return most of their withdrawn water (minus evaporative losses of less than 3 percent), surface water withdrawals for closed-cycle cooling systems can have significant impacts, because consumptive losses are much higher (up to 60 percent), resulting in the return of less water (Section 4.5). These impacts may be greater during times of drought, especially when temperatures are high.

4.13.7 Groundwater

Cumulative impacts on groundwater resources relate to issues concerning water use and quality. Impacts typically result from the water demands associated with urban, industrial and

Environmental Consequences and Mitigating Actions

1 commercial, and agricultural development. Short-duration construction projects could also
2 result in groundwater impacts over time (e.g., from spills), unless best management practices
3 (e.g., spill prevention and control plans and spill containment measures) are employed. The
4 magnitude of cumulative impacts resulting from all actions taking place within the region in
5 which a power plant is located would depend on the number of actions (facilities or projects)
6 that draw water from the aquifer, the overall demand on the aquifer, the hydrogeologic
7 characteristics of the aquifer, and whether facilities follow best management practices to protect
8 groundwater resources from degradation and overpumping.
9

10 **4.13.8 Ecology**

11
12 Cumulative impacts on terrestrial habitats and wildlife include habitat loss and degradation,
13 disturbance and displacement, injury and mortality, and obstruction of movement. Impacting
14 factors include exposure to elevated noise levels and contaminants, altered surface water and
15 groundwater quality and flow patterns, and hazards associated with direct contact with physical
16 structures (e.g., bird collisions with buildings and other structures). Adverse impacts typically
17 result from activities (e.g., construction) associated with urban sprawl, industrial and
18 commercial development, agricultural development, transportation development, water projects,
19 and regional tourism and recreation. Migratory species may be affected by activities carried out
20 in locations remote from the nuclear plant sites. Plant communities (including floodplain and
21 wetland communities) also may be affected by activities (e.g., clearing and grading) associated
22 with these actions, creating conditions that favor the encroachment of invasive species. The
23 magnitude of cumulative impacts resulting from all actions taking place within the region in
24 which a power plant is located would depend on the nature and location of the actions relative
25 to important wildlife habitats and plant communities, the number (and density) of actions, and
26 the extent to which these actions (facilities or projects) employ mitigation measures to minimize
27 such impacts.
28

29 Three scales of cumulative impacts on aquatic resources can be identified: (1) cumulative
30 impacts due to the various impacts from an individual power plant (e.g., entrainment,
31 impingement, thermal discharges, and chemical discharges), (2) cumulative impacts due to
32 closely sited power plants, and (3) cumulative impacts due to multiple activities that affect the
33 water body (e.g., dams, agriculture, urban, and industrial development) (York et al. 2005).
34 Cumulative impacts on aquatic habitats and species include the (1) loss and degradation of
35 habitat; (2) species disturbance, displacement, injury, and mortality; (3) obstruction of
36 movement; and (4) the introduction and spread of invasive species. These impacts result from
37 activities (e.g., increased water use and discharges to natural water bodies, increased and
38 contaminated runoff) associated with urban sprawl; industrial, commercial, agricultural, and
39 transportation development; water projects; and regional tourism and recreation. The
40 magnitude of cumulative impacts resulting from all actions taking place within the region in
41 which a power plant is located would depend on the nature and location of the actions relative

1 to important water bodies, the number (and density) of actions, and the extent to which these
2 actions (facilities or projects) employ mitigation measures to minimize such impacts.

3 4 **4.13.9 Historic and Cultural Resources**

5
6 Cumulative impacts on historic and cultural resources relate to the damage or destruction of
7 historic and cultural resources (i.e., archaeological sites, historic structures, and traditional
8 cultural properties, or their context). These impacts typically result from land disturbance
9 (e.g., earthmoving, blasting, grading, and excavation) or maintenance activities associated with
10 urban, industrial and commercial, agricultural, and transportation development (e.g., vegetation
11 clearing). Such activities may directly damage or destroy cultural artifacts or increase the
12 potential for their exposure by accelerating erosion, leaving them vulnerable to theft and
13 vandalism. The magnitude of cumulative impacts resulting from all actions taking place in the
14 region where a power plant is located would depend on the nature and location of the actions
15 and whether appropriate mitigation measures (in consultation with the SHPO) are implemented.

16 17 **4.13.10 Socioeconomics**

18
19 Cumulative impacts on the socioeconomic conditions in local communities relate to increases in
20 employment and income, tax revenues, population and housing, community services and
21 education, and transportation. These represent benefits that typically result from the economic
22 activities associated with urban, industrial and commercial, agricultural, and transportation
23 development and regional tourism and recreation. Significant employment and income are
24 generated by various industries, including nuclear power plants. Expenditures associated with
25 wages, salaries, and the procurement of materials and services create demand for a range of
26 durable and nondurable goods, while wage and salary spending also increases demand for
27 services and housing. Annual tax revenues to local and State government entities, primarily
28 from property taxes, are also significant. These revenues, in turn, contribute to expenditures on
29 local education, public safety, government services, and transportation, as well as employment
30 and income in each host State. New industries increase the local population and the demand
31 for housing and transportation networks. Adverse impacts include loss of jobs associated with
32 changes in various industries, housing and other types of shortages associated with a rapid
33 influx of workers to meet the demands of new projects, and changes in traffic patterns that could
34 increase congestion on some transportation networks. The magnitude of cumulative impacts
35 resulting from all actions taking place within the region in which a power plant is located would
36 depend on the intensity of development in the area, the tax revenues generated, and the
37 allocations of these revenues among local communities.

1
2
3
4
5
6
7
8
9
10
11
12
13
14
15
16
17
18
19
20
21
22
23
24
25
26
27
28
29
30
31
32
33
34
35
36
37
38
39
40
41
42

4.13.11 Human Health

Cumulative human health impacts relate to public exposure to radiological, chemical, and microbiological hazards and the potentially chronic effects of EMF exposure. Public exposures may occur as a result of environmental accumulations of harmful constituents released from various facilities associated with urban development, agriculture, and industrial and commercial development. The cumulative impacts of EMF exposure, while uncertain, would relate to activities (e.g., transmission lines and substations) associated with urban, industrial, and commercial development.

The magnitude of cumulative impacts resulting from all actions taking place within the region in which a power plant is located would depend on the nature and location of the actions, the number of actions (facilities or projects), the level of the public's exposure, and whether facilities comply with regulating agency requirements (e.g., permitted discharge limits).

4.13.12 Environmental Justice

Cumulative impacts can result when impacts on various individual resources (air, land, water, and ecology) combine to produce health and environmental impacts that are cumulatively high and adverse. Whether these impacts are disproportionately high and adverse to minority and low-income populations depends on the level of representation of these populations within the region. Sites that are close to metropolitan areas or that are located in rural areas in the south and southwest tend to have large minority and low-income populations. Adverse impacts from activities associated with urban sprawl and industrial, commercial, agricultural, and transportation development affect the resources on which these populations depend (e.g., fish, game animals, and native vegetation). The magnitude of cumulative impacts resulting from all actions taking place within the region in which a nuclear power plant is located would depend on the magnitudes of the impacts on various socioeconomic resources and the levels at which low-income and minority populations are represented within a region.

4.13.13 Waste Management and Pollution Prevention

Radioactive Waste – Spent fuel is currently stored at plant sites either in spent fuel pools or in aboveground ISFSIs until it can be shipped to a permanent repository (anticipated to be 2017 to 2020). Given the delays in the opening of the repository, however, it is likely that power plants would have to expand their spent fuel storage capacity beyond their original design. (The impacts of storage would be addressed under a general license or a specific license for the storage facility.) Waste volumes are projected to exceed the approved quantities of waste for Yucca Mountain by the early to mid 2010s; however, DOE's GNEP initiative, which could reduce waste quantities (decreasing the space requirement in the repository), is currently underway.

1
2 The magnitude of cumulative radiological impacts resulting from all actions taking place within
3 the region in which a power plant is located would be small, because nuclear power plants are
4 likely to be the only significant generators of radioactive waste within the region of concern and
5 because onsite and offsite waste management activities already consider the cumulative effects
6 at potential offsite disposal facilities. As a result, the cumulative impacts from radioactive waste
7 management and pollution prevention would be equivalent to the impact from the overall
8 incremental contribution of license renewal.

9
10 *Other Wastes* – The magnitude of cumulative impacts resulting from nonradioactive and mixed
11 wastes resulting from all actions taking place within the region in which a power plant is located
12 would be small, since waste-generating facilities must comply with Federal and State
13 regulations in terms of storage, treatment, and disposal. In addition, facilities must employ
14 procedures that ensure the proper handling and storage of wastes and monitoring for releases.
15
16

17 **4.14 Resource Commitments Associated with the Proposed** 18 **Action**

19
20 This section addresses the resources that would be committed under the proposed action. In
21 particular, it describes unavoidable adverse environmental impacts (Section 4.14.1), the
22 relationship between short-term uses of the environment and the maintenance and
23 enhancement of long-term productivity (Section 4.14.2), and the irreversible and irretrievable
24 commitment of resources (Section 4.14.3) that would be associated with the proposed action.
25 Potential unavoidable adverse environmental impacts and irreversible and irretrievable resource
26 commitments that would be associated with alternatives to the proposed action are also
27 discussed.
28

29 **4.14.1 Unavoidable Adverse Environmental Impacts**

30
31 Unavoidable adverse environmental impacts are impacts that would occur after implementation
32 of all feasible mitigation measures. Continued nuclear plant operations and the implementation
33 of any of the energy alternatives considered in this GEIS would result in some unavoidable
34 adverse environmental impacts.
35

36 The impacts of continued nuclear plant operations that are anticipated to occur are discussed
37 for each resource area in Sections 4.1 through 4.11. Some of these impacts cannot be avoided
38 because they are inherently associated with nuclear plant operations and cannot be fully
39 mitigated. Minor unavoidable adverse impacts on air quality would occur due to emission and
40 release of various chemical and radiological constituents into the environment from plant

Environmental Consequences and Mitigating Actions

1 operations. Nonradiological emissions are expected to comply with EPA emissions standards,
2 though the alternative of operating a fossil-fueled power plant in some areas may worsen
3 existing air quality attainment issues. Chemical and radiological emissions would not exceed
4 the National Emission Standards for Hazardous Air Pollutants. Other unavoidable adverse
5 impacts (depending on the plant) include the impact on land use and visual resources, some
6 minor noise effects, surface water and groundwater use, thermal effluents emitted to the
7 environment from the power conversion equipment, and entrainment and impingement of
8 aquatic organisms in the cooling water system.

9
10 During nuclear power plant operations, workers and members of the public would face
11 unavoidable exposure to radiation and hazardous and toxic chemicals. Workers would be
12 exposed to radiation and chemicals associated with routine plant operations and the handling of
13 nuclear fuel and waste material. Workers would have a higher risk of exposure than members
14 of the public, but doses would be administratively controlled and would not exceed any
15 standards or administrative control limits. Construction and operation of alternative energy
16 generating facilities would also result in unavoidable exposure to hazardous and toxic
17 chemicals to workers and the general public.

18
19 Also unavoidable would be the generation of spent nuclear fuel and waste material, including
20 LLW, hazardous waste, and nonhazardous waste. Hazardous and nonhazardous wastes would
21 also be generated at non-nuclear power generating facilities. Wastes generated during plant
22 operations would be collected, stored, and shipped for suitable treatment, recycling, or disposal
23 in accordance with applicable Federal and State regulations. Due to the costs of handling
24 these materials, power plant operators would be expected to conduct all activities and optimize
25 all operations in a way that generates the smallest amount of waste practical. Although
26 pollution prevention and waste minimization efforts are intended to prevent emissions to the
27 environment and prevent and/or minimize the quantities of waste generated, some waste and
28 emissions cannot be entirely eliminated due to current technology.

29
30 Many of these unavoidable impacts are being mitigated by incorporating safety features and/or
31 applying operational procedures at the plants and are monitored by the plant owners and State
32 agencies. Thermal, entrainment, and impingement impacts at plants with once-through cooling
33 water systems are unavoidable. However, these impacts could be reduced by modifying the
34 once-through cooling system, or by converting to a closed-cycle cooling system. Although
35 closed-cycle cooling water systems can reduce thermal, entrainment, and impingement
36 impacts, they increase water consumption (through cooling tower evaporation), fogging, icing,
37 and salt drift.

38
39 Nuclear plants being considered for license renewal already exist and have been operating for
40 decades. The environmental impacts considered for license renewal are those associated with
41 continued plant operation and refurbishment. Alternatives to license renewal involve major

1 construction impacts. Unavoidable adverse impacts of the energy alternatives if the nuclear
2 plants ceased operation at or before the expiration of current operating licenses may not be
3 smaller and could be greater than those associated with the continued operation of existing
4 plants.

5
6 Unavoidable adverse impacts would vary among plants and would depend on the specific
7 characteristics of each plant and its interaction with the environment. These unavoidable
8 adverse impacts would need to be evaluated in plant-specific SEISs.

9
10 **4.14.2 Relationship Between Short-Term Use of the Environment and Long-Term**
11 **Productivity**

12
13 The operation of power generating facilities would result in short-term uses of the environment
14 as described earlier in this Chapter. "Short term" is the period of time during which continued
15 power generating activities would take place.

16
17 Power plant operations would necessitate short-term use of the environment and commitments
18 of resources, and would also commit certain resources (e.g., land and energy) indefinitely or
19 permanently. Certain short-term resource commitments would be substantially greater under
20 most energy alternatives, including license renewal, than under the No-Action Alternative due to
21 the continued generation of electrical power as well as continued use of generating sites and
22 associated infrastructure. During operations, all energy alternatives would entail similar
23 relationships between local short-term uses of the environment and the maintenance and
24 enhancement of long term productivity.

25
26 Short-term use of the environment can affect long-term productivity of the ecosystem if that use
27 alters the ability of the ecosystem to reestablish an equilibrium that is comparable to that of its
28 original condition. An initial commitment regarding the trade-off between short-term use and
29 long-term productivity at the nuclear power plant sites was made when the plants were first
30 constructed decades ago. Renewal of the operating licenses and the continued operation of
31 the plants would not alter any existing effects on long-term productivity, but they might postpone
32 the availability of the sites at which the plants are located for other uses. The No Action
33 Alternative would lead to a cessation of operations and shutdown of the plants (an eventuality
34 regardless of current license renewal decisions).

35
36 Air emissions from power plant operations would introduce small amounts of radiological and
37 nonradiological constituents to the region around the plant site. Over time, these emissions
38 could result in increased concentrations and exposure, but are not expected to impact air quality
39 or radiation exposure to the extent that public health and long-term productivity of the
40 environment would be impaired.

Environmental Consequences and Mitigating Actions

1 Continued employment, expenditures, and tax revenues generated during power plant
2 operations would directly benefit local, regional, and state economies over the short term.
3 Local governments investing project-generated tax revenues into infrastructure and other
4 required services could enhance economic productivity over the long term.

5
6 The management and disposal of spent nuclear fuel, LLW, hazardous waste, and
7 nonhazardous waste would require an increase in energy and would consume space at
8 treatment, storage, or disposal facilities. Regardless of the location, the use of land to meet
9 waste disposal needs would reduce the long-term productivity of the land.

10
11 Power plant facilities would be committed to electricity production over the short term. After
12 decommissioning these facilities and restoring the area the land could be available for other
13 future productive uses.

14
15 The nature of the relationship between short-term use of the environment and long-term
16 productivity would vary among plants and would depend on the specific characteristics of each
17 plant and its interaction with the environment. This relationship would need to be evaluated in
18 plant-specific SEISs.

20 **4.14.3 Irreversible and Irrecoverable Commitment of Resources**

21
22 Irreversible and irretrievable commitment of resources for electrical power generation would
23 include the commitment of land, water, energy, raw materials, and other natural and manmade
24 resources required for power plant operations during the license renewal term and any
25 refurbishment activities that might be carried out that would not otherwise have taken place if
26 the operating licenses had not been renewed. This section describes the irreversible and
27 irretrievable commitments of resources that have been identified in this GEIS. A commitment of
28 resources is irreversible when primary or secondary impacts limit the future options for a
29 resource. An irretrievable commitment refers to the use or consumption of resources neither
30 renewable nor recoverable for future use. In general, the commitment of capital, energy, labor,
31 and material resources would also be irreversible.

32
33 Resources include materials and equipment required for plant maintenance and operation,
34 energy and water needed to run the plants, the nuclear fuel used by the reactors to generate
35 electricity, and the land required to permanently dispose of the radioactive and nonradioactive
36 wastes. Some of these resources can be retrieved and reused at the end of the license
37 renewal term. For example, some reactor equipment can be used at other reactors or can be
38 decontaminated and released for recycling or restricted or unrestricted use by others.
39 However, some of the equipment and irradiated components that might be replaced during the
40 license renewal term might not be reused or recycled and therefore need to be permanently
41 disposed of. In addition, the fossil fuels used by the plants would be permanently lost. Most of

Environmental Consequences and Mitigating Actions

1 the water used by the plants relying on once-through cooling is returned to the surface water
2 bodies that supply the cooling water. The relatively small portion of the water that evaporates to
3 the air would be lost to the local water bodies and the region but would be returned to the
4 environment as part of the hydrologic cycle, potentially within another watershed. For closed-
5 cycle cooling systems, a much larger percent of the water used for cooling would be lost to
6 evaporation, but that, too, would be returned as part of the hydrologic cycle.

7
8 The most significant irreversible and irretrievable commitment of resources related to nuclear
9 power plant operations during the license renewal term would be the nuclear fuel used to
10 generate electricity and the land used to dispose of wastes, including spent nuclear fuel
11 generated during the license renewal term. The treatment, storage, and disposal of spent
12 nuclear fuel, LLW, hazardous waste, and nonhazardous waste would require the irretrievable
13 commitment of energy and fuel and could result in the irreversible commitment of space in
14 disposal facilities. Some of the land used for the disposal of LLW may be available for other
15 uses in a few hundred years because of the nearly complete decay of short-lived radionuclides
16 in LLW, but most of the land used for the disposal of spent nuclear fuel or some mixed or
17 hazardous wastes could be permanently lost to other users.

18
19 The irreversible and irretrievable commitment of resources would not be the same for all plants
20 and would depend on the specific characteristics of plants and their resource needs. This
21 commitment would need to be evaluated in plant-specific SEISs.

22
23 The implementation of any of the energy alternatives would entail the irreversible and
24 irretrievable commitment of energy, water, chemicals, and, in some cases, fossil fuels. These
25 resources would be committed over the entire life cycle of the power plant from construction,
26 operation, and decommissioning, and would essentially be unrecoverable.

27
28 Energy expended would be in the form of fuel for equipment, vehicles, and power plant
29 operations and electricity for power plant construction and facility operations. Electricity and
30 fuels would be purchased from offsite commercial sources. Water would be obtained from
31 existing water supply systems. These resources are generally available, and the amounts
32 required are not expected to deplete available supplies or exceed available system capacities.

33
34 The irreversible and irretrievable commitment of material resources are the materials that
35 cannot be recovered or recycled, materials that are rendered radioactive and/or cannot be
36 decontaminated, and materials consumed or reduced to unrecoverable forms of waste.
37 However, none of the resources used by these alternative power generating facilities is in short
38 supply, and, for the most part, readily available.

Environmental Consequences and Mitigating Actions

1 Various materials and chemicals, including acids and caustics, would be required to support
2 operations activities. These materials would be derived from commercial vendors, and their
3 consumption is not expected to affect local, regional, or national supplies.
4
5

6 **4.15 References**

7
8 10 CFR Part 20. *Code of Federal Regulations*, Title 10, *Energy*, Part 20, “Standards for
9 Protection Against Radiation.”

10
11 10 CFR Part 50. *Code of Federal Regulations*, Title 10, *Energy*, Part 50, “Domestic Licensing of
12 Production and Utilization Facilities.”

13
14 10 CFR Part 51. *Code of Federal Regulations*, Title 10, *Energy*, Part 51, “Environmental
15 Protection Regulations for Domestic Licensing and Related Regulatory Functions.”

16
17 10 CFR Part 52. *Code of Federal Regulations*, Title 10, *Energy*, Part 52, “Early Site Permits;
18 Standard Design Certifications; and Combined Licenses for Nuclear Power Plants.”

19
20 10 CFR Part 54. *Code of Federal Regulations*, Title 10, *Energy*, Part 54, “Requirements for
21 Renewal of Operating Licenses for Nuclear Power Plants.”

22
23 10 CFR Part 63. *Code of Federal Regulations*, Title 10, *Energy*, Part 63, “Disposal of High-
24 Level Radioactive Wastes in a Geologic Repository at Yucca Mountain, Nevada.”

25
26 10 CFR Part 72. *Code of Federal Regulations*, Title 10, *Energy*, Part 72, “Licensing
27 Requirements for the Independent Storage of Spent Nuclear Fuel, High-Level Radioactive
28 Waste, and Reactor-Related Greater Than Class C Waste.”

29
30 40 CFR Part 125. *Code of Federal Regulations*, Title 40, *Protection of the Environment*,
31 Part 125, “Criteria and Standards for the National Pollutant Discharge Elimination System.”

32
33 40 CFR Part 190. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 190,
34 “Environmental Radiation Protection Standards for Nuclear Power Operations.”

35
36 40 CFR Part 191. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 191,
37 “Environmental Radiation Protection Standards for Management and Disposal of Spent Nuclear
38 Fuel, High-Level and Transuranic Radioactive Waste.”
39

Environmental Consequences and Mitigating Actions

- 1 40 CFR Part 197. *Code of Federal Regulations*, Title 40, *Protection of Environment*, Part 197,
2 “Public Health and Environmental Radiation Protection Standards for Management and
3 Disposal for Yucca Mountain, Nevada.”
4
- 5 40 CFR Part 1508. *Code of Federal Regulations*, Title 40, *Protection of the Environment*,
6 Part 1508, “Terminology and Index.”
7
- 8 Able, K.P. 1973. “The Changing Seasons.” *American Birds* 27:19–23.
9
- 10 Ahier, B.A., and B.L. Tracy. 1995. “Radionuclides in the Great Lake Basin.” *Environmental*
11 *Health Perspectives* 103:89–101.
12
- 13 Aldrich, T.E., and C.E. Easterly. 1987. “Electromagnetic Fields and Public Health.”
14 *Environmental Health Perspectives* 75:159–171.
15
- 16 Algers, B., and J. Hultgren. 1987. “Effects of Long-Term Exposure to a 400-kV, 50-Hz
17 Transmission Line on Estrous and Fertility in Cows.” *Preventive Veterinary Medicine* 5:21–36.
18
- 19 Allen, E., D. Bucaneg, N. Davis, J. Diamond, M. Layton, J. Klein, N. Nelson, M. Trask,
20 D. Vidaver, and R. York. 2004. *Resource, Reliability and Environmental Concerns of Aging*
21 *Power Plant Operations and Retirements*. Draft Staff White Paper 100-04-005D, California
22 Energy Commission, Sacramento, California. (August). Available URL: http://www.energy.ca.gov/2004_policy_update/documents/2004-08-26_workshop/2004-08-04_100-04-005D.pdf
23 (Accessed December 14, 2007).
24
25
- 26 Alverson, W.S., D.M. Waller, and S.L. Solheim. 1988. “Forests to Deer: Edge Effects in
27 Northern Wisconsin.” *Conservation Biology* 2:348–358.
28
- 29 Amstutz, H.E., and D.B. Miller. 1980. “A Study of Farm Animals near 765-kV Transmission
30 Lines.” *Bovine Practitioner* 15:51–62.
31
- 32 Atomic Energy Act of 1954, as amended. 42 USC 2011 et seq.
33
- 34 Bamber, R.N., and R.M.H. Seaby. 2004. “The Effects of Power Station Entrainment Passage
35 on Three Species of Marine Planktonic Crustacean, *Acartia tonsa* (Copepoda), *Crangon*
36 *crangon* (Decapoda) and *Homarus gammarus* (Decapoda).” *Marine Environmental Research*
37 57:281–294.
38
- 39 Bankoske, J.W., et al. 1976. “The Effects of High-Voltage Electric Fields on the Growth and
40 Development of Plants and Animals.” Pp. 112–23 in R. E. Tillman, ed., *Proceedings of the First*
41
42

Environmental Consequences and Mitigating Actions

- 1 *National Symposium on Environmental Concerns in Rights-of-Way Management, January 6–8,*
2 *1976.* Mississippi State University, Mississippi State, Mississippi.
3
- 4 Banks, R.C. 1979. *Human Related Mortality of Birds in the United States.* U.S. Fish and
5 Wildlife Service Special Scientific Report 215, pp. 1–16.
6
- 7 Barkley, S.W., and C. Perrin. 1971. "The Effects of the Lake Catherine Steam Electric Plant
8 Effluent on the Distribution of Fishes in the Receiving Embayment." Pages 384–92 in
9 *Proceedings of the Twenty-Fifth Annual Conference of the Southeastern Association of Game*
10 *and Fish Commissioners,* Columbia, South Carolina.
11
- 12 Beitinger, T.L., W.A. Bennett, and R.W. McCauley. 2000. "Temperature Tolerances of North
13 American Freshwater Fishes Exposed to Dynamic Changes in Temperature." *Environmental*
14 *Biology of Fishes* 58:237–275.
15
- 16 Bell, J.N.B., M.J. Minski, and H.A. Grogan. 1988. "Plant Uptake of Radionuclides." *Soil Use*
17 *and Management* 4(3):76–84.
18
- 19 Beresford, N.A., S.M. Wright, C.L. Barnett, M.D. Wood, S. Gaschak, A. Arkhipov,
20 T.G. Sazykina, and B.J. Howard. 2005. "Predicting Radionuclide Transfer to Wild Animals: An
21 Application of a Proposed Environmental Assessment Framework to the Chernobyl Exclusion
22 Zone." *Radiation and Environmental Biophysics* 44:161–168.
23
- 24 Bevanger, K. 1988. "Biological and Conservation Aspects of Bird Mortality Caused by
25 Electricity Power Lines: A Review." *Biological Conservation*, Vol. 86, pp. 67–76.
26
- 27 Blaylock, B.G., M.L. Frank, and B.R. O'Neal. 1993. *Methodology for Estimating Radiation Dose*
28 *Rates to Freshwater Biota Exposed to Radionuclides in the Environment.* ES/ER/TM-78, Oak
29 Ridge National Laboratory, Tennessee. (September).
30
- 31 Bindokas, V. P., et al. 1988. "Mechanisms of Biological Effects Observed in Honey Bees
32 (*Apis mellifera*, L.) Hived Under Extra-High-Voltage Transmission Lines: Implications Derived
33 from Bee Exposure to Simulated Intense Electric Fields and Shocks." *Bioelectromagnetics*, 9(3),
34 285–301.
35
- 36 Blue, R. 1996. "Documentation of Raptor Nests on Electric Utility Facilities Through a Mail
37 Survey." Pages 87–95 in D.M. Bird, D.E. Varland, and J.J. Negro (eds.). *Raptors in Human*
38 *Landscapes: Adaptations to Built and Cultivated Environments.* Academic Press, Inc.,
39 San Diego, California.
40
41

Environmental Consequences and Mitigating Actions

- 1 Bodensteiner, L.R., and W.M. Lewis. 1992. "Role of Temperature, Dissolved Oxygen, and
2 Backwaters in the Winter Survival of Freshwater Drum (*Aplodinotus grunniens*) in the
3 Mississippi River." *Canadian Journal of Fisheries and Aquatic Sciences* 49:173–184.
4
- 5 Bodensteiner, L.R., and W.M. Lewis. 1994. "Downstream Drift of Fishes in the Upper
6 Mississippi River During Winter." *Journal of Freshwater Ecology* 9(1):45–56.
7
- 8 Bonneville Power Administration (BPA). 2000. *Transmission System Vegetation Management*
9 *Program Final Environmental Impact Statement*. DOE/EIS-0285, U.S. Department of Energy,
10 Portland, Oregon, May.
11
- 12 Boorman, G.A., C.N. Rafferty, J.M. Ward, and R.C. Sills. 2000. "Leukemia and Lymphoma
13 Incidence in Rodents Exposed to Low-Frequency Magnetic Fields." *Radiation Research*
14 153:627–636.
15
- 16 Bracken, T.C., and A.L. Gabriel. 1981. *Lyons Ozone Instrumentation Program and Data*
17 *Analysis*. Laboratory Report No. EL-81-3, Bonneville Power Administration, Portland, Oregon.
18
- 19 Bramble, W.C., R.H. Yahner, and W.R. Byrnes. 1999. "Effect of Herbicide Maintenance of an
20 Electric Transmission Line Right-of-Way on Butterfly Populations." *Journal of Arboriculture*
21 25:302–310.
22
- 23 Brown, J., S.R. Jones, R. Saxén, H. Thørring, and J. Vives I Batlle. 2004. "Radiation Doses to
24 Aquatic Organisms from Natural Radionuclides." *Journal of Radiological Protection*
25 24:A63–A77.
26
- 27 Byus, C.V., S.E. Pieper, and W.R. Adey. 1987. "The Effects of Low-Energy 60-Hz
28 Environmental Electromagnetic Field upon the Growth-Related Enzyme Ornithine
29 Decarboxylase." *Carcinogenesis* 8:1385–1389.
30
- 31 Cada, G.F. et al. 1981. *Effects of Sublethal Entrainment Stresses on the Vulnerability of*
32 *Juvenile Bluegill Sunfish to Predation*. ORNL/TM-7801, Oak Ridge National Laboratory, Oak
33 Ridge, Tennessee.
34
- 35 Cahill, D.F., J.F. Wright, J.H. Godbold, J.M. Ward, J.W. Laskey, and E.A. Tompkins. 1975.
36 "Neoplastic and Life-Span Effects of Chronic Exposure to Tritium. 1. Effects on Adult Rats
37 Exposed During Pregnancy. *Journal of the National Cancer Institute* 55:371–374.
38
- 39 Cairns, J., Jr. 1990. "Lack of Theoretical Basis for Predicting Rate and Pathways of Recovery."
40 *Environmental Management* 14:517–526.
41

Environmental Consequences and Mitigating Actions

- 1 California Department of Health Services (CADHS). 2002. *An Evaluation of the Possible Risks*
2 *from Electric and Magnetic Field (EMF) from Power Lines, Internal Wiring, Electrical*
3 *Occupations and Appliances*. California EMF Program. Available URL: [www.dhs.ca.gov/ehib/](http://www.dhs.ca.gov/ehib/emf/RiskEvaluation/riskeval.html)
4 [emf/RiskEvaluation/riskeval.html](http://www.dhs.ca.gov/ehib/emf/RiskEvaluation/riskeval.html) (Accessed September 19, 2007).
5
- 6 Canfield, J.E. 1988. *Impact Mitigation and Monitoring of the BPA 500-kV Garrison-Taft*
7 *Transmission Line – Effects on Elk Security and Hunter Opportunity: Final Report prepared for*
8 *Bonneville Power Administration, DOE/BP-1136, Montana Department of Fish, Wildlife and*
9 *Parks, Helena, Montana.*
10
- 11 Carlton, B.D., P. Barlett, A. Basaran, K. Colling, I. Osis, and M.K. Smith. 1986. “Reproductive
12 Effects of Alternative Disinfectants.” *Environmental Health Perspectives* 69: 237–241.
13
- 14 Carpenter, E.J., B.B. Peck, and S.J. Anderson. 1974. “Survival of Copepods Passing through a
15 Nuclear Power Station on Northeastern Long Island Sound, USA.” *Marine Biology* 24:49–55.
16
- 17 Clean Air Act of 1970, as amended. 42 USC 7401 et seq.
18
- 19 Clean Water Act (CWA). 33 USC 1251 et seq.
20
- 21 Coastal Zone Management Act of 1972 (CZMA), as amended. 16 USC 1451, et seq.
22
- 23 Constellation Energy Group (CEG). 2003. *Annual Radiological Environmental Operating*
24 *Report for the Calvert Cliffs Nuclear Power Plant Units 1 and 2 and the Independent Spent Fuel*
25 *Storage Installation*. Lusby, Maryland.
26
- 27 Constellation Energy Group (CEG). 2004. *Nine Mile Point Nuclear Station Units 1 and 2 2004*
28 *Annual Radiological Environmental Operating Report*. Docket Nos. 50-220, 50-410. Lycoming,
29 New York.
30
- 31 Consumers Energy Company and Nuclear Management Company, LLC. 2001. *Palisades*
32 *Nuclear Plant Biological Assessment of the 1999 Cooling Water Flow Increase at the Palisades*
33 *Plant, near South Haven, Michigan*. Consumers Energy Company, Jackson, Michigan, and
34 Nuclear Management Company, LLC, Covert, Michigan. (May).
35
- 36 Council on Environmental Quality (CEQ). 1997. *Considering Cumulative Effects Under the*
37 *National Environmental Policy Act*. (January).
38
- 39 Coutant, C.C. 1981. *A Critical Review of Aquatic Ecological Effects of Power Plant Cooling*.
40 U.S. Department of Energy, Office of Health and Environmental Research, Washington, D.C.
41

Environmental Consequences and Mitigating Actions

- 1 Coutant, C.C. 1987. "Thermal Preference: When Does an Asset Become a Liability?"
2 *Environmental Biology of Fishes* 18(3):161–72.
3
- 4 Crawford, R.L., and R.T. Engstrom. 2001. Characteristics of Avian Mortality at a North Florida
5 Television Tower: A 29-Year Study. *Journal of Field Ornithology* 72:380–388.
6
- 7 Crooks, K.R. 2002. "Relative Sensitivities of Mammalian Carnivores to Habitat Fragmentation."
8 *Conservation Biology* 16:488–502.
9
- 10 Crooks, K.R., and M.E. Soulé. 1999. "Mesopredator Release and Avifaunal Extinctions in a
11 Fragmented System." *Nature* 400:563–566.
12
- 13 Diaz, R.J. 1994. "Response of Tidal Freshwater Macrobenthos to Sediment Disturbance."
14 *Hydrobiologia* 278:201–212.
15
- 16 Dominion Nuclear Connecticut (DNC). 2004. *Millstone Power Station Units 1, 2, and 3 2004*
17 *Annual Radiological Environmental Operating Report*. Docket Nos. 50-245, 50-336, 50-423.
18 Waterford, Connecticut.
19
- 20 Draper, G., T. Vincent, M.E. Kroll, and J. Swanson. 2005. "Childhood Cancer in Relation to
21 Distance from High Voltage Power Lines in England and Wales: A Case-Control Study."
22 *BMJ* Vol. 330. (June 4). Available URL: <http://bmj.com/cgi/content/full/330/7503/1290>.
23 (Accessed September 2007).
24
- 25 Dunning, D.J., Q.E. Ross, P. Geoghegan, J.J. Reichle, J.K. Menezes, and J.K. Watson. 1992.
26 "Alewives Avoid High-Frequency Sound." *North American Journal of Fisheries Management*
27 12:407–416.
28
- 29 Easterly, C.E. 1981. "Cancer Link to Magnetic Fields: A Hypothesis." *American Journal of*
30 *Epidemiology* 114(2):169–173.
31
- 32 Eisler, R. 1994. *Radiation Hazards to Fish, Wildlife, and Invertebrates: A Syntopic Review*.
33 Biological Report 26. U.S. Department of the Interior, National Biological Service, Washington,
34 D.C.
35
- 36 Endangered Species Act of 1973 (ESA). 16 USC 1531–1544.
37
- 38 Energy Northwest. 2005. *Columbia Generating Station 2005 Annual Radiological*
39 *Environmental Operating Report*. Richland, Virginia.
40
- 41 Energy Policy Act of 2005. P.L. 109-058, August 8, 2005.
42

Environmental Consequences and Mitigating Actions

- 1 Entergy. 2003. *Vermont Yankee Nuclear Power Station 2003 Annual Radiological*
2 *Environmental Operating Report*. Docket No. 50-271. Brattleboro, Vermont.
3
- 4 Entergy. 2006a. *Arkansas Nuclear One – Units 1 and 2 Annual Radiological Environmental*
5 *Operating Report for 2006*. Russellville, Arkansas.
6
- 7 Entergy. 2006b. *Indian Point Nuclear Power Plants Units 1, 2, and 3 Annual Radiological*
8 *Environmental Operating Report for 2006*. Docket Nos. 50-3, 50-247, 50-286. Buchanan,
9 New York.
10
- 11 Environmental Incorporated Midwest Laboratory (EIML). 2005. *Radiological Environmental*
12 *Monitoring Program (REMP) for the Point Beach Nuclear Power Plant*. Project No. 8006, Two
13 Rivers, Wisconsin.
14
- 15 Erickson, W.P., G.D. Johnson, M.D. Strickland, K.J. Sernka, and R.E. Good. 2001. *Avian*
16 *Collisions with Wind Turbines: A Summary of Existing Studies and Comparisons to Other*
17 *Sources of Avian Collision Mortality in the United States*. National Wind Coordinating
18 Committee Resource Document, Western EcoSystems Technology, Inc., Cheyenne, Wyoming.
19 (August).
20
- 21 European Committee on Radiation Risk (ECRR). 2003. *Recommendations of the European*
22 *Committee on Radiation Risk, Health Effects of Ionising Radiation Exposure at Low Doses for*
23 *Radiation Protection Purposes*. Brussels, Belgium.
24
- 25 Evans, D.R., and J.E. Gates. 1997. “Cowbird Selection of Breeding Areas: The Role of Habitat
26 and Bird Species Abundance.” *Wilson Bulletin* 109:470–480.
27
- 28 Evans, M.S., G.J. Warren, and D.I. Page. 1986. “The Effects of Power Plant Passage on
29 Zooplankton Mortalities: Eight Years of Study at the Donald C. Cook Nuclear Plant.” *Water*
30 *Research* 20(6):725–734.
31
- 32 Exelon Generating Company, LLC (Exelon). 2003. *Applicant’s Environmental Report –*
33 *Operating License Renewal Stage, Dresden Nuclear Power Station, Units 2 and 3*. Docket Nos.
34 50-237 and 50-249, Warrenville, Illinois. (January).
35
- 36 Exelon Generation Company, LLC (Exelon). 2001. *Applicant’s Environmental Report –*
37 *Operating License Renewal Stage Peach Bottom Units 2 and 3*. Kennett Square,
38 Pennsylvania.
39
40
41
42

Environmental Consequences and Mitigating Actions

- 1 Fairbanks, R.B., and R.P. Lawton. 1977. "Occurrence of Large Striped Mullet, *Mugil cephalus*, in
2 Cape Cod Bay, Massachusetts." *Chesapeake Science* 18:309–310.
3
- 4 Federal Communications Commission (FCC). 2003. "Effects of Communication Towers on
5 Migratory Birds." *Federal Register* 68:53696–53702.
6
- 7 Federal Insecticide, Fungicide, and Rodenticide Act, as amended (FIFRA). 7 USC 135 et seq.
8
- 9 Florida Power & Light Company (FPL). 2000. *Applicant's Environmental Report – Operating
10 License Renewal Stage Turkey Point Units 3 and 4*. Miami, Florida.
11
- 12 Fox, J.L., and M.S. Moyer. 1973. "Some Effects of a Power Plant on Marine Microbiota."
13 *Chesapeake Science* 14(1):1–10.
14
- 15 Gibbs, J.P. 1998. "Distribution of Woodland Amphibians Along a Forest Fragmentation
16 Gradient." *Landscape Ecology* 13:263–268.
- 17 Gilmer, D.S., and R.E. Stewart. 1983. "Ferruginous Hawk Populations and Habitat Use in
18 North Dakota." *Journal of Wildlife Management* 47:146–57.
19
- 20 Goodman, R., and A.S. Henderson. 1986. "Sine Waves Enhance Cellular Transcription."
21 *Bioelectromagnetics* 7(1):23–29.
22
- 23 Goodman, R., and A.S. Henderson. 1988. "Exposure of Salivary Gland Cells to Low-
24 Frequency Electromagnetic Fields Alters Polypeptide Synthesis." *Proceedings of the National
25 Academy Science* 85:3928–3932.
26
- 27 Goodman, R., J. Abbott, and A.S. Henderson. 1987. "Transcriptional Patterns in the
28 X Chromosome of *Sciara coprophilia* Following Exposure to Magnetic Fields."
29 *Bioelectromagnetics* 8(1):1–7.
30
- 31 Gray, R.H., T.L. Page, and M.G. Saroglia. 1983. "Behavioral Response of Carp, *Cyprinus
32 carpio*, and Black Bullhead, *Ictalurus melas*, from Italy to Gas Supersaturated Water."
33 *Environmental Biology of Fishes* 8:163–167.
34
- 35 Greenberg, B. et al. 1985. *Extra-High Voltage Transmission Lines: Mechanisms of Biological
36 Effects on Honeybees*. EPRI EA-4218, Electric Power Research Institute, Palo Alto, California.
37
- 38 Guerra-García, J.M., J. Corzo, and J. García-Gomez. 2003. "Short-Term Benthic
39 Recolonization after Dredging in the Harbour of Ceuta, North Africa." *Marine Ecology
40* 24:217–229.
41

Environmental Consequences and Mitigating Actions

- 1 Gunter, L., P. Gunter, S. Cullen, and N. Burton. 2001. *Licensed to Kill: How the Nuclear Power*
2 *Industry Destroys Endangered Marine Wildlife and Ocean Habitat to Save Money*. Prepared by
3 Safe Energy Communication Council, Washington, D.C.; Nuclear Information and Resource
4 Service, Washington, D.C.; Standing for Truth About Radiation, East Hampton, New York; and
5 Humane Society of the United States, Washington, D.C.
6
- 7 Hall, C.A.S., R. Howarth, B. Moore, III, and C.J. Vorosmarty. 1978. "Environmental Impacts of
8 Industrial Energy Systems in the Coastal Zone," *Annual Review of Energy* 3:395-475.
9
- 10 Hallenbeck, W.H., and G.R. Brenniman. 1989. "Risk of Fatal Amoebic Meningoencephalitis
11 from Waterborne *Naegleria fowleri*." *Environmental Management* 13(2):227-232.
12
- 13 Harness, R.E., and K.R. Wilson. 2001. Electric-Utility Structures Associated with Raptor
14 Electrocutations in Rural Areas." *Wildlife Society Bulletin* 29:612-623.
15
- 16 Harrison, F.L. 1985. "Effect of Physiochemical Form on Copper Availability to Aquatic
17 Organisms." In R.D. Cardwell et al., eds., *Seventh Symposium on Aquatic Toxicology and*
18 *Hazard Assessment*. ASTM STP 854. American Society for Testing and Materials,
19 Philadelphia, Pennsylvania.
20
- 21 Harvard Center for Cancer Prevention (HCCP). 2007. *Electromagnetic Fields*. Available URL:
22 http://www.hsph.harvard.edu/cancer/resources_materials/reports/HCCPreport_1electro.htm
23 (Accessed October 10, 2007).
24
- 25 Haynes, J.M., and J.C. Makarewicz. 1982. "Comparison of Benthic Communities in Dredged
26 and Undredged Areas of the St. Lawrence River, Cape Vincent, N.Y." *Ohio Journal of Science*
27 82:165-170.
28
- 29 Henderson, P.A. and R.M.H. Seaby. 2000. *Technical Evaluation of U.S. Environmental*
30 *Protection Agency Proposed Cooling Water Intake Regulations for New Facilities*. Pisces
31 Conservation Ltd., Lymington, England.
32
- 33 Henderson, P.A., R.M.H. Seaby, and J.R. Somes. 2003. *A Comparison of Ecological Impacts*
34 *of Power Plant Once-through, Evaporative and Dry Cooling Systems on Fish Impingement and*
35 *Entrainment*. Pisces Conservation Ltd., Lymington, England. (May). Available URL:
36 http://www.riverkeeper.org/document.php/135/Appendix_B_Pis.pdf (Accessed November 27,
37 2007).
38
39
40

- 1 Hinton, T.G., M. McDonald, Y. Ivanov, N. Arkhipov, and A. Arkhipov. 1996. "Foliar Absorption
2 of Resuspended ¹³⁷Cs Relative to Other Pathways of Plant Contamination." *Journal of*
3 *Environmental Radioactivity* 30(4):15–30.
4
- 5 Hinton, T.G., C.M. Bell, F.W. Whicker, and T. Philippi. 1999. "Temporal Changes and Factors
6 Influencing ¹³⁷Cs Concentration in Vegetation Colonizing an Exposed Lake Bed over a Three-
7 Year Period." *Journal of Environmental Radioactivity* 44:1–19.
8
- 9 Hitchcock, D.R., C.D. Barton, K.T. Rebel, J. Singer, J.C. Seaman, J.D. Strawbridge, S.J. Riha,
10 and J.I. Blake. 2005. "A Containment and Disposition Strategy for Tritium-Contaminated
11 Groundwater at the Savannah River Site, South Carolina, United States." *Environmental*
12 *Geosciences* 12(1):17–28.
13
- 14 Indiana Michigan Power (IMP). 2006. *Donald C. Cook Nuclear Plant Units 1 and 2 Annual*
15 *Radiological Environmental Operating Report for 2006*. Docket Nos. 50-315, 50-316.
16 Bridgman, Michigan.
17
- 18 Institute of Electrical and Electronic Engineers, Inc. (IEEE). 2007. *National Electrical Safety*
19 *Code*. New York, New York.
20
- 21 International Agency for Research on Cancer. (IARC). 2002. "Non-Ionizing Radiation, Part 1:
22 Static and Extremely Low Frequency (ELF) Electric and Magnetic Field." *IARC Monographs on*
23 *the Evaluation of Carcinogenic Risks to Humans* 80:1–429.
24
- 25 International Atomic Energy Agency (IAEA). 1992. *Effects of Ionizing Radiation on Plants and*
26 *Animals at Levels Implied by Current Radiation Protection Standards*. Technical Report
27 No. 332. Vienna, Austria.
28
- 29 International Radiation Protection Association/International Non-Ionizing Radiation Commission
30 (IRPA/INIRC). 1990. "Interim Guidelines on Limits of Exposure to 50/60 Hz Electric and
31 Magnetic Fields." *Health Physics* 58(1):113–1122.
32
- 33 Janes, D.E. 1980. *Evaluation of Health and Environmental Effects of Extra-High-Voltage (EHV)*
34 *Transmission*. U.S. Environmental Protection Agency, Office of Radiation Programs.
35
- 36 Janss, G.F.E. 2000. "Avian Mortality from Power Lines: A Morphological Approach of Species-
37 Specific Mortality." *Biological Conservation* 95:353–359.
38

Environmental Consequences and Mitigating Actions

- 1 Jinks, S. 2005. *A Review of Impingement Survival Studies at Steam-Electric Power Stations*.
2 Pages 219–241 in EPA 625-C-05-002, Proceedings Report Symposium on Cooling Water
3 Intake Technologies to Protect Aquatic Organisms, Hilton Crystal City at National Airport,
4 Arlington, Virginia, May 6-76, 2003, Available URL: [http://www.epa.gov/waterscience/316b/
5 meetings/symposium/proceedings.pdf](http://www.epa.gov/waterscience/316b/meetings/symposium/proceedings.pdf) (Accessed August 8, 2007).
6
- 7 Johnson, W.C., R.K. Schreiber, and R.L. Burgess. 1979. "Diversity of Small Mammals in a
8 Powerline Right-of-Way and Adjacent Forest in East Tennessee." *American Midland Naturalist*
9 101:231–235.
- 10
11 Joint Resolution Approving the Site at Yucca Mountain, Nevada, for the Development of a
12 Repository for the Disposal of High-Level Radioactive Waste and Spent Nuclear Fuel, pursuant
13 to the Nuclear Waste Policy Act of 1982. 2002. Public Law 107-200. 116 Stat. 735.
14
- 15 Kaplan, D.I., T.G. Hinton, and A.S. Knox. 2005. "Cesium-137 Partitioning to Wetland
16 Sediments and Uptake by Plants." *Journal of Radioanalytical and Nuclear Chemistry*
17 264(2):393–399.
18
- 19 Kaplan, E.H., J.R. Welker, M.G. Kraus, and S. McCourt. 1975. "Some Factors Affecting the
20 Colonization of a Dredged Channel." *Marine Biology* 32:193–204.
21
- 22 Kelsey-Wall, A., J.C. Seaman, C.H. Jagoe, C.E. Dallas, K.F. Gaines. 2005. "Rodents as
23 Receptor Species at a Tritium Disposal Site." *Journal of Environmental Radioactivity*
24 82:95–104.
25
- 26 Kelso, J.R., and G.S. Milburn. 1979. "Entrainment and Impingement of Fish by Power Plants in
27 the Great Lakes Which Use the Once-Through Cooling Process." *Journal of Great Lakes*
28 *Research* 5(2):182–194.
29
- 30 Kemper, C. 1996. "A Study of Bird Mortality at a West Central Wisconsin TV Tower from
31 1957–1995." *The Passenger Pigeon* 58:219–235.
32
- 33 Kennish, M.J. et al. 1984. "Anthropogenic Effects on Aquatic Communities." Pages 318–38 in
34 M.J. Kennish and R.A. Lutz, eds., *Ecology of Barnegat Bay, New Jersey*, Springer-Verlag, New
35 York.
36
- 37 Kheifets, L., M. Repacholi, R. Saunders, and E. van Deventer. 2005. "The Sensitivity of
38 Children to Electromagnetic Fields." *Pediatrics* 116(2). (August). Available URL:
39 www.pediatrics.org (Accessed September 20, 2007).
40
41

Environmental Consequences and Mitigating Actions

- 1 King, D.I., and B.E. Byers. 2002. "An Evaluation of Powerline Rights-of-Way as Habitat for
2 Early Successional Shrubland Birds." *Wildlife Society Bulletin* 30:868–874.
3
- 4 Klem, D., Jr. 1990. "Bird Injuries, Cause of Death, and Recuperation from Collisions with
5 Windows." *Journal of Field Ornithology* 61:115–119.
6
- 7 Kroodsma, R.L. 1984. "Effects of Power-Line Corridors on the Density and Diversity of Bird
8 Communities in Forested Areas." Pages 551–61 in A.F. Crabtree, ed., *Proceedings of the*
9 *Third International Symposium on Environmental Concerns in Rights-of-Way Management,*
10 *San Diego, California, February 15–18, 1982.* Mississippi State University, Mississippi State,
11 Mississippi.
12
- 13 Kroodsma, R.L. 1987. "Edge Effect on Breeding Birds Along Power-Line Corridors in East
14 Tennessee." *American Midland Naturalist* 118:275–83.
15
- 16 Kryshev, I.I., and T.G. Sazykina. 1998. "Radioecological Effects on Aquatic Organisms in the
17 Areas with High Levels of Radioactive Contamination: Environmental Protection Criteria."
18 *Radiation Protection Dosimetry* 75:187–191.
19
- 20 Laist, D.W., and J.E. Reynolds, III. 2005. "Influence of Power Plants and Other Warm-Water
21 Refuges on Florida Manatees." *Marine Mammal Science* 21(4):739–764.
22
- 23 LaJeone, L.J., and R.G. Monzingo. 2000. "316(b) and Quad Cities Station, Commonwealth
24 Edison Company." *Environmental Science & Policy* 3:S313–S322.
25
- 26 Langford, T.E. 1975. "The Emergence of Insect from a British River, Warmed by Power Station
27 Cooling-Water. Part II The Emergence Patterns of Some Species of *Ephemeroptera,*
28 *Trichoptera* and *Megaloptera* in Relation to Water Temperature and River Flow, Upstream and
29 Downstream of the Cooling-Water Outfalls." *Hydrobiologia* 47(1):91–133.
30
- 31 Langford, T.E. 1983. *Electricity Generation and the Ecology of Natural Waters.* Liverpool
32 University Press, Liverpool, England.
33
- 34 Larkin, R.P., and B.A. Frase. 1988. "Circular Paths of Birds Flying near a Broadcasting Tower
35 in Cloud." *Journal of Comparative Physiology* 102:90–93.
36
- 37 Lee, G.F., and P.H. Martin. 1975. "Dissolved Gas Supersaturation and Dilution in Thermal
38 Plumes from Steam Electric Generating Stations." *Water Research* 9:643–648.
39
- 40 Lee, J.M., Jr. 1980. "Raptors and the BPA Transmission System." Pages 41–55 in
41 R.P. Howard and J.F. Gore, eds., *Proceedings of the Workshop on Raptors and Energy*

Environmental Consequences and Mitigating Actions

- 1 *Developments, Boise, Idaho, January 25–26, 1980.* Bonneville Power Administration, U.S. Fish
2 and Wildlife Service, Idaho Power Company, and the Idaho Chapter of the Wildlife Society.
3
- 4 Lee, J.M., Jr., V.L. Chartier, D.P. Hartmann, G.E. Lee, K.S. Pierce, F.L. Shon, R.D. Stearns,
5 and M.T. Zeckmeister. 1989. *Electrical and Biological Effects of Transmission Lines: A Review*,
6 DOE/BP-945, U.S. Department of Energy, Bonneville Power Administration, Portland, Oregon
7 (June).
8
- 9 Lieberman, J.T., and P.H. Muessio. 1978. “Evaluation of an Air Bubbler to Mitigate Fish
10 Impingement at an Electric Generating Plant.” *Estuaries* 1(2):129–132.
11
- 12 Maes, J., A.W.H. Turnpenny, D.R. Lambert, J.R. Nedwell, A. Parmentier, and F. Ollevier. 2004.
13 “Field Evaluation of a Sound System to reduce Estuarine Fish Intake Rates at a Power Plant
14 Cooling Water Inlet.” *Journal of Fish Biology* 64:938–946.
15
- 16 Magnuson-Stevens Fishery Conservation and Management Act of 1976 (FCMA). 16 USC
17 1801, et seq.
18
- 19 Manville, A.M., II. 2005. “Bird Strikes and Electrocutions at Power Lines, Communication
20 Towers, and Wind Turbines: State of the Art and State of the Science – Next Steps Toward
21 Mitigation, Bird Conservation Implementation in the Americas.” Pages 1051–1064 in C.J. Ralph
22 and T.D. Rich, eds., *Proceedings of the 3rd International Partners in Flight Conference 2002*.
23 USDA Forest Service General Technical Report PSW-GTR-191, Pacific Southwest Research
24 Station, Albany, California.
25
- 26 Marine Mammal Protection Act of 1972 (MMPA) 16 USC 1361 et seq.
27
- 28 Marino, A.A., et al. 1983. “Weak Electric Fields Affect Plant Development.” *IEEE Transactions*
29 *on Biomedical Engineering* BME30(12): 833–34.
30
- 31 Marshall, J.S., and L.W. Vandruff. 2002. “Impact of Selective Herbicide Right-of-Way
32 Vegetation Treatment on Birds.” *Environmental Management* 30(6): 801–806.
33
- 34 McCormick, S.D., R.A. Cunjak, B. Dempson, M.F. O’Dea, and J.B. Carey. 1999.
35 “Temperature-Related Loss of Smolt Characteristics in Atlantic Salmon (*Salmo salar*) in the
36 Wild.” *Canadian Journal of Fisheries and Aquatic Sciences* 56:1649–1658.
37
- 38 McInerney, M.C. 1990. “Gas-Bubble Disease in Three Fish Species Inhabiting the Heated
39 Discharge of a Steam-Electric Station Using Hypolimnetic Cooling Water.” *Water, Air, and Soil*
40 *Pollution* 49:7–15.
41

Environmental Consequences and Mitigating Actions

- 1 McLean, R., W.A. Richkus, S.P. Schreiner, and D. Fluke. 2002. "Maryland Power Plant
2 Cooling Water Intake Regulations and Their Application in Evaluation of Adverse Environmental
3 Impact." Maryland Power Plant Research Program PPRP-127. Available URL: [http://esm.
4 vesar.com/PPRP/316/PPRP-127.pdf](http://esm.vesar.com/PPRP/316/PPRP-127.pdf) (Accessed May 10, 2007).
5
- 6 Meyer, S.W., and S.M. Pegula. 2006. *Injuries, Illness, and Fatalities in the Construction
7 Industry, 2004*. U.S. Department of Labor, Bureau of Labor Statistics, Washington, D.C.
8 (May 24). Available URL: [http://www.bls.gov/opub/cwc/print/sh20060519ar01p1.htm
9](http://www.bls.gov/opub/cwc/print/sh20060519ar01p1.htm) (Accessed October 15, 2007).
10
- 11 Meyers-Schone, L., and B.T. Walton. 1990. *Comparison of Two Freshwater Turtle Species as
12 Monitors of Environmental Contamination*. ORNL/TM-11460, Environmental Sciences Division
13 Publication No. 3454, Oak Ridge National Laboratory, Oak Ridge, Tennessee.
14
- 15 Miller, M.W. 1983. "Biological Effects from Exposure to Transmission Line Electromagnetic
16 Fields," *International Right of Way Association* 30(3):8–15.
17
- 18 Mitchell, C.A., and J. Carlson. 1993. "Lesser Scaup Forage on Zebra Mussels at Cook Nuclear
19 Plant, Michigan." *Journal of Field Ornithology* 64:219–222.
20
- 21 Morrow, J.V., and J.C. Fischenich. 2000. *Habitat Requirements for Freshwater Fishes*.
22 EMRRP Technical Notes Collection, ERDC TN-EMRRPSR-06, U.S. Army Corps of Engineers,
23 Engineer Research and Development Center, Vicksburg, Mississippi. (May). Available URL:
24 <http://el.ercd.usace.army.mil/elpubs/pdf/sr06.pdf>. (Accessed November 12, 2007).
25
- 26 Nagasawa, H., J.B. Little, W.C. Inkret, S. Carpenter, K. Thompson, M.R. Raju, D.J. Chen, and
27 G.F. Strniste. 1990. "Cytogenetic Effects of Extremely Low Doses of Plutonium-238 Alpha-
28 particle Irradiation in CHO K-1 Cells." *Mutation Research* 244:233–238.
29
- 30 National Academy of Sciences (NAS). 1995. *Technical Bases for Yucca Mountain Standards*.
31 Washington, D.C.
32
- 33 National Council on Radiation Protection and Measurements (NCRP). 1991. *Effects of Ionizing
34 Radiation on Aquatic Organisms*. NCRP Report No. 109, Bethesda, Maryland. (August).
35
- 36 National Council on Radiation Protection and Measurements (NCRP). 2006. *Cesium-137 in
37 the Environment: Radioecology and Approaches to Assessment and Management,
38 Recommendations of the National Council on Radiation Protection and Measurements*. NCRP
39 Report No. 154, Bethesda, Maryland. (November).
40
41

Environmental Consequences and Mitigating Actions

- 1 National Energy Technology Laboratory (NETL). 2006. *Emerging Issues for Fossil Energy and*
2 *Water*. DOE/NETL-2006/1233, U.S. Department of Energy. (June). Available URL:
3 <http://www.netl.doe.gov/technologies/oil-gas/publications/AP/IssuesforFEandWater.pdf>
4 (Accessed November 15, 2007).
5
- 6 National Energy Technology Laboratory (NETL). 2007. *Cost and Performance Baseline for*
7 *Fossil Energy Plants, Vol. 1, Bituminous Coal and Natural Gas to Electricity*. DOE/NETL
8 2007/1281, Final Report, U.S. Department of Energy, Pittsburgh, Pennsylvania. (May).
9 Available URL: [http://www.netl.doe.gov/energy-analyses/pubs/Bituminous%20Baseline_Final](http://www.netl.doe.gov/energy-analyses/pubs/Bituminous%20Baseline_Final%20Report.pdf)
10 [%20Report.pdf](http://www.netl.doe.gov/energy-analyses/pubs/Bituminous%20Baseline_Final%20Report.pdf).
11
- 12 National Environmental Policy Act of 1969, as amended (NEPA). 42 USC 4321 et seq.
13
- 14 National Historic Preservation Act of 1966, as amended (NHPA). 16 USC 470aa et seq.
15
- 16 National Institute of Environmental Health Sciences (NIEHS). 1999. *NIEHS Report on Health*
17 *Effects from Exposure to Power-Line Frequency Electric and Magnetic Fields*. NIH Publication
18 No. 99-4493, Research Triangle Park, North Carolina.
19
- 20 National Institute of Environmental Health Sciences (NIEHS). 2002. *EMF Electric and*
21 *Magnetic Fields Associated with the Use of Electric Power, Questions & Answers*. EMF RAPID
22 Program Report. (June).
23
- 24 National Marine Fisheries Service (NMFS). 2002. "Small Takes of Marine Mammals Incidental
25 to Specified Activities; Taking of Marine Mammals Incidental to Power Plant Operations."
26 *Federal Register* 67(1):61–62. (January 2).
27
- 28 National Radiological Protection Board (NRPB). 2001. "Electromagnetic Fields and the Risk of
29 Cancer." *Documents of the NRPB* 12(1). Chilton, Didcot, Oxfordshire, England.
30
- 31 National Radiological Protection Board (NRPB). 2004. "Review of the Scientific Evidence for
32 Limiting Exposure to Electromagnetic Field." *Documents of the NRPB* 12(3). Chilton, Didcot,
33 Oxfordshire, England.
34
- 35 National Renewable Energy Laboratory (NREL). 2003. *Highlights of Biopower Technical*
36 *Assessment: State of the Industry and the Technology*. NREL/TP-510-33502, U.S. Department
37 of Energy, Golden, Colorado. (April). Available URL: [http://www.nrel.gov/](http://www.nrel.gov/docs/fy03osti/33502.pdf)
38 [docs/fy03osti/33502.pdf](http://www.nrel.gov/docs/fy03osti/33502.pdf) (Accessed October 18, 2007).
39
- 40 National Research Council. 1990. *Decline of the Sea Turtles Causes and Prevention*. National
41 Academy Press, Washington, D.C.
42

Environmental Consequences and Mitigating Actions

- 1 National Waste Policy Act of 1982 (NWPA). 42 USC 10101 et seq.
2
- 3 Nebeker, A.V. 1971. "Effect of High Winter Water Temperatures on Adult Emergence of
4 Aquatic Insects." *Water Resources* 5:777–783.
5
- 6 Nebeker, A.V., F.D. Baker, and S.L. Weitz. 1981. "Survival and Adult Emergence of Aquatic
7 Insects in Air-Supersaturated Water." *Journal of Freshwater Ecology* 1:243–250.
8
- 9 Nichols, S.R. 1981. "Effect of Thermal Effluents on Oligochaetes in Keowee Reservoir, South
10 Carolina." *Hydrobiologia* 79:129–136.
11
- 12 Nichols, M., R.J. Diaz, and L.C. Schaffner. 1990. "Effects of Hopper Dredging and Sediment
13 Dispersion, Chesapeake Bay." *Environmental Geology and Water Science* 15:31–43.
14
- 15 Niemi, G.J., and J.M. Hanowski. 1984. "Effects of a Transmission Line on Bird Populations in
16 the Red Lake Peatland, Northern Minnesota." *Auk* 101:487–98.
17
- 18 Noga, E.J. 2000. *Fish Disease: Diagnosis and Treatment*. Iowa State University Press, Ames,
19 Iowa, pp. 75–77.
20
- 21 Nonindigenous Aquatic Nuisance Prevention and Control Act. (1990). 16 U.S.C. 4701.
22
- 23 Nuclear Energy Institute (NEI). 2007. *Industry Ground Water Protection Initiative – Final*
24 *Guidance Document*. NEI 07-07 (Final), Washington D.C. (August). Available URL:
25 [http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=07](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=072670589)
26 [2670589](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=072670589) (Accessed November 5, 2007).
27
- 28 Nuclear Management and Resources Council (NUMARC). 1990. *Survey of U.S. Utility-Owned*
29 *Nuclear Power Plants*. Oak Ridge National Laboratory, Oak Ridge, Tennessee, and NUMARC,
30 Washington, D.C. (June).
31
- 32 Nuclear Management Company (NMC). 2004. *Palisades Nuclear Plant 2004 Radiological*
33 *Environmental Operating Report*. Docket No. 50-255, Covert, Michigan.
34
- 35 Office of Energy Efficiency and Renewable Energy (EERE). 1997. *Renewable Energy*
36 *Technology Characterizations*. Topical Report TR-109496, U.S. Department of Energy, Office
37 of Utility Technologies, Washington, D.C. (December). Available URL: [http://www1.eere.](http://www1.eere.energy.gov/ba/pba/tech_characterizations.html)
38 [energy.gov/ba/pba/tech_characterizations.html](http://www1.eere.energy.gov/ba/pba/tech_characterizations.html) (Accessed November 12, 2007).
39
- 40 Office of Technology Assessment (OTA). 1989. *Biological Effects of Power Frequency Electric*
41 *and Magnetic Fields, Background Paper*. OTA-BP-E-53, U.S. Congress, Washington, D.C.
42

Environmental Consequences and Mitigating Actions

- 1
2 Omaha Public Power District (OPPD). 2004. *Fort Calhoun Nuclear Station 2004 Radiological*
3 *Environmental Operating Report*. License No. DPR-40.
4
5 Parametrix, Inc. 1975. *Resource and Literature Review: Dissolved Gas Supersaturation and*
6 *Gas Bubble Disease, 1975*. Report #75-0815-042FR. Submitted by Parametrix, Inc.,
7 Environmental Services Section, Seattle, Washington, to Northwest Utility Cooperative, Boise,
8 Idaho.
9
10 Parkhurst, M.A., L. A. Rathbun, and D.W. Murphy. 1983. *Radiological Assessment of Steam*
11 *Generator Repair and Replacement*. NUREG/CR-3540, U.S. Nuclear Regulatory Commission.
12 (December).
13
14 Parsch, L.D., and M.D. Norman. 1986. "Impact of Powerlines on Crop Yields in Eastern
15 Arkansas." *Arkansas Farm Research*, September–October.
16
17 Paton, P.W. 1994. "The Effect of Edge on Avian Nest Success: How Strong Is the Evidence?"
18 *Conservation Biology* 8:17–26.
19
20 Patrick, R., J. Palms, D. Kreeger, and C. Harris. 2007. "Twenty-Five-Year Study of
21 Radionuclides in the Susquehanna River via Periphyton Biomonitors." *Health Physics*
22 92(1):1–9.
23
24 Petersen, W., E. Willer, and C. Williamowski. 1997. "Remobilization of Trace Elements from
25 Polluted Anoxic Sediments After Resuspension in Oxidic Water." *Water, Air, and Soil Pollution*
26 99:515–522.
27
28 Pinder, J.E. III, T.G. Hinton, and F.W. Whicker. 2006. "Foliar Uptake of Cesium from the Water
29 Column by Aquatic Macrophytes." *Journal of Environmental Radioactivity* 85:23–47.
30
31 Poznaniak, D.T., and T.J. Reed. 1978. "Recent Studies Examining the Biological Effects of
32 UHV Transmission Line Ground Gradients." *Proceedings of the American Power Conference*
33 40:1272–84.
34
35 Ramsdell, Jr., J.V., et al. 2001. *Environmental Effects of Extending Fuel Burnup Above*
36 *60 GWd/MTU*. NUREG/CR-6703, PNNL-13257. Prepared by Pacific Northwest National
37 Laboratory, Richland, Washington, for U.S. Nuclear Regulatory Commission, Office of Nuclear
38 Reactor Regulation, Washington, D.C. (January).
39
40
41

Environmental Consequences and Mitigating Actions

- 1 Real, A., S. Sundell-Bergman, J.F. Knowles, D.S. Woodhead, and I. Zinger. 2004. "Effects of
2 Ionizing Radiation Exposure on Plants, Fish, and Mammals: Relevant Data for Environmental
3 Radiation Protection." *Journal of Radiological Protection* 24:A123–A137.
- 4
- 5 Richards, B.R., et al. 1984. "Shipworms." Pages 201–25 in M.J. Kennish and R.A. Lutz, eds.,
6 *Ecology of Barnegat Bay, New Jersey*, Springer-Verlag, New York.
- 7
- 8 Robinson, S.K., et al. 1995. "Regional Forest Fragmentation and the Nesting Success of
9 Migratory Birds." *Science* 31:1987–1990.
- 10
- 11 Rogers, L., and R. Hinds. 1983. *Environmental Studies for a 1100-kV Power Line in Oregon*.
12 Prepared by Battelle, Pacific Northwest Laboratories, Richland, Washington, for Bonneville
13 Power Administration.
- 14
- 15 Rogers, L.E., et al. 1984. *Environmental Studies of a 1100-kV Prototype Transmission Line—*
16 *Effects on Trees Growing Below the Line, An Annual Report for the 1984 Study Period*.
17 Prepared by Battelle, Pacific Northwest Laboratories, Richland, Washington, for Bonneville
18 Power Administration.
- 19
- 20 Romberg, G.P. et al. 1974. "Fish Behavior at a Thermal Discharge into Lake Michigan." Pages
21 296–312 in J. W. Gibbons and R. R. Sharitz, eds., *Thermal Ecology*, CONF-730505, National
22 Technical Information Service, Springfield, Virginia.
- 23
- 24 Roosenburg, W.H. 1969. "Greening and Copper Accumulation in the American Oyster,
25 *Crassostrea virginica*, in the Vicinity of a Steam Electric Generating Station." *Chesapeake*
26 *Science* 10:41–252.
- 27
- 28 Ross, Q.E., D.J. Dunning, R. Thorne, J.K. Menezes, G.W. Tiller, and J.K. Watson. 1993.
29 "Responses of Alewives to High-frequency Sound at a Power Plant Intake on Lake Ontario."
30 *North American Journal of Fisheries Management* 13:291–303.
- 31
- 32 Ross, Q.E., D.J. Dunning, J.K. Menezes, M.K. Kenna, Jr., and G. Tiller. 1996. "Reducing
33 Impingement of Alewives with High-frequency Sound at a Power Plant Intake on Lake Ontario."
34 *North American Journal of Fisheries Management* 16:548–559.
- 35
- 36 Rothermel, B.B. 2004. "Migratory Success of Juveniles: A Potential Constraint on Connectivity
37 for Pond-Breeding Amphibians." *Ecological Applications* 14:1535–1546.
- 38
- 39 Sackschewsky, M.R. 2004. *Threatened and Endangered Species Evaluation for Operating*
40 *Commercial Nuclear Power Generating Plants*. Office of Nuclear Reactor Regulation,
41 U.S. Nuclear Regulatory Commission, Washington, D.C. (January).
- 42

Environmental Consequences and Mitigating Actions

- 1
2 Sahl, J.D., et al. 2002. "Occupational Magnetic Field Exposure and Cardiovascular Mortality in
3 a Cohort of Electric Utility Workers." *American Journal of Epidemiology* 156:913–918.
4
- 5 Sahr, T., G. Voight, W. Schimmack, H.G. Paretzke, and D. Ernst. 2005. "Low-Level
6 Radiocaesium Exposure Alters Gene Expression in Roots of *Arabidopsis*." *New Phytologist*
7 168:141–148.
8
- 9 Saunders, D.A., R.J. Hobbs, and C.R. Margules. 1991. "Biological Consequences of
10 Ecosystem Fragmentation: A Review." *Conservation Biology* 5:18–32.
11
- 12 Schreiber, R.K., et al. 1976. "Effects of Power Line Rights-of-Way on Small Nongame Mammal
13 Community Structure." Pages 264–73 in R. E. Tillman, ed., *Proceedings of the First National*
14 *Symposium on Environmental Concerns in Rights-of-Way Management, January 6–8, 1976*.
15 Mississippi State University, Mississippi State, Mississippi.
16
- 17 Schubel, J.R., C.F. Smith, and T.S. Koo. 1977. "Thermal Effects of Power Plant Entrainment
18 on Survival of Larval Fishes: A Laboratory Assessment." *Chesapeake Science* 18(3):290–298.
19
- 20 Scott-Walton, B. et al. 1979. *Potential Environmental Effects of 765-kV Transmission Lines:*
21 *Views Before the New York State Public Service Commission, Cases 26529 and 26559, 1976–*
22 *1978*. U.S. Department of Energy, Washington, D.C.
23
- 24 Sergio, F., L. Marchesi, P. Pedrini, M. Ferrer, and V. Penteriani. 2004. "Electrocution Alters the
25 Distribution and Density of a Top Predator, the Eagle Owl *Bubo bubo*." *Journal of Applied*
26 *Ecology* 41:836–845.
27
- 28 Solley, W.B., R.R. Pierce, and H.A. Perlman. 1998. *Estimated Use of Water in the*
29 *United States in 1995*. U.S. Geological Survey Circular 1200. Available URL: [http://onlinepubs.](http://onlinepubs.er.usgs.gov/djvu/CIR/circ_1200.djvu)
30 [er.usgs.gov/djvu/CIR/circ_1200.djvu](http://onlinepubs.er.usgs.gov/djvu/CIR/circ_1200.djvu) (Accessed November 15, 2007).
31
- 32 Southern California Edison (SCE). 2005. *2005 Annual Radiological Environmental Operating*
33 *Report, San Onofre Nuclear Generating Station Units 1, 2, and 3 and Independent Spent Fuel*
34 *Storage Facility*. Docket Nos. 50-206, 50-361, 50-362, San Clemente, California.
35
- 36 Southern Company. 2003. *Edwin I. Hatch Nuclear Plant Annual Radiological Environmental*
37 *Operating Report for 2003*.
38

Environmental Consequences and Mitigating Actions

- 1 State of New York Public Service Commission (SNYPSC). 1978. *Opinion No. 78-13, Opinion*
2 *and Order Determining Health and Safety Issues, Imposing Operating Conditions, and*
3 *Authorizing, in Case 26529, Operation Pursuant to Those Conditions*, Power Authority of the
4 State of New York, Albany, New York.
- 5
- 6 Steenhof, K., et al. 1993. "Nesting by Raptors and Common Ravens on Electrical
7 Transmission Line Towers." *Journal of Wildlife Management* 57(2):271–81.
- 8
- 9 Stout, I.J., and G.W. Cornwell. 1976. "Nonhunting Mortality of Fledged North American
10 Waterfowl." *Journal of Wildlife Management* 40:681–693.
- 11
- 12 Su, S.H., L.C. Pearlman, J.A. Rothrock, T.J. Iannuzzi, and B.L. Finley. 2002. "Potential Long-
13 Term Ecological Impacts Caused by Disturbance of Contaminated Sediments: A Case Study."
14 *Environmental Management* 29:234–249.
- 15
- 16 Sundar, K.S.G., and B.C. Choudhury. 2005. "Mortality of Sarus Cranes (*Grus antigone*) Due to
17 Electricity Wires in Uttar Pradesh, India." *Environmental Conservation* 32:260–269.
- 18
- 19 Talbot, J. 1979. "A Review of Potential Biological Impacts of Cooling Tower Salt Drift."
20 *Atmospheric Environment* 13:395–405.
- 21
- 22 Taylor, W.K., and M.A. Kershner. 1986. "Migrant Birds Killed at the Vehicle Assembly Building
23 (VAB), John F. Kennedy Space Center." *Journal of Field Ornithology* 57:142–154.
- 24
- 25 Temme, M., and W.B. Jackson. 1979. "Cooling Towers as Obstacles in Bird Migrations." In
26 *Bird Control Seminars Proceedings*, Internet Center for Wildlife Management. Available URL:
27 <http://digitalcommons.unl.edu/icwdmbirdcontrol/16> (Accessed November 7, 2007).
- 28
- 29 Tennessee Valley Authority (TVA). 2003. *Browns Ferry Nuclear Plant Units 1, 2, and 3 –*
30 *Annual Radiological Environmental Operating Report for 2003*. Docket Nos. 50-259, 50-260,
31 50-296, Decatur, Alabama.
- 32
- 33 Turner, F.B., P. Litch, J.D. Thrasher, P.A. Medica, and J.R. Lannom, Jr. 1971. "Radiation-
34 Induced Sterility in Natural Populations of Lizards (*Crotaphytus wislinzenii* and *Cnemidophorus*
35 *tigris*)." In D.J. Nelson, ed., Volume 1, *Radionuclides in Ecosystems, Proceedings of the Third*
36 *National Symposium on Radioecology*. Oak Ridge, Tennessee. (May).
- 37
- 38 TXU Generation Company (TXU). 2004. *Comanche Peak Steam Electric Station (CPSES)*
39 *Annual Radiological Environmental Operating Report for 2004*. Docket Nos. 50-445, 50-446.
40 Glen Rose, Texas.
- 41

Environmental Consequences and Mitigating Actions

- 1 Ulsh, B.A., M.C. Muhlmann-Diaz, F.W. Whicker, T.G. Hinton, J.D. Congdon, and J. S. Bedford.
2 2000. "Chromosome Translocations in Turtles: A Biomarker in a Sentinel Animal for Ecological
3 Dosimetry." *Radiation Research* 153:752–759.
4
- 5 U.S. Bureau of Labor Statistics (BLS). 2005a. *Fatal Occupational Injuries by Event or*
6 *Exposure, All United States, 2005*. U.S. Department of Labor, Washington, D.C. Available
7 URL: <http://www.bls.gov/iif/oshwc/cfoi/cfch0005.pdf> (Accessed October 14, 2007).
8
- 9 U.S. Bureau of Labor Statistics (BLS). 2005b. *2005 News Release, National Census of Fatal*
10 *Occupational Injuries in 2005*. USDL-06-1364, U.S. Department of Labor, Washington, D.C.
11 Available URL: <http://www.bls.gov/iif/oshwc/cfoi/cfnr0012.pdf> (Accessed October 14, 2007).
12
- 13 U.S. Bureau of Labor Statistics (BLS). 2005c. *Incidence Rates of Nonfatal Occupational*
14 *Injuries and Illnesses by Industry and Case Types, 2005*. U.S. Department of Labor,
15 Washington, D.C. Available URL: <http://www.bls.gov/iif/oshwc/osh/os/ostb1619.pdf> (Accessed
16 October 14, 2007).
17
- 18 U.S. Bureau of Land Management (BLM). 1999. *Telephone Flat Geothermal Development*
19 *Project, Final Environmental Impact Statement, Environmental Impact Report*, California
20 Clearinghouse Number 97052078; DOI/FEIS 99-6; USFS/MDF/FEIS 99-1; DOE/FEIS-0298.
21 (February). Available URL: <http://www.osti.gov/bridge/purl.cover.jsp?purl=/894161-og5W8v/>
22 (Accessed October 22, 2007).
23
- 24 U.S. Bureau of Land Management (BLM). 2007. *Final Vegetation Treatments Using Herbicides*
25 *on Bureau of Land Management Lands in 17 Western States, Programmatic Environmental*
26 *Impact Statement*. FES 07-21, U.S. Department of the Interior, Reno, Nevada. (June).
27
- 28 U.S. Department of Energy (DOE). 1999. *Programmatic Environmental Impact Statement for*
29 *Alternative Strategies for the Long-Term Management and Use of Depleted Uranium*
30 *Hexafluoride*. DOE/EIS-0269, Washington, D.C. (April). Available URL: <http://web.ead.anl.gov/uranium/documents/>
31 (Accessed October 25, 2007).
32
- 33 U.S. Department of Energy (DOE). 2002a. *A Graded Approach for Evaluating Radiation Doses*
34 *to Aquatic and Terrestrial Biota*. DOE-STD-1153-2002, Washington, D.C. (July 2002).
35
- 36 U.S. Department of Energy (DOE). 2002b. *Final Environmental Impact Statement for a*
37 *Geologic Repository for the Disposal of Spent Nuclear Fuel and High-Level Radioactive Waste*
38 *at Yucca Mountain, Nye County, Nevada*. DOE/EIS-0250, Washington, D.C. (February).
39 Available URL: http://www.ocrwm.doe.gov/documents/feis_2/index.htm (Accessed
40 October 25, 2007).
41
42

Environmental Consequences and Mitigating Actions

- 1
2 U.S. Department of Energy (DOE). 2004a. *Final Environmental Impact Statement for*
3 *Construction and Operation of a Depleted Uranium Hexafluoride Conversion Facility at the*
4 *Paducah, Kentucky, Site*. DOE/EIS-0359, Washington, DC. (June). Available URL:
5 <http://web.ead.anl.gov/uranium/documents/> (Accessed October 25, 2007).
6
- 7 U.S. Department of Energy (DOE). 2004b. *Final Environmental Impact Statement for*
8 *Construction and Operation of a Depleted Uranium Hexafluoride Conversion Facility, at the*
9 *Portsmouth, Ohio, Site*. DOE/EIS-0360, Washington, D.C. (June). Available URL:
10 <http://web.ead.anl.gov/uranium/documents/> (Accessed October 25, 2007).
11
- 12 U.S. Department of Energy (DOE). 2004c. “Record of Decision for Construction and Operation
13 of a Depleted Uranium Hexafluoride Conversion Facility at the Paducah, Kentucky, Site.”
14 *Federal Register* (143):44654–44658, Washington, D.C. (July 27). Available URL:
15 <http://web.ead.anl.gov/uranium/documents/> (Accessed October 25, 2007).
16
- 17 U.S. Department of Energy (DOE). 2004d. “Record of Decision for Construction and Operation
18 of a Depleted Uranium Hexafluoride Conversion Facility at the Portsmouth, Ohio, Site.” *Federal*
19 *Register* 69(143):44649–44654. Washington, D.C. (July 27). Available URL:
20 <http://web.ead.anl.gov/uranium/documents/> (Accessed October 25, 2007).
21
- 22 U.S. Department of Energy (DOE). 2004e. *RESRAD-BIOTA: A Tool for Implementing a Graded*
23 *Approach to Biota Dose Evaluation*. ISCORS Technical Report 2004-02, Interagency Steering
24 Committee on Radiation Standards, Office of Air, Water and Radiation Protection Policy and
25 Guidance, Washington, D.C. (January). Available URL: [http://web.ead.anl.gov/resrad/](http://web.ead.anl.gov/resrad/documents/RESRAD-BIOTA_Manual_Version_1.pdf)
26 [documents/RESRAD-BIOTA_Manual_Version_1.pdf](http://web.ead.anl.gov/resrad/documents/RESRAD-BIOTA_Manual_Version_1.pdf). (Accessed November 13, 2007).
27
- 28 U.S. Department of Energy (DOE). 2006a. *Report to Congress – Spent Nuclear Fuel Recycling*
29 *Program Plan*. Washington, D.C. (May). Available URL: <http://www.gnep.energy.gov/pdfs/snf>
30 [RecyclingProgramPlanMay2006.pdf](http://www.gnep.energy.gov/pdfs/snf) (Accessed October 25, 2007).
31
- 32 U.S. Department of Energy (DOE). 2007a. *Draft Supplement Analysis for Locations(s) to*
33 *Dispose of Depleted Uranium Oxide Conversion Product Generated from DOE’s Inventory of*
34 *Depleted Uranium Hexafluoride (DOE/EIS-0359-SA1 and DOE/EIS-0360-SA1)*. Washington,
35 D.C. (March). Available URL: <http://web.ead.anl.gov/uranium/documents/>
36 (Accessed October 25, 2007).
37
- 38 U.S. Department of Energy (DOE). 2007b. *GNEP Overview Fact Sheet*. Washington, D.C.
39 Available URL: <http://www.gnep.energy.gov/pdfs/06-GA50506-01.pdf> (Accessed October 25,
40 2007).
41

Environmental Consequences and Mitigating Actions

- 1 U.S. Department of Energy (DOE). 2008. *Final Supplemental Environmental Impact Statement*
2 *for a Geologic Repository for the Disposal of Spent Nuclear Fuel and High-Level Radioactive*
3 *Waste at Yucca Mountain, Nye County, Nevada* (DOE/EIS-0250F-S1). Washington, D.C. June.
4 Available URL: http://www.ocrwm.doe.gov/ym_repository/seis/index.shtml. ML081750211,
5 ML081750212, ML081750213, ML081750214, ML081750216, ML081750217, ML081750218.
6
- 7 U.S. Department of Labor (DOL). 2007a. *Industry Injury and Illness Data – 2006, Summary*
8 *Table 1, Incident Rates of Non-Fatal Occupational Injuries and Illnesses by Industry and Case*
9 *Types*. Bureau of Labor Statistics, Washington, D.C. Available URL: [http://www.bls.gov/iif/](http://www.bls.gov/iif/oshwc/osh/os/osnr0028.txt)
10 [oshwc/osh/os/osnr0028.txt](http://www.bls.gov/iif/oshwc/osh/os/osnr0028.txt) (Accessed October 15, 2007).
11
- 12 U.S. Department of Labor (DOL). 2007b. *Census of Fatal and Occupational Injuries – Current*
13 *and Revised Data for 2006*, Table A-1. Bureau of Labor Statistics, Washington, D.C.
14 Available URL: <http://www.bls.gov/iif/oshwc/cfoi/cftb0214.pdf> (Accessed October 15, 2007).
15
- 16 U.S. Environmental Protection Agency (EPA). 1974. "*Information on Levels of Environmental*
17 *Noise Requisite to Protect Public Health and Welfare with an Adequate Margin of Safety.*"
18 Report 550/9-74-004, Washington, D.C. Available online at
19 <http://www.nonoise.org/library/levels74/levels74.htm>. March. (See also "*EPA Identifies Noise*
20 *Levels Affecting Health and Welfare.*" September 21, 2007. Available online at
21 <http://www.epa.gov/history/topics/noise/01.htm>. Accessed March 2, 2009).
22
- 23 U.S. Environmental Protection Agency (EPA). 1986. *Quality Criteria for Water*. EPA 440/5-86-
24 001, Office of Water, Washington. D.C. (May).
25
- 26 U.S. Environmental Protection Agency (EPA). 1989. *Drinking Water Criteria Document for*
27 *Chlorine, Hypochlorous Acid and Hypochlorite Ion*. Prepared by Environmental Criteria and
28 Assessment Office, Cincinnati, Ohio, for the EPA Office of Drinking Water.
29
- 30 U.S. Environmental Protection Agency (EPA). 1990. *Evaluation of the Potential*
31 *Carcinogenicity of Electromagnetic Fields*. EPA/600/6-90/005B, Workshop Review Draft,
32 Washington, D.C. (October).
33
- 34 U.S. Environmental Protection Agency (EPA). 1993. *Natural Wetlands and Urban Stormwater:*
35 *Potential Impacts and Management*, Office of Wetlands, Oceans, and Watersheds, Wetlands
36 Division, Washington, D.C. (February).
37
- 38 U.S. Environmental Protection Agency (EPA). 1996. *Protecting Natural Wetlands, A Guide to*
39 *Stormwater Best Management Practices*. EPA-843-B-96-001, Office of Water. (October).
40

Environmental Consequences and Mitigating Actions

- 1 U.S. Environmental Protection Agency (EPA). 1999. *Consideration of Cumulative Impacts in*
2 *EPA Review of NEPA Documents*. EPA 315-R-99-002, Office of Federal Activities,
3 Washington, D.C. (May).
4
- 5 U.S. Environmental Protection Agency (EPA). 2002. *Case Study Analysis for the Proposed*
6 *Section 316(b) Phase II Existing Facilities Rule*. EPA-821-R-02-002, Office of Science and
7 Technology, Washington, D.C. (February).
8
- 9 U.S. Environmental Protection Agency (EPA). 2004a. *The Incidence and Severity of Sediment*
10 *Contamination in Surface Waters of the United States, National Sediment Quality Survey:*
11 *Second Edition*. EPA-823-R-04-007, Office of Science and Technology, Washington, D.C.
12 (November).
13
- 14 U.S. Environmental Protection Agency (EPA). 2004b. "National Pollutant Discharge Elimination
15 System – Final Regulations to Establish Requirements for Cooling Water Intake Structures at
16 Phase II Existing Facilities." *Federal Register* 69(131):41575–41624. (July 9).
17
- 18 U.S. Environmental Protection Agency (EPA). 2005. "Public Health and Environmental
19 Radiation Protection Standards for Yucca Mountain, Nevada." *Federal Register*
20 70(161):49014–49068. (August 22).
21
- 22 U.S. Environmental Protection Agency (EPA). 2006. *Final Report: Environmental Footprints*
23 *and Costs of Coal-Based Integrated Gasification Combined Cycle and Pulverized Coal*
24 *Technologies*. EPA-430/R-06/006, Clean Air Markets, Office of Atmospheric Programs,
25 Washington, D.C. (July). Available URL: [http://www.epa.gov/air/caaac/coaltech/](http://www.epa.gov/air/caaac/coaltech/2007_01_epaigcc.pdf)
26 [2007_01_epaigcc.pdf](http://www.epa.gov/air/caaac/coaltech/2007_01_epaigcc.pdf) (Accessed October 12, 2007).
27
- 28 U.S. Environmental Protection Agency (EPA). 2007a. "National Pollutant Discharge Elimination
29 System – Suspension of Regulations Establishing Requirements for Cooling Water Intake
30 Structures at Phase II Existing Facilities." *Federal Register* 72(130):37107–37109.
31 (July 9).
32
- 33 U.S. Environmental Protection Agency (EPA). 2007b. "Notice of Data Availability on the
34 Disposal of Coal Combustion Wastes in Landfills and Surface Impoundments," *Federal*
35 *Register* 72(167), Office of Solid Waste, Research Triangle Park, North Carolina, August 29.
36 Available URL: <http://www.epa.gov/fedrgstr/EPA-WASTE/2007/August/Day-29/f17138.pdf>
37 (Accessed October 15, 2007).
38

Environmental Consequences and Mitigating Actions

- 1 U.S. Fish and Wildlife Service and National Marine Fisheries Service (USFWS and NMFS).
2 1998. *Endangered Species Consultation Handbook, Procedures for Conducting Consultation*
3 *and Conference Activities Under Section 7 of the Endangered Species Act*. Available URL:
4 <http://www.fws.gov/endangered/consultations/s7hndbk/s7hndbk.htm>. (Accessed November 14,
5 2007).
6
- 7 U.S. Nuclear Regulatory Commission (NRC). 1974. *Environmental Survey of the Uranium*
8 *Fuel Cycle*. WASH-1248, U.S. Atomic Energy Commission, Washington, D.C. (April).
9
- 10 U.S. Nuclear Regulatory Commission (NRC). 1976. *Environmental Survey of the*
11 *Reprocessing and Waste Management Portions of the LWR Fuel Cycle, A Task Force Report*.
12 NUREG-0116 (Supp. 1 to WASH-1248), Washington, D.C. (October).
13
- 14 U.S. Nuclear Regulatory Commission (NRC). 1977. *Calculation of Annual Doses to Man from*
15 *Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR*
16 *Part 50, Appendix 1*. Regulatory Guide 1.109, Office of Standards Development. (October).
17
- 18 U.S. Nuclear Regulatory Commission (NRC). 1980. *Prairie Island Nuclear Generating Plant,*
19 *Unit Nos. 1 and 2, Docket Nos. 50-282 and 50-306, Amendment to Facility Operating License*.
20 Northern States Power Company.
21
- 22 U.S. Nuclear Regulatory Commission (NRC). 1996. *Generic Environmental Impact Statement*
23 *for License Renewal of Nuclear Plants*. NUREG-1437, Vols. 1 and 2, Office of Nuclear Reactor
24 Regulation, Washington, D.C.
25
- 26 U.S. Nuclear Regulatory Commission (NRC). 1999a. *Generic Environmental Impact Statement*
27 *for License Renewal of Nuclear Plants, Main Report, Section 6.3 – Transportation, Table 9.1,*
28 *Summary of Findings on NEPA Issues for License Renewal of Nuclear Power Plants, Final*
29 *Report*. NUREG-1437, Addendum 1, Division of Regulatory Improvement Programs, Office of
30 Nuclear Reactor Regulation, Washington, D.C. (August).
31
- 32 U.S. Nuclear Regulatory Commission (NRC). 1999b. *Generic Environmental Impact Statement*
33 *for License Renewal of Nuclear Plants, Supplement 1: Regarding Calvert Cliffs Nuclear Power*
34 *Plant*. NUREG-1437, Supplement 1, Office of Nuclear Reactor Regulation, Washington, D.C.
35 (October).
36
- 37 U.S. Nuclear Regulatory Commission (NRC). 2002a. *Generic Environmental Impact Statement*
38 *for Decommissioning of Nuclear Facilities, Supplement 1: Regarding the Decommissioning of*
39 *Nuclear Power Reactors*. NUREG-0586, Supplement 1, Vols. 1 and 2, Office of Nuclear Reactor
40 Regulation, Washington, D.C. (November).
41

Environmental Consequences and Mitigating Actions

- 1 U.S. Nuclear Regulatory Commission (NRC). 2002b. *Generic Environmental Impact*
2 *Statement for License Renewal of Nuclear Plants, Supplement 5: Regarding Turkey Point,*
3 *Units 3 and 4.* NUREG-1437, Supplement 5, Office of Nuclear Reactor Regulation,
4 Washington, D.C. (January).
5
- 6 U.S. Nuclear Regulatory Commission (NRC). 2002c. *Generic Environmental Impact Statement*
7 *for License Renewal of Nuclear Plants, Supplement 8: Regarding McGuire Nuclear Station,*
8 *Units 1 and 2.* NUREG-1437, Supplement 8, Office of Nuclear Reactor Regulation,
9 Washington, D.C. (December).
10
- 11 U.S. Nuclear Regulatory Commission (NRC). 2002d. *Generic Environmental Impact Statement*
12 *for License Renewal of Nuclear Plants, Supplement 6: Regarding Surry Power Station, Units 1*
13 *and 2.* NUREG-1437, Supplement 6, Office of Nuclear Reactor Regulation, Washington, D.C.
14 (November).
15
- 16 U.S. Nuclear Regulatory Commission (NRC). 2002e. *Generic Environmental Impact Statement*
17 *for License Renewal of Nuclear Plants, Supplement 7: Regarding North Anna Power Station,*
18 *Units 1 and 2.* NUREG-1437, Supplement 7, Office of Nuclear Reactor Regulation,
19 Washington, D.C. (November).
20
- 21 U.S. Nuclear Regulatory Commission (NRC). 2003a. *Generic Environmental Impact Statement*
22 *for License Renewal of Nuclear Plants, Supplement 10: Regarding Peach Bottom Atomic*
23 *Power Station, Units 2 and 3.* NUREG-1437, Supplement 10, Office of Nuclear Reactor
24 Regulation, Washington, D.C. (January).
25
- 26 U.S. Nuclear Regulatory Commission (NRC). 2003b. *Generic Environmental Impact Statement*
27 *for License Renewal of Nuclear Plants, Supplement 13: Regarding H.B. Robinson Steam*
28 *Electric Plant, Unit 2.* NUREG-1437, Supplement 13, Office of Nuclear Reactor Regulation,
29 Washington, D.C. (December).
30
- 31 U.S. Nuclear Regulatory Commission (NRC). 2004a. *Generic Environmental Impact Statement*
32 *for License Renewal of Nuclear Plants, Supplement 17: Regarding Dresden Nuclear Power*
33 *Station, Units 2 and 3.* NUREG-1437, Supplement 17, Office of Nuclear Reactor Regulation,
34 Washington, D.C. (June 2004).
35
- 36 U.S. Nuclear Regulatory Commission (NRC). 2004b. *Generic Environmental Impact*
37 *Statement for License Renewal of Nuclear Plants, Supplement 15: Regarding Virgil C. Summer*
38 *Nuclear Station.* NUREG-1437, Supplement 15, Office of Nuclear Reactor Regulation,
39 Washington, D.C. (February).
40

Environmental Consequences and Mitigating Actions

- 1 U.S. Nuclear Regulatory Commission (NRC). 2005a. *Generic Environmental Impact*
2 *Statement for License Renewal of Nuclear Plants, Supplement 20: Regarding Donald C. Cook*
3 *Nuclear Plant Units No. 1 and 2*. NUREG-1437, Supplement 20, Office of Nuclear Reactor
4 Regulation, Washington, D.C. (May).
5
- 6 U.S. Nuclear Regulatory Commission (NRC). 2005b. *Generic Environmental Impact*
7 *Statement for License Renewal of Nuclear Plants, Supplement 23: Regarding Point Beach*
8 *Nuclear Plant, Units 1 and 2*. NUREG-1437, Supplement 23, Office of Nuclear Reactor
9 Regulation, Washington, D.C. (August).
10
- 11 U.S. Nuclear Regulatory Commission (NRC), 2005c. *Generic Environmental Impact Statement*
12 *for License Renewal of Nuclear Plants, Supplement 22: Regarding Millstone Power Station,*
13 *Units 2 and 3*. NUREG-1437, Supplement 22, Office of Nuclear Reactor Regulation,
14 Washington, D.C. (July).
15
- 16 U.S. Nuclear Regulatory Commission (NRC). 2005d. *Generic Environmental Impact*
17 *Statement for License Renewal of Nuclear Plants, Supplement 21: Regarding Browns Ferry*
18 *Nuclear Plant, Units 1, 2, and 3*. NUREG-1437, Supplement 21, Office of Nuclear Reactor
19 Regulation, Washington, D.C.. (June).
20
- 21 U.S. Nuclear Regulatory Commission (NRC). 2005e. "Implementation of a Dose Standard
22 After 10,000 Years." *Federal Register* (173):53313–53320. Washington, D.C. (September 8).
23
- 24 U.S. Nuclear Regulatory Commission (NRC). 2005f. *Event Notification Report for June 29,*
25 *2005*. Operations Center, Washington, D.C. Available URL: [http://www.nrc.gov/reading-](http://www.nrc.gov/reading-rm/doc-collections/event-status/event/2005/20050629en.html)
26 [rm/doc-collections/event-status/event/2005/20050629en.html](http://www.nrc.gov/reading-rm/doc-collections/event-status/event/2005/20050629en.html) (Accessed November 20, 2007).
27
- 28 U.S. Nuclear Regulatory Commission (NRC). 2006a. *Liquid Radioactive Release Lessons*
29 *Learned Task Force Final Report*. (September 1). Available URL: [http://adamswebsearch2.](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=062770207)
30 [nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=062770207](http://adamswebsearch2.nrc.gov/idmws/doccontent.dll?library=PU_ADAMS^PBNTAD01&ID=062770207).
31 (Accessed October 17, 2007).
32
- 33 U.S. Nuclear Regulatory Commission (NRC). 2006b. *Generic Environmental Impact*
34 *Statement for License Renewal of Nuclear Plants, Supplement 25: Regarding New Brunswick*
35 *Steam Electric Plant, Units 1 and 2*. Washington, D.C., Office of Nuclear Reactor Regulation,
36 NUREG-1437, Supplement 25. (April).
37
- 38 U.S. Nuclear Regulatory Commission (NRC). 2006c. *Generic Environmental Impact Statement*
39 *for License Renewal of Nuclear Plants, Supplement 26: Regarding Monticello Nuclear*
40 *Generating Plant*. NUREG-1437, Supplement 26, Office of Nuclear Reactor Regulation,
41 Washington, D.C. (August).
42

Environmental Consequences and Mitigating Actions

- 1 U.S. Nuclear Regulatory Commission (NRC). 2006d. *Generic Environmental Impact*
2 *Statement for License Renewal of Nuclear Plants, Supplement 27: Regarding Palisades*
3 *Nuclear Plant*. NUREG-1437, Supplement 27, Office of Nuclear Reactor Regulation,
4 Washington, D.C. (October).
5
- 6 U.S. Nuclear Regulatory Commission (NRC). 2006e. *Generic Environmental Impact*
7 *Statement for License Renewal of Nuclear Plants, Supplement 24: Regarding the Nine Mile*
8 *Point*. NUREG-1437, Office of Nuclear Reactor Regulation, Washington, D.C. (May).
9
- 10 U.S. Nuclear Regulatory Commission (NRC). 2007a. *Generic Environmental Impact*
11 *Statement for License Renewal of Nuclear Plants Supplement 30: Regarding Vermont Yankee*
12 *Power Station*. NUREG-1437, Supplement 30, Office of Nuclear Reactor Regulation,
13 Washington, D.C. (August).
14
- 15 U.S. Nuclear Regulatory Commission (NRC). 2007b. *Generic Environmental Impact*
16 *Statement for License Renewal of Nuclear Plants, Supplement 28: Regarding Oyster Creek*
17 *Nuclear Generating Station*. NUREG-1437, Supplement 28, Office of Nuclear Reactor
18 Regulation, Washington, D.C. (January).
19
- 20 U.S. Nuclear Regulatory Commission (NRC). 2007c. *Generic Environmental Impact Statement*
21 *for License Renewal of Nuclear Plants, Supplement 29: Regarding Pilgrim Nuclear Power*
22 *Station*. NUREG-1437, Supplement 29, Office of Nuclear Reactor Regulation, Washington,
23 D.C. (July).
24
- 25 U.S. Nuclear Regulatory Commission (NRC). 2007d. "Combined License Applications and
26 Subsequent Documentation." Available URL: [http://www.nrc.gov/reactors/new-](http://www.nrc.gov/reactors/new-licensing/col.html)
27 [licensing/col.html](http://www.nrc.gov/reactors/new-licensing/col.html) (Accessed November 15, 2007).
28
- 29 U.S. Nuclear Regulatory Commission (NRC). 2007e. "Early Site Permits-Licensing Reviews."
30 Available URL: <http://www.nrc.gov/reactors/new-licensing/esp.html> (Accessed November 15,
31 2007).
32
- 33 U.S. Nuclear Regulatory Commission (NRC). 2008a. *Generic Environmental Impact*
34 *Statement for License Renewal of Nuclear Plants, Supplement 32: Regarding Wolf Creek*
35 *Generating Station*. NUREG-1437, Supplement 32, Office of Nuclear Reactor Regulation,
36 Washington, D.C. (May).
37
- 38 U.S. Nuclear Regulatory Commission (NRC). 2008b. *Generic Environmental Impact*
39 *Statement for License Renewal of Nuclear Plants, Supplement 34: Regarding Susquehanna*
40
41

Environmental Consequences and Mitigating Actions

- 1 *Steam Electric Station*. Draft, NUREG-1437, Supplement 34, Office of Nuclear Reactor
2 Regulation, Washington, D.C. (January).
3
- 4 U.S. Nuclear Regulatory Commission (NRC). 2008c. *Indian Point Nuclear Generating Units 1*
5 *& 2 – NRC Inspection Report. Nos. 05000003/2007010 and 05000247/2007010*. Docket
6 Numbers 50-003 and 50-247, Washington, D.C. Accessible at ML081340425.
7
- 8 Valberg, P.A., R. Kavet, and C.N. Rafferty. 1997. “Can Low Level 50/60-Hz Electric and
9 Magnetic Fields Cause Biological Effects?” *Radiation Research* 148(1):2–21. (July).
10
- 11 Varfalvy, L., et al. 1985. “Measurement and Statistical Analysis of Ozone from HVDC and
12 HVAC Transmission Lines.” *IEEE Transactions on Power Apparatus and Systems*, PAS-
13 104(10), October.
14
- 15 Veil, J.A., J.K. Rice, and M.E.S. Raivel. 1997. *Biocide Usage in Cooling Towers in the Electric*
16 *Power and Petroleum Refining Industries*. Prepared by Argonne National Laboratory, Argonne,
17 Illinois, for the U.S. Department of Energy, Office of Fossil Energy, Washington, D.C.
18 (September). Available URL: http://www.ead.anl.gov/pub/doc/ANL-Biocide_Usage.pdf
19 (Accessed November 1, 2007).
20
- 21 Warren, J.L., et al. 1981. *Environmental Studies of a 1100 kV Prototype Transmission Line:*
22 *An Annual Report for the 1980 Study Period*. Battelle, Pacific Northwest Laboratories,
23 Richland, Washington.
24
- 25 Whitlatch, R.B., A.M. Lohrer, S.F. Thrush, R.D. Pridmore, J.E. Hewitt, V.J. Cummings, and
26 R.N. Zajac. 1998. “Scale-Dependent Benthic Recolonization Dynamics: Life Stage-Based
27 Dispersal and Demographic Consequences.” *Hydrobiologia* 375/376: 217–226.
28
- 29 Wilber, D.H., and D.G. Clarke. 2001. “Biological Effects of Suspended Sediments: A Review of
30 Suspended Sediment Impacts on Fish and Shellfish with Relation to Dredging Activities in
31 Estuaries.” *North American Journal of Fisheries Management* 21:855–875.
32
- 33 Wilcove, D.S. 1988. “Changes in the Avifauna of the Great Smoky Mountains: 1947–1983.”
34 *Wilson Bulletin* 100:256–271.
35
- 36 Williams, R.D., and E.W. Colson. 1989. “Raptor Associations with Linear Rights-of-Way,”
37 *Western Raptor Management Symposium and Workshop No. 12*, 173–92.
38
- 39 Wolf Creek Generating Station (WCGS). 2003. *Applicant’s Environmental Report; Operating*
40 *License Renewal Stage*. Docket No. 50-482, License No. NPF-42.
41

Environmental Consequences and Mitigating Actions

- 1 Wolf Creek Nuclear Operating Corporation (WCNOC). 2002. *Wolf Creek Generating Station*
2 *Annual Environmental Operating Report 2002*. Docket No. 50-482, RA 03-0053.
3
- 4 Wolff, J.O., E.M. Schaubert, and W.D. Edge. 1997. "Effects of Habitat Loss and Fragmentation
5 on the Behavior and Demography of Gray-Tailed Voles." *Conservation Biology* 11:945–956.
6
- 7 World Health Organization (WHO). 2007. *Extremely Low Frequency Fields*. Environmental
8 Health Criteria Monograph No. 238, Geneva, Switzerland. Available URL: http://www.who.int/pehemf/publications/elf_ehc/en/index.html.
9
- 10
- 11 Wright, T., J. Tomlinson, T. Schueler, K. Cappiella, A. Kitchell, and D. Hirschman. 2006. *Direct*
12 *and Indirect Impacts of Urbanization on Wetland Quality: Wetlands and Watersheds Article # 1*.
13 Prepared by Center for Watershed Protection for U.S. Environmental Protection Agency, Office
14 of Wetlands, Oceans and Watersheds, Washington, D.C. (December).
15
- 16 Yahner, R.H. 1988. "Changes in Wildlife Communities near Edges." *Conservation*
17 *Biology* 2:333–339.
18
- 19 Yahner, R.H. 2004. "Wildlife Response to More Than 50 Years of Vegetation Maintenance on
20 a Pennsylvania, U.S., Right-of-Way." *Journal of Arboriculture* 30:123–126.
21
- 22 Yahner, R.H., et al. 2004. "Long-Term Effects of Rights-of-Way Maintenance via the Wire-
23 Border Zone Method on Bird Nesting Ecology." *Journal of Arboriculture* 30: 288–294.
24
- 25 Yahner, R.H., R.J. Hutnik, and S.A. Liscinsky. 2002. "Bird Populations Associated with an
26 Electric Transmission Right-of-Way." *Journal of Arboriculture* 28:123–130.
27
- 28 York, R., M. Foster, N. Davis, J. Schoonmaker, R. Unsworth, C. Holmes, J. O'Hagan, and
29 J. McKinney. 2005. *Issues and Environmental Impacts Associated with Once-Through Cooling*
30 *at California's Coastal Power Plants*. CEC-700-2005-013, California Energy Commission,
31 Sacramento, California. (June). Available URL: [http://www.energy.ca.gov/2005publications/](http://www.energy.ca.gov/2005publications/CEC-700-2005-013/CEC-700-2005-013.pdf)
32 [CEC-700-2005-013/CEC-700-2005-013.pdf](http://www.energy.ca.gov/2005publications/CEC-700-2005-013/CEC-700-2005-013.pdf) (Accessed May 21, 2007).
33
- 34 Zach, R., J.L. Hawkins, and S.C. Sheppard. 1993. "Effects of Ionizing Radiation on Breeding
35 Swallows at Current Radiation Protection Standards." *Environmental Toxicology and Chemistry*
36 12:779.
37

5 List of Preparers

1
2
3
4
5
6
7
8
9

The overall responsibility for the preparation of this Generic Environmental Impact Statement revision was assigned to the U.S. Nuclear Regulatory Commission (NRC), Office of Nuclear Reactor Regulation. The revision was prepared by members of the Office of Nuclear Reactor Regulation with assistance from other NRC organizations, Argonne National Laboratory, and Information Systems Laboratories, Inc.

Name	Education/Expertise	Contribution
Nuclear Regulatory Commission		
Briana Balsam	B.S., Conservation Biology; 3 years of experience in environmental impact analysis	Ecology
Dennis Beissel	B.S., Geology, M.S., Geology; 39 years of commercial and government services in environmental and natural resource assessment	Hydrology; Air Quality/ Meteorology
Eric Benner	B.S., Nuclear Engineering, M.S., Environmental Engineering; 18 years of regulatory experience in reactor oversight and environmental assessment	RERB Branch Chief
Andrew Carrera	M.S., Radiation Health Science, B.S. in Biology; 3 years of research experience in nuclear medicine at NIH; 5 years of research experience in radiopharmacology and radiation oncology at Johns Hopkins University; 2 years of regulatory experience with NEPA reviews	Human Health; Waste Management/Fuel Cycle; Accidents
Jennifer Davis	B.A., Historic Preservation and Classical Civilization (archaeology); 2 years of fieldwork; 7 years of experience in NEPA compliance, project management, and cultural resources impact analysis and regulatory compliance	Project Manager; Cultural Resources; Decommissioning
Nathan Goodman	M.S., Environmental Science; 3 years of consulting experience in NEPA compliance; 3 years of regulatory experience with NEPA reviews	Terrestrial Ecology
Donald Helton	B.S., M.S., Nuclear Engineering; 7 years of experience in computational thermal hydraulic and severe accident analysis for reactors and spent fuel; additional limited experience in probabilistic risk assessment, consequence analysis, and incident response	Postulated Accidents; Severe Accident Mitigation Alternatives

10

List of Preparers

Name	Education/Expertise	Contribution
Nuclear Regulatory Commission (cont.)		
Stephen Klementowicz	M.S., Health Physics; 27 years of commercial and regulatory experience in reactor health physics, radiological effluent and environmental monitoring programs, and radioactive waste	Human Health; Waste Management/Fuel Cycle; Accidents; Decommissioning
Justin Leous	M.P.A., Environmental Policy; 3 years of environmental project development and management	Alternatives
Ekatarina Lenning	M.S., Health Physics, Radiological Protection and Safety, B.S., Chemistry; 3 years of experience in radiological dose and risk assessment; 3 years of experience in environmental research and assessment, air/quality/meteorology, waste management	Air Quality and Meteorology; Human Health; Waste Management/Fuel Cycle; Accidents; Decommissioning
Dennis Logan	Ph.D., Marine Studies (Biological Oceanography), M.S., Marine Biology; 33 years of experience assessing the effects of anthropogenic actions on natural populations, including ecological and human health risk assessments, power plant-related environmental studies, and project management	Aquatic Ecology; Decommissioning
Sarah Lopas	M.P.A., Environmental Policy, B.A., Molecular Biology and Environmental Science; 6 years of experience in environmental site assessments, soil and groundwater remediation, and environmental impact statement preparation	Ecology; Alternatives
Jessie Muir	M.S., Environmental Engineering and Science; 5 years of consulting experience in regulatory compliance and waste management; 1 year of regulatory experience with NEPA reviews	Nonradiological Waste
Robert Palla	B.S., M.S., Mechanical Engineering; 27 years of experience in severe accident analysis; 19 years of experience in analysis of severe accident mitigation alternatives	Postulated Accidents; Severe Accident Mitigation Alternatives
Jeffrey Rikhoff	M.R.P., Regional Planning, M.S., Economic Development and Appropriate Technology; 21 years of experience in NEPA compliance, socioeconomics and environmental justice impact analysis, cultural resource impacts, and comprehensive land-use and development planning	Socioeconomics; Environmental Justice; Cultural Resources; Land Use; Decommissioning

Name	Education/Expertise	Contribution
Nuclear Regulatory Commission (cont.)		
Andrew Stuyvenberg	M.E.M., Environmental Economics and Policy, B.S., Biochemistry/Molecular Biology and Political Science; 3 years of experience in energy policy research and development, project management, utilities regulation, and energy investing	Alternatives
Scott Werts	Ph.D., Geology; 5 years of experience in groundwater, sedimentology and soil science physical and geochemical assessments; 2 years of experience in meteorology	Hydrology, Meteorology/Air Quality, Alternatives
Elizabeth Wexler	M.E.M., Environmental Management; 3 years of experience in environmental impact assessment	Aquatic Ecology
----- Argonne National Laboratory^(a)		
Timothy Allison	M.S., Mineral and Energy Resource Economics, M.A., Geography; 21 years of experience in regional analysis and economic impact analysis	Socioeconomics; Environmental Justice
Halil Avci	Ph.D., Nuclear Engineering; 23 years of experience in environmental assessment, waste management, accident analysis, and project management	Assistant Project Team Leader; Waste Management/Fuel Cycle
John Hayse	Ph.D., Zoology; 23 years of experience in ecological research and environmental assessment	Aquatic Ecology
Sunita Kamboj	Ph.D., Health Physics, 16 years of experience in radiological dose and risk assessment	Human Health
Ronald Kolpa	M.S., Inorganic Chemistry, B.S., Chemistry; 36 years of experience in environmental regulation, auditing, and planning	Alternatives
James Kuiper	M.S., Biometrics, Certificate in Remote Sensing; 21 years of experience in GIS analysis, programming, and remote sensing	Geographic Information System Cartography and Analysis
Kirk LaGory	Ph.D., Zoology, M.En., Environmental Science; 33 years of experience in ecological research; 22 years of experience in environmental assessment	Team Leader
Michael Lazaro	M.S., Environmental/Nuclear Engineering, 34 years of experience in atmospheric science/ modeling research and development; 23 years of experience in environmental assessment	Air Quality and Meteorology; Noise
William Metz	Ph.D., Geography, M.A., Geography, M.B.A, M.I.S, Information Systems; 36 years of experience in socioeconomic and land-use assessment, emergency planning, and perception-based impact research	Land Use; Visual Resources
Marita Moniger	B.A., English; 31 years of experience in technical editing and writing	Technical Editor

List of Preparers

Name	Education/Expertise	Contribution
Argonne National Laboratory (cont.)		
Ellen Moret	B.A., Environmental Studies; 4 years of experience in environmental impact statement preparation	Administrative Support, Alternatives
Michele Nelson	Graphic designer; 30 years of experience in graphical design and technical illustration	Graphics
Lee Northcutt	A.A.; 19 years of experience in program and editorial assistance; 12 years of experience in environmental impact statement preparation	Glossary
Daniel O'Rourke	M.S., Industrial Archaeology; 13 years of experience in cultural resource management; 8 years of experience in historical property issues	Cultural Resources
Terri Patton	M.S., Geology; 20 years of experience in environmental research and assessment	Cumulative Impacts
John Quinn	M.S., Geology; 20 years of experience in hydrogeology	Hydrology, Geology, Soils
Robert Van Lonkhuyzen	B.A., Biology; 19 years of experience in ecological research and environmental assessment	Terrestrial Ecology
William Vinikour	M.S., Biology with environmental emphasis; 31 years of experience in ecological research and environmental assessment	Aquatic Ecology
Leroy Walston	M.S., Biology; 4 years of experience in ecological and environmental research	Terrestrial Ecology
Konstance Wescott	M.A., Anthropology, B.A., Mathematics and Sociology/Anthropology; 21 years of experience in archaeology, 19 years in environmental assessment	Alternatives
Information Systems Laboratories, Inc.^(b)		
Thomas King	M.S., Mechanical Engineering; 40 years of experience in nuclear reactor design, operation, safety reviews, rulemaking and research, including the environmental impacts of postulated accidents	Postulated Accidents
Christopher Chwasz	B.S., Nuclear Engineering and Radiological Sciences; 3 years of experience in nuclear science and nuclear power research	Postulated Accidents

(a) Argonne National Laboratory is operated for the U.S. Department of Energy by UChicago Argonne, LLC.

(b) Information Systems Laboratories, Inc., is located in Rockville, Maryland.

6 Distribution List

1		
2		
3	David Agnew	Cape Cod Downwinders
4	Jack Alexander	Entergy Nuclear
5	Rita Arditti	Women's Community Center Cancer Project
6	Rochelle Becker	San Luis Obispo Mothers for Peace
7	Tama Becker	San Luis Obispo Mothers for Peace
8	Rick Buckley	Entergy Nuclear
9	Brian Campbell	WATD
10	John Carlson	American Electric Power
11	Vera S Cohen	Women's Community Cancer Program and Toxic Action Center
12		
13	Corey J Conn	Nuclear Energy Information Service
14	Alice Domby	General Public
15	Art Domby	Troutman Sanders, LLP
16	Emma Domby	General Public
17	Fred Emerson	Nuclear Energy Institute
18	Jerome S Fields	PPL
19	Carey W Fleming	Winston and Strawn
20	Sandra Gavutis	C-10 Research and Education Foundation
21	Guillermo Gonzalez	Office of Senator Feinstein
22	Terry Grebel	Pacific Gas and Electric
23	Debbie Grinnell	C-10 Research and Education Foundation
24	Oliver Hall	Massachusetts Public Interest Research Group
25	Milton Hirshberg, MD	Capedownwinders
26	Darcie Houck	California Energy Commission
27	Julea Hovey	Constellation Nuclear Service, Inc
28	Peggy Huang	General Public
29	Tim Judson	Citizens Awareness Network
30	Deb Katz	Citizens Awareness Network
31	Fred Katz	Climate Action Network
32	Rita Kilpatrick	Southern Alliance for Clean Energy
33	Jeanne M Kota	Sierra Club
34	Jan Kozyra	Progress Energy
35	Adele Kushner	Action for a Clean Environment
36	David J Lach	Entergy Nuclear
37	Mary Lampert	Pilgrim Security Watch
38	Bill Maher	Exelon Corporation
39		
40		

7 Glossary

1
2
3
4 **Absorbed dose:** The energy imparted by ionizing radiation per unit mass of tissue. The units
5 of absorbed dose are the rad and the gray (Gy).
6

7 **Acid rain:** Also called acid precipitation or acid deposition, acid rain is precipitation containing
8 harmful amounts of nitric and sulfuric acids formed primarily by sulfur dioxide and nitrogen
9 oxides released into the atmosphere when fossil fuels are burned. It can be wet precipitation
10 (rain, snow, or fog) or dry precipitation (absorbed gaseous and particulate matter, aerosol
11 particles, or dust). Acid rain has a pH below 5.6. Normal rain has a pH of about 5.6, which is
12 slightly acidic. The term pH is a measure of acidity or alkalinity and ranges from 0 to 14. A pH
13 measurement of 7 is regarded as neutral. Measurements below 7 indicate increased acidity,
14 while those above indicate increased alkalinity.
15

16 **Activation products:** Radionuclides produced from the interaction of radiation with matter.
17 Generally it is the neutrons that interact with stable atoms and make them radioactive.
18

19 **Activity:** The rate of disintegration (transformation) or decay of radioactive material. The units
20 of radioactivity are the curie (Ci) and the Becquerel (Bq).
21

22 **Acute effects:** Effects resulting from short-term exposure to relatively high levels of a stressing
23 factor (e.g., contaminant, disease, electromagnetic field, noise, and radionuclides) over long
24 periods.
25

26 **Acute radiation exposure:** A single accidental exposure to high doses of radiation for a short
27 period of time, which may produce biological effects within a short time after exposure.
28

29 **Adverse environmental impacts:** Impacts that are determined to be harmful to the
30 environment.
31

32 **Advisory Council for Historic Preservation:** A Federal oversight group that provides
33 guidance on the application of Federal law concerning cultural resources and serves as an
34 arbiter when disputes arise.
35

36 **Aerobic:** Requiring the presence of oxygen to support life.
37
38

Glossary

- 1 **Air quality:** Assessment of the health-related and visual characteristics of the air, often derived
2 from quantitative measurements of the concentrations of specific injurious or contaminating
3 substances. Air quality standards are the prescribed levels of substances in the outside air that
4 cannot be exceeded during a specific time in a specified area.
5
- 6 **ALARA:** Acronym for “as low as (is) reasonably achievable.” This means making every
7 reasonable effort to maintain exposures to ionizing radiation as far below the dose limits as
8 practical, consistent with the purpose for which the licensed activity is undertaken, taking into
9 account the state of technology, the economics of improvements in relation to state of
10 technology, the economics of improvements in relation to benefits to the public health and
11 safety, and other societal and socioeconomic considerations, and in relation to utilization of
12 nuclear energy and licensed materials in the public interest (see 10 CFR 20.1003).
13
- 14 **Alluvial:** Refers to soil or earth material that has been deposited by running water, as in a
15 riverbed, floodplain, or delta.
16
- 17 **Alluvial aquifer:** An aquifer composed of alluvial sediments, generally located in a river valley.
18
- 19 **Alpha particle:** Positively charged highly energetic ionizing radiation that consists of
20 two protons and two neutrons.
21
- 22 **Alternatives to the proposed action considered in the GEIS:** (1) Not renewing the operating
23 licenses of commercial nuclear power plants (no-action alternative). This is the only alternative
24 to the proposed action that is within the NRC’s decision-making authority; (2) replacing existing
25 nuclear generating capacity with other energy sources (including fossil energy generation, new
26 nuclear generation, and renewable energy); (3) compensating for lost nuclear generation
27 capacity by using demand-side management (conservation) or purchasing power.
28
- 29 **Ambient air:** The surrounding atmosphere as it exists around people, plants, and structures.
30
- 31 **Ambient noise level:** The level of acoustic noise at a given location, such as in a room or
32 outdoors, that is representative of typical conditions unaffected by human activities.
33
- 34 **Ambient water temperature:** The water temperature in a water body that is representative of
35 typical conditions unaffected by human activities (e.g., the temperature of the surface water
36 body away from the thermal effluent).
37
- 38 **Anadromous:** Pertaining to fish that spend a part of their life cycle in the sea and return to
39 freshwater streams to spawn; for example, salmon, steelhead, and shad.
40
41

- 1 **Annual dose:** Dose received in one year.
2
- 3 **Anoxic:** Absence of oxygen. Usually used in reference to an aquatic habitat.
4
- 5 **Anthracite coal:** A hard, black coal averaging 86–97 percent carbon, but with a slightly lower
6 heating value than bituminous coal. Anthracite coal deposits are rare in the United States and
7 account for less than 1 percent of annual production. Its limited availability confines its use to
8 specialty applications such as residential and industrial space heating.
9
- 10 **Anthropogenic:** Made or generated by a human or caused by human activity.
11
- 12 **Aquatic biota:** Consisting of, relating to, or being in water; living or growing in, or near the
13 water. An organism that lives in, on, or near the water.
14
- 15 **Aquifer:** An underground layer of permeable, unconsolidated sediments or porous or fractured
16 bedrock that yields usable quantities of water to a well or spring.
17
- 18 **Archeological Resources Protection Act of 1979:** Requires a permit for excavation or
19 removal of archeological resources from public or Native American lands.
20
- 21 **Atom:** The smallest particle of an element that cannot be divided or broken up by chemical
22 means. It consists of a central core of protons and neutrons, called the nucleus. Electrons
23 revolve in orbits in the region surrounding the nucleus.
24
- 25 **Atomic Energy Act:** The Atomic Energy Act of 1954 is a United States Federal law that is,
26 according to the Nuclear Regulatory Commission, “the fundamental U.S. law on both the civilian
27 and the military uses of nuclear materials.” It covers the laws for the “development and the
28 regulation of the uses of nuclear materials and facilities in the United States.” It was an
29 amendment to the Atomic Energy Act of 1946 and substantially refined certain aspects of the
30 law, including increased support for the possibility of a civilian nuclear industry.
31
- 32 **Attainment:** An area is deemed in attainment by the U.S. Environmental Protection Agency
33 (EPA) when the air quality is monitored and the resultant concentrations are found to be
34 consistently below the National Ambient Air Quality Standards (NAAQS). Areas can be in
35 attainment for some pollutants, while designated as nonattainment for others. Some areas are
36 designated as “maintenance” areas. These are regions that were initially designated as
37 nonattainment or unclassifiable and have since attained compliance with the NAAQS.
38
- 39 **Attenuation:** The reduction in the level of sound.
40

Glossary

- 1 **Auxiliary buildings:** Auxiliary buildings house support systems, such as the ventilation
2 system, emergency core cooling system, laundry facilities, water treatment system, and waste
3 treatment system. An auxiliary building may also contain the emergency diesel generators and,
4 in some pressurized water reactors, the fuel storage facility. The facility's control room is often
5 located in the auxiliary building.
6
- 7 **Avian:** Of, relating to, or characteristic of birds.
8
- 9 **Barrel:** A unit of volume equal to 42 U.S. gallons.
10
- 11 **Background radiation:** Radiation from cosmic sources; naturally occurring radioactive
12 material, including radon (except as a decay product of source or special nuclear material); and
13 global fallout as it exists in the environment from the testing of nuclear explosive devices or from
14 past nuclear accidents such as Chernobyl and are not under the control of the licensee.
15 Background radiation does not include radiation from sources, by-products, or special nuclear
16 materials regulated by the Commission.
17
- 18 **Becquerel:** The unit of radioactive decay equal to 1 disintegration per second. 37 billion
19 (3.7×10^{10}) becquerels = 1 curie (Ci).
20
- 21 **BEIR reports:** Series of reports issued by the National Research Council to advise the Federal
22 government on the relationship between exposure to ionizing radiation and human health. BEIR
23 stands for Biological Effects of Ionizing Radiation.
24
- 25 **Benthic:** Of, relating to, or occurring at the bottom of a body of water.
26
- 27 **Best Available Control Technology (BACT):** A pollution control standard created by the
28 U.S. Environmental Protection Agency that is used to determine what air pollution control
29 technology will be used to control a specific pollutant to a specified limit.
30
- 31 **Best management practices:** A practice or combination of practices that are determined to
32 provide the most effective, environmentally sound, and economically feasible means of
33 managing an activity and mitigating its impacts.
34
- 35 **Beta particle:** An electron that is ejected from the nucleus of a radioactive atom. It is much
36 lighter than an alpha particle and can travel a longer distance in air compared to an alpha
37 particle, but can still be stopped by a thin sheet of aluminum foil.
38
- 39 **Bioavailability:** A contaminant existing in a form that can be taken up by living organisms.
40
41

- 1 **Biocide:** A chemical agent, such as a pesticide, that is used to kill and control living organisms.
2
- 3 **Biomass:** Organic nonfossil material of biological origin constituting a renewable energy
4 source.
5
- 6 **Biota:** The combined flora and fauna of a region.
7
- 8 **Bituminous coal:** A dense black or brown coal that has, on average 45–86 percent carbon by
9 weight and a heating value as much as five times greater than lignite coal. U.S. deposits are
10 100–300 million years old and are found primarily in the states of West Virginia, Kentucky, and
11 Pennsylvania, with lesser amounts in the Midwest. Bituminous coal is the most abundant rank
12 of coal in the United States. It is used primarily to produce electricity, and in the industrial
13 sector, to produce heat and process steam and as a starting material for the production of coke,
14 an intensely hot-burning derivative fuel used in the steel industry.
15
- 16 **Blast furnace:** A furnace in which solid fuel (coke) is burned with an air blast to smelt ore.
17
- 18 **Blowdown:** Continual or periodic purging of a circulating working fluid to prevent buildup of
19 impurities in the fluid.
20
- 21 **Boiler:** A device for generating steam for power, processing, or heating purposes; or hot water
22 for heating purposes or hot water supply. Heat from an external combustion source is
23 transmitted to a fluid contained within the tubes found in the boiler shell. This fluid is delivered
24 to an end-use at a desired pressure, temperature, and quality.
25
- 26 **Boiling water reactor (BWR):** A reactor in which water, used as both coolant and moderator,
27 boils in the core to produce steam, which drives a turbine connected to an electrical generator,
28 thereby producing electricity.
29
- 30 **Brownfield site:** Abandoned, idled, or under-used industrial and commercial facilities in which
31 expansion or redevelopment is sometimes complicated by real or perceived environmental
32 contaminations. (See also greenfield site).
33
- 34 **Btu:** British thermal unit. A measure of the energy required to raise the temperature of one
35 pound of water by one degree Fahrenheit.
36
- 37 **Burnup spent fuel:** See spent fuel burnup.
38

Glossary

- 1 **Cap and trade:** An environmental policy instrument used by governments to limit the amount of
2 pollutants emitted to the environment. The total emissions are capped at a specified level but
3 polluters can trade the emission allowances among themselves as long as the total amount is
4 not exceeded.
5
- 6 **Capacity:** See generator capacity.
7
- 8 **Capacity factor:** The actual energy output of an electricity-generating device divided by the
9 energy output that would be produced if it operated at its rated power output for the entire year.
10 Generally expressed as percentage.
11
- 12 **Capacity rating:** See rated power.
13
- 14 **Carbon:** A naturally abundant nonmetallic element that occurs in many inorganic and in all
15 organic compounds, which exists freely as graphite and diamond and as a constituent of coal,
16 limestone, and petroleum. Carbon is capable of chemical self-bonding to form an enormous
17 number of chemically, biologically, and commercially important molecules. Carbon's atomic
18 number is 6.
19
- 20 **Carbon capture and storage:** Refers to the capture of carbon dioxide generated at fossil-
21 fueled power plants and storing of carbon dioxide so it is not released into the air. Underground
22 storage media are being investigated for this (e.g., abandoned mines, depleted oil or natural
23 gas fields, and other types of geologic media).
24
- 25 **Carbon monoxide (CO):** A colorless, odorless gas formed when carbon in fuel is not burned
26 completely. Motor vehicle exhaust is a major contributor to nationwide CO emissions, followed
27 by other engines and vehicles. CO interferes with the blood's ability to carry oxygen to the
28 body's tissues and results in numerous adverse health effects. CO is listed as a criteria air
29 pollutant under Title I of the Clean Air Act.
30
- 31 **Carbonaceous:** Consisting of, containing, relating to, or yielding carbon.
32
- 33 **Carbon sequestration:** See carbon capture and storage.
34
- 35 **Carcinogenesis:** The process by which normal cells are transformed into cancer cells.
36
- 37 **Cask:** A heavily shielded container used to store and/or ship radioactive materials. Lead and
38 steel are common materials used in the manufacture of casks.
39

1 **Category 1 issue:** Environmental impact issues that meet all of the following criteria: (1) the
2 environmental impacts associated with the issue have been determined to apply either to all
3 nuclear plants or, for some issues, to nuclear plants that have a specific type of cooling system
4 or other specified plant or site characteristics; (2) a single significance level (i.e., small,
5 moderate, or large) has been assigned to the impacts (except for collective offsite radiological
6 impacts from the fuel cycle and from high-level waste and spent fuel disposal); (3) mitigation of
7 adverse impacts associated with the issue has been considered in the analysis, and it has been
8 determined that additional plant-specific mitigation measures are likely not to be sufficiently
9 beneficial to warrant implementation. For issues that meet the three Category 1 criteria, no
10 additional plant-specific analysis is required in future Supplemental Environmental Impact
11 Statements (SEISs) unless new and significant information is identified.

12
13 **Category 2 issue:** Environmental impact issues that do not meet one or more of the criteria of
14 Category 1, and, therefore, additional plant-specific review for these issues is required.

15
16 **Cesium:** A metal that may be stable (nonradioactive) or unstable (radioactive). The most
17 common radioactive form of cesium is cesium-137. Another fairly common radioisotope is
18 cesium-134. Cesium-137 is much more significant as an environmental contaminant than
19 cesium-134.

20
21 **Chain reaction:** A reaction that initiates its own repetition. In a fission chain reaction, a
22 fissionable nucleus absorbs a neutron and fissions spontaneously, releasing additional
23 neutrons. These, in turn, can be absorbed by other fissionable nuclei, releasing still more
24 neutrons. A fission chain reaction is self-sustaining when the number of neutrons released in a
25 given time equals or exceeds the number of neutrons lost by absorption in nonfissionable
26 material or by escape from the system.

27
28 **Chlorinated hydrocarbons:** Organic compounds made up of atoms of carbon, hydrogen, and
29 chlorine. All chlorinated hydrocarbons have a carbon-chlorine bond. Sometimes hydrogen is
30 not present at all, as in carbon tetrachloride (CCl₄). Examples of chlorinated hydrocarbons
31 include dichloro-diphenyl-trichloroethane (DDT) and polychlorinated biphenyls (PCBs).
32 Chlorinated hydrocarbons tend to be very long-lived and persistent in the environment; they
33 tend to be toxic; and they tend to accumulate in the food web and undergo biological
34 amplification.

35
36 **Chronic effects:** Effects resulting from exposure to low levels of a stressing factor
37 (e.g., contaminant, disease, electromagnetic field, noise, and radionuclides) over long periods.

38
39 **Chronic radiation exposure:** Long-term, low-level overexposure to radiation or radioactive
40 materials.

41

Glossary

- 1 **Cladding:** The thin-walled metal tube that forms the outer jacket of a nuclear fuel rod. It
2 prevents corrosion of the fuel by the coolant and the release of fission products into the coolant.
3 Aluminum, stainless steel, and zirconium alloys are common cladding materials.
4
- 5 **Class I areas (Clean Air Act):** Class I areas are Federally owned properties for which air
6 quality-related values are highly prized and for which no diminution of air quality, including
7 visibility, can be tolerated. Class I areas fall under the stewardship of four Federal agencies:
8 the Bureau of Land Management, National Park Service, U.S. Fish and Wildlife Service, and the
9 U.S. Forest Service. Air quality impacts in Class I areas are strictly limited, while restrictions in
10 Class II areas are less strict.
11
- 12 **Class II areas (Clean Air Act):** See Class I areas.
13
- 14 **Class 2B carcinogenic:** Agents (e.g., electromagnetic fields [EMFs]) or substances that are
15 possibly carcinogenic to humans.
16
- 17 **Clean Air Act (CAA):** Establishes national ambient air quality standards and requires
18 facilities to comply with emission limits or reduction limits stipulated in State Implementation
19 Plans (SIPs). Under this act, construction and operating permits, as well as reviews of new
20 stationary sources and major modifications to existing sources, are required. The Act also
21 prohibits the Federal government from approving actions that do not conform to SIPs.
22
- 23 **Clean coal technologies:** Technologies that would allow the continued use of coal (or coal-
24 derived synthetic fuels) for electricity production, while at the same time, mitigating the potential
25 adverse impacts to air quality and guaranteeing compliance with regulatory requirements.
26 Clean coal initiatives include coal-cleaning processes to remove constituents that would
27 ultimately be converted to problematic pollutants during combustion, synthesis of clean
28 derivative fuels through coal gasification technologies, improved combustion technologies, and
29 improved devices, and ancillary support systems for capturing and sequestering pollutants.
30
- 31 **Clean Water Act (CWA):** Act requiring National Pollutant Discharge Elimination System
32 (NPDES) permits for discharges of effluents to surface waters, permits for stormwater
33 discharges related to industrial activity, and notification of oil discharges to navigable waters of
34 the United States.
35
- 36 **Climatology:** The meteorological study of climates and their phenomena.
37
- 38 **Closed-cycle cooling:** In this type of cooling water system, the cooling water is recirculated
39 through the condenser after the waste heat is removed by dissipation to the atmosphere,
40 usually by circulating the water through large cooling towers constructed for that purpose.
41

- 1 **Coal:** A readily combustible black or brownish-black rock whose composition, including
2 inherent moisture, consists of more than 50 percent by weight and more than 70 percent by
3 volume of carbonaceous material. It is formed from plant remains that have been compacted,
4 hardened, chemically altered, and metamorphosed by heat and pressure over geologic time.
5
- 6 **Coal bed methane:** Methane is generated during coal formation and is contained in the coal
7 microstructure. Typical recovery entails pumping water out of the coal to allow the gas to
8 escape. Methane is the principal component of natural gas. Coal bed methane can be added to
9 natural gas pipelines without any special treatment.
10
- 11 **Coal combustion wastes:** Wastes produced from the combustion of coal, which contains
12 concentrated levels of numerous contaminants, particularly metals like arsenic, mercury, lead,
13 chromium, cadmium, and radioactive elements found naturally in coal.
14
- 15 **Coal gasification:** The process of converting coal into gas. The basic process involves
16 crushing coal to a powder, which is then heated in the presence of steam and oxygen to
17 produce a gas. The gas is then refined to reduce sulfur and other impurities. The gas can be
18 used as a fuel or processed further and concentrated into chemical or liquid fuel.
19
- 20 **Coal-producing regions:** *Appalachian Region:* Alabama, Georgia, eastern Kentucky,
21 Maryland, North Carolina, Ohio, Pennsylvania, Tennessee, Virginia, and West Virginia; *Interior*
22 *Region (with Gulf Coast):* Arkansas, Illinois, Indiana, Iowa, Kansas, Louisiana, Michigan,
23 Mississippi, Missouri, Oklahoma, Texas, and western Kentucky; *Western Region:* Alaska,
24 Arizona, Colorado, Montana, New Mexico, North Dakota, Utah, Washington, and Wyoming.
25 *Note:* Some States discontinue producing coal as reserves are depleted or as production
26 becomes uneconomical.
27
- 28 **Coal rank:** The classification of coals according to their degree of progressive alteration
29 from lignite to anthracite. In the United States, the standard ranks of coal include lignite,
30 sub-bituminous coal, bituminous coal, and anthracite, and are based on fixed carbon, volatile
31 matter, heating value, and agglomerating (or caking) properties.
32
- 33 **Coal seam:** A deposit of coal.
34
- 35 **Coal syngas:** Any liquid fuel obtained from coal.
36
- 37 **Coal washing:** The process of removing noncombustible materials, sulfur, mercury, and other
38 contaminants from coal. Coal washing involves grinding the coal into smaller pieces and
39 separating materials according to density. One coal-washing technique involves feeding the
40 coal into barrels that contain a fluid with a density that causes the coal to float, while unwanted
41 material sinks and is removed from the fuel mix.

Glossary

- 1 **Code of Federal Regulations (CFR):** The codification of the general and permanent rules
2 published in the *Federal Register* by the executive departments and agencies of the Federal
3 government. It is divided into 50 titles that represent broad areas subject to Federal regulation.
4 Each volume of the CFR is updated once each calendar year and is issued on a quarterly basis.
5
- 6 **Co-firing:** The process of burning natural gas in conjunction with another fuel to reduce air
7 pollutants.
8
- 9 **Coke:** A solid carbonaceous residue derived from low-ash, low-sulfur bituminous coal from
10 which the volatile constituents are driven off by baking in an oven at temperatures as high as
11 2000°F so that the fixed carbon and residual ash are fused together. Coke is used as a fuel and
12 as a reducing agent in smelting iron ore in a blast furnace. Coke from coal is gray, hard, and
13 porous and has a heating value of 24.8 million Btu per ton.
14
- 15 **Cold shutdown:** The term used to define a reactor coolant system at atmospheric pressure
16 and at a temperature below 200°F following a reactor cooldown.
17
- 18 **Collective dose:** The sum of the individual doses received in a given period by a specified
19 population from exposure to a specified source of radiation.
20
- 21 **Combined cycle:** A technology through which electricity is produced from otherwise lost waste
22 heat exiting from one or more gas (combustion) turbines. The exiting heat is routed to a
23 conventional boiler or to a heat recovery steam generator for utilization by a steam turbine in the
24 production of electricity. This process increases the efficiency of the electric generating unit.
25
- 26 **Combustion:** Chemical oxidation accompanied by the generation of light and heat.
27
- 28 **Committed dose equivalent:** The dose equivalent to organs or tissues of reference that will
29 be received from an intake of radioactive material by an individual during the 50-year period
30 following the intake.
31
- 32 **Compact:** A group of two or more States formed to dispose of low-level radioactive waste on a
33 regional basis. The Low-Level Radioactive Waste Policy Act of 1980 encouraged States to form
34 compacts to ensure continuing low-level waste disposal capacity. As of December 2000,
35 44 States have formed 10 compacts. No compact has successfully sited and constructed a
36 disposal facility.
37

1 **Condenser:** A large heat exchanger designed to cool exhaust steam from a turbine below the
2 boiling point so that it can be returned to the heat source as water. In a pressurized water
3 reactor, the water is returned to the steam generator. In a boiling water reactor, it returns to the
4 reactor core. The heat removed from the steam by the condenser is transferred to a circulating
5 water system and is exhausted to the environment, either through a cooling tower or directly into
6 a body of water.

7
8 **Coniferous:** Of or relating to or part of trees or shrubs bearing cones and evergreen leaves.

9
10 **Containment or reactor building:** The containment or reactor building in a pressurized water
11 reactor (PWR) is a massive concrete or steel structure that houses the reactor vessel, reactor
12 coolant piping and pumps, steam generators, pressurizer, pumps, and associated piping. The
13 reactor building structure of a BWR generally includes a containment structure and a shield
14 building. The BWR containment reactor building is a massive concrete or steel structure that
15 houses the reactor vessel, the reactor coolant piping and pumps, and the suppression pool. It
16 is located inside a somewhat less substantive structure called the shield building. The shield
17 building for a BWR also generally contains the spent fuel pool and the new fuel pool. The
18 reactor building for both PWRs and BWRs is designed to withstand natural disasters, such as
19 hurricanes and earthquakes. The containment's ability to withstand such events and to contain
20 the effects of accidents initiated by system failures constitutes the principal protection against
21 releasing radioactive material to the environment.

22
23 **Cooling pond:** A natural or man-made body of water that is used for dissipating waste heat
24 from power plants.

25
26 **Cooling tower:** Structures designed to remove excess heat from the condenser without
27 dumping the heated cooling water directly into water bodies, such as lakes or rivers. There are
28 two principal types of cooling towers: mechanical draft towers and natural draft towers. Most
29 nuclear plants that have once-through cooling do not rely on cooling towers. However, five
30 facilities with once-through cooling also have cooling towers.

31
32 **Cooling tower drift:** Water lost from a cooling tower in the form of liquid droplets entrained in
33 the exhaust air. Drift is independent of water lost through evaporation. Units may be in lbs/hr or
34 a percentage of circulating water flow. Drift eliminators control this loss from the tower.

35
36 **Cooling-water intake structure:** The structure and any associated constructed waterways
37 used to withdraw cooling water from water bodies. The cooling water intake structure extends
38 from the point at which water is withdrawn from the surface water source to the first intake pump
39 or series of pumps.

Glossary

1 **Corona discharge:** The electrical breakdown of air into charged particles that results in the
2 creation of ions or charged particles in air due to electric field discharge near transmission lines,
3 most noticeable during thunder or rain storms. Corona is a phenomenon associated with all
4 energized transmission lines. It is the electrical breakdown of air into charged particles. The
5 phenomenon appears as a bluish-purple glow on the surface of and adjacent to a conductor
6 when the voltage gradient exceeds a certain critical value, thereby producing light, audible noise
7 (described as crackling or hissing), and ozone.

8
9 **Council on Environmental Quality (CEQ):** Established by the National Environmental Policy
10 Act (NEPA). Council on Environmental Quality regulations (40 CFR Parts 1500–1508) describe
11 the process for implementing NEPA, including preparation of environmental assessments and
12 environmental impact statements, and the timing and extent of public participation.

13
14 **Criteria pollutants:** A group of very common air pollutants whose presence in the environment
15 is regulated by the EPA on the basis of certain criteria (information on health and/or
16 environmental effects of pollution). Criteria air pollutants are widely distributed all over the
17 United States. There are six common air pollutants for which National Ambient Air Quality
18 Standards have been established by the EPA under Title I of the Clean Air Act: sulfur dioxide,
19 nitrogen oxides, carbon monoxide, ozone, particulate matter (PM_{2.5} and PM₁₀), and lead.
20 Standards were developed for these pollutants on the basis of scientific knowledge about their
21 health and environmental effects.

22
23 **Critical habitat:** Specific geographic areas, whether occupied by a listed species or not, that
24 are essential for its conservation and that have been formally designated by rules published in
25 the *Federal Register*.

26
27 **Criticality:** A term used in reactor physics to describe the state when the number of neutrons
28 released by fission is exactly balanced by the neutrons being absorbed (by the fuel and
29 poisons) and escaping the reactor core. A reactor is said to be “critical” when it achieves a
30 self-sustaining nuclear chain reaction, as when the reactor is operating.

31
32 **Crude oil:** A mixture of hydrocarbons that exists in liquid phase in natural underground
33 reservoirs and remains liquid at atmospheric pressure after passing through surface separating
34 facilities. Depending upon the characteristics of the crude stream, it may also include: (1) small
35 amounts of hydrocarbons that exist in the gaseous phase in natural underground reservoirs but
36 are liquid at atmospheric pressure; (2) small amounts of nonhydrocarbons produced with the oil,
37 such as sulfur and various metals, and (3) drip gases and liquid hydrocarbons produced from
38 tar sands, oil sands, gilsonite, and oil shale.

- 1 **Cultural Resources:** The physical remains of past human activities that have historic or
2 cultural meaning. They include archaeological sites (e.g., prehistoric campsites and villages),
3 historic-era resources (e.g., farmsteads, forts, and canals), and traditional cultural properties
4 (e.g., resource collection areas and sacred areas).
5
- 6 **Cumulative dose:** The total dose resulting from repeated or prolonged exposures to ionizing
7 radiation over time.
8
- 9 **Cumulative impacts:** The impacts on the environment that result from the incremental impact
10 of an action when added to other past, present, and reasonably foreseeable future actions,
11 regardless of what agency (Federal or nonfederal) or person undertakes such other actions.
12 See also Impacts significance levels.
13
- 14 **Cumulative risk:** The risk of a common toxic effect associated with concurrent exposure by all
15 relevant pathways and routes of exposure to a group of chemicals that share a common
16 mechanism of toxicity.
17
- 18 **Curie (Ci):** The basic unit used to describe the intensity of radioactivity in a sample of material.
19 The curie is equal to 37 billion (3.7×10^{10}) disintegrations per second, which is approximately
20 the activity of 1 gram of radium. A curie is also a quantity of any radionuclide that decays at a
21 rate of 37 billion disintegrations per second. It is named for Marie and Pierre Curie, who
22 discovered radium in 1898.
23
- 24 **Decibel, A-weighted [dB(A)]:** A standard unit for the measure of the relative loudness or
25 intensity of sound. The relative intensity is the ratio of the intensity of a sound wave to a
26 reference intensity. In general, a sound doubles in loudness with every increase of 10 dB. By
27 convention, the intensity level of sound at the threshold of hearing for a young healthy individual
28 is 0 dB.
29
- 30 **Deciduous:** Trees and shrubs that shed their leaves on an annual cycle.
31
- 32 **Decommissioning:** The process of closing down a facility followed by reducing residual
33 radioactivity to a level that permits the release of the property for unrestricted use or restricted
34 use (see 10 CFR 20.1003).
35
- 36 **DECON:** A method of decommissioning in which the equipment, structures, and portions of a
37 facility and site containing radioactive contaminants are removed and safety buried in a
38 low-level radioactive waste landfill or decontaminated to a level that permits the property to be
39 released for unrestricted use shortly after cessation of operations.
40

Glossary

- 1 **Decontamination:** Removal of unwanted radioactive or hazardous contamination by a
2 chemical or mechanical process.
3
- 4 **Deep-dose equivalent:** The dose equivalent at a tissue depth of 1 cm; applies to external
5 whole-body exposure.
6
- 7 **Demand-side management (DSM):** The planning, implementation, and monitoring of utility
8 activities designed to encourage consumers to modify patterns of electricity usage, including the
9 timing and level of electricity demand. It only refers to energy and load-shape modifying
10 activities that are undertaken in response to utility-administered programs. It does not refer to
11 energy and load-shaped changes arising from the normal operation of the marketplace or from
12 government-mandated energy-efficiency standards. DSM covers the complete range of
13 load-shape objectives, including strategic conservation and load management, as well as
14 strategic load growth.
15
- 16 **Demographics:** A term used to describe specific population characteristics such as age,
17 gender, education, and income level.
18
- 19 **Densitometer:** An apparatus for measuring the optical density of a material, such as a
20 photographic negative.
21
- 22 **Depleted uranium:** Uranium having a percentage of uranium-235 smaller than the 0.7 percent
23 found in natural uranium. It results from uranium isotope enrichment operations.
24
- 25 **Deposition:** The laying down of matter by a natural process (e.g., the settling of particulate
26 matter out of air or water onto soil or sediment surfaces).
27
- 28 **Design-basis accident:** A postulated accident that a nuclear facility must be designed and
29 built to withstand without loss to the systems, structures, and components necessary to ensure
30 public health and safety.
31
- 32 **Desquamation:** To shed, peel, or come off in scales.
33
- 34 **Detritus:** Dead, decaying plant material.
35
- 36 **Dewatering:** To remove or drain water from an area.
37
- 38 **Dielectric:** A nonconductor of electricity.
39
- 40 **Diesel generator:** An electric generator that runs on diesel fuel.
41

- 1 **Diffusion:** A process in which substances are transported from one area to another due to
2 differences in the concentration of that material or in temperature.
3
- 4 **Disposal:** The act of placing unwanted materials in an area with the intent of not recovering in
5 the future.
6
- 7 **Dissolved gas:** Gas dissolved in water or in other liquid without change in its chemical
8 structure.
9
- 10 **Dissolved oxygen:** Oxygen dissolved in water. Dissolved oxygen is necessary for the life of
11 fish and most other aquatic organisms, and is one of the most important indicators of the
12 condition of a water body.
13
- 14 **DNA (deoxyribonucleic acid):** One of two types of molecules that encode genetic information
15 (the other is ribonucleic acid [RNA]). In humans, DNA is the genetic material, and RNA is
16 transcribed from it. In some other organisms, RNA is the genetic material and, in reverse
17 fashion, the DNA is transcribed from it.
18
- 19 **Dose:** The absorbed dose, given in rads (or in SI units, grays), that represents the energy
20 absorbed from the radiation in a gram of any material. The biological dose or dose equivalent,
21 given in rem or sieverts, is a measure of the biological damage to living tissue from radiation
22 exposure.
23
- 24 **Dose equivalent:** The product of the absorbed dose in tissue, quality factor, and all other
25 modifying factors at the location of interest. The units of dose equivalent are the rem and
26 sievert (Sv).
27
- 28 **Dose rates:** The ionizing radiation dose delivered per unit of time (e.g., rem or sieverts per
29 hour).
30
- 31 **Dosimeter:** A small, portable instrument (such as a film badge or thermoluminescent or pocket
32 dosimeter) for measuring and recording the total accumulated personal dose of ionizing
33 radiation.
34
- 35 **Dredging:** Removing accumulated sediments from a water body to increase depth or remove
36 contaminants.
37
- 38 **Dry cask:** Large, rugged container made of steel or steel-reinforced concrete, 18 or more
39 inches thick. A cask uses materials like steel, concrete and lead – instead of water – as a
40 radiation shield. Depending on the design, a dry cask can hold from 7 to 56 twelve-foot-long
41 fuel assemblies.

Glossary

- 1 **Dry cask storage:** A method for storing spent nuclear fuel (see dry cask).
2
- 3 **Dry steam:** Geothermal plants that use the steam from the geothermal reservoir as it comes
4 from wells, and route it directly through turbine/generator units to produce electricity.
5
- 6 **Dual-fired unit:** A generating unit that can produce electricity using two or more input fuels. In
7 some of these units, only the primary fuel can be used continuously; the alternate fuel(s) can be
8 used only as a start-up fuel or in emergencies.
9
- 10 **Ecoregion:** A geographically distinct area of land that is characterized by a distinctive climate,
11 ecological features, and plant and animal communities.
12
- 13 **Ecosystem:** A group of organisms and their physical environment interacting and functioning
14 as a unit.
15
- 16 **Effective dose equivalent:** The sum of the products of the dose equivalent to the organ or
17 tissue and the weighting factors applicable to each of the body organs or tissues that are
18 irradiated.
19
- 20 **Effluent:** Wastewater (treated or untreated) that flows out of a treatment plant, sewer, or
21 industrial outfall. This term generally refers to wastes discharged into surface waters.
22
- 23 **Electric power:** The rate at which electric energy is transferred. Electric power is measured by
24 capacity and is commonly expressed in megawatts (MW).
25
- 26 **Electric power grid:** A system of synchronized power providers and consumers connected by
27 transmission and distribution lines and operated by one or more control centers. In the
28 continental United States, the electric power grid consists of three systems: the Eastern
29 Interconnect, the Western Interconnect, and the Texas Interconnect. In Alaska and Hawaii,
30 several systems encompass areas smaller than the State (e.g., the interconnect serving
31 Anchorage, Fairbanks, and the Kenai Peninsula).
32
- 33 **Electricity:** A form of energy characterized by the presence and motion of elementary charged
34 particles generated by friction, induction, or chemical change.
35
- 36 **Electricity generation:** The process of producing electric energy or the amount of electric
37 energy produced by transforming other forms of energy, commonly expressed in kilowatt
38 hours (kWh) or megawatt hours (MWh).
39

1 **Electromagnetic fields:** The field of energy resulting from the movement of alternating electric
2 current (AC) along the path of a conductor, composed of both electrical and magnetic
3 components and existing in the immediate vicinity of, and surrounding, the electric conductor.
4 Electromagnetic fields exist in both high-voltage electric transmission power lines and in
5 low-voltage electric conductors in homes and appliances.
6

7 **Electromagnetic radiation:** A traveling wave motion resulting from changing electric or
8 magnetic fields. Familiar electromagnetic radiation ranges from x-rays (and gamma rays) of
9 short wavelength, through the ultraviolet, visible, and infrared regions, to radar and radio waves
10 of relatively long wavelength.
11

12 **Endangered species:** Any species, plant or animal, that is in danger of extinction throughout
13 all or a significant part of its range. Requirements for declaring a species endangered are found
14 in the Endangered Species Act.
15

16 **Endangered Species Act of 1973 (ESA):** Requires consultation with the U.S. Fish and Wildlife
17 Service and/or the National Marine Fisheries Service to determine whether endangered or
18 threatened species or their habitats will be affected by a proposed activity and what, if any,
19 mitigation measures are needed to address the impacts.
20

21 **Energy:** The capacity for doing work as measured by the capability of doing work (potential
22 energy) or the conversion of this capability to motion (kinetic energy). Energy has several
23 forms, some of which are easily convertible and can be changed to another form useful for
24 work. Most of the world's convertible energy comes from fossil fuels that are burned to produce
25 heat that is then used as a transfer medium to mechanical or other means in order to
26 accomplish tasks. Electrical energy is usually measured in kilowatt hours, while heat energy is
27 usually measured in British thermal units (Btu).
28

29 **Energy demand:** The energy needed by consumers at any point in time for household,
30 business, or industrial purposes.
31

32 **Energy Information Administration (EIA):** An independent agency within the
33 U.S. Department of Energy (DOE) that develops surveys, collects energy data, and analyzes
34 and models energy issues. The EIA must meet (1) the requests of Congress, other elements
35 within the DOE, Federal Energy Regulatory Commission, and Executive Branch; (2) its own
36 independent needs; and (3) assist the general public or other interest groups, without taking a
37 policy position.
38

39 **Energy supply:** Energy made available for use. Supply can be considered and measured
40 from the point of view of the energy provider or the receiver.
41

Glossary

- 1 **ENTOMB:** A method of decommissioning nuclear facilities in which radioactive contaminants
2 are encased in a structurally long-lived material, such as concrete. The entombment structure
3 is appropriately maintained and continued surveillance is carried out until the radioactivity
4 decays to a level permitting unrestricted release of the property.
5
- 6 **Entrainment:** The incorporation of fish, eggs, larvae, and other plankton with intake water-flow
7 entering and passing through a cooling water intake structure and into a cooling water system.
8
- 9 **Environmental Assessment: (EA):** A concise public document that a Federal agency
10 prepares under the National Environmental Policy Act to provide sufficient evidence and
11 analysis to determine whether a proposed action requires preparation of an environmental
12 impact statement or whether a Finding of No Significant Impact can be issued. An EA must
13 include brief discussions on the need for the proposal, the alternatives, and the environmental
14 impacts of the proposed action and alternatives.
15
- 16 **Environmental Impact Statement (EIS):** A document required of Federal agencies by the
17 National Environmental Policy Act for major proposals or legislation that will or could
18 significantly affect the environment.
19
- 20 **Environmental Justice:** The fair treatment of people of all races, cultures, incomes, and
21 educational levels with respect to the development, implementation, and enforcement of
22 environmental laws, regulations, and policies.
23
- 24 **Erythema:** Superficial reddening of the skin due to the dilatation of blood vessels. Erythema is
25 often a sign of infection or inflammation.
26
- 27 **Essential Fish Habitat (EFH):** Those waters and substrates necessary to fish for spawning,
28 breeding, feeding or growth to maturity. EFH is protected under the Magnuson-Stevens Fishery
29 Conservation and Management Act of 1976.
30
- 31 **Estuary:** A transitional zone along the coastline where ocean saltwater mixes with freshwater
32 from the land, subject to tidal influences. Estuaries are often semi-enclosed by land, but their
33 currents always have access to the open ocean.
34
- 35 **Eutrophication:** A condition in an aquatic ecosystem where high nutrient concentrations
36 stimulate blooms of algae (e.g., phytoplankton). Algal decomposition may lower dissolved
37 oxygen concentrations. Although eutrophication is a natural process in the aging of lakes and
38 some estuaries, it can be accelerated by both point and nonpoint sources of nutrients.
39

- 1 **Exceedance probability:** The average frequency with which an event (e.g., flood) of a
2 particular magnitude will be exceeded during a certain length of time. Expressed as the
3 probability that a level will be exceeded in any year (the annual exceedance probability) or as
4 the average recurrence interval (e.g, a 100-year flood).
5
- 6 **Exposure:** Being exposed to ionizing radiation, radioactive material, or other contaminants.
7
- 8 **External dose:** That portion of the dose equivalent received from radiation sources outside the
9 body.
10
- 11 **Fecundity:** Number of eggs an animal produces during each reproductive cycle; the potential
12 reproductive capacity of an organism or population.
13
- 14 **Federal Energy Regulatory Commission (FERC):** Independent Federal agency with
15 jurisdiction over interstate electricity sales, wholesale electric rates, hydroelectric licensing,
16 natural gas pricing, and oil pipeline rates.
17
- 18 **Federal Register:** The official daily publication for rules, proposed rules, and notices of Federal
19 agencies and organizations, as well as Executive Orders and other presidential documents.
20
- 21 **Film badge:** Photographic film used to measure ionizing radiation exposure for personnel
22 monitoring purposes. The film badge may contain two or three films of differing sensitivities,
23 and it may also contain a filter that shields part of the film from certain types of radiation.
24
- 25 **Fission:** The splitting of a nucleus into at least two other nuclei and the release of a relatively
26 large amount of energy. Two or three neutrons are usually released during this type of
27 transformation.
28
- 29 **Fission products:** The radioactive isotopes formed by the fission of heavy elements.
30
- 31 **Floodplain:** Low lands adjoining the channel of a river, stream, or watercourse; or ocean, lake,
32 or other body of water, which have been or may be inundated by flood water, and those other
33 areas subject to flooding.
34
- 35 **Flue gas:** The air coming out of a chimney after combustion in the burner it is venting. It can
36 include nitrogen oxides, carbon oxides, water vapor, sulfur oxides, particles, and many chemical
37 pollutants.
38
39

Glossary

- 1 **Flue gas desulfurization:** Equipment (also referred to as scrubbers) used to remove sulfur
2 oxides from the combustion gases of a boiler plant before discharge to the atmosphere.
3 Chemicals such as lime are used as scrubbing media.
4
- 5 **Fluidized-bed combustion:** A method of burning particulate fuel, such as coal, in which the
6 amount of air required for combustion far exceeds that found in conventional burners. The fuel
7 particles are continually fed into a bed of mineral ash in the proportions of 1 part fuel to
8 200 parts ash, while a flow of air passes up through the bed, causing it to act like a turbulent
9 fluid.
10
- 11 **Fossil fuel:** Fuel derived from ancient organic remains such as peat, coal, crude oil, and
12 natural gas.
13
- 14 **Fossil fuel plant:** A plant using coal, petroleum, or gas as its source of energy.
15
- 16 **Fossil-fuel electric (power) generation:** Electric generation in which the prime mover is a
17 turbine rotated by high-pressure steam produced in a boiler by heat from burning fossil fuels.
18
- 19 **Fuel:** Any material substance that can be consumed to supply heat or power. Includes
20 petroleum, coal, and natural gas (the fossil fuels), and other consumable materials, such as
21 uranium, biomass, and hydrogen.
22
- 23 **Fuel assembly:** A cluster of fuel rods (or plates) that are also called fuel pins or fuel elements.
24 Many fuel assemblies make up a reactor core.
25
- 26 **Fuel cladding:** See cladding.
27
- 28 **Fuel cycle:** The entire set of sequential processes or stages involved in the utilization of fuel,
29 including extraction, transformation, transportation, and combustion. Emissions generally occur
30 at each stage of the fuel cycle.
31
- 32 **Fuel oil:** A liquid petroleum product less volatile than gasoline, used as an energy source. Fuel
33 oil includes distillate fuel oil (No. 1, No. 2, and No. 4), and residual fuel oil (No. 5 and No. 6).
34
- 35 **Fuel pellets:** As used in pressurized water reactors and boiling water reactors, a pellet is a
36 small cylinder approximately 3/8-in. in diameter and 5/8-inch in length, consisting of uranium
37 fuel in a ceramic form – uranium dioxide (UO₂). Typical fuel pellet enrichments in nuclear power
38 reactors range from 2.0 percent to 3.5 percent uranium-235.
39

- 1 **Fuel rod:** A long, slender tube that holds fissionable material (fuel) for nuclear reactor use.
2 Fuel rods are assembled into bundles called fuel elements or fuel assemblies, which are loaded
3 individually into the reactor core.
4
- 5 **Fugitive dust:** Particulate air pollution released to the ambient air from ground-disturbing
6 activities related to construction, manufacturing, or transportation (i.e., the discharges are not
7 released through a confined stream such as a stack, chimney, vent, or other functionally
8 equivalent opening). Specific activities that generate fugitive dust include, but are not limited to,
9 land-clearing operations, travel of vehicles on disturbed land or unpaved access roads, or onsite
10 roads.
11
- 12 **Fugitive emissions:** Unintended leaks of gas from vessels, pipes, valves, or fittings used in
13 the processing, transmission, and/or transportation of liquids or gases. These emissions can
14 include the release of volatile vapors from a diesel fuel, natural gas, or solvent leak.
15
- 16 **Fujita Scale:** Classifies tornadoes based on wind damage. The scale ranges from F0 for the
17 weakest to F5 for the strongest tornadoes.
18
- 19 **Gamma rays:** High-energy, short wavelength, electromagnetic radiation emitted from the
20 nucleus of an atom. Gamma radiation frequently accompanies alpha and beta emissions and
21 always accompanies fission. Gamma rays are very penetrating and are best stopped or
22 shielded by dense materials, such as lead or depleted uranium. Gamma rays are similar to
23 x-rays. See also X-rays and gamma rays.
24
- 25 **Gas bubble disease:** A condition that occurs when aquatic organisms are exposed to water
26 with high partial pressures of certain gases (usually nitrogen) and then subsequently are
27 exposed to water with lower partial pressures of the same gases. Dissolved gas (especially
28 nitrogen) within the tissues comes out of solution and forms embolisms (bubbles) within the
29 affected tissues, most noticeably the eyes and fins.
30
- 31 **Gas supersaturation:** Concentrations of dissolved gases in water that are above the normal
32 saturation limit.
33
- 34 **Gas turbine:** A gas turbine consists typically of an axial-flow air compressor and one or more
35 combustion chambers where liquid or gaseous fuel is burned and the hot gases are passed to
36 the turbine, and where the hot gases expand, drive the generator, and are then used to run the
37 compressor.
38
- 39 **Gasification:** A method for converting coal, petroleum, biomass, wastes, or other
40 carbon-containing materials into a gas that can be (1) burned to generate power or
41 (2) processed into chemicals and fuels.

Glossary

- 1 **Generator capacity:** The maximum output, commonly expressed in megawatts (MW), that
2 generating equipment can supply to system load, adjusted for ambient conditions.
3
- 4 **Generic Environmental Impact Statement (GEIS):** A GEIS assesses the scope and impact of
5 environmental effects that would be associated with an action at numerous sites.
6
- 7 **Geologic repository:** A deep underground engineered facility used to permanently isolate
8 used nuclear fuel or high-level nuclear waste while its radioactivity decays safely.
9
- 10 **Geology:** The study of the materials, processes, environments, and history of the earth,
11 including rocks and their formations and structures.
12
- 13 **Geothermal energy:** Hot water or steam extracted from geothermal reservoirs in the earth's
14 crust. Water or steam extracted from geothermal reservoirs can be used for geothermal heat
15 pumps, water heating, or electricity generation.
16
- 17 **Geothermal plant:** A plant in which the prime mover is a steam turbine driven either by steam
18 produced from hot water or by natural steam that derives its energy from heat found in rock.
19
- 20 **Global warming:** An increase in the near-surface temperature of the earth. Global warming
21 has occurred in the distant past as the result of natural influences, but the term is today most
22 often used to refer to the warming many scientists predict will occur as a result of increased
23 anthropogenic emissions of greenhouse gases.
24
- 25 **Global warming potential (GWP):** An index used to compare the relative radiative forcing per
26 unit molecule or unit mass change for varied greenhouse gases of different gases without
27 directly calculating the changes in atmospheric concentrations. The GWPs of a particular
28 greenhouse gas are calculated as a time-integrated ratio of the radiative or climate forcing that
29 would result from the emission of one kilogram of that greenhouse gas to that resulting from the
30 emission of one kilogram of carbon dioxide over a fixed period of time, such as 100 years.
31
- 32 **Gonads:** Male and female sex organs (ovaries and testes).
33
- 34 **Graphite:** Pure carbon in mineral form. Technically, graphite at 100 percent carbon is the
35 highest rank of coal. However, its relatively limited availability and physical characteristics and
36 chemical characteristics have limited its use as an energy source. Instead, it is used primarily in
37 lubricants.
38
- 39 **Gray:** The international system (SI) unit of absorbed dose. One gray is equal to an absorbed
40 dose of 1 Joule/kilogram (one gray equals 100 rads) (see 10 CFR 20.1004).
41

- 1 **Greater-than-Class C Waste (GTCC):** GTCC waste means low-level radioactive waste that
2 exceeds the concentration limits of radionuclides established for Class C waste
3 in 10 CFR 61.55.
4
- 5 **Greenfield site:** Vacant land that has never been developed or was formerly occupied by
6 farms or low-density development that left the land free of environmental contamination.
7 Greenfield sites are typically located in suburban or ex-urban areas and can be less costly to
8 develop than the brownfield sites that are often located in urban areas.
9
- 10 **Greenhouse gases:** Those gases, such as water vapor, carbon dioxide, nitrous oxide,
11 methane, hydrofluorocarbons (HFCs), perfluorocarbons (PFCs), and sulfur hexafluoride, that
12 are transparent to solar (short-wave) radiation but opaque to long-wave (infrared) radiation, thus
13 preventing long-wave radiant energy from leaving the earth's atmosphere. The net effect is a
14 trapping of absorbed radiation and a tendency to warm the planet's surface.
15
- 16 **Grid:** See electric power grid.
17
- 18 **Gross generation:** The total amount of electric energy produced by generating units and
19 measured at the generating terminal in kilowatt hours (kWh) or megawatt hours (MWh).
20
- 21 **Groundwater:** The water found beneath the earth's surface, usually in porous rock formations
22 (aquifers), which may supply wells and springs. Generally, it refers to all water contained in the
23 ground.
24
- 25 **Habitat:** The place, including physical and biotic conditions, where a plant or animal lives.
26
- 27 **Half-life:** The time in which one-half of the atoms of a particular radioactive substance
28 disintegrate into another nuclear form. Measured half-lives vary from millionths of a second to
29 billions of years. Also called physical or radiological half-life.
30
- 31 **Hazardous air pollutants (HAPs):** Air pollutants that are not covered by ambient air quality
32 standards but which, as defined in the Clean Air Act, may present a threat of adverse human
33 health effects or adverse environmental effects. Such pollutants include asbestos, beryllium,
34 mercury, benzene, coke oven emissions, radionuclides, and vinyl chloride.
35
- 36 **Hazardous waste:** A solid waste or combination of solid wastes that, because of its quantity,
37 concentration, or physical, chemical, or infectious characteristics, may (1) cause or significantly
38 contribute to an increase in mortality or an increase in serious irreversible or incapacitating
39 reversible illness or (2) pose a substantial present or potential hazard to human health or the
40 environment when improperly treated, stored, transported, disposed of, or otherwise managed
41 (as defined in the Resource Conservation and Recovery Act, as amended, Public Law 94-580).

Glossary

- 1 **Heat sink:** Anything that absorbs heat. It is usually part of the environment, such as the air, a
2 river, or a lake.
3
- 4 **Heavy metals:** Metallic elements with higher atomic weights, many of which are toxic at higher
5 concentrations. Examples are mercury, chromium, cadmium, and lead.
6
- 7 **High-level waste (HLW):** The highly radioactive material resulting from the reprocessing of
8 spent nuclear fuel. If not reprocessed, the spent nuclear fuel is also considered high-level
9 waste.
10
- 11 **Horizontal axis wind turbine:** The most common type of wind turbine, in which the axis of
12 rotation is oriented horizontally.
13
- 14 **Hydrocarbons:** Any compound or mix of compounds, solids, liquids, or gases, composed of
15 carbon and hydrogen (e.g., coal, crude oil, and natural gas).
16
- 17 **Hydrochlorofluorocarbons (HCFCs):** Chemicals composed of one or more carbon atoms and
18 varying numbers of hydrogen, chlorine, and fluorine atoms.
19
- 20 **Hydroelectric power:** The use of flowing water to produce electrical energy.
21
- 22 **Hydrofluorocarbons (HFCs):** A group of man-made chemicals composed of one or two
23 carbon atoms and varying numbers of hydrogen and fluorine atoms. Most HFCs have 100-year
24 Global Warming Potentials in the thousands.
25
- 26 **Hydrology:** The study of water that considers its occurrence, properties distribution, circulation,
27 and transport and includes groundwater, surface water, and rainfall.
28
- 29 **IGCC:** See Integrated Gasification Combined Cycle technology.
30
- 31 **Impacting factors:** The mechanisms by which an action affects a given resource or receptor.
32
- 33 **Impingement:** The entrapment of aquatic organisms on the outer part of an intake structure or
34 against a screening device during periods of intake water withdrawal.
35
- 36 **IMPLAN:** Input-output economic models based on economic accounts showing the flow of
37 commodities to industries from producers and institutional consumers. The accounts also show
38 consumption activities by workers, owners of capital, and imports from outside the region.
39
- 40 **Impulse turbine:** A turbine that is driven by high-velocity jets of water or steam from a nozzle
41 directed onto vanes or buckets attached to a wheel.

1 **Independent spent fuel storage installation (ISFSI):** An ISFSI is designed and constructed
2 for the interim storage of spent nuclear fuel and other radioactive materials associated with
3 spent fuel storage. ISFSIs may be located at the site of a nuclear power plant or at another
4 location. The most common design for an ISFSI, at this time, is a concrete pad with dry casks
5 containing spent fuel bundles. ISFSIs are used by operating plants that require increased spent
6 fuel storage capability because their spent fuel pools have reached capacity

7

8 **In situ:** In its original place.

9

10 **Integrated Gasification Combined Cycle (IGCC) technology:** An energy generation
11 technology in which coal, water, and oxygen are fed to a gasifier, which produces syngas. This
12 medium-Btu gas is cleaned (particulates and sulfur compounds removed) and fed to a gas
13 turbine. The hot exhaust of the gas turbine and heat recovered from the gasification process is
14 routed through a heat-recovery generator to produce steam, which drives a steam turbine to
15 produce electricity.

16

17 **Internal dose:** That portion of the dose equivalent received from radioactive material taken into
18 the body.

19

20 **Ionizing radiation:** Any radiation capable of displacing electrons from atoms or molecules,
21 thereby producing ions. Some examples are alpha, beta, gamma, x-rays, neutrons, and
22 ultraviolet light. High doses of ionizing radiation may produce severe skin or tissue damage.

23

24 **Isotopic enrichment:** A process by which the relative abundance of the isotopes of a given
25 element are altered, thus producing a form of the element that has been enriched in one
26 particular isotope and depleted in its other isotopic forms.

27

28 **Landfill gas:** Gas that is generated by decomposition of organic material at landfill disposal
29 sites. The average composition of landfill gas is approximately 50 percent methane and
30 50 percent carbon dioxide and water vapor by volume. The methane percentage, however, can
31 vary from 40 to 60 percent, depending on several factors including waste composition
32 (e.g., carbohydrate and cellulose content). The methane in landfill gas may be vented, flared, or
33 combusted to generate electricity or heat, or injected into a pipeline for combustion elsewhere.

34

35 **Leachate:** The liquid that has percolated through the soil or other medium.

36

37 **License renewal:** Renewal of the operating license of a nuclear power plant.

38

39

Glossary

- 1 **License renewal term:** That period of time past the original or current license term for which
2 the renewed license is in force. Although the length of license renewal terms can vary, they
3 cannot exceed 20 years.
4
- 5 **Licensee:** The entity (usually an energy company) that holds the license to operate a nuclear
6 power plant.
7
- 8 **Light water reactors (LWRs):** Reactors that use ordinary water as coolant, including BWRs
9 and PWRs, the most common types used in the United States.
10
- 11 **Lignite coal:** Also referred to as brown coal, it is the youngest and lowest rank coal with
12 respect to its value as an energy source. Lignite coal deposits are relatively young and have
13 not experienced extremes of heat and pressure as have higher ranks of coal. On average,
14 lignite coals contain 25–35 percent by weight carbon. They represent about 7 percent of the
15 U.S. annual coal production and are used primarily to produce electricity.
16
- 17 **Load shape:** A method of describing peak load demand and the relationship of power supplied
18 to the time of occurrence.
19
- 20 **Lower limit of detection (LLD):** The lowest limit that a detector can measure.
21
- 22 **Lowest-observed-effects-level (LOEL):** The lowest exposure level at which there are
23 statistically or biologically significant increases in frequency or severity of an effect between the
24 exposed population and its appropriate control group.
25
- 26 **Low-income populations:** Persons whose average family income is below the poverty line.
27 The poverty line takes into account family size and age of individuals in the family. In 1999, the
28 poverty line for a family of five with three children below the age of 18 was \$19,882. For any
29 family below the poverty line, all family members are considered to be below the poverty line.
30
- 31 **Low-level radioactive waste (LLW):** A general term for a wide range of wastes having low
32 levels of radioactivity. Nuclear fuel cycle facilities (e.g., nuclear power reactors and fuel
33 fabrication plants) that use radioactive materials generate low-level wastes as part of their
34 normal operations. These wastes are generated in many physical and chemical forms and
35 levels of contamination (see 10 CFR 61.2). Low-level radioactive wastes containing source,
36 special nuclear, or by-product material are acceptable for disposal in a land disposal facility.
37 For the purposes of this definition, low-level waste has the same meaning as in the Low-Level
38 Radioactive Waste Policy Act, that is, radioactive waste not classified as high-level radioactive
39 waste, transuranic waste, spent nuclear fuel, or by-product material as defined in
40 Section 11e.(2) of the Atomic Energy Act (uranium or thorium tailings and waste).

- 1 **Macroinvertebrates:** Nonplanktonic, aquatic invertebrates, including insects, crustaceans,
2 mollusks, and worms, which typically inhabit the bottom sediments of rivers, ponds, lakes,
3 wetlands, or oceans. Their abundance and diversity are often used as an indicator of
4 ecosystem health.
5
- 6 **Maintenance areas:** Regions that were initially designated as nonattainment or unclassifiable
7 and have since attained compliance with the National Ambient Air Quality Standards. The
8 Clean Air Act outlines several conditions that must be met before an area can be reclassified
9 from nonattainment to an attainment maintenance area, one of which is the development and
10 EPA approval of a maintenance plan.
11
- 12 **Man-rem:** See person-rem.
13
- 14 **Marine:** Of or pertaining to ocean environments.
15
- 16 **Maximally exposed individual (MEI):** A hypothetical individual who, because of proximity,
17 activities, or living habits, could potentially receive the maximum possible dose of radiation or of
18 a hazardous chemical from a given event or process.
19
- 20 **Maximum Achievable Control Technology (MACT):** The emission standard for sources of air
21 pollution requiring the maximum reduction of hazardous emissions, taking cost and feasibility
22 into account. Under the Clean Air Act Amendments of 1990, the MACT must not be less than
23 the average emission level achieved by controls on the best performing 12 percent of existing
24 sources, by category of industrial and utility sources.
25
- 26 **Mechanical draft tower:** Cooling tower system that sprays heated cooling water downward,
27 while large fans pull air across the dropping water to remove the heat. As the water drops
28 downward onto the slats in the cooling tower, the drops break up into a finer spray, and, thus,
29 facilitate cooling.
30
- 31 **Methane:** A colorless, flammable, odorless hydrocarbon gas (CH₄), which is the major
32 component of natural gas. Methane is an important source of hydrogen in various industrial
33 processes. Methane is a greenhouse gas.
34
- 35 **Methyl tertiary butyl ether (MTBE):** A gasoline additive, an oxygenate produced by reacting
36 methanol with isobutylene.
37
- 38 **Microorganism:** An organism that can be seen only through a microscope. Microorganisms
39 include bacteria, protozoa, algae, and fungi.
40

Glossary

- 1 **Minority populations:** Include American Indian or Alaskan Native; Asian; Native Hawaiian or
2 other Pacific Islander; Black races; or people of Hispanic ethnicity. "Other" races and multiracial
3 individuals may be considered as separate minorities.
4
- 5 **Mitigation:** A method or process by which impacts from actions can be made less injurious to
6 the environment through appropriate protective measures.
7
- 8 **Mixed waste:** Waste that contains both radioactive and hazardous constituents.
9
- 10 **Motile:** Moving or having the power to move.
11
- 12 **Municipal solid waste (MSW):** Residential solid waste and some nonhazardous commercial,
13 institutional, and industrial wastes.
14
- 15 **National Ambient Air Quality Standards (NAAQS):** Air quality standards established by the
16 Clean Air Act, as amended. The primary NAAQS specify maximum outdoor air concentrations of
17 criteria pollutants that would protect the public health within an adequate margin of safety. The
18 secondary NAAQS specify maximum concentrations that would protect the public welfare from
19 any known or anticipated adverse effects of a pollutant.
20
- 21 **National Environmental Policy Act of 1969 (NEPA):** Act requiring Federal agencies to
22 prepare a detailed statement on the environmental impacts of their proposed major actions that
23 may significantly affect the quality of the human environment.
24
- 25 **National Historic Preservation Act (NHPA) of 1966, as amended:** The primary law that
26 addresses the impacts of Federal undertakings on archaeological or historic resources.
27 Undertakings are defined in the NHPA as any project or activity that is funded or under the
28 direct jurisdiction of a Federal agency, or any project or activity that requires a Federal permit,
29 license, or approval.
30
- 31 **National Pollutant Discharge Elimination System (NPDES):** A Federal and State permitting
32 system controlling the discharge of effluents to surface water and regulated through the Clean
33 Water Act, as amended.
34
- 35 **Native American Graves Protection and Repatriation Act:** This act established the priority
36 for ownership or control of Native American cultural items excavated or discovered on Federal
37 or Tribal land after 1990 and the procedures for repatriation of items in Federal possession.
38 The act allows the intentional removal from or excavation of Native American cultural items from
39 Federal or Tribal lands only with a permit or upon consultation with the appropriate Tribe.
40

- 1 **Natural-draft cooling towers:** Natural-draft cooling towers use the differential pressure
2 between the relatively cold outside air and the hot humid air on the inside of the tower as the
3 driving force to move and cool water without the use of fans.
4
- 5 **Natural gas:** A gaseous mixture of hydrocarbon compounds, the primary one being methane.
6
- 7 **Natural Gas Combined Cycle (NGCC) technology:** An advanced power generation
8 technology that improves the fuel efficiency of natural gas. Most new gas power plants in
9 North America and Europe use NGCC technology.
10
- 11 **Natural gas liquids (NGL):** Those hydrocarbons in natural gas that are separated from the gas
12 as liquids through the process of absorption, condensation, adsorption, or other methods in gas
13 processing or cycling plants. Generally such liquids consist of propane and heavier
14 hydrocarbons and are commonly referred to as lease condensate, natural gasoline, and
15 liquefied petroleum gases. Natural gas liquids include natural gas plant liquids (primarily
16 ethane, propane, butane, and isobutene).
17
- 18 **Naturally occurring radioactive materials (NORM):** Radioactive materials that are found in
19 nature.
20
- 21 **Neutron:** An uncharged elementary particle, with a mass slightly greater than that of the
22 proton, found in the nucleus of every atom heavier than hydrogen.
23
- 24 **NGCC:** See Natural Gas Combined Cycle.
25
- 26 **Nitrogen oxides (NO_x):** Nitrogen oxides include various nitrogen compounds, primarily
27 nitrogen dioxide and nitric oxide. They form when fossil fuels are burned at high temperatures
28 and react with volatile organic compounds to form ozone, the main component of urban smog.
29 They are also a precursor pollutant that contributes to the formation of acid rain. Nitrogen oxides
30 are among the six criteria air pollutants specified under Title I of the Clean Air Act.
31
- 32 **No-Action Alternative:** For this GEIS, the no-action alternative represents a decision by the
33 Nuclear Regulatory Commission to not allow for continued operation of nuclear power plants
34 beyond the current operating license terms. All plants eventually would be required to shut
35 down and undergo decommissioning. Under the no-action alternative, these eventualities would
36 occur sooner rather than later.
37
- 38 **Noble gases:** A gaseous chemical element that does not readily enter into chemical
39 combination with other elements. Examples are helium, argon, krypton, xenon, and radon.
40

Glossary

- 1 **Noise:** Unwanted sound; a subjective term reflective of societal values regarding what
2 constitutes unwanted or undesirable intrusions of sound.
3
- 4 **Nonattainment:** Any area that does not meet the national primary or secondary ambient air
5 quality standard established by the Environmental Protection Agency for designated pollutants,
6 such as carbon monoxide and ozone.
7
- 8 **Nonradioactive nonhazardous waste:** Waste that is neither radioactive nor hazardous.
9
- 10 **Nonrenewable fuels:** Fuels that cannot be easily made or “renewed,” such as oil, natural gas,
11 and coal.
12
- 13 **Nonrenewable waste fuels:** Municipal solid wastes from nonbiogenic sources and tire-derived
14 fuels.
15
- 16 **Nonstochastic effect:** Health effects, the severity of which varies with the dose and for which
17 a threshold is believed to exist. Radiation-induced cataract formation is an example of a
18 nonstochastic effect (also called a deterministic effect).
19
- 20 **North American Electric Reliability Council (NERC):** A council formed in 1968 by the electric
21 utility industry to promote the reliability and adequacy of bulk power supply in the electric utility
22 systems of North America. NERC consists of regional reliability councils and encompasses
23 essentially all the power regions of the contiguous United States, Canada, and Mexico.
24
- 25 **North American Industry Classification System (NAICS):** A coding system developed jointly
26 by the United States, Canada, and Mexico to classify businesses and industries according to
27 the type of economic activity in which they are engaged. NAICS replaces the Standard Industrial
28 Classification (SIC) codes.
29
- 30 **Nuclear fuel:** Fuel that produces energy in a nuclear reactor through the process of nuclear
31 fission.
32
- 33 **Nuclear fuel cycle:** The series of steps involved in supplying fuel for nuclear power reactors,
34 including mining, milling, isotopic enrichment, fabrication of fuel elements, use in reactors,
35 chemical reprocessing to recover the fissionable material remaining in the spent fuel,
36 re-enrichment of the fuel material re-fabrication into new fuel elements, and waste disposal.
37
- 38 **Nuclear power: (nuclear electric power):** Electricity generated by the use of the thermal
39 energy released from the fission of nuclear fuel in a reactor.
40
41

1 **Nuclear power plant:** A facility that uses a nuclear reactor to generate electricity.

2

3 **Nuclear reactor:** A device in which nuclear fission may be sustained and controlled in a
4 self-supporting nuclear reaction. There are many types of reactors, but all incorporate certain
5 features, including fissionable material or fuel, a moderating material (unless the reactor is
6 operated on fast neutrons), a reflector to conserve escaping neutrons, provisions of removal of
7 heat, measuring and controlling instruments, and protective devices. The reactor is the heart of
8 a nuclear power plant.

9

10 **Nuclear Regulatory Commission (NRC):** An independent regulatory agency that is
11 responsible for overseeing the civilian use of nuclear materials in the United States. The NRC
12 was established on October 11, 1974, by President Gerald Ford as one of two successor
13 organizations to the Atomic Energy Commission (AEC), which became defunct on that same
14 day. The NRC took over the AEC's responsibility for seeing that civilian nuclear materials and
15 facilities are used safely and affect neither the public health nor the quality of the environment.
16 The Commission's activities focus on the nuclear reactors in the United States that are used to
17 generate electricity on a commercial basis. It licenses the construction of new nuclear reactors
18 and regulates their operation on a continuing basis. It oversees the use, processing, handling,
19 and disposal of nuclear materials and wastes, inspects nuclear power plants and monitors both
20 their safety procedures and their security measures, enforces compliance with established
21 safety standards, and investigates nuclear accidents. The NRC's Commissioners are appointed
22 by the President of the United States.

23

24 **Occupational dose:** The dose received by an individual in the course of employment in which
25 the individual's assigned duties involve exposure to radiation or to radioactive material.
26 Occupational dose does not include dose received from background radiation, from any medical
27 administration the individual has received, from exposure to individuals administered radioactive
28 materials and released in accordance with 10 CFR 35.75, from voluntary participation in medical
29 research programs, or as a member of the general public.

30

31 **Occupational exposure:** An exposure that occurs during work with sources of ionizing
32 radiation. For example, exposures received from working on a nuclear reactor, in nuclear
33 reprocessing, or by a dental nurse taking x-rays would be classed as occupational.

34

35 **Occupational Safety and Health Administration (OSHA):** Independent Federal agency
36 whose mission is to prevent work-related injuries, illnesses, and deaths. Congress created
37 OSHA under the Occupational Safety and Health Act on December 29, 1970.

38

39 **Once-through cooling system:** In this cooling system, circulating water for condenser cooling
40 is obtained from an adjacent body of water, such as a lake or river, passed through the
41 condenser tubes, and returned directly at a higher temperature to the adjacent body of water.

Glossary

- 1 **Organ dose:** Dose received as a result of radiation energy absorbed in a specific organ.
2
- 3 **Organism:** An individual of any form of animal or plant life.
4
- 5 **Outer Continental Shelf (OCS):** The OCS consists of the submerged lands, subsoil, and
6 seabed, lying between the seaward extent of the States' jurisdiction and the seaward extent of
7 Federal jurisdiction.
8
- 9 **Overburden:** Any material, consolidated or unconsolidated, that overlies a coal or other
10 mineral deposit.
11
- 12 **Ozone (O₃):** A strong-smelling, reactive toxic chemical gas consisting of three oxygen atoms
13 chemically attached to each other. It is formed in the atmosphere by chemical reactions
14 involving nitrogen oxide and volatile organic compounds. The reactions are energized by
15 sunlight. Ozone is a criteria air pollutant under the Clean Air Act and is a major constituent of
16 smog.
17
- 18 **Parabolic trough:** A high-temperature (above 180°F) solar thermal concentrator with the
19 capacity for tracking the sun using one axis of rotation. Also known as a power trough.
20
- 21 **Particulate matter:** Fine solid or liquid particles, such as dust, smoke, mist, fumes, or smog,
22 found in air or emissions. The size of the particulates is measured in micrometers (μm). One
23 micrometer is 1 millionth of a meter or 0.000039 inch. The U.S. Environmental Protection
24 Agency has set standards for PM_{2.5} and PM₁₀ particulates.
25
- 26 **Pathway (exposure):** The way in which people are exposed to radiation or other contaminants.
27 The three basic pathways are inhalation (contaminants are taken into the lungs), ingestion
28 (contaminants are swallowed), and direct (external) exposure (contaminants cause damage
29 from outside the body).
30
- 31 **Peak load:** The maximum load during a specified period of time.
32
- 33 **Perfluorocarbons (PFCs):** A group of man-made chemicals composed of one or two carbon
34 atoms and four to six fluorine atoms, containing no chlorine. PFCs have no commercial uses
35 and are emitted as a by-product of aluminum smelting and semiconductor manufacturing. PFCs
36 have very high 100-year Global Warming Potentials and are very long-lived in the atmosphere.
37
- 38 **Personal protective equipment (PPE):** Clothing and equipment that are worn to reduce
39 exposure to potentially hazardous chemicals and other pollutants.
40

- 1 **Person-rem:** The sum of the individual radiation dose equivalents received by members of a
2 certain group or population. It may be calculated by multiplying the average dose per person by
3 the number of persons exposed. For example, a thousand people, each exposed to
4 one millirem, would have a collective dose of one person-rem.
5
- 6 **Petroleum:** A broadly defined class of liquid hydrocarbon mixtures. Includes crude oil, lease
7 condensate, unfinished oils, refined products obtained from the processing of crude oil, and
8 natural gas plant liquids. Volumes of finished petroleum products include nonhydrocarbon
9 compounds, such as additives and detergents, after they have been blended into products.
10
- 11 **Photosynthesis:** The process in green plants and certain other organisms by which
12 carbohydrates are synthesized from carbon dioxide and water using sunlight as an energy
13 source. Most forms of photosynthesis release oxygen as a by-product. Chlorophyll typically
14 acts as the catalyst in this process.
15
- 16 **Photovoltaic and solar thermal energy:** Energy radiated by the sun as electromagnetic
17 waves (electromagnetic radiation) that is converted at electric utilities into electricity by means
18 of solar (photovoltaic) cells or concentrating (focusing) collectors.
19
- 20 **Photovoltaic cell (PVC):** An electronic device consisting of layers of semiconductor materials
21 fabricated to form a junction (adjacent layers of materials with different electronic
22 characteristics) and electrical contacts and being capable of converting incident light directly
23 into electricity (direct current).
24
- 25 **Photovoltaic system:** A system that converts light into electric current.
26
- 27 **Phytoplankton:** Small, often single-celled plants that live suspended in bodies of water.
28
- 29 **Plutonium:** A heavy, man-made, radioactive metallic element. The most important isotope is
30 Pu-239, which has a half-life of more than 20,000 years; it can be used in reactor fuel and is the
31 primary isotope in weapons.
32
- 33 **PM₁₀:** Particulate matter with a mean aerodynamic diameter of 10 micrometers (0.0004 in.) or
34 less. Particles less than this diameter are small enough to be deposited in the lungs.
35
- 36 **PM_{2.5}:** Particulate matter with a mean aerodynamic diameter of 2.5 micrometers (0.0001 in.) or
37 less.
38
- 39 **Polycyclic aromatic hydrocarbons (PAHs):** Aromatic hydrocarbons containing more than
40 one fused benzene ring. PAHs are commonly formed during the incomplete burning of coal, oil
41 and gas, garbage, or other organic substances.

Glossary

- 1 **Population dose:** Dose received collectively by a population.
2
- 3 **Power:** The rate of producing, transferring, or using energy, most commonly associated with
4 electricity. Power is measured in watts and often expressed in kilowatts (kW) or
5 megawatts (mW).
6
- 7 **Pressurized water reactor (PWR):** A power reactor in which thermal energy is transferred
8 from the core to a heat exchanger by high-temperature water kept under high pressure in the
9 primary system. Steam is generated in the heat exchanger in a secondary circuit.
10
- 11 **Prevention of Significant Deterioration (PSD):** A Federal permit program for facilities defined
12 as major sources under the New Source Review program. The intent of the program is to
13 prevent the air quality in an attainment area from deteriorating.
14
- 15 **Primary system:** A term that refers to the circulating water system in a pressurized water
16 reactor, which removes the energy from the reactor and delivers it to the heat exchanger.
17
- 18 **Proposed Action:** An action proposed by a Federal agency and evaluated in an environmental
19 impact statement or environmental assessment. In this GEIS, the proposed action is to renew
20 commercial nuclear power plant operating licenses.
21
- 22 **Proton:** A small particle, typically found within an atom's nucleus, that possesses a positive
23 electrical charge. The number of protons is unique for each chemical element.
24
- 25 **Proximity:** Used sparingly to evaluate the remoteness of areas in which nuclear plants are
26 located. A measure of the distance to larger cities.
27
- 28 **Public dose:** The dose received by members of the public from exposure to radiation or to
29 radioactive material released by a licensee, or to any other source of radiation under the control
30 of a licensee. Public dose does not include occupational dose or doses received from
31 background radiation, from any medical administration the individual has received, from
32 exposure to individuals administered radioactive materials and released in accordance with
33 10 CFR 35.75, or from voluntary participation in medical research programs.
34
- 35 **Pulverized coal:** Coal that has been crushed to a fine dust in a grinding mill. It is blown into
36 the combustion zone of a furnace and burns very rapidly and efficiently.
37

- 1 **Pumped-storage hydroelectric plant:** A hydropower plant that usually generates electric
2 energy during peak load periods by using water previously pumped into an elevated storage
3 reservoir during offpeak periods when excess generating capacity is available to do so. When
4 additional generating capacity is needed, the water can be released from the reservoir through
5 a conduit to turbine generators located in a power plant at a lower level.
6
- 7 **Putrescible:** Subject to the biological decomposition of organic matter and associated with
8 anaerobic (no oxygen present) conditions.
9
- 10 **Pyrolysis:** The thermal decomposition of biomass at high temperatures (greater than 400°F, or
11 200°C) in the absence of air. The end product of pyrolysis is a mixture of solids (char), liquids
12 (oxygenated oils), and gases (methane, carbon monoxide, and carbon dioxide) with proportions
13 determined by operating temperature, pressure, oxygen content, and other conditions.
14
- 15 **Quality factor:** The modifying factor that is used to derive dose equivalent from absorbed
16 dose.
17
- 18 **Rad:** The special unit for radiation absorbed dose, which is the amount of energy from any type
19 of ionizing radiation (e.g., alpha, beta, gamma, neutrons) deposited in any medium (e.g., water,
20 tissue, air). A dose of one rad means the absorption of 100 ergs (a small but measurable
21 amount of energy) per gram of absorbing tissue (100 rad=1 gray).
22
- 23 **Radiation (ionizing radiation):** Alpha particles, beta particles, gamma rays, x-rays, neutrons,
24 high-speed electrons, high-speed protons, and other particles capable of producing ions.
25 Radiation, as used in 10 CFR Part 20, does not include nonionizing radiation, such as
26 radiowaves or microwaves, or visible, infrared, or ultraviolet light (see also 10 CFR 20.1003).
27
- 28 **Radioactive decay:** The decrease in the amount of any radioactive material with the passage
29 of time due to the spontaneous emission from the atomic nuclei of either alpha or beta particles,
30 often accompanied by gamma radiation.
31
- 32 **Radioactive waste:** Radioactive materials at the end of a useful life cycle or in a product that is
33 no longer useful and should be properly disposed of.
34
- 35 **Radioactivity:** The spontaneous emission of radiation, generally alpha or beta particles, often
36 accompanied by gamma rays, from the nucleus of an unstable isotope. Also, the rate at which
37 radioactive material emits radiation. Measured in units of becquerels or disintegrations per
38 second.
39
40

Glossary

- 1 **Radioisotope:** An unstable isotope of an element that decays or disintegrates spontaneously,
2 emitting radiation. Approximately 5000 natural and artificial radioisotopes have been identified.
3
- 4 **Radionuclide:** A radioisotope of an element.
5
- 6 **Raptor:** A bird of prey such as a falcon, hawk, or eagle.
7
- 8 **Rated power:** The design power level of an electrical generating device, which is the maximum
9 power the device is allowed to generate.
10
- 11 **Reactor vessel:** A device in which nuclear fission may be sustained and controlled in a
12 self-supporting nuclear reaction. It houses the core (made up of fuel rods, control rods, and
13 instruments contained within a reactor vessel) of most types of power reactors.
14
- 15 **Receptor:** The individual or resource being affected by the impact.
16
- 17 **Reference reactor year (RRY):** Refers to one year of operation of a 1000-MW electric capacity
18 nuclear power plant.
19
- 20 **Refurbishment:** Repair or replacement of reactor systems, structures, and components, such
21 as turbines, steam generators, pressurizers, and recirculation piping systems.
22
- 23 **Region of Influence:** Area occupied by affected resources and the distances at which impacts
24 associated with license renewal may occur.
25
- 26 **rem (roentgen equivalent man):** The acronym for roentgen equivalent man is a standard unit
27 that measures the effects of ionizing radiation on humans. The dose equivalent in rem is equal
28 to the absorbed dose in rads multiplied by the quality factor of the type of radiation
29 (see 10 CFR 20.1004).
30
- 31 **Renewable energy resources:** Energy resources that are naturally replenishing but
32 flow-limited. They are virtually inexhaustible in duration, but limited in the amount of energy that
33 is available per unit of time. Renewable energy resources include biomass, hydro, geothermal,
34 solar, wind, ocean thermal, wave action, and tidal action.
35
- 36 **Renewable portfolio standards (RPSs):** State policies that require electricity providers to
37 generate a certain percentage, or, in some cases a certain specified amount, of electrical power
38 through the use of renewable energy sources by a certain date.
39

- 1 **Residual fuel oil:** A general classification for the heavier oils, known as No. 5 and No. 6 fuel
2 oils, that remain after the distillate fuel oils and lighter hydrocarbons are distilled away in refinery
3 operations.
4
- 5 **Resource Conservation and Recovery Act (RCRA):** Act that regulates the storage,
6 treatment, and disposal of hazardous and nonhazardous wastes.
7
- 8 **Right-of-way:** The land and legal right to use and service the land along which a transmission
9 line is located. Transmission line right-of-ways are usually acquired in widths that vary with the
10 kilovolt (kV) size of the line.
11
- 12 **Riparian:** Relating to, living in, or located on the bank of a river, lake, or tidewater.
13
- 14 **Risk:** The combined answers to the questions (1) What can go wrong?, (2) How likely is it?,
15 and (3) What are the consequences?
16
- 17 **Risk coefficient:** A coefficient used to convert dose to risk.
18
- 19 **roentgen equivalent man (rem):** See rem.
20
- 21 **Run-of-river hydroelectric plant:** A hydropower plant that uses the flow of a stream as it
22 occurs and has little or no reservoir capacity for storage.
23
- 24 **SAFSTOR:** A method of decommissioning in which the nuclear facility is placed and
25 maintained in such condition that the nuclear facility can be safely stored and subsequently
26 decontaminated to levels that permit release for restricted or unrestricted use.
27
- 28 **Savanna:** Grassland with scattered individual trees.
29
- 30 **Scouring:** The rapid erosion of sediment caused by the movement of water.
31
- 32 **Scrubbers:** Air pollution control devices that are used to remove particulates and/or gases
33 from industrial or power exhaust streams.
34
- 35 **Sediment:** Particles of geologic origin that sink to the bottom of a body of water, or materials
36 that are deposited by wind, water, or glaciers.
37
- 38 **Seismic:** Of, subject to, or caused by an earthquake or earth vibration.
39
- 40 **Service water:** Water used to cool heat exchangers or coolers in the power house other than
41 the condenser. Service water may or may not be treated for use.

Glossary

- 1 **Shallow-dose equivalent:** Applies to external exposure of the skin or an extremity, is taken as
2 the dose equivalent at a tissue depth of 0.007 centimeters averaged over an area of 1 square
3 centimeter.
4
- 5 **Sievert (Sv):** The international system (SI) unit for dose equivalent equal to 1 Joule/kilogram.
6 1 sievert = 100 rem. Named for physicist Rolf Sievert.
7
- 8 **Sludge:** A dense, slushy, liquid-to-semifluid product that accumulates as an end result of an
9 industrial or technological process. Industrial sludges are produced from the processing of
10 energy-related raw materials, chemical products, water, mined ores, sewage, and other natural
11 and man-made products.
12
- 13 **Socioeconomics:** Social and economic characteristics of a human population. Includes both
14 the social impacts of economic activity and the economic impacts of social activity.
15
- 16 **Solar energy:** The radiant energy of the sun, which can be converted into other forms of
17 energy, such as heat or electricity.
18
- 19 **Solar power tower:** A solar energy conversion system that uses a large field of independently
20 adjustable mirrors (heliostats) to focus solar rays on a near single point atop a fixed tower
21 (receiver). The concentrated energy may be used to directly heat the working fluid of a Rankin
22 cycle engine or to heat an intermediary thermal storage medium (such as a molten salt).
23
- 24 **Solar radiation:** A general term for the visible and near-visible (ultraviolet and near-infrared)
25 electromagnetic radiation that is emitted by the sun. It has a spectral, or wavelength,
26 distribution that corresponds to different energy levels; short wavelength radiation has a higher
27 energy than long-wavelength radiation.
28
- 29 **Solar thermal systems or concentrating solar power (CSP):** See solar power tower.
30
- 31 **Sound intensity:** The measure of the amount of energy that is transported over a given area
32 per unit of time. Sound intensity is expressed in units of W/m^2 .
33
- 34 **Sparseness:** Used (with proximity) to evaluate the remoteness of areas in which nuclear plants
35 are located. A measure of population density.
36
- 37 **Spawning:** Release or deposition of spermatozoa or ova, of which some will fertilize or be
38 fertilized to produce offspring.
39
- 40 **Spent fuel burnup:** A measure of how much energy is extracted from the nuclear fuel before it
41 is removed from the core. Its units are MW-day per metric tonne of uranium in fresh fuel.

- 1 **Spent nuclear fuel:** Nuclear reactor fuel that has been removed from a nuclear reactor
2 because it can no longer sustain power production for economic or other reasons.
3
- 4 **Spent-fuel pool:** An underwater storage and cooling facility for spent fuel elements that have
5 been removed from a reactor.
6
- 7 **State Historic Preservation Officer (SHPO):** The State officer charged with the identification
8 and protection of prehistoric and historic resources in accordance with the National Historic
9 Preservation Act.
10
- 11 **State Implementation Plan (SIP):** State-specific air quality plan for controlling air pollution
12 emissions at levels that would attain and maintain compliance with the National Ambient Air
13 Quality Standards or State-specific air quality standards. Each State must develop its own
14 regulations to monitor, permit, and control air emissions within its boundaries.
15
- 16 **Steam turbine:** A device that converts high-pressure steam, produced in a boiler, into
17 mechanical energy that can then be used to produce electricity by forcing blades in a cylinder to
18 rotate and turn a generator shaft.
19
- 20 **Stilling basin:** An open structure or excavation at the foot of an overfall, chute, drop, or
21 spillway to reduce the energy of the descending stream. A basin constructed to dissipate the
22 energy of fast-flowing water (e.g., from a spillway or bottom outlet) and to protect the stream
23 bed below a dam from erosion.
24
- 25 **Stochastic effect:** Health effects that occur randomly and for which the probability of the effect
26 occurring, rather than its severity, is assumed to be a linear function of dose without threshold.
27 Hereditary effects and cancer incidence are examples of stochastic effect.
28
- 29 **Store and release dam:** Hydropower facilities that store water in a reservoir behind a dam and
30 release the water through turbines as needed to generate electricity.
31
- 32 **Stratification:** The formation, accumulation, or deposition of materials in layers, such as layers
33 of freshwater overlying higher salinity water (saltwater) in estuaries.
34
- 35 **Strip mine:** An open cut in which the overburden is removed from a coal bed or other mineral
36 deposit prior to the removal of the desired underlying material.
37

Glossary

1 **Sub-bituminous coal:** Sub-bituminous coal has a higher heating value than lignite coal, due
2 primarily to its average carbon content of 35–45 percent carbon and lower moisture levels.
3 Sub-bituminous coal deposits in the United States are estimated to be at least 100 million years
4 old. Sub-bituminous coal represents about 42 percent of annual U.S. coal production, with the
5 majority being burned in boilers to produce steam to drive turbines that produce electricity. The
6 major sub-bituminous deposits are in the Western states, primarily Wyoming.

7
8 **Sulfur:** A yellowish nonmetallic element. It is present at various concentrations in many fossil
9 fuels whose combustion releases sulfur compounds that are considered harmful to the
10 environment. Some of the most commonly used fossil fuels are categorized according to their
11 sulfur content, with lower sulfur fuels usually selling at a higher price.

12
13 **Sulfur dioxide (SO₂):** A gas formed from burning fossil fuels. Sulfur dioxide is one of the six
14 criteria air pollutants specified under Title I of the Clean Air Act.

15
16 **Sulfur oxides (SO_x):** Pungent, colorless gases that are formed primarily by fossil fuel
17 combustion. Sulfur oxides may damage the respiratory tract, as well as plants and trees.

18
19 **Supercritical and subcritical:** Supercritical and subcritical define the thermodynamic state of
20 the water in the steam cycle. In supercritical steam generating units, the pressure at which the
21 steam cycle is maintained is above water's critical point so there is no distinction between
22 water's liquid and gaseous phases and the steam behaves as a homogenous supercritical fluid.
23 The supercritical point for water is 22.1 MPa (approximately 3207 pounds per square inch [psi]).
24 Supercritical steam generators offer numerous advantages over their subcritical counterparts,
25 including higher thermal efficiencies, greater flexibility in changing loads, and greater
26 combustion efficiencies, resulting in lesser amounts of pollutants per units of power generated.
27 No ultra-supercritical units are operating in the United States.

28
29 **Supplemental Environmental Impact Statement (SEIS):** A SEIS updates or supplements an
30 existing EIS (such as the GEIS). The (Nuclear Regulatory) Commission directs the staff to
31 issue site-specific supplements to the GEIS for each license renewal application.

32
33 **Surface mine (surface mining):** A coal-producing mine that is usually within a few hundred
34 feet of the surface. Earth above or around the coal (overburden) is removed to expose the
35 coalbed, which is then mined with surface excavation equipment, such as draglines, power
36 shovels, bulldozers, loaders, and augers. It may also be known as an area, contour, open-pit,
37 strip, or auger mine.

38
39 **Surface water:** Water on the earth's surface that is directly exposed to the atmosphere, as
40 distinguished from water in the ground (groundwater).

41

- 1 **Switchyard:** A facility used at power plants to increase the electric voltage and feed into the
2 regional power distribution system. Electricity generated at the plant is carried off the site by
3 transmission lines.
4
- 5 **Syngas:** A gas mixture that contains varying amounts of carbon monoxide and hydrogen
6 generated by the gasification of a carbon-containing fuel.
7
- 8 **Tallgrass:** Any of various grasses that are tall and that flourish with abundant moisture,
9 typically associated with the prairies of the Midwestern United States.
10
- 11 **Terrestrial:** Belonging to or living on land.
12
- 13 **Thermal:** Having to do with heat. Also, a term used to identify a type of electric generating
14 station, capacity, capability, or output in which the source of energy for the prime mover is heat.
15
- 16 **Thermal efficiency:** A measure of the efficiency of converting the thermal energy generated by
17 the burning of the fossils fuels or the fission of nuclear fuel to electrical energy.
18
- 19 **Thermal effluents:** Heated discharge from a cooling water system.
20
- 21 **Thermal plume:** The hot water discharged from a power-generating facility or other industrial
22 plant. When the water at elevated temperature enters a receiving stream or body of water, it is
23 not immediately dispersed and mixed with the cooler waters. The warmer water moves as a
24 single mass (plume) from the discharge point until it cools and gradually mixes with that of the
25 receiving water.
26
- 27 **Thermal stratification:** The formation of layers of different temperatures in a lake or reservoir.
28
- 29 **Thermophilic:** Organisms such as bacteria that require a relatively high-temperature
30 environment for normal development.
31
- 32 **Threatened species:** Any species that is likely to become an endangered species within the
33 foreseeable future throughout all or a significant portion of its range. Requirements for
34 declaring a species threatened are contained in the Endangered Species Act.
35
- 36 **Total body dose:** Sum of the dose received from external exposure to the total body, gonads,
37 active blood-forming organs, head and trunk, or lens of the eye and the dose due to the intake
38 of radionuclides by inhalation and ingestion where a radioisotope is uniformly distributed
39 throughout the body tissues rather than being concentrated in certain parts.
40

Glossary

- 1 **Total effective dose equivalent (TEDE):** The sum of the deep-dose equivalent (for external
2 exposure) and the committed effective dose equivalent (for internal exposure).
3
- 4 **Transformer:** An electrical device for changing the voltage of alternating current.
5
- 6 **Transmission:** The movement or transfer of electric energy over an interconnected group of
7 lines and associated equipment between points of supply and points at which it is transformed
8 for delivery to consumers or is delivered to other electric systems. Transmission is considered
9 to end when the energy is transformed for distribution to the consumer.
10
- 11 **Transmission line:** A set of conductors, insulators, supporting structures, and associated
12 equipment used to move large quantities of power at high voltage, usually over long distances
13 between a generating or receiving point and major substations or delivery points.
14
- 15 **Transuranic waste:** Material contaminated with transuranic elements that is produced
16 primarily from reprocessing spent fuel and from use of plutonium in fabrication of nuclear
17 weapons.
18
- 19 **Tritium:** A radioactive isotope of hydrogen with one proton and two neutrons. Because it is
20 chemically identical to natural hydrogen, tritium can easily be taken into the body by any
21 ingestion path. It decays by beta emission. It has a radioactive half-life of about 12.5 years.
22
- 23 **Turbine:** A device in which a stream of water or gas turns a bladed wheel, converting the
24 kinetic energy of the flow into mechanical energy available from the turbine shaft. Turbines are
25 considered the most economical means of turning large electrical generators. They are typically
26 driven by steam, fuel vapor, water, or wind.
27
- 28 **U.S. Environmental Protection Agency (EPA):** The independent Federal agency, established
29 in 1970, that regulates Federal environmental matters and oversees the implementation of
30 Federal environmental laws.
31
- 32 **Uranium:** A radioactive element with the atomic number 92 and, as found in natural ores, an
33 atomic weight of approximately 238. The two principal natural isotopes are uranium-235
34 (0.7 percent of natural uranium) and uranium-238 (99.3 percent of natural uranium). Natural
35 uranium also includes a minute amount of uranium-234.
36
- 37 **Universal waste:** A special class of hazardous waste consisting of commonly used and yet
38 hazardous materials: batteries, pesticides, mercury-containing equipment, and lamps.
39
- 40 **Vertebrate:** Any species having a backbone or spinal column including fish, amphibians,
41 reptiles, birds, and mammals.

- 1 **Visual impact:** The creation of an intrusion or perceptible contrast that affects the scenic
2 quality of a landscape.
3
- 4 **Visual resources:** Refers to all objects (man-made and natural, moving and stationary) and
5 features such as landforms and water bodies that are visible on a landscape.
6
- 7 **Volatile organic compounds (VOCs):** A broad range of organic compounds that readily
8 evaporate at normal temperatures and pressures. Sources include certain solvents, degreasers
9 (e.g., benzene), and fuels. Volatile organic compounds react with other substances (primarily
10 nitrogen oxides) to form ozone. They contribute significantly to photochemical smog production
11 and certain health problems.
12
- 13 **Waste coal:** Usable material that is a by-product of previous coal processing operations.
14 Waste coal may be relatively clean material composed primarily of coal fines, material in which
15 extraneous noncombustible constituents have been partially removed, or mixed coal, soil, and
16 rock (mine waste) burned as is in unconventional boilers, such as fluidized bed units. Examples
17 include fine coal, coal obtained from a refuse bank or slurry dam, anthracite culm, bituminous
18 gob, and lignite waste.
19
- 20 **Wastewater:** The used water and solids that flow to a treatment plant. Stormwater, surface
21 water, and groundwater infiltration also may be included in the wastewater that enters a
22 wastewater treatment plant.
23
- 24 **Water quality:** The condition of water with respect to the amount of impurities in it.
25
- 26 **Weir:** A dam in a waterway over which water flows and that serves to raise the water level or to
27 direct or regulate flow.
28
- 29 **Whole-body dose:** Sum of the dose received from external exposure to the total body,
30 gonads, active blood-forming organs, head and trunk, or lens of the eye and the dose due to the
31 intake of radionuclides by inhalation and ingestion where a radioisotope is uniformly distributed
32 throughout the body tissues rather than being concentrated in certain parts.
33
- 34 **Wind energy:** Kinetic energy present in wind motion that can be converted to mechanical
35 energy for driving pumps, mills, and electric power generators.
36
- 37 **Wind farm:** One or more wind turbines operating within a contiguous area for the purpose of
38 generating electricity. See also wind power plant.
39

Glossary

- 1 **Wind power plant:** Wind turbines interconnected to a common utility system through a system
2 of transformers, distribution lines, and (usually) one substation. Operation, control, and
3 maintenance functions are often centralized through a network of computerized monitoring
4 systems, supplemented by visual inspection.
5
- 6 **Wind turbine:** Wind energy conversion device that produces electricity; typically three blades
7 rotating about a horizontal axis and positioned upwind of the supporting tower.
8
- 9 **X-rays and gamma rays:** Waves of pure energy that travel with the speed of light that are very
10 penetrating and require thick concrete or lead shielding to stop them.
11
- 12 **Yucca Mountain Repository:** The site of the U.S. Department of Energy's proposed repository
13 for spent nuclear fuel and high-level radioactive waste. The U.S. Environmental Protection
14 Agency established the public health and environmental radiation protection standards for the
15 facility.
16
- 17 **Zooplankton:** Small animals that float passively in the water column. Includes eggs and larvae
18 of many fish and invertebrate species.

BIBLIOGRAPHIC DATA SHEET

(See instructions on the reverse)

NUREG-1437, Volume 1, Revision
1

2. TITLE AND SUBTITLE

Generic Environmental Impact Statement for License Renewal of Nuclear Plants
Main Report
Draft Report for Comment

3. DATE REPORT PUBLISHED

MONTH

YEAR

July

2009

4. FIN OR GRANT NUMBER

5. AUTHOR(S)

6. TYPE OF REPORT

Technical

7. PERIOD COVERED (Inclusive Dates)

8. PERFORMING ORGANIZATION - NAME AND ADDRESS (If NRC, provide Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address; if contractor, provide name and mailing address.)

Division of License Renewal
Office of Nuclear Reactor Regulation
U.S. Nuclear Regulatory Commission
Washington, DC 20555-0001

9. SPONSORING ORGANIZATION - NAME AND ADDRESS (If NRC, type "Same as above"; if contractor, provide NRC Division, Office or Region, U.S. Nuclear Regulatory Commission, and mailing address.)

Same as 8 above

10. SUPPLEMENTARY NOTES

11. ABSTRACT (200 words or less)

U.S. Nuclear Regulatory Commission (NRC) regulations allow for the renewal of commercial nuclear power plant operating licenses, depending on the outcome of an assessment to determine whether the nuclear plant can continue to operate safely and protect the environment during the 20-year period of extended operation. Renewal of a nuclear power plant operating license requires the preparation of an environmental impact statement (EIS). To support the preparation of these EISs, the NRC published the Generic Environmental Impact Statement for License Renewal of Nuclear Plants (GEIS) in 1996.

The NRC committed to review and revise the GEIS on a 10-year cycle, if necessary. This GEIS revision reviews and reevaluates the issues and findings of the 1996 GEIS. Lessons learned and knowledge gained during previous license renewal reviews provides a significant source of new information for this assessment. In addition, new research, findings, and other information were considered in evaluating the significance of impacts associated with license renewal. The intent of the GEIS is to determine which issues would result in the same impact at all nuclear power plants, and which issues require a plant-specific analysis for impact determinations. The GEIS is intended to improve the efficiency of the license renewal process by (1) providing an evaluation of the types of environmental impacts that may occur as a result of renewing the license of a nuclear power plant, (2) identifying and assessing the impacts that are expected to be generic (the same or similar), and (3) defining the number and scope of impacts that need to be addressed in plant-specific EISs. The GEIS revision identifies 78 environmental impact issues for consideration in plant-specific supplements to the GEIS.

12. KEY WORDS/DESCRIPTORS (List words or phrases that will assist researchers in locating the report.)

Generic Environmental Impact Statement for License Renewal of Nuclear Plants
GEIS
NUREG-1437, Revision 1
National Environmental Policy Act
NEPA
License Renewal

13. AVAILABILITY STATEMENT

unlimited

14. SECURITY CLASSIFICATION

(This Page)

unclassified

(This Report)

unclassified

15. NUMBER OF PAGES

16. PRICE



Federal Recycling Program