



HITACHI

GE Hitachi Nuclear Energy

Richard E. Kingston
Vice President, ESBWR Licensing
Regulatory Affairs

P.O. Box 780 M/C A-65
Wilmington, NC 28402 USA

T 910.819.6192
F 910.362.6192
rick.kingston@ge.com

Security Notice

This letter forwards Security-Related information in accordance with 10CFR2.390. Upon removal of Enclosure 2, the balance of this letter may be considered non-Security-Related.

MFN 09-449

Docket 52-010

July 1, 2009

U.S. Nuclear Regulatory Commission
Document Control Desk
Washington, DC 20555-0001

Subject: Response to Portion of NRC RAI Letter No. 323 Related to ESBWR Design Certification Application – DCD Tier 2 Section 3.8 – Seismic Category I Structures; RAI Number 3.8-96 S04


The purpose of this letter is to submit the GE Hitachi Nuclear Energy (GEH) response to a portion of the U.S. Nuclear Regulatory Commission (NRC) Request for Additional Information (RAI) letter number 323 sent by NRC letter dated April 6, 2009 (Reference 1). RAI Number 3.8-96 S04 is addressed in Enclosure 1. Enclosure 2 contains the DCD changes to Tier 2 as a result of GEH's response to this RAI. Verified DCD changes associated with this RAI response are identified in the enclosed DCD markups by enclosing the text within a black box.

Note that Enclosure 2 contains Security-Related Information identified by the designation "{{{Security-Related Information - Withhold Under 10 CFR 2.390}}}". GEH hereby requests this information be withheld from public disclosure in accordance with the provisions of 10 CFR 2.390. A public version is contained in Enclosures 3.

Doc 8
NR0

If you have any questions or require additional information, please contact me

Sincerely,



Richard E. Kingston
Vice President, ESBWR Licensing

Reference:

1. MFN 09-245 Letter from U.S. Nuclear Regulatory Commission to J. G. Head, GEH, *Request For Additional Information Letter No. 323 Related to ESBWR Design Certification* dated April 6, 2009

Enclosure:

1. Response to Portion of NRC RAI Letter No. 323 Related to ESBWR Design Certification Application - DCD Tier 2 Section 3.8 – Seismic Category I Structures; RAI Number 3.8-96 S04
2. Response to Portion of NRC RAI Letter No. 323 Related to ESBWR Design Certification Application - DCD Markups for RAI Number 3.8-96 S04 - with Security Information
3. Response to Portion of NRC RAI Letter No. 323 Related to ESBWR Design Certification Application - DCD Markups for RAI Number 3.8-96 S04 – Public Version

cc: AE Cabbage USNRC (with enclosure)
JG Head GEH/Wilmington (w/o enclosure)
DH Hinds GEH/Wilmington (w/o enclosure)
eDRF Section 0000-0102-9097 (RAI 3.8-96 S04)

ENCLOSURE 1

MFN 09-449

**Partial Response to NRC RAI Letter No. 323
Related to ESBWR Design Certification Application¹**

DCD Tier 2 Section 3.8 – Seismic Category I Structures

RAI Number 3.8-96 S04

¹ Original Response, Supplement 1, Supplement 2 and Supplement 3 previously submitted under MFNs 06-407; 06-407, Supplement 2; 06-407, Supplement 3 and 06-407, Supplement 14 without DCD updates are included to provide historical continuity during review.

NRC RAI 3.8-96

DCD Section 3.8.5.5 presents two specifications of appropriate safety factors (SF) for foundation design. The SF against sliding indicates that sliding resistance is judged as the sum of both shear friction along the basemat and passive pressures induced due to embedment effects. However, the DCD does not indicate (1) how these effects are to consider consistent lateral displacement criteria (that is, the displacement effect on passive pressure is not the same as on friction development) and (2) how the effect of waterproofing is to impact the development of basemat friction capacity. DCD Section 3.8.5.5 needs to clearly indicate how these effects are incorporated into the standard plant design for the considered range of acceptable site conditions considered.

Include this information in DCD Section 3.8.5.5. In addition, (1) identify the applicable detailed report/calculation (number, title, revision and date, and brief description of content) that will be available for audit by the staff, and (2) reference this report/calculation in the DCD.

GE Response

- a) As stated in the response to NRC RAI 3.7-35, SASSI analyses were performed to address the embedment effect. It was confirmed that the base shears calculated by the SASSI analyses, which consider the embedment effect, are less than those obtained by design seismic analyses that neglect the embedment effect. The use of higher base shears calculated without the beneficial effect of embedment is deemed conservative for the sliding evaluation without explicit consideration of consistent lateral displacement criteria for passive pressure and friction resistance.
- b) Please see NRC RAI 3.8-89 for the response to impact of waterproofing.
- (1) The applicable detailed reports/calculations that will be available for the NRC audit are:
 - 26A6652, *RB FB Stability Analysis Report, Revision 2*, April 2006, which contains the stability calculations of the Reactor Building/Fuel Building.
 - 26A6654, *CB Stability Analysis Report, Revision 2*, April 2006, which contains the stability calculations of the Control Building.
- (2) Since this information exists as part of GE's internal tracking system, it is not necessary to add it to the DCD.

No DCD change will be made in response to this RAI.

NRC RAI 3.8-96, Supplement 1

NRC Assessment Following the December 14, 2006 Audit

GE needs to clarify the response to this RAI and revise Section 3.8.5.5 to be consistent with their response. Does GE calculate the SF against sliding by only considering the basemat shear friction? If not, GE needs to better explain the method used in the light of the question asked. GE also needs to explain (1) Do the exterior walls need to be designed for passive pressures as implied in the last sentence of item (a) of the response? (2) Are both base shear and passive pressures being relied upon for lateral restraint? (3) the friction coefficient used in the analysis and its technical bases, (4) how lift-off effects are captured in the sliding analysis, (5) the capacity of the mud mat to resist applied loads, and (6) what effect the use of chemical crystalline powder in the mud mat has on the assumed structural properties. Potential leaching of the mud mat due to groundwater is being reviewed under RAI 3.8-81.

During the audit, GE indicated the following:

(1) & (2) GE explained the answer to both is yes. The seismic stick model did not consider embedment effects while the stability calculations (soil sliding), using this shear force, did consider soil friction and soil passive pressure. However, the SASSI did consider soil embedment and it was shown that the resulting shear loads are smaller than those calculated by the seismic stick model. GE indicated that they will determine an appropriate method to consider the seismic shear force from the seismic stick model and/or SASSI analysis in their calculation of sliding stability calculation. The method used will ensure consistency of the deformation in developing the frictional soil resistance and soil passive pressure. Also, the design of the foundation walls will consider the appropriate pressures from the SASSI analysis and passive soil pressures used in the sliding stability calculations.

(3) GE will provide the reference for the static and dynamic coefficient of friction values. This would be needed if GE is not able to show that the soil frictional resistance alone can resist the seismic shear force.

(4) GE will provide additional justification to demonstrate that the effects of uplift are not significant.

(5) GE will expand on the description of the mud mat and provide the minimum applicable requirements (e.g., ACI Code).

(6) GE explained that this material has no deleterious effect on the concrete and has been used and approved at other NPPs.

GE Response

(1) & (2) Table 3.8-96(1) summarizes the evaluation results of the foundation sliding analyses for generic site conditions.

The seismic loads used in the evaluation are obtained by seismic response analysis using the lumped soil spring stick model (DAC3N analyses). Since the lumped soil spring model does not consider embedment effects, the resulting shear loads are larger than those calculated by SASSI analyses. The use of higher base shear is conservative for the foundation stability evaluation.

Sliding resistance is composed of the following:

- Friction force at the basemat bottom surface
- Cohesion force at the basemat bottom surface
- Passive soil pressure at the basemat side surface
For the RB/FB and CB, the gap between the building and excavated soil is filled with concrete up to the top level of the basemat or higher. Since the basemat is constrained by rigid concrete backfill, the passive soil pressure is mobilized for the region.
- Passive soil pressure on walls
The passive soil pressures considered are the envelope lateral soil pressures obtained from the elastic solution based on ASCE 4-98, Section 3.5.3.2 and SASSI analysis results, which are used in the wall design.

- (3) Only the static coefficient of friction is used for stability evaluation. Coefficient of friction, μ , is calculated by the following equation.

$$\mu = \min(\tan \phi, 0.75)$$

where,

ϕ = Angle of internal friction (30° for soft and medium soil, 40° for hard soil).

The minimum angle of internal friction will be specified to be 30° in DCD Tier 2 Table 2.0-1 as a site requirement.

- (4) Sliding resistance is composed of passive soil pressure, friction and cohesion forces at the basemat bottom. Uplift of the basemat has no effect on the passive soil pressure. The friction force at the basemat bottom is also not influenced by the uplift, because the friction force is calculated by (normal compressive force) x (friction coefficient). Because the basemat uplift has no effect on both the normal compressive force and friction coefficient, the resulting friction force is unchanged even if uplift occurs. As for the cohesion force, since it is calculated by (cohesion stress) x (contact area of basemat), the value is reduced if the basemat is uplifted. However, the contribution of the cohesion force to the total resistance is relatively small as shown in Table 3.8-96(1). The reduction of the cohesion force due to uplift has little impact on the total resistance.
- (5) The mud mat construction is performed in accordance with the same standards and requirements as the basemat to avoid possibility of errors in the field.

- (6) The crystalline powder used is the same material approved for use in AP-1000 and has no deleterious effect on concrete. It forms a substantial waterproofing barrier to prevent water infiltration or ex-filtration.

Table 3.8-96(1) Sliding Evaluation Results

(i) RBFB

Building width X	70.0 m					
Building width Y	49.0 m					
Total Weight	2360 MN					
Buoyancy	652 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	676 MN		1159 MN		1103 MN	
Minimum Vertical Load	1438 MN		1244 MN		1267 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<i>Fv: Horizontal Seismic Force (MN)</i>	899	787	1462	1619	1486	1243
Fub: Bottom Friction Force (MN)	830	830	718	718	950	950
Fc: Effective Cohesion Force (MN)	0	0	343	343	1166	1166
Fpb: Passive Pressure for Basemat (MN)	132	188	213	304	539	769
Fdsf: Passive Soil Pressure on Wall (MN)	440	644	440	644	440	644
<i>Fr: Sliding Resistance (=Fub+Fc+Fpb+Fdsf)</i>	1402	1663	1714	2010	3095	3530
FS (=Fr/Fv)	1.56	2.11	1.17	1.24	2.08	2.84

(ii) CB

Building width X	30.3 m					
Building width Y	23.8 m					
Total Weight	173 MN					
Buoyancy	101 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	72 MN		79 MN		100 MN	
Minimum Vertical Load	43 MN		40 MN		32 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<i>Fv: Horizontal Seismic Force (MN)</i>	105	100	97	94	101	91
Fub: Bottom Friction Force (MN)	25	25	23	23	24	24
Fc: Effective Cohesion Force (MN)	0	0	72	72	245	245
Fpb: Passive Pressure for Basemat (MN)	36	46	64	82	173	220
Fds: Passive Soil Pressure on Wall (MN)	58	74	58	74	58	74
<i>Fr: Sliding Resistance (=Fub+Fc+Fpb+Fds)</i>	119	145	218	251	500	563
FS (=Fr/Fv)	1.13	1.44	2.23	2.67	4.94	6.22

Note:

1. Minimum vertical load: $W_m = W_t - F_b - 0.4F_a$
where,
Fb: Buoyancy due to groundwater
Fa: Vertical seismic force
2. Bottom friction force: $F_{ub} = W_m * \mu$
where,
 μ : friction coefficient
3. Fv and Fa are obtained by seismic lumped soil spring stick model analyses (DAC3N analyses)

DCD Tier 2 Table 2.0-1, Subsections 3G.1.5.5 and 3G.2.5.5 and Tables 3G.1-57 and 3G.2-26 have been revised. DCD Tier 2 Figures 3G.1-65 and 3G.2-15 have been added. The pages (pp. 2.0-3, 3G-16, 3G-123, 3G-189, 3G-194, 3G-215 & 3G-230) revised in DCD Tier 2 Revision 3 for this response are attached.

DCD Impact

As stated above.

NRC RAI 3.8-96, Supplement 2

NRC Assessment from Chandu Patel E-mail Dated May 24, 2007

The applicant has not used a consistent set of criteria to determine the safety factor against sliding and also needs to provide the technical bases for some of the parameters used in the analysis results that are presented. The staff requests the applicant to address the following:

(1) The fourth bullet in the list of items that comprise the sliding resistance is identified as "passive soil pressure on walls." This terminology is misleading since the information included under this item is the elastic lateral soil pressure. If passive soil pressures are being credited to provide sliding resistance, explain how these pressures are calculated and confirm that the walls are designed to resist these forces. If elastic lateral soil pressures on the walls are being credited to provide sliding resistance, it is not consistent to use these elastic soil pressures with the passive soil pressures at the basemat side surface. Also, explain how the passive soil pressures are calculated for the basemat side surface.

(2) Passive soil pressure at the basemat side surface is being credited to provide sliding resistance, which means that the static friction resistance at the bottom of the basemat is overcome. Therefore, explain why a dynamic coefficient of friction is not used to calculate the friction force at the basemat bottom surface.

(3) How has GE determined that there are sufficient soil sites that would have an angle of internal friction of 30 degrees or greater? What would a COL applicant be required to do if a site has a soil friction angle of less than 30 degrees?

(4) Provide a description of the formulations used to calculate the cohesion resisting forces and discuss how the material properties were determined for the analysis.

(5) Provide the technical basis for assuming that medium soils with an angle of internal friction of 30 degrees would also have the effective cohesion resisting forces reported in the analysis results in Table 3.8-96(1). Why is the cohesion value in Table 3.8-96(1) equal to zero for soft soils?

(6) Provide the technical basis for assuming that the hard soil/rock conditions have the effective cohesion resisting forces reported in the analysis results in Table 3.8-96(1).

(7) Why does the response indicate that the cohesion force contribution to total force is small when Table 3.8-96(1) shows that it is quite large for hard soils? For the RBF medium soil condition, a small change in the cohesion force could result in a factor of safety of less than 1.1. In the light of these observations, further justification is needed to support the statement that the reduction of the cohesion due to uplift has little impact on the total resistance.

(8) Describe the COL requirements for the backfill material for the gap shown in Figures 3G.1-65 and 3G.2-15. Will the backfill material be required to have a stiffness defined by its shear wave velocity which is at least equal to the shear wave velocity of the surrounding insitu soil? If not, explain why not. Also, clarify that the backfill material will completely fill the gap above the concrete backfill to the grade level.

(9) The note in Table 3.8-96(1) implies that the 100-40-40 three directional combination method was used for the sliding evaluation. The data in the tables above the note, however indicate that a two dimensional (one horizontal and one vertical) check was made for calculating the factor of safety. In this evaluation the bottom friction force is derived based on the total vertical load consisting of dead weight minus the buoyancy effect minus 0.40 times the vertical seismic force. Since a simplified two dimensional approach (i.e., N-S & Vertical and then E-W & Vertical) is being used to demonstrate the factors of safety against sliding and overturning, the 100-40-40 rule is not considered to be appropriate. The typical approach that is utilized for checking sliding and overturning in accordance with the SRP 3.8.5 requirements is to use the dead load minus the buoyancy effect and then subtract the full vertical seismic load for the N-S & Vertical check and the E-W & Vertical check. If any other method is utilized, then GE needs to provide the technical justification for the approach. Note that 90% of the dead load (including the buoyancy effect) should be utilized as specified in Note 1 of DCD Table 3.8-15, which is also in accordance with ACI 349 requirements.

GEH Response

- (1) In the calculations shown in Table 3.8-96(1), elastic lateral soil pressures on the walls were credited to provide sliding resistance. This is conservative for sliding evaluation since actual passive pressures, if mobilized, would be higher. Wall design is based on elastic lateral soil pressures. As discussed in the response to Item (4), the required factor of safety can be satisfied without considering the sliding resistance from the elastic lateral soil pressures. Passive pressure is mobilized on the side surface of the basemat since the basemat is constrained by rigid concrete backfill. The passive pressure at the basemat side is calculated using the following equations:

$$P_p = k_p \gamma' H + \gamma_w H_w + k_p q + 2C \sqrt{k_p}$$
$$k_p = \frac{1 + \sin \phi}{1 - \sin \phi}$$

where,

- k_p = Passive pressure coefficient
- H = Height of soil column
- H_w = Height of water column
- γ' = Effective weight of soil. Use buoyant unit weight below water table and moist unit weight above water table.
- γ_w = Unit weight of water

- q = Magnitude of surcharge load per unit area
- ϕ = Angle of internal friction of soil
- C = Cohesion

The stress in the basemat generated by passive soil pressures is 2.45 MPa for the Hard site condition and is less than 10% of the concrete compressive strength. The stress is acceptable for the basemat design.

- (2) The shear strength of soil, i.e., the resistance at the basemat bottom, is composed of friction and cohesion. It is generally recognized that the strength of soil for dynamic loads is larger than that for static loads. Therefore, calculations using static coefficient of friction, i.e., calculations based on the static strengths, are conservative.
- (3) Table 2-6 from Reference 1 shows that a 30° angle of internal friction is a reasonable lower bound for competent soil material. A site-specific sliding evaluation would be performed if the angle of friction of the site-specific foundation material is lower than 30°. In DCD Tier 2 Subsection 2.0-1-A, the COL applicant referencing the ESBWR DCD is required to demonstrate that the site characteristics, which includes angle of internal friction, of a given site fall within ESBWR DCD design parameter values shown in DCD Tier 2 Table 2.0-1.

TABLE 2-6 Representative values for angle of internal friction ϕ

Soil	Type of test*		
	Unconsolidated-undrained U	Consolidated-undrained CU	Consolidated-drained CD
Gravel			
Medium size	40-55°		40-55°
Sandy	35-50°		35-50°
Sand			
Loose dry	28-34°		
Loose saturated	28-34°		
Dense dry	35-46°		43-50°
Dense saturated	1-2° less than dense dry		43-50°
Silt or silty sand			
Loose	20-22°		27-30°
Dense	25-30°		30-35°
Clay	0° if saturated	3-20°	20-42°

* See a laboratory manual on soil testing for a complete description of these tests, e.g., Bowles (1986b).

Notes:

- 1. Use larger values as γ increases
- 2. Use larger values for more angular particles
- 3. Use larger values for well-graded sand and gravel mixtures (EGW, SW)
- 4. Average values for
 - Gravels: 35-38°
 - Sands: 32-34°

- (4) In Reference 1 it is stated that the ultimate bearing capacity, q_u , can be nine times cohesion, c . In the same reference, it is suggested to use 0.5 to 0.7 of c for sliding stability evaluations. That is, the cohesion used for sliding evaluations, c' , can be evaluated by the following equation as a function of the ultimate bearing capacity:

$$c' = 0.5 \times q_u / 9 = q_u / 18$$

The expected ultimate bearing capacities of the ESBWR design need to be larger than the maximum soil bearing stresses summarized in the DCD Tier 2 Table 3G.1-58 for the RBFB and Table 3G.2-27 for the CB, respectively. These are the demand pressures.

Assuming the demand pressures are the actual ultimate bearing capacities, the associated cohesions can be conservatively evaluated by substituting the maximum soil bearing stresses into q_u in the above equation. The resulting cohesions are summarized in Table 3.8-96(2). The sliding stability evaluations were updated using these cohesions. The results are shown in Table 3.8-96(3). The calculated factors of safety (FS) satisfy the allowable value of 1.1. In DCD Tier 2 Revision 4, Tables 3G.1-57 and 3G.2-26 were revised in accordance with the results in Table 3.8-96(3). The revised pages 3G-123 and 3G-228 in DCD Tier 2 Revision 4 are attached.

In the calculations in Table 3.8-96(3), the elastic lateral soil pressures on the walls discussed in Item (1) above are conservatively neglected. The passive pressure utilized is only at the basemat side as described Item (1) above.

- (5) See response to Item (4) where cohesion is taken to be a function of the ultimate bearing capacity.
- (6) See response to Item (4) where cohesion is taken to be a function of the ultimate bearing capacity.
- (7) According to the basemat uplift analysis results, which are shown in the DCD Tier 2 Figures 3G.1-60 and 3G.1-61, the ratios of contact area of the basemat are about 80% and 85% for N-S and E-W directions, respectively. Since the cohesion is effective at the contact area only, it is reduced in proportion to the ratio of contact area. The FS listed in Table 3.8-96(3) have sufficient margins for the reduced contact area of 80%.
- (8) The shear wave velocity of the backfill material is not required to be at least equal to that of the surrounding in situ soil. This is because lateral soil/backfill was neglected in the design basis seismic analysis using the lumped-mass soil spring approach (DCD Tier 2 Subsection 3A.5.1). This approach was confirmed to be conservative as compared to the results of the SASSI analysis taking into account embedment (DCD Tier 2 Subsection 3A.8.7). The gap is completely filled with compacted engineered backfill material. This statement is included in notes to DCD Tier 2 Revision 4 Figures 3G.1-65 and 3G.2-17. The revised pages 3G-189 and 3G-245 in DCD Tier 2 Revision 4 are attached.

- (9) Alternate sliding stability is performed for the three dimensional seismic loads in accordance with the 100-40-40 rule.

Applied horizontal seismic forces and sliding resistances are schematically shown in Figure 3.8-96(1). Among the resistances, the basemat bottom friction and cohesion act in the direction of the resultant seismic force and their magnitudes are the same as those in the 2-dimensional evaluation.

Resistances due to the passive soil pressures applied to the basemat side surfaces are evaluated as follows:

Soil pressures are applied perpendicular to the basemat. The component in the direction of the seismic force is calculated by the following equation:

$$F = F_x \cos \theta + F_y \sin \theta \dots\dots\dots (1)$$

From the equilibrium of forces in the direction perpendicular to the seismic forces, the following equation needs to be satisfied:

$$F_x \sin \theta = F_y \cos \theta \dots\dots\dots (2)$$

By substituting Eq. (2) into Eq. (1), the following equations are obtained:

$$F_1 = \left(\cos \theta + \frac{\sin^2 \theta}{\cos \theta} \right) F_x = \left(\cos \theta + \frac{1 - \cos^2 \theta}{\cos \theta} \right) F_x = \frac{F_x}{\cos \theta} \dots\dots\dots (3a)$$

or

$$F_2 = \left(\sin \theta + \frac{\cos^2 \theta}{\sin \theta} \right) F_y = \left(\sin \theta + \frac{1 - \sin^2 \theta}{\sin \theta} \right) F_y = \frac{F_y}{\sin \theta} \dots\dots\dots (3b)$$

F_1 and F_2 reach their maximum values when F_x and F_y are equal to the resultant forces due to passive soil pressures. As a result, the resistance due to passive soil pressures is obtained by the following equations:

$$\begin{aligned} F_{pb1} &= F_{pbx} / \cos \theta \\ F_{pb2} &= F_{pby} / \sin \theta \dots\dots\dots (4) \\ F_{pbm} &= \min(F_{pb1}, F_{pb2}) \end{aligned}$$

where,

F_{pbx}, F_{pby} : Forces due to passive soil pressures in X and Y directions, respectively

The evaluation results are shown in Tables 3.8-96(4) and 3.8-96(5). The calculated factors of safety are similar to those in Table 3.8-96(3) for the two-dimensional approach using 40% of vertical seismic forces. Therefore, the use of 0.4 vertical seismic component in the two dimensional approach (i.e., N-S & Vertical and then E-W & Vertical) is justified for design evaluation.

As for dead load consideration, SRP 3.8.5 has no requirements for dead load reduction in sliding evaluation. The uncertainties in dead load are implicitly accounted for in the required minimum factor of safety. The 90% reduction specified in Note 1 of DCD Tier 2 Table 3.8-15 and ACI 349 is for design of structural members only and therefore it does not apply to the foundation sliding evaluation. However, the 90% reduction is conservatively considered in the calculations shown in Table 3.8-96(3) and in Tables 3.8-96(4) and 3.8-96(5).

Reference:

1. Bowles, Joseph E. Foundation Analysis and Design. 4th Edition. New York: McGraw-Hill, 1988.

Table 3.8-96(2) Cohesions Based on Maximum Soil Bearing Pressure

Building	RFBF			CB		
	Soft	Medium	Hard	Soft	Medium	Hard
Soil Condition						
Max. Soil Bearing Stress (MPa)	2.7	7.3	5.4	2.8	2.5	2.4
Cohesion coefficient (MPa)	0.15	0.41	0.30	0.16	0.14	0.13

Table 3.8-96(3) Updated Sliding Stability Evaluation Results

<RB>

Building width X	70.0 m					
Building width Y	49.0 m					
Total Weight	2360 MN					
Buoyancy	652 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	676 MN		1159 MN		1103 MN	
Minimum Vertical Load	1202 MN		1008 MN		1031 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<i>Fv: Horizontal Seismic Force (MN)</i>	899	787	1462	1619	1485	1243
Fub: Bottom Friction Force (MN)	694	694	582	582	773	773
Fc: Effective Cohesion Force (MN)	514	514	1391	1391	1029	1029
Fpb: Passive Pressure for Basemat (MN)	132	188	213	304	539	769
Fdsf: Passive Soil Pressure on Wall (MN)	0	0	0	0	0	0
<i>Fr: Sliding Resistance (=Fub+Fc+Fpb+Fdsf)</i>	1340	1397	2186	2277	2341	2572
FS (=Fr/Fv)	1.49	1.78	1.50	1.41	1.58	2.07

<CB>

Building width X	30.3 m					
Building width Y	23.8 m					
Total Weight	173 MN					
Buoyancy	101 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	91 MN		83 MN		90 MN	
Minimum Vertical Load	18 MN		22 MN		19 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<i>Fv: Horizontal Seismic Force (MN)</i>	124	124	109	118	115	122
Fub: Bottom Friction Force (MN)	11	11	12	12	14	14
Fc: Effective Cohesion Force (MN)	112	112	100	100	96	96
Fpb: Passive Pressure for Basemat (MN)	36	46	64	82	173	220
Fdsf: Passive Soil Pressure on Wall (MN)	0	0	0	0	0	0
<i>Fr: Sliding Resistance (=Fub+Fc+Fpb+Fdsf)</i>	159	169	177	195	283	331
FS (=Fr/Fv)	1.28	1.36	1.63	1.64	2.46	2.71

**Table 3.8-96(4) Sliding Evaluation Results for 3-dimensional Inputs:
RBF**

Building width X	70.0 m					
Building width Y	49.0 m					
Total Weight	2360 MN					
Buoyancy	652 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	676 MN		1159 MN		1103 MN	
Minimum Vertical Load	1202 MN		1008 MN		1031 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<3-dimenaional Evaluation> 1.0*NS+0.4*EW+0.4*V						
Factored Horizontal Seismic Force (MN)	899	315	1462	648	1485	497
Fvr: Resultant Seismic Force (MN)	953		1599		1566	
Fub: Bottom Friction Force (MN)	694		582		773	
Fc: Effective Cohesion Force (MN)	514		1391		1029	
Fpb1, Fpb2: Passive Pressure for Basemat (MN)	142	507	229	819	580	2072
Fpbm=min(Fpb1, Fpb2) (MN)	142		229		580	
Fr: Sliding Resistance (=Fub+Fc+Fpbm)	1350		2203		2382	
FS (=Fr/Fv)	1.42		1.38		1.52	
<3-dimenaional Evaluation> 0.4*NS+1.0*EW+0.4*V						
Factored Horizontal Seismic Force (MN)	360	787	585	1619	594	1243
Fvr: Resultant Seismic Force (MN)	865		1721		1378	
Fub: Bottom Friction Force (MN)	694		582		773	
Fc: Effective Cohesion Force (MN)	514		1391		1029	
Fpb1, Fpb2: Passive Pressure for Basemat (MN)	355	203	573	328	1450	829
Fpbm=min(Fpb1, Fpb2) (MN)	203		328		829	
Fr: Sliding Resistance (=Fub+Fc+Fpbm)	1411		2301		2631	
FS (=Fr/Fv)	1.63		1.34		1.91	

Table 3.8-96(5) Sliding Evaluation Results for 3-dimensional Inputs: CB

Building width X	30.3 m					
Building width Y	23.8 m					
Total Weight	173 MN					
Buoyancy	101 MN					
Soil Condition	Soft		Medium		Hard	
Vertical Seismic Load	91 MN		83 MN		90 MN	
Minimum Vertical Load	18 MN		22 MN		19 MN	
	NS dir	EW dir	NS dir	EW dir	NS dir	EW dir
<3-dimenaional Evaluation> 1.0*NS+0.4*EW+0.4*V						
Factored Horizontal Seismic Force (MN)	124	49	109	47	115	49
Fvr: Resultant Seismic Force (MN)	133		118		125	
Fub: Bottom Friction Force (MN)	11		12		14	
Fc: Effective Cohesion Force (MN)	112		100		96	
Fpb1, Fpb2: Passive Pressure for Basemat (MN)	39	123	69	221	187	594
Fpbm=min(Fpb1, Fpb2) (MN)	39		69		187	
Fr: Sliding Resistance (=Fub+Fc+Fpbm)	162		182		297	
FS (=Fr/Fv)	1.21		1.54		2.38	
<3-dimenaional Evaluation> 0.4*NS+1.0*EW+0.4*V						
Factored Horizontal Seismic Force (MN)	50	124	43	118	46	122
Fvr: Resultant Seismic Force (MN)	133		126		130	
Fub: Bottom Friction Force (MN)	11		12		14	
Fc: Effective Cohesion Force (MN)	112		100		96	
Fpb1, Fpb2: Passive Pressure for Basemat (MN)	97	49	173	88	466	237
Fpbm=min(Fpb1, Fpb2) (MN)	49		88		237	
Fr: Sliding Resistance (=Fub+Fc+Fpbm)	172		201		348	
FS (=Fr/Fv)	1.29		1.59		2.67	

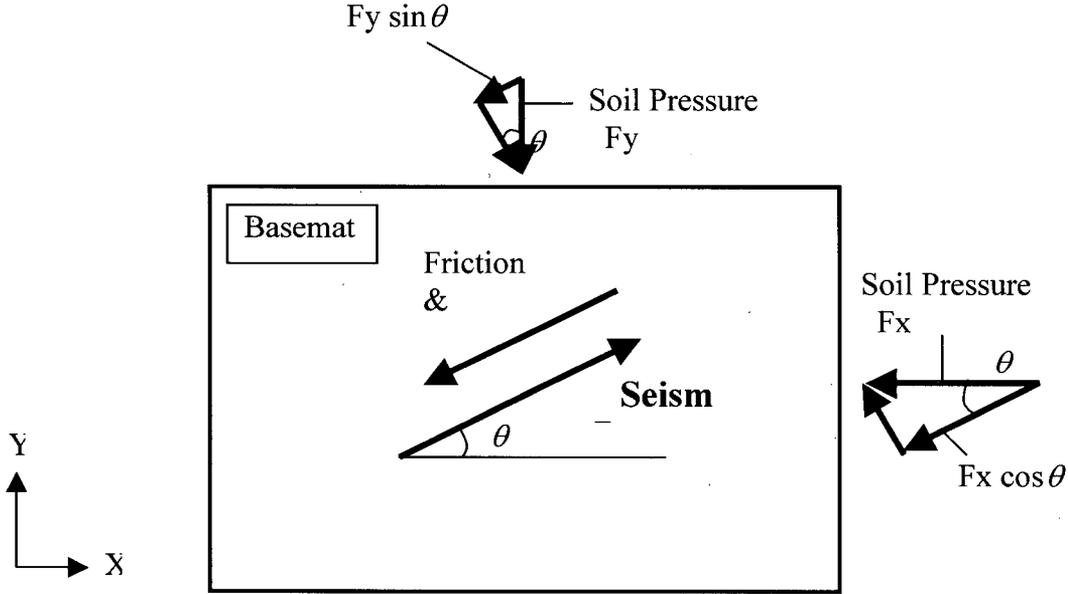


Figure 3.8-96(1) Horizontal Forces in Sliding Evaluation (Basemat Plan)

DCD Impact

No DCD change was made in response to this RAI Supplement.

NRC RAI 3.8-96, Supplement 3

The RAI Supplement 2 response, transmitted in GEH letter dated November 28, 2007, provided information to address nine items related to the stability analyses performed for the ESBWR foundations. The staff requests GEH to address the items discussed below which are still unresolved. The item numbers match the prior RAI Supplement 2 item numbers except for item number 10 which is a follow-up item from RAI 3.8-96, Supplement 1. Note that some of the items discussed below, in the context of sliding stability, are also applicable to overturning stability.

(1) In the equation given for passive soil pressure, why was the water pressure considered in resisting sliding, since there would be an equal and opposite water pressure on the other side of the building? Why wasn't the active soil pressure, on the entire foundation wall and basemat vertical edge, due to static and seismic loads considered on the other side of the building acting in the opposite direction to the passive pressures? Clearly define what surcharge loads (q) were utilized in the equation, because only known permanent surcharge loads (e.g., from other buildings) which would never be removed are appropriate.

(2)

- a. GEH states that the shear strength of the soil, i.e., the resistance at the basemat bottom, is composed of friction and cohesion. However, the procedure described by GEH would only apply to a sliding capacity calculation where failure occurs within the soil medium; it would not apply to a sliding capacity calculation at the concrete to soil interface. Therefore, GEH also needs to consider the sliding capacity caused by sliding resistance between the concrete and soil interface (alone). Typically this consists of the bottom friction resistance term given in Tables 3.8-96(3) and 3.8-96(4) of the RAI response which is identified as "Fub: Bottom Friction Force." If any additional sliding resistance due to cohesion between the soil and concrete at the foundation bottom is used, then describe this approach and explain how it compares to other industry analytical methods such as the Navy Design Manual DM7-02 (available from various websites). Such an approach would require having a cohesive soil which would then become a site interface parameter. This will then need to be placed in DCD Tier 1 and Tier 2, and will need to be satisfied by the COL applicant. Note that whatever approach is used for all soil stability calculations, the evaluations must cover all soil types/conditions that the design certification is intended to cover (e.g., soft, medium, and hard soils; cohesive soils and granular (cohesionless) soils; varying soil friction angle; etc.).*
- b. For the case of sliding frictional resistance capacity between the foundation mat and soil, the staff does not agree that the use of the static coefficient of friction is conservative. The shear force required to initiate sliding between two surfaces is usually greater than the force required to maintain motion, and therefore it is not conservative to use the higher value to resist sliding.*

Furthermore, the use of the static frictional resistance at the bottom of the basemat is not consistent with the use of the passive soil resistance at the vertical edge of the basemat. This is because to mobilize the full passive resistance at the vertical edge of the basemat requires some movement of the basemat, in which case, the dynamic sliding friction would be more applicable. Based on the above, GEH is requested to revise their approach to ensure that all of the resisting forces utilized to prevent sliding are developed using a consistent set of assumptions or provide justification for any alternative methods.

- (3) No additional information needed.*
- (4) The equation provided for the calculation of cohesion (c') for use in sliding evaluations does not appear to be appropriate for its intended use. That is because of the following items: (a) It appears that this equation which determines the cohesion value c' is only applicable for cohesive soils, not granular (cohesionless) soils; (b) The use of the cohesion value is applicable for soil shear capacity calculations where failure may occur within the soil medium; it would not be applicable for a sliding capacity calculation at the concrete to soil interface; (c) The relationship between q_u and cohesion c' and the recommended use of 0.5 to 0.7 of c' for sliding stability evaluations could not be located in Reference 1, which was referred to in the RAI response; (d) The magnitudes of the bearing capacities tabulated in Table 3.8-96(2), which are used to determine c' seem to be unrealistically high. They would require, for the RB/FB medium soil case for example, a soil bearing pressure capacity of 7.3MPa (153ksf) which are extremely large compared to known soil and rock capacities (also identified under RAI 3.8-94). Therefore, GEH is requested to provide the technical basis for application of their approach for all soil types/conditions (e.g., soft, medium, and stiff; cohesive soils and granular (cohesionless) soils; varying soil friction angle; etc.) that the design certification is intended to cover or utilize other accepted analytical methods typically used for sliding evaluations as discussed under item (2) above.*
- (5) and (6) Please revise the response to these items based on any revision to Item (4).*
- (7) The reduction in contact area between the foundation basemat and the soil, due to some overturning uplift from seismic loads, needs to be considered in the calculations, especially since the margins currently shown in the tables will change and may be reduced when the sliding calculations are revised to address the other items in this RAI.*
- (8)*
 - a. Confirm whether the response given means that the analysis and design of the SSCs in the ESBWR plant including development of the floor response spectra were all based on the enveloped responses for the lumped mass models and the SASSI models. If the analysis and design of the SSCs were based only on the lumped mass models, then did all of the building responses (i.e., member forces, nodal accelerations, nodal displacements, and floor*

- response spectra) from the lumped mass models bound the responses from the SASSI models?*
- b. *From the response to this item, it appears that the shear wave velocity of the backfill material does not have to match the surrounding undisturbed soil. Since the properties of the backfill material will likely be different, GEH is requested to identify the extent of excavation of the soil during the construction of the plant structures and identify what will be the requirements for the soil properties of the backfill material. If these are different than what were assumed in any of the seismic analyses and designs, then GEH is also requested to provide the technical basis for accepting the differences or confirm that the design basis building responses (including floor response spectra) bound the expected values of the backfill soil properties (including reduced shear wave velocities). In the case of the foundation walls, GEH is also requested to explain why the elastically calculated wall pressures from seismic and other loads are still appropriate in view of the soil properties (including reduced shear wave velocity) of the backfill material. Unless the analyses and design cover the entire range of possible backfill soil properties, the assumed soil properties for the backfill materials should be considered a requirement, and therefore, clearly stated in the DCD as a site requirement.*
- (9) *As noted in the staff's prior assessment of GEH RAI 3.8-96, Supplement 2, response, the traditional method for evaluating the stability (sliding and overturning) of nuclear plant structures in accordance with SRP 3.8 is to perform two separate 2-D evaluations, one for the N-S direction and one for the E-W direction. The minimum vertical downward load (deadweight minus upward buoyancy force minus upward vertical seismic force) is considered separately with the N-S horizontal seismic force and with the E-W horizontal seismic force.*

In calculating the total upward vertical seismic force, the total N-S horizontal seismic force, and the total E-W horizontal seismic force at the soil/foundation interface, it is acceptable to use either SRSS or 100-40-40 (as defined in RG 1.92, Rev. 2) to combine the individual RESPONSES from response spectrum analyses for the 3 directions of seismic loading. Thus, the SRSS or the 100-40-40 methods are used only to determine the individual total structural response in a given direction (e.g., total shear force in N-S direction) from the individual collinear responses due to each of the three perpendicular seismic excitations (i.e., N-S shear force due to N-S earthquake, N-S shear force due to E-W earthquake, and N-S shear force due to vertical earthquake). The approach GEH is using does not follow this method, but instead combines non-collinear structural responses (i.e., N-S shear force, E-W shear force, and vertical force) following the 100-40-40 method, which is unacceptable. In lieu of this, the results from a 3-D time history analysis using statistically independent inputs can be used, to search the time history response for the worst case combination of vertical and horizontal seismic responses, which minimize the sliding and overturning factors of safety when combined with deadweight and upward buoyancy force.

GEH's proposed application of the 100-40-40 method in this case is not consistent with the staff's acceptance of the method, which as stated in RG 1.92, Rev. 2, applies to combination of individual response components when RSA is used. On this basis, it is not acceptable to the staff. The two approaches described above are acceptable. If GEH chooses to apply an alternate method, then it will need to submit a comparison to results that would be achieved by either one of the two methods described above.

(10) The crystalline powder which is proposed by GEH for use in the mud mat concrete below the basemat and which is intended to provide waterproofing to prevent water infiltration or ex-filtration still raises some questions. It appears that the concrete mud mat is unreinforced and therefore, cracking of the mud mat is very likely to occur and the crystalline powder may not be effective in preventing water infiltration or ex-filtration. GEH is requested to provide technical information that demonstrates the effectiveness of the crystalline additive in concrete foundations. This information should include: the requirements necessary for proper use of this product, data which demonstrates its effectiveness under similar conditions (e.g., reinforced or unreinforced concrete, effect on concrete compressive strength, minimum thickness required for the concrete section, water pressure/head capacity and permeability versus water pressure/head, etc.), and what performance testing requirements will need to be satisfied during construction. In addition, specific information needs to be provided in the DCD regarding: the compressive strength of the concrete mud mat, if any reinforcement is needed, the acceptable range of thickness for the concrete mud mat, the inclusion of a statement (which was made in the Supplement 1 response) that "The mud mat construction is performed in accordance with the same standards and requirements as the basemat," and inclusion of performance testing requirements that will be needed during construction of the mud mat (e.g., permeability testing, compressive strength testing, etc.). GEH is also requested to explain what waterproofing system is relied upon to prevent infiltration of ground water through the walls below grade.

Revised GEH Response

- (1) The water pressure term in the passive pressure equation described in the response to NRC RAI 3.8-96, Supplement 2 was not considered in resisting sliding. The effect of active soil pressure is considered in the revised sliding evaluation (see Item 9 for details) in terms of a net lateral resistance pressure (i.e., the difference between passive and active pressures) that is required to achieve minimum 1.1 factor of safety against sliding. In this revised sliding evaluation, the permanent surcharge loads from the Turbine Building are also included as lateral soil force applied to the RB/FB.

- (2)
- a. See Item (9) on the revised sliding evaluation approach in which the cohesion resistance is ignored
 - b. See item (9) on the revised sliding evaluation approach in which all of the resisting forces utilized to prevent sliding and associated site interface parameters are defined.
- (3) In the NRC Audit in June 2008, the staff requested the following additional information.

For the sliding resistance between the basemat and mudmat, GEH needs to provide the technical basis for the coefficient of friction of 0.7. Currently ACI 349 Section 11.7.4.3 which states that μ is 0.6 concrete placed on concrete with surface not intentionally roughened and 1.0 if the surface is intentionally roughened as specified in 11.7.9 (roughened to $\frac{1}{4}$ inch).

The weak link at the sliding interface of concrete to soil is the soil, since the concrete surface in contact with soil is rough. As a result, the 0.7 coefficient of friction is controlled by the soil shear strength as a function of internal friction angle, $\tan(\phi)$, where ϕ is equal to 35 degrees. Since this friction angle results in a friction coefficient larger than 0.6, which is the value for concrete placed against hardened concrete not intentionally roughened in accordance with ACI 349 Section 11.7.4.3, roughening the mudmat top surface is required to ensure that the interface between the basemat and mudmat is not the controlling sliding surface. The following statement, "The top surface of the mudmat is intentionally roughened in accordance with ACI 349-01 Section 11.7.9 requirement." will be added to DCD Tier 2 Subsection 3.8.6.5.

- (4) The equation for the calculation of cohesion (c') is no longer used in the revised sliding evaluation in Item (9).
- (5) and (6) See Item (4).
- (7) The reduction in contact area between the foundation basemat and the soil, due to some overturning uplift from seismic loads, is considered in a separate calculation of bearing pressures in the response to RAI 3.8-94 S03, transmitted to the NRC on December 9, 2008 via MFN 06-407, Supplement 10.
- (8)
- a. The building responses are all based on the enveloped responses for the lumped mass models and the SASSI models.
 - b. The effects of backfill adjacent to building walls on structural response can be addressed in two aspects. One deals with the global SSI effect and other with the local wall pressures. For the global SSI effect, the design forces are controlled by non-embedded cases using lumped mass model as shown in DCD Tier 2 Subsection 3A.8.7. This has been further confirmed by additional SASSI analyses

for uniform sites taking into account embedment as discussed in RAI 3.8-94 S03. The effect of embedment on the design floor response spectra, as discussed in RAI 3.8-94 S03 is only limited to high frequency range at few locations in the CB and FPE. Inclusion of high frequency response in the design response spectra is a conservative design requirement without consideration of the beneficial effects of seismic wave incoherence. Therefore, it can be concluded that for the purpose of the global SSI response, no additional site interface requirements for the property of backfill material are needed in the DCD. For the local effect on wall lateral pressures, the main parameters are the density, Poisson's ratio and peak ground acceleration in accordance with the ASCE 4-98 Section 3.5.3.2 Elastic Solution method. To ensure the wall design seismic lateral pressures induced from backfill are not exceeded, a COL item will be added in DCD Tier 2 Table 2.0-1 to limit the product of peak ground acceleration (α) of the site-specific Foundation Input Response Spectra (FIRS) in g's, Poisson's ratio (ν) and density (γ) as follows:

$$\alpha (0.95\nu + 0.65) \gamma : 1220 \text{ kg/m}^3 (76 \text{ lbf/ft}^3) \text{ maximum}$$

Additional site interface parameters for backfill related to sliding are defined in Item (9) below.

- (9) This part of the RAI response presents the revised sliding evaluation. Time-consistent phasing between the horizontal base shear and vertical base force is considered to compute the sliding factor of safety as a function of time when combined with deadweight and upward buoyancy force. In this evaluation the base shears and base vertical forces calculated by SASSI analyses with embedment included are used. See RAI 3.8-94 S03 for details of additional SASSI analyses for uniform sites.

1. Soil Properties

The following soil properties are assumed in the sliding evaluation. They will be stated in the DCD Table 2.0-1 as site interface requirements.

- Angle of internal friction
 $\phi = 35$ degree minimum for all sites
- Backfill on sides of Seismic Category I structures (not applicable if the fill material is concrete)

Product of at-rest soil pressure coefficient (k_0) and density (γ)

$$k_0 \gamma : 750 \text{ kg/m}^3 (47 \text{ lbf/ft}^3) \text{ minimum}$$

Product of the difference of passive (k_p) and active pressure (k_a) coefficients and density (γ)

$$(k_p - k_a)\gamma : \quad 1100 \text{ kg/m}^3 \text{ (69 lbf/ft}^3\text{) minimum}$$

- Backfill underneath FWSC against shear keys (not applicable if the fill material is concrete)


At-rest pressure coefficient (k_0')

$$k_0' : \quad 0.36 \text{ minimum}$$

Difference of passive (k_p') and active pressure (k_a') coefficients

$$(k_p' - k_a') : \quad 2.5 \text{ minimum}$$

2. Sliding Evaluation Method

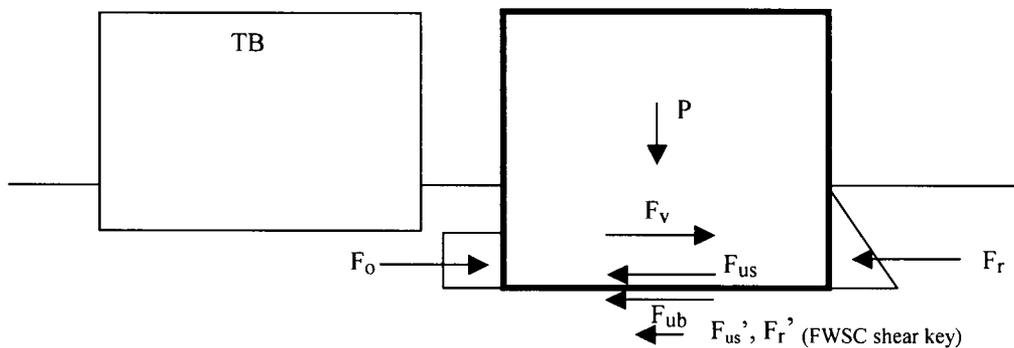

FS (factor of safety) is evaluated by taking the minimum values of the $FS(t)$ time history calculated per the following equation.

$$FS(t) = \frac{F_{ub}(t) + F_{us} + F_r + F_{us}' + F_r'}{F_v(t) + F_o} \dots\dots\dots(1)$$

where,

$F_v(t)$: Base shear time history at bottom of basemat.

F_o : Lateral soil force on RB due to TB surcharge load.

$F_{ub}(t)$: Friction resistance force provided by basemat bottom.

For "Dry sites" where ground water is below the foundation:

$$F_{ub}(t) = P \tan \phi = (0.9D - V_z(t)) \tan \phi$$

For "Wet sites" where ground water is above the foundation:

$$F_{ub}(t) = P \tan \phi = (0.9D - B) \tan \phi \quad (\text{undrained shear strength})$$

where D : Dead weight

$V_z(t)$: Vertical seismic force time history

B : Buoyancy

The vertical seismic force is not considered in the building stability calculations under the undrained seismic event. The peaks in seismographic strong motion time histories last only for hundredths of seconds which is at least an order of magnitude less than the time it takes to adjust pore pressures. The delay in adjustment of pore pressures results in that there is not enough time for the pore fluid to accommodate the changes in pore water pressure and the effective normal stress does not change, and hence, the shear strength does not change either. Therefore, the undrained shear strength is not affected by the vertical seismic loading.

F_{us} : Skin Friction resistance force provided by basemat side parallel to the direction of motion.

$$F_{us} = P_0 \tan \phi \dots \dots \dots (2)$$

where,

$P_0 = k_o \gamma LH^2/2$: At-rest soil force on the basemat side neglecting surcharge term and water pressure term

where, L : Length of basemat parallel to the direction of motion

H : Embedment depth

F_r : Lateral resistance pressure along the wall and basemat normal to the direction of motion.

Additional sliding resistance is provided by the side soil and it is defined to be the difference of the passive and active pressures. The net resistance is determined to achieve the required 1.1 FS, while not exceeding the at-rest soil pressure considered in the wall design.

$$F_r = (k_p - k_a) \gamma LH^2/2 \dots \dots \dots (3)$$

where, L : Length of building normal to the direction of motion

H : Embedment depth

F_{us}' : Skin Friction resistance force provided by FWSC shear-key side parallel to the direction of motion.

$$F_{us}' = P_0' \tan \phi \dots \dots \dots (4)$$

where,

$P_0' = k_o' qL'H'$: At-rest soil force on the FWSC shear-key side

where, q : FWSC surcharge load

L' : Length of shear-key parallel to the direction of motion

H' : Shear-key depth

F_r' : Lateral resistance pressure along FWSC shear-key normal to the direction of motion. The net resistance is determined to achieve the required 1.1 FS.

$$F_r' = (k_p' - k_a') qL'H' : \dots \dots \dots (5)$$

where, q : FWSC surcharge load

L' : Length of shear-key normal to the direction of motion

H' : Shear-key depth

3. Summary of Calculated FS

Summary

(1) Dry condition

	L-1		L-2		L-3		L-4		SOFT		MEDIUM		HARD	
	NS dir	EW dir												
RB/FB	1.86	3.50	-	-	2.30	3.42	-	-	2.43	3.04	1.68	2.27	1.98	2.54
CB	2.10	1.97	-	-	2.11	2.04	-	-	2.17	2.09	1.61	1.63	1.58	1.84
FWSC (H=3.0m)	1.27	1.33	1.10	1.34	1.28	1.49	1.12	1.28	1.28	1.48	1.27	1.33	1.12	1.18

(2) Undrained condition

	L-1		L-2		L-3		L-4		SOFT		MEDIUM		HARD	
	NS dir	EW dir												
RB/FB	1.66	2.87	-	-	1.86	2.89	-	-	1.92	2.51	1.53	2.05	1.66	2.04
CB	1.42	1.33	-	-	1.41	1.39	-	-	1.44	1.40	1.14	1.15	1.10	1.11
FWSC (H=3.0m)	1.45	1.46	1.33	1.57	1.53	1.67	1.33	1.54	1.50	1.62	1.55	1.63	1.44	1.62

Minimum FS

	Minimum
RB/FB	1.53
CB	1.10
FWSC	1.10

Cases L-2 and L-4 are not considered for RB/FB and CB. To be consistent with this limitation, a new site interface parameter for maximum ratio of shear wave velocity in adjacent layers will be added in DCD Tier 2 Table 2.0-1 to ensure that

the site layering does not have large contrast in shear wave velocities as generic layer sites L-2 and L-4 (see DCD Tier 2 Table 3A-3 for descriptions of layered sites) as follows:

Bottom 20 m (66 ft) layer to top 20 m (66 ft) layer: 2.5

Bottom 40 m (131 ft) layer to top 20 m (66 ft) layer: 2.5

Adjacent layers are the two layers with a total depth of 40 m (131 ft) or 60 m (197 ft) below grade. The first layer, termed top layer, covers the top 20 m (66 ft). The second layer, termed bottom layer, covers the next 20 m (66 ft) or 40 m (131 ft). The ratio is the average velocity of the bottom layer divided by the average velocity of the top layer. Either the lower bound seismic strain (i.e., strain compatible) profile or the best estimate low strain profile can be used since only the velocity ratio is of interest. This velocity ratio condition does not apply to the FWSC nor to the RB/FB and CB if founded on rock-like material having a shear wave velocity of 1067 m/sec (3500 ft/sec) or higher.

(10)

The integral crystalline material waterproofs and protects concrete in-depth and is applied as an admixture to the mud mat concrete mix at the time of batching. The crystalline waterproofing material can self-heal cracks up to 0.4 mm.

As an added waterproofing measure for any mud mat cracks exceeding 0.4 mm during basemat construction, once the mud mat has cured and just before pouring the basemat, the crystalline waterproofing material will be applied at the top surface of the mud mat. Once the basemat is poured, this added crystalline waterproofing material will penetrate into the mud mat to self-heal concrete cracks. In addition, any mud mat cracks will also be filled by the basemat cement paste.

Calculated maximum crack widths for the mud mat during normal conditions and for the basemat during construction and normal conditions are contained in Table 3.8-96(6). The basemat is designed to limit the concrete crack width during construction and normal conditions to no more than 0.4 mm.

Technical information that demonstrates the effectiveness of crystalline waterproofing material for concrete, including the requirements necessary for proper use of the product, data which demonstrates its effectiveness, and necessary performance testing requirements that need to be satisfied during construction, are attached as Attachment 3.8-96, Supplement 3(X), Attachment 3.8-96, Supplement 3(Y) and Attachment 3.8-96, Supplement 3(Z).

The mud mat is designed as structural plain concrete in accordance with ACI 318-05. The specified compressive strength of concrete at 28 days, or earlier, is 2500 psi for the mud mat. The thickness of the mud mat is no less than 8 inches. The performance testing requirements for the mud mat are those delineated in ACI 318-05. The mud mat construction is performed in accordance with the same standards and requirements as

the basemat. These mud mat details will be added as DCD Tier 2 Subsection 3.8.6.5 in Revision 6.

As stated in the response to NRC RAI 3.8-89, which was transmitted to the NRC via MFN 06-407 on November 8, 2006, a membrane waterproofing system is applied to the exterior walls and is relied upon to prevent infiltration of ground water through the exterior walls below grade.

Table 3.8-96(6) Calculated Maximum Crack Widths for Basemat and Mud-mat

	<i>During Construction *1</i>	<i>During Normal Condition</i>
<i>Basemat</i>	<i>0.13 mm</i>	<i>0.12 mm</i>
<i>Mud-mat</i>	---	<i>0.17 mm</i>

Note *1: Crack width at the basemat bottom of the first concrete layers during the second concrete pouring were calculated, based on the results of analyses performed for RAI 3.8-93 response.

DCD Impact

DCD Tier 1 Table 5.1-1 will be revised in Revision 6 as noted in the attached markup.

DCD Tier 2 Subsection 3.8.6.5 will be added, Tables 2.0-1, Subsections 3G.1.5.5, Table 3G.1-57, Subsections 3G.2.5.5, Table 3G.2-26, Subsections 3G.4.5.5, and Table 3G.4-22 will be revised, and Figures 3G.1-65, 3G.2-17, and 3G.4-11 will be deleted as noted in the attached markup. These changes will be made in Revision 6 of DCD Tier 2.

NRC RAI 3.8-96, Supplement 4

Based on the review of GEH RAI 3.8-96 S03 response, presented in GEH letter dated February 20, 2009, GEH is requested to address the items described below.

- A) In response to Item 3 on Page 21 of 27, the following statement is made. "The weak link at the sliding interface of concrete to soil is the soil, since the concrete surface in contact with soil is rough. As a result, the 0.7 coefficient of friction is controlled by the soil shear strength as a function of internal friction angle, $\tan(\phi)$, where ϕ is equal to 35 degrees. Since this friction angle results in a friction coefficient larger than 0.6, which is the value for concrete placed against hardened concrete not intentionally roughened in accordance with ACI 349 Section 11.7.4.3, roughening the mudmat top surface is required to ensure that the interface between the basemat and mudmat is not the controlling sliding surface. The following statement, "The top surface of the mudmat is intentionally roughened in accordance with ACI 349-01 Section 11.7.9 requirement." will be added to DCD Tier 2 Subsection 3.8.6.5."

This response however, appears to neglect potential sliding between the bottom of the mud mat and the soil surface, and implies that sliding will take place in the soil below the mud mat. GEH is requested to provide the technical basis for the statement that "the concrete surface in contact with the soil is rough", and as a result, the failure surface can only occur within the soil below the mud mat (e.g., providing appropriate references and/or test data). Alternatively, testing by the COL applicant may be required to demonstrate this assumption.

- B) In Item (8) (page 21 of 27), GEH indicates that the design forces on the walls of the NI are based on the envelope of SASSI runs for non-embedded cases using uniform half-space representations of a site as well the results of two layered soil cases using the embedded condition of the NI. Provide the following information for the embedded soil cases: (1) explain whether the input motions were defined at the basemat elevation, (2) if so, explain how the motions were converted to the appropriate input motions in SASSI problem, and (3) explain why the results of two layered cases can be considered as bounding for generic design. Also see requested information in new RAIs 3.7-69 and 71, that relate to this issue.

In the same section, GEH also provides the following recommendation: "To ensure the wall design seismic lateral pressures induced from backfill are not exceeded, a COL item will be added in DCD Tier 2 Table 2.0-1 to limit the product of peak ground acceleration (α) of the site-specific Foundation Input Response Spectra (FIRS) in g's, Poisson's ratio (ν) and density (γ) as follows: α ($0.95\nu + 0.65$) γ : 1220 kg/m³ (76 lbf/ft³) maximum." Provide an explanation and the basis for this recommendation.

- C) In Item (9) (pages 22 through 26 of 27), a description of the revised sliding evaluation is presented. This new calculation considers the static coefficient of friction beneath the basemat and on the side walls, passive soil pressures, and at rest soil pressures. As indicated in the prior revision to this RAI, the use of these terms should be based on a consistent set of expected deformations. For example, to develop the full passive pressure capability of the soil implies that sufficient

foundation deformation occurs. This may not be consistent with the use of the full static coefficient of friction. Therefore, provide detailed information which demonstrates that the individual forces used in the stability calculations are calculated in a consistent manner for the assumed foundation displacements.

- D) In Item (9), (page 24 of 27), the lateral resistance pressure (F_r) provided by the foundation/walls perpendicular to the direction of motion is defined to be the difference of the passive and active pressures. The paragraph also states that "The net resistance is determined to achieve the required 1.1 FS, while not exceeding the at-rest soil pressure considered in the wall design." For the FWSC, another term F_r' is defined as: "Lateral resistance pressure along the FWSC shear-key normal to the direction of motion. The net resistance is determined to achieve the required 1.1 FS." In Section 3 – Summary of Calculated FS, presented on page 25 of 27 of the RAI response, the minimum FS for the RB/FB is equal to 1.53, and for the CB and FWSC the FS is 1.1. GEH is requested to address the related items listed below.
- (a) For the RB/FB, if F_r is calculated such that the FS is equal to 1.1, explain why the Summary of Calculated FS in the RAI response states that FS is equal to 1.53 and not 1.1.
 - (b) Explain why F_r "is determined to achieve the required 1.1 FS, while not exceeding the at-rest soil pressure considered in the wall design." According to the DCD, the foundation walls are designed for the worst soil pressures resulting from either SASSI 2000 analysis or ASCE 4-98 methodology, not the at-rest soil pressure.
 - (c) For F_r' (used for the FWSC), there is no limitation on exceeding the at-rest soil pressure considered in the wall design, as there is for the other structures. Confirm that this was intended to be the case. If so, then were the shear keys designed for this potentially higher passive pressure load?
 - (d) In view of the confusion, for each of the three structures (RB/FB, CB, and FWSC), provide a description of the approach used to calculate each of the resisting forces, their calculated magnitudes (for the governing FS), and compare the total calculated pressures for these resisting forces to what were used in the actual design. This comparison should clearly demonstrate that the foundation walls were designed to the higher of the SASSI 2000 analysis, ASCE 4-98 methodology, and sliding stability required passive pressures.
- E) In Item (9) (page 24 of 27), the lateral resistance provided by the foundation/walls parallel to the direction of motion (i.e., vertical edges of the side foundation/walls) is given as $F_{us} = P_o \tan(\phi)$, where ϕ is the soil internal friction angle. Since waterproofing membrane will be used on the vertical edges of the foundation and walls, explain how will it be demonstrated that the coefficient of friction between soil and the membrane is greater than 0.7 (based on $\tan(\phi)$, where $\phi = 35$ degrees for the soil).
- F) In the description of the sliding evaluation method presented on page 24 of 27, the effective friction angle for wet sites is indicated to be determined from undrained

shear strength data. If, as indicated in the RAI responses provided by GEH, effective pore pressures under seismic conditions are deemed to remain unchanged during short seismic response times, explain why the effective friction angle is not defined as potentially zero, particularly for silty foundation soils.

- G) *In Item (10) (page 26 of 27), GEH indicates that "The basemat is designed to limit the concrete crack width during construction and normal conditions to no more than 0.4mm." Item (10) also states that "The mud mat is designed as structural plain concrete in accordance with ACI 318-05." Since the concrete is identified as plain concrete, it is not clear whether any reinforcement is utilized in the mud mat. Explain whether the design of the mud mat includes sufficient reinforcement: to limit cracks to no more than 0.4mm and to address temperature and shrinkage effects in accordance with ACI code requirements. Identify where the reinforcement requirements for the mud mat are defined in the DCD.*
- H) *In Item (10) (page 26 of 27), GEH indicates that a membrane waterproofing system is applied to the exterior walls and is relied upon to prevent infiltration of ground water through the exterior walls below grade. This does not address the RAI question which asked what waterproofing system is relied upon. GEH should provide information such as the type of waterproofing material, thickness, and whether the provisions of an industry standard such as ACI 515.1R-79 (revised 1985) will be used.*
- I) *GEH is requested to revise other applicable sections of the DCD (Section 3.8 and related appendices) that are affected by the revised calculation for sliding stability. As an example, DCD Tier 2, Section 3.8.5.5 – Structural Acceptance Criteria does not reflect the current approach being used.*

GEH Response

- A) The assumed 0.7 coefficient of friction can be achieved as long as the angle of internal friction, which is a site interface requirement, is no less than 35 degrees. In order to ensure that the failure surface can only occur within the soil below the mud mat and to justify the use of a 0.7 coefficient of friction, troughs are provided on the ground surface before the mud mat is poured. The size of the troughs is approximately 150 mm (6 in) wide and 100 mm (4 in) deep. They are arranged in a grid pattern with no larger than a 2.5 m (8.2 ft) spacing distributed over the footprint of the mud mat. The trough size and spacing are determined such that the mud mat concrete shear stress due to the friction forces is less than the ACI 349-01 allowable concrete shear stress. The trough requirements will be added to DCD Tier 2 Subsection 3.8.6.5 in Revision 6.
- B) The following information is for the embedded soil cases:
- (a) The input motions for the embedded soil cases are defined as outcrop motion at the basemat bottom elevation.

- (b) These foundation input motions are converted to the surface motions by a SHAKE analysis in which the entire column was used. These surface motions are then used as input motion in SASSI2000.
- (c) The two layered site soil Cases L-2 and L-4 are no longer excluded in the soil bearing and sliding evaluations. Please see GEH's response to NRC RAI 3.8-94 S04 (MFN 09-388, dated 6/12/09).

The seismic lateral pressure limit, $\alpha (0.95\nu + 0.65) \gamma$, is derived from the resultant force F_r equation in ASCE 4-98, Figure 3.5-2, as follows:

$$F_r = \alpha C_v \gamma H^2 \quad (\text{from Figure 3.5-2 of ASCE 4-98})$$

where,

- α : horizontal earthquake acceleration (g)
- γ : soil unit weight
- H : embedment height
- C_v : coefficient as a function of Poisson's ratio, ν . A numerical analysis of this equation shows that C_v , the coefficient as a function of Poisson's ratio, can be approximated by a straight line, $0.95\nu + 0.65$, as shown in Figure 3.8-96(4).

C) The magnitude of foundation deformation is evaluated for wall rotation as a ratio of the horizontal displacement at grade relative to base to the height of the embedded wall. Among all SASSI results, the maximum rotation of the embedded RB/FB and the CB are 0.0008 (0.08%) and 0.0002 (0.02%), respectively, which are much smaller than the wall movement required for the development of passive pressures in accordance with Figure 1 in Chapter 3 of the Navy Design Manual 7.02 (NRC RAI 3.8-96 S04, Reference 1). Therefore, the foundation can be treated as being in a non-displaced state using the static coefficient of friction. The individual forces used in the revised stability calculations are calculated in a consistent manner for the non-slide condition. Shear keys are provided as needed to ensure a non-slide condition. Details are presented in the updated sliding evaluation at the end of this supplemental response.

D)

- (a) The 1.1 minimum factor of safety (FS) is the most critical for the Seismic Category I structures. In the previous evaluation, the CB is most critical and the RB/FB has a larger FS. As explained in Item C) above, the sliding evaluation will be updated and the FS values will also be revised.
- (b) The foundation walls are designed for the combined loads of the at-rest soil pressures and the seismic lateral pressures resulting from the SASSI analysis and ASCE 4-98 elastic solution. In the updated evaluation presented below, F_r is set to be the wall design pressure of at-rest plus seismic.
- (c) There is no F_r limitation for the FWSC because the FWSC has no embedded walls. The shear keys for the FWSC are attached to the bottom of basemat

and are designed to the differential pressure between soil passive pressures and active pressure, k_p-k_a .

- (d) The sliding evaluation approach used and results obtained are described for each structure at the end of this supplemental response.
- E) The skin friction, F_{us} , is considered for the basemat only and not for the walls. The vertical edges of the basemat do not use a waterproofing membrane and instead are sprayed with the crystalline waterproofing material to ensure that the 0.7 coefficient of friction is achieved.
- F) The vertical seismic responses will be included in all cases. The revised sliding evaluation and results are in the "Detailed Evaluation" below.
- G) As stated in Part (10) of GEH's response to NRC RAI 3.8-96 S03 (MFN 06-407 S14, dated 2/20/09), the mud mat is designed as Plain Concrete. The mud mat contains no reinforcement. It is used to provide a level surface for construction. As required by ACI 318-05 Chapter 22, contraction joints will be used to limit the spread of cracking due to creep, shrinkage, and temperature effects. The crystalline waterproofing material will be applied to the top surface of the mud mat as an added waterproofing measure for any mud mat cracks exceeding 0.4 mm during basemat construction. Once the basemat is poured, this added crystalline waterproofing material will penetrate into the mud mat to self-heal concrete cracks. In addition, any mud mat cracks will be filled by the basemat cement paste.
- H) The type of the waterproofing system applied to the exterior walls is sheet-applied barrier materials described in Section 4.2.1.4 of ACI 515.1R-79 (revised 1985) (e.g. non-vulcanized butyl rubber sheet). The thickness of the waterproofing sheet is 2.0 mm. Two layers of sheets are applied to the exterior walls below grade.
- I) The revised sliding evaluation and results are in the "Detailed Evaluation" below. DCD Tier 2 Subsections 3.8.5.5, 3.8.6.5 and 3G.1.5.5, Tables 2.0-1, 3G.1-57 and 3G.2-26 and Figures 3G.1-1, 3G.1-6, 3G.1-7 and 3G.4-1 will be revised in Revision 6 accordingly.

Reference:

1. Naval Facilities Engineering Command, "Foundations & Earth Structures," Navy Design Manual 7.02, September 1986.

Detailed Evaluation

1. Soil Properties


The following soil properties are assumed in the sliding evaluation. They are site parameter requirements for backfill on the sides and underneath of Seismic Category I structures:

- Angle of internal friction
 $\phi = 35$ degree minimum
- Soil density
 $\gamma = 1900 \text{ kg/m}^3$ (119 lbf/ft³) minimum
- At-rest pressure coefficient
 $k_o = 0.36$ minimum
- Product of at-rest soil pressure coefficient and density
 $k_o\gamma = 750 \text{ kg/m}^3$ (47 lbf/ft³) minimum

2. Sliding Evaluation

Time-consistent phasing between the horizontal base shear and vertical base force is considered to compute the sliding factor of safety (FS(t)) as a function of time when combined with deadweight and upward buoyancy force.

(a) RB/FB Structure

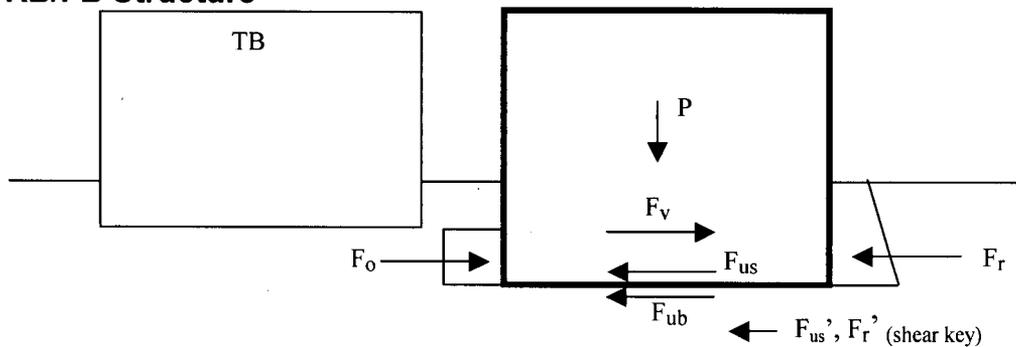

The FS is evaluated by taking the minimum values of the FS(t) time history calculated per the following equation:

$$FS(t) = \frac{F_{ub}(t) + F_{us} + F_r + F_{us}' + F_r'}{F_v(t) + F_o} \dots\dots\dots(1)$$

where,

$F_v(t)$: Base shear time history at bottom of basemat.

F_o : Lateral soil force on RB due to TB surcharge load.

$F_{ub}(t)$: Friction resistance force provided by basemat bottom.

$$F_{ub}(t) = P \tan\phi = (0.9D - B - V_z(t)) \tan\phi \dots\dots\dots(2)$$

where D : Dead weight

$V_z(t)$: Vertical seismic force time history

B : Buoyancy

F_{us} : Skin friction resistance force provided by basemat side parallel to the direction of motion.

$$F_{us} = P_o \tan \phi \dots \dots \dots (3)$$

where,

$$P_o = k_o \gamma L (H_2^2 - H_1^2) / 2:$$

At-rest soil force on the basemat side neglecting surcharge term and water pressure term

L : Skin friction length of both sides of basemat parallel to the direction of motion

H_1, H_2 : Embedment depths at the top and bottom of basemat

F_r : Lateral resistance pressure along the wall and basemat opposite to the direction of motion. It is equal to the wall design lateral pressure, which consists of at-rest static earth pressures and dynamic earth pressures calculated from the SASSI analysis and the ASCE 4-98 elastic solution.

F_{us}' : Skin friction resistance force provided by shear key side parallel to the direction of motion.

$$F_{us}' = P_o' \tan \phi \dots \dots \dots (4)$$

where,

$$P_o' = k_o \gamma L' (H_3^2 - H_2^2) / 2 + k_o q L' (H_3 - H_2):$$

At-rest soil force on the shear key side

q : Surcharge load of RB/FB

L' : Skin friction length of both sides of shear key parallel to the direction of motion

H_2, H_3 : Embedment depths at the top and bottom of shear key

F_r' : Lateral resistance pressure along shear key opposite to the direction of motion.

$$F_r' = (k_p - k_a) \gamma L' (H_3^2 - H_2^2) / 2 + (k_p - k_a) q L' (H_3 - H_2) \dots \dots \dots (5)$$

where,

$$k_p = (1 + \sin \phi) / (1 - \sin \phi): \quad \text{Rankine's passive pressure coefficient}$$

$$k_a = (1 - \sin \phi) / (1 + \sin \phi): \quad \text{Rankine's active pressure coefficient}$$

q : Surcharge load of RB/FB

L' : Length of shear key opposite to the direction of motion

H_2, H_3 : Embedment depths at the top and bottom of shear key


The following are calculation results of individual forces for the RB/FB at the RL-2 site in the NS direction, which is the governing FS case:

$$\begin{aligned} F_v(t) &= 1,106 \text{ MN} \quad (t = 7.175 \text{ sec}) \\ F_o &= 128 \text{ MN} \\ F_{ub}(t) &= 359 \text{ MN} \quad (t = 7.175 \text{ sec}) \\ F_{us} &= 52 \text{ MN} \\ F_r &= 497 \text{ MN} \\ F_{us}' &= 88 \text{ MN} \\ F_r' &= 391 \text{ MN} \end{aligned}$$

$$FS = 1.12$$

The shear key configuration is shown in Figure 3.8-96(2). The reinforcement in the shear key is determined to resist full capacity of the passive pressure less the active pressure.

(b) CB Structure

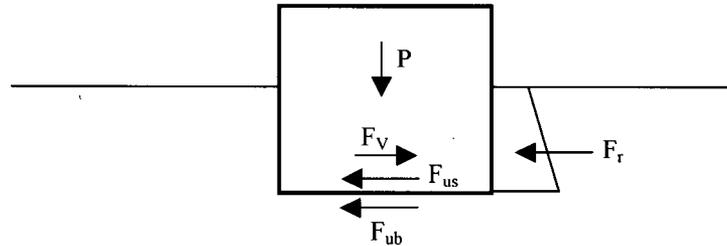

The *FS* is evaluated by taking the minimum values of the *FS(t)* time history calculated per the following equation:

$$FS(t) = \frac{F_{ub}(t) + F_{us} + F_r}{F_v(t)} \dots\dots\dots(6)$$

where,

$F_v(t)$: Base shear time history at bottom of basemat.

$F_{ub}(t)$: Friction resistance force provided by basemat bottom.

$$F_{ub}(t) = P \tan \phi = (0.9D - B - V_z(t)) \tan \phi \dots\dots\dots(7)$$

where D : Dead weight

$V_z(t)$: Vertical seismic force time history

B : Buoyancy

F_{us} : Skin friction resistance force provided by basemat side parallel to the direction of motion.

$$F_{us} = P_o \tan \phi \dots\dots\dots(8)$$

where,

$$P_o = k_o \gamma L (H_2^2 - H_1^2) / 2:$$

At-rest soil force on the basemat side neglecting surcharge term and water pressure term

L : Skin friction length of both sides of basemat parallel to the direction of motion

H_1, H_2 : Embedment depths at the top and bottom of basemat

F_r : Lateral resistance pressure along the wall and basemat opposite to the direction of motion. It is equal to the wall design lateral pressure, which consists of at-rest static earth pressures and dynamic earth pressures calculated from the SASSI analysis and the ASCE 4-98 elastic solution.


The following are calculation results of individual forces for the CB at the CL-2 site in the NS direction, which is the governing FS case:

$$F_v(t) = 128 \text{ MN } (t = 7.375 \text{ sec})$$

$$F_{ub}(t) = 26 \text{ MN } (t = 7.375 \text{ sec})$$

$$\begin{aligned}
 F_{us} &= 13 \text{ MN} \\
 F_r &= 132 \text{ MN} \\
 FS &= 1.33
 \end{aligned}$$

(c) FWSC Structure

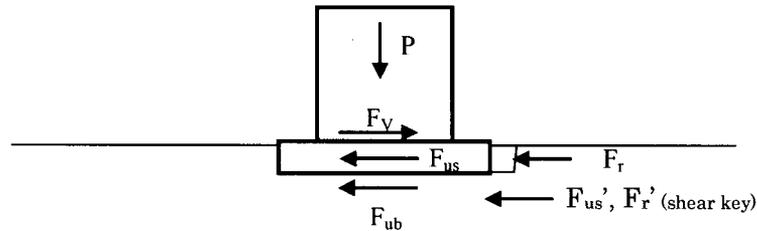

The FS is evaluated by taking the minimum values of the FS(t) time history calculated per the following equation:

$$FS(t) = \frac{F_{ub}(t) + F_{us} + F_r + F_{us}' + F_r'}{F_v(t)} \dots\dots\dots(9)$$

where,

$F_v(t)$: Base shear time history at bottom of basemat.

$F_{ub}(t)$: Friction resistance force provided by basemat bottom.

$$F_{ub}(t) = P \tan \phi = (0.9D - B - V_z(t)) \tan \phi \dots\dots\dots(10)$$

where D : Dead weight

$V_z(t)$: Vertical seismic force time history

B : Buoyancy

F_{us} : Skin friction resistance force provided by basemat side parallel to the direction of motion.

$$F_{us} = P_o \tan \phi \dots\dots\dots(11)$$

where,

$$P_o = k_o \gamma L H_1^2 / 2:$$

At-rest soil force on the basemat side neglecting surcharge term and water pressure term

L : Skin friction length of both sides of basemat parallel to the direction of motion

H_1 : Embedment depth of basemat

F_r : Lateral resistance pressure along the wall and basemat opposite to the direction of motion. It is equal to the wall design lateral pressure, which consists of at-rest static earth pressures and dynamic earth pressures calculated from the SASSI analysis and the ASCE 4-98 elastic solution.

F_{us}' : Skin friction resistance force provided by shear key side parallel to the direction of motion.

$$F_{us}' = P_o' \tan \phi \dots\dots\dots(13)$$

where,

$$P_o' = k_o \gamma L' (H_2^2 - H_1^2) / 2 + k_o q L' (H_2 - H_1):$$

At-rest soil force on the shear key side

q : Surcharge load of FWSC

L' : Skin friction length of both sides of shear key parallel to the direction of motion

H_1, H_2 : Embedment depths at the top and bottom of shear key

F_r' : Lateral resistance pressure along shear key opposite to the direction of motion.

$$F_r' = (k_p - k_a) \gamma L' (H_2^2 - H_1^2) / 2 + (k_p - k_a) q L' (H_2 - H_1) \dots\dots\dots(14)$$

where,

$k_p = (1 + \sin\phi) / (1 - \sin\phi)$: Rankine's passive pressure coefficient

$k_a = (1 - \sin\phi) / (1 + \sin\phi)$: Rankine's active pressure coefficient

q : Surcharge load of FWSC

L' : Length of shear key opposite to the direction of motion

H_1, H_2 : Embedment depths at the top and bottom of shear key

The following are calculation results of individual forces for the FWSC at the FL-2 site in the NS direction, which is the governing FS case:

$$\begin{aligned} F_v(t) &= 104 \text{ MN} \quad (t = 7.165 \text{ sec}) \\ F_{ub}(t) &= 41 \text{ MN} \quad (t = 7.165 \text{ sec}) \\ F_{us} &= 1 \text{ MN} \\ F_r &= 4 \text{ MN} \\ F_{us}' &= 11 \text{ MN} \\ F_r' &= 57 \text{ MN} \\ FS &= 1.10 \end{aligned}$$

The shear key configuration is shown in Figure 3.8-96(3). The reinforcement in the shear key is determined to resist full capacity of the passive pressure less the active pressure.

3. Summary of Calculated FS

The calculated FS for the RB/FB, CB and FWSC for all site cases are summarized in Table 3.8-96(7).

Table 3.8-96(7) Summary of Factor of Safety for Sliding

	L-1		L-2		L-3		L-4		SOFT		MEDIUM		HARD		Minimum FS
	NS dir.	EW dir.													
RB/FB	2.46	5.24	1.12	1.45	2.95	5.17	1.19	1.49	3.16	4.55	2.23	3.50	2.61	3.90	1.12
CB	2.61	2.84	1.33	1.77	2.62	2.95	1.34	1.76	2.68	3.01	2.02	2.39	1.98	2.57	1.33
FWSC	1.28	1.45	1.10	1.48	1.29	1.65	1.12	1.44	1.29	1.63	1.28	1.49	1.12	1.32	1.10

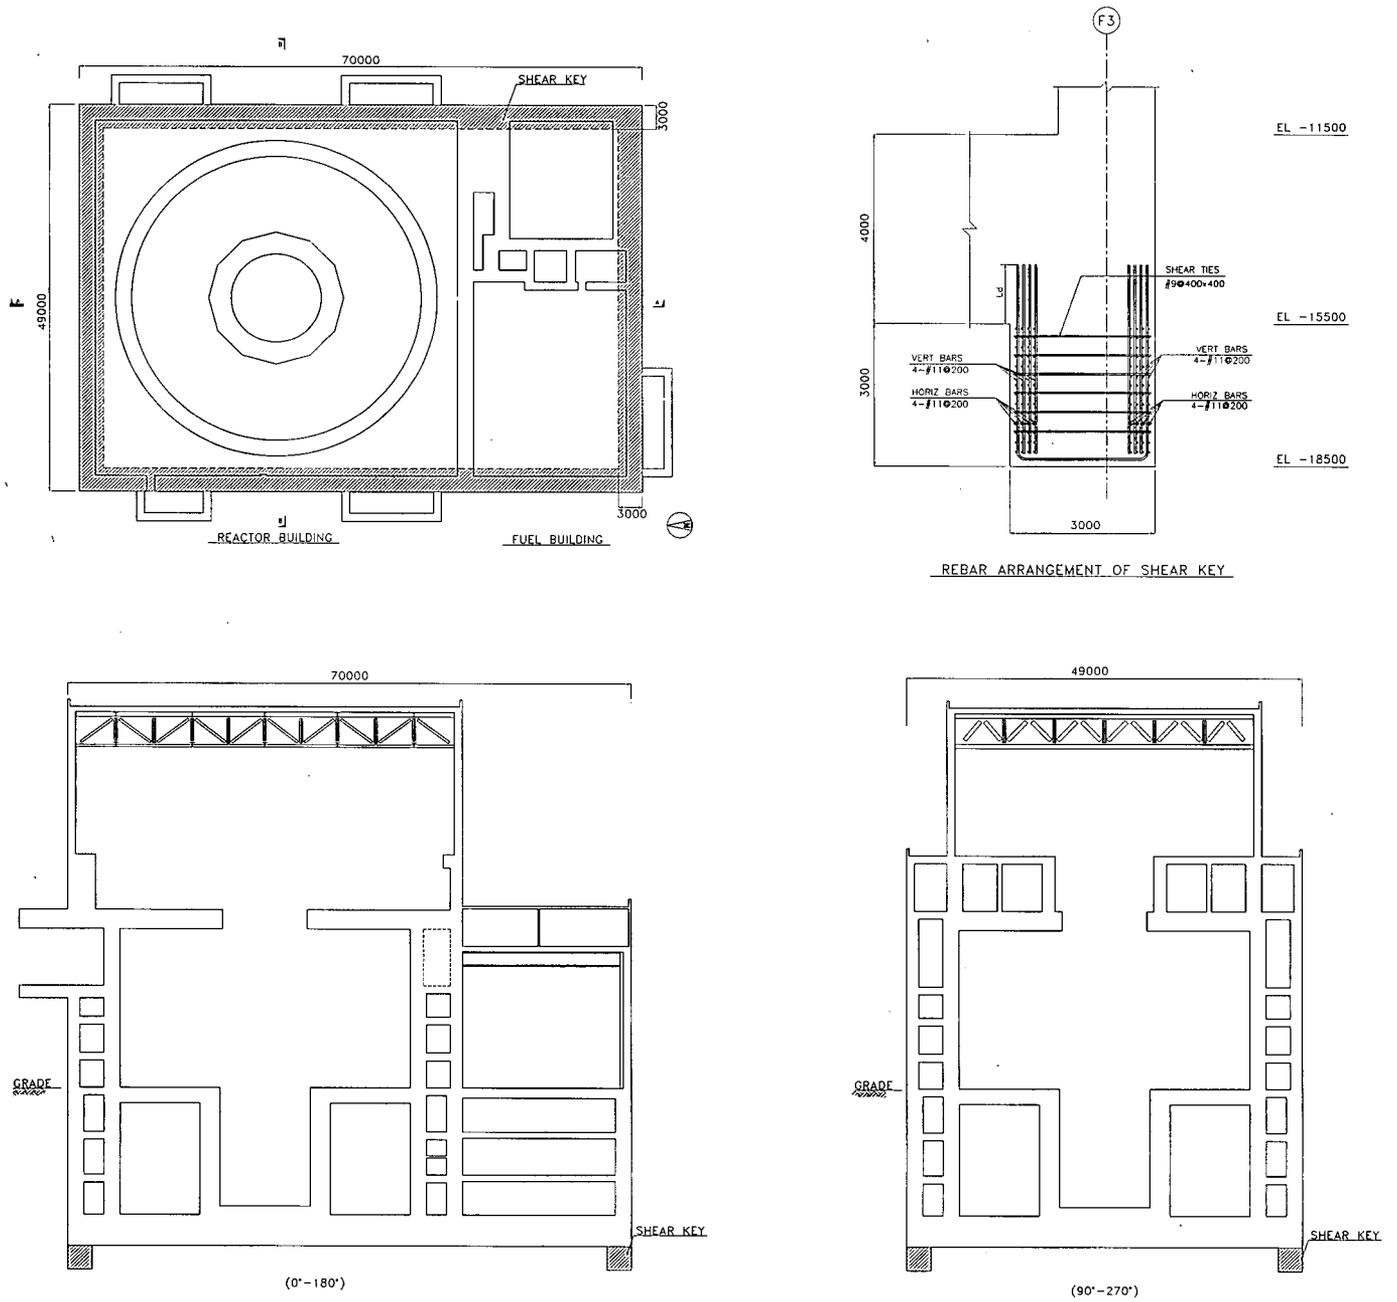


Figure 3.8-96(2) Shear Key Configuration for the RB/FB Structure

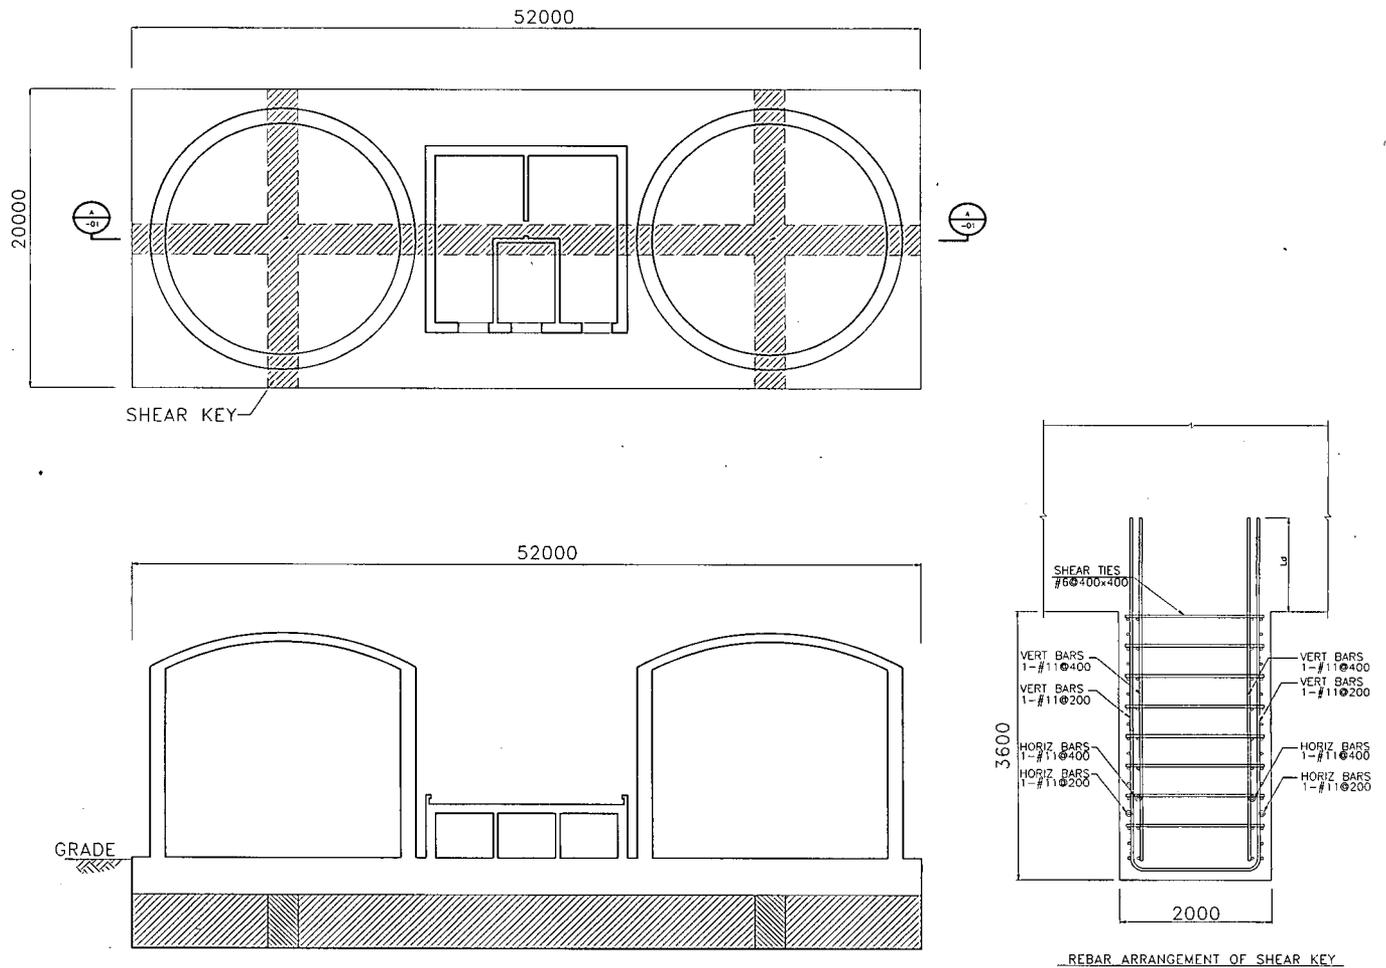


Figure 3.8-96(3) Shear Key Configuration for the FWSC Structure

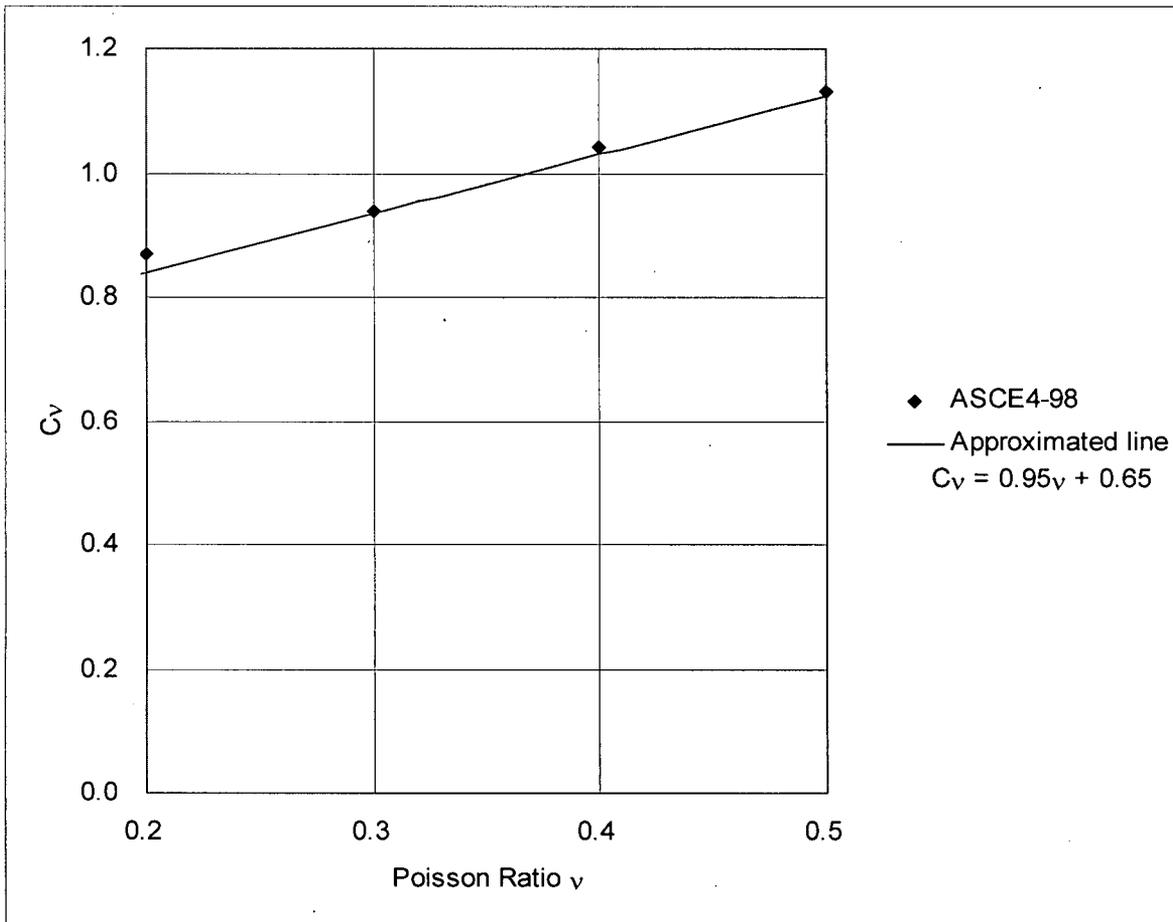


Figure 3.8-96(4) Coefficient as a Function of Poisson's Ratio

DCD Impact

DCD Tier 2 Subsections 3.8.5.5, 3.8.6.5 and 3G.1.5.5, Tables 2.0-1, 3G.1-57 and 3G.2-26 and Figures 3G.1-1, 3G.1-6, 3G.1-7 and 3G.4-1 will be revised in Revision 6 as noted in the attached markups.

Enclosure 3

MFN 09-449

**Response to Portion of NRC Request for
Additional Information Letter No. 323
Related to ESBWR Design Certification Application**

DCD Markups for RAI Number 3.8-96 S04

Public Version

Table 2.0-1
Envelope of ESBWR Standard Plant Site Parameters (continued)

Soil Properties: ⁽¹⁶⁾	<p>- Minimum Maximum Static Bearing Capacity Demand: ⁽⁷⁾</p> <p>Reactor/Fuel Building: 699 kPa (14,600 lbf/ft²)</p> <p>Control Building: 292 kPa (6,100 lbf/ft²)</p> <p>Firewater Service Complex: 165 kPa (3,450 lbf/ft²)</p> <p>- Minimum Maximum Dynamic Bearing Capacity Demand (SSE + Static): ⁽⁷⁾</p> <p>Reactor/Fuel Building:</p> <p>Soft: 271100 kPa (2536,4000 lbf/ft²)</p> <p>Medium: 732700 kPa (152,556,400 lbf/ft²)</p> <p>Hard: 541100 kPa (1123,0800 lbf/ft²)</p> <p>Control Building:</p> <p>Soft: 280500 kPa (58,510,500 lbf/ft²)</p> <p>Medium: 22500 kPa (4652,0300 lbf/ft²)</p> <p>Hard: 24200 kPa (850,8200 lbf/ft²)</p> <p>Firewater Service Complex (FWSC):</p> <p>Soft: 4460 kPa (9,6200 lbf/ft²)</p> <p>Medium: 69540 kPa (141,3400 lbf/ft²)</p> <p>Hard: 120670 kPa (2514,1000 lbf/ft²)</p> <p>- Minimum Shear Wave Velocity: ⁽⁸⁾ 300 m/s (1000 ft/s)</p> <p>- Liquefaction Potential:</p> <p>Seismic Category I Structures None under footprint of Seismic Category I structures resulting from site-specific SSE.</p> <p>Other than Seismic Category I Structures See Note (14)</p> <p>- Angle of Internal Friction ≥ 35 degrees</p> <p>(in-situ and backfill)</p> <p>- Backfill on sides of and underneath Seismic Category I structures (not applicable if the fill material is concrete)</p> <p>Product of peak ground acceleration α (in g), Poisson's ratio ν and density γ</p> <p>$\alpha(0.95\nu+0.65)\gamma$: 1220 kg/m³ (76 lbf/ft³) maximum</p> <p>Product of at-rest pressure coefficient k_0 and density:</p> <p>$k_0\gamma$: 750 kg/m³ (47 lbf/ft³) minimum</p> <p>At-rest pressure coefficient:</p> <p>k_0: 0.36 minimum</p> <p>Soil density:</p> <p>γ: 1900 kg/m³ (119 lbf/ft³) minimum</p>
Seismology:	<p>- SSE Horizontal Ground Response Spectra: ⁽⁹⁾ See Figure 2.0-1</p> <p>- SSE Vertical Ground Response Spectra: ⁽⁹⁾ See Figure 2.0-2</p>

This iterative process is continued until there are no more springs in tension. The analysis results confirmed the adequacy of the basemat design. Details are provided in Appendix 3G.1.5.5.1.

The selected waterproofing material for the bottom of the basemat is a chemical crystalline powder that is added to the mud mat mixture forming a water proof barrier when cured. No membrane waterproofing is used under the foundations in the ESBWR.

The standard ESBWR design is developed using a range of soil conditions as detailed in Appendix 3A. The minimum requirements for the physical properties of the site-specific subgrade materials are furnished in Table 2.0-1. Stability of subsurface materials and foundations are addressed in Table 2.0-2, Subsection 2.5.4. Settlement of the foundations, and differential settlement between foundations for the site-specific foundations medium, is calculated, and safety-related systems (i.e., piping, conduit, etc.) designed for the calculated settlement of the foundations. The effect of the site-specific subgrade stiffness and calculated settlement on the design of the Seismic Category I structures and foundations is evaluated.

A detailed description of the analytical and design methods for the foundations of the RB including the containment, CB, FB and FWSC is included in Appendix 3G.

3.8.5.5 Structural Acceptance Criteria

*[The structural acceptance criteria for the containment foundation and for the other Seismic Category I foundations are the same as those for their respective superstructures with additional foundation stability requirements consistent with SRP 3.8.5 Section II.5.]**

The main structural criteria for the containment portion of the foundation are to provide adequate strength to resist loads and sufficient stiffness to protect the containment liner from excessive strain. The acceptance criteria for the containment portion of the foundation mat are presented in Subsection 3.8.1.5. The structural acceptance criteria for the RB, CB, FB and FWSC foundations are described in Subsection 3.8.4.5.

*[The allowable factors of safety of the ESBWR structures for overturning, sliding, and flotation are included in Table 3.8-14.]** The calculated factors of safety are shown in Appendix 3G for each foundation mat evaluated according to the following procedures.

The factor of safety against overturning due to earthquake loading is determined by the energy approach described in Subsection 3.7.2.14.

The factor of safety against sliding is defined as:

$$FS = (F_{ub} + F_{us} + F_r + F_{us}' + F_r'F_s + F_p) / (F_v + F_oF_d + F_h)$$

Notations are as follows: where F_s and F_p are the shearing and sliding resistance, and passive soil pressure resistance, respectively. F_d is the maximum lateral seismic force including any dynamic active earth pressure, and F_h is the maximum lateral force due to loads other than seismic loads.

F_{ub} = Friction resistance force provided by basemat bottom.

F_{us} = Skin friction resistance force provided by basemat side parallel to the direction of motion.

F_r = Lateral resistance pressure along the wall and basemat opposite to the direction of motion, which is equal to the wall design lateral pressure (at-rest plus dynamic).

F_{us}' = Skin friction resistance force provided by shear key side parallel to the direction of motion (when shear keys are used).

F_r' = Lateral resistance pressure along the shear key opposite to the direction of motion (when shear keys are used).

F_v = Base shear at the basemat bottom.

F_o = Lateral soil force due to surcharge load of adjacent structure, as applicable.

The sliding evaluation is performed for two orthogonal horizontal directions separately. In each direction the horizontal SSE shear and vertical SSE force at the base are combined in a time consistent manner at each time step when the input motions are statistically independent. Alternately, the maximum horizontal SSE base shear may be combined with the maximum vertical SSE force acting upward. The total vertical load at the base takes into account the dead loads and buoyancy force.

The factor of safety against flotation is defined as:

$$FS = F_{DL}/F_B$$

Notations are as follows:~~where~~

F_{DL} = ~~Downward~~ ~~is the downward~~ force due to dead load, ~~and~~

F_B = ~~Upward~~ ~~is the upward~~ force due to buoyancy.

Text sections that are bracketed and italicized with an asterisk following the brackets are designated as Tier 2. Prior NRC approval is required to change.

3.8.5.6 Materials, Quality Control, and Special Construction Techniques

*[The foundations of Seismic Category I structures are constructed of reinforced concrete using proven methods common to heavy industrial construction. For further discussion, see Subsection 3.8.1.6 for the containment foundation mat and Subsection 3.8.4.6 for the foundations of the other Seismic Category I structures.]**

Text sections that are bracketed and italicized with an asterisk following the brackets are designated as Tier 2. Prior NRC approval is required to change.

3.8.5.7 Testing and In-Service Inspection Requirements

The foundations of Seismic Category I structures are monitored per NUREG-1801 and 10 CFR 50.65 as clarified in RG 1.160, in accordance with Section 1.5 of RG 1.160.

3.8.6 Special Topics

3.8.6.1 Foundation Waterproofing

*[The selected waterproofing material for the bottom of the basemat is a chemical crystalline powder that is added to the mud mat mixture forming a water proof barrier when cured. No membrane waterproofing is used under the foundations in ESBWR.]**

Text sections that are bracketed and italicized with an asterisk following the brackets are designated as Tier 2. Prior NRC approval is required to change.

3.8.6.2 Site-Specific Physical Properties and Foundation Settlement

[See Table 2.0-1 for soil properties requirements of site-specific foundation bearing capacities, minimum shear wave velocity, liquefaction potential, angle of internal friction and maximum settlement values for Seismic Category I buildings.]*

For sites not meeting the soil property requirements, a site-specific analysis is required to demonstrate that site-specific conditions are enveloped by the standardized design.

Text sections that are bracketed and italicized with an asterisk following the brackets are designated as Tier 2. Prior NRC approval is required to change.

3.8.6.3 Structural Integrity Pressure Result

See DCD Tier 1 Table 2.15.1-2 for the SIT of the containment structure, which is an ITAAC item.

3.8.6.4 Identification of Seismic Category I Structures

See Subsections 3.8.1, 3.8.2, 3.8.3 and 3.8.4 for identification of Seismic Category I structures.

3.8.6.5 Foundation Mud Mat

The mud mat is designed as structural plain concrete in accordance with ACI 318-05. The specified compressive strength of concrete at 28 days, or earlier, is 17.3 MPa (2500 psi) for the mud mat. The thickness of the mud mat is no less than 200 mm (8 in.). The performance testing requirements for the mud mat are those delineated in ACI 318-05. The mud mat construction is performed in accordance with the same standards and requirements as the basemat. The top surface of the mudmat is intentionally roughened in accordance with ACI 349-01 Subsection 11.7.9 requirement.

In order to ensure that the failure surface can only occur within the soil below the mud mat and to justify the use of a 0.7 coefficient of friction in the sliding evaluation, troughs are provided on the ground surface before the mud mat is poured. The size of the troughs is approximately 150 mm (6 in) wide and 100 mm (4 in) deep. They are arranged in a grid pattern with no larger than a 2.5 m (8.2 ft) spacing distributed over the footprint of the mud mat.

3G.1.5.4.3.2 RB Foundation Mat Outside Containment

Section 24 is selected for the foundation mat outside the containment at the junction with the cylindrical wall below the RCCV wall. The maximum rebar stress of 327.4 MPa (47.49 ksi) is found in the top rebar as shown in Table 3G.1-54. The maximum bottom rebar stress is found to be 133.6 MPa (19.38 ksi) also as shown in Table 3G.1-54. The maximum transverse shear force is found to be 10.74 MN/m (61.30 kips/in) against the shear strength of 16.03 MN/m (91.50 kips/in).

3G.1.5.4.3.3 RB Floor Slabs

Sections 25 to 27 are selected for the floor slabs at elevations EL 4650, EL 17500 and EL 27000 (see Figure 3G.1-28) at their junction with the RCCV. ~~Floor slabs are composite structures, which are reinforced by rebars at their top surfaces and by steel plates at the bottom surfaces, as described in Subsection 3.8.4.1.1. However, the slabs surrounding the Main Steam (MS) tunnel are constructed of conventional reinforced concrete. Among the elements at Sections 26 and 27, Element #96113 and 98424 are included in the MS tunnel slabs.~~

~~The maximum rebar stress of 274.03461 MPa (39.745020 ksi) is found at Section 26 as shown in Table 3G.1-53, whereas the maximum stress of steel plate is found to be 150.2 MPa (21.78 ksi) at Section 26 as shown in Table 3G.1-55. The maximum transverse shear force is found to be 8.16 MN/m (46.60 kips/in) against the shear strength of 9.08 MN/m (51.80 kips/in).~~

3G.1.5.4.3.4 Pool Girders

The maximum rebar stress of 263.4 MPa (38.20 ksi) is found in the horizontal rebar at Section 29 as shown in Table 3G.1-55, whereas the maximum vertical rebar stress is found to be 249.0 MPa (36.11 ksi) at Section 28 as shown in Table 3G.1-55. The maximum transverse shear force is found to be 1.10 MN/m (6.28 kips/in) against the shear strength of 5.31 MN/m (30.30 kips/in).

3G.1.5.4.3.5 Main Steam Tunnel Floors and Walls

Section 31 is selected for the MS tunnel wall ~~(Element #150122) and slabs (Elements #96611 and #98614)~~. The MS tunnel is composed of the reinforced concrete structures as described in Subsection 3G.1.5.4.3.3.

The maximum rebar stress is found to be 220.5 MPa (31.98 ksi) in Table 3G.1-51, and the maximum transverse shear force is found to be 0.47 MN/m (2.68 kips/in) against the shear strength of 3.70 MN/m (21.1 kips/in).

3G.1.5.5 Foundation Stability

The RB, the concrete containment and the FB share a common foundation. The stabilities of the foundation against overturning, sliding and floatation are evaluated. The energy approach is used in calculating the factor of safety against overturning.

The factors of safety against overturning, sliding and floatation are given in Table 3G.1-57. All of these meet the acceptance criteria given in Table 3.8-14. Shear keys under the basemat shown in Figures 3G.1-1, 3G.1-6 and 3G.1-7 are used to resist sliding. ~~In the sliding evaluation the~~

Table 3G.1-57

Factors of Safety for Foundation Stability

Load Combination	Overturning		Sliding		Floatation	
	<i>Required</i>	<i>Actual</i>	<i>Required</i>	<i>Actual</i>	<i>Required</i>	<i>Actual</i>
<i>D + H + E'</i>	1.1	111.1	1.1	<u>1.12</u> 1.41	--	--
<i>D + F'</i>	--	--	--	--	1.1	3.48

Where,

D = Dead Load

H = Lateral soil pressure

E' = Safe Shutdown Earthquake


F' = Buoyant forces of design basis flood

Table 3G.1-58

Maximum Dynamic Soil Bearing Pressure Stress Involving SSE + Static


	Site Condition*		
	<i>Soft</i> ($V_s = 300$ m/sec)	<i>Medium</i> ($V_s = 800$ m/sec)	<i>Hard</i> ($V_s \geq 1700$ m/sec)
<i>Bearing Stress (MPa)</i>	<u>1.12</u> 7	<u>2.77</u> 3	<u>15.4</u> 1

* See Table 3A.3-1 for site properties. For site specific application, use the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level.




(((Security-Related Information - Withheld Under 10 CFR 2.390)))
3G-121

Figure 3G.1-1. RB and FB Concrete Outline Plan at EL -11500

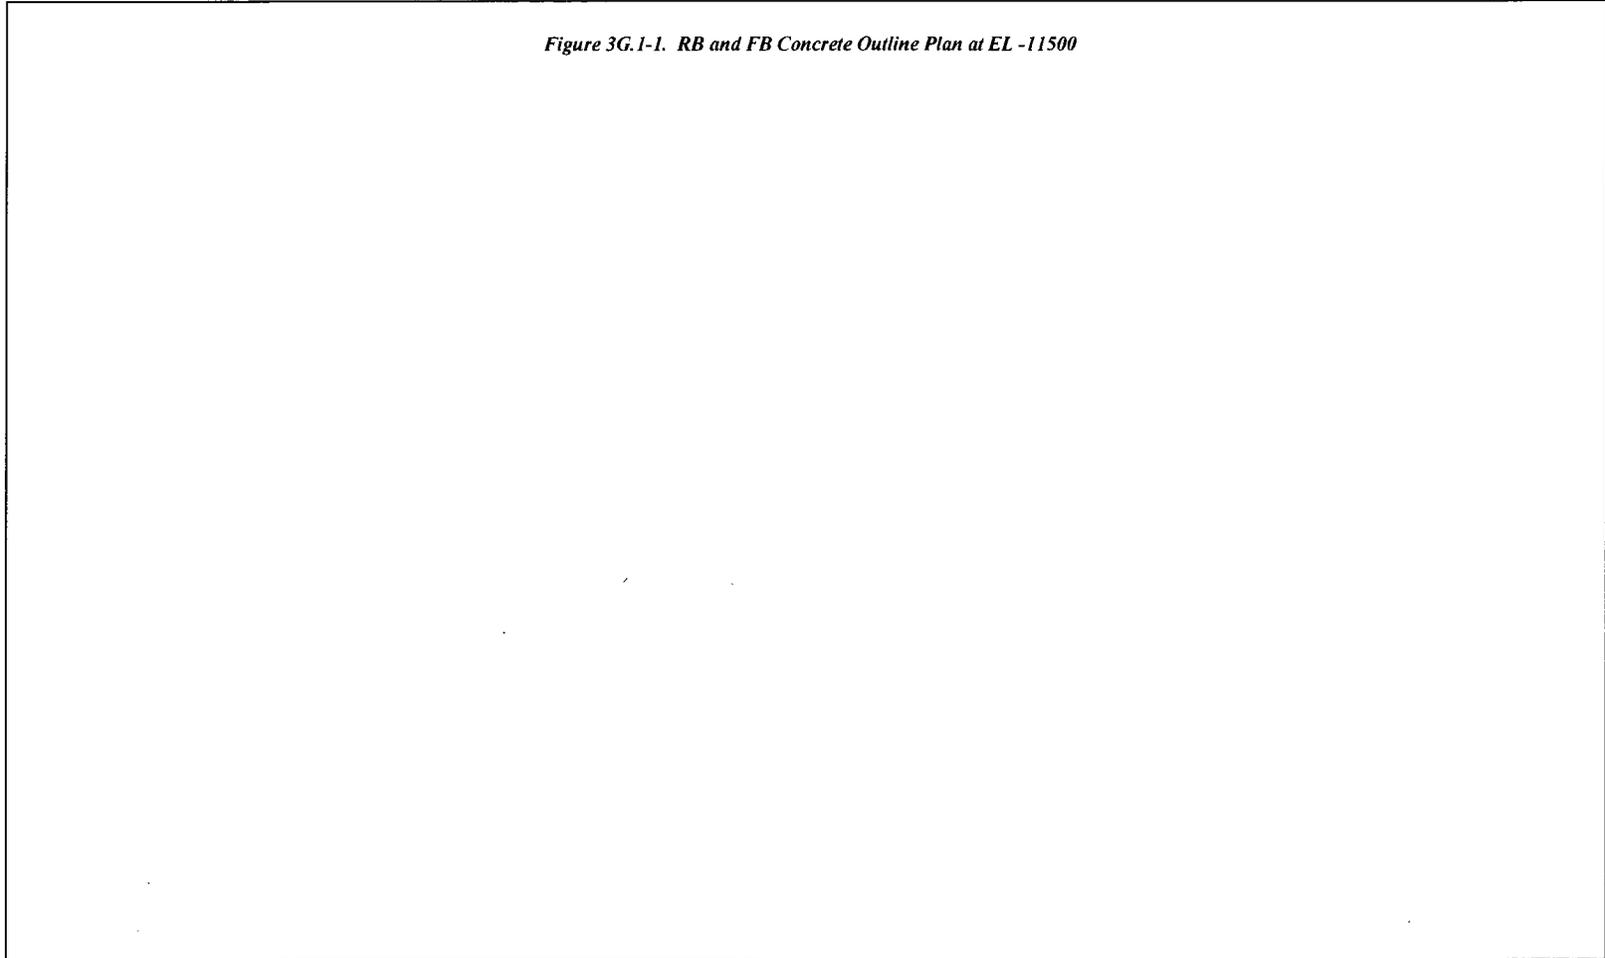


{{{Security-Related Information - Withheld Under 10 CFR 2.390}}}
3G-122




{{{Security-Related Information - Withheld Under 10 CFR 2.390}}}

Figure 3G.1-6. RB and FB Concrete Outline N-S Section

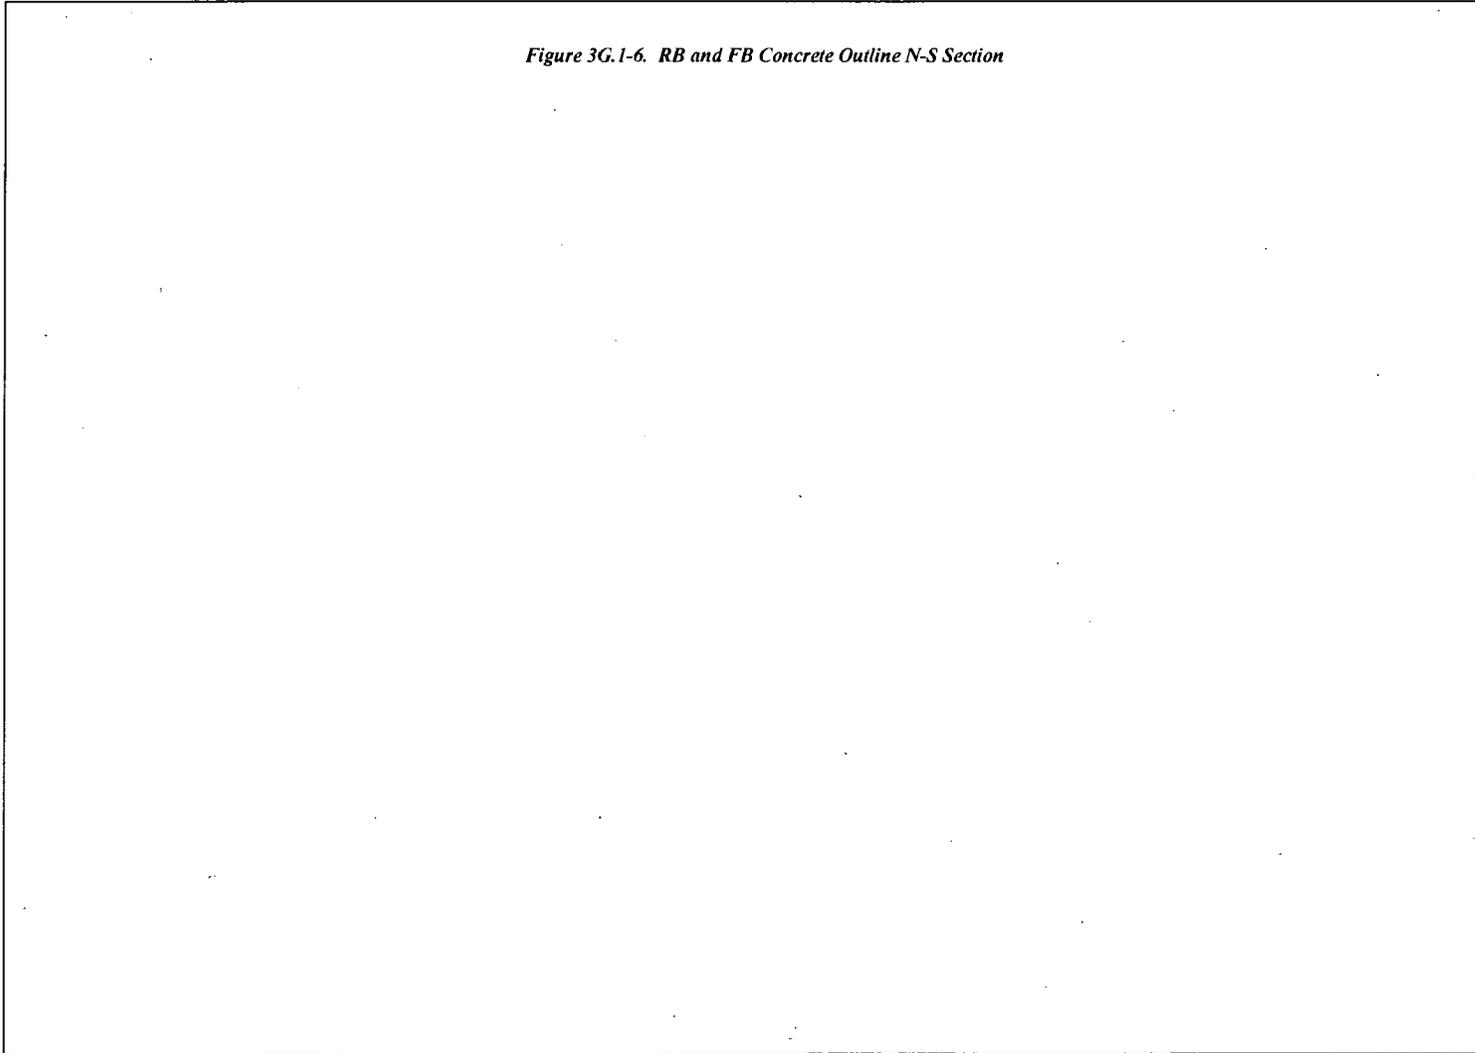

(((Security-Related Information - Withheld Under 10 CFR 2.390)))
3G-130

Figure 3G.1-7. RB and FB Concrete Outline E-W Section

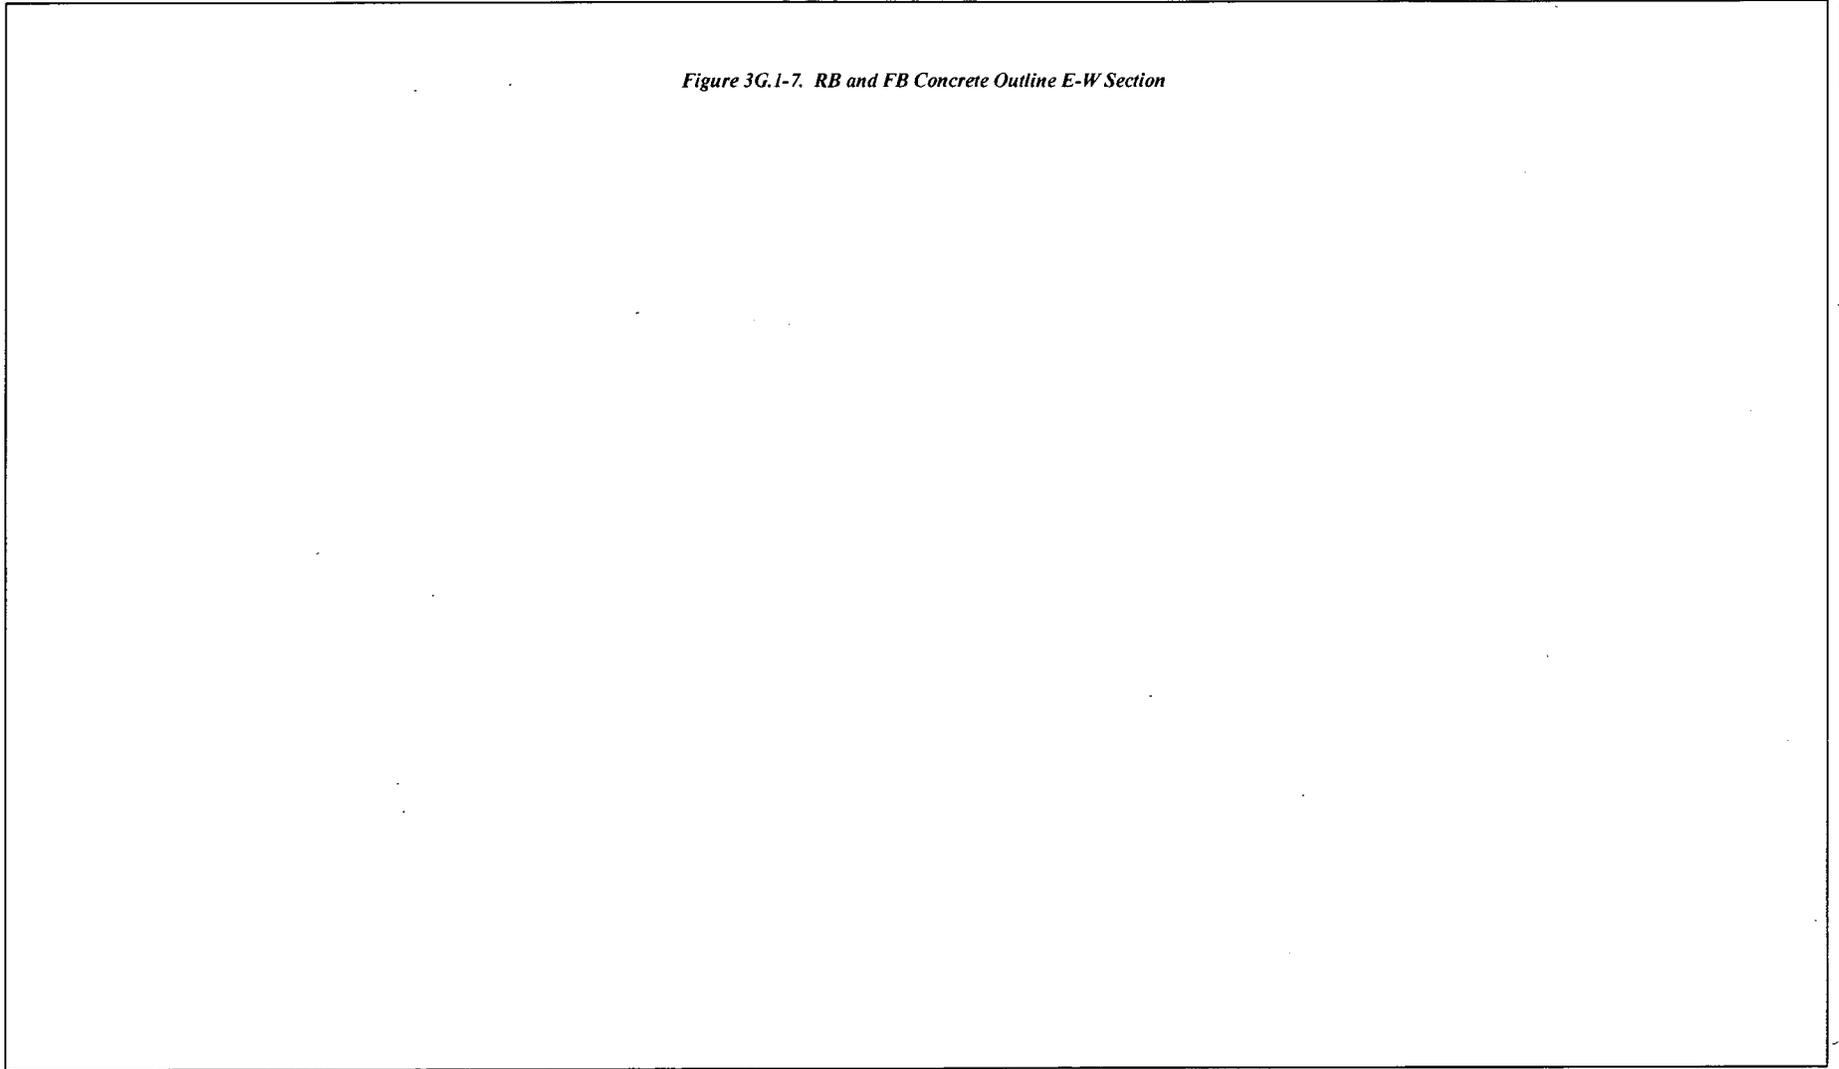

(((Security-Related Information - Withheld Under 10 CFR 2.390)))
3G-131

Table 3G.2-26

Factors of Safety for Foundation Stability

Load Combination	Overturning		Sliding		Floatation	
	<i>Required</i>	<i>Actual</i>	<i>Required</i>	<i>Actual</i>	<i>Required</i>	<i>Actual</i>
<i>D + H + E'</i>	1.1	62.5	1.1	<u>1.331.28</u>	--	--
<i>D + F'</i>	--	--	--	--	1.1	1.85

Where,

D = Dead Load

H = Lateral soil pressure

E' = Safe Shutdown Earthquake


F' = Buoyant forces of design basis flood

Table 3G.2-27

Maximum Dynamic Soil Bearing Stress Pressure Involving SSE + Static

	Site Condition *		
	<i>Soft</i> ($V_s = 300$ m/sec)	<i>Medium</i> ($V_s = 800$ m/sec)	<i>Hard</i> ($V_s \geq 1700$ m/sec)
<i>Bearing Stress (MPa)</i>	<u>20.850</u>	<u>22.52</u>	<u>20.42</u>

* See Table 3A.3-1 for site properties. For site specific application, use the larger value or a linearly interpolated value of the applicable range of shear wave velocities at the foundation level.



(((Security-Related Information - Withheld Under 10 CFR 2.390)))
3G-322

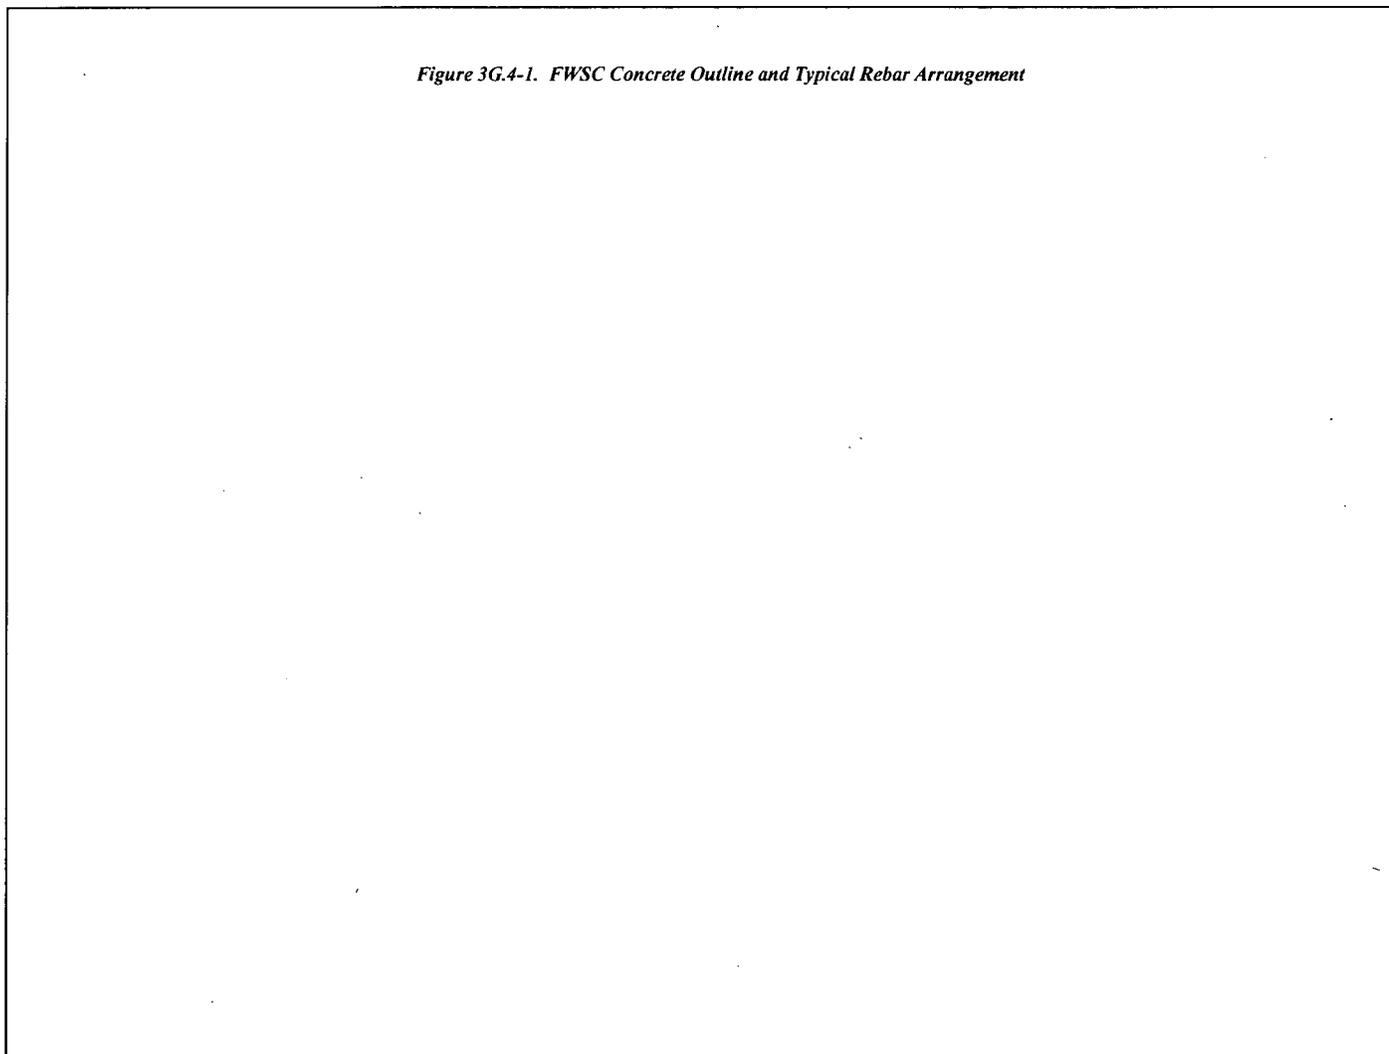


Figure 3G.4-1. FWSC Concrete Outline and Typical Rebar Arrangement

{{{Security-Related Information - Withheld Under 10 CFR 2.390}}}
3G-323