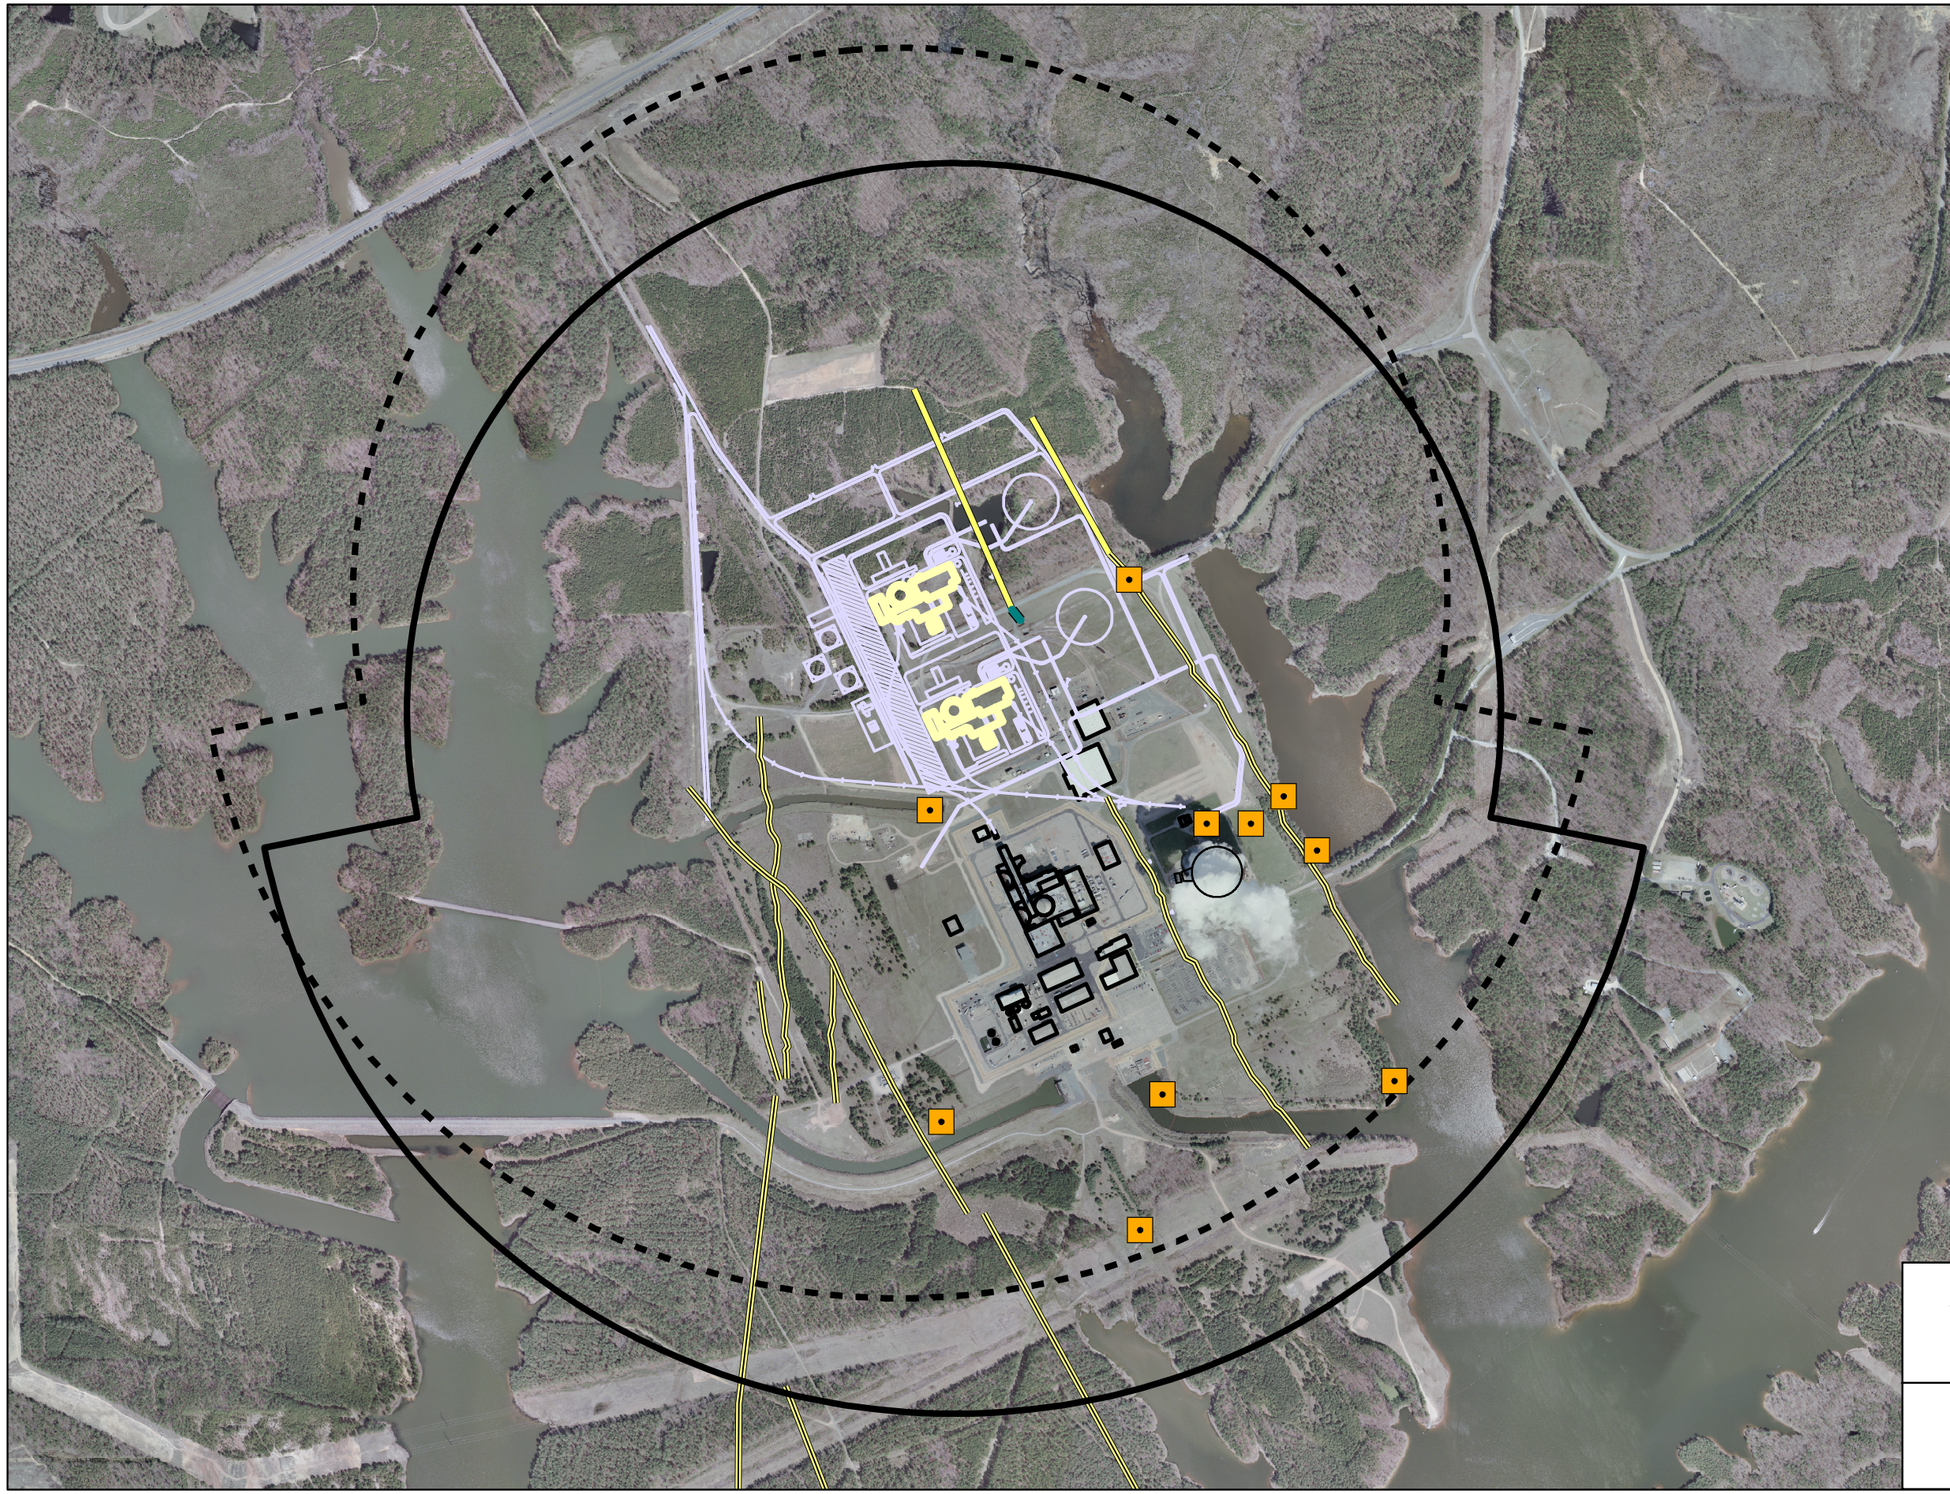

N
W E
S

LEGEND

- Outfall
- Dikes
- Interpreted Dike Trace
- Dike Detected On Magnetometer Survey
- Proposed AP1000 Related Structure
- Proposed AP1000 Layout
- Cooling Tower
- HNP - Building
- EAB U/2
- EAB U/3

0 100 200 300 400 500
Meters

0 500 1,000 1,500 2,000
Feet

Progress Energy Carolinas

Shearon Harris Nuclear Power Plant
Units 2 and 3
Part 3, Environmental Report

New Hill, North Carolina

Aerial Photo of HAR 2 and HAR 3 in Relationship to HNP

FIGURE 2.0-3

Rev 1