

# Results, Trends, and Insights of the Accident Sequence Precursor Program

## 1.0 Introduction

This enclosure discusses the results of accident sequence precursor (ASP) analyses conducted by the staff as they relate to events that occurred during fiscal years (FY) 2008–2009. Based on those results, this document also discusses the staff's analysis of historical ASP trends and the evaluation of the related insights.

## 2.0 Background

The U.S. Nuclear Regulatory Commission (NRC) established the ASP Program in 1979 in response to recommendations made in NUREG/CR-0400, "Risk Assessment Review Group Report," issued September 1978. The ASP Program systematically evaluates U.S. nuclear power plant operating experience to identify, document, and rank the operating events that are most likely to lead to inadequate core cooling and severe core damage (precursors).

To identify potential precursors, the staff reviews plant events from licensee event reports (LERs) and inspection reports. The staff then analyzes any identified potential precursors by calculating a probability of an event leading to a core damage state. A plant event can be one of two types, either (1) an occurrence of an initiating event, such as a reactor trip or a loss of offsite power (LOOP), with or without any subsequent equipment unavailability or degradation, or (2) a degraded plant condition depicted by unavailability or degradation of equipment without the occurrence of an initiating event.

For the first type, the staff calculates a conditional core damage probability (CCDP). This metric represents a conditional probability that a core damage state is reached, given an occurrence of an initiating event (and any subsequent equipment failure or degradation).

For the second type, the staff calculates an increase in core damage probability ( $\Delta$ CCDP). This metric represents the increase in core damage probability for a time period that a piece or multiple pieces of equipment are deemed unavailable or degraded.

The ASP Program considers an event with a CCDP or a  $\Delta$ CCDP greater than or equal to  $1 \times 10^{-6}$  to be a precursor.<sup>1</sup> The ASP Program defines a *significant* precursor as an event with a CCDP or  $\Delta$ CCDP greater than or equal to  $1 \times 10^{-3}$ .

**Program Objectives.** The ASP Program has the following objectives:

- Provide a comprehensive, risk-based view of nuclear power plant operating experience and a measure for trending nuclear power plant core damage risk.
- Provide a partial check on dominant core damage scenarios predicted by probabilistic risk assessments (PRAs).
- Provide feedback to regulatory activities.

---

<sup>1</sup> For initiating event analyses, the precursor threshold is a CCDP  $\geq 1 \times 10^{-6}$  or the plant-specific CCDP for a non-recoverable loss of feedwater, whichever is greater. This initiating event precursor threshold prevents reactor trips with no losses of safety system equipment from being precursors.

The NRC also uses the ASP Program to monitor performance against the safety goal established in the agency's Strategic Plan (see Reference 1). Specifically, the program provides input to the following performance measures:

- Zero events per year identified as a *significant* precursor of a nuclear reactor accident (i.e., CCDP or ΔCDP greater than or equal to  $1 \times 10^{-3}$ ).
- No more than one significant adverse trend in industry safety performance (determination principally made from the Industry Trends Program (ITP) but partially supported by ASP results).

**Program Scope.** The ASP Program is one of three agency programs that assess the risk significance of issues and events. (The other two programs are the Significance Determination Process (SDP) and the event response evaluation process as defined in Management Directive (MD) 8.3, "NRC Incident Investigation Program"). Compared to the other two programs, the ASP Program assesses additional scope of operating experience at U.S. nuclear power plants. For example, compared to the SDP, the ASP Program analyzes initiating events as well as degraded conditions where no identified deficiency occurred in the licensee's performance. The ASP Program scope also includes events with concurrent, multiple degraded conditions.

### 3.0 ASP Program Status

Table 1 summarizes the status of NRC's ASP analyses as of September 30, 2009. Specifically, the table identifies ASP analyses that the staff has completed for events that occurred during FY 2008–2009. (Note that, as of September 30, 2009, the staff had not yet screened all of the FY 2009 events.) The following subsections summarize the results of these analyses, which are further detailed in the associated Tables 1–4.

**Table 1. Status of ASP analyses.**

Status	FY 2008	FY 2009
Analyzed events that were determined not to be precursors	67	14
Events to be further analyzed	—	9
ASP precursor analyses	2	—
SDP (or MD 8.3) results used for ASP program input	13	2
Total precursors identified	15	2

**FY 2008 Analyses.** The ASP analyses for FY 2008 identified 15 precursors. Fourteen of the 15 precursors occurred while the plants were at power. The staff used SDP analysis results to identify 13 of the 15 precursors.

None of the FY 2008 analyses exceeded  $1 \times 10^{-4}$ ; therefore, in accordance with the streamlined review process (see Reference 2); the staff issued these ASP analyses as final after completion of internal reviews.

Table 2 presents the results of the staff's ASP analyses for FY 2008 precursors that involved initiating events. Table 3 presents the analysis results for FY 2008 precursors that involved degraded conditions.

**Table 2. FY 2008 precursors involving initiating events.**

Event Date	Plant	Description	CCDP/SDP Color
04/15/08	Oconee 1	Procedure error leads to loss of reactor coolant system inventory while shutdown. <b>Enforcement Action (EA)-08-324</b>	WHITE
09/11/08	Monticello	Trip with partial loss of offsite power to due to blown fuse. <b>Inspection Report (IR) 50-263/08-09</b>	1E-05

**Table 3. FY 2008 precursors involving degraded conditions.**

Event Date	Condition Duration	Plant	Description	ΔCDP/SDP Color
10/19/07	1 year	Byron 1	Corrosion of equipment cooling water system piping. <b>EA-08-046</b>	WHITE
10/19/07	1 year	Byron 2	Corrosion of equipment cooling water system piping. <b>EA-08-046</b>	WHITE
11/21/07	20 days	Comanche Peak 1	Emergency diesel generator failed to activate during testing. <b>EA-08-028</b>	WHITE
01/15/08	125 days	Cooper	Failure to establish procedural controls for maintenance of electrical connections on essential equipment. <b>EA-08-124</b>	WHITE
01/15/08	6.5 hours	Point Beach 2	Concurrent unavailabilities- station auxiliary transformer and 480V safety bus. <b>IR 50-266/08-07</b>	7.E-06
03/13/08	38 days	Farley 1	Emergency diesel generator exhaust pipe failure. <b>EA-08-192</b>	WHITE
03/25/08	4 years	San Onofre 2	Deficient electrical connections with potential to affect multiple safety systems. <b>EA-08-296</b>	WHITE
07/12/08	183 days	Hatch 1	Degraded coupling leads to emergency diesel generator inoperability. <b>EA-09-054</b>	WHITE
07/12/08	183 days	Hatch 2	Degraded coupling leads to emergency diesel generator inoperability. <b>EA-09-054</b>	WHITE
07/31/08	138 days	Prairie Island 1	Turbine-driven auxiliary feedwater pump inoperable due to valve out-of-position. <b>EA-08-272</b>	WHITE
07/31/08	34 years	Prairie Island 2	Potential unavailability of the component cooling water system during a postulated high-energy line break due to inadequate design. <b>EA-09-167</b>	WHITE
08/19/08	1 year	Brunswick 1	All emergency diesel generators unable to be operated locally due to incorrect control relay wiring. <b>EA-09-121</b>	WHITE
08/19/08	1 year	Brunswick 2	All emergency diesel generators unable to be operated locally due to incorrect control relay wiring. <b>EA-09-121</b>	WHITE

**FY 2009 Analyses.** The staff has completed all screening and reviews for potential *significant* precursors (i.e., CCDP or ΔCDP greater than or equal to  $1 \times 10^{-3}$ ) through September 30, 2009. In particular, the staff reviewed a combination of LERs (as required by Title 10, Section 50.73, "Licensee Event Report System," of the *Code of Federal Regulations* [10 CFR 50.73]) and daily event notification reports (as required by 10 CFR 50.72, "Immediate Notification Requirements for Operating Nuclear Power Reactors") to identify potential *significant* precursors. The staff did not identify any *significant* precursors in FY 2009.

The staff is still screening and reviewing LERs concerning other potential precursor events that occurred during FY 2009.<sup>2</sup> Two FY 2009 precursors have been identified thus far. The staff plans to complete all FY 2009 analyses by September 2010.

#### 4.0 Industry Trends

This section discusses the results of trending analyses for all precursors and *significant* precursors.

**Statistically Significant Trend.** The trending method used in this analysis is consistent with those methods used in the staff's risk studies (see Appendix E to Reference 3). The trending method uses the p-value approach for determining the probability of observing a trend as a result of chance alone. A trend is considered statistically significant if the p-value is smaller than 0.05.

**Data Coverage.** Based on insights gained in SECY-06-028, "Status of the Accident Sequence Precursor Program and the Development of Standardized Plant Analysis Risk Models," dated October 5, 2006, the staff chose FY 2001 as the trend analyses' starting point to provide a data period with a consistent ASP Program scope and to align it with the first full year of the Reactor Oversight Process (ROP). ASP Program changes that occurred in FY 2001 (e.g., inclusion of SDP findings and external initiated events) resulted in a step increase in the number of precursors identified compared to those identified in previous years. The data period for trending analyses ends in FY 2008 (the last full year of completed ASP analyses) but will become a shifting 10-year period in the future.

The following exception applies to the data coverage of the trending analyses:

- **Significant Precursors.** The trend of *significant* precursors includes events that occurred during FY 2009. The results for FY 2009 are based on the staff's screening and review of a combination of LERs and daily event notification reports (as of September 30, 2009). The staff analyzes all potential *significant* precursors immediately.
- **Integrated ASP Index.** The integrated ASP index is not used for trending; therefore, older data may be used. A data period of 10 years (FYs 1999–2008) is used when reporting this index.

#### 4.1 Occurrence Rate of All Precursors

The NRC's ITP provides the basis for addressing the agency's safety-performance measure on the "number of statistically significant adverse trends in industry safety performance" (one measure associated with the safety goal established in NRC's Strategic Plan). The mean occurrence rate of all precursors identified by the ASP Program is one indicator used by the ITP to assess industry performance.

**Results.** A review of the data for that period reveals the following insights:

- The mean occurrence rate of all precursors exhibits a statistically significant decreasing trend (p-value = 0.01) for the period from FY 2001–2008 (see Figure 1).

---

<sup>2</sup> Licensees have a 60-day grace period after an event or discovery of a degraded condition to submit an LER.

- The analysis detected a statistically significant decreasing trend (p-value = <0.0001) for precursors with a CCDP or  $\Delta$ CDP greater than or equal to  $1 \times 10^{-4}$  during this same period (see Figure 2).

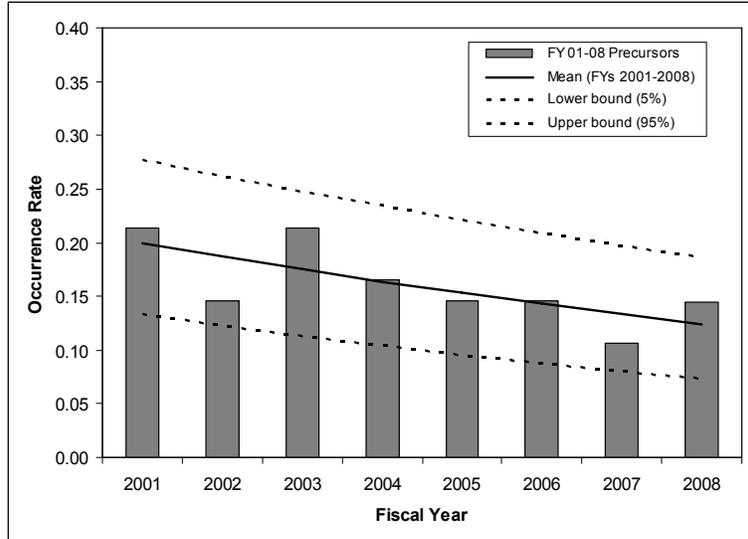


Figure 1. Total precursors.

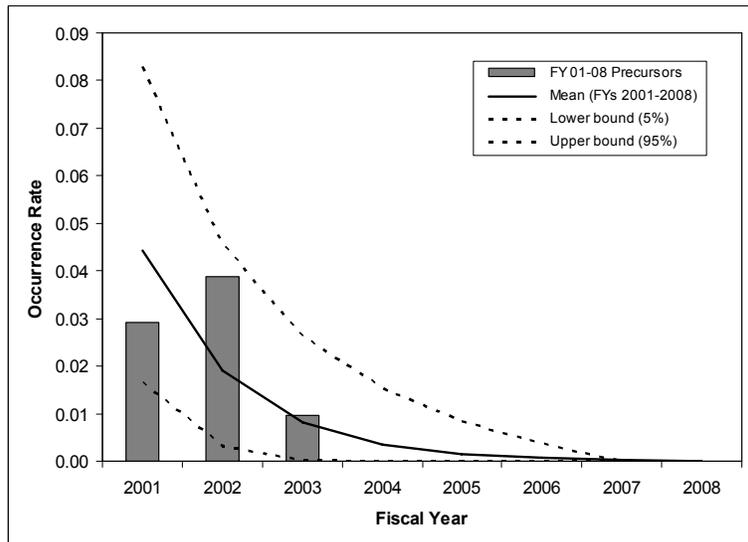


Figure 2. Precursors with a CCDP or  $\Delta$ CDP  $\geq 10^{-4}$ .

#### 4.2 Significant Precursors

The ASP Program provides the basis for the safety-performance measure of zero “number of significant accident sequence precursors of a nuclear reactor accident” (one measure associated with the safety goal established in NRC’s Strategic Plan). Specifically, the Strategic Plan defines a *significant* precursor as an event that has a probability of at least 1 in 1000 (greater than or equal to  $1 \times 10^{-3}$ ) of leading to a reactor accident (see Reference 1).

**Results.** A review of the data for that period reveals the following insights:

- No *significant* precursors were identified in FY 2009.
- The staff has identified only one *significant* precursor since FY 2001. In FY 2002, the staff identified a *significant* precursor involving concurrent, multiple degraded conditions at Davis-Besse. The specific conditions included cracking of control rod drive mechanism (CRDM) nozzles, degradation of the reactor pressure vessel (RPV) head, potential clogging of the emergency sump, and potential degradation of the high-pressure injection (HPI). Reference 4 provides a complete list of all *significant* precursors from 1969–2006, including event descriptions.
- Over the past 20 years, *significant* precursors have occurred, on average, about once every 5 years. The events in this group involve differing failure modes, causes, and systems.

## 5.0 Insights and Other Trends


The following sections provide additional ASP trends and insights from the period FY 2001–2008.

### 5.1 Initiating Events vs. Degraded Conditions

A review of the data for FY 2001–2008 yields insights described below.

#### *Initiating Events*

- The mean occurrence rate of precursors involving initiating events is not statistically significant ( $p$ -value = 0.95) for the period from FY 2001–2008, as shown in Figure 3.

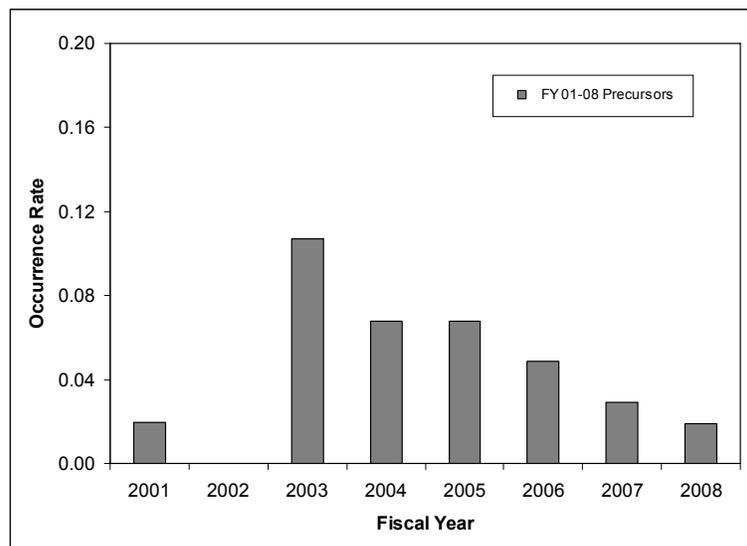

**Figure 3. Precursors involving initiating events.**

- Of the 37 precursors involving initiating events during FY 2001–2008, 59 percent were LOOP events.

### Degraded Conditions

- The mean occurrence rate of precursors involving degraded conditions exhibits a statistically significant decreasing trend ( $p$ -value = 0.03) during the FY 2001–2008 period, as shown in Figure 4.
- Over the past 8 years, precursors involving degraded conditions outnumbered initiating events (72 percent compared to 28 percent, respectively). This predominance was most notable in FY 2001 and FY 2002, when degraded conditions contributed to 91 percent and 100 percent of the identified precursors, respectively.

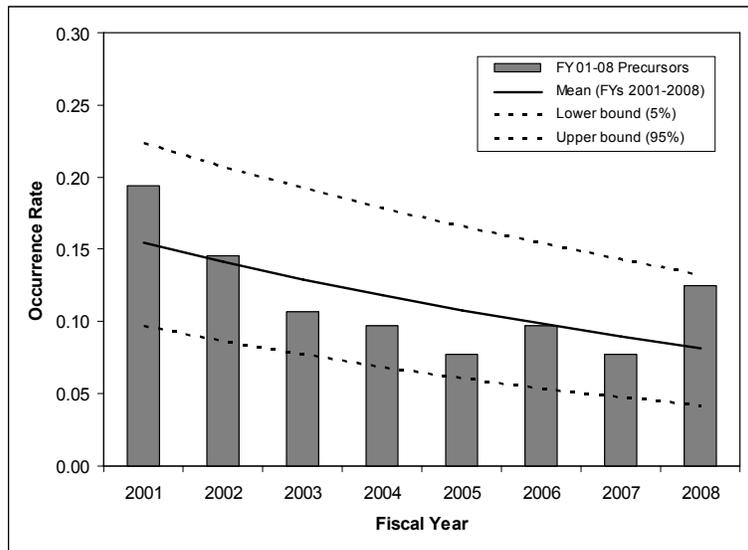


Figure 4. Precursors involving degraded conditions.

- From FY 2001–2008, 36 percent of precursors involving degraded conditions had a condition start date before FY 2001. Of these precursors, 53 percent involved degraded conditions with condition start dating back to initial plant construction.

### 5.2 Precursors Involving Loss of Offsite Power Initiating Events

None of FY 2008 precursors resulted from a loss of offsite power initiating event.

**Results.** A review of the data for FY 2001–2008 leads to the following insights:

- The mean occurrence rate of precursors resulting from a LOOP does not exhibit a trend that is statistically significant ( $p$ -value = 0.49) for the period from FY 2001–2008, as shown in Figure 5.
- Of the 22 LOOP events that occurred during the FY 2001–2008 period, one-half resulted from a degraded electrical grid outside of the nuclear power plant boundary. Eight of the 11 grid-related LOOP precursors were the result of the 2003 Northeast Blackout.
- A simultaneous unavailability of an emergency power system train was involved in 2 of the 22 LOOP precursor events during FY 2001–2008.

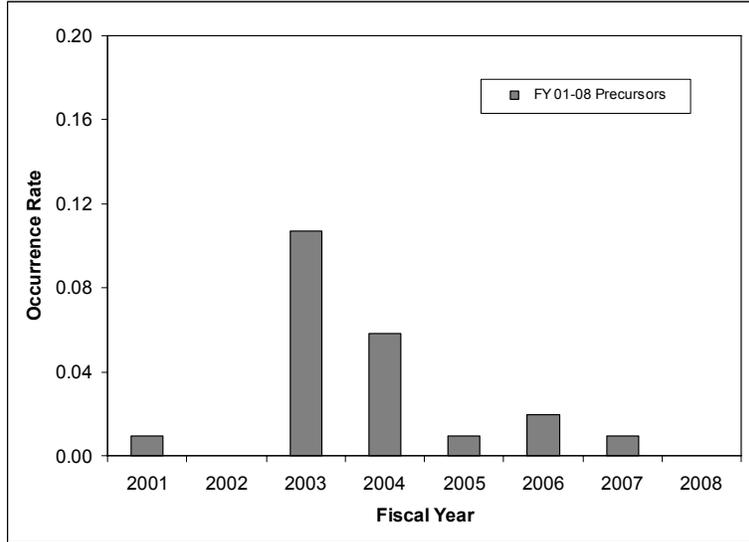


Figure 5. Precursors involving LOOP events.

### 5.3 Precursors at Boiling-Water Reactors Versus Pressurized-Water Reactors

A review of the data for FY 2001–2008 reveals the results for boiling-water reactors (BWRs) and pressurized-water reactors (PWRs) described below.<sup>3</sup>

#### **BWRs**

- The mean occurrence rate of precursors that occurred at BWRs does not exhibit a trend that is statistically significant (p-value = 0.96) for the period from FY 2001–2008, as shown in Figure 6.

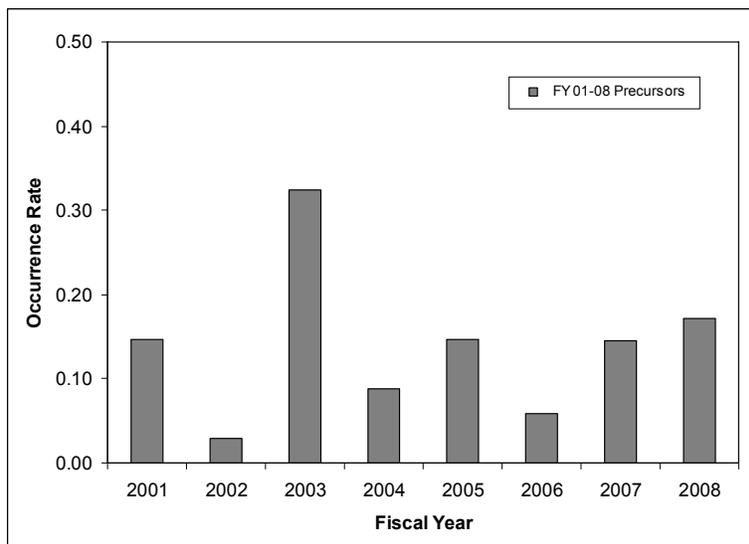



Figure 6. Precursors involving BWRs.

<sup>3</sup> The sum of percentages in this section does not always equal 100 percent because some precursors involve multiple equipment availabilities.

- LOOP events contributed to 63 percent of precursors involving initiating events at BWRs.
- Of the 22 precursors involving the unavailability of safety-related equipment that occurred at BWRs during FY 2001–2008, most were caused by failures in the emergency power system (50 percent), emergency core cooling systems (50 percent), electrical distribution system (18 percent), or safety-related cooling water systems (14 percent).

### **PWRs**

- The mean occurrence rate of precursors that occurred at PWRs exhibits a statistically significant decreasing trend (p-value = 0.002) during the FY 2001–2008 period, as shown in Figure 7.

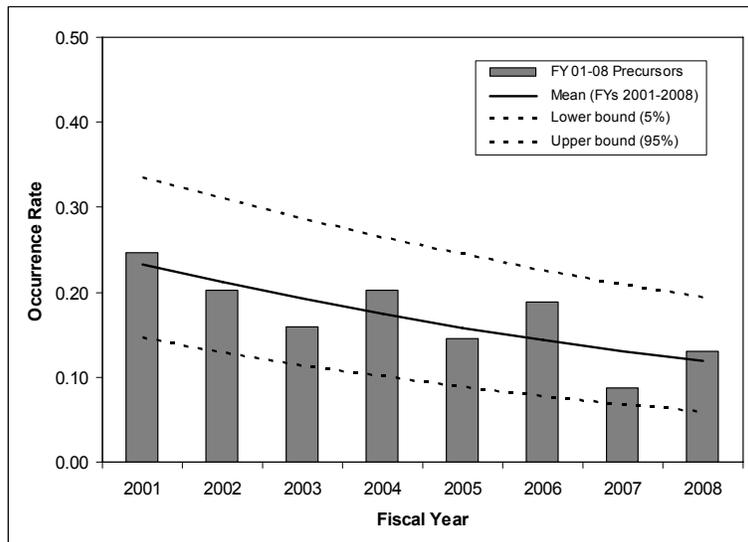

**Figure 7. Precursors involving PWRs.**

- LOOP events contribute to 57 percent of precursors involving initiating events at PWRs.
- Of the 73 precursors involving the unavailability of safety-related equipment that occurred at PWRs during FY 2001–2008, most were caused by failures in the emergency core cooling systems (33 percent), auxiliary feedwater system (21 percent), emergency power system (19 percent), or safety-related cooling water systems (18 percent).
  - Of the 24 precursors involving failures in the emergency core cooling systems, 17 precursors (71 percent) were due to conditions affecting sump recirculation during postulated loss-of coolant accidents of varying break sizes. Design errors were the cause of most of these precursors (88 percent).
  - Of the 15 precursors involving failures of the auxiliary feedwater system, random hardware failures (40 percent) and design errors (40 percent) were the largest failure contributors. Thirteen of the 15 precursors involved the unavailability of the turbine-driven auxiliary feedwater pump train.
  - Of the 14 precursors involving failures of the emergency power system, 12 precursors (86 percent) were from random hardware failures.

- Design errors contributed 48 percent of all precursors involving the unavailability of safety-related equipment that occurred at PWRs during FY 2001–2008.

#### 5.4 Integrated ASP Index

The staff derives the integrated ASP index for order-of-magnitude comparisons with industry-average core damage frequency (CDF) estimates derived from probabilistic risk assessments (PRAs) and NRC’s standardized plant analysis risk (SPAR) models. The index or CDF from precursors for a given fiscal year is the sum of CCDPs and  $\Delta$ CDPs in the fiscal year divided by the number of reactor-calendar years in the fiscal year.

The integrated ASP index includes the risk contribution of a precursor for the entire duration of the degraded condition (i.e., the risk contribution is included in each fiscal year that the condition exists). The risk contributions from precursors involving initiating events are included in the fiscal year that the event occurred.

**Examples.** A precursor involving a degraded condition is identified in FY 2003 and has a  $\Delta$ CDP of  $5 \times 10^{-6}$ . A review of the LER reveals that the degraded condition has existed since a design modification performed in FY 2001. In the integrated ASP index, the  $\Delta$ CDP of  $5 \times 10^{-6}$  is included in FYs 2001, 2002, and 2003.

For an initiating event occurring in FY 2003, only FY 2003 includes the CCDP from this precursor.

**Results.** Figure 8 depicts the integrated ASP indices for FY 1999–2008. A review of the ASP indices leads to the following insights:

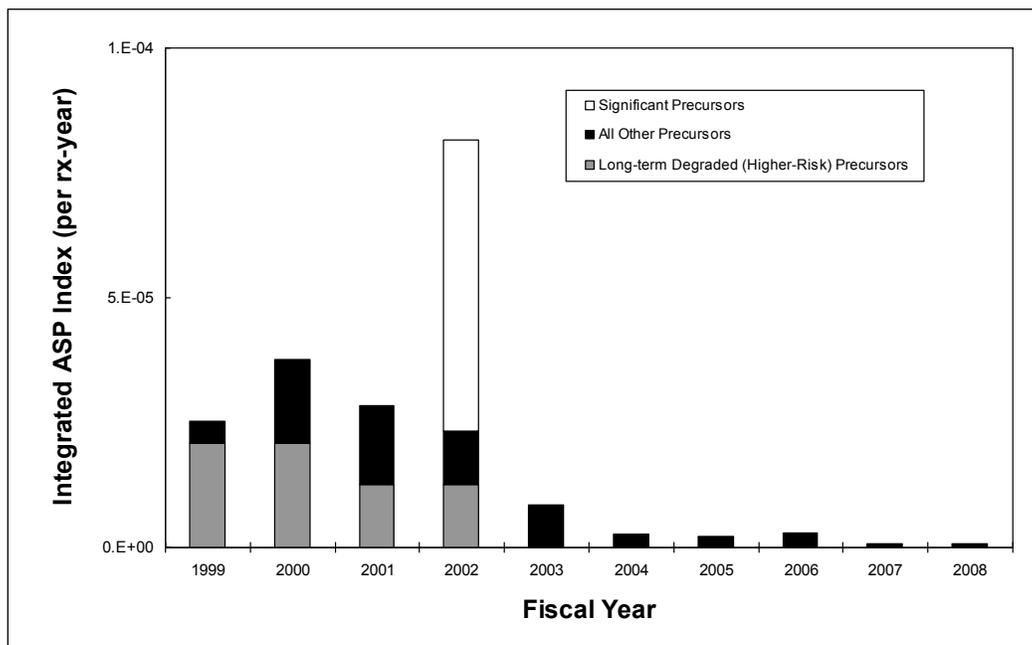


Figure 8. Integrated ASP index.

- Based on order of magnitude ( $10^{-5}$ ), the average integrated ASP index for the period from FY 1999–2008 is consistent with the CDF estimates from the SPAR models and industry PRAs.
- Precursors over the 10-year period (FY 1999–2008) made the following contributions to the average integrated ASP index:
  - The one *significant* precursor (i.e., CCDP or  $\Delta$ CDP greater than or equal to  $1 \times 10^{-3}$ ) contributed to 31 percent of the average integrated ASP index over the 10-year period. The *significant* precursor (Davis-Besse, FY 2002) existed for a 1-year period.
  - Four precursors contribute 35 percent of the average integrated ASP index over the 10-year period. Specifically, long-term degraded conditions at Point Beach Units 1 and 2 (discovered in 2001) involved potential common-mode failure of all AFW pumps, while long-term degraded conditions at D.C. Cook Units 1 and 2 (discovered in 1999) involved a number of locations in the plant where the effects of postulated high-energy line break events would damage safety-related components. The associated  $\Delta$ CDPs of the degraded conditions at Point Beach ( $7 \times 10^{-4}$ ) and D.C. Cook ( $4 \times 10^{-4}$ ) were high and the degraded conditions had existed since plant construction.
  - The remaining 34 percent of the average integrated ASP index over the 10-year period resulted from contributions from 146 precursors.

**Limitations.** Using CCDPs and  $\Delta$ CDPs from ASP results to estimate CDF is difficult because (1) the mathematical relationship requires a significant level of detail, (2) statistics for frequency of occurrence of specific precursor events are sparse, and (3) the assessment also must account for events and conditions that did not meet the ASP precursor criteria.

The integrated ASP index provides the contribution of risk (per fiscal year) resulting from precursors and cannot be used for direct trending purposes because the discovery of precursors involving longer-term degraded conditions in future years may change the cumulative risk from the previous year(s).

## 5.5 Consistency with Probabilistic Risk Assessments and Individual Plant Examinations

A secondary objective of the ASP Program is to provide a partial validation of the dominant core damage scenarios predicted by PRAs and individual plant examinations (IPEs). Most of the identified precursor events are consistent with failure combinations identified in PRAs and IPEs.

However, a review of the precursor events for FY 2001–2008 reveals that approximately 31 percent of the identified precursors involved event initiators or failure modes that were not explicitly modeled in the PRA or IPE for the specific plant where the precursor event occurred. Table 4 lists precursors that occurred over the past five years that were not explicitly modeled in a PRA or IPE. The occurrence of these precursors does not imply that explicit modeling is needed; however, such modeling could yield insights that could be incorporated in future revisions of the PRA.

**Table 4. Precursors involving failure modes or initiators not explicitly modeled in a PRA/IPE.**

FY	Plant	Event Description
2008	Prairie Island 2	Potential unavailability of the component cooling water system during a postulated high-energy line break due to inadequate design. <b>EA-09-167</b>
2008	Byron 1 & 2	Corrosion of equipment cooling water system piping. <b>EA-08-046</b>
2008	San Onofre 2	Deficient electrical connections with potential to affect multiple safety systems. <b>EA-08-296</b>
2008	Oconee 1	Procedure error leads to loss of reactor coolant system inventory while shutdown (Mode 6). <b>EA-08-324</b>
2007	Cooper	Inadequate post-fire procedure could have prevented achieving safe shutdown. <b>EA-07-204</b>
2007	McGuire 1 & 2	Potential inoperability of service water strainer backwash system during accident conditions. <b>EA-08-220</b>
2006	Clinton	Potential air entrapment of high-pressure core spray because of incorrect suction source switchover set point. <b>EA-06-291</b>
2006	Oconee 1, 2, & 3	Failure to maintain design control for the standby shutdown facility flooding boundary. <b>EA-06-199</b>
2005	Kewaunee	Design deficiency could cause unavailability of safety-related equipment during postulated internal flooding. <b>EA-05-176</b>
2005	LaSalle 1 & 2 Crystal River 3	Single-failure vulnerability of safety bus protective relay schemes caused by common power metering circuits. <b>EA-05-103, EA-05-114</b>
2005	Watts Bar	Component cooling backup line from essential raw cooling water was unavailable because silt blockage. <b>IR 50-390/04-05</b>
2005	Watts Bar	Low-temperature, overpressure valve actuations while shut down. <b>EA-05-169</b>
2004	Calvert Cliffs 2	Failed relay causes overcooling condition during reactor trip. <b>LER 318/04-001</b>
2004	Palo Verde 1, 2, & 3	Containment sump recirculation potentially inoperable because of pipe voids. <b>LER 528/04-009</b>

## 6.0 Summary

This section summarizes the ASP results, trends, and insights:

- Significant Precursors.** The staff did not identify any *significant* precursors (i.e., CCDP or  $\Delta$ CDP greater than or equal to  $1 \times 10^{-3}$ ) in FY 2009. The ASP Program provides the basis for the safety-performance measure of zero “number of significant accident sequence precursors of a nuclear reactor accident.” The NRC FY 2009 Citizens' Report: FY 2009 Summary of Performance and Financial Results and the NRC Performance Budget: FY 2011 will report these results.
- Occurrence Rate of All Precursors.** A statistically significant decreasing trend was detected in the occurrence rate of all precursors during the FY 2001–2008 period. This ASP trend provides the basis for one performance indicator used by the ITP to assess industry performance. The NRC FY 2009 Citizens' Report: FY 2009 Summary of Performance and Financial Results and the NRC Performance Budget: FY 2011 will report these results.
- Additional Trend Results.** During the same period, statistically significant decreasing trends were detected for three groups of precursors—precursors with a CCDP or  $\Delta$ CDP greater than or equal to  $10^{-4}$ , precursors involving degraded conditions, and precursors that occurred at PWRs.

## **7.0 References**

1. NUREG-1100, Vol. 24, "Performance Budget, Fiscal Year 2009," U.S. Nuclear Regulatory Commission, Washington, DC, February 2008.
2. Regulatory Issue Summary 2006-24, "Revised Review and Transmittal Process for Accident Sequence Precursor Analyses," U.S. Nuclear Regulatory Commission, Washington, DC, December 2006.
3. NUREG/CR-5750, "Rates of Initiating Events at U.S. Nuclear Power Plants: 1987–1995," U.S. Nuclear Regulatory Commission, Washington, DC, February 1999.
4. SECY-06-0208, "Status of the Accident Sequence Precursor Program and the Development of Standardized Plant Analysis Risk Models," U.S. Nuclear Regulatory Commission, Washington, DC, October 2006.