


# **U.S. EPR Design Certification Review RLBLOCA Methodology**




AREVA NP Inc. and the NRC  
August 6, 2009

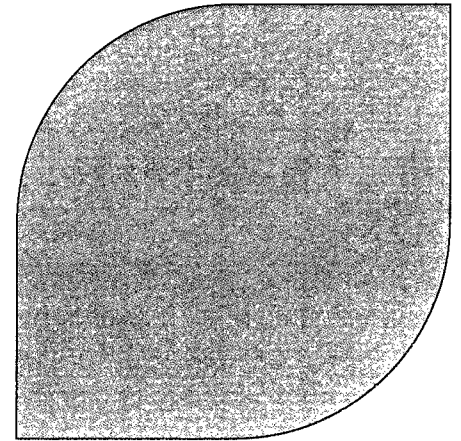

EPR is a trademark of the AREVA Group.




# Objective




**Describe the proposed strategy for addressing NRC concerns, and thus reduce the magnitude of proposed PCT adjustments, while preserving overall DC review schedule.**

# Requirements for Proposed Approach



- ▶ **Changes or additional information should not generate more RAIs**
- ▶ **Changes should reflect options already indicated by NRC staff as viable**
- ▶ **Schedule for implementation should support submittal of revised topical report and FSAR Chapter 15 large break LOCA calculations to support current Chapter 15 review schedule**
- ▶ **Reduction of PCT adjustments, not necessarily elimination**

# Agenda



## ► Where we are today

**Bert Dunn**

## ► Issues

**Bert Dunn**

### ◇ Initial stored core energy

- Burnup-dependent initial stored energy
- Initial stored energy in average and peripheral assemblies
- Burnup-dependent fuel conductivity in transient calculations

### ◇ Lower plenum refill and core flow oscillations

### ◇ Nitrogen injection


### ◇ Accumulator liquid temperature

### ◇ Decay heat sampling

## ► Summary and next steps

**Sandra Sloan**


# Where We Are Today



## ► Incorporated changes to-date:


RAI	Change
10	Treated core power deterministically using maximum measurement uncertainty, i.e. 100.48% of rated power or 4612 MWt.
21	Evaluated 124 cases instead of present 59 cases.
22	Considered only loss-of-offsite power (LOOP) conditions.
23	Used a revised U.S. EPR ICECON containment model.
24	Changed upper bound of containment temperature sampling range to 131°F.
30	Changed application of Forslund-Rohsenow. Contribution of Forslund- Rohsenow with 0.7 to 0.9 void fraction interpolation range limited to 15% or less.
33	Set decay heat multiplier to 1.06.

# Where We Are Today




Comparison of original and test of changes to-date

As reported in:	Cycle	PCT, °F	Total Oxidation, %	Max Oxidation, %
ANP-10278P, U.S. EPR FSAR	Equilibrium	1425	< 0.01	0.2354
U.S. EPR FSAR	First	1531	< 0.01	0.8836
Test of changes to-date	Equilibrium	~1750	< 0.01	~2.0



# Proprietary Session


# NRC Concerns on Fuel Rod Model



- ▶ **RODEX3 hot pin burnup-dependent temperature predictions**
- ▶ **Initial stored energy in average and peripheral assemblies**
- ▶ **Transient and steady state fuel conductivity**




# Hot Pin Initial Stored Energy




- ▶ **NRC concern: Hot pin initial stored energy is too low**
- ▶ **Proposed approach**
  - ◇ **Evaluate NRC predictions of PCT impact**
    - Review NRC RELAP5 calculations with RODEX4 conductivities
    - Determine centerline fuel temperatures from NRC calculations
  - ◇ **Evaluate PCT impact of 300°F increase in centerline fuel temperatures**
  - ◇ **Develop fit of RODEX3 to RODEX4 database with rod IFA 432 removed**
  - ◇ **Options**
    - Implement burnup-dependent conductivity adjustment, or
    - Define modified PCT adjustment


# Impact of increase of 300°F in Fuel Centerline Temperature – Preliminary Results




# Initial Stored Energy in Average and Peripheral Assemblies



- ▶ NRC concern: Combined region initial stored energy under predicted
- ▶ Proposed approach


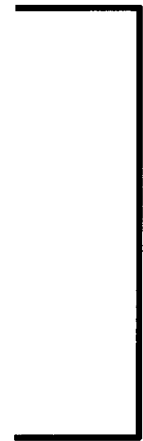


# Transient and steady state fuel conductivity




- ▶ **NRC concern: Burnup-dependent fuel conductivity adjustment not included in transient calculations**
- ▶ **Proposed approach**
  - ◇ [ ]

# Transient and steady state fuel conductivity




# Lower Plenum Refill and Core Flow Oscillations




- ▶ **NRC Concern: Coolant enters core before lower plenum is water solid**
- ▶ **Proposed approach**
  - ◇ **Assess gas incursion and boiling phenomena**
  - ◇ **Sensitivity studies to determine PCT impact**
    - Steam-only containment
    - Lower plenum nodalization

# Lower Plenum Refill and Core Flow Oscillations



# Lower Plenum Refill and Core Flow Oscillations




- ▶ Lower plenum noding study
- ▶ 1 to 2 nodes






# Nitrogen Injection




- ▶ **NRC concern: S-RELAP5 code does not appropriately respond to nitrogen injection under certain conditions.**
  - ◇ **Impact: Higher-than-expected RCS pressurization prediction for certain cases**
- ▶ **To address this issue, the cases submitted as part of sample problem in ANP-10278P were rerun with no nitrogen injection.**
  - ◇ **Accumulators isolated when close to empty.**
    - **Similar to a study conducted in response to RAI-28 on ANP-10278P**
    - **Overall impact on PCT is not significant**
- ▶ **Proposed approach**
  - ◇ **Isolate accumulators near the end of liquid injection**


# Case 44 – Preliminary Results




# Case 18 – Preliminary Results



# Nitrogen Injection – Preliminary Results




# Accumulator Temperature




- ▶ **NRC concern: Accumulator temperature is sampled to too low a value**
  - ◆ **RLBLOCA model applies the sampled value of the containment temperature to:**
    - ◆ **Accumulators**
    - ◆ **Containment vapor and liquid**
  - ◆ **The containment temperature is sampled from 59°F to 131°F.**
    - ◆ **Lower bound from Technical Specification minimum temperature for IRWST (Technical Specification Surveillance Requirements (SR) 3.5.4.1).**

# Accumulator Temperature




- ▶ **Proposed approach is to use a revised sampling range**
  - ◆ **Lower bound - 80 to 90°F (nominal temperature in accessible space at accumulator elevation)**
  - ◆ **Upper bound: 131°F**
  - ◆ **Flat distribution based on sensitivity study**

# Preliminary Sensitivity of PCT to Proposed Temperature Distribution




# Decay Heat Sampling



- ▶ **AREVA NP's earlier agreement to use a deterministic treatment of decay heat is not consistent with a best estimate model**
  - ◆ **Sampling of ANSI/ANS 5.1-1979 standard is justified by comparison to best estimate decay heat curve**
    - ◆ **ORIGEN calculation for equilibrium cycle**
  - ◆ **If ANSI/ANS 5.1-1979 as applied by AREVA NP is greater than the ORIGEN best estimate calculations, sampling remains conservative**



# Revised Decay Heat Evaluation ORIGEN Parameters




## ► ORIGEN parameters to review and establish

- ◇ Enrichment
- ◇ Fuel powers
- ◇ Fuel temperature
- ◇ Irradiation history
- ◇ 30 day updates for cross sections


## ► Desired result

- ◇ Bound of best estimate decay heat rate including actinides

# RLBLOCA – Decay Heat




# Potential Cumulative PCT Impact



Item	Proposed PCT Adder, °F	PCT Adjustment After Improvements, °F
Cumulative Effect	~600	~275
PCT (current FSAR = 1531°F)	~2130	~1806


# Summary



- ▶ **Proposed approach involves:**
  - ◆ **Straight-forward modification of analytical approach**
  - ◆ **Providing additional information to support reduction in PCT penalty**
- ▶ **Changes in methodology will be documented in Revision 1 of the topical report**
- ▶ **Chapter 15 FSAR large break LOCA calculations will be updated**
- ▶ **AREVA to keep NRC informed of status**

**AREVA's objective is to obtain a prediction of PCT which appropriately reflects the design margin of the U.S. EPR and the application of a realistic analytical method.**

# Next Steps



- ▶ Request fuel temperature results from NRC analysis
- ▶ Status meetings, early October and early November 2009
- ▶ Submit Revision 1 of topical report and updated FSAR LBLOCA analysis, January 2010
- ▶ Post submittal meeting, February 2010
- ▶ NRC requested to notify AREVA immediately if the proposed approach at any time jeopardizes the overall DC review schedule