Information Need No. AE-20 **ER Figure 3.4-3, 3.4-11**

Request:

Provide a knowledgeable expert to discuss the existing sanitary sewer discharge upstream of the proposed location of the BBNPP intake system.

Knowledgeable Expert:

A knowledgeable expert was provided.

Response:

A knowledgeable expert will be available during the audit to discuss the existing sanitary sewer discharge upstream of the proposed location of the BBNPP intake system.

A large, new sanitary sewer line is being installed in the vicinity of the SSES plant along US Route 11. The new line is owned by the Berwick Area Joint Sewer Authority. The line will discharge into a treatment plant located in the Borough of Berwick. The sanitary sewer from the SSES plant presently discharges into the Susquehanna River. PPL is reviewing the option of connecting the SSES sanitary sewer line to this new line.

It is not planned for the sanitary sewer to continue to discharge into the river at the current location because of the possibility of the sanitary wastewater being drawn into the BBNPP intake.

Figures 3.4-3 and 3.4-11 show a "Sanitary Sewage Discharge (to be removed)." This is presumably the line from the Current SSES Sewage Treatment Plant.

References:

Public

ER Figure 3.4-3 and 3.4-11

Internal

None

Figure 3.4-3 Circulating Water System Intake/Discharge Structure Location Plan

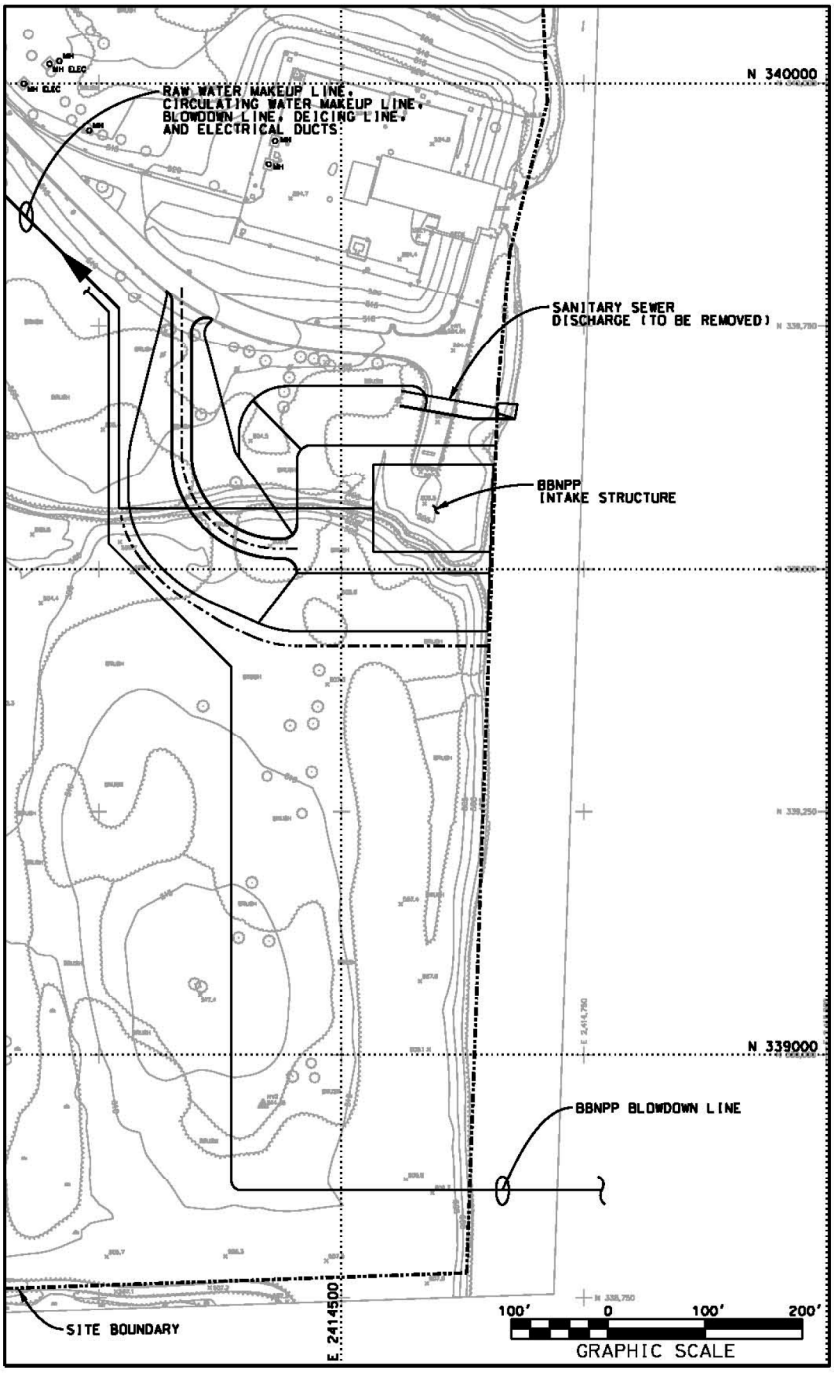

© 2008 UniStar Nuclear Services, LLC. All rights reserved.
COPYRIGHT PROTECTED

Figure 3.4-11 CWS Makeup Water Intake Structure Construction Coffer Dam

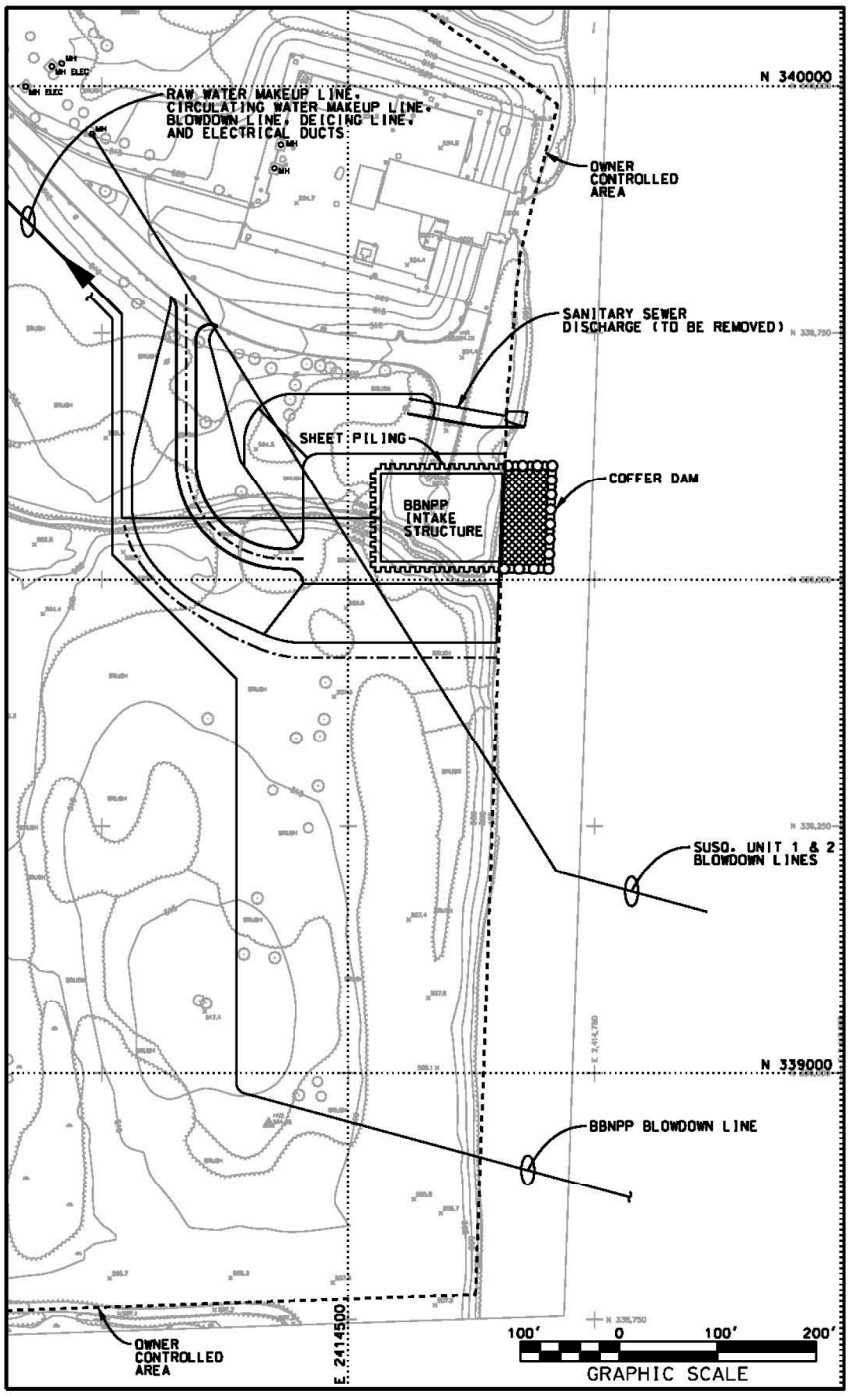

© 2008 UniStar Nuclear Services, LLC. All rights reserved.
COPYRIGHT PROTECTED