

UNITED STATES GOVERNMENT

Memorandum

TO : E. Epstein, Region I - Division of Compliance DATE: January 20, 1964

FROM : N. Y. Chu, Chemist *NYC*
Radiochemistry Division - HASL

SUBJECT: ST. ALBANS NAVAL HOSPITAL SMEAR SAMPLE #881 -- REQUISITION D-3713.

HSC:NYC

A beta absorption curve was run on Smear Sample #881 and the contamination was found to be purely Sr^{90} - Y^{90} . A Sr^{90} standard was used to check the sample. Copies of the curves obtained are attached.


Enclosures - 2

9/11

JAN 20, 196

D-3713-881

Sc 90 - 1/80

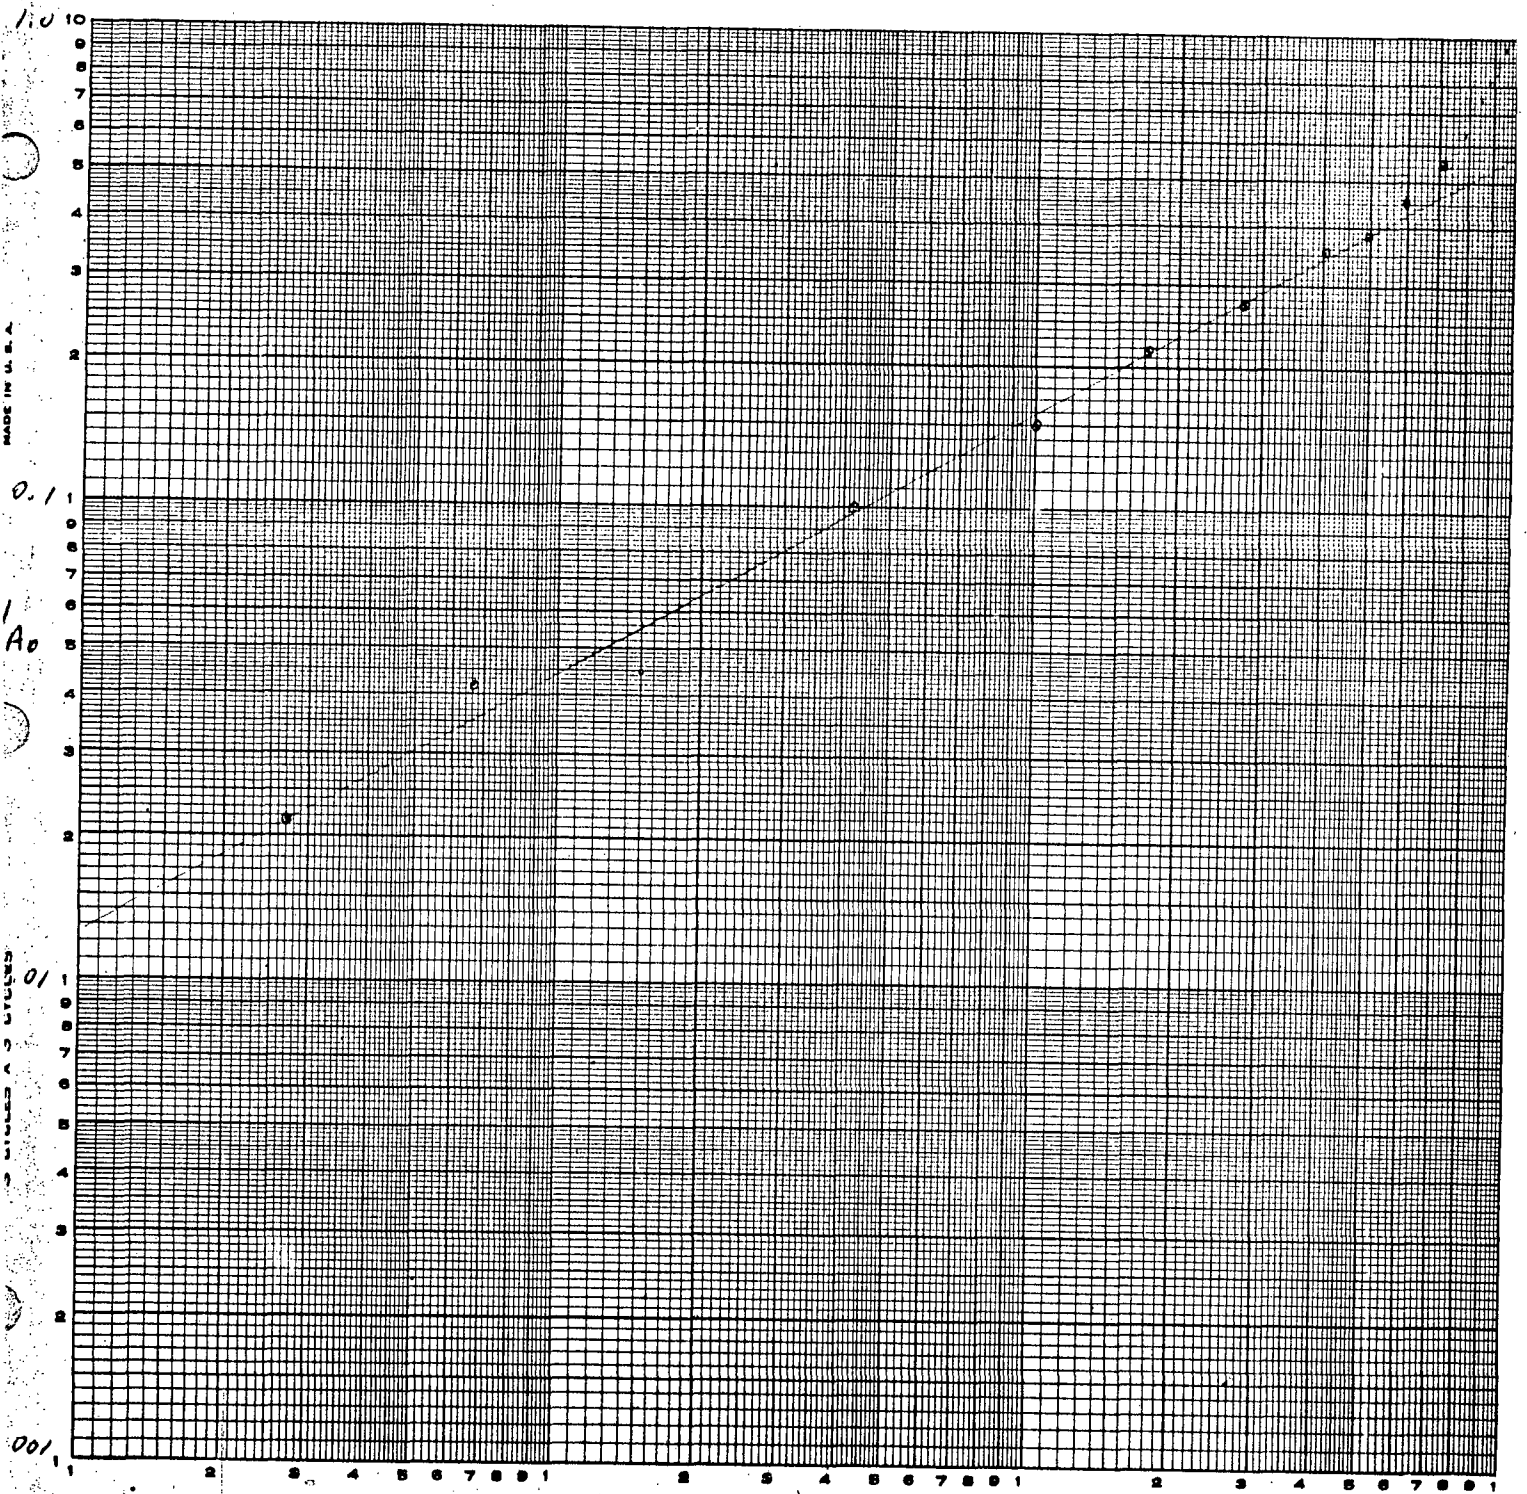


A/A_0 P-32

2-27-60

Sp 90 STD

EUGENE DIETZEN CO.
MADE IN U. S. A.

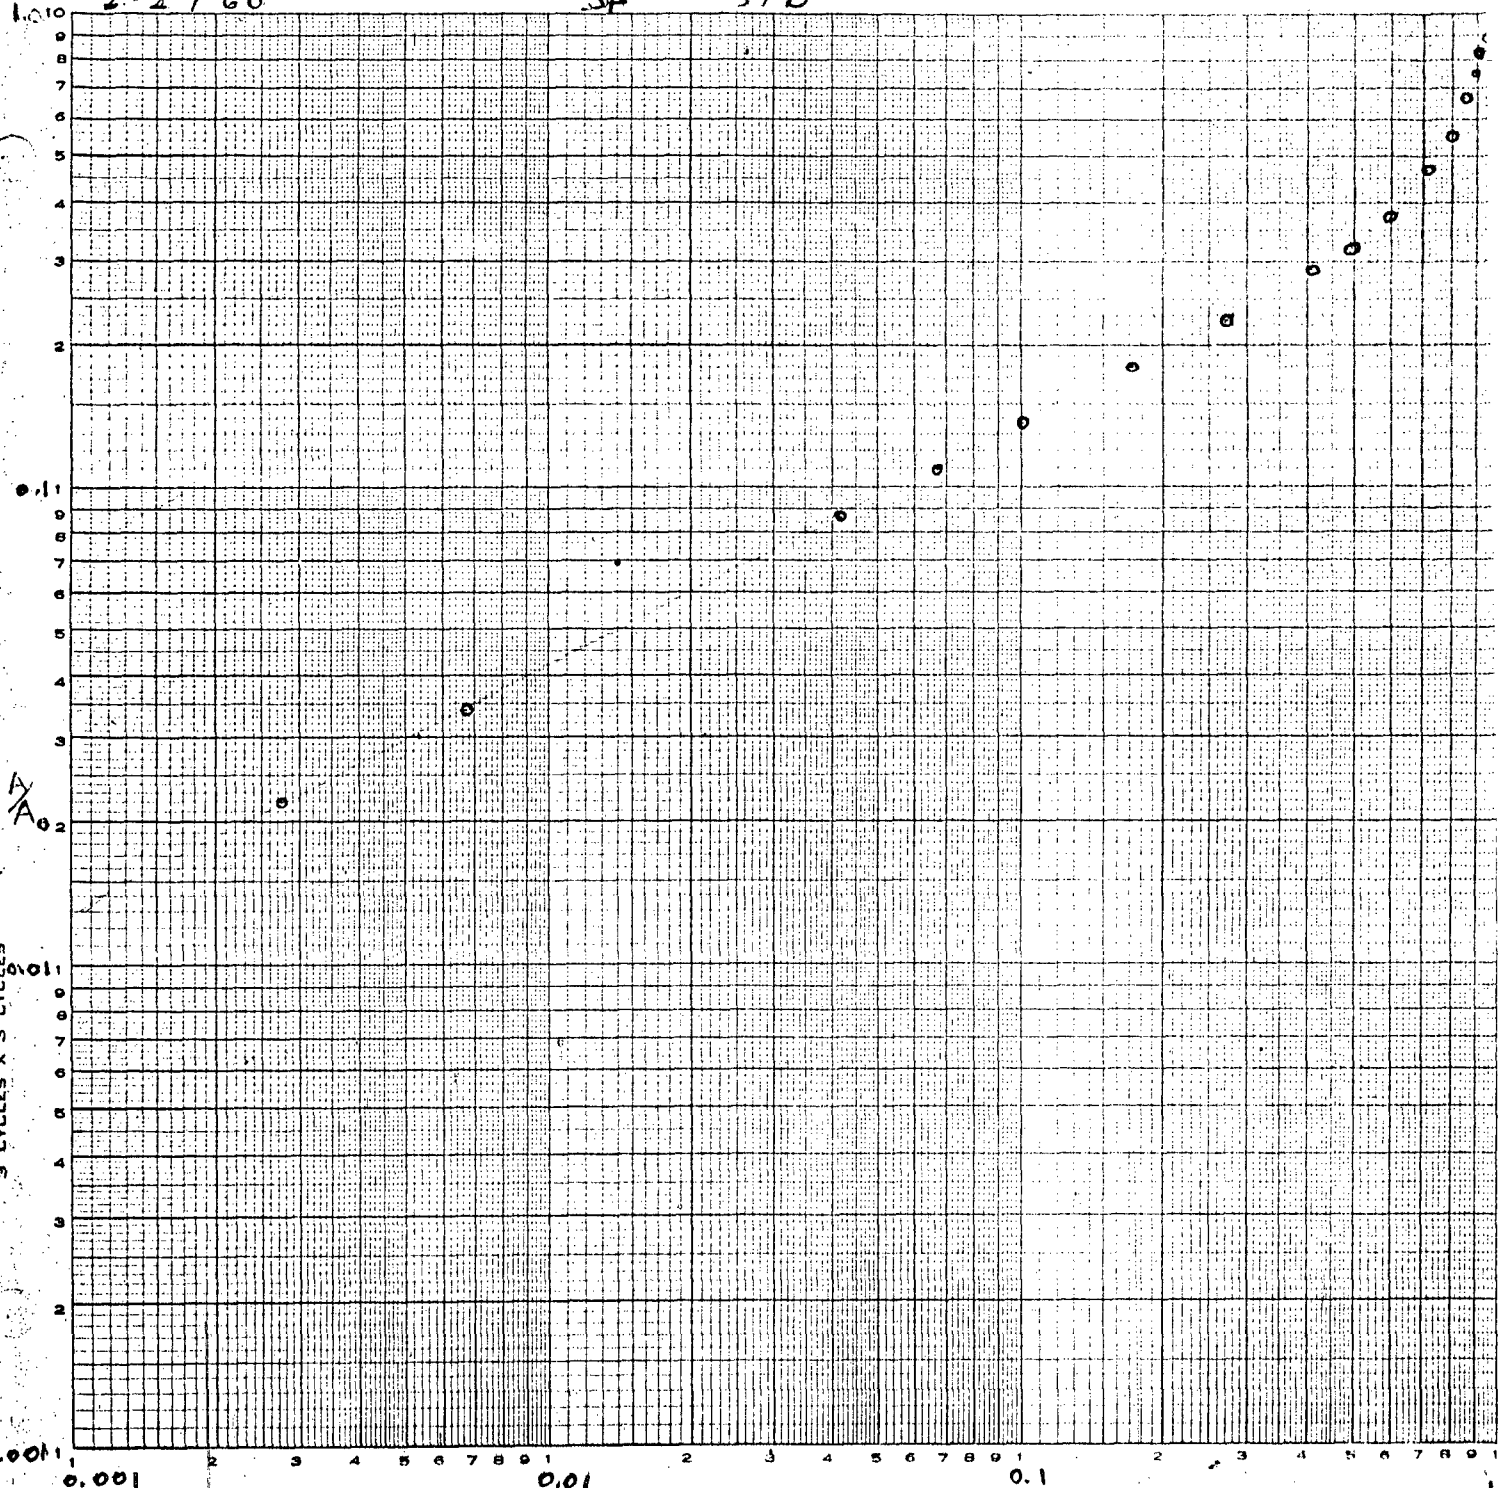

A/A0

3 CYCLES X 3 CYCLES

A/A0 P-32