

RS-09-063

10 CFR 50.90

May 8, 2009

U. S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington, DC 20555-0001

LaSalle County Station, Units 1 and 2
Facility Operating License Nos. NPF-11 and NPF-18
NRC Docket Nos. 50-373 and 50-374

Subject: Additional Information Supporting the Request for a License Amendment
to Revise Local Power Range Monitor Calibration Frequency

- References:
1. Letter from Mr. P. R. Simpson (Exelon Generation Company, LLC) to U. S. NRC, "Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency," dated July 25, 2008
 2. Letter from U. S. NRC to Mr. C. G. Pardee (Exelon Generation Company, LLC), "LaSalle County Station, Units 1 and 2 – Request for Additional Information Related to License Amendment Request to Revise Local Power Range Monitor Calibration Frequency (TAC Nos. MD9414 and MD9415)," dated October 1, 2008
 3. Letter from Mr. P. R. Simpson (Exelon Generation Company, LLC) to U. S. NRC, "Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency," dated October 31, 2008
 4. Letter from Mr. P. R. Simpson (Exelon Generation Company, LLC) to U. S. NRC, "Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency," dated February 17, 2009

In Reference 1, Exelon Generation Company, LLC (EGC) requested an amendment to the facility operating license for LaSalle County Station (LSCS), Units 1 and 2. Specifically, the proposed changes will revise Technical Specification (TS) 3.3.1.1, "Reactor Protection System (RPS) Instrumentation," Surveillance Requirement (SR) 3.3.1.1.8 and TS 3.3.1.3, "Oscillation Power Range Monitor (OPRM) Instrumentation,"

May 8, 2009
U. S. Nuclear Regulatory Commission
Page 2

SR 3.3.1.3.2 to increase the frequency interval between Local Power Range Monitor (LPRM) calibrations from 1000 effective full power hours (EFPH) to 2000 EFPH.


In Reference 2, the NRC requested that EGC provide additional information in support of their review of Reference 1. The response to this NRC request was provided in Reference 3. Following their review of the responses provided in Reference 3, the NRC requested by email that EGC provide additional information to support their review of Reference 1. The response to this request was provided in Reference 4. Based on their review of the responses to these requests, the NRC requested by email, additional clarification of the responses provided in Reference 4. The additional clarification is provided in the attachment to this letter.

EGC has reviewed the information supporting a finding of no significant hazards consideration that was previously provided to the NRC in Reference 1. The additional information provided in this submittal does not affect the bases for concluding that the proposed license amendment does not involve a significant hazards consideration. No new regulatory commitments are established by this submittal.

If you have any questions concerning this letter, please contact Mr. Timothy A. Byam at (630) 657-2804.

I declare under penalty of perjury that the foregoing is true and correct. Executed on the 8th day of May 2009.

Respectfully,



Patrick R. Simpson
Manager – Licensing
Exelon Generation Company, LLC

Attachment: Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

ATTACHMENT

Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

SRXB-1

RAI-1 requested the licensee to provide an uncertainty analysis using decay constants specific to the LPRM detectors at the LSCS. The results should demonstrate that the uncertainties based on a fixed decay factor bound that based on the LPRM specific decay factors for the LSCS. In the response, the licensee did not provide the requested analysis. Instead, it summarized the results of its analysis and indicated that: (1) the analysis used in support of the LAR was based on a fixed decay factor of -0.092, which is based on manufacture's data; and (2) the decay constant used in the CMS will be adjusted to -0.100 to assure that the evaluated LPRM uncertainty is within the bounds of SLMCPR analysis.

With the results of the analysis with the fixed decay constants of either -0.092 or -0.100, the NRC staff is not sure whether the results are adequate to represent the actual data with values of the decay constants specific to various LPRM detectors at the LSCS. To resolve this RAI satisfactorily, the licensee should provide a discussion or an analysis (such as the requested detector specific decay constant analysis) to show that the assumption used in the analysis in support of the LAR is valid, i.e., the uncertainties based on a fixed decay factor bound that based on the LPRM specific decay factors for the LSCS. If the licensee uses an existing analysis to support the RAI response, it should address applicability of the existing analysis to the LAR. The RAI response should identify the effects of any plant specific deviations, such as the LPRM exposure data that may be collected from different models of LPRM detectors, or methods for the uncertainty analysis that may be based on different ranges of the LPRM exposures to represent a nominal exposure value.

Response

The GE Local Power Range Monitor (LPRM) detectors used by Grand Gulf (i.e., NA-250) and used by LaSalle County Station (LSCS) (i.e., NA-300), are regenerative sensors. A regenerative sensor contains U-234 and U-235 in the coated surface. The U-235 absorbs neutrons and produces fission fragments that ionize the gas in the fission chamber. The ionized particles are collected by the sensor electrodes, and produce a detector signal that is proportional to the neutron flux incident on the detector. The fission rate is due primarily to thermal neutron flux, since the product of neutron flux and fission cross section in the thermal region is significantly greater than in the epithermal and fast neutron regions. The U-234 atoms absorb neutrons, become U-235 atoms, and the new U-235 atoms are then available for future fission events. Due to the similarity in the characteristic behavior of the detectors used in Grand Gulf and LSCS, the conclusions presented by Grand Gulf showing the fixed decay constant bounds the specific decay constant is applicable to LSCS.

Previous analysis for Grand Gulf presented results where LPRM calibration currents were based upon LPRM specifically derived calibration curve slopes (Reference 2). This data was presented because this was the method employed in the core monitoring system at Grand Gulf. It was demonstrated that these results were more accurate than the results utilizing a fixed value for the LPRM calibration current slope and therefore provided additional margin (i.e., less uncertainty). LSCS does not utilize LPRM specific


ATTACHMENT

Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

decay constants so an evaluation of the uncertainties based upon individual LPRM decay constants is not applicable to LSCS.

LPRM calibration data for the NA-300 type LPRMs was collected for both LSCS Units 1 and 2 over a period of several years (Enclosure 1). During this time the core monitoring system (CMS) was accumulating LPRM exposure using the MICROBURN-B (1996 – 2004) or the MICROBURN-B2 (2004 – 2006) LPRM flux calculations. The core monitoring system evaluates the LPRM sensitivity between calibrations based upon this same LPRM flux calculation and a single input value for the variation in sensitivity as a function of LPRM fluence (i.e., exposure). In order to evaluate the uncertainty of this core monitoring system it is necessary to evaluate the variance in the actual and expected LPRM sensitivity. This is the analysis that was presented in the original License Amendment Request (LAR) and following Requests for Additional Information (RAIs). In order to project the uncertainty associated with longer calibration intervals, intermediate calibrations were ignored and the projected sensitivity is based upon the calibration one or more calibration steps previous. The projected sensitivity is based upon the single input value for the variation in sensitivity as a function of LPRM fluence. The measured calibration currents, provided in Enclosure 1, are compared to the vendor supplied logarithmic slope (i.e., -0.092) as well as the average slope determined from the measured data (i.e., -0.100) in Figure SRXB-1.1.

Figure 1. LaSalle Station LPRM Decay Constant

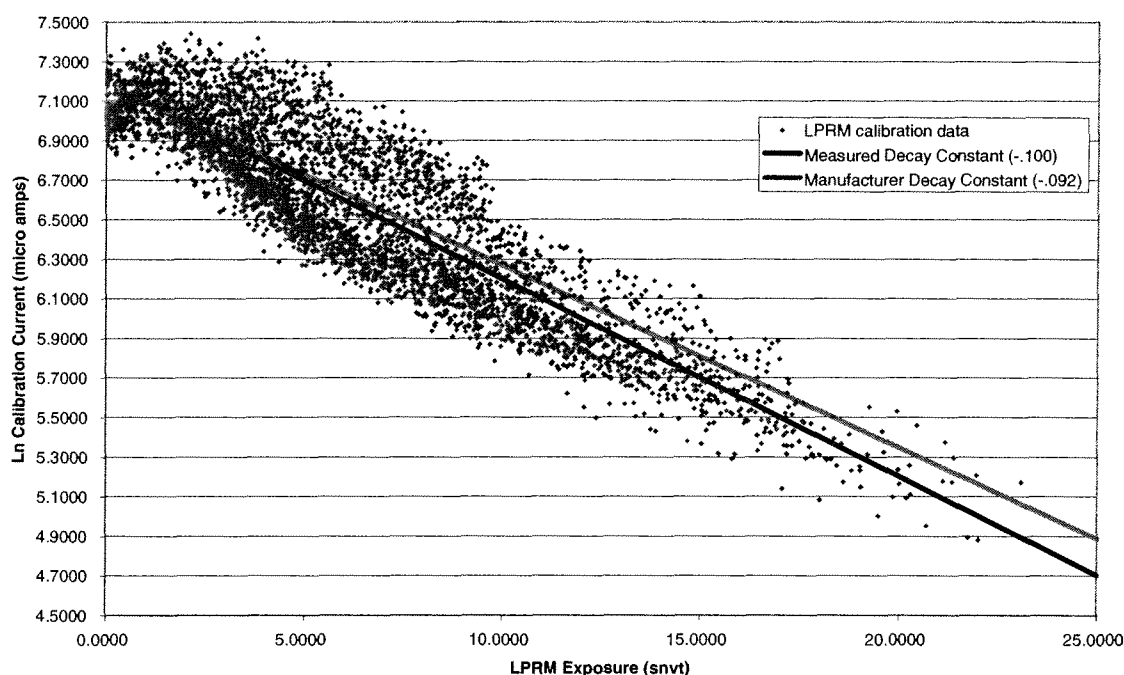

This collection of raw calibration currents is not representative of LPRM uncertainties since the LPRM is specifically calibrated for first use and the CMS uses this calibration to project the sensitivity during the interval between that calibration and the next

ATTACHMENT

Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

calibration. This projection is based upon a constant calibration current below a user defined breakpoint and a user defined logarithmic slope (i.e., decay constant). LSCS provides a single value for the breakpoint and slope for all NA-300 detectors. The error in the LPRM reading just prior to the next calibration is evaluated by comparing the measured calibration current with the projected calibration current at the time of a calibration.

A detailed discussion of the methodology was provided in Reference 1. The LSCS data described above and provided in Enclosure 1 supports using a fixed decay constant of -0.100 . This decay constant was used in the uncertainty analysis and supports the conclusions provided in Reference 1.

SRXB-2

In the RAI-2 response, the licensee indicated that it would modify the decay constant to -0.100 in its CMS so that the evaluated LPRM uncertainty is within the bounds of the SLMCPR analysis.

Discuss adequacy of the use of the LPRM uncertainty in the SLMCPR to bound the evaluated LPRM uncertainty, which is the difference between standard deviations (underlined for emphasis) calculated at two different exposure intervals (i.e., 1000 MWd/MTU and 2675 MWd/MTU). If applicable, clarify that the LPRM uncertainty limit used in the SLMCPR analysis is the maximum value of one standard deviation (which captures 67% of the data points) allowed for the relative LPRM errors. Explain that the LPRM uncertainty limit is appropriately used in the SLMCPR analysis to assure that the determined SLMCPR is the core-wide critical power ratio at which 99.9% (equivalent to more than 3 standard deviations) of the fuel rods would not be expected to experience boiling transition during normal condition.

Response

The Safety Limit Minimum Critical Power Ratio (SLMCPR) uncertainties used to determine LSCS SLMCPR are identified in the methodology provided in AREVA topical report ANF-524(P)(A), Revision 2, (Reference 3) and approved by the NRC in the SER provided on August 8, 1990, (Reference 4). The report includes the MCPR calculational procedure and the system measurement and calculational uncertainties to determine an MCPR safety limit that protects 99.9 percent of the fuel rods from boiling transition. The uncertainties used in AREVA's SLMCPR methodology for LSCS are equivalent to one standard deviation.

The radial bundle power uncertainty being used in the SLMCPR calculations, consistent with the methodology described above, includes the LPRM uncertainty component discussed in the AREVA topical report EMF-2158(P)(A) dated October 1999 (Reference 5). The NRC completed their review of topical report EMF-2158 and documented their approval in the Safety Evaluation dated October 18, 1999 (Reference 6). As documented in Reference 5, Equations 9-12 and 9-13 incorporate the LPRM measurement uncertainty into the radial bundle power measurement uncertainty. The

ATTACHMENT

Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

radial bundle power uncertainty value currently being used in the SLMCPR analysis for LSCS utilizes an LPRM uncertainty of 4.3% (i.e., a conservative value for the 2500 EFPH recalibration interval) in lieu of 3.4% for 1000 EFPH.

SRXB-3

In the RAI-3 response, the licensee indicated that a 3D nodal simulator was used to calculate the accumulated exposure values.

Identify the name of the simulator (or computer code) if it has one, and discuss acceptability of the simulator used for determination of accumulated exposure values. If the simulator was previously approved by the NRC, reference the title and the date of the safety evaluation report that approved the simulator for licensing applications.

Response

Since 1996 EGC has used two different software packages for core monitoring at LSCS. LSCS has used POWERPLEX-II and POWERPLEX-III.

POWERPLEX-II is a software package developed by AREVA for core monitoring tasks in BWR plants. The accumulated exposure values in POWERPLEX-II are performed by the calculation engine (or code) MICROBURN-B in accordance with XN-NF-80-19(P)(A), Volume 1, Supplements 3 and 4, dated November 1990 (Reference 7). This report was reviewed and approved by the NRC in the Safety Evaluation dated August 13, 1990 (Reference 8).

POWERPLEX-III is a software package developed by AREVA for core monitoring tasks in BWR plants. The accumulated exposure values in POWERPLEX-III are performed by the calculation engine (or code) MICROBURN-B2 in accordance with EMF-2158(P)(A), dated October 1999 (Reference 5) as reviewed and approved by the NRC in the Safety Evaluation dated October 18, 1999 (Reference 6).

References:

1. Letter from Mr. P. R. Simpson (Exelon Generation Company, LLC) to U. S. NRC, "Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency," dated October 31, 2008
2. Letter from W. R. Brian (Entergy Operations, Inc.) to U. S. NRC, "License Amendment Request Changes to the Local Power Range Monitor (LPRM) Calibration Frequency," dated November 1, 2006
3. AREVA Topical Report ANF-524(P)(A), "Advanced Nuclear Fuel Corporation Critical Power Methodology for Boiling Water Reactors," Revision 2, dated November 1990

ATTACHMENT

Additional Information Supporting the Request for a License Amendment to Revise Local Power Range Monitor Calibration Frequency

4. Letter from A. C. Thadani (NRC) to R. A. Copeland (ANF), "Acceptance for Referencing of Topical Report ANF-524(P), Revision 2, ANF Critical Power Methodology for Boiling Water Reactors," dated August 8, 1990
5. Siemens Topical Report EMF-2158(P)(A), "Siemens Power Corporation Methodology for Boiling Water Reactors: Evaluation and Validation of CASMO-4/MICROBURN-B2," dated October 1999
6. Letter from Stephen Dembeck (U. S. NRC) to J. F. Mallay (Siemens Power Corporation), "Acceptance for Referencing of Licensing Topical Report EMF-2158(P), Revision 0, 'Siemens Power Corporation Methodology for Boiling Water Reactors: Evaluation and Validation of CASMO-4/MICROBURN-B2' (TAC No. MA4592)," dated October 18, 1999
7. Advanced Nuclear Fuels Topical Report XN-NF-80-19(P)(A), Volume 1, Supplements 3 and 4, "Advanced Nuclear Fuels Corporation Methodology for Boiling Water Reactors: Benchmark Results for the CASMO-3G/MICROBURN-B Calculation Methodology," dated November 1990
8. Letter from Stephen Dembeck (U.S. NRC) to R. A. Copeland (Advanced Nuclear Fuels Corporation), "Acceptance for Referencing of Licensing Topical Report XN-NF-80-19(P) Volume 1, Supplement 3, Revision 0, 'Advanced Nuclear Fuels Corporation Methodology for Boiling Water Reactors: Benchmark Results for the CASMO-3G/MICROBURN-B Calculation Methodology,'" dated August 13, 1990

ENCLOSURE 1

LaSalle County Station Units 1 and 2
Local Power Range Monitor (LPRM) Calibration Data

LaSalle County Station Unit 1

LaSalle Unit 1**LPRM Data****Printed: 11/22/2006****String No.: 1****Serial No.: L-2693****Cycle Installed:****6****Coordinates: 57****Type: NA300****Cumulative Core Average Exposure at BOC:****86,992****Level: A****LPRM ID No.: 44****Beginning of Life Calibration Current:****1,289.0**

Total		Pre-Cal	Post-Cal	Gaf's Exp.		Good		% Life	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	In(CalCur)	Byp.?	Value
6/7/2001	46,317	5.206	1.459	0.000	No	650.0	6.5	No	Yes
7/7/2001	47,088	5.341	1.052	0.000	No	617.9	6.4	No	Yes
9/13/2001	48,853	5.687	1.057	0.000	No	584.6	6.4	No	Yes
3/29/2002	50,962	6.333	1.074	0.000	No	544.3	6.3	No	Yes
1/16/2003	55,612	7.492	1.063	0.000	No	512.0	6.2	No	Yes
7/30/2003	60,484	8.442	1.054	0.000	No	485.8	6.2	No	Yes
3/25/2004	69,535	9.087	1.059	0.000	No	458.7	6.1	No	Yes
5/6/2004	70,615	9.208	0.949	0.000	No	483.4	6.2	No	Yes
7/15/2004	72,392	9.411	1.061	0.000	No	455.6	6.1	No	Yes
1/6/2005	76,871	9.910	0.912	0.000	No	499.5	6.2	No	Yes
4/21/2005	79,565	10.147	1.070	0.000	No	466.9	6.1	No	Yes
9/15/2005	83,306	10.536	0.943	0.000	No	495.1	6.2	No	Yes
10/20/2005	84,207	10.596	0.948	0.000	No	522.0	6.3	No	Yes
3/24/2006	87,119	10.838	1.154	0.000	No	452.3	6.1	No	Yes
10/26/2006	92,606	11.493	0.994	0.000	No	455.1	6.1	No	Yes

Level: B**LPRM ID No.: 130****Beginning of Life Calibration Current:****1,281.0**

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	2.398	1.047	0.000	Yes	969.0	6.9	No	Yes
8/25/1998	22,612	2.495	1.060	0.000	No	914.2	6.8	No	Yes
9/29/1998	23,473	2.648	0.992	0.000	No	921.5	6.8	No	Yes
3/11/1999	27,265	3.306	1.086	0.000	No	846.0	6.7	No	Yes
6/24/1999	29,696	3.690	1.069	0.000	No	791.4	6.7	No	Yes
11/24/1999	32,205	4.029	1.081	0.000	No	732.1	6.6	No	Yes
2/2/2000	33,916	4.333	1.061	0.000	No	690.0	6.5	No	Yes
6/14/2000	37,221	4.941	1.051	0.000	No	656.5	6.5	No	Yes
9/28/2000	39,966	5.467	1.050	0.000	No	625.3	6.4	No	Yes
1/18/2001	42,777	6.010	1.057	0.000	No	591.5	6.4	No	Yes
6/7/2001	46,317	6.684	1.059	0.000	No	558.6	6.3	No	Yes
7/7/2001	47,088	6.830	1.098	0.000	No	508.7	6.2	No	Yes
3/29/2002	50,962	7.946	1.084	0.000	No	469.3	6.2	No	Yes

1/16/2003	55,612	9.361	1.079	0.000	No	434.9	6.1	No	Yes
7/30/2003	60,484	10.327	1.045	0.000	No	435.0	6.1	No	Yes
10/16/2003	62,481	10.693	1.063	0.000	No	409.2	6.0	No	Yes
2/19/2004	68,646	11.082	1.069	0.000	No	382.8	5.9	No	Yes
6/17/2004	71,692	11.542	1.074	0.000	No	356.4	5.9	No	Yes
6/8/2006	89,031	13.743	1.071	0.000	No	332.8	5.8	No	Yes
10/26/2006	92,606	14.267	1.018	0.000	No	326.9	5.8	No	Yes

Level: C

LPRM ID No.: 216

Beginning of Life Calibration Current:

1,371.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	2.900	1.016	0.000	Yes	1,201.0	7.1	No	Yes
8/25/1998	22,612	2.954	1.066	0.000	No	1,126.6	7.0	No	Yes
9/29/1998	23,473	3.078	0.992	0.000	No	1,135.7	7.0	No	Yes
4/15/1999	28,093	3.770	1.052	0.000	No	1,079.6	7.0	No	Yes
11/24/1999	32,205	4.436	1.106	0.000	No	976.1	6.9	No	Yes
4/12/2000	35,637	4.942	1.070	0.000	No	912.3	6.8	No	Yes
5/10/2000	36,328	5.039	1.002	0.000	No	910.4	6.8	No	Yes
7/7/2001	47,088	6.755	1.102	0.000	No	827.8	6.7	No	Yes
6/6/2002	49,915	7.963	1.002	0.000	No	780.0	6.7	No	Yes
3/29/2002	50,962	7.777	1.055	0.000	No	784.7	6.7	No	Yes
12/5/2002	54,558	8.556	1.053	0.000	No	740.7	6.6	No	Yes
7/30/2003	60,484	9.356	1.064	0.000	No	696.2	6.5	No	Yes
11/20/2003	63,386	9.855	1.056	0.000	No	659.3	6.5	No	Yes
2/19/2004	68,646	10.133	1.061	0.000	No	621.4	6.4	No	Yes
6/17/2004	71,692	10.577	1.082	0.000	No	574.3	6.4	No	Yes
12/9/2004	76,150	11.247	1.070	0.000	No	536.7	6.3	No	Yes
8/4/2005	82,243	12.084	1.052	0.000	No	510.2	6.2	No	Yes
1/12/2006	86,332	12.709	1.051	0.000	No	485.4	6.2	No	Yes
10/26/2006	92,606	13.622	1.046	0.000	No	464.1	6.1	No	Yes

Level: D

LPRM ID No.: 302

Beginning of Life Calibration Current:

1,300.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	2.554	1.051	0.000	Yes	988.0	6.9	No	Yes
8/25/1998	22,612	2.573	1.027	0.000	No	962.0	6.9	No	Yes
9/29/1998	23,473	2.647	0.999	0.000	No	963.0	6.9	No	Yes
3/11/1999	27,265	3.014	1.061	0.000	No	908.0	6.8	No	Yes
11/24/1999	32,205	3.602	1.128	0.000	No	805.0	6.7	No	Yes

4/12/2000	35,637	3.869	1.054	0.000	No	763.7	6.6	No	Yes
1/18/2001	42,777	4.522	1.059	0.000	No	721.2	6.6	No	Yes
7/7/2001	47,088	5.006	1.051	0.000	No	686.2	6.5	No	Yes
10/18/2001	49,756	5.337	1.055	0.000	No	650.4	6.5	No	Yes
3/25/2004	69,535	6.841	0.927	0.000	No	701.6	6.6	No	Yes
5/6/2004	70,615	6.929	1.146	0.000	No	612.2	6.4	No	Yes
7/15/2004	72,392	7.092	0.941	0.000	No	650.6	6.5	No	Yes
8/12/2004	73,112	7.164	1.066	0.000	No	610.3	6.4	No	Yes
2/3/2005	77,588	7.665	1.051	0.000	No	580.7	6.4	No	Yes
12/1/2005	85,259	8.717	1.063	0.000	No	546.3	6.3	No	Yes
3/24/2006	87,119	9.061	0.932	0.000	No	586.2	6.4	No	Yes
6/8/2006	89,031	9.268	1.066	0.000	No	549.9	6.3	No	Yes
10/26/2006	92,606	9.723	1.001	0.000	No	549.3	6.3	No	Yes

String No.: 2		Serial No.: K-7089		Cycle Installed:		7			
Coordinates: 57		Type: NA300		Cumulative Core Average Exposure at BOC:		79,343			
Level: A		LPRM ID No.: 45		Beginning of Life Calibration Current:		1,426.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	13,460	2.344	1.035	0.000	Yes	1,194.0	7.1	No	Yes
8/25/1998	14,963	2.461	1.095	0.000	No	1,090.4	7.0	No	Yes
9/29/1998	15,824	2.613	1.007	0.000	No	1,082.8	7.0	No	Yes
2/4/1999	18,757	3.087	1.061	0.000	No	1,020.6	6.9	No	Yes
11/24/1999	24,556	3.937	1.080	0.000	No	945.0	6.9	No	Yes
11/30/1999	24,692	3.963	1.053	0.000	No	897.4	6.8	No	Yes
6/14/2000	29,572	4.933	1.062	0.000	No	845.0	6.7	No	Yes
9/28/2000	32,317	5.526	1.104	0.000	No	765.4	6.6	No	Yes
2/22/2001	35,949	6.438	1.073	0.000	No	713.3	6.6	No	Yes
6/7/2001	38,668	6.961	1.082	0.000	No	659.3	6.5	No	Yes
2/14/2002	42,230	8.191	1.052	0.000	No	587.9	6.4	No	Yes
3/29/2002	43,313	8.431	1.073	0.000	No	547.9	6.3	No	Yes
12/20/2001	43,726	8.061	1.066	0.000	No	618.5	6.4	No	Yes
9/19/2002	44,942	9.396	1.081	0.000	No	506.8	6.2	No	Yes
4/10/2003	50,087	10.676	1.060	0.000	No	478.2	6.2	No	Yes
7/30/2003	52,835	11.571	1.066	0.000	No	448.6	6.1	No	Yes
10/16/2003	54,832	12.134	1.061	0.000	No	422.8	6.0	No	Yes
2/19/2004	60,997	12.618	1.078	0.000	No	392.2	6.0	No	Yes

7/15/2004	64,743	13.351	1.086	0.000	No	361.1	5.9	No	Yes
10/28/2004	67,434	14.000	1.062	0.000	No	340.0	5.8	No	Yes
1/6/2005	69,222	14.373	0.942	0.000	No	361.0	5.9	No	Yes
4/21/2005	71,916	14.976	1.089	0.000	No	331.5	5.8	No	Yes
8/4/2005	74,594	15.584	1.056	0.000	No	313.9	5.7	No	Yes
12/1/2005	77,610	16.132	0.940	0.000	No	333.9	5.8	No	Yes
3/24/2006	79,470	16.435	1.116	0.000	No	299.2	5.7	No	Yes
5/4/2006	80,518	16.705	1.112	0.000	No	269.1	5.6	No	Yes
8/17/2006	83,172	17.216	0.926	0.000	No	290.6	5.7	No	Yes
9/21/2006	84,063	17.395	1.097	0.000	No	264.9	5.6	No	Yes
10/26/2006	84,957	17.592	1.006	0.000	No	263.3	5.6	No	Yes

Level: B

LPRM ID No.: 131

Beginning of Life Calibration Current:

1,445.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	13,460	3.144	1.065	0.000	Yes	1,137.0	7.0	Yes
8/25/1998	14,963	3.262	1.077	0.000	No	1,055.7	7.0	Yes
9/29/1998	15,824	3.463	1.016	0.000	No	1,039.1	6.9	Yes
2/4/1999	18,757	4.133	1.098	0.000	No	946.3	6.9	Yes
3/11/1999	19,616	4.312	1.053	0.000	No	904.0	6.8	Yes
6/24/1999	22,047	4.796	1.060	0.000	No	852.8	6.7	Yes
11/24/1999	24,556	5.225	1.104	0.000	No	772.5	6.6	Yes
2/2/2000	26,267	5.589	1.061	0.000	No	728.1	6.6	Yes
5/10/2000	28,679	6.121	1.057	0.000	No	688.8	6.5	Yes
7/20/2000	30,502	6.528	1.080	0.000	No	637.8	6.5	Yes
1/18/2001	35,128	7.576	1.072	0.000	No	595.0	6.4	Yes
3/22/2001	36,674	7.884	1.056	0.000	No	563.4	6.3	Yes
6/7/2001	38,668	8.271	1.058	0.000	No	532.5	6.3	Yes
10/18/2001	42,107	9.018	1.090	0.000	No	488.5	6.2	Yes
2/14/2002	42,230	9.536	1.121	0.000	No	435.8	6.1	Yes
8/15/2002	44,072	10.589	1.084	0.000	No	402.0	6.0	Yes
4/10/2003	50,087	12.081	1.052	0.000	No	382.2	5.9	Yes
7/30/2003	52,835	12.783	1.057	0.000	No	361.6	5.9	Yes
11/20/2003	55,737	13.512	1.061	0.000	No	340.8	5.8	Yes
2/19/2004	60,997	13.845	1.065	0.000	No	320.0	5.8	Yes
7/15/2004	64,743	14.634	1.076	0.000	No	297.4	5.7	Yes
2/3/2005	69,939	15.744	1.059	0.000	No	280.8	5.6	Yes
5/31/2005	72,935	16.382	1.053	0.000	No	266.7	5.6	Yes

10/20/2005	76,558	17.128	1.066	0.000	No	250.0	5.5	No	Yes
3/24/2006	79,470	17.801	1.238	0.000	No	201.9	5.3	No	Yes
7/13/2006	82,276	18.434	1.053	0.000	No	191.8	5.3	No	Yes
10/26/2006	84,957	19.016	1.005	0.000	No	190.8	5.3	No	Yes

Level: C

LPRM ID No.: 217

Beginning of Life Calibration Current:

1,411.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	3.129	1.043	0.000	Yes	1,173.0	7.1	No	Yes
8/25/1998	14,963	3.208	1.104	0.000	No	1,062.5	7.0	No	Yes
9/29/1998	15,824	3.368	1.022	0.000	No	1,039.6	6.9	No	Yes
2/4/1999	18,757	3.939	1.081	0.000	No	961.7	6.9	No	Yes
4/15/1999	20,444	4.276	1.062	0.000	No	905.6	6.8	No	Yes
8/4/1999	22,908	4.775	1.076	0.000	No	841.6	6.7	No	Yes
11/24/1999	24,556	5.125	1.141	0.000	No	737.6	6.6	No	Yes
2/2/2000	26,267	5.409	1.081	0.000	No	682.3	6.5	No	Yes
6/14/2000	29,572	5.943	1.065	0.000	No	640.7	6.5	No	Yes
11/4/2000	33,192	6.567	1.055	0.000	No	607.3	6.4	No	Yes
2/22/2001	35,949	7.093	1.064	0.000	No	570.8	6.3	No	Yes
8/17/2001	40,505	8.125	1.055	0.000	No	541.0	6.3	No	Yes
10/18/2001	42,107	8.478	1.052	0.000	No	514.3	6.2	No	Yes
2/14/2002	42,230	8.976	1.108	0.000	No	464.1	6.1	No	Yes
6/19/2003	51,771	10.804	1.057	0.000	No	439.1	6.1	No	Yes
7/30/2003	52,835	11.007	1.022	0.000	No	439.0	6.1	No	Yes
11/20/2003	55,737	11.635	1.063	0.000	No	413.0	6.0	No	Yes
2/19/2004	60,997	11.988	1.063	0.000	No	388.5	6.0	No	Yes
6/17/2004	64,043	12.516	1.073	0.000	No	362.1	5.9	No	Yes
12/9/2004	68,501	13.346	1.077	0.000	No	336.2	5.8	No	Yes
8/4/2005	74,594	14.506	1.089	0.000	No	308.7	5.7	No	Yes
1/12/2006	78,683	15.419	1.083	0.000	No	285.1	5.7	No	Yes
3/24/2006	79,470	15.665	1.125	0.000	No	253.4	5.5	No	Yes
9/21/2006	84,063	16.540	1.051	0.000	No	241.1	5.5	No	Yes
10/26/2006	84,957	16.710	0.996	0.000	No	242.1	5.5	No	Yes

Level: D

LPRM ID No.: 303

Beginning of Life Calibration Current:

1,384.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	2.289	1.018	0.000	Yes	1,387.0	7.2	No	Yes
8/25/1998	14,963	2.314	1.049	0.000	No	1,322.2	7.2	No	Yes

9/29/1998	15,824	2.414	1.007	0.000	No	1,313.0	7.2	No	Yes
3/11/1999	19,616	2.909	1.055	0.000	No	1,239.0	7.1	No	Yes
11/24/1999	24,556	3.697	1.121	0.000	No	1,105.3	7.0	No	Yes
7/20/2000	30,502	4.250	1.071	0.000	No	1,032.0	6.9	No	Yes
10/18/2001	42,107	5.798	1.063	0.000	No	970.8	6.9	No	Yes
2/14/2002	42,230	6.166	1.159	0.000	No	837.6	6.7	No	Yes
4/10/2003	50,087	6.752	0.948	0.000	No	883.6	6.8	No	Yes
6/19/2003	51,771	6.869	1.058	0.000	No	835.2	6.7	No	Yes
7/30/2003	52,835	6.959	1.008	0.000	No	835.0	6.7	No	Yes
6/17/2004	64,043	7.758	1.086	0.000	No	768.9	6.6	No	Yes
8/12/2004	65,463	7.916	1.062	0.000	No	724.0	6.6	No	Yes
10/28/2004	67,434	8.150	0.935	0.000	No	774.3	6.7	No	Yes
12/9/2004	68,501	8.290	1.073	0.000	No	721.6	6.6	No	Yes
5/31/2005	72,935	8.995	1.084	0.000	No	665.7	6.5	No	Yes
12/1/2005	77,610	9.850	1.096	0.000	No	607.4	6.4	No	Yes
3/24/2006	79,470	10.318	1.171	0.000	No	518.7	6.3	No	Yes
5/4/2006	80,518	10.450	0.923	0.000	No	562.0	6.3	No	Yes
6/8/2006	81,382	10.578	1.081	0.000	No	519.9	6.3	No	Yes
8/17/2006	83,172	10.895	1.069	0.000	No	486.3	6.2	No	Yes
9/21/2006	84,063	11.048	0.932	0.000	No	521.8	6.3	No	Yes
10/26/2006	84,957	11.193	1.001	0.000	No	521.3	6.3	No	Yes

String No.: 3		Serial No.: L-2689		Cycle Installed:		6			
Coordinates: 57		Type: NA300		Cumulative Core Average Exposure at BOC:		86,992			
Level: A		LPRM ID No.: 46		Beginning of Life Calibration Current:		1,345.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	21,038	3.537	1.064	0.000	Yes	759.0	6.6	No	Yes
8/25/1998	22,612	3.638	1.025	0.000	No	740.5	6.6	No	Yes
9/29/1998	23,473	3.786	1.041	0.000	No	711.3	6.6	No	Yes
2/4/1999	26,406	4.241	1.063	0.000	No	669.2	6.5	No	Yes
6/24/1999	29,696	4.744	1.057	0.000	No	633.1	6.5	No	Yes
11/24/1999	32,205	5.080	1.087	0.000	No	582.4	6.4	No	Yes
12/27/1999	33,008	5.230	1.090	0.000	No	534.3	6.3	No	Yes
8/24/2000	39,057	6.471	1.073	0.000	No	498.0	6.2	No	Yes
2/22/2001	43,598	7.507	1.102	0.000	No	451.9	6.1	No	Yes
2/14/2002	49,879	9.182	1.051	0.000	No	407.2	6.0	No	Yes

12/20/2001	51,375	9.044	1.056	0.000	No	427.9	6.1	No	Yes
8/15/2002	51,721	10.204	1.062	0.000	No	383.4	5.9	No	Yes
6/19/2003	59,420	12.050	1.059	0.000	No	362.0	5.9	No	Yes
7/30/2003	60,484	12.373	1.033	0.000	No	362.0	5.9	No	Yes
10/16/2003	62,481	12.948	1.077	0.000	No	336.1	5.8	No	Yes
2/19/2004	68,646	13.447	1.150	0.000	No	292.3	5.7	No	Yes
3/25/2004	69,535	13.646	0.900	0.000	No	324.8	5.8	No	Yes
6/17/2004	71,692	14.111	1.149	0.000	No	282.6	5.6	No	Yes
8/12/2004	73,112	14.391	0.916	0.000	No	308.6	5.7	No	Yes
10/28/2004	75,083	14.848	1.101	0.000	No	280.3	5.6	No	Yes
12/9/2004	76,150	15.109	1.051	0.000	No	266.7	5.6	No	Yes
1/6/2005	76,871	15.252	0.894	0.000	No	298.3	5.7	No	Yes
2/3/2005	77,588	15.398	1.115	0.000	No	267.5	5.6	No	Yes
8/4/2005	82,243	16.446	0.936	0.000	No	285.8	5.7	No	Yes
9/15/2005	83,306	16.624	1.135	0.000	No	251.8	5.5	No	Yes
1/12/2006	86,332	17.176	0.912	0.000	No	276.1	5.6	No	Yes
3/24/2006	87,119	17.336	1.216	0.000	No	227.1	5.4	No	Yes
10/26/2006	92,606	18.373	1.034	0.000	No	219.6	5.4	No	Yes

Level: B

LPRM ID No.: 132

Beginning of Life Calibration Current:

1,365.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
9/12/1996	21,038	4.568	1.066	0.000	Yes	721.0	6.6	No	Yes
8/25/1998	22,612	4.681	1.042	0.000	No	691.9	6.5	No	Yes
9/29/1998	23,473	4.883	1.034	0.000	No	669.2	6.5	No	Yes
2/4/1999	26,406	5.541	1.095	0.000	No	611.1	6.4	No	Yes
6/24/1999	29,696	6.175	1.086	0.000	No	562.7	6.3	No	Yes
11/24/1999	32,205	6.632	1.106	0.000	No	508.8	6.2	No	Yes
3/8/2000	34,776	7.206	1.058	0.000	No	480.9	6.2	No	Yes
7/20/2000	38,151	7.993	1.050	0.000	No	458.0	6.1	No	Yes
9/28/2000	39,966	8.362	1.053	0.000	No	435.0	6.1	No	Yes
4/26/2001	45,228	9.514	1.071	0.000	No	406.1	6.0	No	Yes
10/18/2001	49,756	10.417	1.085	0.000	No	374.3	5.9	No	Yes
2/14/2002	49,879	10.955	1.089	0.000	No	343.7	5.8	No	Yes
12/5/2002	54,558	12.711	1.060	0.000	No	324.3	5.8	No	Yes
5/15/2003	58,582	13.609	1.058	0.000	No	306.5	5.7	No	Yes
7/30/2003	60,484	14.092	1.020	0.000	No	306.0	5.7	No	Yes
11/20/2003	63,386	14.819	1.063	0.000	No	287.9	5.7	No	Yes

2/19/2004	68,646	15.154	1.150	0.000	No	250.3	5.5	No	Yes
8/12/2004	73,112	16.110	1.052	0.000	No	237.9	5.5	No	Yes
12/9/2004	76,150	16.770	1.051	0.000	No	226.4	5.4	No	Yes
10/20/2005	84,207	18.336	1.060	0.000	No	214.0	5.4	No	Yes
3/24/2006	87,119	19.023	1.143	0.000	No	187.2	5.2	No	Yes
9/21/2006	91,712	20.008	1.072	0.000	No	174.7	5.2	No	Yes
10/26/2006	92,606	20.207	0.977	0.000	No	178.8	5.2	No	Yes

Level: C

LPRM ID No.: 218

Beginning of Life Calibration Current:

1,325.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	21,038	4.587	1.081	0.000	Yes	656.0	6.5	Yes
8/25/1998	22,612	4.666	1.048	0.000	No	626.0	6.4	Yes
9/29/1998	23,473	4.827	1.018	0.000	No	614.9	6.4	Yes
2/4/1999	26,406	5.423	1.058	0.000	No	581.2	6.4	Yes
6/24/1999	29,696	6.123	1.084	0.000	No	536.1	6.3	Yes
11/24/1999	32,205	6.666	1.144	0.000	No	468.7	6.1	Yes
3/8/2000	34,776	7.096	1.057	0.000	No	443.4	6.1	Yes
1/18/2001	42,777	8.519	1.059	0.000	No	418.7	6.0	Yes
6/7/2001	46,317	9.300	1.060	0.000	No	395.0	6.0	Yes
2/14/2002	49,879	10.541	1.061	0.000	No	353.9	5.9	Yes
11/15/2001	50,480	10.191	1.052	0.000	No	375.5	5.9	Yes
5/15/2003	58,582	12.191	1.064	0.000	No	332.6	5.8	Yes
7/30/2003	60,484	12.545	1.005	0.000	No	333.0	5.8	Yes
11/20/2003	63,386	13.176	1.059	0.000	No	314.4	5.8	Yes
2/19/2004	68,646	13.529	1.082	0.000	No	290.6	5.7	Yes
7/15/2004	72,392	14.174	1.056	0.000	No	275.2	5.6	Yes
12/9/2004	76,150	14.852	1.077	0.000	No	255.5	5.5	Yes
9/15/2005	83,306	16.143	1.054	0.000	No	242.4	5.5	Yes
3/24/2006	87,119	17.108	1.141	0.000	No	212.5	5.4	Yes
7/13/2006	89,925	17.657	1.068	0.000	No	198.9	5.3	Yes
10/26/2006	92,606	18.179	1.009	0.000	No	197.2	5.3	Yes

Level: D

LPRM ID No.: 304

Beginning of Life Calibration Current:

1,362.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	21,038	3.473	1.060	0.000	Yes	883.0	6.8	Yes
8/25/1998	22,612	3.499	1.057	0.000	No	835.4	6.7	Yes
9/29/1998	23,473	3.599	0.999	0.000	No	836.2	6.7	Yes

2/4/1999	26,406	3.986	1.062	0.000	No	787.4	6.7	No	Yes
6/24/1999	29,696	4.463	1.070	0.000	No	735.9	6.6	No	Yes
11/24/1999	32,205	4.911	1.127	0.000	No	653.0	6.5	No	Yes
2/2/2000	33,916	5.073	1.070	0.000	No	610.2	6.4	No	Yes
9/28/2000	39,966	5.681	1.065	0.000	No	573.0	6.4	No	Yes
2/14/2002	49,879	7.478	1.085	0.000	No	528.1	6.3	No	Yes
6/19/2003	59,420	8.203	0.929	0.000	No	568.5	6.3	No	Yes
7/30/2003	60,484	8.297	1.004	0.000	No	568.0	6.3	No	Yes
3/25/2004	69,535	8.872	1.124	0.000	No	505.3	6.2	No	Yes
6/17/2004	71,692	9.068	0.916	0.000	No	551.7	6.3	No	Yes
8/12/2004	73,112	9.220	1.104	0.000	No	499.7	6.2	No	Yes
10/28/2004	75,083	9.445	0.948	0.000	No	527.1	6.3	No	Yes
1/6/2005	76,871	9.688	1.081	0.000	No	487.6	6.2	No	Yes
2/3/2005	77,588	9.801	0.949	0.000	No	513.8	6.2	No	Yes
8/4/2005	82,243	10.431	1.119	0.000	No	459.2	6.1	No	Yes
9/15/2005	83,306	10.598	0.927	0.000	No	495.3	6.2	No	Yes
1/12/2006	86,332	11.189	1.132	0.000	No	437.6	6.1	No	Yes
5/4/2006	88,167	11.558	1.078	0.000	No	405.9	6.0	No	Yes
7/13/2006	89,925	11.868	1.091	0.000	No	372.1	5.9	No	Yes
10/26/2006	92,606	12.366	0.962	0.000	No	386.8	6.0	No	Yes

String No.: 4		Serial No.: K-7091		Cycle Installed:		7			
Coordinates: 57		Type: NA300		Cumulative Core Average Exposure at BOC:		79,343			
Level: A		LPRM ID No.: 47		Beginning of Life Calibration Current:		1,232.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	13,460	1.880	1.046	0.000	Yes	1,170.0	7.1	No	Yes
8/25/1998	14,963	1.982	1.087	0.000	No	1,076.4	7.0	No	Yes
9/29/1998	15,824	2.114	1.026	0.000	No	1,049.1	7.0	No	Yes
3/11/1999	19,616	2.640	1.065	0.000	No	980.0	6.9	No	Yes
6/24/1999	22,047	3.002	1.055	0.000	No	928.9	6.8	No	Yes
11/24/1999	24,556	3.283	1.111	0.000	No	836.1	6.7	No	Yes
12/27/1999	25,359	3.416	1.059	0.000	No	789.5	6.7	No	Yes
4/12/2000	27,988	3.864	1.061	0.000	No	744.1	6.6	No	Yes
8/24/2000	31,408	4.530	1.075	0.000	No	692.2	6.5	No	Yes
9/28/2000	32,317	4.678	1.050	0.000	No	659.3	6.5	No	Yes
1/18/2001	35,128	5.258	1.060	0.000	No	621.9	6.4	No	Yes

11/15/2001	42,831	6.789	1.058	0.000	No	587.8	6.4	No	Yes
10/24/2002	45,842	8.430	1.059	0.000	No	555.1	6.3	No	Yes
4/10/2003	50,087	9.483	1.063	0.000	No	522.2	6.3	No	Yes
7/30/2003	52,835	10.254	1.032	0.000	No	522.0	6.3	No	Yes
10/16/2003	54,832	10.705	1.088	0.000	No	479.8	6.2	No	Yes
2/19/2004	60,997	11.084	1.061	0.000	No	452.2	6.1	No	Yes
7/15/2004	64,743	11.695	1.086	0.000	No	416.4	6.0	No	Yes
12/9/2004	68,501	12.492	0.947	0.000	No	439.7	6.1	No	Yes
2/3/2005	69,939	12.662	1.052	0.000	No	418.0	6.0	No	Yes
4/21/2005	71,916	13.031	1.067	0.000	No	391.7	6.0	No	Yes
1/12/2006	78,683	14.156	0.960	0.000	No	419.0	6.0	No	Yes
3/24/2006	79,470	14.287	1.152	0.000	No	363.7	5.9	No	Yes
5/4/2006	80,518	14.502	1.088	0.000	No	334.3	5.8	No	Yes
7/13/2006	82,276	14.812	0.939	0.000	No	356.0	5.9	No	Yes
10/26/2006	84,957	15.270	1.087	0.000	No	327.5	5.8	No	Yes

Level: B

LPRM ID No.: 133

Beginning of Life Calibration Current:

1,299.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	13,460	2.568	1.043	0.000	Yes	1,185.0	7.1	Yes
8/25/1998	14,963	2.674	1.071	0.000	No	1,106.4	7.0	Yes
9/29/1998	15,824	2.859	1.014	0.000	No	1,091.2	7.0	Yes
3/11/1999	19,616	3.640	1.068	0.000	No	1,020.0	6.9	Yes
6/24/1999	22,047	4.081	1.068	0.000	No	955.1	6.9	Yes
11/24/1999	24,556	4.466	1.088	0.000	No	877.8	6.8	Yes
3/8/2000	27,127	4.984	1.079	0.000	No	813.5	6.7	Yes
7/20/2000	30,502	5.675	1.073	0.000	No	758.2	6.6	Yes
12/7/2000	34,042	6.407	1.060	0.000	No	715.3	6.6	Yes
3/22/2001	36,674	6.927	1.057	0.000	No	676.7	6.5	Yes
6/7/2001	38,668	7.285	1.073	0.000	No	630.7	6.4	Yes
9/13/2001	41,204	7.808	1.053	0.000	No	598.9	6.4	Yes
2/14/2002	42,230	8.485	1.119	0.000	No	535.2	6.3	Yes
6/6/2002	42,266	9.082	1.055	0.000	No	507.3	6.2	Yes
9/19/2002	44,942	9.701	1.060	0.000	No	478.6	6.2	Yes
4/10/2003	50,087	10.921	1.075	0.000	No	443.0	6.1	Yes
7/30/2003	52,835	11.583	1.052	0.000	No	421.1	6.0	Yes
11/20/2003	55,737	12.260	1.067	0.000	No	394.7	6.0	Yes
2/19/2004	60,997	12.566	1.133	0.000	No	348.3	5.9	Yes

8/12/2004	65,463	13.419	1.075	0.000	No	324.0	5.8	No	Yes
2/3/2005	69,939	14.253	1.052	0.000	No	308.0	5.7	No	Yes
10/20/2005	76,558	15.442	1.063	0.000	No	290.0	5.7	No	Yes
3/24/2006	79,470	16.030	1.133	0.000	No	256.0	5.5	No	Yes
10/26/2006	84,957	17.150	1.046	0.000	No	244.7	5.5	No	Yes

Level: C

LPRM ID No.: 219

Beginning of Life Calibration Current:

1,319.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	2.744	1.042	0.000	Yes	1,247.0	7.1	No	Yes
8/25/1998	14,963	2.811	1.087	0.000	No	1,135.0	7.0	No	Yes
9/29/1998	15,824	2.961	1.006	0.000	No	1,128.2	7.0	No	Yes
2/4/1999	18,757	3.488	1.059	0.000	No	1,065.4	7.0	No	Yes
6/24/1999	22,047	4.090	1.099	0.000	No	969.4	6.9	No	Yes
11/24/1999	24,556	4.579	1.128	0.000	No	859.4	6.8	No	Yes
12/27/1999	25,359	4.703	1.075	0.000	No	799.4	6.7	No	Yes
3/8/2000	27,127	4.976	1.048	0.000	No	762.8	6.6	No	Yes
7/20/2000	30,502	5.477	1.115	0.000	No	717.0	6.6	No	Yes
12/7/2000	34,042	6.067	1.055	0.000	No	679.6	6.5	No	Yes
3/22/2001	36,674	6.551	1.053	0.000	No	645.4	6.5	No	Yes
8/17/2001	40,505	7.341	1.063	0.000	No	607.2	6.4	No	Yes
2/14/2002	42,230	8.135	1.086	0.000	No	559.1	6.3	No	Yes
7/30/2003	52,835	10.072	1.052	0.000	No	531.4	6.3	No	Yes
12/30/2003	56,664	10.876	1.053	0.000	No	504.7	6.2	No	Yes
2/19/2004	60,997	10.991	1.112	0.000	No	453.9	6.1	No	Yes
6/17/2004	64,043	11.496	1.052	0.000	No	431.4	6.1	No	Yes
1/6/2005	69,222	12.422	1.057	0.000	No	408.2	6.0	No	Yes
8/4/2005	74,594	13.333	1.060	0.000	No	385.1	6.0	No	Yes
1/12/2006	78,683	14.148	1.053	0.000	No	365.7	5.9	No	Yes
3/24/2006	79,470	14.371	1.054	0.000	No	346.9	5.8	No	Yes
8/17/2006	83,172	15.023	1.060	0.000	No	327.3	5.8	No	Yes
10/26/2006	84,957	15.334	0.991	0.000	No	330.3	5.8	No	Yes

Level: D

LPRM ID No.: 305

Beginning of Life Calibration Current:

1,261.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
8/25/1998	14,963	2.208	0.999	0.000	No	1,164.0	7.1	No	Yes
9/29/1998	15,824	2.301	0.997	0.000	No	1,167.5	7.1	No	Yes
11/24/1999	24,556	3.487	1.120	0.000	No	1,042.4	6.9	No	Yes

11/30/1999	24,692	3.498	1.058	0.000	No	985.3	6.9	No	Yes
8/24/2000	31,408	4.083	1.051	0.000	No	937.5	6.8	No	Yes
3/22/2001	36,674	4.663	1.057	0.000	No	886.9	6.8	No	Yes
2/14/2002	42,230	5.715	1.055	0.000	No	796.8	6.7	No	Yes
12/20/2001	43,726	5.625	1.055	0.000	No	840.7	6.7	No	Yes
2/26/2003	49,017	6.216	0.923	0.000	No	863.3	6.8	No	Yes
7/30/2003	52,835	6.483	1.047	0.000	No	863.0	6.8	No	Yes
9/11/2003	53,930	6.585	1.051	0.000	No	821.1	6.7	No	Yes
6/17/2004	64,043	7.268	1.090	0.000	No	753.3	6.6	No	Yes
12/9/2004	68,501	7.794	1.081	0.000	No	696.9	6.5	No	Yes
8/4/2005	74,594	8.754	1.039	0.000	No	670.7	6.5	No	Yes
10/20/2005	76,558	9.123	1.091	0.000	No	639.0	6.5	No	Yes
3/24/2006	79,470	9.759	1.054	0.000	No	606.3	6.4	No	Yes
7/13/2006	82,276	10.134	1.068	0.000	No	567.7	6.3	No	Yes
10/26/2006	84,957	10.538	0.942	0.000	No	602.6	6.4	No	Yes

String No.: 5		Serial No.: L-2692		Cycle Installed:		6			
Coordinates: 49		Type: NA300		Cumulative Core Average Exposure at BOC:		86,992			
Level: A		LPRM ID No.: 48		Beginning of Life Calibration Current:		1,059.0			
Total	Pre-Cal		Post-Cal		Gaf's Exp.		Good		
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	21,038	1.915	1.057	0.000	Yes	954.0	6.9	No	Yes
8/25/1998	22,612	2.010	0.983	0.000	No	970.5	6.9	No	Yes
9/29/1998	23,473	2.143	1.013	0.000	No	958.0	6.9	No	Yes
3/11/1999	27,265	2.622	1.054	0.000	No	912.0	6.8	No	Yes
8/4/1999	30,557	3.089	1.048	0.000	No	870.2	6.8	No	Yes
11/24/1999	32,205	3.283	1.098	0.000	No	792.6	6.7	No	Yes
7/20/2000	38,151	4.047	1.065	0.000	No	744.2	6.6	No	Yes
11/4/2000	40,841	4.475	1.059	0.000	No	702.7	6.6	No	Yes
3/22/2001	44,323	5.054	1.055	0.000	No	666.1	6.5	No	Yes
4/26/2001	45,228	5.235	1.073	0.000	No	620.8	6.4	No	Yes
2/14/2002	49,879	6.432	1.074	0.000	No	545.8	6.3	No	Yes
11/15/2001	50,480	6.208	1.059	0.000	No	586.2	6.4	No	Yes
8/15/2002	51,721	7.269	1.092	0.000	No	499.8	6.2	No	Yes
4/10/2003	57,736	8.449	1.072	0.000	No	466.2	6.1	No	Yes
7/30/2003	60,484	9.034	1.040	0.000	No	466.0	6.1	No	Yes
10/16/2003	62,481	9.328	1.060	0.000	No	439.6	6.1	No	Yes

3/25/2004	69,535	9.717	1.078	0.000	No	407.8	6.0	No	Yes
9/23/2004	74,182	10.390	1.058	0.000	No	385.5	6.0	No	Yes
12/9/2004	76,150	10.651	0.915	0.000	No	421.3	6.0	No	Yes
8/4/2005	82,243	11.335	1.096	0.000	No	384.4	6.0	No	Yes
9/15/2005	83,306	11.452	0.893	0.000	No	430.4	6.1	No	Yes
12/1/2005	85,259	11.616	1.086	0.000	No	396.3	6.0	No	Yes
1/12/2006	86,332	11.707	0.948	0.000	No	452.0	6.1	No	Yes
3/24/2006	87,119	11.803	1.088	0.000	No	415.4	6.0	No	Yes
5/4/2006	88,167	12.002	1.099	0.000	No	378.0	5.9	No	Yes
10/26/2006	92,606	12.690	0.987	0.000	No	383.0	5.9	No	Yes

Level: B

LPRM ID No.: 134

Beginning of Life Calibration Current:

1,062.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	2.804	1.054	0.000	Yes	856.0	6.8	No	Yes
8/25/1998	22,612	2.904	0.977	0.000	No	876.2	6.8	No	Yes
9/29/1998	23,473	3.082	1.014	0.000	No	864.1	6.8	No	Yes
2/4/1999	26,406	3.640	1.077	0.000	No	802.3	6.7	No	Yes
4/15/1999	28,093	3.951	1.062	0.000	No	755.4	6.6	No	Yes
8/4/1999	30,557	4.355	1.056	0.000	No	715.4	6.6	No	Yes
11/30/1999	32,341	4.635	1.088	0.000	No	657.5	6.5	No	Yes
3/8/2000	34,776	5.073	1.057	0.000	No	622.1	6.4	No	Yes
7/20/2000	38,151	5.689	1.053	0.000	No	590.8	6.4	No	Yes
11/4/2000	40,841	6.204	1.053	0.000	No	561.0	6.3	No	Yes
4/26/2001	45,228	7.031	1.068	0.000	No	525.3	6.3	No	Yes
7/7/2001	47,088	7.387	1.051	0.000	No	499.8	6.2	No	Yes
12/20/2001	51,375	8.178	1.056	0.000	No	473.3	6.2	No	Yes
8/15/2002	51,721	9.217	1.086	0.000	No	435.8	6.1	No	Yes
2/26/2003	56,666	10.241	1.053	0.000	No	413.9	6.0	No	Yes
7/30/2003	60,484	11.022	1.056	0.000	No	391.9	6.0	No	Yes
2/19/2004	68,646	11.775	1.148	0.000	No	341.4	5.8	No	Yes
6/17/2004	71,692	12.339	1.073	0.000	No	318.2	5.8	No	Yes
6/30/2005	81,352	13.701	1.051	0.000	No	302.7	5.7	No	Yes
3/24/2006	87,119	14.478	0.948	0.000	No	319.3	5.8	No	Yes
7/13/2006	89,925	15.014	1.051	0.000	No	303.9	5.7	No	Yes
10/26/2006	92,606	15.479	1.012	0.000	No	300.2	5.7	No	Yes

Level: C

LPRM ID No.: 220

Beginning of Life Calibration Current:

1,200.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
-------	---------	--	----------	--	------------	--	--	--	------

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	3.278	1.054	0.000	Yes	886.0	6.8	No	Yes
8/25/1998	22,612	3.340	0.975	0.000	No	908.7	6.8	No	Yes
9/29/1998	23,473	3.479	1.013	0.000	No	897.1	6.8	No	Yes
2/4/1999	26,406	3.968	1.059	0.000	No	847.1	6.7	No	Yes
6/24/1999	29,696	4.521	1.098	0.000	No	771.5	6.6	No	Yes
11/24/1999	32,205	4.982	1.075	0.000	No	717.7	6.6	No	Yes
11/30/1999	32,341	5.004	1.052	0.000	No	682.2	6.5	No	Yes
3/8/2000	34,776	5.377	1.053	0.000	No	647.8	6.5	No	Yes
7/20/2000	38,151	5.851	1.069	0.000	No	606.0	6.4	No	Yes
2/22/2001	43,598	6.698	1.070	0.000	No	566.4	6.3	No	Yes
7/7/2001	47,088	7.268	1.052	0.000	No	538.4	6.3	No	Yes
8/15/2002	51,721	8.728	1.062	0.000	No	507.0	6.2	No	Yes
7/30/2003	60,484	9.975	1.066	0.000	No	475.6	6.2	No	Yes
2/19/2004	68,646	10.782	1.159	0.000	No	410.3	6.0	No	Yes
12/9/2004	76,150	11.965	1.061	0.000	No	386.7	6.0	No	Yes
8/4/2005	82,243	12.834	1.083	0.000	No	357.1	5.9	No	Yes
3/24/2006	87,119	13.695	0.927	0.000	No	385.2	6.0	No	Yes
8/17/2006	90,821	14.274	1.068	0.000	No	360.7	5.9	No	Yes
10/26/2006	92,606	14.529	0.993	0.000	No	363.2	5.9	No	Yes

Level: D

LPRM ID No.: 306

Beginning of Life Calibration Current:

1,123.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	2.854	1.041	0.000	Yes	962.0	6.9	No	Yes
8/25/1998	22,612	2.859	0.978	0.000	No	983.6	6.9	No	Yes
9/29/1998	23,473	2.940	1.012	0.000	No	972.0	6.9	No	Yes
6/24/1999	29,696	3.638	1.062	0.000	No	915.2	6.8	No	Yes
11/24/1999	32,205	4.000	1.085	0.000	No	843.5	6.7	No	Yes
11/30/1999	32,341	4.011	1.067	0.000	No	790.6	6.7	No	Yes
4/12/2000	35,637	4.286	1.052	0.000	No	751.5	6.6	No	Yes
1/18/2001	42,777	4.964	1.061	0.000	No	708.3	6.6	No	Yes
9/13/2001	48,853	5.659	1.070	0.000	No	661.9	6.5	No	Yes
2/14/2002	49,879	6.080	1.060	0.000	No	624.5	6.4	No	Yes
7/30/2003	60,484	6.852	0.986	0.000	No	624.0	6.4	No	Yes
2/19/2004	68,646	7.323	1.077	0.000	No	579.4	6.4	No	Yes
12/9/2004	76,150	8.105	1.068	0.000	No	542.5	6.3	No	Yes
9/15/2005	83,306	9.093	1.061	0.000	No	511.3	6.2	No	Yes

5/4/2006	88,167	9.887	0.928	0.000	No	551.0	6.3	No	Yes
10/26/2006	92,606	10.442	1.027	0.000	No	536.5	6.3	No	Yes

String No.: 6		Serial No.: 03s61368		Cycle Installed:		11			
Coordinates: 49		Type: NA300		Cumulative Core Average Exposure at BOC:		18,500			
Level: A		LPRM ID No.: 497		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.029	1.058	0.000	No	1,181.5	7.1	No	Yes
3/25/2004	1,043	0.287	1.085	0.000	No	1,088.9	7.0	No	Yes
8/12/2004	4,620	1.420	0.926	0.000	No	1,175.9	7.1	No	Yes
9/23/2004	5,690	1.736	1.058	0.000	No	1,111.5	7.0	No	Yes
12/9/2004	7,658	2.328	0.906	0.000	No	1,226.8	7.1	No	Yes
1/6/2005	8,379	2.499	1.054	0.000	No	1,163.9	7.1	No	Yes
3/17/2005	10,169	2.959	0.945	0.000	No	1,231.7	7.1	No	Yes
4/21/2005	11,073	3.207	1.082	0.000	No	1,138.3	7.0	No	Yes
3/24/2006	18,627	5.227	1.180	0.000	No	964.7	6.9	No	Yes
10/26/2006	24,114	6.861	1.010	0.000	No	955.1	6.9	No	Yes
Level: B		LPRM ID No.: 507		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.041	1.086	0.000	No	1,151.0	7.0	No	Yes
9/23/2004	5,690	1.594	0.939	0.000	No	1,225.8	7.1	No	Yes
4/21/2005	11,073	2.849	0.937	0.000	No	1,308.2	7.2	No	Yes
12/1/2005	16,767	4.254	1.071	0.000	No	1,221.5	7.1	No	Yes
3/24/2006	18,627	4.832	1.177	0.000	No	1,037.8	6.9	No	Yes
10/26/2006	24,114	6.340	1.022	0.000	No	1,015.4	6.9	No	Yes
Level: C		LPRM ID No.: 517		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
8/12/2004	4,620	1.029	0.941	0.000	No	1,328.4	7.2	No	Yes
12/9/2004	7,658	1.675	0.941	0.000	No	1,411.7	7.3	No	Yes
6/30/2005	12,860	2.721	0.948	0.000	No	1,489.1	7.3	No	Yes
1/12/2006	17,840	4.036	1.059	0.000	No	1,406.1	7.2	No	Yes

3/24/2006	18,627	4.350	1.167	0.000	No	1,204.9	7.1	No	Yes
10/26/2006	24,114	5.551	1.012	0.000	No	1,190.6	7.1	No	Yes

Level: D LPRM ID No.: 527

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.018	0.942	0.000	No	1,327.0	7.2	No	Yes
9/23/2004	5,690	0.659	0.917	0.000	No	1,447.1	7.3	No	Yes
1/6/2005	8,379	1.021	0.941	0.000	No	1,537.8	7.3	No	Yes
4/21/2005	11,073	1.452	0.946	0.000	No	1,625.6	7.4	No	Yes
5/31/2005	12,092	1.624	1.065	0.000	No	1,526.4	7.3	No	Yes
9/15/2005	14,814	2.134	0.896	0.000	No	1,704.0	7.4	No	Yes
12/1/2005	16,767	2.582	1.083	0.000	No	1,573.4	7.4	No	Yes
5/4/2006	19,675	3.235	1.071	0.000	No	1,469.1	7.3	No	Yes
8/17/2006	22,329	3.669	0.948	0.000	No	1,549.7	7.3	No	Yes
9/21/2006	23,220	3.813	0.932	0.000	No	1,662.8	7.4	No	Yes
10/26/2006	24,114	3.942	1.061	0.000	No	1,567.2	7.4	No	Yes

String No.: 7 Serial No.: 00s19542

Cycle Installed:

10

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

37,300

Level: A LPRM ID No.: 401

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/14/2002	187	0.053	1.100	0.000	No	1,136.0	7.0	No	Yes
3/29/2002	1,270	0.346	1.054	0.000	No	1,077.8	7.0	No	Yes
2/26/2003	6,974	2.727	1.062	0.000	No	1,014.9	6.9	No	Yes
5/15/2003	8,890	3.413	1.106	0.000	No	917.6	6.8	No	Yes
7/30/2003	10,792	3.953	1.066	0.000	No	860.8	6.8	No	Yes
10/16/2003	12,789	4.513	1.100	0.000	No	782.5	6.7	No	Yes
2/19/2004	18,954	5.036	1.119	0.000	No	699.3	6.6	No	Yes
5/6/2004	20,923	5.681	1.063	0.000	No	657.9	6.5	No	Yes
6/17/2004	22,000	6.036	1.069	0.000	No	615.4	6.4	No	Yes
12/9/2004	26,458	7.292	1.123	0.000	No	548.0	6.3	No	Yes
2/3/2005	27,896	7.782	1.057	0.000	No	518.5	6.3	No	Yes
4/21/2005	29,873	8.555	1.058	0.000	No	490.0	6.2	No	Yes
8/4/2005	32,551	9.461	1.061	0.000	No	461.9	6.1	No	Yes
3/24/2006	37,427	10.690	1.130	0.000	No	408.7	6.0	No	Yes

7/13/2006	40,233	11.461	1.055	0.000	No	387.4	6.0	No	Yes
9/21/2006	42,020	11.946	1.082	0.000	No	358.1	5.9	No	Yes
10/26/2006	42,914	12.247	1.000	0.000	No	358.1	5.9	No	Yes

Level: B

LPRM ID No.: 409

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.051	1.054	0.000	No	1,186.0	7.1	No	Yes
8/15/2002	2,029	1.351	0.943	0.000	No	1,257.7	7.1	No	Yes
6/19/2003	9,728	3.506	1.067	0.000	No	1,178.7	7.1	No	Yes
7/30/2003	10,792	3.781	1.044	0.000	No	1,179.0	7.1	No	Yes
9/11/2003	11,887	4.069	1.072	0.000	No	1,099.8	7.0	No	Yes
10/16/2003	12,789	4.336	1.061	0.000	No	1,036.6	6.9	No	Yes
12/30/2003	14,621	4.842	1.058	0.000	No	979.8	6.9	No	Yes
2/19/2004	18,954	4.979	1.193	0.000	No	821.3	6.7	No	Yes
6/17/2004	22,000	5.890	1.113	0.000	No	737.9	6.6	No	Yes
9/23/2004	24,490	6.544	1.056	0.000	No	698.7	6.5	No	Yes
12/9/2004	26,458	7.058	1.068	0.000	No	654.3	6.5	No	Yes
3/17/2005	28,969	7.747	1.072	0.000	No	610.3	6.4	No	Yes
5/31/2005	30,892	8.271	1.054	0.000	No	579.0	6.4	No	Yes
8/4/2005	32,551	8.701	1.056	0.000	No	548.3	6.3	No	Yes
10/20/2005	34,515	9.250	1.053	0.000	No	521.0	6.3	No	Yes
1/12/2006	36,640	9.854	1.078	0.000	No	483.3	6.2	No	Yes
3/24/2006	37,427	10.169	1.089	0.000	No	443.8	6.1	No	Yes
7/13/2006	40,233	10.952	1.053	0.000	No	421.5	6.0	No	Yes
10/26/2006	42,914	11.735	1.051	0.000	No	401.0	6.0	No	Yes

Level: C

LPRM ID No.: 417

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.037	1.046	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.269	1.091	0.000	No	1,145.7	7.0	No	Yes
8/15/2002	2,029	0.963	0.927	0.000	No	1,236.0	7.1	No	Yes
5/15/2003	8,890	2.566	1.069	0.000	No	1,156.2	7.1	No	Yes
7/30/2003	10,792	3.078	1.089	0.000	No	1,061.7	7.0	No	Yes
9/11/2003	11,887	3.406	1.065	0.000	No	996.9	6.9	No	Yes
10/16/2003	12,789	3.670	1.063	0.000	No	937.8	6.8	No	Yes
12/30/2003	14,621	4.241	1.093	0.000	No	858.0	6.8	No	Yes
2/19/2004	18,954	4.393	1.066	0.000	No	804.9	6.7	No	Yes

5/6/2004	20,923	4.839	1.055	0.000	No	762.9	6.6	No	Yes
8/12/2004	23,420	5.397	1.064	0.000	No	717.0	6.6	No	Yes
12/9/2004	26,458	6.054	1.081	0.000	No	663.3	6.5	No	Yes
5/31/2005	30,892	7.121	1.089	0.000	No	609.1	6.4	No	Yes
8/4/2005	32,551	7.516	1.067	0.000	No	570.9	6.3	No	Yes
12/1/2005	35,567	8.422	1.085	0.000	No	526.1	6.3	No	Yes
1/12/2006	36,640	8.766	1.040	0.000	No	501.0	6.2	No	Yes
3/24/2006	37,427	9.113	1.087	0.000	No	460.9	6.1	No	Yes
6/8/2006	39,339	9.523	1.052	0.000	No	438.1	6.1	No	Yes
10/26/2006	42,914	10.381	1.049	0.000	No	417.7	6.0	No	Yes

Level: D

LPRM ID No.: 425

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.013	0.988	0.000	No	1,250.0	7.1	No	Yes
6/6/2002	223	0.211	0.989	0.000	No	1,163.0	7.1	No	Yes
8/15/2002	2,029	0.349	0.948	0.000	No	1,226.8	7.1	No	Yes
2/26/2003	6,974	0.859	0.901	0.000	No	1,346.0	7.2	No	Yes
7/30/2003	10,792	1.302	0.982	0.000	No	1,346.0	7.2	No	Yes
3/25/2004	19,843	2.188	1.095	0.000	No	1,229.2	7.1	No	Yes
10/28/2004	25,391	2.895	1.066	0.000	No	1,153.1	7.1	No	Yes
4/21/2005	29,873	3.637	1.058	0.000	No	1,089.9	7.0	No	Yes
6/30/2005	31,660	3.947	1.069	0.000	No	1,019.6	6.9	No	Yes
9/15/2005	33,614	4.371	1.100	0.000	No	926.9	6.8	No	Yes
12/1/2005	35,567	4.852	1.094	0.000	No	847.2	6.7	No	Yes
1/12/2006	36,640	5.144	1.027	0.000	No	803.0	6.7	No	Yes
6/8/2006	39,339	5.735	1.100	0.000	No	730.0	6.6	No	Yes
10/26/2006	42,914	6.498	1.068	0.000	No	683.5	6.5	No	Yes

String No.: 8

Serial No.: 00s19547

Cycle Installed:

10

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

37,300

Level: A

LPRM ID No.: 402

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.060	1.148	0.000	No	1,066.0	7.0	No	Yes
3/29/2002	1,270	0.428	1.063	0.000	No	1,002.8	6.9	No	Yes
12/5/2002	4,866	2.098	1.051	0.000	No	901.0	6.8	No	Yes
1/16/2003	5,920	2.338	0.945	0.000	No	953.4	6.9	No	Yes

2/26/2003	6,974	2.738	1.097	0.000	No	869.1	6.8	No	Yes
5/15/2003	8,890	3.547	1.147	0.000	No	757.7	6.6	No	Yes
6/19/2003	9,728	3.818	1.059	0.000	No	715.5	6.6	No	Yes
7/30/2003	10,792	4.112	1.021	0.000	No	716.0	6.6	No	Yes
10/16/2003	12,789	4.692	1.066	0.000	No	599.0	6.4	No	Yes
3/25/2004	19,843	5.472	1.052	0.000	No	569.4	6.3	No	Yes
6/17/2004	22,000	6.086	1.051	0.000	No	541.8	6.3	No	Yes
9/23/2004	24,490	6.791	1.102	0.000	No	491.6	6.2	No	Yes
3/17/2005	28,969	8.345	1.109	0.000	No	443.3	6.1	No	Yes
9/15/2005	33,614	10.063	1.052	0.000	No	421.4	6.0	No	Yes
1/12/2006	36,640	10.761	1.074	0.000	No	392.4	6.0	No	Yes
3/24/2006	37,427	10.986	1.157	0.000	No	339.1	5.8	No	Yes
10/26/2006	42,914	12.487	1.040	0.000	No	326.1	5.8	No	Yes

Level: B

LPRM ID No.: 410

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.057	1.117	0.000	No	1,119.0	7.0	No	Yes
12/5/2002	4,866	2.154	1.072	0.000	No	1,043.8	7.0	No	Yes
2/26/2003	6,974	2.780	1.074	0.000	No	971.9	6.9	No	Yes
5/15/2003	8,890	3.387	1.106	0.000	No	878.8	6.8	No	Yes
7/30/2003	10,792	3.908	1.078	0.000	No	815.2	6.7	No	Yes
10/16/2003	12,789	4.477	1.060	0.000	No	769.0	6.6	No	Yes
12/30/2003	14,621	4.987	1.076	0.000	No	714.7	6.6	No	Yes
2/19/2004	18,954	5.119	1.122	0.000	No	637.0	6.5	No	Yes
8/12/2004	23,420	6.314	1.086	0.000	No	586.6	6.4	No	Yes
2/3/2005	27,896	7.537	1.096	0.000	No	535.2	6.3	No	Yes
6/30/2005	31,660	8.595	1.088	0.000	No	491.9	6.2	No	Yes
12/1/2005	35,567	9.734	1.063	0.000	No	462.7	6.1	No	Yes
1/12/2006	36,640	10.035	1.064	0.000	No	434.9	6.1	No	Yes
3/24/2006	37,427	10.353	1.083	0.000	No	401.6	6.0	No	Yes
6/8/2006	39,339	10.943	1.053	0.000	No	381.4	5.9	No	Yes
10/26/2006	42,914	11.918	1.054	0.000	No	361.8	5.9	No	Yes

Level: C

LPRM ID No.: 418

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.037	1.086	0.000	No	1,151.0	7.0	No	Yes
1/16/2003	5,920	1.949	1.050	0.000	No	1,096.2	7.0	No	Yes

5/15/2003	8,890	2.586	1.071	0.000	No	1,023.5	6.9	No	Yes
7/30/2003	10,792	3.132	1.108	0.000	No	923.8	6.8	No	Yes
9/11/2003	11,887	3.469	1.063	0.000	No	869.0	6.8	No	Yes
11/20/2003	13,694	4.014	1.073	0.000	No	809.9	6.7	No	Yes
2/19/2004	18,954	4.451	1.133	0.000	No	714.8	6.6	No	Yes
8/12/2004	23,420	5.365	1.055	0.000	No	677.6	6.5	No	Yes
1/6/2005	27,179	6.226	1.071	0.000	No	632.6	6.4	No	Yes
5/31/2005	30,892	7.094	1.056	0.000	No	599.1	6.4	No	Yes
9/15/2005	33,614	7.830	1.085	0.000	No	552.2	6.3	No	Yes
12/1/2005	35,567	8.444	1.053	0.000	No	524.4	6.3	No	Yes
1/12/2006	36,640	8.782	0.000	0.000	No	480.0	6.2	No	Yes
5/4/2006	38,475	9.379	1.084	0.000	No	442.8	6.1	No	Yes
6/8/2006	39,339	9.582	1.055	0.000	No	419.7	6.0	No	Yes
10/26/2006	42,914	10.416	1.034	0.000	No	405.9	6.0	No	Yes

Level: D LPRM ID No.: 426

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.013	1.023	0.000	No	1,250.0	7.1	No	Yes
1/16/2003	5,920	0.768	0.949	0.000	No	1,317.2	7.2	No	Yes
5/15/2003	8,890	1.062	0.939	0.000	No	1,402.7	7.2	No	Yes
7/30/2003	10,792	1.313	1.026	0.000	No	1,403.0	7.2	No	Yes
2/19/2004	18,954	2.115	1.058	0.000	No	1,326.1	7.2	No	Yes
8/12/2004	23,420	2.626	1.094	0.000	No	1,212.1	7.1	No	Yes
9/23/2004	24,490	2.789	0.928	0.000	No	1,306.2	7.2	No	Yes
2/3/2005	27,896	3.355	1.138	0.000	No	1,147.8	7.0	No	Yes
6/30/2005	31,660	3.992	1.135	0.000	No	1,011.3	6.9	No	Yes
9/15/2005	33,614	4.408	1.079	0.000	No	937.2	6.8	No	Yes
12/1/2005	35,567	4.886	1.065	0.000	No	880.0	6.8	No	Yes
1/12/2006	36,640	5.183	1.049	0.000	No	807.0	6.7	No	Yes
3/24/2006	37,427	5.491	0.978	0.000	No	807.0	6.7	No	Yes
6/8/2006	39,339	5.794	1.071	0.000	No	753.5	6.6	No	Yes
7/13/2006	40,233	5.992	1.078	0.000	No	699.0	6.5	No	Yes
10/26/2006	42,914	6.605	1.028	0.000	No	679.9	6.5	No	Yes

String No.: 9

Serial No.: 03s61362

Cycle Installed:

11

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

18,500

Level: A

LPRM ID No.: 498

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	18,627	5.639	1.656	0.000	No	754.8	6.6	No	Yes
9/21/2006	23,220	6.986	1.088	0.000	No	693.8	6.5	No	Yes
10/26/2006	24,114	7.272	0.984	0.000	No	705.1	6.6	No	Yes

Level: B

LPRM ID No.: 508

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.047	1.152	0.000	No	1,085.1	7.0	No	Yes
6/17/2004	3,200	0.960	0.944	0.000	No	1,149.4	7.0	No	Yes
1/6/2005	8,379	2.308	0.928	0.000	No	1,238.6	7.1	No	Yes
3/24/2006	18,627	5.054	1.127	0.000	No	1,099.0	7.0	No	Yes
8/17/2006	22,329	6.107	1.052	0.000	No	1,044.7	7.0	No	Yes
10/26/2006	24,114	6.643	1.002	0.000	No	1,042.6	6.9	No	Yes

Level: C

LPRM ID No.: 518

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.042	1.063	0.000	No	1,175.9	7.1	No	Yes
6/8/2006	20,539	4.925	1.060	0.000	No	1,179.2	7.1	No	Yes
10/26/2006	24,114	5.792	1.015	0.000	No	1,161.8	7.1	No	Yes

Level: D

LPRM ID No.: 528

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.019	0.932	0.000	No	1,341.2	7.2	No	Yes
12/9/2004	7,658	0.969	0.933	0.000	No	1,437.5	7.3	No	Yes
6/8/2006	20,539	3.556	1.065	0.000	No	1,349.8	7.2	No	Yes
7/13/2006	21,433	3.719	1.060	0.000	No	1,273.4	7.1	No	Yes
8/17/2006	22,329	3.891	0.945	0.000	No	1,347.5	7.2	No	Yes
10/26/2006	24,114	4.209	0.995	0.000	No	1,354.3	7.2	No	Yes

String No.: 10

Serial No.: 05s105126

Cycle Installed:

12

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 577

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.036	1.143	0.000	No	1,093.6	7.0	No	Yes
7/13/2006	2,933	0.792	1.054	0.000	No	1,037.6	6.9	No	Yes
9/21/2006	4,720	1.194	0.934	0.000	No	1,110.9	7.0	No	Yes
10/26/2006	5,614	1.339	1.027	0.000	No	1,081.7	7.0	No	Yes

Level: B

LPRM ID No.: 585

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.032	1.057	0.000	No	1,182.6	7.1	No	Yes
6/8/2006	2,039	0.534	1.054	0.000	No	1,122.0	7.0	No	Yes
10/26/2006	5,614	1.379	0.969	0.000	No	1,157.9	7.1	No	Yes

Level: C

LPRM ID No.: 593

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.023	1.035	0.000	No	1,250.0	7.1	No	Yes
6/8/2006	2,039	0.406	1.091	0.000	No	1,145.7	7.0	No	Yes
10/26/2006	5,614	1.101	0.962	0.000	No	1,191.0	7.1	No	Yes

Level: D

LPRM ID No.: 601

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/8/2006	2,039	0.265	1.057	0.000	No	1,182.6	7.1	No	Yes
10/26/2006	5,614	0.786	0.959	0.000	No	1,233.2	7.1	No	Yes

String No.: 11 Serial No.: 01s19549

Cycle Installed:

11

Coordinates: 41 Type: NA300

Cumulative Core Average Exposure at BOC:

18,500

Level: A LPRM ID No.: 499

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.026	1.137	0.000	No	1,099.4	7.0	No	Yes
3/25/2004	1,043	0.221	1.078	0.000	No	1,019.8	6.9	No	Yes
10/28/2004	6,591	1.608	0.936	0.000	No	1,089.6	7.0	No	Yes

1/6/2005	8,379	2.053	1.061	0.000	No	1,026.9	6.9	No	Yes
3/17/2005	10,169	2.470	1.069	0.000	No	960.6	6.9	No	Yes
4/21/2005	11,073	2.697	0.945	0.000	No	1,016.6	6.9	No	Yes
5/31/2005	12,092	2.978	1.146	0.000	No	887.0	6.8	No	Yes
8/4/2005	13,751	3.521	1.071	0.000	No	828.2	6.7	No	Yes
1/12/2006	17,840	4.519	1.001	0.000	No	749.0	6.6	No	Yes
5/4/2006	19,675	5.073	1.079	0.000	No	694.2	6.5	No	Yes
7/13/2006	21,433	5.560	1.065	0.000	No	651.8	6.5	No	Yes
10/26/2006	24,114	6.322	1.065	0.000	No	612.0	6.4	No	Yes

Level: B LPRM ID No.: 509

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
2/19/2004	154	0.038	1.136	0.000	No	1,100.4	7.0	No Yes
3/17/2005	10,169	2.345	0.995	0.000	No	1,105.9	7.0	No Yes
6/30/2005	12,860	2.920	1.108	0.000	No	993.1	6.9	No Yes
10/20/2005	15,715	3.571	1.071	0.000	No	927.0	6.8	No Yes
1/12/2006	17,840	4.106	1.052	0.000	No	838.0	6.7	No Yes
3/24/2006	18,627	4.385	1.013	0.000	No	838.0	6.7	No Yes
6/8/2006	20,539	4.884	1.089	0.000	No	769.5	6.6	No Yes
8/17/2006	22,329	5.333	1.056	0.000	No	728.7	6.6	No Yes
10/26/2006	24,114	5.803	1.043	0.000	No	698.7	6.5	No Yes

Level: C LPRM ID No.: 519

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
2/19/2004	154	0.036	1.053	0.000	No	1,187.1	7.1	No Yes
12/9/2004	7,658	1.503	0.930	0.000	No	1,276.4	7.2	No Yes
2/3/2005	9,096	1.816	1.057	0.000	No	1,207.6	7.1	No Yes
8/4/2005	13,751	2.714	1.090	0.000	No	1,107.9	7.0	No Yes
10/20/2005	15,715	3.170	1.071	0.000	No	1,034.0	6.9	No Yes
1/12/2006	17,840	3.752	1.053	0.000	No	908.0	6.8	No Yes
3/24/2006	18,627	4.051	1.070	0.000	No	848.6	6.7	No Yes
7/13/2006	21,433	4.617	1.070	0.000	No	793.1	6.7	No Yes
10/26/2006	24,114	5.179	1.045	0.000	No	758.9	6.6	No Yes

Level: D LPRM ID No.: 529

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
-------	---------	--	----------	------------	--	--	--	------

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.102	0.901	0.000	No	1,387.3	7.2	No	Yes
5/6/2004	2,123	0.210	1.058	0.000	No	1,311.3	7.2	No	Yes
2/3/2005	9,096	1.110	0.908	0.000	No	1,444.2	7.3	No	Yes
4/21/2005	11,073	1.431	1.053	0.000	No	1,371.5	7.2	No	Yes
8/4/2005	13,751	1.853	0.925	0.000	No	1,482.7	7.3	No	Yes
10/20/2005	15,715	2.249	1.066	0.000	No	1,391.0	7.2	No	Yes
12/1/2005	16,767	2.469	1.051	0.000	No	1,323.5	7.2	No	Yes
7/13/2006	21,433	3.342	1.076	0.000	No	1,230.0	7.1	No	Yes
10/26/2006	24,114	3.774	1.091	0.000	No	1,127.4	7.0	No	Yes

String No.: 12 Serial No.: 03s61367 Cycle Installed: 11
Coordinates: 41 Type: NA300 Cumulative Core Average Exposure at BOC: 18,500
Level: A LPRM ID No.: 500 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.033	0.934	0.000	No	1,338.3	7.2	No	Yes
3/25/2004	1,043	0.341	1.149	0.000	No	1,164.8	7.1	No	Yes
3/17/2005	10,169	3.382	0.940	0.000	No	1,239.1	7.1	No	Yes
5/31/2005	12,092	4.160	1.092	0.000	No	1,134.7	7.0	No	Yes
3/24/2006	18,627	5.770	1.167	0.000	No	972.3	6.9	No	Yes
10/26/2006	24,114	7.336	1.051	0.000	No	925.2	6.8	No	Yes

Level: B LPRM ID No.: 510 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/31/2005	12,092	3.434	0.938	0.000	No	1,310.0	7.2	No	Yes
12/1/2005	16,767	4.689	1.081	0.000	No	1,211.8	7.1	No	Yes
3/24/2006	18,627	5.297	1.187	0.000	No	1,020.9	6.9	No	Yes
10/26/2006	24,114	6.893	1.017	0.000	No	1,003.9	6.9	No	Yes

Level: C LPRM ID No.: 520 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/17/2004	3,200	0.759	0.939	0.000	No	1,331.2	7.2	No	Yes

12/9/2004	7,658	1.729	0.940	0.000	No	1,416.2	7.3	No	Yes
1/12/2006	17,840	4.369	1.051	0.000	No	1,347.5	7.2	No	Yes
3/24/2006	18,627	4.711	1.153	0.000	No	1,168.7	7.1	No	Yes
7/13/2006	21,433	5.377	1.053	0.000	No	1,109.8	7.0	No	Yes
10/26/2006	24,114	6.073	0.965	0.000	No	1,150.1	7.0	No	Yes

Level: D

LPRM ID No.: 530

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/17/2004	3,200	0.367	0.936	0.000	No	1,335.5	7.2	No	Yes
12/9/2004	7,658	1.044	1.051	0.000	No	1,270.7	7.1	No	Yes
3/17/2005	10,169	1.467	0.937	0.000	No	1,356.1	7.2	No	Yes
5/31/2005	12,092	1.803	0.923	0.000	No	1,469.2	7.3	No	Yes
9/15/2005	14,814	2.365	1.068	0.000	No	1,375.7	7.2	No	Yes
12/1/2005	16,767	2.832	0.923	0.000	No	1,490.4	7.3	No	Yes
1/12/2006	17,840	3.123	1.084	0.000	No	1,375.0	7.2	No	Yes
5/4/2006	19,675	3.576	1.052	0.000	No	1,307.0	7.2	No	Yes
10/26/2006	24,114	4.472	1.003	0.000	No	1,303.1	7.2	No	Yes

String No.: 13

Serial No.: 04s82833

Cycle Installed:

12

Coordinates: 41

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 578

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.046	1.132	0.000	No	1,104.2	7.0	No	Yes
6/8/2006	2,039	0.690	1.069	0.000	No	1,033.0	6.9	No	Yes
10/26/2006	5,614	1.747	0.945	0.000	No	1,093.1	7.0	No	Yes

Level: B

LPRM ID No.: 586

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/8/2006	2,039	0.653	1.051	0.000	No	1,189.3	7.1	No	Yes
10/26/2006	5,614	1.743	0.952	0.000	No	1,249.3	7.1	No	Yes

Level: C

LPRM ID No.: 594

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value

2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/26/2006	5,614	1.417	0.978	0.000	No	1,278.1	7.2	No	Yes

Level: D LPRM ID No.: 602

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.016	0.882	0.000	No	1,417.2	7.3	No	Yes
6/8/2006	2,039	0.303	1.053	0.000	No	1,345.9	7.2	No	Yes
10/26/2006	5,614	1.108	0.967	0.000	No	1,391.8	7.2	No	Yes

String No.: 14 Serial No.: K-7092

Coordinates: 41 Type: NA300

Cycle Installed:

7

Cumulative Core Average Exposure at BOC:

79,343

Level: A LPRM ID No.: 57

Beginning of Life Calibration Current:

1,265.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	13,460	3.510	1.043	0.000	Yes	1,026.0	6.9	No	Yes
8/25/1998	14,963	3.654	1.021	0.000	No	1,004.9	6.9	No	Yes
9/29/1998	15,824	3.926	1.024	0.000	No	981.3	6.9	No	Yes
2/4/1999	18,757	4.700	1.103	0.000	No	889.7	6.8	No	Yes
3/11/1999	19,616	4.940	0.000	0.000	No	890.0	6.8	Yes	Yes
6/14/2000	29,572	7.440	0.000	0.000	No	552.0	6.3	No	Yes
11/4/2000	33,192	8.248	1.063	0.000	No	519.3	6.3	No	Yes
1/18/2001	35,128	8.608	1.069	0.000	No	485.8	6.2	No	Yes
8/17/2001	40,505	9.971	1.067	0.000	No	455.3	6.1	No	Yes
2/14/2002	42,230	10.795	1.064	0.000	No	403.7	6.0	No	Yes
11/15/2001	42,831	10.430	1.060	0.000	No	429.5	6.1	No	Yes
3/29/2002	43,313	11.105	1.052	0.000	No	383.7	5.9	No	Yes
9/19/2002	44,942	12.435	1.064	0.000	No	360.6	5.9	No	Yes
12/5/2002	46,909	12.824	1.057	0.000	No	341.2	5.8	No	Yes
7/30/2003	52,835	14.723	1.086	0.000	No	314.2	5.7	No	Yes
12/30/2003	56,664	15.712	1.054	0.000	No	298.1	5.7	No	Yes
5/6/2004	62,966	16.469	1.086	0.000	No	274.5	5.6	No	Yes
3/17/2005	71,012	19.254	1.065	0.000	No	257.7	5.6	No	Yes
4/21/2005	71,916	19.588	1.130	0.000	No	228.1	5.4	No	Yes
5/31/2005	72,935	19.945	0.905	0.000	No	252.0	5.5	No	Yes
8/4/2005	74,594	20.459	1.073	0.000	No	234.9	5.5	No	Yes
1/12/2006	78,683	21.179	1.026	0.000	No	216.0	5.4	No	Yes

3/24/2006	79,470	21.384	1.082	0.000	No	199.6	5.3	No	Yes
6/8/2006	81,382	21.960	1.094	0.000	No	182.5	5.2	No	Yes
10/26/2006	84,957	23.088	1.036	0.000	No	176.1	5.2	No	Yes

Level: B

LPRM ID No.: 143

Beginning of Life Calibration Current:

1,289.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	4.292	1.102	0.000	Yes	831.0	6.7	No	Yes
8/25/1998	14,963	4.376	0.995	0.000	No	835.2	6.7	No	Yes
9/29/1998	15,824	4.648	1.047	0.000	No	797.7	6.7	No	Yes
12/29/1998	17,872	5.225	1.119	0.000	No	712.9	6.6	No	Yes
3/11/1999	19,616	5.697	1.071	0.000	No	666.0	6.5	No	Yes
4/15/1999	20,444	5.924	1.067	0.000	No	624.2	6.4	No	Yes
6/24/1999	22,047	6.373	1.070	0.000	No	583.3	6.4	No	Yes
9/17/1999	23,855	6.930	1.087	0.000	No	536.7	6.3	No	Yes
11/24/1999	24,556	7.153	1.161	0.000	No	462.2	6.1	No	Yes
11/30/1999	24,692	7.187	1.059	0.000	No	436.5	6.1	No	Yes
3/8/2000	27,127	7.871	1.061	0.000	No	411.4	6.0	No	Yes
5/10/2000	28,679	8.280	1.059	0.000	No	388.5	6.0	No	Yes
7/20/2000	30,502	8.730	1.056	0.000	No	367.9	5.9	No	Yes
11/4/2000	33,192	9.379	1.058	0.000	No	347.7	5.9	No	Yes
1/18/2001	35,128	9.811	1.069	0.000	No	325.3	5.8	No	Yes
6/7/2001	38,668	10.672	1.073	0.000	No	303.1	5.7	No	Yes
2/14/2002	42,230	12.075	1.071	0.000	No	257.5	5.6	No	Yes
11/15/2001	42,831	11.646	1.099	0.000	No	275.8	5.6	No	Yes
3/29/2002	43,313	12.381	1.055	0.000	No	244.1	5.5	No	Yes
10/24/2002	45,842	13.881	1.070	0.000	No	228.1	5.4	No	Yes
4/10/2003	50,087	15.043	1.065	0.000	No	214.2	5.4	No	Yes
7/30/2003	52,835	15.873	1.054	0.000	No	203.2	5.3	No	Yes
2/19/2004	60,997	17.064	1.191	0.000	No	170.6	5.1	No	Yes
6/17/2004	64,043	18.010	1.060	0.000	No	161.0	5.1	No	Yes
1/6/2005	69,222	19.495	1.083	0.000	No	148.7	5.0	No	Yes
6/30/2005	73,703	20.710	1.052	0.000	No	141.3	5.0	No	Yes
12/1/2005	77,610	21.745	1.060	0.000	No	133.3	4.9	No	Yes
1/12/2006	78,683	22.004	1.013	0.000	No	131.6	4.9	No	Yes

Level: C

LPRM ID No.: 229

Beginning of Life Calibration Current:

1,336.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value

9/12/1996	13,460	4.156	1.026	0.000	Yes	1,119.0	7.0	No	Yes
8/25/1998	14,963	4.185	1.002	0.000	No	1,116.8	7.0	No	Yes
9/29/1998	15,824	4.388	1.045	0.000	No	1,068.7	7.0	No	Yes
2/4/1999	18,757	5.070	1.087	0.000	No	983.1	6.9	No	Yes
4/15/1999	20,444	5.481	1.084	0.000	No	907.0	6.8	No	Yes
6/24/1999	22,047	5.891	1.069	0.000	No	848.4	6.7	No	Yes
9/17/1999	23,855	6.446	1.090	0.000	No	778.4	6.7	No	Yes
11/24/1999	24,556	6.692	1.154	0.000	No	674.5	6.5	No	Yes
12/27/1999	25,359	6.884	1.071	0.000	No	629.8	6.4	No	Yes
4/12/2000	27,988	7.439	1.072	0.000	No	587.0	6.4	No	Yes
6/14/2000	29,572	7.729	1.051	0.000	No	558.5	6.3	No	Yes
9/28/2000	32,317	8.229	1.056	0.000	No	528.9	6.3	No	Yes
12/7/2000	34,042	8.557	1.078	0.000	No	490.6	6.2	No	Yes
4/26/2001	37,579	9.193	1.061	0.000	No	462.4	6.1	No	Yes
10/18/2001	42,107	10.202	1.062	0.000	No	435.4	6.1	No	Yes
3/29/2002	43,313	11.109	1.071	0.000	No	383.9	6.0	No	Yes
12/20/2001	43,726	10.669	1.059	0.000	No	411.2	6.0	No	Yes
10/24/2002	45,842	12.282	1.080	0.000	No	355.5	5.9	No	Yes
5/15/2003	50,933	13.473	1.068	0.000	No	332.8	5.8	No	Yes
7/30/2003	52,835	13.974	1.042	0.000	No	333.0	5.8	No	Yes
9/11/2003	53,930	14.293	1.074	0.000	No	310.1	5.7	No	Yes
12/30/2003	56,664	15.125	1.064	0.000	No	291.4	5.7	No	Yes
2/19/2004	60,997	15.274	1.097	0.000	No	265.6	5.6	No	Yes
6/17/2004	64,043	15.979	1.051	0.000	No	252.7	5.5	No	Yes
3/17/2005	71,012	17.612	1.060	0.000	No	238.4	5.5	No	Yes
9/15/2005	75,657	18.758	1.063	0.000	No	224.3	5.4	No	Yes
1/12/2006	78,683	19.628	1.092	0.000	No	205.4	5.3	No	Yes
3/24/2006	79,470	19.974	1.094	0.000	No	187.8	5.2	No	Yes
9/21/2006	84,063	21.115	1.058	0.000	No	177.5	5.2	No	Yes
10/26/2006	84,957	21.350	1.005	0.000	No	176.6	5.2	No	Yes

Level: D

LPRM ID No.: 315

Beginning of Life Calibration Current:

1,343.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.		Good		
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	13,460	2.922	1.005	0.000	Yes	1,291.0	7.2	No	Yes
8/25/1998	14,963	2.891	0.988	0.000	No	1,306.7	7.2	No	Yes
9/29/1998	15,824	3.018	0.991	0.000	No	1,318.5	7.2	No	Yes
4/15/1999	20,444	3.852	1.076	0.000	No	1,225.4	7.1	No	Yes

9/17/1999	23,855	4.591	1.077	0.000	No	1,137.8	7.0	No	Yes
11/24/1999	24,556	4.785	1.102	0.000	No	1,032.5	6.9	No	Yes
12/27/1999	25,359	4.912	1.081	0.000	No	955.1	6.9	No	Yes
6/14/2000	29,572	5.482	1.079	0.000	No	885.2	6.8	No	Yes
9/28/2000	32,317	5.889	1.059	0.000	No	835.9	6.7	No	Yes
12/7/2000	34,042	6.265	1.076	0.000	No	776.8	6.7	No	Yes
3/22/2001	36,674	6.734	1.057	0.000	No	734.9	6.6	No	Yes
8/17/2001	40,505	7.355	1.073	0.000	No	684.9	6.5	No	Yes
10/18/2001	42,107	7.720	1.064	0.000	No	643.7	6.5	No	Yes
3/29/2002	43,313	8.301	1.058	0.000	No	577.3	6.4	No	Yes
12/20/2001	43,726	8.075	1.054	0.000	No	610.8	6.4	No	Yes
7/30/2003	52,835	9.614	1.041	0.000	No	577.0	6.4	No	Yes
12/30/2003	56,664	10.354	1.077	0.000	No	535.7	6.3	No	Yes
2/19/2004	60,997	10.462	1.071	0.000	No	500.2	6.2	No	Yes
3/25/2004	61,886	10.561	1.089	0.000	No	459.3	6.1	No	Yes
5/6/2004	62,966	10.692	0.912	0.000	No	503.7	6.2	No	Yes
6/17/2004	64,043	10.832	1.113	0.000	No	452.5	6.1	No	Yes
7/15/2004	64,743	10.931	0.918	0.000	No	493.0	6.2	No	Yes
8/12/2004	65,463	11.040	1.103	0.000	No	446.9	6.1	No	Yes
9/23/2004	66,533	11.197	0.943	0.000	No	473.9	6.2	No	Yes
12/9/2004	68,501	11.477	1.067	0.000	No	444.2	6.1	No	Yes
4/21/2005	71,916	12.060	0.917	0.000	No	484.4	6.2	No	Yes
5/31/2005	72,935	12.224	1.113	0.000	No	435.2	6.1	No	Yes
9/15/2005	75,657	12.777	1.068	0.000	No	407.5	6.0	No	Yes
1/12/2006	78,683	13.562	1.073	0.000	No	379.8	5.9	No	Yes
3/24/2006	79,470	13.886	1.076	0.000	No	352.9	5.9	No	Yes
9/21/2006	84,063	14.709	1.052	0.000	No	335.5	5.8	No	Yes
10/26/2006	84,957	14.914	1.053	0.000	No	318.6	5.8	No	Yes

String No.: 15 Serial No.: 99S06335 Cycle Installed: 9
Coordinates: 41 Type: NA300 Cumulative Core Average Exposure at BOC: 54,800
Level: A LPRM ID No.: 345 Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
11/24/1999	13	0.004	1.099	0.000	No	1,137.4	7.0	No	Yes
11/30/1999	149	0.034	1.116	0.000	No	1,019.2	6.9	No	Yes
3/8/2000	2,584	0.643	1.053	0.000	No	967.9	6.9	No	Yes

8/24/2000	6,865	1.986	1.086	0.000	No	891.2	6.8	No	Yes
11/4/2000	8,649	2.468	1.106	0.000	No	805.8	6.7	No	Yes
1/18/2001	10,585	2.843	1.062	0.000	No	758.8	6.6	No	Yes
3/22/2001	12,131	3.254	1.067	0.000	No	711.1	6.6	No	Yes
4/26/2001	13,036	3.507	1.051	0.000	No	677.0	6.5	No	Yes
6/7/2001	14,125	3.796	1.050	0.000	No	644.8	6.5	No	Yes
7/7/2001	14,896	3.979	1.140	0.000	No	565.6	6.3	No	Yes
9/13/2001	16,661	4.359	1.053	0.000	No	537.1	6.3	No	Yes
2/14/2002	17,687	5.000	0.946	0.000	No	567.8	6.3	No	Yes
6/6/2002	17,723	5.794	1.061	0.000	No	508.0	6.2	No	Yes
12/5/2002	22,366	6.978	1.061	0.000	No	478.8	6.2	No	Yes
4/10/2003	25,544	7.967	1.053	0.000	No	454.7	6.1	No	Yes
6/19/2003	27,228	8.515	1.051	0.000	No	432.6	6.1	No	Yes
7/30/2003	28,292	8.835	1.016	0.000	No	433.0	6.1	No	Yes
10/16/2003	30,289	9.316	1.054	0.000	No	410.8	6.0	No	Yes
3/25/2004	37,343	9.978	1.053	0.000	No	390.1	6.0	No	Yes
8/12/2004	40,920	11.076	1.069	0.000	No	365.0	5.9	No	Yes
12/9/2004	43,958	12.121	1.069	0.000	No	341.4	5.8	No	Yes
3/17/2005	46,469	13.046	1.054	0.000	No	323.9	5.8	No	Yes
9/15/2005	51,114	14.693	1.071	0.000	No	302.0	5.7	No	Yes
10/20/2005	52,015	14.912	1.079	0.000	No	280.0	5.6	No	Yes
12/1/2005	53,067	15.070	0.875	0.000	No	320.0	5.8	No	Yes
1/12/2006	54,140	15.244	1.041	0.000	No	300.0	5.7	No	Yes
3/24/2006	54,927	15.431	1.128	0.000	No	266.0	5.6	No	Yes
9/21/2006	59,520	16.733	1.115	0.000	No	238.5	5.5	No	Yes
10/26/2006	60,414	16.966	0.979	0.000	No	243.6	5.5	No	Yes

Level: B

LPRM ID No.: 351

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
11/24/1999	13	0.005	1.112	0.000	No	1,124.1	7.0	Yes
12/27/1999	816	0.236	1.073	0.000	No	1,047.6	7.0	Yes
8/24/2000	6,865	2.089	1.087	0.000	No	963.8	6.9	Yes
11/4/2000	8,649	2.615	1.065	0.000	No	905.0	6.8	Yes
1/18/2001	10,585	3.092	1.107	0.000	No	817.5	6.7	Yes
4/26/2001	13,036	3.736	1.078	0.000	No	758.3	6.6	Yes
6/7/2001	14,125	4.027	1.056	0.000	No	718.1	6.6	Yes
7/7/2001	14,896	4.230	1.116	0.000	No	643.5	6.5	Yes

9/13/2001	16,661	4.670	1.063	0.000	No	605.3	6.4	No	Yes
6/6/2002	17,723	6.257	1.048	0.000	No	543.0	6.3	No	Yes
11/15/2001	18,288	5.063	1.057	0.000	No	572.7	6.4	No	Yes
8/15/2002	19,529	6.749	1.084	0.000	No	500.9	6.2	No	Yes
12/5/2002	22,366	7.520	1.056	0.000	No	474.4	6.2	No	Yes
4/10/2003	25,544	8.440	1.054	0.000	No	450.1	6.1	No	Yes
6/19/2003	27,228	8.906	1.058	0.000	No	425.4	6.1	No	Yes
7/30/2003	28,292	9.202	1.006	0.000	No	425.0	6.1	No	Yes
11/20/2003	31,194	9.934	1.066	0.000	No	398.7	6.0	No	Yes
2/19/2004	36,454	10.262	1.108	0.000	No	359.8	5.9	No	Yes
9/23/2004	41,990	11.835	1.084	0.000	No	331.9	5.8	No	Yes
4/21/2005	47,373	13.339	1.081	0.000	No	307.1	5.7	No	Yes
9/15/2005	51,114	14.408	1.061	0.000	No	289.4	5.7	No	Yes
1/12/2006	54,140	15.222	1.059	0.000	No	273.3	5.6	No	Yes
3/24/2006	54,927	15.514	1.096	0.000	No	249.4	5.5	No	Yes
9/21/2006	59,520	16.876	1.064	0.000	No	234.4	5.5	No	Yes
10/26/2006	60,414	17.134	1.003	0.000	No	233.7	5.5	No	Yes

Level: C

LPRM ID No.: 357

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
7/7/2001	14,896	3.366	1.103	0.000	No	1,133.3	7.0	No	Yes
10/18/2001	17,564	4.033	1.052	0.000	No	1,077.3	7.0	No	Yes
9/19/2002	20,399	5.687	1.058	0.000	No	1,018.2	6.9	No	Yes
1/16/2003	23,420	6.498	1.072	0.000	No	949.8	6.9	No	Yes
6/19/2003	27,228	7.301	1.064	0.000	No	892.7	6.8	No	Yes
7/30/2003	28,292	7.555	1.034	0.000	No	893.0	6.8	No	Yes
9/11/2003	29,387	7.832	1.071	0.000	No	833.8	6.7	No	Yes
12/30/2003	32,121	8.564	1.070	0.000	No	779.3	6.7	No	Yes
2/19/2004	36,454	8.697	1.099	0.000	No	709.1	6.6	No	Yes
8/12/2004	40,920	9.692	1.077	0.000	No	658.4	6.5	No	Yes
1/6/2005	44,679	10.564	1.060	0.000	No	621.1	6.4	No	Yes
5/31/2005	48,392	11.443	1.071	0.000	No	579.9	6.4	No	Yes
9/15/2005	51,114	12.188	1.074	0.000	No	540.0	6.3	No	Yes
1/12/2006	54,140	13.091	1.090	0.000	No	495.4	6.2	No	Yes
3/24/2006	54,927	13.418	1.137	0.000	No	435.7	6.1	No	Yes
7/13/2006	57,733	14.117	1.051	0.000	No	414.5	6.0	No	Yes
9/21/2006	59,520	14.581	1.071	0.000	No	387.1	6.0	No	Yes

10/26/2006	60,414	14.790	1.007	0.000	No	384.4	6.0	No	Yes
Level: D		LPRM ID No.: 363		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/24/1999	13	0.002	1.119	0.000	No	1,117.1	7.0	No	Yes
12/27/1999	816	0.128	1.077	0.000	No	1,037.2	6.9	No	Yes
1/18/2001	10,585	1.887	1.100	0.000	No	942.9	6.8	No	Yes
4/26/2001	13,036	2.381	1.071	0.000	No	880.4	6.8	No	Yes
7/7/2001	14,896	2.707	1.087	0.000	No	809.9	6.7	No	Yes
9/13/2001	16,661	3.116	1.078	0.000	No	751.3	6.6	No	Yes
11/15/2001	18,288	3.481	1.079	0.000	No	696.3	6.5	No	Yes
12/5/2002	22,366	4.507	1.070	0.000	No	650.8	6.5	No	Yes
7/30/2003	28,292	5.155	1.050	0.000	No	651.0	6.5	No	Yes
9/11/2003	29,387	5.307	1.070	0.000	No	608.4	6.4	No	Yes
2/19/2004	36,454	5.870	1.077	0.000	No	564.9	6.3	No	Yes
5/6/2004	38,423	6.107	1.077	0.000	No	524.5	6.3	No	Yes
6/17/2004	39,500	6.259	0.946	0.000	No	554.5	6.3	No	Yes
9/23/2004	41,990	6.662	1.078	0.000	No	514.3	6.2	No	Yes
12/9/2004	43,958	6.957	0.934	0.000	No	550.7	6.3	No	Yes
2/3/2005	45,396	7.190	1.054	0.000	No	522.5	6.3	No	Yes
4/21/2005	47,373	7.519	1.077	0.000	No	485.1	6.2	No	Yes
9/15/2005	51,114	8.304	1.061	0.000	No	457.2	6.1	No	Yes
10/20/2005	52,015	8.520	0.936	0.000	No	488.0	6.2	No	Yes
1/12/2006	54,140	9.067	1.101	0.000	No	443.2	6.1	No	Yes
3/24/2006	54,927	9.382	1.065	0.000	No	416.2	6.0	No	Yes
7/13/2006	57,733	9.851	1.064	0.000	No	391.1	6.0	No	Yes
10/26/2006	60,414	10.422	1.016	0.000	No	385.0	6.0	No	Yes

String No.: 16		Serial No.: 99S06332		Cycle Installed:				9	
Coordinates: 41		Type: NA300		Cumulative Core Average Exposure at BOC:				54,800	
Level: A		LPRM ID No.: 346		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/24/1999	13	0.003	1.111	0.000	No	1,125.1	7.0	No	Yes
11/30/1999	149	0.035	1.064	0.000	No	1,057.4	7.0	No	Yes
12/27/1999	816	0.222	1.058	0.000	No	999.5	6.9	No	Yes
4/12/2000	3,445	0.946	1.052	0.000	No	950.1	6.9	No	Yes

8/24/2000	6,865	1.772	1.077	0.000	No	882.1	6.8	No	Yes
11/4/2000	8,649	2.174	1.081	0.000	No	816.0	6.7	No	Yes
1/18/2001	10,585	2.579	1.074	0.000	No	759.8	6.6	No	Yes
4/26/2001	13,036	3.244	1.109	0.000	No	685.1	6.5	No	Yes
7/7/2001	14,896	3.723	1.087	0.000	No	630.3	6.4	No	Yes
10/18/2001	17,564	4.374	1.082	0.000	No	582.5	6.4	No	Yes
2/14/2002	17,687	4.944	1.102	0.000	No	528.6	6.3	No	Yes
8/15/2002	19,529	6.250	1.063	0.000	No	497.3	6.2	No	Yes
12/5/2002	22,366	7.120	1.063	0.000	No	467.8	6.1	No	Yes
2/26/2003	24,474	7.793	1.075	0.000	No	435.2	6.1	No	Yes
5/15/2003	26,390	8.454	1.066	0.000	No	408.2	6.0	No	Yes
7/30/2003	28,292	9.133	1.041	0.000	No	408.0	6.0	No	Yes
9/11/2003	29,387	9.461	1.056	0.000	No	386.4	6.0	No	Yes
2/19/2004	36,454	10.209	1.059	0.000	No	364.8	5.9	No	Yes
5/6/2004	38,423	10.881	1.083	0.000	No	336.9	5.8	No	Yes
6/17/2004	39,500	11.252	1.052	0.000	No	320.2	5.8	No	Yes
12/9/2004	43,958	12.591	1.056	0.000	No	303.2	5.7	No	Yes
1/6/2005	44,679	12.832	0.937	0.000	No	323.6	5.8	No	Yes
2/3/2005	45,396	13.081	1.097	0.000	No	295.0	5.7	No	Yes
3/17/2005	46,469	13.430	0.947	0.000	No	311.5	5.7	No	Yes
5/31/2005	48,392	14.083	1.089	0.000	No	286.1	5.7	No	Yes
8/4/2005	50,051	14.610	0.931	0.000	No	307.3	5.7	No	Yes
9/15/2005	51,114	14.888	1.072	0.000	No	286.6	5.7	No	Yes
3/24/2006	54,927	15.808	1.150	0.000	No	249.2	5.5	No	Yes
7/13/2006	57,733	16.656	1.075	0.000	No	231.9	5.4	No	Yes
10/26/2006	60,414	17.495	1.070	0.000	No	216.7	5.4	No	Yes

Level: B

LPRM ID No.: 352

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.044	1.050	0.000	No	1,190.5	7.1	No	Yes
1/18/2001	10,585	2.833	1.049	0.000	No	1,134.9	7.0	No	Yes
7/7/2001	14,896	3.926	1.078	0.000	No	1,052.8	7.0	No	Yes
10/18/2001	17,564	4.597	1.076	0.000	No	978.4	6.9	No	Yes
2/14/2002	17,687	5.256	1.078	0.000	No	907.6	6.8	No	Yes
8/15/2002	19,529	6.541	1.052	0.000	No	862.7	6.8	No	Yes
12/5/2002	22,366	7.425	1.087	0.000	No	793.7	6.7	No	Yes
2/26/2003	24,474	8.053	1.069	0.000	No	742.5	6.6	No	Yes

6/19/2003	27,228	8.844	1.056	0.000	No	703.1	6.6	No	Yes
7/30/2003	28,292	9.167	1.035	0.000	No	703.0	6.6	No	Yes
9/11/2003	29,387	9.487	1.056	0.000	No	665.7	6.5	No	Yes
11/20/2003	31,194	10.001	1.052	0.000	No	632.8	6.5	No	Yes
2/19/2004	36,454	10.386	1.175	0.000	No	538.6	6.3	No	Yes
6/17/2004	39,500	11.299	1.053	0.000	No	511.5	6.2	No	Yes
12/9/2004	43,958	12.460	1.054	0.000	No	485.3	6.2	No	Yes
3/17/2005	46,469	13.096	1.079	0.000	No	449.7	6.1	No	Yes
9/15/2005	51,114	14.254	1.065	0.000	No	422.3	6.0	No	Yes
1/12/2006	54,140	15.083	1.058	0.000	No	399.1	6.0	No	Yes
3/24/2006	54,927	15.394	1.099	0.000	No	363.2	5.9	No	Yes
8/17/2006	58,629	16.463	1.066	0.000	No	340.7	5.8	No	Yes
10/26/2006	60,414	16.992	1.038	0.000	No	328.2	5.8	No	Yes

Level: C

LPRM ID No.: 358

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/12/2000	3,445	0.757	0.943	0.000	No	1,325.6	7.2	No	Yes
7/7/2001	14,896	3.360	1.067	0.000	No	1,242.3	7.1	No	Yes
10/18/2001	17,564	4.003	1.069	0.000	No	1,162.1	7.1	No	Yes
3/29/2002	18,770	4.875	1.060	0.000	No	1,084.0	7.0	No	Yes
9/19/2002	20,399	5.674	1.052	0.000	No	1,030.4	6.9	No	Yes
12/5/2002	22,366	6.136	1.053	0.000	No	978.6	6.9	No	Yes
5/15/2003	26,390	6.998	1.051	0.000	No	931.1	6.8	No	Yes
7/30/2003	28,292	7.471	1.051	0.000	No	885.9	6.8	No	Yes
10/16/2003	30,289	8.030	1.063	0.000	No	833.4	6.7	No	Yes
2/19/2004	36,454	8.746	1.164	0.000	No	716.0	6.6	No	Yes
6/17/2004	39,500	9.444	1.057	0.000	No	677.4	6.5	No	Yes
12/9/2004	43,958	10.404	1.056	0.000	No	641.4	6.5	No	Yes
3/17/2005	46,469	10.970	1.057	0.000	No	606.8	6.4	No	Yes
6/30/2005	49,160	11.543	1.058	0.000	No	573.6	6.4	No	Yes
9/15/2005	51,114	12.025	1.052	0.000	No	545.2	6.3	No	Yes
1/12/2006	54,140	12.918	1.067	0.000	No	511.0	6.2	No	Yes
3/24/2006	54,927	13.251	1.121	0.000	No	455.8	6.1	No	Yes
6/8/2006	56,839	13.655	1.082	0.000	No	421.3	6.0	No	Yes
10/26/2006	60,414	14.488	1.049	0.000	No	401.6	6.0	No	Yes

Level: D

LPRM ID No.: 364

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good
-------	---------	----------	------------	------

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.021	1.117	0.000	No	1,119.1	7.0	No	Yes
4/12/2000	3,445	0.476	0.937	0.000	No	1,194.3	7.1	No	Yes
3/29/2002	18,770	3.681	1.050	0.000	No	1,137.4	7.0	No	Yes
7/30/2003	28,292	4.809	1.018	0.000	No	1,137.0	7.0	No	Yes
11/20/2003	31,194	5.273	1.111	0.000	No	1,023.4	6.9	No	Yes
2/19/2004	36,454	5.553	1.094	0.000	No	935.5	6.8	No	Yes
3/25/2004	37,343	5.643	1.074	0.000	No	871.0	6.8	No	Yes
6/17/2004	39,500	5.891	0.926	0.000	No	940.6	6.8	No	Yes
12/9/2004	43,958	6.516	1.102	0.000	No	853.6	6.7	No	Yes
1/6/2005	44,679	6.637	1.122	0.000	No	760.7	6.6	No	Yes
2/3/2005	45,396	6.760	0.933	0.000	No	815.4	6.7	No	Yes
3/17/2005	46,469	6.949	1.089	0.000	No	748.7	6.6	No	Yes
8/4/2005	50,051	7.580	1.096	0.000	No	683.2	6.5	No	Yes
10/20/2005	52,015	8.026	1.093	0.000	No	625.0	6.4	No	Yes
1/12/2006	54,140	8.554	1.084	0.000	No	576.6	6.4	No	Yes
6/8/2006	56,839	9.111	1.100	0.000	No	524.2	6.3	No	Yes
10/26/2006	60,414	9.685	1.007	0.000	No	520.5	6.3	No	Yes

String No.: 17 Serial No.: L-2703 Cycle Installed: 7
Coordinates: 41 Type: NA300 Cumulative Core Average Exposure at BOC: 79,343
Level: A LPRM ID No.: 60 Beginning of Life Calibration Current: 1,188.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	1.878	1.033	0.000	Yes	1,028.0	6.9	No	Yes
8/25/1998	14,963	1.971	0.990	0.000	No	1,038.4	6.9	No	Yes
9/29/1998	15,824	2.104	1.019	0.000	No	1,019.0	6.9	No	Yes
4/15/1999	20,444	2.754	1.047	0.000	No	973.3	6.9	No	Yes
8/4/1999	22,908	3.106	1.045	0.000	No	931.4	6.8	No	Yes
11/24/1999	24,556	3.274	1.124	0.000	No	828.6	6.7	No	Yes
12/27/1999	25,359	3.413	1.039	0.000	No	797.5	6.7	No	Yes
2/2/2000	26,267	3.571	1.061	0.000	No	779.0	6.7	No	Yes
5/10/2000	28,679	4.024	1.052	0.000	No	740.5	6.6	No	Yes
7/20/2000	30,502	4.410	1.057	0.000	No	700.6	6.6	No	Yes
11/4/2000	33,192	4.955	1.055	0.000	No	664.0	6.5	No	Yes
1/18/2001	35,128	5.428	1.070	0.000	No	620.6	6.4	No	Yes
6/7/2001	38,668	6.126	1.054	0.000	No	588.8	6.4	No	Yes

8/17/2001	40,505	6.533	1.061	0.000	No	555.0	6.3	No	Yes
3/29/2002	43,313	7.520	1.118	0.000	No	496.4	6.2	No	Yes
10/24/2002	45,842	8.610	1.051	0.000	No	472.3	6.2	No	Yes
4/10/2003	50,087	9.634	1.063	0.000	No	444.3	6.1	No	Yes
7/30/2003	52,835	10.407	1.025	0.000	No	444.0	6.1	No	Yes
9/11/2003	53,930	10.668	1.066	0.000	No	416.5	6.0	No	Yes
2/19/2004	60,997	11.272	1.090	0.000	No	382.1	5.9	No	Yes
7/15/2004	64,743	11.892	1.082	0.000	No	353.2	5.9	No	Yes
12/9/2004	68,501	12.689	0.902	0.000	No	391.5	6.0	No	Yes
1/6/2005	69,222	12.773	1.060	0.000	No	369.4	5.9	No	Yes
2/3/2005	69,939	12.859	0.947	0.000	No	390.0	6.0	No	Yes
3/17/2005	71,012	13.054	1.075	0.000	No	362.8	5.9	No	Yes
4/21/2005	71,916	13.222	1.077	0.000	No	336.9	5.8	No	Yes
1/12/2006	78,683	14.342	0.944	0.000	No	356.9	5.9	No	Yes
3/24/2006	79,470	14.474	1.139	0.000	No	313.3	5.7	No	Yes
10/26/2006	84,957	15.539	1.054	0.000	No	297.3	5.7	No	Yes

Level: B

LPRM ID No.: 146

Beginning of Life Calibration Current:

1,172.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Value
9/12/1996	13,460	2.585	1.052	0.000	Yes	915.0	6.8	Yes
8/25/1998	14,963	2.689	0.981	0.000	No	932.7	6.8	Yes
9/29/1998	15,824	2.875	1.040	0.000	No	896.8	6.8	Yes
2/4/1999	18,757	3.486	1.071	0.000	No	837.4	6.7	Yes
4/15/1999	20,444	3.812	1.048	0.000	No	799.0	6.7	Yes
8/4/1999	22,908	4.240	1.050	0.000	No	761.0	6.6	Yes
11/24/1999	24,556	4.483	1.150	0.000	No	661.7	6.5	Yes
2/2/2000	26,267	4.838	1.051	0.000	No	629.6	6.4	Yes
5/10/2000	28,679	5.350	1.052	0.000	No	598.5	6.4	Yes
8/24/2000	31,408	5.931	1.056	0.000	No	566.8	6.3	Yes
1/18/2001	35,128	6.731	1.066	0.000	No	531.7	6.3	Yes
3/22/2001	36,674	7.023	1.022	0.000	No	520.2	6.3	Yes
8/17/2001	40,505	7.773	1.077	0.000	No	483.0	6.2	Yes
2/14/2002	42,230	8.616	1.075	0.000	No	449.3	6.1	Yes
10/24/2002	45,842	10.029	1.075	0.000	No	418.0	6.0	Yes
6/19/2003	51,771	11.459	1.061	0.000	No	394.0	6.0	Yes
7/30/2003	52,835	11.715	1.033	0.000	No	394.0	6.0	Yes
10/16/2003	54,832	12.185	1.059	0.000	No	372.0	5.9	Yes

2/19/2004	60,997	12.699	1.174	0.000	No	316.9	5.8	No	Yes
7/15/2004	64,743	13.411	1.053	0.000	No	301.0	5.7	No	Yes
3/17/2005	71,012	14.602	1.070	0.000	No	281.3	5.6	No	Yes
9/15/2005	75,657	15.452	1.069	0.000	No	263.1	5.6	No	Yes
3/24/2006	79,470	16.199	1.096	0.000	No	240.1	5.5	No	Yes
9/21/2006	84,063	17.172	1.058	0.000	No	226.9	5.4	No	Yes
10/26/2006	84,957	17.351	0.991	0.000	No	229.0	5.4	No	Yes

Level: C

LPRM ID No.: 232

Beginning of Life Calibration Current:

1,102.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	2.720	1.067	0.000	Yes	894.0	6.8	No	Yes
12/29/1998	17,872	3.311	1.012	0.000	No	879.0	6.8	No	Yes
3/11/1999	19,616	3.625	1.074	0.000	No	821.0	6.7	No	Yes
8/4/1999	22,908	4.238	1.089	0.000	No	753.9	6.6	No	Yes
11/24/1999	24,556	4.563	1.153	0.000	No	653.9	6.5	No	Yes
3/8/2000	27,127	4.970	1.076	0.000	No	607.7	6.4	No	Yes
11/4/2000	33,192	5.934	1.058	0.000	No	574.4	6.4	No	Yes
3/22/2001	36,674	6.578	1.072	0.000	No	535.8	6.3	No	Yes
8/17/2001	40,505	7.394	1.076	0.000	No	497.9	6.2	No	Yes
2/14/2002	42,230	8.210	1.062	0.000	No	468.9	6.2	No	Yes
6/19/2003	51,771	9.943	1.051	0.000	No	446.1	6.1	No	Yes
7/30/2003	52,835	10.130	1.030	0.000	No	446.0	6.1	No	Yes
11/20/2003	55,737	10.712	1.066	0.000	No	418.4	6.0	No	Yes
2/19/2004	60,997	11.041	1.197	0.000	No	349.5	5.9	No	Yes
3/17/2005	71,012	12.794	1.052	0.000	No	332.3	5.8	No	Yes
6/30/2005	73,703	13.238	1.051	0.000	No	316.1	5.8	No	Yes
1/12/2006	78,683	14.204	1.069	0.000	No	295.7	5.7	No	Yes
3/24/2006	79,470	14.424	1.052	0.000	No	281.1	5.6	No	Yes
9/21/2006	84,063	15.212	1.051	0.000	No	267.5	5.6	No	Yes
10/26/2006	84,957	15.357	0.981	0.000	No	272.6	5.6	No	Yes

Level: D

LPRM ID No.: 318

Beginning of Life Calibration Current:

1,268.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	13,460	2.145	1.034	0.000	Yes	1,039.0	6.9	No	Yes
8/25/1998	14,963	2.171	0.962	0.000	No	1,080.0	7.0	No	Yes
9/29/1998	15,824	2.264	1.015	0.000	No	1,064.1	7.0	No	Yes
3/11/1999	19,616	2.722	1.049	0.000	No	1,013.0	6.9	No	Yes

6/24/1999	22,047	3.041	1.049	0.000	No	965.7	6.9	No	Yes
11/24/1999	24,556	3.449	1.131	0.000	No	853.8	6.7	No	Yes
12/27/1999	25,359	3.515	1.050	0.000	No	813.2	6.7	No	Yes
7/20/2000	30,502	3.962	1.061	0.000	No	766.4	6.6	No	Yes
3/22/2001	36,674	4.626	1.072	0.000	No	714.9	6.6	No	Yes
2/14/2002	42,230	5.707	1.126	0.000	No	634.9	6.5	No	Yes
2/26/2003	49,017	6.201	0.928	0.000	No	684.2	6.5	No	Yes
7/30/2003	52,835	6.465	1.049	0.000	No	684.0	6.5	No	Yes
2/19/2004	60,997	6.931	1.073	0.000	No	637.5	6.5	No	Yes
8/12/2004	65,463	7.459	1.053	0.000	No	605.4	6.4	No	Yes
12/9/2004	68,501	7.858	1.108	0.000	No	546.4	6.3	No	Yes
12/1/2005	77,610	9.437	1.087	0.000	No	502.6	6.2	No	Yes
6/8/2006	81,382	10.100	1.070	0.000	No	469.8	6.2	No	Yes
10/26/2006	84,957	10.562	0.978	0.000	No	480.3	6.2	No	Yes

String No.: 18		Serial No.: 03s61361		Cycle Installed:		11			
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:		18,500			
Level: A		LPRM ID No.: 501		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.306	1.118	0.000	No	1,118.1	7.0	No	Yes
8/12/2004	4,620	1.249	0.919	0.000	No	1,216.6	7.1	No	Yes
3/17/2005	10,169	3.003	1.063	0.000	No	1,144.5	7.0	No	Yes
10/20/2005	15,715	4.745	1.125	0.000	No	1,017.0	6.9	No	Yes
12/1/2005	16,767	5.009	0.936	0.000	No	1,086.5	7.0	No	Yes
3/24/2006	18,627	5.453	1.166	0.000	No	931.9	6.8	No	Yes
10/26/2006	24,114	6.945	0.999	0.000	No	932.8	6.8	No	Yes
Level: B		LPRM ID No.: 511		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/23/2004	5,690	1.459	0.929	0.000	No	1,345.5	7.2	No	Yes
3/17/2005	10,169	2.643	0.944	0.000	No	1,425.4	7.3	No	Yes
1/12/2006	17,840	4.653	1.078	0.000	No	1,322.2	7.2	No	Yes
3/24/2006	18,627	4.951	1.161	0.000	No	1,138.9	7.0	No	Yes
10/26/2006	24,114	6.365	0.998	0.000	No	1,141.1	7.0	No	Yes

Level: C		LPRM ID No.: 521		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/17/2004	3,200	0.660	0.924	0.000	No	1,352.8	7.2	No	Yes
1/6/2005	8,379	1.742	0.933	0.000	No	1,450.0	7.3	No	Yes
3/24/2006	18,627	4.444	1.133	0.000	No	1,279.8	7.2	No	Yes
10/26/2006	24,114	5.631	1.021	0.000	No	1,253.4	7.1	No	Yes

Level: D		LPRM ID No.: 531		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.099	0.854	0.000	No	1,463.7	7.3	No	Yes
5/6/2004	2,123	0.204	1.056	0.000	No	1,386.1	7.2	No	Yes
9/23/2004	5,690	0.667	0.948	0.000	No	1,462.1	7.3	No	Yes
3/17/2005	10,169	1.368	0.943	0.000	No	1,550.5	7.3	No	Yes
10/20/2005	15,715	2.347	0.940	0.000	No	1,649.0	7.4	No	Yes
12/1/2005	16,767	2.598	1.075	0.000	No	1,534.0	7.3	No	Yes
1/12/2006	17,840	2.866	0.947	0.000	No	1,619.8	7.4	No	Yes
3/24/2006	18,627	3.143	1.155	0.000	No	1,402.4	7.2	No	Yes
5/4/2006	19,675	3.286	0.935	0.000	No	1,499.9	7.3	No	Yes
6/8/2006	20,539	3.433	1.065	0.000	No	1,408.4	7.3	No	Yes
10/26/2006	24,114	4.169	0.996	0.000	No	1,414.0	7.3	No	Yes

String No.: 19		Serial No.: 95S01707		Cycle Installed:				8	
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:				67,204	
Level: A		LPRM ID No.: 62		Beginning of Life Calibration Current:				1,148.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.623	1.023	0.000	Yes	1,120.0	7.0	No	Yes
8/25/1998	2,824	0.710	0.971	0.000	No	1,153.5	7.1	No	Yes
9/29/1998	3,685	0.942	0.993	0.000	No	1,161.6	7.1	No	Yes
3/11/1999	7,477	2.020	1.067	0.000	No	1,086.0	7.0	No	Yes
6/24/1999	9,908	2.715	1.085	0.000	No	1,000.9	6.9	No	Yes
9/17/1999	11,716	3.209	1.060	0.000	No	944.3	6.9	No	Yes
11/24/1999	12,417	3.352	1.097	0.000	No	860.8	6.8	No	Yes
2/2/2000	14,128	3.640	1.064	0.000	No	809.0	6.7	No	Yes

5/10/2000	16,540	4.195	1.076	0.000	No	751.9	6.6	No	Yes
7/20/2000	18,363	4.683	1.076	0.000	No	698.7	6.5	No	Yes
9/28/2000	20,178	5.089	1.068	0.000	No	654.3	6.5	No	Yes
12/7/2000	21,903	5.404	1.059	0.000	No	617.8	6.4	No	Yes
2/22/2001	23,810	5.814	1.022	0.000	No	574.0	6.4	No	Yes
4/26/2001	25,440	6.251	1.052	0.000	No	557.0	6.3	No	Yes
8/17/2001	28,366	6.954	1.063	0.000	No	524.0	6.3	No	Yes
2/14/2002	30,091	7.868	1.067	0.000	No	460.2	6.1	No	Yes
3/29/2002	31,174	8.234	1.051	0.000	No	437.9	6.1	No	Yes
12/20/2001	31,587	7.705	1.067	0.000	No	491.1	6.2	No	Yes
9/19/2002	32,803	9.468	1.067	0.000	No	410.4	6.0	No	Yes
2/26/2003	36,878	10.494	1.085	0.000	No	378.3	5.9	No	Yes
6/19/2003	39,632	11.558	1.070	0.000	No	353.5	5.9	No	Yes
7/30/2003	40,696	11.819	1.022	0.000	No	354.0	5.9	No	Yes
11/20/2003	43,598	12.602	1.071	0.000	No	330.5	5.8	No	Yes
3/25/2004	49,747	13.158	1.109	0.000	No	298.0	5.7	No	Yes
9/23/2004	54,394	14.675	1.097	0.000	No	271.7	5.6	No	Yes
10/28/2004	55,295	14.996	0.947	0.000	No	286.9	5.7	No	Yes
1/6/2005	57,083	15.606	1.092	0.000	No	262.7	5.6	No	Yes
2/3/2005	57,800	15.846	0.932	0.000	No	281.9	5.6	No	Yes
3/17/2005	58,873	16.219	1.118	0.000	No	252.1	5.5	No	Yes
4/21/2005	59,777	16.545	0.920	0.000	No	274.1	5.6	No	Yes
5/31/2005	60,796	16.920	1.150	0.000	No	238.3	5.5	No	Yes
6/30/2005	61,564	17.221	0.924	0.000	No	257.9	5.6	No	Yes
1/12/2006	66,544	18.336	1.038	0.000	No	245.0	5.5	No	Yes
3/24/2006	67,331	18.559	1.144	0.000	No	214.2	5.4	No	Yes
6/8/2006	69,243	19.207	1.056	0.000	No	202.8	5.3	No	Yes
10/26/2006	72,818	20.270	1.057	0.000	No	191.9	5.3	No	Yes

Level: B

LPRM ID No.: 148

Beginning of Life Calibration Current:

1,160.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
9/12/1996	1,276	0.708	0.986	0.000	Yes	1,159.0	7.1	No	Yes
8/25/1998	2,824	0.733	1.000	0.000	No	1,159.0	7.1	No	Yes
9/29/1998	3,685	0.974	1.006	0.000	No	1,152.1	7.0	No	Yes
2/4/1999	6,618	1.852	1.046	0.000	No	1,115.0	7.0	No	Yes
3/11/1999	7,477	2.085	1.094	0.000	No	1,070.0	7.0	No	Yes
4/15/1999	8,305	2.308	1.098	0.000	No	974.5	6.9	No	Yes

8/4/1999	10,769	3.028	1.072	0.000	No	909.0	6.8	No	Yes
9/17/1999	11,716	3.320	1.133	0.000	No	802.3	6.7	No	Yes
11/24/1999	12,417	3.535	1.076	0.000	No	745.7	6.6	No	Yes
12/27/1999	13,220	3.722	1.058	0.000	No	704.8	6.6	No	Yes
3/22/2001	24,535	6.438	1.331	0.000	No	531.0	6.3	No	Yes
8/17/2001	28,366	7.334	1.056	0.000	No	502.8	6.2	No	Yes
10/18/2001	29,968	7.714	1.053	0.000	No	477.5	6.2	No	Yes
2/14/2002	30,091	8.337	1.107	0.000	No	431.4	6.1	No	Yes
6/6/2002	30,127	9.164	0.999	0.000	No	403.0	6.0	No	Yes
9/19/2002	32,803	9.901	1.074	0.000	No	375.2	5.9	No	Yes
4/10/2003	37,948	11.401	1.080	0.000	No	347.4	5.9	No	Yes
7/30/2003	40,696	12.158	1.055	0.000	No	329.3	5.8	No	Yes
10/16/2003	42,693	12.701	1.052	0.000	No	313.0	5.7	No	Yes
2/19/2004	48,858	13.329	1.191	0.000	No	262.8	5.6	No	Yes
3/25/2004	49,747	13.591	1.056	0.000	No	248.9	5.5	No	Yes
10/28/2004	55,295	15.227	1.052	0.000	No	236.6	5.5	No	Yes
4/21/2005	59,777	16.437	1.059	0.000	No	223.4	5.4	No	Yes
10/20/2005	64,419	17.755	1.060	0.000	No	211.0	5.4	No	Yes
1/12/2006	66,544	18.285	1.036	0.000	No	198.0	5.3	No	Yes
3/24/2006	67,331	18.603	1.122	0.000	No	176.5	5.2	No	Yes
10/26/2006	72,818	20.300	1.065	0.000	No	165.7	5.1	No	Yes

Level: C		LPRM ID No.: 234		Beginning of Life Calibration Current:				1,156.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.592	0.992	0.000	Yes	1,159.0	7.1	No	Yes
8/25/1998	2,824	0.589	0.964	0.000	No	1,202.3	7.1	No	Yes
9/29/1998	3,685	0.768	1.008	0.000	No	1,192.7	7.1	No	Yes
2/4/1999	6,618	1.547	0.946	0.000	No	1,260.8	7.1	No	Yes
6/24/1999	9,908	2.508	1.109	0.000	No	1,136.9	7.0	No	Yes
9/17/1999	11,716	3.066	1.096	0.000	No	1,037.3	6.9	No	Yes
11/24/1999	12,417	3.307	1.126	0.000	No	921.2	6.8	No	Yes
12/27/1999	13,220	3.472	1.068	0.000	No	862.6	6.8	No	Yes
3/8/2000	14,988	3.805	1.061	0.000	No	813.0	6.7	No	Yes
5/10/2000	16,540	4.099	1.062	0.000	No	765.5	6.6	No	Yes
7/20/2000	18,363	4.466	1.071	0.000	No	714.8	6.6	No	Yes
11/4/2000	21,053	4.962	1.056	0.000	No	676.9	6.5	No	Yes
3/22/2001	24,535	5.603	1.060	0.000	No	638.6	6.5	No	Yes

10/18/2001	29,968	6.769	1.089	0.000	No	586.4	6.4	No	Yes
2/14/2002	30,091	7.419	1.123	0.000	No	522.2	6.3	No	Yes
6/6/2002	30,127	8.013	0.989	0.000	No	493.0	6.2	No	Yes
12/5/2002	34,770	9.153	1.084	0.000	No	454.8	6.1	No	Yes
5/15/2003	38,794	10.139	1.053	0.000	No	431.9	6.1	No	Yes
7/30/2003	40,696	10.573	1.022	0.000	No	432.0	6.1	No	Yes
9/11/2003	41,791	10.862	1.079	0.000	No	400.4	6.0	No	Yes
11/20/2003	43,598	11.412	1.059	0.000	No	378.1	5.9	No	Yes
2/19/2004	48,858	11.854	1.154	0.000	No	327.6	5.8	No	Yes
1/6/2005	57,083	13.771	1.075	0.000	No	304.8	5.7	No	Yes
9/15/2005	63,518	15.394	1.066	0.000	No	285.9	5.7	No	Yes
12/1/2005	65,471	15.958	1.070	0.000	No	267.2	5.6	No	Yes
3/24/2006	67,331	16.621	1.179	0.000	No	226.6	5.4	No	Yes
7/13/2006	70,137	17.318	1.069	0.000	No	212.0	5.4	No	Yes
10/26/2006	72,818	17.994	1.047	0.000	No	202.5	5.3	No	Yes

Level: D

LPRM ID No.: 320

Beginning of Life Calibration Current:

1,102.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
9/12/1996	1,276	0.407	1.032	0.000	Yes	1,075.0	7.0	No	Yes
8/25/1998	2,824	0.372	0.981	0.000	No	1,095.8	7.0	No	Yes
9/29/1998	3,685	0.489	1.023	0.000	No	1,071.2	7.0	No	Yes
3/11/1999	7,477	1.165	1.055	0.000	No	1,020.0	6.9	No	Yes
6/24/1999	9,908	1.645	1.075	0.000	No	948.8	6.9	No	Yes
9/17/1999	11,716	2.048	1.074	0.000	No	883.5	6.8	No	Yes
11/24/1999	12,417	2.240	1.116	0.000	No	791.6	6.7	No	Yes
2/2/2000	14,128	2.508	1.060	0.000	No	746.8	6.6	No	Yes
6/14/2000	17,433	2.980	1.064	0.000	No	701.9	6.6	No	Yes
12/7/2000	21,903	3.768	1.057	0.000	No	664.0	6.5	No	Yes
4/26/2001	25,440	4.342	1.051	0.000	No	631.8	6.4	No	Yes
2/14/2002	30,091	5.656	1.147	0.000	No	550.9	6.3	No	Yes
7/30/2003	40,696	7.036	0.989	0.000	No	551.0	6.3	No	Yes
9/11/2003	41,791	7.230	1.060	0.000	No	519.8	6.3	No	Yes
2/19/2004	48,858	7.914	1.201	0.000	No	432.8	6.1	No	Yes
3/25/2004	49,747	8.000	0.835	0.000	No	518.3	6.3	No	Yes
7/15/2004	52,604	8.327	1.097	0.000	No	472.5	6.2	No	Yes
8/12/2004	53,324	8.439	1.071	0.000	No	441.2	6.1	No	Yes
9/23/2004	54,394	8.601	0.892	0.000	No	494.6	6.2	No	Yes

10/28/2004	55,295	8.732	1.143	0.000	No	432.7	6.1	No	Yes
1/6/2005	57,083	9.037	0.933	0.000	No	463.8	6.1	No	Yes
2/3/2005	57,800	9.177	1.070	0.000	No	433.5	6.1	No	Yes
3/17/2005	58,873	9.344	0.926	0.000	No	468.1	6.1	No	Yes
4/21/2005	59,777	9.485	1.121	0.000	No	417.6	6.0	No	Yes
5/31/2005	60,796	9.653	0.892	0.000	No	468.1	6.1	No	Yes
6/30/2005	61,564	9.796	1.147	0.000	No	408.1	6.0	No	Yes
9/15/2005	63,518	10.228	1.061	0.000	No	384.7	6.0	No	Yes
1/12/2006	66,544	11.030	1.049	0.000	No	357.0	5.9	No	Yes
6/8/2006	69,243	11.648	1.073	0.000	No	332.7	5.8	No	Yes
8/17/2006	71,033	12.027	1.060	0.000	No	313.9	5.7	No	Yes
10/26/2006	72,818	12.445	1.004	0.000	No	312.6	5.7	No	Yes

String No.: 20		Serial No.: 05s105131		Cycle Installed:		12			
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:		0			
Level: A		LPRM ID No.: 579		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.042	1.176	0.000	No	1,062.9	7.0	No	Yes
6/8/2006	2,039	0.592	1.098	0.000	No	968.1	6.9	No	Yes
10/26/2006	5,614	1.574	1.015	0.000	No	953.7	6.9	No	Yes
Level: B		LPRM ID No.: 587		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.038	1.052	0.000	No	1,188.2	7.1	No	Yes
10/26/2006	5,614	1.629	0.952	0.000	No	1,248.1	7.1	No	Yes
Level: C		LPRM ID No.: 595		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/4/2006	1,175	0.254	1.093	0.000	No	1,143.6	7.0	No	Yes
9/21/2006	4,720	1.079	0.946	0.000	No	1,208.9	7.1	No	Yes
10/26/2006	5,614	1.319	0.987	0.000	No	1,224.8	7.1	No	Yes
Level: D		LPRM ID No.: 603		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/21/2006	4,720	0.884	0.932	0.000	No	1,341.2	7.2	No	Yes
10/26/2006	5,614	1.104	1.007	0.000	No	1,331.9	7.2	No	Yes

String No.: 21 Serial No.: 99S06333 Cycle Installed: 9
 Coordinates: 33 Type: NA300 Cumulative Core Average Exposure at BOC: 54,800
 Level: A LPRM ID No.: 347 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.030	1.078	0.000	No	1,159.6	7.1	No	Yes
12/7/2000	9,499	2.360	1.050	0.000	No	1,104.3	7.0	No	Yes
7/7/2001	14,896	3.838	1.095	0.000	No	1,008.5	6.9	No	Yes
6/6/2002	17,723	5.731	1.051	0.000	No	901.9	6.8	No	Yes
3/29/2002	18,770	5.242	1.064	0.000	No	947.9	6.9	No	Yes
4/10/2003	25,544	7.633	1.065	0.000	No	846.8	6.7	No	Yes
6/19/2003	27,228	8.206	1.053	0.000	No	804.2	6.7	No	Yes
7/30/2003	28,292	8.607	1.018	0.000	No	804.0	6.7	No	Yes
9/11/2003	29,387	8.935	1.065	0.000	No	754.9	6.6	No	Yes
2/19/2004	36,454	9.530	1.089	0.000	No	693.2	6.5	No	Yes
5/6/2004	38,423	10.195	1.079	0.000	No	642.5	6.5	No	Yes
6/17/2004	39,500	10.547	1.051	0.000	No	611.3	6.4	No	Yes
10/28/2004	42,891	11.613	1.057	0.000	No	578.3	6.4	No	Yes
12/9/2004	43,958	11.985	1.079	0.000	No	536.0	6.3	No	Yes
3/17/2005	46,469	12.923	1.069	0.000	No	501.4	6.2	No	Yes
4/21/2005	47,373	13.327	1.051	0.000	No	477.1	6.2	No	Yes
6/30/2005	49,160	13.973	1.059	0.000	No	450.5	6.1	No	Yes
8/4/2005	50,051	14.225	0.946	0.000	No	476.2	6.2	No	Yes
9/15/2005	51,114	14.453	1.096	0.000	No	434.0	6.1	No	Yes
12/1/2005	53,067	14.822	0.913	0.000	No	475.4	6.2	No	Yes
1/12/2006	54,140	14.974	1.021	0.000	No	451.0	6.1	No	Yes
10/26/2006	60,414	16.625	1.054	0.000	No	362.3	5.9	No	Yes

Level: B LPRM ID No.: 353 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.040	1.095	0.000	No	1,141.6	7.0	No	Yes
2/2/2000	1,724	0.461	1.050	0.000	No	1,087.2	7.0	No	Yes

6/14/2000	5,029	1.401	1.061	0.000	No	1,024.7	6.9	No	Yes
8/24/2000	6,865	1.932	1.092	0.000	No	938.4	6.8	No	Yes
11/4/2000	8,649	2.411	1.091	0.000	No	860.1	6.8	No	Yes
1/18/2001	10,585	2.826	1.108	0.000	No	776.3	6.7	No	Yes
4/26/2001	13,036	3.504	1.093	0.000	No	710.2	6.6	No	Yes
6/7/2001	14,125	3.818	1.050	0.000	No	676.4	6.5	No	Yes
7/7/2001	14,896	4.039	1.069	0.000	No	632.7	6.5	No	Yes
9/13/2001	16,661	4.507	1.052	0.000	No	601.5	6.4	No	Yes
2/14/2002	17,687	5.324	1.065	0.000	No	533.8	6.3	No	Yes
6/6/2002	17,723	6.122	1.083	0.000	No	492.9	6.2	No	Yes
11/15/2001	18,288	4.905	1.058	0.000	No	568.5	6.3	No	Yes
12/5/2002	22,366	7.357	1.062	0.000	No	464.1	6.1	No	Yes
4/10/2003	25,544	8.172	1.072	0.000	No	432.9	6.1	No	Yes
7/30/2003	28,292	8.998	1.045	0.000	No	433.0	6.1	No	Yes
9/11/2003	29,387	9.314	1.074	0.000	No	403.2	6.0	No	Yes
2/19/2004	36,454	10.077	1.118	0.000	No	360.6	5.9	No	Yes
5/6/2004	38,423	10.691	1.052	0.000	No	342.8	5.8	No	Yes
9/23/2004	41,990	11.707	1.074	0.000	No	319.2	5.8	No	Yes
12/9/2004	43,958	12.304	1.056	0.000	No	302.2	5.7	No	Yes
5/31/2005	48,392	13.675	1.055	0.000	No	286.5	5.7	No	Yes
8/4/2005	50,051	14.179	1.067	0.000	No	268.5	5.6	No	Yes
12/1/2005	53,067	15.056	1.065	0.000	No	252.1	5.5	No	Yes
1/12/2006	54,140	15.345	1.013	0.000	No	238.0	5.5	No	Yes
7/13/2006	57,733	16.448	1.051	0.000	No	206.6	5.3	No	Yes
10/26/2006	60,414	17.174	1.015	0.000	No	203.6	5.3	No	Yes

Level: C

LPRM ID No.: 359

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.032	1.091	0.000	No	1,145.7	7.0	No	Yes
2/14/2002	17,687	4.506	1.051	0.000	No	1,027.5	6.9	No	Yes
11/15/2001	18,288	4.021	1.061	0.000	No	1,079.9	7.0	No	Yes
9/19/2002	20,399	5.603	1.052	0.000	No	976.7	6.9	No	Yes
2/26/2003	24,474	6.507	1.061	0.000	No	920.5	6.8	No	Yes
7/30/2003	28,292	7.362	1.070	0.000	No	860.3	6.8	No	Yes
10/16/2003	30,289	7.909	1.086	0.000	No	792.2	6.7	No	Yes
2/19/2004	36,454	8.577	1.144	0.000	No	692.5	6.5	No	Yes
5/6/2004	38,423	9.021	1.060	0.000	No	653.3	6.5	No	Yes

9/23/2004	41,990	9.806	1.084	0.000	No	602.6	6.4	No	Yes
1/6/2005	44,679	10.499	1.056	0.000	No	570.7	6.3	No	Yes
4/21/2005	47,373	11.242	1.068	0.000	No	534.4	6.3	No	Yes
8/4/2005	50,051	11.965	1.068	0.000	No	500.3	6.2	No	Yes
10/20/2005	52,015	12.568	1.078	0.000	No	464.0	6.1	No	Yes
1/12/2006	54,140	13.234	1.069	0.000	No	434.1	6.1	No	Yes
8/17/2006	58,629	14.409	1.062	0.000	No	340.6	5.8	No	Yes
10/26/2006	60,414	14.848	1.049	0.000	No	324.7	5.8	No	Yes

Level: D

LPRM ID No.: 365

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	17,687	3.479	1.054	0.000	No	1,186.0	7.1	No	Yes
7/30/2003	28,292	4.877	1.040	0.000	No	1,186.0	7.1	No	Yes
9/11/2003	29,387	5.054	1.054	0.000	No	1,125.2	7.0	No	Yes
2/19/2004	36,454	5.677	1.066	0.000	No	1,055.6	7.0	No	Yes
9/23/2004	41,990	6.450	1.139	0.000	No	926.8	6.8	No	Yes
2/3/2005	45,396	7.153	1.089	0.000	No	851.0	6.7	No	Yes
3/17/2005	46,469	7.378	0.905	0.000	No	940.3	6.8	No	Yes
5/31/2005	48,392	7.777	1.062	0.000	No	885.4	6.8	No	Yes
8/4/2005	50,051	8.146	1.091	0.000	No	811.6	6.7	No	Yes
9/15/2005	51,114	8.433	0.941	0.000	No	862.0	6.8	No	Yes
10/20/2005	52,015	8.676	1.063	0.000	No	811.0	6.7	No	Yes
12/1/2005	53,067	9.004	1.079	0.000	No	751.6	6.6	No	Yes
6/8/2006	56,839	9.990	1.079	0.000	No	623.6	6.4	No	Yes
8/17/2006	58,629	10.403	1.061	0.000	No	587.8	6.4	No	Yes
10/26/2006	60,414	10.881	1.056	0.000	No	556.6	6.3	No	Yes

String No.: 22

Serial No.: 00s10723

Cycle Installed:

10

Coordinates: 33

Type: NA300

Cumulative Core Average Exposure at BOC:

37,300

Level: A

LPRM ID No.: 403

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
3/29/2002	1,270	0.261	1.082	0.000	No	1,155.3	7.1	No	Yes
10/24/2002	3,799	1.663	1.060	0.000	No	1,089.9	7.0	No	Yes
4/10/2003	8,044	2.746	1.097	0.000	No	993.5	6.9	No	Yes
6/19/2003	9,728	3.353	1.057	0.000	No	939.9	6.8	No	Yes
7/30/2003	10,792	3.751	1.062	0.000	No	885.1	6.8	No	Yes

10/16/2003	12,789	4.388	1.084	0.000	No	816.5	6.7	No	Yes
11/20/2003	13,694	4.613	1.056	0.000	No	773.2	6.7	No	Yes
3/25/2004	19,843	5.193	1.149	0.000	No	672.9	6.5	No	Yes
7/15/2004	22,700	6.186	1.110	0.000	No	606.2	6.4	No	Yes
12/9/2004	26,458	7.424	1.107	0.000	No	547.6	6.3	No	Yes
2/3/2005	27,896	7.976	1.060	0.000	No	516.6	6.2	No	Yes
4/21/2005	29,873	8.702	1.086	0.000	No	475.7	6.2	No	Yes
9/15/2005	33,614	9.807	1.071	0.000	No	444.2	6.1	No	Yes
3/24/2006	37,427	10.501	1.106	0.000	No	401.6	6.0	No	Yes
5/4/2006	38,475	10.809	1.065	0.000	No	377.1	5.9	No	Yes
7/13/2006	40,233	11.336	1.070	0.000	No	352.4	5.9	No	Yes
10/26/2006	42,914	12.140	1.061	0.000	No	332.2	5.8	No	Yes

Level: B

LPRM ID No.: 411

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.052	1.112	0.000	No	1,124.0	7.0	No	Yes
8/15/2002	2,029	1.215	0.942	0.000	No	1,193.2	7.1	No	Yes
12/5/2002	4,866	2.002	1.087	0.000	No	1,097.7	7.0	No	Yes
2/26/2003	6,974	2.582	1.062	0.000	No	1,033.6	6.9	No	Yes
5/15/2003	8,890	3.111	1.081	0.000	No	956.2	6.9	No	Yes
7/30/2003	10,792	3.713	1.093	0.000	No	874.8	6.8	No	Yes
10/16/2003	12,789	4.302	1.072	0.000	No	816.1	6.7	No	Yes
12/30/2003	14,621	4.791	1.073	0.000	No	760.5	6.6	No	Yes
2/19/2004	18,954	4.919	1.111	0.000	No	684.6	6.5	No	Yes
3/25/2004	19,843	5.207	1.064	0.000	No	643.4	6.5	No	Yes
7/15/2004	22,700	6.069	1.074	0.000	No	599.0	6.4	No	Yes
10/28/2004	25,391	6.844	1.055	0.000	No	567.8	6.3	No	Yes
1/6/2005	27,179	7.344	1.051	0.000	No	540.3	6.3	No	Yes
4/21/2005	29,873	8.078	1.070	0.000	No	504.9	6.2	No	Yes
8/4/2005	32,551	8.812	1.051	0.000	No	480.4	6.2	No	Yes
10/20/2005	34,515	9.327	1.076	0.000	No	446.0	6.1	No	Yes
3/24/2006	37,427	10.161	1.161	0.000	No	384.2	6.0	No	Yes
7/13/2006	40,233	11.000	1.060	0.000	No	362.4	5.9	No	Yes
10/26/2006	42,914	11.817	1.045	0.000	No	346.8	5.8	No	Yes

Level: C

LPRM ID No.: 419

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value

2/14/2002	187	0.038	1.056	0.000	No	1,184.0	7.1	No	Yes
8/15/2002	2,029	0.914	0.947	0.000	No	1,250.3	7.1	No	Yes
1/16/2003	5,920	1.937	1.057	0.000	No	1,182.8	7.1	No	Yes
4/10/2003	8,044	2.365	1.075	0.000	No	1,100.3	7.0	No	Yes
7/30/2003	10,792	3.017	1.123	0.000	No	979.8	6.9	No	Yes
10/16/2003	12,789	3.599	1.091	0.000	No	898.1	6.8	No	Yes
12/30/2003	14,621	4.163	1.084	0.000	No	828.5	6.7	No	Yes
2/19/2004	18,954	4.313	1.151	0.000	No	719.8	6.6	No	Yes
7/15/2004	22,700	5.181	1.070	0.000	No	672.7	6.5	No	Yes
12/9/2004	26,458	6.043	1.074	0.000	No	626.4	6.4	No	Yes
4/21/2005	29,873	6.854	1.053	0.000	No	594.8	6.4	No	Yes
8/4/2005	32,551	7.510	1.066	0.000	No	558.0	6.3	No	Yes
10/20/2005	34,515	8.058	1.061	0.000	No	526.0	6.3	No	Yes
1/12/2006	36,640	8.665	1.041	0.000	No	491.0	6.2	No	Yes
3/24/2006	37,427	9.010	1.089	0.000	No	450.9	6.1	No	Yes
7/13/2006	40,233	9.651	1.056	0.000	No	427.0	6.1	No	Yes
10/26/2006	42,914	10.310	1.044	0.000	No	409.0	6.0	No	Yes

Level: D

LPRM ID No.: 427

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Byp.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
2/14/2002	187	0.015	1.057	0.000	No	1,183.0	7.1	No	Yes
6/6/2002	223	0.197	1.068	0.000	No	1,107.7	7.0	No	Yes
9/19/2002	2,899	0.422	0.924	0.000	No	1,198.8	7.1	No	Yes
2/26/2003	6,974	0.947	0.925	0.000	No	1,296.0	7.2	No	Yes
7/30/2003	10,792	1.354	0.994	0.000	No	1,296.0	7.2	No	Yes
12/30/2003	14,621	2.071	1.082	0.000	No	1,197.8	7.1	No	Yes
2/19/2004	18,954	2.178	1.183	0.000	No	1,012.5	6.9	No	Yes
3/25/2004	19,843	2.279	0.860	0.000	No	1,177.3	7.1	No	Yes
5/6/2004	20,923	2.411	1.072	0.000	No	1,098.2	7.0	No	Yes
8/12/2004	23,420	2.759	1.077	0.000	No	1,019.7	6.9	No	Yes
1/6/2005	27,179	3.334	1.066	0.000	No	956.6	6.9	No	Yes
6/30/2005	31,660	4.083	1.052	0.000	No	909.3	6.8	No	Yes
9/15/2005	33,614	4.494	1.052	0.000	No	864.4	6.8	No	Yes
12/1/2005	35,567	4.982	1.089	0.000	No	793.7	6.7	No	Yes
1/12/2006	36,640	5.284	1.045	0.000	No	734.0	6.6	No	Yes
9/21/2006	42,020	6.354	1.082	0.000	No	678.4	6.5	No	Yes
10/26/2006	42,914	6.536	1.019	0.000	No	665.7	6.5	No	Yes

String No.: 23		Serial No.: 03s61364		Cycle Installed:		11			
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:		18,500			
Level: A		LPRM ID No.: 502		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.036	1.082	0.000	No	1,155.3	7.1	No	Yes
3/25/2004	1,043	0.285	1.055	0.000	No	1,095.0	7.0	No	Yes
6/17/2004	3,200	0.887	0.948	0.000	No	1,155.1	7.1	No	Yes
4/21/2005	11,073	3.483	1.059	0.000	No	1,090.8	7.0	No	Yes
3/24/2006	18,627	5.735	1.323	0.000	No	824.5	6.7	No	Yes
6/8/2006	20,539	6.339	0.944	0.000	No	873.4	6.8	No	Yes
10/26/2006	24,114	7.017	1.004	0.000	No	869.9	6.8	No	Yes
Level: B		LPRM ID No.: 512		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/6/2004	2,123	0.584	0.932	0.000	No	1,341.2	7.2	No	Yes
9/23/2004	5,690	1.528	0.919	0.000	No	1,459.4	7.3	No	Yes
1/12/2006	17,840	4.949	1.056	0.000	No	1,382.0	7.2	No	Yes
3/24/2006	18,627	5.265	1.240	0.000	No	1,114.5	7.0	No	Yes
10/26/2006	24,114	6.679	1.058	0.000	No	1,053.4	7.0	No	Yes
Level: C		LPRM ID No.: 522		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/6/2004	2,123	0.445	0.948	0.000	No	1,318.6	7.2	No	Yes
9/23/2004	5,690	1.213	0.933	0.000	No	1,413.3	7.3	No	Yes
1/12/2006	17,840	4.441	1.060	0.000	No	1,333.3	7.2	No	Yes
3/24/2006	18,627	4.789	1.219	0.000	No	1,093.7	7.0	No	Yes
10/26/2006	24,114	5.870	1.010	0.000	No	1,082.9	7.0	No	Yes
Level: D		LPRM ID No.: 532		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.020	0.893	0.000	No	1,399.8	7.2	No	Yes

10/28/2004	6,591	0.831	0.932	0.000	No	1,501.9	7.3	No	Yes
3/24/2006	18,627	3.443	1.101	0.000	No	1,364.1	7.2	No	Yes
10/26/2006	24,114	4.171	0.975	0.000	No	1,399.1	7.2	No	Yes

String No.: 24		Serial No.: L-2708		Cycle Installed:		6			
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:		86,992			
Level: A		LPRM ID No.: 67		Beginning of Life Calibration Current:		1,336.0			
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	21,038	3.452	1.079	0.000	Yes	720.0	6.6	No	Yes
8/25/1998	22,612	3.564	1.013	0.000	No	710.8	6.6	No	Yes
9/29/1998	23,473	3.713	1.018	0.000	No	698.2	6.5	No	Yes
2/4/1999	26,406	4.170	1.061	0.000	No	658.1	6.5	No	Yes
6/24/1999	29,696	4.674	1.067	0.000	No	616.7	6.4	No	Yes
11/24/1999	32,205	5.011	1.095	0.000	No	563.2	6.3	No	Yes
11/30/1999	32,341	5.038	1.068	0.000	No	527.4	6.3	No	Yes
3/8/2000	34,776	5.504	1.051	0.000	No	501.8	6.2	No	Yes
8/24/2000	39,057	6.427	1.058	0.000	No	474.3	6.2	No	Yes
4/26/2001	45,228	7.817	1.090	0.000	No	435.1	6.1	No	Yes
3/29/2002	50,962	9.378	1.079	0.000	No	383.0	5.9	No	Yes
12/20/2001	51,375	9.020	1.053	0.000	No	413.2	6.0	No	Yes
10/24/2002	53,491	10.474	1.077	0.000	No	355.6	5.9	No	Yes
7/30/2003	60,484	12.167	1.034	0.000	No	356.0	5.9	No	Yes
9/11/2003	61,579	12.485	1.080	0.000	No	329.6	5.8	No	Yes
12/30/2003	64,313	13.181	1.058	0.000	No	311.6	5.7	No	Yes
2/19/2004	68,646	13.277	1.085	0.000	No	287.2	5.7	No	Yes
3/25/2004	69,535	13.473	0.924	0.000	No	310.8	5.7	No	Yes
5/6/2004	70,615	13.706	1.095	0.000	No	283.8	5.6	No	Yes
12/9/2004	76,150	14.910	1.060	0.000	No	267.7	5.6	No	Yes
6/30/2005	81,352	16.077	0.946	0.000	No	283.0	5.6	No	Yes
8/4/2005	82,243	16.217	1.065	0.000	No	265.8	5.6	No	Yes
9/15/2005	83,306	16.393	1.061	0.000	No	250.5	5.5	No	Yes
12/1/2005	85,259	16.772	0.943	0.000	No	265.6	5.6	No	Yes
3/24/2006	87,119	17.096	1.190	0.000	No	223.2	5.4	No	Yes
10/26/2006	92,606	18.110	0.968	0.000	No	230.6	5.4	No	Yes
Level: B		LPRM ID No.: 153		Beginning of Life Calibration Current:		1,246.0			
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	4.603	1.042	0.000	Yes	614.0	6.4	No	Yes
8/25/1998	22,612	4.707	1.002	0.000	No	612.8	6.4	No	Yes
9/29/1998	23,473	4.909	1.017	0.000	No	602.5	6.4	No	Yes
2/4/1999	26,406	5.568	1.082	0.000	No	556.9	6.3	No	Yes
6/24/1999	29,696	6.203	1.055	0.000	No	527.8	6.3	No	Yes
11/24/1999	32,205	6.661	1.146	0.000	No	460.6	6.1	No	Yes
12/27/1999	33,008	6.839	1.054	0.000	No	437.0	6.1	No	Yes
6/14/2000	37,221	7.809	1.053	0.000	No	415.0	6.0	No	Yes
12/7/2000	41,691	8.805	1.061	0.000	No	391.1	6.0	No	Yes
8/17/2001	48,154	10.124	1.061	0.000	No	368.7	5.9	No	Yes
10/18/2001	49,756	10.462	1.080	0.000	No	341.3	5.8	No	Yes
3/29/2002	50,962	11.248	1.061	0.000	No	321.7	5.8	No	Yes
8/15/2002	51,721	12.024	1.064	0.000	No	302.4	5.7	No	Yes
2/26/2003	56,666	13.208	1.054	0.000	No	286.9	5.7	No	Yes
7/30/2003	60,484	14.102	1.025	0.000	No	287.0	5.7	No	Yes
9/11/2003	61,579	14.373	1.068	0.000	No	268.7	5.6	No	Yes
12/30/2003	64,313	15.041	1.061	0.000	No	253.3	5.5	No	Yes
2/19/2004	68,646	15.156	1.105	0.000	No	229.2	5.4	No	Yes
10/28/2004	75,083	16.546	1.070	0.000	No	214.2	5.4	No	Yes
6/30/2005	81,352	17.817	1.053	0.000	No	203.4	5.3	No	Yes
1/12/2006	86,332	18.811	1.087	0.000	No	187.2	5.2	No	Yes
3/24/2006	87,119	19.042	1.087	0.000	No	172.2	5.1	No	Yes
8/17/2006	90,821	19.854	1.053	0.000	No	163.5	5.1	No	Yes
10/26/2006	92,606	20.202	1.005	0.000	No	162.7	5.1	No	Yes

Level: C

LPRM ID No.: 239

Beginning of Life Calibration Current:

1,263.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	21,038	4.640	1.063	0.000	Yes	653.0	6.5	No	Yes
8/25/1998	22,612	4.718	0.985	0.000	No	662.9	6.5	No	Yes
9/29/1998	23,473	4.879	1.026	0.000	No	646.1	6.5	No	Yes
2/4/1999	26,406	5.474	1.064	0.000	No	607.3	6.4	No	Yes
4/15/1999	28,093	5.844	1.056	0.000	No	575.1	6.4	No	Yes
8/4/1999	30,557	6.358	1.068	0.000	No	538.5	6.3	No	Yes
11/24/1999	32,205	6.719	1.103	0.000	No	488.2	6.2	No	Yes
12/27/1999	33,008	6.854	1.050	0.000	No	464.9	6.1	No	Yes
8/24/2000	39,057	7.873	1.055	0.000	No	440.7	6.1	No	Yes

1/18/2001	42,777	8.580	1.053	0.000	No	418.5	6.0	No	Yes
6/6/2002	49,915	10.961	0.977	0.000	No	350.0	5.9	No	Yes
11/15/2001	50,480	10.266	1.110	0.000	No	377.0	5.9	No	Yes
7/30/2003	60,484	12.582	1.046	0.000	No	350.0	5.9	No	Yes
10/16/2003	62,481	12.998	1.094	0.000	No	319.9	5.8	No	Yes
2/19/2004	68,646	13.551	1.105	0.000	No	289.5	5.7	No	Yes
8/12/2004	73,112	14.334	1.060	0.000	No	273.1	5.6	No	Yes
1/6/2005	76,871	15.045	1.051	0.000	No	259.9	5.6	No	Yes
8/4/2005	82,243	16.015	1.053	0.000	No	246.8	5.5	No	Yes
1/12/2006	86,332	16.931	1.072	0.000	No	230.2	5.4	No	Yes
3/24/2006	87,119	17.185	1.086	0.000	No	212.0	5.4	No	Yes
8/17/2006	90,821	17.853	1.058	0.000	No	200.4	5.3	No	Yes
10/26/2006	92,606	18.152	1.009	0.000	No	198.6	5.3	No	Yes

Level: D

LPRM ID No.: 325

Beginning of Life Calibration Current:

1,391.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
9/12/1996	21,038	3.412	1.061	0.000	Yes	891.0	6.8	No	Yes
8/25/1998	22,612	3.436	0.956	0.000	No	932.0	6.8	No	Yes
9/29/1998	23,473	3.537	1.034	0.000	No	901.4	6.8	No	Yes
3/11/1999	27,265	4.046	1.046	0.000	No	858.0	6.8	No	Yes
4/15/1999	28,093	4.166	1.053	0.000	No	814.8	6.7	No	Yes
9/17/1999	31,504	4.705	1.055	0.000	No	772.3	6.6	No	Yes
11/24/1999	32,205	4.848	1.140	0.000	No	677.5	6.5	No	Yes
6/14/2000	37,221	5.328	1.057	0.000	No	641.0	6.5	No	Yes
3/22/2001	44,323	6.168	1.066	0.000	No	601.3	6.4	No	Yes
2/14/2002	49,879	7.428	1.072	0.000	No	525.7	6.3	No	Yes
12/20/2001	51,375	7.327	1.067	0.000	No	563.5	6.3	No	Yes
4/10/2003	57,736	8.012	0.945	0.000	No	556.3	6.3	No	Yes
7/30/2003	60,484	8.225	1.004	0.000	No	556.0	6.3	No	Yes
2/19/2004	68,646	8.716	1.076	0.000	No	516.7	6.2	No	Yes
3/25/2004	69,535	8.789	1.105	0.000	No	467.6	6.1	No	Yes
5/6/2004	70,615	8.882	0.887	0.000	No	527.2	6.3	No	Yes
8/12/2004	73,112	9.142	1.140	0.000	No	462.5	6.1	No	Yes
9/23/2004	74,182	9.266	0.943	0.000	No	490.4	6.2	No	Yes
10/28/2004	75,083	9.370	1.053	0.000	No	465.7	6.1	No	Yes
12/9/2004	76,150	9.503	0.928	0.000	No	501.9	6.2	No	Yes
1/6/2005	76,871	9.615	1.051	0.000	No	477.5	6.2	No	Yes

6/30/2005	81,352	10.260	1.105	0.000	No	432.1	6.1	No	Yes
8/4/2005	82,243	10.375	0.939	0.000	No	460.2	6.1	No	Yes
10/20/2005	84,207	10.713	1.080	0.000	No	426.0	6.1	No	Yes
3/24/2006	87,119	11.367	1.073	0.000	No	397.0	6.0	No	Yes
6/8/2006	89,031	11.627	1.080	0.000	No	367.6	5.9	No	Yes
7/13/2006	89,925	11.748	0.940	0.000	No	391.1	6.0	No	Yes
9/21/2006	91,712	11.999	1.077	0.000	No	363.1	5.9	No	Yes
10/26/2006	92,606	12.126	0.990	0.000	No	366.8	5.9	No	Yes

String No.: 25 Serial No.: 00s19544 Cycle Installed: 10
Coordinates: 25 Type: NA300 Cumulative Core Average Exposure at BOC: 37,300
Level: A LPRM ID No.: 404 Beginning of Life Calibration Current: 700.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
2/14/2002	187	0.060	1.103	0.000	No	1,133.0	7.0	Yes
6/6/2002	223	0.842	0.983	0.000	No	1,078.0	7.0	Yes
1/16/2003	5,920	2.432	1.077	0.000	No	1,000.9	6.9	Yes
4/10/2003	8,044	3.232	1.082	0.000	No	925.1	6.8	Yes
5/15/2003	8,890	3.587	1.053	0.000	No	878.5	6.8	Yes
6/19/2003	9,728	3.863	1.067	0.000	No	823.3	6.7	Yes
7/30/2003	10,792	4.173	1.050	0.000	No	823.0	6.7	Yes
9/11/2003	11,887	4.483	1.085	0.000	No	758.5	6.6	Yes
11/20/2003	13,694	5.021	1.067	0.000	No	710.9	6.6	Yes
3/25/2004	19,843	5.536	1.098	0.000	No	647.4	6.5	Yes
9/23/2004	24,490	6.618	1.128	0.000	No	574.0	6.4	Yes
1/6/2005	27,179	7.371	0.945	0.000	No	607.4	6.4	Yes
3/17/2005	28,969	7.895	1.139	0.000	No	533.3	6.3	Yes
5/31/2005	30,892	8.564	1.052	0.000	No	506.9	6.2	Yes
10/20/2005	34,515	9.659	1.062	0.000	No	477.0	6.2	Yes
3/24/2006	37,427	10.400	1.117	0.000	No	427.0	6.1	Yes
9/21/2006	42,020	11.598	1.077	0.000	No	396.5	6.0	Yes
10/26/2006	42,914	11.883	1.029	0.000	No	385.3	6.0	Yes

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
2/14/2002	187	0.056	1.113	0.000	No	1,123.0	7.0	Yes
10/24/2002	3,799	1.904	1.053	0.000	No	1,066.5	7.0	Yes

1/16/2003	5,920	2.493	1.094	0.000	No	974.8	6.9	No	Yes
4/10/2003	8,044	3.142	1.088	0.000	No	896.0	6.8	No	Yes
6/19/2003	9,728	3.634	1.097	0.000	No	816.8	6.7	No	Yes
7/30/2003	10,792	3.918	1.040	0.000	No	817.0	6.7	No	Yes
9/11/2003	11,887	4.214	1.084	0.000	No	753.7	6.6	No	Yes
11/20/2003	13,694	4.745	1.080	0.000	No	697.9	6.5	No	Yes
2/19/2004	18,954	5.131	1.165	0.000	No	599.0	6.4	No	Yes
8/12/2004	23,420	6.187	1.058	0.000	No	566.2	6.3	No	Yes
3/17/2005	28,969	7.521	1.054	0.000	No	537.2	6.3	No	Yes
8/4/2005	32,551	8.387	1.060	0.000	No	506.8	6.2	No	Yes
10/20/2005	34,515	8.888	1.066	0.000	No	475.0	6.2	No	Yes
3/24/2006	37,427	9.735	1.100	0.000	No	431.8	6.1	No	Yes
7/13/2006	40,233	10.453	1.059	0.000	No	407.8	6.0	No	Yes
10/26/2006	42,914	11.136	1.063	0.000	No	383.6	5.9	No	Yes

Level: C

LPRM ID No.: 420

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
2/14/2002	187	0.033	1.089	0.000	No	1,148.0	7.0	No Yes
8/15/2002	2,029	0.862	0.942	0.000	No	1,218.7	7.1	No Yes
7/30/2003	10,792	2.785	1.045	0.000	No	1,219.0	7.1	No Yes
9/11/2003	11,887	3.091	1.106	0.000	No	1,102.2	7.0	No Yes
11/20/2003	13,694	3.607	1.086	0.000	No	1,014.9	6.9	No Yes
2/19/2004	18,954	4.040	1.145	0.000	No	886.4	6.8	No Yes
7/15/2004	22,700	4.775	1.068	0.000	No	829.9	6.7	No Yes
12/9/2004	26,458	5.541	1.065	0.000	No	779.3	6.7	No Yes
4/21/2005	29,873	6.302	1.081	0.000	No	720.9	6.6	No Yes
9/15/2005	33,614	7.164	1.094	0.000	No	659.0	6.5	No Yes
10/20/2005	34,515	7.416	1.060	0.000	No	622.0	6.4	No Yes
1/12/2006	36,640	8.034	1.020	0.000	No	587.0	6.4	No Yes
3/24/2006	37,427	8.345	1.097	0.000	No	535.1	6.3	No Yes
6/8/2006	39,339	8.734	1.063	0.000	No	503.4	6.2	No Yes
10/26/2006	42,914	9.475	1.049	0.000	No	479.9	6.2	No Yes

Level: D

LPRM ID No.: 428

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
2/14/2002	187	0.011	1.065	0.000	No	1,174.0	7.1	No Yes
1/16/2003	5,920	0.642	0.942	0.000	No	1,246.3	7.1	No Yes

7/30/2003	10,792	1.112	0.962	0.000	No	1,246.0	7.1	No	Yes
2/19/2004	18,954	1.795	1.076	0.000	No	1,158.0	7.1	No	Yes
3/25/2004	19,843	1.878	0.894	0.000	No	1,295.3	7.2	No	Yes
5/6/2004	20,923	1.985	1.118	0.000	No	1,158.6	7.1	No	Yes
7/15/2004	22,700	2.186	1.062	0.000	No	1,090.9	7.0	No	Yes
9/23/2004	24,490	2.421	0.903	0.000	No	1,208.1	7.1	No	Yes
10/28/2004	25,391	2.533	1.102	0.000	No	1,096.3	7.0	No	Yes
1/6/2005	27,179	2.801	1.081	0.000	No	1,014.2	6.9	No	Yes
6/30/2005	31,660	3.521	1.069	0.000	No	948.7	6.9	No	Yes
10/20/2005	34,515	4.066	1.069	0.000	No	887.5	6.8	No	Yes
12/1/2005	35,567	4.301	1.057	0.000	No	839.6	6.7	No	Yes
1/12/2006	36,640	4.554	0.940	0.000	No	813.0	6.7	No	Yes
6/8/2006	39,339	5.089	1.119	0.000	No	726.5	6.6	No	Yes
10/26/2006	42,914	5.762	1.018	0.000	No	713.7	6.6	No	Yes

String No.: 26		Serial No.: 05s105132		Cycle Installed:		12			
Coordinates: 25		Type: NA300		Cumulative Core Average Exposure at BOC:		0			
Level: A		LPRM ID No.: 580		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.p.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.040	1.097	0.000	No	1,139.5	7.0	No	Yes
5/4/2006	1,175	0.348	1.077	0.000	No	1,058.0	7.0	No	Yes
8/17/2006	3,829	1.165	1.053	0.000	No	1,004.8	6.9	No	Yes
9/21/2006	4,720	1.445	0.945	0.000	No	1,063.2	7.0	No	Yes
10/26/2006	5,614	1.736	1.026	0.000	No	1,036.3	6.9	No	Yes
Level: B		LPRM ID No.: 588		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.p.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/26/2006	5,614	1.704	0.988	0.000	No	1,265.2	7.1	No	Yes
Level: C		LPRM ID No.: 596		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.p.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/8/2006	2,039	0.457	1.053	0.000	No	1,187.1	7.1	No	Yes
9/21/2006	4,720	1.161	0.942	0.000	No	1,260.2	7.1	No	Yes

10/26/2006	5,614	1.387	0.994	0.000	No	1,267.8	7.1	No	Yes
Level: D		LPRM ID No.: 604		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.015	0.920	0.000	No	1,358.7	7.2	No	Yes
10/26/2006	5,614	1.068	0.997	0.000	No	1,362.8	7.2	No	Yes

String No.: 27		Serial No.: 03s61359		Cycle Installed:				11	
Coordinates: 25		Type: NA300		Cumulative Core Average Exposure at BOC:				18,500	
Level: A		LPRM ID No.: 503		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.033	1.059	0.000	No	1,180.4	7.1	No	Yes
12/9/2004	7,658	2.369	0.915	0.000	No	1,290.0	7.2	No	Yes
4/21/2005	11,073	3.674	1.073	0.000	No	1,202.2	7.1	No	Yes
1/12/2006	17,840	5.446	0.929	0.000	No	1,223.0	7.1	No	Yes
3/24/2006	18,627	5.622	1.141	0.000	No	1,071.9	7.0	No	Yes
10/26/2006	24,114	7.185	1.057	0.000	No	1,014.1	6.9	No	Yes

Level: B		LPRM ID No.: 513		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.042	1.076	0.000	No	1,161.7	7.1	No	Yes
5/6/2004	2,123	0.615	0.943	0.000	No	1,231.9	7.1	No	Yes
12/9/2004	7,658	2.191	0.949	0.000	No	1,298.1	7.2	No	Yes
1/12/2006	17,840	5.061	1.039	0.000	No	1,195.0	7.1	No	Yes
3/24/2006	18,627	5.336	1.074	0.000	No	1,112.7	7.0	No	Yes
10/26/2006	24,114	6.948	1.018	0.000	No	1,093.0	7.0	No	Yes

Level: C		LPRM ID No.: 523		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.238	1.061	0.000	No	1,178.1	7.1	No	Yes
6/17/2004	3,200	0.717	0.928	0.000	No	1,269.5	7.1	No	Yes
10/28/2004	6,591	1.518	0.948	0.000	No	1,339.2	7.2	No	Yes

3/17/2005	10,169	2.403	0.946	0.000	No	1,415.6	7.3	No	Yes
1/12/2006	17,840	4.603	1.034	0.000	No	1,330.0	7.2	No	Yes
3/24/2006	18,627	4.921	1.127	0.000	No	1,180.1	7.1	No	Yes
10/26/2006	24,114	6.232	1.026	0.000	No	1,150.2	7.0	No	Yes

Level: D

LPRM ID No.: 533

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/19/2004	154	0.023	0.925	0.000	No	1,351.4	7.2	No	Yes
9/23/2004	5,690	0.763	1.057	0.000	No	1,278.5	7.2	No	Yes
10/28/2004	6,591	0.896	0.916	0.000	No	1,395.7	7.2	No	Yes
1/6/2005	8,379	1.194	1.057	0.000	No	1,320.5	7.2	No	Yes
2/3/2005	9,096	1.324	0.948	0.000	No	1,392.9	7.2	No	Yes
8/4/2005	13,751	2.186	0.930	0.000	No	1,497.7	7.3	No	Yes
9/15/2005	14,814	2.467	1.055	0.000	No	1,419.6	7.3	No	Yes
10/20/2005	15,715	2.687	0.946	0.000	No	1,501.0	7.3	No	Yes
3/24/2006	18,627	3.623	1.148	0.000	No	1,302.0	7.2	No	Yes
10/26/2006	24,114	4.732	0.965	0.000	No	1,349.2	7.2	No	Yes

String No.: 28

Serial No.: 00s19546

Cycle Installed:

10

Coordinates: 25

Type: NA300

Cumulative Core Average Exposure at BOC:

37,300

Level: A

LPRM ID No.: 405

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/14/2002	187	0.054	1.087	0.000	No	1,150.0	7.0	No	Yes
8/15/2002	2,029	1.373	1.079	0.000	No	1,065.8	7.0	No	Yes
12/5/2002	4,866	2.050	1.063	0.000	No	1,002.6	6.9	No	Yes
4/10/2003	8,044	2.905	1.110	0.000	No	903.3	6.8	No	Yes
6/19/2003	9,728	3.507	1.095	0.000	No	824.9	6.7	No	Yes
7/30/2003	10,792	3.899	1.061	0.000	No	777.5	6.7	No	Yes
10/16/2003	12,789	4.471	1.071	0.000	No	725.9	6.6	No	Yes
2/19/2004	18,954	4.945	1.116	0.000	No	650.5	6.5	No	Yes
5/6/2004	20,923	5.598	1.078	0.000	No	603.4	6.4	No	Yes
8/12/2004	23,420	6.376	1.059	0.000	No	569.8	6.3	No	Yes
12/9/2004	26,458	7.277	1.081	0.000	No	527.1	6.3	No	Yes
5/31/2005	30,892	9.074	1.108	0.000	No	475.7	6.2	No	Yes
10/20/2005	34,515	9.913	0.944	0.000	No	504.0	6.2	No	Yes

1/12/2006	36,640	10.281	1.043	0.000	No	469.0	6.2	No	Yes
3/24/2006	37,427	10.470	1.117	0.000	No	419.9	6.0	No	Yes
7/13/2006	40,233	11.239	1.099	0.000	No	382.1	5.9	No	Yes
10/26/2006	42,914	11.985	0.996	0.000	No	383.6	5.9	No	Yes

Level: B

LPRM ID No.: 413

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.052	1.149	0.000	No	1,088.0	7.0	No	Yes
1/16/2003	5,920	2.379	1.056	0.000	No	1,030.3	6.9	No	Yes
4/10/2003	8,044	2.955	1.107	0.000	No	930.7	6.8	No	Yes
6/19/2003	9,728	3.438	1.088	0.000	No	855.4	6.8	No	Yes
7/30/2003	10,792	3.765	1.048	0.000	No	855.0	6.8	No	Yes
9/11/2003	11,887	4.083	1.079	0.000	No	792.4	6.7	No	Yes
11/20/2003	13,694	4.562	1.058	0.000	No	749.0	6.6	No	Yes
2/19/2004	18,954	4.926	1.199	0.000	No	624.7	6.4	No	Yes
6/17/2004	22,000	5.875	1.059	0.000	No	589.9	6.4	No	Yes
10/28/2004	25,391	6.795	1.055	0.000	No	559.1	6.3	No	Yes
2/3/2005	27,896	7.497	1.069	0.000	No	523.0	6.3	No	Yes
5/31/2005	30,892	8.390	1.052	0.000	No	497.2	6.2	No	Yes
8/4/2005	32,551	8.846	1.068	0.000	No	465.5	6.1	No	Yes
12/1/2005	35,567	9.638	1.055	0.000	No	441.2	6.1	No	Yes
3/24/2006	37,427	10.215	1.098	0.000	No	401.9	6.0	No	Yes
8/17/2006	41,129	11.257	1.057	0.000	No	380.2	5.9	No	Yes
10/26/2006	42,914	11.795	1.026	0.000	No	370.6	5.9	No	Yes

Level: C

LPRM ID No.: 421

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.038	1.083	0.000	No	1,154.0	7.1	No	Yes
2/26/2003	6,974	2.132	1.063	0.000	No	1,085.6	7.0	No	Yes
6/19/2003	9,728	2.691	1.110	0.000	No	978.0	6.9	No	Yes
7/30/2003	10,792	2.971	1.059	0.000	No	923.5	6.8	No	Yes
10/16/2003	12,789	3.546	1.072	0.000	No	861.5	6.8	No	Yes
12/30/2003	14,621	4.111	1.086	0.000	No	793.3	6.7	No	Yes
2/19/2004	18,954	4.266	1.134	0.000	No	699.5	6.6	No	Yes
7/15/2004	22,700	5.152	1.067	0.000	No	655.6	6.5	No	Yes
12/9/2004	26,458	5.991	1.062	0.000	No	617.3	6.4	No	Yes
4/21/2005	29,873	6.891	1.068	0.000	No	578.0	6.4	No	Yes

8/4/2005	32,551	7.590	1.100	0.000	No	525.5	6.3	No	Yes
12/1/2005	35,567	8.472	1.053	0.000	No	499.0	6.2	No	Yes
1/12/2006	36,640	8.805	1.023	0.000	No	471.0	6.2	No	Yes
3/24/2006	37,427	9.139	1.059	0.000	No	444.8	6.1	No	Yes
6/8/2006	39,339	9.557	1.053	0.000	No	422.4	6.0	No	Yes
10/26/2006	42,914	10.412	1.041	0.000	No	405.7	6.0	No	Yes

Level: D

LPRM ID No.: 429

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.016	1.033	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.114	1.052	0.000	No	1,188.2	7.1	No	Yes
9/19/2002	2,899	0.483	0.937	0.000	No	1,268.1	7.1	No	Yes
2/26/2003	6,974	1.021	0.945	0.000	No	1,341.9	7.2	No	Yes
7/30/2003	10,792	1.422	0.993	0.000	No	1,342.0	7.2	No	Yes
2/19/2004	18,954	2.276	1.083	0.000	No	1,239.2	7.1	No	Yes
3/25/2004	19,843	2.380	1.084	0.000	No	1,143.1	7.0	No	Yes
5/6/2004	20,923	2.517	0.916	0.000	No	1,248.0	7.1	No	Yes
6/17/2004	22,000	2.665	1.062	0.000	No	1,175.1	7.1	No	Yes
9/23/2004	24,490	3.007	1.094	0.000	No	1,074.1	7.0	No	Yes
10/28/2004	25,391	3.134	0.948	0.000	No	1,133.1	7.0	No	Yes
1/6/2005	27,179	3.442	1.077	0.000	No	1,052.0	7.0	No	Yes
2/3/2005	27,896	3.588	1.067	0.000	No	986.0	6.9	No	Yes
8/4/2005	32,551	4.448	1.067	0.000	No	924.1	6.8	No	Yes
9/15/2005	33,614	4.695	1.082	0.000	No	854.0	6.7	No	Yes
12/1/2005	35,567	5.191	1.055	0.000	No	809.5	6.7	No	Yes
1/12/2006	36,640	5.514	1.036	0.000	No	757.0	6.6	No	Yes
8/17/2006	41,129	6.490	1.060	0.000	No	714.2	6.6	No	Yes
9/21/2006	42,020	6.695	1.071	0.000	No	666.8	6.5	No	Yes
10/26/2006	42,914	6.911	1.028	0.000	No	648.6	6.5	No	Yes

String No.: 29

Serial No.: 05s105134

Cycle Installed:

12

Coordinates: 25

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 581

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.046	1.207	0.000	No	1,035.6	6.9	No	Yes

8/17/2006	3,829	1.223	1.270	0.000	No	993.0	6.9	No	Yes
10/26/2006	5,614	1.706	1.025	0.000	No	968.8	6.9	No	Yes
Level: B		LPRM ID No.: 589		Beginning of Life Calibration Current:			1,250.0		
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.041	1.165	0.000	No	1,073.0	7.0	No	Yes
5/4/2006	1,175	0.377	1.061	0.000	No	1,011.3	6.9	No	Yes
8/17/2006	3,829	1.193	0.915	0.000	No	1,105.2	7.0	No	Yes
10/26/2006	5,614	1.713	1.001	0.000	No	1,104.1	7.0	No	Yes
Level: C		LPRM ID No.: 597		Beginning of Life Calibration Current:			1,250.0		
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.029	1.032	0.000	No	1,250.0	7.1	No	Yes
5/4/2006	1,175	0.273	1.078	0.000	No	1,159.6	7.1	No	Yes
10/26/2006	5,614	1.354	0.963	0.000	No	1,204.1	7.1	No	Yes
Level: D		LPRM ID No.: 605		Beginning of Life Calibration Current:			1,250.0		
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/26/2006	5,614	1.023	0.993	0.000	No	1,258.8	7.1	No	Yes
String No.: 30		Serial No.: 05s105125		Cycle Installed:			12		
Coordinates: 25		Type: NA300		Cumulative Core Average Exposure at BOC:			0		
Level: A		LPRM ID No.: 582		Beginning of Life Calibration Current:			1,250.0		
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.040	1.176	0.000	No	1,062.9	7.0	No	Yes
8/17/2006	3,829	1.149	1.263	0.000	No	989.7	6.9	No	Yes
10/26/2006	5,614	1.687	1.044	0.000	No	948.0	6.9	No	Yes
Level: B		LPRM ID No.: 590		Beginning of Life Calibration Current:			1,250.0		
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.036	1.125	0.000	No	1,111.1	7.0	No	Yes

10/26/2006	5,614	1.628	1.023	0.000	No	1,086.1	7.0	No	Yes
Level: C		LPRM ID No.: 598		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.026	1.061	0.000	No	1,178.1	7.1	No	Yes
5/4/2006	1,175	0.242	1.059	0.000	No	1,112.5	7.0	No	Yes
7/13/2006	2,933	0.634	0.947	0.000	No	1,174.8	7.1	No	Yes
9/21/2006	4,720	1.038	0.905	0.000	No	1,298.1	7.2	No	Yes
10/26/2006	5,614	1.234	0.964	0.000	No	1,346.6	7.2	No	Yes
Level: D		LPRM ID No.: 606		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/4/2006	1,175	0.165	1.068	0.000	No	1,170.4	7.1	No	Yes
10/26/2006	5,614	0.853	0.935	0.000	No	1,251.8	7.1	No	Yes
String No.: 31		Serial No.: 95S01703		Cycle Installed:				8	
Coordinates: 25		Type: NA300		Cumulative Core Average Exposure at BOC:				67,204	
Level: A		LPRM ID No.: 74		Beginning of Life Calibration Current:				1,349.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.387	1.078	0.000	Yes	1,234.0	7.1	No	Yes
8/25/1998	2,824	0.507	1.059	0.000	No	1,165.3	7.1	No	Yes
9/29/1998	3,685	0.660	1.049	0.000	No	1,110.8	7.0	No	Yes
11/30/1999	12,553	2.016	1.059	0.000	No	1,048.9	7.0	No	Yes
9/28/2000	20,178	3.631	1.084	0.000	No	967.7	6.9	No	Yes
4/26/2001	25,440	4.911	1.068	0.000	No	906.0	6.8	No	Yes
2/14/2002	30,091	6.336	1.091	0.000	No	753.6	6.6	No	Yes
6/6/2002	30,127	6.866	1.023	0.000	No	709.0	6.6	No	Yes
11/15/2001	30,692	6.038	1.102	0.000	No	822.2	6.7	No	Yes
9/19/2002	32,803	7.491	1.093	0.000	No	648.7	6.5	No	Yes
1/16/2003	35,824	8.116	1.075	0.000	No	603.4	6.4	No	Yes
4/10/2003	37,948	8.723	1.073	0.000	No	562.4	6.3	No	Yes
6/19/2003	39,632	9.280	1.051	0.000	No	535.1	6.3	No	Yes
7/30/2003	40,696	9.608	1.015	0.000	No	535.0	6.3	No	Yes
10/16/2003	42,693	10.055	1.080	0.000	No	495.4	6.2	No	Yes

2/19/2004	48,858	10.563	1.056	0.000	No	469.1	6.2	No	Yes
3/25/2004	49,747	10.730	1.062	0.000	No	441.7	6.1	No	Yes
7/15/2004	52,604	11.272	1.068	0.000	No	413.6	6.0	No	Yes
10/28/2004	55,295	11.902	1.055	0.000	No	392.0	6.0	No	Yes
1/12/2006	66,544	14.125	0.947	0.000	No	414.0	6.0	No	Yes
3/24/2006	67,331	14.274	1.147	0.000	No	360.9	5.9	No	Yes
5/4/2006	68,379	14.533	1.077	0.000	No	335.1	5.8	No	Yes
9/21/2006	71,924	15.263	1.079	0.000	No	310.6	5.7	No	Yes
10/26/2006	72,818	15.431	1.003	0.000	No	309.6	5.7	No	Yes

Level: B

LPRM ID No.: 160

Beginning of Life Calibration Current:

1,571.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	1,276	0.514	1.031	0.000	Yes	1,461.0	7.3	Yes
8/25/1998	2,824	0.630	1.097	0.000	No	1,331.8	7.2	Yes
9/29/1998	3,685	0.831	0.999	0.000	No	1,333.1	7.2	Yes
4/15/1999	8,305	1.849	1.049	0.000	No	1,270.9	7.1	Yes
8/4/1999	10,769	2.326	1.049	0.000	No	1,211.5	7.1	Yes
11/30/1999	12,553	2.627	1.094	0.000	No	1,107.4	7.0	Yes
11/4/2000	21,053	4.500	1.063	0.000	No	1,041.8	6.9	Yes
2/22/2001	23,810	5.114	1.101	0.000	No	946.2	6.9	Yes
6/7/2001	26,529	5.642	1.063	0.000	No	890.1	6.8	Yes
10/18/2001	29,968	6.392	1.069	0.000	No	832.7	6.7	Yes
2/14/2002	30,091	6.911	1.168	0.000	No	671.3	6.5	Yes
6/6/2002	30,127	7.505	0.995	0.000	No	625.0	6.4	Yes
12/20/2001	31,587	6.752	1.062	0.000	No	784.1	6.7	Yes
9/19/2002	32,803	8.154	1.076	0.000	No	580.9	6.4	Yes
1/16/2003	35,824	8.906	1.086	0.000	No	534.9	6.3	Yes
6/19/2003	39,632	9.868	1.068	0.000	No	500.8	6.2	Yes
7/30/2003	40,696	10.140	1.022	0.000	No	501.0	6.2	Yes
9/11/2003	41,791	10.400	1.055	0.000	No	474.9	6.2	Yes
11/20/2003	43,598	10.796	1.052	0.000	No	451.4	6.1	Yes
12/30/2003	44,525	11.017	1.019	0.000	No	443.0	6.1	Yes
3/24/2006	67,331	15.050	1.537	0.000	No	293.7	5.7	Yes
7/13/2006	70,137	15.690	1.055	0.000	No	278.4	5.6	Yes
10/26/2006	72,818	16.259	1.054	0.000	No	264.1	5.6	Yes

Level: C

LPRM ID No.: 246

Beginning of Life Calibration Current:

1,368.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
-------	---------	--	----------	------------	--	--	--	------

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.440	1.023	0.000	Yes	1,292.0	7.2	No	Yes
8/25/1998	2,824	0.514	1.113	0.000	No	1,160.8	7.1	No	Yes
9/29/1998	3,685	0.674	0.983	0.000	No	1,180.9	7.1	No	Yes
11/24/1999	12,417	2.432	1.128	0.000	No	1,046.9	7.0	No	Yes
3/8/2000	14,988	2.857	1.062	0.000	No	985.8	6.9	No	Yes
2/22/2001	23,810	4.400	1.070	0.000	No	921.3	6.8	No	Yes
6/7/2001	26,529	5.024	1.080	0.000	No	853.0	6.7	No	Yes
9/13/2001	29,065	5.592	1.058	0.000	No	806.3	6.7	No	Yes
2/14/2002	30,091	6.288	1.192	0.000	No	639.3	6.5	No	Yes
11/15/2001	30,692	5.947	1.058	0.000	No	762.1	6.6	No	Yes
9/19/2002	32,803	7.017	1.069	0.000	No	598.1	6.4	No	Yes
4/10/2003	37,948	7.827	1.051	0.000	No	569.0	6.3	No	Yes
7/30/2003	40,696	8.284	1.047	0.000	No	569.0	6.3	No	Yes
9/11/2003	41,791	8.506	1.082	0.000	No	525.9	6.3	No	Yes
11/20/2003	43,598	8.924	1.067	0.000	No	492.9	6.2	No	Yes
2/19/2004	48,858	9.271	1.098	0.000	No	448.9	6.1	No	Yes
10/28/2004	55,295	10.438	1.065	0.000	No	421.5	6.0	No	Yes
12/9/2004	56,362	10.643	1.054	0.000	No	399.9	6.0	No	Yes
5/31/2005	60,796	11.499	1.065	0.000	No	375.5	5.9	No	Yes
10/20/2005	64,419	12.219	1.069	0.000	No	351.0	5.9	No	Yes
3/24/2006	67,331	12.945	1.105	0.000	No	317.6	5.8	No	Yes
7/13/2006	70,137	13.449	1.061	0.000	No	299.4	5.7	No	Yes
10/26/2006	72,818	13.909	1.006	0.000	No	297.6	5.7	No	Yes

Level: D

LPRM ID No.: 332

Beginning of Life Calibration Current:

1,382.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.298	0.974	0.000	Yes	1,369.0	7.2	No	Yes
8/25/1998	2,824	0.323	1.123	0.000	No	1,219.1	7.1	No	Yes
9/29/1998	3,685	0.422	0.987	0.000	No	1,235.1	7.1	No	Yes
11/30/1999	12,553	1.716	1.124	0.000	No	1,098.9	7.0	No	Yes
2/14/2002	30,091	4.175	1.242	0.000	No	839.4	6.7	No	Yes
11/15/2001	30,692	3.922	1.054	0.000	No	1,042.6	6.9	No	Yes
12/5/2002	34,770	4.548	0.949	0.000	No	884.5	6.8	No	Yes
1/16/2003	35,824	4.620	1.051	0.000	No	841.6	6.7	No	Yes
7/30/2003	40,696	4.944	0.968	0.000	No	842.0	6.7	No	Yes
12/30/2003	44,525	5.374	1.074	0.000	No	784.0	6.7	No	Yes

6/17/2004	51,904	5.763	1.059	0.000	No	740.3	6.6	No	Yes
12/9/2004	56,362	6.324	1.090	0.000	No	679.2	6.5	No	Yes
4/21/2005	59,777	6.908	1.061	0.000	No	640.1	6.5	No	Yes
8/4/2005	62,455	7.334	1.070	0.000	No	598.3	6.4	No	Yes
12/1/2005	65,471	7.937	1.070	0.000	No	559.1	6.3	No	Yes
3/24/2006	67,331	8.402	1.091	0.000	No	513.0	6.2	No	Yes
8/17/2006	71,033	8.877	1.054	0.000	No	486.7	6.2	No	Yes
9/21/2006	71,924	8.996	0.939	0.000	No	518.3	6.3	No	Yes
10/26/2006	72,818	9.115	1.004	0.000	No	516.3	6.2	No	Yes

String No.: 32		Serial No.: 05s105130		Cycle Installed:		12			
Coordinates: 17		Type: NA300		Cumulative Core Average Exposure at BOC:		0			
Level: A		LPRM ID No.: 583		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.035	1.087	0.000	No	1,150.0	7.0	No	Yes
5/4/2006	1,175	0.305	1.088	0.000	No	1,056.9	7.0	No	Yes
10/26/2006	5,614	1.341	1.003	0.000	No	1,053.8	7.0	No	Yes
Level: B		LPRM ID No.: 591		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/4/2006	1,175	0.278	1.067	0.000	No	1,171.5	7.1	No	Yes
10/26/2006	5,614	1.294	0.992	0.000	No	1,181.0	7.1	No	Yes
Level: C		LPRM ID No.: 599		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.021	1.096	0.000	No	1,140.5	7.0	No	Yes
10/26/2006	5,614	1.026	1.028	0.000	No	1,109.4	7.0	No	Yes
Level: D		LPRM ID No.: 607		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/26/2006	5,614	0.756	0.951	0.000	No	1,314.4	7.2	No	Yes

String No.: 33		Serial No.: 00s19545		Cycle Installed:		10			
Coordinates: 17		Type: NA300		Cumulative Core Average Exposure at BOC:		37,300			
Level: A		LPRM ID No.: 406		Beginning of Life Calibration Current:		700.0			
Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.062	1.158	0.000	No	1,079.0	7.0	No	Yes
8/15/2002	2,029	1.492	1.052	0.000	No	1,025.7	6.9	No	Yes
10/24/2002	3,799	2.036	1.106	0.000	No	927.4	6.8	No	Yes
1/16/2003	5,920	2.597	1.087	0.000	No	853.1	6.7	No	Yes
4/10/2003	8,044	3.270	1.132	0.000	No	753.7	6.6	No	Yes
6/19/2003	9,728	3.817	1.062	0.000	No	709.7	6.6	No	Yes
7/30/2003	10,792	4.106	1.055	0.000	No	672.7	6.5	No	Yes
12/30/2003	14,621	4.922	1.055	0.000	No	637.6	6.5	No	Yes
2/19/2004	18,954	5.013	1.091	0.000	No	584.4	6.4	No	Yes
5/6/2004	20,923	5.688	1.068	0.000	No	547.2	6.3	No	Yes
9/23/2004	24,490	6.775	1.062	0.000	No	515.3	6.2	No	Yes
2/3/2005	27,896	7.840	1.067	0.000	No	482.9	6.2	No	Yes
3/17/2005	28,969	8.233	1.052	0.000	No	459.0	6.1	No	Yes
12/1/2005	35,567	10.250	1.078	0.000	No	425.8	6.1	No	Yes
3/24/2006	37,427	10.685	1.181	0.000	No	360.6	5.9	No	Yes
10/26/2006	42,914	12.204	1.064	0.000	No	338.9	5.8	No	Yes
Level: B		LPRM ID No.: 414		Beginning of Life Calibration Current:		700.0			
Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.058	1.209	0.000	No	1,034.0	6.9	No	Yes
10/24/2002	3,799	1.990	1.084	0.000	No	953.9	6.9	No	Yes
1/16/2003	5,920	2.591	1.071	0.000	No	890.6	6.8	No	Yes
4/10/2003	8,044	3.181	1.098	0.000	No	811.1	6.7	No	Yes
7/30/2003	10,792	3.922	1.081	0.000	No	750.4	6.6	No	Yes
10/16/2003	12,789	4.418	1.078	0.000	No	696.1	6.5	No	Yes
2/19/2004	18,954	5.037	1.209	0.000	No	575.7	6.4	No	Yes
7/15/2004	22,700	6.179	1.074	0.000	No	536.1	6.3	No	Yes
12/9/2004	26,458	7.178	1.061	0.000	No	505.3	6.2	No	Yes
5/31/2005	30,892	8.321	1.088	0.000	No	464.4	6.1	No	Yes
10/20/2005	34,515	9.331	1.080	0.000	No	430.0	6.1	No	Yes
1/12/2006	36,640	9.883	1.018	0.000	No	407.0	6.0	No	Yes
3/24/2006	37,427	10.189	1.086	0.000	No	374.8	5.9	No	Yes

8/17/2006	41,129	11.235	1.074	0.000	No	348.9	5.9	No	Yes
10/26/2006	42,914	11.726	1.031	0.000	No	338.5	5.8	No	Yes

Level: C

LPRM ID No.: 422

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/14/2002	187	0.037	1.122	0.000	No	1,114.0	7.0	No	Yes
8/15/2002	2,029	0.944	0.937	0.000	No	1,188.9	7.1	No	Yes
6/19/2003	9,728	2.685	1.058	0.000	No	1,123.7	7.0	No	Yes
7/30/2003	10,792	2.924	1.038	0.000	No	1,124.0	7.0	No	Yes
9/11/2003	11,887	3.191	1.070	0.000	No	1,050.5	7.0	No	Yes
11/20/2003	13,694	3.689	1.071	0.000	No	980.8	6.9	No	Yes
2/19/2004	18,954	4.140	1.134	0.000	No	864.9	6.8	No	Yes
5/6/2004	20,923	4.606	1.064	0.000	No	812.9	6.7	No	Yes
7/15/2004	22,700	5.016	1.071	0.000	No	759.0	6.6	No	Yes
1/6/2005	27,179	6.015	1.089	0.000	No	697.0	6.5	No	Yes
4/21/2005	29,873	6.618	1.054	0.000	No	661.3	6.5	No	Yes
8/4/2005	32,551	7.275	1.061	0.000	No	623.3	6.4	No	Yes
10/20/2005	34,515	7.847	1.088	0.000	No	573.0	6.4	No	Yes
12/1/2005	35,567	8.132	1.053	0.000	No	544.2	6.3	No	Yes
3/24/2006	37,427	8.794	1.088	0.000	No	500.1	6.2	No	Yes
6/8/2006	39,339	9.230	1.091	0.000	No	458.4	6.1	No	Yes
10/26/2006	42,914	10.104	1.018	0.000	No	450.3	6.1	No	Yes

Level: D

LPRM ID No.: 430

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
2/14/2002	187	0.013	1.023	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.093	1.064	0.000	No	1,174.8	7.1	No	Yes
10/24/2002	3,799	0.516	0.946	0.000	No	1,241.9	7.1	No	Yes
2/26/2003	6,974	0.868	0.944	0.000	No	1,315.5	7.2	No	Yes
4/10/2003	8,044	0.981	1.057	0.000	No	1,244.6	7.1	No	Yes
5/15/2003	8,890	1.076	0.929	0.000	No	1,339.7	7.2	No	Yes
7/30/2003	10,792	1.310	0.983	0.000	No	1,340.0	7.2	No	Yes
5/6/2004	20,923	2.320	1.072	0.000	No	1,238.0	7.1	No	Yes
9/15/2005	33,614	4.411	1.339	0.000	No	922.0	6.8	No	Yes
10/20/2005	34,515	4.634	1.080	0.000	No	854.0	6.7	No	Yes
1/12/2006	36,640	5.146	1.014	0.000	No	797.0	6.7	No	Yes
6/8/2006	39,339	5.724	1.056	0.000	No	754.7	6.6	No	Yes

10/26/2006	42,914	6.408	1.056	0.000	No	714.7	6.6	No	Yes
------------	--------	-------	-------	-------	----	-------	-----	----	-----

String No.: 34	Serial No.: 03s61360	Cycle Installed:	11
Coordinates: 17	Type: NA300	Cumulative Core Average Exposure at BOC:	18,500
Level: A	LPRM ID No.: 504	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.334	1.135	0.000	No	1,101.3	7.0	No	Yes
6/17/2004	3,200	1.089	1.059	0.000	No	1,040.0	6.9	No	Yes
7/15/2004	3,900	1.332	0.939	0.000	No	1,107.5	7.0	No	Yes
8/12/2004	4,620	1.577	1.071	0.000	No	1,034.1	6.9	No	Yes
3/24/2006	18,627	5.709	1.192	0.000	No	867.5	6.8	No	Yes
5/4/2006	19,675	6.013	0.906	0.000	No	957.5	6.9	No	Yes
7/13/2006	21,433	6.546	1.135	0.000	No	843.7	6.7	No	Yes
10/26/2006	24,114	7.373	1.007	0.000	No	837.8	6.7	No	Yes

Level: B	LPRM ID No.: 514	Beginning of Life Calibration Current:	1,250.0
----------	------------------	--	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/6/2004	2,123	0.665	0.927	0.000	No	1,348.4	7.2	No	Yes
8/12/2004	4,620	1.417	0.940	0.000	No	1,434.5	7.3	No	Yes
12/9/2004	7,658	2.251	0.947	0.000	No	1,514.8	7.3	No	Yes
1/12/2006	17,840	4.985	1.016	0.000	No	1,441.0	7.3	No	Yes
3/24/2006	18,627	5.297	1.197	0.000	No	1,203.8	7.1	No	Yes
10/26/2006	24,114	6.962	1.021	0.000	No	1,179.1	7.1	No	Yes

Level: C	LPRM ID No.: 524	Beginning of Life Calibration Current:	1,250.0
----------	------------------	--	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/17/2004	3,200	0.760	0.918	0.000	No	1,361.7	7.2	No	Yes
12/9/2004	7,658	1.811	0.935	0.000	No	1,456.3	7.3	No	Yes
1/12/2006	17,840	4.490	1.038	0.000	No	1,339.0	7.2	No	Yes
3/24/2006	18,627	4.838	1.114	0.000	No	1,202.0	7.1	No	Yes
10/26/2006	24,114	6.199	1.038	0.000	No	1,158.0	7.1	No	Yes

Level: D	LPRM ID No.: 534	Beginning of Life Calibration Current:	1,250.0
----------	------------------	--	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good
-------	---------	----------	------------	--	--	------

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/6/2004	2,123	0.231	0.936	0.000	No	1,335.5	7.2	No	Yes
7/15/2004	3,900	0.455	1.063	0.000	No	1,256.3	7.1	No	Yes
8/12/2004	4,620	0.566	0.948	0.000	No	1,325.2	7.2	No	Yes
10/28/2004	6,591	0.854	0.938	0.000	No	1,412.8	7.3	No	Yes
12/9/2004	7,658	1.016	1.052	0.000	No	1,343.0	7.2	No	Yes
2/3/2005	9,096	1.274	0.917	0.000	No	1,464.6	7.3	No	Yes
1/12/2006	17,840	3.112	1.052	0.000	No	1,392.2	7.2	No	Yes
5/4/2006	19,675	3.580	1.070	0.000	No	1,301.1	7.2	No	Yes
10/26/2006	24,114	4.484	0.974	0.000	No	1,335.8	7.2	No	Yes

String No.: 35 Serial No.: 99S06334 Cycle Installed: 9
Coordinates: 17 Type: NA300 Cumulative Core Average Exposure at BOC: 54,800
Level: A LPRM ID No.: 349 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.024	1.063	0.000	No	1,175.9	7.1	No	Yes
4/12/2000	3,445	0.655	0.949	0.000	No	1,239.1	7.1	No	Yes
4/26/2001	13,036	2.862	1.073	0.000	No	1,155.0	7.1	No	Yes
2/14/2002	17,687	4.486	1.072	0.000	No	1,014.5	6.9	No	Yes
6/6/2002	17,723	5.332	0.976	0.000	No	941.0	6.8	No	Yes
11/15/2001	18,288	4.105	1.062	0.000	No	1,087.6	7.0	No	Yes
10/24/2002	21,299	6.266	1.064	0.000	No	884.4	6.8	No	Yes
4/10/2003	25,544	7.519	1.101	0.000	No	803.3	6.7	No	Yes
6/19/2003	27,228	8.113	1.055	0.000	No	761.4	6.6	No	Yes
7/30/2003	28,292	8.383	1.038	0.000	No	761.0	6.6	No	Yes
10/16/2003	30,289	8.896	1.058	0.000	No	719.3	6.6	No	Yes
12/30/2003	32,121	9.284	1.054	0.000	No	682.4	6.5	No	Yes
2/19/2004	36,454	9.380	1.054	0.000	No	647.5	6.5	No	Yes
7/15/2004	40,200	10.554	1.132	0.000	No	572.0	6.3	No	Yes
9/23/2004	41,990	11.198	1.059	0.000	No	540.1	6.3	No	Yes
4/21/2005	47,373	13.124	1.093	0.000	No	494.1	6.2	No	Yes
5/31/2005	48,392	13.503	1.090	0.000	No	453.3	6.1	No	Yes
1/12/2006	54,140	14.901	1.065	0.000	No	425.7	6.1	No	Yes
3/24/2006	54,927	15.120	1.091	0.000	No	390.2	6.0	No	Yes
6/8/2006	56,839	15.757	1.069	0.000	No	365.0	5.9	No	Yes

10/26/2006	60,414	16.795	1.027	0.000	No	355.4	5.9	No	Yes
Level: B		LPRM ID No.: 355		Beginning of Life Calibration Current:				1,250.0	
Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/30/1999	149	0.035	1.082	0.000	No	1,155.3	7.1	No	Yes
10/18/2001	17,564	4.172	1.074	0.000	No	1,086.0	7.0	No	Yes
2/14/2002	17,687	4.794	1.097	0.000	No	990.0	6.9	No	Yes
6/6/2002	17,723	5.613	1.002	0.000	No	930.0	6.8	No	Yes
9/19/2002	20,399	6.349	1.063	0.000	No	874.9	6.8	No	Yes
1/16/2003	23,420	7.155	1.068	0.000	No	819.2	6.7	No	Yes
4/10/2003	25,544	7.811	1.083	0.000	No	756.4	6.6	No	Yes
7/30/2003	28,292	8.545	1.054	0.000	No	717.6	6.6	No	Yes
10/16/2003	30,289	9.073	1.066	0.000	No	673.2	6.5	No	Yes
2/19/2004	36,454	9.680	1.187	0.000	No	567.2	6.3	No	Yes
6/17/2004	39,500	10.559	1.067	0.000	No	531.5	6.3	No	Yes
8/12/2004	40,920	10.998	1.052	0.000	No	505.3	6.2	No	Yes
1/6/2005	44,679	12.095	1.073	0.000	No	470.9	6.2	No	Yes
3/17/2005	46,469	12.570	1.058	0.000	No	445.1	6.1	No	Yes
9/15/2005	51,114	13.892	1.074	0.000	No	414.0	6.0	No	Yes
1/12/2006	54,140	14.666	1.088	0.000	No	380.5	5.9	No	Yes
3/24/2006	54,927	14.986	1.082	0.000	No	351.7	5.9	No	Yes
6/8/2006	56,839	15.595	1.059	0.000	No	332.1	5.8	No	Yes
9/21/2006	59,520	16.417	1.059	0.000	No	313.6	5.7	No	Yes
10/26/2006	60,414	16.676	1.018	0.000	No	308.0	5.7	No	Yes

Level: C		LPRM ID No.: 361		Beginning of Life Calibration Current:				1,250.0	
Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/24/1999	13	0.002	1.096	0.000	No	1,140.5	7.0	No	Yes
11/30/1999	149	0.029	1.067	0.000	No	1,068.9	7.0	No	Yes
5/10/2000	4,136	0.793	0.989	0.000	No	1,080.8	7.0	No	Yes
12/7/2000	9,499	1.818	1.050	0.000	No	1,018.0	6.9	No	Yes
2/22/2001	11,406	2.168	1.066	0.000	No	955.0	6.9	No	Yes
4/26/2001	13,036	2.456	1.055	0.000	No	905.2	6.8	No	Yes
9/13/2001	16,661	3.214	1.085	0.000	No	834.3	6.7	No	Yes
10/18/2001	17,564	3.459	1.057	0.000	No	789.3	6.7	No	Yes
2/14/2002	17,687	4.108	1.078	0.000	No	681.7	6.5	No	Yes
6/6/2002	17,723	4.686	0.999	0.000	No	635.0	6.5	No	Yes

12/20/2001	19,183	3.921	1.074	0.000	No	734.9	6.6	No	Yes
8/15/2002	19,529	5.094	1.054	0.000	No	602.5	6.4	No	Yes
12/5/2002	22,366	5.820	1.083	0.000	No	556.3	6.3	No	Yes
4/10/2003	25,544	6.557	1.068	0.000	No	520.9	6.3	No	Yes
7/30/2003	28,292	7.096	1.054	0.000	No	494.2	6.2	No	Yes
10/16/2003	30,289	7.606	1.070	0.000	No	461.9	6.1	No	Yes
12/30/2003	32,121	8.161	1.053	0.000	No	438.6	6.1	No	Yes
2/19/2004	36,454	8.308	1.112	0.000	No	394.4	6.0	No	Yes
8/12/2004	40,920	9.329	1.065	0.000	No	370.4	5.9	No	Yes
2/3/2005	45,396	10.414	1.078	0.000	No	343.6	5.8	No	Yes
8/4/2005	50,051	11.553	1.078	0.000	No	318.7	5.8	No	Yes
1/12/2006	54,140	12.741	1.065	0.000	No	299.3	5.7	No	Yes
3/24/2006	54,927	13.100	1.143	0.000	No	261.8	5.6	No	Yes
8/17/2006	58,629	14.029	1.057	0.000	No	247.7	5.5	No	Yes
10/26/2006	60,414	14.461	1.021	0.000	No	242.6	5.5	No	Yes

Level: D

LPRM ID No.: 367

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
11/24/1999	13	0.001	1.167	0.000	No	1,071.1	7.0	No	Yes
11/30/1999	149	0.022	1.069	0.000	No	1,002.0	6.9	No	Yes
12/27/1999	816	0.126	1.050	0.000	No	954.3	6.9	No	Yes
6/14/2000	5,029	0.738	0.946	0.000	No	1,008.7	6.9	No	Yes
1/18/2001	10,585	1.749	1.061	0.000	No	950.7	6.9	No	Yes
4/26/2001	13,036	2.108	1.074	0.000	No	885.2	6.8	No	Yes
9/13/2001	16,661	2.763	1.081	0.000	No	818.9	6.7	No	Yes
2/14/2002	17,687	3.418	1.059	0.000	No	694.8	6.5	No	Yes
11/15/2001	18,288	3.102	1.052	0.000	No	778.4	6.7	No	Yes
12/20/2001	19,183	3.294	1.058	0.000	No	735.8	6.6	No	Yes
8/15/2002	19,529	3.789	1.076	0.000	No	645.7	6.5	No	Yes
7/30/2003	28,292	4.696	1.011	0.000	No	646.0	6.5	No	Yes
9/11/2003	29,387	4.859	1.096	0.000	No	589.4	6.4	No	Yes
2/19/2004	36,454	5.460	1.086	0.000	No	542.7	6.3	No	Yes
6/17/2004	39,500	5.783	1.070	0.000	No	507.2	6.2	No	Yes
8/12/2004	40,920	5.995	1.053	0.000	No	481.7	6.2	No	Yes
9/23/2004	41,990	6.159	0.914	0.000	No	527.0	6.3	No	Yes
12/9/2004	43,958	6.457	1.072	0.000	No	491.6	6.2	No	Yes
6/30/2005	49,160	7.349	1.090	0.000	No	451.0	6.1	No	Yes

1/12/2006	54,140	8.554	1.000	0.000	No	413.0	6.0	No	Yes
3/24/2006	54,927	8.877	1.057	0.000	No	390.7	6.0	No	Yes
7/13/2006	57,733	9.351	1.073	0.000	No	364.1	5.9	No	Yes
10/26/2006	60,414	9.953	1.040	0.000	No	350.1	5.9	No	Yes

String No.: 36		Serial No.: 03s61365		Cycle Installed:		11			
Coordinates: 17		Type: NA300		Cumulative Core Average Exposure at BOC:		18,500			
Level: A		LPRM ID No.: 505		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?		Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.349	1.130	0.000	No	1,106.2	7.0	No	Yes
7/15/2004	3,900	1.363	0.921	0.000	No	1,201.1	7.1	No	Yes
3/24/2006	18,627	5.854	1.239	0.000	No	956.0	6.9	No	Yes
9/21/2006	23,220	7.109	1.082	0.000	No	894.0	6.8	No	Yes
10/26/2006	24,114	7.390	1.033	0.000	No	865.4	6.8	No	Yes
Level: B		LPRM ID No.: 515		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?		Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/23/2004	5,690	1.697	0.945	0.000	No	1,322.8	7.2	No	Yes
1/6/2005	8,379	2.419	0.946	0.000	No	1,398.3	7.2	No	Yes
1/12/2006	17,840	5.015	1.001	0.000	No	1,396.9	7.2	No	Yes
Level: C		LPRM ID No.: 525		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?		Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/23/2004	5,690	1.335	0.929	0.000	No	1,345.5	7.2	No	Yes
1/6/2005	8,379	1.930	0.936	0.000	No	1,437.5	7.3	No	Yes
9/15/2005	14,814	3.502	0.935	0.000	No	1,537.5	7.3	No	Yes
3/24/2006	18,627	4.742	1.478	0.000	No	1,040.2	6.9	No	Yes
10/26/2006	24,114	6.071	0.985	0.000	No	1,056.1	7.0	No	Yes
Level: D		LPRM ID No.: 535		Beginning of Life Calibration Current:		1,250.0			
Total	Pre-Cal		Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?		Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.117	0.923	0.000	No	1,354.3	7.2	No	Yes

6/17/2004	3,200	0.385	1.053	0.000	No	1,286.1	7.2	No	Yes
10/28/2004	6,591	0.914	0.934	0.000	No	1,377.0	7.2	No	Yes
3/17/2005	10,169	1.499	0.940	0.000	No	1,464.9	7.3	No	Yes
10/20/2005	15,715	2.633	0.945	0.000	No	1,550.0	7.3	No	Yes
3/24/2006	18,627	3.469	1.253	0.000	No	1,237.0	7.1	No	Yes
10/26/2006	24,114	4.474	0.992	0.000	No	1,247.0	7.1	No	Yes

String No.: 37		Serial No.: 00s19548		Cycle Installed:		10			
Coordinates: 17		Type: NA300		Cumulative Core Average Exposure at BOC:		37,300			
Level: A		LPRM ID No.: 407		Beginning of Life Calibration Current:		700.0			
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.058	1.156	0.000	No	1,081.0	7.0	No	Yes
6/6/2002	223	0.818	1.055	0.000	No	1,024.6	6.9	No	Yes
10/24/2002	3,799	1.961	1.067	0.000	No	960.3	6.9	No	Yes
2/26/2003	6,974	3.006	1.067	0.000	No	900.0	6.8	No	Yes
4/10/2003	8,044	3.420	1.083	0.000	No	831.0	6.7	No	Yes
6/19/2003	9,728	4.053	1.099	0.000	No	756.2	6.6	No	Yes
7/30/2003	10,792	4.394	1.048	0.000	No	756.0	6.6	No	Yes
9/11/2003	11,887	4.672	1.080	0.000	No	700.0	6.6	No	Yes
12/30/2003	14,621	5.198	1.062	0.000	No	659.1	6.5	No	Yes
5/6/2004	20,923	5.903	1.128	0.000	No	584.3	6.4	No	Yes
9/23/2004	24,490	7.004	1.061	0.000	No	550.7	6.3	No	Yes
2/3/2005	27,896	7.953	1.053	0.000	No	523.0	6.3	No	Yes
5/31/2005	30,892	8.778	1.062	0.000	No	492.5	6.2	No	Yes
3/24/2006	37,427	10.494	1.183	0.000	No	416.3	6.0	No	Yes
6/8/2006	39,339	11.124	1.059	0.000	No	393.1	6.0	No	Yes
9/21/2006	42,020	11.923	1.063	0.000	No	369.8	5.9	No	Yes
10/26/2006	42,914	12.139	0.995	0.000	No	371.7	5.9	No	Yes
Level: B		LPRM ID No.: 415		Beginning of Life Calibration Current:		700.0			
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.054	1.125	0.000	No	1,111.0	7.0	No	Yes
12/5/2002	4,866	2.212	1.092	0.000	No	1,017.4	6.9	No	Yes
2/26/2003	6,974	2.853	1.090	0.000	No	933.4	6.8	No	Yes
5/15/2003	8,890	3.421	1.079	0.000	No	865.1	6.8	No	Yes
7/30/2003	10,792	3.973	1.086	0.000	No	796.6	6.7	No	Yes

11/20/2003	13,694	4.700	1.081	0.000	No	736.9	6.6	No	Yes
2/19/2004	18,954	5.068	1.153	0.000	No	639.1	6.5	No	Yes
6/17/2004	22,000	5.965	1.055	0.000	No	605.8	6.4	No	Yes
10/28/2004	25,391	6.861	1.051	0.000	No	576.4	6.4	No	Yes
4/21/2005	29,873	7.880	1.056	0.000	No	545.8	6.3	No	Yes
8/4/2005	32,551	8.542	1.055	0.000	No	517.4	6.2	No	Yes
1/12/2006	36,640	9.571	1.054	0.000	No	490.8	6.2	No	Yes
3/24/2006	37,427	9.863	1.157	0.000	No	424.2	6.1	No	Yes
7/13/2006	40,233	10.658	1.051	0.000	No	403.7	6.0	No	Yes
10/26/2006	42,914	11.364	1.044	0.000	No	386.6	6.0	No	Yes

Level: C LPRM ID No.: 423

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.033	1.044	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.231	1.101	0.000	No	1,135.3	7.0	No	Yes
8/15/2002	2,029	0.830	0.929	0.000	No	1,222.1	7.1	No	Yes
2/26/2003	6,974	1.828	1.055	0.000	No	1,158.4	7.1	No	Yes
6/19/2003	9,728	2.349	1.061	0.000	No	1,091.8	7.0	No	Yes
7/30/2003	10,792	2.584	1.050	0.000	No	1,092.0	7.0	No	Yes
9/11/2003	11,887	2.844	1.068	0.000	No	1,022.5	6.9	No	Yes
1/6/2005	27,179	5.536	1.444	0.000	No	707.0	6.6	No	Yes
8/4/2005	32,551	6.656	1.062	0.000	No	665.7	6.5	No	Yes
12/1/2005	35,567	7.440	1.051	0.000	No	633.4	6.5	No	Yes
3/24/2006	37,427	8.067	1.226	0.000	No	516.7	6.2	No	Yes
8/17/2006	41,129	8.875	1.058	0.000	No	488.3	6.2	No	Yes
10/26/2006	42,914	9.221	1.013	0.000	No	482.1	6.2	No	Yes

Level: D LPRM ID No.: 431

Beginning of Life Calibration Current:

700.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.011	1.048	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.077	1.124	0.000	No	1,112.1	7.0	No	Yes
9/19/2002	2,899	0.352	0.949	0.000	No	1,171.9	7.1	No	Yes
4/10/2003	8,044	0.810	0.939	0.000	No	1,248.0	7.1	No	Yes
7/30/2003	10,792	1.070	0.987	0.000	No	1,248.0	7.1	No	Yes
3/25/2004	19,843	1.834	1.135	0.000	No	1,099.6	7.0	No	Yes
5/6/2004	20,923	1.946	0.937	0.000	No	1,173.5	7.1	No	Yes
8/12/2004	23,420	2.265	1.059	0.000	No	1,108.1	7.0	No	Yes

2/3/2005	27,896	2.886	1.036	0.000	No	1,069.6	7.0	No	Yes
4/21/2005	29,873	3.238	1.103	0.000	No	1,004.6	6.9	No	Yes
6/30/2005	31,660	3.555	1.055	0.000	No	952.3	6.9	No	Yes
9/15/2005	33,614	3.937	1.060	0.000	No	898.4	6.8	No	Yes
12/1/2005	35,567	4.391	1.068	0.000	No	841.2	6.7	No	Yes
3/24/2006	37,427	4.916	1.092	0.000	No	770.3	6.6	No	Yes
5/4/2006	38,475	5.046	1.054	0.000	No	730.8	6.6	No	Yes
10/26/2006	42,914	5.688	1.002	0.000	No	729.4	6.6	No	Yes

String No.: 38	Serial No.: 95S01706	Cycle Installed:	8
Coordinates: 17	Type: NA300	Cumulative Core Average Exposure at BOC:	67,204
Level: A	LPRM ID No.: 81	Beginning of Life Calibration Current:	1,143.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost					
				Corrected					
				CalCur					
				Byp.?					
				Value					
9/12/1996	1,276	0.253	1.072	0.000	Yes	1,045.0	7.0	No	Yes
8/25/1998	2,824	0.335	0.771	0.000	No	1,097.0	7.0	No	Yes
9/29/1998	3,685	0.439	1.044	0.000	No	1,050.8	7.0	No	Yes
6/24/1999	9,908	1.171	0.879	0.000	No	1,164.0	7.1	No	Yes
8/4/1999	10,769	1.271	1.077	0.000	No	1,178.0	7.1	No	Yes
9/17/1999	11,716	1.368	1.085	0.000	No	1,085.7	7.0	No	Yes
11/30/1999	12,553	1.448	1.101	0.000	No	986.1	6.9	No	Yes
9/28/2000	20,178	2.639	1.069	0.000	No	922.5	6.8	No	Yes
1/18/2001	22,989	3.140	1.067	0.000	No	864.5	6.8	No	Yes
7/7/2001	27,300	3.989	1.099	0.000	No	786.7	6.7	No	Yes
8/17/2001	28,366	4.212	1.060	0.000	No	742.1	6.6	No	Yes
2/14/2002	30,091	4.800	1.059	0.000	No	662.4	6.5	No	Yes
6/6/2002	30,127	5.211	1.052	0.000	No	629.6	6.4	No	Yes
11/15/2001	30,692	4.591	1.058	0.000	No	701.5	6.6	No	Yes
9/19/2002	32,803	5.666	1.051	0.000	No	564.0	6.3	No	Yes
7/30/2003	40,696	7.053	1.049	0.000	No	564.0	6.3	No	Yes
10/16/2003	42,693	7.301	1.094	0.000	No	527.0	6.3	No	Yes
5/6/2004	50,827	7.792	1.054	0.000	No	500.0	6.2	No	Yes
7/15/2004	52,604	8.004	1.052	0.000	No	489.0	6.2	No	Yes
6/30/2005	61,564	8.950	0.948	0.000	No	515.8	6.2	No	Yes
10/20/2005	64,419	9.214	0.919	0.000	No	561.0	6.3	No	Yes
1/12/2006	66,544	9.383	0.947	0.000	No	592.4	6.4	No	Yes
3/24/2006	67,331	9.463	1.244	0.000	No	476.2	6.2	No	Yes

10/26/2006	72,818	10.141	0.997	0.000	No	477.6	6.2	No	Yes
Level: B		LPRM ID No.: 167		Beginning of Life Calibration Current:				1,171.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.373	1.027	0.000	Yes	1,101.0	7.0	No	Yes
8/25/1998	2,824	0.472	0.995	0.000	No	1,106.5	7.0	No	Yes
9/29/1998	3,685	0.625	1.010	0.000	No	1,095.6	7.0	No	Yes
12/29/1998	5,733	0.976	0.886	0.000	No	1,236.5	7.1	No	Yes
6/24/1999	9,908	1.665	1.058	0.000	No	1,168.8	7.1	No	Yes
11/30/1999	12,553	2.030	1.115	0.000	No	1,048.2	7.0	No	Yes
3/8/2000	14,988	2.470	1.063	0.000	No	986.1	6.9	No	Yes
6/14/2000	17,433	2.925	1.069	0.000	No	922.4	6.8	No	Yes
8/24/2000	19,269	3.276	1.051	0.000	No	877.7	6.8	No	Yes
11/4/2000	21,053	3.624	1.069	0.000	No	819.0	6.7	No	Yes
1/18/2001	22,989	3.997	1.066	0.000	No	768.3	6.6	No	Yes
3/22/2001	24,535	4.291	1.074	0.000	No	715.4	6.6	No	Yes
6/7/2001	26,529	4.673	1.054	0.000	No	678.7	6.5	No	Yes
7/7/2001	27,300	4.820	1.054	0.000	No	643.9	6.5	No	Yes
8/17/2001	28,366	5.029	1.064	0.000	No	605.2	6.4	No	Yes
2/14/2002	30,091	5.728	1.123	0.000	No	538.9	6.3	No	Yes
8/15/2002	31,933	6.582	1.073	0.000	No	502.3	6.2	No	Yes
10/24/2002	33,703	6.933	1.056	0.000	No	475.6	6.2	No	Yes
4/10/2003	37,948	7.775	1.066	0.000	No	446.2	6.1	No	Yes
7/30/2003	40,696	8.310	1.082	0.000	No	412.4	6.0	No	Yes
2/19/2004	48,858	9.036	1.071	0.000	No	385.0	6.0	No	Yes
7/15/2004	52,604	9.620	1.051	0.000	No	366.3	5.9	No	Yes
3/17/2005	58,873	10.448	1.057	0.000	No	346.6	5.8	No	Yes
1/12/2006	66,544	11.314	0.957	0.000	No	376.0	5.9	No	Yes
3/24/2006	67,331	11.434	1.206	0.000	No	311.8	5.7	No	Yes
10/26/2006	72,818	12.258	1.036	0.000	No	300.9	5.7	No	Yes
Level: C		LPRM ID No.: 253		Beginning of Life Calibration Current:				1,153.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.339	0.993	0.000	Yes	1,084.0	7.0	No	Yes
8/25/1998	2,824	0.397	1.005	0.000	No	1,078.6	7.0	No	Yes
9/29/1998	3,685	0.521	0.994	0.000	No	1,085.1	7.0	No	Yes
2/4/1999	6,618	0.956	0.976	0.000	No	1,111.8	7.0	No	Yes

3/11/1999	7,477	1.084	0.977	0.000	No	1,085.0	7.0	No	Yes
11/30/1999	12,553	1.898	1.056	0.000	No	1,027.5	6.9	No	Yes
4/12/2000	15,849	2.385	1.052	0.000	No	976.7	6.9	No	Yes
11/4/2000	21,053	3.138	1.054	0.000	No	926.6	6.8	No	Yes
2/22/2001	23,810	3.591	1.082	0.000	No	856.4	6.8	No	Yes
6/7/2001	26,529	4.056	1.069	0.000	No	801.1	6.7	No	Yes
8/17/2001	28,366	4.387	1.080	0.000	No	741.8	6.6	No	Yes
2/14/2002	30,091	5.098	1.082	0.000	No	648.6	6.5	No	Yes
11/15/2001	30,692	4.811	1.057	0.000	No	701.8	6.6	No	Yes
10/24/2002	33,703	5.850	1.059	0.000	No	612.5	6.4	No	Yes
7/30/2003	40,696	6.773	1.084	0.000	No	565.0	6.3	No	Yes
12/30/2003	44,525	7.438	1.057	0.000	No	534.5	6.3	No	Yes
10/28/2004	55,295	8.513	1.060	0.000	No	504.3	6.2	No	Yes
3/17/2005	58,873	9.028	1.054	0.000	No	478.4	6.2	No	Yes
8/4/2005	62,455	9.511	1.058	0.000	No	452.2	6.1	No	Yes
3/24/2006	67,331	10.295	1.091	0.000	No	414.5	6.0	No	Yes
10/26/2006	72,818	10.993	1.043	0.000	No	397.4	6.0	No	Yes

Level: D

LPRM ID No.: 339

Beginning of Life Calibration Current:

1,186.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
9/12/1996	1,276	0.223	0.995	0.000	Yes	1,142.0	7.0	No	Yes
8/25/1998	2,824	0.243	1.040	0.000	No	1,098.1	7.0	No	Yes
9/29/1998	3,685	0.317	0.985	0.000	No	1,114.8	7.0	No	Yes
11/30/1999	12,553	1.280	1.105	0.000	No	1,008.9	6.9	No	Yes
12/7/2000	21,903	2.076	1.051	0.000	No	959.9	6.9	No	Yes
4/26/2001	25,440	2.449	1.053	0.000	No	911.6	6.8	No	Yes
10/18/2001	29,968	3.007	1.055	0.000	No	864.1	6.8	No	Yes
2/14/2002	30,091	3.311	1.132	0.000	No	763.3	6.6	No	Yes
7/30/2003	40,696	3.986	1.025	0.000	No	763.0	6.6	No	Yes
12/30/2003	44,525	4.343	1.061	0.000	No	719.1	6.6	No	Yes
2/19/2004	48,858	4.396	0.924	0.000	No	778.3	6.7	No	Yes
8/12/2004	53,324	4.827	1.084	0.000	No	718.0	6.6	No	Yes
1/6/2005	57,083	5.257	1.068	0.000	No	672.3	6.5	No	Yes
6/30/2005	61,564	5.861	1.059	0.000	No	634.8	6.5	No	Yes
10/20/2005	64,419	6.278	1.060	0.000	No	599.0	6.4	No	Yes
6/8/2006	69,243	6.971	1.071	0.000	No	559.3	6.3	No	Yes
10/26/2006	72,818	7.360	0.991	0.000	No	564.4	6.3	No	Yes

String No.: 39		Serial No.: 05s105129		Cycle Installed:		12			
Coordinates: 9		Type: NA300		Cumulative Core Average Exposure at BOC:		0			
Level: A		LPRM ID No.: 584		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
5/4/2006	1,175	0.291	1.077	0.000	No	1,160.6	7.1	No	Yes
7/13/2006	2,933	0.694	1.054	0.000	No	1,101.2	7.0	No	Yes
8/17/2006	3,829	0.892	0.920	0.000	No	1,196.9	7.1	No	Yes
9/21/2006	4,720	1.085	1.093	0.000	No	1,095.1	7.0	No	Yes
10/26/2006	5,614	1.278	1.004	0.000	No	1,090.7	7.0	No	Yes
Level: B		LPRM ID No.: 592		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	127	0.030	1.088	0.000	No	1,148.9	7.0	No	Yes
5/4/2006	1,175	0.276	1.066	0.000	No	1,077.8	7.0	No	Yes
10/26/2006	5,614	1.283	0.974	0.000	No	1,106.5	7.0	No	Yes
Level: C		LPRM ID No.: 600		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
6/8/2006	2,039	0.364	1.060	0.000	No	1,179.2	7.1	No	Yes
10/26/2006	5,614	1.025	0.955	0.000	No	1,234.8	7.1	No	Yes
Level: D		LPRM ID No.: 608		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/16/2006	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
8/17/2006	3,829	0.515	1.051	0.000	No	1,189.3	7.1	No	Yes
9/21/2006	4,720	0.643	0.937	0.000	No	1,269.3	7.1	No	Yes
10/26/2006	5,614	0.762	0.981	0.000	No	1,293.9	7.2	No	Yes
String No.: 40		Serial No.: 95s01704		Cycle Installed:		9			
Coordinates: 9		Type: NA300		Cumulative Core Average Exposure at BOC:		54,800			
Level: A		LPRM ID No.: 350		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/24/1999	13	0.003	1.093	0.000	No	1,143.6	7.0	No	Yes
12/27/1999	816	0.212	1.062	0.000	No	1,076.9	7.0	No	Yes
6/14/2000	5,029	1.352	0.949	0.000	No	1,134.7	7.0	No	Yes
9/28/2000	7,774	2.095	1.069	0.000	No	1,061.5	7.0	No	Yes
2/22/2001	11,406	2.969	1.082	0.000	No	981.1	6.9	No	Yes
4/26/2001	13,036	3.393	1.074	0.000	No	913.5	6.8	No	Yes
6/7/2001	14,125	3.661	1.059	0.000	No	862.6	6.8	No	Yes
8/17/2001	15,962	4.157	1.088	0.000	No	792.8	6.7	No	Yes
10/18/2001	17,564	4.584	1.079	0.000	No	734.8	6.6	No	Yes
2/14/2002	17,687	5.159	1.083	0.000	No	678.4	6.5	No	Yes
6/6/2002	17,723	5.943	1.001	0.000	No	612.0	6.4	No	Yes
3/29/2002	18,770	5.490	1.052	0.000	No	644.9	6.5	No	Yes
8/15/2002	19,529	6.526	1.066	0.000	No	574.1	6.4	No	Yes
10/24/2002	21,299	7.025	1.077	0.000	No	533.1	6.3	No	Yes
2/26/2003	24,474	7.835	1.094	0.000	No	487.3	6.2	No	Yes
6/19/2003	27,228	8.724	1.090	0.000	No	447.0	6.1	No	Yes
7/30/2003	28,292	9.020	1.009	0.000	No	447.0	6.1	No	Yes
9/11/2003	29,387	9.284	1.060	0.000	No	421.7	6.0	No	Yes
6/17/2004	39,500	10.572	1.074	0.000	No	392.6	6.0	No	Yes
7/15/2004	40,200	10.731	0.941	0.000	No	417.3	6.0	No	Yes
9/23/2004	41,990	11.169	1.055	0.000	No	395.5	6.0	No	Yes
10/28/2004	42,891	11.446	1.121	0.000	No	352.8	5.9	No	Yes
12/9/2004	43,958	11.771	0.893	0.000	No	395.1	6.0	No	Yes
1/6/2005	44,679	11.944	1.101	0.000	No	358.8	5.9	No	Yes
2/3/2005	45,396	12.124	0.925	0.000	No	387.9	6.0	No	Yes
3/17/2005	46,469	12.486	1.052	0.000	No	368.8	5.9	No	Yes
5/31/2005	48,392	13.177	1.107	0.000	No	333.1	5.8	No	Yes
6/30/2005	49,160	13.441	0.942	0.000	No	353.6	5.9	No	Yes
8/4/2005	50,051	13.734	1.082	0.000	No	326.8	5.8	No	Yes
1/12/2006	54,140	14.802	0.969	0.000	No	303.0	5.7	No	Yes
8/17/2006	58,629	15.946	1.084	0.000	No	279.5	5.6	No	Yes
10/26/2006	60,414	16.443	1.049	0.000	No	266.5	5.6	No	Yes

Level: B

LPRM ID No.: 356

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
11/24/1999	13	0.004	1.080	0.000	No	1,157.4	7.1	No	Yes

4/26/2001	13,036	3.366	1.058	0.000	No	1,094.0	7.0	No	Yes
7/7/2001	14,896	3.817	1.061	0.000	No	1,031.1	6.9	No	Yes
9/13/2001	16,661	4.299	1.063	0.000	No	970.0	6.9	No	Yes
2/14/2002	17,687	5.187	1.073	0.000	No	859.3	6.8	No	Yes
6/6/2002	17,723	5.966	1.059	0.000	No	759.7	6.6	No	Yes
3/29/2002	18,770	5.512	1.068	0.000	No	804.6	6.7	No	Yes
12/20/2001	19,183	4.991	1.052	0.000	No	922.0	6.8	No	Yes
8/15/2002	19,529	6.514	1.072	0.000	No	708.7	6.6	No	Yes
10/24/2002	21,299	7.027	1.089	0.000	No	650.8	6.5	No	Yes
1/16/2003	23,420	7.606	1.073	0.000	No	606.5	6.4	No	Yes
4/10/2003	25,544	8.160	1.074	0.000	No	564.7	6.3	No	Yes
7/30/2003	28,292	8.863	1.087	0.000	No	519.5	6.3	No	Yes
10/16/2003	30,289	9.349	1.070	0.000	No	485.5	6.2	No	Yes
12/30/2003	32,121	9.770	1.068	0.000	No	454.6	6.1	No	Yes
2/19/2004	36,454	9.883	1.092	0.000	No	416.3	6.0	No	Yes
7/15/2004	40,200	10.789	1.053	0.000	No	395.4	6.0	No	Yes
1/6/2005	44,679	11.875	1.057	0.000	No	374.1	5.9	No	Yes
3/17/2005	46,469	12.300	1.051	0.000	No	355.9	5.9	No	Yes
8/4/2005	50,051	13.177	1.065	0.000	No	334.2	5.8	No	Yes
1/12/2006	54,140	14.251	1.053	0.000	No	300.0	5.7	No	Yes
6/8/2006	56,839	15.053	1.079	0.000	No	278.0	5.6	No	Yes
10/26/2006	60,414	15.938	1.041	0.000	No	267.1	5.6	No	Yes

Level: C

LPRM ID No.: 362

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
11/24/1999	13	0.003	1.102	0.000	No	1,134.3	7.0	Yes
9/28/2000	7,774	1.552	0.934	0.000	No	1,214.5	7.1	Yes
6/7/2001	14,125	3.139	1.065	0.000	No	1,140.3	7.0	Yes
8/17/2001	15,962	3.624	1.092	0.000	No	1,044.3	7.0	Yes
10/18/2001	17,564	4.053	1.050	0.000	No	994.5	6.9	Yes
2/14/2002	17,687	4.671	1.097	0.000	No	906.6	6.8	Yes
3/29/2002	18,770	4.872	1.084	0.000	No	836.3	6.7	Yes
8/15/2002	19,529	5.491	1.093	0.000	No	765.2	6.6	Yes
12/5/2002	22,366	6.104	1.081	0.000	No	707.8	6.6	Yes
4/10/2003	25,544	6.638	1.088	0.000	No	650.6	6.5	Yes
7/30/2003	28,292	7.066	1.056	0.000	No	616.1	6.4	Yes
10/16/2003	30,289	7.454	1.053	0.000	No	585.1	6.4	Yes

12/30/2003	32,121	7.881	1.077	0.000	No	543.3	6.3	No	Yes
2/19/2004	36,454	8.004	1.054	0.000	No	515.4	6.2	No	Yes
7/15/2004	40,200	8.746	1.062	0.000	No	485.3	6.2	No	Yes
1/6/2005	44,679	9.697	1.074	0.000	No	451.9	6.1	No	Yes
5/31/2005	48,392	10.518	1.052	0.000	No	429.6	6.1	No	Yes
8/4/2005	50,051	10.897	1.060	0.000	No	405.2	6.0	No	Yes
12/1/2005	53,067	11.740	1.052	0.000	No	385.2	6.0	No	Yes
1/12/2006	54,140	12.059	1.016	0.000	No	359.0	5.9	No	Yes
3/24/2006	54,927	12.374	1.082	0.000	No	331.8	5.8	No	Yes
7/13/2006	57,733	12.946	1.074	0.000	No	308.9	5.7	No	Yes
10/26/2006	60,414	13.507	1.005	0.000	No	307.4	5.7	No	Yes

Level: D

LPRM ID No.: 368

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
2/2/2000	1,724	0.205	0.943	0.000	No	1,325.6	7.2	No	Yes
3/8/2000	2,584	0.307	1.096	0.000	No	1,209.4	7.1	No	Yes
4/12/2000	3,445	0.412	0.897	0.000	No	1,237.0	7.1	No	Yes
5/10/2000	4,136	0.501	0.938	0.000	No	1,318.8	7.2	No	Yes
3/29/2002	18,770	3.285	1.075	0.000	No	1,226.8	7.1	No	Yes
1/16/2003	23,420	3.832	0.949	0.000	No	1,292.7	7.2	No	Yes
4/10/2003	25,544	3.957	1.056	0.000	No	1,224.1	7.1	No	Yes
7/30/2003	28,292	4.132	1.001	0.000	No	1,224.0	7.1	No	Yes
3/25/2004	37,343	4.661	1.065	0.000	No	1,149.3	7.0	No	Yes
6/17/2004	39,500	4.883	0.944	0.000	No	1,217.5	7.1	No	Yes
7/15/2004	40,200	4.966	1.111	0.000	No	1,095.8	7.0	No	Yes
10/28/2004	42,891	5.310	0.880	0.000	No	1,245.3	7.1	No	Yes
12/9/2004	43,958	5.453	1.173	0.000	No	1,061.6	7.0	No	Yes
1/6/2005	44,679	5.578	0.912	0.000	No	1,164.0	7.1	No	Yes
2/3/2005	45,396	5.705	1.141	0.000	No	1,020.2	6.9	No	Yes
5/31/2005	48,392	6.166	0.937	0.000	No	1,088.8	7.0	No	Yes
6/30/2005	49,160	6.286	1.081	0.000	No	1,007.2	6.9	No	Yes
12/1/2005	53,067	7.074	1.061	0.000	No	949.3	6.9	No	Yes
5/4/2006	55,975	7.735	1.089	0.000	No	871.7	6.8	No	Yes
7/13/2006	57,733	8.048	1.073	0.000	No	812.4	6.7	No	Yes
10/26/2006	60,414	8.553	1.006	0.000	No	807.6	6.7	No	Yes

String No.: 41

Serial No.: 00s19543

Cycle Installed:

10

Coordinates: 9		Type: NA300		Cumulative Core Average Exposure at BOC:				37,300	
Level: A		LPRM ID No.: 408		Beginning of Life Calibration Current:				700.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.062	1.180	0.000	No	1,059.0	7.0	No	Yes
9/19/2002	2,899	1.732	1.079	0.000	No	981.5	6.9	No	Yes
1/16/2003	5,920	2.392	1.081	0.000	No	907.9	6.8	No	Yes
4/10/2003	8,044	3.036	1.081	0.000	No	839.9	6.7	No	Yes
6/19/2003	9,728	3.596	1.063	0.000	No	790.1	6.7	No	Yes
7/30/2003	10,792	3.905	1.040	0.000	No	790.0	6.7	No	Yes
9/11/2003	11,887	4.179	1.097	0.000	No	720.1	6.6	No	Yes
12/30/2003	14,621	4.680	1.052	0.000	No	684.5	6.5	No	Yes
5/6/2004	20,923	5.353	1.066	0.000	No	642.2	6.5	No	Yes
6/17/2004	22,000	5.667	1.054	0.000	No	609.3	6.4	No	Yes
8/12/2004	23,420	5.988	0.945	0.000	No	644.7	6.5	No	Yes
9/23/2004	24,490	6.280	1.065	0.000	No	605.4	6.4	No	Yes
10/28/2004	25,391	6.586	1.104	0.000	No	548.3	6.3	No	Yes
4/21/2005	29,873	8.122	1.145	0.000	No	478.9	6.2	No	Yes
5/31/2005	30,892	8.507	0.939	0.000	No	510.0	6.2	No	Yes
6/30/2005	31,660	8.736	1.064	0.000	No	479.3	6.2	No	Yes
1/12/2006	36,640	9.978	1.017	0.000	No	445.0	6.1	No	Yes
3/24/2006	37,427	10.194	1.179	0.000	No	377.4	5.9	No	Yes
8/17/2006	41,129	11.134	0.933	0.000	No	404.5	6.0	No	Yes
9/21/2006	42,020	11.350	1.125	0.000	No	359.6	5.9	No	Yes
10/26/2006	42,914	11.620	1.023	0.000	No	351.5	5.9	No	Yes
Level: B		LPRM ID No.: 416		Beginning of Life Calibration Current:				700.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.056	1.140	0.000	No	1,096.0	7.0	No	Yes
12/5/2002	4,866	2.158	1.057	0.000	No	1,036.9	6.9	No	Yes
1/16/2003	5,920	2.439	1.061	0.000	No	977.3	6.9	No	Yes
4/10/2003	8,044	2.987	1.067	0.000	No	915.9	6.8	No	Yes
6/19/2003	9,728	3.422	1.071	0.000	No	855.2	6.8	No	Yes
7/30/2003	10,792	3.688	1.055	0.000	No	810.6	6.7	No	Yes
10/16/2003	12,789	4.179	1.073	0.000	No	755.5	6.6	No	Yes
12/30/2003	14,621	4.600	1.053	0.000	No	717.4	6.6	No	Yes
2/19/2004	18,954	4.718	1.077	0.000	No	666.1	6.5	No	Yes

5/6/2004	20,923	5.258	1.053	0.000	No	632.6	6.4	No	Yes
9/23/2004	24,490	6.148	1.078	0.000	No	586.8	6.4	No	Yes
10/28/2004	25,391	6.401	1.003	0.000	No	585.1	6.4	No	Yes
1/6/2005	27,179	6.875	1.064	0.000	No	551.5	6.3	No	Yes
5/31/2005	30,892	7.860	1.075	0.000	No	513.1	6.2	No	Yes
9/15/2005	33,614	8.533	1.053	0.000	No	487.2	6.2	No	Yes
1/12/2006	36,640	9.385	1.024	0.000	No	447.0	6.1	No	Yes
3/24/2006	37,427	9.685	1.196	0.000	No	373.7	5.9	No	Yes
9/21/2006	42,020	10.837	1.058	0.000	No	353.3	5.9	No	Yes
10/26/2006	42,914	11.085	1.003	0.000	No	352.2	5.9	No	Yes

Level: C

LPRM ID No.: 424

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.033	1.072	0.000	No	1,166.0	7.1	No	Yes
7/30/2003	10,792	2.436	1.031	0.000	No	1,166.0	7.1	No	Yes
10/16/2003	12,789	2.826	1.080	0.000	No	1,079.6	7.0	No	Yes
12/30/2003	14,621	3.254	1.057	0.000	No	1,021.4	6.9	No	Yes
2/19/2004	18,954	3.377	1.082	0.000	No	944.0	6.9	No	Yes
5/6/2004	20,923	3.785	1.059	0.000	No	891.4	6.8	No	Yes
9/23/2004	24,490	4.499	1.084	0.000	No	822.3	6.7	No	Yes
1/6/2005	27,179	5.113	1.052	0.000	No	781.7	6.7	No	Yes
3/17/2005	28,969	5.530	1.059	0.000	No	738.1	6.6	No	Yes
6/30/2005	31,660	6.129	1.051	0.000	No	702.3	6.6	No	Yes
9/15/2005	33,614	6.604	1.076	0.000	No	652.7	6.5	No	Yes
1/12/2006	36,640	7.520	1.071	0.000	No	609.4	6.4	No	Yes
3/24/2006	37,427	7.844	1.219	0.000	No	500.0	6.2	No	Yes
6/8/2006	39,339	8.261	1.052	0.000	No	475.2	6.2	No	Yes
10/26/2006	42,914	9.017	1.026	0.000	No	463.2	6.1	No	Yes

Level: D

LPRM ID No.: 432

Beginning of Life Calibration Current:

700.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/14/2002	187	0.011	1.012	0.000	No	1,250.0	7.1	No	Yes
3/29/2002	1,270	0.076	1.076	0.000	No	1,161.7	7.1	No	Yes
9/19/2002	2,899	0.354	0.921	0.000	No	1,261.4	7.1	No	Yes
12/5/2002	4,866	0.540	1.107	0.000	No	1,250.0	7.1	No	Yes
2/26/2003	6,974	0.695	0.939	0.000	No	1,331.2	7.2	No	Yes
7/30/2003	10,792	0.929	1.025	0.000	No	1,331.0	7.2	No	Yes

9/11/2003	11,887	1.021	1.108	0.000	No	1,326.0	7.2	No	Yes
3/25/2004	19,843	1.464	1.078	0.000	No	1,230.1	7.1	No	Yes
5/6/2004	20,923	1.570	0.932	0.000	No	1,319.8	7.2	No	Yes
8/12/2004	23,420	1.887	1.094	0.000	No	1,206.4	7.1	No	Yes
1/6/2005	27,179	2.445	1.082	0.000	No	1,115.0	7.0	No	Yes
5/31/2005	30,892	3.063	1.093	0.000	No	1,020.1	6.9	No	Yes
8/4/2005	32,551	3.326	1.053	0.000	No	968.8	6.9	No	Yes
12/1/2005	35,567	3.990	1.087	0.000	No	891.2	6.8	No	Yes
3/24/2006	37,427	4.543	1.144	0.000	No	779.0	6.7	No	Yes
6/8/2006	39,339	4.836	1.055	0.000	No	738.4	6.6	No	Yes
8/17/2006	41,129	5.220	1.090	0.000	No	677.5	6.5	No	Yes
10/26/2006	42,914	5.566	0.967	0.000	No	700.6	6.6	No	Yes

String No.: 42		Serial No.: 03s61363		Cycle Installed:		11			
Coordinates: 9		Type: NA300		Cumulative Core Average Exposure at BOC:		18,500			
Level: A		LPRM ID No.: 506		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/24/2006	18,627	4.928	1.451	0.000	No	861.5	6.8	No	Yes
10/26/2006	24,114	6.445	1.034	0.000	No	833.1	6.7	No	Yes
Level: B		LPRM ID No.: 516		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/25/2004	1,043	0.258	1.064	0.000	No	1,174.8	7.1	No	Yes
6/17/2004	3,200	0.770	0.946	0.000	No	1,241.9	7.1	No	Yes
12/9/2004	7,658	1.864	0.918	0.000	No	1,352.8	7.2	No	Yes
5/31/2005	12,092	2.793	0.945	0.000	No	1,431.5	7.3	No	Yes
1/12/2006	17,840	4.185	1.051	0.000	No	1,362.1	7.2	No	Yes
3/24/2006	18,627	4.467	1.221	0.000	No	1,115.5	7.0	No	Yes
10/26/2006	24,114	5.874	1.009	0.000	No	1,105.6	7.0	No	Yes
Level: C		LPRM ID No.: 526		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/23/2004	5,690	1.152	0.941	0.000	No	1,311.0	7.2	No	Yes

4/21/2005	11,073	2.235	0.939	0.000	No	1,396.2	7.2	No	Yes
3/24/2006	18,627	4.160	1.146	0.000	No	1,218.3	7.1	No	Yes
10/26/2006	24,114	5.275	1.002	0.000	No	1,215.9	7.1	No	Yes

Level: D

LPRM ID No.: 536

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
12/30/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
9/23/2004	5,690	0.636	0.933	0.000	No	1,339.8	7.2	No Yes
2/3/2005	9,096	1.124	0.947	0.000	No	1,414.7	7.3	No Yes
5/31/2005	12,092	1.592	0.898	0.000	No	1,575.4	7.4	No Yes
8/4/2005	13,751	1.858	1.089	0.000	No	1,446.7	7.3	No Yes
3/24/2006	18,627	2.971	1.069	0.000	No	1,353.3	7.2	No Yes
10/26/2006	24,114	3.785	0.967	0.000	No	1,399.5	7.2	No Yes

String No.: 43

Serial No.: 95S01705

Cycle Installed:

8

Coordinates: 9

Type: NA300

Cumulative Core Average Exposure at BOC:

67,204

Level: A

LPRM ID No.: 86

Beginning of Life Calibration Current:

1,097.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	1,276	0.354	1.064	0.000	Yes	1,017.0	6.9	No Yes
8/25/1998	2,824	0.434	0.916	0.000	No	1,110.3	7.0	No Yes
9/29/1998	3,685	0.568	0.970	0.000	No	1,144.6	7.0	No Yes
3/11/1999	7,477	1.032	1.051	0.000	No	1,090.0	7.0	No Yes
11/24/1999	12,417	1.697	1.076	0.000	No	1,013.0	6.9	No Yes
11/30/1999	12,553	1.712	1.054	0.000	No	961.1	6.9	No Yes
8/24/2000	19,269	2.611	0.945	0.000	No	1,017.0	6.9	No Yes
4/26/2001	25,440	3.653	1.061	0.000	No	958.6	6.9	No Yes
9/13/2001	29,065	4.360	1.076	0.000	No	890.9	6.8	No Yes
2/14/2002	30,091	4.849	1.072	0.000	No	831.0	6.7	No Yes
6/6/2002	30,127	5.333	1.023	0.000	No	780.0	6.7	No Yes
8/15/2002	31,933	5.681	1.088	0.000	No	716.9	6.6	No Yes
10/24/2002	33,703	6.004	1.056	0.000	No	678.9	6.5	No Yes
5/15/2003	38,794	6.929	1.053	0.000	No	644.7	6.5	No Yes
7/30/2003	40,696	7.238	1.046	0.000	No	645.0	6.5	No Yes
9/11/2003	41,791	7.379	1.060	0.000	No	608.5	6.4	No Yes
2/19/2004	48,858	7.684	1.098	0.000	No	554.2	6.3	No Yes
5/6/2004	50,827	8.034	1.071	0.000	No	517.4	6.2	No Yes

10/20/2005	64,419	9.942	0.938	0.000	No	552.0	6.3	No	Yes
1/12/2006	66,544	10.149	0.962	0.000	No	590.0	6.4	No	Yes
3/24/2006	67,331	10.249	1.117	0.000	No	528.2	6.3	No	Yes
6/8/2006	69,243	10.605	1.060	0.000	No	498.3	6.2	No	Yes
10/26/2006	72,818	11.139	0.984	0.000	No	506.4	6.2	No	Yes

Level: B

LPRM ID No.: 172

Beginning of Life Calibration Current:

1,076.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.445	0.994	0.000	Yes	1,052.0	7.0	No	Yes
8/25/1998	2,824	0.547	0.961	0.000	No	1,094.7	7.0	No	Yes
9/29/1998	3,685	0.726	1.015	0.000	No	1,078.5	7.0	No	Yes
11/30/1999	12,553	2.261	1.067	0.000	No	1,010.8	6.9	No	Yes
7/20/2000	18,363	3.315	1.058	0.000	No	955.4	6.9	No	Yes
2/22/2001	23,810	4.349	1.064	0.000	No	897.9	6.8	No	Yes
6/7/2001	26,529	4.865	1.072	0.000	No	837.6	6.7	No	Yes
8/17/2001	28,366	5.222	1.060	0.000	No	790.2	6.7	No	Yes
2/14/2002	30,091	5.931	1.091	0.000	No	724.3	6.6	No	Yes
6/6/2002	30,127	6.464	1.028	0.000	No	678.0	6.5	No	Yes
8/15/2002	31,933	6.835	1.071	0.000	No	633.1	6.5	No	Yes
10/24/2002	33,703	7.201	1.066	0.000	No	593.9	6.4	No	Yes
4/10/2003	37,948	8.024	1.065	0.000	No	557.6	6.3	No	Yes
6/19/2003	39,632	8.306	1.055	0.000	No	528.5	6.3	No	Yes
7/30/2003	40,696	8.479	1.016	0.000	No	529.0	6.3	No	Yes
11/20/2003	43,598	8.906	1.067	0.000	No	495.8	6.2	No	Yes
2/19/2004	48,858	9.112	1.126	0.000	No	440.3	6.1	No	Yes
6/17/2004	51,904	9.724	1.066	0.000	No	413.0	6.0	No	Yes
10/28/2004	55,295	10.337	1.055	0.000	No	391.5	6.0	No	Yes
1/6/2005	57,083	10.617	1.056	0.000	No	370.7	5.9	No	Yes
8/4/2005	62,455	11.377	1.057	0.000	No	350.8	5.9	No	Yes
1/12/2006	66,544	11.945	0.975	0.000	No	370.0	5.9	No	Yes
9/21/2006	71,924	12.956	1.054	0.000	No	351.0	5.9	No	Yes
10/26/2006	72,818	13.100	1.004	0.000	No	349.6	5.9	No	Yes

Level: C

LPRM ID No.: 258

Beginning of Life Calibration Current:

1,072.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	1,276	0.371	1.000	0.000	Yes	1,039.0	6.9	No	Yes
8/25/1998	2,824	0.442	0.960	0.000	No	1,082.3	7.0	No	Yes

9/29/1998	3,685	0.581	1.033	0.000	No	1,047.7	7.0	No	Yes
4/15/1999	8,305	1.331	0.953	0.000	No	1,099.4	7.0	No	Yes
11/30/1999	12,553	2.088	1.113	0.000	No	987.8	6.9	No	Yes
5/10/2000	16,540	2.683	1.053	0.000	No	938.1	6.8	No	Yes
8/24/2000	19,269	3.058	1.052	0.000	No	891.7	6.8	No	Yes
1/18/2001	22,989	3.654	1.078	0.000	No	827.2	6.7	No	Yes
4/26/2001	25,440	4.031	1.076	0.000	No	768.7	6.6	No	Yes
8/17/2001	28,366	4.529	1.076	0.000	No	714.4	6.6	No	Yes
12/20/2001	31,587	5.116	1.054	0.000	No	677.8	6.5	No	Yes
8/15/2002	31,933	5.801	1.064	0.000	No	637.1	6.5	No	Yes
4/10/2003	37,948	6.594	1.052	0.000	No	605.6	6.4	No	Yes
7/30/2003	40,696	6.904	1.042	0.000	No	606.0	6.4	No	Yes
10/16/2003	42,693	7.171	1.064	0.000	No	569.5	6.3	No	Yes
2/19/2004	48,858	7.554	1.110	0.000	No	513.1	6.2	No	Yes
8/12/2004	53,324	8.295	1.068	0.000	No	480.4	6.2	No	Yes
12/9/2004	56,362	8.783	1.057	0.000	No	454.5	6.1	No	Yes
5/31/2005	60,796	9.421	1.054	0.000	No	431.2	6.1	No	Yes
10/20/2005	64,419	10.012	1.057	0.000	No	408.0	6.0	No	Yes
10/26/2006	72,818	11.392	1.039	0.000	No	392.7	6.0	No	Yes

Level: D

LPRM ID No.: 344

Beginning of Life Calibration Current:

1,103.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
9/12/1996	1,276	0.255	0.991	0.000	Yes	1,060.0	7.0	No	Yes
8/25/1998	2,824	0.263	0.960	0.000	No	1,104.2	7.0	No	Yes
9/29/1998	3,685	0.343	0.957	0.000	No	1,153.8	7.1	No	Yes
11/30/1999	12,553	1.401	1.123	0.000	No	1,027.4	6.9	No	Yes
9/28/2000	20,178	2.053	1.050	0.000	No	978.5	6.9	No	Yes
2/22/2001	23,810	2.441	1.067	0.000	No	917.0	6.8	No	Yes
10/18/2001	29,968	3.167	1.068	0.000	No	858.7	6.8	No	Yes
2/14/2002	30,091	3.468	1.075	0.000	No	798.7	6.7	No	Yes
9/19/2002	32,803	3.712	1.071	0.000	No	745.8	6.6	No	Yes
2/26/2003	36,878	3.961	0.935	0.000	No	797.6	6.7	No	Yes
7/30/2003	40,696	4.153	1.025	0.000	No	798.0	6.7	No	Yes
11/20/2003	43,598	4.373	1.052	0.000	No	758.6	6.6	No	Yes
3/25/2004	49,747	4.587	1.065	0.000	No	712.3	6.6	No	Yes
12/9/2004	56,362	5.308	1.052	0.000	No	677.1	6.5	No	Yes
4/21/2005	59,777	5.764	1.051	0.000	No	644.2	6.5	No	Yes

8/4/2005	62,455	6.139	1.052	0.000	No	612.4	6.4	No	Yes
12/1/2005	65,471	6.640	1.055	0.000	No	580.4	6.4	No	Yes
6/8/2006	69,243	7.214	0.949	0.000	No	611.6	6.4	No	Yes
7/13/2006	70,137	7.324	1.056	0.000	No	579.2	6.4	No	Yes
10/26/2006	72,818	7.643	1.021	0.000	No	567.3	6.3	No	Yes

LaSalle County Station Unit 2

LaSalle Unit 2

LPRM Data

Printed: 11/22/2006

String No.: 1

Serial No.: 96S00501

Cycle Installed:

8

Coordinates: 57

Type: NA300

Cumulative Core Average Exposure at BOC:

51,228

Level: A

LPRM ID No.: 1

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal	Post-Cal	Gaf's Exp.		Good		% Life	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	In(CalCur)	Byp.?	Value
4/16/1999	48	0.009	1.007	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.028	1.034	0.000	No	1,250.0	7.1	No	Yes
5/18/2000	9,611	1.669	1.037	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	14,092	2.308	1.105	0.000	No	1,131.2	7.0	No	Yes
1/9/2003	15,550	5.060	1.066	0.000	No	763.6	6.6	No	Yes
2/15/2001	15,846	2.551	1.048	0.000	No	1,079.4	7.0	No	Yes
7/12/2001	19,517	3.035	1.077	0.000	No	1,002.2	6.9	No	Yes
1/31/2002	24,595	3.857	1.100	0.000	No	911.1	6.8	No	Yes
5/7/2002	26,607	4.195	1.057	0.000	No	862.0	6.8	No	Yes
7/18/2002	28,480	4.454	1.059	0.000	No	814.0	6.7	No	Yes
4/3/2003	34,037	5.261	1.085	0.000	No	703.8	6.6	No	Yes
7/31/2003	36,969	5.752	1.072	0.000	No	656.5	6.5	No	Yes
11/13/2003	39,615	6.134	1.052	0.000	No	624.0	6.4	No	Yes
6/3/2004	44,858	7.022	1.065	0.000	No	585.9	6.4	No	Yes
4/28/2005	52,297	8.090	1.144	0.000	No	512.2	6.2	No	Yes
11/17/2005	57,483	8.840	0.937	0.000	No	547.0	6.3	No	Yes
2/9/2006	59,635	9.100	1.112	0.000	No	492.0	6.2	No	Yes
3/23/2006	60,713	9.234	0.943	0.000	No	521.7	6.3	No	Yes
11/21/2006	66,942	9.845	1.009	0.000	No	517.1	6.2	No	Yes

Level: B

LPRM ID No.: 87

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal	Post-Cal	Gaf's Exp.		Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur
4/20/1999	146	0.028	0.000	0.000	No	1,250.0

Level: C

LPRM ID No.: 173

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal	Post-Cal	Gaf's Exp.		Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur
4/16/1999	48	0.007	0.955	0.000	No	1,250.0
4/20/1999	146	0.019	0.982	0.000	No	1,250.0
11/23/1999	5,275	0.703	0.941	0.000	No	1,328.4
5/18/2000	9,611	1.319	0.956	0.000	No	1,328.0
8/10/2000	11,664	1.634	0.947	0.000	No	1,402.3

12/8/2000	14,092	2.063	1.109	0.000	No	1,264.5	7.1	No	Yes
8/16/2001	20,431	3.062	1.060	0.000	No	1,192.9	7.1	No	Yes
2/27/2003	33,184	5.039	1.063	0.000	No	1,122.2	7.0	No	Yes
11/13/2003	39,615	5.798	1.051	0.000	No	1,067.8	7.0	No	Yes
3/23/2004	42,997	6.245	1.054	0.000	No	1,013.1	6.9	No	Yes
10/21/2004	48,434	7.068	1.068	0.000	No	948.6	6.9	No	Yes
12/29/2004	50,211	7.391	1.069	0.000	No	887.3	6.8	No	Yes
7/7/2005	54,077	7.992	1.051	0.000	No	844.3	6.7	No	Yes
8/11/2005	54,977	8.123	1.059	0.000	No	797.2	6.7	No	Yes
10/13/2005	56,583	8.377	1.058	0.000	No	753.5	6.6	No	Yes
12/29/2005	58,559	8.689	1.056	0.000	No	713.6	6.6	No	Yes
4/27/2006	61,610	9.157	1.059	0.000	No	673.8	6.5	No	Yes
8/10/2006	64,302	9.560	1.070	0.000	No	629.7	6.4	No	Yes
11/21/2006	66,942	9.938	1.048	0.000	No	600.9	6.4	No	Yes

Level: D

LPRM ID No.: 259

Beginning of Life Calibration Current:

1,359.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.003	0.922	0.000	No	1,359.0	7.2	No	Yes
4/20/1999	146	0.010	1.024	0.000	No	1,250.0	7.1	No	Yes
5/18/2000	9,611	0.754	0.948	0.000	No	1,425.0	7.3	No	Yes
12/8/2000	14,092	1.198	1.113	0.000	No	1,280.3	7.2	No	Yes
2/15/2001	15,846	1.327	0.955	0.000	No	1,340.7	7.2	No	Yes
3/14/2002	25,649	2.162	0.948	0.000	No	1,414.2	7.3	No	Yes
3/23/2004	42,997	3.559	1.084	0.000	No	1,304.6	7.2	No	Yes
6/3/2004	44,858	3.707	0.930	0.000	No	1,402.8	7.2	No	Yes
7/8/2004	45,715	3.783	0.920	0.000	No	1,524.8	7.3	No	Yes
10/21/2004	48,434	4.088	1.088	0.000	No	1,401.5	7.2	No	Yes
3/21/2005	51,328	4.500	1.045	0.000	No	1,401.0	7.2	No	Yes
7/7/2005	54,077	4.731	0.949	0.000	No	1,476.3	7.3	No	Yes
8/11/2005	54,977	4.812	1.138	0.000	No	1,297.3	7.2	No	Yes
11/17/2005	57,483	5.101	1.070	0.000	No	1,212.0	7.1	No	Yes
2/9/2006	59,635	5.349	0.949	0.000	No	1,277.0	7.2	No	Yes
3/23/2006	60,713	5.490	1.109	0.000	No	1,151.5	7.0	No	Yes
7/6/2006	63,402	5.830	1.052	0.000	No	1,094.6	7.0	No	Yes
11/21/2006	66,942	6.309	1.041	0.000	No	1,051.5	7.0	No	Yes

String No.: 2

Serial No.: 04s82827

Cycle Installed:

11

Coordinates: 57

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A		LPRM ID No.: 537		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.016	0.907	0.000	No	1,378.2	7.2	No	Yes
4/28/2005	1,069	0.275	1.204	0.000	No	1,144.7	7.0	No	Yes
2/9/2006	8,407	1.886	0.934	0.000	No	1,226.0	7.1	No	Yes
3/23/2006	9,485	2.087	1.066	0.000	No	1,150.1	7.0	No	Yes
7/6/2006	12,174	2.569	0.944	0.000	No	1,218.3	7.1	No	Yes
11/21/2006	15,714	3.245	0.973	0.000	No	1,252.1	7.1	No	Yes
Level: B		LPRM ID No.: 547		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.027	0.931	0.000	No	1,342.6	7.2	No	Yes
10/19/2006	14,867	3.311	1.010	0.000	No	1,329.3	7.2	No	Yes
Level: C		LPRM ID No.: 557		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.021	1.060	0.000	No	1,179.2	7.1	No	Yes
11/17/2005	6,255	1.093	0.947	0.000	No	1,245.0	7.1	No	Yes
11/21/2006	15,714	3.111	0.999	0.000	No	1,246.2	7.1	No	Yes
Level: D		LPRM ID No.: 567		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.088	0.884	0.000	No	1,414.0	7.3	No	Yes
11/21/2006	15,714	2.071	1.029	0.000	No	1,374.2	7.2	No	Yes
String No.: 3		Serial No.: 02S41541		Cycle Installed:				10	
Coordinates: 57		Type: NA300		Cumulative Core Average Exposure at BOC:				18,162	
Level: A		LPRM ID No.: 433		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.266	1.087	0.000	No	1,150.0	7.0	No	Yes

8/5/2004	13,375	3.570	1.052	0.000	No	1,093.0	7.0	No	Yes
3/21/2005	18,262	4.479	1.087	0.000	No	1,005.5	6.9	No	Yes
11/17/2005	24,417	5.926	1.052	0.000	No	956.0	6.9	No	Yes
6/1/2006	29,438	7.048	0.946	0.000	No	1,010.6	6.9	No	Yes
7/6/2006	30,336	7.254	1.065	0.000	No	948.9	6.9	No	Yes
11/21/2006	33,876	8.112	0.972	0.000	No	976.2	6.9	No	Yes

Level: B

LPRM ID No.: 449

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
9/4/2003	4,813	1.117	0.937	0.000	No	1,334.0	7.2	No	Yes
6/3/2004	11,792	2.754	0.938	0.000	No	1,422.2	7.3	No	Yes
9/16/2004	14,457	3.373	1.051	0.000	No	1,353.2	7.2	No	Yes
10/21/2004	15,368	3.594	1.051	0.000	No	1,287.5	7.2	No	Yes
3/21/2005	18,262	4.253	1.185	0.000	No	1,086.5	7.0	No	Yes
2/9/2006	26,569	6.251	1.051	0.000	No	1,034.0	6.9	No	Yes
9/14/2006	32,130	7.512	1.075	0.000	No	961.9	6.9	No	Yes
11/21/2006	33,876	7.916	1.033	0.000	No	931.1	6.8	No	Yes

Level: C

LPRM ID No.: 465

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/16/2003	5,819	0.833	0.944	0.000	No	1,324.2	7.2	No	Yes
6/3/2004	11,792	1.793	0.948	0.000	No	1,396.8	7.2	No	Yes
3/21/2005	18,262	3.242	1.226	0.000	No	1,139.3	7.0	No	Yes
9/14/2006	32,130	5.973	1.060	0.000	No	1,064.0	7.0	No	Yes
11/21/2006	33,876	6.374	0.970	0.000	No	1,096.9	7.0	No	Yes

Level: D

LPRM ID No.: 481

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/16/2003	5,819	0.404	0.930	0.000	No	1,344.1	7.2	No	Yes
1/5/2004	7,911	0.587	0.941	0.000	No	1,428.4	7.3	No	Yes
7/8/2004	12,649	1.026	0.942	0.000	No	1,516.3	7.3	No	Yes
3/21/2005	18,262	1.943	1.119	0.000	No	1,355.1	7.2	No	Yes
4/27/2006	28,544	3.092	0.945	0.000	No	1,433.9	7.3	No	Yes
6/1/2006	29,438	3.211	1.124	0.000	No	1,275.7	7.2	No	Yes

7/6/2006	30,336	3.348	0.935	0.000	No	1,364.4	7.2	No	Yes
11/21/2006	33,876	3.937	1.058	0.000	No	1,289.6	7.2	No	Yes

String No.: 4	Serial No.: M5419	Cycle Installed:	7
Coordinates: 57	Type: NA300	Cumulative Core Average Exposure at BOC:	61,028
Level: A	LPRM ID No.: 4	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	9,490	1.229	1.019	0.000	Yes	1,091.0	7.0	No	Yes
11/23/1999	15,075	2.292	1.073	0.000	No	1,016.8	6.9	No	Yes
2/3/2000	16,838	2.600	1.053	0.000	No	965.6	6.9	No	Yes
5/18/2000	19,411	3.008	1.051	0.000	No	918.7	6.8	No	Yes
8/10/2000	21,464	3.434	1.039	0.000	No	885.0	6.8	No	Yes
12/8/2000	23,892	3.788	1.165	0.000	No	759.7	6.6	No	Yes
3/30/2001	26,762	4.275	1.074	0.000	No	707.3	6.6	No	Yes
7/12/2001	29,317	4.673	1.059	0.000	No	667.9	6.5	No	Yes
9/20/2001	30,967	4.969	1.050	0.000	No	636.1	6.5	No	Yes
12/27/2001	33,507	5.492	1.051	0.000	No	605.2	6.4	No	Yes
3/14/2002	35,449	5.953	1.051	0.000	No	575.9	6.4	No	Yes
9/26/2002	40,020	6.974	1.072	0.000	No	537.2	6.3	No	Yes
2/27/2003	42,984	7.478	1.068	0.000	No	503.0	6.2	No	Yes
5/8/2003	44,745	7.890	1.052	0.000	No	478.1	6.2	No	Yes
10/16/2003	48,685	8.740	1.052	0.000	No	454.5	6.1	No	Yes
1/5/2004	50,777	9.173	1.060	0.000	No	428.8	6.1	No	Yes
7/8/2004	55,515	10.355	1.116	0.000	No	384.2	6.0	No	Yes
4/28/2005	62,097	11.637	1.166	0.000	No	329.5	5.8	No	Yes
10/13/2005	66,383	12.564	1.082	0.000	No	304.5	5.7	No	Yes
12/29/2005	68,359	12.920	0.945	0.000	No	322.3	5.8	No	Yes
2/9/2006	69,435	13.139	1.061	0.000	No	304.0	5.7	No	Yes
6/1/2006	72,304	13.641	0.947	0.000	No	321.0	5.8	No	Yes
9/14/2006	74,996	13.934	1.067	0.000	No	300.9	5.7	No	Yes
11/21/2006	76,742	14.238	1.002	0.000	No	300.3	5.7	No	Yes

Level: B	LPRM ID No.: 90	Beginning of Life Calibration Current:	1,250.0
-----------------	------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/12/1996	9,490	1.695	1.011	0.000	Yes	1,129.0	7.0	No	Yes
4/16/1999	9,848	1.737	0.940	0.000	No	1,201.1	7.1	No	Yes

5/25/1999	10,770	1.925	1.058	0.000	No	1,135.2	7.0	No	Yes
10/14/1999	14,167	2.614	1.059	0.000	No	1,072.0	7.0	No	Yes
11/23/1999	15,075	2.800	1.057	0.000	No	1,014.2	6.9	No	Yes
3/9/2000	17,697	3.378	1.062	0.000	No	955.0	6.9	No	Yes
5/18/2000	19,411	3.774	1.075	0.000	No	888.3	6.8	No	Yes
7/5/2000	20,547	4.018	1.058	0.000	No	839.6	6.7	No	Yes
10/26/2000	23,420	4.610	1.104	0.000	No	760.5	6.6	No	Yes
12/8/2000	23,892	4.698	1.124	0.000	No	676.6	6.5	No	Yes
3/30/2001	26,762	5.230	1.108	0.000	No	610.7	6.4	No	Yes
7/12/2001	29,317	5.721	1.088	0.000	No	561.3	6.3	No	Yes
9/20/2001	30,967	6.066	1.043	0.000	No	538.1	6.3	No	Yes
11/29/2001	32,778	6.464	1.091	0.000	No	514.5	6.2	No	Yes
5/7/2002	36,407	7.288	1.055	0.000	No	487.7	6.2	No	Yes
7/18/2002	38,280	7.709	1.056	0.000	No	461.8	6.1	No	Yes
2/27/2003	42,984	8.583	1.101	0.000	No	419.4	6.0	No	Yes
5/8/2003	44,745	8.964	1.061	0.000	No	395.3	6.0	No	Yes
10/16/2003	48,685	9.793	1.061	0.000	No	372.6	5.9	No	Yes
2/16/2004	51,865	10.454	1.100	0.000	No	338.7	5.8	No	Yes
9/16/2004	57,323	11.646	1.073	0.000	No	315.7	5.8	No	Yes
12/2/2004	59,312	12.085	1.071	0.000	No	294.7	5.7	No	Yes
4/28/2005	62,097	12.715	1.127	0.000	No	261.5	5.6	No	Yes
8/11/2005	64,777	13.382	1.064	0.000	No	245.8	5.5	No	Yes
10/13/2005	66,383	13.753	1.068	0.000	No	230.1	5.4	No	Yes
3/23/2006	70,513	14.688	1.060	0.000	No	217.1	5.4	No	Yes
9/14/2006	74,996	15.467	1.065	0.000	No	203.9	5.3	No	Yes
11/21/2006	76,742	15.808	1.026	0.000	No	198.7	5.3	No	Yes

Level: C

LPRM ID No.: 176

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	9,490	1.824	1.020	0.000	Yes	1,029.0	6.9	Yes
4/16/1999	9,848	1.886	0.949	0.000	No	1,083.0	7.0	Yes
11/23/1999	15,075	2.704	1.084	0.000	No	999.1	6.9	Yes
5/18/2000	19,411	3.434	1.047	0.000	No	999.0	6.9	Yes
7/5/2000	20,547	3.630	1.080	0.000	No	925.0	6.8	Yes
10/26/2000	23,420	4.205	1.080	0.000	No	856.5	6.8	Yes
12/8/2000	23,892	4.308	1.125	0.000	No	761.3	6.6	Yes
12/12/2002	24,660	7.574	1.060	0.000	No	536.2	6.3	Yes

3/8/2001	26,187	4.714	1.059	0.000	No	718.9	6.6	No	Yes
5/24/2001	28,124	5.071	1.065	0.000	No	675.0	6.5	No	Yes
8/16/2001	30,231	5.450	1.052	0.000	No	641.7	6.5	No	Yes
12/27/2001	33,507	6.016	1.057	0.000	No	607.1	6.4	No	Yes
6/13/2002	37,371	6.717	1.068	0.000	No	568.4	6.3	No	Yes
2/27/2003	42,984	7.767	1.055	0.000	No	508.3	6.2	No	Yes
11/13/2003	49,415	8.620	1.054	0.000	No	482.2	6.2	No	Yes
8/5/2004	56,241	9.679	1.061	0.000	No	455.0	6.1	No	Yes
10/21/2004	58,234	10.089	1.062	0.000	No	428.4	6.1	No	Yes
3/21/2005	61,128	10.752	1.109	0.000	No	386.3	6.0	No	Yes
7/7/2005	63,877	11.261	1.059	0.000	No	364.8	5.9	No	Yes
11/17/2005	67,283	11.951	1.072	0.000	No	340.0	5.8	No	Yes
3/23/2006	70,513	12.637	1.060	0.000	No	320.8	5.8	No	Yes
6/1/2006	72,304	13.008	1.060	0.000	No	302.6	5.7	No	Yes
11/21/2006	76,742	13.997	1.076	0.000	No	281.2	5.6	No	Yes

Level: D

LPRM ID No.: 262

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value

String No.: 5

Serial No.: 04s82826

Cycle Installed:

11

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 538

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.182	1.111	0.000	No	1,125.1	7.0	No	Yes
11/17/2005	6,255	1.043	0.942	0.000	No	1,194.0	7.1	No	Yes
12/29/2005	7,331	1.180	1.076	0.000	No	1,109.7	7.0	No	Yes
3/23/2006	9,485	1.507	0.943	0.000	No	1,176.7	7.1	No	Yes
11/21/2006	15,714	2.212	0.997	0.000	No	1,180.3	7.1	No	Yes

Level: B

LPRM ID No.: 548

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.022	0.956	0.000	No	1,307.5	7.2	No	Yes
11/21/2006	15,714	2.653	1.008	0.000	No	1,240.1	7.1	No	Yes

Level: C

LPRM ID No.: 558

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.017	0.980	0.000	No	1,250.0	7.1	No	Yes
11/21/2006	15,714	2.567	1.016	0.000	No	1,230.3	7.1	No	Yes

Level: D

LPRM ID No.: 568

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.010	0.847	0.000	No	1,475.8	7.3	No	Yes
7/7/2005	2,849	0.280	1.067	0.000	No	1,383.1	7.2	No	Yes
10/13/2005	5,355	0.569	0.936	0.000	No	1,477.7	7.3	No	Yes
11/17/2005	6,255	0.693	1.079	0.000	No	1,370.0	7.2	No	Yes
12/29/2005	7,331	0.835	0.947	0.000	No	1,446.7	7.3	No	Yes
11/21/2006	15,714	1.986	1.023	0.000	No	1,414.1	7.3	No	Yes

String No.: 6

Serial No.: 02S41547

Cycle Installed:

10

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 434

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.028	1.083	0.000	No	1,154.2	7.1	No	Yes
10/16/2003	5,819	1.298	1.051	0.000	No	1,098.2	7.0	No	Yes
10/21/2004	15,368	4.440	1.066	0.000	No	1,030.2	6.9	No	Yes
4/28/2005	19,231	5.330	1.080	0.000	No	953.9	6.9	No	Yes
11/17/2005	24,417	6.830	0.941	0.000	No	1,014.0	6.9	No	Yes
12/29/2005	25,493	7.088	1.066	0.000	No	951.2	6.9	No	Yes
2/9/2006	26,569	7.416	1.079	0.000	No	882.0	6.8	No	Yes
9/14/2006	32,130	8.893	1.066	0.000	No	827.4	6.7	No	Yes
11/21/2006	33,876	9.377	1.015	0.000	No	815.2	6.7	No	Yes

Level: B

LPRM ID No.: 450

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.292	1.129	0.000	No	1,107.2	7.0	No	Yes
6/3/2004	11,792	3.220	0.949	0.000	No	1,158.0	7.1	No	Yes
10/21/2004	15,368	4.268	1.058	0.000	No	1,094.5	7.0	No	Yes

3/21/2005	18,262	5.001	1.080	0.000	No	1,013.4	6.9	No	Yes
9/8/2005	22,627	6.249	1.064	0.000	No	952.5	6.9	No	Yes
7/6/2006	30,336	8.301	1.078	0.000	No	883.6	6.8	No	Yes
9/14/2006	32,130	8.729	1.094	0.000	No	807.6	6.7	No	Yes
11/21/2006	33,876	9.186	1.103	0.000	No	732.2	6.6	No	Yes

Level: C

LPRM ID No.: 466

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.024	1.057	0.000	No	1,182.6	7.1	No	Yes
1/21/2005	17,737	4.090	1.053	0.000	No	1,123.1	7.0	No	Yes
3/21/2005	18,262	4.236	1.094	0.000	No	1,026.6	6.9	No	Yes
6/1/2006	29,438	6.950	1.069	0.000	No	960.3	6.9	No	Yes
8/10/2006	31,236	7.379	1.059	0.000	No	906.8	6.8	No	Yes
11/21/2006	33,876	8.058	1.100	0.000	No	824.4	6.7	No	Yes

Level: D

LPRM ID No.: 482

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.088	1.095	0.000	No	1,141.6	7.0	No	Yes
10/16/2003	5,819	0.624	0.934	0.000	No	1,222.2	7.1	No	Yes
7/8/2004	12,649	1.531	0.900	0.000	No	1,358.0	7.2	No	Yes
3/21/2005	18,262	2.784	1.094	0.000	No	1,241.3	7.1	No	Yes
8/11/2005	21,911	3.212	0.933	0.000	No	1,330.5	7.2	No	Yes
9/8/2005	22,627	3.307	1.064	0.000	No	1,250.4	7.1	No	Yes
11/17/2005	24,417	3.602	1.214	0.000	No	1,030.0	6.9	No	Yes
2/9/2006	26,569	3.939	0.911	0.000	No	1,300.0	7.2	No	Yes
6/1/2006	29,438	4.448	1.061	0.000	No	1,225.3	7.1	No	Yes
11/21/2006	33,876	5.251	0.988	0.000	No	1,240.1	7.1	No	Yes

String No.: 7

Serial No.: 02S41544

Cycle Installed:

10

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 435

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.031	1.102	0.000	No	1,134.3	7.0	No	Yes
4/3/2003	971	0.255	1.062	0.000	No	1,068.1	7.0	No	Yes

10/16/2003	5,819	1.496	1.052	0.000	No	1,015.3	6.9	No	Yes
7/8/2004	12,649	3.528	0.946	0.000	No	1,073.2	7.0	No	Yes
3/21/2005	18,262	4.854	1.105	0.000	No	971.3	6.9	No	Yes
9/8/2005	22,627	6.173	1.082	0.000	No	897.7	6.8	No	Yes
6/1/2006	29,438	8.143	1.051	0.000	No	854.1	6.8	No	Yes
11/21/2006	33,876	9.562	1.081	0.000	No	790.1	6.7	No	Yes
11/21/2006	33,876	9.215	1.076	0.000	No	704.9	6.6	No	Yes

Level: C

LPRM ID No.: 467

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.022	1.078	0.000	No	1,159.6	7.1	No	Yes
7/8/2004	12,649	2.505	0.942	0.000	No	1,230.9	7.1	No	Yes
12/2/2004	16,446	3.502	1.053	0.000	No	1,158.0	7.1	No	Yes
3/21/2005	18,262	4.032	1.109	0.000	No	1,044.2	7.0	No	Yes
8/10/2006	31,236	7.147	1.086	0.000	No	961.5	6.9	No	Yes
9/14/2006	32,130	7.422	1.061	0.000	No	906.2	6.8	No	Yes
10/19/2006	33,029	7.660	1.071	0.000	No	846.1	6.7	No	Yes
11/21/2006	33,876	7.903	1.071	0.000	No	790.0	6.7	No	Yes

Level: D

LPRM ID No.: 483

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/23/2004	9,931	1.312	0.942	0.000	No	1,327.0	7.2	No	Yes
7/8/2004	12,649	1.713	0.945	0.000	No	1,404.2	7.2	No	Yes
3/21/2005	18,262	3.046	1.116	0.000	No	1,258.2	7.1	No	Yes
9/14/2006	32,130	5.215	0.945	0.000	No	1,331.5	7.2	No	Yes
11/21/2006	33,876	5.585	0.916	0.000	No	1,453.6	7.3	No	Yes

String No.: 8

Serial No.: 00s10719

Cycle Installed:

9

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

37,262

Level: A

LPRM ID No.: 369

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.034	1.109	0.000	No	1,127.1	7.0	No	Yes
12/12/2002	894	3.969	1.054	0.000	No	615.4	6.4	No	Yes
1/11/2001	994	0.242	1.068	0.000	No	1,055.4	7.0	No	Yes

4/16/2001	3,366	0.783	1.052	0.000	No	1,003.2	6.9	No	Yes
7/12/2001	5,551	1.302	1.077	0.000	No	931.5	6.8	No	Yes
10/25/2001	8,114	1.871	1.078	0.000	No	864.1	6.8	No	Yes
12/27/2001	9,741	2.262	1.075	0.000	No	803.8	6.7	No	Yes
1/31/2002	10,629	2.484	1.054	0.000	No	762.6	6.6	No	Yes
5/7/2002	12,641	2.878	1.103	0.000	No	691.4	6.5	No	Yes
9/26/2002	16,254	3.577	1.066	0.000	No	648.6	6.5	No	Yes
6/12/2003	21,885	4.850	1.073	0.000	No	573.5	6.4	No	Yes
11/13/2003	25,649	5.897	1.102	0.000	No	520.4	6.3	No	Yes
2/16/2004	28,099	6.598	1.058	0.000	No	491.9	6.2	No	Yes
6/3/2004	30,892	7.397	1.059	0.000	No	464.5	6.1	No	Yes
12/2/2004	35,546	8.504	1.055	0.000	No	440.3	6.1	No	Yes
6/2/2005	39,224	9.426	1.087	0.000	No	405.0	6.0	No	Yes
10/13/2005	42,617	10.366	1.069	0.000	No	378.9	5.9	No	Yes
8/10/2006	50,336	12.598	1.071	0.000	No	353.8	5.9	No	Yes
10/19/2006	52,129	13.183	1.056	0.000	No	335.0	5.8	No	Yes
11/21/2006	52,976	13.414	0.986	0.000	No	339.8	5.8	No	Yes

Level: B

LPRM ID No.: 377

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.032	1.063	0.000	No	1,175.9	7.1	No	Yes
12/12/2002	894	4.730	1.065	0.000	No	645.2	6.5	No	Yes
5/24/2001	4,358	1.109	1.057	0.000	No	1,112.5	7.0	No	Yes
8/16/2001	6,465	1.731	1.067	0.000	No	1,042.6	6.9	No	Yes
10/25/2001	8,114	2.180	1.073	0.000	No	971.7	6.9	No	Yes
12/27/2001	9,741	2.671	1.094	0.000	No	888.2	6.8	No	Yes
3/14/2002	11,683	3.221	1.099	0.000	No	808.2	6.7	No	Yes
6/13/2002	13,605	3.682	1.087	0.000	No	743.5	6.6	No	Yes
8/22/2002	15,409	4.124	1.082	0.000	No	687.2	6.5	No	Yes
4/3/2003	20,071	5.190	1.076	0.000	No	599.7	6.4	No	Yes
7/31/2003	23,003	5.926	1.065	0.000	No	563.1	6.3	No	Yes
12/18/2003	26,544	6.904	1.107	0.000	No	508.6	6.2	No	Yes
9/16/2004	33,557	8.629	1.077	0.000	No	472.3	6.2	No	Yes
12/29/2004	36,245	9.314	1.063	0.000	No	444.3	6.1	No	Yes
3/21/2005	37,362	9.581	1.055	0.000	No	421.1	6.0	No	Yes
10/13/2005	42,617	11.065	1.089	0.000	No	386.7	6.0	No	Yes

6/1/2006	48,538	12.786	1.069	0.000	No	361.7	5.9	No	Yes
9/14/2006	51,230	13.552	1.059	0.000	No	341.6	5.8	No	Yes
11/21/2006	52,976	14.051	1.027	0.000	No	332.6	5.8	No	Yes

Level: C

LPRM ID No.: 385

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.027	1.079	0.000	No	1,158.5	7.1	No	Yes
12/12/2002	894	4.590	1.056	0.000	No	684.7	6.5	No	Yes
9/20/2001	7,201	1.810	1.053	0.000	No	1,100.2	7.0	No	Yes
11/29/2001	9,012	2.247	1.069	0.000	No	1,029.2	6.9	No	Yes
1/31/2002	10,629	2.667	1.085	0.000	No	948.5	6.9	No	Yes
3/14/2002	11,683	2.963	1.058	0.000	No	896.5	6.8	No	Yes
5/7/2002	12,641	3.221	1.077	0.000	No	832.4	6.7	No	Yes
7/18/2002	14,514	3.698	1.079	0.000	No	771.5	6.6	No	Yes
9/26/2002	16,254	4.154	1.067	0.000	No	723.0	6.6	No	Yes
4/3/2003	20,071	5.021	1.064	0.000	No	643.5	6.5	No	Yes
7/31/2003	23,003	5.633	1.069	0.000	No	602.0	6.4	No	Yes
11/13/2003	25,649	6.207	1.057	0.000	No	569.5	6.3	No	Yes
2/16/2004	28,099	6.697	1.059	0.000	No	537.8	6.3	No	Yes
9/16/2004	33,557	7.803	1.069	0.000	No	503.1	6.2	No	Yes
12/2/2004	35,546	8.330	1.057	0.000	No	475.9	6.2	No	Yes
3/21/2005	37,362	8.877	1.096	0.000	No	434.3	6.1	No	Yes
8/11/2005	41,011	9.576	1.061	0.000	No	409.3	6.0	No	Yes
12/29/2005	44,593	10.437	1.052	0.000	No	389.1	6.0	No	Yes
9/14/2006	51,230	12.169	1.070	0.000	No	363.6	5.9	No	Yes
11/21/2006	52,976	12.671	1.037	0.000	No	350.6	5.9	No	Yes

Level: D

LPRM ID No.: 393

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.013	1.083	0.000	No	1,154.2	7.1	No	Yes
12/12/2002	894	3.268	1.078	0.000	No	1,006.3	6.9	No	Yes
1/11/2001	994	0.139	1.052	0.000	No	1,097.1	7.0	No	Yes
5/24/2001	4,358	0.657	0.947	0.000	No	1,158.6	7.1	No	Yes
8/22/2002	15,409	2.702	1.068	0.000	No	1,084.8	7.0	No	Yes
2/27/2003	19,218	3.504	1.071	0.000	No	939.6	6.8	No	Yes

6/12/2003	21,885	3.787	1.052	0.000	No	893.1	6.8	No	Yes
10/16/2003	24,919	4.166	1.054	0.000	No	847.4	6.7	No	Yes
2/16/2004	28,099	4.583	1.077	0.000	No	786.8	6.7	No	Yes
9/16/2004	33,557	5.345	1.055	0.000	No	745.8	6.6	No	Yes
12/2/2004	35,546	5.802	1.095	0.000	No	681.1	6.5	No	Yes
1/21/2005	36,837	6.151	1.074	0.000	No	634.2	6.5	No	Yes
9/8/2005	41,727	6.829	1.064	0.000	No	596.0	6.4	No	Yes
12/29/2005	44,593	7.222	1.060	0.000	No	562.3	6.3	No	Yes
10/19/2006	52,129	8.635	1.054	0.000	No	533.5	6.3	No	Yes
11/21/2006	52,976	8.820	1.016	0.000	No	525.1	6.3	No	Yes

String No.: 9

Serial No.: 02S41555

Cycle Installed:

10

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 436

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.028	1.079	0.000	No	1,158.5	7.1	No	Yes
4/3/2003	971	0.243	1.072	0.000	No	1,080.7	7.0	No	Yes
3/21/2005	18,262	4.753	1.117	0.000	No	967.5	6.9	No	Yes
4/28/2005	19,231	5.077	0.947	0.000	No	1,021.6	6.9	No	Yes
7/7/2005	21,011	5.673	1.079	0.000	No	946.8	6.9	No	Yes
9/8/2005	22,627	6.209	0.942	0.000	No	1,005.1	6.9	No	Yes
10/13/2005	23,517	6.428	1.058	0.000	No	950.0	6.9	No	Yes
3/23/2006	27,647	7.516	1.082	0.000	No	878.0	6.8	No	Yes
4/27/2006	28,544	7.792	0.944	0.000	No	930.1	6.8	No	Yes
6/1/2006	29,438	8.092	1.054	0.000	No	882.5	6.8	No	Yes
11/21/2006	33,876	9.414	1.072	0.000	No	823.2	6.7	No	Yes

Level: B

LPRM ID No.: 452

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.165	0.000	No	1,073.0	7.0	No	Yes
5/8/2003	1,879	0.463	1.061	0.000	No	1,011.3	6.9	No	Yes
4/22/2004	10,709	2.596	0.940	0.000	No	1,075.8	7.0	No	Yes
8/5/2004	13,375	3.332	0.940	0.000	No	1,144.0	7.0	No	Yes
3/21/2005	18,262	4.575	1.158	0.000	No	987.9	6.9	No	Yes
7/6/2006	30,336	8.109	1.075	0.000	No	919.0	6.8	No	Yes

8/10/2006	31,236	8.372	1.063	0.000	No	864.5	6.8	No	Yes
9/14/2006	32,130	8.624	1.100	0.000	No	785.9	6.7	No	Yes
10/19/2006	33,029	8.854	1.059	0.000	No	742.1	6.6	No	Yes
11/21/2006	33,876	9.086	1.034	0.000	No	717.7	6.6	No	Yes

Level: C

LPRM ID No.: 468

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.159	1.058	0.000	No	1,181.5	7.1	No	Yes
7/31/2003	3,903	0.652	0.948	0.000	No	1,246.3	7.1	No	Yes
12/18/2003	7,444	1.381	0.947	0.000	No	1,316.0	7.2	No	Yes
3/21/2005	18,262	3.949	1.120	0.000	No	1,175.0	7.1	No	Yes
12/29/2005	25,493	5.715	1.073	0.000	No	1,095.1	7.0	No	Yes
7/6/2006	30,336	7.006	1.054	0.000	No	1,039.0	6.9	No	Yes
9/14/2006	32,130	7.539	1.109	0.000	No	936.9	6.8	No	Yes
11/21/2006	33,876	8.005	1.079	0.000	No	868.3	6.8	No	Yes

Level: D

LPRM ID No.: 484

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	0.409	0.941	0.000	No	1,328.4	7.2	No	Yes
1/5/2004	7,911	0.917	0.941	0.000	No	1,411.7	7.3	No	Yes
8/5/2004	13,375	1.721	0.935	0.000	No	1,510.0	7.3	No	Yes
3/21/2005	18,262	2.829	1.054	0.000	No	1,432.6	7.3	No	Yes
4/28/2005	19,231	2.938	1.058	0.000	No	1,354.1	7.2	No	Yes
7/7/2005	21,011	3.155	0.941	0.000	No	1,439.0	7.3	No	Yes
9/8/2005	22,627	3.366	1.079	0.000	No	1,333.6	7.2	No	Yes
10/13/2005	23,517	3.506	0.931	0.000	No	1,432.5	7.3	No	Yes
12/29/2005	25,493	3.825	1.064	0.000	No	1,346.3	7.2	No	Yes
11/21/2006	33,876	5.443	1.010	0.000	No	1,333.0	7.2	No	Yes

String No.: 10

Serial No.: 04s82829

Cycle Installed:

11

Coordinates: 49

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 539

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.019	1.115	0.000	No	1,121.1	7.0	No	Yes

6/2/2005	1,962	0.464	1.066	0.000	No	1,051.7	7.0	No	Yes
11/21/2006	15,714	3.582	0.977	0.000	No	1,076.4	7.0	No	Yes
Level: B		LPRM ID No.: 549		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/29/2005	7,331	1.916	1.053	0.000	No	1,187.1	7.1	No	Yes
11/21/2006	15,714	3.847	0.991	0.000	No	1,197.9	7.1	No	Yes
Level: C		LPRM ID No.: 559		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.021	1.120	0.000	No	1,116.1	7.0	No	Yes
11/21/2006	15,714	3.581	0.986	0.000	No	1,131.9	7.0	No	Yes
Level: D		LPRM ID No.: 569		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.013	0.946	0.000	No	1,321.4	7.2	No	Yes
4/28/2005	1,069	0.129	1.110	0.000	No	1,190.4	7.1	No	Yes
6/2/2005	1,962	0.238	0.927	0.000	No	1,284.2	7.2	No	Yes
7/7/2005	2,849	0.344	1.058	0.000	No	1,213.8	7.1	No	Yes
8/11/2005	3,749	0.454	0.900	0.000	No	1,348.6	7.2	No	Yes
10/13/2005	5,355	0.694	1.120	0.000	No	1,204.1	7.1	No	Yes
11/17/2005	6,255	0.848	0.941	0.000	No	1,280.0	7.2	No	Yes
11/21/2006	15,714	2.507	0.989	0.000	No	1,294.2	7.2	No	Yes
String No.: 11		Serial No.: 02S41548		Cycle Installed:				10	
Coordinates: 41		Type: NA300		Cumulative Core Average Exposure at BOC:				18,162	
Level: A		LPRM ID No.: 437		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.026	1.067	0.000	No	1,171.5	7.1	No	Yes
12/18/2003	7,444	1.946	1.063	0.000	No	1,102.1	7.0	No	Yes
4/28/2005	19,231	5.312	1.125	0.000	No	979.6	6.9	No	Yes
11/17/2005	24,417	6.598	0.927	0.000	No	1,057.0	7.0	No	Yes
2/9/2006	26,569	7.128	1.062	0.000	No	995.0	6.9	No	Yes

6/1/2006	29,438	7.892	1.061	0.000	No	937.8	6.8	No	Yes
7/6/2006	30,336	8.094	1.107	0.000	No	847.1	6.7	No	Yes
9/14/2006	32,130	8.488	1.083	0.000	No	782.2	6.7	No	Yes
10/19/2006	33,029	8.744	1.061	0.000	No	737.3	6.6	No	Yes
11/21/2006	33,876	8.980	1.001	0.000	No	736.5	6.6	No	Yes

Level: B

LPRM ID No.: 453

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	1.000	0.947	0.000	No	1,320.0	7.2	No	Yes
7/8/2004	12,649	3.181	0.945	0.000	No	1,396.8	7.2	No	Yes
12/2/2004	16,446	4.183	1.063	0.000	No	1,314.0	7.2	No	Yes
3/21/2005	18,262	4.620	1.105	0.000	No	1,189.1	7.1	No	Yes
8/11/2005	21,911	5.613	1.051	0.000	No	1,131.4	7.0	No	Yes
7/6/2006	30,336	7.722	1.082	0.000	No	1,045.7	7.0	No	Yes
9/14/2006	32,130	8.136	1.058	0.000	No	988.4	6.9	No	Yes
11/21/2006	33,876	8.578	1.067	0.000	No	926.3	6.8	No	Yes

Level: C

LPRM ID No.: 469

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	0.625	0.945	0.000	No	1,322.8	7.2	No	Yes
10/16/2003	5,819	0.973	0.941	0.000	No	1,405.7	7.2	No	Yes
8/5/2004	13,375	2.494	0.942	0.000	No	1,492.0	7.3	No	Yes
3/21/2005	18,262	3.793	1.199	0.000	No	1,244.4	7.1	No	Yes
6/2/2005	20,124	4.151	0.948	0.000	No	1,312.6	7.2	No	Yes
12/29/2005	25,493	5.339	1.058	0.000	No	1,240.7	7.1	No	Yes
8/10/2006	31,236	6.757	1.056	0.000	No	1,174.9	7.1	No	Yes
11/21/2006	33,876	7.448	1.024	0.000	No	1,147.3	7.0	No	Yes

Level: D

LPRM ID No.: 485

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.009	0.919	0.000	No	1,360.2	7.2	No	Yes
6/3/2004	11,792	1.175	0.935	0.000	No	1,454.7	7.3	No	Yes
8/5/2004	13,375	1.394	0.921	0.000	No	1,580.0	7.4	No	Yes
3/21/2005	18,262	2.393	1.229	0.000	No	1,285.0	7.2	No	Yes

4/28/2005	19,231	2.485	0.874	0.000	No	1,470.3	7.3	No	Yes
11/17/2005	24,417	3.108	1.107	0.000	No	1,328.0	7.2	No	Yes
6/1/2006	29,438	3.879	0.927	0.000	No	1,432.6	7.3	No	Yes
11/21/2006	33,876	4.684	0.992	0.000	No	1,444.1	7.3	No	Yes

String No.: 12	Serial No.: 02S41553	Cycle Installed: 10
Coordinates: 41	Type: NA300	Cumulative Core Average Exposure at BOC: 18,162
Level: A	LPRM ID No.: 438	Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.030	1.053	0.000	No	1,187.1	7.1	No	Yes
4/3/2003	971	0.235	1.066	0.000	No	1,113.6	7.0	No	Yes
3/21/2005	18,262	4.717	1.066	0.000	No	1,044.6	7.0	No	Yes
8/11/2005	21,911	6.015	1.092	0.000	No	956.6	6.9	No	Yes
6/1/2006	29,438	8.280	1.052	0.000	No	909.3	6.8	No	Yes
8/10/2006	31,236	8.922	1.056	0.000	No	861.1	6.8	No	Yes
10/19/2006	33,029	9.436	1.105	0.000	No	779.3	6.7	No	Yes
11/21/2006	33,876	9.671	1.075	0.000	No	724.9	6.6	No	Yes

Level: B	LPRM ID No.: 454	Beginning of Life Calibration Current: 1,250.0							
Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.030	1.292	0.000	No	967.5	6.9	No	Yes
4/22/2004	10,709	2.608	0.930	0.000	No	1,040.3	6.9	No	Yes
3/21/2005	18,262	4.597	1.195	0.000	No	870.6	6.8	No	Yes
4/27/2006	28,544	7.731	1.075	0.000	No	809.8	6.7	No	Yes
10/19/2006	33,029	9.053	1.062	0.000	No	762.5	6.6	No	Yes
11/21/2006	33,876	9.289	1.025	0.000	No	743.9	6.6	No	Yes

Level: C	LPRM ID No.: 470	Beginning of Life Calibration Current: 1,250.0							
Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.023	1.103	0.000	No	1,133.3	7.0	No	Yes
9/4/2003	4,813	0.935	0.925	0.000	No	1,225.2	7.1	No	Yes
9/16/2004	14,457	3.063	0.949	0.000	No	1,291.0	7.2	No	Yes
10/21/2004	15,368	3.315	1.055	0.000	No	1,223.7	7.1	No	Yes
3/21/2005	18,262	4.115	1.107	0.000	No	1,105.4	7.0	No	Yes

6/1/2006	29,438	6.888	1.054	0.000	No	1,048.8	7.0	No	Yes
8/10/2006	31,236	7.418	1.061	0.000	No	988.5	6.9	No	Yes
10/19/2006	33,029	7.927	1.096	0.000	No	901.9	6.8	No	Yes
11/21/2006	33,876	8.176	1.083	0.000	No	832.8	6.7	No	Yes

Level: D

LPRM ID No.: 486

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.013	1.121	0.000	No	1,115.1	7.0	No	Yes
9/4/2003	4,813	0.652	0.932	0.000	No	1,196.4	7.1	No	Yes
2/16/2004	8,999	1.242	0.939	0.000	No	1,274.2	7.2	No	Yes
7/8/2004	12,649	1.844	0.925	0.000	No	1,365.0	7.2	No	Yes
3/21/2005	18,262	3.226	1.077	0.000	No	1,267.4	7.1	No	Yes
3/23/2006	27,647	4.636	1.056	0.000	No	1,200.2	7.1	No	Yes
8/10/2006	31,236	5.318	0.946	0.000	No	1,268.7	7.1	No	Yes
11/21/2006	33,876	5.905	1.017	0.000	No	1,247.5	7.1	No	Yes

String No.: 13

Serial No.: 04s82825

Cycle Installed:

11

Coordinates: 41

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 540

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.299	1.137	0.000	No	1,099.4	7.0	No	Yes
9/8/2005	4,465	1.468	0.941	0.000	No	1,168.3	7.1	No	Yes
10/13/2005	5,355	1.713	1.073	0.000	No	1,088.8	7.0	No	Yes
11/21/2006	15,714	4.853	0.994	0.000	No	1,095.4	7.0	No	Yes

Level: B

LPRM ID No.: 550

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.309	1.054	0.000	No	1,186.0	7.1	No	Yes
9/8/2005	4,465	1.389	0.946	0.000	No	1,253.7	7.1	No	Yes
9/14/2006	13,968	4.248	1.055	0.000	No	1,188.3	7.1	No	Yes
11/21/2006	15,714	4.729	1.006	0.000	No	1,181.2	7.1	No	Yes

Level: C

LPRM ID No.: 560

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value

1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.025	1.058	0.000	No	1,181.5	7.1	No	Yes
9/8/2005	4,465	1.018	0.935	0.000	No	1,263.6	7.1	No	Yes
11/21/2006	15,714	4.059	1.024	0.000	No	1,234.0	7.1	No	Yes

Level: D LPRM ID No.: 570

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.016	1.083	0.000	No	1,154.2	7.1	No	Yes
8/11/2005	3,749	0.524	0.948	0.000	No	1,217.5	7.1	No	Yes
6/1/2006	11,276	1.730	0.923	0.000	No	1,319.1	7.2	No	Yes
11/21/2006	15,714	2.615	1.012	0.000	No	1,303.4	7.2	No	Yes

String No.: 14 Serial No.: 02S41542

Cycle Installed:

10

Coordinates: 41 Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A LPRM ID No.: 439

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.238	1.053	0.000	No	1,187.1	7.1	No	Yes
9/4/2003	4,813	1.090	1.058	0.000	No	1,122.0	7.0	No	Yes
10/16/2003	5,819	1.327	0.948	0.000	No	1,183.6	7.1	No	Yes
4/22/2004	10,709	2.469	1.061	0.000	No	1,115.5	7.0	No	Yes
7/8/2004	12,649	2.989	0.933	0.000	No	1,195.6	7.1	No	Yes
10/21/2004	15,368	3.748	1.070	0.000	No	1,117.4	7.0	No	Yes
4/28/2005	19,231	4.919	1.124	0.000	No	994.1	6.9	No	Yes
10/13/2005	23,517	6.329	1.067	0.000	No	931.7	6.8	No	Yes
3/23/2006	27,647	7.402	0.930	0.000	No	1,001.8	6.9	No	Yes
4/27/2006	28,544	7.662	1.051	0.000	No	953.2	6.9	No	Yes
7/6/2006	30,336	8.336	1.051	0.000	No	907.0	6.8	No	Yes
11/21/2006	33,876	9.409	1.058	0.000	No	857.2	6.8	No	Yes

Level: B LPRM ID No.: 455

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.108	0.000	No	1,128.2	7.0	No	Yes
6/12/2003	2,785	0.660	1.070	0.000	No	1,054.4	7.0	No	Yes
3/21/2005	18,262	4.418	1.138	0.000	No	926.5	6.8	No	Yes

8/10/2006	31,236	8.342	1.067	0.000	No	868.3	6.8	No	Yes
11/21/2006	33,876	9.077	1.104	0.000	No	786.5	6.7	No	Yes

Level: C LPRM ID No.: 471

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.021	1.193	0.000	No	1,047.8	7.0	No	Yes
4/3/2003	971	0.171	1.057	0.000	No	991.3	6.9	No	Yes
10/16/2003	5,819	1.122	0.943	0.000	No	1,051.2	7.0	No	Yes
1/21/2005	17,737	3.703	1.060	0.000	No	991.7	6.9	No	Yes
3/21/2005	18,262	3.850	1.156	0.000	No	857.9	6.8	No	Yes
10/19/2006	33,029	7.618	1.056	0.000	No	812.4	6.7	No	Yes
11/21/2006	33,876	7.867	1.013	0.000	No	801.9	6.7	No	Yes

Level: D LPRM ID No.: 487

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.013	1.081	0.000	No	1,156.3	7.1	No	Yes
4/3/2003	971	0.101	1.051	0.000	No	1,100.2	7.0	No	Yes
7/8/2004	12,649	1.605	0.947	0.000	No	1,161.8	7.1	No	Yes
3/21/2005	18,262	2.762	1.211	0.000	No	959.4	6.9	No	Yes
4/28/2005	19,231	2.885	0.921	0.000	No	1,041.7	6.9	No	Yes
11/21/2006	33,876	5.390	1.064	0.000	No	979.0	6.9	No	Yes

String No.: 15

Serial No.: 96S00500

Cycle Installed:

8

Coordinates: 41

Type: NA300

Cumulative Core Average Exposure at BOC:

51,228

Level: A LPRM ID No.: 15

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.	Good					
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
9/17/1999	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/16/1999	48	0.016	1.064	0.000	No	1,168.0	7.1	No	Yes
4/14/2000	8,776	2.464	1.050	0.000	No	1,112.4	7.0	No	Yes
5/18/2000	9,611	2.696	1.030	0.000	No	1,112.0	7.0	No	Yes
8/10/2000	11,664	3.232	1.064	0.000	No	1,045.1	7.0	No	Yes
12/8/2000	14,092	3.719	1.111	0.000	No	940.7	6.8	No	Yes
1/9/2003	15,550	7.812	1.062	0.000	No	512.0	6.2	No	Yes
2/15/2001	15,846	4.111	1.053	0.000	No	893.3	6.8	No	Yes
3/30/2001	16,962	4.351	1.058	0.000	No	844.4	6.7	No	Yes

5/24/2001	18,324	4.670	1.057	0.000	No	798.8	6.7	No	Yes
8/16/2001	20,431	5.152	1.059	0.000	No	754.3	6.6	No	Yes
9/20/2001	21,167	5.297	1.052	0.000	No	717.0	6.6	No	Yes
12/27/2001	23,707	5.882	1.103	0.000	No	650.1	6.5	No	Yes
3/14/2002	25,649	6.294	1.065	0.000	No	610.4	6.4	No	Yes
5/7/2002	26,607	6.491	1.065	0.000	No	573.2	6.4	No	Yes
9/26/2002	30,220	7.187	1.054	0.000	No	543.8	6.3	No	Yes
6/12/2003	35,851	8.474	1.097	0.000	No	466.8	6.1	No	Yes
11/13/2003	39,615	9.310	1.055	0.000	No	442.4	6.1	No	Yes
4/22/2004	43,775	10.318	1.063	0.000	No	416.2	6.0	No	Yes
12/2/2004	49,512	11.839	1.089	0.000	No	382.2	5.9	No	Yes
3/21/2005	51,328	12.375	1.051	0.000	No	363.7	5.9	No	Yes
4/28/2005	52,297	12.651	0.986	0.000	No	368.8	5.9	No	Yes
6/2/2005	53,190	12.938	1.065	0.000	No	346.3	5.8	No	Yes
10/13/2005	56,583	14.121	1.056	0.000	No	327.9	5.8	No	Yes
6/1/2006	62,504	15.904	1.080	0.000	No	303.6	5.7	No	Yes
9/14/2006	65,196	16.714	1.064	0.000	No	285.4	5.7	No	Yes
11/21/2006	66,942	17.191	0.960	0.000	No	297.3	5.7	No	Yes

Level: B

LPRM ID No.: 101

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.013	1.028	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.038	1.038	0.000	No	1,250.0	7.1	No	Yes
5/25/1999	970	0.243	1.057	0.000	No	1,182.6	7.1	No	Yes
2/3/2000	7,038	1.855	1.055	0.000	No	1,120.9	7.0	No	Yes
4/14/2000	8,776	2.304	1.080	0.000	No	1,037.9	6.9	No	Yes
5/18/2000	9,611	2.520	1.048	0.000	No	1,038.0	6.9	No	Yes
7/5/2000	10,747	2.812	1.103	0.000	No	941.1	6.8	No	Yes
8/10/2000	11,664	3.062	1.053	0.000	No	893.7	6.8	No	Yes
9/21/2000	12,742	3.344	1.054	0.000	No	847.9	6.7	No	Yes
10/26/2000	13,620	3.563	1.059	0.000	No	800.7	6.7	No	Yes
12/8/2000	14,092	3.678	1.122	0.000	No	713.6	6.6	No	Yes
2/15/2001	15,846	4.088	1.053	0.000	No	677.7	6.5	No	Yes
3/30/2001	16,962	4.357	1.070	0.000	No	633.4	6.5	No	Yes
5/24/2001	18,324	4.730	1.057	0.000	No	599.2	6.4	No	Yes
8/16/2001	20,431	5.329	1.059	0.000	No	565.8	6.3	No	Yes
10/25/2001	22,080	5.775	1.058	0.000	No	534.8	6.3	No	Yes

1/31/2002	24,595	6.535	1.056	0.000	No	506.4	6.2	No	Yes
5/7/2002	26,607	7.087	1.053	0.000	No	481.0	6.2	No	Yes
8/22/2002	29,375	7.753	1.058	0.000	No	454.6	6.1	No	Yes
2/27/2003	33,184	8.665	1.125	0.000	No	404.1	6.0	No	Yes
6/12/2003	35,851	9.310	1.054	0.000	No	383.4	5.9	No	Yes
3/23/2004	42,997	10.996	1.052	0.000	No	364.4	5.9	No	Yes
6/3/2004	44,858	11.430	1.069	0.000	No	340.9	5.8	No	Yes
3/21/2005	51,328	13.127	1.189	0.000	No	286.7	5.7	No	Yes
10/13/2005	56,583	14.771	1.073	0.000	No	267.2	5.6	No	Yes
4/27/2006	61,610	16.282	1.053	0.000	No	253.8	5.5	No	Yes
10/19/2006	66,095	17.572	1.056	0.000	No	240.3	5.5	No	Yes
11/21/2006	66,942	17.792	1.013	0.000	No	237.2	5.5	No	Yes

Level: C

LPRM ID No.: 187

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.	CalCur		Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected				Value
4/16/1999	48	0.010	0.997	0.000	No	1,250.0	7.1	No	Yes
5/25/1999	970	0.210	0.993	0.000	No	1,255.0	7.1	No	Yes
5/18/2000	9,611	2.134	0.967	0.000	No	1,255.0	7.1	No	Yes
12/8/2000	14,092	3.212	1.136	0.000	No	1,104.8	7.0	No	Yes
1/9/2003	15,550	7.824	1.060	0.000	No	723.3	6.6	No	Yes
3/8/2001	16,387	3.729	1.046	0.000	No	1,056.2	7.0	No	Yes
8/16/2001	20,431	4.774	1.077	0.000	No	980.7	6.9	No	Yes
11/29/2001	22,978	5.386	1.057	0.000	No	927.8	6.8	No	Yes
3/14/2002	25,649	6.025	1.069	0.000	No	867.9	6.8	No	Yes
6/13/2002	27,571	6.485	1.055	0.000	No	822.6	6.7	No	Yes
9/26/2002	30,220	7.159	1.073	0.000	No	766.7	6.6	No	Yes
2/27/2003	33,184	7.898	1.127	0.000	No	641.8	6.5	No	Yes
7/31/2003	36,969	8.741	1.080	0.000	No	594.2	6.4	No	Yes
11/13/2003	39,615	9.301	1.058	0.000	No	561.7	6.3	No	Yes
4/22/2004	43,775	10.115	1.068	0.000	No	525.9	6.3	No	Yes
9/16/2004	47,523	10.942	1.052	0.000	No	499.9	6.2	No	Yes
12/29/2004	50,211	11.720	1.073	0.000	No	465.9	6.1	No	Yes
3/21/2005	51,328	12.039	1.103	0.000	No	422.4	6.0	No	Yes
6/2/2005	53,190	12.431	1.082	0.000	No	390.4	6.0	No	Yes
12/29/2005	58,559	13.804	1.078	0.000	No	362.1	5.9	No	Yes
8/10/2006	64,302	15.368	1.063	0.000	No	340.7	5.8	No	Yes
11/21/2006	66,942	16.129	1.040	0.000	No	327.6	5.8	No	Yes

Level: D		LPRM ID No.: 273		Beginning of Life Calibration Current:				-99.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.005	0.980	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.019	1.004	0.000	No	1,250.0	7.1	No	Yes
12/29/1999	6,155	0.976	0.934	0.000	No	1,338.3	7.2	No	Yes
5/18/2000	9,611	1.469	0.976	0.000	No	1,338.0	7.2	No	Yes
12/8/2000	14,092	2.295	1.112	0.000	No	1,203.2	7.1	No	Yes
12/12/2002	14,860	5.557	1.062	0.000	No	702.5	6.6	No	Yes
3/30/2001	16,962	2.758	1.065	0.000	No	1,129.8	7.0	No	Yes
5/24/2001	18,324	3.015	1.073	0.000	No	1,052.9	7.0	No	Yes
8/16/2001	20,431	3.387	1.084	0.000	No	971.3	6.9	No	Yes
11/29/2001	22,978	3.744	1.084	0.000	No	896.1	6.8	No	Yes
1/31/2002	24,595	3.998	1.055	0.000	No	849.4	6.7	No	Yes
5/7/2002	26,607	4.357	1.072	0.000	No	792.3	6.7	No	Yes
8/22/2002	29,375	4.982	1.062	0.000	No	746.1	6.6	No	Yes
2/27/2003	33,184	5.797	1.069	0.000	No	657.2	6.5	No	Yes
4/3/2003	34,037	5.889	1.061	0.000	No	619.4	6.4	No	Yes
12/18/2003	40,510	6.752	1.057	0.000	No	586.0	6.4	No	Yes
4/22/2004	43,775	7.155	1.004	0.000	No	583.6	6.4	No	Yes
3/21/2005	51,328	8.750	1.228	0.000	No	477.2	6.2	No	Yes
4/28/2005	52,297	8.880	1.029	0.000	No	463.7	6.1	No	Yes
8/11/2005	54,977	9.257	1.094	0.000	No	436.2	6.1	No	Yes
9/8/2005	55,693	9.362	0.945	0.000	No	461.6	6.1	No	Yes
10/13/2005	56,583	9.490	1.088	0.000	No	462.0	6.1	No	Yes
11/17/2005	57,483	9.625	1.147	0.000	No	403.0	6.0	No	Yes
4/27/2006	61,610	10.403	0.941	0.000	No	427.0	6.1	No	Yes
11/21/2006	66,942	11.481	1.056	0.000	No	404.4	6.0	No	Yes

String No.: 16 Serial No.: 02S41549 Cycle Installed: 10

Coordinates: 41 Type: NA300 Cumulative Core Average Exposure at BOC: 18,162

Level: A LPRM ID No.: 440 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.028	1.231	0.000	No	1,015.4	6.9	No	Yes
4/3/2003	971	0.244	1.084	0.000	No	936.7	6.8	No	Yes
11/13/2003	6,549	1.568	1.073	0.000	No	873.0	6.8	No	Yes

1/21/2005	17,737	4.670	1.059	0.000	No	824.4	6.7	No	Yes
3/21/2005	18,262	4.787	1.118	0.000	No	737.4	6.6	No	Yes
9/8/2005	22,627	6.253	0.920	0.000	No	801.5	6.7	No	Yes
12/29/2005	25,493	6.975	1.118	0.000	No	716.9	6.6	No	Yes
11/21/2006	33,876	9.503	0.996	0.000	No	719.8	6.6	No	Yes

Level: B

LPRM ID No.: 456

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.267	0.000	No	986.6	6.9	No	Yes
4/3/2003	971	0.242	1.066	0.000	No	925.5	6.8	No	Yes
7/8/2004	12,649	3.126	0.933	0.000	No	992.0	6.9	No	Yes
10/21/2004	15,368	3.883	1.004	0.000	No	992.0	6.9	No	Yes
3/21/2005	18,262	4.586	1.180	0.000	No	840.7	6.7	No	Yes
8/10/2006	31,236	8.364	1.056	0.000	No	796.1	6.7	No	Yes
10/19/2006	33,029	8.839	1.064	0.000	No	748.2	6.6	No	Yes
11/21/2006	33,876	9.071	1.046	0.000	No	715.3	6.6	No	Yes

Level: C

LPRM ID No.: 472

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.168	1.082	0.000	No	1,155.3	7.1	No	Yes
7/31/2003	3,903	0.662	0.941	0.000	No	1,227.7	7.1	No	Yes
10/16/2003	5,819	1.027	0.943	0.000	No	1,301.9	7.2	No	Yes
3/21/2005	18,262	3.969	1.089	0.000	No	1,195.5	7.1	No	Yes
10/13/2005	23,517	5.189	1.065	0.000	No	1,122.5	7.0	No	Yes
8/10/2006	31,236	7.275	1.054	0.000	No	1,065.0	7.0	No	Yes
11/21/2006	33,876	7.998	1.026	0.000	No	1,038.0	6.9	No	Yes

Level: D

LPRM ID No.: 488

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.011	0.943	0.000	No	1,325.6	7.2	No	Yes
6/12/2003	2,785	0.283	1.059	0.000	No	1,251.7	7.1	No	Yes
10/16/2003	5,819	0.648	0.948	0.000	No	1,320.4	7.2	No	Yes
7/8/2004	12,649	1.603	0.911	0.000	No	1,449.4	7.3	No	Yes
7/7/2005	21,011	3.185	1.061	0.000	No	1,366.0	7.2	No	Yes

11/17/2005	24,417	3.685	1.062	0.000	No	1,286.0	7.2	No	Yes
12/29/2005	25,493	3.852	0.922	0.000	No	1,394.8	7.2	No	Yes
11/21/2006	33,876	5.461	1.064	0.000	No	1,310.9	7.2	No	Yes

String No.: 17	Serial No.: M5421	Cycle Installed: 7
Coordinates: 41	Type: NA300	Cumulative Core Average Exposure at BOC: 61,028
Level: A	LPRM ID No.: 17	Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	9,490	1.281	1.001	0.000	Yes	1,081.0	7.0	No	Yes
8/5/1999	12,541	1.814	1.063	0.000	No	1,016.9	6.9	No	Yes
11/23/1999	15,075	2.299	1.052	0.000	No	966.7	6.9	No	Yes
4/14/2000	18,576	2.855	1.072	0.000	No	901.7	6.8	No	Yes
5/18/2000	19,411	2.984	1.010	0.000	No	902.0	6.8	No	Yes
9/21/2000	22,542	3.595	1.073	0.000	No	840.6	6.7	No	Yes
12/8/2000	23,892	3.776	1.076	0.000	No	781.3	6.7	No	Yes
11/19/2002	24,072	7.188	1.084	0.000	No	524.2	6.3	No	Yes
2/15/2001	25,646	4.075	1.050	0.000	No	744.1	6.6	No	Yes
7/12/2001	29,317	4.661	1.068	0.000	No	696.7	6.5	No	Yes
9/20/2001	30,967	4.956	1.053	0.000	No	661.6	6.5	No	Yes
12/27/2001	33,507	5.481	1.076	0.000	No	614.9	6.4	No	Yes
5/7/2002	36,407	6.175	1.082	0.000	No	568.3	6.3	No	Yes
2/27/2003	42,984	7.456	1.076	0.000	No	487.2	6.2	No	Yes
5/8/2003	44,745	7.869	1.058	0.000	No	460.5	6.1	No	Yes
11/13/2003	49,415	8.855	1.068	0.000	No	431.2	6.1	No	Yes
4/22/2004	53,575	9.817	1.104	0.000	No	390.6	6.0	No	Yes
12/29/2004	60,011	11.186	1.052	0.000	No	371.3	5.9	No	Yes
4/28/2005	62,097	11.584	1.089	0.000	No	340.9	5.8	No	Yes
6/2/2005	62,990	11.797	1.070	0.000	No	318.6	5.8	No	Yes
2/9/2006	69,435	13.036	1.073	0.000	No	297.0	5.7	No	Yes
11/21/2006	76,742	14.119	0.954	0.000	No	311.3	5.7	No	Yes

Level: B	LPRM ID No.: 103	Beginning of Life Calibration Current: 1,250.0
-----------------	-------------------------	---

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	9,490	1.721	1.021	0.000	Yes	1,023.0	6.9	No	Yes
7/1/1999	11,679	2.136	1.051	0.000	No	973.4	6.9	No	Yes
10/14/1999	14,167	2.637	1.054	0.000	No	923.5	6.8	No	Yes
12/29/1999	15,955	3.003	1.068	0.000	No	864.7	6.8	No	Yes

4/14/2000	18,576	3.595	1.069	0.000	No	808.9	6.7	No	Yes
5/18/2000	19,411	3.786	1.031	0.000	No	809.0	6.7	No	Yes
7/5/2000	20,547	4.027	1.067	0.000	No	758.2	6.6	No	Yes
9/21/2000	22,542	4.445	1.066	0.000	No	711.3	6.6	No	Yes
12/8/2000	23,892	4.700	1.085	0.000	No	655.5	6.5	No	Yes
1/9/2003	25,350	8.528	1.050	0.000	No	478.2	6.2	No	Yes
3/8/2001	26,187	5.123	1.053	0.000	No	622.5	6.4	No	Yes
7/12/2001	29,317	5.724	1.079	0.000	No	577.0	6.4	No	Yes
1/31/2002	34,395	6.834	1.068	0.000	No	540.2	6.3	No	Yes
7/18/2002	38,280	7.715	1.076	0.000	No	502.1	6.2	No	Yes
2/27/2003	42,984	8.584	1.094	0.000	No	437.1	6.1	No	Yes
6/12/2003	45,651	9.161	1.057	0.000	No	413.5	6.0	No	Yes
12/18/2003	50,310	10.137	1.059	0.000	No	390.5	6.0	No	Yes
6/3/2004	54,658	11.067	1.060	0.000	No	368.4	5.9	No	Yes
9/16/2004	57,323	11.673	1.063	0.000	No	346.5	5.8	No	Yes
3/21/2005	61,128	12.492	1.099	0.000	No	315.3	5.8	No	Yes
4/28/2005	62,097	12.743	1.063	0.000	No	296.6	5.7	No	Yes
8/11/2005	64,777	13.398	1.057	0.000	No	280.6	5.6	No	Yes
11/17/2005	67,283	13.957	1.064	0.000	No	264.0	5.6	No	Yes
6/1/2006	72,304	15.043	1.071	0.000	No	246.5	5.5	No	Yes
11/21/2006	76,742	15.774	0.983	0.000	No	250.8	5.5	No	Yes

Level: C

LPRM ID No.: 189

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	9,490	1.812	1.035	0.000	Yes	1,001.0	6.9	No	Yes
10/14/1999	14,167	2.550	1.055	0.000	No	948.8	6.9	No	Yes
5/18/2000	19,411	3.417	1.078	0.000	No	880.2	6.8	No	Yes
9/21/2000	22,542	3.987	1.082	0.000	No	813.5	6.7	No	Yes
12/8/2000	23,892	4.276	1.115	0.000	No	729.6	6.6	No	Yes
12/12/2002	24,660	7.539	1.053	0.000	No	521.7	6.3	No	Yes
3/8/2001	26,187	4.682	1.062	0.000	No	687.0	6.5	No	Yes
7/12/2001	29,317	5.253	1.061	0.000	No	647.5	6.5	No	Yes
11/29/2001	32,778	5.860	1.051	0.000	No	616.1	6.4	No	Yes
3/14/2002	35,449	6.315	1.056	0.000	No	583.4	6.4	No	Yes
7/18/2002	38,280	6.873	1.062	0.000	No	549.3	6.3	No	Yes
2/27/2003	42,984	7.730	1.114	0.000	No	468.3	6.1	No	Yes
11/13/2003	49,415	8.598	1.060	0.000	No	441.8	6.1	No	Yes

7/8/2004	55,515	9.544	1.062	0.000	No	416.0	6.0	No	Yes
10/21/2004	58,234	10.101	1.053	0.000	No	395.1	6.0	No	Yes
3/21/2005	61,128	10.773	1.157	0.000	No	341.4	5.8	No	Yes
7/7/2005	63,877	11.273	1.056	0.000	No	323.3	5.8	No	Yes
12/29/2005	68,359	12.172	1.053	0.000	No	307.1	5.7	No	Yes
6/1/2006	72,304	12.990	1.053	0.000	No	291.6	5.7	No	Yes
10/19/2006	75,895	13.791	1.057	0.000	No	275.9	5.6	No	Yes
11/21/2006	76,742	13.963	1.009	0.000	No	273.4	5.6	No	Yes

Level: D

LPRM ID No.: 275

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/12/1996	9,490	1.484	1.019	0.000	Yes	1,197.0	7.1	No Yes
5/18/2000	19,411	2.431	1.037	0.000	No	1,197.0	7.1	No Yes
8/10/2000	21,464	2.635	1.061	0.000	No	1,128.2	7.0	No Yes
12/8/2000	23,892	2.939	1.138	0.000	No	991.4	6.9	No Yes
7/12/2001	29,317	3.479	1.075	0.000	No	922.2	6.8	No Yes
1/31/2002	34,395	3.969	1.070	0.000	No	861.9	6.8	No Yes
7/18/2002	38,280	4.427	1.079	0.000	No	798.8	6.7	No Yes
2/27/2003	42,984	5.047	1.131	0.000	No	706.3	6.6	No Yes
5/8/2003	44,745	5.144	0.945	0.000	No	747.4	6.6	No Yes
6/12/2003	45,651	5.200	1.070	0.000	No	698.5	6.5	No Yes
10/21/2004	58,234	6.382	1.066	0.000	No	655.2	6.5	No Yes
3/21/2005	61,128	6.885	1.145	0.000	No	572.2	6.3	No Yes
10/13/2005	66,383	7.487	1.062	0.000	No	538.8	6.3	No Yes
11/17/2005	67,283	7.621	0.947	0.000	No	569.0	6.3	No Yes
3/23/2006	70,513	8.121	1.051	0.000	No	541.4	6.3	No Yes
7/6/2006	73,202	8.573	1.052	0.000	No	514.6	6.2	No Yes
11/21/2006	76,742	9.226	1.063	0.000	No	484.1	6.2	No Yes

String No.: 18

Serial No.: 03s61366

Cycle Installed:

11

Coordinates: 33

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 541

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
4/28/2005	1,069	0.346	1.120	0.000	No	1,116.1	7.0	No Yes
6/2/2005	1,962	0.601	0.935	0.000	No	1,193.7	7.1	No Yes
12/29/2005	7,331	2.099	1.066	0.000	No	1,119.8	7.0	No Yes

11/21/2006	15,714	4.559	0.983	0.000	No	1,139.1	7.0	No	Yes
Level: B		LPRM ID No.: 551		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.032	0.966	0.000	No	1,250.0	7.1	No	Yes
12/29/2005	7,331	2.039	0.945	0.000	No	1,322.8	7.2	No	Yes
11/21/2006	15,714	4.344	0.990	0.000	No	1,336.1	7.2	No	Yes
Level: C		LPRM ID No.: 561		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
11/17/2005	6,255	1.223	0.948	0.000	No	1,319.0	7.2	No	Yes
4/27/2006	10,382	2.184	0.933	0.000	No	1,413.7	7.3	No	Yes
11/21/2006	15,714	3.649	1.003	0.000	No	1,409.5	7.3	No	Yes
Level: D		LPRM ID No.: 571		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.101	0.905	0.000	No	1,381.2	7.2	No	Yes
12/29/2005	7,331	0.851	0.906	0.000	No	1,524.5	7.3	No	Yes
9/14/2006	13,968	2.003	0.925	0.000	No	1,648.1	7.4	No	Yes
11/21/2006	15,714	2.347	1.018	0.000	No	1,619.0	7.4	No	Yes
String No.: 19		Serial No.: 02S41545		Cycle Installed:				10	
Coordinates: 33		Type: NA300		Cumulative Core Average Exposure at BOC:				18,162	
Level: A		LPRM ID No.: 441		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.030	1.136	0.000	No	1,100.4	7.0	No	Yes
10/16/2003	5,819	1.367	1.072	0.000	No	1,026.4	6.9	No	Yes
7/7/2005	21,011	5.623	1.065	0.000	No	963.8	6.9	No	Yes
8/11/2005	21,911	5.944	1.059	0.000	No	910.1	6.8	No	Yes
12/29/2005	25,493	6.976	0.930	0.000	No	978.6	6.9	No	Yes
4/27/2006	28,544	7.775	1.096	0.000	No	892.9	6.8	No	Yes
10/19/2006	33,029	9.264	1.097	0.000	No	813.9	6.7	No	Yes
11/21/2006	33,876	9.479	0.926	0.000	No	879.0	6.8	No	Yes

Level: B LPRM ID No.: 457

Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.031	1.067	0.000	No	1,171.5	7.1	No	Yes
1/21/2005	17,737	4.496	1.051	0.000	No	1,114.7	7.0	No	Yes
3/21/2005	18,262	4.623	1.067	0.000	No	1,044.7	7.0	No	Yes
11/17/2005	24,417	6.470	1.068	0.000	No	978.0	6.9	No	Yes
6/1/2006	29,438	7.919	1.065	0.000	No	918.3	6.8	No	Yes
8/10/2006	31,236	8.448	1.068	0.000	No	859.8	6.8	No	Yes
10/19/2006	33,029	8.975	1.104	0.000	No	778.8	6.7	No	Yes
11/21/2006	33,876	9.201	1.038	0.000	No	750.3	6.6	No	Yes

Level: C LPRM ID No.: 473

Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.027	1.057	0.000	No	1,182.6	7.1	No	Yes
10/16/2003	5,819	1.377	0.947	0.000	No	1,248.8	7.1	No	Yes
3/21/2005	18,262	4.268	1.123	0.000	No	1,112.0	7.0	No	Yes
2/9/2006	26,569	6.114	1.056	0.000	No	1,053.0	7.0	No	Yes
9/14/2006	32,130	7.660	1.068	0.000	No	986.0	6.9	No	Yes
10/19/2006	33,029	7.932	1.077	0.000	No	915.5	6.8	No	Yes
11/21/2006	33,876	8.174	1.040	0.000	No	880.3	6.8	No	Yes

Level: D LPRM ID No.: 489

Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/16/2003	5,819	0.813	0.941	0.000	No	1,328.4	7.2	No	Yes
3/23/2004	9,931	1.397	0.942	0.000	No	1,410.2	7.3	No	Yes
8/5/2004	13,375	1.869	0.948	0.000	No	1,488.0	7.3	No	Yes
3/21/2005	18,262	3.079	1.161	0.000	No	1,281.7	7.2	No	Yes
6/2/2005	20,124	3.298	0.939	0.000	No	1,364.9	7.2	No	Yes
8/11/2005	21,911	3.540	0.927	0.000	No	1,472.4	7.3	No	Yes
10/13/2005	23,517	3.746	1.051	0.000	No	1,400.9	7.2	No	Yes
2/9/2006	26,569	4.176	1.070	0.000	No	1,309.0	7.2	No	Yes
6/1/2006	29,438	4.760	0.939	0.000	No	1,394.0	7.2	No	Yes
9/14/2006	32,130	5.229	1.078	0.000	No	1,293.2	7.2	No	Yes

10/19/2006	33,029	5.423	0.926	0.000	No	1,396.5	7.2	No	Yes
11/21/2006	33,876	5.622	1.083	0.000	No	1,289.5	7.2	No	Yes

String No.: 20	Serial No.: 00s10717	Cycle Installed:	9
Coordinates: 33	Type: NA300	Cumulative Core Average Exposure at BOC:	37,262
Level: A	LPRM ID No.: 370	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.026	1.080	0.000	No	1,157.4	7.1	Yes
1/11/2001	994	0.200	1.091	0.000	No	1,060.9	7.0	Yes
1/31/2002	10,629	1.725	1.061	0.000	No	999.9	6.9	Yes
7/18/2002	14,514	2.206	1.100	0.000	No	909.0	6.8	Yes
2/27/2003	19,218	3.101	1.177	0.000	No	772.3	6.6	Yes
4/3/2003	20,071	3.314	1.051	0.000	No	734.8	6.6	Yes
7/31/2003	23,003	3.956	1.115	0.000	No	659.0	6.5	Yes
11/13/2003	25,649	4.525	1.060	0.000	No	621.7	6.4	Yes
12/18/2003	26,544	4.719	1.073	0.000	No	579.4	6.4	Yes
2/16/2004	28,099	5.095	1.072	0.000	No	540.5	6.3	Yes
6/3/2004	30,892	5.833	1.057	0.000	No	511.4	6.2	Yes
7/8/2004	31,749	6.085	0.912	0.000	No	560.7	6.3	Yes
9/16/2004	33,557	6.599	1.070	0.000	No	524.0	6.3	Yes
3/21/2005	37,362	7.434	1.172	0.000	No	447.1	6.1	Yes
6/2/2005	39,224	8.030	0.942	0.000	No	474.6	6.2	Yes
7/7/2005	40,111	8.265	1.068	0.000	No	444.0	6.1	Yes
11/17/2005	43,517	9.313	1.147	0.000	No	387.0	6.0	Yes
4/27/2006	47,644	10.387	0.935	0.000	No	413.9	6.0	Yes
6/1/2006	48,538	10.650	1.058	0.000	No	391.2	6.0	Yes
8/10/2006	50,336	11.297	1.111	0.000	No	352.1	5.9	Yes
11/21/2006	52,976	12.033	0.975	0.000	No	361.2	5.9	Yes

Level: B	LPRM ID No.: 378	Beginning of Life Calibration Current:	1,250.0
----------	------------------	--	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
11/19/2002	306	4.071	1.102	0.000	No	780.5	6.7	Yes
1/11/2001	994	0.233	1.052	0.000	No	1,188.2	7.1	Yes
1/9/2003	1,584	4.350	1.004	0.000	No	777.4	6.7	Yes
3/30/2001	2,996	0.706	0.950	0.000	No	1,250.8	7.1	Yes

11/29/2001	9,012	2.135	1.068	0.000	No	1,171.1	7.1	No	Yes
1/31/2002	10,629	2.560	1.081	0.000	No	1,083.4	7.0	No	Yes
3/14/2002	11,683	2.835	1.090	0.000	No	993.9	6.9	No	Yes
6/13/2002	13,605	3.265	1.070	0.000	No	928.9	6.8	No	Yes
8/22/2002	15,409	3.659	1.080	0.000	No	860.1	6.8	No	Yes
3/21/2005	37,362	8.696	0.000	0.000	No	399.0	6.0	No	Yes
11/17/2005	43,517	10.556	1.054	0.000	No	379.0	5.9	No	Yes
2/9/2006	45,669	11.207	1.057	0.000	No	359.0	5.9	No	Yes
9/14/2006	51,230	12.814	1.068	0.000	No	336.1	5.8	No	Yes
11/21/2006	52,976	13.278	1.016	0.000	No	330.8	5.8	No	Yes

Level: C

LPRM ID No.: 386

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.029	1.052	0.000	No	1,188.2	7.1	Yes
11/19/2002	306	3.967	1.057	0.000	No	768.8	6.6	Yes
3/30/2001	2,996	0.706	0.929	0.000	No	1,279.0	7.2	Yes
11/29/2001	9,012	2.065	1.090	0.000	No	1,173.4	7.1	Yes
1/31/2002	10,629	2.420	1.078	0.000	No	1,088.5	7.0	Yes
3/14/2002	11,683	2.654	1.091	0.000	No	997.7	6.9	Yes
5/7/2002	12,641	2.866	1.060	0.000	No	941.2	6.8	Yes
7/18/2002	14,514	3.295	1.099	0.000	No	856.5	6.8	Yes
9/26/2002	16,254	3.742	1.054	0.000	No	812.6	6.7	Yes
2/27/2003	19,218	4.333	1.146	0.000	No	670.8	6.5	Yes
5/8/2003	20,979	4.660	1.061	0.000	No	632.3	6.4	Yes
9/4/2003	23,913	5.240	1.080	0.000	No	585.4	6.4	Yes
12/18/2003	26,544	5.716	1.086	0.000	No	539.1	6.3	Yes
4/22/2004	29,809	6.297	1.055	0.000	No	511.0	6.2	Yes
3/21/2005	37,362	8.039	1.241	0.000	No	411.7	6.0	Yes
2/9/2006	45,669	9.984	1.062	0.000	No	388.0	6.0	Yes
8/10/2006	50,336	11.242	1.061	0.000	No	365.7	5.9	Yes
11/21/2006	52,976	12.022	1.056	0.000	No	346.3	5.8	Yes

Level: D

LPRM ID No.: 394

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.018	1.148	0.000	No	1,088.9	7.0	Yes

11/19/2002	306	3.145	1.064	0.000	No	981.8	6.9	No	Yes
4/16/2001	3,366	0.559	0.939	0.000	No	1,159.6	7.1	No	Yes
1/31/2002	10,629	1.710	0.932	0.000	No	1,244.2	7.1	No	Yes
3/14/2002	11,683	1.918	1.066	0.000	No	1,167.2	7.1	No	Yes
7/18/2002	14,514	2.603	1.054	0.000	No	1,107.4	7.0	No	Yes
8/22/2002	15,409	2.793	1.060	0.000	No	1,044.7	7.0	No	Yes
2/27/2003	19,218	3.475	1.142	0.000	No	859.8	6.8	No	Yes
6/12/2003	21,885	3.840	1.094	0.000	No	785.9	6.7	No	Yes
10/16/2003	24,919	4.295	1.072	0.000	No	733.1	6.6	No	Yes
12/18/2003	26,544	4.486	1.059	0.000	No	692.3	6.5	No	Yes
7/8/2004	31,749	5.071	0.926	0.000	No	747.6	6.6	No	Yes
10/21/2004	34,468	5.523	1.080	0.000	No	692.2	6.5	No	Yes
12/2/2004	35,546	5.752	1.082	0.000	No	639.7	6.5	No	Yes
3/21/2005	37,362	6.129	1.117	0.000	No	572.7	6.4	No	Yes
8/11/2005	41,011	6.677	1.069	0.000	No	535.8	6.3	No	Yes
9/8/2005	41,727	6.797	1.052	0.000	No	509.3	6.2	No	Yes
11/17/2005	43,517	7.054	0.940	0.000	No	542.0	6.3	No	Yes
4/27/2006	47,644	7.703	1.073	0.000	No	505.1	6.2	No	Yes
11/21/2006	52,976	8.757	1.076	0.000	No	469.4	6.2	No	Yes

String No.: 21 Serial No.: 96S00497 Cycle Installed: 8
Coordinates: 33 Type: NA300 Cumulative Core Average Exposure at BOC: 51,228
Level: A LPRM ID No.: 21 Beginning of Life Calibration Current: -99.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.		CalCur		Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected				Value
9/17/1999	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/16/1999	48	0.014	1.016	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.034	1.041	0.000	No	1,250.0	7.1	No	Yes
5/25/1999	970	0.190	1.052	0.000	No	1,177.0	7.1	No	Yes
7/1/1999	1,879	0.352	0.999	0.000	No	1,178.2	7.1	No	Yes
10/26/2000	13,620	3.411	1.058	0.000	No	1,112.5	7.0	No	Yes
12/8/2000	14,092	3.502	1.108	0.000	No	1,004.0	6.9	No	Yes
11/19/2002	14,272	6.179	0.940	0.000	No	883.6	6.8	No	Yes
3/30/2001	16,962	3.996	1.080	0.000	No	929.7	6.8	No	Yes
1/31/2002	24,595	5.322	1.055	0.000	No	881.2	6.8	No	Yes
5/7/2002	26,607	5.678	1.061	0.000	No	830.5	6.7	No	Yes
2/27/2003	33,184	6.550	1.060	0.000	No	833.5	6.7	No	Yes
5/8/2003	34,945	6.993	1.058	0.000	No	787.8	6.7	No	Yes

10/16/2003	38,885	7.793	1.072	0.000	No	734.9	6.6	No	Yes
3/23/2004	42,997	8.537	1.059	0.000	No	694.0	6.5	No	Yes
7/8/2004	45,715	9.099	0.939	0.000	No	739.1	6.6	No	Yes
3/21/2005	51,328	9.936	1.203	0.000	No	614.4	6.4	No	Yes
6/2/2005	53,190	10.535	1.080	0.000	No	568.8	6.3	No	Yes
9/8/2005	55,693	11.228	1.062	0.000	No	535.6	6.3	No	Yes
11/17/2005	57,483	11.955	1.076	0.000	No	498.0	6.2	No	Yes
3/23/2006	60,713	12.932	1.061	0.000	No	469.4	6.2	No	Yes
6/1/2006	62,504	13.350	1.063	0.000	No	441.6	6.1	No	Yes
9/14/2006	65,196	14.124	1.060	0.000	No	416.6	6.0	No	Yes
11/21/2006	66,942	14.585	0.989	0.000	No	421.2	6.0	No	Yes

Level: B

LPRM ID No.: 107

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.013	0.967	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.035	0.996	0.000	No	1,250.0	7.1	No	Yes
5/18/2000	9,611	2.500	0.988	0.000	No	1,250.0	7.1	No	Yes
8/10/2000	11,664	3.079	1.016	0.000	No	1,230.3	7.1	No	Yes
12/8/2000	14,092	3.777	1.148	0.000	No	1,088.9	7.0	No	Yes
11/19/2002	14,272	7.992	1.061	0.000	No	738.8	6.6	No	Yes
3/30/2001	16,962	4.420	1.080	0.000	No	1,008.2	6.9	No	Yes
7/12/2001	19,517	5.089	1.060	0.000	No	951.1	6.9	No	Yes
11/29/2001	22,978	6.013	1.055	0.000	No	901.5	6.8	No	Yes
3/14/2002	25,649	6.849	1.082	0.000	No	833.2	6.7	No	Yes
7/18/2002	28,480	7.458	1.063	0.000	No	783.8	6.7	No	Yes
2/27/2003	33,184	8.344	1.058	0.000	No	698.3	6.5	No	Yes
5/8/2003	34,945	8.765	1.052	0.000	No	663.8	6.5	No	Yes
7/31/2003	36,969	9.215	1.051	0.000	No	631.5	6.4	No	Yes
10/16/2003	38,885	9.605	1.053	0.000	No	599.8	6.4	No	Yes
2/16/2004	42,065	10.208	1.068	0.000	No	561.6	6.3	No	Yes
6/3/2004	44,858	10.774	1.073	0.000	No	523.4	6.3	No	Yes
7/8/2004	45,715	10.949	0.948	0.000	No	552.1	6.3	No	Yes
9/16/2004	47,523	11.321	1.061	0.000	No	520.3	6.3	No	Yes
12/29/2004	50,211	11.789	1.056	0.000	No	492.7	6.2	No	Yes
3/21/2005	51,328	11.980	1.096	0.000	No	449.6	6.1	No	Yes
6/2/2005	53,190	12.613	1.051	0.000	No	427.8	6.1	No	Yes
9/8/2005	55,693	13.295	1.078	0.000	No	396.8	6.0	No	Yes

12/29/2005	58,559	14.310	1.066	0.000	No	372.2	5.9	No	Yes
4/27/2006	61,610	15.178	1.068	0.000	No	348.5	5.9	No	Yes
8/10/2006	64,302	15.953	1.051	0.000	No	331.6	5.8	No	Yes
11/21/2006	66,942	16.697	1.035	0.000	No	320.4	5.8	No	Yes

Level: C

LPRM ID No.: 193

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.009	1.012	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.029	1.028	0.000	No	1,250.0	7.1	No	Yes
5/18/2000	9,611	2.175	0.964	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	14,092	3.371	1.101	0.000	No	1,146.0	7.0	No	Yes
11/19/2002	14,272	7.592	1.081	0.000	No	713.9	6.6	No	Yes
3/30/2001	16,962	4.017	1.049	0.000	No	1,092.5	7.0	No	Yes
7/12/2001	19,517	4.693	1.068	0.000	No	1,022.9	6.9	No	Yes
10/25/2001	22,080	5.331	1.068	0.000	No	957.8	6.9	No	Yes
1/31/2002	24,595	5.986	1.075	0.000	No	891.0	6.8	No	Yes
5/7/2002	26,607	6.525	1.082	0.000	No	823.4	6.7	No	Yes
7/18/2002	28,480	6.980	1.067	0.000	No	771.7	6.6	No	Yes
2/27/2003	33,184	7.966	1.065	0.000	No	670.3	6.5	No	Yes
4/3/2003	34,037	8.112	1.053	0.000	No	636.6	6.5	No	Yes
6/12/2003	35,851	8.431	1.055	0.000	No	603.4	6.4	No	Yes
9/4/2003	37,879	8.802	1.082	0.000	No	573.0	6.4	No	Yes
2/16/2004	42,065	9.423	1.078	0.000	No	531.5	6.3	No	Yes
9/16/2004	47,523	10.337	1.094	0.000	No	485.9	6.2	No	Yes
12/29/2004	50,211	10.861	1.060	0.000	No	458.4	6.1	No	Yes
3/21/2005	51,328	11.076	1.116	0.000	No	410.7	6.0	No	Yes
8/11/2005	54,977	11.915	1.058	0.000	No	388.2	6.0	No	Yes
9/8/2005	55,693	12.073	1.051	0.000	No	369.4	5.9	No	Yes
2/9/2006	59,635	13.163	1.057	0.000	No	349.0	5.9	No	Yes
6/1/2006	62,504	13.865	1.060	0.000	No	329.2	5.8	No	Yes
10/19/2006	66,095	14.883	1.051	0.000	No	313.3	5.7	No	Yes
11/21/2006	66,942	15.145	1.015	0.000	No	308.6	5.7	No	Yes

Level: D

LPRM ID No.: 279

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.005	0.971	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.018	0.978	0.000	No	1,250.0	7.1	No	Yes

11/23/1999	5,275	0.840	0.938	0.000	No	1,332.6	7.2	No	Yes
5/18/2000	9,611	1.511	0.985	0.000	No	1,333.0	7.2	No	Yes
10/26/2000	13,620	2.255	0.949	0.000	No	1,404.6	7.2	No	Yes
12/8/2000	14,092	2.354	1.112	0.000	No	1,263.2	7.1	No	Yes
1/9/2003	15,550	5.973	1.057	0.000	No	957.8	6.9	No	Yes
1/31/2002	24,595	4.166	1.071	0.000	No	1,179.4	7.1	No	Yes
6/13/2002	27,571	4.890	1.099	0.000	No	1,073.2	7.0	No	Yes
8/22/2002	29,375	5.382	1.060	0.000	No	1,012.4	6.9	No	Yes
4/3/2003	34,037	6.107	1.079	0.000	No	887.7	6.8	No	Yes
9/4/2003	37,879	6.574	1.074	0.000	No	826.5	6.7	No	Yes
2/16/2004	42,065	6.966	1.055	0.000	No	783.5	6.7	No	Yes
7/8/2004	45,715	7.325	0.940	0.000	No	833.5	6.7	No	Yes
9/16/2004	47,523	7.543	1.078	0.000	No	773.2	6.7	No	Yes
12/29/2004	50,211	7.948	1.067	0.000	No	724.6	6.6	No	Yes
3/21/2005	51,328	8.130	1.159	0.000	No	625.2	6.4	No	Yes
7/7/2005	54,077	8.589	1.077	0.000	No	580.5	6.4	No	Yes
9/8/2005	55,693	8.895	1.057	0.000	No	549.2	6.3	No	Yes
8/10/2006	64,302	10.365	1.079	0.000	No	509.0	6.2	No	Yes
11/21/2006	66,942	11.000	1.108	0.000	No	459.4	6.1	No	Yes

String No.: 22

Serial No.: 00s10720

Cycle Installed:

9

Coordinates: 33

Type: NA300

Cumulative Core Average Exposure at BOC:

37,262

Level: A

LPRM ID No.: 371

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes

Level: B

LPRM ID No.: 379

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/30/2001	2,996	0.790	1.114	0.000	No	1,122.1	7.0	No	Yes
7/12/2001	5,551	1.387	1.053	0.000	No	1,065.6	7.0	No	Yes
8/16/2001	6,465	1.608	1.055	0.000	No	1,010.1	6.9	No	Yes
10/25/2001	8,114	2.086	1.094	0.000	No	923.3	6.8	No	Yes
12/27/2001	9,741	2.554	1.084	0.000	No	851.7	6.7	No	Yes
3/14/2002	11,683	3.064	1.087	0.000	No	783.6	6.7	No	Yes
6/13/2002	13,605	3.506	1.071	0.000	No	731.6	6.6	No	Yes
8/22/2002	15,409	3.880	1.071	0.000	No	683.1	6.5	No	Yes

2/27/2003	19,218	4.675	1.099	0.000	No	621.6	6.4	No	Yes
7/31/2003	23,003	5.572	1.082	0.000	No	574.5	6.4	No	Yes
12/18/2003	26,544	6.391	1.061	0.000	No	541.4	6.3	No	Yes
3/23/2004	29,031	6.941	1.059	0.000	No	511.3	6.2	No	Yes
9/16/2004	33,557	8.034	1.066	0.000	No	479.6	6.2	No	Yes
3/21/2005	37,362	9.062	1.274	0.000	No	376.5	5.9	No	Yes
10/13/2005	42,617	10.699	1.056	0.000	No	356.5	5.9	No	Yes
2/9/2006	45,669	11.582	1.070	0.000	No	333.0	5.8	No	Yes
8/10/2006	50,336	13.047	1.061	0.000	No	313.9	5.7	No	Yes
11/21/2006	52,976	13.780	1.046	0.000	No	300.1	5.7	No	Yes

Level: C

LPRM ID No.: 387

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/12/2002	894	4.306	1.064	0.000	No	719.4	6.6	No	Yes
1/11/2001	994	0.251	1.052	0.000	No	1,188.2	7.1	No	Yes
8/16/2001	6,465	1.558	1.072	0.000	No	1,108.4	7.0	No	Yes
10/25/2001	8,114	1.988	1.065	0.000	No	1,040.8	6.9	No	Yes
12/27/2001	9,741	2.386	1.054	0.000	No	987.4	6.9	No	Yes
3/14/2002	11,683	2.832	1.106	0.000	No	892.8	6.8	No	Yes
6/13/2002	13,605	3.279	1.083	0.000	No	824.4	6.7	No	Yes
8/22/2002	15,409	3.706	1.077	0.000	No	765.4	6.6	No	Yes
2/27/2003	19,218	4.551	1.079	0.000	No	666.7	6.5	No	Yes
6/12/2003	21,885	5.056	1.059	0.000	No	629.6	6.4	No	Yes
12/18/2003	26,544	5.982	1.056	0.000	No	596.2	6.4	No	Yes
3/23/2004	29,031	6.416	1.060	0.000	No	562.4	6.3	No	Yes
9/16/2004	33,557	7.313	1.058	0.000	No	531.6	6.3	No	Yes
12/29/2004	36,245	8.066	1.056	0.000	No	503.4	6.2	No	Yes
3/21/2005	37,362	8.378	1.217	0.000	No	413.7	6.0	No	Yes
9/8/2005	41,727	9.383	1.063	0.000	No	389.1	6.0	No	Yes
3/23/2006	46,747	10.610	1.059	0.000	No	367.5	5.9	No	Yes
9/14/2006	51,230	11.943	1.068	0.000	No	344.1	5.8	No	Yes
11/21/2006	52,976	12.438	1.047	0.000	No	328.6	5.8	No	Yes

Level: D

LPRM ID No.: 395

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes

11/19/2002	306	3.264	1.057	0.000	No	865.3	6.8	No	Yes
3/30/2001	2,996	0.505	1.052	0.000	No	1,188.2	7.1	No	Yes
4/16/2001	3,366	0.570	0.945	0.000	No	1,257.4	7.1	No	Yes
12/27/2001	9,741	1.613	1.074	0.000	No	1,170.7	7.1	No	Yes
5/7/2002	12,641	2.196	1.102	0.000	No	1,062.4	7.0	No	Yes
6/13/2002	13,605	2.432	1.055	0.000	No	1,007.0	6.9	No	Yes
8/22/2002	15,409	2.874	1.101	0.000	No	914.6	6.8	No	Yes
2/27/2003	19,218	3.626	1.125	0.000	No	769.1	6.6	No	Yes
6/12/2003	21,885	3.959	1.051	0.000	No	731.8	6.6	No	Yes
12/18/2003	26,544	4.640	1.062	0.000	No	689.1	6.5	No	Yes
9/16/2004	33,557	5.499	1.053	0.000	No	654.4	6.5	No	Yes
12/29/2004	36,245	6.112	1.051	0.000	No	622.7	6.4	No	Yes
3/21/2005	37,362	6.385	1.166	0.000	No	534.0	6.3	No	Yes
9/8/2005	41,727	6.999	1.075	0.000	No	496.8	6.2	No	Yes
4/27/2006	47,644	7.934	1.067	0.000	No	465.6	6.1	No	Yes
6/1/2006	48,538	8.093	0.941	0.000	No	494.8	6.2	No	Yes
11/21/2006	52,976	9.000	1.067	0.000	No	463.7	6.1	No	Yes

String No.: 23

Serial No.: 02S41550

Cycle Installed:

10

Coordinates: 33

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 442

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.032	1.071	0.000	No	1,167.1	7.1	No	Yes
1/5/2004	7,911	2.168	1.057	0.000	No	1,104.2	7.0	No	Yes
7/8/2004	12,649	3.479	0.942	0.000	No	1,172.2	7.1	No	Yes
12/2/2004	16,446	4.350	1.102	0.000	No	1,063.7	7.0	No	Yes
1/21/2005	17,737	4.656	0.933	0.000	No	1,140.1	7.0	No	Yes
3/21/2005	18,262	4.747	1.104	0.000	No	1,032.7	6.9	No	Yes
4/28/2005	19,231	5.025	0.932	0.000	No	1,108.0	7.0	No	Yes
7/7/2005	21,011	5.498	1.079	0.000	No	1,026.9	6.9	No	Yes
10/13/2005	23,517	6.216	1.085	0.000	No	946.4	6.9	No	Yes
11/17/2005	24,417	6.509	0.949	0.000	No	997.0	6.9	No	Yes
12/29/2005	25,493	6.869	1.061	0.000	No	939.7	6.8	No	Yes
3/23/2006	27,647	7.418	0.935	0.000	No	1,005.0	6.9	No	Yes
4/27/2006	28,544	7.653	1.064	0.000	No	944.6	6.9	No	Yes
8/10/2006	31,236	8.457	1.051	0.000	No	898.7	6.8	No	Yes

10/19/2006	33,029	9.035	1.084	0.000	No	829.1	6.7	No	Yes
11/21/2006	33,876	9.265	0.941	0.000	No	881.1	6.8	No	Yes

Level: B

LPRM ID No.: 458

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
11/13/2003	6,549	1.719	0.948	0.000	No	1,318.6	7.2	No	Yes
3/21/2005	18,262	4.650	1.162	0.000	No	1,134.7	7.0	No	Yes
8/11/2005	21,911	5.649	1.054	0.000	No	1,076.6	7.0	No	Yes
9/8/2005	22,627	5.849	1.053	0.000	No	1,022.4	6.9	No	Yes
10/13/2005	23,517	6.128	1.089	0.000	No	938.9	6.8	No	Yes
11/17/2005	24,417	6.410	1.055	0.000	No	890.0	6.8	No	Yes
12/29/2005	25,493	6.751	1.064	0.000	No	836.5	6.7	No	Yes
3/23/2006	27,647	7.349	1.090	0.000	No	767.4	6.6	No	Yes
6/1/2006	29,438	7.846	1.064	0.000	No	721.2	6.6	No	Yes
8/10/2006	31,236	8.356	1.066	0.000	No	676.6	6.5	No	Yes
10/19/2006	33,029	8.879	1.058	0.000	No	639.5	6.5	No	Yes
11/21/2006	33,876	9.103	1.015	0.000	No	630.0	6.4	No	Yes

Level: C

LPRM ID No.: 474

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.023	1.108	0.000	No	1,138.0	7.0	No	Yes
1/21/2005	17,737	3.910	1.051	0.000	No	1,082.8	7.0	No	Yes
3/21/2005	18,262	4.066	1.116	0.000	No	970.2	6.9	No	Yes
2/9/2006	26,569	5.881	1.052	0.000	No	922.0	6.8	No	Yes
11/21/2006	33,876	7.860	1.039	0.000	No	887.4	6.8	No	Yes

Level: D

LPRM ID No.: 490

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.011	0.933	0.000	No	1,339.8	7.2	No	Yes
10/16/2003	5,819	0.675	0.911	0.000	No	1,470.7	7.3	No	Yes
7/8/2004	12,649	1.535	0.932	0.000	No	1,578.0	7.4	No	Yes
3/21/2005	18,262	2.843	1.071	0.000	No	1,473.3	7.3	No	Yes
9/8/2005	22,627	3.385	1.076	0.000	No	1,369.3	7.2	No	Yes
10/13/2005	23,517	3.504	0.901	0.000	No	1,519.7	7.3	No	Yes

11/17/2005	24,417	3.630	1.107	0.000	No	1,373.0	7.2	No	Yes
12/29/2005	25,493	3.780	0.936	0.000	No	1,466.9	7.3	No	Yes
3/23/2006	27,647	4.211	1.065	0.000	No	1,377.4	7.2	No	Yes
6/1/2006	29,438	4.544	0.931	0.000	No	1,479.4	7.3	No	Yes
10/19/2006	33,029	5.210	1.066	0.000	No	1,387.8	7.2	No	Yes
11/21/2006	33,876	5.395	1.018	0.000	No	1,363.3	7.2	No	Yes

String No.: 24	Serial No.: 04s82831	Cycle Installed:	11
Coordinates: 33	Type: NA300	Cumulative Core Average Exposure at BOC:	0
Level: A	LPRM ID No.: 542	Beginning of Life Calibration Current:	1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.022	1.106	0.000	No	1,130.2	7.0	No	Yes
4/28/2005	1,069	0.287	1.053	0.000	No	1,073.3	7.0	No	Yes
8/11/2005	3,749	0.877	0.930	0.000	No	1,154.1	7.1	No	Yes
12/29/2005	7,331	1.748	1.086	0.000	No	1,062.7	7.0	No	Yes
11/21/2006	15,714	3.667	0.938	0.000	No	1,133.0	7.0	No	Yes

Level: B	LPRM ID No.: 552	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.027	1.102	0.000	No	1,134.3	7.0	No	Yes
11/21/2006	15,714	3.641	0.976	0.000	No	1,162.2	7.1	No	Yes

Level: C	LPRM ID No.: 562	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.178	1.054	0.000	No	1,186.0	7.1	No	Yes
12/29/2005	7,331	1.286	0.930	0.000	No	1,275.2	7.2	No	Yes
11/21/2006	15,714	3.117	1.002	0.000	No	1,272.7	7.1	No	Yes

Level: D	LPRM ID No.: 572	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.010	0.900	0.000	No	1,388.9	7.2	No	Yes
8/11/2005	3,749	0.325	1.061	0.000	No	1,309.0	7.2	No	Yes
12/29/2005	7,331	0.725	0.911	0.000	No	1,436.9	7.3	No	Yes

11/21/2006	15,714	2.004	0.979	0.000	No	1,467.7	7.3	No	Yes
------------	--------	-------	-------	-------	----	---------	-----	----	-----

String No.: 25	Serial No.: 99s06337	Cycle Installed:	9
Coordinates: 25	Type: NA300	Cumulative Core Average Exposure at BOC:	37,262
Level: A	LPRM ID No.: 372	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.034	1.096	0.000	No	1,140.5	7.0	Yes
4/16/2001	3,366	0.811	1.060	0.000	No	1,076.0	7.0	Yes
9/26/2002	16,254	3.948	1.055	0.000	No	1,019.9	6.9	Yes
2/27/2003	19,218	4.573	1.067	0.000	No	955.8	6.9	Yes
7/31/2003	23,003	5.683	1.055	0.000	No	906.0	6.8	Yes
9/4/2003	23,913	5.934	1.054	0.000	No	859.6	6.8	Yes
12/18/2003	26,544	6.719	1.070	0.000	No	803.3	6.7	Yes
3/23/2004	29,031	7.525	1.075	0.000	No	747.3	6.6	Yes
6/3/2004	30,892	8.181	1.118	0.000	No	668.4	6.5	Yes
9/16/2004	33,557	8.875	1.069	0.000	No	625.3	6.4	Yes
3/21/2005	37,362	9.685	1.078	0.000	No	580.0	6.4	Yes
4/28/2005	38,331	9.991	1.084	0.000	No	535.1	6.3	Yes
6/2/2005	39,224	10.235	0.915	0.000	No	584.8	6.4	Yes
8/11/2005	41,011	10.633	1.105	0.000	No	529.2	6.3	Yes
9/8/2005	41,727	10.801	1.068	0.000	No	495.5	6.2	Yes
2/9/2006	45,669	11.959	1.111	0.000	No	446.0	6.1	Yes
10/19/2006	52,129	13.702	1.096	0.000	No	406.9	6.0	Yes
11/21/2006	52,976	13.969	0.960	0.000	No	423.9	6.0	Yes

Level: B	LPRM ID No.: 380	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/12/2002	894	4.646	1.054	0.000	No	1,112.5	7.0	Yes
7/18/2002	14,514	3.784	1.066	0.000	No	1,172.6	7.1	Yes
5/8/2003	20,979	5.365	1.065	0.000	No	1,044.6	7.0	Yes
9/4/2003	23,913	6.150	1.068	0.000	No	978.1	6.9	Yes
12/18/2003	26,544	6.873	1.069	0.000	No	915.0	6.8	Yes
4/22/2004	29,809	7.770	1.078	0.000	No	848.8	6.7	Yes
8/5/2004	32,475	8.474	1.060	0.000	No	801.0	6.7	Yes

9/16/2004	33,557	8.748	1.053	0.000	No	760.7	6.6	No	Yes
12/29/2004	36,245	9.456	1.081	0.000	No	703.7	6.6	No	Yes
3/21/2005	37,362	9.737	1.176	0.000	No	598.4	6.4	No	Yes
9/8/2005	41,727	10.858	1.055	0.000	No	567.2	6.3	No	Yes
2/9/2006	45,669	11.968	1.081	0.000	No	525.0	6.3	No	Yes
9/14/2006	51,230	13.365	1.058	0.000	No	496.2	6.2	No	Yes
11/21/2006	52,976	13.842	1.017	0.000	No	487.9	6.2	No	Yes

Level: C

LPRM ID No.: 388

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.027	1.080	0.000	No	1,157.4	7.1	No	Yes
1/9/2003	1,584	4.421	1.063	0.000	No	1,100.3	7.0	No	Yes
9/20/2001	7,201	1.647	0.938	0.000	No	1,233.9	7.1	No	Yes
6/13/2002	13,605	3.136	1.055	0.000	No	1,169.6	7.1	No	Yes
6/12/2003	21,885	4.936	1.077	0.000	No	1,021.6	6.9	No	Yes
12/18/2003	26,544	5.824	1.068	0.000	No	956.6	6.9	No	Yes
6/3/2004	30,892	6.701	1.076	0.000	No	889.0	6.8	No	Yes
10/21/2004	34,468	7.541	1.075	0.000	No	827.0	6.7	No	Yes
12/2/2004	35,546	7.848	1.056	0.000	No	783.1	6.7	No	Yes
3/21/2005	37,362	8.374	1.111	0.000	No	704.9	6.6	No	Yes
10/13/2005	42,617	9.360	1.058	0.000	No	666.2	6.5	No	Yes
3/23/2006	46,747	10.310	1.080	0.000	No	616.9	6.4	No	Yes
8/10/2006	50,336	11.223	1.066	0.000	No	578.7	6.4	No	Yes
11/21/2006	52,976	11.963	1.021	0.000	No	566.8	6.3	No	Yes

Level: D

LPRM ID No.: 396

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.012	1.131	0.000	No	1,105.2	7.0	No	Yes
12/12/2002	894	2.697	1.065	0.000	No	963.0	6.9	No	Yes
2/15/2001	1,880	0.207	1.059	0.000	No	1,043.6	7.0	No	Yes
3/30/2001	2,996	0.336	0.953	0.000	No	1,095.1	7.0	No	Yes
9/20/2001	7,201	0.941	0.937	0.000	No	1,168.7	7.1	No	Yes
5/7/2002	12,641	1.668	1.066	0.000	No	1,096.4	7.0	No	Yes
8/22/2002	15,409	2.205	1.069	0.000	No	1,025.6	6.9	No	Yes
2/27/2003	19,218	2.906	1.060	0.000	No	908.5	6.8	No	Yes

9/4/2003	23,913	3.328	1.083	0.000	No	838.9	6.7	No	Yes
6/3/2004	30,892	4.150	1.092	0.000	No	768.2	6.6	No	Yes
12/2/2004	35,546	4.996	1.101	0.000	No	697.7	6.5	No	Yes
3/21/2005	37,362	5.435	1.083	0.000	No	644.3	6.5	No	Yes
4/28/2005	38,331	5.524	0.948	0.000	No	679.6	6.5	No	Yes
6/2/2005	39,224	5.610	1.067	0.000	No	636.9	6.5	No	Yes
12/29/2005	44,593	6.268	1.076	0.000	No	591.9	6.4	No	Yes
9/14/2006	51,230	7.396	1.082	0.000	No	547.1	6.3	No	Yes
10/19/2006	52,129	7.560	0.909	0.000	No	601.8	6.4	No	Yes
11/21/2006	52,976	7.725	1.112	0.000	No	541.2	6.3	No	Yes

String No.: 26 Serial No.: 02S41551 Cycle Installed: 10
Coordinates: 25 Type: NA300 Cumulative Core Average Exposure at BOC: 18,162
Level: A LPRM ID No.: 443 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.030	1.074	0.000	No	1,163.9	7.1	No	Yes
3/23/2004	9,931	2.371	1.063	0.000	No	1,094.9	7.0	No	Yes
10/21/2004	15,368	3.850	0.945	0.000	No	1,158.6	7.1	No	Yes
3/21/2005	18,262	4.522	1.119	0.000	No	1,035.4	6.9	No	Yes
6/2/2005	20,124	5.158	1.054	0.000	No	982.4	6.9	No	Yes
3/23/2006	27,647	7.459	1.073	0.000	No	915.5	6.8	No	Yes
6/1/2006	29,438	8.110	1.053	0.000	No	869.4	6.8	No	Yes
9/14/2006	32,130	9.058	1.068	0.000	No	814.1	6.7	No	Yes
11/21/2006	33,876	9.521	1.111	0.000	No	732.8	6.6	No	Yes

Level: B LPRM ID No.: 459 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.063	0.000	No	1,175.9	7.1	No	Yes
11/13/2003	6,549	1.576	0.976	0.000	No	1,204.8	7.1	No	Yes
7/8/2004	12,649	3.050	0.939	0.000	No	1,252.3	7.1	No	Yes
12/2/2004	16,446	3.997	1.074	0.000	No	1,166.0	7.1	No	Yes
3/21/2005	18,262	4.460	1.132	0.000	No	1,030.1	6.9	No	Yes
11/17/2005	24,417	6.349	1.089	0.000	No	946.0	6.9	No	Yes
2/9/2006	26,569	6.961	1.052	0.000	No	899.0	6.8	No	Yes
4/27/2006	28,544	7.571	1.070	0.000	No	840.2	6.7	No	Yes

7/6/2006	30,336	8.139	1.079	0.000	No	778.7	6.7	No	Yes
8/10/2006	31,236	8.419	1.057	0.000	No	736.7	6.6	No	Yes
10/19/2006	33,029	8.933	1.084	0.000	No	679.6	6.5	No	Yes
11/21/2006	33,876	9.167	1.073	0.000	No	633.4	6.5	No	Yes

Level: C

LPRM ID No.: 475

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.184	1.059	0.000	No	1,180.4	7.1	No	Yes
7/31/2003	3,903	0.741	0.933	0.000	No	1,265.1	7.1	No	Yes
1/5/2004	7,911	1.566	0.949	0.000	No	1,333.1	7.2	No	Yes
3/21/2005	18,262	3.960	1.176	0.000	No	1,133.6	7.0	No	Yes
9/14/2006	32,130	7.497	1.057	0.000	No	1,072.5	7.0	No	Yes
10/19/2006	33,029	7.747	1.073	0.000	No	999.5	6.9	No	Yes
11/21/2006	33,876	7.996	1.071	0.000	No	933.2	6.8	No	Yes

Level: D

LPRM ID No.: 491

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
11/13/2003	6,549	0.853	0.946	0.000	No	1,321.4	7.2	No	Yes
7/8/2004	12,649	1.754	0.913	0.000	No	1,447.3	7.3	No	Yes
3/21/2005	18,262	3.021	1.118	0.000	No	1,294.5	7.2	No	Yes
11/21/2006	33,876	5.605	0.974	0.000	No	1,329.1	7.2	No	Yes

String No.: 27

Serial No.: 96S00498

Cycle Installed:

8

Coordinates: 25

Type: NA300

Cumulative Core Average Exposure at BOC:

51,228

Level: A

LPRM ID No.: 27

Beginning of Life Calibration Current:

1,179.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.014	1.057	0.000	No	1,179.0	7.1	No	Yes
4/20/1999	146	0.036	1.049	0.000	No	1,123.9	7.0	No	Yes
5/18/2000	9,611	2.396	1.076	0.000	No	1,044.5	7.0	No	Yes
9/21/2000	12,742	3.137	1.104	0.000	No	946.1	6.9	No	Yes
12/8/2000	14,092	3.393	1.088	0.000	No	869.6	6.8	No	Yes
2/15/2001	15,846	3.764	1.075	0.000	No	808.9	6.7	No	Yes
3/30/2001	16,962	3.985	1.088	0.000	No	743.5	6.6	No	Yes
7/12/2001	19,517	4.557	1.093	0.000	No	680.3	6.5	No	Yes
9/20/2001	21,167	4.886	1.083	0.000	No	628.1	6.4	No	Yes

11/29/2001	22,978	5.237	1.058	0.000	No	593.7	6.4	No	Yes
3/14/2002	25,649	5.755	1.072	0.000	No	553.8	6.3	No	Yes
7/18/2002	28,480	6.144	1.085	0.000	No	510.4	6.2	No	Yes
4/3/2003	34,037	7.225	1.051	0.000	No	485.7	6.2	No	Yes
7/31/2003	36,969	7.869	1.051	0.000	No	462.1	6.1	No	Yes
12/18/2003	40,510	8.652	1.066	0.000	No	433.5	6.1	No	Yes
4/22/2004	43,775	9.426	1.063	0.000	No	407.8	6.0	No	Yes
3/21/2005	51,328	11.595	1.186	0.000	No	343.8	5.8	No	Yes
4/28/2005	52,297	11.865	0.947	0.000	No	363.1	5.9	No	Yes
6/2/2005	53,190	12.120	1.054	0.000	No	344.5	5.8	No	Yes
10/13/2005	56,583	13.145	1.058	0.000	No	325.6	5.8	No	Yes
12/29/2005	58,559	13.793	1.061	0.000	No	306.9	5.7	No	Yes
3/23/2006	60,713	14.397	0.929	0.000	No	330.3	5.8	No	Yes
6/1/2006	62,504	14.922	1.104	0.000	No	299.2	5.7	No	Yes
11/21/2006	66,942	16.233	1.044	0.000	No	286.6	5.7	No	Yes

Level: B

LPRM ID No.: 113

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good	Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
4/16/1999	48	0.013	1.006	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.036	1.046	0.000	No	1,195.0	7.1	No	Yes
11/23/1999	5,275	1.340	0.949	0.000	No	1,259.2	7.1	No	Yes
5/18/2000	9,611	2.405	1.051	0.000	No	1,198.1	7.1	No	Yes
8/10/2000	11,664	2.922	1.053	0.000	No	1,137.8	7.0	No	Yes
9/21/2000	12,742	3.206	1.059	0.000	No	1,074.4	7.0	No	Yes
10/26/2000	13,620	3.426	1.053	0.000	No	1,020.3	6.9	No	Yes
12/8/2000	14,092	3.543	1.075	0.000	No	949.2	6.9	No	Yes
11/19/2002	14,272	7.993	1.063	0.000	No	477.5	6.2	No	Yes
2/15/2001	15,846	3.961	1.104	0.000	No	859.7	6.8	No	Yes
3/30/2001	16,962	4.232	1.076	0.000	No	799.0	6.7	No	Yes
5/24/2001	18,324	4.613	1.081	0.000	No	739.1	6.6	No	Yes
7/12/2001	19,517	4.954	1.082	0.000	No	683.1	6.5	No	Yes
9/20/2001	21,167	5.422	1.065	0.000	No	641.4	6.5	No	Yes
10/25/2001	22,080	5.674	1.054	0.000	No	608.6	6.4	No	Yes
12/27/2001	23,707	6.185	1.063	0.000	No	572.5	6.4	No	Yes
3/14/2002	25,649	6.726	1.059	0.000	No	540.6	6.3	No	Yes
7/18/2002	28,480	7.370	1.065	0.000	No	507.6	6.2	No	Yes
2/27/2003	33,184	8.370	1.062	0.000	No	449.7	6.1	No	Yes

6/12/2003	35,851	8.990	1.055	0.000	No	426.2	6.1	No	Yes
2/16/2004	42,065	10.394	1.081	0.000	No	394.3	6.0	No	Yes
10/21/2004	48,434	12.004	1.071	0.000	No	368.1	5.9	No	Yes
3/21/2005	51,328	12.736	1.192	0.000	No	308.8	5.7	No	Yes
11/17/2005	57,483	14.564	1.059	0.000	No	292.0	5.7	No	Yes
2/9/2006	59,635	15.244	1.061	0.000	No	275.0	5.6	No	Yes
7/6/2006	63,402	16.310	1.052	0.000	No	261.4	5.6	No	Yes
11/21/2006	66,942	17.305	1.052	0.000	No	248.5	5.5	No	Yes

Level: C

LPRM ID No.: 199

Beginning of Life Calibration Current:

-99.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.009	0.981	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.030	1.004	0.000	No	1,250.0	7.1	No	Yes
5/18/2000	9,611	2.073	0.963	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	14,092	3.128	1.074	0.000	No	1,163.9	7.1	No	Yes
1/9/2003	15,550	7.764	1.069	0.000	No	757.6	6.6	No	Yes
3/30/2001	16,962	3.810	1.053	0.000	No	1,105.3	7.0	No	Yes
8/16/2001	20,431	4.752	1.067	0.000	No	1,035.9	6.9	No	Yes
11/29/2001	22,978	5.387	1.061	0.000	No	976.3	6.9	No	Yes
3/14/2002	25,649	6.049	1.069	0.000	No	913.3	6.8	No	Yes
7/18/2002	28,480	6.732	1.070	0.000	No	853.6	6.7	No	Yes
9/26/2002	30,220	7.193	1.054	0.000	No	809.8	6.7	No	Yes
5/8/2003	34,945	8.202	1.071	0.000	No	707.3	6.6	No	Yes
9/4/2003	37,879	8.870	1.072	0.000	No	659.8	6.5	No	Yes
12/18/2003	40,510	9.361	1.066	0.000	No	619.0	6.4	No	Yes
4/22/2004	43,775	9.928	1.066	0.000	No	580.7	6.4	No	Yes
9/16/2004	47,523	10.768	1.070	0.000	No	542.7	6.3	No	Yes
12/29/2004	50,211	11.520	1.067	0.000	No	508.6	6.2	No	Yes
3/21/2005	51,328	11.811	1.123	0.000	No	452.9	6.1	No	Yes
8/11/2005	54,977	12.583	1.065	0.000	No	425.2	6.1	No	Yes
3/23/2006	60,713	14.022	1.075	0.000	No	395.6	6.0	No	Yes

Level: D

LPRM ID No.: 285

Beginning of Life Calibration Current:

-99.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.005	1.015	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.020	1.059	0.000	No	1,180.0	7.1	No	Yes
11/23/1999	5,275	0.877	0.936	0.000	No	1,260.7	7.1	No	Yes

5/18/2000	9,611	1.508	0.995	0.000	No	1,261.0	7.1	No	Yes
12/8/2000	14,092	2.345	1.138	0.000	No	1,108.1	7.0	No	Yes
3/8/2001	16,387	2.772	1.049	0.000	No	1,056.3	7.0	No	Yes
5/24/2001	18,324	3.173	1.106	0.000	No	955.1	6.9	No	Yes
7/12/2001	19,517	3.396	1.079	0.000	No	885.2	6.8	No	Yes
10/25/2001	22,080	3.825	1.081	0.000	No	818.8	6.7	No	Yes
3/14/2002	25,649	4.486	1.094	0.000	No	748.5	6.6	No	Yes
6/13/2002	27,571	4.962	1.061	0.000	No	705.4	6.6	No	Yes
8/22/2002	29,375	5.443	1.064	0.000	No	663.0	6.5	No	Yes
4/3/2003	34,037	6.275	1.087	0.000	No	609.9	6.4	No	Yes
11/13/2003	39,615	7.027	1.059	0.000	No	576.0	6.4	No	Yes
9/16/2004	47,523	8.017	1.055	0.000	No	545.9	6.3	No	Yes
12/2/2004	49,512	8.482	1.069	0.000	No	510.7	6.2	No	Yes
4/28/2005	52,297	9.023	1.112	0.000	No	459.3	6.1	No	Yes
6/2/2005	53,190	9.152	0.930	0.000	No	493.8	6.2	No	Yes
7/7/2005	54,077	9.286	1.107	0.000	No	446.1	6.1	No	Yes
3/23/2006	60,713	10.299	1.071	0.000	No	416.5	6.0	No	Yes
9/14/2006	65,196	11.065	1.065	0.000	No	391.1	6.0	No	Yes
11/21/2006	66,942	11.485	0.972	0.000	No	402.4	6.0	No	Yes

String No.: 28

Serial No.: 00s10718

Cycle Installed:

9

Coordinates: 25

Type: NA300

Cumulative Core Average Exposure at BOC:

37,262

Level: A

LPRM ID No.: 373

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.		CalCur	By.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected				
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.026	1.090	0.000	No	1,146.8	7.0	No	Yes
11/19/2002	306	2.673	1.053	0.000	No	941.5	6.8	No	Yes
1/9/2003	1,584	2.994	1.067	0.000	No	882.4	6.8	No	Yes
8/16/2001	6,465	1.058	1.004	0.000	No	1,142.2	7.0	No	Yes
1/31/2002	10,629	1.757	1.079	0.000	No	1,062.8	7.0	No	Yes
6/13/2002	13,605	2.163	1.072	0.000	No	991.4	6.9	No	Yes
2/27/2003	19,218	3.063	1.100	0.000	No	802.2	6.7	No	Yes
5/8/2003	20,979	3.471	1.086	0.000	No	738.7	6.6	No	Yes
7/31/2003	23,003	3.903	1.076	0.000	No	686.5	6.5	No	Yes
10/16/2003	24,919	4.306	1.090	0.000	No	629.8	6.4	No	Yes
2/16/2004	28,099	4.961	1.076	0.000	No	585.3	6.4	No	Yes
8/5/2004	32,475	6.045	1.059	0.000	No	553.0	6.3	No	Yes

3/21/2005	37,362	7.236	1.105	0.000	No	500.5	6.2	No	Yes
4/28/2005	38,331	7.558	1.091	0.000	No	458.7	6.1	No	Yes
10/13/2005	42,617	8.820	1.071	0.000	No	428.3	6.1	No	Yes
11/17/2005	43,517	9.124	0.936	0.000	No	458.0	6.1	No	Yes
2/9/2006	45,669	9.756	1.085	0.000	No	422.0	6.0	No	Yes
6/1/2006	48,538	10.491	1.074	0.000	No	392.9	6.0	No	Yes
11/21/2006	52,976	11.867	0.999	0.000	No	393.3	6.0	No	Yes

Level: B

LPRM ID No.: 381

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.030	1.141	0.000	No	1,095.5	7.0	Yes
11/19/2002	306	4.003	1.076	0.000	No	728.1	6.6	Yes
11/29/2001	9,012	2.133	1.053	0.000	No	1,040.4	6.9	Yes
1/31/2002	10,629	2.557	1.080	0.000	No	963.3	6.9	Yes
3/14/2002	11,683	2.832	1.068	0.000	No	902.0	6.8	Yes
6/13/2002	13,605	3.262	1.080	0.000	No	835.2	6.7	Yes
8/22/2002	15,409	3.655	1.066	0.000	No	783.5	6.7	Yes
2/27/2003	19,218	4.355	1.098	0.000	No	663.1	6.5	Yes
5/8/2003	20,979	4.784	1.085	0.000	No	611.2	6.4	Yes
7/31/2003	23,003	5.257	1.067	0.000	No	573.0	6.4	Yes
10/16/2003	24,919	5.698	1.076	0.000	No	532.5	6.3	Yes
3/23/2004	29,031	6.594	1.074	0.000	No	495.8	6.2	Yes
6/3/2004	30,892	6.998	1.054	0.000	No	470.4	6.2	Yes
1/21/2005	36,837	8.509	1.064	0.000	No	442.1	6.1	Yes
3/21/2005	37,362	8.630	1.125	0.000	No	393.0	6.0	Yes
10/13/2005	42,617	10.193	1.079	0.000	No	364.2	5.9	Yes
2/9/2006	45,669	11.139	1.065	0.000	No	342.0	5.8	Yes
8/10/2006	50,336	12.482	1.053	0.000	No	324.8	5.8	Yes
11/21/2006	52,976	13.212	1.038	0.000	No	312.9	5.7	Yes

Level: C

LPRM ID No.: 389

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
12/8/2000	126	0.029	1.139	0.000	No	1,097.5	7.0	Yes
11/19/2002	306	3.912	1.064	0.000	No	721.1	6.6	Yes
3/30/2001	2,996	0.705	0.930	0.000	No	1,180.1	7.1	Yes

9/20/2001	7,201	1.620	1.051	0.000	No	1,122.8	7.0	No	Yes
11/29/2001	9,012	2.062	1.058	0.000	No	1,061.2	7.0	No	Yes
1/31/2002	10,629	2.416	1.095	0.000	No	969.2	6.9	No	Yes
3/14/2002	11,683	2.652	1.057	0.000	No	916.9	6.8	No	Yes
6/13/2002	13,605	3.086	1.121	0.000	No	817.9	6.7	No	Yes
8/22/2002	15,409	3.546	1.066	0.000	No	767.3	6.6	No	Yes
2/27/2003	19,218	4.280	1.115	0.000	No	646.8	6.5	No	Yes
5/8/2003	20,979	4.612	1.071	0.000	No	603.9	6.4	No	Yes
9/4/2003	23,913	5.199	1.062	0.000	No	568.6	6.3	No	Yes
1/5/2004	27,011	5.758	1.057	0.000	No	538.0	6.3	No	Yes
4/22/2004	29,809	6.228	1.051	0.000	No	511.9	6.2	No	Yes
10/21/2004	34,468	7.262	1.062	0.000	No	482.0	6.2	No	Yes
3/21/2005	37,362	7.985	1.182	0.000	No	407.8	6.0	No	Yes
11/17/2005	43,517	9.390	1.068	0.000	No	382.0	5.9	No	Yes
8/10/2006	50,336	11.190	1.060	0.000	No	360.4	5.9	No	Yes
10/19/2006	52,129	11.711	1.061	0.000	No	339.7	5.8	No	Yes
11/21/2006	52,976	11.968	0.977	0.000	No	347.7	5.9	No	Yes

Level: D

LPRM ID No.: 397

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Byp.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.018	1.107	0.000	No	1,129.2	7.0	No	Yes
1/11/2001	994	0.156	1.077	0.000	No	1,048.4	7.0	No	Yes
1/9/2003	1,584	3.381	1.052	0.000	No	868.2	6.8	No	Yes
3/30/2001	2,996	0.493	0.902	0.000	No	1,162.4	7.1	No	Yes
4/16/2001	3,366	0.556	0.934	0.000	No	1,244.5	7.1	No	Yes
12/27/2001	9,741	1.551	1.052	0.000	No	1,183.0	7.1	No	Yes
5/7/2002	12,641	2.116	1.111	0.000	No	1,064.8	7.0	No	Yes
7/18/2002	14,514	2.605	1.104	0.000	No	964.5	6.9	No	Yes
9/26/2002	16,254	2.936	1.056	0.000	No	913.3	6.8	No	Yes
2/27/2003	19,218	3.434	1.084	0.000	No	800.9	6.7	No	Yes
4/3/2003	20,071	3.529	1.051	0.000	No	762.0	6.6	No	Yes
6/12/2003	21,885	3.799	1.053	0.000	No	723.7	6.6	No	Yes
11/13/2003	25,649	4.343	1.080	0.000	No	670.1	6.5	No	Yes
10/21/2004	34,468	5.468	1.055	0.000	No	635.2	6.5	No	Yes
3/21/2005	37,362	6.078	1.205	0.000	No	527.1	6.3	No	Yes
9/8/2005	41,727	6.748	1.066	0.000	No	494.5	6.2	No	Yes

10/13/2005	42,617	6.874	0.936	0.000	No	528.3	6.3	No	Yes
11/17/2005	43,517	7.006	1.089	0.000	No	485.0	6.2	No	Yes
12/29/2005	44,593	7.162	0.929	0.000	No	522.1	6.3	No	Yes
9/14/2006	51,230	8.300	1.052	0.000	No	496.3	6.2	No	Yes
11/21/2006	52,976	8.711	1.104	0.000	No	449.5	6.1	No	Yes

String No.: 29	Serial No.: 02S41554	Cycle Installed:	10
Coordinates: 25	Type: NA300	Cumulative Core Average Exposure at BOC:	18,162
Level: A	LPRM ID No.: 444	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.030	1.223	0.000	No	1,022.1	6.9	No	Yes
4/3/2003	971	0.234	1.065	0.000	No	959.7	6.9	No	Yes
6/12/2003	2,785	0.635	1.053	0.000	No	911.4	6.8	No	Yes
10/16/2003	5,819	1.308	1.080	0.000	No	843.9	6.7	No	Yes
1/5/2004	7,911	1.791	1.041	0.000	No	810.6	6.7	No	Yes
12/29/2004	17,145	4.269	1.078	0.000	No	782.8	6.7	No	Yes
6/2/2005	20,124	5.157	1.069	0.000	No	730.0	6.6	No	Yes
12/29/2005	25,493	6.835	1.054	0.000	No	692.6	6.5	No	Yes
9/14/2006	32,130	8.813	1.061	0.000	No	652.8	6.5	No	Yes
11/21/2006	33,876	9.287	0.973	0.000	No	670.9	6.5	No	Yes

Level: B	LPRM ID No.: 460	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.031	1.210	0.000	No	1,033.1	6.9	No	Yes
6/3/2004	11,792	2.779	1.056	0.000	No	978.3	6.9	No	Yes
3/21/2005	18,262	4.529	1.238	0.000	No	790.2	6.7	No	Yes
4/27/2006	28,544	7.620	1.051	0.000	No	751.9	6.6	No	Yes
10/19/2006	33,029	8.945	1.072	0.000	No	701.4	6.6	No	Yes
11/21/2006	33,876	9.165	1.005	0.000	No	697.9	6.5	No	Yes

Level: C	LPRM ID No.: 476	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.027	1.068	0.000	No	1,170.4	7.1	No	Yes
10/16/2003	5,819	1.386	0.926	0.000	No	1,263.9	7.1	No	Yes

4/22/2004	10,709	2.326	0.944	0.000	No	1,338.9	7.2	No	Yes
3/21/2005	18,262	4.308	1.185	0.000	No	1,129.9	7.0	No	Yes
2/9/2006	26,569	6.268	1.083	0.000	No	1,043.0	6.9	No	Yes
3/23/2006	27,647	6.549	1.058	0.000	No	985.8	6.9	No	Yes
7/6/2006	30,336	7.297	1.091	0.000	No	903.6	6.8	No	Yes
8/10/2006	31,236	7.549	1.058	0.000	No	854.1	6.8	No	Yes
10/19/2006	33,029	8.075	1.097	0.000	No	778.5	6.7	No	Yes
11/21/2006	33,876	8.315	1.032	0.000	No	754.4	6.6	No	Yes

Level: D

LPRM ID No.: 492

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.014	1.164	0.000	No	1,073.9	7.0	No	Yes
2/16/2004	8,999	1.271	0.942	0.000	No	1,140.0	7.0	No	Yes
12/29/2004	17,145	2.747	0.946	0.000	No	1,205.1	7.1	No	Yes
3/21/2005	18,262	3.037	1.138	0.000	No	1,058.9	7.0	No	Yes
4/28/2005	19,231	3.169	1.064	0.000	No	995.2	6.9	No	Yes
6/2/2005	20,124	3.294	0.935	0.000	No	1,064.4	7.0	No	Yes
8/11/2005	21,911	3.554	1.052	0.000	No	1,011.8	6.9	No	Yes
9/8/2005	22,627	3.660	0.942	0.000	No	1,074.1	7.0	No	Yes
6/1/2006	29,438	4.817	0.932	0.000	No	1,152.5	7.0	No	Yes
10/19/2006	33,029	5.495	1.059	0.000	No	1,088.3	7.0	No	Yes
11/21/2006	33,876	5.714	0.984	0.000	No	1,106.0	7.0	No	Yes

String No.: 30

Serial No.: 00s10722

Cycle Installed:

9

Coordinates: 25

Type: NA300

Cumulative Core Average Exposure at BOC:

37,262

Level: A

LPRM ID No.: 374

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.031	1.121	0.000	No	1,115.1	7.0	No	Yes
11/19/2002	306	3.689	1.068	0.000	No	796.2	6.7	No	Yes
1/31/2002	10,629	2.113	1.072	0.000	No	1,040.2	6.9	No	Yes
3/14/2002	11,683	2.336	1.060	0.000	No	981.3	6.9	No	Yes
6/13/2002	13,605	2.720	1.052	0.000	No	932.8	6.8	No	Yes
8/22/2002	15,409	3.122	1.097	0.000	No	850.3	6.7	No	Yes
2/27/2003	19,218	4.010	1.102	0.000	No	722.5	6.6	No	Yes
5/8/2003	20,979	4.459	1.100	0.000	No	656.8	6.5	No	Yes

7/31/2003	23,003	4.946	1.070	0.000	No	613.8	6.4	No	Yes
10/16/2003	24,919	5.466	1.110	0.000	No	553.0	6.3	No	Yes
2/16/2004	28,099	6.395	1.087	0.000	No	508.7	6.2	No	Yes
6/3/2004	30,892	7.205	1.068	0.000	No	476.4	6.2	No	Yes
9/16/2004	33,557	7.982	1.053	0.000	No	452.4	6.1	No	Yes
3/21/2005	37,362	8.789	1.106	0.000	No	409.0	6.0	No	Yes
9/8/2005	41,727	10.115	1.075	0.000	No	380.5	5.9	No	Yes
11/17/2005	43,517	10.677	1.064	0.000	No	358.0	5.9	No	Yes
6/1/2006	48,538	12.057	1.054	0.000	No	339.7	5.8	No	Yes
11/21/2006	52,976	13.498	1.086	0.000	No	312.8	5.7	No	Yes

Level: B

LPRM ID No.: 382

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.030	1.087	0.000	No	1,150.0	7.0	No	Yes
1/9/2003	1,584	4.448	1.065	0.000	No	750.8	6.6	No	Yes
4/16/2001	3,366	0.774	0.946	0.000	No	1,215.6	7.1	No	Yes
10/25/2001	8,114	1.850	1.082	0.000	No	1,123.5	7.0	No	Yes
1/31/2002	10,629	2.495	1.092	0.000	No	1,028.8	6.9	No	Yes
5/7/2002	12,641	2.992	1.127	0.000	No	912.9	6.8	No	Yes
7/18/2002	14,514	3.434	1.076	0.000	No	848.4	6.7	No	Yes
9/26/2002	16,254	3.887	1.061	0.000	No	799.6	6.7	No	Yes
2/27/2003	19,218	4.520	1.089	0.000	No	689.5	6.5	No	Yes
5/8/2003	20,979	4.968	1.057	0.000	No	652.3	6.5	No	Yes
7/31/2003	23,003	5.467	1.085	0.000	No	601.2	6.4	No	Yes
10/16/2003	24,919	5.974	1.075	0.000	No	559.2	6.3	No	Yes
1/5/2004	27,011	6.549	1.058	0.000	No	528.6	6.3	No	Yes
4/22/2004	29,809	7.218	1.057	0.000	No	500.1	6.2	No	Yes
9/16/2004	33,557	8.219	1.094	0.000	No	457.1	6.1	No	Yes
12/29/2004	36,245	8.882	1.058	0.000	No	432.0	6.1	No	Yes
3/21/2005	37,362	9.176	1.184	0.000	No	364.9	5.9	No	Yes
12/29/2005	44,593	11.318	1.053	0.000	No	346.5	5.8	No	Yes
7/6/2006	49,436	12.675	1.056	0.000	No	328.2	5.8	No	Yes
10/19/2006	52,129	13.456	1.051	0.000	No	312.2	5.7	No	Yes

Level: C

LPRM ID No.: 390

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value

10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.026	1.075	0.000	No	1,162.8	7.1	No	Yes
11/19/2002	306	3.811	1.064	0.000	No	761.5	6.6	No	Yes
10/25/2001	8,114	1.711	1.074	0.000	No	1,082.7	7.0	No	Yes
12/27/2001	9,741	2.052	1.056	0.000	No	1,025.3	6.9	No	Yes
3/14/2002	11,683	2.449	1.093	0.000	No	938.0	6.8	No	Yes
5/7/2002	12,641	2.657	1.075	0.000	No	872.6	6.8	No	Yes
7/18/2002	14,514	3.111	1.077	0.000	No	810.2	6.7	No	Yes
2/27/2003	19,218	4.214	1.138	0.000	No	669.1	6.5	No	Yes
5/8/2003	20,979	4.543	1.054	0.000	No	634.8	6.5	No	Yes
9/4/2003	23,913	5.080	1.058	0.000	No	600.0	6.4	No	Yes
12/18/2003	26,544	5.662	1.068	0.000	No	561.8	6.3	No	Yes
2/16/2004	28,099	6.027	1.059	0.000	No	530.5	6.3	No	Yes
8/5/2004	32,475	6.928	1.069	0.000	No	496.0	6.2	No	Yes
12/2/2004	35,546	7.749	1.070	0.000	No	463.6	6.1	No	Yes
3/21/2005	37,362	8.274	1.183	0.000	No	391.8	6.0	No	Yes
10/13/2005	42,617	9.401	1.057	0.000	No	370.7	5.9	No	Yes
7/6/2006	49,436	11.136	1.062	0.000	No	349.1	5.9	No	Yes
11/21/2006	52,976	12.164	1.059	0.000	No	329.6	5.8	No	Yes

Level: D

LPRM ID No.: 398

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.013	1.103	0.000	No	1,133.3	7.0	No	Yes
11/19/2002	306	2.583	1.085	0.000	No	1,055.1	7.0	No	Yes
1/9/2003	1,584	2.873	1.057	0.000	No	998.2	6.9	No	Yes
4/16/2001	3,366	0.418	0.932	0.000	No	1,216.0	7.1	No	Yes
3/14/2002	11,683	1.532	0.940	0.000	No	1,293.6	7.2	No	Yes
5/7/2002	12,641	1.668	1.063	0.000	No	1,216.9	7.1	No	Yes
7/18/2002	14,514	2.044	1.063	0.000	No	1,144.8	7.0	No	Yes
2/27/2003	19,218	2.927	1.078	0.000	No	926.0	6.8	No	Yes
6/12/2003	21,885	3.240	1.082	0.000	No	855.8	6.8	No	Yes
12/18/2003	26,544	3.870	1.065	0.000	No	803.6	6.7	No	Yes
4/22/2004	29,809	4.357	1.057	0.000	No	760.2	6.6	No	Yes
10/21/2004	34,468	5.216	1.096	0.000	No	693.6	6.5	No	Yes
12/29/2004	36,245	5.688	1.051	0.000	No	660.0	6.5	No	Yes
3/21/2005	37,362	5.999	1.157	0.000	No	570.4	6.3	No	Yes

8/11/2005	41,011	6.446	1.079	0.000	No	528.7	6.3	No	Yes
12/29/2005	44,593	6.956	0.947	0.000	No	558.3	6.3	No	Yes
3/23/2006	46,747	7.377	1.070	0.000	No	521.7	6.3	No	Yes
11/21/2006	52,976	8.617	1.041	0.000	No	501.2	6.2	No	Yes

String No.: 31	Serial No.: 04s82828	Cycle Installed:	11
Coordinates: 25	Type: NA300	Cumulative Core Average Exposure at BOC:	0
Level: A	LPRM ID No.: 543	Beginning of Life Calibration Current:	1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	By.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.286	1.125	0.000	No	1,111.1	7.0	No	Yes
7/7/2005	2,849	0.709	0.949	0.000	No	1,170.8	7.1	No	Yes
9/8/2005	4,465	1.056	1.080	0.000	No	1,084.1	7.0	No	Yes
3/23/2006	9,485	2.196	0.920	0.000	No	1,178.4	7.1	No	Yes
6/1/2006	11,276	2.552	1.083	0.000	No	1,088.1	7.0	No	Yes
11/21/2006	15,714	3.414	1.009	0.000	No	1,078.4	7.0	No	Yes

Level: B	LPRM ID No.: 553	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	By.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/19/2006	14,867	3.305	1.074	0.000	No	1,163.9	7.1	No	Yes
11/21/2006	15,714	3.488	0.968	0.000	No	1,202.3	7.1	No	Yes

Level: C	LPRM ID No.: 563	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	By.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/7/2005	2,849	0.474	1.052	0.000	No	1,188.2	7.1	No	Yes
3/23/2006	9,485	1.746	0.940	0.000	No	1,264.1	7.1	No	Yes
11/21/2006	15,714	3.121	1.031	0.000	No	1,226.0	7.1	No	Yes

Level: D	LPRM ID No.: 573	Beginning of Life Calibration Current:	1,250.0
-----------------	-------------------------	---	---------

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good			
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	By.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.010	0.881	0.000	No	1,418.8	7.3	No	Yes
4/28/2005	1,069	0.089	0.932	0.000	No	1,522.4	7.3	No	Yes
8/11/2005	3,749	0.338	1.077	0.000	No	1,413.5	7.3	No	Yes
9/8/2005	4,465	0.415	0.898	0.000	No	1,574.1	7.4	No	Yes

10/13/2005	5,355	0.520	1.073	0.000	No	1,467.0	7.3	No	Yes
6/1/2006	11,276	1.337	0.917	0.000	No	1,599.8	7.4	No	Yes
7/6/2006	12,174	1.485	1.073	0.000	No	1,490.9	7.3	No	Yes
11/21/2006	15,714	2.091	0.954	0.000	No	1,562.8	7.4	No	Yes

String No.: 32	Serial No.: 04s82832	Cycle Installed: 11
Coordinates: 17	Type: NA300	Cumulative Core Average Exposure at BOC: 0
Level: A	LPRM ID No.: 544	Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/29/2005	7,331	1.733	1.075	0.000	No	1,162.8	7.1	No	Yes
11/21/2006	15,714	3.555	0.966	0.000	No	1,203.7	7.1	No	Yes

Level: B	LPRM ID No.: 554	Beginning of Life Calibration Current: 1,250.0							
Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.278	1.062	0.000	No	1,177.0	7.1	No	Yes
11/21/2006	15,714	3.664	1.000	0.000	No	1,177.0	7.1	No	Yes

Level: C	LPRM ID No.: 564	Beginning of Life Calibration Current: 1,250.0							
Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.203	1.054	0.000	No	1,186.0	7.1	No	Yes
12/29/2005	7,331	1.545	0.946	0.000	No	1,253.7	7.1	No	Yes
11/21/2006	15,714	3.394	1.036	0.000	No	1,210.1	7.1	No	Yes

Level: D	LPRM ID No.: 574	Beginning of Life Calibration Current: 1,250.0							
Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.011	0.890	0.000	No	1,404.5	7.2	No	Yes
6/2/2005	1,962	0.195	1.071	0.000	No	1,311.4	7.2	No	Yes
7/7/2005	2,849	0.289	0.927	0.000	No	1,414.7	7.3	No	Yes
11/17/2005	6,255	0.751	1.062	0.000	No	1,332.0	7.2	No	Yes
12/29/2005	7,331	0.915	0.893	0.000	No	1,491.6	7.3	No	Yes
4/27/2006	10,382	1.394	1.051	0.000	No	1,419.2	7.3	No	Yes
6/1/2006	11,276	1.532	0.915	0.000	No	1,551.1	7.3	No	Yes
11/21/2006	15,714	2.297	1.058	0.000	No	1,466.0	7.3	No	Yes

String No.: 33		Serial No.: 02S41552		Cycle Installed:		10			
Coordinates: 17		Type: NA300		Cumulative Core Average Exposure at BOC:		18,162			
Level: A		LPRM ID No.: 445		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.087	0.000	No	1,150.0	7.0	No	Yes
9/4/2003	4,813	1.039	1.059	0.000	No	1,085.9	7.0	No	Yes
1/5/2004	7,911	1.764	0.915	0.000	No	1,186.8	7.1	No	Yes
2/16/2004	8,999	2.104	1.089	0.000	No	1,089.8	7.0	No	Yes
3/21/2005	18,262	4.846	1.122	0.000	No	971.3	6.9	No	Yes
8/11/2005	21,911	6.052	1.056	0.000	No	919.8	6.8	No	Yes
9/14/2006	32,130	9.077	1.069	0.000	No	860.4	6.8	No	Yes
10/19/2006	33,029	9.340	0.947	0.000	No	908.6	6.8	No	Yes
11/21/2006	33,876	9.586	1.039	0.000	No	874.5	6.8	No	Yes
Level: B		LPRM ID No.: 461		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.084	0.000	No	1,153.1	7.1	No	Yes
11/13/2003	6,549	1.788	1.054	0.000	No	1,094.1	7.0	No	Yes
12/29/2004	17,145	4.638	1.052	0.000	No	1,040.0	6.9	No	Yes
3/21/2005	18,262	4.921	1.154	0.000	No	901.2	6.8	No	Yes
6/1/2006	29,438	8.208	1.075	0.000	No	838.3	6.7	No	Yes
7/6/2006	30,336	8.454	1.091	0.000	No	768.4	6.6	No	Yes
8/10/2006	31,236	8.698	1.065	0.000	No	721.5	6.6	No	Yes
10/19/2006	33,029	9.189	1.084	0.000	No	665.6	6.5	No	Yes
11/21/2006	33,876	9.428	1.040	0.000	No	640.0	6.5	No	Yes
Level: C		LPRM ID No.: 477		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	0.772	0.921	0.000	No	1,369.0	7.2	No	Yes
2/16/2004	8,999	1.828	0.942	0.000	No	1,453.3	7.3	No	Yes
1/21/2005	17,737	3.999	1.014	0.000	No	1,433.2	7.3	No	Yes
Level: D		LPRM ID No.: 493		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.011	0.930	0.000	No	1,344.1	7.2	No	Yes
11/13/2003	6,549	0.736	0.947	0.000	No	1,419.3	7.3	No	Yes
1/5/2004	7,911	0.904	1.069	0.000	No	1,327.7	7.2	No	Yes
2/16/2004	8,999	1.052	0.907	0.000	No	1,463.8	7.3	No	Yes
3/21/2005	18,262	2.897	1.055	0.000	No	1,387.5	7.2	No	Yes
9/8/2005	22,627	3.465	1.075	0.000	No	1,290.7	7.2	No	Yes
11/17/2005	24,417	3.752	0.937	0.000	No	1,377.0	7.2	No	Yes
10/19/2006	33,029	5.347	1.053	0.000	No	1,307.7	7.2	No	Yes
11/21/2006	33,876	5.545	0.997	0.000	No	1,311.6	7.2	No	Yes

String No.: 34

Serial No.: 00s10716

Cycle Installed:

8

Coordinates: 17

Type: NA300

Cumulative Core Average Exposure at BOC:

51,228

Level: A

LPRM ID No.: 375

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal		Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.025	1.106	0.000	No	1,130.2	7.0	No	Yes
11/19/2002	306	3.370	1.071	0.000	No	807.8	6.7	No	Yes
1/11/2001	994	0.189	1.060	0.000	No	1,066.2	7.0	No	Yes
1/9/2003	1,584	3.673	1.063	0.000	No	759.9	6.6	No	Yes
5/24/2001	4,358	0.747	0.933	0.000	No	1,142.8	7.0	No	Yes
11/29/2001	9,012	1.546	1.055	0.000	No	1,083.2	7.0	No	Yes
1/31/2002	10,629	1.856	1.057	0.000	No	1,024.8	6.9	No	Yes
6/13/2002	13,605	2.429	1.073	0.000	No	955.1	6.9	No	Yes
8/22/2002	15,409	2.779	1.104	0.000	No	865.1	6.8	No	Yes
2/27/2003	19,218	3.738	1.084	0.000	No	701.0	6.6	No	Yes
5/8/2003	20,979	4.146	1.079	0.000	No	649.7	6.5	No	Yes
9/4/2003	23,913	4.786	1.055	0.000	No	615.8	6.4	No	Yes
10/16/2003	24,919	5.034	1.052	0.000	No	585.4	6.4	No	Yes
2/16/2004	28,099	5.802	1.096	0.000	No	534.1	6.3	No	Yes
4/22/2004	29,809	6.239	1.052	0.000	No	507.7	6.2	No	Yes
3/21/2005	37,362	8.173	1.130	0.000	No	449.3	6.1	No	Yes
4/28/2005	38,331	8.501	1.098	0.000	No	409.2	6.0	No	Yes
7/7/2005	40,111	9.122	1.053	0.000	No	388.6	6.0	No	Yes
9/8/2005	41,727	9.696	0.942	0.000	No	412.5	6.0	No	Yes
10/13/2005	42,617	9.939	1.088	0.000	No	379.2	5.9	No	Yes

4/27/2006	61,610	11.302	1.090	0.000	No	347.8	5.9	No	Yes
8/10/2006	64,302	12.305	1.054	0.000	No	330.0	5.8	No	Yes
11/21/2006	66,942	13.071	1.048	0.000	No	314.9	5.8	No	Yes

Level: B

LPRM ID No.: 383

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
12/8/2000	126	0.027	1.113	0.000	No	1,123.1	7.0	No Yes
11/19/2002	306	4.023	1.057	0.000	No	761.3	6.6	No Yes
12/27/2001	9,741	2.181	1.071	0.000	No	1,048.6	7.0	No Yes
1/31/2002	10,629	2.407	1.051	0.000	No	997.8	6.9	No Yes
3/14/2002	11,683	2.672	1.066	0.000	No	936.0	6.8	No Yes
6/13/2002	13,605	3.144	1.080	0.000	No	866.6	6.8	No Yes
8/22/2002	15,409	3.560	1.077	0.000	No	804.7	6.7	No Yes
2/27/2003	19,218	4.423	1.095	0.000	No	695.2	6.5	No Yes
4/3/2003	20,071	4.630	1.059	0.000	No	656.5	6.5	No Yes
6/12/2003	21,885	5.063	1.066	0.000	No	615.9	6.4	No Yes
9/4/2003	23,913	5.547	1.053	0.000	No	584.9	6.4	No Yes
12/18/2003	26,544	6.189	1.068	0.000	No	547.6	6.3	No Yes
4/22/2004	29,809	6.942	1.072	0.000	No	510.8	6.2	No Yes
9/16/2004	33,557	7.899	1.074	0.000	No	475.6	6.2	No Yes
1/21/2005	36,837	8.693	1.053	0.000	No	451.7	6.1	No Yes
3/21/2005	37,362	8.836	1.186	0.000	No	380.9	5.9	No Yes
10/13/2005	42,617	10.457	1.081	0.000	No	352.3	5.9	No Yes
3/23/2006	60,713	11.606	1.051	0.000	No	335.2	5.8	No Yes
8/10/2006	64,302	12.702	1.063	0.000	No	315.4	5.8	No Yes
10/19/2006	66,095	13.216	1.052	0.000	No	299.8	5.7	No Yes
11/21/2006	66,942	13.450	1.018	0.000	No	294.5	5.7	No Yes

Level: C

LPRM ID No.: 391

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.					Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
12/8/2000	126	0.025	1.133	0.000	No	1,103.3	7.0	No Yes
11/19/2002	306	3.733	1.051	0.000	No	815.8	6.7	No Yes
1/11/2001	994	0.205	1.054	0.000	No	1,046.7	7.0	No Yes
3/30/2001	2,996	0.622	0.887	0.000	No	1,180.1	7.1	No Yes
12/27/2001	9,741	2.033	1.059	0.000	No	1,114.3	7.0	No Yes

3/14/2002	11,683	2.436	1.090	0.000	No	1,022.3	6.9	No	Yes
6/13/2002	13,605	2.857	1.084	0.000	No	943.1	6.8	No	Yes
8/22/2002	15,409	3.274	1.100	0.000	No	857.4	6.8	No	Yes
2/27/2003	19,218	4.140	1.097	0.000	No	743.6	6.6	No	Yes
4/3/2003	20,071	4.294	1.055	0.000	No	704.9	6.6	No	Yes
6/12/2003	21,885	4.637	1.051	0.000	No	670.7	6.5	No	Yes
9/4/2003	23,913	5.027	1.062	0.000	No	631.5	6.4	No	Yes
2/16/2004	28,099	5.932	1.071	0.000	No	589.6	6.4	No	Yes
4/22/2004	29,809	6.254	1.055	0.000	No	558.9	6.3	No	Yes
9/16/2004	33,557	7.062	1.060	0.000	No	527.3	6.3	No	Yes
12/2/2004	35,546	7.571	1.056	0.000	No	499.3	6.2	No	Yes
3/21/2005	37,362	8.062	1.226	0.000	No	407.3	6.0	No	Yes
10/13/2005	42,617	9.259	1.073	0.000	No	379.6	5.9	No	Yes
3/23/2006	60,713	10.254	1.058	0.000	No	358.8	5.9	No	Yes
9/14/2006	65,196	11.558	1.080	0.000	No	332.2	5.8	No	Yes
11/21/2006	66,942	12.056	1.030	0.000	No	322.5	5.8	No	Yes

Level: D

LPRM ID No.: 399

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.	CalCur		Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected				Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.014	1.109	0.000	No	1,127.1	7.0	No	Yes
11/19/2002	306	2.587	1.061	0.000	No	935.0	6.8	No	Yes
1/9/2003	1,584	2.877	1.055	0.000	No	886.3	6.8	No	Yes
3/30/2001	2,996	0.385	0.944	0.000	No	1,194.0	7.1	No	Yes
1/31/2002	10,629	1.420	1.060	0.000	No	1,126.4	7.0	No	Yes
6/13/2002	13,605	1.862	1.067	0.000	No	1,055.7	7.0	No	Yes
8/22/2002	15,409	2.218	1.062	0.000	No	994.1	6.9	No	Yes
9/26/2002	16,254	2.378	1.066	0.000	No	932.5	6.8	No	Yes
4/3/2003	20,071	3.018	1.087	0.000	No	815.3	6.7	No	Yes
9/4/2003	23,913	3.527	1.058	0.000	No	770.6	6.6	No	Yes
1/5/2004	27,011	3.969	1.057	0.000	No	729.1	6.6	No	Yes
9/16/2004	33,557	4.975	1.071	0.000	No	680.7	6.5	No	Yes
12/29/2004	36,245	5.626	1.082	0.000	No	629.1	6.4	No	Yes
1/21/2005	36,837	5.790	1.058	0.000	No	594.7	6.4	No	Yes
3/21/2005	37,362	5.921	1.117	0.000	No	532.4	6.3	No	Yes
4/28/2005	38,331	6.035	0.947	0.000	No	562.2	6.3	No	Yes
9/8/2005	41,727	6.488	1.082	0.000	No	519.6	6.3	No	Yes

11/17/2005	43,517	6.725	0.886	0.000	No	586.0	6.4	No	Yes
12/29/2005	44,593	6.870	1.150	0.000	No	509.6	6.2	No	Yes
10/19/2006	66,095	8.333	1.058	0.000	No	481.6	6.2	No	Yes
11/21/2006	66,942	8.542	0.970	0.000	No	496.5	6.2	No	Yes

String No.: 35	Serial No.: 96S00496	Cycle Installed:	8
Coordinates: 17	Type: NA300	Cumulative Core Average Exposure at BOC:	51,228
Level: A	LPRM ID No.: 35	Beginning of Life Calibration Current:	-99.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.			Good		
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
9/17/1999	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
4/16/1999	48	0.014	0.952	0.000	No	1,316.0	7.2	No Yes
5/25/1999	970	0.227	1.046	0.000	No	1,258.1	7.1	No Yes
5/18/2000	9,611	2.518	1.022	0.000	No	1,258.0	7.1	No Yes
9/21/2000	12,742	3.329	1.090	0.000	No	1,154.2	7.1	No Yes
12/8/2000	14,092	3.643	1.094	0.000	No	1,055.1	7.0	No Yes
7/12/2001	19,517	4.712	1.071	0.000	No	985.1	6.9	No Yes
3/14/2002	25,649	5.976	1.075	0.000	No	916.4	6.8	No Yes
9/26/2002	30,220	6.812	1.064	0.000	No	861.3	6.8	No Yes
2/27/2003	33,184	7.486	1.159	0.000	No	743.1	6.6	No Yes
6/12/2003	35,851	8.104	1.095	0.000	No	678.6	6.5	No Yes
10/16/2003	38,885	8.812	1.113	0.000	No	609.7	6.4	No Yes
2/16/2004	42,065	9.602	0.922	0.000	No	661.3	6.5	No Yes
3/23/2004	42,997	9.835	1.145	0.000	No	577.6	6.4	No Yes
6/3/2004	44,858	10.326	1.098	0.000	No	526.0	6.3	No Yes
12/2/2004	49,512	11.606	1.073	0.000	No	490.2	6.2	No Yes
1/21/2005	50,803	11.987	0.941	0.000	No	521.0	6.3	No Yes
3/21/2005	51,328	12.098	1.070	0.000	No	486.9	6.2	No Yes
6/2/2005	53,190	12.658	1.088	0.000	No	447.5	6.1	No Yes
8/11/2005	54,977	13.290	1.054	0.000	No	424.6	6.1	No Yes
12/29/2005	58,559	14.335	1.051	0.000	No	404.0	6.0	No Yes
4/27/2006	61,610	15.257	1.068	0.000	No	378.3	5.9	No Yes
7/6/2006	63,402	15.894	1.101	0.000	No	343.6	5.8	No Yes
9/14/2006	65,196	16.446	1.051	0.000	No	326.9	5.8	No Yes
10/19/2006	66,095	16.737	0.945	0.000	No	345.9	5.8	No Yes
11/21/2006	66,942	16.947	0.961	0.000	No	360.0	5.9	No Yes

Level: B	LPRM ID No.: 121	Beginning of Life Calibration Current:	-99.0
Total	Pre-Cal	Post-Cal	Gaf's Exp.
			Good

Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.012	1.019	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.036	1.047	0.000	No	1,194.0	7.1	No	Yes
7/1/1999	1,879	0.443	0.989	0.000	No	1,194.0	7.1	No	Yes
5/18/2000	9,611	2.418	0.967	0.000	No	1,194.0	7.1	No	Yes
12/8/2000	14,092	3.630	1.173	0.000	No	1,017.9	6.9	No	Yes
12/12/2002	14,860	7.933	1.052	0.000	No	642.5	6.5	No	Yes
7/12/2001	19,517	4.881	1.070	0.000	No	951.3	6.9	No	Yes
10/25/2001	22,080	5.528	1.081	0.000	No	880.0	6.8	No	Yes
12/27/2001	23,707	5.989	1.061	0.000	No	829.4	6.7	No	Yes
5/7/2002	26,607	6.752	1.066	0.000	No	778.1	6.7	No	Yes
7/18/2002	28,480	7.159	1.057	0.000	No	736.1	6.6	No	Yes
9/26/2002	30,220	7.542	1.089	0.000	No	676.0	6.5	No	Yes
2/27/2003	33,184	8.174	1.129	0.000	No	569.1	6.3	No	Yes
4/3/2003	34,037	8.399	1.064	0.000	No	534.9	6.3	No	Yes
6/12/2003	35,851	8.864	1.059	0.000	No	505.1	6.2	No	Yes
9/4/2003	37,879	9.374	1.072	0.000	No	471.2	6.2	No	Yes
1/5/2004	40,977	10.146	1.057	0.000	No	445.8	6.1	No	Yes
2/16/2004	42,065	10.396	1.053	0.000	No	423.3	6.0	No	Yes
6/3/2004	44,858	11.035	1.054	0.000	No	401.6	6.0	No	Yes
9/16/2004	47,523	11.764	1.052	0.000	No	381.8	5.9	No	Yes
3/21/2005	51,328	12.750	1.154	0.000	No	330.8	5.8	No	Yes
8/11/2005	54,977	13.857	1.082	0.000	No	305.8	5.7	No	Yes
3/23/2006	60,713	15.532	1.097	0.000	No	278.7	5.6	No	Yes
8/10/2006	64,302	16.625	1.059	0.000	No	263.2	5.6	No	Yes
11/21/2006	66,942	17.375	1.008	0.000	No	261.1	5.6	No	Yes

Level: C

LPRM ID No.: 207

Beginning of Life Calibration Current:

-99.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.009	1.032	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.030	1.057	0.000	No	1,183.0	7.1	No	Yes
11/23/1999	5,275	1.323	0.932	0.000	No	1,269.3	7.1	No	Yes
5/18/2000	9,611	2.388	0.994	0.000	No	1,269.0	7.1	No	Yes
12/8/2000	14,092	3.507	1.189	0.000	No	1,067.5	7.0	No	Yes
1/9/2003	15,550	7.881	1.059	0.000	No	659.0	6.5	No	Yes
8/16/2001	20,431	4.966	1.061	0.000	No	1,006.2	6.9	No	Yes
11/29/2001	22,978	5.540	1.060	0.000	No	949.2	6.9	No	Yes

3/14/2002	25,649	6.222	1.088	0.000	No	872.4	6.8	No	Yes
6/13/2002	27,571	6.682	1.081	0.000	No	807.1	6.7	No	Yes
8/22/2002	29,375	7.096	1.075	0.000	No	750.8	6.6	No	Yes
2/27/2003	33,184	7.953	1.166	0.000	No	565.2	6.3	No	Yes
5/8/2003	34,945	8.365	1.066	0.000	No	530.2	6.3	No	Yes
7/31/2003	36,969	8.854	1.055	0.000	No	502.5	6.2	No	Yes
11/13/2003	39,615	9.465	1.065	0.000	No	471.9	6.2	No	Yes
4/22/2004	43,775	10.272	1.052	0.000	No	448.6	6.1	No	Yes
8/5/2004	46,441	10.831	1.056	0.000	No	425.0	6.1	No	Yes
12/2/2004	49,512	11.639	1.066	0.000	No	398.7	6.0	No	Yes
3/21/2005	51,328	12.166	1.122	0.000	No	355.3	5.9	No	Yes
8/11/2005	54,977	12.951	1.051	0.000	No	338.1	5.8	No	Yes
12/29/2005	58,559	13.769	1.052	0.000	No	321.4	5.8	No	Yes
8/10/2006	64,302	15.348	1.068	0.000	No	300.9	5.7	No	Yes
11/21/2006	66,942	16.124	1.045	0.000	No	288.0	5.7	No	Yes

Level: D

LPRM ID No.: 293

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Byp.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
4/16/1999	48	0.006	0.970	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.020	1.007	0.000	No	1,250.0	7.1	No	Yes
11/23/1999	5,275	0.833	0.949	0.000	No	1,317.2	7.2	No	Yes
5/18/2000	9,611	1.509	0.975	0.000	No	1,317.0	7.2	No	Yes
10/26/2000	13,620	2.238	0.945	0.000	No	1,393.7	7.2	No	Yes
12/8/2000	14,092	2.332	1.107	0.000	No	1,258.9	7.1	No	Yes
11/19/2002	14,272	5.282	1.102	0.000	No	1,057.8	7.0	No	Yes
1/9/2003	15,550	5.587	1.052	0.000	No	1,005.6	6.9	No	Yes
3/30/2001	16,962	2.725	0.939	0.000	No	1,340.7	7.2	No	Yes
5/7/2002	26,607	4.266	1.085	0.000	No	1,235.7	7.1	No	Yes
7/18/2002	28,480	4.703	1.060	0.000	No	1,165.7	7.1	No	Yes
2/27/2003	33,184	5.644	1.136	0.000	No	885.2	6.8	No	Yes
5/8/2003	34,945	5.863	1.057	0.000	No	837.4	6.7	No	Yes
10/16/2003	38,885	6.442	1.053	0.000	No	795.3	6.7	No	Yes
1/5/2004	40,977	6.765	1.063	0.000	No	748.2	6.6	No	Yes
7/8/2004	45,715	7.355	1.054	0.000	No	709.8	6.6	No	Yes
12/2/2004	49,512	8.163	1.059	0.000	No	670.3	6.5	No	Yes
1/21/2005	50,803	8.523	1.127	0.000	No	594.7	6.4	No	Yes
3/21/2005	51,328	8.670	1.081	0.000	No	550.2	6.3	No	Yes

6/2/2005	53,190	8.891	0.991	0.000	No	550.0	6.3	No	Yes
12/29/2005	58,559	9.600	1.062	0.000	No	517.9	6.2	No	Yes
2/9/2006	59,635	9.787	0.941	0.000	No	550.0	6.3	No	Yes
3/23/2006	60,713	10.008	1.111	0.000	No	495.0	6.2	No	Yes
7/6/2006	63,402	10.485	0.891	0.000	No	555.6	6.3	No	Yes
8/10/2006	64,302	10.640	1.073	0.000	No	517.8	6.2	No	Yes
10/19/2006	66,095	11.006	1.115	0.000	No	464.4	6.1	No	Yes
11/21/2006	66,942	11.206	0.972	0.000	No	477.8	6.2	No	Yes

String No.: 36

Serial No.: 04s82830

Cycle Installed:

11

Coordinates: 17

Type: NA300

Cumulative Core Average Exposure at BOC:

0

Level: A

LPRM ID No.: 545

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.351	1.115	0.000	No	1,121.1	7.0	No	Yes
6/2/2005	1,962	0.671	1.051	0.000	No	1,066.7	7.0	No	Yes
3/23/2006	9,485	3.081	0.939	0.000	No	1,136.0	7.0	No	Yes
4/27/2006	10,382	3.345	1.074	0.000	No	1,057.7	7.0	No	Yes
11/21/2006	15,714	5.020	1.041	0.000	No	1,016.0	6.9	No	Yes

Level: B

LPRM ID No.: 555

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.331	1.068	0.000	No	1,170.4	7.1	No	Yes
3/23/2006	9,485	2.925	0.947	0.000	No	1,235.9	7.1	No	Yes
8/10/2006	13,074	3.992	1.055	0.000	No	1,171.5	7.1	No	Yes
11/21/2006	15,714	4.730	1.020	0.000	No	1,148.5	7.0	No	Yes

Level: C

LPRM ID No.: 565

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.027	1.062	0.000	No	1,177.0	7.1	No	Yes
8/11/2005	3,749	0.889	0.932	0.000	No	1,262.9	7.1	No	Yes
11/21/2006	15,714	4.119	1.003	0.000	No	1,259.1	7.1	No	Yes

Level: D

LPRM ID No.: 575

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value

1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/28/2005	1,069	0.133	1.054	0.000	No	1,186.0	7.1	No	Yes
6/2/2005	1,962	0.247	0.926	0.000	No	1,280.7	7.2	No	Yes
7/6/2006	12,174	1.967	0.947	0.000	No	1,352.4	7.2	No	Yes
11/21/2006	15,714	2.723	0.988	0.000	No	1,368.8	7.2	No	Yes

String No.: 37 Serial No.: 00s10721 Cycle Installed: 9

Coordinates: 17 Type: NA300 Cumulative Core Average Exposure at BOC: 37,262

Level: A LPRM ID No.: 376 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.022	1.098	0.000	No	1,138.4	7.0	No	Yes
11/19/2002	306	3.773	1.086	0.000	No	794.2	6.7	No	Yes
1/9/2003	1,584	4.117	1.060	0.000	No	749.2	6.6	No	Yes
12/27/2001	9,741	1.893	1.055	0.000	No	1,079.1	7.0	No	Yes
3/14/2002	11,683	2.402	1.061	0.000	No	1,017.0	6.9	No	Yes
5/7/2002	12,641	2.624	1.074	0.000	No	947.0	6.9	No	Yes
7/18/2002	14,514	3.020	1.098	0.000	No	862.4	6.8	No	Yes
2/27/2003	19,218	4.185	1.095	0.000	No	684.2	6.5	No	Yes
4/3/2003	20,071	4.390	1.079	0.000	No	634.1	6.5	No	Yes
7/31/2003	23,003	5.035	1.060	0.000	No	598.2	6.4	No	Yes
9/4/2003	23,913	5.223	1.058	0.000	No	565.4	6.3	No	Yes
10/16/2003	24,919	5.443	1.054	0.000	No	536.5	6.3	No	Yes
2/16/2004	28,099	6.300	1.112	0.000	No	482.4	6.2	No	Yes
6/3/2004	30,892	7.285	1.069	0.000	No	451.3	6.1	No	Yes
9/16/2004	33,557	8.266	1.052	0.000	No	429.0	6.1	No	Yes
3/21/2005	37,362	9.158	1.107	0.000	No	387.5	6.0	No	Yes
7/7/2005	40,111	9.981	1.069	0.000	No	362.5	5.9	No	Yes
10/13/2005	42,617	10.701	0.939	0.000	No	386.0	6.0	No	Yes
11/17/2005	43,517	10.890	1.088	0.000	No	355.0	5.9	No	Yes
6/1/2006	48,538	12.300	1.063	0.000	No	334.0	5.8	No	Yes
7/6/2006	49,436	12.505	1.052	0.000	No	317.5	5.8	No	Yes
11/21/2006	52,976	13.379	1.014	0.000	No	313.1	5.7	No	Yes

Level: B LPRM ID No.: 384 Beginning of Life Calibration Current: 1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes

12/8/2000	126	0.026	1.085	0.000	No	1,152.1	7.0	No	Yes
11/19/2002	306	4.018	1.074	0.000	No	772.4	6.6	No	Yes
12/27/2001	9,741	2.117	1.064	0.000	No	1,082.8	7.0	No	Yes
3/14/2002	11,683	2.623	1.110	0.000	No	975.5	6.9	No	Yes
6/13/2002	13,605	3.128	1.098	0.000	No	888.4	6.8	No	Yes
7/18/2002	14,514	3.376	1.071	0.000	No	829.5	6.7	No	Yes
2/27/2003	19,218	4.398	1.135	0.000	No	680.5	6.5	No	Yes
4/3/2003	20,071	4.666	1.084	0.000	No	627.8	6.4	No	Yes
6/12/2003	21,885	5.214	1.063	0.000	No	590.6	6.4	No	Yes
7/31/2003	23,003	5.543	1.055	0.000	No	559.8	6.3	No	Yes
11/13/2003	25,649	6.223	1.058	0.000	No	529.1	6.3	No	Yes
12/18/2003	26,544	6.433	1.052	0.000	No	502.9	6.2	No	Yes
3/23/2004	29,031	7.131	1.062	0.000	No	473.6	6.2	No	Yes
8/5/2004	32,475	8.131	1.070	0.000	No	443.0	6.1	No	Yes
12/2/2004	35,546	8.975	1.084	0.000	No	408.7	6.0	No	Yes
3/21/2005	37,362	9.423	1.154	0.000	No	354.1	5.9	No	Yes
10/13/2005	42,617	10.888	1.051	0.000	No	337.0	5.8	No	Yes
2/9/2006	45,669	11.693	1.061	0.000	No	318.0	5.8	No	Yes
7/6/2006	49,436	12.702	1.064	0.000	No	298.9	5.7	No	Yes
11/21/2006	52,976	13.583	1.040	0.000	No	287.4	5.7	No	Yes

Level: C

LPRM ID No.: 392

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.			Byp.?	Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/8/2000	126	0.024	1.077	0.000	No	1,160.6	7.1	No	Yes
12/12/2002	894	3.705	1.052	0.000	No	781.9	6.7	No	Yes
1/11/2001	994	0.182	1.051	0.000	No	1,104.3	7.0	No	Yes
3/30/2001	2,996	0.555	0.947	0.000	No	1,166.1	7.1	No	Yes
1/31/2002	10,629	1.964	1.065	0.000	No	1,094.9	7.0	No	Yes
5/7/2002	12,641	2.408	1.091	0.000	No	1,003.6	6.9	No	Yes
7/18/2002	14,514	2.887	1.134	0.000	No	885.0	6.8	No	Yes
9/26/2002	16,254	3.318	1.076	0.000	No	822.5	6.7	No	Yes
2/27/2003	19,218	3.949	1.138	0.000	No	687.0	6.5	No	Yes
6/12/2003	21,885	4.483	1.081	0.000	No	635.6	6.5	No	Yes
10/16/2003	24,919	5.115	1.083	0.000	No	586.9	6.4	No	Yes
12/18/2003	26,544	5.481	1.059	0.000	No	554.2	6.3	No	Yes
3/23/2004	29,031	6.022	1.051	0.000	No	527.3	6.3	No	Yes

8/5/2004	32,475	6.826	1.051	0.000	No	502.0	6.2	No	Yes
10/21/2004	34,468	7.393	1.076	0.000	No	466.5	6.1	No	Yes
12/29/2004	36,245	7.897	1.067	0.000	No	437.2	6.1	No	Yes
3/21/2005	37,362	8.211	1.155	0.000	No	378.6	5.9	No	Yes
11/17/2005	43,517	9.684	1.070	0.000	No	354.0	5.9	No	Yes
6/1/2006	48,538	10.966	1.051	0.000	No	336.8	5.8	No	Yes
8/10/2006	50,336	11.400	1.065	0.000	No	316.3	5.8	No	Yes
11/21/2006	52,976	12.082	1.042	0.000	No	303.5	5.7	No	Yes

Level: D

LPRM ID No.: 400

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
10/26/2000	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
12/12/2002	894	2.183	1.053	0.000	No	1,187.7	7.1	No	Yes
1/11/2001	994	0.097	1.056	0.000	No	1,183.7	7.1	No	Yes
3/30/2001	2,996	0.304	0.942	0.000	No	1,256.6	7.1	No	Yes
8/16/2001	6,465	0.726	0.947	0.000	No	1,326.9	7.2	No	Yes
9/26/2002	16,254	1.905	1.061	0.000	No	1,250.6	7.1	No	Yes
2/27/2003	19,218	2.364	1.114	0.000	No	1,066.1	7.0	No	Yes
6/12/2003	21,885	2.628	1.072	0.000	No	994.5	6.9	No	Yes
11/13/2003	25,649	3.073	1.067	0.000	No	932.1	6.8	No	Yes
12/18/2003	26,544	3.187	1.056	0.000	No	882.7	6.8	No	Yes
3/23/2004	29,031	3.512	1.074	0.000	No	821.8	6.7	No	Yes
12/2/2004	35,546	4.701	1.072	0.000	No	766.6	6.6	No	Yes
1/21/2005	36,837	5.032	1.070	0.000	No	716.5	6.6	No	Yes
3/21/2005	37,362	5.160	1.141	0.000	No	627.9	6.4	No	Yes
6/2/2005	39,224	5.383	1.051	0.000	No	597.5	6.4	No	Yes
7/7/2005	40,111	5.492	0.942	0.000	No	634.3	6.5	No	Yes
8/11/2005	41,011	5.601	1.080	0.000	No	587.3	6.4	No	Yes
4/27/2006	47,644	6.710	1.054	0.000	No	557.2	6.3	No	Yes
7/6/2006	49,436	7.002	0.937	0.000	No	594.7	6.4	No	Yes
8/10/2006	50,336	7.148	1.052	0.000	No	565.3	6.3	No	Yes
11/21/2006	52,976	7.689	1.064	0.000	No	531.3	6.3	No	Yes

String No.: 38

Serial No.: M5420

Cycle Installed:

7

Coordinates: 17

Type: NA300

Cumulative Core Average Exposure at BOC:

61,028

Level: A

LPRM ID No.: 38

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value

9/12/1996	9,490	0.711	1.023	0.000	Yes	1,021.0	6.9	No	Yes
5/18/2000	19,411	2.308	1.006	0.000	No	1,021.0	6.9	No	Yes
12/8/2000	23,892	2.947	1.197	0.000	No	853.0	6.7	No	Yes
1/9/2003	25,350	5.887	1.052	0.000	No	610.1	6.4	No	Yes
9/20/2001	30,967	3.918	1.079	0.000	No	790.5	6.7	No	Yes
12/27/2001	33,507	4.341	1.080	0.000	No	732.0	6.6	No	Yes
5/7/2002	36,407	4.908	1.082	0.000	No	676.5	6.5	No	Yes
7/18/2002	38,280	5.216	1.054	0.000	No	641.8	6.5	No	Yes
5/8/2003	44,745	6.245	1.065	0.000	No	572.9	6.4	No	Yes
9/4/2003	47,679	6.720	1.054	0.000	No	543.5	6.3	No	Yes
3/23/2004	52,797	7.496	1.055	0.000	No	515.2	6.2	No	Yes
3/21/2005	61,128	8.706	1.057	0.000	No	487.4	6.2	No	Yes
4/28/2005	62,097	8.876	1.055	0.000	No	462.0	6.1	No	Yes
12/29/2005	68,359	9.721	1.051	0.000	No	439.6	6.1	No	Yes
6/1/2006	72,304	10.190	0.928	0.000	No	473.7	6.2	No	Yes
11/21/2006	76,742	10.582	1.025	0.000	No	462.1	6.1	No	Yes

Level: B

LPRM ID No.: 124

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal		Gaf's Exp.		Byp.?	Good Value
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur			
2/9/2006	-10,308	11.556	1.053	0.000	No	392.0	6.0	No	Yes
9/12/1996	9,490	1.065	1.032	0.000	Yes	1,025.0	6.9	No	Yes
4/16/1999	9,848	1.093	0.921	0.000	No	1,114.0	7.0	No	Yes
12/29/1999	15,955	2.162	1.076	0.000	No	1,035.3	6.9	No	Yes
5/18/2000	19,411	2.807	1.075	0.000	No	963.1	6.9	No	Yes
9/21/2000	22,542	3.365	1.070	0.000	No	900.1	6.8	No	Yes
12/8/2000	23,892	3.579	1.192	0.000	No	755.1	6.6	No	Yes
8/16/2001	30,231	4.644	1.065	0.000	No	709.0	6.6	No	Yes
10/25/2001	31,880	4.950	1.066	0.000	No	665.1	6.5	No	Yes
1/31/2002	34,395	5.449	1.063	0.000	No	625.7	6.4	No	Yes
7/18/2002	38,280	6.239	1.064	0.000	No	588.1	6.4	No	Yes
2/27/2003	42,984	6.991	1.079	0.000	No	545.0	6.3	No	Yes
7/31/2003	46,769	7.693	1.061	0.000	No	513.7	6.2	No	Yes
1/5/2004	50,777	8.383	1.054	0.000	No	487.4	6.2	No	Yes
10/21/2004	58,234	9.712	1.058	0.000	No	460.6	6.1	No	Yes
3/21/2005	61,128	10.163	1.059	0.000	No	435.0	6.1	No	Yes
8/11/2005	64,777	10.850	1.053	0.000	No	413.1	6.0	No	Yes
11/21/2006	76,742	12.469	1.013	0.000	No	387.0	6.0	No	Yes

Level: C		LPRM ID No.: 210		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
2/9/2006	-10,308	10.393	1.057	0.000	No	425.0	6.1	No	Yes
9/12/1996	9,490	1.376	1.029	0.000	Yes	959.0	6.9	No	Yes
4/16/1999	9,848	1.418	0.944	0.000	No	1,020.0	6.9	No	Yes
12/29/1999	15,955	2.237	1.052	0.000	No	969.6	6.9	No	Yes
5/18/2000	19,411	2.725	1.034	0.000	No	970.0	6.9	No	Yes
9/21/2000	22,542	3.214	1.078	0.000	No	899.8	6.8	No	Yes
12/8/2000	23,892	3.458	1.193	0.000	No	754.2	6.6	No	Yes
2/15/2001	25,646	3.723	1.047	0.000	No	720.4	6.6	No	Yes
3/30/2001	26,762	3.897	0.952	0.000	No	756.7	6.6	No	Yes
8/16/2001	30,231	4.449	1.074	0.000	No	704.6	6.6	No	Yes
10/25/2001	31,880	4.701	1.051	0.000	No	670.4	6.5	No	Yes
3/14/2002	35,449	5.246	1.060	0.000	No	632.4	6.4	No	Yes
7/18/2002	38,280	5.755	1.066	0.000	No	593.3	6.4	No	Yes
2/27/2003	42,984	6.526	1.113	0.000	No	533.0	6.3	No	Yes
2/16/2004	51,865	7.633	1.063	0.000	No	501.5	6.2	No	Yes
7/8/2004	55,515	8.135	0.939	0.000	No	534.0	6.3	No	Yes
9/16/2004	57,323	8.433	1.060	0.000	No	503.8	6.2	No	Yes
4/28/2005	62,097	9.260	1.056	0.000	No	477.1	6.2	No	Yes
9/8/2005	65,493	9.764	1.062	0.000	No	449.2	6.1	No	Yes
8/10/2006	74,102	11.105	1.071	0.000	No	396.8	6.0	No	Yes
11/21/2006	76,742	11.481	1.013	0.000	No	391.7	6.0	No	Yes

Level: D		LPRM ID No.: 296		Beginning of Life Calibration Current:				1,250.0	
Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
9/12/1996	9,490	1.258	1.046	0.000	Yes	1,029.0	6.9	No	Yes
4/16/1999	9,848	1.305	0.904	0.000	No	1,143.0	7.0	No	Yes
5/18/2000	19,411	2.052	1.026	0.000	No	1,143.0	7.0	No	Yes
12/8/2000	23,892	2.490	1.164	0.000	No	982.0	6.9	No	Yes
11/29/2001	32,778	3.233	1.067	0.000	No	920.3	6.8	No	Yes
8/22/2002	39,175	3.866	1.076	0.000	No	855.3	6.8	No	Yes
2/27/2003	42,984	4.308	1.099	0.000	No	778.2	6.7	No	Yes
7/8/2004	55,515	5.169	0.875	0.000	No	889.4	6.8	No	Yes
8/5/2004	56,241	5.244	1.054	0.000	No	844.0	6.7	No	Yes
9/16/2004	57,323	5.369	1.003	0.000	No	844.0	6.7	No	Yes

3/21/2005	61,128	5.892	1.070	0.000	No	788.8	6.7	No	Yes
7/7/2005	63,877	6.125	1.069	0.000	No	737.9	6.6	No	Yes
9/8/2005	65,493	6.279	0.965	0.000	No	738.0	6.6	No	Yes
6/1/2006	72,304	7.119	1.058	0.000	No	697.5	6.5	No	Yes
7/6/2006	73,202	7.237	1.054	0.000	No	661.8	6.5	No	Yes
11/21/2006	76,742	7.719	1.001	0.000	No	661.1	6.5	No	Yes

String No.: 39 Serial No.: 04s82824 Cycle Installed: 11

Coordinates: 9 Type: NA300 Cumulative Core Average Exposure at BOC: 0

Level: A LPRM ID No.: 546 Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.022	1.107	0.000	No	1,129.2	7.0	No	Yes
4/28/2005	1,069	0.299	1.063	0.000	No	1,062.3	7.0	No	Yes
11/17/2005	6,255	1.572	0.913	0.000	No	1,163.0	7.1	No	Yes
12/29/2005	7,331	1.772	1.086	0.000	No	1,070.9	7.0	No	Yes
9/14/2006	13,968	3.244	1.052	0.000	No	1,018.0	6.9	No	Yes
11/21/2006	15,714	3.617	0.965	0.000	No	1,054.9	7.0	No	Yes

Level: B LPRM ID No.: 556 Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.028	0.936	0.000	No	1,335.5	7.2	No	Yes
11/21/2006	15,714	3.644	1.020	0.000	No	1,309.3	7.2	No	Yes

Level: C LPRM ID No.: 566 Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
11/21/2006	15,714	3.358	1.011	0.000	No	1,236.4	7.1	No	Yes

Level: D LPRM ID No.: 576 Beginning of Life Calibration Current: 1,250.0

Total	Pre-Cal	Post-Cal	Gaf's Exp.		Good				
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value	
1/21/2005	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
3/21/2005	100	0.011	0.917	0.000	No	1,363.1	7.2	No	Yes
6/2/2005	1,962	0.197	1.083	0.000	No	1,258.7	7.1	No	Yes
8/11/2005	3,749	0.389	0.949	0.000	No	1,326.3	7.2	No	Yes
4/27/2006	10,382	1.399	0.949	0.000	No	1,397.6	7.2	No	Yes

11/21/2006	15,714	2.302	0.998	0.000	No	1,400.4	7.2	No	Yes
String No.: 40		Serial No.: 02S41546		Cycle Installed:		10			
Coordinates: 9		Type: NA300		Cumulative Core Average Exposure at BOC:		18,162			
Level: A		LPRM ID No.: 446		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.029	1.097	0.000	No	1,139.5	7.0	No	Yes
9/4/2003	4,813	1.392	1.054	0.000	No	1,079.0	7.0	No	Yes
12/18/2003	7,444	2.179	0.946	0.000	No	1,140.6	7.0	No	Yes
4/22/2004	10,709	3.256	1.071	0.000	No	1,065.0	7.0	No	Yes
7/7/2005	21,011	5.892	1.093	0.000	No	974.4	6.9	No	Yes
11/17/2005	24,417	6.788	1.065	0.000	No	915.0	6.8	No	Yes
12/29/2005	25,493	7.114	0.934	0.000	No	979.7	6.9	No	Yes
3/23/2006	27,647	7.688	1.065	0.000	No	919.9	6.8	No	Yes
4/27/2006	28,544	7.903	0.945	0.000	No	973.4	6.9	No	Yes
6/1/2006	29,438	8.140	1.057	0.000	No	920.9	6.8	No	Yes
7/6/2006	30,336	8.390	0.939	0.000	No	980.7	6.9	No	Yes
8/10/2006	31,236	8.638	1.116	0.000	No	878.8	6.8	No	Yes
11/21/2006	33,876	9.462	0.985	0.000	No	892.2	6.8	No	Yes
Level: B		LPRM ID No.: 462		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
10/21/2004	15,368	4.129	1.062	0.000	No	1,177.0	7.1	No	Yes
3/21/2005	18,262	4.873	1.102	0.000	No	1,068.1	7.0	No	Yes
8/11/2005	21,911	5.816	1.077	0.000	No	991.7	6.9	No	Yes
2/9/2006	26,569	7.101	1.051	0.000	No	944.0	6.9	No	Yes
3/23/2006	27,647	7.363	1.067	0.000	No	884.7	6.8	No	Yes
6/1/2006	29,438	7.800	1.076	0.000	No	822.2	6.7	No	Yes
8/10/2006	31,236	8.257	1.066	0.000	No	771.3	6.6	No	Yes
10/19/2006	33,029	8.734	1.074	0.000	No	718.2	6.6	No	Yes
11/21/2006	33,876	8.963	1.002	0.000	No	716.7	6.6	No	Yes
Level: C		LPRM ID No.: 478		Beginning of Life Calibration Current:		1,250.0			
Total		Pre-Cal		Post-Cal		Gaf's Exp.		Good	
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		By.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes

9/4/2003	4,813	0.830	0.947	0.000	No	1,320.0	7.2	No	Yes
3/23/2004	9,931	1.857	0.946	0.000	No	1,395.3	7.2	No	Yes
12/29/2004	17,145	3.564	1.068	0.000	No	1,306.5	7.2	No	Yes
3/21/2005	18,262	3.891	1.148	0.000	No	1,138.0	7.0	No	Yes
8/11/2005	21,911	4.546	0.943	0.000	No	1,206.8	7.1	No	Yes
12/29/2005	25,493	5.345	1.054	0.000	No	1,145.0	7.0	No	Yes
9/14/2006	32,130	7.013	1.103	0.000	No	1,038.1	6.9	No	Yes
10/19/2006	33,029	7.253	1.058	0.000	No	981.2	6.9	No	Yes
11/21/2006	33,876	7.486	1.044	0.000	No	939.8	6.8	No	Yes

Level: D

LPRM ID No.: 494

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
4/22/2004	10,709	1.108	0.947	0.000	No	1,320.0	7.2	Yes
3/21/2005	18,262	2.502	1.181	0.000	No	1,117.7	7.0	Yes
6/2/2005	20,124	2.680	0.938	0.000	No	1,191.5	7.1	Yes
8/11/2005	21,911	2.879	0.946	0.000	No	1,259.6	7.1	Yes
9/8/2005	22,627	2.965	1.085	0.000	No	1,160.9	7.1	Yes
11/17/2005	24,417	3.202	0.905	0.000	No	1,283.0	7.2	Yes
12/29/2005	25,493	3.346	1.103	0.000	No	1,163.2	7.1	Yes
3/23/2006	27,647	3.699	0.947	0.000	No	1,228.3	7.1	Yes
7/6/2006	30,336	4.142	1.065	0.000	No	1,153.3	7.1	Yes
8/10/2006	31,236	4.308	0.908	0.000	No	1,270.2	7.1	Yes
10/19/2006	33,029	4.646	1.079	0.000	No	1,177.2	7.1	Yes
11/21/2006	33,876	4.812	0.987	0.000	No	1,192.7	7.1	Yes

String No.: 41

Serial No.: 02S41543

Cycle Installed:

10

Coordinates: 9

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 447

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	Yes
2/27/2003	118	0.036	1.080	0.000	No	1,157.4	7.1	Yes
4/3/2003	971	0.308	1.098	0.000	No	1,054.1	7.0	Yes
10/16/2003	5,819	1.752	1.068	0.000	No	987.0	6.9	Yes
7/8/2004	12,649	3.965	0.934	0.000	No	1,056.7	7.0	Yes
8/5/2004	13,375	4.135	1.086	0.000	No	973.0	6.9	Yes
3/21/2005	18,262	5.183	1.104	0.000	No	881.3	6.8	Yes

10/13/2005	23,517	6.613	1.063	0.000	No	829.1	6.7	No	Yes
11/17/2005	24,417	6.904	0.946	0.000	No	876.0	6.8	No	Yes
12/29/2005	25,493	7.264	1.100	0.000	No	796.4	6.7	No	Yes
3/23/2006	27,647	7.841	0.885	0.000	No	899.8	6.8	No	Yes
6/1/2006	29,438	8.276	1.149	0.000	No	783.2	6.7	No	Yes
11/21/2006	33,876	9.729	1.010	0.000	No	775.4	6.7	No	Yes

Level: B

LPRM ID No.: 463

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp. ?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	1.058	0.925	0.000	No	1,351.4	7.2	No	Yes
12/29/2004	17,145	4.565	1.070	0.000	No	1,262.9	7.1	No	Yes
3/21/2005	18,262	4.837	1.108	0.000	No	1,139.8	7.0	No	Yes
7/7/2005	21,011	5.573	1.058	0.000	No	1,077.4	7.0	No	Yes
10/13/2005	23,517	6.237	1.102	0.000	No	977.6	6.9	No	Yes
11/17/2005	24,417	6.507	1.062	0.000	No	921.0	6.8	No	Yes
12/29/2005	25,493	6.835	1.094	0.000	No	841.9	6.7	No	Yes
2/9/2006	26,569	7.153	1.062	0.000	No	793.0	6.7	No	Yes
3/23/2006	27,647	7.419	1.051	0.000	No	754.5	6.6	No	Yes
6/1/2006	29,438	7.864	1.100	0.000	No	685.9	6.5	No	Yes
8/10/2006	31,236	8.378	1.060	0.000	No	647.1	6.5	No	Yes
9/14/2006	32,130	8.633	1.054	0.000	No	613.9	6.4	No	Yes
11/21/2006	33,876	9.134	1.029	0.000	No	596.6	6.4	No	Yes

Level: C

LPRM ID No.: 479

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/16/2004	8,999	1.675	0.940	0.000	No	1,329.8	7.2	No	Yes
1/21/2005	17,737	3.725	1.059	0.000	No	1,255.7	7.1	No	Yes
3/21/2005	18,262	3.875	1.089	0.000	No	1,153.1	7.1	No	Yes
9/14/2006	32,130	6.989	1.061	0.000	No	1,086.8	7.0	No	Yes
11/21/2006	33,876	7.484	1.026	0.000	No	1,059.2	7.0	No	Yes

Level: D

LPRM ID No.: 495

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal			Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
7/31/2003	3,903	0.335	0.929	0.000	No	1,345.5	7.2	No	Yes

8/5/2004	13,375	1.423	0.906	0.000	No	1,485.0	7.3	No	Yes
3/21/2005	18,262	2.478	1.130	0.000	No	1,314.2	7.2	No	Yes
9/8/2005	22,627	2.952	1.053	0.000	No	1,248.0	7.1	No	Yes
12/29/2005	25,493	3.330	0.908	0.000	No	1,374.5	7.2	No	Yes
2/9/2006	26,569	3.492	1.081	0.000	No	1,271.0	7.1	No	Yes
11/21/2006	33,876	4.832	0.987	0.000	No	1,287.7	7.2	No	Yes

String No.: 42

Serial No.: 02S41540

Cycle Installed:

10

Coordinates: 9

Type: NA300

Cumulative Core Average Exposure at BOC:

18,162

Level: A

LPRM ID No.: 448

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
2/27/2003	118	0.026	1.087	0.000	No	1,150.0	7.0	No Yes
4/3/2003	971	0.282	1.058	0.000	No	1,086.9	7.0	No Yes
11/13/2003	6,549	1.742	1.057	0.000	No	1,028.3	6.9	No Yes
9/16/2004	14,457	4.207	1.059	0.000	No	971.0	6.9	No Yes
3/21/2005	18,262	4.994	1.100	0.000	No	882.7	6.8	No Yes
8/11/2005	21,911	6.036	1.090	0.000	No	809.9	6.7	No Yes
9/8/2005	22,627	6.221	0.871	0.000	No	929.8	6.8	No Yes
10/13/2005	23,517	6.398	1.087	0.000	No	855.4	6.8	No Yes
11/17/2005	24,417	6.576	0.928	0.000	No	922.0	6.8	No Yes
12/29/2005	25,493	6.815	1.132	0.000	No	814.5	6.7	No Yes
2/9/2006	26,569	7.108	0.922	0.000	No	883.0	6.8	No Yes
4/27/2006	28,544	7.635	1.084	0.000	No	814.6	6.7	No Yes
7/6/2006	30,336	8.087	0.948	0.000	No	859.3	6.8	No Yes
9/14/2006	32,130	8.482	1.084	0.000	No	792.7	6.7	No Yes
11/21/2006	33,876	8.975	0.988	0.000	No	802.3	6.7	No Yes

Level: B

LPRM ID No.: 464

Beginning of Life Calibration Current:

1,250.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No Yes
3/23/2004	9,931	2.506	0.939	0.000	No	1,331.2	7.2	No Yes
12/2/2004	16,446	4.227	1.052	0.000	No	1,265.4	7.1	No Yes
1/21/2005	17,737	4.535	1.058	0.000	No	1,196.0	7.1	No Yes
3/21/2005	18,262	4.665	1.166	0.000	No	1,025.8	6.9	No Yes
12/29/2005	25,493	6.508	1.051	0.000	No	976.0	6.9	No Yes
3/23/2006	27,647	7.078	1.097	0.000	No	889.7	6.8	No Yes

6/1/2006	29,438	7.540	1.066	0.000	No	834.6	6.7	No	Yes
8/10/2006	31,236	7.954	1.061	0.000	No	786.6	6.7	No	Yes
9/14/2006	32,130	8.159	1.056	0.000	No	744.9	6.6	No	Yes
11/21/2006	33,876	8.599	1.053	0.000	No	707.4	6.6	No	Yes

Level: C

LPRM ID No.: 480

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
4/3/2003	971	0.151	1.095	0.000	No	1,141.6	7.0	No	Yes
7/8/2004	12,649	2.330	0.934	0.000	No	1,222.2	7.1	No	Yes
10/21/2004	15,368	3.014	1.064	0.000	No	1,148.7	7.0	No	Yes
3/21/2005	18,262	3.804	1.188	0.000	No	966.9	6.9	No	Yes
11/21/2006	33,876	7.475	1.034	0.000	No	935.1	6.8	No	Yes

Level: D

LPRM ID No.: 496

Beginning of Life Calibration Current:

1,250.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
1/9/2003	0	0.000	1.000	0.000	No	1,250.0	7.1	No	Yes
2/27/2003	118	0.009	0.930	0.000	No	1,344.1	7.2	No	Yes
4/3/2003	971	0.067	1.067	0.000	No	1,259.7	7.1	No	Yes
11/13/2003	6,549	0.572	0.939	0.000	No	1,341.5	7.2	No	Yes
6/3/2004	11,792	1.165	0.948	0.000	No	1,415.1	7.3	No	Yes
8/5/2004	13,375	1.382	0.944	0.000	No	1,499.0	7.3	No	Yes
10/21/2004	15,368	1.731	1.053	0.000	No	1,423.6	7.3	No	Yes
3/21/2005	18,262	2.374	1.082	0.000	No	1,315.7	7.2	No	Yes
11/17/2005	24,417	3.107	1.083	0.000	No	1,215.0	7.1	No	Yes
12/29/2005	25,493	3.264	0.872	0.000	No	1,393.3	7.2	No	Yes
2/9/2006	26,569	3.417	1.094	0.000	No	1,274.0	7.1	No	Yes
6/1/2006	29,438	3.884	0.921	0.000	No	1,383.3	7.2	No	Yes
7/6/2006	30,336	4.039	1.068	0.000	No	1,295.2	7.2	No	Yes
11/21/2006	33,876	4.701	1.015	0.000	No	1,276.1	7.2	No	Yes

String No.: 43

Serial No.: 96S00499

Cycle Installed:

8

Coordinates: 9

Type: NA300

Cumulative Core Average Exposure at BOC:

51,228

Level: A

LPRM ID No.: 43

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.010	1.029	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.031	1.038	0.000	No	1,250.0	7.1	No	Yes

5/25/1999	970	0.185	1.086	0.000	No	1,151.0	7.0	No	Yes
5/18/2000	9,611	1.750	0.991	0.000	No	1,151.0	7.0	No	Yes
12/8/2000	14,092	2.420	1.202	0.000	No	957.6	6.9	No	Yes
1/9/2003	15,550	5.194	1.025	0.000	No	723.4	6.6	No	Yes
11/29/2001	22,978	3.596	1.059	0.000	No	904.2	6.8	No	Yes
12/27/2001	23,707	3.717	1.051	0.000	No	860.3	6.8	No	Yes
5/7/2002	26,607	4.219	1.103	0.000	No	780.0	6.7	No	Yes
7/18/2002	28,480	4.508	1.052	0.000	No	741.4	6.6	No	Yes

Level: B

LPRM ID No.: 129

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.011	0.962	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.030	0.963	0.000	No	1,250.0	7.1	No	Yes
2/3/2000	7,038	1.354	0.947	0.000	No	1,320.0	7.2	No	Yes
5/18/2000	9,611	1.870	1.010	0.000	No	1,320.0	7.2	No	Yes
12/8/2000	14,092	2.709	1.173	0.000	No	1,125.3	7.0	No	Yes
4/16/2001	17,332	3.234	0.942	0.000	No	1,194.6	7.1	No	Yes
1/31/2002	24,595	4.509	1.062	0.000	No	1,124.9	7.0	No	Yes
8/22/2002	29,375	5.451	1.056	0.000	No	1,065.2	7.0	No	Yes
2/27/2003	33,184	6.046	1.094	0.000	No	973.7	6.9	No	Yes
5/8/2003	34,945	6.409	1.058	0.000	No	920.3	6.8	No	Yes
7/31/2003	36,969	6.812	1.062	0.000	No	866.6	6.8	No	Yes
10/16/2003	38,885	7.178	1.057	0.000	No	819.8	6.7	No	Yes
1/5/2004	40,977	7.558	1.092	0.000	No	750.8	6.6	No	Yes
4/22/2004	43,775	8.099	1.068	0.000	No	703.0	6.6	No	Yes
8/5/2004	46,441	8.620	1.052	0.000	No	668.0	6.5	No	Yes
12/2/2004	49,512	9.183	1.094	0.000	No	610.6	6.4	No	Yes
3/21/2005	51,328	9.464	1.105	0.000	No	552.6	6.3	No	Yes
6/2/2005	53,190	9.821	1.058	0.000	No	522.3	6.3	No	Yes
11/17/2005	57,483	10.604	1.073	0.000	No	487.0	6.2	No	Yes
4/27/2006	61,610	11.290	1.062	0.000	No	458.6	6.1	No	Yes
11/21/2006	66,942	11.982	1.024	0.000	No	447.8	6.1	No	Yes

Level: C

LPRM ID No.: 215

Beginning of Life Calibration Current:

-99.0

Total		Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur		Byp.?	Value
4/16/1999	48	0.008	0.973	0.000	No	1,250.0	7.1	No	Yes
4/20/1999	146	0.021	0.984	0.000	No	1,250.0	7.1	No	Yes

12/29/1999	6,155	0.899	0.943	0.000	No	1,325.6	7.2	No	Yes
5/18/2000	9,611	1.436	0.998	0.000	No	1,326.0	7.2	No	Yes
12/8/2000	14,092	2.239	1.167	0.000	No	1,136.2	7.0	No	Yes
3/30/2001	16,962	2.660	0.908	0.000	No	1,251.4	7.1	No	Yes
8/22/2002	29,375	4.634	1.062	0.000	No	1,178.3	7.1	No	Yes
5/8/2003	34,945	5.456	1.052	0.000	No	1,120.1	7.0	No	Yes
11/13/2003	39,615	6.093	1.051	0.000	No	1,065.7	7.0	No	Yes
2/16/2004	42,065	6.454	1.056	0.000	No	1,009.2	6.9	No	Yes
9/16/2004	47,523	7.330	1.073	0.000	No	940.5	6.8	No	Yes
12/2/2004	49,512	7.712	1.068	0.000	No	880.7	6.8	No	Yes
12/29/2004	50,211	7.845	1.036	0.000	No	850.1	6.7	No	Yes
3/21/2005	51,328	8.050	1.155	0.000	No	762.5	6.6	No	Yes
7/7/2005	54,077	8.490	1.068	0.000	No	713.9	6.6	No	Yes
10/13/2005	56,583	8.913	1.076	0.000	No	663.5	6.5	No	Yes
2/9/2006	59,635	9.436	1.059	0.000	No	627.0	6.4	No	Yes
7/6/2006	63,402	10.048	1.076	0.000	No	582.7	6.4	No	Yes
11/21/2006	66,942	10.582	1.045	0.000	No	557.6	6.3	No	Yes

Level: D

LPRM ID No.: 301

Beginning of Life Calibration Current:

-99.0

Total	Pre-Cal		Post-Cal	Gaf's Exp.				Good
Date	CAVEX	Exp	GAF	GAFpost	Corrected	CalCur	Byp.?	Value
4/16/1999	48	0.004	0.969	0.000	No	1,250.0	7.1	No Yes
4/20/1999	146	0.011	0.976	0.000	No	1,250.0	7.1	No Yes
2/3/2000	7,038	0.584	0.945	0.000	No	1,322.8	7.2	No Yes
5/18/2000	9,611	0.806	1.003	0.000	No	1,323.0	7.2	No Yes
12/8/2000	14,092	1.283	1.114	0.000	No	1,187.6	7.1	No Yes
3/30/2001	16,962	1.495	0.918	0.000	No	1,293.7	7.2	No Yes
12/27/2001	23,707	2.062	0.929	0.000	No	1,392.6	7.2	No Yes
6/12/2003	35,851	3.203	1.053	0.000	No	1,322.5	7.2	No Yes
9/4/2003	37,879	3.337	0.948	0.000	No	1,395.0	7.2	No Yes
10/16/2003	38,885	3.412	1.059	0.000	No	1,317.3	7.2	No Yes
7/8/2004	45,715	3.999	0.889	0.000	No	1,481.8	7.3	No Yes
10/21/2004	48,434	4.340	1.053	0.000	No	1,407.2	7.2	No Yes
12/29/2004	50,211	4.613	1.052	0.000	No	1,337.6	7.2	No Yes
3/21/2005	51,328	4.790	1.099	0.000	No	1,217.1	7.1	No Yes
8/11/2005	54,977	5.149	1.074	0.000	No	1,133.3	7.0	No Yes
9/8/2005	55,693	5.228	1.052	0.000	No	1,077.3	7.0	No Yes
4/27/2006	61,610	6.018	1.055	0.000	No	1,021.1	6.9	No Yes

10/19/2006	66,095	6.616	1.069	0.000	No	955.2	6.9	No	Yes
11/21/2006	66,942	6.739	1.023	0.000	No	933.7	6.8	No	Yes