

Jeffrey B. Archie
Vice President, Nuclear Operations
803.345.4214

August 26, 2009



Document Control Desk
U. S. Nuclear Regulatory Commission
Washington, DC 20555

Dear Sir / Madam:


Subject: VIRGIL C. SUMMER NUCLEAR STATION (VCSNS)
DOCKET NO. 50/395
OPERATING LICENSE NO. NPF-12
SPECIAL REPORT (SPR) 2009-002

South Carolina Electric & Gas Company (SCE&G) is submitting this report pursuant to the requirements of Technical Specifications 6.9.2 and Fire Protection Procedure (FPP)-024, Enclosure 6.1.1. This report addresses the impairment of the Diesel Driven Fire Service Pump (XPP0134B) for greater than 7 days.

The fire pump was removed from service on July 20, 2009 at 0445 hours to conduct maintenance to the engine and pump. Maintenance was conducted per Mechanical Maintenance Procedures and technical manuals with Surveillance Testing performed to validate operability. XPP0134B was returned to operable status July 31, 2009 at 1555 hours. The equipment remained out of service for a total of 11 days, 11 hours, and 10 minutes, therefore exceeding the 7 day administrative limits established within VCSNS Fire Protection Program. During the maintenance interval the Fire Service System was maintained operable by the Electric Driven Fire Pump (XPP0134A).

The extended maintenance time has been entered into the VCSNS corrective action program. Should you have any questions, please call Mr. Bruce Thompson at (803) 931-5042 at your convenience.

Very truly yours,

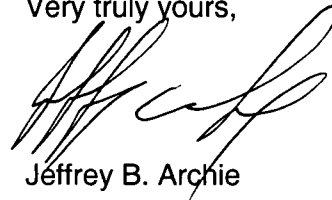

Jeffrey B. Archie

JMG/JHW/JBA/gar

c: K. B. Marsh
S. A. Byrne
N. S. Carns
J. H. Hamilton
R. J. White
W. M. Cherry
L. A. Reyes
R. E. Martin

K. M. Sutton
NRC Resident Inspector
INPO Records Center
NSRC
RTS (CR-09-02888)
File (818.08)
PRSF (RC-09-0102)

JEAD
NRK