




REACTOR BUILDINGS

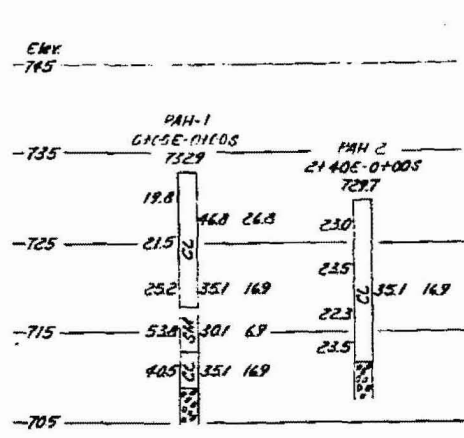


PLANT BUILDINGS

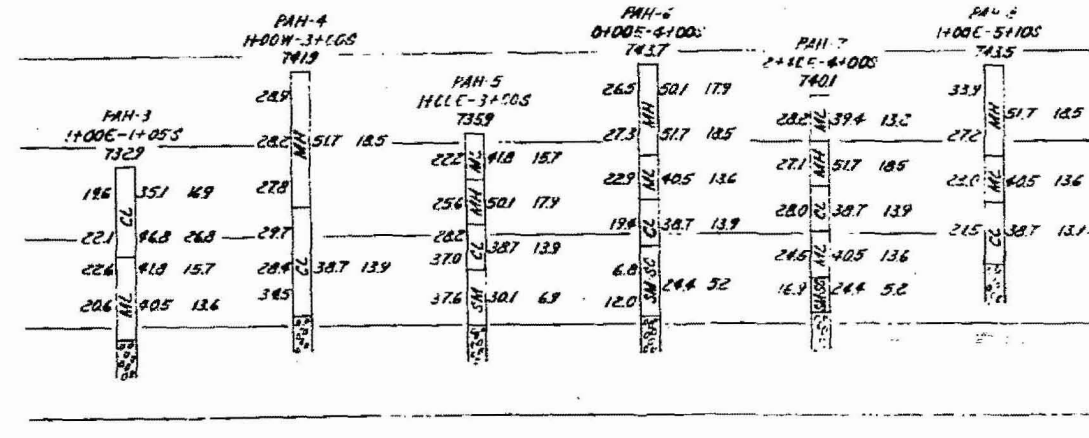


TRANSFORMER YARD & 500 KV SWITCHYARD

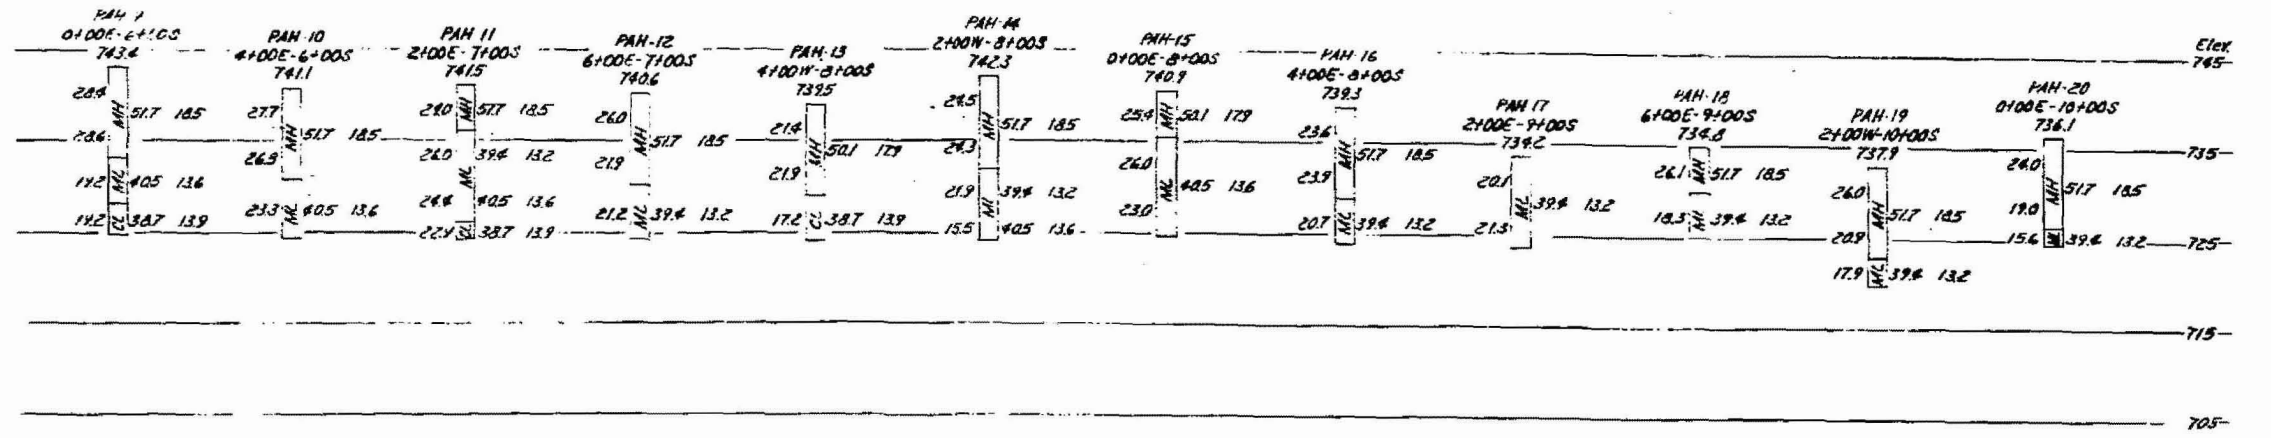

COOLING TOWERS

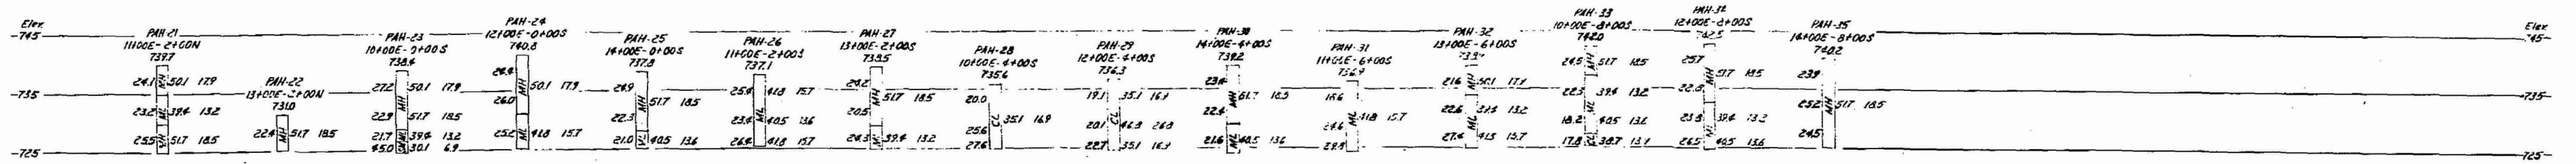

INTAKE CHANNEL

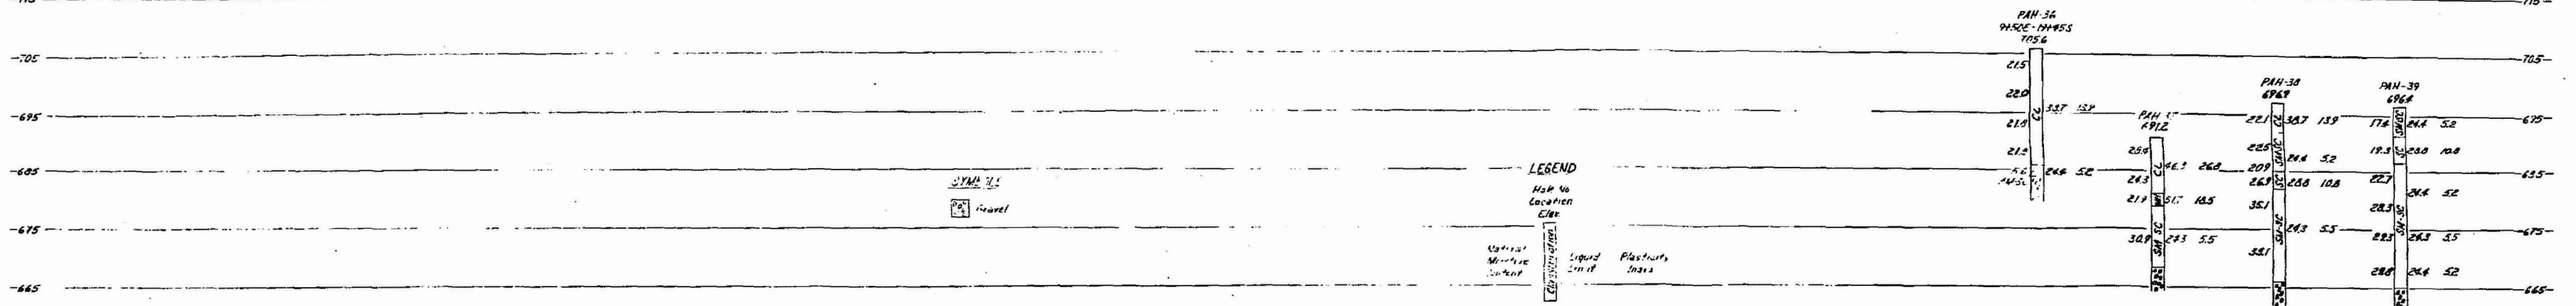

SYMBOLS
 Ground

LEGEND

- Utility Structure
- Manhole
- Liquid Drain
- Plasticity Index

**WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT**

BORROW INVESTIGATION

Figure 2.5-222