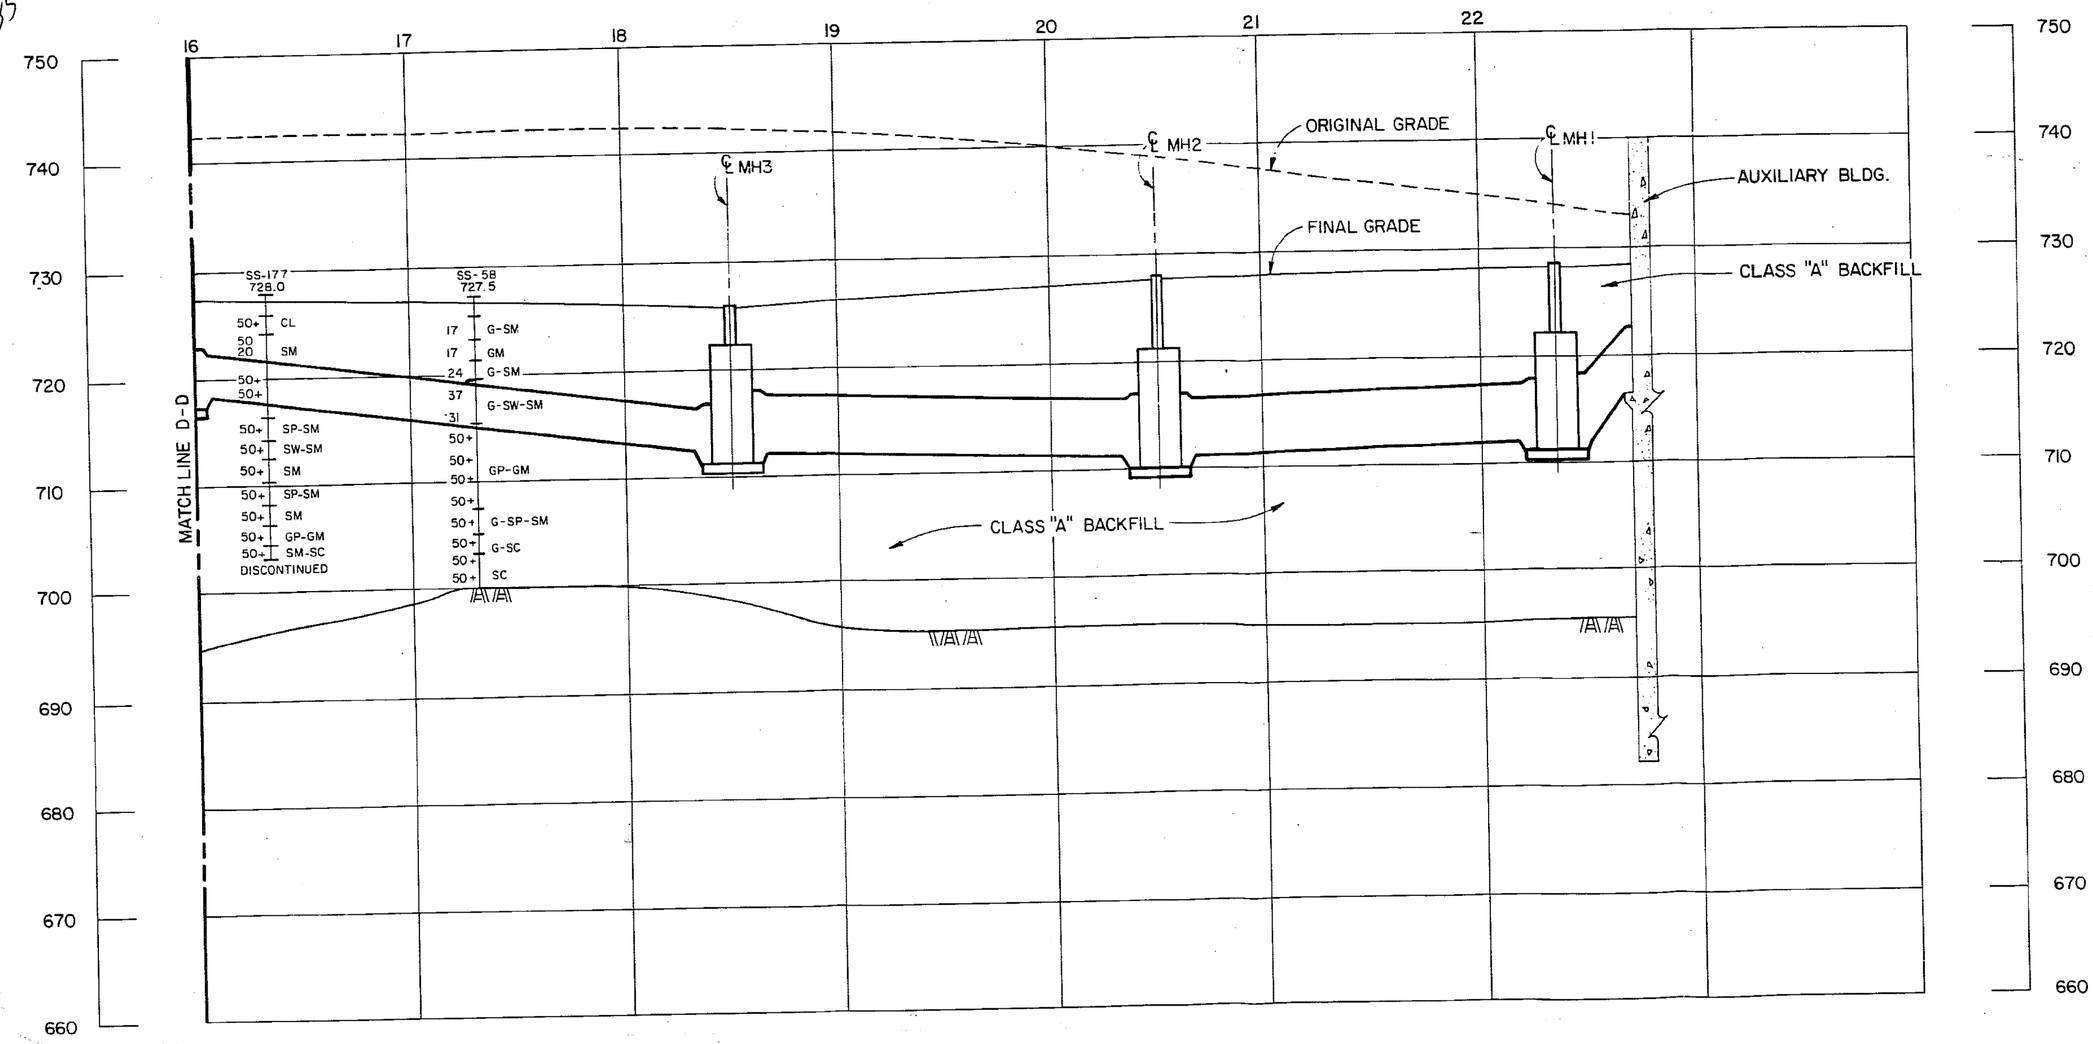


F-F

▼ WATER TABLE (24 HR)
MH SOIL CLASSIFICATION
13 BLOW COUNT

Added by Amendment 49

**WATTS BAR NUCLEAR PLANT**
**FINAL SAFETY ANALYSIS REPORT**

CATEGORY I
CONDUIT BANKS
SECTION F-F
SHEET 1 OF 2
FIGURE 2.5-281 SHT 2