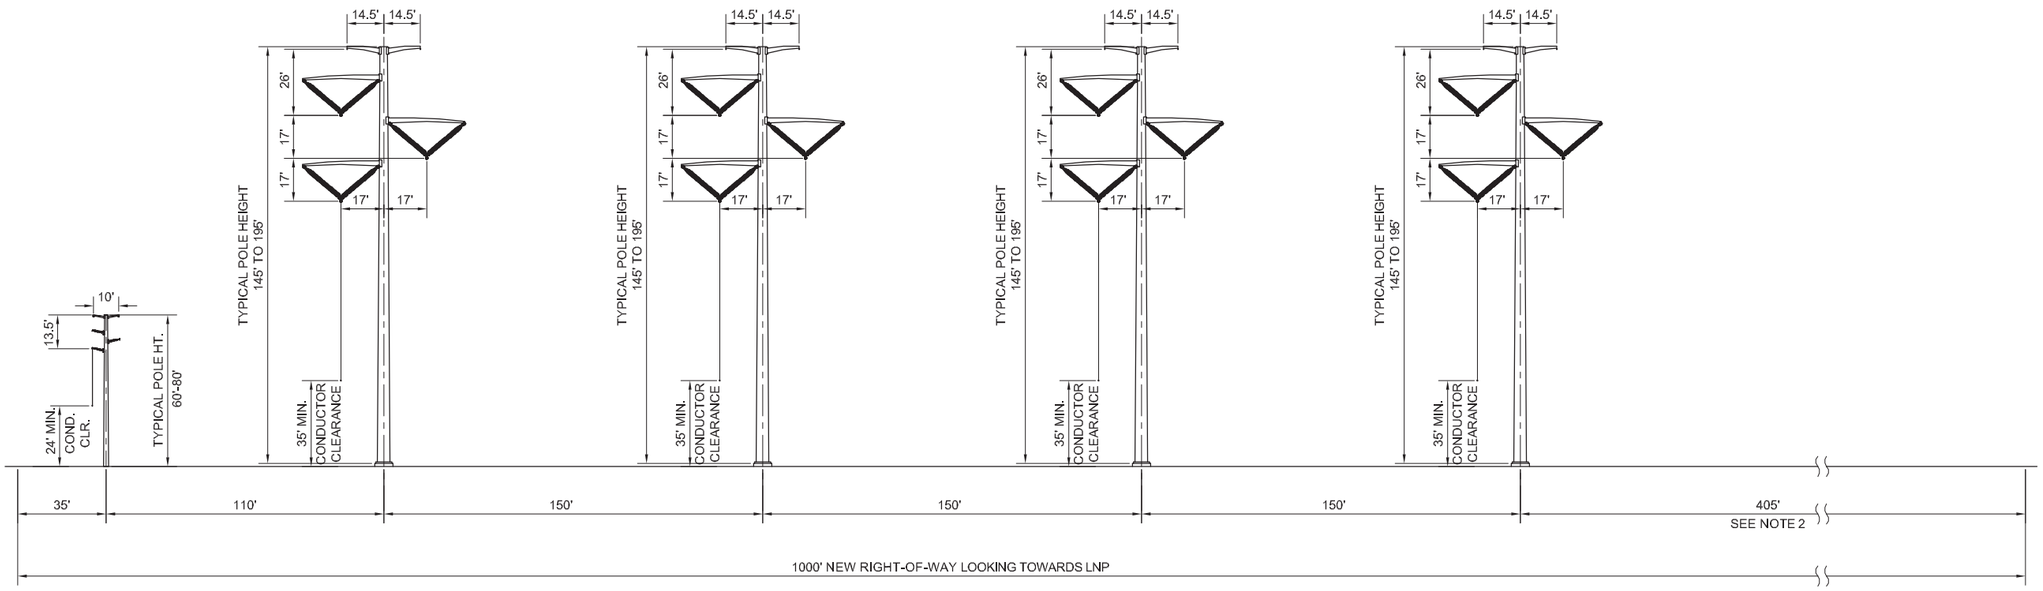

NOTE:

1. TYPICAL PIER FOUNDATION TO BE 8' TO 11' IN DIAMETER.
2. PROVISIONS FOR FUTURE TRANSMISSION LINES.

0 30 60
Feet

Progress Energy Florida

Levy Nuclear Plant
Units 1 and 2
Part 3, Environmental Report

Typical Tangent Steel Monopole Structure on New Multi-Circuit Right-of-Way North of CR 40 with 69kv Line

FIGURE 3.7-11

Rev 0