



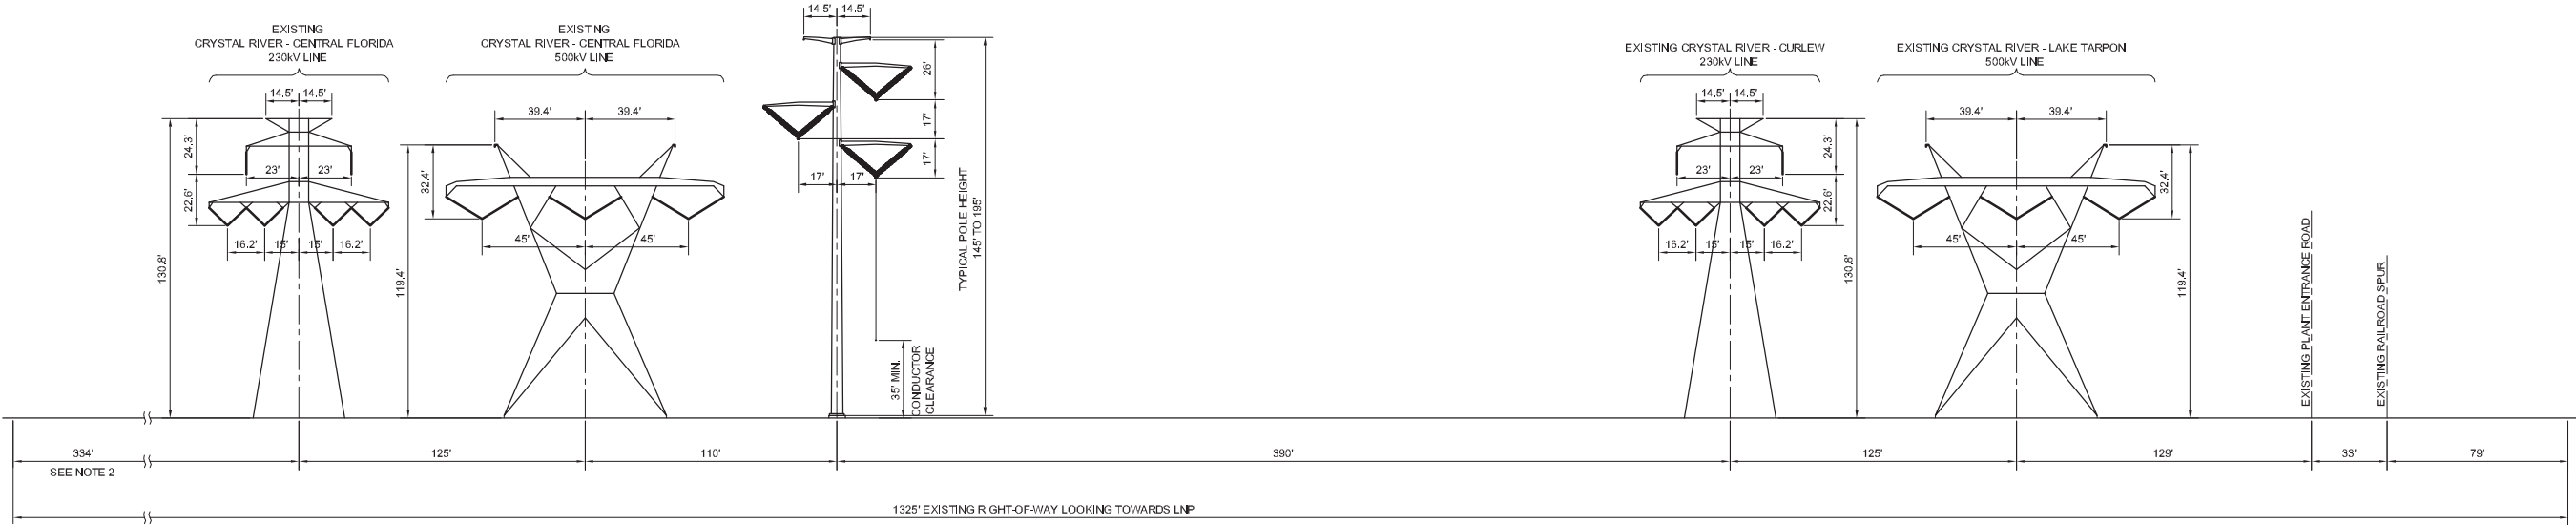

NOTE:
1. TYPICAL PIER FOUNDATION TO BE 8' TO 11' IN DIAMETER.
2. PROVISIONS FOR FUTURE TRANSMISSION LINES IN EXISTING ROW.



Progress Energy Florida Levy Nuclear Plant Units 1 and 2 Part 3, Environmental Report
Typical Tangent Steel Monopole Structure on Existing PEF 230/500kV Right-of-Way
FIGURE 3.7-17
Rev 0