

UNCONFINED COMPRESSION RESULTS

1950

1950

1950

1950



Unconfined Compression Test Report
ASTM D2166

Date: 10/20/2006

Project: Calvert Cliffs Nuclear Power Plant

Location: Calvert County, MD

Schnabel No.: 06120048

Boring No.: B-304

Depth: 98.5-99.5

Elevation: -30.5 to -31.5


Test Specimen Data	
Initial Diameter, in:	2.897
Initial Area, in ² :	6.594
Initial Height, in:	5.787
Height/Diameter Ratio:	2.0
Moisture Content, %:	42.1
Wet Unit Weight, pcf:	110.5
Dry Unit Weight, pcf:	77.7

Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Remarks:

Specimen Type: Tube Sample	
Strength Data	
Strain at Failure, %:	3.9
Unconfined Strength (Qu), tsf:	3.73
Shear Strength (Su), tsf:	1.87

Failure Sketch




Reviewed by: CJS

Soil Desc.: Fine CLAYEY SAND (SC), contains shell fragments - light gray

LL, %:	79	% < 200:	47.3
PI, %:	51	Gs:	2.65

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area ¹ (in ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.59	0.0	0.00
1	1.5	0.006	0.1	6.60	0.2	0.02
2	4.3	0.011	0.2	6.61	0.7	0.05
3	10.7	0.017	0.3	6.61	1.6	0.12
4	19.5	0.024	0.4	6.62	2.9	0.21
5	26.8	0.029	0.5	6.63	4.0	0.29
6	33.5	0.035	0.6	6.63	5.0	0.36
7	40.1	0.041	0.7	6.64	6.0	0.43
8	48.7	0.046	0.8	6.65	7.3	0.53
9	55.1	0.052	0.9	6.65	8.3	0.60
10	64.0	0.058	1.0	6.66	9.6	0.69
11	103.0	0.087	1.5	6.69	15.4	1.11
12	125.5	0.111	1.9	6.72	18.7	1.34
13	159.0	0.140	2.4	6.76	23.5	1.69
14	204.9	0.169	2.9	6.79	30.2	2.17
15	297.3	0.204	3.5	6.84	43.5	3.13
16	333.7	0.216	3.7	6.85	48.7	3.51
17	355.5	0.227	3.9	6.86	51.8	3.73
18	107.8	0.251	4.3	6.89	15.6	1.13
19	0.0	0.000	0.0	6.59	0.0	0.00
20	0.0	0.000	0.0	6.59	0.0	0.00
21	0.0	0.000	0.0	6.59	0.0	0.00
22	0.0	0.000	0.0	6.59	0.0	0.00
23	0.0	0.000	0.0	6.59	0.0	0.00
24	0.0	0.000	0.0	6.59	0.0	0.00
25	0.0	0.000	0.0	6.59	0.0	0.00
26	0.0	0.000	0.0	6.59	0.0	0.00

Axial Stress vs. Axial Strain Plot

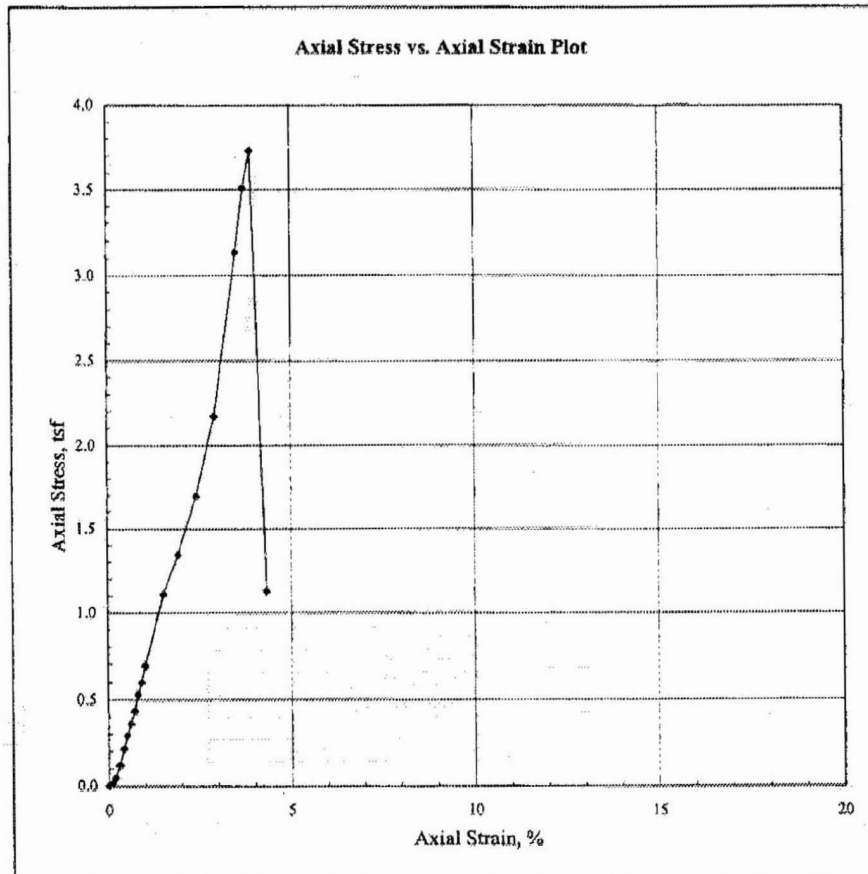

Notes: 1. Right Cylinder Area Correction Method

UC 8/2006 Rev. 0



Unconfined Compression Test Report

ASTM D2166

Date: 10/20/2006

Project: Calvert Cliffs Nuclear Power Plant

Location: Calvert County, MD

Schnabel No.: 06120048.00

Boring No.: B-304

Depth: 138.5-139.3 ft

Elevation: -70.5 to -71.3

Test Specimen Data	
Initial Diameter, in:	2.898
Initial Area, in ² :	6.596
Initial Height, in:	5.680
Height/Diameter Ratio:	2.0
Moisture Content, %:	36.4
Wet Unit Weight, pcf:	112.2
Dry Unit Weight, pcf:	82.3

Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Specimen Type: Tube Sample

Strength Data	
Strain at Failure, %:	3.7
Unconfined Strength (Qu), tsf:	5.23
Shear Strength (Su), tsf:	2.62

Failure Sketch



Remarks:


Reviewed by: CJS

Soil Desc.: Fine CLAYEY SAND (SC) - dark gray

LL, %:	43	% < 200:	45.7
PI, %:	17	Gs:	2.65

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area ¹ (in ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.60	0.0	0.00
1	1.7	0.005	0.1	6.60	0.3	0.02
2	4.9	0.011	0.2	6.61	0.7	0.05
3	8.4	0.017	0.3	6.62	1.3	0.09
4	12.0	0.023	0.4	6.62	1.8	0.13
5	16.2	0.029	0.5	6.63	2.4	0.18
6	22.6	0.035	0.6	6.64	3.4	0.25
7	29.7	0.041	0.7	6.64	4.5	0.32
8	37.6	0.046	0.8	6.65	5.7	0.41
9	45.6	0.052	0.9	6.66	6.8	0.49
10	53.1	0.058	1.0	6.66	8.0	0.57
11	84.6	0.083	1.5	6.69	12.6	0.91
12	124.4	0.112	2.0	6.73	18.5	1.33
13	182.2	0.140	2.5	6.76	26.9	1.94
14	302.5	0.170	3.0	6.80	44.5	3.20
15	463.3	0.198	3.5	6.83	67.8	4.88
16	498.0	0.210	3.7	6.85	72.7	5.23
17	343.7	0.227	4.0	6.87	50.0	3.60
18	112.4	0.281	4.9	6.94	16.2	1.17
19	0.0	0.000	0.0	6.60	0.0	0.00
20	0.0	0.000	0.0	6.60	0.0	0.00
21	0.0	0.000	0.0	6.60	0.0	0.00
22	0.0	0.000	0.0	6.60	0.0	0.00
23	0.0	0.000	0.0	6.60	0.0	0.00
24	0.0	0.000	0.0	6.60	0.0	0.00
25	0.0	0.000	0.0	6.60	0.0	0.00
26	0.0	0.000	0.0	6.60	0.0	0.00

Axial Stress vs. Axial Strain Plot

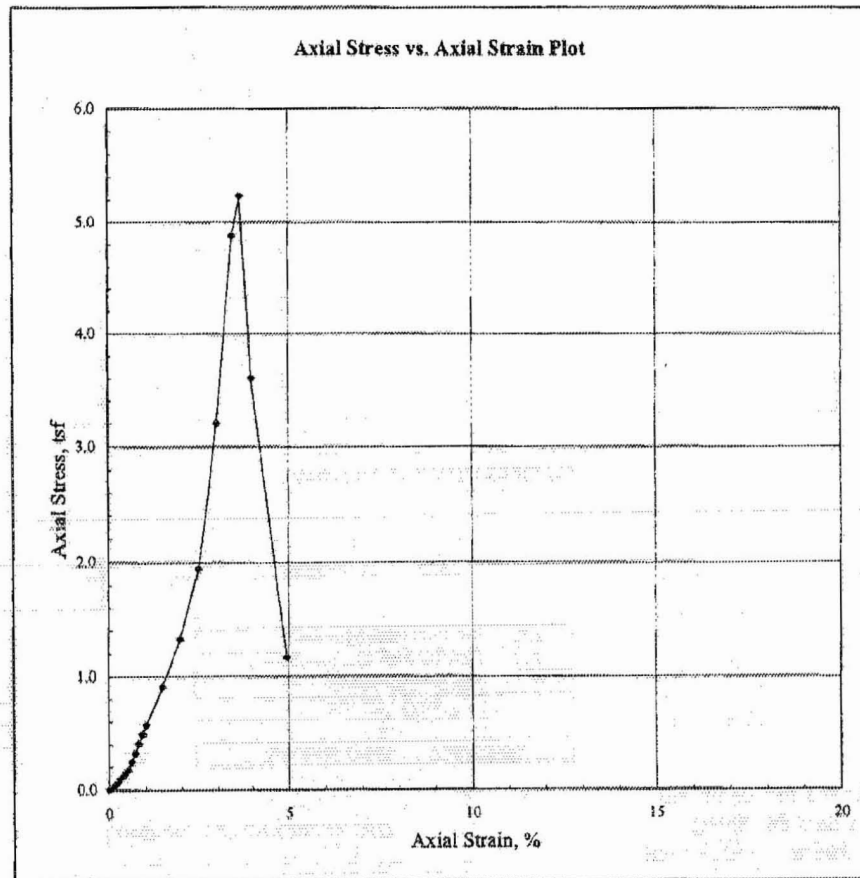

Notes: 1. Right Cylinder Area Correction Method

Unconfined Compression Test Report
ASTM D2166

Date: 10/26/2006

Project: Calvert Cliffs Nuclear Power Plant

Location: Calvert County, MD

Schnabel No.: 06120048

Boring No.: B-316

Depth: 43.5-45.5 ft.

Elevation: 64.6 to 62.6

Test Specimen Data	
Initial Diameter, in:	2.884
Initial Area, in ² :	6.535
Initial Height, in:	5.847
Height/Diameter Ratio:	2.0
Moisture Content, %:	28.6
Wet Unit Weight, pcf:	119.4
Dry Unit Weight, pcf:	92.8

Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Specimen Type: Tube Sample

Strength Data	
Strain at Failure, %:	3.4
Unconfined Strength (Qu), tsf:	1.13
Shear Strength (Su), tsf:	0.57

Failure Sketch



Remarks:


Reviewed by: CJS

Soil Desc.: LEAN CLAY with sand (CL) - gray

LL, %:	44	% < 200:	71.0
PI, %:	28	Gs:	2.79

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area (in ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.54	0.0	0.00
1	7.0	0.005	0.1	6.54	1.1	0.08
2	10.6	0.011	0.2	6.55	1.6	0.12
3	13.6	0.017	0.3	6.55	2.1	0.15
4	16.4	0.023	0.4	6.56	2.5	0.18
5	18.7	0.029	0.5	6.57	2.8	0.21
6	21.2	0.035	0.6	6.57	3.2	0.23
7	23.4	0.040	0.7	6.58	3.6	0.26
8	25.7	0.046	0.8	6.59	3.9	0.28
9	28.6	0.052	0.9	6.59	4.3	0.31
10	30.9	0.058	1.0	6.60	4.7	0.34
11	46.2	0.087	1.5	6.63	7.0	0.50
12	63.5	0.116	2.0	6.67	9.5	0.69
13	83.2	0.145	2.5	6.70	12.4	0.89
14	99.9	0.175	3.0	6.74	14.8	1.07
15	106.0	0.198	3.4	6.76	15.7	1.13
16	104.1	0.216	3.7	6.79	15.3	1.10
17	96.6	0.233	4.0	6.81	14.2	1.02
18	65.9	0.291	5.0	6.88	9.6	0.69
19	55.2	0.309	5.3	6.90	8.0	0.58
20						
21						
22						
23						
24						
25						
26						

Axial Stress vs. Axial Strain Plot

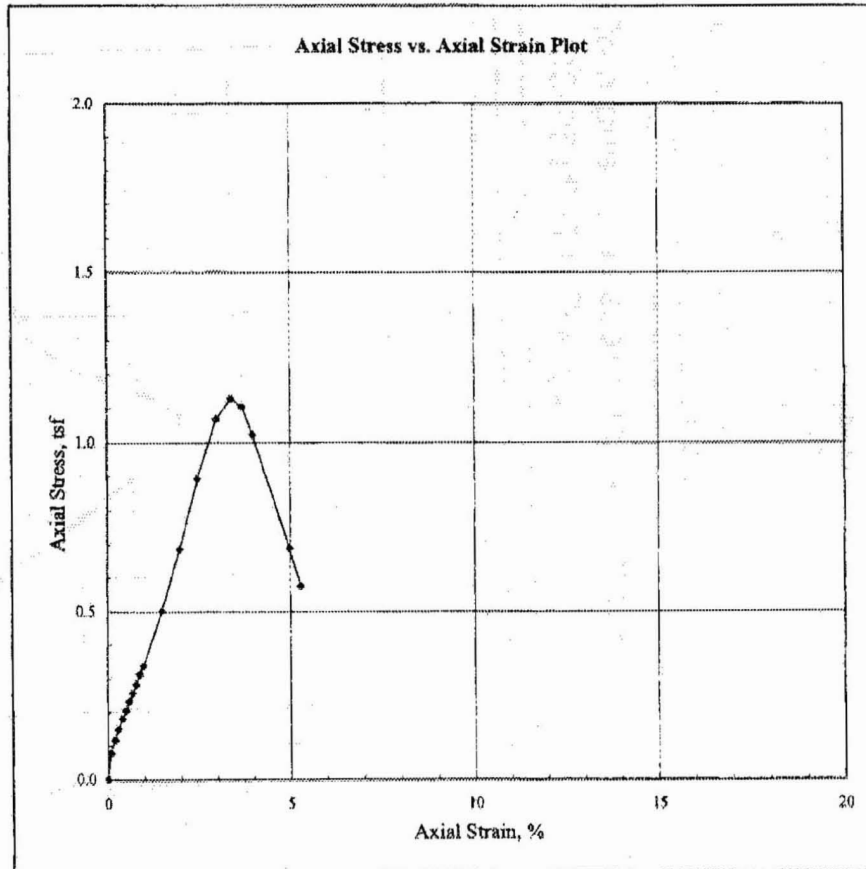



Notes: 1. Right Cylinder Area Correction Method

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/18/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-326
Sample ID:	S-10
Depth, ft:	33.5-35.5
Visual Description:	Moist, dark gray sandy clay
Test No.:	UC9

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

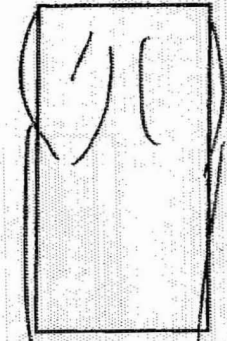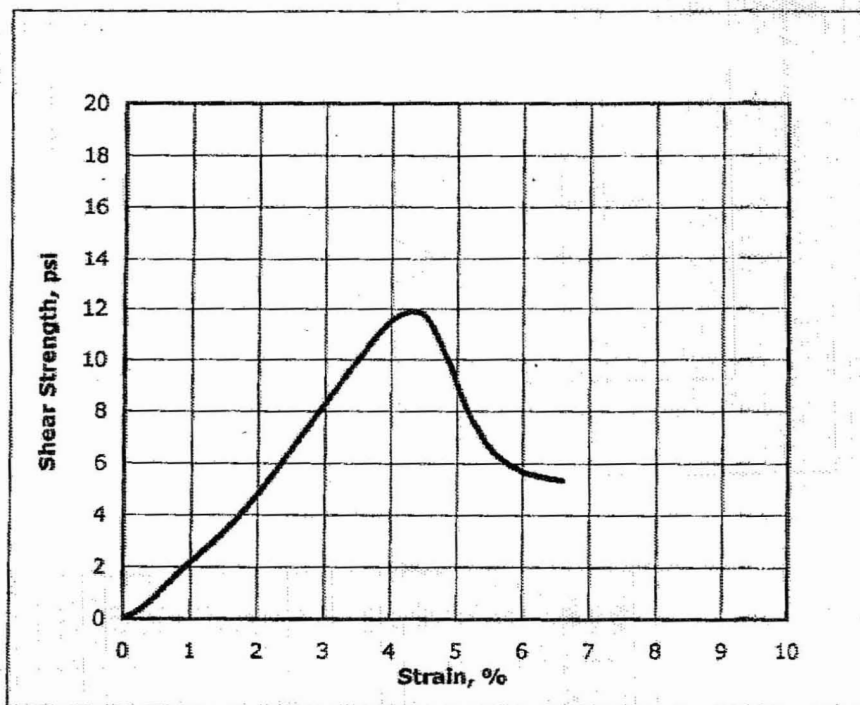

Failure Sketch

Initial Diameter, In:	2.87	Shear Strength, psi:	11.9
Initial Height, In:	6.05	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.11	Strain at Failure, %:	4.3
Initial Mass, grams:	1237	Sample Type:	Tube
Initial Bulk Density, pcf:	120.4	Liquid Limit:	41
Initial Moisture Content, %:	26.6	Plastic Limit:	16
Initial Dry Density, pcf:	95.1	Plasticity Index:	25
Initial Degree of Saturation:	90.4	% Passing #200 sieve:	62
Initial Void Ratio:	0.81	Soil Classification:	Sandy Lean Clay
Measured Specific Gravity:	2.76	Group Symbol:	CL



Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	9/27/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-326
Sample ID:	S-12
Depth, ft:	43.5-45.5
Visual Description:	Moist, very dark gray organic clay
Test No.:	UCB

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

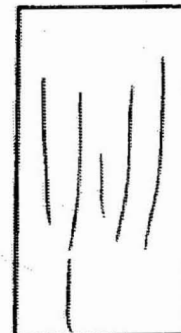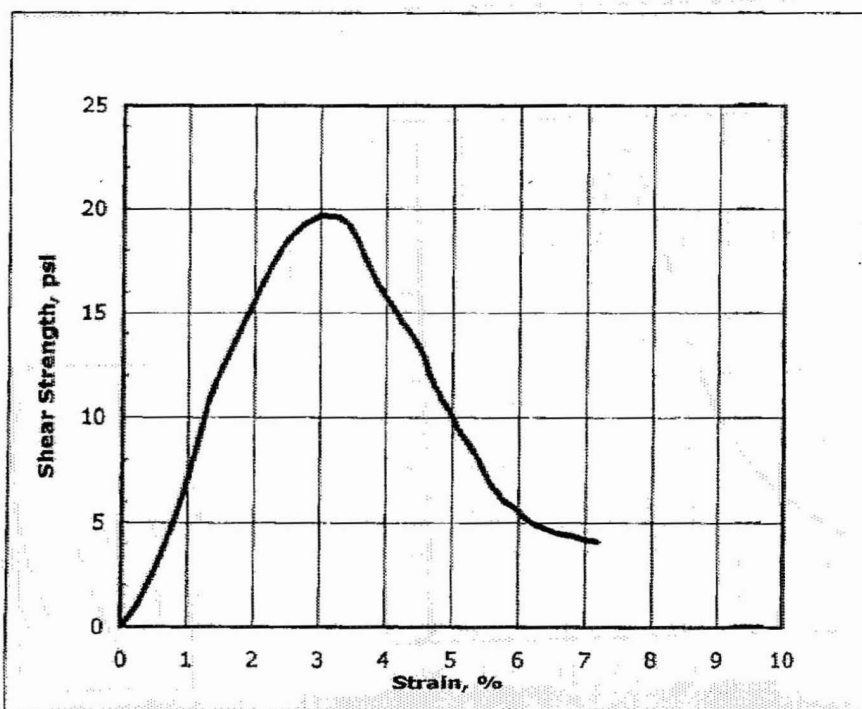

Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	19.7
Initial Height, in:	6	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.09	Strain at Failure, %:	3.1
Initial Mass, grams:	1134	Sample Type:	Tube
Initial Bulk Density, pcf:	111.3	Liquid Limit:	63
Initial Moisture Content, %:	32.3	Plastic Limit:	22
Initial Dry Density, pcf:	84.1	Plasticity Index:	41
Initial Degree of Saturation:	87.0	% Passing #200 sieve:	89
Initial Void Ratio:	1.00	Soil Classification:	Organic Clay
Measured Specific Gravity:	2.70	Group Symbol:	OH


Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	9/27/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-331
Sample ID:	S-7
Depth, ft:	18.5-20.5
Visual Description:	Moist, mottled dark greenish gray, dusky red, and reddish brown clay
Test No.:	UC8

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

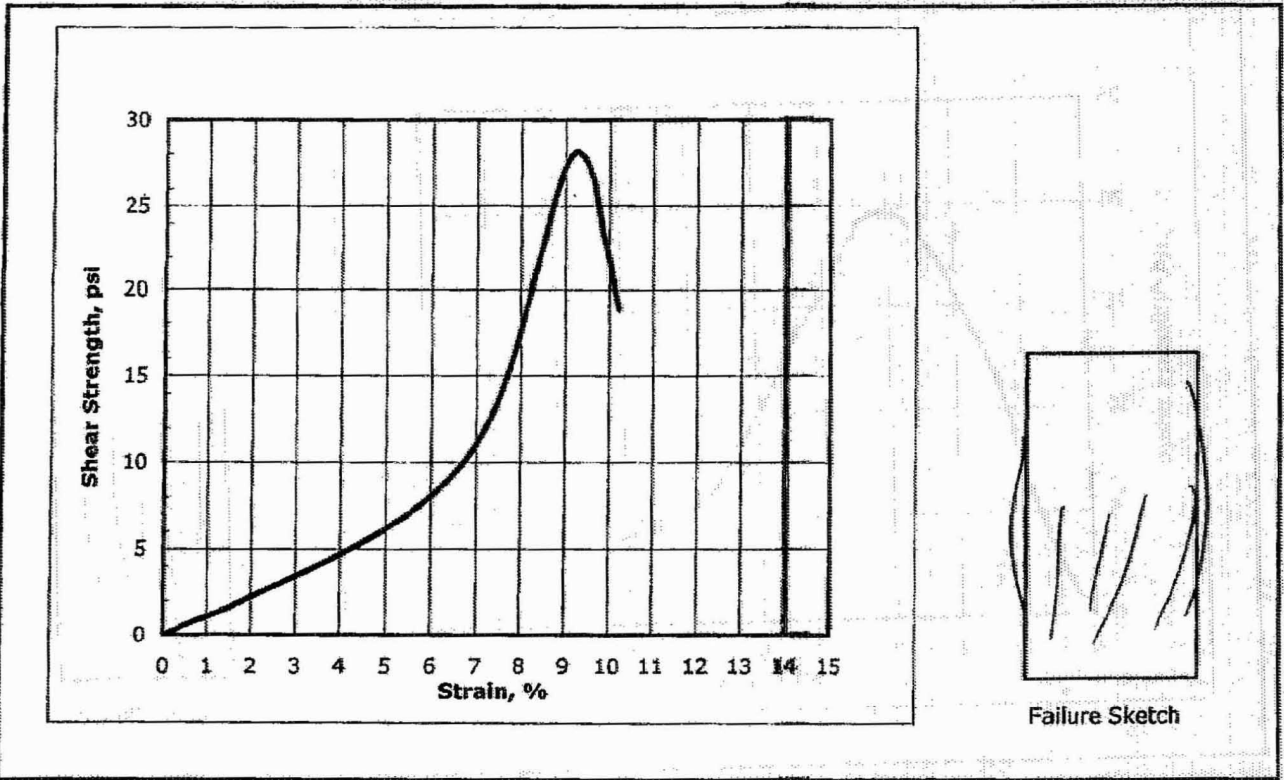

Initial Diameter, in:	2.87	Shear Strength, psi:	28.2
Initial Height, in:	5.75	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.00	Strain at Failure, %:	9.3
Initial Mass, grams:	1084	Sample Type:	Tube
Initial Bulk Density, pcf:	111.0	Liquid Limit:	57
Initial Moisture Content, %:	31.3	Plastic Limit:	23
Initial Dry Density, pcf:	84.5	Plasticity Index:	34
Initial Degree of Saturation:	84.9	% Passing #200 sieve:	97
Initial Void Ratio:	1.00	Soil Classification:	Fat Clay
Measured Specific Gravity:	2.71	Group Symbol:	CH

Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422



Unconfined Compression Test Report
ASTM D2166

Date: 10/30/2006

Project: Calvert Cliffs Nuclear Power Plant

Location: Calvert County, MD

Schnabel No.: 06120048

Boring No.: B-333

Depth: 28.5-30.5 ft.

Elevation: 61 to 59 ft


Test Specimen Data	
Initial Diameter, in.	2.892
Initial Area, in. ²	6.569
Initial Height, in.	5.825
Height/Diameter Ratio:	2.0
Moisture Content, %:	38.9
Wet Unit Weight, pcf:	112.8
Dry Unit Weight, pcf:	81.2

Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Remarks:

Specimen Type: Tube Sample	
Strength Data	
Strain at Failure, %:	3.4
Unconfined Strength (Qu), tsf:	1.49
Shear Strength (Su), tsf:	0.75

Failure Sketch




Reviewed by: CJS

Soil Desc.: FAT CLAY with sand (CH) - gray

LL, %:	52	% < 200:	85.3
PL, %:	33	Gs:	2.82

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area (in. ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.57	0.0	0.00
1	2.0	0.005	0.1	6.57	0.3	0.02
2	4.6	0.012	0.2	6.58	0.7	0.05
3	7.3	0.017	0.3	6.59	1.1	0.08
4	9.8	0.023	0.4	6.60	1.5	0.11
5	12.3	0.029	0.5	6.60	1.9	0.13
6	14.5	0.035	0.6	6.61	2.2	0.16
7	17.1	0.040	0.7	6.61	2.6	0.19
8	19.8	0.046	0.8	6.62	3.0	0.22
9	22.6	0.052	0.9	6.63	3.4	0.25
10	25.7	0.058	1.0	6.64	3.9	0.28
11	45.4	0.087	1.5	6.67	6.8	0.49
12	72.9	0.116	2.0	6.70	10.9	0.78
13	103.8	0.145	2.5	6.74	15.4	1.11
14	130.9	0.175	3.0	6.77	19.3	1.39
15	140.3	0.198	3.4	6.80	20.6	1.49
16	127.8	0.216	3.7	6.82	18.7	1.35
17	87.2	0.234	4.0	6.84	12.7	0.92
18	22.4	0.291	5.0	6.91	3.2	0.23
19						
20						
21						
22						
23						
24						
25						
26						

Axial Stress vs. Axial Strain Plot

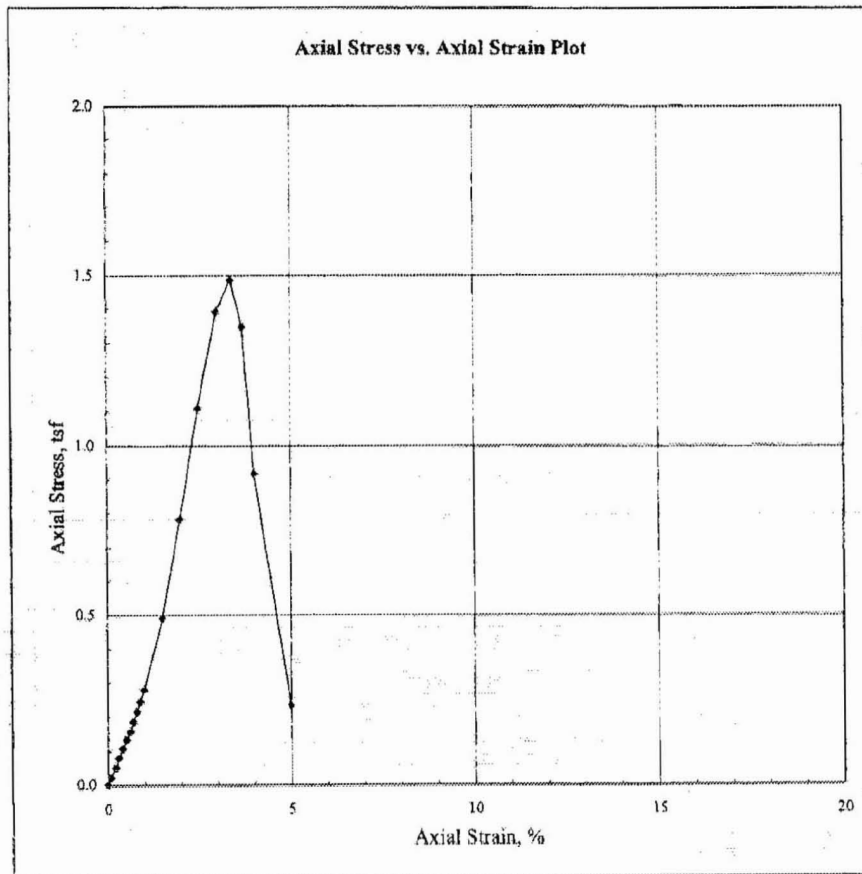

Notes: 1. Right Cylinder Area Correction Method

UC 8/2006 Rev. 0



Unconfined Compression Test Report

ASTM D2166

Date: 11/27/2006

Project: Calvert Cliffs Nuclear Power Plant

Location: Calvert County, MD

Schnabel No.: 06120048

Boring No.: B-333

Depth: 38.5-40.5ft.

Elevation: 51 to 49 ft

Test Specimen Data	
Initial Diameter, in:	2.885
Initial Area, in ² :	6.540
Initial Height, in:	5.889
Height/Diameter Ratio:	2.0
Moisture Content, %:	35.7
Wet Unit Weight, pcf:	118.0
Dry Unit Weight, pcf:	87.0

Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Specimen Type: Tube Sample

Strength Data	
Strain at Failure, %:	2.4
Unconfined Strength (Qu), tsf:	2.98
Shear Strength (Su), tsf:	1.49

Failure Sketch



Remarks:


Reviewed by: CJS

Soil Desc.: FAT CLAY (CH) - gray

LL, %:	61	% < 200:	98.8
PI, %:	38	Gs:	2.85

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area ¹ (in ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.54	0.0	0.00
1	8.1	0.006	0.1	6.55	1.2	0.09
2	16.4	0.011	0.2	6.55	2.5	0.18
3	24.2	0.017	0.3	6.56	3.7	0.27
4	31.4	0.023	0.4	6.57	4.8	0.34
5	38.2	0.029	0.5	6.57	5.8	0.42
6	47.5	0.035	0.6	6.58	7.2	0.52
7	56.8	0.041	0.7	6.59	8.6	0.62
8	67.4	0.046	0.8	6.59	10.2	0.74
9	79.5	0.052	0.9	6.60	12.0	0.87
10	91.8	0.058	1.0	6.60	13.9	1.00
11	171.2	0.087	1.5	6.64	25.8	1.86
12	247.6	0.116	2.0	6.67	37.1	2.67
13	276.8	0.140	2.4	6.70	41.3	2.98
14	176.1	0.175	3.0	6.74	26.1	1.88
15	52.9	0.233	4.0	6.81	7.8	0.56
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						

Axial Stress vs. Axial Strain Plot

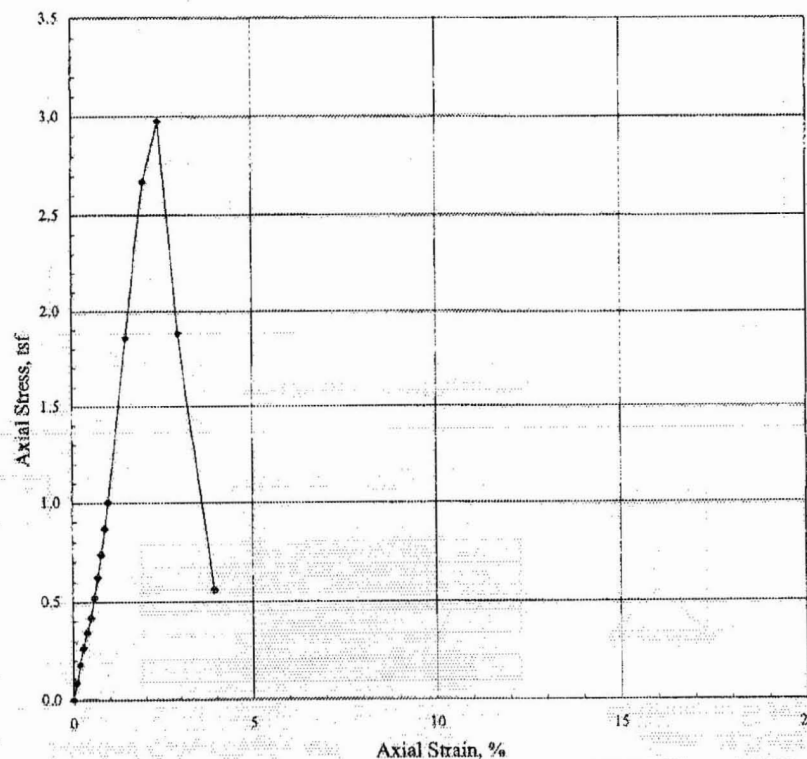

Notes: 1. Right Cylinder Area Correction Method


UC 8/2006 Rev. 0

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/19/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-406
Sample ID:	S-16
Depth, ft:	63.5-65.5
Visual Description:	Moist, very dark gray organic clay with sand
Test No.:	UC13

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

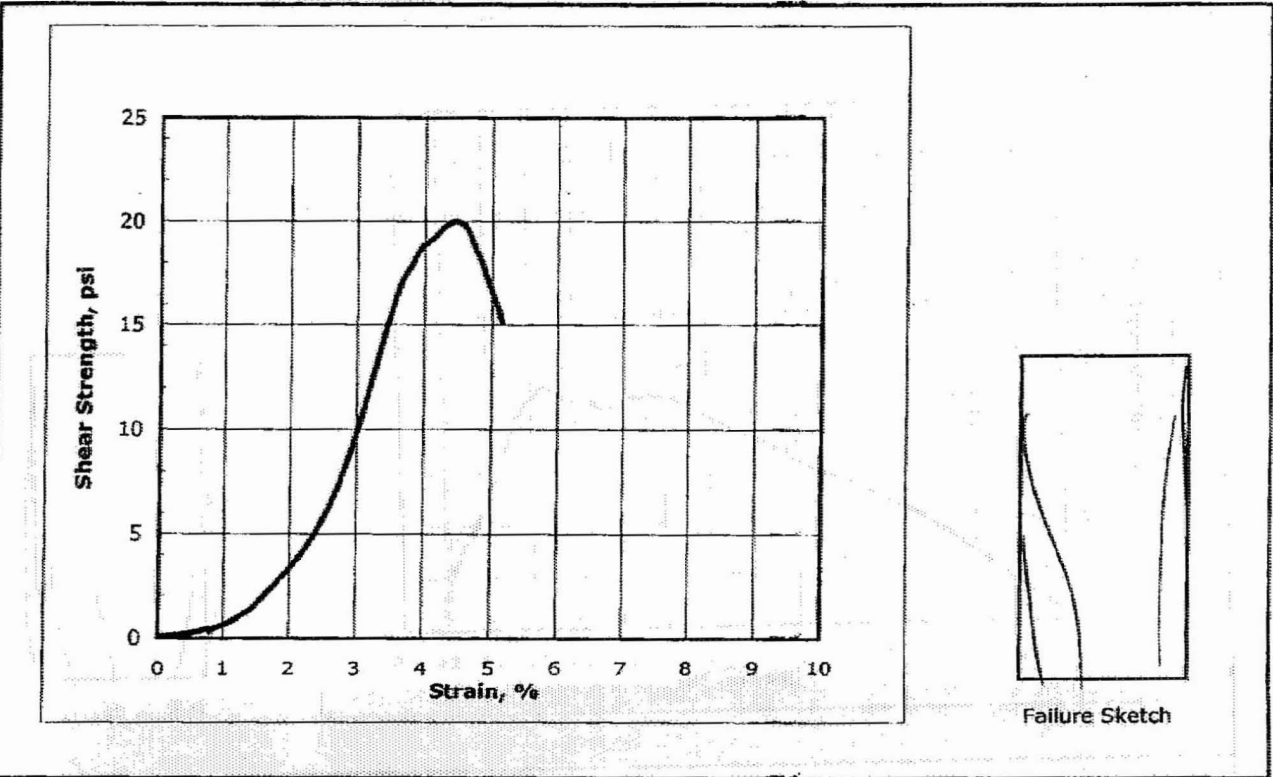

Initial Diameter, in:	2.87	Shear Strength, psi:	20.0
Initial Height, in:	5.9	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.06	Strain at Failure, %:	4.5
Initial Mass, grams:	1126	Sample Type:	Tube
Initial Bulk Density, pcf:	112.4	Liquid Limit:	63
Initial Moisture Content, %:	38.3	Plastic Limit:	19
Initial Dry Density, pcf:	81.2	Plasticity Index:	44
Initial Degree of Saturation:	95.1	% Passing #200 sieve:	90
Initial Void Ratio:	1.10	Soil Classification:	Organic Clay
Measured Specific Gravity:	2.74	Group Symbol:	OH


Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/19/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-414
Sample ID:	S-17
Depth, ft:	68-70
Visual Description:	Moist, dark greenish gray clay
Test No.:	UC11

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

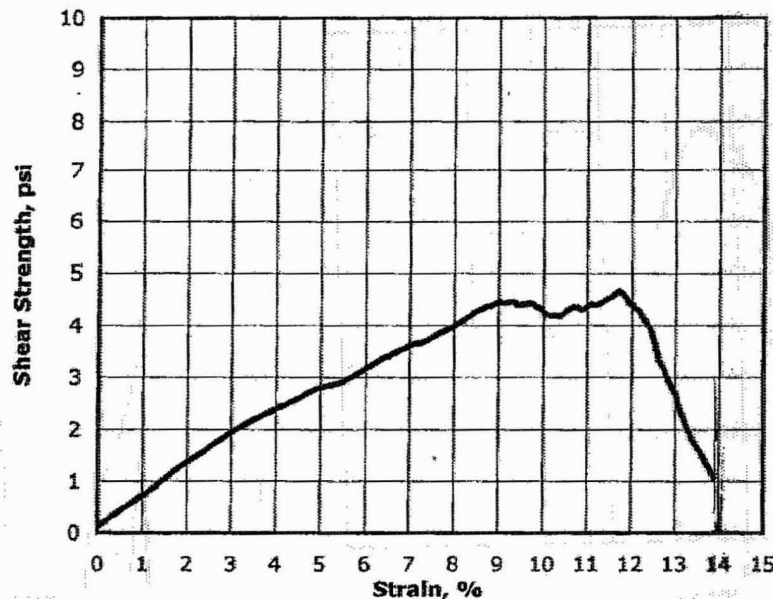

Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	4.7
Initial Height, in:	6.05	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.11	Strain at Failure, %:	11.7
Initial Mass, grams:	1059	Sample Type:	Tube
Initial Bulk Density, pcf:	103.1	Liquid Limit:	51
Initial Moisture Content, %:	36.6	Plastic Limit:	15
Initial Dry Density, pcf:	75.4	Plasticity Index:	36
Initial Degree of Saturation:	78.6	% Passing #200 sieve:	97
Initial Void Ratio:	1.29	Soil Classification:	Fat Clay
Measured Specific Gravity:	2.77	Group Symbol:	CH


Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	9/12/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-420
Sample ID:	S-16
Depth, ft:	63.5-65.5
Visual Description:	Moist, olive gray clayey sand
Test No.:	UC1

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

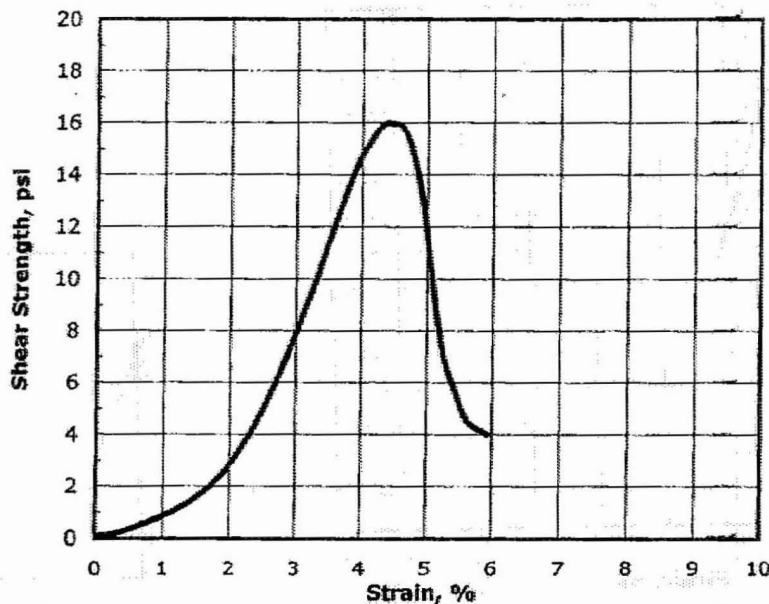


Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	16.0
Initial Height, in:	6.05	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.11	Strain at Failure, %:	4.4
Initial Mass, grams:	1204	Sample Type:	Tube
Initial Bulk Density, pcf:	117.2	Liquid Limit:	49
Initial Moisture Content, %:	31.6	Plastic Limit:	38
Initial Dry Density, pcf:	89.0	Plasticity Index:	11
Initial Degree of Saturation:	93.8	% Passing #200 sieve:	19
Initial Void Ratio:	0.93	Soil Classification:	Clayey Sand
Measured Specific Gravity:	2.75	Group Symbol:	SC

Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/19/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-427
Sample ID:	S-16
Depth, ft:	63.5-65.5
Visual Description:	Moist, black sandy organic clay
Test No.:	UC12

**Unconfined Compressive Strength of Cohesive Soil
 by ASTM D 2166-00**

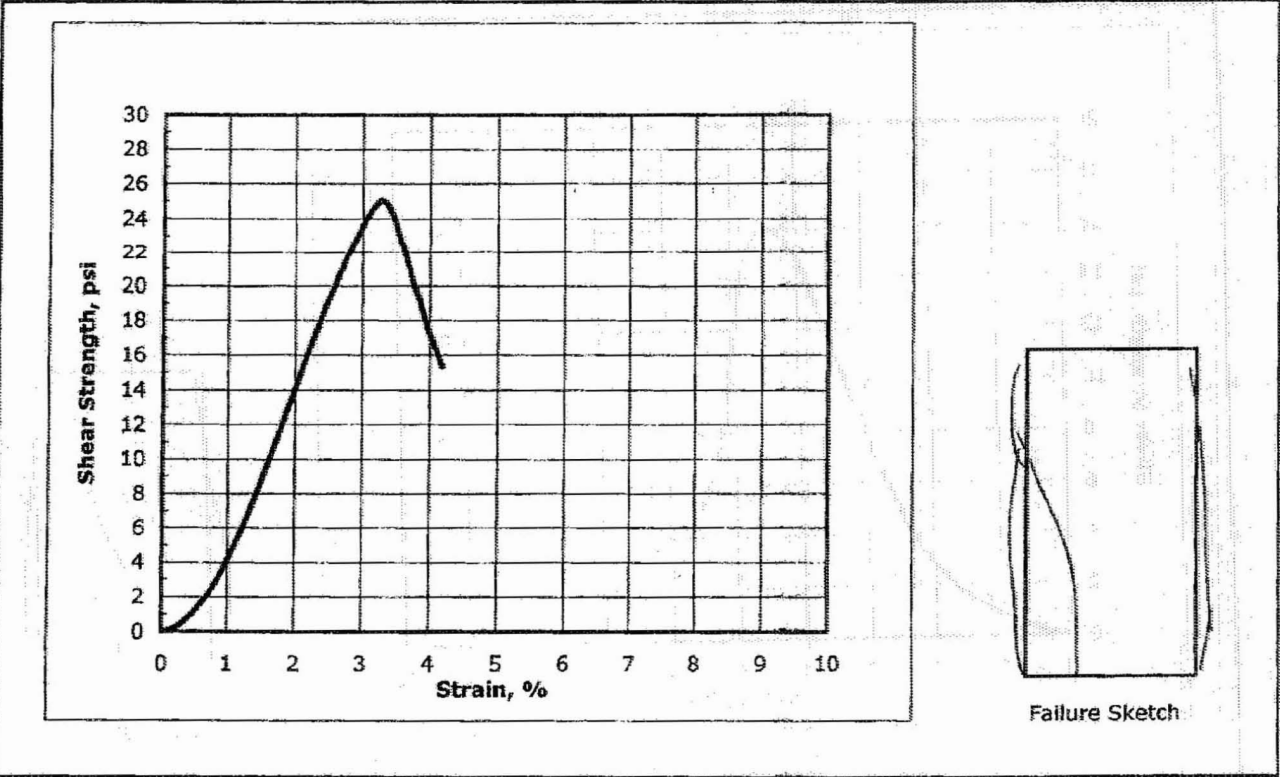

Initial Diameter, in:	2.87	Shear Strength, psi:	25.0
Initial Height, in:	5.83	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.03	Strain at Failure, %:	3.3
Initial Mass, grams:	1158	Sample Type:	Tube
Initial Bulk Density, pcf:	117.0	Liquid Limit:	56
Initial Moisture Content, %:	36.4	Plastic Limit:	18
Initial Dry Density, pcf:	85.7	Plasticity Index:	38
Initial Degree of Saturation:	100.7	% Passing #200 sieve:	61
Initial Void Ratio:	0.99	Soil Classification:	Organic Clay
Measured Specific Gravity:	2.73	Group Symbol:	OH


Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/27/2006
Tested By:	md
Checked By:	ldt
Boring ID:	B-428
Sample ID:	---
Depth, ft:	60-62
Visual Description:	Moist, dark greenish gray ^{fat} organic clay with sand BB/4/6/07
Test No.:	UC14

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

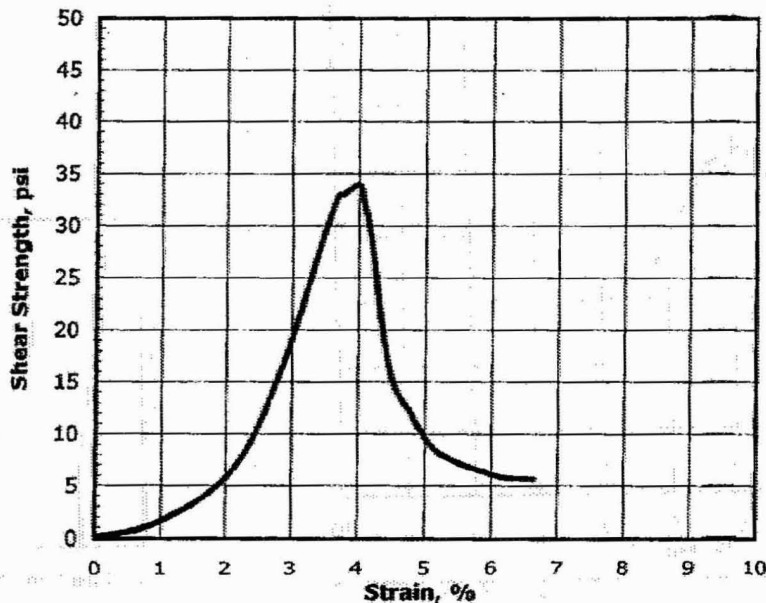

Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	33.9
Initial Height, in:	6	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.09	Strain at Failure, %:	4.0
Initial Mass, grams:	1227	Sample Type:	Tube
Initial Bulk Density, pcf:	120.4	Liquid Limit:	61
Initial Moisture Content, %:	32.2	Plastic Limit:	17
Initial Dry Density, pcf:	91.1	Plasticity Index:	44
Initial Degree of Saturation:	99.3	% Passing #200 sieve:	93
Initial Void Ratio:	0.90	Soil Classification:	^{fat} Organic Clay w/ Sand
Measured Specific Gravity:	2.77	Group Symbol:	OH CH

Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422


BB/4/6/07

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	9/27/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-433
Sample ID:	S-11
Depth, ft:	38.5-40.5
Visual Description:	Moist, very dark gray clay
Test No.:	UC6

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

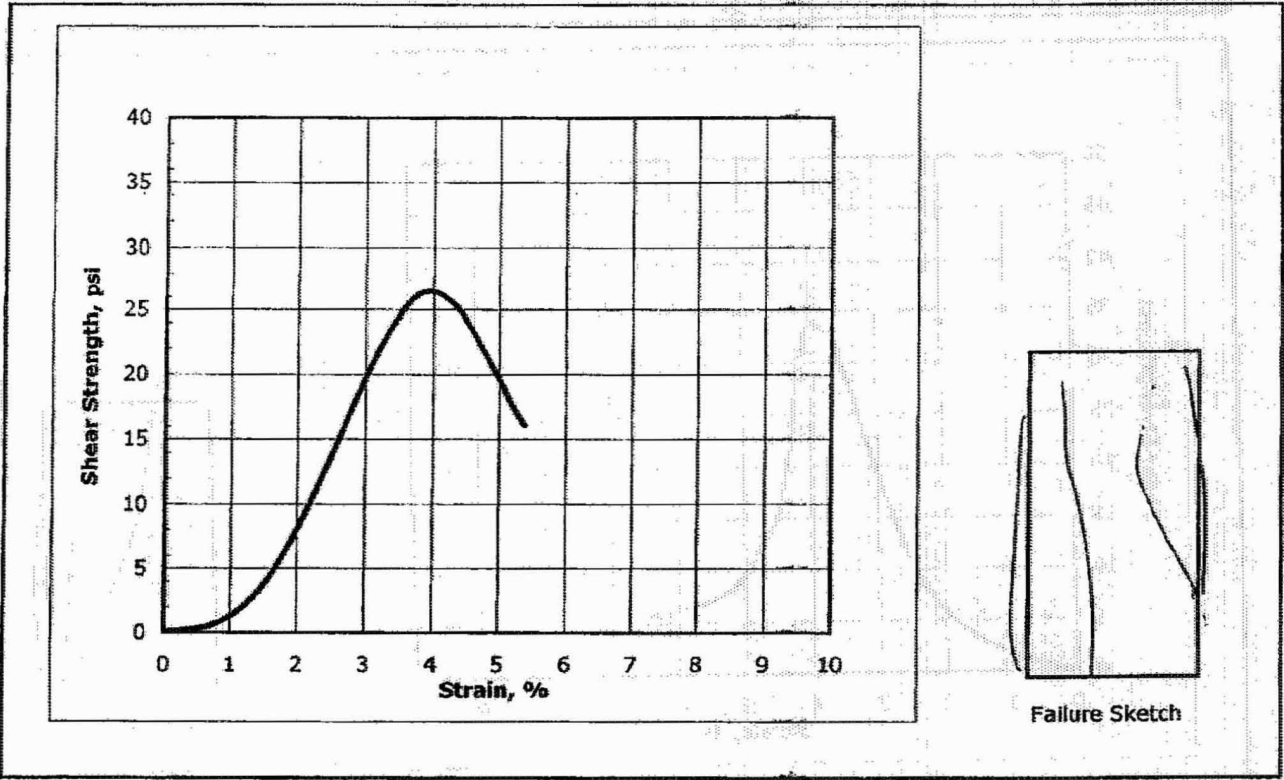

Initial Diameter, in:	2.87	Shear Strength, psi:	26.4
Initial Height, in:	6.00	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.09	Strain at Failure, %:	4.0
Initial Mass, grams:	1232	Sample Type:	Tube
Initial Bulk Density, pcf:	120.9	Liquid Limit:	61
Initial Moisture Content, %:	30.5	Plastic Limit:	14
Initial Dry Density, pcf:	92.6	Plasticity Index:	47
Initial Degree of Saturation:	97.7	% Passing #200 sieve:	91
Initial Void Ratio:	0.87	Soil Classification:	Fat Clay
Measured Specific Gravity:	2.77	Group Symbol:	CH


Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/27/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-433
Sample ID:	S-13
Depth, ft:	48.5-50.5
Visual Description:	Moist, black clay with sand
Test No.:	UC7

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

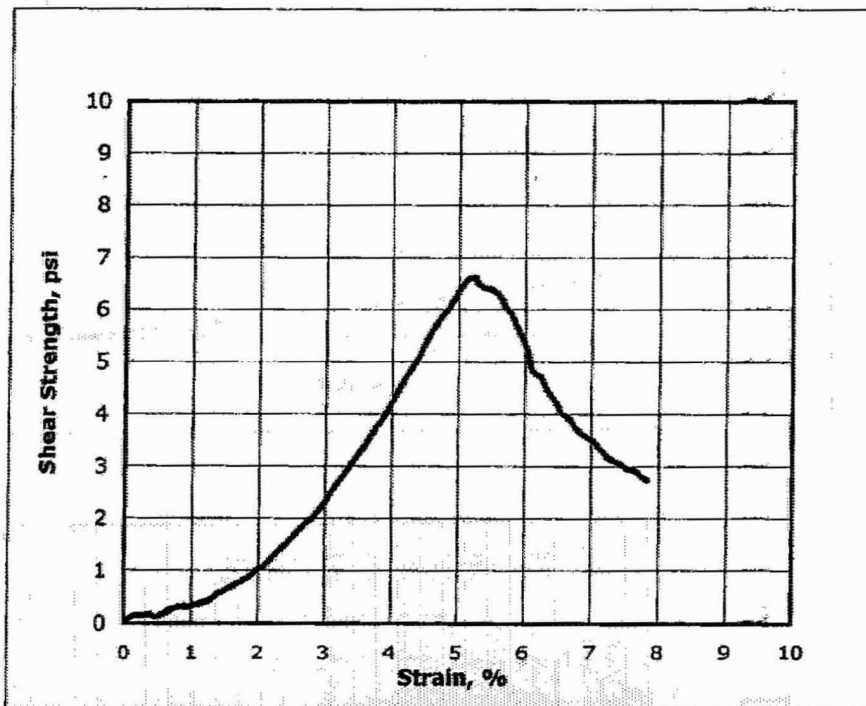

Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	6.6
Initial Height, in:	6.3	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.20	Strain at Failure, %:	5.2
Initial Mass, grams:	1207	Sample Type:	Tube
Initial Bulk Density, pcf:	112.8	Liquid Limit:	64
Initial Moisture Content, %:	36.8	Plastic Limit:	23
Initial Dry Density, pcf:	82.4	Plasticity Index:	41
Initial Degree of Saturation:	96.7	% Passing #200 sieve:	95
Initial Void Ratio:	1.01	Soil Classification:	Clay with Sand
Measured Specific Gravity:	2.66	Group Symbol:	CH

Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422



Unconfined Compression Test Report

ASTM D2166

Project: Calvert Cliffs Nuclear Power Plant

Schnabel No.: 06120048

Date: 11/27/2006

Location: Calvert County, MD

Boring No.: B-434

Depth: 53.5-55.5ft.

Elevation: 51.7 to 49.7 ft

Test Specimen Data	
Initial Diameter, in:	2.889
Initial Area, in ² :	6.558
Initial Height, in:	5.843
Height/Diameter Ratio:	2.0
Moisture Content, %:	34.4
Wet Unit Weight, pcf:	116.4
Dry Unit Weight, pcf:	86.6


Testing Information	
Test Procedure:	ASTM D2166
Type of Specimen:	Tube Sample
Load Cell No.:	1018253
Strain Rate, %/min.:	1.0

Specimen Type: Tube Sample

Strength Data	
Strain at Failure, %:	2.0
Unconfined Strength (Qu), tsf:	4.10
Shear Strength (Su), tsf:	2.05

Remarks:


Reviewed by: C/S



Soil Desc.: FAT CLAY (CH) trace sand - gray

LL, %:	56	% < 200:	94.9
PI, %:	32	Gs:	2.84

Test Data						
Reading No.	Axial Load (lbs)	Axial Displ. (in.)	Axial Strain (%)	Corrected Area ¹ (in ²)	Axial Stress (psi)	Axial Stress (tsf)
Zero	0.0	0.000	0.0	6.56	0.0	0.00
1	26.4	0.006	0.1	6.56	4.0	0.29
2	47.3	0.012	0.2	6.57	7.2	0.52
3	74.3	0.018	0.3	6.58	11.3	0.81
4	99.4	0.024	0.4	6.58	15.1	1.09
5	125.8	0.030	0.5	6.59	19.1	1.37
6	152.7	0.037	0.6	6.60	23.1	1.67
7	174.4	0.041	0.7	6.60	26.4	1.90
8	197.0	0.047	0.8	6.61	29.8	2.15
9	219.8	0.054	0.9	6.62	33.2	2.39
10	238.7	0.059	1.0	6.62	36.0	2.59
11	319.4	0.082	1.4	6.65	48.0	3.46
12	381.3	0.117	2.0	6.69	57.0	4.10
13	117.2	0.146	2.5	6.73	17.4	1.25
14	47.9	0.176	3.0	6.76	7.1	0.51
15						
16						
17						
18						
19						
20						
21						
22						
23						
24						
25						
26						

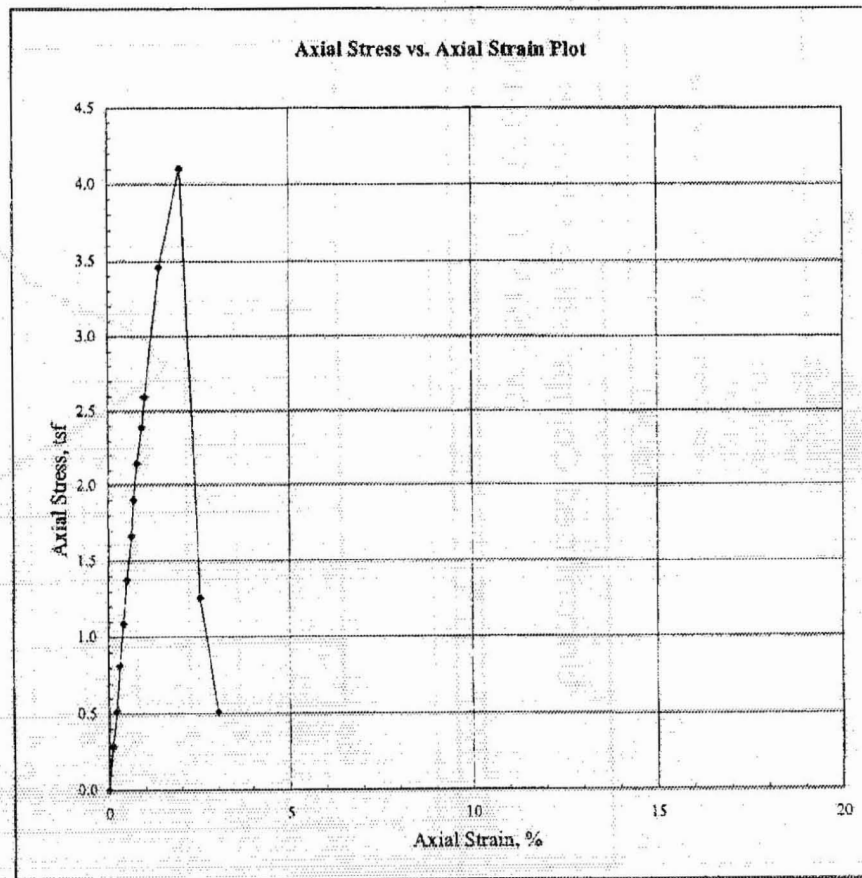



Notes: 1. Right Cylinder Area Correction Method

GeoTesting express

a subsidiary of Geocomp Corporation

Client:	Schnabel Engineering, Inc.
Project Name:	Subsurface Investigation Calvert Cliffs Nuclear PP
Project Location:	Calvert County, MD
GTX #:	6880
Test Date:	10/27/2006
Tested By:	md
Checked By:	jdt
Boring ID:	B-440
Sample ID:	S-14
Depth, ft:	51-53
Visual Description:	Moist, dark greenish gray organic clay with sand
Test No.:	UC14

Unconfined Compressive Strength of Cohesive Soil by ASTM D 2166-00

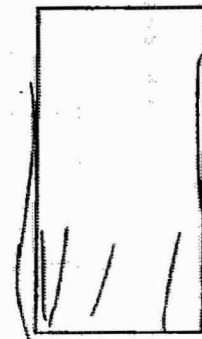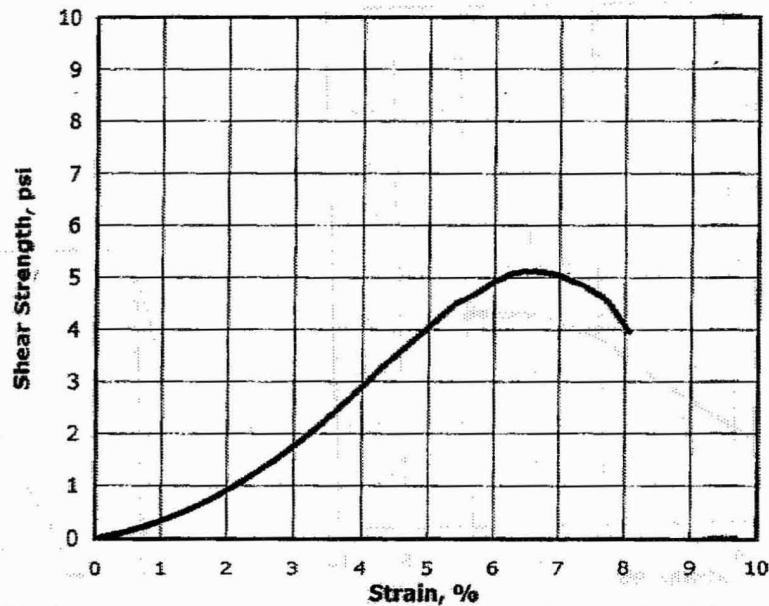

Failure Sketch

Initial Diameter, in:	2.87	Shear Strength, psi:	5.1
Initial Height, in:	5.8	Strain Rate, %/min:	1
Height to Diameter Ratio:	2.02	Strain at Failure, %:	6.5
Initial Mass, grams:	1163	Sample Type:	Tube
Initial Bulk Density, pcf:	118.1	Liquid Limit:	30
Initial Moisture Content, %:	30.2	Plastic Limit:	21
Initial Dry Density, pcf:	90.7	Plasticity Index:	9
Initial Degree of Saturation:	93.4	% Passing #200 sieve:	18
Initial Void Ratio:	0.88	Soil Classification:	Clayey Sand
Measured Specific Gravity:	2.74	Group Symbol:	SC

Notes: Moisture content obtained before shear from sample trimmings
 Moisture Content determined by ASTM D 2216
 Specific Gravity determined by ASTM D 854
 Percent passing #200 sieve determined by ASTM D 422