

November 2, 2009

NRC 2009-0112
TS 5.6.4

U.S. Nuclear Regulatory Commission
ATTN: Document Control Desk
Washington DC 20555

Point Beach Nuclear Plant Unit 2
Docket No. 50-301
Renewed License No. DPR-27

Unit 2 Cycle 31 (U2C31) Core Operating Limits Report

In accordance with the requirements of Point Beach Nuclear Plant (PBNP) Technical Specification 5.6.4, "Core Operating Limits Report (COLR)," NextEra Energy Point Beach, LLC (NextEra) is submitting the Core Operating Limits Report for PBNP Unit 2 Cycle 31 (U2C31).

The enclosure to this letter contains the PBNP U2C31 COLR that was issued on October 31, 2009.

This letter contains no new regulatory commitments and no revisions to existing commitments.

Very truly yours,

NextEra Energy Point Beach, LLC

A handwritten signature in cursive script, appearing to read "James Costedio".

James Costedio
Licensing Manager

Enclosure

cc: Administrator, Region III, USNRC
Project Manager, Point Beach Nuclear Plant, USNRC
Resident Inspector, Point Beach Nuclear Plant, USNRC
PSCW

ENCLOSURE

**NEXTERA ENERGY POINT BEACH, LLC
POINT BEACH NUCLEAR PLANT, UNIT 2**

**CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31 (U2C31)**

TRM 2.1

CORE OPERATING LIMITS REPORT
(COLR)

UNIT 2 CYCLE 31

REVISION 11

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

1.0 CORE OPERATING LIMITS REPORT

This Core Operating Limits Report (COLR) for Point Beach Nuclear Plant has been prepared in accordance with the requirements of Technical Specification (TS) 5.6.4.

A cross-reference between the COLR sections and the PBNP Technical Specifications affected by this report is given below:

<u>COLR Section</u>	<u>PBNP TS</u>	<u>Description</u>
2.1	2.1.1	Reactor Core Safety Limits
2.2	3.1.1	Shutdown Margin
	3.1.4	Rod Group Alignment Limits
	3.1.5	Shutdown Bank Insertion Limits
	3.1.6	Control Bank Insertion Limits
	3.1.8	Physics Test Exceptions
2.3	3.1.3	Moderator Temperature Coefficient
2.4	3.1.5	Shutdown Bank Insertion Limit
2.5	3.1.6	Control Bank Insertion Limits
2.6	3.2.1	Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$)
2.7	3.2.2	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)
2.8	3.2.3	Axial Flux Difference (AFD)
2.9	3.3.1	Overtemperature ΔT Setpoint
2.10	3.3.1	Overpower ΔT Setpoint
2.11	3.4.1	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits
2.12	3.9.1	Refueling Boron Concentration
Figure 1	2.1.1	Reactor Core Safety Limits Curve
Figure 2	3.1.1	Required Shutdown Margin
Figure 3	3.1.6	Control Bank Insertion Limits
Figure 4	3.2.1	Hot Channel Factor Normalized Operating Envelope ($K(Z)$) for 422V+ Fuel
Figure 5	3.2.1	RAOC Summary of $W(Z)$ with HFP AFD Band of -8/+9% (Top 15% and Bottom 11% Excluded)
Figure 5A	3.2.1	BOC Part-Power RAOC Summary of $W(Z)$ with HFP AFD Band of -8/+9%
Figure 6	3.2.3	Flux Difference Operating Envelope

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

2.0 OPERATING LIMITS

The cycle-specific parameter limits for the specifications listed in Section 1.0 are presented in the following subsections. These limits have been developed using the NRC approved methodologies specified in Technical Specification 5.6.4.

2.1 Reactor Core Safety Limits (TS 2.1.1)

The combination of THERMAL POWER, Reactor Coolant System (RCS) highest loop average temperature, and pressurizer pressure shall not exceed the limits specified in Figure 1.

Applicability: MODES 1 and 2

2.2 Shutdown Margin (TS 3.1.1 and referenced in TS 3.1.4, 3.1.5, 3.1.6, and 3.1.8)

2.2.1 SDM shall be within the limits provided in Figure 2.

Applicability: MODES 1, 2, and 3

2.2.2 SDM shall be $\geq 1\% \Delta k/k$.

Applicability: MODES 4 and 5

2.3 Moderator Temperature Coefficient (TS 3.1.3)

2.3.1 The upper MTC limits shall be maintained within the limits.

2.3.2 The maximum upper MTC limits shall be:

$\leq 5 \text{ pcm}/^{\circ}\text{F}$ for power levels $\leq 70\%$ RTP

$\leq 0 \text{ pcm}/^{\circ}\text{F}$ for power levels $> 70\%$ RTP

Applicability: MODE 1 and MODE 2 with $k_{\text{eff}} \geq 1.0$.

2.4 Shutdown Bank Insertion Limit (TS 3.1.5)

NOTE: This limit is not applicable while performing SR 3.1.4.2.

2.4.1 Each shutdown bank shall be fully withdrawn.

2.4.2 Fully withdrawn is defined as ≥ 228 steps.

Applicability: MODES 1 and 2

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

2.5 Control Bank Insertion Limits (TS 3.1.6)

NOTE: This limit is not applicable while performing SR 3.1.4.2.

The control banks shall be within the insertion, sequence and overlap limits specified in Figure 3.

Applicability: MODE 1 and MODE 2 with $k_{eff} \geq 1.0$

2.6 Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$) (TS 3.2.1)

The Heat Flux Hot Channel Factor shall be within the following limits:

$$F_Q(Z) \leq CF_Q * K(Z) / P \text{ for } P > 0.5$$

$$F_Q(Z) \leq CF_Q * K(Z) / 0.5 \text{ for } P \leq 0.5$$

Where P is the fraction of Rated Power at which the core is operating.

$F_Q(Z)$ is both:

- Steady State $F_Q^C(Z) = F_Q(Z) * 1.08$
- Transient $F_Q^W(Z) = F_Q^C(Z) * W(Z) / P \text{ for } P > 0.5$
 $F_Q^W(Z) = F_Q^C(Z) * W(Z) / 0.5 \text{ for } P \leq 0.5$

$$CF_Q = 2.60 \text{ (422V+ Fuel)}$$

$K(Z)$ is the function in Figure 4

$W(Z)$ is the function in Figure 5

The following FQ penalty factors are applicable to Cycle 31.

Cycle Burnup (MWD/MTU)	$F_Q^W(Z)$ Penalty Factors
Beginning of Cycle to End-of-Cycle	1.0200

Linear interpolation is adequate for intermediate cycle burnups.

Applicability: MODE 1

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

2.7 Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$) (TS 3.2.2)

The Nuclear Enthalpy Rise Hot Channel Factor shall be within the following limit:

2.7.1 $F_{\Delta H}^N < 1.77 \times [1 + 0.3(1-P)]$ (422V+ Fuel)

where: P is the fraction of Rated Power at which the core is operating.

Applicability: MODE 1

2.8 Axial Flux Difference (AFD) (TS 3.2.3)

NOTE: The AFD shall be considered outside limits when two or more OPERABLE excore channels indicate AFD to be outside limits.

The indicated axial flux difference in % flux difference units shall be maintained within the allowed operational space defined by Figure 6.

Applicability: MODE 1 with THERMAL POWER $\geq 50\%$ RTP

2.9 Overtemperature ΔT Setpoint (TS 3.3.1, Table 3.3.1-1 note 1)

Overtemperature ΔT setpoint parameter values:

ΔT_o	=	indicated ΔT at Rated Power, °F
T	=	average temperature, °F
T'	≤	569.0°F
P'	=	2235 psig
K_1	≤	1.16
K_2	=	0.0149
K_3	=	0.00072
τ_1	=	25 sec
τ_2	=	3 sec
τ_3	=	2 sec for Rosemont or equivalent RTD = 0 sec for Sostman or equivalent RTD
τ_4	=	2 sec for Rosemont or equivalent RTD = 0 sec for Sostman or equivalent RTD

$f(\Delta I)$ is an even function of the indicated difference between top and bottom detectors of the power-range nuclear ion chambers; with gains to be selected based on measured instrument response during plant startup tests, where q_t and q_b are the percent power in the top and bottom halves of the core respectively, and $q_t + q_b$ is total core power in percent of Rated Power, such that:

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

- 2.9.1 For $q_t - q_b$ within -12, +5 percent, $f(\Delta I) = 0$.
- 2.9.2 For each percent that the magnitude of $q_t - q_b$ exceeds +5 percent, the ΔT trip setpoint shall be automatically reduced by an equivalent of 2.12 percent of Rated Power.
- 2.9.3 For each percent that the magnitude of $q_t - q_b$ exceeds -12 percent, the ΔT trip setpoint shall be automatically reduced by an equivalent of 2.0 percent of Rated Power.

Applicability: MODES 1 and 2

2.10 Overpower ΔT Setpoint (TS 3.3.1, Table 3.3.1-1 note 2)

Overpower ΔT setpoint parameter values:

ΔT_o	=	indicated ΔT at Rated Power, °F
T	=	average temperature, °F
T'	\leq	569.0°F
K_4	\leq	1.10 of Rated Power
K_5	=	0.0262 for increasing T
K_5	=	0.0 for decreasing T
K_6	=	0.00103 for $T \geq T'$
K_6	=	0.0 for $T < T'$
τ_5	=	10 sec
τ_3	=	2 sec for Rosemont or equivalent RTD
	=	0 sec for Sostman or equivalent RTD
τ_4	=	2 sec for Rosemont or equivalent RTD
	=	0 sec for Sostman or equivalent RTD

Applicability: MODES 1 and 2

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

2.11 RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits (TS 3.4.1)

2.11.1 T_{avg} shall be $\leq 574^{\circ}\text{F}$.

2.11.2 Pressurizer pressure shall be maintained ≥ 2205 psig during operation.

NOTE: Pressurizer pressure limit does not apply during:

- 1) **THERMAL POWER ramp $> 5\%$ RTP per minute; or**
- 2) **THERMAL POWER step $> 10\%$ RTP.**

2.11.3 Reactor Coolant System raw measured Total Flow Rate shall be maintained $\geq 182,400$ gpm.

Applicability: MODE 1


2.12 Refueling Boron Concentration (TS 3.9.1)

Boron concentrations of the Reactor Coolant System, the refueling canal, and the refueling cavity shall be maintained ≥ 2200 ppm.

Applicability: MODE 6


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 1
REACTOR CORE SAFETY LIMITS CURVE
(Cores containing 422V+ fuel)

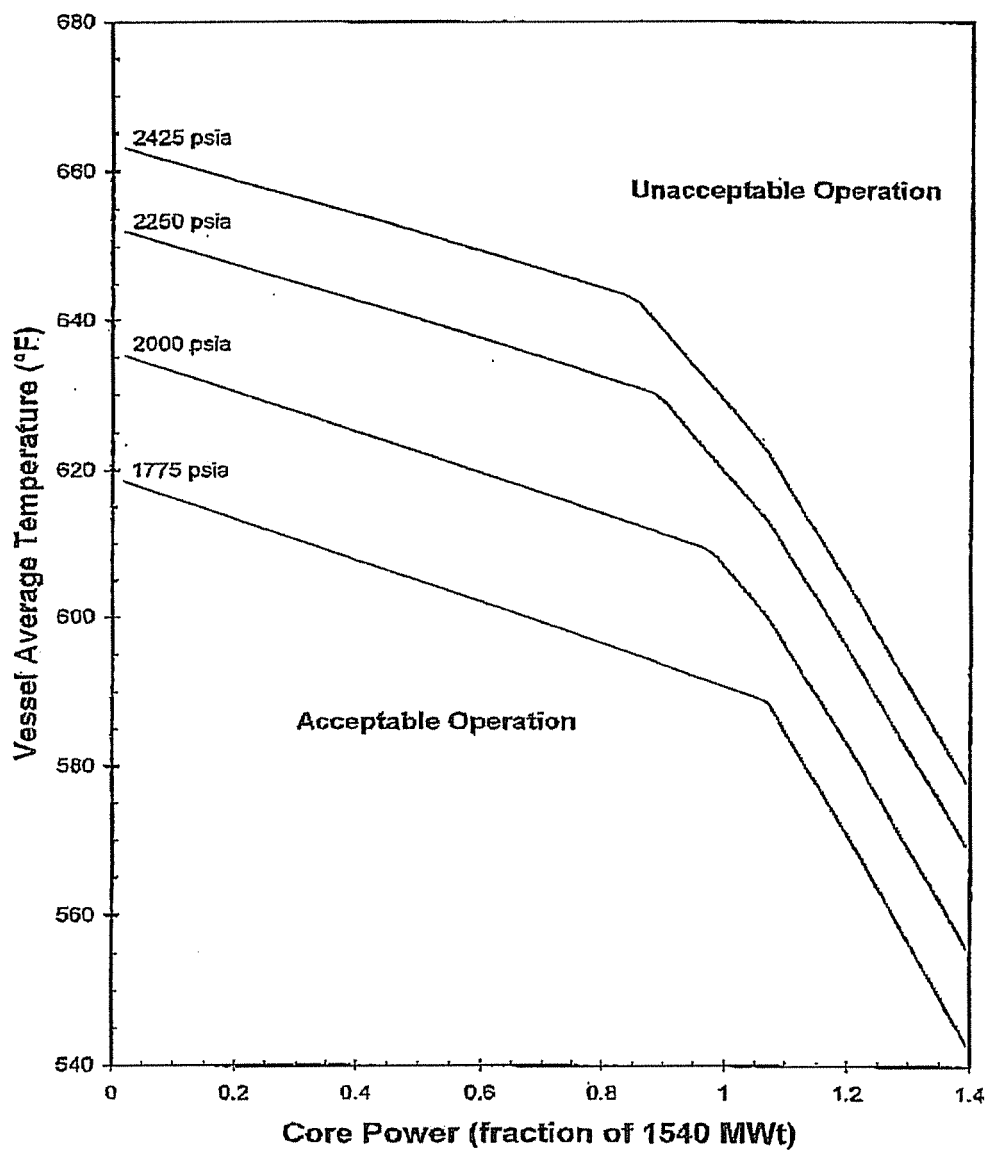


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 2
REQUIRED SHUTDOWN MARGIN

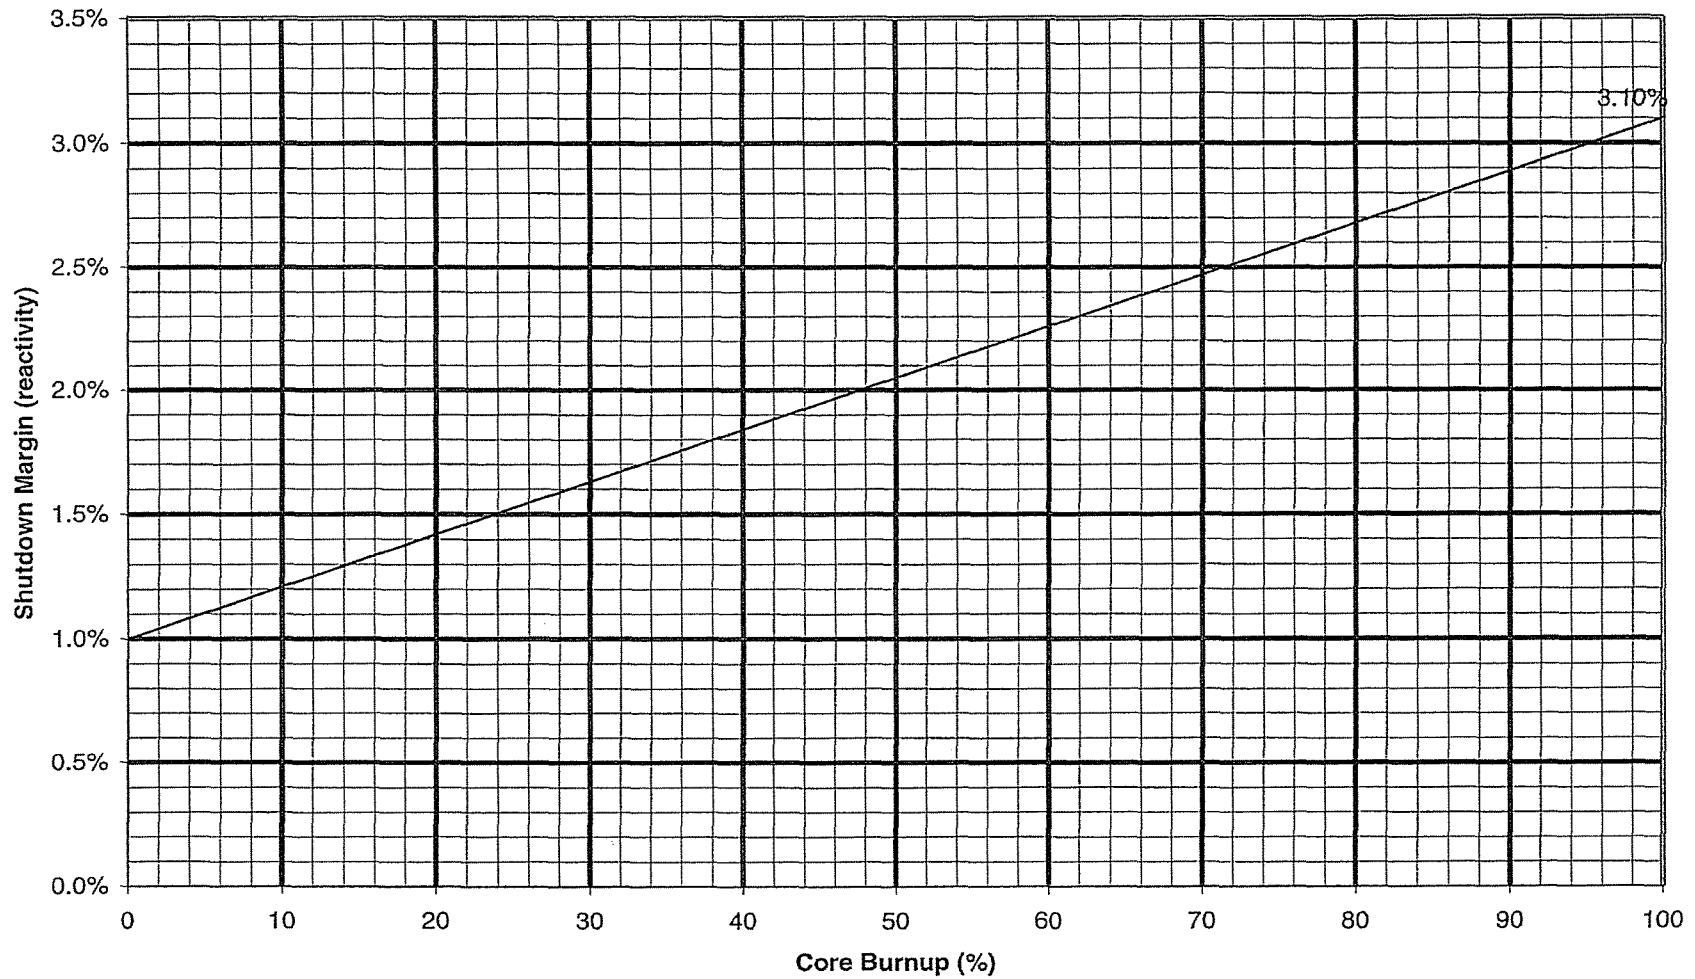

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31


FIGURE 3
CONTROL BANK INSERTION LIMITS

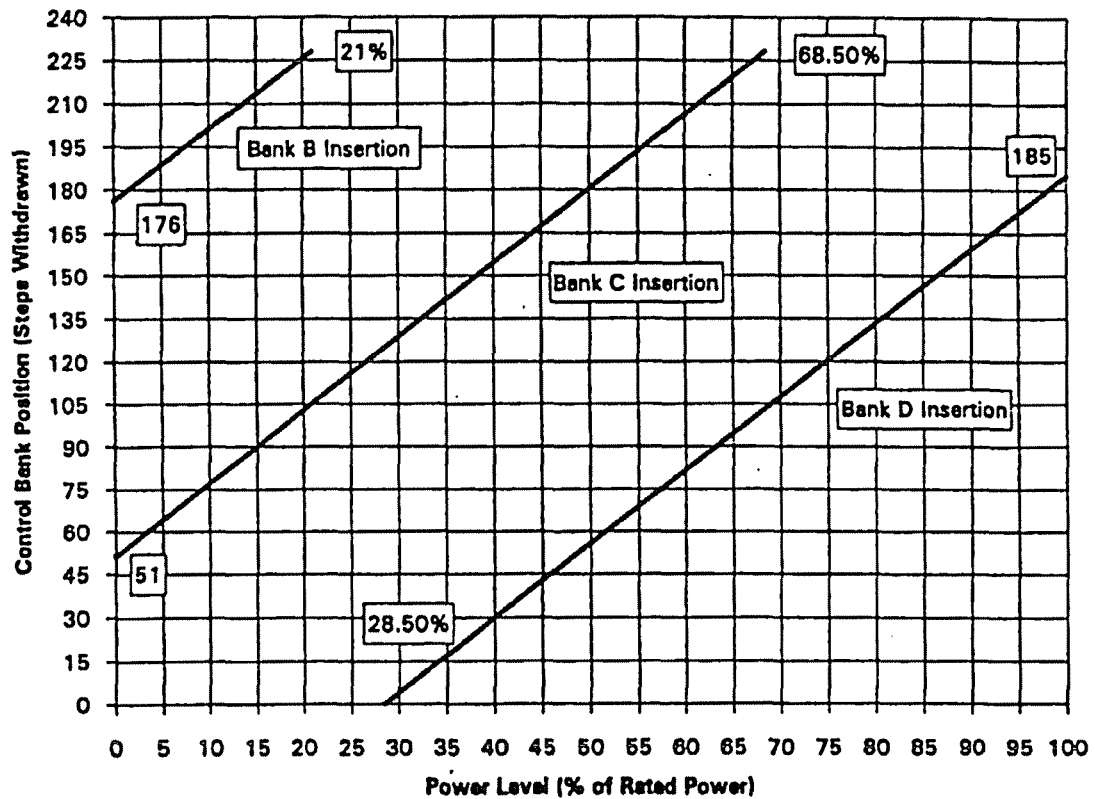

NOTE: The "fully withdrawn" parking position range ≥ 225 steps can be used without violating this Figure.

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 4
HOT CHANNEL FACTOR NORMALIZED OPERATING ENVELOPE (K(Z))
FOR 422V+ FUEL

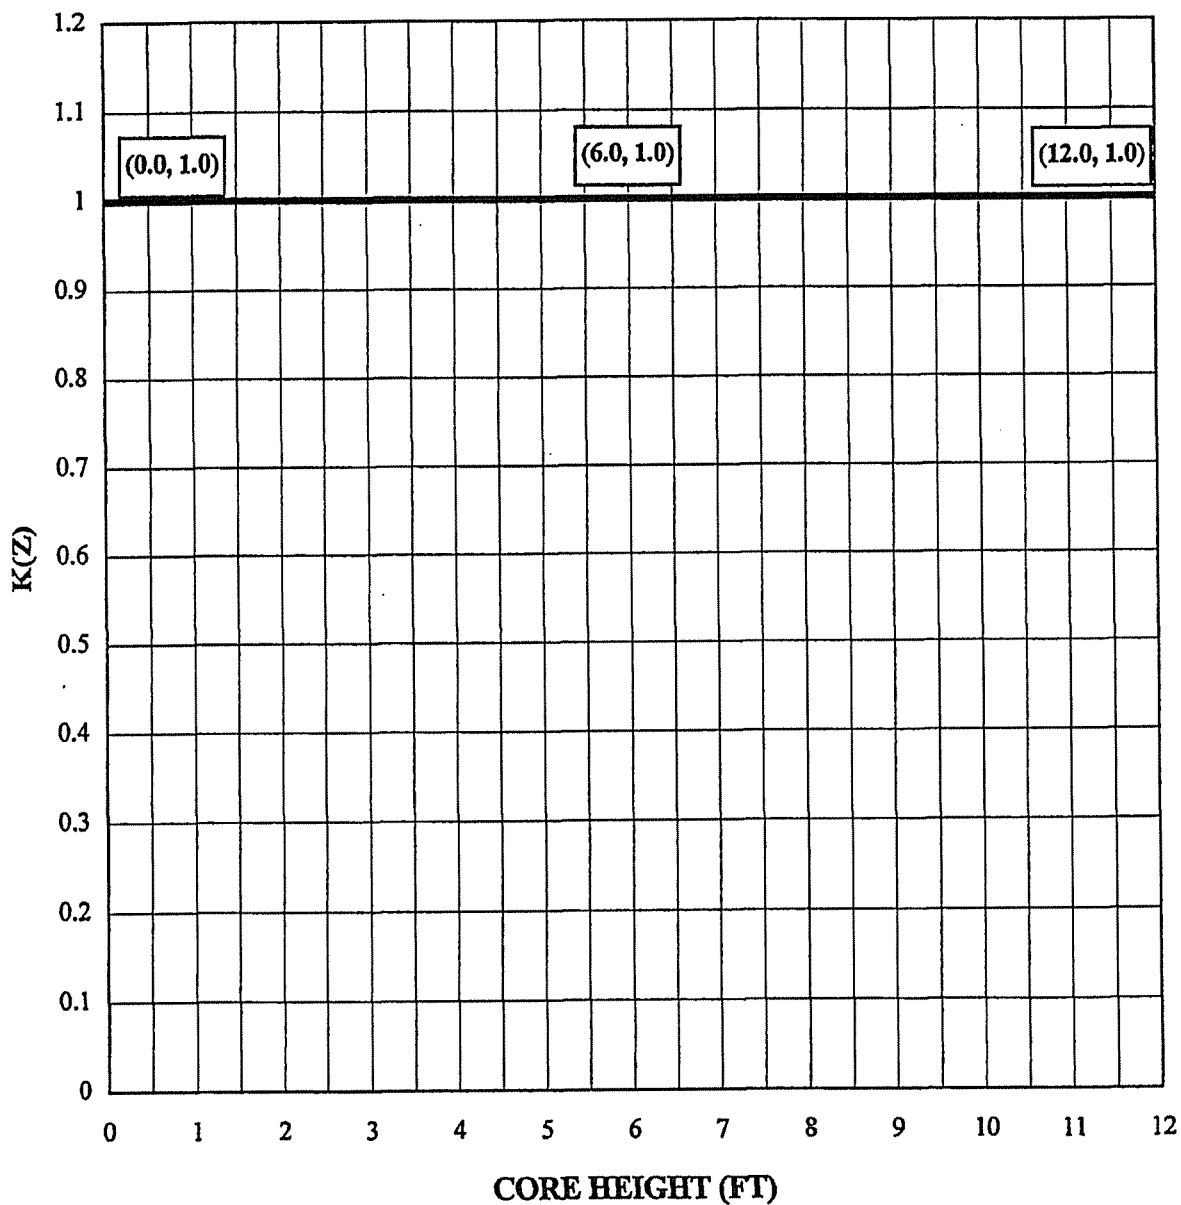

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 5
RAOC Summary of W(Z) with HFP AFD Band of -8/+9 %
(Top 15% and Bottom 11% Excluded)

Height (feet)	W(Z)			
	150 MWD/MTU	6000 MWD/MTU	8000 MWD/MTU	12000 MWD/MTU
0.0	1.0000	1.0000	1.0000	1.0000
0.2	1.0000	1.0000	1.0000	1.0000
0.4	1.0000	1.0000	1.0000	1.0000
0.6	1.0000	1.0000	1.0000	1.0000
0.8	1.0000	1.0000	1.0000	1.0000
1.0	1.0000	1.0000	1.0000	1.0000
1.2	1.0000	1.0000	1.0000	1.0000
1.4	1.2844	1.1881	1.1677	1.1636
1.6	1.2697	1.1762	1.1599	1.1562
1.8	1.2533	1.1629	1.1509	1.1477
2.0	1.2359	1.1489	1.1415	1.1388
2.2	1.2178	1.1346	1.1317	1.1298
2.4	1.1995	1.1202	1.1219	1.1209
2.6	1.1810	1.1060	1.1121	1.1118
2.8	1.1621	1.0934	1.1020	1.1023
3.0	1.1491	1.0833	1.0960	1.0980
3.2	1.1430	1.0806	1.0939	1.0973
3.4	1.1388	1.0815	1.0921	1.0965
3.6	1.1347	1.0829	1.0901	1.0954
3.8	1.1323	1.0842	1.0874	1.0966
4.0	1.1299	1.0855	1.0864	1.0999
4.2	1.1268	1.0862	1.0867	1.1036
4.4	1.1233	1.0873	1.0889	1.1063
4.6	1.1194	1.0900	1.0912	1.1086
4.8	1.1150	1.0925	1.0945	1.1117
5.0	1.1102	1.0946	1.0975	1.1149
5.2	1.1049	1.0962	1.1001	1.1179
5.4	1.0993	1.0975	1.1020	1.1199
5.6	1.0948	1.1000	1.1034	1.1211
5.8	1.0945	1.1049	1.1088	1.1283
6.0	1.1005	1.1102	1.1172	1.1403
6.2	1.1087	1.1167	1.1263	1.1530
6.4	1.1155	1.1282	1.1344	1.1643
6.6	1.1218	1.1404	1.1419	1.1748
6.8	1.1278	1.1517	1.1483	1.1840

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 5 (con't)
RAOC Summary of W(Z) with HFP AFD Band of -8/+9 %
(Top 15% and Bottom 11% Excluded)

Height (feet)	W(Z)			
	150 MWD/MTU	6000 MWD/MTU	8000 MWD/MTU	12000 MWD/MTU
7.0	1.1343	1.1618	1.1536	1.1919
7.2	1.1407	1.1709	1.1586	1.1993
7.4	1.1458	1.1787	1.1635	1.2062
7.6	1.1498	1.1852	1.1671	1.2115
7.8	1.1527	1.1902	1.1693	1.2151
8.0	1.1542	1.1938	1.1701	1.2170
8.2	1.1544	1.1958	1.1694	1.2170
8.4	1.1531	1.1960	1.1672	1.2150
8.6	1.1504	1.1946	1.1635	1.2110
8.8	1.1454	1.1905	1.1615	1.2055
9.0	1.1433	1.1892	1.1652	1.1964
9.2	1.1461	1.1925	1.1796	1.1907
9.4	1.1594	1.2056	1.1948	1.1936
9.6	1.1708	1.2168	1.2099	1.2043
9.8	1.1835	1.2293	1.2246	1.2135
10.0	1.1973	1.2410	1.2387	1.2273
10.2	1.2095	1.2514	1.2520	1.2478
10.4	1.0000	1.0000	1.0000	1.0000
10.6	1.0000	1.0000	1.0000	1.0000
10.8	1.0000	1.0000	1.0000	1.0000
11.0	1.0000	1.0000	1.0000	1.0000
11.2	1.0000	1.0000	1.0000	1.0000
11.4	1.0000	1.0000	1.0000	1.0000
11.6	1.0000	1.0000	1.0000	1.0000
11.8	1.0000	1.0000	1.0000	1.0000
12.0	1.0000	1.0000	1.0000	1.0000

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 5A
BOC Part-Power RAOC summary of W(Z) with HFP AFD Band of -8/+9%
(Top 15% and Bottom 11% Excluded)

Height (feet)	Power W(Z) with Correction Factor (excluding power ratio)							
	Hot Full Power	30% Power	40% Power	50% Power	60% Power	70% Power	75% Power	80% Power
0.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
0.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
1.4	1.2844	1.6098	1.5451	1.4942	1.4484	1.4034	1.3794	1.3551
1.6	1.2697	1.5849	1.5231	1.4729	1.4281	1.3843	1.3611	1.3375
1.8	1.2533	1.5612	1.5007	1.4496	1.4044	1.3613	1.3393	1.3167
2.0	1.2359	1.5306	1.4735	1.4232	1.3789	1.3371	1.3166	1.2952
2.2	1.2178	1.4946	1.4444	1.3959	1.3532	1.3132	1.2939	1.2737
2.4	1.1995	1.4535	1.4103	1.3653	1.3255	1.2879	1.2701	1.2514
2.6	1.1810	1.4076	1.3702	1.3306	1.2948	1.2609	1.2450	1.2280
2.8	1.1621	1.3502	1.3174	1.2869	1.2577	1.2295	1.2167	1.2020
3.0	1.1491	1.3089	1.2801	1.2554	1.2311	1.2069	1.1960	1.1831
3.2	1.1430	1.2846	1.2594	1.2377	1.2161	1.1945	1.1839	1.1724
3.4	1.1388	1.2648	1.2428	1.2236	1.2043	1.1849	1.1751	1.1648
3.6	1.1347	1.2458	1.2269	1.2100	1.1929	1.1756	1.1668	1.1575
3.8	1.1323	1.2288	1.2128	1.1985	1.1835	1.1680	1.1601	1.1516
4.0	1.1299	1.2121	1.1989	1.1870	1.1741	1.1604	1.1533	1.1457
4.2	1.1268	1.1951	1.1842	1.1746	1.1639	1.1520	1.1458	1.1391
4.4	1.1233	1.1776	1.1695	1.1616	1.1531	1.1433	1.1380	1.1324
4.6	1.1194	1.1601	1.1546	1.1487	1.1419	1.1343	1.1297	1.1251
4.8	1.1150	1.1419	1.1389	1.1353	1.1302	1.1244	1.1210	1.1173
5.0	1.1102	1.1238	1.1232	1.1216	1.1183	1.1140	1.1119	1.1091
5.2	1.1049	1.1057	1.1073	1.1077	1.1059	1.1035	1.1022	1.1004
5.4	1.0993	1.0880	1.0918	1.0938	1.0937	1.0930	1.0924	1.0914
5.6	1.0948	1.0718	1.0774	1.0812	1.0828	1.0838	1.0837	1.0837
5.8	1.0945	1.0599	1.0673	1.0727	1.0759	1.0786	1.0793	1.0802
6.0	1.1005	1.0541	1.0633	1.0703	1.0752	1.0796	1.0809	1.0829
6.2	1.1087	1.0502	1.0613	1.0699	1.0765	1.0826	1.0848	1.0876
6.4	1.1155	1.0448	1.0578	1.0680	1.0762	1.0839	1.0875	1.0908
6.6	1.1218	1.0396	1.0543	1.0660	1.0758	1.0852	1.0898	1.0940
6.8	1.1278	1.0343	1.0506	1.0638	1.0752	1.0863	1.0918	1.0969


CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 5A (con't)
BOC Part-Power RAOC summary of W(Z) with HFP AFD Band of -8/+9%
(Top 15% and Bottom 11% Excluded)

Height (feet)	Power W(Z) with Correction Factor (excluding power ratio)							
	Hot Full Power	30% Power	40% Power	50% Power	60% Power	70% Power	75% Power	80% Power
7.0	1.1343	1.0295	1.0475	1.0622	1.0751	1.0879	1.0940	1.1000
7.2	1.1407	1.0248	1.0443	1.0605	1.0750	1.0895	1.0962	1.1031
7.4	1.1458	1.0192	1.0401	1.0577	1.0738	1.0896	1.0974	1.1051
7.6	1.1498	1.0128	1.0350	1.0540	1.0716	1.0888	1.0976	1.1062
7.8	1.1527	1.0058	1.0292	1.0495	1.0685	1.0871	1.0969	1.1063
8.0	1.1542	0.9977	1.0221	1.0436	1.0639	1.0842	1.0946	1.1049
8.2	1.1544	0.9889	1.0142	1.0369	1.0585	1.0803	1.0913	1.1025
8.4	1.1531	0.9792	1.0055	1.0291	1.0519	1.0751	1.0868	1.0989
8.6	1.1504	0.9686	0.9959	1.0205	1.0446	1.0688	1.0815	1.0944
8.8	1.1454	0.9567	0.9848	1.0102	1.0354	1.0607	1.0741	1.0879
9.0	1.1433	0.9480	0.9767	1.0028	1.0289	1.0557	1.0698	1.0842
9.2	1.1461	0.9439	0.9732	1.0000	1.0271	1.0554	1.0703	1.0855
9.4	1.1594	0.9490	0.9790	1.0068	1.0352	1.0651	1.0808	1.0969
9.6	1.1708	0.9524	0.9832	1.0120	1.0420	1.0731	1.0896	1.1066
9.8	1.1835	0.9576	0.9891	1.0188	1.0503	1.0827	1.0999	1.1181
10.0	1.1973	0.9644	0.9965	1.0273	1.0600	1.0939	1.1120	1.1312
10.2	1.2095	0.9707	1.0032	1.0350	1.0686	1.1041	1.1231	1.1433
10.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
10.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
10.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.2	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.4	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.6	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
11.8	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000
12.0	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000	1.0000

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

FIGURE 6
FLUX DIFFERENCE OPERATING ENVELOPE

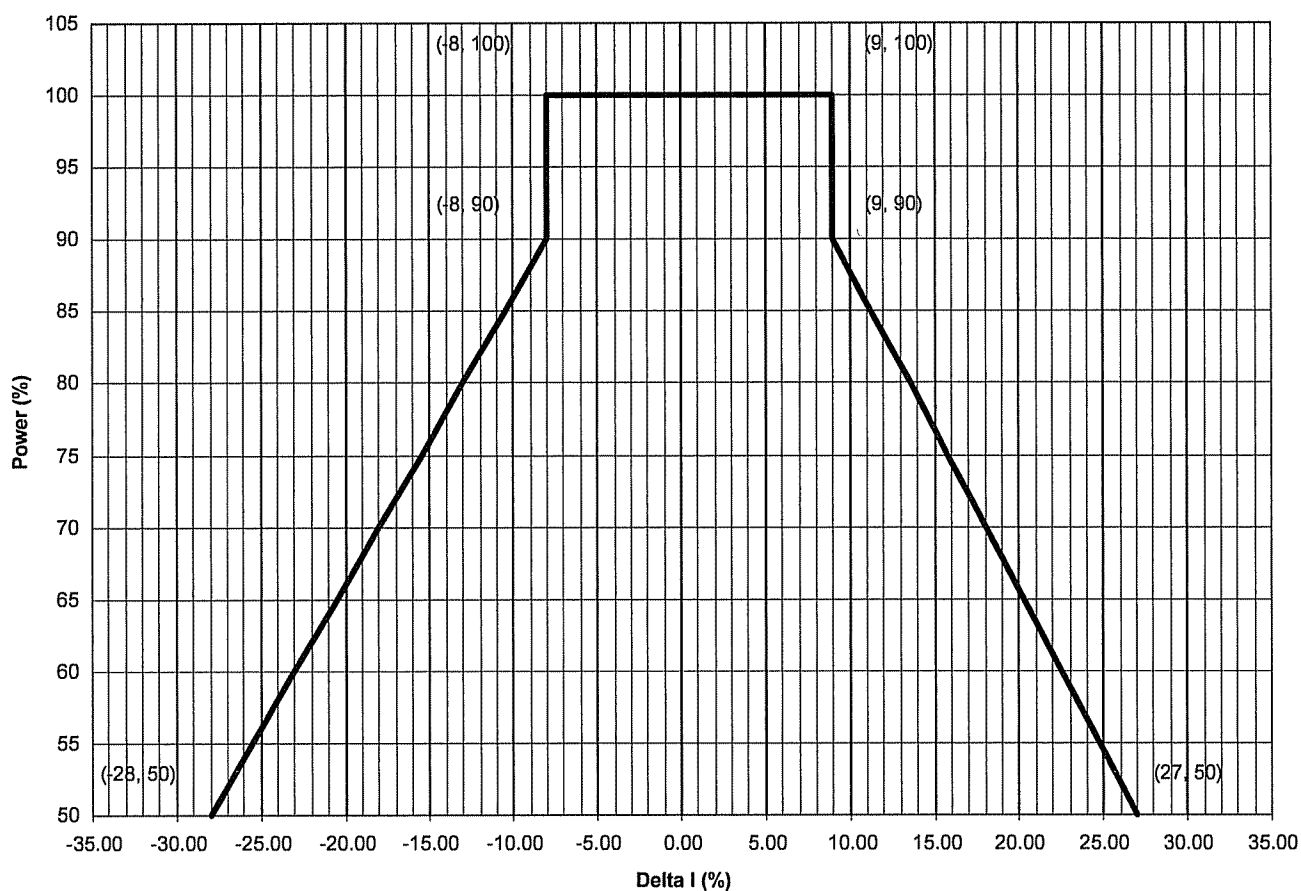

NOTE: This figure represents the Relaxed Axial Offset Control (RAOC) band used in safety analyses, it may be administratively tightened depending on in-core flux map results. Refer to Figure 2 of ROD 1.2 for the administrative limit.

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

TABLE 1
NRC APPROVED METHODOLOGIES FOR COLR PARAMETERS

COLR Section	Parameter	NRC Approved Methodology
2.1	Reactor Core Safety Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.2	Shutdown Margin	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.3	Moderator Temperature Coefficient	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.4	Shutdown Bank Insertion Limit	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.5	Control Bank Insertion Limits	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.6	Nuclear Heat Flux Hot Channel Factor ($F_Q(Z)$)	<p>WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset Control," February 1994</p> <p>WCAP-14449-P-A, "Application of Best Estimate Large Break LOCA Methodology to Westinghouse PWRs with Upper Plenum Injection," Revision 1, October 1999 (cores containing 422V + fuel)</p> <p>WCAP-10924-P-A, "Large Break LOCA Best Estimate Methodology, Volume 2: Application to Two-Loop PWRs Equipped with Upper Plenum Injection," and Addenda, December 1988 (cores not containing 422V + fuel)</p> <p>WCAP-10924-P-A, "LBLOCA Best Estimate Methodology: Model Description and Validation: Model Revisions," Volume 1, Addendum 4, August 1990 (cores not containing 422V + fuel)</p> <p>WCAP-10054-P-A, "Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code," August 1985</p> <p>WCAP-10054-P-A, "Addendum to the Westinghouse Small Break ECCS Evaluation Model Using the NOTRUMP Code: Safety Injection into the Broken Loop and COSI Condensation Model," Addendum 2, Revision 1, July 1997</p>

CORE OPERATING LIMITS REPORT (COLR)
UNIT 2 CYCLE 31

TABLE 1
NRC APPROVED METHODOLOGIES FOR COLR PARAMETERS

COLR Section	Parameter	NRC Approved Methodology
2.7	Nuclear Enthalpy Rise Hot Channel Factor ($F_{\Delta H}^N$)	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985
2.8	Axial Flux Difference (AFD)	WCAP-10216-P-A, Revision 1A, "Relaxation of Constant Axial Offset Control," February 1994
2.9	Overtemperature ΔT Setpoint	WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986
2.10	Overpower ΔT Setpoint	WCAP-8745-P-A, "Design Bases for the Thermal Overpower ΔT and Thermal Overtemperature ΔT Trip Functions," September 1986
2.11	RCS Pressure, Temperature, and Flow Departure from Nucleate Boiling (DNB) Limits	<p>WCAP-11397-P-A, "Revised Thermal Design Procedure," April 1989, for those events analyzed using RTDP</p> <p>WCAP-14787-P, Rev. 2, "Westinghouse Revised Thermal Design Procedure Instrument Uncertainty Methodology for Wisconsin Electric Power Company Point Beach Units 1 & 2 (Fuel Upgrade & Uprate to 1656 MWt-NSSS Power with Feedwater Venturis, or 1679 MWt-NSSS Power with LEFM on Feedwater Header)", October 2002.</p> <p>WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985 for those events not utilizing RTDP</p>
2.12	Refueling Boron Concentration	WCAP-9272-P-A, "Westinghouse Reload Safety Evaluation Methodology," July 1985