




REACTOR BUILDINGS

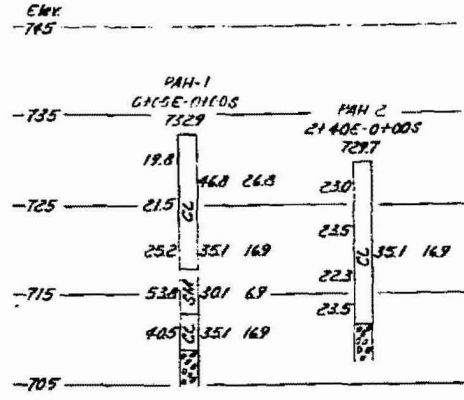


PLANT BUILDINGS

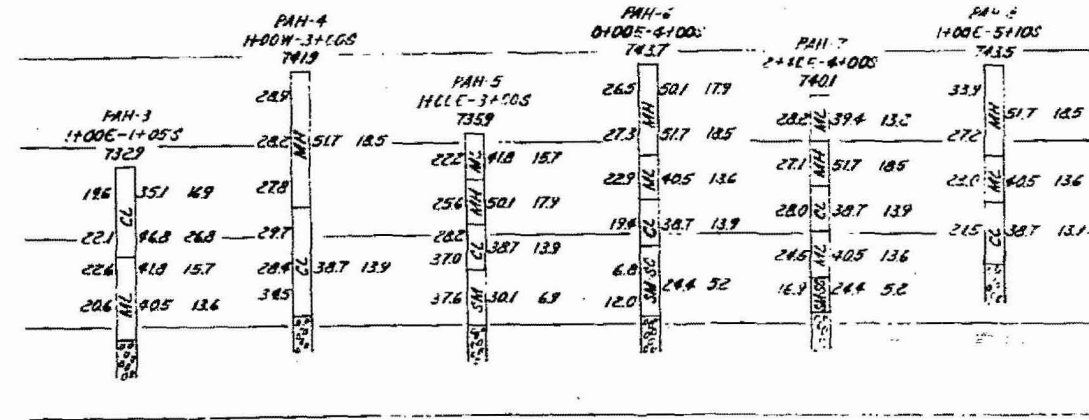


TRANSFORMER YARD & 500 KV SWITCHYARD

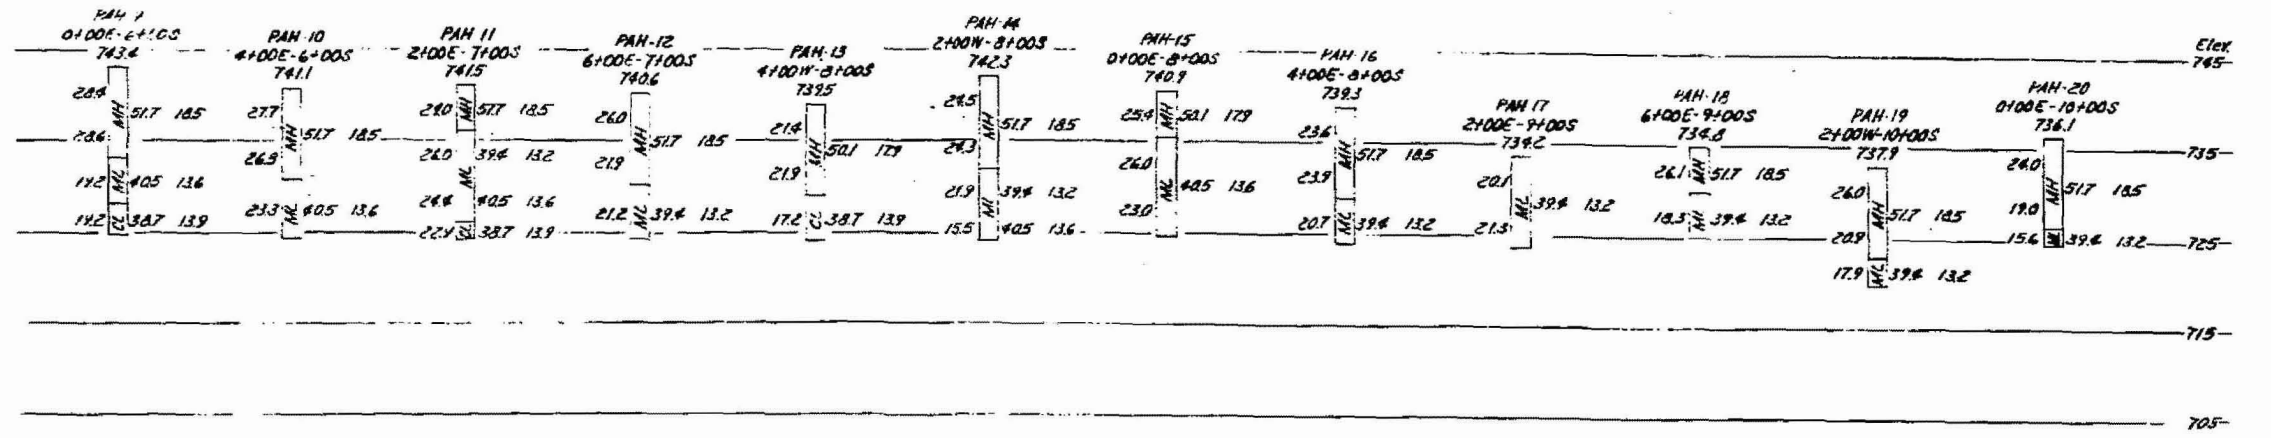

COOLING TOWERS

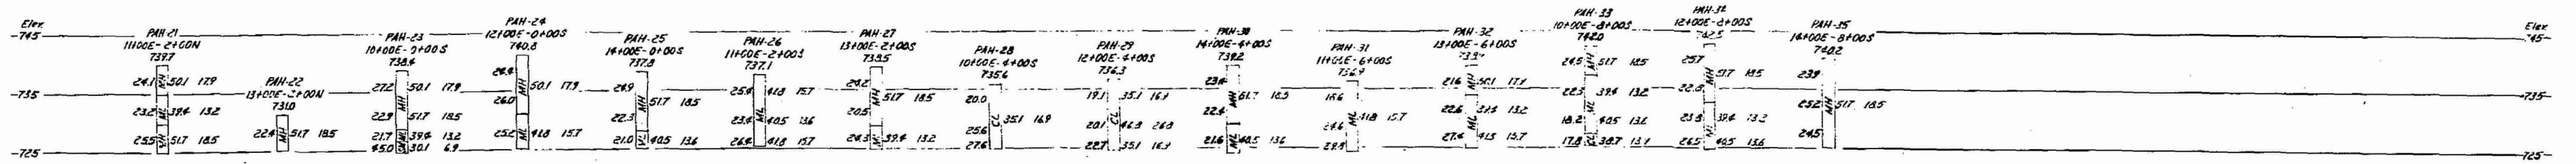

INTAKE CHANNEL

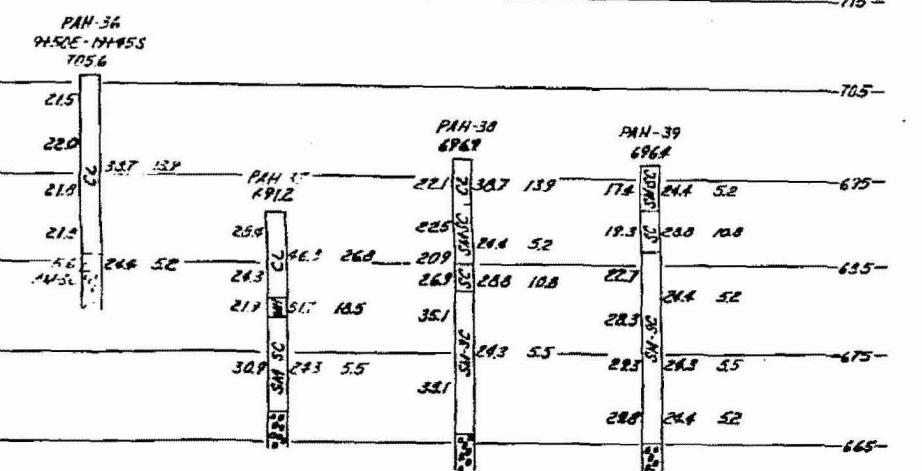

SYMBOLS
 Ground

LEGEND

- Station Name
- Location
- City
- Liquid Unit
- Plasticity Index

WATTS BAR NUCLEAR PLANT
 FINAL SAFETY
 ANALYSIS REPORT
 BORROW INVESTIGATION
 Figure 2.5-222