



ENERCON SERVICES, INC.

CALCULATION COVER SHEET

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 1 of 29

Title: Estimated Annual Dose Due to Normal Liquid Effluents

Client: Luminant

Project: MITS003

Item	Cover Sheet Items	Yes	No
1	Does this calculation contain any open assumptions that require confirmation? If YES, identify the assumptions. Assumptions _____	<input type="checkbox"/>	<input checked="" type="checkbox"/>
2	Does this calculation serve as an "Alternate Calculation"? If YES, identify the design verified calculation. Design Verified Calculation No. _____	<input type="checkbox"/>	<input checked="" type="checkbox"/>
3	Does this calculation supersede an existing calculation? If YES, identify the superseded calculation. Superseded Calculation No. _____	<input type="checkbox"/>	<input checked="" type="checkbox"/>

Scope of Revision:

Initial Issue

Revision Impact on Results:

N/A

Study Calculation	<input type="checkbox"/>	Final Calculation	<input checked="" type="checkbox"/>
Safety-Related	<input type="checkbox"/>	Non-Safety Related	<input checked="" type="checkbox"/>
(Print Name and Sign)			
Originator: Joanne G. Morris	<i>Joanne G. Morris</i>	Date:	5/20/08
Design Verifier: Jared Monroe	<i>Jared Monroe</i>	Date:	5/20/08
Approver: Marvin Morris	<i>Marvin Morris</i>	Date:	5/20/08



ENERCON SERVICES, INC.

CALCULATION
REVISION STATUS SHEETCALC. NO.
TXUT-001-ER-5.4-CALC-010
REV. 0
PAGE NO. 2 of 29CALCULATION REVISION STATUS

<u>REVISION</u>	<u>DATE</u>	<u>DESCRIPTION</u>
0	5/20/08	Initial Issue

PAGE REVISION STATUS

<u>PAGE NO.</u>	<u>REVISION</u>	<u>PAGE NO.</u>	<u>REVISION</u>
1 - 29	0		

APPENDIX REVISION STATUS

<u>APPENDIX NO.</u>	<u>PAGE NO.</u>	<u>REVISION NO.</u>	<u>APPENDIX NO.</u>	<u>PAGE NO.</u>	<u>REVISION NO.</u>
Appendix 1	All Pages	0	Appendix 9	All Pages	0
Appendix 2	All Pages	0	Appendix 10	All Pages	0
Appendix 3	All Pages	0	Appendix 11	All Pages	0
Appendix 4	All Pages	0	Appendix 12	All Pages	0
Appendix 5	All Pages	0	Appendix 13	All Pages	0
Appendix 6	All Pages	0			
Appendix 7	All Pages	0			
Appendix 8	All Pages	0			



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 3 of 29

TABLE OF CONTENTS

1.0	Purpose and Background.....	4
2.0	Summary of Results and Conclusions	5
3.0	References.....	8
4.0	Assumptions.....	10
5.0	Design Inputs	11
5.1	Regulatory Dose Limits.....	11
5.2	LADTAP II Inputs.....	11
5.2.1	Site Characteristics	11
5.2.2	Site Population Data	13
5.2.3	Radionuclide Release Information	14
5.2.4	Impoundment Reconcentration Model Data	16
5.2.5	ALAR Analysis Usage Location Data	17
5.2.6	Population Dose Usage Location Data.....	19
5.2.7	Biota	27
5.2.8	Block Data.....	27
6.0	Methodology.....	28
7.0	Calculations.....	29

Appendices

No. of Pages

1.	Case 1 - CPNPP Unit 3 or 4 Appendix I LADTAP II Output File	14
2.	Case 2 - CPNPP Unit 3 or 4 Population Dose LADTAP II Output File	14
3.	Email from Darren Lovvorn, Enercon, to Joanne Morris, Enercon, Subject: Information Request (Reference to eroom files including WATER USER TABLES.xls).....	3
4.	Email from Melissa Gayley, Enercon, to MAMorris et al., Subject: Population for Calculation, Attachments: PopulationResults.xls, PopSectorMiles (0 – 10 mi).jpg, PopSectorMiles (10 – 50 mi).jpg	5
5.	Record of Phone Conference between Darren Lavvorn, Enercon and Brad Brunette, Brazos River Authority, Lake Whitney Municipile Surface Water Contracts	1
6.	Email from John Tibbs, Texas Parks and Wildlife Department, to Audrey Thompson, Enercon, Subject: RE: Recreation and Fisheries Data Needed for Local Rivers	3
7.	Texas Parks and Wildlife, Historical Fish Kill Events Involving the Golden Alga, <i>Prymnesium parvum</i> , in Texas	5
8.	U. S. Census Bureau, American Fact Finder, Population Finder.....	2
9.	Volumetric Survey of Lake Whitney	35
10.	Email from Sei Kudo, Mitsubishi Heavy Industries, Ltd., to Marvin Morris, et al., Enercon, Subject: Final Confirmation of Parameters.....	1
11.	Statistics from the Census of Agriculture (5-year Cycle), Texas: Bosque County, Hill County, Johnson County, McClellan County and Somervell County	10
12.	USGS Elevation Data for Squaw Creek Reservoir.....	26
13.	Volumetric Survey of Squaw Creek Reservoir	35

 ENERCON SERVICES, INC.	Estimated Annual Dose Due to Normal Liquid Effluents	CALC. NO. TXUT-001-ER-5.4-CALC-010 REV. 0 PAGE NO. 4 of 29
--	---	--

1.0 Purpose and Background

The purpose of this calculation is to determine the offsite doses that would result from normal releases through the liquid pathway for a US-APWR located on the Comanche Peak Nuclear Power Plant (CPNPP) site. The results of this calculation will be used to support the Combined Operating License (COL) application for CPNPP Units 3 and 4. As such, the guidance of NUREG 1555, "Standard Review Plans for Environmental Reviews for Nuclear Power Plants" [Reference 3.3] and Regulatory Guide 1.206, "Combined License Applications For Nuclear Power Plants (LWR Edition)" [Reference 3.7] will be applied.

As required by NUREG 1555, Section 5.4, "Radiological Impacts of Normal Operation" and Regulatory Guide 1.206, Section C.I.12.3, "Dose Assessment", this calculation will provide the bases, models, and assumptions for the estimated annual whole body dose and maximum organ dose to a member of the public from normal liquid effluent. Acceptance criteria for analyzing the radiological impacts of normal operations are based on the relevant requirements of 10 CFR 50, Appendix I, "Numerical Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion 'As Low As Is Reasonably Achievable' for Radioactive Material in Light-Water-Cooled Nuclear Power Reactor Effluents" [Reference 3.5] and 10 CFR 20.1301(d), "Radiation Dose Limits for Individual Members of the Public" [Reference 3.8]. NUREG-0543, "Methods for Demonstrating LWR Compliance with the EPA Uranium Fuel Cycle Standard (40 CFR Part 190)" [Reference 3.9] provides guidance for meeting the 10 CFR 20.1301(d) requirement for compliance with 40 CFR Part 190, "Environmental Radiation Protection Standards for Nuclear Power Operations" [Reference 3.6]. The acceptance criteria of these regulations that are relevant to doses resulting from liquid effluents released during normal operations are given in Section 5.1 of this calculation.

This calculation is performed using the LADTAP II computer program [References 3.1 and 3.2], which is also used by the U.S. Nuclear Regulatory Commission for this type of evaluation. The computer program, LADTAP II, "A Computer Program for Calculating Radiation Exposure to Man From Routine Release of Nuclear Reactor Liquid Effluents," implements the guidance provided in Regulatory Guide 1.109, "Calculation of Annual Does to Man From Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I" [Reference 3.4] and Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents From Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I" [Reference 3.10]. Refer to Reference 3.2 for the Computer Program Documentation Package for the LADTAP II program.



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 5 of 29

2.0 Summary of Results and Conclusions

The offsite doses that would result from normal liquid effluents from a US-APWR located on the Comanche Peak site are summarized below. As noted in Section 7, Case 1, which considers the minimum discharge from Squaw Creek Reservoir to Squaw Creek, produces the most limiting individual doses. Case 1 results are compared with regulatory limits for the maximally exposed individual. Case 2 considers the proposed increased discharge from Squaw Creek Reservoir to Squaw Creek when four units are operational. Since the increased releases and lower dilution result in higher downstream population doses, Case 2 results are reported for population doses.

Table 2-1
10 CFR 50 Appendix I Comparison
Estimated Maximum Individual Dose from Liquid Effluents (mrem/yr, per unit)

Dose	Appendix I Objective	CPNPP Unit 3 or 4 Assessment
Total Body		
Shoreline Use		1.30E-03
Water Ingestion		6.39E-03
Fish Ingestion		8.83E-01
Irrigated Foods		8.91E-03
Total	3	9.00E-01^a
Maximum Organ		
Shoreline Use		7.25E-03
Water Ingestion		4.51E-03
Fish Ingestion		1.26E+00
Irrigated Foods		1.04E-02
Total	10	1.28E+00^b

- a. an adult receives the maximum individual total body dose
- b. a teenager receives the maximum individual organ dose which is to the liver

Table 2-2
10 CFR 20.1301 Comparison
Estimated Maximum Individual Dose from Liquid Effluents (mrem/yr, per unit)

Dose	10 CFR 20.1301 Objective	CPNPP Unit 3 or 4 Assessment
Total Body	-	9.00E-01 ^a
Thyroid Dose	-	1.52E-01
TEDE	100	9.05E-01 ^b
Dose in any hour (mrem/hr)	2	1.03E-04

- a. an adult receives the maximum individual total body dose
- b. the total effective dose equivalent (TEDE) is approximated by the sum of the whole body dose and 3% of the thyroid dose [Reference 3.16]



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 6 of 29

**Table 2-3
Dose Equivalent from Liquid Effluents
to Any Member of the Public (mrem/yr, per site)**

Dose	40 CFR 190 Requirements	CPNPP Assessment of all Units
Whole Body Dose Equivalent	25	7.79E+00
Thyroid Dose	75	9.17E+00 ^c
Dose to Another Organ	25	1.14E+01

- a. an adult receives the maximum individual total body dose
- b. a teenager receives the maximum individual organ dose which is to the liver
- c. Note that the collective thyroid dose includes the maximum organ dose due to gaseous effluents from Units 1 & 2. This value bounds the thyroid dose.

**Table 2-4
Estimated Population Dose from Liquid Effluents (person-rem/yr, per unit)**

Dose	CPNPP Unit 3 or 4 Assessment
Total Body	2.14E+00
GI-LLI (Max. organ)	2.23E+00
Thyroid	2.04E+00

**Table 2-5
CPNPP Units 3 and 4
Doses to Primary and Secondary Organisms (Biota) (mRad/yr)**

Organism	Internal Dose	External Dose	Total Dose	Dose Limit ^a (per site)
Fish	9.10E+00	9.48E+00	1.86E+01	Total Body: 25 Thyroid: 75 Another organ:25
Invertebrate	1.29E+01	1.90E+01	3.18E+01	
Algae	4.08E+01	7.82E-03	4.08E+01	
Muskrat	6.10E+01	6.32E+00	6.73E+01	
Raccoon	1.56E+01	4.74E+00	2.03E+01	
Heron	1.97E+02	6.32E+00	2.04E+02	
Duck	5.84E+01	9.48E+00	6.79E+01	

a. 40 CFR 190 [Reference 3.6]



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 7 of 29

Table 2-6
CPNPP All Units
Doses to Primary and Secondary Organisms (Biota) (mRad/yr)

Organism	Total Dose ^a	Dose Limit ^b (per site)
Fish	1.33E+02	
Invertebrate	3.18E+01 ^c	
Algae	4.08E+01 ^c	Total Body: 25
Muskrat	7.32E+01	Thyroid: 75
Raccoon	2.62E+01	Another organ:25
Heron	2.10E+02	
Duck	7.37E+01	

- a. Units 1 and 2 biota doses obtained from Reference 3.33, Section 5.2. Note that Units 1 and 2 doses include contributions from both liquid and gaseous pathways.
- b. 40 CFR 190 [Reference 3.6]
- c. Units 1 & 2 dose contributions unavailable

Table 2-7
10 CFR 50 Appendix I Comparison
Additional Use Location, Squaw Creek Reservoir (mrem/yr, per unit)

Dose ^a	Appendix I Objective	CPNPP Unit 3 or 4 Assessment
Total Body	3	8.85E-01 ^b
Maximum Organ	10	1.27E+00 ^c

- a. The uses of Squaw Creek Reservoir is limited to shoreline recreation and fishing. No drinking water pathway is included.
- b. an adult receives the maximum individual total body dose
- c. a teenager receives the maximum individual organ dose which is to the liver



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 8 of 29

3.0 References

- 3.1 LADTAP II - Technical Reference and User Guide, NUREG/CR-4013, PNL-5270, April 1986.
- 3.2 ENERCON Computer Program Certification, LADTAP II - A Computer Program for Calculating Radiation Exposure to Man from Routine Release of Nuclear Reactor Liquid Effluents, September 2002 release, 1/20/2003.
- 3.3 U.S. Nuclear Regulatory Commission, NUREG-1555, Standard Review Plans for Environmental Reviews for Nuclear Power Plants, October 1999.
- 3.4 U.S. Nuclear Regulatory Commission, Regulatory Guide 1.109, Calculation of Annual Does to Man From Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50, Appendix I, Revision 1, October 1977.
- 3.5 U.S. Nuclear Regulatory Commission, 10 CFR 50 Appendix I, Numerical Guides for Design Objectives and Limiting Conditions for Operation to Meet the Criterion 'As Low As Is Reasonably Achievable' for Radioactive Material in Light-Water-Cooled Nuclear Power Reactor Effluents.
- 3.6 U.S. Nuclear Regulatory Commission, 40 CFR 190, Environmental Radiation Protection Standards for Nuclear Power Operations.
- 3.7 U.S. Nuclear Regulatory Commission, Regulatory Guide 1.206, Combined License Applications for Nuclear Power Plants (LWR Edition), Revision 0, June 2007
- 3.8 U.S. Nuclear Regulatory Commission, 10 CFR 20.1301, Radiation Dose Limits for Individual Members of the Public
- 3.9 U.S. Nuclear Regulatory Commission, NUREG-0543, Methods for Demonstrating LWR Compliance with the EPA Uranium Fuel Cycle Standard (40 CFR Part 190), January 1980.
- 3.10 U.S. Nuclear Regulatory Commission, Regulatory Guide 1.113, Estimating Aquatic Dispersion of Effluents from Accidental and Routine Reactor Releases for the Purpose of Implementing Appendix I, Revision 1, April 1977
- 3.11 Mitsubishi Heavy Industries, Ltd., Design Control Document for the US-APWR, MUAP-DC011, Revision 0
- 3.12 Comanche Peak Nuclear Power Plant, Units 3 & 4, COL Application, Part 3 – Environmental Report, Revision A
- 3.13 Comanche Peak Steam Electric Station Final Safety Analysis Report, Amendment 101.
- 3.14 Certificate of Adjudication Number 12-4097, The Adjudication of Water Rights in the Brazos II River Segment of the Brazos River Basin, Permit 2871, Texas Utilities Electric Company, Somervell and Hood Counties, November 8, 1985
- 3.15 Mitsubishi Heavy Industries, Ltd., US-APWR Design Description, October 2006
- 3.16 U.S. Nuclear Regulatory Commission, Regulatory Guide 1.183, Alternative Radiological Source Terms for Evaluating Design basis Accidents at Nuclear Power Reactors, July 2000
- 3.17 United States Department of Agriculture (USDA), Transportation and Marketing, Statistics from the Census of Agriculture (5-year Cycle), Texas: Bosque County, Hill County, Johnson County, McClellan County and Somervell County (see Appendix 11)
- 3.18 U.S. Environmental Protection Agency, Office of Science and Technology, U.S. EPA Reach File 1 (RF1) for the Conterminous United States in BASINS, Version 4.0
- 3.19 Record of Phone Conference between Darren Lavorn, Enercon and Brad Brunette, Brazos River Authority, Lake Whitney Municiple Surface Water Contracts, 4/16/08 (see Appendix 5)



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 9 of 29

- 3.20 Email from John Tibbs, Texas Parks and Wildlife Department, to Audrey Thompson, Enercon, Subject: RE: Recreation and Fisheries Data Needed for Local Rivers, April 11,2008 (see Appendix 6)
- 3.21 Texas Parks and Wildlife, Historical Fish Kill Events Involving the Golden Alga, *Prymnesium parvum*, in Texas, <http://www.tpwd.state.tx.us/landwater/water/environconcerns/hab/ga/blooms.phtml>, accessed 4/27/2008 (see Appendix 7)
- 3.22 North Carolina Sport Fish Profiles, http://www.ncwildlife.org/pg03_fishing/profiles/index.htm, accessed 4/27/2008
- 3.23 Fishes Found in Texas Freshwater, <http://www.tpwd.state.tx.us/landwater/water/aquaticspecies/inland.phtml>, accessed 4/27/2008
- 3.24 U. S. Census Bureau, American Fact Finder, Population Finder, http://factfinder.census.gov/servlet/SAFFPopulation?_submenuld=population_0&sse=on, accessed 4/11/2008 (see Appendix 8)
- 3.25 Texas Water Development Board, Volumetric Survey of Lake Whitney, June 2005 Survey, September 2006 (see Appendix 9)
- 3.26 Mitsubishi Heavy Industries, Ltd., US-APWR (Comanche Peak #3/4) Radioactive Release Rates for Calculations of Public Doses, CP34-HKH-0013, Revision 1
- 3.27 Email from Sei Kudo, Mitsubishi Heavy Industries, Ltd., to Marvin Morris, et al., Enercon, Subject: Final Confirmation of Parameters, April 22, 2008 (see Appendix 10)
- 3.28 Email from Melissa Gayley, Enercon, to MAMorris et al., Subject: Population for Calculation, Attachments: PopulationResults.xls, PopSectorMiles (0 – 10 mi).jpg, PopSectorMiles (10 – 50 mi).jpg, March 14, 2008 (see Appendix 4)
- 3.29 Email from Darren Lovvorn, Enercon, to Joanne Morris, Enercon, Subject: Information Request, April 18, 2008 (Reference to eroom files including WATER USER TABLES.xls, see Appendix 3)
- 3.30 Calculation TXUT-001-ER-5.4-CALC-011, CPNPP Offsite Dose Due to Normal Gaseous Releases, Revision 0
- 3.31 USGS National Water Information System: Web Interface, USGS 08091730 Squaw Ck Res nr Glen Rose, TX, http://waterdata.usgs.gov/nwis/nwisman/?site_no=08091730&agency_cd=USGS, accessed 5/12/2008 (see Appendix 12)
- 3.32 Texas Water Development Board, Volumetric Survey of Squaw Creek Reservoir, March 10, 2003 (see Appendix 13)
- 3.33 Comanche Peak Steam Electric Station, Environmental Report, Volume II, Amendment 2, January 21, 1974.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 10 of 29

4.0 Assumptions

- 4.1 LADTAP II calculations can only be performed for radionuclides that are included in the LADTAP dose conversion factor library. As a result, releases of Rh-103m, Rh-106, Ag-110, and Ba-137m are not used in this analysis. Given the relatively short half-lives of these radionuclides, 56.12 minutes, 29.92 seconds, 24.57 seconds and 2.55 minutes, respectively, the effect of this omission is considered negligible.
- 4.2 The midpoint of Whitney Reservoir is approximately 50,654 ft downstream of the water diversion location for the City of Cleburne on the Brazos River. The transit time from the City of Cleburne diversion to the midpoint of the lake is determined using the average Brazos River stream velocity of 1.3 ft/sec [Reference 3.18]. Assumption of this stream velocity is conservative since velocity is reduced with increasing width and depth of the lake. The use of a higher stream velocity produces more conservative doses resulting from a shorter transit time and reduced decay.
- 4.3 The dilution factor for the water use locations associated with the City of Whitney, is assumed to be 1645.4. The dilution factor determined for complete mixing of the Squaw Creek effluent into the Brazos River, 822.7, is increased by a factor of two (2) for dilution in Whitney Reservoir. This is a conservative assumption given the large capacity of Whitney Reservoir, 554,203 ac-ft (1.81E+11 gal) [Reference 3.25].
- 4.4 Shoreline distances from the Squaw Creek dam to each of the surface water user diversion locations were calculated using Google Earth Maps which can be accessed via the following website: <http://maps.google.com/maps?hl=en&tab=wl>. The distances are documented in Reference 3.29 and Appendix 3. The distances were reviewed for reasonableness and are assumed to be sufficiently accurate for the purposes of this calculation.
- 4.5 The projected populations of Cleburne and Whitney are used for evaluation of potential future drinking water pathways (see Section 5.2.6.2). The 2006 populations of these cities were obtained from U.S. Census Bureau data [Reference 3.24]. Projection of the population data for these cities to 2058 was based on the ratio of the 2056 fifty (50) mile population to the 2007 fifty (50) mile population ($2,760,243/1,538,761 = 1.79$; say 1.8) [Reference 3.12, Tables 2.5-1 2.5-2]. The population of these towns was conservatively assumed to increase at the same rate as the population of the entire fifty (50) mile region including Ft Worth.
- 4.6 It is assumed that only 50% of the population within 50 miles of CPNPP Units 3 and 4 will spend recreational time in the vicinity of Whitney Reservoir. Since the majority of the population within fifty (50) miles of CPNPP is located north of the plant site in the Dallas/Ft Worth area and there are many recreational lakes closer than Whitney Reservoir, which is well south of the plant site, this is a reasonable assumption.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 11 of 29

5.0 Design Inputs

5.1 Regulatory Dose Limits

The regulatory dose limits applicable to normal liquid radiological releases are specified in 10 CFR 50, Appendix I [Reference 3.5] and 10 CFR 20.1301(d) [Reference 3.8]. NUREG-0543 provides guidance for meeting the 10 CFR 20.1301(d) requirement for compliance with 40 CFR Part 190 [Reference 3.6]. These dose limits are also given in NUREG-1555, Section 5.4.3.

Table 5.1-1 10 CFR 50 Appendix I Annual Dose Limit from Liquid Effluents	
Dose	Appendix I (per unit)
Total body dose ^(a)	3 mrem
Maximum organ dose ^(a)	10 mrem
(a) Maximally exposed individual	

In accordance with the statement of considerations for 10 CFR 20 (5 CFR 23360), demonstration of compliance with the limits of 40 CFR 190 (as referenced in 10 CFR 20.1301(d)) is considered to be in compliance with the 0.1-rem limit (10 CFR 20.1301).

Table 5.1-2 40 CFR 190 Dose Limits^(a)	
Annual whole body dose equivalent ^(b)	25 mrem
Thyroid dose	75 mrem
Dose to another organ	25 mrem
(a) Doses are for all units at a site. (b) This dose limit applies to all pathways for all effluents and direct radiation sources for all units at the site.	

5.2 LADTAP II Inputs

5.2.1 Site Characteristics

Regulatory Guide 1.109 [Reference 3.4] provides guidance for addressing doses to man from routine release of reactor effluents including doses from liquid effluent pathways. The maximally exposed individual and the population within fifty (50) miles of the plant site are to be considered. For this reason liquid pathways within fifty (50) miles of CPNPP are considered.

The proposed onsite liquid effluent release location for Comanche Peak Units 3 and 4 is the Squaw Creek Reservoir impoundment in the Brazos River Basin located in rural Somervell and Hood counties in north central Texas. Squaw Creek Reservoir is the cooling water source for CPNPP Units 1 and 2. The liquid radioactive waste discharge from CPNPP Units 3 and 4 is directed to either Units 1 or 2 circulating water system, where it is diluted and then combined prior to discharge to Squaw Creek Reservoir. [Reference 3.12, Section 3.5.1.3]



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 12 of 29

The discharge from Squaw Creek Reservoir is Squaw Creek, a freshwater stream that converges with the Paluxy and Brazos Rivers approximately 4.3 miles south of the reservoir. [Reference 3.12, Section 2.3.1.3.5]



Figure 5.2.1-1
Confluence of Squaw Creek, Paluxy River and Brazos River

From its confluence with the Paluxy River, the Brazos River flows approximately sixty (60) stream miles south to Whitney Reservoir. Whitney Dam impounds Whitney Reservoir, a lake with a capacity of 554,203 ac-ft [Reference 3.25] and length of approximately thirty (30) stream miles. Below Whitney Dam, the Brazos River continues to flow south for many miles; however, only approximately 16 stream miles are considered in this analysis since at this point the river flows outside the fifty (50) mile radius of CPNPP. Figure 5.2.1-2 shows the Brazos River system within fifty (50) miles of CPNPP.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 13 of 29

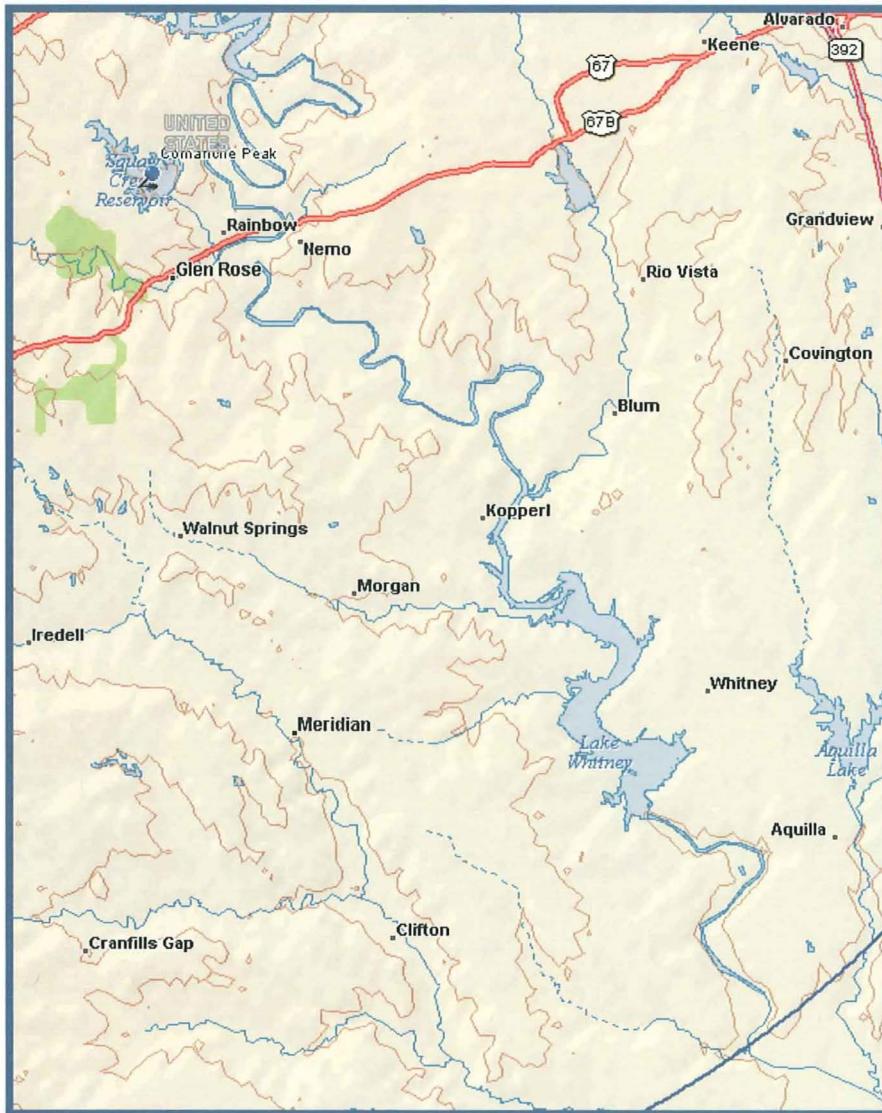


Figure 5.2.1-2
Brazos River System within 50 Miles of CPNPP

5.2.2 Site Population Data

General expressions for population dose given in Appendix D of Regulatory Guide 1.109 [Reference 3.4] address dose to permanent and transient population where they might be considered to be exposed to the average radionuclide concentration estimated for the sub-region. Excluding the Fort Worth Metropolitan area, the bulk of transient population in the region surrounding CPNPP comes from parks, camping, and lodging [Reference 3.12, Section 2.5.1.3]. Since recreational activities associated with visitors to an area such as boating, swimming and shoreline use are considered among liquid effluent pathways, it is conservative to include transient population in the evaluation of dose associated with liquid effluents.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 14 of 29

NUREG 1555 [Reference 3.3] requires that the population distribution for 80 km (50 mi) around the site for 5 years after the time of the licensing action be considered in the assessment of effluent doses. The projected permanent and transient population for the year 2058, 3,493,553 persons [Reference 3.28], conservatively bounds this requirement. Population projections derived from county estimates and the cohort-component method are documented in Reference 3.28 and Appendix 4. Default population fractions of 0.71 (adult), 0.11 (teen), and 0.18 (child) are assumed. The source term multiplier is set to the default value of 1.0 for evaluation of one unit.

5.2.3 Radionuclide Release Information

The annual average release of nuclides from the US-APWR were determined using the PWR-GALE Code. Per Table 11.2-10 of Reference 3.11, the associated projected annual releases from a single US-APWR plant are as given in Table 5.2.3-1 below.

Table 5.2.3-1
US APWR Liquid Radionuclide Releases (one unit, Ci/yr)

Isotope	Shim Bleed	Misc. Wastes	Turbine Building	Combined Releases	Detergent Waste	TOTAL Releases
Corrosion and Activation Products						
Na-24	0.00000	0.00029	0.00002	0.00031	0.00000	4.70E-03
P-32	0.00000	0.00000	0.00000	0.00000	0.00018	1.80E-04
Cr-51	0.00000	0.00008	0.00000	0.00008	0.00470	6.00E-03
Mn-54	0.00000	0.00004	0.00000	0.00005	0.00380	4.50E-03
Fe-55	0.00000	0.00003	0.00000	0.00003	0.00720	7.70E-03
Fe-59	0.00000	0.00001	0.00000	0.00001	0.00220	2.30E-03
Co-58	0.00000	0.00012	0.00000	0.00013	0.00790	9.80E-03
Co-60	0.00000	0.00001	0.00000	0.00002	0.01400	1.40E-02
Ni-63	0.00000	0.00000	0.00000	0.00000	0.00170	1.70E-03
Zn-65	0.00000	0.00001	0.00000	0.00001	0.00000	2.20E-04
W-187	0.00000	0.00002	0.00000	0.00002	0.00000	3.50E-04
Np-239	0.00000	0.00003	0.00000	0.00004	0.00000	5.30E-04
Fission Products						
Rb-88	0.00000	0.00187	0.00000	0.00187	0.00000	2.80E-02
Sr-89	0.00000	0.00000	0.00000	0.00000	0.00009	1.50E-04
Sr-90	0.00000	0.00000	0.00000	0.00000	0.00001	1.80E-05
Sr-91	0.00000	0.00000	0.00000	0.00000	0.00000	6.80E-05
Y-91m	0.00000	0.00000	0.00000	0.00000	0.00000	4.40E-05
Y-91	0.00000	0.00000	0.00000	0.00000	0.00008	9.00E-05
Y-93	0.00000	0.00002	0.00000	0.00002	0.00000	2.90E-04
Zr-95	0.00000	0.00001	0.00000	0.00001	0.00110	1.30E-03
Nb-95	0.00000	0.00001	0.00000	0.00001	0.00190	2.00E-03
Mo-99	0.00000	0.00011	0.00000	0.00011	0.00006	1.70E-03
Tc-99m	0.00000	0.00011	0.00000	0.00011	0.00000	1.70E-03



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 15 of 29

Table 5.2.3-1
US APWR Liquid Radionuclide Releases (one unit, Ci/yr)

Isotope	Shim Bleed	Misc. Wastes	Turbine Building	Combined Releases	Detergent Waste	TOTAL Releases
Ru-103	0.00001	0.00020	0.00000	0.00021	0.00029	3.40E-03
Rh-103m	0.00001	0.00020	0.00000	0.00021	0.00000	3.10E-03
Ru-106	0.00010	0.00243	0.00005	0.00257	0.00890	4.70E-02
Rh-106	0.00010	0.00243	0.00005	0.00257	0.00000	3.90E-02
Ag-110m	0.00000	0.00003	0.00000	0.00004	0.00120	1.80E-03
Ag-110	0.00000	0.00000	0.00000	0.00000	0.00000	7.20E-05
Sb-124	0.00000	0.00000	0.00000	0.00000	0.00043	4.30E-04
Te-129m	0.00000	0.00000	0.00000	0.00001	0.00000	7.80E-05
Te-129	0.00000	0.00002	0.00000	0.00002	0.00000	3.10E-04
Te-131m	0.00000	0.00002	0.00000	0.00002	0.00000	2.50E-04
Te-131	0.00000	0.00000	0.00000	0.00001	0.00000	7.60E-05
I-131	0.00002	0.00001	0.00000	0.00002	0.00160	2.00E-03
Te-132	0.00000	0.00003	0.00000	0.00003	0.00000	4.70E-04
I-132	0.00000	0.00001	0.00001	0.00002	0.00000	3.10E-04
I-133	0.00001	0.00002	0.00003	0.00005	0.00000	8.10E-04
I-134	0.00000	0.00001	0.00000	0.00001	0.00000	8.90E-05
Cs-134	0.00002	0.00005	0.00000	0.00007	0.01100	1.20E-02
I-135	0.00000	0.00002	0.00003	0.00005	0.00000	7.80E-04
Cs-136	0.00030	0.00112	0.00000	0.00141	0.00037	2.20E-02
Cs-137	0.00003	0.00008	0.00000	0.00011	0.01600	1.80E-02
Ba-137m	0.00003	0.00000	0.00000	0.00003	0.00000	4.60E-04
Ba-140	0.00001	0.00031	0.00001	0.00033	0.00091	5.80E-03
La-140	0.00001	0.00051	0.00001	0.00053	0.00000	8.00E-03
Ce-141	0.00000	0.00000	0.00000	0.00000	0.00023	2.90E-04
Ce-143	0.00000	0.00003	0.00000	0.00003	0.00000	5.00E-04
Pr-143	0.00000	0.00001	0.00000	0.00001	0.00000	7.90E-05
Ce-144	0.00000	0.00011	0.00000	0.00011	0.00390	5.60E-03
Pr-144	0.00000	0.00011	0.00000	0.00011	0.00000	1.70E-03
Allothers	0.00000	0.00000	0.00000	0.00000	0.00000	1.20E-05
TOTAL (except H-3)	0.00065	0.01053	0.00025	0.01143	0.08975	2.60E-01
H-3 release	1.60E+03					

As CPNPP Units 3 and 4 will not have an onsite laundry [Reference 3.26], detergent wastes are omitted. In addition, LADTAP II calculations can only be performed for radionuclides that are included in the LADTAP II dose conversion factor library. As a result, releases of Rh-103m, Rh-106, AG-110, and Ba-137m are not used in this analysis. Given the relatively short half-lives of these radionuclides, the effect of this exclusion is considered negligible (see Assumption 4.1). The release rates used in the LADTAP II analysis are given in Table 5.2.3-2 below.



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 16 of 29

Table 5.2.3-2
CPNPP Units 3 and 4 Estimated Liquid Radionuclide Releases
(one unit, Ci/yr)

Na-24	4.70E-03	Ru-106	3.81E-02
P-32	0.00E+00	Ag-110m	6.00E-04
Cr-51	1.30E-03	Sb-124	0.00E+00
Mn-54	7.00E-04	Te-129m	7.80E-05
Fe-55	5.00E-04	Te-129	3.10E-04
Fe-59	1.00E-04	Te-131m	2.50E-04
Co-58	1.90E-03	Te-131	7.60E-05
Co-60	0.00E+00	I-131	4.00E-04
Ni-63	0.00E+00	Te-132	4.70E-04
Zn-65	2.20E-04	I-132	3.10E-04
W-187	3.50E-04	I-133	8.10E-04
Np-239	5.30E-04	I-134	8.90E-05
Rb-88	2.80E-02	Cs-134	1.00E-03
Sr-89	6.00E-05	I-135	7.80E-04
Sr-90	8.00E-06	Cs-136	2.16E-02
Sr-91	6.80E-05	Cs-137	2.00E-03
Y-91m	4.40E-05	Ba-140	4.89E-03
Y-91	1.00E-05	La-140	8.00E-03
Y-93	2.90E-04	Ce-141	6.00E-05
Zr-95	2.00E-04	Ce-143	5.00E-04
Nb-95	1.00E-04	Pr-143	7.90E-05
Mo-99	1.64E-03	Ce-144	1.70E-03
Tc-99m	1.70E-03	Pr-144	1.70E-03
Ru-103	3.11E-03	Total (except H-3)	1.29E-01
		H-3	1.60E+03

5.2.4 Impoundment Reconcentration Model Data

Regulatory Guide 1.113, "Estimating Aquatic Dispersion of Effluents from Accidental and Routine Releases for the Purpose of Implementing Appendix I" [Reference 3.10] presents transport and water use models acceptable to the NRC for use in calculating the potential annual average radiation doses to the public. Regulatory Guide 1.113 models include both simplified and complex models. Simplified models must employ demonstrably conservative assumptions. If this approach supports a conclusion of compliance with 10 CFR 50 Appendix I limits, no further effort is indicated.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 17 of 29

The LADTAP II hydrologic model used to represent mixing of the CPNPP Units 3 and 4 liquid effluent in Squaw Creek Reservoir is the completely mixed impoundment (reservoir) model. The LADTAP II completely mixed impoundment model assumptions are consistent with Regulatory Guide 1.113. The reservoir is represented as a completely mixed tank. All inputs of material makeup are instantaneously mixed throughout the tank so that the concentration is homogeneous. Negligible evaporation and leakage losses are assumed. Per Regulatory Guide 1.113, simple models such as the completely mixed model may be used to describe all cooling ponds; however, the analytical techniques, assumptions, and level of conservatism of the model must be fully justified.

Since the Squaw Creek Reservoir is represented as a completely mixed tank, the circulating water system flowrate from CPNPP Units 1 and 2 to Squaw Creek Reservoir does not affect the reconcentration in the impoundment or the resulting doses. The total Unit 1 and 2 circulating water system flow rate, 2.2E+06 gpm [Reference 3.13, Section 10.4.5.1], serves only to demonstrate that the reservoir would be fairly homogeneous, satisfying the "completely mixed" limitation of the model. Although the liquid radwaste discharge rate from the plant to the impoundment is not used in the LADTAP II calculation, a value of 247,500 gpm is input for this parameter. This flow rate represents 90% of the flow rate of one of eight Unit 1 and 2 circulating water system pumps (275,000 gpm/pump) [Reference 3.13].

The volume of Squaw Creek Reservoir is another required impoundment model parameter. Per Reference 3.12, Section 2.3.1.2.5, the volume of Squaw Creek Reservoir at the conservation pool elevation of 775 ft is 151,418 ac-ft; however, USGS data shows a minimum pool elevation of 772.98 ft [Reference 3.31]. This pool elevation equates to a volume of approximately 144,700 ac-ft (6.3E+09 ft³) [Reference 3.32]. Since it is conservative for a minimum volume to be applied in an impoundment model, a volume of 6.3E+09 ft³ will be used in this calculation.

Another important hydrological parameter associated with the completely mixed model is the flushing of the reservoir by the blowdown stream. Lower effluent releases from Squaw Creek Reservoir result in higher reconcentration in the impoundment; therefore, it is conservative to use a low flowrate when evaluating compliance with 10 CFR 50 Appendix I limits. The minimum discharge flowrate from Squaw Creek Reservoir is 1.5 ft³/s. This minimum flowrate is based on the current contract with the Brazos River Authority for water allocation rights [Reference 3.14]. The contract stipulates that the owner make sufficient releases to maintain a minimum flow of 1.5 ft³/s at the Highway 144 crossing over Squaw Creek. United States Geological Survey (USGS) data for Squaw Creek is consistent with a release rate of 1.5 ft³/s. USGS data gives an average mean minimum flow of 2 ft³/s for the time period from 1977 to 2006.

The expected average release rate from Squaw Creek Reservoir, once Units 3 and 4 are operational, is anticipated to be approximately 45.4 ft³/s (32,900 acre ft/year) [Reference 3.27]. More realistic doses are calculated using this value for comparison with the Appendix I case (Case 1). Input and output files for the realistic case (Case 2) can be found in Appendix 2.

Effluent concentrations are estimated at the midpoint of plant life, 30 years [Reference 3.15, Table 1.3-1].

5.2.5 ALARA Analysis Usage Location Data

5.2.5.1 Maximally Exposed Individual

The LADTAP II As Low As Reasonably Achievable (ALARA) analysis calculates doses to individuals from ingestion of aquatic food, ingestion of drinking water, external exposure from shoreline activities, and exposure from swimming and boating. Doses associated with ingested irrigated foods and milk and meat production are also considered (see Section 5.2.6). This hypothetical individual represents the maximally exposed individual within 50 miles. 10 CFR 50 Appendix I ALARA limits apply to individuals in unrestricted areas, therefore, unrestricted areas within 50 miles of CPNPP were reviewed to identify the most limiting locations and pathways of exposure.

Squaw Creek Reservoir is owned by Luminant Generation Company LLC (Luminant) and is closed to the public [Reference 3.12, Section 2.5.1.3]. Access is limited to those persons (employees and guests) granted access rights by Luminant [Reference 3.12, Section 2.2]. Squaw Creek Reservoir discharges to



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 18 of 29

Squaw Creek. There are no other sources of dilution in Squaw Creek; therefore, the most limiting location for aquatic food and recreation for an individual in an unrestricted area is along Squaw Creek. For calculation of shoreline dose, a width factor is input to define the shoreline geometry of Squaw Creek. A shore-width factor for rivers of 0.2 is used [Reference 3.1].

Squaw Creek flows approximately 4.3 miles south of CPNPP to the Paluxy River. Regulatory Guide 1.109 [Reference 3.4] characterizes the maximum individual as "maximum" with regard to usage of the region in the vicinity of the plant representing habits with reasonable deviations from the average. In this calculation, aquatic food and recreation pathways will be evaluated for an individual located approximately two (2) miles (10,560 ft) south of the Squaw Creek dam. Given the size and access to Squaw Creek, usage by the maximally exposed individual at two (2) miles is judged to be reasonable and conservative. Using the stream velocity in the reach of Squaw Creek at mean flow obtained from Reference 3.18, 0.4 ft/sec, a transit time of 7.3 hours is obtained. Since there are no other sources of dilution along Squaw Creek, a dilution factor of 1 is applied.

The Texas Commission on Environmental Quality (TCEQ) is the environmental agency for the state of Texas. The TCEQ is the regulatory agency responsible for water rights. Through the TCEQ it was determined that the Brazos River Authority (BRA) holds the majority of water rights within the Brazos River basin and sells water to various individuals, municipalities, and industries. A review of water rights granted by these agencies showed that drinking water and irrigation water are not obtained from surface water in close proximity to CPNPP. The nearest possible source of drinking water that was identified is associated with the City of Cleburne. The BRA has a municipal/domestic use water contract with the City of Cleburne for 5000 ac-ft/yr. However, according to the BRA [Reference 3.19], there is no diversion infrastructure in place and no water has ever been diverted. The diversion location of the City of Cleburne water use contract number 213383 is shown in Figure 5.2.5.1-1. The shoreline distance from the Squaw Creek dam to this location is approximately 257,750 ft. Since NUREG 1555, Section 5.4 guidance indicates that present and known future drinking water intake locations be considered, the location of the Cleburne water right is conservatively used for evaluation of the drinking water pathway for the maximally exposed individual.



Figure 5.2.5.1-1
Water Use Locations Above Whitney Reservoir

 ENERCON SERVICES, INC.	Estimated Annual Dose Due to Normal Liquid Effluents	CALC. NO. TXUT-001-ER-5.4-CALC-010
		REV. 0
		PAGE NO. 19 of 29

Given the distance from the confluence of Squaw Creek, the Paluxy River and the Brazos River to the City of Cleburne water right, complete mixing is assumed. The Brazos River monthly average stream flow is 1,234 ft³/sec [Reference 3.12, Table 2.3-13]. A ratio of this value and the Squaw Creek stream flow given for Case 1 in Section 5.2.4, 1.5 ft³/sec, is used to determine the dilution factor for the drinking water pathway for the maximally exposed individual, 822.7. The dilution factor determined for Case 2 (ratio of 1,234 ft³/sec and 45.4 ft³/sec) is 27.2.

The Squaw Creek and Brazos River stream velocities at mean flow are 0.4 and 1.3 ft/sec, respectively [References 3.18]. The shoreline distance from the Squaw Creek dam to the confluence with the Paluxy River is approximately 4.3 miles (22,704 ft). The shoreline distance from the Squaw Creek confluence of the Paluxy River to the drinking water diversion on the Brazos River is approximately 235,046 ft. These values are used to determine the transit time for the drinking water pathway for the maximally exposed individual as shown below. Note that the Brazos River stream velocity is used for the approximately 400 ft along the Paluxy River to the Brazos River.

$$\text{Transit Time} = \left[\frac{22,704 \text{ ft}}{0.4 \text{ ft/sec}} + \frac{257,750 \text{ ft} - 22,704 \text{ ft}}{1.3 \text{ ft/sec}} \right] \times \frac{1 \text{ hour}}{3600 \text{ sec}} = 66 \text{ hours}$$

LADTAP II default usage and consumption parameter values, which are consistent with the guidance of Regulatory Guide 1.109, are used without change in this ALARA analysis.

5.2.5.2 Additional Locations

An additional location in the restricted area around Squaw Creek Reservoir was selected for an analysis similar to the ALARA analysis described above. This evaluation considers those persons (employees and guests) granted access rights to the reservoir by Luminant. The parameters that must be entered for a LADTAP II evaluation of an individual other than the maximally exposed individual are the dilution factor for all pathways, the transit time from the discharge point to the usage location, and the shore-width factor. Since this location represents employee use of Squaw Creek Reservoir for shoreline activities, swimming and fishing, a dilution factor of one (1) and a transit time of zero (0) are appropriate. A lake shore is the applicable shoreline geometry for Squaw Creek Reservoir; therefore, a shore-width factor of 0.3 is used [Reference 3.1]. Although LADTAP II determines doses associated with the drinking water pathway for additional usage locations, there is no drinking water taken from Squaw Creek Reservoir. Doses associated with the drinking water pathway are neglected.

5.2.6 Population Dose Usage Location Data

Locations and usage data for sport fishing harvest, irrigated foods and milk and meat production are described below. This data is used for population dose estimates associated with the consumption of aquatic and irrigated foods as well as milk and meat. LADTAP II default usage and consumption parameter values, which are consistent with the guidance of Regulatory Guide 1.109, are used without change.

There is no commercial fish harvest in Squaw Creek, the Brazos River below the Paluxy River, or Whitney Reservoir [Reference 3.20]. In addition, as is typical of freshwater sites, there is no sport or commercial harvest of invertebrates. Aquatic vegetation is not normally consumed in the vicinity surrounding CPNPP; therefore, this pathway is not evaluated. Sport fishing, irrigation and milk and meat production are discussed below.

5.2.6.1 Sport Fishing Harvest

Current sport fish harvest data is not available for the Brazos River Basin in the vicinity of CPNPP [Reference 3.20]. In addition, outbreaks of golden alga, a microscopic organism that produces toxins causing massive fish kills, were experienced in Lake Granbury, the Brazos River and Whitney Reservoir as recently as March of 2003 [Reference 3.21]. Sport species require considerable stocking effort and



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 20 of 29

years to recover naturally from a golden alga outbreak; therefore, creel data for Whitney Reservoir from 1999-2000, prior to the outbreaks which have impacted fishing and the number of anglers on the reservoir, are used in evaluation of the aquatic foods pathway.

The total number of sport fish harvested by species in Whitney Reservoir from 12/1/1999 through 11/29/2000 was obtained from the Texas Parks and Wildlife Department [Reference 3.20]. Typical weight of each species [Reference 3.22 and 3.23] was used to conservatively estimate the total weight of each species harvested. To account for the lack of creel data for the Brazos River and the future increase in the quantity of sport fish harvested, the total weight of sport fish harvested in 1999 – 2000 is increased by 25%. This increase is reasonable since there is no public access to the Brazos River above Whitney Reservoir and harvest data predates recent fish kills associated with golden alga. See Table 5.2.6.1-1 for the Whitney Reservoir sport fish harvest data used in the LADTAP II analysis. A total harvest value of 715,125 lbs/yr (324,375 kg/yr) is input.

**Table 5.2.6.1-1
Sportfish Harvest by Species, Whitney Reservoir,
12/1/99 through 11/30/00**

Fish Species	Harvest	Species Weight Used (lbs)	Total Species Weight (lbs)
White bass	13,866	3	41,598
Striped bass	13,994	17	237,898
Largemouth bass	2,960	10	29,600
Smallmouth bass	114	5	570
White crappie	4,152	3	12,456
Black crappie	1,736	3	5,208
Freshwater drum	433	20	8,660
Blue catfish	2,681	30	80,430
Channel catfish	7,784	20	155,680
Total Harvest Weight (lbs)			572,100
Total Harvest Weight Used in LADTAP II (25% added)			715,125

Since the annual sport fish harvest is assumed to be caught in both the Brazos River and Whitney Reservoir, the location of the City of Cleburne municipal water diversion above Lake Whitney is conservatively assumed for the determination of the transit time (66 hrs) and dilution factor (822.7) for aquatic foods. (see Section 5.2.5.1)

5.2.6.2 Drinking Water

The TCEQ is the Texas regulatory agency responsible for water rights. Through the TCEQ it was determined that the Brazos River Authority (BRA) holds the majority of water rights within the Brazos River Basin and sells water to various individuals, municipalities, and industries. A review of water rights granted by these agencies showed that municipal (drinking) water is not obtained from surface water in close proximity to CPNPP. Table 5.2.6.2-1 shows TCEQ and BRA municipal water rights within 50 miles of CPNPP from the Brazos River system. As noted in Section 5.2.5.2, although water rights contracts exist, no diversion of water has been made for municipal use and, in most cases, no infrastructure currently exists. Consistent with the guidance of NUREG 1555, these water contracts are conservatively considered as potential future drinking water sources.



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.


TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 21 of 29

**Table 5.2.6.2-1
TCEQ and BRA Municipal Water Rights**

Water Right / Contract No.	Owner	Use	Ac-Ft/Yr	Distance From SCR Dam (Ft)
213200	Whitney, City of	Municiple	750	359,057
213206	Cleburne, City of	Municiple	4700	359,057
213277	Lake Whitney Water Co.	Municiple	150	359,057
213311	Fred T. Owen, Jr.	Municiple	60	359,057
213383	Cleburne, City of	Multi	5000	257,750

Figures 5.2.6.2-1, 5.2.6.2-2 and 5.2.6.2-3 below show the locations of TCEQ and BRA municipal water rights identified in Table 5.2.6.2-1. The numbers for water right contracts for municipal use are shown in blue.

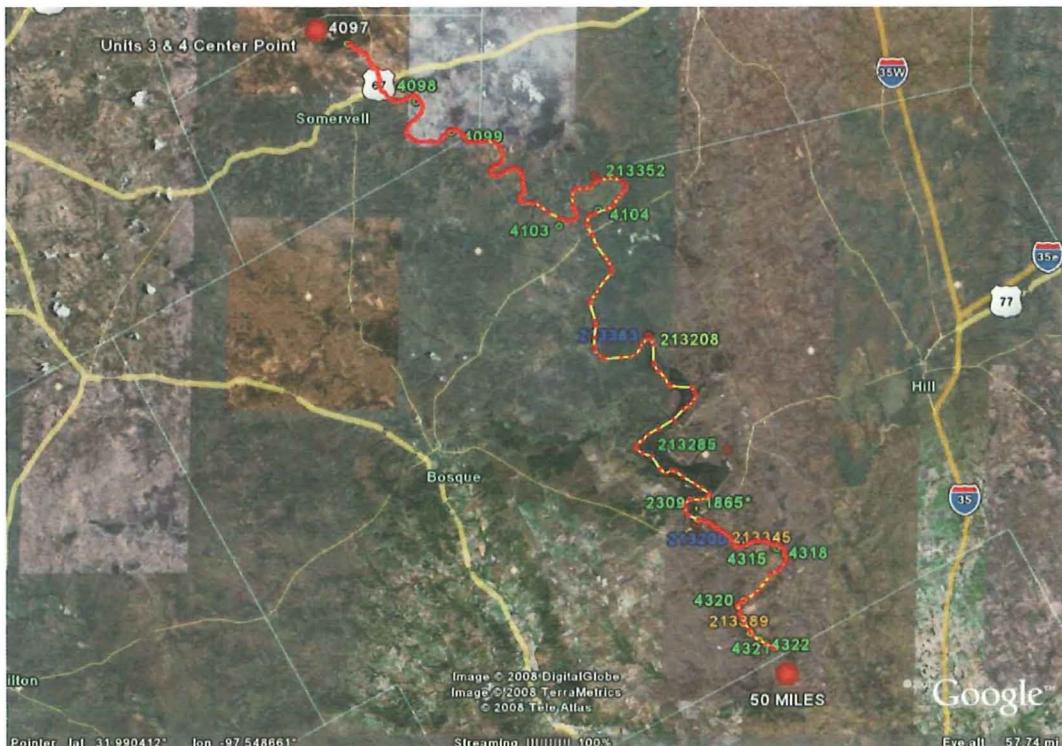

**Figures 5.2.6.2-1
Brazos River System Water Rights within 50 Miles of CPNPP**



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 22 of 29



Figures 5.2.6.2-2
Brazos River System Water Rights below Whitney Reservoir, View 1



Figures 5.2.6.2-3
Brazos River System Water Rights below Whitney Reservoir, View 2



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 23 of 29

As shown in Table 5.2.6.2-1, there are two identified locations for municipal water use contracts. The first location, the City of Cleburne, is located approximately 257,750 ft below Squaw Creek dam, just above Whitney Reservoir. All of the other water rights are approximately 359,057 ft below Squaw Creek Dam immediately below Whitney Reservoir. However, since there is no infrastructure, the actual future use location for these other water rights might be anywhere along Whitney Reservoir; therefore, for the purpose of conservatively calculating transit time, a location at the midpoint of the reservoir will be assumed. The transit time for the City of Cleburne diversion location is 66 hours as given in Section 5.2.5.1. The transit time for the midpoint of Whitney Reservoir, an additional 50,654 ft downstream, is determined to be 77 hours assuming the average Brazos River stream velocity of 1.3 ft/sec (see Assumption 4.2). The dilution factor for the City of Cleburne drinking water diversion location was determined to be 822.7 in Section 5.2.5.1. The dilution factor for the remaining water use locations, which are primarily associated with the City of Whitney, is determined by assuming an additional dilution factor of two (2) due to mixing in the volume of Whitney Reservoir (see Assumption 4.3). The resulting value is 1645.4.

The populations of Cleburne and Whitney from U.S. Census Bureau 2006 data, are 29,689 and 2,068, respectively [Reference 3.24]. These populations are conservatively increased by 80% to 53,440 and 3,722 to project the populations to the year 2058 (see Assumption 4.5).

5.2.6.3 Population Shoreline Usage Location Data

It is assumed that 50% of the population within 50 miles of CPNPP Units 3 and 4 will spend recreational time in the vicinity of Whitney Reservoir (see Assumption 4.6). Since the majority of the population within fifty (50) miles of CPNPP is located north of the plant site in the Dallas/Ft Worth area and there are many recreational lakes closer than Whitney Reservoir, this is a reasonable assumption. The total transient and permanent population within fifty (50) miles of CPNPP is 3,493,553 [Reference 3.28]. Fifty percent of this number is 1,746,777.

The assumed location for calculating the dilution factor and transit time is the midpoint of Whitney Reservoir. This is the same location as assumed for the City of Whitney drinking water diversion described in Section 5.2.6.3. The transit time and dilution factor used for the shoreline pathway for Case 1 are 77 hours and 1645.4, respectively. The transit time and dilution factor used for the shoreline pathway for Case 2 are 77 hours and 54.4, respectively.

The average exposure time per person for each age group is taken from Table E-4 of Regulatory Guide 1.109. The exposure times for children, teenagers, and adults are 9.5 hrs/yr, 47 hrs/yr, and 8.3 hrs/yr, respectively. Multiplying these values by the fraction of the population represented by each age group, yields a shoreline exposure time of 12.8 hrs/person/yr. The default values for the fraction of the population represented by each age group are 71% adults, 11% teens, and 18% children [Reference 3.1]. The percentage of infants is conservatively included in that of children. These values are in accordance with Regulatory Guide 1.109 [Reference 3.4]. The population shoreline usage time calculated for this location is 22,358,746 person-hr/yr.

A shore-width factor of 0.3 for a lake is applied.

5.2.6.4 Population Boating and Swimming Usage Location Data

The same parameters used for shoreline use are conservatively applied to the boating and swimming pathways. See Section 5.2.6.3.

5.2.6.5 Irrigated Food Pathway Data

Surface water is not commonly used for irrigation in the vicinity of CPNPP Units 3 and 4. Some water is diverted from the Brazos River system downstream of the plant for the purpose of irrigation [Reference 3.29]; however, a review of water rights granted by the TCEQ and BRA showed that it is not used for



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0

PAGE NO. 24 of 29

cultivation of farm products for human consumption. Identified uses are irrigation of grass, hay and oats [Reference 3.29]. Although acreage irrigated with surface water is normally used for the production of feed for livestock, the irrigated food pathways for vegetables and leafy vegetables will be considered in this evaluation for conservatism. Locations of TCEQ and BRA water rights associated with irrigation and irrigated acreage are identified in Table 5.2.6.5-1 below.

Table 5.2.6.5-1
TCEQ and BRA Irrigation Water Rights

Water Right / Contract No.	Owner	Use	Acres	Ac-Ft/Yr	Distance From SCR Dam (Ft)
4098	Bob Harris Oil Co	Irrigation	130	258	37907
4099	Dorothy W Little Et Al	Irrigation	27	5	69958
4103	Cyril Wagner Jr Et Al	Irrigation	186	186	135764
4104	Chisholm Trail Ventures Lp	Irrigation	968	3,811	183745
2309	Clubcorp Golf	Irrigation	150	400	359057
4315	Clifford N Auten	Irrigation	14	30	379320
4316	B W Bowers & Wife	Irrigation	20	75	383024
4317	Mary Ann Jenkins Et Al	Irrigation	963	243	389302
4318	Smith Bend Ranch Ltd	Irr., Ind., Mun.	629	2153	390124
4319	Birch Wilfong	Irrigation	27	34	394184
4320	Warren D Whitlow Et Ux	Irrigation	84	84	415075
4321	David Ballew	Irrigation	123	337	428128
4322	Ronald Lee Burnette	Irrigation	255	175	432010
4323	Ronald Lee Burnette / Kenneth Gage Burnette	Irrigation	35	173	434524
4324	Charles L Harless Et Ux	Irrigation	60	305	437513
213208	Double Diamond, Inc. (White Bluff)	Irrigation	not given	1000	257750
213259	Lakeside Domestic Use	Irrigation	not given	15	359057
213285	Lake Whitney Golf Club	Irrigation	not given	50	351325
213345	James K. Boyd	Agriculture	not given	10	368220
213352	Double Diamond, Inc. (The Retreat)	Irrigation	not given	1200	159886
213389	Charles Matthews	Agriculture	not given	50	417935
Total			2574	10,594	

Figures 5.2.6.2-1, 5.2.6.2-2 and 5.2.6.2-3 show the locations of TCEQ and BRA irrigation water rights identified in Table 5.2.6.5-1. The numbers for water right contracts for irrigation use are shown in green and yellow. The total irrigation rate from the Brazos River system within fifty (50) miles of CPNPP is 10,594 ac-ft/yr ($1.09E+09$ L/mo). The irrigated acreage from the Brazos River system within fifty (50) miles of CPNPP that is used in determination of the irrigation rate is 3,600 acres ($1.46E+07$ m²). This value is based on TCEQ data conservatively increased by approximately 40% to include BRA water



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 25 of 29

contracts that do not identify acreage [Reference 3.29]. The irrigation rate and acreage are used to determine the irrigation rate in the units required for LADTAP II input, 74.6 L/m²/mo.

Vegetable, milk and meat production data was determined from United States Department of Agriculture (USDA) county farm statistics [Reference 3.17]. Data from the counties bordering the Brazos River System below CPNPP was reviewed to determine the total farm acreage and the total irrigated farm acreage. The fraction of cropland irrigated and the fraction of the county south of CPNPP and along Brazos River within the fifty (50) mile radius of CPNPP [Reference 3.12, Figure 2.5-3] were used to determine the fraction of the vegetable, meat, and milk production from each county that is produced from irrigation with water from the Brazos River. See Table 5.2.6.5-2 below.

**Table 5.2.6.5-2
TCEQ and BRA Irrigation Water Rights**

Counties Bordering Brazos River	Total Acres of Cropland	Irrigated Acres of Cropland	Fraction of Cropland Irrigated	Fraction of Co. in 50 mi Radius South of Site	Fraction of Production Irrigated
Bosque Co.	46,538	1,592	0.03	1.00	0.0342
Hill Co.	211,217	3,864	0.02	0.60	0.0110
Johnson Co.	80,868	1,004	0.01	0.25	0.0031
McLennan Co.	178,252	1,596	0.01	0.05	0.0004
Somervell Co.	6,736	129	0.02	1.00	0.0192

The fraction of the production irrigated in each county was then applied to the total production of vegetables, meat and milk in each county to determine the overall production values to use in the liquid effluent dose evaluation.

Table 5.2.6.5-3 below shows the methodology used to determine vegetable production from total acreage irrigated and harvested in the vicinity of the Brazos River. The acreage harvested for each crop is multiplied by the United States average yield of each crop, which is obtained from USDA county agriculture statistics [Reference 3.17]. The average yield for the leafy vegetables is determined based on the production values for the ten major vegetables produced in Texas for 2007 according to USDA records [Reference 3.30]. Some of the average crop yields are based on bushels. For these crops, the average weight per bushel based on Reference 3.30 is used to calculate a total weight for each crop. The total irrigated production of leafy vegetables and other vegetables is given in Table 5.2.6.5-3.



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 26 of 29

**Table 5.2.6.5-3
Irrigated Vegetable Production**

Group	Description	Total Acreage	Ave. Yield / Acre		Wt. / Bushel (lbs)	Total Wt. (lbs)	Total Wt. (kgs)
Grains	Corn for Grain or Seed	545	158.9	bushels	70	6,066,614	2,751,299
	Sorghum for Grain or Seed	567	66.4	bushels	56	2,110,081	956,953
	Wheat	704	71.4	bushels	60	3,017,371	1,368,422
	Oats	91	80	bushels	32	232,347	105,373
Green Leafy	Vegetables	4	6.0	tons		54,038	24,507
Other	Orchards	89	2000	lbs		178,212	80,822
Legumes/Seeds	Soybeans	6	42.9	bushels	60	14,654	6,646
Total Leafy Veg.						54,038	24,507
Total All Others						11,619,279	5,269,514

Table 5.2.6.5-4 shows the methodology used to determine meat and milk production from total numbers raised on irrigated feed in the vicinity of the Brazos River. By dividing the number of cattle slaughtered in Texas in 2002, 6,471,600 [Reference 3.30], by the total inventory of cattle and calves in Texas in 2002, 13,978,987 [Reference 3.30], a slaughter rate in Texas of 46.3% is calculated. This same methodology is also used to calculate the slaughter rate of hogs/pigs in Texas. By dividing the number of hogs/pigs slaughtered in Texas in 2002, 429,500 [Reference 3.30], by the total inventory of hogs/pigs in Texas in 2002, 930,000 [Reference 3.30], a slaughter rate in Texas of 46.2% is calculated. For conservatism, a slaughter rate of 50% is used for both beef cows and hogs/pigs.

The total number of slaughtered beef cows is multiplied by the 2006 average dressed weight of 780 lbs/head and the total number of slaughtered hogs/pigs is multiplied by the 2006 average dressed weight of 204 lbs/head. The average dressed weights are based on USDA livestock slaughter data [Reference 3.30]. The average dressed weights from 2006 were used instead of the average dressed weights from 2002 because the 2006 average dressed weights are higher and therefore conservative. The total beef and pork production from Brazos River irrigation is given in Table 5.2.6.5-4.

The number of milk cows raised along the Brazos River system within 50 miles of the Comanche Peak site is multiplied by the 2006 average milk produced per cow in the state of Texas, which is 21,328 lbs/cow [Reference 3.30]. Similarly, the total number of milk goats raised along the Brazos River system within 50 miles of the Comanche Peak site is multiplied by the average milk produced per goat. The highest annual milk production per goat for any breed identified in Reference 3.30 is 2,077 lbs/goat. For conservatism, an average milk production per goat of 2,200 lbs/goat was used. To convert pounds of milk to liters of milk, a density of 1,030 kg/m³ for whole milk is used [Reference 3.30]. Using the density of whole milk is conservative because it has a lower density than skim milk. A lower density results in a greater volume of milk. The total annual milk production from milk cows and milk goats raised along the Brazos River system within 50 miles of the site is given in Table 5.2.6.5-4.



ENERCON SERVICES, INC.

**Estimated Annual Dose Due to
Normal Liquid Effluents**

CALC. NO.

TXUT-001-ER-5.4-CALC-010

REV. 0**PAGE NO.** 27 of 29

**Table 5.2.6.5-4
Irrigated Meat and Milk Production**

Group	Total Numbers	Ave. Slaughter Rate	Dressed Weight (lbs)	Individual Milk Production (lbs/yr)	Total Production (lbs/yr)	Total Production. (kg/yr or L/yr)
Beef Cattle	1,584	50%	780	-	617,760	280,163
Hogs/Pigs	22	50%	204	-	2,244	1,018
Milk Cows	96	-	-	21,328	2,047,488	901,520
Milk Goats	43	-	-	2,077	94,600	41,653
Total Meat Production (kg/yr)					281,181	
Total Milk Production (L/yr)						943,173

As shown in Table 5.2.6.5-1, there are numerous locations identified for irrigation water use contracts. For conservatism and calculational simplicity, the location of the Double Diamond, Inc. White Bluff diversion is used for the determination of transit time for all irrigation sources. Most other irrigation take-off locations are below the Double Diamond, Inc. diversion. The Double Diamond, Inc. White Bluff diversion is located approximately 257,750 ft below Squaw Creek dam, just above Whitney Reservoir. It is at the same location as the City of Cleburne municipal water diversion. The transit time for the City of Cleburne diversion location for Case 1 is sixty-six (66) hours as given in Section 5.2.5.1. The dilution factor for the City of Cleburne municipal water diversion location, 822.7, was also determined in Section 5.2.5.1. The dilution factor for Case 2, also found in Section 5.2.5.1, is 27.2.

5.2.7 Biota

A location in the restricted area around Squaw Creek Reservoir was selected for the evaluation of the impacts of radiological effluent on biota. The parameters that must be entered for the biota evaluation are the dilution factor and the transit time from the discharge point to the usage location.. For a location on Squaw Creek Reservoir, a dilution factor of one (1) and a transit time of zero (0) are appropriate. A lake shore is the applicable shoreline geometry for Squaw Creek Reservoir; therefore, a shore-width factor of 0.3 is used.

5.2.8 Block Data

LADTAP II block data parameters include radionuclide constants and data for the various exposure pathways that are not likely to be site or case specific. These parameters include age-specific consumption rates, pathway usage parameters, and bioaccumulation factors for each aquatic and terrestrial food pathway. Default values are supplied for all of these parameters. Most default parameters are derived from Regulatory Guide 1.109 [Reference 3.4]; however, as noted in Section 3.3 of the LADTAP II Users Guide [Reference 3.1], the LADTAP II dose factor file includes modifications that reflect more current values for several dosimetry parameters.

With the exception of the midpoint of plant life, which is 30 years for a US-APWR, the LADTAP II block data was not changed in this calculation.

 ENERCON SERVICES, INC.	Estimated Annual Dose Due to Normal Liquid Effluents	CALC. NO. TXUT-001-ER-5.4-CALC-010 REV. 0 PAGE NO. 28 of 29
--	---	---

6.0 Methodology

The evaluation of the doses due to the release of liquid activity under normal conditions was performed by using the methodology given in NUREG/CR-4013 [Reference 3.1] as implemented in the LADTAP II computer code. LADTAP II provides an evaluation of radiological exposure due to the release of radioactive material from nuclear power plants during normal operation via liquid effluent pathways. The LADTAP II computer program was developed by the Nuclear Regulatory Commission to estimate radiation doses to individuals and population groups from radionuclide releases as liquid effluents from light-water nuclear reactors during routine operation. The code provides an estimated radiation dose to individuals and population groups from ingestion (aquatic foods) and external exposure pathways. The calculated doses provide information for determining compliance with Appendix I of 10 CFR 50 (the "ALARA" philosophy).

LADTAP II implements the radiological exposure models described in Regulatory Guide 1.109, Revision 1, "Calculation of Annual Doses to Man from Routine Releases of Reactor Effluents for the Purpose of Evaluating Compliance with 10 CFR Part 50 Appendix I", for radioactivity releases in liquid effluent. The exposure pathway models estimate the radiation dose to selected individuals and population groups. The exposure pathways considered in LADTAP II are:

1. external exposure to contaminated water by way of swimming, boating, or walking on the shoreline
2. ingestion of foods which are irrigated by contaminated water
3. ingestion of contaminated water
4. ingestion of aquatic animals exposed to contaminated water

 ENERCON SERVICES, INC.	Estimated Annual Dose Due to Normal Liquid Effluents	CALC. NO. TXUT-001-ER-5.4-CALC-010 REV. 0 PAGE NO. 29 of 29
--	---	---

7.0 Calculations

As discussed in the Methodology section, liquid effluent dose calculations are done using the LADTAP II computer code. Two cases are considered. The first case uses the minimum release rate from Squaw Creek Reservoir to Squaw Creek to determine the dose to the maximally exposed individual. Case 1 is also used for evaluation of an additional use location representing Luminant employees and guests using Squaw Creek Reservoir for recreational purposes. The second case uses the expected release rate from Squaw Creek Reservoir to Squaw Creek when Units 3 and 4 are operational. Case 2 produces the more conservative population doses. LADTAP II output files for Case 1 and Case 2 are attached in Appendices 1 and 2, respectively. Calculation results are summarized in Section 2.0.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 1 of 14

Appendix 1
Case 1 - CPNPP Unit 3 or 4 Appendix I LADTAP II Output File

```
*****
*          L      AAA     DDDD    TTTTT   AAA     PPPP    IIIII  IIIII
*          L      A       A     D     D    T       A       A     P       P    I       I
*          L      A       A     D     D    T       A       A     P       P    I       I
*          L      AAAAAA  D     D    T       AAAAAA  PPPP    I       I
*          L      A       A     D     D    T       A       A     P       P    I       I
*          LLLLLL  A       A     DDDD   T       A       A     P       P    IIIII  IIIII
*
*
*
*
*
*          EVALUATION OF RADIATION DOSES FROM RELEASES OF RADIACTIVITY
*
*          IN NUCLEAR POWER PLANTS LIQUID EFFLUENTS
*
*          REVISION DATE: JSB PC - February 1996
*
*          CPNPP Unit 3 or 4 Case 1 Liquid Effluent Dose Appendix I Calc
*
*
*
*          RADIOLOGICAL ASSESSMENT BRANCH
*
*          DIVISION OF SYSTEMS INTEGRATION
*
*          U. S. NUCLEAR REGULATORY COMMISSION
*
*          WASHINGTON, D. C.
*
*          DATE OF RUN: 08-May-2008
*
*****
```



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 2 of 14

```

0   1* ARRAY      16 ENTRIES READ
0   OT
1
CPNPP Unit 3 or 4 Case 1 Liquid Effluent Dose Appendix I Calc
0  DISCHARGE=5.51E+02 CFS      SOURCE TERM MULTIPLIER=1.00E+00
0  50-MILE POPULATION=3.49E+06    FRACTION --- ADULT=.71
                                         TEENAGER=.11
                                         CHILD=.18
0  FRESHWATER SITE
1
US APWR Liquid Releases DCD Table 11-2-10 w/o Det Waste
COMPLETELY MIXED MODEL-- POND BLOWDOWN (CFS) - 1.50E+00      POND VOLUME (CF) - 6.30E+09
0          * * * ADULT DOSE FACTORS * * *
0
          INGESTION DOSE FACTORS           SHORELINE
          (MREM/PCI INTAKE)           (MREM/HR) / (PCI/M**2)
NUCLIDE CURIE/YEAR BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI SKIN TOTAL BODY RECON
  1H     3  1.60E+03 0.00E+00 5.99E-08 5.99E-08 5.99E-08 5.99E-08 5.99E-08 0.00E+00 0.00E+00 3.69E+01
 11NA   24  4.70E-03 1.70E-06 1.70E-06 1.70E-06 1.70E-06 1.70E-06 1.70E-06 2.90E-08 2.50E-08 6.84E-03
 24CR   51  1.30E-03 0.00E+00 2.66E-09 1.59E-09 5.86E-10 3.53E-09 6.69E-07 2.60E-10 2.20E-10 3.02E-01
 25MN   54  7.00E-04 0.00E+00 4.57E-06 8.72E-07 0.00E+00 1.36E-06 0.00E+00 1.40E-05 6.80E-09 5.80E-09 3.37E+00
 26FE   55  5.00E-04 2.75E-06 1.90E-06 4.43E-07 0.00E+00 0.00E+00 1.06E-06 1.09E-06 0.00E+00 0.00E+00 1.04E+01
 26FE   59  1.00E-04 4.34E-06 1.02E-05 3.91E-06 0.00E+00 0.00E+00 2.85E-06 3.40E-05 9.40E-09 8.00E-09 4.86E-01
 27CO   58  1.90E-03 0.00E+00 7.45E-07 1.67E-06 0.00E+00 0.00E+00 0.00E+00 1.51E-05 8.20E-09 7.00E-09 7.73E-01
 30ZN   65  2.20E-04 4.84E-06 1.54E-05 6.96E-06 0.00E+00 1.03E-05 0.00E+00 9.70E-06 4.60E-09 4.00E-09 2.64E+00
 74W    187 3.50E-04 1.03E-07 8.61E-08 3.01E-08 0.00E+00 0.00E+00 0.00E+00 2.82E-05 3.60E-09 3.10E-09 1.09E-02
 93NP   239 5.30E-04 1.19E-09 1.17E-10 6.45E-11 0.00E+00 3.65E-10 0.00E+00 2.40E-05 1.10E-09 9.50E-10 2.57E-02
 37RB   88  2.80E-02 0.00E+00 6.05E-08 3.21E-08 0.00E+00 0.00E+00 0.00E+00 8.36E-19 4.00E-09 3.50E-09 1.35E-04
 38SR   89  6.00E-05 3.08E-04 0.00E+00 8.84E-06 0.00E+00 0.00E+00 0.00E+00 4.94E-05 6.50E-13 5.60E-13 5.50E-01
 38SR   90  8.00E-06 8.71E-03 0.00E+00 1.75E-04 0.00E+00 0.00E+00 0.00E+00 2.19E-04 0.00E+00 0.00E+00 5.33E+01
 38SR   91  6.80E-05 5.67E-06 0.00E+00 2.29E-07 0.00E+00 0.00E+00 0.00E+00 2.70E-05 8.30E-09 7.10E-09 4.31E-03
 39Y    91M  4.40E-05 9.09E-11 0.00E+00 3.52E-12 0.00E+00 0.00E+00 0.00E+00 2.67E-10 4.40E-09 3.80E-09 3.76E-04
 39Y    91   1.00E-05 1.41E-07 0.00E+00 3.77E-09 0.00E+00 0.00E+00 0.00E+00 7.76E-05 2.70E-11 2.40E-11 6.38E-01
 39Y    93   2.90E-04 2.68E-09 0.00E+00 7.40E-11 0.00E+00 0.00E+00 0.00E+00 8.50E-05 7.80E-10 5.70E-10 4.58E-03
 40ZR   95   2.00E-04 3.04E-08 9.75E-09 6.60E-09 0.00E+00 1.53E-08 0.00E+00 3.09E-05 5.80E-09 5.00E-09 6.99E-01
 41NB   95   1.00E-04 6.22E-09 3.46E-09 1.86E-09 0.00E+00 3.42E-09 0.00E+00 2.10E-05 6.00E-09 5.10E-09 3.83E-01
 42MO   99   1.60E-03 0.00E+00 4.31E-06 8.20E-07 0.00E+00 9.76E-06 0.00E+00 9.99E-06 2.20E-09 1.90E-09 3.00E-02
 43TC   99M   1.70E-03 2.47E-10 6.98E-10 8.89E-09 0.00E+00 1.06E-08 3.42E-10 4.13E-07 1.10E-09 9.60E-10 2.74E-03
 44RU   103   3.10E-03 1.85E-07 0.00E+00 7.97E-08 0.00E+00 7.06E-07 0.00E+00 2.16E-05 4.20E-09 3.60E-09 4.29E-01
 44RU   106   3.80E-02 2.75E-06 0.00E+00 3.48E-07 0.00E+00 5.31E-06 0.00E+00 1.78E-04 1.80E-09 1.50E-09 3.97E+00
 47AG  110M   6.00E-04 1.60E-07 1.48E-07 8.79E-08 0.00E+00 2.91E-07 0.00E+00 6.04E-05 2.10E-08 1.80E-08 2.71E+00
 52TE  129M   7.80E-05 1.15E-05 4.29E-06 1.82E-06 3.95E-06 4.80E-05 0.00E+00 5.79E-05 9.00E-10 7.70E-10 3.66E-01
 52TE  129   3.10E-04 3.14E-08 1.18E-08 7.65E-09 2.41E-08 1.32E-07 0.00E+00 2.37E-08 8.40E-10 7.10E-10 5.27E-04
 52TE  131M   2.50E-04 1.73E-06 8.46E-07 7.05E-07 1.34E-06 8.57E-06 0.00E+00 8.40E-05 9.90E-09 8.40E-09 1.36E-02
 52TE  131   7.60E-05 1.97E-08 8.23E-09 6.22E-09 1.62E-08 8.63E-08 0.00E+00 2.79E-09 2.60E-06 2.20E-09 1.90E-04
 53I   131   4.00E-04 4.16E-06 5.95E-06 3.41E-06 1.95E-03 1.02E-05 0.00E+00 1.57E-06 3.40E-09 2.80E-09 8.77E-02

```



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 3 of 14

52TE 132 4.70E-04 2.52E-06 1.63E-06 1.53E-06 1.80E-06 1.57E-05 0.00E+00 7.71E-05 2.00E-09 1.70E-09 3.56E-02
 53I 132 3.10E-04 2.03E-07 5.43E-07 1.90E-07 1.90E-05 8.65E-07 0.00E+00 1.02E-07 2.00E-08 1.70E-08 1.05E-03
 53I 133 8.10E-04 1.42E-06 2.47E-06 7.53E-07 3.63E-04 4.31E-06 0.00E+00 2.22E-06 4.50E-09 3.70E-09 9.46E-03
 53I 134 8.90E-05 1.06E-07 2.88E-07 1.03E-07 4.99E-06 4.58E-07 0.00E+00 2.51E-10 1.90E-08 1.60E-08 3.98E-04
 55CS 134 1.00E-03 6.22E-05 1.48E-04 1.21E-04 0.00E+00 4.79E-05 1.59E-05 2.59E-06 1.40E-08 1.20E-08 8.00E+00
 53I 135 7.80E-04 4.43E-07 1.16E-06 4.28E-07 7.65E-05 1.86E-06 0.00E+00 1.31E-06 1.40E-08 1.20E-08 3.00E-03
 55CS 136 2.20E-02 6.51E-06 2.57E-05 1.85E-05 0.00E+00 1.43E-05 1.96E-06 2.92E-06 1.70E-08 1.50E-08 1.43E-01
 55CS 137 2.00E-03 7.97E-05 1.09E-04 7.14E-05 0.00E+00 3.70E-05 1.23E-05 2.11E-06 4.90E-09 4.20E-09 5.42E+01
 56BA 140 4.90E-03 2.03E-05 2.55E-08 1.33E-06 0.00E+00 8.67E-09 1.46E-08 4.18E-05 2.40E-09 2.10E-09 1.40E-01
 57LA 140 8.00E-03 2.50E-09 1.26E-09 3.33E-10 0.00E+00 0.00E+00 9.25E-05 1.70E-08 1.50E-08 1.83E-02
 58CE 141 6.00E-05 9.36E-09 6.33E-09 7.18E-10 0.00E+00 2.94E-09 0.00E+00 2.42E-05 6.20E-10 5.50E-10 3.54E-01
 58CE 143 5.00E-04 1.65E-09 1.22E-06 1.35E-10 0.00E+00 5.37E-10 0.00E+00 4.56E-05 2.50E-09 2.20E-09 1.51E-02
 59PR 143 7.90E-05 9.20E-09 3.69E-09 4.56E-10 0.00E+00 2.13E-09 0.00E+00 4.03E-05 0.00E+00 0.00E+00 1.48E-01
 59PR 144 1.70E-03 3.01E-11 1.25E-11 1.53E-12 0.00E+00 7.05E-12 0.00E+00 4.33E-18 2.30E-10 2.00E-10 1.31E-04
 58CE 144 1.70E-03 4.88E-07 2.04E-07 2.62E-08 0.00E+00 1.21E-07 0.00E+00 1.65E-04 3.70E-10 3.20E-10 3.08E+00

0 * * * TEENAGER DOSE FACTORS * * *

NUCLIDE	CURIE/YEAR	INGESTION DOSE FACTORS					SHORELINE			
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI	SKIN	TOTAL BODY
1H	3	1.60E+03	0.00E+00	6.04E-08	6.04E-08	6.04E-08	6.04E-08	6.04E-08	6.04E-08	
11NA	24	4.70E-03	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06	2.30E-06	
24CR	51	1.30E-03	0.00E+00	0.00E+00	3.60E-09	2.00E-09	7.89E-10	5.14E-09	6.05E-07	
25MN	54	7.00E-04	0.00E+00	5.90E-06	1.17E-06	0.00E+00	1.76E-06	0.00E+00	1.21E-05	
26FE	55	5.00E-04	3.78E-06	2.68E-06	6.25E-07	0.00E+00	0.00E+00	1.70E-06	1.16E-06	
26FE	59	1.00E-04	5.87E-06	1.37E-05	5.29E-06	0.00E+00	0.00E+00	4.32E-06	3.24E-05	
27CO	58	1.90E-03	0.00E+00	9.72E-07	2.24E-06	0.00E+00	0.00E+00	0.00E+00	1.34E-05	
30ZN	65	2.20E-04	5.76E-06	2.00E-05	9.33E-06	0.00E+00	1.28E-05	0.00E+00	8.47E-06	
74W	187	3.50E-04	1.46E-07	1.19E-07	4.17E-08	0.00E+00	0.00E+00	0.00E+00	3.22E-05	
93NP	239	5.30E-04	1.76E-09	1.66E-10	9.22E-11	0.00E+00	5.21E-10	0.00E+00	2.67E-05	
37RB	88	2.80E-02	0.00E+00	8.52E-08	4.54E-08	0.00E+00	0.00E+00	0.00E+00	7.30E-15	
38SR	89	6.00E-05	4.40E-04	0.00E+00	1.26E-05	0.00E+00	0.00E+00	0.00E+00	5.24E-05	
38SR	90	8.00E-06	1.02E-02	0.00E+00	2.04E-04	0.00E+00	0.00E+00	0.00E+00	2.33E-04	
38SR	91	6.80E-05	8.07E-06	0.00E+00	3.21E-07	0.00E+00	0.00E+00	0.00E+00	3.66E-05	
39Y	91M	4.40E-05	1.29E-10	0.00E+00	4.93E-12	0.00E+00	0.00E+00	0.00E+00	6.09E-09	
39Y	91	1.00E-05	2.01E-07	0.00E+00	5.39E-09	0.00E+00	0.00E+00	0.00E+00	8.24E-05	
39Y	93	2.90E-04	3.83E-09	0.00E+00	1.05E-10	0.00E+00	0.00E+00	0.00E+00	1.17E-04	
40ZR	95	2.00E-04	4.12E-08	1.30E-08	8.94E-09	0.00E+00	1.91E-08	0.00E+00	3.00E-05	
41NB	95	1.00E-04	8.22E-09	4.56E-09	2.51E-09	0.00E+00	4.42E-09	0.00E+00	1.95E-05	
42MO	99	1.60E-03	0.00E+00	6.03E-06	1.15E-06	0.00E+00	1.38E-05	0.00E+00	1.08E-05	
43TC	99M	1.70E-03	3.32E-10	9.26E-10	1.20E-08	0.00E+00	1.38E-08	5.14E-10	6.08E-07	
44RU	103	3.10E-03	2.55E-07	0.00E+00	1.09E-07	0.00E+00	8.99E-07	0.00E+00	2.13E-05	
44RU	106	3.80E-02	3.92E-06	0.00E+00	4.94E-07	0.00E+00	7.56E-06	0.00E+00	1.88E-04	
47AG	110M	6.00E-04	2.05E-07	1.94E-07	1.18E-07	0.00E+00	3.70E-07	0.00E+00	5.45E-05	
52TE	129M	7.80E-05	1.63E-05	6.05E-06	2.58E-06	5.26E-06	6.82E-05	0.00E+00	6.12E-05	
52TE	129	3.10E-04	4.48E-08	1.67E-08	1.09E-08	3.20E-08	1.88E-07	0.00E+00	2.45E-07	



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 4 of 14

52TE 131M	2.50E-04	2.44E-06	1.17E-06	9.76E-07	1.76E-06	1.22E-05	0.00E+00	9.39E-05
52TE 131	7.60E-05	2.79E-08	1.15E-08	8.72E-09	2.15E-08	1.22E-07	0.00E+00	2.29E-09
53I 131	4.00E-04	5.85E-06	8.19E-06	4.40E-06	2.39E-03	1.41E-05	0.00E+00	1.62E-06
52TE 132	4.70E-04	3.49E-06	2.21E-06	2.08E-06	2.33E-06	2.12E-05	0.00E+00	7.00E-05
53I 132	3.10E-04	2.79E-07	7.30E-07	2.62E-07	2.46E-05	1.15E-06	0.00E+00	3.18E-07
53I 133	8.10E-04	2.01E-06	3.41E-06	1.04E-06	4.76E-04	5.98E-06	0.00E+00	2.58E-06
53I 134	8.90E-05	1.46E-07	3.87E-07	1.39E-07	6.45E-06	6.10E-07	0.00E+00	5.10E-09
55CS 134	1.00E-03	8.37E-05	1.97E-04	9.14E-05	0.00E+00	6.26E-05	2.39E-05	2.45E-06
53I 135	7.80E-04	6.10E-07	1.57E-06	5.82E-07	1.01E-04	2.48E-06	0.00E+00	1.74E-06
55CS 136	2.20E-02	8.59E-06	3.38E-05	2.27E-05	0.00E+00	1.84E-05	2.90E-06	2.72E-06
55CS 137	2.00E-03	1.12E-04	1.49E-04	5.19E-05	0.00E+00	5.07E-05	1.97E-05	2.12E-06
56BA 140	4.90E-03	2.84E-05	3.48E-08	1.83E-06	0.00E+00	1.18E-08	2.34E-08	4.38E-05
571A 140	8.00E-03	3.48E-09	1.71E-09	4.55E-10	0.00E+00	0.00E+00	0.00E+00	9.82E-05
58CE 141	6.00E-05	1.33E-08	8.88E-09	1.02E-09	0.00E+00	4.18E-09	0.00E+00	2.54E-05
58CE 143	5.00E-04	2.35E-09	1.71E-06	1.91E-10	0.00E+00	7.67E-10	0.00E+00	5.14E-05
59PR 143	7.90E-05	1.31E-08	5.23E-09	6.52E-10	0.00E+00	3.04E-09	0.00E+00	4.31E-05
59PR 144	1.70E-03	4.30E-11	1.76E-11	2.18E-12	0.00E+00	1.01E-11	0.00E+00	4.74E-14
58CE 144	1.70E-03	6.96E-07	2.88E-07	3.74E-08	0.00E+00	1.72E-07	0.00E+00	1.75E-04

0 * * * CHILD DOSE FACTORS * * *

INGESTION DOSE FACTORS							SHORELINE		
(MREM/PCI INTAKE)							(MREM/HR) / (PCI/M**2)		

NUCLIDE	CURIE/YEAR	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI	SKIN	TOTAL BODY	RECON
1H	3	1.60E+03	0.00E+00	1.16E-07	1.16E-07	1.16E-07	1.16E-07	1.16E-07	1.16E-07	1.16E-07	
11NA	24	4.70E-03	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	
24CR	51	1.30E-03	0.00E+00	0.00E+00	8.90E-09	4.94E-09	1.35E-09	9.02E-09	4.72E-07		
25MN	54	7.00E-04	0.00E+00	1.07E-05	2.85E-06	0.00E+00	3.00E-06	0.00E+00	8.98E-06		
26FE	55	5.00E-04	1.15E-05	6.10E-06	1.89E-06	0.00E+00	0.00E+00	3.45E-06	1.13E-06		
26FE	59	1.00E-04	1.65E-05	2.67E-05	1.33E-05	0.00E+00	0.00E+00	7.74E-06	2.78E-05		
27CO	58	1.90E-03	0.00E+00	1.80E-06	5.51E-06	0.00E+00	0.00E+00	0.00E+00	1.05E-05		
30ZN	65	2.20E-04	1.37E-05	3.65E-05	2.27E-05	0.00E+00	2.30E-05	0.00E+00	6.41E-06		
74W	187	3.50E-04	4.29E-07	2.54E-07	1.14E-07	0.00E+00	0.00E+00	0.00E+00	3.57E-05		
93NP	239	5.30E-04	5.25E-09	3.77E-10	2.65E-10	0.00E+00	1.09E-09	0.00E+00	2.79E-05		
37RB	88	2.80E-02	0.00E+00	1.90E-07	1.32E-07	0.00E+00	0.00E+00	0.00E+00	9.32E-09		
38SR	89	6.00E-05	1.32E-03	0.00E+00	3.77E-05	0.00E+00	0.00E+00	0.00E+00	5.11E-05		
38SR	90	8.00E-06	2.56E-02	0.00E+00	5.15E-04	0.00E+00	0.00E+00	0.00E+00	2.29E-04		
38SR	91	6.80E-05	2.40E-05	0.00E+00	9.06E-07	0.00E+00	0.00E+00	0.00E+00	5.30E-05		
39Y	91M	4.40E-05	3.82E-10	0.00E+00	1.39E-11	0.00E+00	0.00E+00	0.00E+00	7.48E-07		
39Y	91	1.00E-05	6.02E-07	0.00E+00	1.61E-08	0.00E+00	0.00E+00	0.00E+00	8.02E-05		
39Y	93	2.90E-04	1.14E-08	0.00E+00	3.13E-10	0.00E+00	0.00E+00	0.00E+00	1.70E-04		
40ZR	95	2.00E-04	1.16E-07	2.55E-08	2.27E-08	0.00E+00	3.65E-08	0.00E+00	2.66E-05		
41NB	95	1.00E-04	2.25E-08	8.76E-09	6.26E-09	0.00E+00	8.23E-09	0.00E+00	1.62E-05		
42MO	99	1.60E-03	0.00E+00	1.33E-05	3.29E-06	0.00E+00	2.84E-05	0.00E+00	1.10E-05		
43TC	99M	1.70E-03	9.23E-10	1.81E-09	3.00E-08	0.00E+00	2.63E-08	9.19E-10	1.03E-06		
44RU	103	3.10E-03	7.31E-07	0.00E+00	2.81E-07	0.00E+00	1.84E-06	0.00E+00	1.89E-05		
44RU	106	3.80E-02	1.17E-05	0.00E+00	1.46E-06	0.00E+00	1.58E-05	0.00E+00	1.82E-04		



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 5 of 14

47AG 110M 6.00E-04 5.39E-07 3.64E-07 2.91E-07 0.00E+00 6.78E-07 0.00E+00 4.33E-05
52TE 129M 7.80E-05 4.87E-05 1.36E-05 7.56E-06 1.57E-05 1.43E-04 0.00E+00 5.94E-05
52TE 129 3.10E-04 1.34E-07 3.74E-08 3.18E-08 9.56E-08 3.92E-07 0.00E+00 8.34E-06
52TE 131M 2.50E-04 7.20E-06 2.49E-06 2.65E-06 5.12E-06 2.41E-05 0.00E+00 1.01E-04
52TE 131 7.60E-05 8.30E-08 2.53E-08 2.47E-08 6.35E-08 2.51E-07 0.00E+00 4.36E-07
53I 131 4.00E-04 1.72E-05 1.73E-05 9.83E-06 5.72E-03 2.84E-05 0.00E+00 1.54E-06
52TE 132 4.70E-04 1.01E-05 4.47E-06 5.40E-06 6.51E-06 4.15E-05 0.00E+00 4.50E-05
53I 132 3.10E-04 8.00E-07 1.47E-06 6.76E-07 6.82E-05 2.25E-06 0.00E+00 1.73E-06
53I 133 8.10E-04 5.92E-06 7.32E-06 2.77E-06 1.36E-03 1.22E-05 0.00E+00 2.95E-06
53I 134 8.90E-05 4.19E-07 7.78E-07 3.58E-07 1.79E-05 1.19E-06 0.00E+00 5.16E-07
55CS 134 1.00E-03 2.34E-04 3.84E-04 8.10E-05 0.00E+00 1.19E-04 4.27E-05 2.07E-06
53I 135 7.80E-04 1.75E-06 3.15E-06 1.49E-06 2.79E-04 4.83E-06 0.00E+00 2.40E-06
55CS 136 2.20E-02 2.35E-05 6.46E-05 4.18E-05 0.00E+00 3.44E-05 5.13E-06 2.27E-06
55CS 137 2.00E-03 3.27E-04 3.13E-04 4.62E-05 0.00E+00 1.02E-04 3.67E-05 1.96E-06
56BA 140 4.90E-03 8.31E-05 7.28E-08 4.85E-06 0.00E+00 2.37E-08 4.34E-08 4.21E-05
57IA 140 8.00E-03 1.01E-08 3.53E-09 1.19E-09 0.00E+00 0.00E+00 0.00E+00 9.84E-05
58CE 141 6.00E-05 3.97E-08 1.98E-08 2.94E-09 0.00E+00 8.68E-09 0.00E+00 2.47E-05
58CE 143 5.00E-04 6.99E-09 3.79E-06 5.49E-10 0.00E+00 1.59E-09 0.00E+00 5.55E-05
59PR 143 7.90E-05 3.93E-08 1.18E-08 1.95E-09 0.00E+00 6.39E-09 0.00E+00 4.24E-05
59PR 144 1.70E-03 1.29E-10 3.99E-11 6.49E-12 0.00E+00 2.11E-11 0.00E+00 8.59E-08
58CE 144 1.70E-03 2.08E-06 6.52E-07 1.11E-07 0.00E+00 3.61E-07 0.00E+00 1.70E-04

* * * INFANT DOSE FACTORS * * *

NUCLIDE	CURIE/YEAR	INGESTION DOSE FACTORS (MREM/PCI INTAKE)					SHORELINE (MREM/HR) / (PCI/M**2)			
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI	SKIN	TOTAL BODY
1H	3	1.60E+03	0.00E+00	1.76E-07	1.76E-07	1.76E-07	1.76E-07	1.76E-07	1.76E-07	
11NA	24	4.70E-03	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	
24CR	51	1.30E-03	0.00E+00	0.00E+00	1.41E-08	9.20E-09	2.01E-09	1.79E-08	4.11E-07	
25MN	54	7.00E-04	0.00E+00	1.99E-05	4.51E-06	0.00E+00	4.41E-06	0.00E+00	7.31E-06	
26FE	55	5.00E-04	1.39E-05	8.98E-06	2.40E-06	0.00E+00	0.00E+00	4.39E-06	1.14E-06	
26FE	59	1.00E-04	3.08E-05	5.38E-05	2.12E-05	0.00E+00	0.00E+00	1.59E-05	2.57E-05	
27CO	58	1.90E-03	0.00E+00	3.60E-06	8.98E-06	0.00E+00	0.00E+00	0.00E+00	8.97E-06	
30ZN	65	2.20E-04	1.84E-05	6.31E-05	2.91E-05	0.00E+00	3.06E-05	0.00E+00	5.33E-05	
74W	187	3.50E-04	9.03E-07	6.28E-07	2.17E-07	0.00E+00	0.00E+00	0.00E+00	3.69E-05	
93NP	239	5.30E-04	1.11E-08	9.93E-10	5.61E-10	0.00E+00	1.98E-09	0.00E+00	2.87E-05	
37RB	88	2.80E-02	0.00E+00	4.98E-07	2.73E-07	0.00E+00	0.00E+00	0.00E+00	4.85E-07	
38SR	89	6.00E-05	2.51E-03	0.00E+00	7.20E-05	0.00E+00	0.00E+00	0.00E+00	5.16E-05	
38SR	90	8.00E-06	2.83E-02	0.00E+00	5.74E-04	0.00E+00	0.00E+00	0.00E+00	2.31E-04	
38SR	91	6.80E-05	5.00E-05	0.00E+00	1.81E-06	0.00E+00	0.00E+00	0.00E+00	5.92E-05	
39Y	91M	4.40E-05	8.10E-10	0.00E+00	2.76E-11	0.00E+00	0.00E+00	0.00E+00	2.70E-06	
39Y	91	1.00E-05	1.13E-06	0.00E+00	3.01E-08	0.00E+00	0.00E+00	0.00E+00	8.10E-05	
39Y	93	2.90E-04	2.43E-08	0.00E+00	6.62E-10	0.00E+00	0.00E+00	0.00E+00	1.92E-04	
40ZR	95	2.00E-04	2.06E-07	5.02E-08	3.56E-08	0.00E+00	5.41E-08	0.00E+00	2.50E-05	
41NB	95	1.00E-04	4.20E-08	1.73E-08	1.00E-08	0.00E+00	1.24E-08	0.00E+00	1.46E-05	
42MO	99	1.60E-03	0.00E+00	3.40E-05	6.63E-06	0.00E+00	5.08E-05	0.00E+00	1.12E-05	



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 6 of 14

43TC 99M 1.70E-03 1.92E-09 3.96E-09 5.10E-08 0.00E+00 4.26E-08 2.07E-09 1.15E-06
 44RU 103 3.10E-03 1.48E-06 0.00E+00 4.95E-07 0.00E+00 3.08E-06 0.00E+00 1.80E-05
 44RU 106 3.80E-02 2.41E-05 0.00E+00 3.01E-06 0.00E+00 2.85E-05 0.00E+00 1.83E-04
 47AG 110M 6.00E-04 9.96E-07 7.27E-07 4.81E-07 0.00E+00 1.04E-06 0.00E+00 3.77E-05
 52TE 129M 7.80E-05 1.00E-04 3.43E-05 1.54E-05 3.84E-05 2.50E-04 0.00E+00 5.97E-05
 52TE 129 3.10E-04 2.84E-07 9.79E-08 6.63E-08 2.38E-07 7.07E-07 0.00E+00 2.27E-05
 52TE 131M 2.50E-04 1.52E-05 6.12E-06 5.05E-06 1.24E-05 4.21E-05 0.00E+00 1.03E-04
 52TE 131 7.60E-05 1.76E-07 6.50E-08 4.94E-08 1.57E-07 4.50E-07 0.00E+00 7.11E-06
 53I 131 4.00E-04 3.59E-05 4.23E-05 1.86E-05 1.39E-02 4.94E-05 0.00E+00 1.51E-06
 52TE 132 4.70E-04 2.08E-05 1.03E-05 9.61E-06 1.52E-05 6.44E-05 0.00E+00 3.81E-05
 53I 132 3.10E-04 1.66E-06 3.37E-06 1.20E-06 1.58E-04 3.76E-06 0.00E+00 2.73E-06
 53I 133 8.10E-04 1.25E-05 1.82E-05 5.33E-06 3.31E-03 2.14E-05 0.00E+00 3.08E-06
 53I 134 8.90E-05 8.69E-07 1.78E-06 6.33E-07 4.15E-05 1.99E-06 0.00E+00 1.84E-06
 55CS 134 1.00E-03 3.77E-04 7.03E-04 7.10E-05 0.00E+00 1.81E-04 7.42E-05 1.91E-06
 53I 135 7.80E-04 3.64E-06 7.24E-06 2.64E-06 6.49E-04 8.07E-06 0.00E+00 2.62E-06
 55CS 136 2.20E-02 4.59E-05 1.35E-04 5.04E-05 0.00E+00 5.38E-05 1.10E-05 2.05E-06
 55CS 137 2.00E-03 5.22E-04 6.11E-04 4.33E-05 0.00E+00 1.64E-04 6.64E-05 1.91E-06
 56BA 140 4.90E-03 1.71E-04 1.71E-07 8.81E-06 0.00E+00 4.06E-08 1.05E-07 4.20E-05
 57LA 140 8.00E-03 2.11E-08 8.32E-09 2.14E-09 0.00E+00 0.00E+00 0.00E+00 9.77E-05
 58CE 141 6.00E-05 7.87E-08 4.80E-08 5.65E-09 0.00E+00 1.48E-08 0.00E+00 2.48E-05
 58CE 143 5.00E-04 1.48E-08 9.82E-06 1.12E-09 0.00E+00 2.86E-09 0.00E+00 5.73E-05
 59PR 143 7.90E-05 8.13E-08 3.04E-08 4.03E-09 0.00E+00 1.13E-08 0.00E+00 4.29E-05
 59PR 144 1.70E-03 2.74E-10 1.06E-10 1.38E-11 0.00E+00 3.84E-11 0.00E+00 4.93E-06
 58CE 144 1.70E-03 2.98E-06 1.22E-06 1.67E-07 0.00E+00 4.93E-07 0.00E+00 1.71E-04

0TOTAL NUMBER IN SOURCE TERM IS 44 TOTAL RELEASE IS 1.6001E+03

1 * * * AS LOW AS REASONABLY ACHIEVABLE * * *

0 A D U L T D O S E S

OPATHWAY	DOSE (REM PER YEAR INTAKE)							
	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
FISH	7.86E-01	1.25E+00	8.83E-01	1.36E-01	5.15E-01	2.61E-01	1.72E-01	
DRINKING	2.40E-05	6.39E-03	6.39E-03	6.37E-03	6.38E-03	6.37E-03	6.42E-03	
SHORELINE	1.52E-03	1.30E-03	1.30E-03	1.30E-03	1.30E-03	1.30E-03	1.30E-03	
TOTAL	1.52E-03	7.87E-01	1.26E+00	8.91E-01	1.43E-01	5.22E-01	2.68E-01	1.79E-01

0 USAGE (KG/YR,HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR=.2

FISH	21.0	1.0	31.30
DRINKING	730.0	822.7	78.00
SHORELINE	12.0	1.0	7.30

0 T E E N A G E R D O S E S

OPATHWAY	DOSE (REM PER YEAR INTAKE)							
	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
FISH	8.38E-01	1.26E+00	5.22E-01	1.04E-01	4.98E-01	2.56E-01	1.32E-01	
DRINKING	2.24E-05	4.51E-03	4.50E-03	4.49E-03	4.50E-03	4.49E-03	4.52E-03	
SHORELINE	8.47E-03	7.25E-03	7.25E-03	7.25E-03	7.25E-03	7.25E-03	7.25E-03	
TOTAL	8.47E-03	8.46E-01	1.27E+00	5.34E-01	1.16E-01	5.10E-01	2.68E-01	1.44E-01

0 USAGE (KG/YR,HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR=.2



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 7 of 14

				DOSE (REM PER YEAR INTAKE)						
				TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI		
		SKIN	BONE	LIVER						
0		FISH	1.05E+00	1.13E+00	2.49E-01	8.64E-02	4.26E-01	2.08E-01	9.74E-02	
0		DRINKING	6.32E-05	8.67E-03	8.63E-03	8.62E-03	8.64E-03	8.62E-03	8.65E-03	
0		SHORELINE	1.77E-03	1.51E-03	1.51E-03	1.51E-03	1.51E-03	1.51E-03	1.51E-03	
0		TOTAL	1.77E-03	1.05E+00	1.14E+00	2.59E-01	9.65E-02	4.36E-01	2.18E-01	1.08E-01
0		USAGE (KG/YR, HR/YR)	DILUTION	TIME(HR)	SHOREWIDTH FACTOR= .2					
0		FISH	6.9	1.0	31.30					
0		DRINKING	510.0	822.7	78.00					
0		SHORELINE	14.0	1.0	7.30					
0		I N F A N T D O S E S		DOSE (REM PER YEAR INTAKE)						
0		OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
0		FISH	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
0		DRINKING	6.16E-05	8.52E-03	8.47E-03	8.46E-03	8.48E-03	8.47E-03	8.48E-03	8.48E-03
0		SHORELINE	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
0		TOTAL	0.00E+00	6.16E-05	8.52E-03	8.47E-03	8.46E-03	8.48E-03	8.47E-03	8.48E-03
0		USAGE (KG/YR, HR/YR)	DILUTION	TIME(HR)	SHOREWIDTH FACTOR= .2					
0		FISH	.0	1.0	31.30					
0		DRINKING	330.0	822.7	78.00					
1		*	*	*	SELECTED LOCATION	*	*	*		
0		OLOCATION IS SCR Employee Use	A D U L T D O S E S		DOSE (REM PER YEAR INTAKE)					
0		OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
0		FISH	7.86E-01	1.25E+00	8.83E-01	1.36E-01	5.15E-01	2.61E-01	1.72E-01	
0		DRINKING	1.98E-02	5.26E+00	5.26E+00	5.24E+00	5.25E+00	5.24E+00	5.28E+00	
0		SHORELINE	2.27E-03	1.95E-03	1.95E-03	1.95E-03	1.95E-03	1.95E-03	1.95E-03	
0		TOTAL	2.27E-03	8.08E-01	6.52E+00	6.14E+00	5.38E+00	5.77E+00	5.51E+00	5.46E+00
0		USAGE (KG/YR, HR/YR)	DILUTION	TIME(HR)	SHOREWIDTH FACTOR= .3					
0		FISH	21.0	1.0	24.00					
0		DRINKING	730.0	1.0	12.00					
0		SHORELINE	12.0	1.0	.00					
0		OLOCATION IS SCR Employee Use	T E E N A G E R D O S E S		DOSE (REM PER YEAR INTAKE)					
0		OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
0		FISH	8.38E-01	1.26E+00	5.22E-01	1.04E-01	4.98E-01	2.56E-01	1.32E-01	
0		DRINKING	1.85E-02	3.71E+00	3.70E+00	3.69E+00	3.70E+00	3.70E+00	3.72E+00	
0		SHORELINE	1.27E-02	1.09E-02	1.09E-02	1.09E-02	1.09E-02	1.09E-02	1.09E-02	
0		TOTAL	1.27E-02	8.68E-01	4.99E+00	4.23E+00	3.81E+00	4.21E+00	3.96E+00	3.87E+00



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 8 of 14

0 USAGE (KG/YR, HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	16.0	1.0	24.00
DRINKING	510.0	1.0	12.00
SHORELINE	67.0	1.0	.00

LOCATION IS SCR Employee Use

0 C H I L D D O S E S

OPATHWAY	SKIN	DOSE (REM PER YEAR INTAKE)					
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH	1.05E+00	1.13E+00	2.49E-01	8.64E-02	4.26E-01	2.08E-01	9.74E-02
DRINKING	5.20E-02	7.13E+00	7.10E+00	7.09E+00	7.11E+00	7.10E+00	7.12E+00
SHORELINE	2.65E-03	2.27E-03	2.27E-03	2.27E-03	2.27E-03	2.27E-03	2.27E-03
TOTAL	2.65E-03	1.11E+00	8.26E+00	7.35E+00	7.18E+00	7.54E+00	7.22E+00

0 USAGE (KG/YR, HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	6.9	1.0	24.00
DRINKING	510.0	1.0	12.00
SHORELINE	14.0	1.0	.00

LOCATION IS SCR Employee Use

0 I N F A N T D O S E S

OPATHWAY	SKIN	DOSE (REM PER YEAR INTAKE)					
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
DRINKING	5.07E-02	7.01E+00	6.97E+00	6.96E+00	6.98E+00	6.97E+00	6.98E+00
SHORELINE	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
TOTAL	0.00E+00	5.07E-02	7.01E+00	6.97E+00	6.96E+00	6.98E+00	6.98E+00

0 USAGE (KG/YR, HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	.0	1.0	24.00
DRINKING	330.0	1.0	12.00

1 * * * FISH CONSUMPTION POPULATION DOSES * * *

PERSON-REM

0 SPORT HARVEST

0 -----DOSE (PERSON-REM)-----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LI
FISH	ADULT	2.71E+05	1.23E-02	1.96E-02	1.38E-02	2.13E-03	8.04E-03	4.08E-03	2.68E-03
FISH	TEENAGER	3.16E+04	2.01E-03	3.03E-03	1.25E-03	2.50E-04	1.19E-03	6.14E-04	3.15E-04
FISH	CHILD	2.19E+04	4.05E-03	4.34E-03	9.53E-04	3.33E-04	1.64E-03	8.00E-04	3.74E-04
FISH	TOTAL	3.24E+05	1.84E-02	2.69E-02	1.60E-02	2.71E-03	1.09E-02	5.49E-03	3.36E-03

0 LOCATION DILUTION CATCH TIME(HR)-INCLUDES FOOD PROCESSING TIME OF 1.68E+02 HR POPULATION=5.53E+04

Sport Fish Above W 8.23E+02 3.24E+05 2.34E+02

0 AVERAGE INDIVIDUAL CONSUMPTION (KG/YR) ADULT=6.90E+00 TEEN=5.20E+00 CHILD=2.20E+00

1 * * * POPULATION WATER CONSUMPTION DOSES * * *

0

0 SUPPLIER-City of Whitney

0 -----DOSE (PERSON-REM)-----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LI
DRINKING	ADULT	9.78E+05	1.61E-05	4.28E-03	4.28E-03	4.27E-03	4.27E-03	4.27E-03	4.30E-03



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 9 of 14

DRINKING TEENAGER	1.06E+05	2.34E-06	4.71E-04	4.69E-04	4.68E-04	4.69E-04	4.69E-04	4.72E-04
DRINKING CHILD	1.74E+05	1.08E-05	1.48E-03	1.47E-03	1.47E-03	1.47E-03	1.47E-03	1.48E-03
DRINKING TOTAL	1.26E+06	2.92E-05	6.23E-03	6.22E-03	6.21E-03	6.22E-03	6.21E-03	6.25E-03
OPOPULATION=3.72E+03	DILUTION=1.65E+03	TRANSIT TIME=1.01E+02 HR (INCLUDING 24 HR FOR TREATMENT FACILITY)						
0AVERAGE INDIVIDUAL CONSUMPTION (L/YR)	ADULT=3.70E+02	TEEN=2.60E+02	CHILD=2.60E+02					

0

0SUPPLIER-City of Cleburne

0

-----DOSE (PERSON-REM)-----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
DRINKING	ADULT	1.40E+07	4.61E-04	1.23E-01	1.23E-01	1.22E-01	1.23E-01	1.23E-01	1.23E-01
DRINKING	TEENAGER	1.53E+06	6.72E-05	1.35E-02	1.35E-02	1.34E-02	1.35E-02	1.35E-02	1.36E-02
DRINKING	CHILD	2.50E+06	3.10E-04	4.25E-02	4.23E-02	4.23E-02	4.23E-02	4.23E-02	4.24E-02
DRINKING	TOTAL	1.81E+07	8.38E-04	1.79E-01	1.79E-01	1.78E-01	1.78E-01	1.78E-01	1.79E-01
OPOPULATION=5.34E+04	DILUTION=8.23E+02	TRANSIT TIME=9.00E+01 HR (INCLUDING 24 HR FOR TREATMENT FACILITY)							
0AVERAGE INDIVIDUAL CONSUMPTION (L/YR)	ADULT=3.70E+02	TEEN=2.60E+02	CHILD=2.60E+02						

0----CUMULATIVE TOTAL----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
DRINKING	CUMUL TOTAL	1.93E+07	8.67E-04	1.85E-01	1.85E-01	1.84E-01	1.85E-01	1.84E-01	1.86E-01

0

0HYDROSPHERE TRITIUM DOSE

0AVERAGE INDIVIDUAL WATER CONSUMPTION = 3.0 L/DAY

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
WATER	TOTAL	2.86E+11	0.00E+00	1.47E-02	1.47E-02	1.47E-02	1.47E-02	1.47E-02	1.47E-02
1		*	*	*	RECREATION POPULATION DOSES	*	*	*	*

0

0LOCATION- Shore W R

0DILUTION= 1.65E+03 TRANSIT TIME= 7.70E+01 HR SWF= .3

0

DOSE (PERSON-REM)

OPATHWAY	AGE GROUP	USAGE	SKIN	TOTAL BODY	THYROID
SHORELINE	TOTAL POPUL	2.24E+07	2.57E-03	2.20E-03	2.20E-03

0

0LOCATION- Swim W R

0DILUTION= 1.65E+03 TRANSIT TIME= 7.70E+01 HR

0

DOSE (PERSON-REM)

OPATHWAY	AGE GROUP	USAGE	SKIN	TOTAL BODY	THYROID
SWIMMING	TOTAL POPUL	2.24E+07		5.97E-06	5.97E-06

0

0LOCATION- Boat W R

0DILUTION= 1.65E+03 TRANSIT TIME= 7.70E+01 HR

0

DOSE (PERSON-REM)

OPATHWAY	AGE GROUP	USAGE	SKIN	TOTAL BODY	THYROID
BOATING	TOTAL POPUL	2.24E+07		2.98E-06	2.98E-06
1		*	*	*	IRRIGATED FOOD PATHWAY *

LEAFY VEGE

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 9.88E+02



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 10 of 14

TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 9.88E+02

	INDIVIDUAL DOSES (REM PER YEAR INTAKE)						
	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.44E-05	5.72E-04	5.68E-04	5.58E-04	5.64E-04	5.60E-04	5.85E-04
TEENAGER	1.26E-05	3.82E-04	3.74E-04	3.70E-04	3.74E-04	3.71E-04	3.88E-04
CHILD	2.19E-05	4.55E-04	4.42E-04	4.39E-04	4.45E-04	4.41E-04	4.50E-04

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 8.23E+02 AND TRANSIT TIME= 6.60E+01 HRS.

0* * * NEPA DOSES * * * POPULATION DOSES (PERSON-REM)

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	4.74E-06	1.88E-04	1.87E-04	1.84E-04	1.85E-04	1.84E-04	1.92E-04
TEENAGER	6.53E-07	1.98E-05	1.94E-05	1.91E-05	1.94E-05	1.92E-05	2.01E-05
CHILD	1.50E-06	3.11E-05	3.02E-05	3.01E-05	3.05E-05	3.02E-05	3.08E-05
TOTAL	6.89E-06	2.39E-04	2.36E-04	2.33E-04	2.35E-04	2.34E-04	2.43E-04

0\$ \$ \$ ALARA DOSES \$ \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	4.74E-06	1.88E-04	1.87E-04	1.84E-04	1.85E-04	1.84E-04	1.92E-04
TEENAGER	6.53E-07	1.98E-05	1.94E-05	1.91E-05	1.94E-05	1.92E-05	2.01E-05
CHILD	1.50E-06	3.11E-05	3.02E-05	3.01E-05	3.05E-05	3.02E-05	3.08E-05
TOTAL	6.89E-06	2.39E-04	2.36E-04	2.33E-04	2.35E-04	2.34E-04	2.43E-04

0IRRRI FOOD IRRIGATION RATE= 7.46E+01 L/M**2/MON

NON-IRRIGATED FEED FRACTION= 0.00E+00

WATER FRACTION NOT VIA IRRIGATION= 0.00E+00

TOTAL 50 MILE GROW= 2.50E+04 KG/YR

TOTAL CROP IRRIGATION= 2.50E+04

CROP GROWING PERIOD= 6.00E+01 DAYS

CROP YIELD= 2.00E+00 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME
Leafy Above W R	8.23E+02	2.50E+04	6.60E+01

0INDIVIDUAL CONSUMPTION RATES ADULT=6.40E+01 KG TEEN=4.20E+01 CHILD=2.60E+01 FOOD PROCESS TIME=2.40E+01 HR

POPULATION CONSUMPTION RATES ADULT=3.00E+01 KG TEEN=2.00E+01 CHILD=1.00E+01 FOOD PROCESS TIME=4.80E+01 HR

1* * * * IRRIGATED FOOD PATHWAY * * * *

VEGETATION

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 2.67E+04

TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 2.67E+04

	INDIVIDUAL DOSES (REM PER YEAR INTAKE)						
	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.17E-04	4.64E-03	4.60E-03	4.53E-03	4.57E-03	4.54E-03	4.74E-03
TEENAGER	1.89E-04	5.72E-03	5.60E-03	5.53E-03	5.60E-03	5.56E-03	5.80E-03
CHILD	4.38E-04	9.09E-03	8.82E-03	8.77E-03	8.89E-03	8.81E-03	8.99E-03

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 8.23E+02 AND TRANSIT TIME= 6.60E+01 HRS.

0* * * NEPA DOSES * * * POPULATION DOSES (PERSON-REM)

0 BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 11 of 14

ADULT	8.03E-04	3.19E-02	3.17E-02	3.12E-02	3.15E-02	3.12E-02	3.25E-02
TEENAGER	2.10E-04	6.35E-03	6.22E-03	6.15E-03	6.23E-03	6.18E-03	6.43E-03
CHILD	8.03E-04	1.67E-02	1.62E-02	1.61E-02	1.63E-02	1.62E-02	1.65E-02
TOTAL	1.82E-03	5.50E-02	5.41E-02	5.34E-02	5.40E-02	5.36E-02	5.54E-02

0\$ \$ \$ ALARA DOSES \$ \$ \$

BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI	
ADULT	8.03E-04	3.19E-02	3.17E-02	3.12E-02	3.15E-02	3.12E-02	3.25E-02
TEENAGER	2.10E-04	6.35E-03	6.22E-03	6.15E-03	6.23E-03	6.18E-03	6.43E-03
CHILD	8.03E-04	1.67E-02	1.62E-02	1.61E-02	1.63E-02	1.62E-02	1.65E-02
TOTAL	1.82E-03	5.50E-02	5.41E-02	5.34E-02	5.40E-02	5.36E-02	5.54E-02

OIRR FOOD

IRRIGATION RATE= 7.46E+01 L/M**2/MON

NON-IRRIGATED FEED FRACTION= 0.00E+00

WATER FRACTION NOT VIA IRRIGATION= 0.00E+00

TOTAL 50 MILE GROW= 5.27E+06 KG/YR

TOTAL CROP IRRIGATION= 5.27E+06

CROP GROWING PERIOD= 6.00E+01 DAYS

CROP YIELD= 2.00E+00 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME
Veg Above W R	8.23E+02	5.27E+06	6.60E+01

0INDIVIDUAL CONSUMPTION RATES	ADULT=5.20E+02 KG	TEEN=6.30E+02	CHILD=5.20E+02	FOOD PROCESS TIME=3.36E+02 HR
POPULATION CONSUMPTION RATES	ADULT=1.90E+02 KG	TEEN=2.40E+02	CHILD=2.00E+02	FOOD PROCESS TIME=1.44E+03 HR

1	*	*	*	IRRIGATED FOOD PATHWAY	*	*	*
---	---	---	---	------------------------	---	---	---

MILK

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 7.21E+03

TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 7.21E+03

INDIVIDUAL DOSES (REM PER YEAR INTAKE)							
0	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	6.84E-05	2.80E-03	2.77E-03	2.71E-03	2.74E-03	2.72E-03	2.71E-03
TEENAGER	1.23E-04	3.69E-03	3.58E-03	3.52E-03	3.58E-03	3.54E-03	3.53E-03
CHILD	2.95E-04	5.86E-03	5.62E-03	5.58E-03	5.67E-03	5.61E-03	5.58E-03

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 8.23E+02 AND TRANSIT TIME= 6.60E+01 HRS.

POPULATION DOSES (PERSON-REM)						
-------------------------------	--	--	--	--	--	--

0* * * NEPA DOSES * * *

0	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.24E-04	5.09E-03	5.03E-03	4.92E-03	4.98E-03	4.94E-03	4.93E-03
TEENAGER	4.88E-05	1.46E-03	1.42E-03	1.40E-03	1.42E-03	1.41E-03	1.40E-03
CHILD	1.97E-04	3.92E-03	3.76E-03	3.73E-03	3.79E-03	3.75E-03	3.73E-03
TOTAL	3.70E-04	1.05E-02	1.02E-02	1.00E-02	1.02E-02	1.01E-02	1.01E-02

0\$ \$ \$ ALARA DOSES \$ \$ \$

0	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.24E-04	5.09E-03	5.03E-03	4.92E-03	4.98E-03	4.94E-03	4.93E-03
TEENAGER	4.88E-05	1.46E-03	1.42E-03	1.40E-03	1.42E-03	1.41E-03	1.40E-03
CHILD	1.97E-04	3.92E-03	3.76E-03	3.73E-03	3.79E-03	3.75E-03	3.73E-03
TOTAL	3.70E-04	1.05E-02	1.02E-02	1.00E-02	1.02E-02	1.01E-02	1.01E-02



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 12 of 14

OIRRI FOOD
 IRRIGATION RATE= 7.46E+01 L/M**2/MON
 NON-IRRIGATED FEED FRACTION= 0.00E+00
 WATER FRACTION NOT VIA IRRIGATION= 0.00E+00
 TOTAL 50 MILE GROW= 9.43E+05 KG/YR
 TOTAL CROP IRRIGATION= 9.43E+05
 CROP GROWING PERIOD= 3.00E+01 DAYS
 CROP YIELD= 7.00E-01 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME			
Milk Above W R	8.23E+02	9.43E+05	6.60E+01			
0 INDIVIDUAL CONSUMPTION RATES	ADULT=3.10E+02	KG	TEEN=4.00E+02	CHILD=3.30E+02	FOOD PROCESS	TIME=4.80E+01 HR
POPULATION CONSUMPTION RATES	ADULT=1.10E+02	KG	TEEN=2.00E+02	CHILD=1.70E+02	FOOD PROCESS	TIME=9.60E+01 HR

1 * * * * IRRIGATED FOOD PATHWAY * * *

MEAT

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 3.49E+03
 TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 3.49E+03

INDIVIDUAL DOSES (REM PER YEAR INTAKE)							
	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	4.04E-05	9.71E-04	9.71E-04	9.60E-04	1.03E-03	9.61E-04	3.04E-03
TEENAGER	3.39E-05	5.81E-04	5.79E-04	5.72E-04	6.27E-04	5.73E-04	1.87E-03
CHILD	6.34E-05	7.05E-04	7.01E-04	6.93E-04	7.65E-04	6.94E-04	1.48E-03

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 8.23E+02 AND TRANSIT TIME= 6.60E+01 HRS.

0 POPULATION DOSES (PERSON-REM) _____

0 * * * NEPA DOSES * * *	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	8.64E-05	2.08E-03	2.08E-03	2.05E-03	2.19E-03	2.05E-03	6.49E-03
TEENAGER	1.18E-05	2.02E-04	2.01E-04	1.99E-04	2.18E-04	2.00E-04	6.50E-04
CHILD	3.59E-05	3.99E-04	3.97E-04	3.92E-04	4.33E-04	3.93E-04	8.41E-04
TOTAL	1.34E-04	2.68E-03	2.68E-03	2.64E-03	2.84E-03	2.65E-03	7.98E-03

0\$ \$ \$ ALARA DOSES \$ \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	8.64E-05	2.08E-03	2.08E-03	2.05E-03	2.19E-03	2.05E-03	6.49E-03
TEENAGER	1.18E-05	2.02E-04	2.01E-04	1.99E-04	2.18E-04	2.00E-04	6.50E-04
CHILD	3.59E-05	3.99E-04	3.97E-04	3.92E-04	4.33E-04	3.93E-04	8.41E-04
TOTAL	1.34E-04	2.68E-03	2.68E-03	2.64E-03	2.84E-03	2.65E-03	7.98E-03

OIRRI FOOD
 IRRIGATION RATE= 7.46E+01 L/M**2/MON
 NON-IRRIGATED FEED FRACTION= 0.00E+00
 WATER FRACTION NOT VIA IRRIGATION= 0.00E+00
 TOTAL 50 MILE GROW= 2.81E+05 KG/YR
 TOTAL CROP IRRIGATION= 2.81E+05
 CROP GROWING PERIOD= 3.00E+01 DAYS
 CROP YIELD= 7.00E-01 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME			
Meat Above W R	8.23E+02	2.81E+05	6.60E+01			



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 13 of 14

0 INDIVIDUAL CONSUMPTION RATES ADULT=1.10E+02 KG TEEN=6.50E+01 CHILD=4.10E+01
 POPULATION CONSUMPTION RATES ADULT=9.50E+01 KG TEEN=5.90E+01 CHILD=3.70E+01
 FOOD PROCESS TIME=4.80E+02 HR
 FOOD PROCESS TIME=4.80E+02 HR

1* * * DOSE TO BIOTA * * *
 0 MRADS PER YEAR
 0

Biota	DILUTION=	1.00E+00	TRANSIT TIME=	0.00E+00 HR
	INTERNAL	EXTERNAL	TOTAL	
FISH	4.55E+00	4.74E+00	9.29E+00	
INVERTEBRATE	6.44E+00	9.48E+00	1.59E+01	
ALGAE	2.04E+01	3.91E-03	2.04E+01	
MUSKRAT	3.05E+01	3.16E+00	3.36E+01	
RACCOON	7.79E+00	2.37E+00	1.02E+01	
HERON	9.87E+01	3.16E+00	1.02E+02	
DUCK	2.92E+01	4.74E+00	3.39E+01	

1 * * * COST-BENEFIT ANALYSIS * * *

0 NUCLIDE	RELEASE	PERSON-REM DOSE		PERSON-REM PER CURIE	
		! CI/YR	! TOTAL BODY ! THYROID	! TOTAL BODY ! THYROID	!
1H 3	! 1.60E+03 !	2.53E-01 !	2.53E-01 !	1.58E-04 !	1.58E-04 !
11NA 24	! 4.70E-03 !	3.65E-10 !	3.65E-10 !	7.76E-08 !	7.76E-08 !
24CR 51	! 1.30E-03 !	2.84E-09 !	2.74E-09 !	2.18E-06 !	2.11E-06 !
25MN 54	! 7.00E-04 !	4.75E-06 !	3.66E-06 !	6.79E-03 !	5.23E-03 !
26FE 55	! 5.00E-04 !	7.41E-07 !	1.38E-11 !	1.48E-03 !	2.76E-08 !
26FE 59	! 1.00E-04 !	5.46E-08 !	1.78E-08 !	5.46E-04 !	1.78E-04 !
27CO 58	! 1.90E-03 !	1.09E-06 !	6.91E-07 !	5.76E-04 !	3.64E-04 !
30ZN 65	! 2.20E-04 !	9.20E-06 !	4.91E-07 !	4.18E-02 !	2.23E-03 !
74W 187	! 3.50E-04 !	1.58E-11 !	1.51E-11 !	4.51E-08 !	4.31E-08 !
93NP 239	! 5.30E-04 !	6.27E-11 !	6.26E-11 !	1.18E-07 !	1.18E-07 !
37RB 88	! 2.80E-02 !	0.00E+00 !	0.00E+00 !	0.00E+00 !	0.00E+00 !
38SR 89	! 6.00E-05 !	4.02E-08 !	6.74E-12 !	6.71E-04 !	1.12E-07 !
38SR 90	! 8.00E-06 !	1.64E-05 !	9.52E-12 !	2.05E+00 !	1.19E-06 !
38SR 91	! 6.80E-05 !	9.15E-14 !	8.54E-14 !	1.35E-09 !	1.26E-09 !
39Y 91M	! 4.40E-05 !	1.60E-43 !	1.60E-43 !	3.63E-39 !	3.63E-39 !
39Y 91	! 1.00E-05 !	1.22E-11 !	8.84E-12 !	1.22E-06 !	8.84E-07 !
39Y 93	! 2.90E-04 !	5.38E-14 !	5.37E-14 !	1.85E-10 !	1.85E-10 !
40ZR 95	! 2.00E-04 !	4.43E-08 !	4.42E-08 !	2.22E-04 !	2.21E-04 !
41NB 95	! 1.00E-04 !	9.13E-09 !	7.43E-09 !	9.13E-05 !	7.43E-05 !
42MO 99	! 1.60E-03 !	1.61E-09 !	5.07E-10 !	1.00E-06 !	3.17E-07 !
43TC 99M	! 1.70E-03 !	6.69E-15 !	6.61E-15 !	3.94E-12 !	3.89E-12 !
44RU 103	! 3.10E-03 !	2.19E-07 !	1.93E-07 !	7.06E-05 !	6.23E-05 !
44RU 106	! 3.80E-02 !	9.44E-05 !	7.08E-05 !	2.48E-03 !	1.86E-03 !
47AG 110M	! 6.00E-04 !	6.40E-06 !	6.35E-06 !	1.07E-02 !	1.06E-02 !
52TE 129M	! 7.80E-05 !	2.42E-08 !	5.06E-08 !	3.10E-04 !	6.49E-04 !
52TE 129	! 3.10E-04 !	4.81E-35 !	4.81E-35 !	1.55E-31 !	1.55E-31 !
52TE 131M	! 2.50E-04 !	8.10E-11 !	1.02E-10 !	3.24E-07 !	4.10E-07 !
52TE 131	! 7.60E-05 !	0.00E+00 !	0.00E+00 !	0.00E+00 !	0.00E+00 !



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 1

REV. 0

PAGE NO. 14 of 14

53I	131	!	4.00E-04	!	7.77E-09	!	3.67E-06	!	1.94E-05	!	9.19E-03	!
52TE	132	!	4.70E-04	!	2.16E-09	!	2.52E-09	!	4.60E-06	!	5.35E-06	!
53I	132	!	3.10E-04	!	3.66E-23	!	3.66E-23	!	1.18E-19	!	1.18E-19	!
53I	133	!	8.10E-04	!	4.36E-11	!	9.00E-09	!	5.38E-08	!	1.11E-05	!
53I	134	!	8.90E-05	!	5.59E-41	!	5.59E-41	!	6.28E-37	!	6.28E-37	!
55CS	134	!	1.00E-03	!	1.65E-03	!	6.03E-05	!	1.65E+00	!	6.03E-02	!
53I	135	!	7.80E-04	!	1.04E-13	!	9.74E-13	!	1.34E-10	!	1.25E-09	!
55CS	136	!	2.20E-02	!	6.59E-05	!	8.82E-07	!	3.00E-03	!	4.01E-05	!
55CS	137	!	2.00E-03	!	1.49E-02	!	2.07E-03	!	7.47E+00	!	1.03E+00	!
56BA	140	!	4.90E-03	!	7.71E-08	!	2.44E-08	!	1.57E-05	!	4.98E-06	!
57IA	140	!	8.00E-03	!	7.41E-09	!	7.41E-09	!	9.27E-07	!	9.27E-07	!
58CE	141	!	6.00E-05	!	4.01E-10	!	4.00E-10	!	6.68E-06	!	6.66E-06	!
58CE	143	!	5.00E-04	!	3.93E-11	!	3.93E-11	!	7.85E-08	!	7.85E-08	!
59PR	143	!	7.90E-05	!	1.06E-12	!	6.58E-13	!	1.34E-08	!	8.33E-09	!
59PR	144	!	1.70E-03	!	0.00E+00	!	0.00E+00	!	0.00E+00	!	0.00E+00	!
58CE	144	!	1.70E-03	!	4.33E-07	!	4.09E-07	!	2.55E-04	!	2.41E-04	!
0	TOTAL				2.70E-01		2.56E-01					
1												

0

1



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 1 of 14

Appendix 2
Case 2 - CPNPP Unit 3 or 4 Population Dose LADTAP II Output File

```
*****
*   L      AAA    DDDD   TTTTT   AAA    PPPP    II IIII IIIII
*   L      A      A      D      D      T      A      A      P      P      I      I
*   L      A      A      D      D      T      A      A      P      P      I      I
*   L      AAAAA  D      D      T      AAAAA  PPPP    I      I
*   L      A      A      D      D      T      A      A      P      I      I
*   LLLLLL A      A      DDDD   T      A      A      P      II IIII IIIII
*****
*   *
*   *
*   *
*   EVALUATION OF RADIATION DOSES FROM RELEASES OF RADIACTIVITY
*   IN NUCLEAR POWER PLANTS LIQUID EFFLUENTS
*   REVISION DATE: JSB PC - February 1996
*   CPNPP Unit 3 or 4 Case 2 Liquid Effluent Population Dose
*
*
*
*   RADIOLOGICAL ASSESSMENT BRANCH
*   DIVISION OF SYSTEMS INTEGRATION
*   U. S. NUCLEAR REGULATORY COMMISSION
*   WASHINGTON, D. C.
*   DATE OF RUN: 08-May-2008
*****
*
```



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 2 of 14

```

0   1* ARRAY      16 ENTRIES READ
0   OT
1
CPNPP Unit 3 or 4 Case 2 Liquid Effluent Population Dose
0  DISCHARGE=5.51E+02 CFS          SOURCE TERM MULTIPLIER=1.00E+00
0  50-MILE POPULATION=3.49E+06    FRACTION ---  ADULT=.71
                                         TEENAGER=.11
                                         CHILD=.18
0  FRESHWATER SITE
1
US APWR Liquid Releases DCD Table 11-2-10 w/o Det Waste
COMPLETELY MIXED MODEL-- POND BLOWDOWN (CFS) - 4.54E+01      POND VOLUME (CF) - 6.30E+09
0               * * * ADULT DOSE FACTORS * * *
0
          INGESTION DOSE FACTORS _____ SHORELINE _____
          (MREM/PCI INTAKE)          (MREM/HR) / (PCI/M**2)
NUCLIDE CURIE/YEAR BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI SKIN TOTAL BODY RECON
  1H     3  1.60E+03 0.00E+00 5.99E-08 5.99E-08 5.99E-08 5.99E-08 5.99E-08 0.00E+00 0.00E+00 9.74E+00
  11NA   24  4.70E-03 1.70E-06 1.70E-06 1.70E-06 1.70E-06 1.70E-06 1.70E-06 2.90E-08 2.50E-08 6.83E-03
  24CR   51  1.30E-03 0.00E+00 2.66E-09 1.59E-09 5.86E-10 3.53E-09 6.69E-07 2.60E-10 2.20E-10 2.94E-01
  25MN   54  7.00E-04 0.00E+00 4.57E-06 8.72E-07 0.00E+00 1.36E-06 0.00E+00 1.40E-05 6.80E-09 5.80E-09 2.66E+00
  26FE   55  5.00E-04 2.75E-06 1.90E-06 4.43E-07 0.00E+00 0.00E+00 1.06E-06 1.09E-06 0.00E+00 0.00E+00 5.70E+00
  26FE   59  1.00E-04 4.34E-06 1.02E-05 3.91E-06 0.00E+00 0.00E+00 2.85E-06 3.40E-05 9.40E-09 8.00E-09 4.68E-01
  27CO   58  1.90E-03 0.00E+00 7.45E-07 1.67E-06 0.00E+00 0.00E+00 0.00E+00 1.51E-05 8.20E-09 7.00E-09 7.28E-01
  30ZN   65  2.20E-04 4.84E-06 1.54E-05 6.96E-06 0.00E+00 1.03E-05 0.00E+00 9.70E-06 4.60E-09 4.00E-09 2.18E+00
  74W    187 3.50E-04 1.03E-07 8.61E-08 3.01E-08 0.00E+00 0.00E+00 0.00E+00 2.82E-05 3.60E-09 3.10E-09 1.09E-02
  93NP   239 5.30E-04 1.19E-09 1.17E-10 6.45E-11 0.00E+00 3.65E-10 0.00E+00 2.40E-05 1.10E-09 9.50E-10 2.57E-02
  37RB   88  2.80E-02 0.00E+00 6.05E-08 3.21E-08 0.00E+00 0.00E+00 0.00E+00 8.36E-19 4.00E-09 3.50E-09 1.35E-04
  38SR   89  6.00E-05 3.08E-04 0.00E+00 8.84E-06 0.00E+00 0.00E+00 0.00E+00 4.94E-05 6.50E-13 5.60E-13 5.27E-01
  38SR   90  8.00E-06 8.71E-03 0.00E+00 1.75E-04 0.00E+00 0.00E+00 0.00E+00 2.19E-04 0.00E+00 0.00E+00 1.10E+01
  38SR   91  6.80E-05 5.67E-06 0.00E+00 2.29E-07 0.00E+00 0.00E+00 0.00E+00 2.70E-05 8.30E-09 7.10E-09 4.31E-03
  39Y    91M  4.40E-05 9.09E-11 0.00E+00 3.52E-12 0.00E+00 0.00E+00 0.00E+00 2.67E-10 4.40E-09 3.80E-09 3.76E-04
  39Y    91   1.00E-05 1.41E-07 0.00E+00 3.77E-09 0.00E+00 0.00E+00 0.00E+00 7.76E-05 2.70E-11 2.40E-11 6.07E-01
  39Y    93   2.90E-04 2.68E-09 0.00E+00 7.40E-11 0.00E+00 0.00E+00 0.00E+00 8.50E-05 7.80E-10 5.70E-10 4.58E-03
  40ZR   95   2.00E-03 3.04E-08 9.75E-09 6.60E-09 0.00E+00 1.53E-08 0.00E+00 3.09E-05 5.80E-09 5.00E-09 6.62E-01
  41NB   95   1.00E-04 6.22E-09 3.46E-09 1.86E-09 0.00E+00 3.42E-09 0.00E+00 2.10E-05 6.00E-09 5.10E-09 3.72E-01
  42MO   99   1.60E-03 0.00E+00 4.31E-06 8.20E-07 0.00E+00 9.76E-06 0.00E+00 9.99E-06 2.20E-09 1.90E-09 2.99E-02
  43TC   99M   1.70E-03 2.47E-10 6.98E-10 8.89E-09 0.00E+00 1.06E-08 3.42E-10 4.13E-07 1.10E-09 9.60E-10 2.73E-03
  44RU  103   3.10E-03 1.85E-07 0.00E+00 7.97E-08 0.00E+00 7.06E-07 0.00E+00 2.16E-05 4.20E-09 3.60E-09 4.14E-01
  44RU  106   3.80E-02 2.75E-06 0.00E+00 3.48E-07 0.00E+00 5.31E-06 0.00E+00 1.78E-04 1.80E-09 1.50E-09 3.02E+00
  47AG  110M   6.00E-04 1.60E-07 1.48E-07 8.79E-08 0.00E+00 2.91E-07 0.00E+00 6.04E-05 2.10E-08 1.80E-08 2.23E+00
  52TE  129M   7.80E-05 1.15E-05 4.29E-06 1.82E-06 3.95E-06 4.80E-05 0.00E+00 5.79E-05 9.00E-10 7.70E-10 3.55E-01
  52TE  129   3.10E-04 3.14E-08 1.18E-08 7.65E-09 2.41E-08 1.32E-07 0.00E+00 2.37E-08 8.40E-10 7.10E-10 5.27E-04
  52TE  131M   2.50E-04 1.73E-06 8.46E-07 7.05E-07 1.34E-06 8.57E-06 0.00E+00 8.40E-05 9.90E-09 8.40E-09 1.36E-02
  52TE  131   7.60E-05 1.97E-08 8.23E-09 6.22E-09 1.62E-08 8.63E-08 0.00E+00 2.79E-09 2.60E-06 2.20E-09 1.90E-04
  53I   131   4.00E-04 4.16E-06 5.95E-06 3.41E-06 1.95E-03 1.02E-05 0.00E+00 1.57E-06 3.40E-09 2.80E-09 8.71E-02

```



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0**PAGE NO.** 3 of 14

```

52TE 132 4.70E-04 2.52E-06 1.63E-06 1.53E-06 1.80E-06 1.57E-05 0.00E+00 7.71E-05 2.00E-09 1.70E-09 3.55E-02
53I 132 3.10E-04 2.03E-07 5.43E-07 1.90E-07 1.90E-05 8.65E-07 0.00E+00 1.02E-07 2.00E-08 1.70E-08 1.05E-03
53I 133 8.10E-04 1.42E-06 2.47E-06 7.53E-07 3.63E-04 4.31E-06 0.00E+00 2.22E-06 4.50E-09 3.70E-09 9.45E-03
53I 134 8.90E-05 1.06E-07 2.88E-07 1.03E-07 4.99E-06 4.58E-07 0.00E+00 2.51E-10 1.90E-08 1.60E-08 3.98E-04
55CS 134 1.00E-03 6.22E-05 1.48E-04 1.21E-04 0.00E+00 4.79E-05 1.59E-05 2.59E-06 1.40E-08 1.20E-08 4.89E+00
53I 135 7.80E-04 4.43E-07 1.16E-06 4.28E-07 7.65E-05 1.86E-06 0.00E+00 1.31E-06 1.40E-08 1.20E-08 3.00E-03
55CS 136 2.20E-02 6.51E-06 2.57E-05 1.85E-05 0.00E+00 1.43E-05 1.96E-06 2.92E-06 1.70E-08 1.50E-08 1.41E-01
55CS 137 2.00E-03 7.97E-05 1.09E-04 7.14E-05 0.00E+00 3.70E-05 1.23E-05 2.11E-06 4.90E-09 4.20E-09 1.10E+01
56BA 140 4.90E-03 2.03E-05 2.55E-08 1.33E-06 0.00E+00 8.67E-09 1.46E-08 4.18E-05 2.40E-09 2.10E-09 1.38E-01
57LA 140 8.00E-03 2.50E-09 1.26E-09 3.33E-10 0.00E+00 0.00E+00 9.25E-05 1.70E-08 1.50E-08 1.83E-02
58CE 141 6.00E-05 9.36E-09 6.33E-09 7.18E-10 0.00E+00 2.94E-09 0.00E+00 2.42E-05 6.20E-10 5.50E-10 3.44E-01
58CE 143 5.00E-04 1.65E-09 1.22E-06 1.35E-10 0.00E+00 5.37E-10 0.00E+00 4.56E-05 2.50E-09 2.20E-09 1.50E-02
59PR 143 7.90E-05 9.20E-09 3.69E-09 4.56E-10 0.00E+00 2.13E-09 0.00E+00 4.03E-05 0.00E+00 0.00E+00 1.47E-01
59PR 144 1.70E-03 3.01E-11 1.25E-11 1.53E-12 0.00E+00 7.05E-12 0.00E+00 4.33E-18 2.30E-10 2.00E-10 1.31E-04
58CE 144 1.70E-03 4.88E-07 2.04E-07 2.62E-08 0.00E+00 1.21E-07 0.00E+00 1.65E-04 3.70E-10 3.20E-10 2.47E+00
 0          *      *      *    TEENAGER DOSE FACTORS      *      *      *
 0          *      *      *    INGESTION DOSE FACTORS      *      *      *

```

NUCLIDE	CURIE/YEAR	BONE	LIVER	TOTAL	BODY	THYROID	KIDNEY	LUNG	SHORELINE		
									(MREM/PCI INTAKE)	(MREM/HR) / (PCI/M**2)	RECON
1H	3	1.60E+03	0.00E+00	6.04E-08	6.04E-08	6.04E-08	6.04E-08	6.04E-08	6.04E-08	6.04E-08	
11NA	24	4.70E-03	2.30E-06	2.30E-06							
24CR	51	1.30E-03	0.00E+00	0.00E+00	3.60E-09	2.00E-09	7.89E-10	5.14E-09	6.05E-07		
25MN	54	7.00E-04	0.00E+00	5.90E-06	1.17E-06	0.00E+00	1.76E-06	0.00E+00	1.21E-05		
26FE	55	5.00E-04	3.78E-06	2.68E-06	6.25E-07	0.00E+00	0.00E+00	1.70E-06	1.16E-06		
26FE	59	1.00E-04	5.87E-06	1.37E-05	5.29E-06	0.00E+00	0.00E+00	4.32E-06	3.24E-05		
27CO	58	1.90E-03	0.00E+00	9.72E-07	2.24E-06	0.00E+00	0.00E+00	0.00E+00	1.34E-05		
30ZN	65	2.20E-04	5.76E-06	2.00E-05	9.33E-06	0.00E+00	1.28E-05	0.00E+00	8.47E-06		
74W	187	3.50E-04	1.46E-07	1.19E-07	4.17E-08	0.00E+00	0.00E+00	0.00E+00	3.22E-05		
93NP	239	5.30E-04	1.76E-09	1.66E-10	9.22E-11	0.00E+00	5.21E-10	0.00E+00	2.67E-05		
37RB	88	2.80E-02	0.00E+00	8.52E-08	4.54E-08	0.00E+00	0.00E+00	0.00E+00	7.30E-15		
38SR	89	6.00E-05	4.40E-04	0.00E+00	1.26E-05	0.00E+00	0.00E+00	0.00E+00	5.24E-05		
38SR	90	8.00E-06	1.02E-02	0.00E+00	2.04E-04	0.00E+00	0.00E+00	0.00E+00	2.33E-04		
38SR	91	6.80E-05	8.07E-06	0.00E+00	3.21E-07	0.00E+00	0.00E+00	0.00E+00	3.66E-05		
39Y	91M	4.40E-05	1.29E-10	0.00E+00	4.93E-12	0.00E+00	0.00E+00	0.00E+00	6.09E-09		
39Y	91	1.00E-05	2.01E-07	0.00E+00	5.39E-09	0.00E+00	0.00E+00	0.00E+00	8.24E-05		
39Y	93	2.90E-04	3.83E-09	0.00E+00	1.05E-10	0.00E+00	0.00E+00	0.00E+00	1.17E-04		
40ZR	95	2.00E-04	4.12E-08	1.30E-08	8.94E-09	0.00E+00	1.91E-08	0.00E+00	3.00E-05		
41NB	95	1.00E-04	8.22E-09	4.56E-09	2.51E-09	0.00E+00	4.42E-09	0.00E+00	1.95E-05		
42MO	99	1.60E-03	0.00E+00	6.03E-06	1.15E-06	0.00E+00	1.38E-05	0.00E+00	1.08E-05		
43TC	99M	1.70E-03	3.32E-10	9.26E-10	1.20E-08	0.00E+00	1.38E-08	5.14E-10	6.08E-07		
44RU	103	3.10E-03	2.55E-07	0.00E+00	1.09E-07	0.00E+00	8.99E-07	0.00E+00	2.13E-05		
44RU	106	3.80E-02	3.92E-06	0.00E+00	4.94E-07	0.00E+00	7.56E-06	0.00E+00	1.88E-04		
47AG	110M	6.00E-04	2.05E-07	1.94E-07	1.18E-07	0.00E+00	3.70E-07	0.00E+00	5.45E-05		
52TE	129M	7.80E-05	1.63E-05	6.05E-06	2.58E-06	5.26E-06	6.82E-05	0.00E+00	6.12E-05		
52TE	129	3.10E-04	4.48E-08	1.67E-08	1.09E-08	3.20E-08	1.88E-07	0.00E+00	2.45E-07		



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 4 of 14

52TE 131M	2.50E-04	2.44E-06	1.17E-06	9.76E-07	1.76E-06	1.22E-05	0.00E+00	9.39E-05
52TE 131	7.60E-05	2.79E-08	1.15E-08	8.72E-09	2.15E-08	1.22E-07	0.00E+00	2.29E-09
53I 131	4.00E-04	5.85E-06	8.19E-06	4.40E-06	2.39E-03	1.41E-05	0.00E+00	1.62E-06
52TE 132	4.70E-04	3.49E-06	2.21E-06	2.08E-06	2.33E-06	2.12E-05	0.00E+00	7.00E-05
53I 132	3.10E-04	2.79E-07	7.30E-07	2.62E-07	2.46E-05	1.15E-06	0.00E+00	3.18E-07
53I 133	8.10E-04	2.01E-06	3.41E-06	1.04E-06	4.76E-04	5.98E-06	0.00E+00	2.58E-06
53I 134	8.90E-05	1.46E-07	3.87E-07	1.39E-07	6.45E-06	6.10E-07	0.00E+00	5.10E-09
55CS 134	1.00E-03	8.37E-05	1.97E-04	9.14E-05	0.00E+00	6.26E-05	2.39E-05	2.45E-06
53I 135	7.80E-04	6.10E-07	1.57E-06	5.82E-07	1.01E-04	2.48E-06	0.00E+00	1.74E-06
55CS 136	2.20E-02	8.59E-06	3.38E-05	2.27E-05	0.00E+00	1.84E-05	2.90E-06	2.72E-06
55CS 137	2.00E-03	1.12E-04	1.49E-04	5.19E-05	0.00E+00	5.07E-05	1.97E-05	2.12E-06
56BA 140	4.90E-03	2.84E-05	3.48E-08	1.83E-06	0.00E+00	1.18E-08	2.34E-08	4.38E-05
571A 140	8.00E-03	3.48E-09	1.71E-09	4.55E-10	0.00E+00	0.00E+00	0.00E+00	9.82E-05
58CE 141	6.00E-05	1.33E-08	8.88E-09	1.02E-09	0.00E+00	4.18E-09	0.00E+00	2.54E-05
58CE 143	5.00E-04	2.35E-09	1.71E-06	1.91E-10	0.00E+00	7.67E-10	0.00E+00	5.14E-05
59PR 143	7.90E-05	1.31E-08	5.23E-09	6.52E-10	0.00E+00	3.04E-09	0.00E+00	4.31E-05
59PR 144	1.70E-03	4.30E-11	1.76E-11	2.18E-12	0.00E+00	1.01E-11	0.00E+00	4.74E-14
58CE 144	1.70E-03	6.96E-07	2.88E-07	3.74E-08	0.00E+00	1.72E-07	0.00E+00	1.75E-04

0 * * * CHILD DOSE FACTORS * * *

NUCLIDE	CURIE/YEAR	INGESTION DOSE FACTORS (MREM/PCI INTAKE)						SHORELINE (MREM/HR) / (PCI/M**2)			RECON
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI	SKIN	TOTAL BODY	
1H	3	1.60E+03	0.00E+00	1.16E-07	1.16E-07	1.16E-07	1.16E-07	1.16E-07	1.16E-07		
11NA	24	4.70E-03	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06	5.80E-06		
24CR	51	1.30E-03	0.00E+00	0.00E+00	8.90E-09	4.94E-09	1.35E-09	9.02E-09	4.72E-07		
25MN	54	7.00E-04	0.00E+00	1.07E-05	2.85E-06	0.00E+00	3.00E-06	0.00E+00	8.98E-06		
26FE	55	5.00E-04	1.15E-05	6.10E-06	1.89E-06	0.00E+00	0.00E+00	3.45E-06	1.13E-06		
26FE	59	1.00E-04	1.65E-05	2.67E-05	1.33E-05	0.00E+00	0.00E+00	7.74E-06	2.78E-05		
27CO	58	1.90E-03	0.00E+00	1.80E-06	5.51E-06	0.00E+00	0.00E+00	0.00E+00	1.05E-05		
30ZN	65	2.20E-04	1.37E-05	3.65E-05	2.27E-05	0.00E+00	2.30E-05	0.00E+00	6.41E-06		
74W	187	3.50E-04	4.29E-07	2.54E-07	1.14E-07	0.00E+00	0.00E+00	0.00E+00	3.57E-05		
93NP	239	5.30E-04	5.25E-09	3.77E-10	2.65E-10	0.00E+00	1.09E-09	0.00E+00	2.79E-05		
37RB	88	2.80E-02	0.00E+00	1.90E-07	1.32E-07	0.00E+00	0.00E+00	0.00E+00	9.32E-09		
38SR	89	6.00E-05	1.32E-03	0.00E+00	3.77E-05	0.00E+00	0.00E+00	0.00E+00	5.11E-05		
38SR	90	8.00E-06	2.56E-02	0.00E+00	5.15E-04	0.00E+00	0.00E+00	0.00E+00	2.29E-04		
38SR	91	6.80E-05	2.40E-05	0.00E+00	9.06E-07	0.00E+00	0.00E+00	0.00E+00	5.30E-05		
39Y	91M	4.40E-05	3.82E-10	0.00E+00	1.39E-11	0.00E+00	0.00E+00	0.00E+00	7.48E-07		
39Y	91	1.00E-05	6.02E-07	0.00E+00	1.61E-08	0.00E+00	0.00E+00	0.00E+00	8.02E-05		
39Y	93	2.90E-04	1.14E-08	0.00E+00	3.13E-10	0.00E+00	0.00E+00	0.00E+00	1.70E-04		
40ZR	95	2.00E-04	1.16E-07	2.55E-08	2.27E-08	0.00E+00	3.65E-08	0.00E+00	2.66E-05		
41NB	95	1.00E-04	2.25E-08	8.76E-09	6.26E-09	0.00E+00	8.23E-09	0.00E+00	1.62E-05		
42MO	99	1.60E-03	0.00E+00	1.33E-05	3.29E-06	0.00E+00	2.84E-05	0.00E+00	1.10E-05		
43TC	99M	1.70E-03	9.23E-10	1.81E-09	3.00E-08	0.00E+00	2.63E-08	9.19E-10	1.03E-06		
44RU	103	3.10E-03	7.31E-07	0.00E+00	2.81E-07	0.00E+00	1.84E-06	0.00E+00	1.89E-05		
44RU	106	3.80E-02	1.17E-05	0.00E+00	1.46E-06	0.00E+00	1.58E-05	0.00E+00	1.82E-04		



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0**PAGE NO.** 5 of 14

4TAG	110M	6.00E-04	5.39E-07	3.64E-07	2.91E-07	0.00E+00	6.78E-07	0.00E+00	4.33E-05
52TE	129M	7.80E-05	4.87E-05	1.36E-05	7.56E-06	1.57E-05	1.43E-04	0.00E+00	5.94E-05
52TE	129	3.10E-04	1.34E-07	3.74E-08	3.18E-08	9.56E-08	3.92E-07	0.00E+00	8.34E-06
52TE	131M	2.50E-04	7.20E-06	2.49E-06	2.65E-06	5.12E-06	2.41E-05	0.00E+00	1.01E-04
52TE	131	7.60E-05	8.30E-08	2.53E-08	2.47E-08	6.35E-08	2.51E-07	0.00E+00	4.36E-07
53I	131	4.00E-04	1.72E-05	1.73E-05	9.83E-06	5.72E-03	2.84E-05	0.00E+00	1.54E-06
52TE	132	4.70E-04	1.01E-05	4.47E-06	5.40E-06	6.51E-06	4.15E-05	0.00E+00	4.50E-05
53I	132	3.10E-04	8.00E-07	1.47E-06	6.76E-07	6.82E-05	2.25E-06	0.00E+00	1.73E-06
53I	133	8.10E-04	5.92E-06	7.32E-06	2.77E-06	1.36E-03	1.22E-05	0.00E+00	2.95E-06
53I	134	8.90E-05	4.19E-07	7.78E-07	3.58E-07	1.79E-05	1.19E-06	0.00E+00	5.16E-07
55CS	134	1.00E-03	2.34E-04	3.84E-04	8.10E-05	0.00E+00	1.19E-04	4.27E-05	2.07E-06
53I	135	7.80E-04	1.75E-06	3.15E-06	1.49E-06	2.79E-04	4.83E-06	0.00E+00	2.40E-06
55CS	136	2.20E-02	2.35E-05	6.46E-05	4.18E-05	0.00E+00	3.44E-05	5.13E-06	2.27E-06
55CS	137	2.00E-03	3.27E-04	3.13E-04	4.62E-05	0.00E+00	1.02E-04	3.67E-05	1.96E-06
56BA	140	4.90E-03	8.31E-05	7.28E-08	4.85E-06	0.00E+00	2.37E-08	4.34E-08	4.21E-05
57LA	140	8.00E-03	1.01E-08	3.53E-09	1.19E-09	0.00E+00	0.00E+00	0.00E+00	9.84E-05
58CE	141	6.00E-05	3.97E-08	1.98E-08	2.94E-09	0.00E+00	8.68E-09	0.00E+00	2.47E-05
58CE	143	5.00E-04	6.99E-09	3.79E-06	5.49E-10	0.00E+00	1.59E-09	0.00E+00	5.55E-05
59PR	143	7.90E-05	3.93E-08	1.18E-08	1.95E-09	0.00E+00	6.39E-09	0.00E+00	4.24E-05
59PR	144	1.70E-03	1.29E-10	3.99E-11	6.49E-12	0.00E+00	2.11E-11	0.00E+00	8.59E-08
58CE	144	1.70E-03	2.08E-06	6.52E-07	1.11E-07	0.00E+00	3.61E-07	0.00E+00	1.70E-04

0 * * * INFANT DOSE FACTORS * * *

NUCLIDE	CURIE/YEAR	BONE	LIVER	TOTAL	BODY	INGESTION DOSE FACTORS		SHORELINE			RECON
						(MREM/PCI INTAKE)	(MREM/HR) / (PCI/M**2)	SKIN	TOTAL	BODY	
1H	3	1.60E+03	0.00E+00	1.76E-07	1.76E-07	1.76E-07	1.76E-07	1.76E-07	1.76E-07		
11NA	24	4.70E-03	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05	1.01E-05		
24CR	51	1.30E-03	0.00E+00	0.00E+00	1.41E-08	9.20E-09	2.01E-09	1.79E-08	4.11E-07		
25MN	54	7.00E-04	0.00E+00	1.99E-05	4.51E-06	0.00E+00	4.41E-06	0.00E+00	7.31E-06		
26FE	55	5.00E-04	1.39E-05	8.98E-06	2.40E-06	0.00E+00	0.00E+00	4.39E-06	1.14E-06		
26FE	59	1.00E-04	3.08E-05	5.38E-05	2.12E-05	0.00E+00	0.00E+00	1.59E-05	2.57E-05		
27CO	58	1.90E-03	0.00E+00	3.60E-06	8.98E-06	0.00E+00	0.00E+00	0.00E+00	8.97E-06		
30ZN	65	2.20E-04	1.84E-05	6.31E-05	2.91E-05	0.00E+00	3.06E-05	0.00E+00	5.33E-05		
74W	187	3.50E-04	9.03E-07	6.28E-07	2.17E-07	0.00E+00	0.00E+00	0.00E+00	3.69E-05		
93NP	239	5.30E-04	1.11E-08	9.93E-10	5.61E-10	0.00E+00	1.98E-09	0.00E+00	2.87E-05		
37RB	88	2.80E-02	0.00E+00	4.98E-07	2.73E-07	0.00E+00	0.00E+00	0.00E+00	4.85E-07		
38SR	89	6.00E-05	2.51E-03	0.00E+00	7.20E-05	0.00E+00	0.00E+00	0.00E+00	5.16E-05		
38SR	90	8.00E-06	2.83E-02	0.00E+00	5.74E-04	0.00E+00	0.00E+00	0.00E+00	2.31E-04		
38SR	91	6.80E-05	5.00E-05	0.00E+00	1.81E-06	0.00E+00	0.00E+00	0.00E+00	5.92E-05		
39Y	91M	4.40E-05	8.10E-10	0.00E+00	2.76E-11	0.00E+00	0.00E+00	0.00E+00	2.70E-06		
39Y	91	1.00E-05	1.13E-06	0.00E+00	3.01E-08	0.00E+00	0.00E+00	0.00E+00	8.10E-05		
39Y	93	2.90E-04	2.43E-08	0.00E+00	6.62E-10	0.00E+00	0.00E+00	0.00E+00	1.92E-04		
40ZR	95	2.00E-04	2.06E-07	5.02E-08	3.56E-08	0.00E+00	5.41E-08	0.00E+00	2.50E-05		
41NB	95	1.00E-04	4.20E-08	1.73E-08	1.00E-08	0.00E+00	1.24E-08	0.00E+00	1.46E-05		
42MO	99	1.60E-03	0.00E+00	3.40E-05	6.63E-06	0.00E+00	5.08E-05	0.00E+00	1.12E-05		



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 6 of 14

43TC 99M 1.70E-03 1.92E-09 3.96E-09 5.10E-08 0.00E+00 4.26E-08 2.07E-09 1.15E-06
 44RU 103 3.10E-03 1.48E-06 0.00E+00 4.95E-07 0.00E+00 3.08E-06 0.00E+00 1.80E-05
 44RU 106 3.80E-02 2.41E-05 0.00E+00 3.01E-06 0.00E+00 2.85E-05 0.00E+00 1.83E-04
 47AG 110M 6.00E-04 9.96E-07 7.27E-07 4.81E-07 0.00E+00 1.04E-06 0.00E+00 3.77E-05
 52TE 129M 7.80E-05 1.00E-04 3.43E-05 1.54E-05 3.84E-05 2.50E-04 0.00E+00 5.97E-05
 52TE 129 3.10E-04 2.84E-07 9.79E-08 6.63E-08 2.38E-07 7.07E-07 0.00E+00 2.27E-05
 52TE 131M 2.50E-04 1.52E-05 6.12E-06 5.05E-06 1.24E-05 4.21E-05 0.00E+00 1.03E-04
 52TE 131 7.60E-05 1.76E-07 6.50E-08 4.94E-08 1.57E-07 4.50E-07 0.00E+00 7.11E-06
 53I 131 4.00E-04 3.59E-05 4.23E-05 1.86E-05 1.39E-02 4.94E-05 0.00E+00 1.51E-06
 52TE 132 4.70E-04 2.08E-05 1.03E-05 9.61E-06 1.52E-05 6.44E-05 0.00E+00 3.81E-05
 53I 132 3.10E-04 1.66E-06 3.37E-06 1.20E-06 1.58E-04 3.76E-06 0.00E+00 2.73E-06
 53I 133 8.10E-04 1.25E-05 1.82E-05 5.33E-06 3.31E-03 2.14E-05 0.00E+00 3.08E-06
 53I 134 8.90E-05 8.69E-07 1.78E-06 6.33E-07 4.15E-05 1.99E-06 0.00E+00 1.84E-06
 55CS 134 1.00E-03 3.77E-04 7.03E-04 7.10E-05 0.00E+00 1.81E-04 7.42E-05 1.91E-06
 53I 135 7.80E-04 3.64E-06 7.24E-06 2.64E-06 6.49E-04 8.07E-06 0.00E+00 2.62E-06
 55CS 136 2.20E-02 4.59E-05 1.35E-04 5.04E-05 0.00E+00 5.38E-05 1.10E-05 2.05E-06
 55CS 137 2.00E-03 5.22E-04 6.11E-04 4.33E-05 0.00E+00 1.64E-04 6.64E-05 1.91E-06
 56BA 140 4.90E-03 1.71E-04 1.71E-07 8.81E-06 0.00E+00 4.06E-08 1.05E-07 4.20E-05
 57LA 140 8.00E-03 2.11E-08 8.32E-09 2.14E-09 0.00E+00 0.00E+00 0.00E+00 9.77E-05
 58CE 141 6.00E-05 7.87E-08 4.80E-08 5.65E-09 0.00E+00 1.48E-08 0.00E+00 2.48E-05
 58CE 143 5.00E-04 1.48E-08 9.82E-06 1.12E-09 0.00E+00 2.86E-09 0.00E+00 5.73E-05
 59PR 143 7.90E-05 8.13E-08 3.04E-08 4.03E-09 0.00E+00 1.13E-08 0.00E+00 4.29E-05
 59PR 144 1.70E-03 2.74E-10 1.06E-10 1.38E-11 0.00E+00 3.84E-11 0.00E+00 4.93E-06
 58CE 144 1.70E-03 2.98E-06 1.22E-06 1.67E-07 0.00E+00 4.93E-07 0.00E+00 1.71E-04

0 TOTAL NUMBER IN SOURCE TERM IS 44 TOTAL RELEASE IS 1.60001E+03

1 * * * AS LOW AS REASONABLY ACHIEVABLE * * *

0 A D U L T D O S E S

		DOSE (MRREM PER YEAR INTAKE)							
OPATHWAY		SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
FISH		1.79E-01	3.09E-01	2.25E-01	3.58E-02	1.30E-01	6.60E-02	5.22E-02	
DRINKING		1.74E-04	5.10E-02	5.09E-02	5.08E-02	5.09E-02	5.08E-02	5.20E-02	
SHORELINE		3.57E-04	3.05E-04	3.05E-04	3.05E-04	3.05E-04	3.05E-04	3.05E-04	3.05E-04
TOTAL		3.57E-04	1.79E-01	3.61E-01	2.76E-01	8.69E-02	1.81E-01	1.17E-01	1.05E-01

0	USAGE (KG/YR, HR/YR)	DILUTION	TIME(HR)	SHOREWIDTH FACTOR=.2			
FISH	21.0	1.0	31.30				
DRINKING	730.0	27.2	78.00				
SHORELINE	12.0	1.0	7.30				

0 T E E N A G E R D O S E S

		DOSE (MRREM PER YEAR INTAKE)							
OPATHWAY		SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
FISH		1.90E-01	3.10E-01	1.35E-01	2.75E-02	1.24E-01	6.38E-02	4.02E-02	
DRINKING		1.63E-04	3.60E-02	3.59E-02	3.58E-02	3.59E-02	3.58E-02	3.66E-02	
SHORELINE		1.99E-03	1.70E-03	1.70E-03	1.70E-03	1.70E-03	1.70E-03	1.70E-03	1.70E-03
TOTAL		1.99E-03	1.92E-01	3.48E-01	1.73E-01	6.50E-02	1.62E-01	1.01E-01	7.85E-02

0	USAGE (KG/YR, HR/YR)	DILUTION	TIME(HR)	SHOREWIDTH FACTOR=.2			
---	----------------------	----------	----------	----------------------	--	--	--



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 7 of 14

FISH	16.0	1.0	31.30				
DRINKING	510.0	27.2	78.00				
SHORELINE	67.0	1.0	7.30				
0	C H I L D D O S E S						
0				DOSE_(MREM PER YEAR INTAKE)			
OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH		2.37E-01	2.74E-01	6.62E-02	2.28E-02	1.05E-01	5.17E-02
DRINKING		4.61E-04	6.91E-02	6.88E-02	6.87E-02	6.89E-02	6.88E-02
SHORELINE	4.17E-04	3.56E-04	3.56E-04	3.56E-04	3.56E-04	3.56E-04	3.56E-04
TOTAL	4.17E-04	2.38E-01	3.44E-01	1.35E-01	9.19E-02	1.75E-01	1.21E-01
0	USAGE (KG/YR,HR/YR)	DILUTION	TIME(HR)		SHOREWIDTH FACTOR= .2		
FISH	6.9	1.0	31.30				
DRINKING	510.0	27.2	78.00				
SHORELINE	14.0	1.0	7.30				
0	I N F A N T D O S E S						
0				DOSE_(MREM PER YEAR INTAKE)			
OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH		0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
DRINKING		4.66E-04	6.79E-02	6.75E-02	6.75E-02	6.77E-02	6.75E-02
SHORELINE	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
TOTAL	0.00E+00	4.66E-04	6.79E-02	6.75E-02	6.75E-02	6.77E-02	6.75E-02
0	USAGE (KG/YR,HR/YR)	DILUTION	TIME(HR)		SHOREWIDTH FACTOR= .2		
FISH	.0	1.0	31.30				
DRINKING	330.0	27.2	78.00				
1	*	*	*	SELECTED LOCATION	*	*	*
0	LOCATION IS SCR Employee Use						
0	A D U L T D O S E S						
0				DOSE_(MREM PER YEAR INTAKE)			
OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH		1.79E-01	3.09E-01	2.25E-01	3.58E-02	1.30E-01	6.60E-02
DRINKING		4.74E-03	1.39E+00	1.39E+00	1.38E+00	1.39E+00	1.38E+00
SHORELINE	5.36E-04	4.58E-04	4.58E-04	4.58E-04	4.58E-04	4.58E-04	4.58E-04
TOTAL	5.36E-04	1.84E-01	1.70E+00	1.61E+00	1.42E+00	1.52E+00	1.45E+00
0	USAGE (KG/YR,HR/YR)	DILUTION	TIME(HR)		SHOREWIDTH FACTOR= .3		
FISH	21.0	1.0	24.00				
DRINKING	730.0	1.0	12.00				
SHORELINE	12.0	1.0	.00				
0	LOCATION IS SCR Employee Use						
0	T E E N A G E R D O S E S						
0				DOSE_(MREM PER YEAR INTAKE)			
OPATHWAY	SKIN	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH		1.90E-01	3.11E-01	1.35E-01	2.75E-02	1.24E-01	6.39E-02
DRINKING		4.45E-03	9.78E-01	9.76E-01	9.74E-01	9.76E-01	9.74E-01
SHORELINE	2.99E-03	2.56E-03	2.56E-03	2.56E-03	2.56E-03	2.56E-03	2.56E-03
TOTAL	2.99E-03	1.97E-01	1.29E+00	1.11E+00	1.00E+00	1.10E+00	1.04E+00



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 8 of 14

0 USAGE (KG/YR,HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	16.0	1.0	24.00
DRINKING	510.0	1.0	12.00
SHORELINE	67.0	1.0	.00

LOCATION IS SCR Employee Use

0 C H I L D D O S E S

OPATHWAY	SKIN	DOSE (MREM PER YEAR INTAKE)					
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH	2.37E-01	2.75E-01	6.62E-02	2.28E-02	1.05E-01	5.17E-02	2.79E-02
DRINKING	1.26E-02	1.88E+00	1.87E+00	1.87E+00	1.88E+00	1.87E+00	1.89E+00
SHORELINE	6.25E-04	5.34E-04	5.34E-04	5.34E-04	5.34E-04	5.34E-04	5.34E-04
TOTAL	6.25E-04	2.50E-01	2.15E+00	1.94E+00	1.89E+00	1.98E+00	1.92E+00

0 USAGE (KG/YR,HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	6.9	1.0	24.00
DRINKING	510.0	1.0	12.00
SHORELINE	14.0	1.0	.00

LOCATION IS SCR Employee Use

0 I N F A N T D O S E S

OPATHWAY	SKIN	DOSE (MREM PER YEAR INTAKE)					
		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG
FISH	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
DRINKING	1.27E-02	1.85E+00	1.84E+00	1.84E+00	1.84E+00	1.84E+00	1.85E+00
SHORELINE	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
TOTAL	0.00E+00	1.27E-02	1.85E+00	1.84E+00	1.84E+00	1.84E+00	1.85E+00

0 USAGE (KG/YR,HR/YR) DILUTION TIME(HR) SHOREWIDTH FACTOR= .3

FISH	.0	1.0	24.00
DRINKING	330.0	1.0	12.00

1 * * * FISH CONSUMPTION POPULATION DOSES * * *

PERSON-REM

0 SPORT HARVEST

0 -----DOSE (PERSON-REM)-----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LI
FISH	ADULT	2.71E+05	8.43E-02	1.45E-01	1.06E-01	1.70E-02	6.07E-02	3.12E-02	2.45E-02
FISH	TEENAGER	3.16E+04	1.37E-02	2.23E-02	9.71E-03	2.00E-03	8.91E-03	4.62E-03	2.89E-03
FISH	CHILD	2.19E+04	2.75E-02	3.17E-02	7.56E-03	2.66E-03	1.22E-02	6.00E-03	3.23E-03
FISH	TOTAL	3.24E+05	1.26E-01	1.99E-01	1.23E-01	2.16E-02	8.18E-02	4.18E-02	3.06E-02

0 LOCATION DILUTION CATCH TIME(HR)-INCLUDES FOOD PROCESSING TIME OF 1.68E+02 HR POPULATION=5.53E+04

Sport Fish Above W 2.72E+01 3.24E+05 2.34E+02

0 AVERAGE INDIVIDUAL CONSUMPTION (KG/YR) ADULT=6.90E+00 TEEN=5.20E+00 CHILD=2.20E+00

1 * * * POPULATION WATER CONSUMPTION DOSES * * *

0

0 SUPPLIER-City of Whitney

0 -----DOSE (PERSON-REM)-----

OPATHWAY	AGE GROUP	USAGE	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LI
DRINKING	ADULT	9.78E+05	1.16E-04	3.41E-02	3.41E-02	3.40E-02	3.41E-02	3.40E-02	3.48E-02



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 9 of 14

DRINKING TEENAGER 1.06E+05 1.70E-05 3.75E-03 3.74E-03 3.73E-03 3.74E-03 3.74E-03 3.82E-03
 DRINKING CHILD 1.74E+05 7.87E-05 1.18E-02 1.17E-02 1.17E-02 1.18E-02 1.17E-02 1.19E-02
 DRINKING TOTAL 1.26E+06 2.12E-04 4.97E-02 4.96E-02 4.95E-02 4.96E-02 4.95E-02 5.05E-02
 0POPULATION=3.72E+03 DILUTION=5.44E+01 TRANSIT TIME=1.01E+02 HR (INCLUDING 24 HR FOR TREATMENT FACILITY)
 0AVERAGE INDIVIDUAL CONSUMPTION (L/YR) ADULT=3.70E+02 TEEN=2.60E+02 CHILD=2.60E+02
 0

0SUPPLIER-City of Cleburn

0-----DOSE (PERSON-REM)-----
 0PATHWAY AGE GROUP USAGE BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI
 DRINKING ADULT 1.40E+07 3.34E-03 9.80E-01 9.79E-01 9.79E-01 9.77E-01 9.77E-01 9.99E-01
 DRINKING TEENAGER 1.53E+06 4.89E-04 1.08E-01 1.07E-01 1.07E-01 1.08E-01 1.07E-01 1.10E-01
 DRINKING CHILD 2.50E+06 2.26E-03 3.39E-01 3.37E-01 3.37E-01 3.38E-01 3.37E-01 3.41E-01
 DRINKING TOTAL 1.81E+07 6.09E-03 1.43E+00 1.42E+00 1.42E+00 1.42E+00 1.42E+00 1.45E+00
 0POPULATION=5.34E+04 DILUTION=2.72E+01 TRANSIT TIME=9.00E+01 HR (INCLUDING 24 HR FOR TREATMENT FACILITY)
 0AVERAGE INDIVIDUAL CONSUMPTION (L/YR) ADULT=3.70E+02 TEEN=2.60E+02 CHILD=2.60E+02
 0-----CUMULATIVE TOTAL-----

0PATHWAY AGE GROUP USAGE BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI
 DRINKING CUMUL TOTAL 1.93E+07 6.30E-03 1.48E+00 1.47E+00 1.47E+00 1.47E+00 1.47E+00 1.50E+00
 0

0HYDROSPHERE TRITIUM DOSE

0AVERAGE INDIVIDUAL WATER CONSUMPTION = 3.0 L/DAY
 0PATHWAY AGE GROUP USAGE BONE LIVER TOTAL BODY THYROID KIDNEY LUNG GI-LLI
 WATER TOTAL 2.86E+11 0.00E+00 1.47E-02 1.47E-02 1.47E-02 1.47E-02 1.47E-02 1.47E-02
 1 * * * RECREATION POPULATION DOSES * * * 0

0LOCATION- Shore W R

0DILUTION= 5.44E+01 TRANSIT TIME= 7.70E+01 HR SWF=.3
 0DOSE (PERSON-REM)-----
 0PATHWAY AGE GROUP USAGE SKIN TOTAL BODY THYROID
 SHORELINE TOTAL POPUL 2.24E+07 1.83E-02 1.57E-02 1.57E-02
 0

0LOCATION- Swim W R

0DILUTION= 5.44E+01 TRANSIT TIME= 7.70E+01 HR
 0DOSE (PERSON-REM)-----
 0PATHWAY AGE GROUP USAGE SKIN TOTAL BODY THYROID
 SWIMMING TOTAL POPUL 2.24E+07 8.74E-05 8.74E-05
 0

0LOCATION- Boat W R

0DILUTION= 5.44E+01 TRANSIT TIME= 7.70E+01 HR
 0DOSE (PERSON-REM)-----
 0PATHWAY AGE GROUP USAGE SKIN TOTAL BODY THYROID
 BOATING TOTAL POPUL 2.24E+07 4.37E-05 4.37E-05
 1 * * * IRRIGATED FOOD PATHWAY * * * LEAFY VEGE
 0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 9.88E+02



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. C

PAGE NO. 10 of 14

TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 9.88E+02

INDIVIDUAL DOSES (MREM PER YEAR INTAKE)

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.02E-04	4.55E-03	4.52E-03	4.45E-03	4.51E-03	4.46E-03	5.06E-03
TEENAGER	8.97E-05	3.04E-03	2.98E-03	2.95E-03	2.99E-03	2.96E-03	3.37E-03
CHILD	1.57E-04	3.62E-03	3.53E-03	3.50E-03	3.56E-03	3.52E-03	3.76E-03

NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 2.72E+01 AND TRANSIT TIME= 6.60E+01 HRS

0 _____ POPULATION DOSES (PERSON-REM) _____

NEPA DOSES		BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	3.35E-05	1.50E-03	1.49E-03	1.46E-03	1.48E-03	1.47E-03	1.67E-03	
TEENAGER	4.64E-06	1.57E-04	1.54E-04	1.53E-04	1.55E-04	1.53E-04	1.74E-04	
CHILD	1.07E-05	2.47E-04	2.41E-04	2.40E-04	2.44E-04	2.41E-04	2.57E-04	
TOTAL	4.89E-05	1.90E-03	1.88E-03	1.86E-03	1.88E-03	1.86E-03	2.10E-03	

0\$ \$ \$ ALARA DOSES \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	3.35E-05	1.50E-03	1.49E-03	1.46E-03	1.48E-03	1.47E-03	1.67E-03
TEENAGER	4.64E-06	1.57E-04	1.54E-04	1.53E-04	1.55E-04	1.53E-04	1.74E-04
CHILD	1.07E-05	2.47E-04	2.41E-04	2.40E-04	2.44E-04	2.41E-04	2.57E-04
TOTAL	4.89E-05	1.90E-03	1.88E-03	1.86E-03	1.88E-03	1.86E-03	2.10E-03

OIRRI FOOD IRRIGATION RATE= 7.46E+01 L/M**2/MON
 NON-IRRIGATED FEED FRACTION= 0.00E+00
 WATER FRACTION NOT VIA IRRIGATION= 0.00E+00
 TOTAL 50 MILE GROW= 2.50E+04 KG/YR
 TOTAL CROP IRRIGATION= 2.50E+04
 CROP GROWING PERIOD= 6.00E+01 DAYS
 CROP YIELD= 2.00E+00 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME
Leafy Above W R	2.72E+01	2.50E+04	6.60E+01

OINDIVIDUAL CONSUMPTION RATES ADULT=6.40E+01 KG TEEN=4.20E+01 CHILD=2.60E+01
 POPULATION CONSUMPTION RATES ADULT=3.00E+01 KG TEEN=2.00E+01 CHILD=1.00E+01
 FOOD PROCESS TIME=2.40E+01 HP
 FOOD PROCESS TIME=4.80E+01 HP

VEGETATION

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 2.67E+04
TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 2.67E+04

INDIVIDUAL DOSES (MREM PER YEAR INTAKE

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	8.24E-04	3.69E-02	3.67E-02	3.61E-02	3.65E-02	3.62E-02	4.10E-02
TEENAGER	1.34E-03	4.54E-02	4.46E-02	4.41E-02	4.48E-02	4.43E-02	5.03E-02

1.54E-03 **4.54E-02** **4.45E-02** **4.41E-02** **4.46E-02** **4.45E-02**
3.11E-03 **7.22E-02** **7.04E-02** **6.99E-02** **7.11E-02** **7.02E-02**

NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 2.72E+0

0 * * * NEPA DOSES * * * POPULATION DOSES (PERSON-REM) _____



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 11 of 14

	ADULT	5.62E-03	2.54E-01	2.52E-01	2.48E-01	2.51E-01	2.49E-01	2.79E-01
	TEENAGER	1.47E-03	5.05E-02	4.96E-02	4.90E-02	4.98E-02	4.92E-02	5.54E-02
	CHILD	5.66E-03	1.33E-01	1.29E-01	1.28E-01	1.30E-01	1.29E-01	1.37E-01
	TOTAL	1.27E-02	4.37E-01	4.31E-01	4.26E-01	4.31E-01	4.27E-01	4.71E-01

0\$ \$ \$ ALARA DOSES \$ \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	5.62E-03	2.54E-01	2.52E-01	2.48E-01	2.51E-01	2.49E-01	2.79E-01
TEENAGER	1.47E-03	5.05E-02	4.96E-02	4.90E-02	4.98E-02	4.92E-02	5.54E-02
CHILD	5.66E-03	1.33E-01	1.29E-01	1.28E-01	1.30E-01	1.29E-01	1.37E-01
TOTAL	1.27E-02	4.37E-01	4.31E-01	4.26E-01	4.31E-01	4.27E-01	4.71E-01

OIRR FOOD IRRIGATION RATE= 7.46E+01 L/M**2/MON

NON-IRRIGATED FEED FRACTION= 0.00E+00

WATER FRACTION NOT VIA IRRIGATION= 0.00E+00

TOTAL 50 MILE GROW= 5.27E+06 KG/YR

TOTAL CROP IRRIGATION= 5.27E+06

CROP GROWING PERIOD= 6.00E+01 DAYS

CROP YIELD= 2.00E+00 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME
Veg Above W R	2.72E+01	5.27E+06	6.60E+01

0INDIVIDUAL CONSUMPTION RATES	ADULT=5.20E+02 KG	TEEN=6.30E+02	CHILD=5.20E+02	FOOD PROCESS TIME=3.36E+02 HR
POPULATION CONSUMPTION RATES	ADULT=1.90E+02 KG	TEEN=2.40E+02	CHILD=2.00E+02	FOOD PROCESS TIME=1.44E+03 HR

1 * * * * IRRIGATED FOOD PATHWAY * * *

MILK

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 7.21E+03

TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 7.21E+03

0 INDIVIDUAL DOSES (MREM PER YEAR INTAKE)

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	4.66E-04	2.23E-02	2.21E-02	2.16E-02	2.18E-02	2.17E-02	2.17E-02
TEENAGER	8.36E-04	2.93E-02	2.85E-02	2.81E-02	2.85E-02	2.82E-02	2.82E-02
CHILD	1.99E-03	4.65E-02	4.48E-02	4.45E-02	4.52E-02	4.47E-02	4.46E-02

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 2.72E+01 AND TRANSIT TIME= 6.60E+01 HRS.

0 POPULATION DOSES (PERSON-REM)

0* * * NEPA DOSES * * *	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	8.46E-04	4.05E-02	4.01E-02	3.92E-02	3.96E-02	3.94E-02	3.94E-02
TEENAGER	3.31E-04	1.16E-02	1.13E-02	1.11E-02	1.13E-02	1.12E-02	1.12E-02
CHILD	1.33E-03	3.11E-02	3.00E-02	2.98E-02	3.02E-02	2.99E-02	2.98E-02
TOTAL	2.51E-03	8.32E-02	8.14E-02	8.01E-02	8.12E-02	8.05E-02	8.04E-02

0\$ \$ \$ ALARA DOSES \$ \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	8.46E-04	4.05E-02	4.01E-02	3.92E-02	3.96E-02	3.94E-02	3.94E-02
TEENAGER	3.31E-04	1.16E-02	1.13E-02	1.11E-02	1.13E-02	1.12E-02	1.12E-02
CHILD	1.33E-03	3.11E-02	3.00E-02	2.98E-02	3.02E-02	2.99E-02	2.98E-02
TOTAL	2.51E-03	8.32E-02	8.14E-02	8.01E-02	8.12E-02	8.05E-02	8.04E-02



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 12 of 14

OIRRI FOOD
 IRRIGATION RATE= 7.46E+01 L/M**2/MON
 NON-IRRIGATED FEED FRACTION= 0.00E+00
 WATER FRACTION NOT VIA IRRIGATION= 0.00E+00
 TOTAL 50 MILE GROW= 9.43E+05 KG/YR
 TOTAL CROP IRRIGATION= 9.43E+05
 CROP GROWING PERIOD= 3.00E+01 DAYS
 CROP YIELD= 7.00E-01 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME			
Milk Above W R	2.72E+01	9.43E+05	6.60E+01			
0 INDIVIDUAL CONSUMPTION RATES	ADULT=3.10E+02	KG	TEEN=4.00E+02	CHILD=3.30E+02	FOOD PROCESS TIME=4.80E+01	HR
POPULATION CONSUMPTION RATES	ADULT=1.10E+02	KG	TEEN=2.00E+02	CHILD=1.70E+02	FOOD PROCESS TIME=9.60E+01	HR

1
MEAT

0 TOTAL 50-MILE-PRODUCTION POPULATION SERVED= 3.49E+03
 TOTAL POPULATION SERVED FROM IRRIGATED PRODUCTION= 3.49E+03

INDIVIDUAL DOSES (MRREM PER YEAR INTAKE)							
	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	7.95E-04	7.74E-03	7.81E-03	7.66E-03	9.11E-03	7.67E-03	5.54E-02
TEENAGER	6.68E-04	4.63E-03	4.66E-03	4.56E-03	5.78E-03	4.57E-03	3.44E-02
CHILD	1.25E-03	5.61E-03	5.69E-03	5.53E-03	7.13E-03	5.54E-03	2.37E-02

0 NOTE- INDIVIDUAL DOSES CALCULATED WITH DILUTION= 2.72E+01 AND TRANSIT TIME= 6.60E+01 HRS.

0 POPULATION DOSES (PERSON-REM)

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.70E-03	1.65E-02	1.67E-02	1.64E-02	1.95E-02	1.64E-02	1.18E-01
TEENAGER	2.33E-04	1.61E-03	1.62E-03	1.59E-03	2.01E-03	1.59E-03	1.20E-02
CHILD	7.11E-04	3.18E-03	3.22E-03	3.13E-03	4.04E-03	3.14E-03	1.34E-02
TOTAL	2.64E-03	2.13E-02	2.15E-02	2.11E-02	2.55E-02	2.11E-02	1.44E-01

0\$ \$ \$ ALARA DOSES \$ \$ \$

	BONE	LIVER	TOTAL BODY	THYROID	KIDNEY	LUNG	GI-LLI
ADULT	1.70E-03	1.65E-02	1.67E-02	1.64E-02	1.95E-02	1.64E-02	1.18E-01
TEENAGER	2.33E-04	1.61E-03	1.62E-03	1.59E-03	2.01E-03	1.59E-03	1.20E-02
CHILD	7.11E-04	3.18E-03	3.22E-03	3.13E-03	4.04E-03	3.14E-03	1.34E-02
TOTAL	2.64E-03	2.13E-02	2.15E-02	2.11E-02	2.55E-02	2.11E-02	1.44E-01

OIRRI FOOD
 IRRIGATION RATE= 7.46E+01 L/M**2/MON
 NON-IRRIGATED FEED FRACTION= 0.00E+00
 WATER FRACTION NOT VIA IRRIGATION= 0.00E+00
 TOTAL 50 MILE GROW= 2.81E+05 KG/YR
 TOTAL CROP IRRIGATION= 2.81E+05
 CROP GROWING PERIOD= 3.00E+01 DAYS
 CROP YIELD= 7.00E-01 KG/M**2

LOCATION	DILUTION	HARVEST	TRANSIT TIME
Meat Above L W	2.72E+01	2.81E+05	6.60E+01



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 13 of 14

OINDIVIDUAL CONSUMPTION RATES	ADULT=1.10E+02 KG	TEEN=6.50E+01	CHILD=4.10E+01	FOOD PROCESS TIME=4.80E+02 HR
POPULATION CONSUMPTION RATES	ADULT=9.50E+01 KG	TEEN=5.90E+01	CHILD=3.70E+01	FOOD PROCESS TIME=4.80E+02 HR
1* * * DOSE TO BIOTA * * *				
0	MRADS PER YEAR			
0				

Biota	DILUTION=	1.00E+00	TRANSIT TIME=	0.00E+00 HR
0	INTERNAL	EXTERNAL	TOTAL	
FISH	1.22E+00	1.12E+00	2.33E+00	
INVERTEBRATE	3.30E+00	2.23E+00	5.53E+00	
ALGAE	1.42E+01	1.92E-03	1.42E+01	
MUSKRAT	8.07E+00	7.44E-01	8.82E+00	
RACCOON	2.01E+00	5.57E-01	2.57E+00	
HERON	2.45E+01	7.44E-01	2.52E+01	
DUCK	7.70E+00	1.12E+00	8.81E+00	

1* * * COST-BENEFIT ANALYSIS * * *

0 NUCLIDE	RELEASE	PERSON-REM DOSE	PERSON-REM PER CURIE	
!	CI/YR	! TOTAL BODY ! THYROID ! TOTAL BODY ! THYROID !		
1H 3	!	1.60E+03 ! 2.02E+00 ! 2.02E+00 ! 1.26E-03 ! 1.26E-03 !		
11NA 24	!	4.70E-03 ! 1.10E-08 ! 1.10E-08 ! 2.34E-06 ! 2.34E-06 !		
24CR 51	!	1.30E-03 ! 8.38E-08 ! 8.09E-08 ! 6.45E-05 ! 6.22E-05 !		
25MN 54	!	7.00E-04 ! 1.13E-04 ! 8.72E-05 ! 1.62E-01 ! 1.25E-01 !		
26FE 55	!	5.00E-04 ! 1.22E-05 ! 2.28E-10 ! 2.45E-02 ! 4.56E-07 !		
26FE 59	!	1.00E-04 ! 1.59E-06 ! 5.19E-07 ! 1.59E-02 ! 5.19E-03 !		
27CO 58	!	1.90E-03 ! 3.12E-05 ! 1.97E-05 ! 1.64E-02 ! 1.04E-02 !		
30ZN 65	!	2.20E-04 ! 2.30E-04 ! 1.23E-05 ! 1.04E+00 ! 5.57E-02 !		
74W 187	!	3.50E-04 ! 4.77E-10 ! 4.55E-10 ! 1.36E-06 ! 1.30E-06 !		
93NP 239	!	5.30E-04 ! 1.89E-09 ! 1.89E-09 ! 3.57E-06 ! 3.57E-06 !		
37RB 88	!	2.80E-02 ! 0.00E+00 ! 0.00E+00 ! 0.00E+00 ! 0.00E+00 !		
38SR 89	!	6.00E-05 ! 1.17E-06 ! 1.95E-10 ! 1.94E-02 ! 3.26E-06 !		
38SR 90	!	8.00E-06 ! 1.02E-04 ! 5.93E-11 ! 1.28E+01 ! 7.41E-06 !		
38SR 91	!	6.80E-05 ! 2.77E-12 ! 2.58E-12 ! 4.07E-08 ! 3.80E-08 !		
39Y 91M	!	4.40E-05 ! 4.82E-42 ! 4.82E-42 ! 1.10E-37 ! 1.10E-37 !		
39Y 91	!	1.00E-05 ! 3.52E-10 ! 2.54E-10 ! 3.52E-05 ! 2.54E-05 !		
39Y 93	!	2.90E-04 ! 1.63E-12 ! 1.62E-12 ! 5.60E-09 ! 5.60E-09 !		
40ZR 95	!	2.00E-04 ! 1.27E-06 ! 1.27E-06 ! 6.35E-03 ! 6.33E-03 !		
41NB 95	!	1.00E-04 ! 2.68E-07 ! 2.18E-07 ! 2.68E-03 ! 2.18E-03 !		
42MO 99	!	1.60E-03 ! 4.84E-08 ! 1.53E-08 ! 3.03E-05 ! 9.56E-06 !		
43TC 99M	!	1.70E-03 ! 2.02E-13 ! 2.00E-13 ! 1.19E-10 ! 1.18E-10 !		
44RU 103	!	3.10E-03 ! 6.40E-06 ! 5.65E-06 ! 2.06E-03 ! 1.82E-03 !		
44RU 106	!	3.80E-02 ! 2.17E-03 ! 1.63E-03 ! 5.71E-02 ! 4.28E-02 !		
47AG 110M	!	6.00E-04 ! 1.59E-04 ! 1.58E-04 ! 2.65E-01 ! 2.63E-01 !		
52TE 129M	!	7.80E-05 ! 7.11E-07 ! 1.49E-06 ! 9.11E-03 ! 1.91E-02 !		
52TE 129	!	3.10E-04 ! 1.46E-33 ! 1.46E-33 ! 4.69E-30 ! 4.69E-30 !		
52TE 131M	!	2.50E-04 ! 2.45E-09 ! 3.09E-09 ! 9.79E-06 ! 1.24E-05 !		
52TE 131	!	7.60E-05 ! 0.00E+00 ! 0.00E+00 ! 0.00E+00 ! 0.00E+00 !		



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 2

REV. 0

PAGE NO. 14 of 14

53I	131	!	4.00E-04	!	2.33E-07	!	1.10E-04	!	5.84E-04	!	2.76E-01	!
52TE	132	!	4.70E-04	!	6.52E-08	!	7.59E-08	!	1.39E-04	!	1.61E-04	!
53I	132	!	3.10E-04	!	1.11E-21	!	1.11E-21	!	3.58E-18	!	3.58E-18	!
53I	133	!	8.10E-04	!	1.32E-09	!	2.72E-07	!	1.63E-06	!	3.36E-04	!
53I	134	!	8.90E-05	!	1.69E-39	!	1.69E-39	!	1.90E-35	!	1.90E-35	!
55CS	134	!	1.00E-03	!	3.05E-02	!	1.11E-03	!	3.05E+01	!	1.11E+00	!
53I	135	!	7.80E-04	!	3.15E-12	!	2.94E-11	!	4.04E-09	!	3.77E-08	!
55CS	136	!	2.20E-02	!	1.97E-03	!	2.64E-05	!	8.96E-02	!	1.20E-03	!
55CS	137	!	2.00E-03	!	9.19E-02	!	1.27E-02	!	4.59E+01	!	6.36E+00	!
56BA	140	!	4.90E-03	!	2.31E-06	!	7.30E-07	!	4.71E-04	!	1.49E-04	!
57LA	140	!	8.00E-03	!	2.24E-07	!	2.24E-07	!	2.80E-05	!	2.80E-05	!
58CE	141	!	6.00E-05	!	1.18E-08	!	1.18E-08	!	1.97E-04	!	1.96E-04	!
58CE	143	!	5.00E-04	!	1.19E-09	!	1.19E-09	!	2.37E-06	!	2.37E-06	!
59PR	143	!	7.90E-05	!	3.18E-11	!	1.97E-11	!	4.02E-07	!	2.49E-07	!
59PR	144	!	1.70E-03	!	0.00E+00	!	0.00E+00	!	0.00E+00	!	0.00E+00	!
58CE	144	!	1.70E-03	!	1.05E-05	!	9.94E-06	!	6.19E-03	!	5.85E-03	!
0	TOTAL				2.15E+00		2.04E+00					
1												

0 TOTAL

1



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 3

REV. 0

PAGE NO. 1 of 3

Appendix 3

Email from Darren Lovvorn, Enercon, to Joanne Morris, Enercon, Subject: Information Request
(Reference to eroom files including WATER USER TABLES.xls)

Joanne Morris

From: ddlovvorn@enercon.com
Sent: Friday, April 18, 2008 1:43 AM
To: 'Joanne Morris'
Subject: Information Request

Joanne,

I have updated just about everything in the e-room in your folder. The changes mainly include the addition of water rights and clarification of the water uses. The distance maps (from the site and dam) have also been updated. The green tabs in the Water User Tables summarize the information. The other tabs are the sorting steps to find the appropriate water rights and/or contracts to include from the large databases. I am finished pending additional requests or clarifications from you.

-Darren



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 3

REV. 0

PAGE NO. 2 of 3

TCEQ ACTIVE WATER RIGHTS

WATER RIGHT NO.	OWNER	USE	LONGITUDE	LATITUDE	AC-FT/YR	DISTANCE FROM SCR DAM (FT)	CROP	ACRES
4098	BOB HARRIS OIL CO	IRR	-97.684181	32.240025	258	37907	No Use Reported	130
4099	DOROTHY W LITTLE ET AL	IRR	-97.645012	32.213223	5	69958	No Use Reported	27
4103	CYRIL WAGNER JR ET AL	IRR	-97.526665	32.129845	186	135764	No Use Reported	186
4104	CHISHOLM TRAIL VENTURES LP	IRR	-97.484886	32.145153	3,811	183745	Coastal Hay/Blue Stem	334/634
5157	BRAZOS RIVER AUTHORITY	MUN,IND,REC	-97.372017	31.866777	18,336	359057	NA	NA
1856*	CITY OF CLEBURNE*	MUN	-97.372017	31.866777	4,700	359057	No Diversion	NA
1874*	CITY OF WHITNEY*	MUN	-97.369652	31.866104	750	359057	No Diversion	NA
2309*	CLUBCORP GOLF*	IRR		LAKE WHITNEY*	400	359057	Bermuda Grass	150
1865	FRED T OWEN JR ET AL*	MUN		LAKE WHITNEY*	60	359057	No Diversion	NA
4315	CLIFFORD N AUTEN	IRR	-97.318924	31.845894	30	379320	Grass	14
4316	B W BOWERS & WIFE	IRR	-97.307419	31.84919	75	383024	Hay	20
4317	MARY ANN JENKINS ET AL	IRR	-97.288483	31.842878	243	389302	No Use Reported	96
4318	SMITH BEND RANCH LTD ¹	IRR, IND, MUN	-97.285728	31.842089	2153	390124	No Use Reported	628.85
4319	BIRCH WILFONG	IRR	-97.275978	31.836432	34	394184	No Use Reported	27
4320	WARREN D WHITLOW ET UX ²	IRR	-97.320229	31.794353	84	415075	No Use Reported	84
4321	DAVID BALLEW	IRR	-97.312424	31.764927	337	428128	Coastal Hay/Oats	55/68
4322	RONALD LEE BURNETTE	IRR	-97.302727	31.758867	175	432010	Hay	25
4323	RONALD LEE BURNETTE/KENNETH GAGE BURNETTE	IRR	-97.295204	31.7563	173	434524	Hay	35
4324	CHARLES L HARLESS ET UX	IRR	-97.286903	31.751728	305	437513	Coastal Bermuda	60

WATER RIGHT NO.	OWNER	USE	LONGITUDE	LATITUDE	AC-FT/YR	DISTANCE FROM SCR DAM (FT)	CROP	ACRES
4325	NELDA KATHRYN CARGILL	IRR	-97.280098	31.718229	48	Beyond 50 Miles	No Use Reported	-
4326	DAN WELDON WILLIAMS	IRR	-97.283684	31.716646	6	Beyond 50 Miles		
4327	DAN WELDON WILLIAMS	IRR	-97.285622	31.714777	4	Beyond 50 Miles		
4328	GEORGE L MOORE	IRR	-97.287415	31.703897	40	Beyond 50 Miles	No Use Reported	-
4329	THOMAS BROTHERS GRASS LTD	IRR	-97.276237	31.697586	856	Beyond 50 Miles	No Use Reported	274

* Denotes Water Supply Contract with BRA

Irrigation

Municipal/Domestic

¹ This water right has been amended to include future municipal use for customers that have not been identified and mining/industrial use.² This water right appears to have been amended for use in Brazos County; however, references to the Guadalupe River Basin and Bosque County are also cited.

Source

TCEQ Water Rights Database. http://www.tceq.state.tx.us/permitting/water_supply/water_rights/wr_databases.html
Records for individual water rights obtained from TCEQ Headquarters Central Records Room.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 3

REV. 0

PAGE NO. 3 of 3

BRA WATER CONTRACTS

OBJECTID	CONTRACT_I	COMPANY_NA	TYPE_CODE	LONGITUDE	LATITUDE	DISTANCE FROM SCR DAM (FT)	AC-FT/YR
213200	WHITNEY	WHITNEY, CITY OF ¹	MU	-97.37220000	31.86310000	359057	750
213206	CLEBURNE	CLEBURNE, CITY OF ²	MU	-97.37440000	31.86390000	359057	4700
213208	WHITE BLUFF_SW	DOUBLE DIAMOND, INC.	IR	-97.42780000	32.03330000	257750	1000
213259	LOCAL_WT	LAKESIDE DOMESTIC USE ³	IR	-97.37360000	31.86360000	359057	15
213277	HILCO UNITED	LAKE WHITNEY WATER COMPANY ⁴	MU	-97.37080000	31.85420000	359057	150
213285	WHITNEY GOLF	LAKE WHITNEY GOLF CLUB	IR	-97.34166667	31.93055556	351325	50
213311	OWEN	FRED T. OWEN, JR. ⁵	MU	-97.37310000	31.86330000	359057	60
213345	BOYD	JAMES K. BOYD	AG	-97.34666667	31.85500000	368220	10
213352	THE RETREAT	DOUBLE DIAMOND, INC.	IR	-97.48972222	32.17638889	159886	1200
213383	CLEBURNE 3	CLEBURNE, CITY OF ²	MULTI	-97.42861111	32.03250000	257750	5000
213389	MATTHEWS-08	CHARLES MATTHEWS	AG	-97.32583333	31.78944444	417935	50

Municipal/Domestic

Irrigation

Agricultural

¹ According to Brad Brunette (BRA Hydrologist), the City of Whitney has a municipal use contract with the BRA ; however, there is no diversion infrastructure and² According to Brad Brunette (BRA Hydrologist), the City of Cleburne has two (2) municipal use contracts with the BRA ; however, there is no diversion infrastructure and no water has been diverted.³ According to Brad Brunette (BRA Hydrologist), Lakeside Domestic Use, constitutes several contracts with residents along the shores of Lake Whitney for lawn irrigation. Residents pay the BRA and the water use is approxiamted.⁴ According to Kent Smith (Hillco - Lake Whitney Water Company), the Lake Whitney Water Company uses groundwater from the Trinity Aquifer. A surface water contract with the BRA for municipal use exists (Lake Whitney); however, there is currently no diversion.⁵ According to Brad Brunette (BRA Hydrologist), Fred T. Owen, Jr. has a municipal use contract with the BRA for the development of a subdivision; however, there is no diversion infrastructure and no water has been diverted.

Source:

Spacial data and selected contract use amounts obtained from Van Walker (BRA-GIS)

 ENERCON SERVICES, INC.	Estimated Annual Dose Due to Normal Liquid Effluents	CALC. NO. TXUT-001-ER-5.4-CALC-010 Appendix 4
		REV. 0
		PAGE NO. 1 of 5

Appendix 4

Email from Melissa Gayley, Enercon, to MAMorris et al., Subject: Population for Calculation, Attachments: PopulationResults.xls, PopSectorMiles (0 – 10 mi).jpg, PopSectorMiles (10 – 50 mi).jpg

From: Melissa Gayley [mgayley@enercon.com]
 Sent: Friday, March 14, 2008 3:22 PM
 To: mamorris@enercon.com; 'Joanne Morris'
 Cc: 'Christy Batterson'; BWELTMA1@txu.com; 'Chris Byerman'

Subject: Population for Calculation
 Attachments: PopulationResults.xls; PopSectorMiles (0 - 10 mi).jpg;
 PopSectorMiles (10 - 50 mi).jpg

Hello everyone,

Here is the completed population analysis using the mile radii (1, 2, 3, 4, 5, 10, 20, 30, 40, 50 mi). I have included permanent, transient, and total population projections for the years 2026 and 2058. The figures illustrate the sectors that correspond to the sector numbers in the table. Please keep in mind that these sector maps and population totals differ from the ones included in the document as the document analysis is based on kilometer radii per NUREG 1555. If there are any problems or if you need any further information for the calculation please contact me.

Thanks!

Melissa Gayley
 GIS Specialist

Enercon Services, Inc.
 6525 N. Meridian, Ste. 400
 Oklahoma City, OK 73116
 mgayley@enercon.com
 (405) 722-7693



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 4

REV. 0

PAGE NO. 2 of 5

Direction	Distance	Sector Number	2026 Permanent Population	2026 Transient Population	2026 Total Population	2058 Permanent Population	2058 Transient Population	2058 Total Population
N	0-1 mi	1	0	0	0	0	0	0
NNE	0-1 mi	2	0	0	0	0	0	0
NE	0-1 mi	3	0	0	0	0	0	0
ENE	0-1 mi	4	0	0	0	0	0	0
E	0-1 mi	5	0	0	0	0	0	0
ESE	0-1 mi	6	0	0	0	0	0	0
SE	0-1 mi	7	0	0	0	0	0	0
SSE	0-1 mi	8	0	0	0	0	0	0
S	0-1 mi	9	0	0	0	0	0	0
SSW	0-1 mi	10	13	0	13	16	0	16
SW	0-1 mi	11	12	0	12	15	0	15
WSW	0-1 mi	12	25	0	25	33	0	33
W	0-1 mi	13	10	0	10	13	0	13
WNW	0-1 mi	14	1	0	1	1	0	1
NW	0-1 mi	15	0	0	0	1	0	1
NNW	0-1 mi	16	0	0	0	0	0	0
N	1-2 mi	17	9	0	9	13	0	13
NNE	1-2 mi	18	13	0	13	17	0	17
NE	1-2 mi	19	8	0	8	11	0	11
ENE	1-2 mi	20	0	0	0	0	0	0
E	1-2 mi	21	0	0	0	0	0	0
ESE	1-2 mi	22	3	0	3	4	0	4
SE	1-2 mi	23	19	0	19	25	0	25
SSE	1-2 mi	24	31	0	31	40	0	40
S	1-2 mi	25	88	0	88	114	0	114
SSW	1-2 mi	26	97	0	97	126	0	126
SW	1-2 mi	27	73	0	73	95	0	95
WSW	1-2 mi	28	48	36	84	63	46	109
W	1-2 mi	29	13	0	13	17	0	17
WNW	1-2 mi	30	4	0	4	5	0	5
NW	1-2 mi	31	2	0	2	3	0	3
NNW	1-2 mi	32	1	0	1	1	0	1
N	2-3 mi	33	27	0	27	39	0	39
NNE	2-3 mi	34	27	0	27	39	0	39
NE	2-3 mi	35	27	0	27	37	0	37
ENE	2-3 mi	36	19	0	19	25	0	25
E	2-3 mi	37	65	0	65	84	0	84
ESE	2-3 mi	38	57	0	57	74	0	74
SE	2-3 mi	39	117	0	117	151	0	151
SSE	2-3 mi	40	205	0	205	265	0	265
S	2-3 mi	41	31	0	31	40	0	40
SSW	2-3 mi	42	15	0	15	19	0	19



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 4

REV. 0

PAGE NO. 3 of 5

Direction	Distance	Sector Number	2026 Permanent Population	2026 Transient Population	2026 Total Population	2058 Permanent Population	2058 Transient Population	2058 Total Population
SW	2-3 mi	43	26	0	26	33	0	33
WSW	2-3 mi	44	24	0	24	31	0	31
W	2-3 mi	45	22	0	22	31	0	31
WNW	2-3 mi	46	8	0	8	12	0	12
NW	2-3 mi	47	5	0	5	7	0	7
NNW	2-3 mi	48	12	0	12	17	0	17
N	3-4 mi	49	78	0	78	111	0	111
NNE	3-4 mi	50	64	0	64	92	0	92
NE	3-4 mi	51	160	0	160	228	0	228
ENE	3-4 mi	52	35	0	35	46	0	46
E	3-4 mi	53	109	0	109	141	0	141
ESE	3-4 mi	54	64	0	64	82	0	82
SE	3-4 mi	55	74	3514	3588	96	4548	4644
SSE	3-4 mi	56	105	0	105	136	0	136
S	3-4 mi	57	22	0	22	29	0	29
SSW	3-4 mi	58	22	644	666	29	1106	1135
SW	3-4 mi	59	27	0	27	35	0	35
WSW	3-4 mi	60	47	0	47	62	0	62
W	3-4 mi	61	74	0	74	105	0	105
WNW	3-4 mi	62	40	0	40	57	0	57
NW	3-4 mi	63	6	0	6	8	0	8
NNW	3-4 mi	64	22	0	22	32	0	32
N	4-5 mi	65	187	0	187	266	0	266
NNE	4-5 mi	66	126	0	126	180	0	180
NE	4-5 mi	67	198	0	198	282	0	282
ENE	4-5 mi	68	106	0	106	146	0	146
E	4-5 mi	69	28	0	28	37	0	37
ESE	4-5 mi	70	112	0	112	145	0	145
SE	4-5 mi	71	187	2655	2842	242	3436	3679
SSE	4-5 mi	72	1015	0	1015	1314	0	1314
S	4-5 mi	73	148	307	455	191	397	588
SSW	4-5 mi	74	25	0	25	32	0	32
SW	4-5 mi	75	54	0	54	70	0	70
WSW	4-5 mi	76	21	0	21	29	0	29
W	4-5 mi	77	113	0	113	161	0	161
WNW	4-5 mi	78	77	0	77	110	0	110
NW	4-5 mi	79	4	0	4	6	0	6
NNW	4-5 mi	80	80	0	80	114	0	114
N	5-10 mi	81	13110	39561	52672	18648	56273	74921
NNE	5-10 mi	82	9004	80	9083	12807	113	12920
NE	5-10 mi	83	3569	278	3847	5077	396	5473
ENE	5-10 mi	84	3797	0	3797	5377	0	5377
E	5-10 mi	85	262	0	262	340	0	340



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 4

REV. 0

PAGE NO. 4 of 5

Direction	Distance	Sector Number	2026 Permanent Population	2026 Transient Population	2026 Total Population	2058 Permanent Population	2058 Transient Population	2058 Total Population
ESE	5-10 mi	86	898	0	898	1162	0	1162
SE	5-10 mi	87	717	766	1483	928	991	1920
SSE	5-10 mi	88	2485	2087	4572	3217	2701	5917
S	5-10 mi	89	527	364	891	683	471	1153
SSW	5-10 mi	90	285	0	285	369	0	369
SW	5-10 mi	91	159	0	159	206	0	206
WSW	5-10 mi	92	149	0	149	204	0	204
W	5-10 mi	93	220	0	220	313	0	313
WNW	5-10 mi	94	394	0	394	560	0	560
NW	5-10 mi	95	1388	226	1613	1974	321	2295
NNW	5-10 mi	96	1370	0	1370	1949	0	1949
N	10-20 mi	97	11316	180	11496	16062	256	16318
NNE	10-20 mi	98	8864	143	9007	12609	203	12812
NE	10-20 mi	99	4644	111	4755	6788	162	6950
ENE	10-20 mi	100	2979	0	2979	4410	0	4410
E	10-20 mi	101	1431	364	1795	2119	539	2658
ESE	10-20 mi	102	574	0	574	836	0	836
SE	10-20 mi	103	401	0	401	500	0	500
SSE	10-20 mi	104	308	0	308	382	0	382
S	10-20 mi	105	1322	0	1322	1650	0	1650
SSW	10-20 mi	106	281	328	609	360	419	780
SW	10-20 mi	107	696	1	697	903	2	905
WSW	10-20 mi	108	683	0	683	888	0	888
W	10-20 mi	109	495	0	495	645	0	645
WNW	10-20 mi	110	692	0	692	925	0	925
NW	10-20 mi	111	849	30	878	1201	42	1243
NNW	10-20 mi	112	4679	8	4686	6649	11	6660
N	20-30 mi	113	10483	7520	18002	14807	10622	25429
NNE	20-30 mi	114	8875	0	8875	12527	0	12527
NE	20-30 mi	115	12350	0	12350	17815	0	17815
ENE	20-30 mi	116	45101	0	45101	67032	0	67032
E	20-30 mi	117	48046	15962	64008	71297	23687	94985
ESE	20-30 mi	118	2617	0	2617	3528	0	3528
SE	20-30 mi	119	2192	0	2192	2778	0	2778
SSE	20-30 mi	120	3331	834	4165	4130	1034	5164
S	20-30 mi	121	809	0	809	1003	0	1003
SSW	20-30 mi	122	2498	0	2498	2903	0	2903
SW	20-30 mi	123	1190	0	1190	1528	0	1528
WSW	20-30 mi	124	24402	6784	31186	31690	8810	40500
W	20-30 mi	125	4082	0	4082	5302	0	5302
WNW	20-30 mi	126	1292	0	1292	1675	0	1675
NW	20-30 mi	127	2150	0	2150	2789	0	2789
NNW	20-30 mi	128	3606	0	3606	5089	0	5089



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 4

REV. 0

PAGE NO. 5 of 5

Direction	Distance	Sector Number	2026 Permanent Population	2026 Transient Population	2026 Total Population	2058 Permanent Population	2058 Transient Population	2058 Total Population
N	30-40 mi	129	45504	52638	98142	64275	74352	138627
NNE	30-40 mi	130	89478	121	89599	125265	169	125434
NE	30-40 mi	131	418539	82858	501397	579473	114717	694190
ENE	30-40 mi	132	83056	7883	90939	122405	11617	134023
E	30-40 mi	133	11530	0	11530	16681	0	16681
ESE	30-40 mi	134	5882	0	5882	7779	0	7779
SE	30-40 mi	135	12977	13490	26466	16749	17411	34161
SSE	30-40 mi	136	5772	6187	11959	7157	7671	14827
S	30-40 mi	137	1113	0	1113	1320	0	1320
SSW	30-40 mi	138	428	0	428	451	0	451
SW	30-40 mi	139	1286	0	1286	1488	0	1488
WSW	30-40 mi	140	8238	0	8238	10651	0	10651
W	30-40 mi	141	1627	0	1627	2108	0	2108
WNW	30-40 mi	142	1326	0	1326	1691	0	1691
NW	30-40 mi	143	2334	0	2334	2885	0	2885
NNW	30-40 mi	144	28367	14601	42968	38695	19917	58611
N	40-50 mi	145	21230	151	21382	30146	215	30361
NNE	40-50 mi	146	103323	1171	104493	143955	1631	145586
NE	40-50 mi	147	707790	193182	900971	978773	267143	1245916
ENE	40-50 mi	148	185543	0	185543	270180	0	270180
E	40-50 mi	149	11949	0	11949	17747	0	17747
ESE	40-50 mi	150	14223	0	14223	18881	0	18881
SE	40-50 mi	151	3671	0	3671	4755	0	4755
SSE	40-50 mi	152	3669	10	3679	4559	12	4572
S	40-50 mi	153	2882	0	2882	3655	0	3655
SSW	40-50 mi	154	4698	1871	6569	4957	1974	6930
SW	40-50 mi	155	1436	0	1436	1424	0	1424
WSW	40-50 mi	156	5336	0	5336	5304	0	5304
W	40-50 mi	157	893	0	893	923	0	923
WNW	40-50 mi	158	1280	0	1280	1495	0	1495
NW	40-50 mi	159	1165	0	1165	1440	0	1440
NNW	40-50 mi	160	7700	0	7700	10106	0	10106
Total:			2,050,406	456,942	2,507,348	2,860,136	633,417	3,493,553



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 5

REV. 0

PAGE NO. 1 of 1

Appendix 5

Record of Phone Conference between Darren Lavvorn, Enercon and Brad Brunette, Brazos River Authority, Lake Whitney Municipile Surface Water Contracts

Record of Phone Conference

CONTACT INFORMATION

Project Number:	MITS004	Enercon Rep:	Darren Lovvorn
Subject:	Lake Whitney Municipal Surface Water Contracts	Follow-up by:	
Date:	4/16/08	NOTES:	
Outside Party:	Brad Brunette		
Job Title:	Hydrologist		
Company:	Brazos River Authority		
Website:	N/A		
Phone:	(254) 761-3171		
Address:			
Email:	N/A		

INFORMATION REQUESTED

The status of BRA municipal use water contracts on Lake Whitney.

INFORMATION OBTAINED

According to Brad Brunette (BRA Hydrologist), the City of Whitney has a municipal use contract with the BRA ; however, there is no diversion infrastructure and no water has been diverted.

Lakeside Domestic Use, constitutes several contracts with residents along the shores of Lake Whitney for lawn irrigation. Residents pay the BRA and the water use is approximated. The City of Cleburne has two (2) municipal use contracts with the BRA; however, there is no diversion infrastructure and no water has been diverted. Fred T. Owen, Jr. has a municipal use contract with the BRA for the development of a subdivision; however, there is no diversion infrastructure and no water has been diverted.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 6

REV. 0

PAGE NO. 1 of 3

Appendix 6

Email from John Tibbs, Texas Parks and Wildlife Department, to Audrey Thompson, Enercon, Subject:
RE: Recreation and Fisheries Data Needed for Local Rivers

From: John Tibbs [John.Tibbs@tpwd.state.tx.us]
Sent: Friday, April 11, 2008 2:29 PM
To: 'Audrey Thompson'
Cc: michael.baird@tpwd.state.tx.us; 'Brian VanZee'
Subject: RE: Recreation and Fisheries Data Needed for Local Rivers

Attachments: Whitney creel harvest 2000 for Comanche peak request
2008.xls

Audrey,

I'd be happy to help you with the questions you have regarding the fisheries downstream of Comanche Peak. Unfortunately, the information we have is rather limited, or at least different, compared to what you are looking for.

We don't have any data for that stretch of the Brazos River. The data we have for Squaw Creek is all catch data from standard sampling that we conduct using electrofishing and nets. That data is limited to pre 9/11 samples, as the angling public has not been allowed on Squaw Creek since that day.

We have some creel data for Lake Whitney that will address some of what you are looking for, but it is from 1999-2000, prior to the golden alga outbreaks which have impacted fishing and the number of anglers on the reservoir. I can provide total hours of angler usage for that year, as well as number of fish harvested or released by species. I do not have weight information. We do have quite a bit of electrofishing and netting data on Whitney if that would meet your needs. Also, we plan on sampling the Brazos River over the next two years using a new river sampling boat that we are putting together.

There is no commercial fish harvest in Squaw Creek, that section of the Brazos River, and Lake Whitney.

For additional information on usage by the public and water quality, you should probably contact the USACE, BRA, and TCEQ.

Please see the attached Excel sheet regarding the above information.

Let me know if this is all you need, or if you have other questions. I will be out of the office Mon-Wed of next week.

John Tibbs
Texas Parks & Wildlife Dept
Inland Fisheries District Supervisor - Waco 254-666-5190



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 6

REV. 0

PAGE NO. 2 of 3

-----Original Message-----

From: Audrey Thompson [mailto:athompson@enercon.com]
Sent: Thursday, April 10, 2008 8:19 AM
To: john.tibbs@tpwd.state.tx.us
Subject: Recreation and Fisheries Data Needed for Local Rivers

Mr. Tibbs,

I am currently working with Comanche Peak Nuclear Power Plant to conduct a study of the local water bodies within 50 miles of the plant, particularly for the Whitney Reservoir, the Brazos River, and Squaw Creek. However, I am having trouble locating some important information. Could you please point me in the right direction to locate the following data:

Shoreline usage
Boating usage
Swimming usage
Harvest of sport fish (kg/year)
Harvest of commercial fish (kg/year)

Any information or guidance you can provide would be greatly appreciated.
Thank you.

Audrey Thompson
Enercon Services, Inc.
(770) 590-2014

This email and any of its attachments may contain ENERCON proprietary information, which is privileged, confidential, or subject to copyright belonging to ENERCON. This email is intended solely for the use of the individual or entity to which it is addressed. If you are not the intended recipient of this email, please delete it without reading it. You are hereby notified that any dissemination, distribution, copying, or action taken in relation to the contents of and attachments to this email is strictly prohibited and may be unlawful. If you have received this email in error, please delete the original and any copy of this email and any printout.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 6

REV. 0

PAGE NO. 3 of 3

Table 1: Total hours fished by bank anglers and boat anglers on Lake Whitney 12/1/99 through 11/30/00

<u>Bank</u>	<u>RSE</u>	<u>Boat</u>	<u>RSE</u>	<u>Total</u>	<u>RSE</u>
34768	26.7	134071		17	168838

RSE = relative standard error

Table 2: Total number of sportfish harvested or released by species on Lake Whitney 12/1/99 through 11/30/00

<u>Fish Species</u>	<u>Harvest</u>	<u>RSE</u>	<u>Released</u>	<u>RSE</u>
White bass	13866	40	6816	57
Striped bass	13994	32	7456	38
Largemouth bass	2960	65	16931	39
Smallmouth bass	114	286	2985	100
White crappie	4152	73	892	157
Black crappie	1736	139	0	0
Freshwater drum	433	290	1830	112
Blue catfish	2681	95	1036	173
Channel catfish	7784	47	3418	79

Harvest is # of fish harvested

RSE = relative standard error



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 7

REV. 0**PAGE NO.** 1 of 5**Appendix 7**

Texas Parks and Wildlife, Historical Fish Kill Events Involving the Golden Alga, *Prymnesium parvum*, in Texas

TPWD: Blooms Data

Page 1 of 5

[HOME](#) [REGULATIONS](#) [PUBLICATIONS](#) [OUTDOOR LEARNING](#) [KIDS](#) [GAME WARDEN](#) [GRANTS](#) [GET INVOLVED](#) [SHOP](#) [FAQ](#) [PRINT FRIENDLY](#)

[CALENDAR](#) [ESPAÑOL](#)

[EXPERIENCE TEXAS](#) | [FISHING & BOATING](#) | [STATE PARKS & DESTINATIONS](#) | [HUNTING & WILDLIFE](#) | [LAND & WATER](#) |

[DOING BUSINESS](#) |

Harmful Algal Blooms:

- [Golden Alga](#)
- [Brown Tide](#)
- [Red Tide](#)
- [Other Harmful Algae](#)
- [HAB Research](#)

Golden Alga Information:

- [Current Bloom Status Reports](#)
- [FAQ](#)
- [Golden Alga News Releases](#)
- [Historic Blooms](#)
- [Research and Management](#)

Historic Blooms in Texas

Historical Fish Kill Events Involving the Golden Alga, *Prymnesium parvum*, in Texas

This page features historical data through Spring 2004. [Get current bloom status.](#)

This is a historical listing of fish kills due to toxic Golden Alga in Texas in chronological order by river basin. This chart gives the estimated number of fish killed at each event; bivalves (i.e. clams and mussels) have also been killed but are not included here.

Beginning	End	River Basin	County(ies)	Affected Waterbody (les)	Estimated # of Fish Killed
08/14/1981*	08/18/1981	Brazos	Stonewall	Brazos River	506,600
10/20/1982*	12/10/1982	Brazos	Haskell	California Creek	4,681
10/25/1988	11/06/1988	Brazos	Haskell, Throckmorton	California Creek, Paint Creek	43,356
04/24/1989	05/16/1989	Brazos	Haskell	Paint Creek	15,162
05/02/1992	?	Brazos	Stonewall	Double Mountain Fork Brazos R.	700
10/05/1997	10/12/1997	Brazos	Young	Brazos River	640,446
06/25/1998	07/20/1998	Brazos	Fisher	Clear Fork of the Brazos	33,873
01/11/2001	07/15/2001	Brazos	Palo Pinto	Possum Kingdom Reservoir	200,027
01/27/2001	06/20/2001	Brazos	Hood	Lake Granbury	409,952
04/13/2001	06/21/2001	Brazos	Hill, Bosque	Lake Whitney	9,596

<http://www.tpwd.state.tx.us/landwater/water/environconcerns/hab/ga/blooms.phtml>

5/13/2008



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents**CALC. NO.**

TXUT-001-ER-5.4-CALC-010

Appendix 7

REV. 0**PAGE NO.** 2 of 5

TPWD: Blooms Data

Page 2 of 5

01/01/2003	04/21/2003	Brazos	Palo Pinto	Possum Kingdom Reservoir	1,475,212
02/03/2003	04/30/2003	Brazos	Hood	Lake Granbury	3,550,159
02/18/2003	05/01/2003	Brazos	Hill, Bosque	Lake Whitney, Brazos River	1,264,236
03/18/2003	04/10/2003	Brazos	Nolan	Lake Sweetwater	7,801
02/03/2003	04/30/2003	Brazos	Lubbock	Lubbock City Lakes 1-6	9,130
03/10/2003	04/30/2003	Brazos	Lubbock	Buffalo Springs Lake	2,203
08/14/2003	08/30/2003	Brazos	Young	Brazos River	124,799
				Total in Brazos River Basin	8,297,933
02/10/2003	04/01/2003	Canadian	Hutchinson	Stilling Basin Lake Meredith	48
				Total in Canadian River Basin	48
08/12/1989	08/18/1989	Colorado	Runnels	Colorado River	4,080
08/16/1989	08/30/1989	Colorado	Runnels	Colorado River	1,723
08/30/1989	09/11/1989	Colorado	Coke	Colorado River	8,542
09/11/1989	09/15/1989	Colorado	Coleman	Colorado River	1,000
11/12/1989	11/18/1989	Colorado	Mills, San Saba	Colorado River	48,928
10/23/2001	10/30/2001	Colorado	Howard	Moss Creek Lake	6,381
10/18/2001	10/30/2001	Colorado	Coke	E.V. Spence Reservoir	2,213,953
01/24/2002	01/28/2002	Colorado	Mitchell	Colorado City Lake	4,060
11/26/2001	12/20/2001	Colorado	Runnels	Colorado River	5,986



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents**CALC. NO.**

TXUT-001-ER-5.4-CALC-010

Appendix 7

REV. 0**PAGE NO.** 3 of 5

TPWD: Blooms Data

Page 3 of 5

01/15/2002	01/29/2002	Colorado	Midland	Wadley-Barrow Park Pond	6,300
01/29/2002	02/05/2002	Colorado	Coke	E.V. Spence Reservoir	1,223
01/29/2002	02/05/2002	Colorado	Mitchell	Colorado City Lake	61,781
10/09/2002	03/19/2003	Colorado	Mitchell	Colorado City Lake	15
01/08/2003	03/19/2003	Colorado	Coke	E.V. Spence Reservoir	175
01/14/2003	03/19/2003	Colorado	Mitchell, Coke, Concho, Runnels	Colorado River	1,199
				Total in Colorado River Basin	2,365,346
01/15/2001	03/15/2001	Red	Archer	Dundee State Fish Hatchery	5,121,827
03/12/2001	06/15/2001	Red	Baylor, Archer	Lake Diversion	309
02/28/2002	04/10/2002	Red	Baylor	Lake Kemp	7,400
01/08/2003	04/20/2003	Red	Baylor	Lake Kemp	329
03/24/2003	04/20/2003	Red	Childress	Baylor Lake	1,490
				Total in Colorado River Basin	5,131,355
04/21/1985*	04/27/1985	Rio Grande	Loving	Red Bluff Reservoir	10,125
10/31/1985	11/10/1985	Rio Grande	Crockett, Pecos, Terrell, Val Verde	Pecos River	111,459
11/19/1985*	11/20/1985	Rio Grande	Val Verde	Pecos River	300
11/20/1986*	12/12/1986	Rio Grande	Pecos, Terrell, Val Verde, Crockett	Pecos River	263,879
11/05/1988	11/16/1988	Rio	Reeves, Loving, Ward, Pecos	Red Bluff Reservoir	1,580,320



ENERCON SERVICES, INC.

Estimated Annual Dose Due to Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010


Appendix 7

REV. 0**PAGE NO.** 4 of 5

TPWD: Blooms Data

Page 4 of 5

		Grande	Crane, Crockett	Pecos R.	
12/06/1989	12/06/1989	Rio Grande	Reeves	Red Bluff Reservoir	50
11/03/1993	11/21/1993	Rio Grande	Pecos, Terrell, Val Verde, Crockett	Pecos River	33,124
12/05/1995	12/09/1995	Rio Grande	Crockett, Terrell	Pecos River	7,598
01/06/2003	02/15/2003	Rio Grande	Reeves	Red Bluff Reservoir	1,156
				Total in Rio Grande Basin	2,008,011
				Total	17,802,293

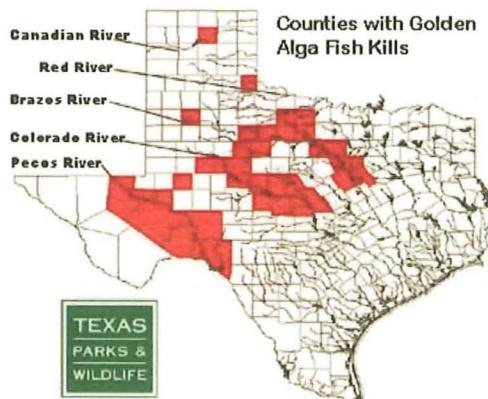* Suspected due to *P. parvum*Texas rivers affected by Golden Alga. [Read details of map.](#)

Impacts of Blooms

Current Bloom Status

[top of page](#)

Additional Information:

Would you like to know more?



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 7

REV. 0

PAGE NO. 5 of 5

TPWD: Blooms Data

Page 5 of 5

The [Biology of Golden Alga](#) summarizes what we know about the alga and its toxins.

Where does golden alga fit compared to other single-celled organisms? The [Golden Alga Family Tree](#) gives examples of and information about golden alga and other protists.

What does golden alga look like?

TPWD [Golden Alga Images](#) has photos of fish kills, golden algal cells, and short videos of live golden alga. These images may be used for noncommercial/educational purposes as long as TPWD is given credit and other [site policies](#) are followed.

Golden Alga Information Card: TPWD has collaborated with TCEQ and other entities to produce a [golden alga information card](#)(pdf document). The purpose of this card is to educate the public on golden alga blooms and answer some common questions. Hard copies of this card are available for free by contacting [Meridith Byrd](#) at 512.912.7068.

Contact Us | Help | Accessibility | Media | Site Policies | Complaints | Intranet | TRAILS Search | TexasOnline | Compact with Texans



Texas Parks and Wildlife Department, 4200 Smith School Road, Austin, TX 78744
Toll Free: (800) 792-1112, Austin: (512) 389-4800
Content of this site © Texas Parks and Wildlife Department unless otherwise noted.

Last modified: August 8, 2007, 10:47 am



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 8

REV. 0

PAGE NO. 1 of 2

Appendix 8
U. S. Census Bureau, American Fact Finder, Population Finder

Cleburne city, Texas - Population Finder - American FactFinder

Page 1 of 1



POPULATION FINDER

United States | Texas | Cleburne city
Cleburne city, Texas

U.S. Census Bureau
American FactFinder

city/town, county, or zip

Cleburne

state

Texas

GO

search by address >

The 2006 population estimate for Cleburne city, Texas is 29,689.

Note: Information about challenges to population estimates data can be found on the Population Estimates Challenges page.

[View population trends...](#)

Population	2008	2000	1990
	29,689	26,005	22,206

Source: U.S. Census Bureau, 2006 Population Estimates, Census 2000, 1990 Census

[View more results...](#)

Population for all cities and towns in Texas, 2000:

[alphabetic](#) | [ranked](#)

Map of Persons per Square Mile, City/Town by Census Tract:

[2000](#) | [1990](#)

[See more data for Cleburne city, Texas on the Fact Sheet.](#)

The letters PDF or symbol indicate a document is in the Portable Document Format (PDF). To view the file you will need the Adobe® Acrobat® Reader, which is available for free from the Adobe web site.



ENERCON SERVICES, INC.

Estimated Annual Dose Due to
Normal Liquid Effluents

CALC. NO.

TXUT-001-ER-5.4-CALC-010

Appendix 8

REV. 0

PAGE NO. 2 of 2

Whitney town, Texas - Population Finder - American FactFinder

Page 1 of 1



POPULATION FINDER

United States | Texas | Whitney town
Whitney town, Texas

city/town, county, or zip

Whitney

state

Texas

search by address

The 2006 population estimate for Whitney town, Texas is 2,068.

Note: Information about challenges to population estimates data can be found on the Population Estimates Challenges page.

[View population trends...](#)

	2008	2000	1990
Population	2,068	1,833	1,526

Source: U.S. Census Bureau, 2006 Population Estimates, Census 2000, 1990 Census

[View more results...](#)

[Population for all cities and towns in Texas, 2000:](#)

[alphabetical](#) | [ranked](#)

[Map of Persons per Square Mile, City/Town by Census Tract:](#)

[2000](#) | [1990](#)

[See more data for Whitney town, Texas on the Fact Sheet.](#)

The letters PDF or symbol indicate a document is in the Portable Document Format (PDF). To view the file you will need the Adobe® Acrobat® Reader, which is available for free from the Adobe web site.