

POWER AUTHORITY OF THE STATE OF NEW YORK

10 COLUMBUS CIRCLE NEW YORK, N.Y. 10019

(212) 397-6200

TRUSTEES

JOHN S. DYSON
CHAIRMAN

GEORGE L. INGALLS
VICE CHAIRMAN

RICHARD M. FLYNN

JAMES L. LARocca

ROLLAND E. KIDDER



LEROY W. SINCLAIR
PRESIDENT & CHIEF
OPERATING OFFICER

WALTER T. KICINSKI
FIRST EXECUTIVE
VICE PRESIDENT &
CHIEF ADMINISTRATIVE
OFFICER

JOSEPH R. SCHMIEDER
EXECUTIVE VICE
PRESIDENT & CHIEF
ENGINEER


STEPHEN L. BAUM
SENIOR VICE PRESIDENT
& GENERAL COUNSEL

May 5, 1983
IPN-83-37

Director of Nuclear Reactor Regulation
U. S. Nuclear Regulatory Commission
Washington, D. C. 20555

Attention: Mr. Steven A. Varga, Chief
Operating Reactors Branch No. 1
Division of Licensing

Subject: Indian Point 3 Nuclear Power Plant
Docket No. 50-286
Proposed Changes to the Technical Specifications
Related to Safety Limit, Reactor Core & Control
Rod & Power Distribution Limits, Shutdown Reactivity

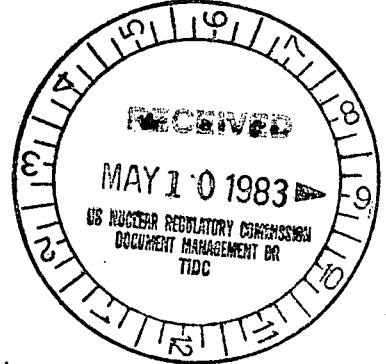

Dear Sir:

Our letter of January 13, 1983 (IPN-83-51) served to submit an application for an Operating License Amendment and proposed changes to the Technical Specifications. However, inadvertently the document entitled, "Application for Amendment to Operating License," was not notarized. This letter serves to resubmit the application for Operating License Amendment with the proper notarization. We regret any inconvenience this may have caused.

Enclosed for filing are three (3) signed originals and nineteen (19) copies of a document entitled, "Application for Amendment to Operating License," together with forty (40) copies of Attachment I and II thereto, comprising a statement of the proposed changes to the Technical Specifications and the associated Safety Evaluation.


This application seeks to amend Sections 2.1, 2.3, 3.1 and 3.10 of Appendix A (Technical Specifications) to the Operating License. The proposed changes result from an Appendix K Emergency Core Cooling System (ECCS) reanalysis performed for a steam generator equivalent tube plugging level of twenty-four (24) percent. This analysis was completed using the NRC approved 1981 Westinghouse evaluation model and demonstrates that the Indian Point 3 facility fully complies with the requirements of 10 CFR 50.46 and the February 11, 1980 Confirmatory Order. The ECCS reanalysis is included in Attachment III. The proposed changes also delete references to three-loop operating since IP-3 is restricted to 10% power or less for less than four-loop operation.

8305110053 830505
PDR ADDCK 05000286
P PDR

Handwritten: A001 3/10

The Authority has classified this application for amendment to the operating license as Class III since it involves the single safety issue of the ECCS reanalysis. A check in the amount of \$4,000 was enclosed in our letter of January 13, 1982 as the filing fee per 10 CFR 170.22. As this letter constitutes a resubmittal of the Application for Operating License Amendment contained in our January 13, 1983 letter, an additional payment is not applicable.

Very truly yours,

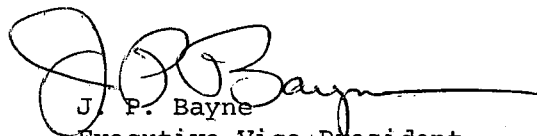A handwritten signature in black ink, appearing to read "J. P. Bayne", with a long horizontal flourish extending to the right.

J. P. Bayne
Executive Vice President
Nuclear Generation

cc: Resident Inspector's Office
Indian Point Unit 3
U. S. Nuclear Regulatory Commission
P. O. Box 38
Buchanan, New York 10511