

List of Requested Changes in the
Technical Specifications for
Fuel Loading and Subcritical Testing
Indian Point Unit No. 2

TECHNICAL SPECIFICATION NO. 3.8

1. Basis (p. 3.8-3) in the second paragraph, Line 5, change "1564 ppm" to "1615 ppm".

TECHNICAL SPECIFICATION NO. 5.3

1. 5.3.A.1 (p. 5.3-1) - Change the second sentence to read:
"The pellets are encapsulated in Zircaloy-4 tubing,
pre-pressurized with Helium to approximately 450 psig,
to form fuel rods".
2. 5.3.A.2 (p. 5.3-1) - In Line 1, change "2.70" to "2.76".
In Line 3, change "3.20" to "3.30".
3. 5.3.A.4. (p. 5.3-2) - In Line 2, change "1160" to "1412".
In Line 2, change "6, 12 and 16'rod" to "7, 8, 9, 12, 16
and 20-rod".

REFERENCES

1. (p. 3.8-5) - In Reference (2), delete "FSAR- Table 3.2.1-1"
and add "Fuel Densification- Indian Point Nuclear
Generating Station Unit No. 2, dated January 1973,
Table 3.3".
2. (p. 5.3-2) - In Reference (1), add "Application for a
Special Nuclear Material License, dated October 6, 1972,
Section III.B."

(p. 5.3-2) - In Reference (2), delete "FSAR Section 3.2.1"
and add "Application for a Special Nuclear Material License,
dated October 6, 1972, Table 1."

(p. 5.3-2) - In Reference (3), delete "FSAR Section 3.2.3".
and add "Fuel Densification - Indian Point Nuclear
Generating Station Unit No. 2, dated January 1973,
Figure 3.3."

5.3 REACTOR

Applicability

Applies to the reactor core, reactor coolant system, and emergency core cooling systems.

Objective

To define those design features which are essential in providing for safe system operations.

A. Reactor Core

1. The reactor core contains approximately 87 metric tons of uranium in the form of slightly enriched uranium dioxide pellets. The pellets are encapsulated in Zircaloy-4 tubing, prepressurized with Helium to approximately 450 psig, to form fuel rods. The reactor core is made up of 193 fuel assemblies. Each fuel assembly contains 204 fuel rods. ⁽¹⁾
2. The average enrichment of the initial core is a nominal 2.76 weight per cent of U-235. Three fuel enrichments are used in the initial core. The highest enrichment is a nominal 3.30 weight per cent of U-235. ⁽²⁾
3. Reload fuel will be similar in design to the initial core. The enrichment of reload fuel will be no more than 3.4 weight per cent of U-235.

4. Burnable poison rods are incorporated in the initial core. There are 1412 poison rods in the form of 7, 8, 9, 12, 16 and 20 rod clusters, which are located in vacant rod cluster control guide tubes.⁽³⁾ The burnable poison rods consist of borated pyrex glass clad with stainless steel.⁽⁴⁾
5. There are 53 full-length RCC assemblies and 8 partial-length RCC assemblies in the reactor core. The full-length RCC assemblies contain a 142 inch length of silver-indium-cadmium alloy clad with the stainless steel. The partial-length RCC assemblies contain a 36 inch length of silver-indium-cadmium alloy with the remainder of the stainless steel sheath filled with Al_2O_3 .⁽⁵⁾

B. Reactor Coolant System

1. The design of the reactor coolant system complies with the code requirements.⁽⁶⁾
2. All piping, components and supporting structures of the reactor coolant system are designed to Class I requirements, and have been designed to withstand the maximum potential seismic ground acceleration, 0.15g, acting in the horizontal and 0.10g acting in the vertical planes simultaneously with no loss of function.
3. The total liquid volume of the reactor coolant system, at rated operating conditions, is 11,350 cubic feet.

References

- (1) FSAR Section 3.2.2, Application for a Special Nuclear Materials License, dated October 6, 1972, Section IIIB
- (2) Application for a Special Nuclear Materials License, dated October 6, 1972, Table 1.
- (3) Fuel Densification - Indian Point Nuclear Generating Station Unit No. 2, dated January 1973, Figure 3.3
- (4) FSAR Section 3.2.3
- (5) FSAR Sections 3.2.1 and 3.2.3
- (6) FSAR Table 4.1.9

- B. If any of the specified limiting conditions for refueling is not met, refueling shall cease until the specified limits are met, and no operations which may increase the reactivity of the core shall be made.

Basis

The equipment and general procedures to be utilized during refueling are discussed in the FSAR. Detailed instructions, the above specified precautions, and the design of the fuel handling equipment incorporating built-in interlocks and safety features, provide assurance that no incident could occur during the refueling operations that would result in a hazard to public health and safety.⁽¹⁾ Whenever changes are not being made in core geometry, one flux monitor is sufficient. This permits maintenance of the instrumentation. Continuous monitoring of radiation levels (2 above) and neutron flux provides immediate indication of an unsafe condition. The residual heat pump is used to maintain a uniform boron concentration.

The shutdown margin indicated in Part 5 will keep the core subcritical, even if all control rods were withdrawn from the core. During refueling, the reactor refueling cavity is filled with approximately 350,000 gallons of water from the refueling water storage tank with a boron concentration of 2000 ppm. The minimum boron concentration of this water at 1615 ppm boron is sufficient to maintain the reactor subcritical by at least 10% $\Delta k/k$ in the cold condition with all rods inserted, and will also maintain the core subcritical even if no control rods were inserted into the reactor.⁽²⁾ Periodic checks of refueling water boron concentration insure the proper shutdown margin. Part 6 allows the control room operator to inform the manipulator operator of any impending unsafe condition detected from the main control board indicators during fuel movement.

In addition to the above safeguards, interlocks are utilized during refueling to ensure safe handling. An excess weight interlock is provided on the lifting hoist to prevent movement of more than one fuel assembly at a time. The spent fuel transfer mechanism can accommodate only one fuel assembly at a time.

The presence of a licensed senior reactor operator at the site and designated in charge provides qualified supervision of the refueling operation during changes in core geometry.

References

- (1) FSAR - Section 9.5.2
- (2) Fuel Densification - Indian Point Nuclear Generating Station Unit No. 2, dated January 1973, Table 3.3

LAW OFFICES OF
LEBOEUF, LAMB, LEIBY & MACRAE
1821 JEFFERSON PLACE, N.W.
WASHINGTON, D. C. 20036

Regulatory

File Cy.

ARVIN E. UPTON
EUGENE B. THOMAS, JR.
LEONARD M. TROSTEN
HARRY H. VOIGT
WASHINGTON PARTNERS

ONE CHASE MANHATTAN PLAZA
NEW YORK, N. Y. 10005

January 30, 1973

WASHINGTON TELEPHONE
202 FEDERAL 8-0111

CABLE ADDRESS
LALALU, WASHINGTON D. C.



Mr. John F. O'Leary
Director
Directorate of Licensing
U. S. Atomic Energy Commission
Washington, D. C. 20545

Re: Consolidated Edison Company
of New York, Inc.
Indian Point Unit No. 2
AEC Docket No. 50-247

Dear Mr. O'Leary:


As counsel for Consolidated Edison Company of New York, Inc., Applicant in the above-captioned proceeding, we hereby file three (3) originals and twenty-five (25) copies of a Petition Requesting Extension of Completion Date.

Very truly yours,

LeBoeuf, Lamb, Leiby & MacRae

LeBoeuf, Lamb, Leiby & MacRae
Attorneys for Applicant

Enclosures

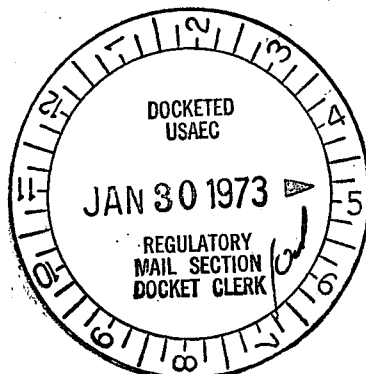

771
EW

8110310792