



DEC 21 2009
SCH09-139

CERTIFIED MAIL
RETURN RECEIPT REQUESTED
ARTICLE NUMBER: 7008 0150 0000 5749 4376

Department of Environmental Protection
Division of Water Quality
Bureau of Permit Management
P.O. Box 029
Trenton, N.J. 08625-0029

**NEW JERSEY POLLUTANT DISCHARGE ELIMINATION SYSTEM
DISCHARGE MONITORING REPORT
SALEM GENERATING STATION
NJPDES PERMIT NJ0005622**

Dear Sir:

Attached is the Discharge Monitoring Report for the Salem Generating Station for the month of November 2009.

This report is required by and prepared specifically for the New Jersey Department of Environmental Protection (NJDEP). It presents only the observed results of measurements and analyses required to be performed by the above agencies. The choice of the measurement devices and analytical methods are controlled by the EPA and the NJDEP, not by the company, and there are limitations on the accuracy of such measurement devices and analytical techniques even when used and maintained as required. Accordingly, this report is not intended as an assertion that any instrument has measured, or that any reading or analytical result represents the true value with absolute accuracy, nor is it an endorsement of the suitability of any analytical or measurement procedure.

Please note, a dye test was performed on November 17th & 18th, 2009. The summary of results is also attached.

If you have any questions concerning this report, please feel free to contact Bob Bernard (856) 339-1636.

Sincerely,

A handwritten signature in black ink, appearing to read "R. Braun", written over a horizontal line.

Robert C. Braun
Site Vice President – Salem

JE25
NRA

DEC 21 2009

Attachment (12 DMR's & Dye Test Results)

C Executive Director, DRBC
USNRC - Docket numbers 50-272 & 50-311

EXPLANATION OF CONDITIONS

November 2009

The following explanations are included to clarify possible deviation from permit conditions.

General - The columns labeled "No. Ex" on the enclosed DMR tabulate the number of daily discharge values outside the indicated limits.

Data reporting and accuracy reflect the working environment, the design capabilities and reliability of the monitoring instruments and operating equipment.

Deviations from required sampling, analysis monitoring and reporting methods and periodicities are noted on the respective transmittal sheet.

Results reported on the Discharge Monitoring Report forms are consistent with permit limits, data supplied from contract laboratories, the December 1993 revision of the NJDEP DMR Instruction Manual and specific guidance from DEP personnel.

DEC 21 2009

EXPLANATION OF EXCEEDANCES

November 2009

The following exceedance(s) are included in the attached report and explained below.

DSN No.	EXPLANATION
---------	-------------

None.	
-------	--

COUNTY OF SALEM
STATE OF NEW JERSEY

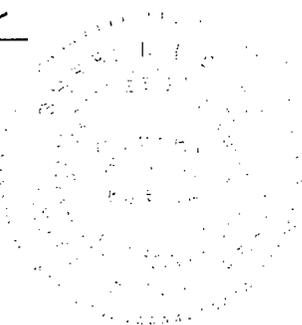
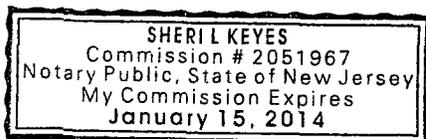

I, Robert C. Braun of full age, being duly sworn according to law, upon my oath depose and say:

1. I am the Site Vice President – Salem for PSEG Nuclear, and as such am authorized to sign Salem's Discharge Monitoring Reports submitted to the New Jersey Department of Environmental Protection pursuant to the Station's New Jersey Pollutant Discharge Elimination System permit.
2. I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe the submitted information is true, accurate and complete. I am aware that there are significant penalties for submitting false information including the possibility of fine and imprisonment.
3. The signature on the attached Discharge Monitoring Reports is my signature and I am submitting this affidavit in satisfaction of the requirement that my signature be notarized.



Robert C. Braun
Site Vice President – Salem

Sworn and subscribed before me
this 18 day of December 2009



DEC 21 2009

BC Site Vice President – Salem
Director – Regulatory Affairs
John Valeri Jr., Esq.
Salem Radwaste and Environmental Supervisor
E. J. Keating
Helen Gregory
Chem File SCH09-139



TO: William G. Biggs
Technical Analyst
Salem Chemistry - PSEG Power

November 20, 2009
Report No. TP09066

SUBJECT: **DETERMINATION OF CIRCULATING WATER FLOW AT
SALEM GENERATING STATION UNIT 1**

CONDUCTED BY: Victor Simpson
Sr. Test Engineer, Maplewood Testing Services

SUMMARY

The Mechanical Division of Maplewood Testing Services conducted a series of test runs at Salem Unit No. 1 to determine the capacities of the circulating water pumps shown in the table below.

Work was performed under SAP work orders:
30171093, 30171169, 30171094, 30171095, 30171161, 30171096

Please note that the CMS designation for the pump in 11A could not be determined.

Final results are as follows:

SUMMARY OF TEST RESULTS

Pump No.	CMS Pump Desig.	Test Date	Measured Pump Capacity (gpm)	Pump Suction Head (ft h2o)	Pump Discharge Head (ft h2o)	Total Static Head (ft h2o)
11A	?	11/17/09	159598	-6.0	18.3	24.3
11B	H	11/17/09	159364	-5.9	18.8	24.7
12A	C	11/17/09	144053	-8.8	18.9	27.7
12B	K	11/18/09	155878	-7.5	18.3	25.8
13A	D	11/18/09	162400	-6.9	19.8	26.7
13B	J	11/18/09	151199	-6.1	17.9	24.0

Note: Pump suction heads and discharge heads corrected to elevation 100'

Pump 12A (C) was removed from service after testing of this pump was completed. Station indications showed necessity to clean the water box.

William G. Biggs
Technical Analyst
Salem Chemistry - PSEG Power

November 20, 2009
Report No. TP09066

SUMMARY (Cont'd)

For reporting purposes, shown below is the data pertinent to the injection of Rhodamine WT dye released to the river during testing. Testing is complete at this station.

RECORD OF RHODAMINE WT DYE INJECTION

Test Date	Pump No.	Injection Time		Pure Dye Injected (ml)	Number of Pumps in Service	Total System Flow (1000 gpm)	Effluent Concentration (ppb)
		(start)	(stop)				
11/17/09	11A	1014	1040	31.77	6	1110.0	0.29
11/17/09	11B	1051	1116	29.87	6	1110.0	0.30
11/17/09	12A	1341	1409	35.19	6	1110.0	0.30
11/18/09	12B	854	917	29.18	5	925.0	0.36
11/18/09	13A	930	953	29.27	5	925.0	0.36
11/18/09	13B	1021	1045	30.66	5	925.0	0.36
11/17/09	12A	1254	1301	8.80	6	1110.0	0.30
11/17/09	12A	1307	1315	10.05	6	1110.0	0.30
11/17/09	12A	1320	1320	7.54	6	1110.0	0.30
11/18/09	13B	1005	1005	12.77	5	925.0	0.36

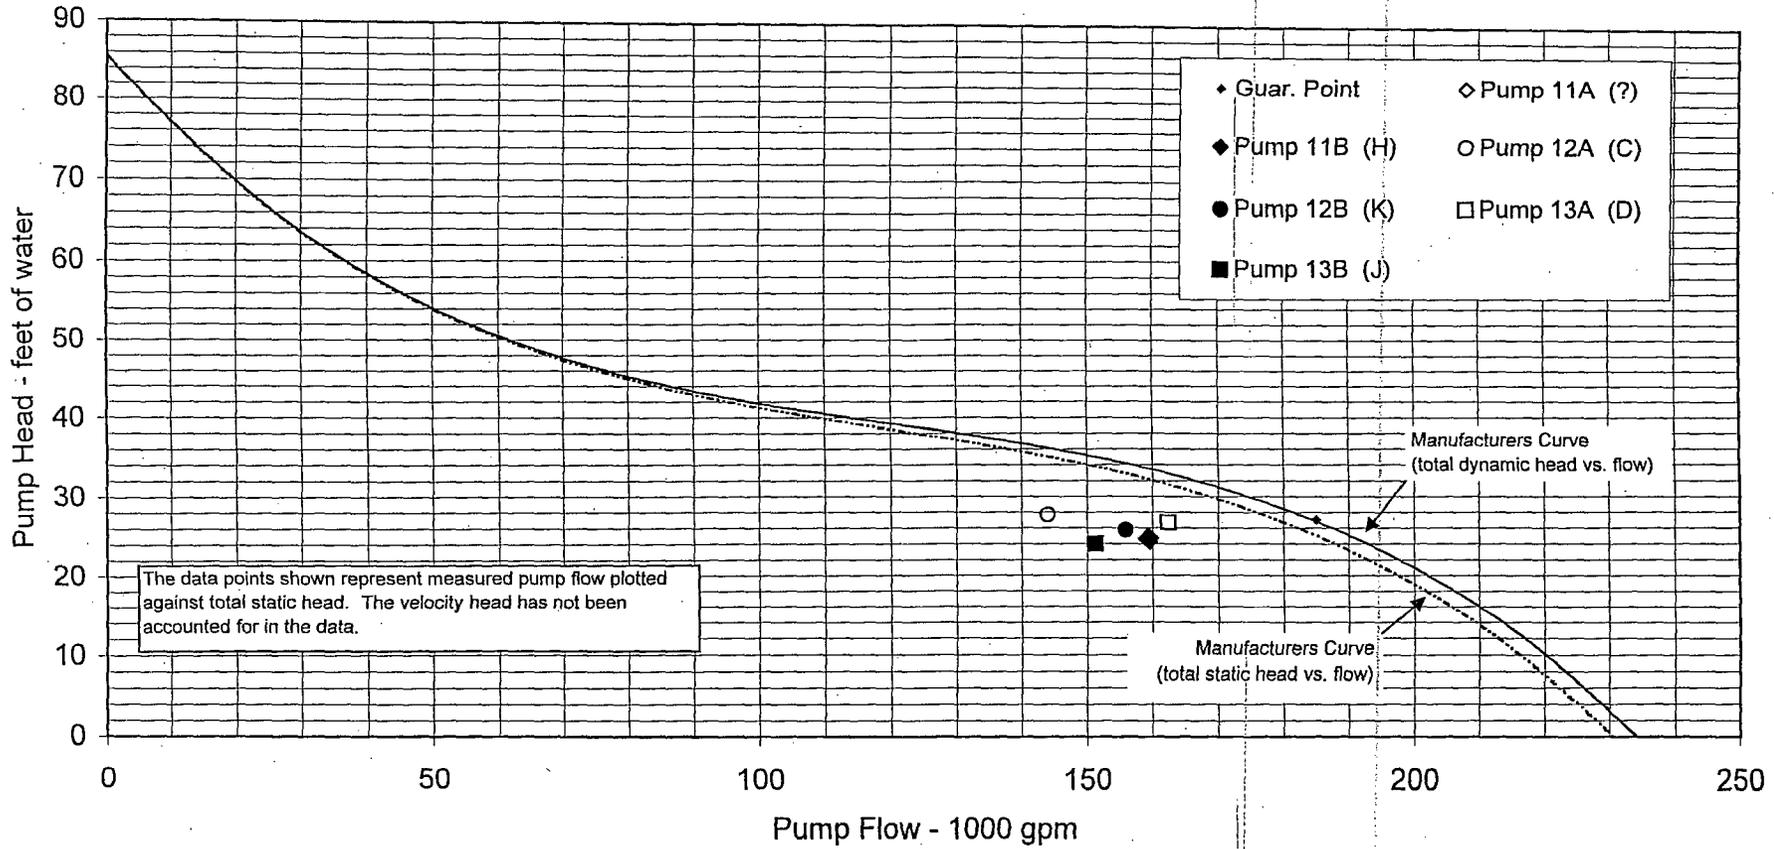
TEST METHOD

The circulating water flow rate was determined by fluorometry using MTS Mechanical Division Work Instruction TPG-19 Rev. 10 "Water Flow Using The Turner Fluorometer". Rhodamine WT dye was injected into the bell mouth of each pump using 1/2 inc PVC pipe with a carrier flow of screen wash water at 3 gallons per minute.

The dye was injected at a known rate using a peristaltic pump and a class A burette to measure rate. The diluted sample was retrieved and monitored by taking a sample from the inlet water box piping. The ratio of the injected concentration to the sample concentration multiplied by the injection flow rate yielded the circulator flow rate.

The total static head was obtained by measuring the pump suction head in feet from elevation

**Salem Generating Station - Unit No.2
Total Pump Head vs. Pump Flow**



New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: FACA – SW Outfall FACA
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/18/2009

856-339-1998

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACA SW Outfall FACA

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE		
Temperature, oC 00010 G Raw Sew/Influent	SAMPLE MEASUREMENT	*****	*****	*****	*****	12.7	14.8	DEG.C	0	CONTINUOUS	CONTIN		
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	REPORT 01DAMX		*****	*****	CONTINUOUS	CONTIN	
	QL	*****	*****		*****	*****	*****		*****	*****	*****	*****	
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	21.8	23.7	DEG.C	0	CONTINUOUS	CONTIN		
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	46.1 01DAMX		*****	*****	CONTINUOUS	CONTIN	
	QL	*****	*****		*****	*****	*****		*****	*****	*****	*****	
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	9.1	9.9	DEG.C	0	1/Day	CALCTD		
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01MOAV	15.3 01DAMX		*****	*****	1/Day	CALCTD	
	QL	*****	*****		*****	*****	*****		*****	*****	*****	*****	
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451	*****	PA 166			*****					
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		*****	REPORT Lab #	REPORT Lab #		REPORT Lab #	*****	*****	Not Applicable	NOT AP
	QL	*****	*****		*****	*****	*****		*****	*****	*****	*****	*****

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:
NJ0005622	Month	Day	Year	To	Month	Day	Year
	11	1	2009		11	30	2009
							FACB – SW Outfall FACB

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

<u>Robert C. Braun, Site Vice President - Salem</u>	<u>N/A</u>
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	<u>12/18/2009</u> <u>856-339-1998</u>
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACB SW Outfall FACB

1/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC 00010 G Raw Sew/Influent	SAMPLE MEASUREMENT	*****	*****		*****	12.7	14.8		0	CONTINUOUS	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****						
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	19.3	22.8		0	CONTINUOUS	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	46.1 01DAMX	DEG.C		Continuous	CONTIN
	QL	*****	*****		*****						
Temperature, oC 00010 2 Effluent Net Value	SAMPLE MEASUREMENT	*****	*****		*****	6.6	9.7		0	1/Day	CALCTD
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	15.3 01DAMX	DEG.C		1/Day	CALCTD
	QL	*****	*****		*****						
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****						

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: FACC – SW Outfall FACC
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:

PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:

PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:

PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE:

No Discharge this Monitoring Period

Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/18/2009

856-339-1998

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

FACC SW Outfall FACC

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATI

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant	SAMPLE MEASUREMENT	2340	2727	MGD	*****	*****	*****	*****	0	1/Day	CALCTD
50050 G Raw Sew/influent	PERMIT REQUIREMENT	3024 01MOAV	REPORT 01DAMX		*****	*****	*****				
	QL	*****	*****		*****	*****	*****				
Thermal Discharge	SAMPLE MEASUREMENT	12999	15964	MBTU/HR	*****	*****	*****	*****	0	1/Day	CALCTD
Million BTUs per Hr	PERMIT REQUIREMENT	REPORT 01MOAV	30600 01DAMX		*****	*****	*****				
00015 2 Effluent Net Value	QL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	17451	PA 166							
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #				
	QL	*****	*****		*****	*****	*****				

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:	
NJ0005622	<u>Month</u>	<u>Day</u>	<u>Year</u>	To	<u>Month</u>	<u>Day</u>	<u>Year</u>	048C – SW Outfall 48C
	11	1	2009		11	30	2009	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

<u>Robert C. Braun, Site Vice President - Salem</u>	<u>N/A</u>
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	<u>12/18/2009</u> <u>856-339-1998</u>
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

048C SW Outfall 48C

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.3209	0.8044	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****	1/Day	CALCTD	
	QL	*****	*****		*****	*****	*****		*****			
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	5	6	MG/L	0	2/MONTH	COMPOS	
	PERMIT REQUIREMENT	*****	*****		*****	*****	30 01MOAV		100 01DAMX	*****	2/Month	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Nitrogen, Ammonia Total (as N) 00610 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	1	1	MG/L	0	2/MONTH	COMPOS	
	PERMIT REQUIREMENT	*****	*****		*****	*****	35 01MOAV		70 01DAMX	*****	2/Month	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	<5	<5	MG/L	0	2/MONTH	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	10 01MOAV		15 01DAMX	*****	2/Month	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	16	18	MG/L	0	2/MONTH	COMPOS	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		50 01DAMX	*****	2/Month	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17457		PA166							
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		*****	REPORT Lab #	REPORT Lab #		REPORT Lab #	*****	Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****		*****	*****		

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the BPSP - Region 2 at (609)292-4680 or via email at "rosenwi@dep.state.nj.us".

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 481A – SW Outfall 481A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

<u>Robert C. Braun, Site Vice President - Salem</u>	<u>N/A</u>
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	<u>12/18/2009</u> <u>856-339-1998</u>
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

<u>N/A</u>	<u>N/A</u>	<u>N/A</u>	<u>N/A</u>
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

481A SW Outfall 481A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	498	504	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****	1/Day	CALCTD	
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	7.8	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	6.0 01DAMN	*****		9.0 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.0	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01DAMN	*****		REPORT 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE = N	*****	*****	%EFFL	0	CODE = N	CODE = N	
	PERMIT REQUIREMENT	*****	*****		*****	50 01DAMN	*****		*****	*****	2/Year	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE = N	CODE = N	MG/L	0	CODE = N	CODE = N	
	PERMIT REQUIREMENT	*****	*****		*****	*****	0.3 01MOAV		0.5 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		0.2 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

481A SW Outfall 481A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C	SAMPLE MEASUREMENT	*****	*****		*****	22.0	26.9		0	1/Day	CONTIN
00010 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	17451		PA 166						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
 Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 482A – SW Outfall 482A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
 PSE&G NUCLEAR LLC
 80 PARK PLAZA
 NEWARK, NJ 07101

LOCATION OF ACTIVITY:
 PSEG NUCLEAR LLC SALEM
 GENERATING STATION
 ALLOWAY CREEK NECK RD
 HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
 PSEG NUCLEAR LLC
 PO BOX 236/N21
 HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem N/A
 NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR GRADE AND REGISTRY NUMBER (IF APPLICABLE)
 12/18/2009 856-339-1998
 SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR DATE AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A N/A N/A N/A
 NAME AND TITLE SIGNATURE DATE AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

482A SW Outfall 482A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	463	471	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****		*****			
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	8.0	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	6.0 01DAMN	*****		9.0 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.0	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01DAMN	*****		REPORT 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
LC50 Statre 96hr Acu Cyprinodon TANGA 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE = N	*****	*****	%EFFL	0	CODE = N	CODE = N	
	PERMIT REQUIREMENT	*****	*****		*****	50 01DAMN	*****		*****	*****	2/Year	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	CODE = N	CODE = N	MG/L	0	CODE = N	CODE = N	
	PERMIT REQUIREMENT	*****	*****		*****	*****	0.3 01MOAV		0.5 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		0.2 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

482A SW Outfall 482A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, oC	SAMPLE MEASUREMENT	*****	*****		*****	21.6	24.6		0.	1/Day	CONTIN
00010 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MGA	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	17451		PA 166						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applicable	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT	MONITORING PERIOD						MONITORED LOCATION:
	Month	Day	Year	To	Month	Day	
NJ0005622	11	1	2009		11	30	2009
							483A – SW Outfall 483A

PERMITTEE:

PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:

PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:


PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/18/2009 856-339-1998
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:


FACILITY NAME:

NJ0005622

483A SW Outfall 483A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	452	460		*****	*****	*****		0	1/Day	CALCTD
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX	MGD	*****	*****	*****	*****		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****				
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		7.5	*****	7.9		0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	5.0 01DAMN	*****	9.0 01DAMX	SU		1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****		7.7	*****	8.0		0	1/Week	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	REPORT 01DAMN	*****	REPORT 01DAMX	SU		1/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****		*****	CODE = N	CODE = N		0	CODE = N	CODE = N
	PERMIT REQUIREMENT	*****	*****	*****	*****	0.3 01MOAV	0.5 01DAMX	MG/L		3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****		*****	<0.1	<0.1		0	3/Week	GRAB
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	0.2 01DAMX	MG/L		3/Week	GRAB
	QL	*****	*****		*****	*****	*****				
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	22.0	26.4		0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

483A SW Outfall 483A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Lab Certification #	SAMPLE MEASUREMENT	17327	17451		PA 166						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****				

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 484A – SW Outfall 484A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/18/2009 856-339-1998
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

484A SW Outfall 484A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATI

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	374	491	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****		*****			
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	7.9	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	6.0 01DAMN	*****		9.0 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.0	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01DAMN	*****		REPORT 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
LC50 Statre 96hr Acu Cyprinodon TAN6A 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	CODE=N	*****	*****	%EFFL	0	CODE=N	CODE=N	
	PERMIT REQUIREMENT	*****	*****		*****	50 01DAMN	*****		*****	*****	2/Year	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	0.3 01MOAV		0.5 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		0.2 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

IJ0005622

484A SW Outfall 484A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
Temperature, °C 0010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****		*****	19.3	27.5		0	1/Day	CONTIN
	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX	DEG.C		1/Day	CONTIN
	QI	*****	*****		*****	*****	*****				
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451		PA 166						
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	QI	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 485A - SW Outfall 485A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038


REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.

I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem	N/A
NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	GRADE AND REGISTRY NUMBER (IF APPLICABLE)
	12/18/2009 856-339-1998
SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR	DATE AREA CODE/PHONE NUMBER

*For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A	N/A	N/A	N/A
NAME AND TITLE	SIGNATURE	DATE	AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

485A SW Outfall 485A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATIN

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant	SAMPLE MEASUREMENT	318	446	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
50050 1 Effluent Gross Value	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****		1/Day	CALCTD
	QL	*****	*****		*****	*****	*****		*****			
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	7.9	SU	0	1/week	GRAB	
00400 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****		*****	6.0 01DAMN	*****		9.0 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
pH	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.0	SU	0	1/week	GRAB	
00400 7 Intake From Stream	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01DAMN	*****		REPORT 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
LC50 Statre 96hr Acu Cyprinodon	SAMPLE MEASUREMENT	*****	*****	*****	CODE = N	*****	*****	%EFFL	0	CODE = N	CODE = N	
TAN6A 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****		*****	50 01DAMN	*****		*****	*****	2/Year	COMPOS
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	0.1	<0.1	MG/L	0	3/week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	0.3 01MOAV		0.5 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		0.2 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

485A SW Outfall 485A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER	X SAMPLE MEASUREMENT	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
		*****	*****		*****	19.5	23.8				
Temperature, oC		*****	*****	*****	*****	19.5	23.8	DEG.C	0	1/Day	CONTIN
00010 1 Effluent Gross Value	PERMIT REQUIREMENT	*****	*****	*****	*****	REPORT 01MOAV	REPORT 01DAMX			1/Day	CONTIN
	GL	*****	*****		*****	*****	*****				
Lab Certification #	SAMPLE MEASUREMENT	17327	17451		PA 166						
99999 99 Lab	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	GL	*****	*****		*****	*****	*****				

Comments: The permittee is required to perform acute toxicity testing on a minimum of one representative CWS outfall while DSN 48C is being routed to that outfall.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 486A – SW Outfall 486A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/18/2009

856-339-1998

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

486A SW Outfall 486A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATION

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	301	422	MGD	*****	*****	*****	*****	0	1/Day	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****	1/Day	CALCTD	
	QL	*****	*****		*****	*****	*****		*****			
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.5	*****	7.8	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	6.0 01DAMN	*****		9.0 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
pH 00400 7 Intake From Stream	SAMPLE MEASUREMENT	*****	*****	*****	7.7	*****	8.0	SU	0	1/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	REPORT 01DAMN	*****		REPORT 01DAMX	*****	1/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 1	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	0.5 01MOAV		0.5 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Chlorine Produced Oxidants *CPOX 1 Effluent Gross Value Option 2	SAMPLE MEASUREMENT	*****	*****	*****	*****	<0.1	<0.1	MG/L	0	3/Week	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		0.2 01DAMX	*****	3/Week	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****		
Temperature, oC 00010 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	19.6	26.0	DEG.C	0	1/Day	CONTIN	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		REPORT 01DAMX	*****	1/Day	CONTIN
	QL	*****	*****		*****	*****	*****		*****	*****		

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

486A SW Outfall 486A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATING

PARAMETER	X	QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE
		SAMPLE MEASUREMENT	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #				
Lab Certification #		17327	17451		PA 166						
99999 99 Lab		REPORT Lab #	REPORT Lab #		REPORT Lab #	REPORT Lab #	REPORT Lab #			Not Applic	NOT AP
	GL										

Comments: Any questions in regards to the monitoring report form can be directed to S. Rosenwinkel of the BPSP - Region 2 at (609)292-4860.

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 487B – SW Outfall 487B
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/18/2009

856-339-1998

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

New Jersey Department of Environmental Protection
Division of Water Quality

Surface Water Discharge Monitoring Report Submittal Form

NJPDES PERMIT NJ0005622	MONITORING PERIOD						MONITORED LOCATION: 489A – SW Outfall 489A
	Month 11	Day 1	Year 2009	To	Month 11	Day 30	

PERMITTEE:
PSE&G NUCLEAR LLC
80 PARK PLAZA
NEWARK, NJ 07101

LOCATION OF ACTIVITY:
PSEG NUCLEAR LLC SALEM
GENERATING STATION
ALLOWAY CREEK NECK RD
HANCOCKS BRIDGE, NJ 08038

REPORT RECIPIENT:
PSEG NUCLEAR LLC
PO BOX 236/N21
HANCOCKS BRIDGE, NJ 08038

REGION / COUNTY: Southern / Salem County

CHECK IF APPLICABLE: No Discharge this Monitoring Period Monitoring Report Comments Attached

WHO MUST SIGN The highest ranking official having day-to-day managerial and operational responsibilities for the discharging facility shall sign the certification or, in his absence a person designated by that person. For a local agency, the highest ranking operator of the treatment works shall sign the certification. Where the highest ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall also sign the second certification at the bottom of this page. If the local agency has contracted with another entity to operate the treatment works, the highest-ranking official of the contracted entity shall sign the certification.


I certify under penalty of law that I have personally examined and am familiar with the information submitted in this document and all attachments, and that, based on my inquiry of those individuals immediately responsible for obtaining the information, I believe that the information is true, accurate and complete. I am aware that there are significant penalties for submitting false information, including the possibility of and/or imprisonment, pursuant to N.J.A.C. 7:14A-6.9(B). The New Jersey water Pollution Control Act provides for penalties up to \$50,000 per violation.

Robert C. Braun, Site Vice President - Salem

N/A

NAME AND TITLE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

GRADE AND REGISTRY NUMBER (IF APPLICABLE)



12/18/2009

856-339-1998

SIGNATURE OF PRINCIPAL EXECUTIVE OFFICER, AUTHORIZED AGENT, OR *LICENSED OPERATOR

DATE

AREA CODE/PHONE NUMBER

**For a local agency where the highest-ranking operator does not have the ability to authorize capital expenditures and hire personnel, a person having that responsibility or person designated by that person shall sign the following certification:*

I certify under penalty of law and in accordance with N.J.S.A. 58:10A-6F(5) that I have reviewed the attached discharge monitoring reports.

N/A

N/A

N/A

N/A

NAME AND TITLE

SIGNATURE

DATE

AREA CODE/PHONE NUMBER

PERMIT NUMBER:

MONITORED LOCATION:

MONITORING PERIOD:

FACILITY NAME:

NJ0005622

489A SW Outfall 489A

11/1/09 TO 11/30/09

PSEG NUCLEAR LLC SALEM GENERATI

PARAMETER		QUANTITY OR LOADING		UNITS	QUALITY OR CONCENTRATION			UNITS	NO. EX.	FREQ. OF ANALYSIS	SAMPLE TYPE	
Flow, In Conduit or Thru Treatment Plant 50050 1 Effluent Gross Value	SAMPLE MEASUREMENT	0.0408	0.0408	MGD	*****	*****	*****	*****	0	1/MONTH	CALCTD	
	PERMIT REQUIREMENT	REPORT 01MOAV	REPORT 01DAMX		*****	*****	*****		*****	1/Month	CALCTD	
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
pH 00400 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7.2	*****	7.2	SU	0	1/MONTH	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	8.0 01DAMN	*****		9.0 01DAMX	*****	1/Month	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Solids, Total Suspended 00530 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	7	7	*****	MG/L	0	1/MONTH	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	100 01DAMX	30 01MOAV		*****	*****	1/Month	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Petroleum Hydrocarbons 00551 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	<5	<5	MG/L	0	1/MONTH	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	10 01MOAV		15 01DAMX	*****	1/Month	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Carbon, Tot Organic (TOC) 00680 1 Effluent Gross Value	SAMPLE MEASUREMENT	*****	*****	*****	*****	6	6	MG/L	0	1/MONTH	GRAB	
	PERMIT REQUIREMENT	*****	*****		*****	*****	REPORT 01MOAV		50 01DAMX	*****	1/Month	GRAB
	QL	*****	*****		*****	*****	*****		*****	*****	*****	
Lab Certification # 99999 99 Lab	SAMPLE MEASUREMENT	17327	17451	*****	PA166			*****				
	PERMIT REQUIREMENT	REPORT Lab #	REPORT Lab #		*****	REPORT Lab #	REPORT Lab #		REPORT Lab #	*****	Not Applic	NOT AP
	QL	*****	*****		*****	*****	*****		*****	*****	*****	

Comments: If there are any questions in regards to the monitoring report form, please contact Susan Rosenwinkel of the the BPSP - Region 2 at (609)292-4860 or via email at "srosenwi@dep.state.nj.us".