ISI-27193 Sht 2 ISI-27193 Sht 2

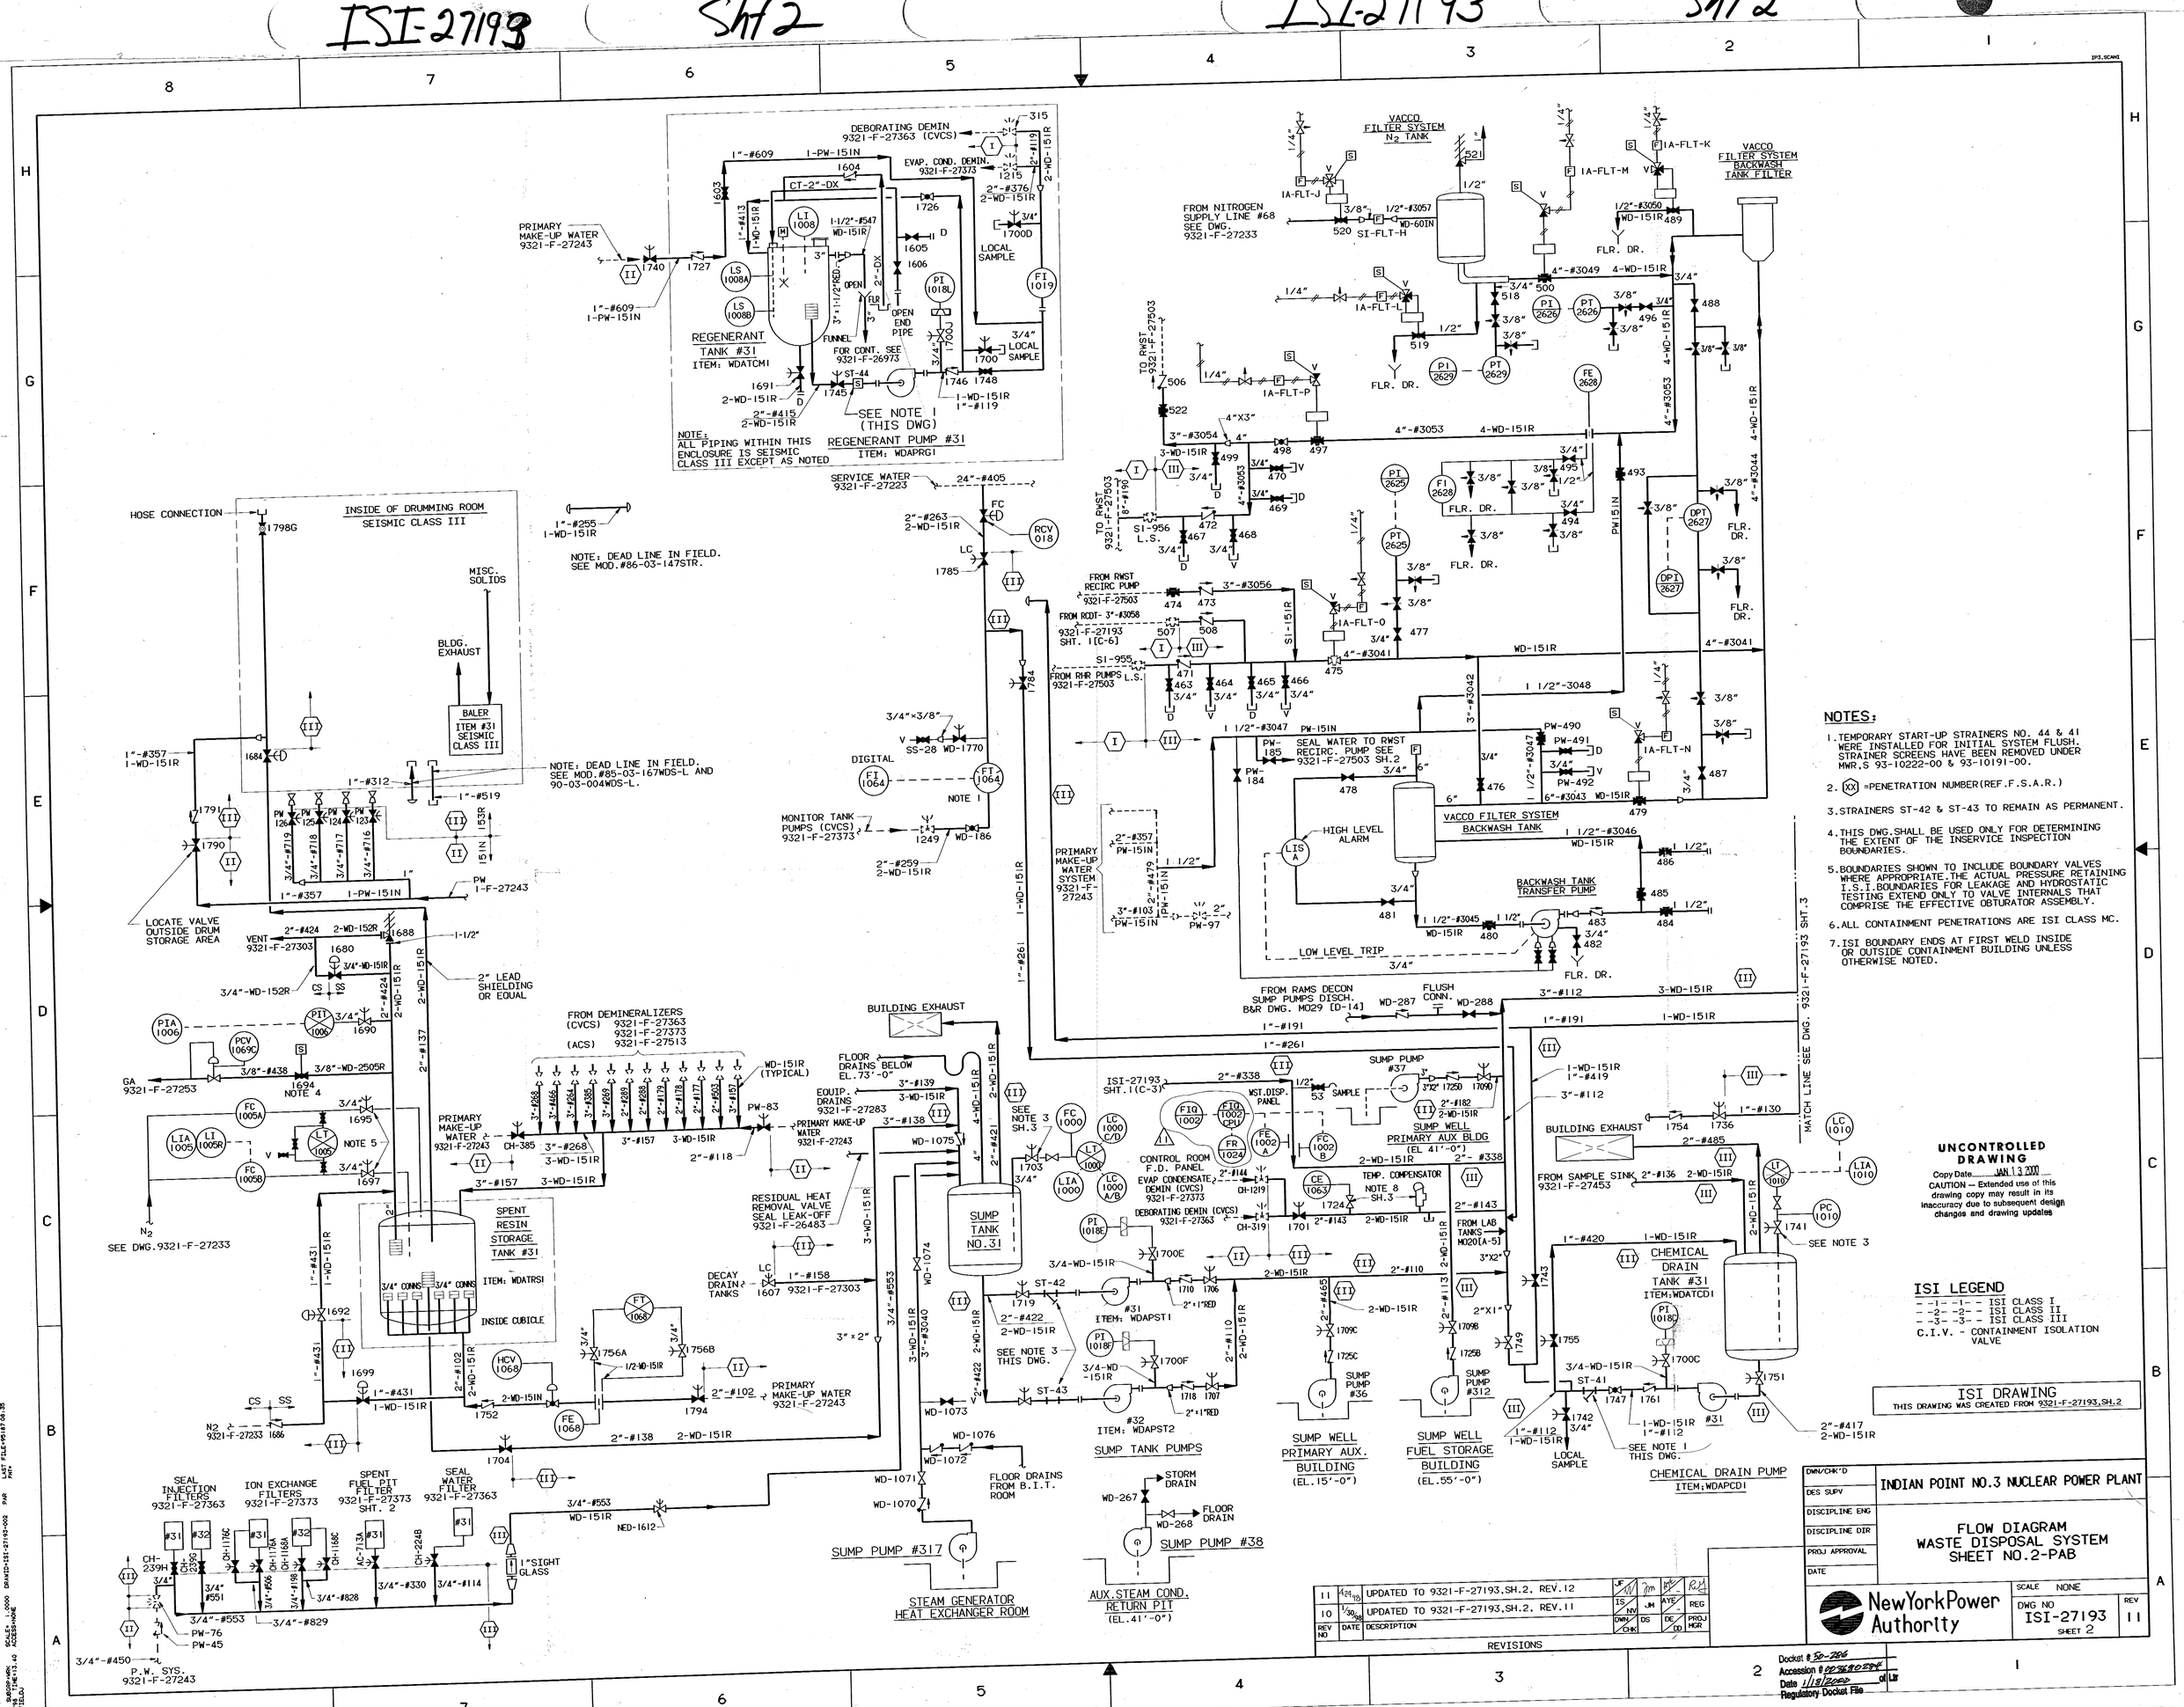

NOTES:

1. TEMPORARY START-UP STRAINERS NO. 44 & 41 WERE INSTALLED FOR INITIAL SYSTEM FLUSH. STRAINER SCREENS HAVE BEEN REMOVED UNDER MWR.S 93-10222-00 & 93-10191-00.
2. (XX) =PENETRATION NUMBER(REF.F.S.A.R.)
3. STRAINERS ST-42 & ST-43 TO REMAIN AS PERMANENT.
4. THIS DWG.SHALL BE USED ONLY FOR DETERMINING THE EXTENT OF THE INSERVICE INSPECTION BOUNDARIES.
5. BOUNDARIES SHOWN TO INCLUDE BOUNDARY VALVES WHERE APPROPRIATE.THE ACTUAL PRESSURE RETAINING I.S.I.BOUNDARIES FOR LEAKAGE AND HYDROSTATIC TESTING EXTEND ONLY TO VALVE INTERNALS THAT COMPRISE THE EFFECTIVE OBTURATOR ASSEMBLY.
6. ALL CONTAINMENT PENETRATIONS ARE ISI CLASS MC.
7. ISI BOUNDARY ENDS AT FIRST WELD INSIDE OR OUTSIDE CONTAINMENT BUILDING UNLESS OTHERWISE NOTED.

UNCONTROLLED DRAWING

Copy Date JAN 13 2000

CAUTION -- Extended use of this drawing copy may result in its inaccuracy due to subsequent design changes and drawing updates

ISI LEGEND

- -1- -1- - ISI CLASS I
- -2- -2- - ISI CLASS II
- -3- -3- - ISI CLASS III

C.I.V. - CONTAINMENT ISOLATION VALVE

ISI DRAWING

THIS DRAWING WAS CREATED FROM 9321-F-27193,SH.2

REV NO	DATE	DESCRIPTION	DWN	CHK	DS	DE	PROJ MGR
11	4/24/98	UPDATED TO 9321-F-27193,SH.2. REV.12	JF				
10	1/30/98	UPDATED TO 9321-F-27193,SH.2. REV.11	IS	JM	AYE		REG

REVISIONS

DWN/CHK'D
DES SUPV
DISCIPLINE ENG
DISCIPLINE DIR
PROJ APPROVAL
DATE

INDIAN POINT NO.3 NUCLEAR POWER PLANT

FLOW DIAGRAM
WASTE DISPOSAL SYSTEM
SHEET NO.2-PAB

NewYorkPower Authority

SCALE NONE
DWG NO ISI-27193 SHEET 2
REV 11

Docket # 50-286
Accession # 00010294
Date 1/18/2000
Regulatory Docket File