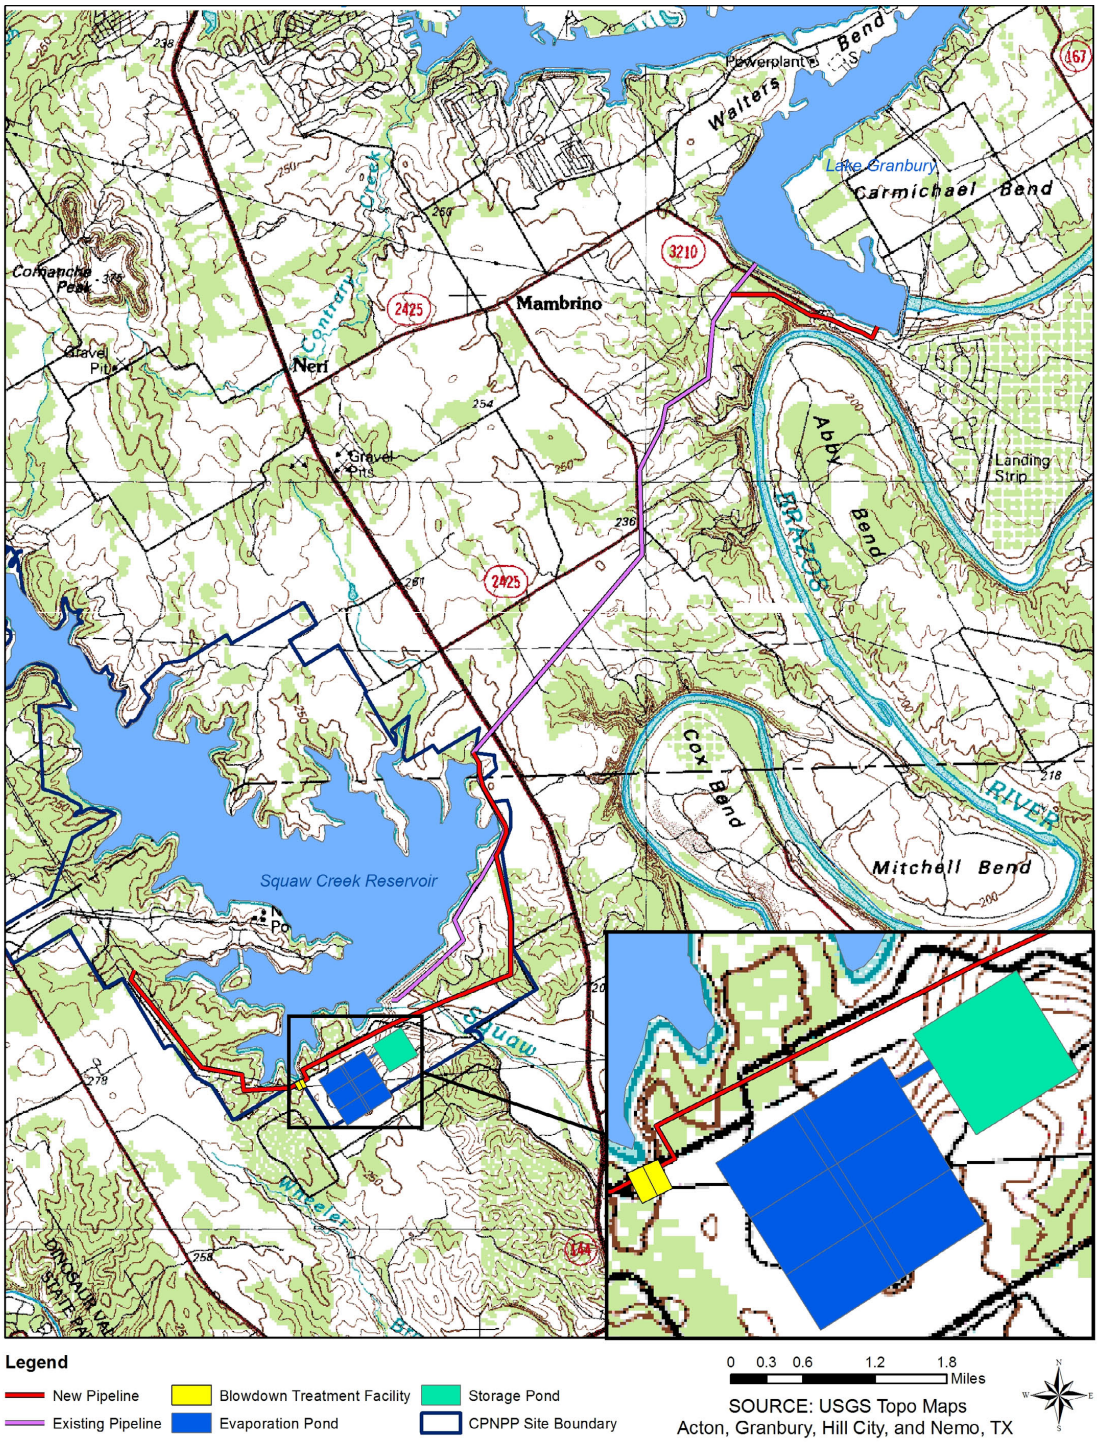

Figure 1.1-4 Off-site Cooling Water Pipelines