


**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 3 - Environmental Report**

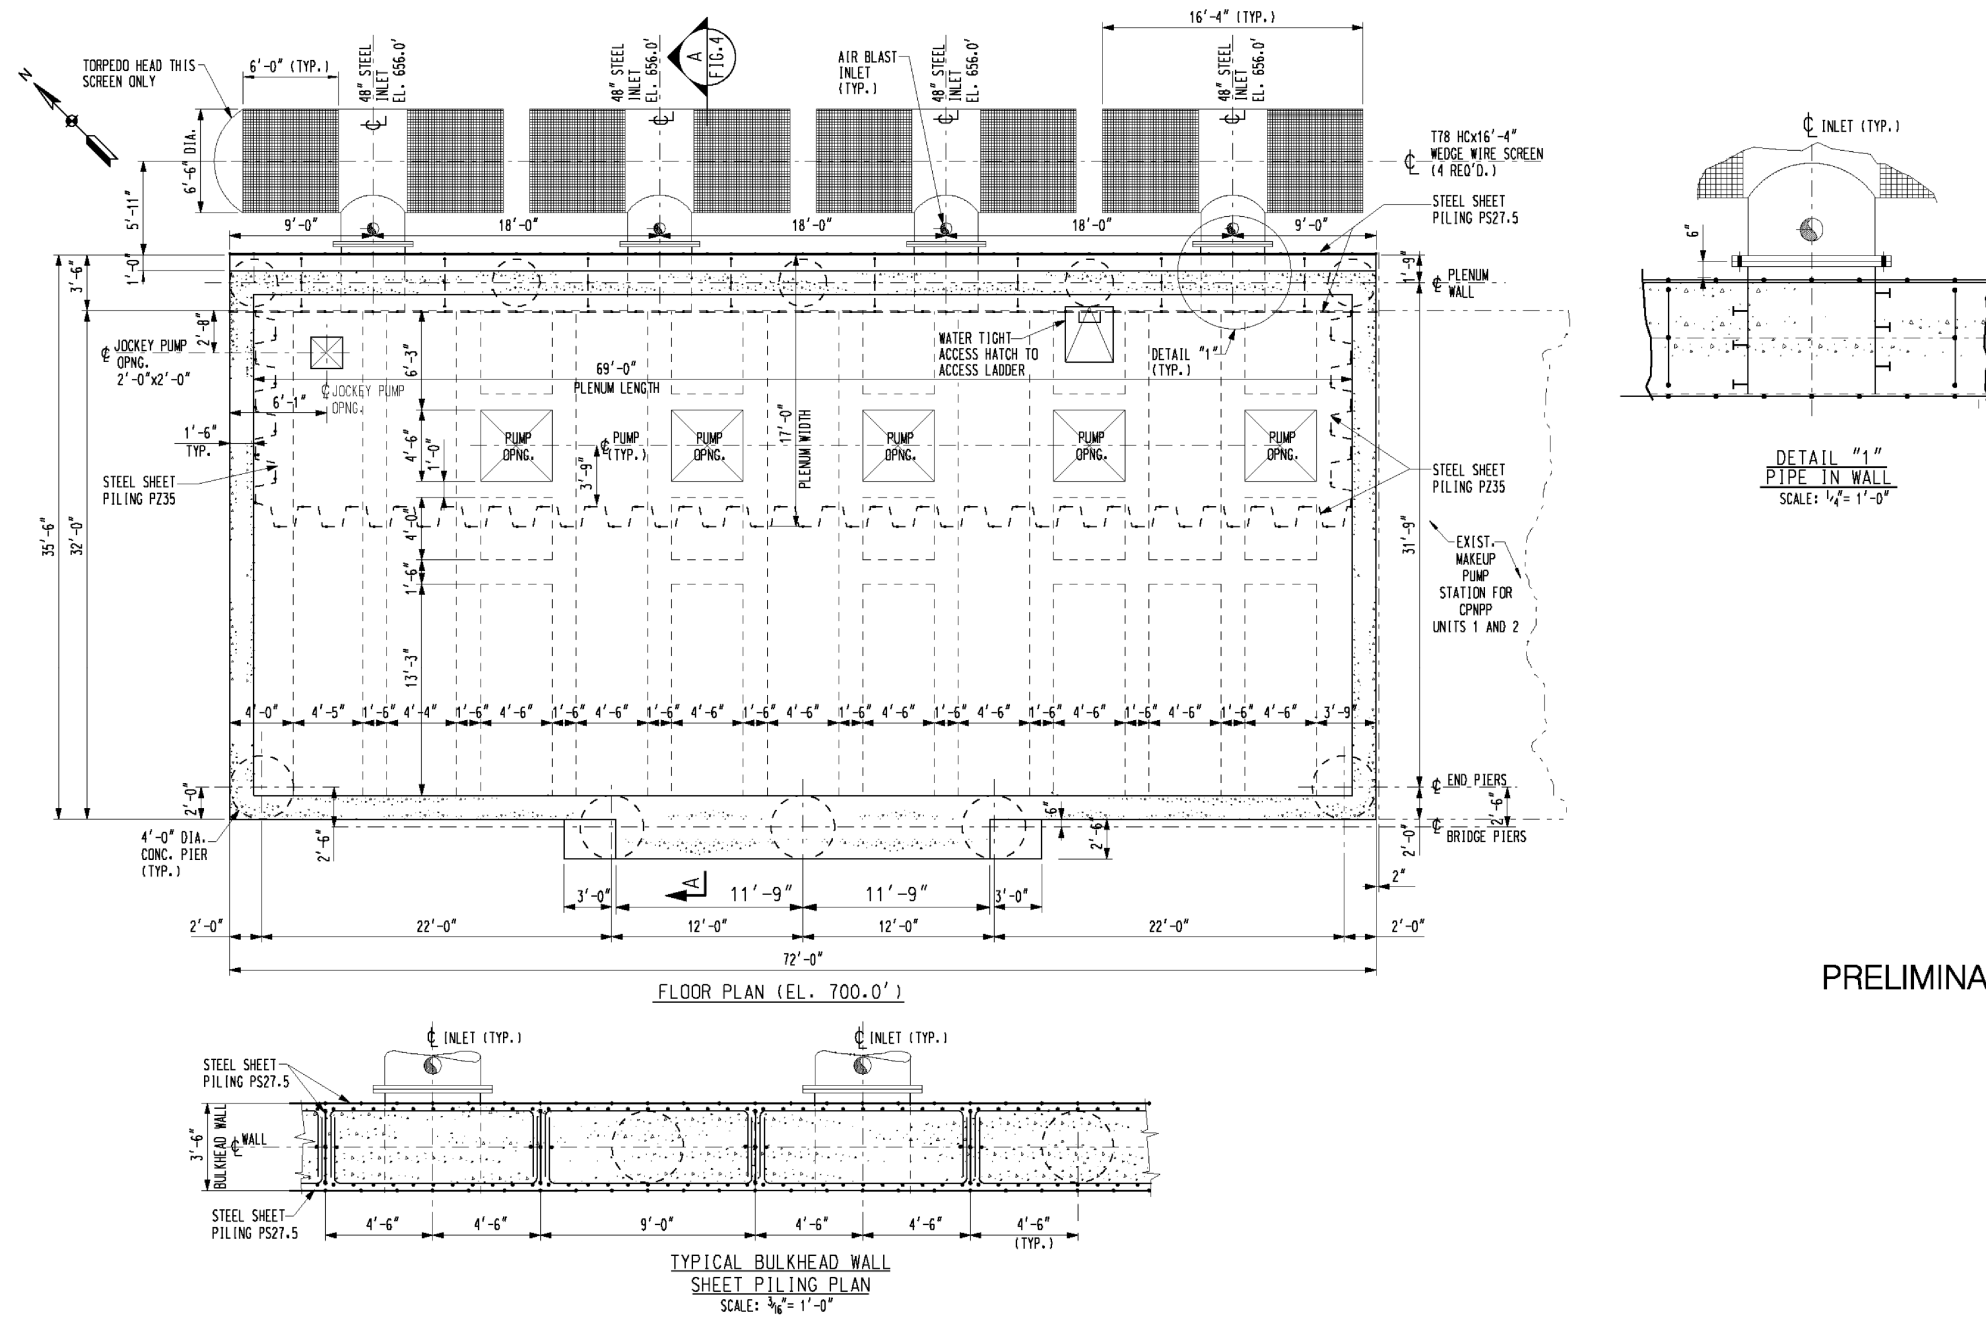

PRELIMINARY

Figure 3.4-4 Makeup Water Intake Structure