


Comanche Peak Nuclear Power Plant, Units 3 & 4 **COL Application** **Part 3 - Environmental Report**

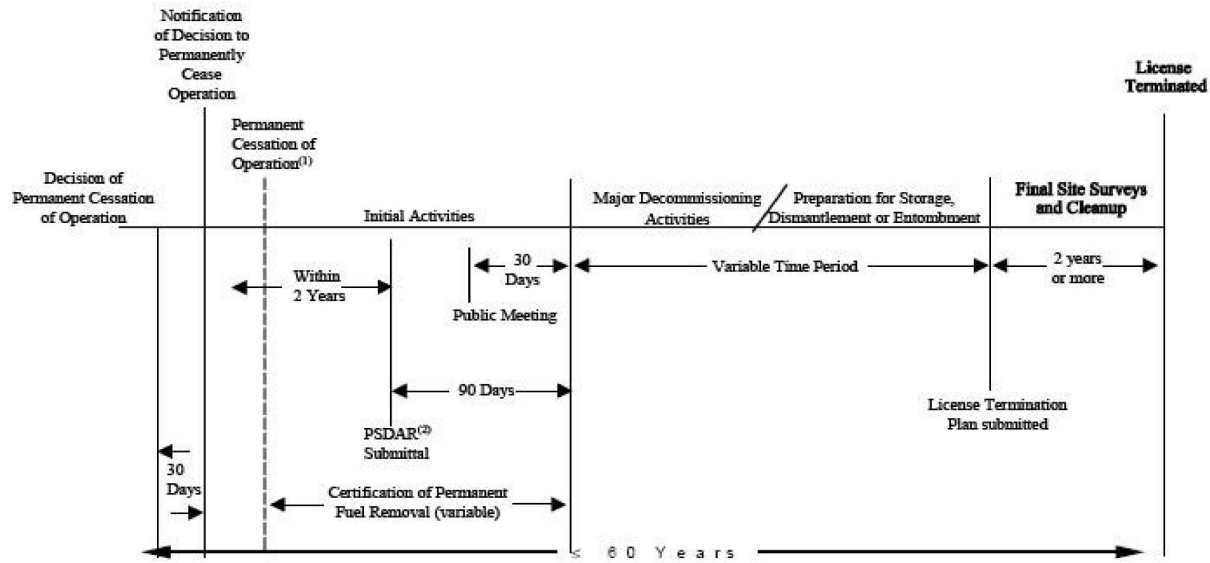

- (1) The cessation of operations may occur before, concurrent with, or following the certification to permanently cease operations.
 (2) The PSDAR may be submitted before permanent cessation of operations.

Figure 5.9-1 Decommissioning Timeline