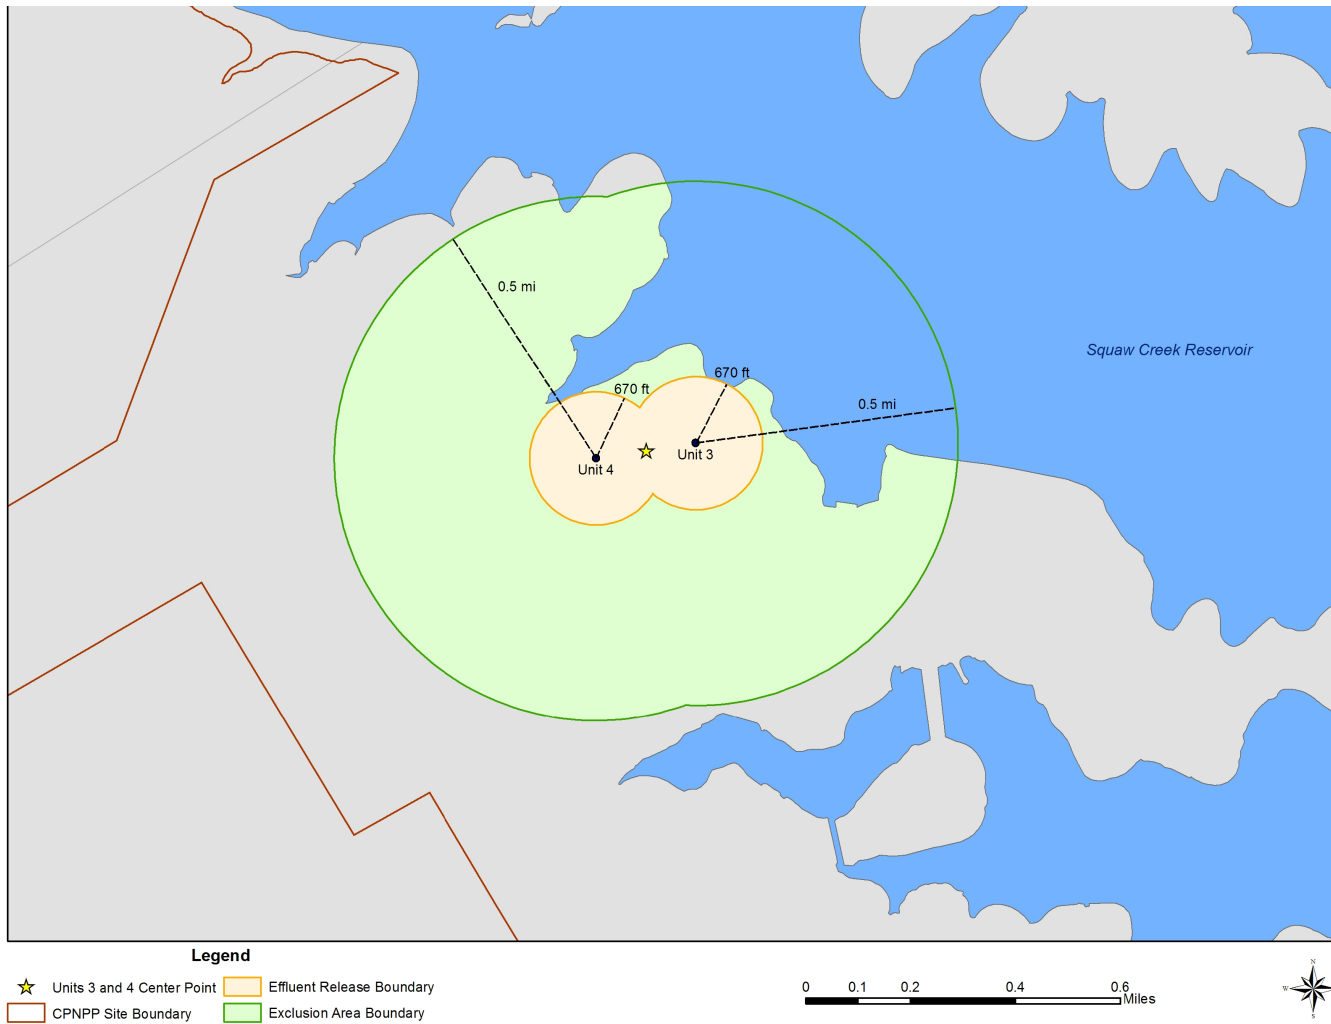


**Comanche Peak Nuclear Power Plant, Units 3 & 4  
COL Application  
Part 2, FSAR**



**Figure 2.1-205 Distance to the Exclusion Area Boundary (EAB)**