

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

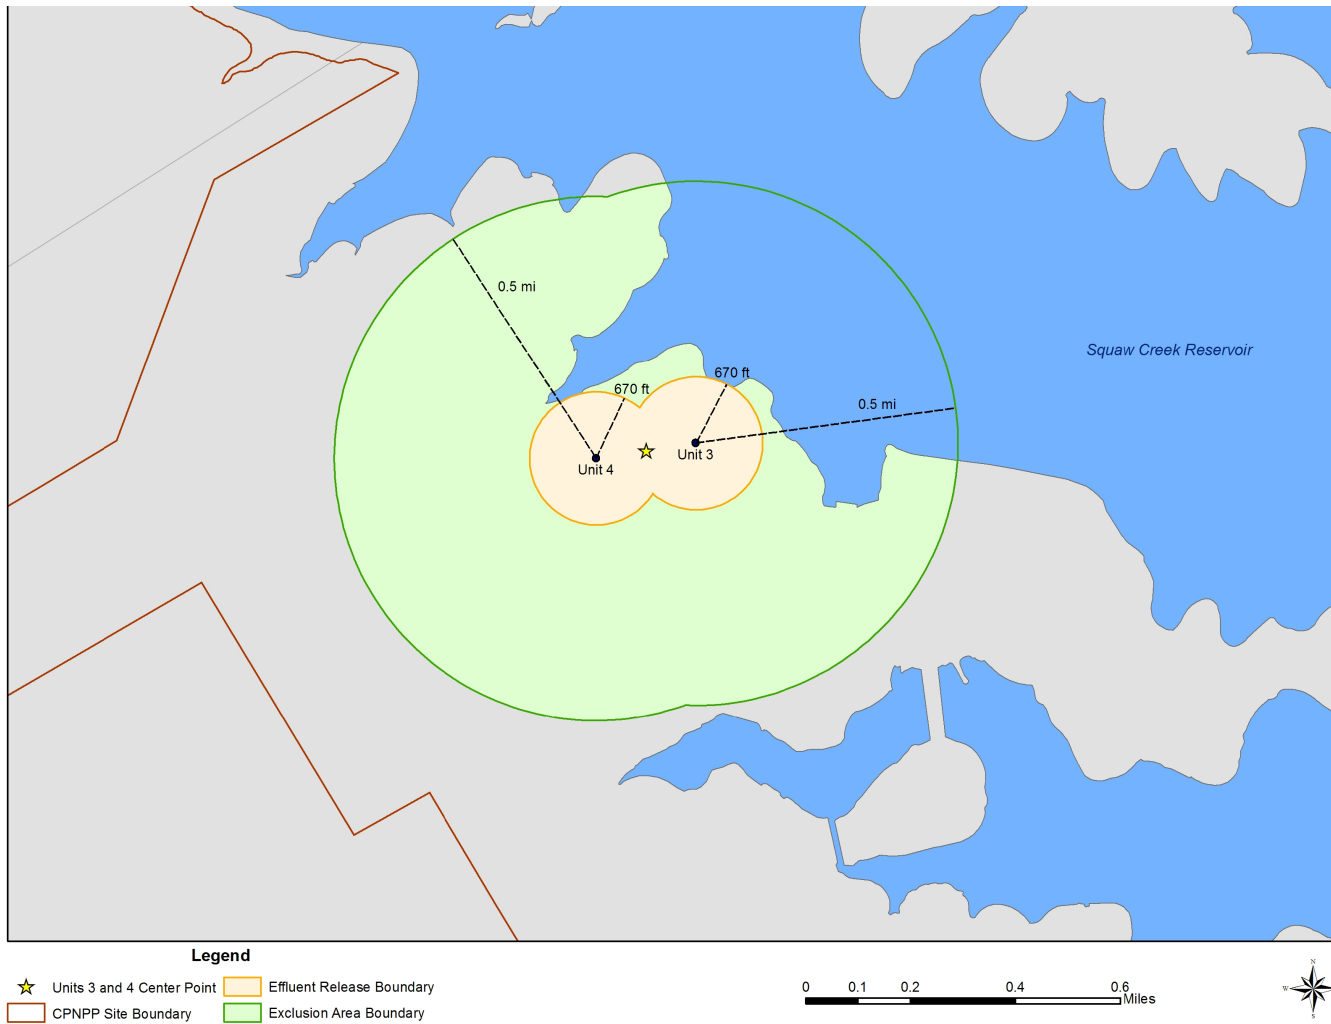


Figure 2.1-205 Distance to the Exclusion Area Boundary (EAB)