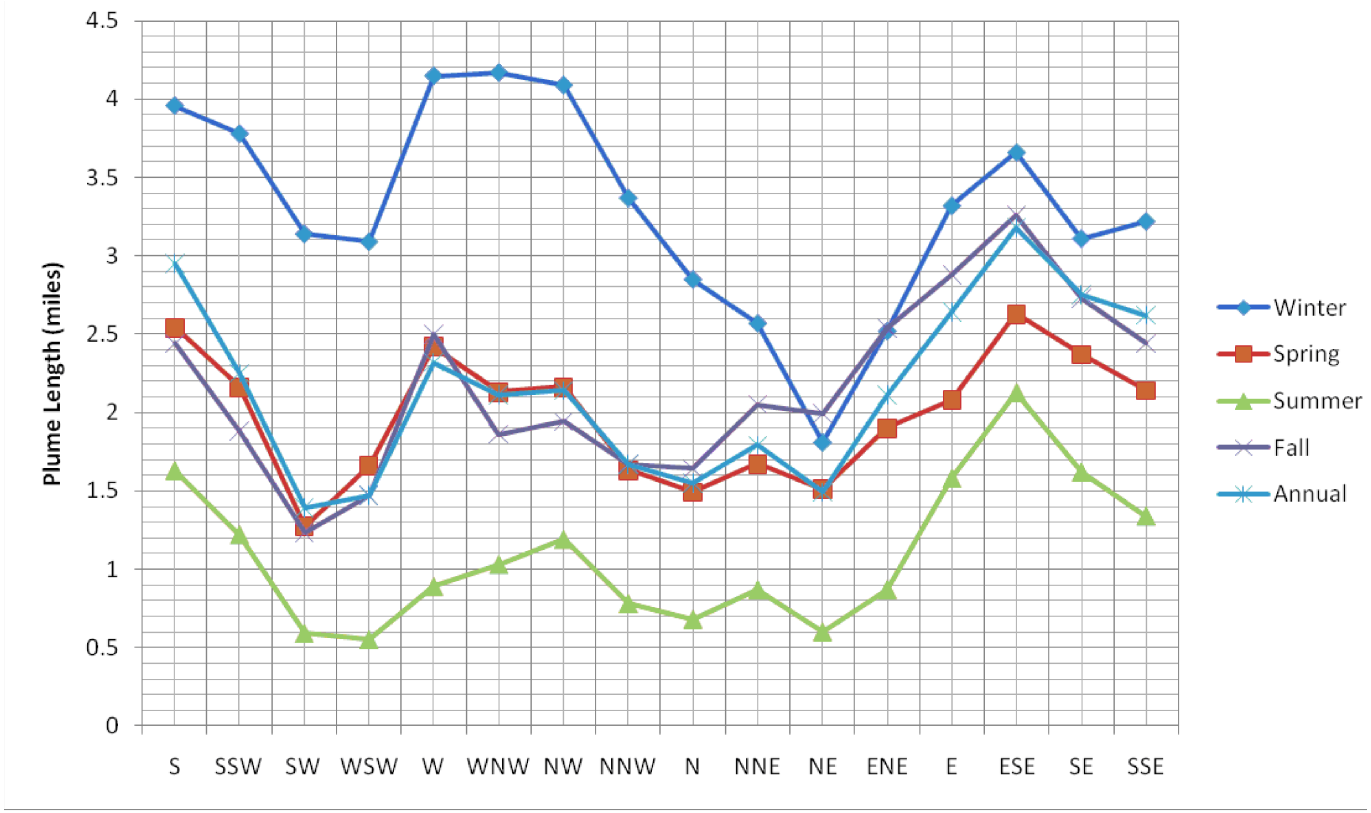

Figure 2.3-372 CPNPP Cooling Tower Seasonal Visible Plume Length