

**Comanche Peak Nuclear Power Plant, Units 3 & 4
COL Application
Part 2, FSAR**

Annual Hours of Rime Ice

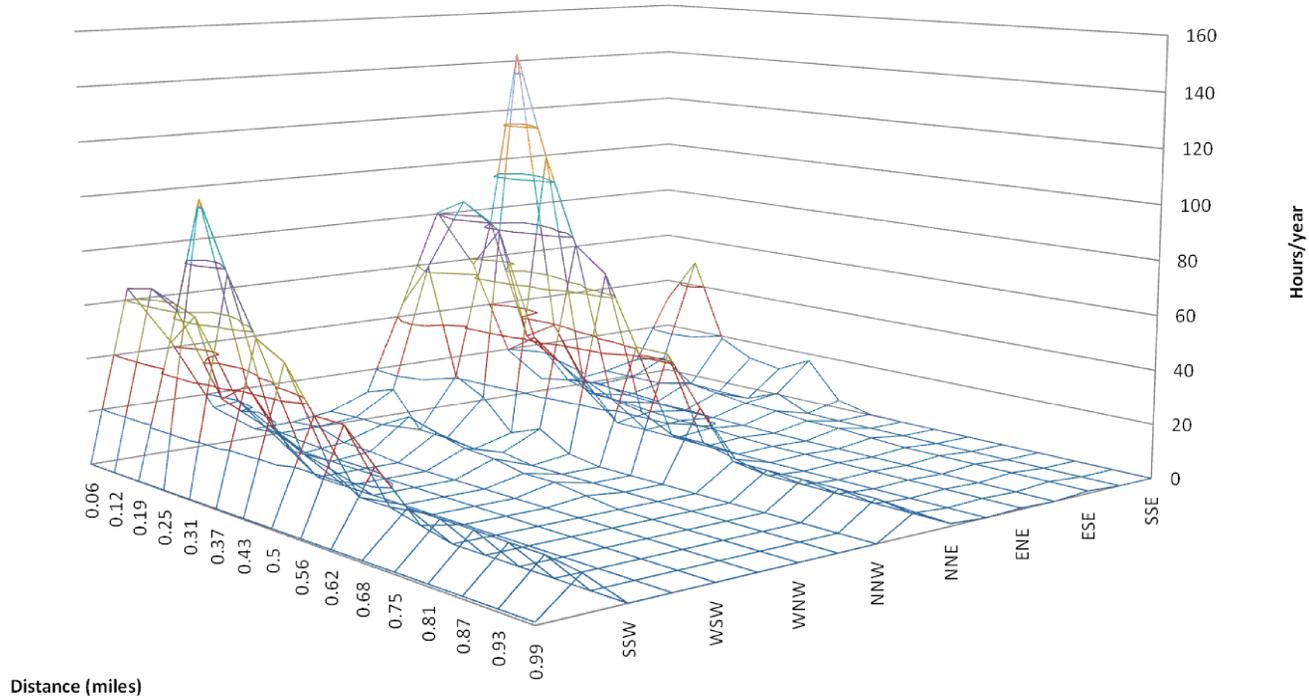


Figure 2.3-378 CPNPP Cooling Tower Annual Hours per Year Rime Icing